ComfortVu™ BACnet Thermostat Model Standard TB-24 (24 Vac)



Installation and Operation Guide



Verify that you have the most current version of this document from **www.hvacpartners.com**, the **Carrier Partner Community** website, or your local Carrier office.

Important changes are listed in **Document revision history** at the end of this document.

©2024 Carrier. All rights reserved.



Contents

Overview	1
Specifications	2
TBPL-24-H Dimensions	4
Technician Settings Index	
Operating Instructions	
Quick Guide	
Turning the thermostat ON and OFF	
Selecting temperature scale	
Adjusting the Setpoint temperature	
Selecting system mode	
Selecting fan speed (for 2 and 3 fan speeds configuration)	
Turning Auto fan ON or OFF (fan on demand)	10
Locking the thermostat buttons	
Economy mode	
Freeze Protection	
Economizer	
Weekly program	14
MAC Address and BACnet Device Instance Number	19
Installation	
General	
Wiring terminals	
DIP switch and jumper configurations	
AC configurations	
FC configurations for 2-pipe systems	
FC configurations for 4-pipe systems / Floor heating	
Wiring and DIP switch/jumper configurations 1 to 4 – AC systems	
Wiring and DIP switch/jumper configurations 5 to 7 - AC systems	
Wiring and DIP switch/jumper configurations 8 to 9 – AC systems	
Wiring and DIP switch/jumper configurations 10 to 13 - FC systems - 2-pipe	
Wiring and DIP switch configurations 18 to 21 – FC systems - 4-pipe	
Wiring and DIP switch/jumper configuration 22 – FC systems - 4-pipe	
Technician Settings	
Technician Settings P01 to P03	
Technician Settings P04 to P07	
Technician Settings P08 to P10	
Technician Settings P11 to P15	
Technician Settings P16 to P25	
Technician Settings P26 to P30	
Technician Settings P31 to P34	39
Technician Settings P35 to P42	
Technician Settings P43 to P44	
Technician Settings P45 to P46	
Technician Settings P47 to P48	
Technician Settings P49 to P51	
Technician Settings P52 to P57	
Technician Settings P65 to P70	
Technician Settings P65 to P70 Technician Settings P71 to P75	
Technician Settings P76 to P79	

Contents

Technician Settings P83 to P88	50
Technician Settings P89 to P99	
Technician Settings P101 to P109	
Technician Settings P114 to P119	
Technician Settings P122 to P187	
Alarms and indications	
Document revision history	

Overview

The Carrier Corporation ComfortVu™ BACnet Thermostat Model TB-24 can be used:

- As a stand-alone thermostat that can control equipment using built-in logic
- As part of an MS/TP network of BACnet Thermostats that can be managed from a BMS front-end system
- As part of a BACnet MS/TP network connected to the Carrier Corporation BACnet router in a i-Vu® system. The
 router's control programs provide trending and alarming of the BACnet Thermostat's data.

The TB-24 thermostat has a white plastic enclosure with an LCD display and buttons for user control. It has on-board temperature sensing, and its on-board inputs and outputs are used to control equipment and optional external sensing devices. Inputs and outputs are configured using DIP switches and jumpers. The TB-24 thermostat requires 24 Vac power.

Specifications

Sensing element:	Range	Accuracy								
Temperature	41° F to 95° F (5° C to 35° C)	±1.0° F (0.5° C)								
Power	24 Vac ±15%: 4VA unit, 76 VA ful	24 Vac ±15%: 4VA unit, 76 VA full load								
	NOTE Devices connected to outp requirements.	outs, such as a fan, will increase VA								
Communication	BACnet MS/TP with baud rates up to 76.8 kbps (default baud rate is 38.4 kbps), detected and set automatically by the BACnet Thermosta Max 127 devices.									
Inputs	T1, 0 - Normally open or normally	y closed dry contract, or								
	0-10 Vdc analog input, or									
	50 kOhm thermistor @ 25°C									
	A, B - Communication +/- (RS485	A, B - Communication +/- (RS485)								
	IN1, 0 - Normally open or Normally closed dry contract, or									
	0-10 Vdc analog input, or									
	50 kOhm thermistor @ 25 ° C									
	C, R - Power: 24 Vac									
Outputs	11, 12, 13 - Digital outputs, 3A n	max.								
	 14 - Digital outputs 0.3A max 15 and 16 - Depends on applica Digital output 0.3A max., or Analog output 0-10 Vdc, 5 mA 									
Environmental operating range	50° to 122° F (10° to 50° C), 10 condensing	0 to 90% relative humidity, non-								
Mounting	4" x 2" electrical box using the	unt the included wallplate to a standard e two larger mounting screws, then wallplate using the three smaller								
	 If not using an electrical box, wallplate needed). 	flush-mount thermostat to wall (no								
Weight	4.8 oz (0.14 kg)									

Compliance

United States of America:

FCC CFR47, Chapter 1, Subchapter A, Part 15, Class B


Canada:

Industry Canada Compliant, ICES-003, Class B

Europe:

C € Mark, Low Voltage Directive: 2014/35/EU RoHS Compliant: 2011/65/EU

Australia and New Zealand:




Title 24 compliant if connected to a BMS with custom programming for economizer fault detection.

CA Prop 65 Warning: This product can expose you to chemicals including Styrene and 1,3

- Propane sultone, which are known to the State of California to cause cancer. For more information, go to www.p65warnings.ca.gov.

TBPL-24-H Dimensions

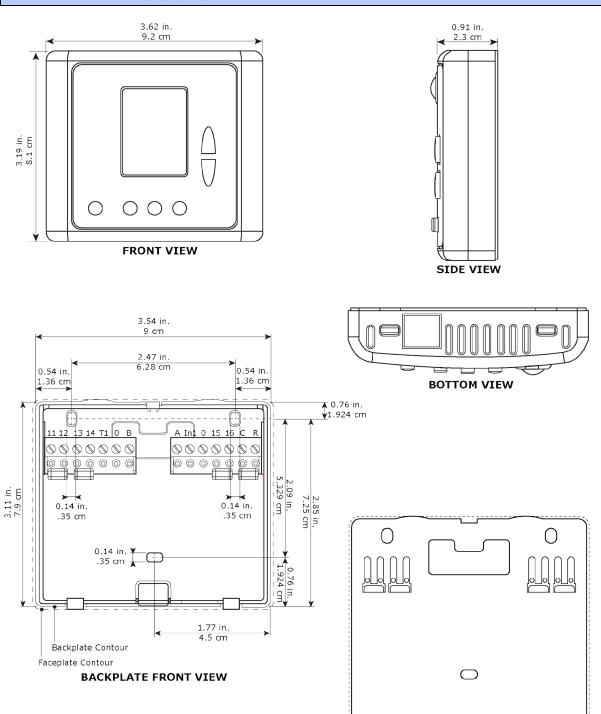

REAR VIEW

Technician Settings Index


P01 - Offset for temperature readings calibration	P40 - View filter counter (hours) - Read only
P02 – Set point limit for cooling	P41 - Reset filter time
P03 – Set point limit for heating	P42 – Adjust filter alarm delay counter (hours)
P04 - Lock the [Fan] button	P43 – Soft start in heat – cut-in temperature
P05 - Lock the [Mode] button	P44 - Soft start in heat - cut-out temperature
P06 - Lock the [On/Off] button	P45 - Cool differential band
P07 - Lock the [+] and [-] buttons (Set buttons)	P46 - Cool differential band offset
P08 - Functionality of T1 terminals	P47 - Heat differential band
P09 - Functionality of IN1,0 terminals	P48 - Heat differential band offset
P10 - Window contact (terminals IN1,0) polarity	P49 - Shift between Cool and Heat in Auto mode
P11 - Window contact delay time	P50 - Shift between Cooling stages
P12 - Door switch (terminals T1,0) polarity	P51 - Shift between Heating stages
P13 - Door switch delay time	P52 - Cool valve proportional band
P14 - Enable/Disable Auto change over mode	P53 - Cool proportional low limit
P15 - Occupancy sensor logic (PIR)	P54 - Cool proportional high limit
P16 - Enable/Disable Occupancy sensor	P55 - Heat valve proportional band
P17 - PIR (occupancy sensor) delay time	P56 - Heat proportional low limit
P18 – Door switch or key tag configuration	P57 - Heat proportional high limit
P19 - PIR (Occupancy sensor) polarity	P60 - Proportional ON percent
P25 – Economy set point for cooling	P61 - Proportional OFF percent
P26 – Economy set point for heating	P63 – Time on-delay between cooling stages
P27 - On-delay time on-delay between heating stages	P64 – Time off-delay between cooling stages
P28 - Off-delay time between heating stages	P65 – Fan VFS proportional band in cooling
P30 - Beeper ON or OFF	P66 – Fan VFS proportional band in heating
P31 – Fan ON delay in cooling	P67 - Fan VFS Low speed percent in cooling
P32 – Fan OFF delay in cooling	P68 – Fan VFS Medium speed percent in cooling
P33 - Fan ON delay in heating	P69 - Fan VFS High speed percent in cooling
P34 – Fan OFF delay in heating	P70 - Fan VFS Low speed percent in heating
P35 - Enable/Disable Freeze protection	P71 - Fan VFS Medium speed percent in heating
P36 - Freeze protection cut-in set point	P72 - Fan VFS High speed percent in heating
P37 - Freeze protection cut-out set point	P74 - VFS Medium speed differential

P75 - VFS High speed differential	P101 - Screen dimming delay
P76 - Fan VFS Low limit in cooling	P107 - Weekly program configuration
P77 - Fan VFS High limit in cooling	P108 - Weekly program - events per day
P78 - Fan VFS Low limit in heating	P109 - Weekly program event configuration
P79 - Fan VFS High limit in heating	P114 - Cool PID Kp
P83 - View T2 temperature sensor readings	P115 - Heat PID Kp
P84 - View T3 temperature sensor readings	P116 - Cool PID Ki
P85 - Deice in cool - cut-in temperature	P117 - Heat PID Ki
P86 - Deice in cool - cut-out temperature	P118 - Cool PID Kd
P87 - Deice in heat time	P119 - Heat PID Kd
P88 - Deice in heat break time	P122 - Cool Proportional output threshold time
P89 - Deice in heat - cut-in temperature	P123 - Heat Proportional output threshold time
P90 - Deice in heat - cut-out temperature	P160 - Minimum compressor ON time
P91 - Compressor delay	P161 - Minimum compressor OFF time
P98 - Display set point only (hide room temperature)	P170 - Economizer low limit temperature
P99 - One or Two set points	P198 - Not in use
	P200 - Restore defaults

Press the [On/Off] button or wait 60 seconds to return to normal display.


Operating Instructions

Quick Guide

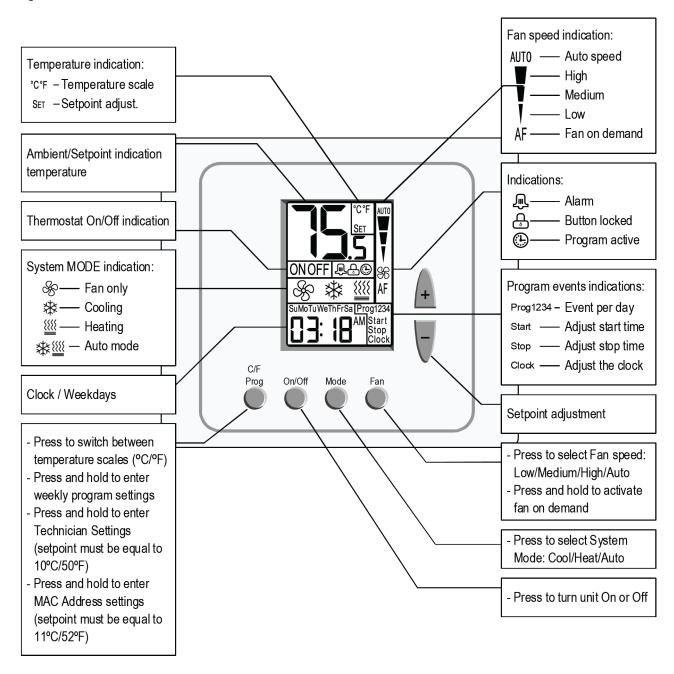


Turning the thermostat ON and OFF

Press the [On/Off] button to turn the thermostat ON or OFF.



Selecting temperature scale

 $\ni [C/F]$ button to switch between temperature scales.



Adjusting the Setpoint temperature

Note: The setpoint must be different than 10, 11°C/50, 52°F.

In One setpoint configuration:

- Press the [+] or [-]buttons once to view the setpoint temperature.
- 2 Press again to adjust the setpoint.





In Two setpoints configuration:

- 1 Press the [+] or [-] buttons once "\vec{*}" and the setpoint temperature for cooling will appear on display.
- 2 Use the [+] or [-] buttons to adjust the setpoint for cooling.
- 3 Press the [Mode] button or wait 3 seconds. " and the setpoint temperature for heating will appear on display.
- 4 Use the [+] or [-] buttons to adjust the setpoint for heating.





Setpoint Setpoint For cooling For heating


Note: The setpoint for cooling must be higher than the setpoint for heating.

Selecting system mode


Press the [Mode] button to switch between system modes.

Notes:

- During demand for cooling or heating, the active mode will flash.
- In Auto mode, the active mode icon (Cool or Heat) will flash.
- Auto mode is not available in 2-Pipe system configuration.



₩



<u>{{{}}}</u>


Auto Fan only

Selecting fan speed (for 2 and 3 fan speeds configuration)

Press the [Fan] button to switch between fan speeds.

Notes:

- In Auto speed, the active fan speed icon will appear on display.
- Medium speed available in 3 speeds configuration.
- Auto Speed in AC configurations: the differential parameter (speed change between stages) is determined by constant 0.7°C (1.4°F)
- Auto Speed in FC configurations: the differential parameter is determined by object AV#59 –DifferentialOnOffFanSpeed



Turning Auto fan ON or OFF (fan on demand)

In 1-speed configuration:


Press the [Fan] button to turn Auto fan ON or OFF.

In 2- and 3-speed configurations:

Press and hold the [Fan] button for 7 seconds to turn Auto fan ON or OFF.


- When ON, the fan will run on demand for cooling or heating.
- When OFF, the fan will run continuously.

Note: Auto fan cannot be selected in Fan only mode.



Locking the thermostat buttons

- Press and hold the [Mode] button for 7 seconds to lock or unlock the thermostat buttons.
- When locked, the lock () icon will appear on display with any attempt to press the buttons.
- Enable or disable the option to lock different buttons using Technician Settings P04-P07.



Economy mode

Activate Economy mode by triggering a window contact - remote on/off switch, window contact - remote economy switch, door switch, key-tag, External motion sensor (PIR - passive infrared sensor) or through communication - binary value "UnoccupiedByNetwork".



- Economy by Window contact Remote On/Off switch Turning unit off
- Economy by Window contact Remote economy switch Using economy set points

Refer to technician parameters P25 and P26 for economy set points

E2

Economy by External motion sensor (PIR) or through **Communication** (binary value "UnoccupiedByNetwork")

Refer to technician parameter P15 "Occupancy sensor logic (PIR)"



Economy triggered by Door switch

Refer to technician parameter P18 "Door switch or key tag configuration"



Economy by Key-tag


Refer to technician parameter P18 "Door switch or key tag configuration"

Freeze Protection

The Freeze protection feature will not allow the room temperature to drop below predefined cut-in temperature. Depending on which configuration the system is operating under (W/WO Heat pump), this feature will force the system to operate in heat mode and activate the fan.

This feature will take effect when the thermostat is either ON or OFF. When the room temperature rises above the predefined cut-out temperature, the thermostat will return to its previous state.

When freeze protection is activated, the display alternates between "AL" and room temperature.



Economizer

Economizer is used to reduce the energy consumed by the cooling systems, by using low external air temperatures to assist in the chilling process. When outdoor temperatures are lower relative to indoor (room) temperatures, the system utilizes the cool outdoor air as a free cooling source.

The outdoor temperature (Teconomizer) triggering the activation of the economizer, can be measured by the temperature sensor connected to T1,0 terminals (technician parameter P08="05") or by setting a temperature value manually through communication - AV#129 "TEconomizerEffective".

When getting the temperature through communication, terminals T1,0 can be used for any other functionality like External sensor/Soft start in heat sensor/De-icing in cool/Door switch/Key tag.


Whenever there is demand for cooling and the outdoor temperature conditions allow the operation of the economizer, it will operate together with the regular cooling system and will not replace it.

Economizer will start when, and run as long as, both of the following conditions are satisfied:

- 1 Teconomizer temperature < Room temperature (Cool differential band / 2)
- 2 Room Temperature > Setpoint temperature


Economizer will stop when the following condition is satisfied:

Room Temperature < Setpoint temperature - (Cool differential band / 2)

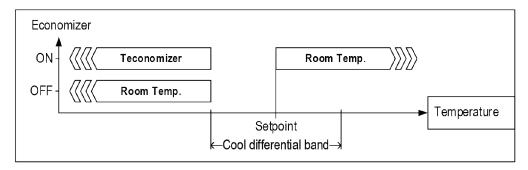

Indication for the Economizer operation:

When Economizer is active, the "Cool" symbol will appear (or flash when active) on display and the "Fan" symbol will flash.



Economizer Active

Weekly program

General

Prior to programming, make sure that Technician Settings P107, P108, and P109 are configured correctly.

Program types

The thermostat can be configured to run four different types of weekly programs (set by Technician Setting P107):

- 7-day program with same parameters for all days.
- 7-day program with different parameters for each day of the week.
- One schedule for the weekdays (Monday to Friday), one schedule for Saturday and another one for Sunday.
- One schedule for the weekdays (Monday to Friday) and another one for Saturday and Sunday.

Daily events

Each daily program can use 2 or 4 schedule events per day (set by Technician Setting P108).

There are two options for settings the schedule events (set by Technician Setting P109):

- "EU Type" Start time and Stop time.
- "US Type" Start time, setpoint temperatures, system mode and fan speed.

IMPORTANT

- Parameter P107 must not be equal to "0" in order to enable weekly program capabilities.
- Changing P107 to "0" will disable all program capabilities and reset programmed information.

Enabling/Temporarily Disabling/Overriding the program

Activate the program



- When the program is activated, a clock icon appears on the display.
- If a clock icon does not appear, ensure that the set-point temperature is not 10/11°C or 50/52°F, press and hold the button to activate the program.

- **Temporarily disable the program** without losing programmed information for example, when out of the office or leaving for vacation:
 - Make sure that the set-point temperature is not 10/11°C or 50/52°F.
 - Press and hold the button to temporarily disable the program.
 - Press and hold the button again to reactivate to the program.
- Override the program the occupant can temporarily change the set point temperature to be different than the set point temperature specified by the program. Changes remain in effect until the next program event begins.

Programming procedure

- The detailed programming procedure is described in the next sections. Make sure to follow the right programming procedure, suitable for the program type and features selected by Technician Settings.
- Press the [C/F-Prog] button to enter and proceed through the steps of the real time clock and programming procedure.
- Use the [+] or [-] buttons to select or change value of a flashing icon.
- It is recommended to select programming values prior to the actual programming.

Exit the programming procedure

At any time during the programming procedure, press the [On/Off] button to exit and return to normal display. Any changed values will be saved.

Adjusting the time and day of the week

1. Press and hold the [C/F-Prog] button. The word "Clock" will appear on display, and the HOURS will flash.

Hours

2. Use the [+] or [-] buttons to adjust the hours.

SyMoTyWeThFrSa Prog1234 AM Start Stop Clock

Minutes

- 3. Press the [C/F-Prog] button again. The MINUTES will flash.
- 4. Use the [+] or [-] buttons to adjust the hours.

Days

- 5. Press the [C/F-Prog] button again. The DAYS will flash.
- 6. Use the [+] or [-] buttons to select the day.
- 7. If Technician Setting P107 is not set to "00" (program is enabled), press the [C/F-Prog] button to enter programming procedure. Be sure to follow the right programming procedure, suitable for the program type and features selected by Technician Settings.

Section C - "EU Type"

Section D - "US Type"

Otherwise, press the [C/F-Prog] button to return to normal display.




Adjusting "EU type" daily programs

Start time


1. Press the [C/F-Prog] button. The programmed weekday(s), "Prog 1" indicating the first program event of the day and the word "Start" will appear on display.


The HOURS will flash.

Note: If this is the first time a program is being set, the symbols "--" will flash.



- 2. Use the [+] and [-] buttons to adjust the start time hours of the first event.
- 3. Press the [C/F-Prog] button again. The MINUTES will flash.
- 4. Use the [+] and [-] buttons to adjust the start time minutes of the first event.









Stop time

5. Press the [C/F-Prog] button again. T the word "Stop" will appear on display, and the HOURS will flash.



6. Use the [+] and [-] buttons to adjust the stop time hours of the first event



7. Press the [C/F-Prog] button again. The MINUTES will flash



8. Use the [+] and [-] buttons to adjust the stop time minutes of the first event



- Follow the steps above for the other schedule events of the same dally period (P2 for two events per day, or P2, P3, and P4 for four events per day).
- Follow the steps above for all daily periods.


Adjusting "US type" daily programs

Start time


1. Press the [C/F-Prog] button. The programmed weekday(s), "Prog 1" indicating the first program event of the day and the word "Start" will appear on display.

The HOURS will flash.


Note: If this is the first time a program is being set, the symbols "--" will flash.



2. Use the [+] and [-] buttons to adjust the start time hours of the first event.



3. Press the [C/F-Prog] button again. The MINUTES will flash.



4. Use the [+] and [-] buttons to adjust the start time minutes of the first event.



System mode and fan speed

5. Press the [C/F-Prog] button again. The system MODES will flash.



6. Use the [+] and [-] buttons to select the system mode of the first event



7. Press the [C/F-Prog] button again. The FAN SPEEDS will flash.



8. Use the [+] and [-] buttons to select the fan speed of the first event.



Setpoint

1. Press the [C/F - Prog] button again. The setpoint will flash.

Note: If the thermostat is configured to have two setpoints, first adjusts the setpoint for cooling and then the setpoint for heating.




- 2. Use the [+] and [-] buttons to adjust the setpoint of the first event.
 - Follow the steps above for the other schedule events of the same daily period (P2 for two events per day, or P2, P3 and P4 for four events per day).
 - Follow the steps above for all daily periods.

MAC Address and BACnet Device Instance Number

MAC Address

To set the communication MAC Address:

- 1 Adjust the setpoint temperature to 11°C or 52°F.
- 2 Press and hold the [C/F] button for 10 seconds to enter MAC Address configuration mode.
- **3** Use the [+] or [-] buttons to define the MAC Address (range 1...127).
- 4 When finished, press the [On/Off] button and readjust the setpoint.
- 5 Switch power supply off and on again for the MAC address changes to take effect.



Caution: Do not use the same MAC address for two devices on the same communication bus!

BACnet Device Instance Number

By default, the BACnet Device Instance Number is generated automatically by the thermostat (Vendor ID + MAC address). For example, Carrier Corporation vendor ID is 16, and if the MAC address is 075, the BACnet Device Instance Number is 16075.

Note: If you change the MAC address, you must cycle the thermostat's power to reset the BACnet Device Instance Number.

You can override the automatically-generated BACnet Device Instance Number using the i-Vu® application, an Analog Network Output microblock in a control program, or some other BACnet utility. Write the new BACnet Device Instance Number to the present_value property of Analog Value 42 (BACnetDeviceInstanceNumber).

Examples:

In the i-Vu® application

- 1 Use the BACnet Discovery feature to discover the BACnet Thermostat and its BACnet objects.
- 2 In the navigation tree, select the Analog Value called BacnetDeviceInstanceNumber.
- 3 Change the Present Value field (shown below) to the desired BACnet Device Instance Number.



4 Click Accept.

In an Analog Network Output microblock

To change the BACnet Device Instance Number from 16075 to 16113, the microblock's address would be:

bacnet://16075/AV:42/present value, or

bacnet://16075/BACnetDeviceInstanceNumber

Subsequent reads/writes of this value will need to be done with the new device instance:

bacnet://16113/AV:42/present_value,or

bacnet://16113/BACnetDeviceInstanceNumber

Installation

Mount the BACnet Thermostat on an interior wall in the room to be controlled. Locate it where the occupant can easily read the LCD display and use the controls. If the built-in temperature sensor is being used to measure room temperature, place the thermostat where the temperature is representative of the general room conditions. Avoid cold or warm air drafts, radiant heat, and direct sunlight.



WARNING: Risk of electric shock and property damage. Disconnect power supply before making electrical connections. The installation is to be performed by a qualified electrician.




WARNING: The integrated circuits in the controller are sensitive to static currents. Take suitable precautions.


General

Installation procedure

- A. Separate the front panel from the back panel by pressing the tab located in the top of the unit and pulling the back panel off of the two bottom tabs.
- B. Use two 2 X ½" screws (b3) to attach the adapter plate (b1) to a 4 X 2 electrical box.
 - Use three 3 X 1/4" screws (b4) to attach the back panel (b2) to the adapter plate (b1).
 - Cover the adaptor's bottom screw hole using the screw cap (b5).
- C. Make electrical connections as shown in the picture below and the *wiring diagram* (page 22). Set DIP switch positions as explained in this manual.
- D. Install the cove to the back panel; first the two bottom tabs and then the top tongue. Push until tight against the wall.

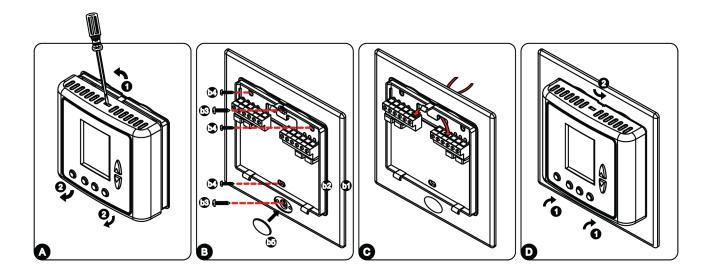

Wiring terminals

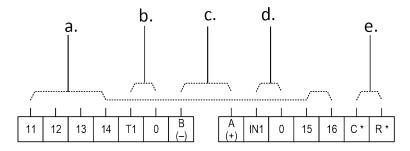


Terminals

- **a** For outputs 11-16, see Wiring and DIP switch/jumper settings (page 26).
- **b** For T1,0 inputs: Dry contact, 10 Vdc input, or 50 kOhm thermistor See Technician Setting P8.
- c MS/TP Communication (RS485): BACnet
- for IN1,0 functionality please refer to parameter P9 in the technician settings section.
 T2 change over sensor / Soft start in heat sensor / Window contact Remote On/Off switch / Window contact Remote economy switch / External PIR
- **e** Power supply: 24 Vac CAUTION Do not connect line voltage to a thermostat that does not show the following symbol:



DIP switch and jumper configurations

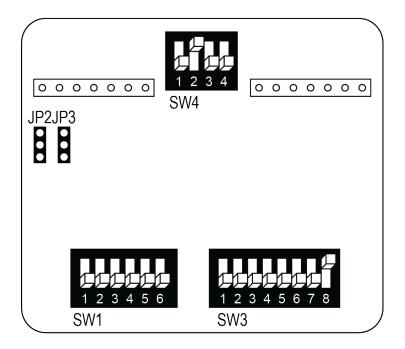

SW4.1 - Without valves control in FC config.

OFF - Enable valves control

ON - Disable valves control

SW4.2 - Not used

Always ON

SW4.3 - Not used

Always OFF

SW4.4 - End of line resistor (120 Ω)

OFF = Not end of line ON = End of line



SW1.1 through SW1.6, and SW3.1 through SW3.8

See Wiring and DIP switch/jumper settings (page 26).


JP2, JP3 – Outputs 15,16 – Analog or Digital

JP2 - Output 16

Position 1- Analog output Position 3- Digital output

JP3 - Output 15

Position 1- Analog output Position 3- Digital output



AC configurations

Find the configuration you want in the tables below, then find that configuration number (1 through 9) on the Wiring and DIP switch/jumper settings.

AC Configurations

Outputs	Configuration	1	2	3	4	5	6	7	8	9
Heat elements (max.)		3	3 2		1	2		1	2	1
Compressors (max.)		2	2	2	1	1	1	1	1	2
Heat pump			•	•	•		•			•
Fan VFS							•	•		
Fan speeds	Fan speeds		1	2 or 3	2 or 3 2 or 3				1	1
Economizer				0	0	0	0	0	0	0

[•] Yes Option

FC configurations for 2-pipe systems

Find the configuration you want in the tables below, then find that configuration number (10 through 13) on Wiring and DIP switch/jumper settings.

FC Configurations for 2-Pipe systems

Outputs	Configuration		10			11		12	13
CI/Ht valve		•			PID	•	•	PID	
Heat eleme	•			•			•	•	
Fan VFS							•	•	
Fan speeds			2	3	1	2	3		
Economizer	0	0		0	0		0	0	

 $[\]bullet \ \ \text{Yes} \quad \ \circ \ \, \text{Option}$

FC configurations for 4-pipe systems / Floor heating

Find the configuration you want in the tables below, then find that configuration number (14 through 22) on the Wiring and DIP switch/jumper settings.

FC Configurations for 4-Pipe systems

Outputs	Configuration		14	ļ		15		15		15		15		15			16			17		1	.8	19			20	21	22																																			
Cool valve /	Cool valve / Cool valve PID		•		•		•		•		•		•		•		•		•		•		•		•		•		•		•		•		•		•		•		•		•		•			•			PIC)	ļ	PID	١	,	•		•		•	PID	F	PID
Heat valve /	valve / Heat valve PID •				•		•		,	• PID)	PID	•	F	PID																																																
Heat eleme	at element (2nd stage) •						•						•		•				•																																													
Fan VFS														,	•				•	•																																												
Fan speeds		1	2	3	1	2	3	1	2	3	1	2	3			1	2	3			1	2 3																																										
Economizer		0	0		0	0		0	0		0	0		()	0	0		0	0	0	0																																										
Floor heatin	ıg					•						•																																																				

[•] Yes Option

Wiring and DIP switch/jumper configurations 1 to 4 - AC systems

Outputs	Config. 1: HC32 1 Speed fan	Config. 2: HP42 1 Speed fan	Config. 3: HP22 2/3 Speeds fan	Config. 4: HP21 2/3 Speeds fan
11	Heat element 3 (3rd stage heat)	Heat element 2 (4th stage heat)	Fan high	Fan high
12	Heat element 2 (2nd stage heat)	Heat element 1 (3rd stage heat)	Fan medium (or Economizer ⁽⁵⁾)	Fan medium (or Economizer ⁽⁵⁾)
13	Fan (1 speed)	Fan (1 speed)	Fan low	Fan low
14	Compressor 2	Compressor 2	Compressor 2	Heat element(2)
15	Compressor 1 ⁽³⁾	Compressor 1(3)	Compressor 1(3)	Compressor ⁽³⁾
16	Heat element 1 ⁽²⁾ (1st stage heat)	Heat pump(2)	Heat pump ⁽²⁾	Heat pump ⁽²⁾

SW3










SW1













Jumpers JP2, JP3 analog outputs









(1) SW3.1, SW3.2 - Fan speeds: 2 speeds (Low and High): SW3.1 = OFF, SW3.2 = ON 3 speeds (Low, Med., and High): SW3.1 = OFF, SW3.2 = OFF

(2) SW3.4 – HP (Heat pump): ON = Heat pump active in cool, OFF = Heat pump active in heat HC (not heat pump): ON = Electrical heater, OFF = Oil/Gas heater (no fan)

(3) SW3.5 – Compressor delay: ON = Disable, OFF = Enable

(4) SW1.3 – Dehumidification: ON = Use dehumidifier, OFF = Use reheat for dehumidification

(5) SW1.6 – Terminal 12 operation: ON = Economizer

OFF = Fan Medium (3 speeds) / Terminal not in use (2 speeds) Important: Economizer will not work in 3 fan speeds configuration.

See drawing for DIP switch and jumper locations (page 23).

Control - Fan on/off, Heat elements, Heat pump, Compressors, Economizer: 24 Vac, 0.5A max

Wiring and DIP switch/jumper configurations 5 to 7 - AC systems

Outputs	Config. 5: HC21 2/3 Speeds fan ⁽¹⁾	Config. 6: HP11 Fan VFS	Config. 7: HC11 Fan VFS
11	Fan high	Х	X
12	Fan medium	Economizer ⁽⁵⁾	Economizer ⁽⁵⁾
12	(or Economizer ⁽⁵⁾)	(option - SW1.6 ON)	(option - SW1.6 ON)
13	Fan low	Х	X
14	Heat element 2	Heat pump(2)	Heat element(2)
14	(2nd stage heat)	ricat pamp.	ricat cicincité /
15	Compressor ⁽³⁾	Compressor ⁽³⁾	Compressor ⁽³⁾
16	Heat element 1 ⁽²⁾	Fan VFS	Fan VFS
10	(1st stage heat)	TailVF3	i all VF3

SW3








SW1









Jumpers JP2, JP3 analog outputsW 2







(1) SW3.1, SW3.2 - Fan speeds:

2 speeds (Low and High): SW3.1 = OFF, SW3.2 = ON 3 speeds (Low, Med., and High): SW3.1 = OFF, SW3.2 = OFF

(2) SW3.4 – HP (Heat pump): HC (not heat pump):

ON = Heat pump active in cool, OFF = Heat pump active in heat ON = Electrical heater, OFF = Oil/Gas heater (no fan)

The (not neat pamp).

ON = Disable, OFF = Enable

(3) SW3.5 - Compressor delay: (4) SW1.3 - Dehumidification:

ON = Use dehumidifier, OFF = Use reheat for dehumidification

(5) SW1.6 - Terminal 12 operation:

ON = Economizer

OFF = Fan Medium (3 speeds) / Terminal not in use (2 speeds) Important: Economizer will not work in 3 fan speeds configuration.

See drawing for DIP switch and jumper locations (page 23).

Fan VFS: 0-10 Vdc, 0.5 mA Not isolated

Control - Fan on/off, Heat elements, Heat pump, Compressors, Economizer: 24 Vac, 0.5A max

Wiring and DIP switch/jumper configurations 8 to 9 - AC systems

Outputs	Config. 8: HC22 1 Speed fan, Economizer,	Config. 9: HP32 1 Speed fan, Economizer
11	Heat element 2 (2nd stage heat)	Heat element (3rd stage heat)
12	Economizer ⁽⁵⁾ (option – SW1.6 ON)	Economizer ⁽⁵⁾ (option – SW1.6 ON)
13	Fan (1 speed)	Fan (1 speed)
14	Compressor 2	Compressor 2
15	Compressor 1 ⁽³⁾	Compressor 1(3)
16	Heat element 1 ⁽²⁾ (1st stage heat)	Heat pump ⁽²⁾

SW3







SW1





Jumpers JP2, JP3 analog outputsW 2





(1) SW3.1, SW3.2 - Fan speeds: 2 speeds (Low and High): SW3.1 = OFF, SW3.2 = ON 3 speeds (Low, Med., and High): SW3.1 = OFF, SW3.2 = OFF

(2) SW3.4 – HP (Heat pump): ON = Heat pump active in cool, OFF = Heat pump active in heat HC (not heat pump): ON = Electrical heater, OFF = Oil/Gas heater (no fan)

(3) SW3.5 - Compressor delay: ON = Disable, OFF = Enable

 $^{(4)}$ SW1.3 – Dehumidification: ON = Use dehumidifier, OFF = Use reheat for dehumidification

(5) SW1.6 – Terminal 12 operation: ON = Economizer

OFF = Fan Medium (3 speeds) / Terminal not in use (2 speeds) Important: Economizer will not work in 3 fan speeds configuration.

See drawing for DIP switch and jumper locations (page 23).

Control - Fan on/off, Heat elements, Heat pump, Compressors, Economizer: 24 Vac, 0.5A max

Wiring and DIP switch/jumper configurations 10 to 13 - FC systems - 2-pipe

Outputs	Config. 10: 2-Pipe, 1/2/3 Speeds fan ⁽¹⁾								
11	Fan high								
12	Fan medium (or Economizer ⁽⁵⁾)								
13	Fan low								
14	Heat element ⁽²⁾ (2nd stage heat)								
15	Cool/Heat valve(3)								
16	X								

Config. 11: 2-Pipe, 1/2/3 Speeds fan ⁽¹⁾ Cool/Heat PID
Fan high
Fan medium
(or Economizer ⁽⁵⁾)
Fan low
Heat element(2)
(2nd stage heat)
Cool/Heat
valve PID ⁽³⁾
X

Config. 12: 2-Pipe, Fan VFS
X
Economizer ⁽⁵⁾
(option - SW1.6 ON)
Х
Heat element(2)
(2nd stage heat)
Cool/Heat valve ⁽³⁾
Fan VFS

Config. 13: 2-Pipe, Fan VFS, Cool/Heat PID
X
Economizer ⁽⁵⁾
(option - SW1.6 ON)
X
Heat element(2)
(2nd stage heat)
Cool/Heat
valve PID(3)
Fan VFS

sw3










SW2













Jumpers JP2, JP3 analog outputs









(1) SW3.1, SW3.2 - Fan speeds:

1 speed (Low): 2 speeds(Low and High):

3 speeds(Low, Medium, and High):

SW3.1 = ON, SW3.2 = OFF SW3.1 = OFF, SW3.2 = ON

SW3.1 = OFF, SW3.2 = OFF

 $^{(2)}$ SW3.4 – 2nd heating stage: ON = Enable, OFF = Disable

(3) SW3.5 - Chilled beam option: ON = Enable chilled beam (fan will not run with cooling)

(4) SW1.3 = Dehumidification: ON – Use dehumidifier, OFF – Use reheat for dehumidification

(5) SW1.6-Terminal 12 operation: ON = Economizer

OFF = Fan Medium (3 speeds) / Terminal not in use (1/2 speeds/VFS) Important: Economizer will not work in 3 fan speeds configuration.

See drawing for DIP switch and jumper locations (page 23).

Fan VFS, PID valves: 0-10 Vdc, 0.5 mA Not isolated

Control - Fan on/off, Heat elements, Cool/Heat valves, Economizer: 24 Vac, 0.5A max

Wiring and DIP switch/jumper configurations 14 to 17 - FC systems - 4-pipe

• •				
Outputs	Config. 14: 4-Pipe, 1/2/3 Speeds fan ⁽¹⁾	Config. 15: 4-Pipe, 1/2/3 Speeds fan ⁽¹⁾ , Floor heating	Config. 16: 4-Pipe, 1/2/3 Speeds fan ⁽¹⁾ , Cool valve PID	Config. 17: 4-Pipe, 1/2/3 speeds fan ⁽¹⁾ , Cool/Heat PID, Floor heating
11	Fan high	Fan high	Fan high	Fan high
12	Fan medium (or Economizer ⁽⁵⁾)	Fan medium (or Economizer ⁽⁵⁾)	Fan medium (or Economizer ⁽⁵⁾)	Fan medium (or Economizer ⁽⁵⁾)
13	Fan Iow	Fan low	Fan Iow	Fan Iow
14	Heat element ⁽²⁾ (2nd stage heat)	Floor heating (1st stage heat – no fan)	Heat element ⁽²⁾ (2nd stage heat)	Floor heating (1st stage heat – no fan)
15	Cool valve(3)	Cool valve(3)	Cool valve PID(3)	Cool valve PID(3)
16	Heat valve (1st stage heat)	Heat valve (2nd stage heat)	Heat valve (1st stage heat)	Heat valve (2nd stage heat)
SW3	1 2 3 4 5 6 7 8	1 2 3 4 5 6 7 8	1 2 3 4 5 6 7 8	1 2 3 4 5 6 7 8
SW1	1 2 3 4 5 6	1 2 3 4 5 6	1 2 3 4 5 6	1 2 3 4 5 6
Jumpers JP2, JP3 analog outputs	JP2 30001 30001 JP3	JP2 3 5 5 1 3 5 5 1 3 5 5 1	JP2 35501 35501 JP3	JP2 3 5 5 1 3 5 5 1

(2) SW3.4 – 2nd heating stage: ON = Enable, OFF = Disable

(3) SW3.5 – Chilled beam option: ON = Enable chilled beam (fan will not run with cooling)

(4) SW1.3 = Dehumidification: ON – Use dehumidifier, OFF – Use reheat for dehumidification

(5) SW1.6-Terminal 12 operation: ON = Economizer

OFF = Fan Medium (3 speeds) / Terminal not in use (1/2 speeds/VFS) Important: Economizer will not work in 3 fan speeds configuration.

See drawing for DIP switch and jumper locations (page 23).

Fan VFS, PID valves: 0-10 Vdc, 0.5 mA Not isolated

Control - Fan on/off, Heat elements, Cool/Heat valves, Economizer: 24 Vac, 0.5A max

Wiring and DIP switch configurations 18 to 21 - FC systems - 4-pipe

Outputs	Config. 18: 4-Pipe, Fan VFS	Config. 19: 4-Pipe, 1/2/3 Speeds fan ⁽¹⁾ , Heat valve PID	Config. 20: 4-Pipe, Fan VFS, Heat valve PID	Config. 21: 4-Pipe, Fan VFS, Cool valve PID
11	X	Fan high	X	Х
12	Economizer ⁽⁵⁾ (option – SW1.6 ON)	Fan medium (or Economizer ⁽⁵⁾)	Economizer ⁽⁵⁾ (option – SW1.6 ON)	Economizer ⁽⁵⁾ (option – SW1.6 ON)
13	X	Fan low	Х	Х
14	Heat valve	Heat element ⁽²⁾ (2nd stage heat)	Cool valve ⁽³⁾	Heat valve
15	Cool valve ⁽³⁾	Cool valve ⁽³⁾	Heat valve PID	Cool valve PID(3)
16	Fan VFS	Heat valve (1st stage heat)	Fan VFS	Fan VFS

SW3









SW1












Jumpers JP2, JP3 analog outputs









 $^{(1)}$ SW3.1, SW3.2 – Fan speeds: 1 speed (Low):

2 speeds(Low and High):

3 speeds(Low, Medium, and High):

SW3.1 = ON, SW3.2 = OFF SW3.1 = OFF, SW3.2 = ON

SW3.1 = OFF, SW3.2 = OFF

 $^{(2)}$ SW3.4 – 2nd heating stage: ON = Enable, OFF = Disable

(3) SW3.5 – Chilled beam option: ON = Enable chilled beam (fan will not run with cooling)

(4) SW1.3 = Dehumidification: ON – Use dehumidifier, OFF – Use reheat for dehumidification

(5) SW1.6-Terminal 12 operation: ON = Economizer

OFF = Fan Medium (3 speeds) / Terminal not in use (1/2 speeds/VFS) Important: Economizer will not work in 3 fan speeds configuration.

See drawing for DIP switch and jumper locations (page 23).

Fan VFS, PID valves: 0-10 Vdc, 0.5 mA Not isolated

Control - Fan on/off, Heat elements, Cool/Heat valves, Economizer: 24 Vac, 0.5A max

Wiring and DIP switch/jumper configuration 22 - FC systems - 4-pipe

Outputs	Config: 22 4-Pipe, 1/2/3 Speeds fan ⁽¹⁾ , Heat valve PID, Cool valve PID
11	Fan high
12	Fan medium (or Economizer ⁽⁵⁾)
13	Fan low
14	Heat element ⁽²⁾ (2nd stage heat)
15	Cool valve PID(3)
16	Heat valve PID (1st stage heat)


SW3



SW1



Jumpers
JP2, JP3
analog
outputs



(1) SW3.1, SW3.2 - Fan speeds: 1 speed (Low): SW3.1 = ON, SW3.2 = OFF

2 speeds(Low and High): SW3.1 = OFF, SW3.2 = ON 3 speeds(Low, Medium, and High): SW3.1 = OFF, SW3.2 = OFF

(2) SW3.4 – 2nd heating stage: ON = Enable, OFF = Disable

(3) SW3.5 – Chilled beam option: ON = Enable chilled beam (fan will not run with cooling)

 $^{(4)}$ SW1.3 = Dehumidification: ON – Use dehumidifier, OFF – Use reheat for dehumidification

(5) SW1.6–Terminal 12 operation: ON = Economizer

OFF = Fan Medium (3 speeds) / Terminal not in use (1/2 speeds/VFS) Important: Economizer will not work in 3 fan speeds configuration.

See drawing for DIP switch and jumper locations (page 23).

PID valves: 0-10 Vdc, 0.5 mA Not isolated

Control - Fan on/off, Heat elements, Cool/Heat valves: 24 Vac, 0.5A max

Technician Settings


Enter Technician Settings mode:

- 1 Adjust the setpoint temperature to 10°C or 50°F.
- 2 Press and hold the [C/F] button for 10 seconds to enter Technician Settings mode. "P01" will appear on the display.

View objects and make adjustments:

- Use the [Mode] button to step forward between different settings.
- Use the [Fan] button to step backward between different settings.
- Press the [On/Off] button to exit Technician Settings and return to normal display.
- If no button is pressed for 60 seconds, the thermostat will automatically exit Technician Settings and return to normal display.
- Use the [+] or [-] button to make adjustments when required.

Technician Settings P01 to P03

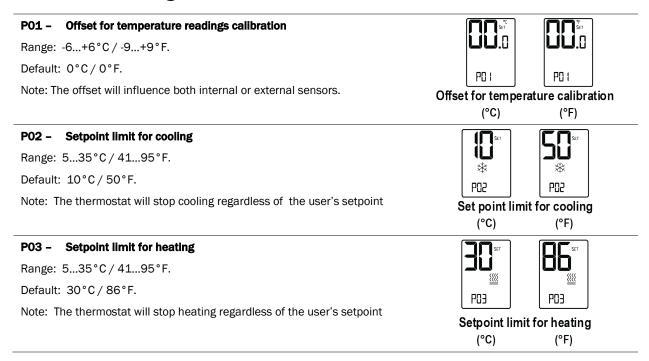

Technician Settings P04 to P07

P04 - Enable/Disable the option to lock the [Fan] button

"LF" + "🚭"

[Fan] button can be locked

"LF" only[Fan] button cannot be locked

Note: When enabled, press and hold the [Mode] buttons for 7 seconds to unlock or relock the buttons.



PU역 [Fan] Can

be locked



[Fan] Cannot be locked

P05 - Enable/Disable the option to lock the [Mode] button

"L1" + "🍮"

[Mode] button can be locked

"L1" only

[Mode] button cannot be locked

Note: When enabled, press and hold [-] and [Fan] buttons for 7 seconds to unlock or relock the buttons.



[Mode] Can be locked



[Mode] Cannot be locked

P06 - Enable/Disable the option to lock the [On/Off] button

"L0" + "💍"

[On/Off] button can be locked

"00" only

[On/Off] button cannot be locked

Note: When enabled, press and hold both [-] and [Fan] buttons for 7 seconds to unlock or relock the buttons.



[On/Off] Can be locked



[On/Off] Cannot be locked

P07 - Enable/Disable the option to lock the ▲ or ▼ button (SET)

"LS" + "💍"

[+] or [-] button can be locked

"I S" only

[+] or [-] button cannot be locked

Note: When enabled, press and hold both [-] and [Fan] buttons for 7 seconds to unlock or relock the buttons.



[+] and [-] Can be locked



[+] and [-] Cannot be locked

P04-P07 Note:

When the option to lock one or more buttons is enabled, these buttons will be automatically locked when leaving technician settings and returning to normal display.

In normal display, press and hold the [Mode] button for 7 seconds to unlock/relock these buttons.

Technician Settings P08 to P10

P08 - Functionality of T1 terminals T1 terminals are not in use "01" -External sensor "02" -T3 Soft start in heat sensor (FC) * or P08 POA POA De-icing in cool (AC) ** T1 terminals T1 sensor T3 Soft start in "03" -Door switch Not in use (External heat sensor (FC) sensor) or De-icing in "04" -Key tag cool sensor (AC) "05" -T Economizer (DIP switch SW2.6 must be ON) * In heating mode, the fan will not start before there is hot water in the P08 P08 P08 Note: To view T3 on the BACnet Thermostat, see Technician Settings P84. Door switch Key tag T Economizer ** Allow de-icing operation of indoor coil in cooling. P09 -Functionality of IN1,0 terminals "00" -IN1,0 terminals are not in use "01" -*T2 (Change over sensor) (FC) or De-icing in heat (AC) P09 P09 P09 **T3 (Soft start in heat sensor) (FC) or "02" -"IN1.0" **T3 Soft start T2 change De-icing in cool (AC) terminals over sensor in heat "03" -Window contact - Remote On/Off switch Not in use (FC) sensor (FC) or Deicing in or Deicing in Window contact - Remote Economy switch heat (AC) cool sensor ***External Passive Infrared detector (AC) * In 2-Pipe system, T2 will sense the water temperature in the pipe in order to select/allow effective system mode. Note: To view T2 on the BACnet Thermostat, see Technician Settings P83. P09 P09 P09 ** Where T1 terminals are used for external sensor, the IN1,0 terminals can be used for T3 sensor. Window Window External contact contact PIR sensor Note: To view T3 on the BACnet Thermostat, see Technician Settings Remote Remote P84. On/Off **Economy** switch switch P10 - Window contact (terminals IN1,0) polarity "01" - Normally open "00" - Normally closed P 10 P 10 Window Window contact contact Normally Normally close open

Technician Settings P11 to P15

P11 - Window contact delay time

Range: 0...999 seconds.

Default: 600 seconds.



Window contact delay time (sec.)

P12 - Door switch (terminals T1,0) polarity

"01" - Normally open
"00" - Normally closed





Door switch Door switch Normally close Normally open

P13 - Door switch delay time

Range: 0...999 seconds.

Default: 180 seconds.



Door switch delay time (sec.)

P14 - Enable/Disable Auto change over mode

- "00" Disable Auto change over mode
- "01" Enable Auto change over mode





Disable Auto mode

Enable Auto mode

P15 - Motion sensor logic (PIR)

- "00" Thermostat turns off when unoccupied and back on when re-occupied.
- "01" Thermostat turns off when unoccupied and remains off when re-occupied.
- "02" Thermostat uses economy setpoints when unoccupied.





Unocc. - Off Re-occ. - On

- Off Unocc. - Off . - On Re-occ. - Off



Economy set points

Technician Settings P16 to P25

P16 - Enable/Disable Motion sensor

"00" - Disable "01" - Enable





Disable occ. sensor

Enable occ. sensor

P17 - PIR (Motion sensor) delay time before switching to unoccupied mode (ON delay)

Range: 0...900 minutes

Default: 20 minutes



PIR ON delay (minutes)

P18 - Door switch or key tag configuration

"00" - Switch On/Off by door switch or key tag

"01" - Changing the setpoint temperature

"02" - Switching fan speed to Low







Switch On or Off

Change set-points

Switch to fan low

P19 - PIR (Motion sensor) polarity

"00" - Normally open

"01" - Normally closed





PIR

Normally open Normally close

P25 - Economy setpoint for cooling

Range: 5...35°C / 41...95°F

Default: 30°C / 86°F





EC set point in cooling (°C) (°F)

Technician Settings P26 to P30

P26 - Economy setpoint for heating

Range: 5...35°C / 41...95°F

Default: 10°C / 50°F





EC set point in heating (°C) (°F)

P27 - On-delay time on-delay between heating stages

Range: 0....600 seconds

Default: 5 seconds



On delay heating stages

P28 - Off-delay time between heating stages

Range: 0....600 seconds

Default: 1 second



Off delay heating stages

P29 - LCD Backlight ON or OFF

"00" - LCD Backlight ON

"01" - LCD Backlight OFF





Backlight ON

Backlight OFF

P30 - Beeper ON or OFF

"01" - Beeper ON

"00" - Beeper OFF






Technician Settings P31 to P34

P31 - P34

Fan on/off delay

with fan on demand (auto fan) active.



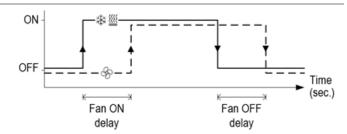

P31 - Fan ON delay in cooling (FC only)

Range: 0...120 seconds

Default: 0 seconds (no delay)



P32 - Fan OFF delay in cooling

Range: 0...120 seconds

Default: 0 seconds (no delay)



P33 - Fan ON delay in heating (FC only)

Range: 0...120 seconds

Default: 0 seconds (no delay)



P34 - Fan OFF delay in heating

Range: 0...120 seconds

Default: 30 seconds



Fan OFF delay in heating (seconds)

Technician Settings P35 to P42

P35 - Enable/Disable Freeze protection

"00" - Disable Freeze protection

"01" - Enable Freeze protection

Note: If enabled, freeze protection will start when the thermostat is either

ON or OFF and regardless of the current system mode.





Disable freeze protection

Enable freeze protection

P36 - Freeze protection cut-in setpoint

Range: 8...15°C / 46...59°F

Default: 8°C / 46°F

The room ambient temperature which will trigger Heating ON.





Freeze protection cut-in set point (°C) (°F)

P37 - Freeze protection cut-out setpoint

Range: 10...17°C / 50...63°F

Default: 10°C / 50°F

The room ambient temperature which will switch the Heating back OFF.





Freeze protection cut-out set point (°C) (°F)

P40 - View filter counter (hours) - Read only

Range: 0...999 hours

The filter counter is related to Fan running time.



View filter Counter (hours)

P41 - Reset filter time

Press the [+] button to reset the filter counter.

The display will change from "00" to "01" and back to "00".





Reset filter counter

P42 - Adjust filter alarm delay time counter (hours)

Range: 0...999 hours

Default: 0 hours (0 = Disable)



Adjust filter alarm delay time (hours)


Technician Settings P43 to P44

P43 - P44

Soft start in heat

with fan on demand (auto fan) active.



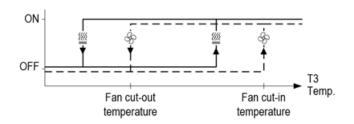


P43 - Soft start in heat - cut-in temperature (FC only)

The fan will not start before the temperature on T3 sensor reaches the cut-in temperature.

See Technician Settings P08/P09.

Range: 14...37°C / 57...99°F

Default: 36°C / 97°F




P44 - Soft start in heat - cut-out temperature (FC only)

The fan will stop if the temperature on T3 sensor drops below the cut-out temperature.

See Technician Settings P08/P09.


Range: 12...35°C / 54...95°F

Default: 32°C / 90°F




Soft start heat cut-out temperature (°C) (°F)


Technician Settings P45 to P46

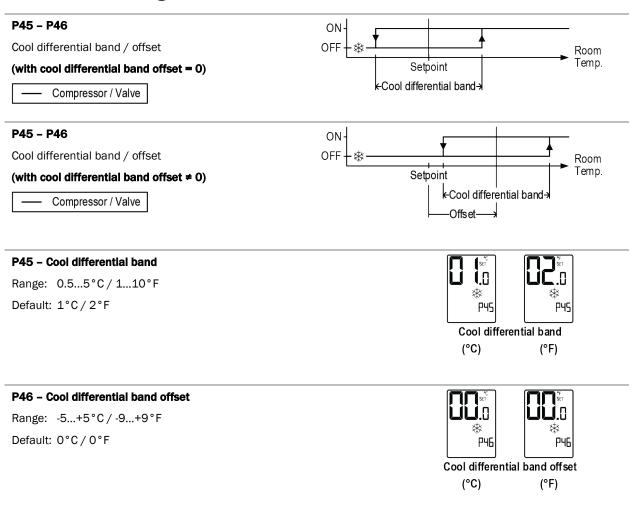

Technician Settings P47 to P48

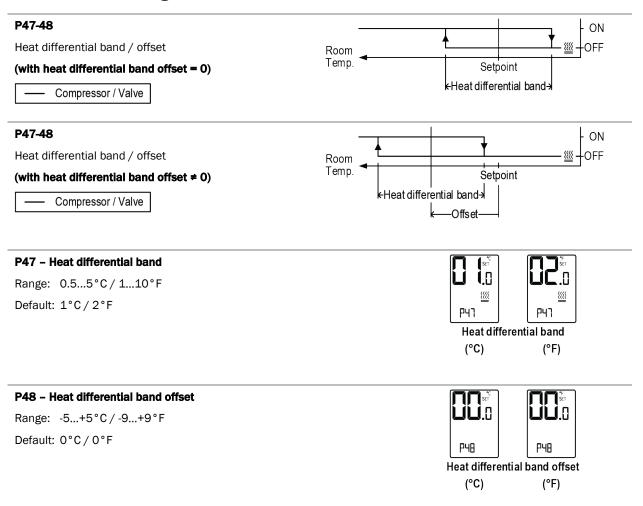

Technician Settings P49 to P51

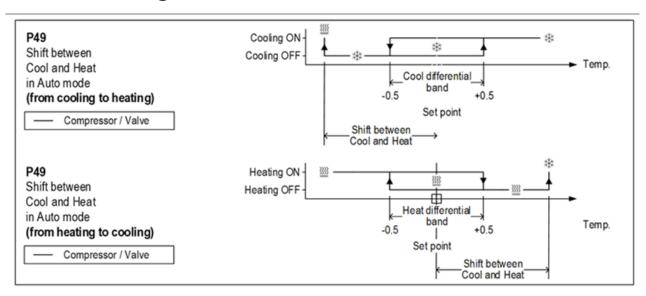

P49 - Shift between Cool and Heat in Auto change over mode

Range: 0...10°C/0...20°F

Default: 2°C/4°F



Shift between Cool & Heat in Auto mode
(°C) (°F)

P50 - Shift between Cooling stages (AC only)

Range: 0...10°C / 0...20°F

Default: 2°C/4°F





Shift between cooling stages (°C) (°F)

P51 - Shift between Heating stages

Range: 0...49°C / 0...98°F

Default: 2°C/4°F





Shift between heating stages (°C) (°F)

Technician Settings P52 to P57

P52 - Cool valve proportional band (FC only)

Range: 2...10°C / 4...20°F

Default: 2°C/4°F

0-10V Valve opening from fully closed to fully open.





Cool valve proportional band (°C) (°F)

P53 - Cool proportional low limit (FC only)

Range: 0...100%

Default: 0%

Minimum valve opening.



Cool prop. low limit (%)

P54 - Cool proportional high limit (FC only)

Range: 0...100%

Default: 100%

Maximum valve opening.



Cool prop. high limit (%)

P55 - Heat valve proportional band (FC only)

Range: 2...10°C / 4...20°F

Default: 2°C/4°F

0-10V Valve opening from fully closed to fully open.





Cool valve proportional band (°C) (°F)

P56 - Heat proportional low limit (FC only)

Range: 0...100%

Default: 0%

Minimum valve opening.



Heat prop. low limit (%)

P57 - Heat proportional high limit (FC only)

Range: 0...100%

Default: 100%

Maximum valve opening.



Heat prop. high limit (%)


Technician Settings P60 to P64

P60

Fan turns ON when the Cool or Heat valve reaches the "Proportional ON percent"

P61

Fan turns OFF when the Cool or Heat valve drops below the "Proportional OFF percent"

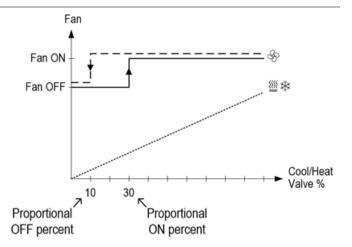

P60 - Proportional ON percent (FC only)

Range: 0...30% Default: 30%



Proportional ON percent (%)

P61 - Proportional OFF percent (FC only)

Range: 0...100%

Default: 100%



Proportional OFF percent (%)

P63 - Time on-delay between cooling stages (AC only)

Range: 0...600 seconds

Default: 5 seconds



On Delay cooling stages

P64 - Time off-delay between cooling stages (AC only)

Range: 0...600 seconds

Default: 1 seconds



Off Delay cooling stages

Technician Settings P65 to P70

P65 - Fan VFS proportional band in cooling

Range: 2...10°C / 4...20°F

Default: 2°C/4°F

0-10V fan speed from off closed to fully running.





VFS Proportional band in cooling (°C) (°F)

P66 - Fan VFS proportional band in heating

Range: 2...10°C / 4...20°F

Default: 2°C/4°F

0-10V fan speed from off closed to fully running.





VFS Proportional band in heating (°C) (°F)

P67 - Fan VFS Low speed percent in cooling

Range: 0...30%

Default: 20%



VFS Low % in cooling

P68 - Fan VFS Medium speed percent in cooling

Range: 30...60% Default: 50%



VFS Med % in cooling

P69 - Fan VFS High speed percent in cooling

Range: 60...100% Default: 90%



VFS High % in cooling

P70 - Fan VFS Low speed percent in heating

Range: 0...30% Default: 30%



VFS Low % in heating

Technician Settings P71 to P75

P71 - Fan VFS Medium speed percent in heating

Range: 30...60% Default: 50%



VFS Med % in heating

P72 - Fan VFS High speed percent in heating

Range: 60...100% Default: 80%




VFS High % in heating

P74

VFS Medium speed differential (display from medium to low)

P75

VFS High speed differential (display from high to medium)

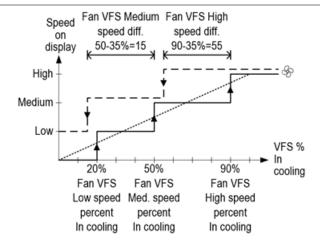

P74 - VFS Medium speed differential

Range: 10...50%

Default: 35



VFS Med speed differential

P75 - VFS High speed differential

Range: 10...50% Default: 35



VFS High speed differential

Technician Settings P76 to P79

P76 - Fan VFS Low limit in cooling

Range: 0...100%

Default: 0%



VFS low limit in cooling

P77 - Fan VFS High limit in cooling

Range: 0...100%

Default: 100%



VFS high limit in cooling

P78 - Fan VFS Low limit in heating

Range: 0...100% Default: 0%



VFS low limit in heating

P79 - Fan VFS High limit in heating

Range: 0...100%

Default: 100%



VFS high limit in heating

Technician Settings P83 to P88

P83 - View T2 temperature sensor readings

Note: If T2 is not connected, -9.9 will appear on display





T2 Sensor Not connected

T2 Sensor readings (°C)

P84 - View T3 temperature sensor readings

Note: If T3 is not connected, -9.9 will appear on display





T3 Sensor T3 Sensor Not connected readings (°C/°F)

P85 - De-ice in cool - cut-in temperature (AC only)

Range: -9.5...+8°C / 15...46°F

Default: 0°C/32°F

The indoor unit coil temperature in which de-icing will start.





Deice in cool cut-in temperature (°C) (°F)

P86 - De-ice in cool - cut-out temperature (AC only)

Range: 2...20°C/36...68°F

Default: 8°C / 46°F

The indoor unit coil temperature in which de-icing will stop.





Deice in cool cut-out temperature
(°C) (°F)

P87 - De-ice in heat time (AC only)

Range: 2...7 Minutes

Default: 5 Minutes

The length of de-icing procedure.



Deice in heat time

P88 - De-ice in heat break time (AC only)

Range: 10... 30 Minutes

Default: 25 Minutes

The time interval between de-icing cycles.



Deice in heat break time

Technician Settings P89 to P99

P89 - De-ice in heat - cut-in temperature (AC only)

Range: -9.5...+8°C / 15...46°F

Default: 0°C/32°F

The outdoor unit coil temperature in which de-icing will start.





Deice in heat cut-in temperature (°C) (°F)

P90 - De-ice in heat - cut-out temperature (AC only)

Range: 2...20°C/35...68°F

Default: 16°C / 61°F

The outdoor unit coil temperature in which de-icing will stop.





Deice in heat cut-out temperature (°C) (°F)

P91 - Compressor delay (AC only)

Range: 0...360 Seconds

Default: 240 Seconds

DIP Switch SW3.5 must be in "OFF" position – compressor delay enabled!



P98 - Display setpoint only (hide room temperature)

"00" - Display both setpoint and room temperatures

"01" - Display only the setpoint temperature





Show room temperature

Hide room temperature

P99 - One or Two setpoints (for cool and for heat)

"00" - One setpoint for cooling and heating

"01" - Two setpoints, one for cool and one for heat





One set point

Two set points

Technician Settings P101 to P109

P101 - Screen dimming delay

Range: 0...99 minutes

Default: 5 minutes



Screen dimming delay

P107 - Weekly program configuration

- "00" Disable weekly program (program parameters will be lost)
- "01" 7 days with the same program
- "02" One program for Monday to Friday and another program for Saturday and Sunday
- "03" One program for Monday to Friday, one for Saturday, and another for Sunday
- "04" 7 days with the different program for each day



Weekly program configuration

P108 - Weekly program - events per day

"00" - Two different events per day "01" - Four different events per day



Weekly program events per day

P109 - Weekly program event configuration

"00" - US Program: Event start time, Mode, Fan speed, Setpoints (one or two)

"01" - Eu program: Event start time, Stop time



Weekly program event configuration

Technician Settings P114 to P119

P114 - Cool PID Kp (FC only)

Range: 0...100%

Default: 100%



Cool PID Kp

P115 - Heat PID Kp (FC only)

Range: 0...100%

Default: 100%



Heat PID Kp

P116 - Cool PID Ki (FC only)

Range: 0...100%

Default: 0%



Cool PID Ki

P117 - Heat PID Ki (FC only)

Range: 0...100%

Default: 0%



Heat PID Ki

P118 - Cool PID Kd (FC only)

Range: 0...100%

Default: 1%



Cool PID Kd

P119 - Heat PID Kd (FC only)

Range: 0...100%

Default: 1%





Heat PID Kd

Technician Settings P122 to P187

P122 - Cool Proportional output threshold time (seconds) (FC only) Range: 0...100 seconds Default: 60 seconds P 122 Cool proportional threshold time P123 - Heat Proportional output threshold time (seconds) (FC Only!) Range: 0...100 seconds Default: 60 seconds P (23 Heat proportional Threshold time P160 - Minimum compressor ON time (AC only) Range: 0...20 minutes Default: 2 minutes P 160 Minimum compressor ON time P161 - Minimum compressor OFF time (AC only) Range: 0...20 minutes Default: 13 minutes P 16 1 Minimum compressor OFF time P170 - Economizer low limit temperature Range: 9...27°C / 48...80°F & ₩ & & Default: 17°C / 63°F P 170 P 170 Economizer low limit temperature (°C) (°F) P198 - Not in use P 198 Not in use P200 - Restore defaults - Press the [+] button - the display will change from "00" to "01". - Press the [On/Off] button to restore default settings. P200 P200 - The thermostat will turn Off. Restore defaults

Alarms and indications

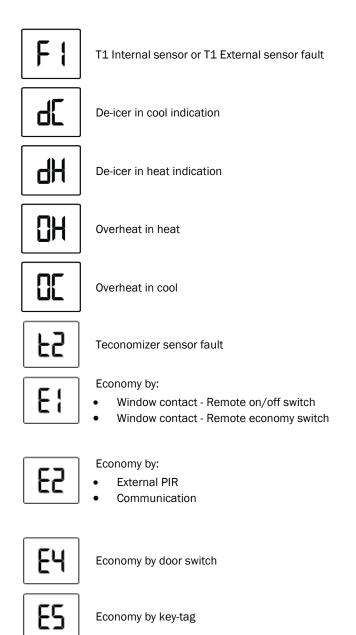



Document revision history

Date	Торіс	Change Description
1/25/24	Specifications	Updated Power specs
4/7/20	Installation	Updated installation height
	Alarms and indicators	Updated Teconomizer sensor fault image
	MAC address and BACnet Device instance number - In an Analog Network Output microblock	Added subsequent values
2/14/20	Operating instructions	Multiple revisions
	Weekly program	Multiple revisions
	Wiring and DIP switch configurations – AC systems – Output 14	Added (3) to each Config
	Technician Settings	Multiple revisions
	Alarms and indications	Added E1, E2, E4, and E5
9/9/19	Operating Instructions, P10	Added AC and FC configurations
	Operating Instructions, P11	Changed Remote economy switch settings
	Technician Settings, P34	Changed P11 default from 60 to 600 seconds
	Technician Settings, P35	Changed P17 range from 250 to 900 minutes
5/22/19	Technician Settings, P03	Changed 86c to 30c, changed 30f to 86f
2/21/19	FC configurations for 2-pipe systems	Changed configurations numbers from 20 through 23 to 10 through 13
	FC configurations for 4-pipe systems	Changed configurations numbers from 31 through 39 to 14 through 22
2/18/19	Specifications	Changed Mounting specification description
		Added CE and C-Tick icons to Compliance specification
	Installation	Changed step B and illustrations
	Technician Settings, P122 and P123	Changed from percent to time (seconds)



Carrier ©2024 · Catalog No. 11-808-722-01 · 1/26/2024