

45VMV---3
Sizes 12K-54K

Vertical Air Handler for Variable Refrigerant Flow (VRF)

Engineering Databook

Table of Contents

SPECIFICATIONS	2
DIMENSIONS	5
UNIT PLACEMENT	6
PIPING DIAGRAM.....	7
WIRING DIAGRAM.....	8
CAPACITY TABLES.....	9
ELECTRICAL CHARACTERISTICS	10
SOUND LEVELS	10
FAN PERFORMANCE	12



Fig. 1 —Unit Image

NOTE: Carrier is committed to continuously improving its products to ensure the highest quality and reliability standards, and to meet local regulations and market requirements. All features and specifications are subject to change without prior notice.

SPECIFICATIONS

Table 1 — Specifications (Sizes 12K-24K)

Model			45VMV12---3	45VMV18---3	45VMV24---3
Power supply			1-phase, 208/230V, 60Hz		
Cooling ¹	Capacity	kW	3.5	5.3	7
		Btu/h	12,000	18,000	24,000
	Power input	W	53	78	128
Heating ²	Capacity	kW	4	6.2	7.9
		kBtu/h	13.5	21	27
	Power input	W	53	78	128
Fan motor type			DC		
Indoor coil	Number of rows ³		4	4	4
	Tube pitch ³	In.	13/16×9/16		
	Fin spacing and type	fins/in.	17 Hydrophilic aluminum		
	Tube OD and type	In.	Φ1/4 Inner-groove		
	Dimensions (L×H×W)	In.	16-5/16×13-1/4×3		17-1/2×16-9/16×3
	Number of circuits		8	8	10
Air flow rate ⁴		cfm	402/389/375/362/348/ 335/321	602/572/542/512/482/ 452/422	804/764/723/683/643/ 602/562
External static pressure ⁵		in.wg	0.2(0-0.8)		
Sound pressure level ⁶		dB(A)	37/35/32.5/30.5/29/28/26	40/37.4/35/32/30/29/28	37.5/35/32/29/26/24/22
Unit	Net dimensions ⁷ (W×H×D)	In.	18-1/8×41-5/16×20-1/2		19-11/16×46-7/16×21-5/8
	Packed dimensions (W×H×D)	In.	20-3/4×42-3/8×24-3/16		22-5/16×47-1/2×25-3/8
	Net/Gross weight	Lbs	108/119		130/141
Refrigerant type			R454B		
Throttle type			Electronic expansion valve		
Design pressure (H/L)		psi	638/377		
Pipe connections	Liquid/Gas pipe	In.	Φ3/8/Φ3/4		
	Drain pipe	In.	OD Φ1		

NOTES:

- Indoor temperature 80°FDB, 67°FWB; outdoor temperature 95°FDB, 75°FWB; equivalent refrigerant piping length 295-1/4in. with zero level difference.
- Indoor temperature 70°FDB, 60°FWB; outdoor temperature 47°FDB, 43°FWB; equivalent refrigerant piping length 295-1/4in. with zero level difference.
- AHU adopts a brand-new special-shaped heat exchanger with different number of rows and different Tube pitch at different positions.
- Fan motor speed and air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
- Stable operation external static pressure range. (Note: setting external static pressure outside the unit's optimal static pressure range may lead to higher noise levels and lower airflow rate. For the optimal external static pressure range refer to the unit's installation manual.)
- Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured 59-1/16in. below the unit in an anechoic chamber.
- The dimension is only the body size, excluding the size of the installation lug, connecting copper pipe, etc. For detailed dimensions, please refer to the installation manual.

Table 2 — Specifications (Sizes 30K-48K)

Model			45VMV30---3	45VMV36---3	45VMV48---3
Power supply			1-phase, 208/230V, 60Hz		
Cooling ¹	Capacity	kW	8.8	10.6	14.1
		kBtu/h	30	36	48
	Power input	W	142	192	246
Heating ²	Capacity	kW	10	11.7	15.8
		kBtu/h	34	40	54
	Power input	W	142	192	246
Fan motor type			DC		
Indoor coil	Number of rows ³		4	4	4
	Tube pitch ³	In.	13/16/×9/16		
	Fin spacing and type	fins/in.	17 Hydrophilic aluminum		
	Tube OD and type	In.	Φ1/4 Inner-groove		
	Dimensions (L×H×W)	In.	17-1/2×16-9/16×3		20-1/16×21-1/2×3
	Number of circuits		10	10	12
Air flow rate ⁴		cfm	1005/955/904/854/804/753/703	1205/1145/1085/1025/964/844	1607/1527/1446/1366/1286/1205/1125
External static pressure ⁵		in.wg	0.2(0-0.8)		
Sound pressure level ⁶		dB(A)	37.5/35/32/29/26/24/22	36/32.5/30.5/28/25.5/23/21.5	39/36/33.5/31.5/30/28/26
Unit	Net dimensions ⁷ (W×H×D)	In.	19-11/16×46-7/16×21-5/8		22-1/16×54-1/2×24
	Packed dimensions (W×H×D)	In.	22-5/16×47-1/2×25-3/8		24-11/16×55-9/16×27-3/4
	Net/Gross weight	Lbs	130/141		150/165
Refrigerant type			R454B		
Throttle type			Electronic expansion valve		
Design pressure (H/L)		MPa (psi)	4.4/2.6 (638/377)		
Pipe connections	Liquid/Gas pipe	In.	Φ3/8/Φ3/4		
	Drain pipe	In.	OD Φ1		

NOTES:

- Indoor temperature 80°FDB, 67°FWB; outdoor temperature 95°FDB, 75°FWB; equivalent refrigerant piping length 295-1/4in. with zero level difference.
- Indoor temperature 70°FDB, 60°FWB; outdoor temperature 47°FDB, 43°FWB; equivalent refrigerant piping length 295-1/4in. with zero level difference.
- AHU adopts a brand-new special-shaped heat exchanger with different number of rows and different Tube pitch at different positions.
- Fan motor speed and air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
- Stable operation external static pressure range. (Note: setting external static pressure outside the unit's optimal static pressure range may lead to higher noise levels and lower airflow rate. For the optimal external static pressure range refer to the unit's installation manual.)
- Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured 59-1/16in. below the unit in an anechoic chamber.
- The dimension is only the body size, excluding the size of the installation lug, connecting copper pipe, etc. For detailed dimensions, please refer to the installation manual.

Table 3 — Specifications (Size 54K)

Model			45VMV54---3
Power supply			1-phase, 208/230V, 60Hz
Cooling ¹	Capacity	kW	15.8
		kBtu/h	54
	Power input	W	450
Heating ²	Capacity	kW	17.6
		kBtu/h	60
	Power input	W	450
Fan motor type			DC
Indoor coil	Number of rows ³		4
	Tube pitch ³	In.	13/16×9/16
	Fin spacing and type	fins/in.	17 Hydrophilic aluminum
	Tube OD and type	In.	Φ1/4 Inner-groove
	Dimensions (L×H×W)	In.	20-1/16×21-1/2×3
	Number of circuits		12
Air flow rate ⁴		cfm	1808/1718/1627/1537/1447/1356/1266
External static pressure ⁵		in.wg	0.2(0-0.8)
Sound pressure level ⁶		dB(A)	39/36/34/31.5/29/25/22
Unit	Net dimensions ⁷ (W×H×D)	In.	22-1/16×54-1/2×24
	Packed dimensions (W×H×D)	In.	24-11/16×55-9/16×27-3/4
	Net/Gross weight	Lbs	150/165
Refrigerant type			R454B
Throttle type			Electronic expansion valve
Design pressure (H/L)		MPa (psi)	4.4/2.6 (638/377)
Pipe connections	Liquid/Gas pipe	In.	Φ3/8/Φ7/8
	Drain pipe	In.	OD Φ1

NOTES:

- Indoor temperature 80°FDB, 67°FWB; outdoor temperature 95°FDB, 75°FWB; equivalent refrigerant piping length 295-1/4in. with zero level difference.
- Indoor temperature 70°FDB, 60°FWB; outdoor temperature 47°FDB, 43°FWB; equivalent refrigerant piping length 295-1/4in. with zero level difference.
- AHU adopts a brand-new special-shaped heat exchanger with different number of rows and different Tube pitch at different positions.
- Fan motor speed and air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
- Stable operation external static pressure range. (Note: setting external static pressure outside the unit's optimal static pressure range may lead to higher noise levels and lower airflow rate. For the optimal external static pressure range refer to the unit's installation manual.)
- Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured 59-1/16in. below the unit in an anechoic chamber.
- The dimension is only the body size, excluding the size of the installation lug, connecting copper pipe, etc. For detailed dimensions, please refer to the installation manual.

DIMENSIONS

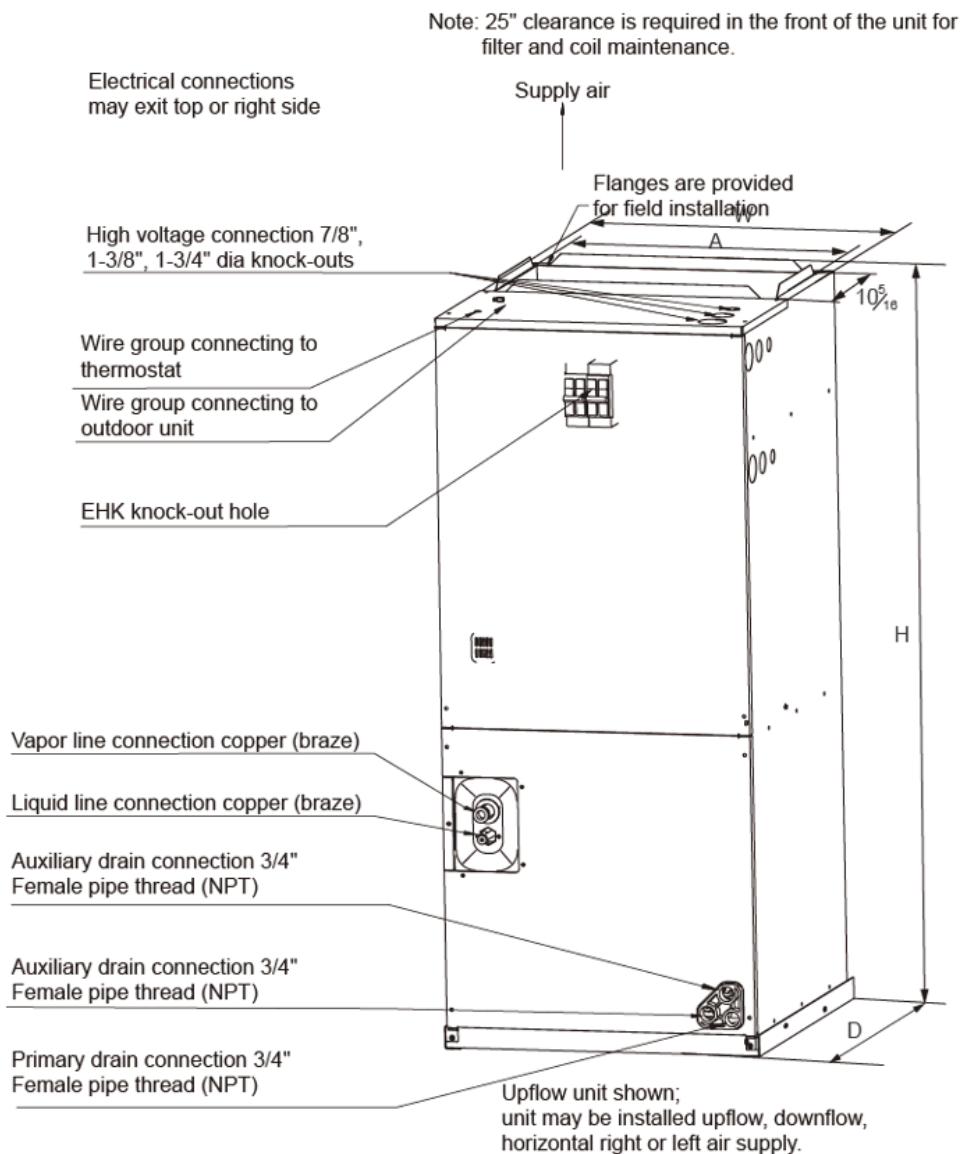


Fig. 2 —Dimensions - All Sizes

Table 4 — Dimensional Data

Model Size	Unit Height "H" in. [mm]	Unit Width "W" in. [mm]	Unit Length "L" in. [mm]	Supply Duct "A"	Unit Weight (lbs {kg})
12	41-15/16 [1050]	18-1/8 [460]	20-1/2 [520]	16 [406]	108 [49]
18	41-15/16 [1050]	18-1/8 [460]	20-1/2 [520]	16 [406]	108 [49]
24	46-7/8 [1180]	19-3/4 [500]	21-5/8 [550]	18 [456]	130 [59]
36	46-7/8 [1180]	19-3/4 [500]	21-5/8 [550]	18 [456]	130 [59]
48	54-1/2 [1385]	22-1/16 [560]	24 [610]	19-1/2 [496]	157 [71]
54	54-1/2 [1385]	22-1/16 [560]	24 [610]	19-1/2 [496]	157 [71]

UNIT PLACEMENT

PLACEMENT CONSIDERATION

Unit placement should take account of the following considerations:

Units should not be installed in the following locations:

- A place filled with mineral oil, fumes or mist, like a kitchen.
- A place where there are corrosive gases, such as acid or alkaline gases.
- A place exposed to combustible gases and using volatile combustible gases such as diluent or gasoline.
- A place where there is equipment emitting electromagnetic radiation.
- A place where there is a high salt content in the air like a coast.
- Do not use the air conditioner in an environment where an explosion may occur.
- Places like in vehicles or cabin rooms.
- Factories with major voltage fluctuations in the power supplies.
- Other special environmental conditions.

Units should be installed in positions where:

- Ensure that the airflow in and out of the IDU is reasonably organized to form an air circulation in the room.
- Ensure IDU maintenance space.
- The nearer the drainage pipe and copper pipe are to the ODU, the lower the pipe cost is.
- Prevent the air conditioner from blowing directly to the human body.
- The closer the wiring to the power cabinet, the lower the wiring cost is.
- Keep the air-conditioning return air away from the setting sun of the room.
- Be careful not to interfere with the light tank, fire pipe, gas pipe and other facilities.
- The IDU should not be lifted in the places like load-bearing beam and columns that affect the structural safety of the house.
- Wired controller and IDU should be in same installation space; otherwise, the sampling point setting of wired controller will need to be changed.

SPACE REQUIREMENTS

AHU Space Requirements (unit: in.)

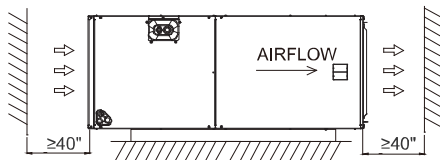


Fig. 3 —Clearances in the Horizontal Position

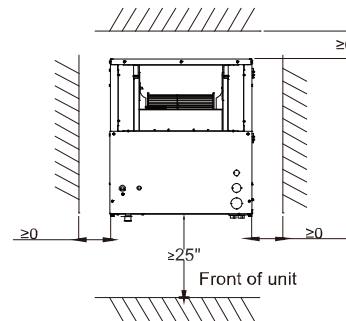


Fig. 4 —Clearances in the Vertical Position

NOTE: The centerline of the maintenance hole should be in the same position as the centerline of the indoor unit.

PIPING DIAGRAM


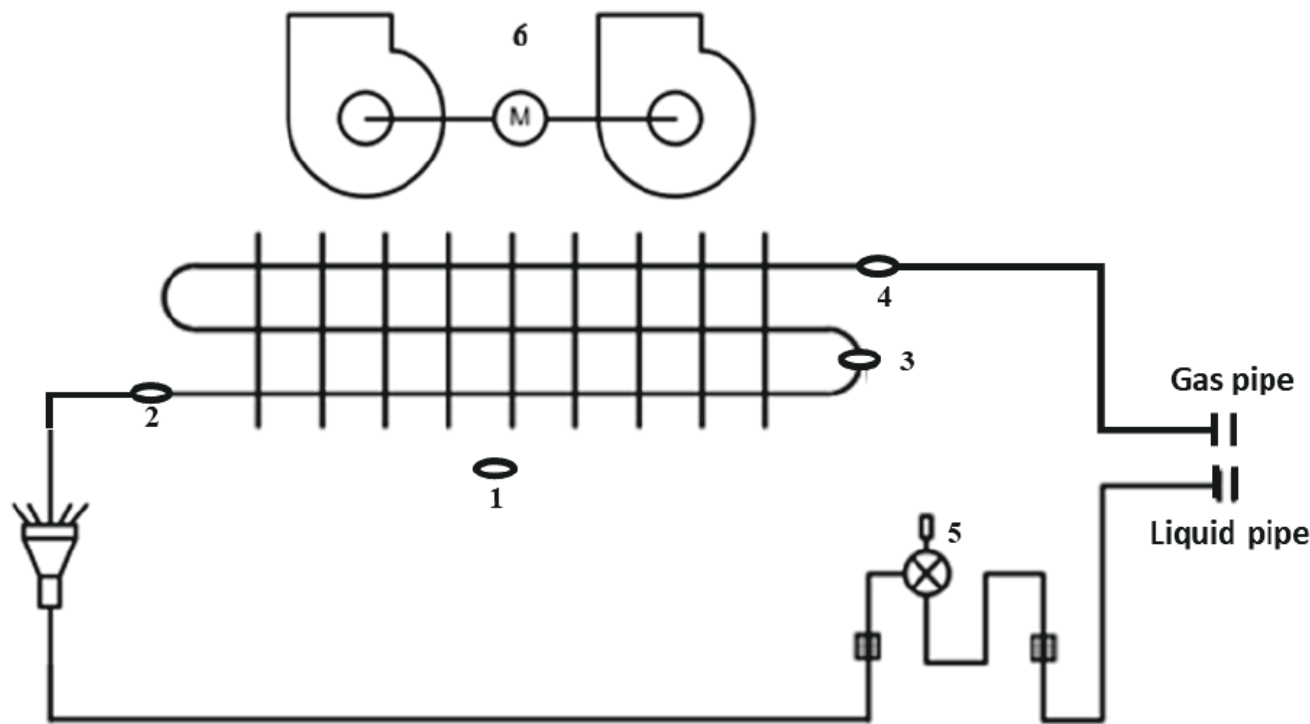


Fig. 5 —Piping Diagram

Table 5 — Legend

Legend	Code	Description
1	T1	Inlet Air Temp. Sensor
2	T2A	Liquid Pipe Temp. Sensor
3	T2	Middle Pipe Temp. Sensor
4	T2B	Gas Pipe Temp. Sensor
5	EEV	Electronic Expansion Valve
6	FAN	DC Fan motor

WIRING DIAGRAM

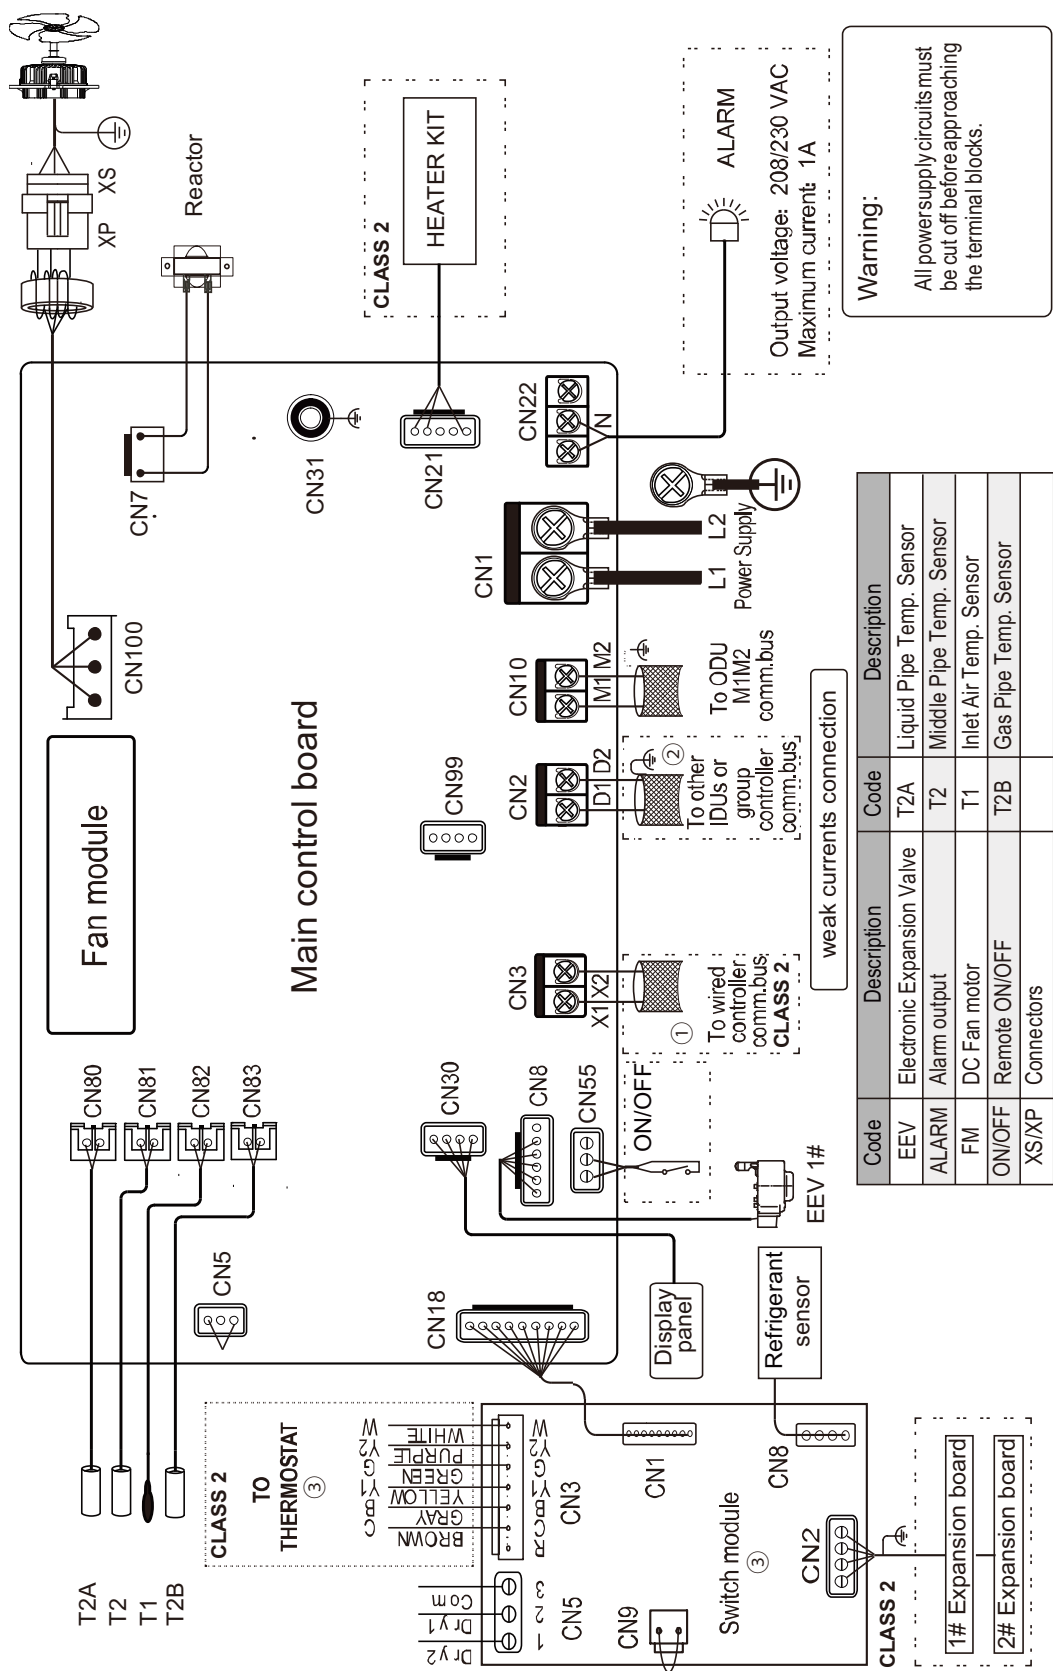

Warning:
All powersupply circuits must be cut off before approaching the terminal blocks.

Caution:

- Power cords should be effectively fixed!
- Confirm the reliability of wiring connection before power on!
- The wiring diagram shown is for reference only!

Notes:

- ① X1, X2 communication ports can be connected to the wired controller.
- ② D1, D2 communication ports are used for group control communication.
- ③ Please refer to the user manual for detailed functions of the switch module.

..... : means optional parts or functions
..... : means customized parts or functions
..... : for specific models only

Fig. 6 —Wiring Diagram



CAUTION

All installation, servicing and maintenance must be carried out by competent and suitably qualified, certified and accredited professionals and in accordance with all applicable legislation.

Units should be grounded in accordance with all applicable legislation. Metal and other conductive components should be insulated in accordance with all applicable legislation.

Power supply wiring should be securely fastened at the power supply terminals – loose power supply wiring would represent a fire risk.

After installation, servicing or maintenance, the electric control box cover should be closed. Failing to close the electric control box cover risks fire or electric shock.

The dotted lines indicate the field wiring or optional function.

D1D2 communication ports are used for group control communication. When connecting the group controller, the D1D2 port of the indoor units that are to be group controlled must be connected in daisy chain, and the group controller must be connected to the X1X2 port of one of the indoor units in the group control, and set to group control mode. In addition, D1D2 communication ports can also be connected to the central controller.

CAPACITY TABLES

Table 6 — Cooling Capacity Table

Model	Indoor air temperature (°C WB/DB)													
	14/20		16/23		18/26		19/27		20/28		22/30		24/32	
	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC
45VMV12---3	10.6	9.9	11.3	9.9	11.9	10.2	12.0	9.6	12.3	9.6	12.6	9.2	13.0	8.9
45VMV18---3	16.0	15.0	17.1	15.0	18.1	15.4	18.0	14.7	18.4	14.3	18.8	13.6	19.4	13.3
45VMV24---3	21.2	19.8	22.5	19.8	23.5	19.8	24.0	19.4	24.2	18.8	24.9	18.1	25.6	17.4
45VMV36---3	32.1	30.0	34.1	30.0	35.8	30.0	36.0	29.0	36.5	28.3	37.5	27.3	38.6	26.3
45VMV48---3	42.7	39.9	45.4	40.3	47.4	39.9	48.0	38.9	48.8	37.9	49.8	35.8	51.2	34.8
45VMV54---3	47.8	45.0	50.8	45.0	53.2	45.0	54.0	43.7	54.6	42.3	56.0	40.3	57.3	38.9

ABBREVIATIONS:

TC: Total capacity (kBtu/h)

SC: Sensible capacity (kBtu/h)

NOTE: Shaded cells indicate rating condition.

Table 7 — Heating Capacity Table

Model	Indoor air temperature (°C WB/DB)					
	16	18	20	21	22	24
	SHC	SHC	SHC	SHC	SHC	SHC
45VMV12---3	14.3	14.2	13.5	13.1	12.8	12.0
45VMV18---3	22.4	22.2	21.0	20.4	19.9	18.5
45VMV24---3	28.6	28.3	27.0	26.0	25.3	23.5
45VMV36---3	42.3	41.9	40.0	38.5	37.5	0.0
45VMV48---3	57.1	56.6	54.0	52.3	50.7	46.9
45VMV54---3	63.7	63.1	60.0	58.2	56.4	52.2

ABBREVIATIONS:

SHC: Sensible Heat Capacity (kBtu/h)

NOTE: Shaded cells indicate rating condition.

ELECTRICAL CHARACTERISTICS

Model name	Power supply				Indoor Fan Motor
	Hz	Volts	MCA	MFA	Rated motor output (W)
45VMV12---3	60	208/230	3.38	15	375
45VMV18---3	60	208/230	3.38	15	375
45VMV24---3	60	208/230	5.08	15	375
45VMV30---3	60	208/230	5.08	15	375
45VMV36---3	60	208/230	5.08	15	375
45VMV48---3	60	208/230	5.65	15	750
45VMV54---3	60	208/230	5.65	15	750

SOUND LEVELS

OVERALL

Table 8 — Sound Pressure Levels

Model name	Sound pressure levels dB						
	SSH	SH	H	M	L	SL	SSL
45VMV12---3	37	35	32.5	30.5	29	28	26
45VMV18---3	40	37.4	35	32	30	29	28
45VMV24---3	37.5	35	32	29	26	24	22
45VMV30---3	37.5	35	32	29	26	24	22
45VMV36---3	36	32.5	30.5	28	25.5	23	21.5
45VMV48---3	39	36	33.5	31.5	30	28	26
45VMV54---3	39	36	34	31.5	29	25	22

NOTE: The sound pressure level is measured in an anechoic chamber at a distance of 1.5m(59-1/16in.) below the unit, under the default static pressure setting at the factory. During on-site operation, the sound pressure level may be higher due to the influence of environmental noise.

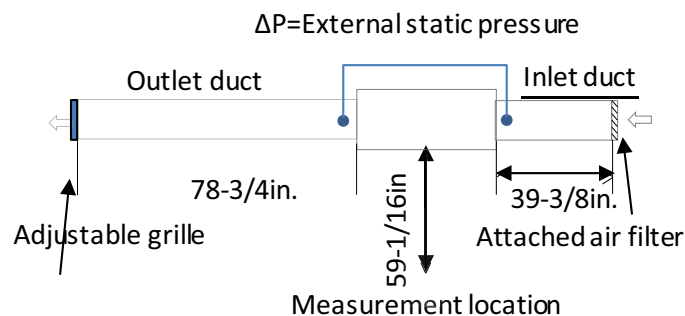


Fig. 7 —Sound Pressure Level Measurement

Connected to a top-discharge outdoor unit and measured in anechoic room. Adjusting the outlet grille to make the ΔP is equal to the rated static pressure, the data was recorded at 1.5m below the unit.

OCTAVE BAND LEVELS

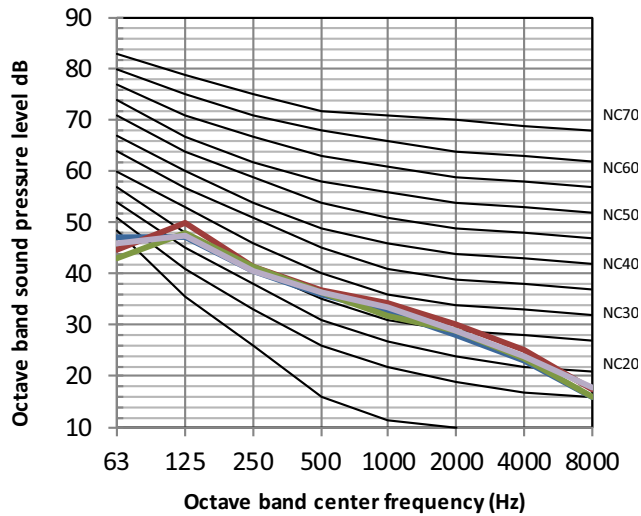


Fig. 8 —45VMV12---3

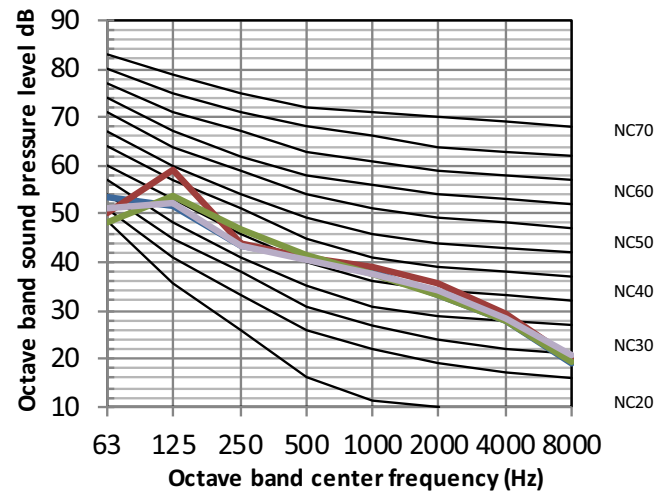


Fig. 11 —45VMV30---3

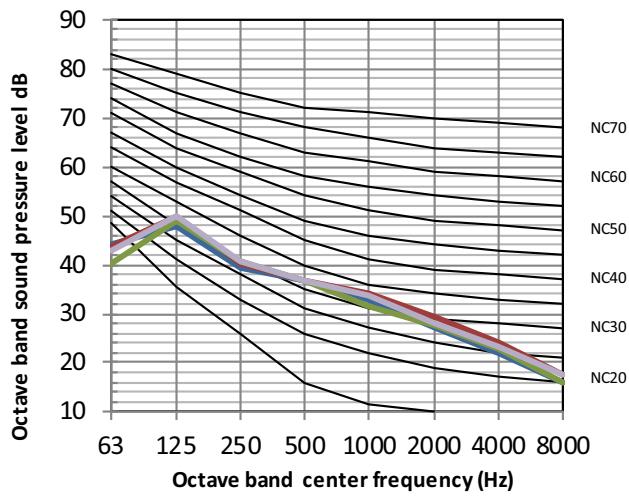


Fig. 9 —45VMV18---3

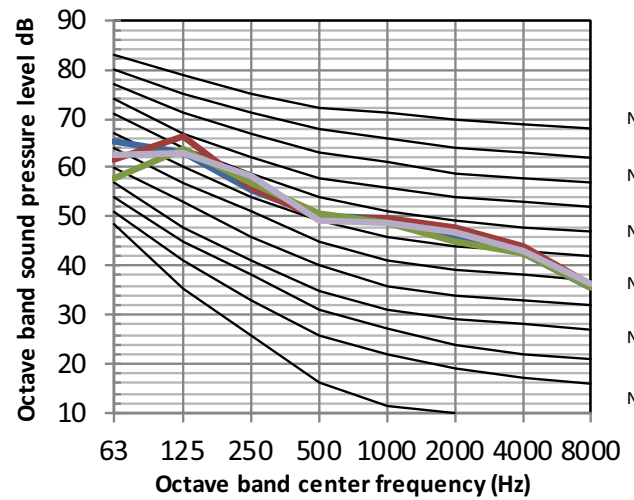


Fig. 12 —45VMV36---3

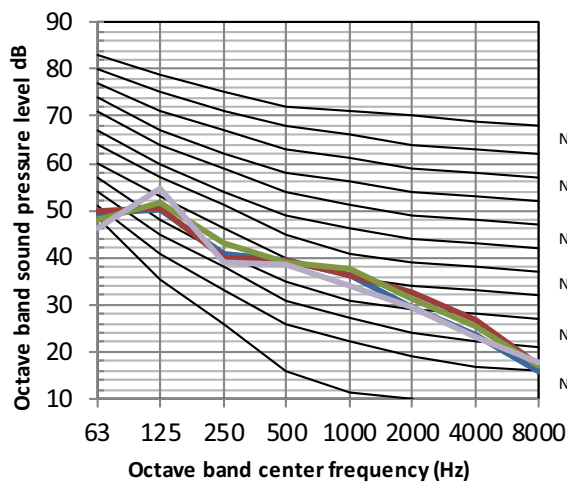


Fig. 10 —45VMV24---3

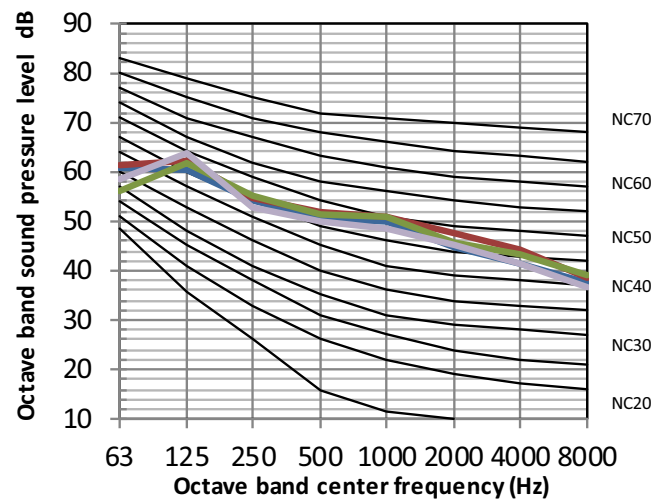


Fig. 13 —45VMV48---3

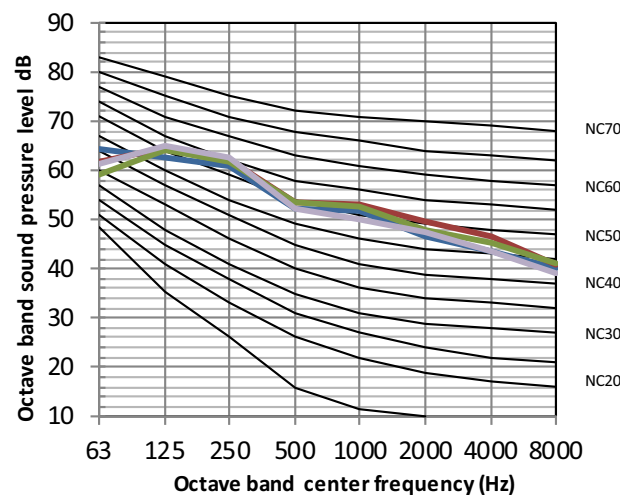


Fig. 14 —45VMV54---3

FAN PERFORMANCE

How to switch between Constant Airflow mode and Constant Speed mode

Use the wired controller (for example, WDC3-120T2) to enter engineering settings.

- Parameters can be set in the power-on or power-off state.
- Hold "≡" and ">" for 3 seconds to enter the parameter setting interface.
- After entering the parameter setting interface, Press "∨" and "∧" to switch the parameter. Set parameters according to the Table of Parameter Settings. Press "○" to enter the parameter setting interface.

Then press "<" and ">" to change parameter value and press "○" to save changes.

- Press the "back" button to return to the previous page until exiting the parameter setting or exiting the parameter setting after 60 s without any operation.
- When it is in the parameter settings page, the wired controller does not respond to any remote control signal.

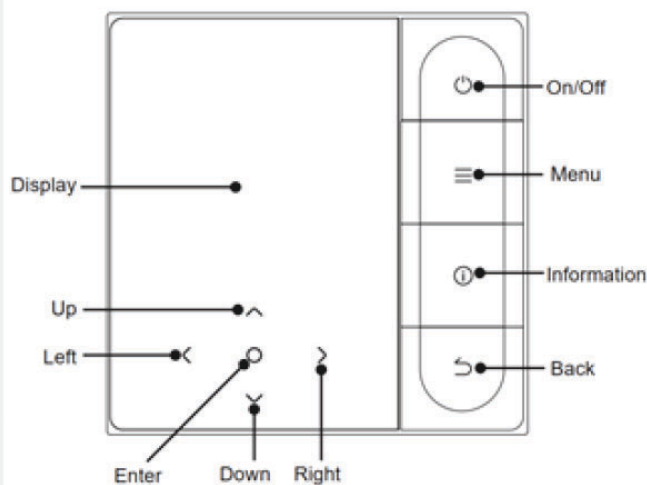


Table 9 — Mode Setting

IDU set item	Parameter name	Parameter range	Default value	Remarks
Fan speed setting	Air flow at fan speed 7	00/01	01	00: constant speed; 01: constant air flow

CONSTANT AIRFLOW MODE

FAN PERFORMANCE DIAGRAMS

How to Read the Following Diagrams

The vertical axis is the External Static Pressure (Pa) while the horizontal axis represents the Air Flow (m^3/h). The characteristic curve for the “SSH”, “SH”, “H”, “M”, “L”, “SL” and “SSL” fan speed control.

For MIH54VMN10, in “H” windshield, when the external static pressure is less than 63.7 Pa, the air flow keeps 1249 m^3/h , but when the external static pressure is greater than 63.7 Pa, the air flow begins to decline, and the allowable maximum external static pressure is 74 Pa.

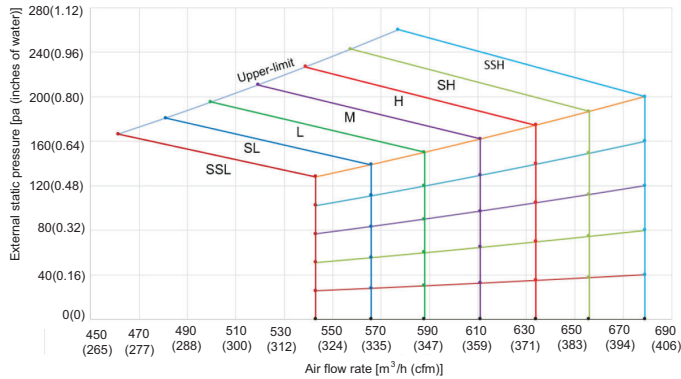


Fig. 15 —45VMV12---3

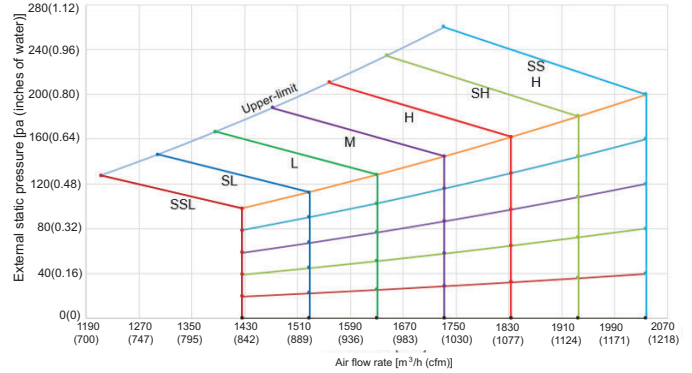


Fig. 18 —45VMV36---3

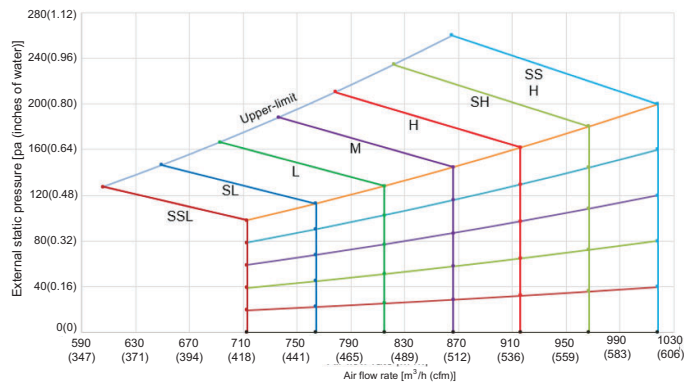


Fig. 16 —45VMV18---3

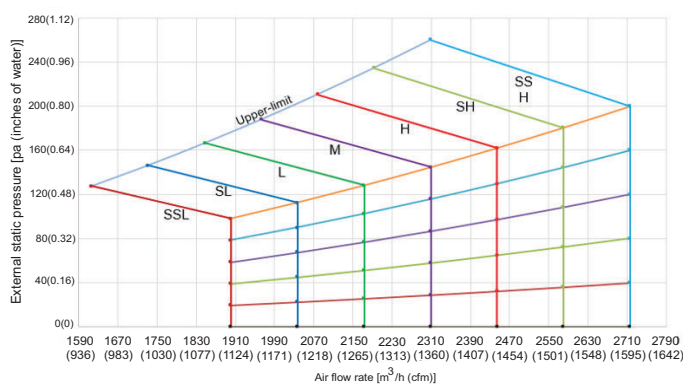


Fig. 19 —45VMV48---3

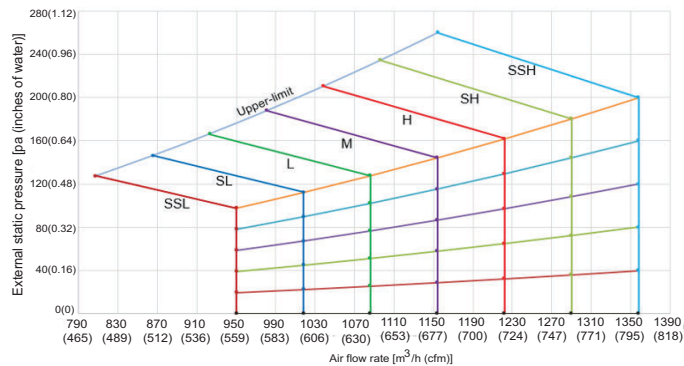


Fig. 17 —45VMV24---3

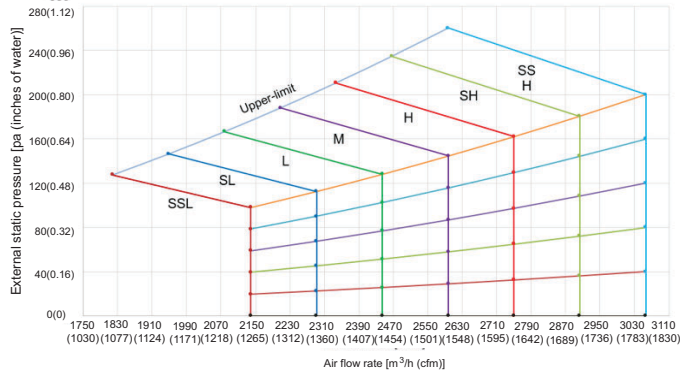


Fig. 20 —45VMV54---3

CONSTANT SPEED MODE**Table 10 — External Static Pressure Setting**

IDU set item	Parameter name	Parameter range	Default value	Remarks
On-site settings	IDU static pressure	00/01-19/FF	FF	IDU static pressure is set based on the parameter value.

Level	00	01	02	03	04	05	06	07	08	09	10
Static pressure Pa((in.wg)	0(0.00)	10(0.04)	20(0.08)	30(0.12)	40(0.16)	50(0.2)	60(0.24)	70(0.28)	80(0.32)	90(0.36)	100(0.4)
Level	11	12	13	14	15	16	17	18	19		
Static pressure Pa((in.wg)	110(0.44)	1200(0.48)	130(0.52)	140(0.56)	150(0.6)	160(0.64)	170(0.68)	180(0.72)	200(0.8)		

NOTE: The above is only an example of WDC3-120T2 wired controller. If you choose other controllers, refer to their manuals for setting.

FAN PERFORMANCE DIAGRAMS

How to Read the Following Diagrams

The vertical axis is the External Static Pressure (Pa) while the horizontal axis represents the Air Flow (m^3/h). The characteristic curve for the “SSH”, “M” and “SSL” fan speed control.

The Air Flow decreases with the increase of the external static pressure. For MIH54VMN10, in “SSH” windshield and “50Pa” setting static pressure, when the external static pressure is 50Pa, the air flow is 1400 m^3/h , and the allowable external static pressure range is 39 to 62.

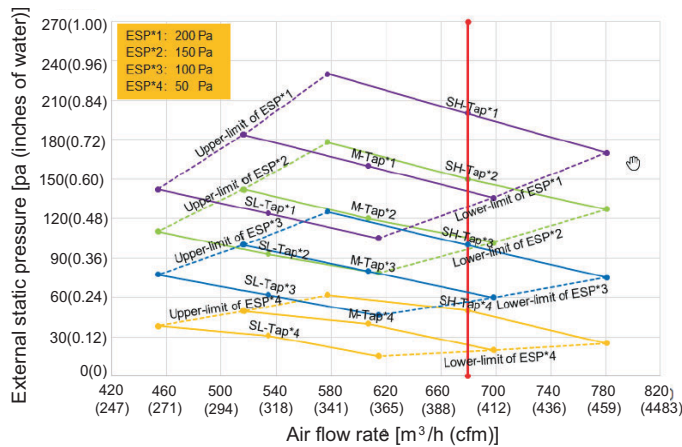


Fig. 21 —45VMV12---3

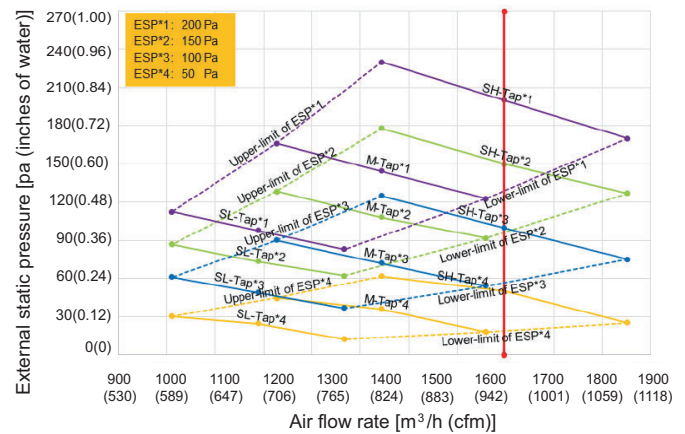


Fig. 24 —45VMV30---3

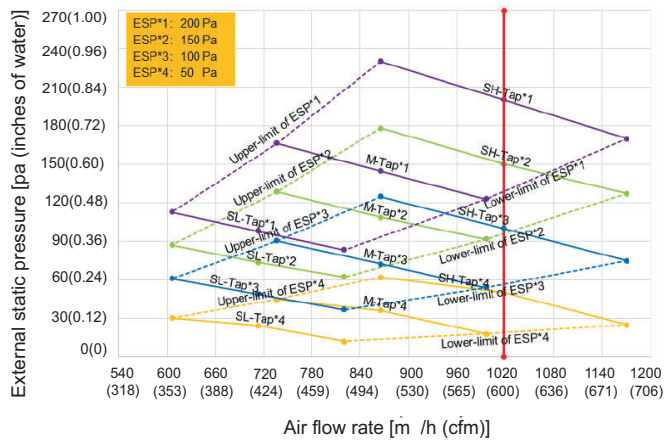


Fig. 22 —45VMV18---3

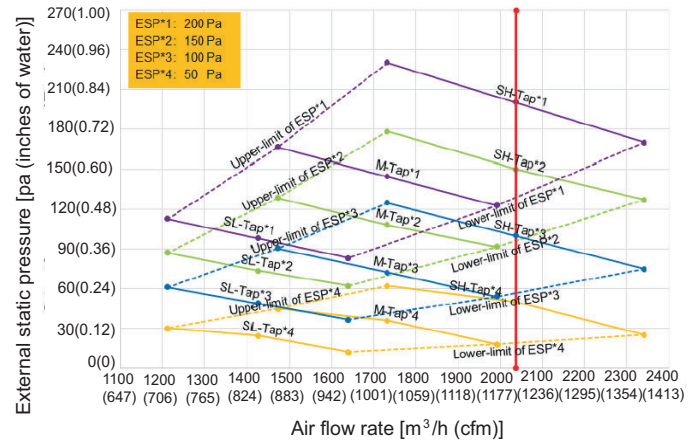


Fig. 25 —45VMV36---3

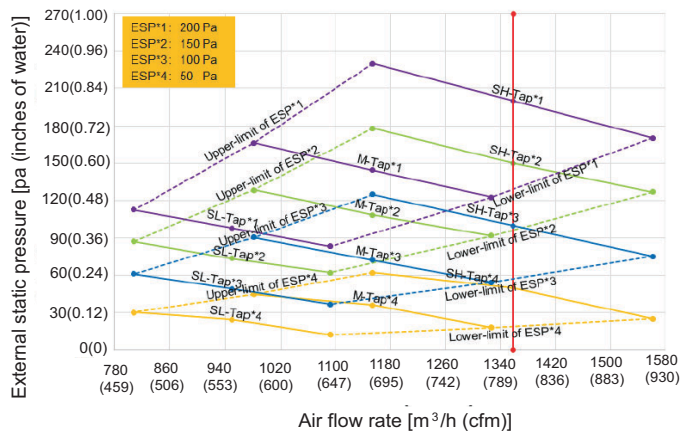


Fig. 23 —45VMV24---3

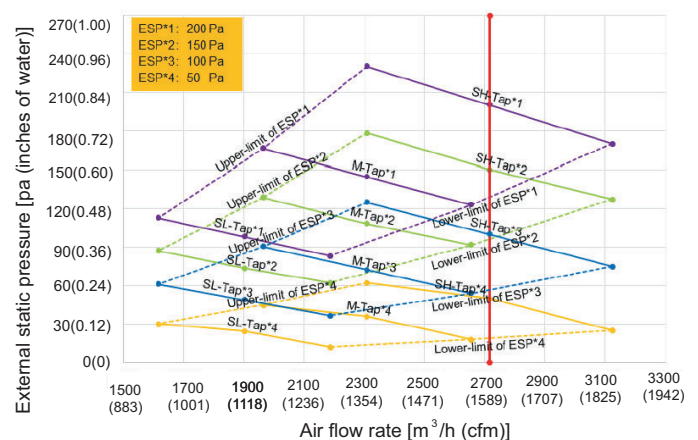


Fig. 26 —45VMV48---3

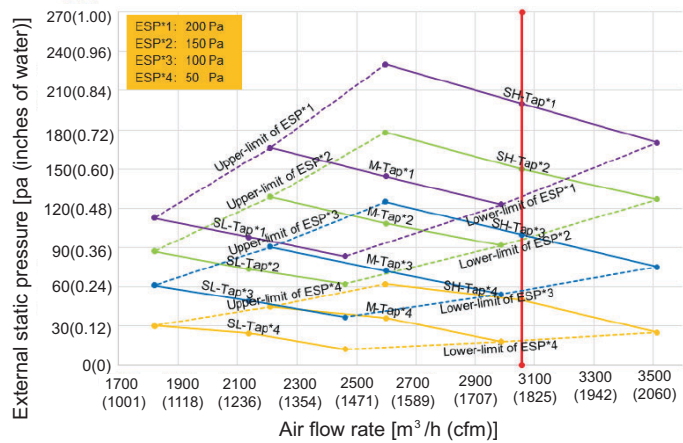


Fig. 27 —45VMV54---3