


Product Data

Vertical and Horizontal Unit Ventilator

Models 40UV,UH 750-1500 Nominal cfm

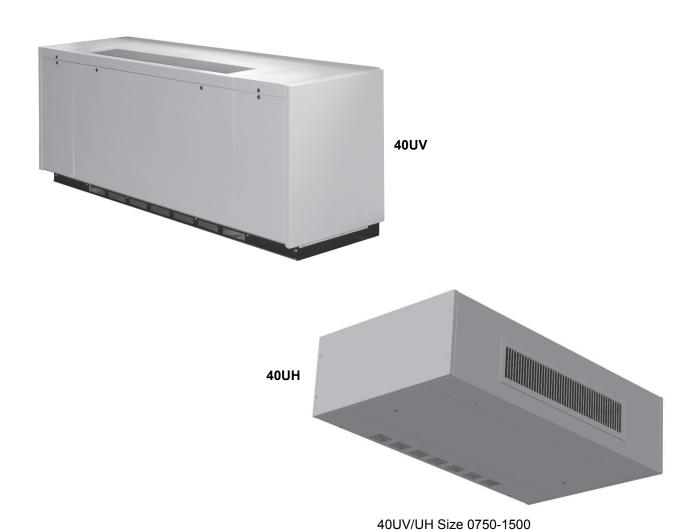

© 2024 Carrier Form 40UV-UH-6PD

Floor and Ceiling Mounted Unit Ventilator

Features/Benefits



The 40UV and 40UH unit ventilators are designed to be tough, dependable, aesthetically pleasing, quiet, and easy to install.

Carrier's 40U unit ventilators offer:

- Strict indoor air quality requirements of schools, hospitals, and institutions.
- Built with heavy duty construction and incorporates a draw-through design.
- Discharge temperature is controlled using either a face-and-bypass damper or modulating control valve.
- Available adapter backs in various configurations allow for easy upgrades to existing systems, and optional factory installed controls have been engineered to ease installation.
- Able to be configured for direct expansion (DX) cooling, chilled water, hot water, steam, or a combination of both chilled and hot water (two pipe and four pipe configurations), chilled water and steam, DX and hot water, or DX and steam.
- Constructed in accordance with UL and CSA standards with a label affixed to the unit listing the product code under which it is registered.

Cabinet

Prior to assembly, the cabinet parts shall be degreased and coated with an electro-statically applied baked-on polyester powder paint and is insulated with acoustic foam containing no fibrous materials. The foam insulation shall have a fire rating of UL94 HF1.

For floor mounted units, the exterior panels of the cabinet shall be constructed of 16 gauge sheet metal. For ceiling mounted units, the exterior panels of the cabinet shall be constructed of 18 gauge sheet metal.

The front panel and compartment panels shall be easily removable with tamper-proof fasteners securing it to the rest of the unit cabinet. The back of the cabinet shall have an opening for connection to a wall sleeve and louver.

Control panel

The control panel is located in the lefthand compartment. All components located in the panel shall be clearly marked for easy identification. All terminal blocks and wire shall be individually numbered. All electrical wires in the control panel shall be run in an enclosed trough. Wiring outside of the control panel shall be run in protective sleeves.

The unit will be provided with a power disconnect sized for the full load amperage of the unit to enable the unit to be disconnected from the power supply prior to any maintenance.

The 3-speed selector switch enables adjustment of the supply air volume. Reduction in fan speed shall be achieved by a step down multi-tap transformer.

Water/steam coil

Large surface area slab coils for optimal heat transfer and airflow.

Evaporator

All direct expansion units include a factory installed thermal expansion valve and utilize large surface area

evaporator coils ideally positioned to optimize heat transfer and airflow. Each evaporator is manufactured from refrigeration quality copper tubes with mechanically bonded aluminum fins. Evaporator coils include a factory-installed low limit stat.

Drain pan

Each unit shall be fitted with a 20 gauge, 304 stainless steel welded construction drain pan sloped in 3 directions. The condensate drain pan connection will be located on the same side as the cooling coil connection and include a 3/4 in. reinforced condensate tubing and splashguard over the drain port.

Supply fan

Supply airflow is provided by a double inlet, forward curved, centrifugal type fan with offset aerodynamic blades. The assembly shall be statically and dynamically balanced to ensure smooth running and minimum noise levels. The fan assembly shall be positioned for a "draw through" configuration.

Fan motor

The fan motor is an electronically commutated type complete with integral automatic thermal overload protection. The fan and motor assembly shall be direct drive type with motor and bearings positioned outside of the air-stream.

Table of contents


Page
Features/Benefits
Model Number Nomenclature
Physical Data4
Options
Base Unit Dimensions
Performance Data
Electrical Data
Application Data
Controls
Guide Specifications

Model number nomenclature

C - RH Cooling - LH Heating

D - LH Cooling - RH Heating



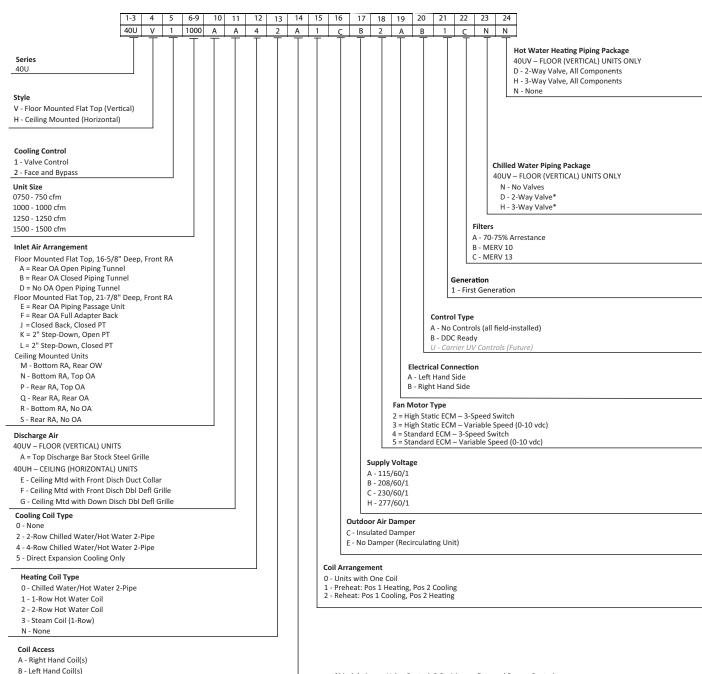

*Modulating on Valve Control, 2-Position on Face and Bypass Control. All 2-way and 3-way valve packages include shut-off valves, strainer, circuit setter, and a balancing valve for 3-way valve units.

Physical data



40UV/UH Physical Data

UNIT 40UV, UH	0750	1000	1250	1500					
NOMINAL AIRFLOW (cfm)	750	1000	1250	1500					
UNIT OPERATING WEIGHT									
Floor Mounted, 16-5/8 in. Units (lb)	410	470	525	580					
Floor Mounted, 21-7/8 in. Units (lb)	445	510	570	630					
Ceiling Mounted Units (lb)	510	580	645	710					
SUPPLY FANS		1	1	1					
Туре		Direct Drive	: Centrifugal						
Quantity	2	3	4	4					
Diameter (in.)		8.	06						
Width (in.)	7.15								
AIR FILTERS									
Nominal Size (in.)	10 x 36 x1	10 x 24 x1	10 x 30 x1	10 x 36 x1					
Quantity	1	2	2	2					
SUPPLY FAN MOTOR		-		•					
Standard Motor (40UV Units Only)									
Туре	ECM - Electronically Commutated Motor								
Size (hp)		1.	/3						
Airflow									
High/Med/Low - CW/HW and DX (cfm)	750/650/500	1000/750/600	1250/900/750	1500/1100/900					
Max. External Static Pressure (in. wg)		0.	05						
High Static Motor (40UH or 40UV Units)									
Type (Premium High Static)		ECM - Electronically	Commutated Motor						
Size (hp)		1.	/2						
Airflow									
High/Med/Low - CW/HW (cfm)	750/650/500	1000/750/600	1250/900/750	1500/1100/900					
High/Med/Low - DX Cooling (cfm)	750/650/500	1000/750/600	1250/900/750	1500/1100/900					
Max. External Static Pressure (in. wg)		0.:	25						
COIL WATER VOLUME (gal)									
1-Row	0.32	0.38	0.44	0.50					
2-Row	0.51	0.63	0.76	0.88					
4-Row	0.92	1.17	1.42	1.66					
COIL CONNECTIONS (in. OD)	1	•	•	•					
Water Coils - Standard Units		Unions with 3/4 in.	female solder joint						
Water Coils - Units with Piping Package	Chilled W	/ater: 3/4 in. NPT drop ea	ar, Hot Water: 1/2 in. NP	T drop ear					
Evaporator Coil Steam Coils (All Units)			ı, 1/2 in. OD Liquid NPT						
Condensate Line			ndensate line						
TOTAL STREET	l	5/7 III. ID COI	idonodio inio						

Options



Available Options^a

	UNIT SE	IES — 40U	
OPTIONS OR STANDARD FEATURES	Vertical (Floor)	Horizontal (Ceiling)	
	UV	UH	
CABINET CONSTRUCTION			
16 Gauge	Std	N/A	
18 Gauge	N/A	Std	
COILS	1		
Chilled Water Coil	Х	X	
Direct Expansion Evaporator Coil	Х	Х	
Hot Water Coil	Х	Х	
Steam Coil	Х	Х	
COIL CONNNECTION	1		
Left Hand	Х	Х	
Right Hand	Х	Х	
RH Cooling/LH Heating	Std	Std	
LH Cooling/RH Heating	Х	Х	
STAINLESS STEEL DRAIN PAN	Std	Std	
DISCHARGE OPTIONS	1		
Floor Mounted Bar Grille With Screen	Х	N/A	
Ceiling Mounted Front Discharge With Duct Collar	N/A	Х	
Ceiling Mounted Front Disch. With Dbl Defl. Grille	N/A	Х	
Ceiling Mounted Down Disch. with Dbl. Defl. Grille	N/A	Х	
DAMPERS	1		
Outside Air	Х	Х	
Face and Bypass	Х	X	
CONDENSATE PUMP	Х	Х	
COIL POSITION			
Pre-Heat	Х	X	
Re-Heat	Х	X	
FILTERS	1		
Throwaway 1 in. (70-75 Arrestance)	Std	Std	
1 in. MERV 10	Х	Х	
1 in. MERV 13	Х	Х	
MOTORS	1	L	
ECM 3-Speed Switch (High Static)	Х	Х	
ECM 0-10 vdc (High Static)	Х	X	
ECM 3-Speed Switch (Standard)	Х	N/A	
ECM 0-10 vdc (Standard)	Х	N/A	
INLET AIR OPTIONS	•		
Rear Outside Air	Х	Х	
No Outside Air	Х	Х	
Top Outside Air	N/A	Х	
Front Return Air	Х	N/A	
Bottom Return Air	N/A	Х	
Rear Return Air	N/A	Х	
	•		

Available Options^a

	UNIT SEF	RIES — 40U
OPTIONS OR STANDARD FEATURES	Vertical (Floor)	Horizontal (Ceiling)
	UV	UH
PAINT OPTIONS		
Beige	Std	Std
Sky White	Х	X
Light Grey	X	Х
CONTROLS		
Field Installed By Others	Std	Std
DDC Ready	Х	Х
Aquastat (2-Pipe Changeover)	Х	Х
Condensate Pan Overflow Switch	Х	Х
Hot Water Coil Freeze Protection	Х	Х
ELECTRICAL CONNECTION		
Left Hand Side	Std	Std
Right Hand Side	Х	N/A
PIPING PACKAGES		
Modulating Control Valve		
2-way or 3-way (Valve Control Units)	Х	N/A
2-position Control Valve		
2-way or 3-way (Face and Bypass Units)	Х	N/A
Balancing Valve (Included With 3-way Valve Package)	Х	N/A
Circuit Setter	Х	N/A
Drain With Hose Bib	Х	N/A
Shut Off Valves	Х	N/A
Strainer	Х	N/A
VOLTAGE		
115/60/1	X	Х
208/60/1	Х	Х
230/60/1	Х	Х
277/60/1	X	Х

NOTE(S):

VRF Compatible DX Coil - ETO only. Contact the application team for ETO availability.

LEGEND

Std — Standard X — Available As Option N/A — Not Available ETO — Engineered to Order



Factory-installed Options

Style

Floor Mounted Flat Top

The unit shall be floor-mounted with adjustable leg levelers. All access and maintenance shall be through the front and the top panels of the unit.

Ceiling mounted

The unit shall be ceiling-mounted using field supplied rods and fasteners. All access and maintenance shall be through the bottom access panels of the unit.

Cooling control

Value Control

The unit shall be furnished with a fixed plate directing 100% of the airflow across the coil(s). Full modulation allowing any mixture of outside air and return air shall be possible. Discharge air temperature is controlled by modulating the optional cooling and/or heating valve(s). The blowers will be located above the coil.

Face and Bypass

The unit shall be furnished with a face and bypass section including aluminum opposed blade face and bypass dampers with overlapping neoprene blade tips and jamb seals, and an optional spring return modulating actuator. The face and bypass damper regulates the amount of return air and outside air passing through the coil. The blowers will be located above the coil.

Inlet air

Floor mounted and ceiling mounted units have a variety of inlet air configurations for outside and return air. Refer to "Airflow Arrangements — Inlet Air, Floor Mounted, 16-5/8 in. Depth (Optional UV Units)" on page 10 for images on the inlet air configurations available.

Floor mounted units have a pipe tunnel built-in the rear of the unit. The pipe tunnel allows for field crossover of hot water and/or chilled water piping, electrical conduit, or refrigeration piping without increasing the depth of the unit

Both open or closed pipe tunnels are available in configurations below:

- The open tunnel provides more space for crossover piping compared to the closed pipe tunnel.
- The closed pipe tunnel includes an insulated back cover for additional insulation and can provide a finished look if the rear of the unit is visible from the exterior of the building.

Floor mounted units with 21-7/8 in. depth can be provided with a 2 in. step-down back adapter. Refer to "Airflow Arrangements — Inlet Air, Floor Mounted, 21-7/8 in. Depth (Optional UV Units)" on page 11. The 2 in. step-down allows for the unit to fit against the wall if there are any architectural obstructions below the standard 30 in. unit height.

Discharge air

Floor mounted bar grille with screen

Floor mounted units have a pencil-proof clear anodized aluminum supply bar grille and 1/4 in. galvanized steel mesh mounted on the top panel.

See "40UV Vertical Unit — 21-7/8 in. Depth — Floor Mounted (Standard)" on page 17 and page 18 for images and dimensions of the top bar grille.

Ceiling mounted front discharge with duct collar

The front discharge duct collar allows for connection to field installed ductwork supplied by others.

Ceiling Mounted Discharge with Double Deflection Grille

The double deflection grille is made of clear anodized aluminum and has adjustable horizontal and vertical louvers to direct air flow. See "40UH Horizontal Unit — Ceiling Mounted — Front Discharge" on page 18 and page 19 for dimensions of the ceiling mounted discharge air options.

Cooling options

2-Row Chilled Water/Hot water 2-pipe

Two-row slab coil assembly for chilled water only or 2-pipe chilled/hot water operation.

4-Row Chilled Water / Hot Water 2-Pipe

Four-row slab coil assembly for chilled water only or 2-pipe chilled/hot water operation.

Direct Expansion (DX) Cooling

Large surface area evaporator coil positioned to optimize heat transfer and airflow.

Heating option

Hot Water/Chilled Water 2-Pipe

- The chilled water coil is used for hot water heating also in a 2-pipe changeover system.

1-Row Hot Water Coil

- One-row hot water heating slab coil assembly.

2 -Row Hot Water Coil

- Two-row hot water heating slab coil assembly.

1-Row Steam Slab Coil

One-row steam heating slab coil assembly.

Coil access

Right hand (RH) and left hand (LH) coil access is available for both heating and cooling coils. For chilled water coils, the standard connection will be on the right hand side of the unit. If left hand cooling connections are required, the factory will bring crossover piping for left hand chilled water connections via the pipe tunnel.

For hot water coils, the standard connection will be on the left hand side of the unit. If right hand heating connections are required, the factory will bring crossover piping for right hand hot water connections via the pipe tunnel. For DX piping, the standard connections will be on the right hand side of the unit. If left hand DX connections are required, refrigerant piping will be routed to the left side of the unit via the pipe tunnel.

For steam piping, the standard connections are on the left hand side of the unit. If right hand steam connections are required, steam piping will be routed to the right hand side of the unit via the pipe tunnel.



Coil positions

Preheat

Heating coil will be positioned in the preheat position when cooling is also selected.

Reheat

Heating coil will be positioned in the reheat position when cooling is also selected.

Damper assembly (outside air)

Insulated Damper

The outside air damper is insulated with 1/2 in. thick insulation to inhibit condensation on the damper surface.

No Damper (Recirculating Unit)

Unit will be recirculating only, with no provision for outside air.

Motor type

EC Motor, Three-Speed Switch

The fan motor shall be an electronically commutated motor (ECM). The ECM provides constant torque to compensate for a wide variety of static pressures, up to 0.25 in. wg with the High Static motor. The motor features a brushless, permanently lubricated ball bearing construction for maintenance free operation. The three speed selector switch enables adjustment of the supply air volume. Reduction in fan speed shall be achieved by a step down multi-tap transformer.

EC Motor, 0-10 VDC

The fan motor shall be an electronically commutated motor (ECM). The ECM provides constant torque to compensate for a wide variety of static pressures, up to 0.25 in. wg with the High Static motor. The motor features a brushless, permanently lubricated ball bearing construction for maintenance free operation. The supply air volume will be adjusted via a 0-10 vdc signal.

Electrical connections

Left Hand Side

The electrical connections terminate on the left hand side of the unit. On ceiling mounted units, the electrical connections will always terminate on the left hand side.

Right Hand Side

The electrical connections terminate on the right hand side of the unit. Due to space constraints, floor mounted units with a cooling piping package will have the mains electrical box containing the disconnect switch, fuses, and other components on the left hand side. A junction box will be installed on the right hand side containing a terminal strip and mains ground lug for the electrical connections.

Controls

By Others-Field Installed

The unit will be provided without a controller or temperature sensors. The controls contractor will be responsible for providing the controller and the appropriate sequence of operations. A wiring diagram will be installed within the unit but will reflect a generic controller.

Direct Digital Controls (DDC) Ready

The unit is provided with a fan relay, disconnect switch, three speed switch, 24-v control circuit transformer and terminal strip. Damper actuators are included with the DDC ready package for outside air and face and bypass dampers when included in the unit configuration. All components located in the panel shall be clearly marked for easy identification. All terminal blocks and wires shall be individually numbered. The controls contractor will be responsible for providing the controller and the appropriate sequence of operations. A wiring diagram will be installed within the unit but will reflect a generic controller.

Filtration

70-75% Arrestance (Standard)

1 in. thick throwaway filter provided and installed at the factory and located to provide filtration of both outdoor and return air prior to being conditioned.

MERV 10

1 in. thick radial pleated disposable filters provided and installed at the factory and located to provide filtration of both outdoor and return air prior to being conditioned.

MERV 13

1 in. thick radial pleated disposable filters provided and installed at the factory and located to provide filtration of both outdoor and return air prior to being conditioned. Minimum Efficiency Reporting Value (MERV) corresponding to the MERV value shown below when evaluated per ASHRAE standard 52.2. Arrestance and Dust Spot Efficiency ratings are based on the ASHRAE 52.2 - 1992 test method.

Piping packages

2-Way Valve, All Components

Factory assembled and installed piping package including a 2-way valve, strainer, circuit setter, and shut-off valves.

3-Way Valve, All Components

Factory assembled and installed piping package including a 3-way valve, balancing valve, strainer, circuit setter, and shut-off valves.

Piping package components

Modulating control valve

Two-way or three-way modulating valve(s) shall be provided for precise capacity control of hot water and/or chilled water coil(s). The capacity control valve(s) shall be controlled by a 2-10 vdc signal from the unit mounted controller.

2-Position spring return control valve

Two-way or three-way 2-position spring return control valve(s) shall be provided for control of hot water and/or chilled water coil(s). The control valve(s) shall be controlled by a 24-v signal from the units control panel.

Balancing valve

A heavy duty ball-valve construction balancing valve.



Circuit setter

A manually adjustable ball-valve construction balancing valve with Schrader¹ style pressure ports and drain port.

Shut-off valve

A set of two heavy duty ball valves, one for the supply and one for the return.

Strainer

A heavy duty cast iron strainer with screen, gasket and tapped retainer cap and blow-off outlet.

Drain with hose bib

A blowdown valve with hose connector and cap shall be mounted on the coil.

Coil freeze protection

An optional automatic reset freeze protection bulb and capillary tube will be mounted on the discharge side of the first coil to prevent any freezing of the first coil assembly. When the sensor detects a freeze up condition it will force the damper to close off the outside air, force the flow control valve open and prevent the supply fan from running.

Aquastat

An optional aquastat shall be fitted to two-pipe systems to prevent changeover into a heating mode when cooling is required and vice-versa.

Condensate pump

The unit may be fitted with a optional condensate pump. The pump shall be equipped with an ABS plastic tank with built-in flow check valve and safety switch.

Condensate pan float switch

The unit may be fitted with a float switch mounted on the condensate pan to stop the cooling function should the condensate rise to a predetermined level.

Accessories

Side panels

Factory supplied side panels constructed of 14 gauge sheet steel and painted to match the unit shall be field mounted

to the base unit. Side panels are available for both 16-5/8 in. and 21-7/8 in. deep units with or without pipe passage cutouts.

Utility compartment (UV unit only)

A factory supplied utility compartment with 14 gauge sheet steel front and top panels and painted to match the unit shall be field mounted to the base unit. Utility compartments are available for both 16-5/8 in. and 21-7/8 in. deep units in 12 in., 18 in., and 24 in. widths.

Filler section

A factory supplied filler section constructed of 18 gauge sheet steel and painted to match the unit shall be field mounted. Filler sections are available in 6 in, 12 in., and 18 in. widths and can be field cut for custom widths.

Unit sub-base (UV unit only)

Unit height adjustments can be made in increments of $1\ \text{in.},\ 2\ \text{in.},\ 4\ \text{in.},\ \text{and}\ 6\ \text{in.}$ with a sub-base field mounted under the standard unit. The sub-base is fully enclosed, constructed of heavy duty steel and painted to match the base of the standard unit.

Utility compartment sub-base

Utility compartment height adjustments can be made in increments of 1 in., 2 in., 4 in., and 6 in. with a sub-base field mounted under the standard utility compartment. The sub-base is fully enclosed, constructed of heavy duty steel and painted to match the base of the standard utility compartment.

Wall sleeve

The wall sleeve shall be constructed from galvanized steel. The sleeve shall be provided by Carrier and insulated by the installing contractor with foil back insulation.

Louver


An outdoor louver shall be furnished by Carrier and be suitable for masonry, glass or panel wall construction. Two louver styles are available: AMCA rated and non-AMCA rated. Louvers shall be made of aluminum with clear anodized finish.


Duct flange

A 1 in. duct flange shall be supplied and field installed to allow for easy installation of a supply air duct to the unit.

Third-party trademarks and logos are the property of their respective owners.



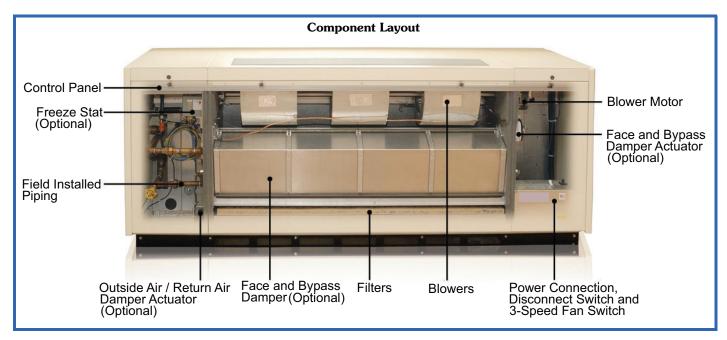

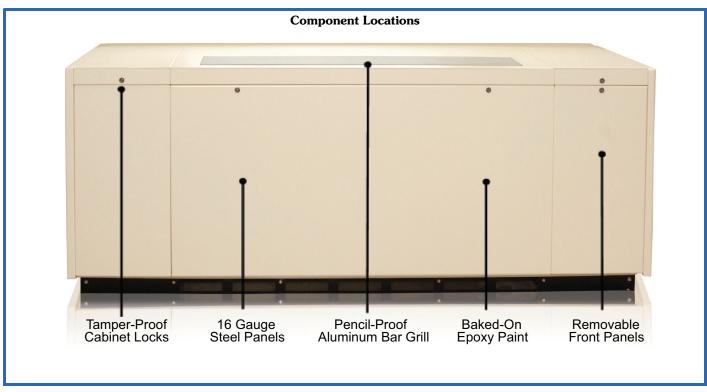





Airflow Arrangements — Inlet Air, Floor Mounted, 16-5/8 in. Depth (Optional UV Units)


Rear Outside Air — Open Pipe Tunnel

Rear Outside Air — Closed Pipe Tunnel

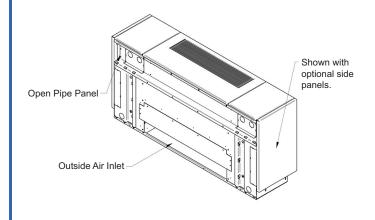

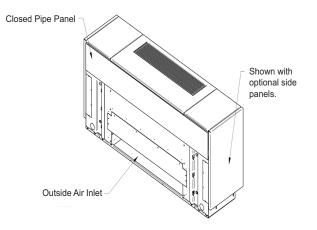


No Outside Air — Open Pipe Tunnel

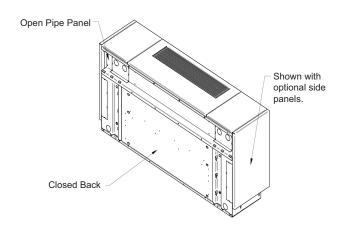




Airflow Arrangements — Inlet Air, Floor Mounted, 21-7/8 in. Depth (Optional UV Units)


Rear Outside Air — Open Pipe Tunnel

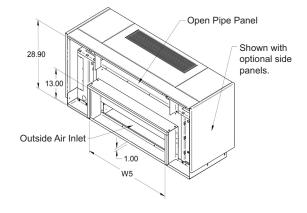


Rear Outside Air — Closed Pipe Tunnel

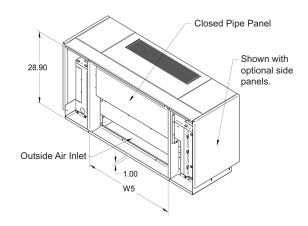


Closed Back — Closed Pipe Tunnel

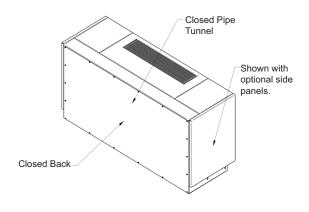

2 in. Step Down — Open Pipe Tunnel

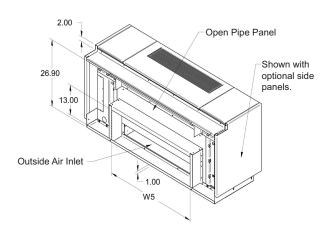


2 in. Step Down — Closed Pipe Tunnel

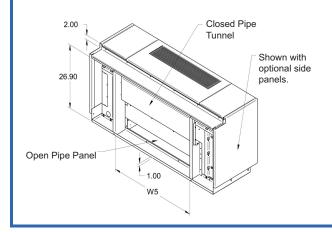

Unit Dimensions

MODEL SIZE	DIMENSIONS (in.)
40UV	W5
0750	38
1000	50
1250	62
1500	74




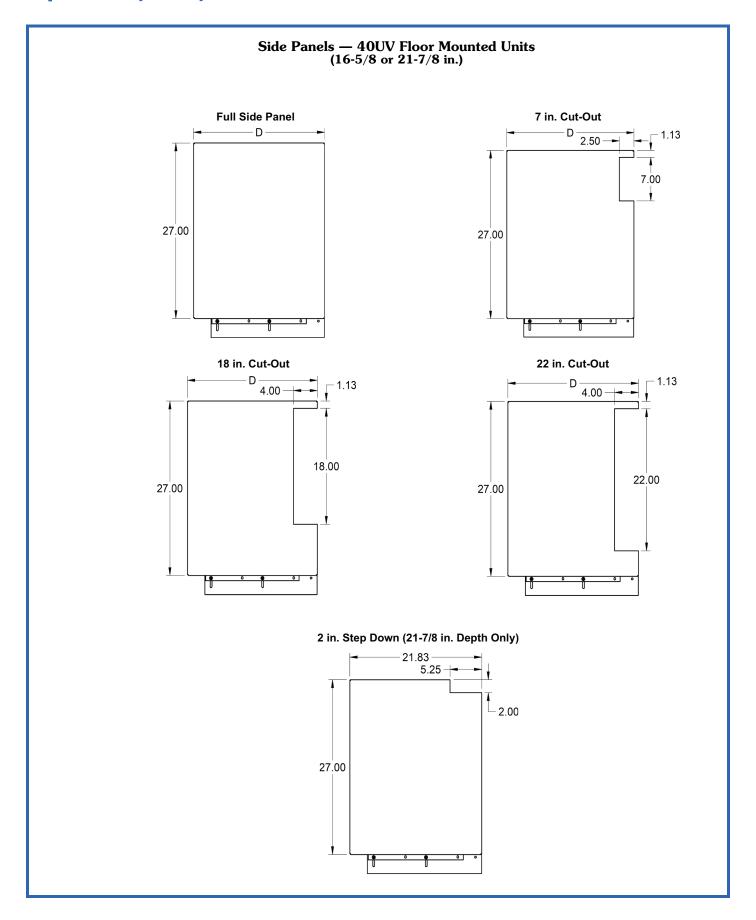




Utility Compartments — UV Floor Mounted Units, Flat Top (12, 18, or 24 in.)


16-5/8 in. Flat Top Utility Compartment



21-7/8 in. Flat Top Utility Compartment




2 in. Step Down Utility Compartment (21-7/8 in. Flat Top Units Only)






Filler Sections

Flat Top Filler Section for Standard Height Units




NOTE: W = 6, 12 or 18 in. D = 16-5/8 or 21-7/8 in.

Flat Top Filler Section for Units With Sub-Base



Unit Sub-Base

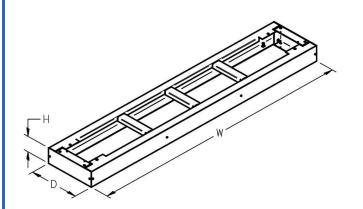

Unit Sub-Base Dimensions

DIMENSIONS (in.)	40UV MODEL SIZE							
DINIENSIONS (III.)	0750	1000	1250	1500				
W	62	74	86	98				
D (16-5/8 in. Deep Units)	13.65	13.65	13.65	13.65				
D (21-7/8 in. Deep Units)	18.90	18.90	18.90	18.90				
Н	1, 2, 4, or 6 in.							



Wall Sleeve (UV and UH Units) Mounting holes in 1-1/2 in. flange to accomodate masonry screws for attachment to inside wall. Wall Depth Max 14 in. Do not attach to unit. 10.38 NOTE: Dimensions in inches. 8.00 Inner sleeve slides inside outer sleeve to correct wall depth (up to 14 in.). NOTE: Dimensions in inches. **Wall Sleeve and Louver Dimensions** 40UV/UH MODEL SIZE **DIMENSIONS** (in.) 0750 1000 1250 1500

48

47.5

60

59.5

72

71.5


36

35.5

В


Base unit dimensions



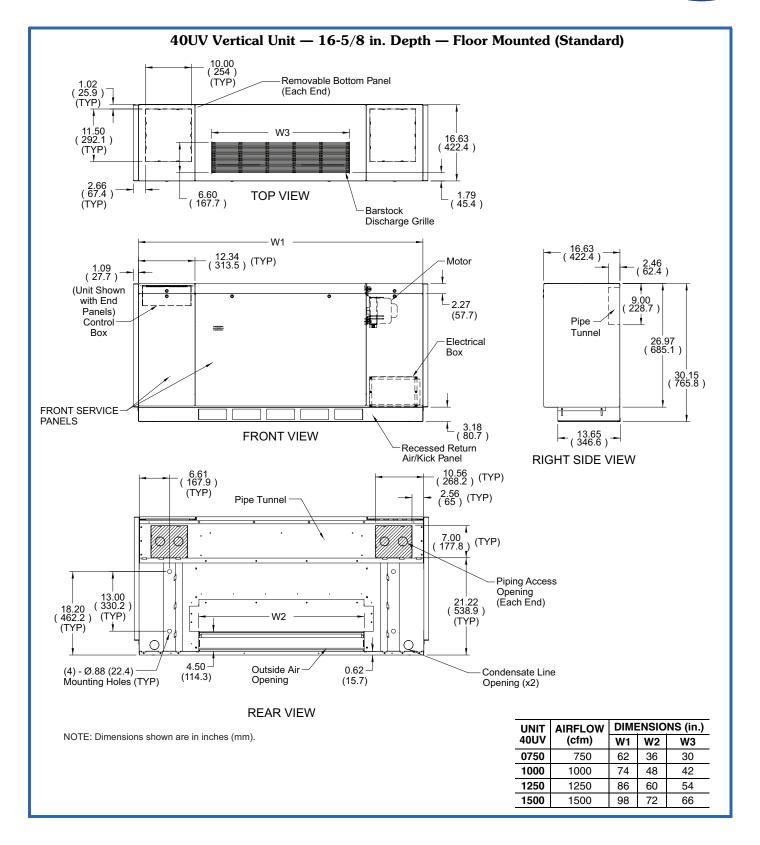


Base unit dimensions (cont)



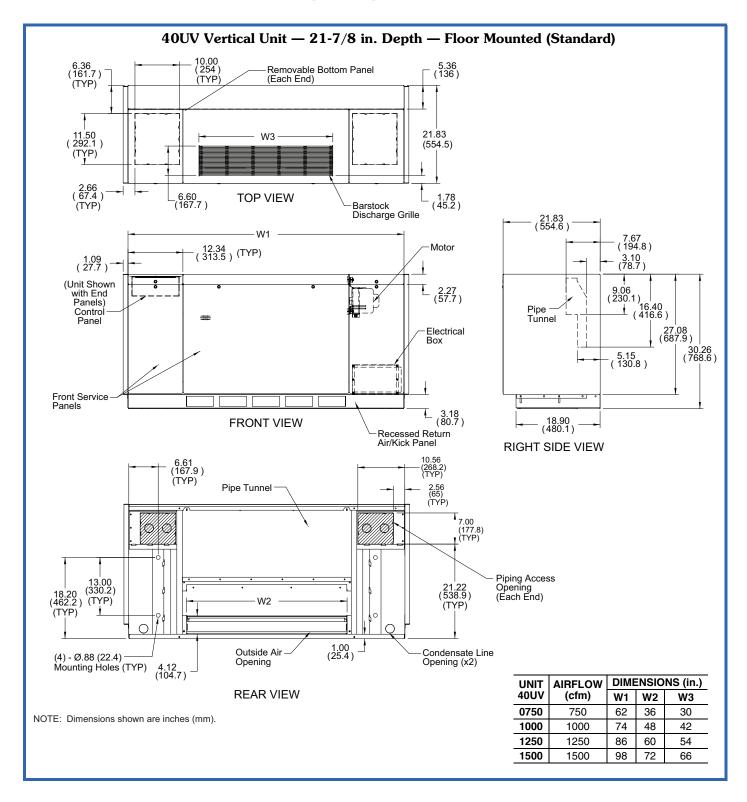


Base unit dimensions (cont)



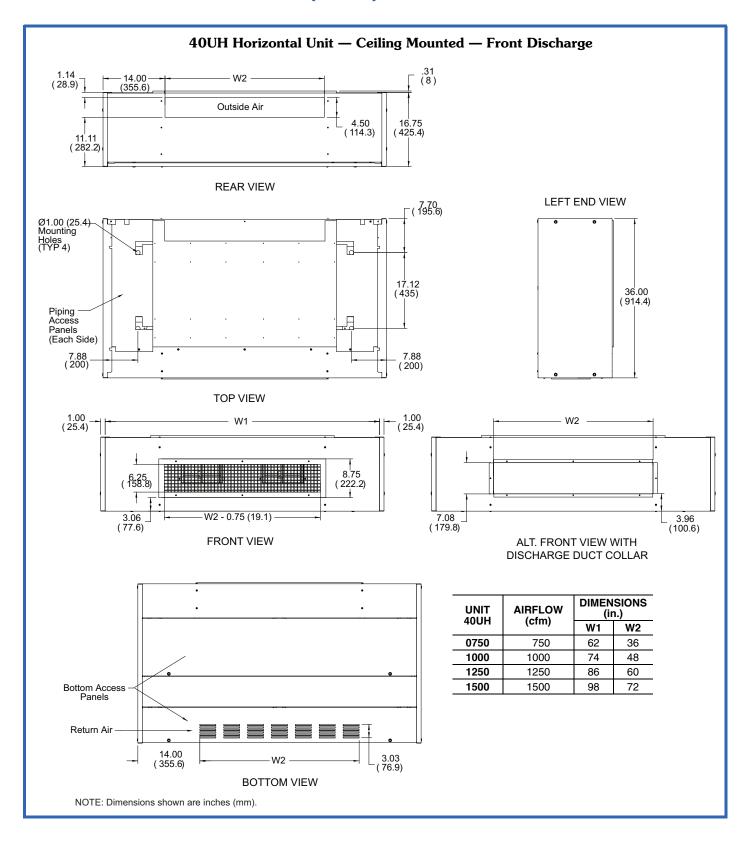

Base unit dimensions (cont)



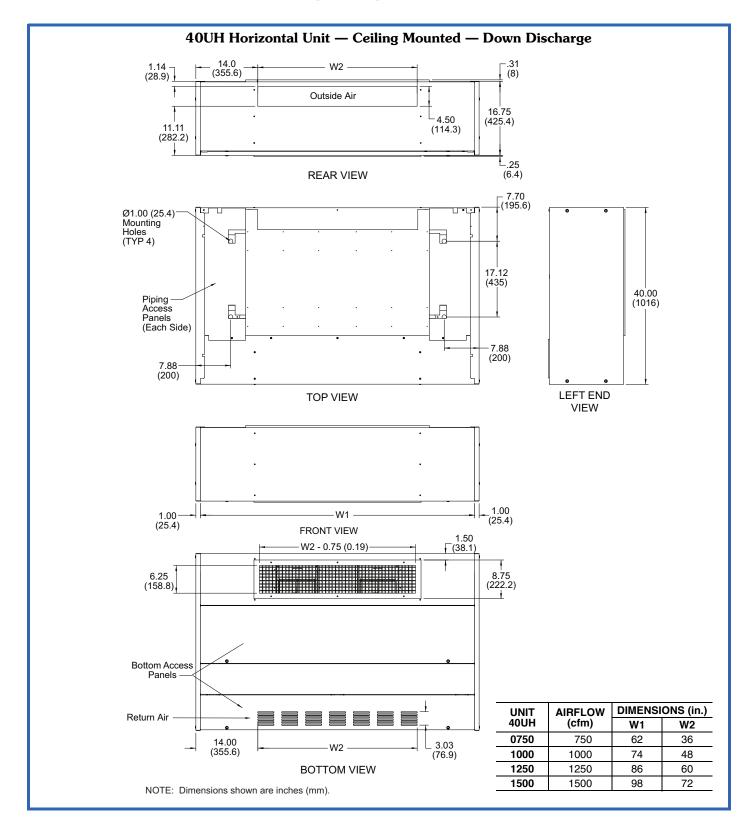

Performance data



Chilled Water — Unit Size 0750a,b

LINIT CIZE	FIACE (OF)	FLOW RATE	NUMBER OF ROWS	PD (PSI)	COOLIN	G CAPACITY	AND LEAVING	AIR TEMPER	ATURES
UNIT SIZE	EWT (°F)	(GPM)			Airflo	w cfm	750 (H)	650 (M)	500 (L)
					TC	Btu/Hr	18,312	17,071	14,694
				2.00	SC	Btu/Hr	14,965	13,694	11,464
			2	2.09	LDB	°F	62.0	61.0	59.3
		6			LWB	°F	59.5	58.8	57.8
		6	4	1.14	TC	Btu/Hr	27,520	25,656	22,083
					SC	Btu/Hr	19,109	17,486	14,639
					LDB	°F	57.0	55.8	53.6
0750	45				LWB	°F	55.2	54.2	52.4
0750	45			F 20	TC	Btu/Hr	21,297	19,255	16,392
					SC	Btu/Hr	16,533	14,908	12,508
			2	5.20	LDB	°F	60.1	59.3	57.5
		10			LWB	°F	58.1	57.7	56.6
		10			TC	Btu/Hr	32,066	28,938	24,634
			4	0.04	SC	Btu/Hr	21,110	19,036	15,971
			4	2.84	LDB	°F	54.6	53.6	51.2
					LWB	°F	53.0	52.3	50.4

NOTE(S):

- a. Cooling Capacity based on Mixed Air at 80/67°F dry/wet bulb.
 b. For additional capacity information, please consult Carrier.

Chilled Water — Unit Size 1000a,b

LINIT CIZE	FIAT (OF)	FLOW RATE	NUMBER OF	PD (PSI)	COOLIN	G CAPACITY	AND LEAVING	AIR TEMPER	ATURES
UNIT SIZE	EWT (°F)	(GPM)	ROWS		Airflo	w cfm	1000 (H)	750 (M)	600 (L)
					TC	Btu/Hr	27,859	24,376	21,468
			2	2.58	SC	Btu/Hr	22,876	19,163	16,439
			2	2.56	LDB	°F	59.4	57.0	55.3
		6			LWB	°F	58.3	56.7	55.3
		6	4	1.35	TC	Btu/Hr	34,454	30,147	26,550
					SC	Btu/Hr	24,461	20,490	17,578
					LDB	°F	58.0	55.4	53.6
1000	45				LWB	°F	56.0	53.9	52.4
1000	45				TC	Btu/Hr	32,099	28,494	25,835
			2	6.40	SC	Btu/Hr	25,955	21,442	19,026
			2	0.40	LDB	°F	56.6	54.2	51.4
		10			LWB	°F	56.6	54.2	51.4
		10			TC	Btu/Hr	39,698	35,240	31,951
			4	2.25	SC	Btu/Hr	27,752	22,927	20,344
			4	3.35	LDB	°F	55.0	52.5	49.5
					LWB	°F	54.1	51.3	48.8

- a. Cooling Capacity based on Mixed Air at 80/67°F dry/wet bulb.
 b. For additional capacity information, please consult Carrier.

LEGEND

EWT — Entering Water Temperature
PD — Pressure Drop
LDB — Leaving Dry Bulb
LWB — Leaving Wet Bulb
SC — Sensible Capacity
TC — Total Capacity



Chilled Water — Unit Size 1250a,b

UNIT SIZE	ENAT (OE)	FLOW RATE	NUMBER OF ROWS	PD (PSI)	COOLING CAPACITY AND LEAVING AIR TEMPERATURES					
UNII SIZE	EWT (°F)	(GPM)			Airflo	w cfm	1250 (H)	900 (M)	750(L)	
					TC	Btu/Hr	32,871	28,391	25,135	
				2.40	SC	Btu/Hr	27,608	22,624	19,635	
			2	3.40	LDB	°F	60.1	57.4	56.4	
		6		-	LWB	°F	58.8	57.0	56.3	
		0	4	1.38	TC	Btu/Hr	40,652	35,112	31,085	
					SC	Btu/Hr	29,520	24,191	20,995	
					LDB	°F	58.7	55.8	54.5	
4250	45				LWB	°F	56.7	54.4	53.4	
1250	45			0.00	TC	Btu/Hr	39,623	32,737	29,067	
					SC	Btu/Hr	30,868	24,748	21,672	
			2	8.30	LDB	°F	57.8	55.2	54.0	
		10			LWB	°F	57.0	55.2	54.0	
		10			TC	Btu/Hr	49,004	40,487	35,949	
			4	2.42	SC	Btu/Hr	33,006	26,462	23,173	
				3.43	LDB	°F	56.2	53.5	52.2	
					LWB	°F	54.3	52.1	51.0	

NOTE(S):

- a. Cooling Capacity based on Mixed Air at 80/67°F dry/wet bulb.
 b. For additional capacity information, please consult Carrier.

Chilled Water — Unit Size 1500a,b

UNIT SIZE	ENAT (OE)	FLOW RATE	NUMBER OF	PD (PSI)	COOLIN	G CAPACITY	AND LEAVING	AIR TEMPER	ATURES
UNII SIZE	EWT (°F)	(GPM)	ROWS		Airflo	w cfm	1500 (H)	1100 (M)	900 (L)
					TC	Btu/Hr	37,455	32,871	29,721
			2	2.58	SC	Btu/Hr	32,186	26,797	23,503
			2	2.30	LDB	°F	60.7	58.1	56.5
		6			LWB	°F	59.3	57.6	56.5
		6	4		TC	Btu/Hr	49,356	40,683	36,784
				1.35	SC	Btu/Hr	34,601	28,808	25,267
					LDB	°F	59.2	56.4	54.7
1500	45				LWB	°F	57.2	55.1	53.7
1500	45			0.40	TC	Btu/Hr	45,709	38,736	34,125
					SC	Btu/Hr	36,205	29,616	25,637
			2	6.40	LDB	°F	58.3	55.7	54.3
		10			LWB	°F	57.4	55.7	54.3
		10			TC	Btu/Hr	56,572	47,942	42,235
			4	3.35	SC	Btu/Hr	38,922	31,839	27,562
			4	3.35	LDB	°F	56.6	53.9	52.4
					LWB	°F	54.8	52.6	51.4

- a. Cooling Capacity based on Mixed Air at 80/67°F dry/wet bulb.b. For additional capacity information, please consult Carrier.

LEGEND

EWT — Entering Water Temperature
PD — Pressure Drop
LDB — Leaving Dry Bulb
LWB — Leaving Wet Bulb
SC — Total Capacity
TC — Sensible Capacity



Direct Expansion — Unit Size 0750a

EVAPORATOR	AIRFLOW cfm			750 (H)			650 (M)		500 (L)		
SATURATION TEMPERATURE (°F)	ENTERING	AIR db/wb (°F)	85/71	80/67	75/63	85/71	80/67	75/63	85/71	80/67	75/63
40	TC	Btu/Hr	34,325	28,463	23,036	30,940	25,669	20,786	26,407	21,928	17,782
	SC	Btu/Hr	19,042	16,960	14,849	17,163	15,294	13,396	14,644	13,059	11,451
40	LDB	°F	62.1	59.6	57.2	61.2	58.8	56.4	58.6	56.5	54.4
	LWB	°F	57.3	54.8	52.4	56.6	54.2	51.9	54.8	52.6	50.5
	TC	Btu/Hr	29,630	23,766	18,430	26,724	21,446	16,644	22,829	18,345	14,258
45	SC	Btu/Hr	16,780	14,708	12,614	15,132	13,268	11,386	12,918	11,339	9,740
45	LDB	°F	64.8	62.3	59.8	64.0	61.6	59.2	61.7	59.6	57.4
	LWB	°F	59.4	57.0	54.7	58.9	56.5	54.3	57.3	55.2	53.2
	TC	Btu/Hr	24,542	18,802	13,605	22,147	16,981	12,296	18,944	14,547	10,546
50	SC	Btu/Hr	14,563	12,510	10,432	13,137	11,291	9,421	11,223	9,657	8,066
50	LDB	°F	67.5	65.0	62.5	66.8	64.4	61.9	64.8	62.6	60.5
	LWB	°F	61.6	59.3	57.0	61.2	58.9	56.7	59.9	57.9	56.0

NOTE(S)

a. Performance based on 105°F Liquid Inlet Temperature.

Direct Expansion — Unit Size 1000a

EVAPORATOR	AIRF	LOW cfm		1000 (H)		750 (M)				600 (L)		
SATURATION TEMPERATURE (°F)	ENTERING	AIR db/wb (°F)	85/71	80/67	75/63	85/71	80/67	75/63	85/71	80/67	75/63	
40	TC	Btu/Hr	46,343	37,911	30,215	38,144	31,142	24,804	32,848	26,875	21,463	
	SC	Btu/Hr	25,801	22,727	19,661	21,237	18,671	16,132	18,291	16,116	13,953	
	LDB	°F	61.8	59.5	57.3	59.5	57.6	55.6	57.5	55.8	54.0	
	LWB	°F	57.1	54.8	52.6	55.5	53.4	51.5	54.0	52.2	50.4	
	TC	Btu/Hr	39,763	31,423	24,087	32,749	25,860	19,781	28,192	22,328	17,087	
45	SC	Btu/Hr	22,688	19,649	16,660	18,688	16,160	13,676	16,092	13,946	11,806	
45	LDB	°F	64.6	62.3	60.0	62.6	60.6	58.6	60.8	59.1	57.3	
	LWB	°F	59.3	57.1	54.9	58.0	56.0	54.0	56.8	55.0	53.2	
	TC	Btu/Hr	32,716	24,757	17,677	26,996	20,380	14,494	23,246	17,559	12,483	
50	SC	Btu/Hr	19,634	16,669	13,698	16,189	13,706	11,232	13,934	11,802	9,675	
50	LDB	°F	67.3	65.0	62.7	65.6	63.5	61.5	64.1	62.3	60.5	
	LWB	°F	61.6	59.4	57.2	60.5	58.6	56.6	59.6	57.8	56.1	

NOTE(S):

a. Performance based on 105°F Liquid Inlet Temperature.

LEGEND

LDB — Leaving Dry Bulb LWB — Leaving Wet Bulb SC — Total Capacity TC — Sensible Capacity



Direct Expansion — Unit Size 1250a

EVAPORATOR SATURATION	AIRF	LOW cfm	1250 (H)			900 (M)			750 (L)		
TEMPERATURE (°F)	ENTERING	AIR db/wb (°F)	85/71	80/67	75/63	85/71	80/67	75/63	85/71	80/67	75/63
	TC	Btu/Hr	62,055	50,784	40,492	49,872	40,756	32,468	43,540	35,633	28,453
40	SC	Btu/Hr	34,494	30,368	26,263	27,729	24,385	21,063	24,212	21,326	18,455
40	LDB	°F	60.1	58.1	56.1	57.2	55.6	53.9	55.9	54.4	52.8
	LWB	°F	55.9	53.8	51.8	53.8	52.0	50.3	52.8	51.1	49.5
	TC	Btu/Hr	53,246	42,060	32,261	42,825	33,830	25,876	37,376	29,596	22,633
45	SC	Btu/Hr	30,293	26,219	22,226	24,380	21,079	17,834	21,284	18,436	15,600
40	LDB	°F	63.2	61.1	59.0	60.6	58.9	57.1	59.4	57.9	56.3
	LWB	°F	58.4	56.3	54.2	56.6	54.9	53.1	55.8	54.2	52.6
	TC	Btu/Hr	43,777	33,135	23,674	35,296	26,613	18,942	30,791	23,255	16,537
50	SC	Btu/Hr	26,181	22,224	18,271	21,096	17,848	14,631	18,405	15,588	12,778
50	LDB	°F	66.1	64.0	61.8	63.9	62.1	60.4	62.9	61.3	59.7
	LWB	°F	60.9	58.8	56.7	59.5	57.7	56.0	58.9	57.2	55.6

NOTE(S):

a. Performance based on 105°F Liquid Inlet Temperature.

Direct Expansion — Unit Size 1500a

EVAPORATOR SATURATION TEMPERATURE °F)	AIRF	LOW cfm		1500 (H)			1100 (M)			900 (L)	
	ENTERING	AIR db/wb (°F)	85/71	80/67	75/63	85/71	80/67	75/63	85/71	80/67	75/63
	TC	Btu/Hr	71,293	58,404	46,636	57,981	47,427	37,803	50,287	41,211	32,891
40	SC	Btu/Hr	39,581	34,844	30,138	32,198	28,311	24,452	27,930	24,610	21,290
	LDB	°F	61.2	59.1	56.9	58.6	56.8	55.0	57.0	55.4	53.7
	LWB	°F	56.7	54.4	52.3	54.8	52.8	51.0	53.6	51.8	50.1
	TC	Btu/Hr	61,240	48,405	37,142	49,855	39,329	30,174	43,229	34,188	26,276
45	SC	Btu/Hr	34,743	30,066	25,490	28,303	24,455	20,712	24,552	21,257	18,037
45	LDB	°F	64.1	61.9	59.7	61.8	60.0	58.0	60.4	58.7	56.9
	LWB	°F	59.0	56.8	54.6	57.4	55.6	53.6	56.5	54.7	53.0
	TC	Btu/Hr	50,283	38,162	27,273	41,040	31,073	22,195	35,610	27,006	19,326
50	SC	Btu/Hr	29,992	25,478	20,972	24,471	20,749	17,051	21,229	18,034	14,838
90	LDB	°F	67.0	64.7	62.4	65.0	63.0	61.0	63.7	61.9	60.1
	LWB	°F	61.3	59.1	57.0	60.1	58.2	56.3	59.4	57.6	55.8

NOTE(S):

a. Performance based on 105°F Liquid Inlet Temperature.

LEGEND

LDB — Leaving Dry Bulb
LWB — Leaving Wet Bulb
SC — Total Capacity
TC — Sensible Capacity



Hot Water Heating — Unit Size 0750a,b

UNIT SIZE	EMT (°E)	FLOW RATE	NUMBER OF	DD (DCI)	COOLIN	G CAPACITY	AND LEAVING	AIR TEMPER	ATURES
UNII SIZE	EWT (°F)	(GPM)	ROWS	PD (PSI)	Airflo	w cfm	750 (H)	650 (M)	500 (L)
			1	0.88	TC	Btu/Hr	38,386	34,752	28,560
			ı	0.00	LAT	°F	106.4	108.5	111.8
		6	2	1.78	TC	Btu/Hr	50,110	45,366	37,283
	50 400	0	2	1.70	LAT	°F	120.6	123.3	127.7
			4 ^c	0.86	TC	Btu/Hr	61,152	55,363	45,499
0750					LAT	°F	134.0	137.3	142.6
0750	160		1	2.32	TC	Btu/Hr	41,823	37,438	30,477
			ı	2.32	LAT	°F	110.6	112.3	115.3
		10	2	4.71	TC	Btu/Hr	54,596	48,872	39,786
		10	2	4.7 1	LAT	°F	126.1	128.2	132.2
			4 ^c	2.20	TC	Btu/Hr	66,627	59,642	48,553
				2.28	LAT	°F	140.6	143.3	148.1

NOTE(S):

- a. Performance based on Mixed Air at 60°F dry bulb.
- b. For additional capacity information, please consult Carrier.
 c. 2-pipe Chilled Water / Hot Water units.

Hot Water Heating — Unit Size 1000a,b

UNIT SIZE	EWT (°F)	FLOW RATE	NUMBER OF	DD (DSI)	COOLIN	G CAPACITY	AND LEAVING	AIR TEMPER	ATURES
UNII SIZE	EVVI (°F)	(GPM)	ROWS	PD (PSI)	Airflo	w cfm	1000 (H)	750 (M)	600 (L)
			4	1.16	TC	Btu/Hr	49,804	40,803	34,395
			I	1.10	LAT	°F	105.2	109.4	112.0
		6	2	2.35	TC	Btu/Hr	62,381	51,107	43,080
		6		2.30	LAT	°F	116.6	121.8	125.2
			4°	1.14	TC	Btu/Hr	81,135	66,472	56,032
1000	160			1.14	LAT	°F	133.6	140.4	144.7
1000	100		1	0.07	TC	Btu/Hr	54,685	44,005	36,773
			I	3.07	LAT	°F	109.6	113.2	115.6
		10	2	6.20	TC	Btu/Hr	68,494	55,118	46,059
	10	10	2	6.20	LAT	°F	122.2	126.7	129.7
			4 c	3.01	TC	Btu/Hr	89,086	71,689	59,906
			40		LAT	°F	140.8	146.7	150.6

NOTE(S):

- a. Performance based on Mixed Air at 60°F dry bulb.
 b. For additional capacity information, please consult Carrier.
 c. 2-pipe Chilled Water / Hot Water units.

LEGEND

EWT — Entering Air Temperature
LAT — Leaving Air Temperature
PD — Pressure Drop
TC — Total Capacity



Hot Water Heating — Unit Size 1250a,b

UNIT SIZE	EMT (°E)	FLOW RATE	NUMBER OF	DD (DSI)	COOLIN	G CAPACITY	AND LEAVING	AIR TEMPER	ATURES
UNII SIZE	EWT (°F)	(GPM)	ROWS	PD (PSI)	Airflo	w cfm	1250 (H)	900 (M)	750 (L)
			1	1.45	TC	Btu/Hr	59,656	47,744	41,610
			ı	1.45	LAT	°F	103.3	108.1	110.3
		6	2	2.93	TC	Btu/Hr	77,550	62,065	54,091
	250 160	0	2	2.93	LAT	°F	116.3	122.6	125.5
			4 ^c	1.43	TC	Btu/Hr	99,226	79,413	69,210
1250					LAT	°F	132.0	140.1	143.7
1250	100		1	2.02	TC	Btu/Hr	66,035	51,738	44,724
			ı	3.82	LAT	°F	107.9	112.2	114.1
		10	2	7.71	TC	Btu/Hr	85,843	67,258	58,139
		10	2	7.71	LAT	°F	122.3	127.8	130.3
			40	0.75	TC	Btu/Hr	109,836	86,057	74,389
			4 ^c	3.75	LAT	°F	139.7	146.8	150.0

NOTE(S):

- a. Performance based on Mixed Air at 60°F dry bulb.
 b. For additional capacity information, please consult Carrier.
 c. 2-pipe Chilled Water / Hot Water units.

Hot Water Heating — Unit Size 1500a,b

UNIT SIZE		FLOW RATE	NUMBER OF	DD (DCI)	COOLIN	G CAPACITY	AND LEAVING	AIR TEMPER	ATURES
UNII SIZE	EWT (°F)	(GPM)	ROWS	PD (PSI)	Airflo	w cfm	1500 (H)	1100 (M)	900 (L)
			4	1 75	TC	Btu/Hr	70,109	57,236	49,403
			ı	1.75	LAT	°F	102.4	107.2	109.8
		6	2	3.52	TC	Btu/Hr	92,625	75,619	65,269
				3.52	LAT	°F	116.0	122.4	125.8
			4 c	1.71	TC	Btu/Hr	108,959	88,594	76,779
1500	160				LAT	°F	125,978	133.4	137.4
1500	100		4	4.50	TC	Btu/Hr	78,277	62,508	53,391
			ı	4.58	LAT	°F	107.4	111.6	113.8
		10	2	0.24	TC	Btu/Hr	103,417	82,584	70,539
			2	9.24	LAT	°F	122.6	128.1	131.1
			40	4.40	TC	Btu/Hr	121,653	97,146	82,978
			4 c	4.49	LAT	°F	133.6	140.1	143.7

NOTE(S):

- a. Performance based on Mixed Air at 60°F dry bulb.
 b. For additional capacity information, please consult Carrier.
 c. 2-pipe Chilled Water / Hot Water units.

LEGEND

EWT — Entering Air Temperature
LAT — Leaving Air Temperature
PD — Pressure Drop
TC — Total Capacity



Steam Heating Capacity at 2 lb. Steam^a

					AIR (ON COIL TE	MPERATUR	E (°F)			
UNIT SIZE	AIRFLOW cfm	4	0	5	0	6	0	7	0	8	0
- OILL	O.I.I.	TC (MBH)	LAT (°F)	TC (MBH)	LAT (°F)	TC (MBH)	LAT (°F)	TC (MBH)	LAT (°F)	TC (MBH)	LAT (°F)
	750 (H)	59.9	113.9	56.1	119.3	52.3	124.5	48.7	130.1	44.9	135.4
750	650 (M)	54.8	118.1	51.4	123.2	47.9	128.2	44.5	133.5	41.1	138.6
	500 (L)	45.7	124.7	42.9	129.4	39.9	133.9	37.2	138.8	34.3	143.5
	1000 (H)	84.4	118.1	79.1	123.2	73.7	128.2	68.6	133.5	63.3	138.6
1000	750 (M)	63.3	118.1	59.3	123.2	55.2	128.2	51.4	133.5	47.4	138.6
	600 (L)	54.0	123.4	50.6	128.1	47.2	132.8	43.9	137.7	40.5	142.5
	1250 (H)	97.0	111.9	90.9	117.3	84.7	122.7	78.8	128.4	72.7	133.9
1250	900 (M)	74.3	116.4	69.6	121.6	64.8	126.7	60.3	132.1	55.7	137.3
	750 (L)	66.3	121.9	62.1	126.7	57.9	131.5	53.9	136.5	49.7	141.4
	1500 (H)	116.9	112.2	109.6	117.6	102.0	123.0	95.0	128.6	87.6	134.1
1500	1100 (M)	89.1	115.0	83.5	120.3	77.8	125.5	72.4	130.9	66.8	136.2
	900 (L)	80.5	122.8	75.5	127.6	70.3	132.3	65.4	137.3	60.4	142.1

NOTE(S):

Steam Heating and Leaving Air Temperature Correction Factors

STEAM				AIR	ON COIL TE	MPERATURE	(°F)			
PRESSURE	4	0	5	0	6	0	7	0	80	
(psig)	TC (MBH)	LAT (°F)	TC (MBH)	LAT (°F)	TC (MBH)	LAT (°F)	TC (MBH)	LAT (°F)	TC (MBH)	LAT (°F)
0	0.96	0.96	0.96	0.97	0.96	0.96	0.96	0.95	0.97	0.93
2	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
5	1.04	1.05	1.05	1.05	1.05	1.06	1.05	1.06	1.06	1.07
10	1.10	1.12	1.11	1.13	1.12	1.14	1.13	1.15	1.14	1.15

LEGEND

LAT — Leaving Air Temperature **TC** — Total Capacity

a. Steam heating performance based on 2 psig steam.

Electrical data



40U — Electrical Data

UNIT	NOMINAL V/Ph/Hz	CONDENSATE PUMP	FLA	MCA	МОР
	115/1/60	No	5.7	7.1	15
	115/1/60	Yes	7.2	8.6	15
	208/1/60	No	3.8	4.7	15
STANDARD - ECM	200/1/00	Yes	4.4	5.3	15
STANDARD - ECM	000/4/00	No	3.3	4.1	15
	230/1/60	Yes	3.8	4.6	15
	277/4/60	No	3.5	4.4	15
	277/1/60	Yes	4.0	4.9	15
	115/1/60	No	6.8	8.5	15
	115/1/60	Yes	8.3	10.0	15
	200/4/00	No	4.5	5.6	15
HIGH STATIC - ECM	208/1/60	Yes	5.1	6.2	15
nion STATIC - ECIVI	230/1/60	No	4.1	5.1	15
	230/1/00	Yes	4.6	5.6	15
	277/1/60	No	3.7	4.6	15
	211/1/00	Yes	4.2	5.1	15

LEGEND

FLA — Full Load Amps
ECM — Electronically Communicated Motor
MCA — Unit Minimum Circuit Ampacity
MOP — Maximum Overcurrent Protection (Maximum Fuse Size or Circuit Breaker Amps)

Application data





Piping Components

- Modulating Control Valve/2-way or 3-way (for valve control units)
- 2-Position Control Valve/2-way or 3-way (for Face and Bypass Units)
- Balancing Valve
- Circuit Setter
- Drain with Hose Bib
- Shut Off Valves
- Strainer

Piping components are factory assembled and shipped installed to the unit.


Piping components shipped installed to the unit are 3/4 in. for chilled water and 1/2 in. for hot water.

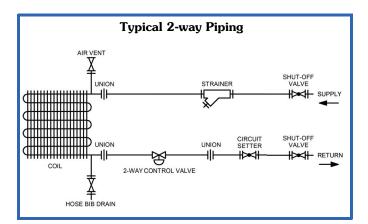

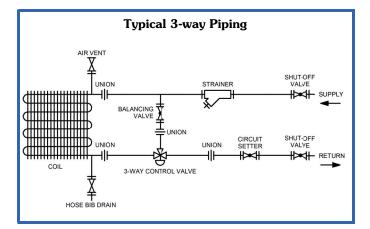

Cooling Piping Connection Locations — Floor Units (No piping package)

Chilled water

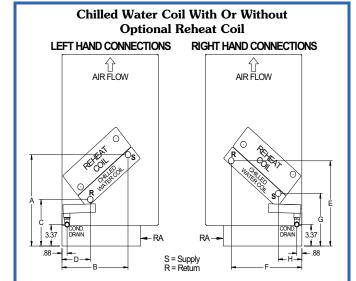

NOTES:

- Supply and Return connection locations represent counterflow orientation (recommended). Unit should be piped in accordance with good plumbing practices.
- All dimensions shown are in inches and are for reference only. For dimensions in mm, multiply inches by 25.4.

Piping Location Dimensions (Chilled Water Optional Re-heat Coil)a,b

UNIT	COIL		DIMENSIONS (in.)										
DEPT	ROWS	Α	В	С	D	E	F	G	Н				
16-5/8	2-row	14.25	11.25	7.25	4.75	13.50	12.25	8.25	4.00				
10-5/6	4-row	15.00	11.00	7.50	4.75	14.00	11.75	9.50	3.00				
21-7/8	2-row	14.25	16.50	7.25	10.00	13.50	17.50	8.25	10.00				
21-//0	4-row	15.00	16.25	7.50	10.00	14.00	17.00	9.50	8.25				

NOTE(S):

- For Hot Water Reheat piping locations see "Hot Water Re-Heat Coil with Chilled Water/DX Cooling Coil (No Piping Package)" on page 31. For Steam Reheat piping locations see "Steam Re-Heat Coil With Chilled
- Water/DX Cooling Coil (No Piping Package)" on page 32.



NOTES:

 Supply and Return connection locations represent counterflow orientation (recommended). Unit should be piped in accordance with good plumbing practices.

S = Supply

All dimensions shown are in inches and are for reference only. For dimensions in mm, multiply inches by 25.4.


Table 1 — Piping Location Dimensions (Chilled Water Pre-Heat Coil)^{a,b}

UNIT	COIL		DIMENSIONS (in.)											
DEPTH (in.)	ROWS	Α	В	С	D	E	F	G	н					
16-5/8	2-row	17.50	8.75	10.50	2.25	16.50	9.50	11.50	1.50					
10-5/0	4-row	16.75	9.25	9.25	3.25	16.00	10.00	11.25	1.50					
21-7/8	2-row	17.50	14.00	10.50	7.50	16.50	14.75	11.50	6.75					
21-7/0	4-row	16.75	14.50	9.25	8.50	16.00	15.25	11.25	6.75					


NOTE(S):

- For Hot Water Pre-heat piping locations see "Hot Water Only or Chilled Water/ DX Cooling Coil with Hot Water Pre-Heat Coil (No Piping Package)" on page 31
- b. For Steam Pre-heat piping locations see "Steam Heating Coil Only or Chilled Water/DX Cooling Coil With Steam Pre-Heat Coil" on page 32.

Direct expansion (DX) coil connection locations — 40UV, Size 0750 only

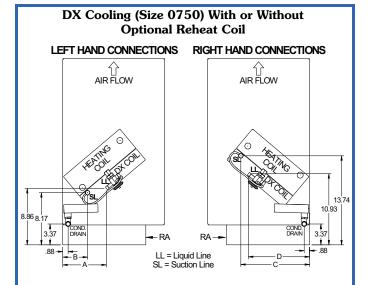

DX Cooling (Size 0750) with Pre-Heat Coil

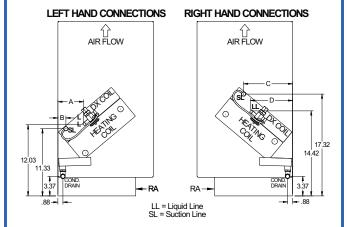

DX Cooling Coil Piping Locationsa,b


UNIT	MODEL		DIMEN	SIONS	
DEPT	SIZE	Α	В	С	D
16-5/8	0750	14.25	11.25	7.25	4.75
21-7/8	0750	14.25	16.50	7.25	10.00

NOTE(S):

- a. For Hot Water Reheat piping location see "Hot Water Re-Heat Coil with Chilled Water/DX Cooling Coil (No Piping Package)" on page 31. For Steam Reheat piping location see "Steam Re-Heat Coil With Chilled Water/DX Cooling Coil (No Piping Package)" on page 32.
 b. For Hot Water Pre-Heat piping location see "Hot Water Only or Chilled Water/DX Coil (No Piping Package)" on page 32.
- b. For Hot Water Pre-Heat piping location see "Hot Water Only or Chilled Water/DX Cooling Coil with Hot Water Pre-Heat Coil (No Piping Package)" on page 31. For Steam Pre-Heat piping location see "Steam Heating Coil Only or Chilled Water/DX Cooling Coil With Steam Pre-Heat Coil" on page 32.



Direct expansion (DX) Piping Connection Locations — 40UV, size 1000-1500 only

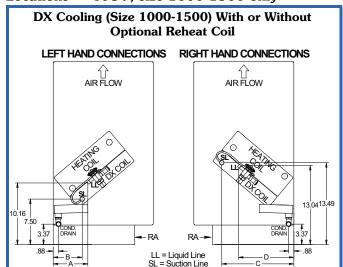

DX Cooling Coil Piping Locations^a

UNIT	MODEL SIZE	DIMENSIONS (in.)					
DEPT	WIODEL SIZE	Α	В	C	D		
16-5/8	1000/1250/1500	7.50	4.50	11.75	10.50		
21-7/8	1000/1250/1500	12.75	9.75	17.00	15.75		

NOTE(S):

a. For Hot Water Reheat piping location see "Hot Water Re-Heat Coil with Chilled Water/DX Cooling Coil (No Piping Package)" on page 31. For Steam Reheat piping location see "Steam Heating Coil Only or Chilled Water/DX Cooling Coil With Steam Pre-Heat Coil" on page 32.

DX Cooling (Size 1000-1500) with Pre-Heat Coil LEFT HAND CONNECTIONS AIR FLOW AIR FLOW REGIT HAND CONNECTIONS AIR FLOW AIR FLOW REGIT HAND CONNECTIONS REGIT HAND CONNECTIONS AIR FLOW REGIT HAND CONNECTIONS AIR FLOW REGIT HAND CONNECTIONS REGIT HAND CONNECTIONS AIR FLOW REGIT HAND CONNECTIONS REGIT HAND CONNECTI

SL = Suction Line

NOTE: All dimensions are in inches and are for reference only. For dimensions in mm, multiply inches by 25.4.

LL = Liquid Line

DX Coil with Pre-Heat Piping Locations^a

UNIT	MODEL SIZE	DIMENSIONS					
DEPT	WODEL SIZE	Α	В	С	D		
16-5/8	1000/1250/1500	4.50	1.75	8.75	7.75		
21-7/8	1000/1250/1500	9.75	7.00	14.00	13.00		

NOTE(S):


a. For Hot Water Pre-Heat piping location see "Hot Water Only or Chilled Water/DX Cooling Coil with Hot Water Pre-Heat Coil (No Piping Package)" on page 31. For Steam Pre-Heat piping location see "Steam Heating Coil Only or Chilled Water/DX Cooling Coil With Steam Pre-Heat Coil" on page 32.



40UV Heating Piping Connection Locations — (no piping package)

Hot water heating coil

Hot Water Only or Chilled Water/DX Cooling Coil with Hot Water Pre-Heat Coil (No Piping Package)



NOTES:

- Supply and Return connection locations represent counterflow orientation (recommended). Unit should be piped in accordance with good plumbing practices. Refer to Hot Water Heating Coil Piping Locations table dimensions.
- All dimensions shown are in inches and are for reference only. For dimensions in mm, multiply inches by 25.4.


Hot Water Heating Coil Piping Locations^a

UNIT	COII	DIMENSIONS (in.)							
DEPTH (in.)	COIL	Α	В	С	D	Е	F	G	Н
16-5/8	1-row	14.25	11.50	7.00	5.00	13.50	12.00	8.25	4.00
	2-row	14.25	11.25	7.25	4.75	13.50	12.25	8.25	4.00
21-7/8	1-row	14.25	16.75	7.00	10.25	13.50	17.25	8.25	9.25
	2-row	14.25	16.50	7.25	10.00	13.50	17.50	8.25	9.25

NOTE(S):

 a. For Chilled Water piping location see "Chilled Water Coil With Or Without Optional Reheat Coil" on page 28. For DX Cooling piping location see "DX Cooling (Size 0750) with Pre-Heat Coil" on page 29. "DX Cooling (Size 1000-1500) with Pre-Heat Coil" on page 30.

Hot Water Re-Heat Coil with Chilled Water/DX Cooling Coil (No Piping Package)

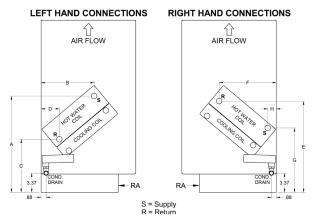

NOTES:

- Supply and Return connection locations represent counterflow orientation (recommended). Unit should be piped in accordance with good plumbing practices. Refer to Hot Water Re-Heat Coil Piping Locations table dimensions.
- All dimensions shown are in inches and are for reference only. For dimensions in mm, multiply inches by 25.4.

Hot Water Heating Coil Piping Locations^a

UNIT DEPTH (in.)	COIL	DIMENSIONS (in.)							
	ROW	Α	В	С	D	Е	F	G	Н
16-5/8	1-row	14.25	11.50	7.00	5.00	13.50	12.00	8.25	4.00
	2-row	14.25	11.25	7.25	4.75	13.50	12.25	8.25	4.00
21-7/8	1-row	14.25	16.75	7.00	10.25	13.50	17.25	8.25	9.25
	2-row	14.25	16.50	7.25	10.00	13.50	17.50	8.25	9.25


NOTE(S):

a. For Chilled Water piping location see "Chilled Water Coil With Or Without Optional Reheat Coil" on page 28. For DX Cooling piping location see "DX Cooling (Size 0750) With or Without Optional Reheat Coil" on page 29 and "DX Cooling (Size 1000-1500) With or Without Optional Reheat Coil" on page 30.



Steam heating coil piping connection locations — 40UV

Steam Heating Coil Only or Chilled Water/DX Cooling Coil With Steam Pre-Heat Coil (No Piping Package)

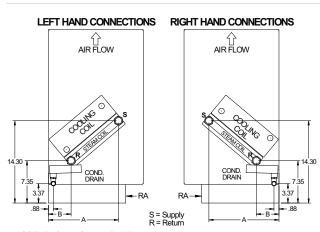


Steam Heating Coil Piping Locations^a

UNIT	COIL ROW	DIMENSIONS (in.)				
DEPTH (in.)		Α	В			
16-5/8	1-Row	12.25	4.00			
21-7/8	1-Row	17.50	9.25			

NOTE(S):

 For Chilled Water piping location see "Chilled Water Coil with Pre-heat Coil" on page 29. For DX Cooling piping location see "DX Cooling (Size 0750) with Pre-Heat Coil" on page 29 and "DX Cooling (Size 1000-1500) with Pre-Heat Coil" on page 30.

Steam Re-Heat Coil With Chilled Water/DX Cooling Coil (No Piping Package)

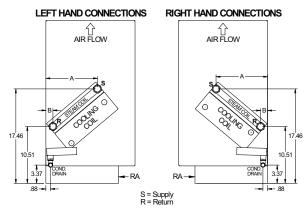

Steam Re-Heat Coil Piping Locations^a

UNIT		DIMENSIONS (in.)				
DEPTH (in.)	COIL ROW	Α	В			
16-5/8	1-Row	9.50	1.25			
21-7/8	1-Row	14.75	6.50			


NOTE(S):

a. For Chilled Water piping location see "Chilled Water Coil With Or Without Optional Reheat Coil" on page 28. For DX Cooling piping location see "DX Cooling (Size 0750) With or Without Optional Reheat Coil" on page 29 and "DX Cooling (Size 1000-1500) with Pre-Heat Coil" on page 30.

Carrier


40UV Cooling Piping Connection Locations — Floor Units (with piping package)


Chilled water

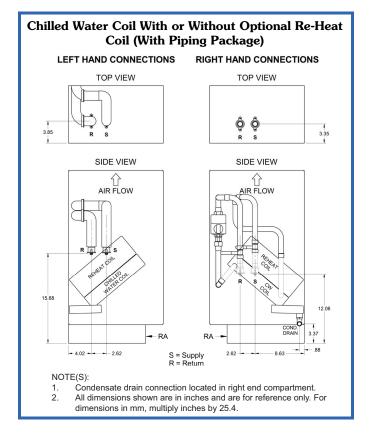

Chilled Water Coil with Pre-Heat Coil (With Piping Package) LEFT HAND CONNECTIONS RIGHT HAND CONNECTIONS TOP VIEW SIDE VIEW SIDE VIEW SIDE VIEW SIDE VIEW RAND CONNECTIONS SIDE VIEW SIDE VIEW RAND CONNECTIONS SIDE VIEW SIDE VIEW NOTE(S): 1. Condensate drain connection located in right end compartment. 2. All dimensions shown are in inches and are for reference only. For dimensions in mm, multiply inches by 25.4.

Direct Expansion (DX) piping connection locations — 40UV, Size 0750 only

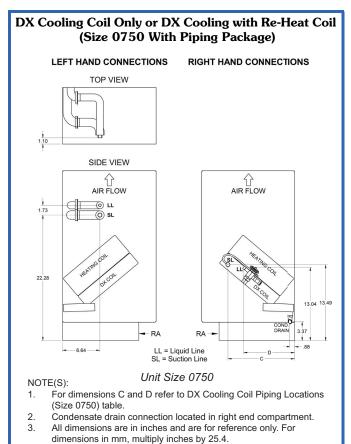

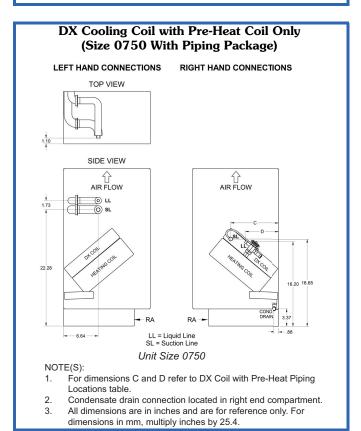



Direct Expansion (DX) Piping Connection Locations — 40UV, Size 1000-1500


DX Cooling Coil Only or DX Cooling with Re-Heat Coil (Size 1000-1500 With Piping Package) LEFT HAND CONNECTIONS TOP VIEW SIDE VIEW AIR FLOW A

Unit Size 1000 / 1250 / 1500

NOTE(S):

- For dimensions C and D refer to DX Coil with Pre-Heat Piping Locations table.
- 2. Condensate drain connection located in right end compartment.
- All dimensions are in inches and are for reference only. For dimensions in mm, multiply inches by 25.4.

DX Cooling Coil with Pre-Heat Coil Only (Size 1000-1500 With Piping Package)

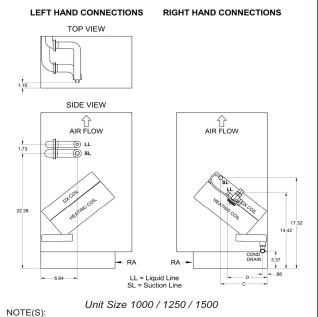


For dimensions C and D refer to DX Coil with Pre-Heat Piping

Condensate drain connection located in right end compartment.

All dimensions are in inches and are for reference only. For


dimensions in mm, multiply inches by 25.4.

Hot water heating coil piping connection locations — 40UV

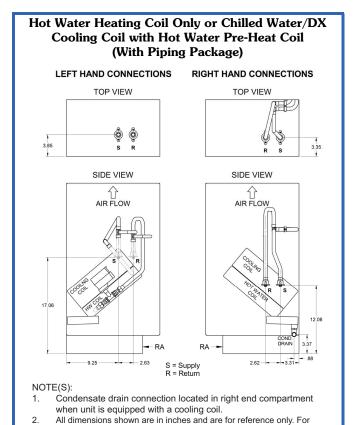

Chilled Water/DX Cooling Coil With Hot Water Re-Heat Coil (With Piping Package)

dimensions in mm, multiply inches by 25.4.

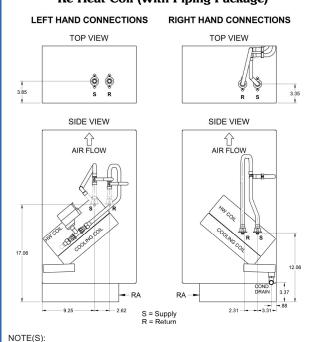

- Condensate drain connection located in right end compartment when unit is equipped with a cooling coil.
- All dimensions shown are in inches and are for reference only. For dimensions in mm, multiply inches by 25.4.

3.

Locations table.



Steam heating coil piping connection locations — 40UV

Steam Heating Coil Only or Chilled Water/DX Cooling Coil With Steam Pre-Heat Coil (With Piping Package) LEFT HAND CONNECTIONS RIGHT HAND CONNECTIONS TOP VIEW AIR FLOW AIR FLOW RA S = Supply R = Return NOTE(S): 1. Condensate drain connection located in right compartment when unit is equipped with a cooling coil.

- 2. For dimensions A and B refer to Steam Re-Heat Coil Piping Locations table
- All dimensions are in inches and are for reference only. For dimensions in mm, multiply inches by 25.4.

Chilled Water/DX Cooling Coil With Steam Re-Heat Coil (With Piping Package) LEFT HAND CONNECTIONS RIGHT HAND CONNECTIONS TOP VIEW AIR FLOW AIR FLOW AIR FLOW AIR FLOW TOP VIEW TO

- NOTE(S):

 R = Return

 Condensate drain connection located in right compartment when unit is equipped with a cooling coil.
- For dimensions A and B refer to Steam Re-Heat Coil Piping Locations table.
- All dimensions are in inches and are for reference only. For dimensions in mm, multiply inches by 25.4.

Controls




Valve Control and Face and Bypass Control

Valve control units

In a Valve Control Unit all of the air passes through the coil. The flow of water through the coil is modulated to maintain the set point temperature in the room.

- Air is drawn through the unit by the blowers (draw-through design), conditioned and supplied to the room.
- 2. Return air enters through the lower front kick panel of the unit and outside air enters through the lower back panel of the unit.
- The percentage of outside air and return air is controlled by the position of the outside air and return air dampers.
- 4. Air passes through the filters and then through the coil. The air is conditioned as it passes through the coil
- Cooling or heating capacity is controlled by adjusting the flow of water through the coil with a modulating valve. For units with DX cooling coils the outdoor condensing unit shall be energized on a call for cooling.

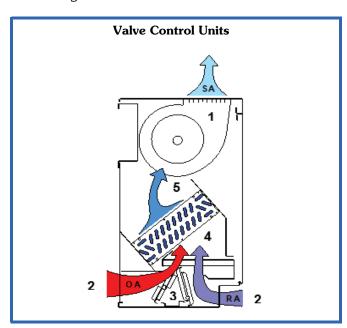


Face and bypass units

In a Face and Bypass Unit the outside air and return air can be separated, to condition only the outside air, or mixed before passing through the coil. The face and bypass damper is modulated to maintain the setpoint temperature in the room.

- Air is drawn through the unit by the blowers (draw-through design), conditioned or bypassed and supplied to the room.
- Return air enters through the lower front kick panel of the unit and outside air enters through the lower back panel of the unit.
- The percentage of outside air and return air is controlled by the position of the outside air and return air dampers.

- Air passes through the filters and then either passes through the coil or is diverted to bypass the coil. The air passing through the coil is conditioned. Bypassed air is mixed with the conditioned air and delivered to the room.
- 5. Cooling or heating capacity is controlled by adjusting the face and bypass damper.

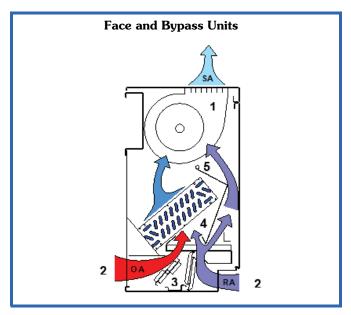

DX cooling face and bypass operation

DX cooling units energize the outdoor condensing unit on a call for cooling. In DX cooling, the face and bypass damper must go to full face mode to maximize airflow through the coil. The face and bypass damper is modulated to maintain the room's setpoint only in heating mode.

Chilled water/hot water face and bypass operation

For chilled water/hot water units, water flow and coil temperature remain constant to provide maximum dehumidification and low risk of coil freezing.

Dehumidification face and bypass and valve control comparison

Face and bypass control is the preferred method for maintaining indoor humidity levels compared to valve control. Due to the constant water flowing through the cooling coil, the surface temperature of the coil will remain cold to improve latent cooling and dehumidification. On valve controlled units, the water flow is modulated causing the surface temperature of the coil to increase. As a result, the coil's ability to remove moisture and dehumidify is reduced.

Coil freeze protection face and bypass and valve control comparison

Face and bypass control has a lower risk of coil freezing compared to valve control units. With face and bypass damper control, the water flow remains constant through the coil so the coil has a lower risk of freezing. With valve controlled units water can remain in the coil after the modulating control valve closes, which can freeze and damage the coil. A hot water coil freeze protection stat is recommended regardless of damper control type.

Controls (cont)



Recommended Sequence of Operation

The supply fan shall run at all times when unit is in occupied mode. When in unoccupied mode, the supply fan shall run only on a call for heating or cooling. The supply fan speed can be adjusted using the standard equipped manual 3-speed switch.

Freeze stat (optional)

On units equipped, an adjustable auto-resetting freeze stat is factory set to trip at 35°F. If the coil temperature reaches the limit and the freeze stat trips, it shall automatically reset when the coil temperature rises 5°F above the setpoint. The freeze stat shall be wired so that upon tripping, power is removed from the supply fan, the outside air damper closes, and either the HW (Hot Water) valve opens or the face and bypass damper goes to full bypass.

Outside air and return air dampers (optional)

The outside air and return air dampers control the mixture of return air and outside air drawn through the unit. Both dampers are linked together and are controlled by an actuator requiring a 2-6 vdc proportional signal. At 2-v, the dampers are positioned for full return air and no outside air. At 6-v, the dampers are positioned for full outside air and no return air. The outside air damper shall open to a minimum position to provide ventilation requirements when the room is occupied. When in heating mode, if the space temperature is more than $4^{\circ}F$ from the heating set-point, the outside air damper shall fully close. The outside air damper shall also be fully closed during unoccupied mode. If the unit is equipped with a CO_2 sensor, the outside air damper shall modulate open proportionally to compensate for the CO_2 levels in the room.

The dampers can act as economizers for free-cooling. If cooling is required and the outside air temperature is below the economizer outside air lockout temperature (60°F recommended) and above 35°F (adjustable), the outside air damper shall modulate open. When the unit is in free-cooling, water valves shall be fully closed, and if equipped, the face and bypass damper should move to full bypass position.

Chilled water with valve control

Units with a chilled water coil controls desiring valve control shall use a non-spring return modulating valve operated by either a proportional (2-10 vdc) or a tri-state (24 vac) signal. When the room temperature is above the cooling setpoint, the valve shall open proportionally according to the adjustable proportional band.

Chilled water with face and bypass control

Units equipped with a chilled water coil and face and bypass control shall modulate the face and bypass damper via a spring return actuator, controlled by a proportional signal (2-5.5-v). The face and bypass damper regulates the amount of return air and outside air passing through the chilled water coil. On a call for cooling, the damper shall open to the face of the coil proportionally based on how many degrees the room temperature is from the setpoint. When the damper is in full bypass position (2-v), all return and outside air bypasses the chilled water coil. When the damper is in full face position (5.5-v), all return and outside air passes through the chilled water coil.

Direct expansion (DX) cooling control

When the room temperature is above the cooling setpoint, the compressor will be energized. The compressor will deenergize when the room temperature falls below the cooling setpoint. If the factory-installed low limit stat detects indoor evaporator coil temperatures below its set-point, the compressor will be disabled.

Hot water or steam with valve control

Units with a hot water or steam coil controls and valve control shall use a spring-return, normally open modulating valve operated by a proportional signal (2-10 vdc) or a tri-state (24 vac) signal. When the room temperature is below the heating setpoint, the valve shall open proportionally according to the adjustable proportional band. If for any reason the supply air temperature drops below 55°F (adjustable), the valve shall modulate open to maintain 55°F.

Hot water with face and bypass control

Units equipped with a hot water or steam coil and face and bypass control shall modulate the face and bypass damper via a spring return actuator, controlled by a proportional signal (2-5.5-v). The face and bypass damper regulates the amount of return air and outside air passing through the heating coil. On a call for heating, the damper shall open proportionally based on how many degrees the room temperature is from the setpoint. When the damper is in full bypass position (2-v), all return and outside air bypasses the heating coil. When the damper is in full face position (5.5-v), all return and outside air passes through the heating coil. If for any reason the supply air temperature drops below 55°F (adjustable), the heating valve shall open (if equipped) and the face and bypass damper shall modulate to maintain 55°F.

Hot water and chilled water (2-pipe) with valve control

Units with valve control to provide heating and cooling on a single water coil (2-pipe system) shall use a spring-return, normally open modulating valve operated by a proportional signal (2-10 vdc) or a tri-state (24 vac) signal. On a call for heating or cooling (depending on the season), the valve shall open proportionally based on how many degrees the room temperature is from the setpoint. If for any reason the supply air temperature drops below 55°F (adjustable), the water valve shall modulate open to maintain 55°F. On 2-pipe units connected to a network, an optional aquastat is recommended to prevent inadvertent changeover of heating/cooling modes.

Hot water and chilled water (2-pipe) with face and bypass control

Units with face and bypass control to provide heating and cooling on a single water coil (2-pipe system) shall modulate the face and bypass damper via a spring return actuator, controlled by a proportional signal (2-5.5-v). The face and bypass damper regulates the amount of return air and outside air passing through the water coil. On a call for heating or cooling (depending on the season), the damper shall open proportionally based on how many degrees the room temperature is from the setpoint. When the damper is in full bypass position (2-v), all return and outside air bypasses the water coil. When the damper is in full face position (5.5-v), all return and outside air passes through the water coil. If for any reason the supply air temperature drops below 55°F (adjustable), the water valve shall open (if equipped) and the face and bypass damper shall modulate to maintain 55°F.

Controls (cont)



2-Position control valves

Optional spring-return, 2-position control valves can be used to control the end of cycle flow on both chilled and hot water coils. On a chilled water coil, a normally closed valve is used. On a hot water coil or 2-pipe changeover system, a normally open valve is used.

The 2-position valve used on a chilled water coil shall open on a call for cooling when the outside air temperature is greater than 55°F (adjustable). When the outside air temperature is less than 55°F, the valve should remain closed and free cooling shall be utilized. The 2-position chilled water valve shall be closed when the 2-position hot water valve is open (when equipped). The valve is controlled by a 24 vac digital output.

The 2-position valve used on a hot water coil shall open on a call for heating. The valve shall always open when the outside air temperature drops below $40^{\circ}F$. This is to prevent the coil from freezing or nuisance tripping of the freeze stat. The 2-position hot water valve shall be closed when the 2-position chilled water valve is open (if equipped). The valve is controlled by a 24 vac digital output.

The 2-position valve used on a 2-pipe changeover system shall operate like the 2-position chilled water valve in cooling mode, and like the 2-position hot water valve in heating mode.

Condensate pump (optional)

On units equipped with a condensate pump, the pump shall begin to run once the condensate reaches a set level. The pump comes with an internal safety switch that can be wired either normally open or normally closed. The safety switch shall be wired such that the chilled water valve closes when it trips.

Condensate pan float switch (optional)

On units equipped with a condensate pan float switch, the normally closed switch shall be wired such that the chilled water valve closes or the outdoor condensing unit is disabled (DX Cooling Models Only) upon tripping.

Guide specifications



Unit Ventilator Series — Vertical

HVAC Guide Specifications — 40UV/UH

Size Range: 750 to 1500 Nominal cfm

Carrier Model Numbers:

40UH (Horizontal) 40UV (Vertical)

Part 1 — General

1.01 SYSTEM DESCRIPTION

- A. The supplied product shall be a Carrier chilled water cooling/hot water heating or combined chilled water cooling and hot water or steam heating unit ventilator. The unit shall be floor-mounted and horizontally configured with adjustable leg levelers. All access and maintenance shall be through the front and the top side panels of the unit.
- B. The supplied product shall be a Carrier split DX cooling only or a combined split DX cooling with hot water or steam heating unit ventilator. The unit shall be floor-mounted and horizontally configured with adjustable leg levelers. All access and maintenance shall be through the front and the top side panels of the unit.
- C. The supplied product shall be a Carrier chilled water cooling/hot water heating or combined chilled water cooling and hot water or steam heating unit ventilator. The unit shall be ceiling-mounted using field supplied rods and fasteners. All access and maintenance shall be through the bottom access panels of the unit.
- D. The supplied product shall be a Carrier split DX cooling only or a combined split DX cooling with hot water or steam heating unit ventilator. The unit shall be ceiling-mounted using field supplied rods and fasteners. All access and maintenance shall be through the bottom access panels of the unit.

1.02 SUBMITTALS

A. General:

This document must be carefully reviewed by the Engineer to ensure it meets the requirements of the project and local building code(s).

B. As Carrier has a Continuous Product Improvement program, it reserves the right to change design and specifications without notice.

1.03 QUALITY ASSURANCE

- A. The unit shall be constructed and listed in accordance with ETL and CSA standards (UL 60335-2-40:2022 Ed.4) (CSA C22.2#60335-2-40:2022 Ed.4).
- B. The unit shall be constructed following ISO: 9001 quality control program procedures and be fully assembled and tested prior to shipment.
- C. ASHRAE Compliance: Applicable requirements in ASHRAE 62.1-2010, Section 5 - "Systems and Equipment" and Section 7 - "Construction and Startup".

D. Manufacturer Qualifications:

Company specializing in manufacturing the products specified in this section with minimum ten years documented experience.

Part 2 — Products

A. 40UV UNIT:

1. Cabinet Construction:

The exterior panels of the cabinet shall be constructed of 16 gauge sheet steel, degreased and coated with electrostatically applied baked-on polyester powder paint.

2. Fresh and Return Air (Standard):

Unit shall provide an opening in rear for fresh air. Return air is from bottom front of unit.

3. Return Air Only (Optional):

Return air is from bottom front of unit. No provisions for fresh air.

4. Pipe Tunnel (Standard):

Unit shall utilize an open rear pipe tunnel.

5. Pipe Tunnel (Optional):

Unit shall utilize a closed rear pipe tunnel.

6. Service and Maintenance Access:

All service and maintenance access shall be possible through the top and front of the unit only.

7. Service and Maintenance Access:

All service and maintenance access shall be possible through the top and front of the unit only.

- 8. The front panel and compartment panels shall be easily removable with tamperproof fasteners securing it to the rest of the unit cabinet.
- The back of the cabinet shall have an opening for connection to a wall sleeve and louver. (optional)
- 10. Discharge Air (optional):

The unit shall have a pencil-proof clear anodized aluminum supply air bar grill and 1/4 in. galvanized steel mesh mounted on the top panel.

B. 40UH UNIT:

1. Cabinet Construction:

The exterior panels of the cabinet shall be constructed of 18 gauge sheet steel, degreased and coated with electrostatically applied baked-on polyester powder paint.

- 2. Fresh and Return Air (Optional):
 - a. Return air provided from bottom return air louvers. Fresh air is from rear duct collar.
 - b. Return air provided from bottom return air louvers. Fresh air is from top duct collar.
 - c. Return air provided from rear duct collar. Fresh air is from top duct collar.



- d. Return air provided from rear lower duct collar. Fresh air is from rear upper duct collar.
- 3. Return Air Only (Standard):

Return air provided from bottom return air louvers. No provisions for fresh air.

4. Return Air Only (Optional):

Return air provided from rear duct collar. No provisions for fresh air.

5. Service and Maintenance Access:

All service and maintenance access shall be possible through the bottom of the unit only.

- 6. The bottom panels shall be easily removable with tamperproof fasteners securing it to the rest of the unit cabinet.
- 7. Discharge Air (optional):
 - a. The unit shall have a front discharge duct collar for connection to field installed ductwork supplied by others.
 - b. The unit shall have a front discharge duct collar for connection to field-installed ductwork supplied by others.
 - c. The unit shall have a clear anodized aluminum supply double deflection front discharge grill.
 - d. The unit shall have a clear anodized aluminum supply double deflection down discharge grill.

C. ALL UNITS

1. Unit Color:

The standard unit color shall be Beige. Optional unit colors are Sky White or Light Gray.

- 2. Paint finish shall be easily cleanable and hard wearing to give maximum protection.
- 3. Insulation:

1 in. thick, acoustic Hushcloth®1 Polyester/Polyurethane foam with density of 2-pounds per cubic foot containing no fibrous materials.

4. Fire-Hazard Classification:

Insulation shall have a fire rating of UL94HF-1.

5. Airstream Surfaces:

Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1-2010.

6. Drain Pan:

Each unit shall be fitted with a 20 gauge, 304 stainless steel welded construction drain pan sloped in 3 directions. The condensate connection will be at the same side as the chilled water or DX coil access side and include 3/4 in. reinforced condensate tubing and splashguard over the drain port.

2.01 COILS

- A. Evaporator Coil (Optional): Direct expansion units include a factory installed thermal expansion valve and utilize large surface area evaporator coils ideally positioned to optimize heat transfer and airflow. Each evaporator is manufactured from refrigeration quality copper tubes with mechanically bonded aluminum fins.
- B. Water/Steam Coil (Optional):

Large surface area slab coils shall be utilized to optimize heat transfer and airflow. Each coil shall be manufactured from refrigeration quality 3/8 in. diameter copper tubing mechanically bonded onto aluminum Highmix^{®1} fins with coil circuitry designed to ensure minimum waterside pressure drops. Each coil shall be fitted with an air bleed at the high point of the coil and a drain plug at the low point.

2.02 FANS AND MOTORS

- A. The fan motor shall be an electronically commutated motor (ECM). The DC motor features a brush-less, permanently lubricated ball bearing construction for maintenance free operation.
- B. (Optional) The high-static constant torque ECM shall compensate for up to 0.25 in. wg.
- C. The fan assembly shall be positioned for a "draw through" configuration.

2.03 FILTERS

A. Standard:

Throwaway 1 in. thick 50-65% arrestance filters shall be provided and installed at the factory and located to provide filtration of the outdoor and return air prior to being conditioned.

- B. Optional:
 - 1 in. thick disposable cotton and synthetic blend filters shall be provided and installed at the factory and located to provide filtration of the outdoor and return air prior to being conditioned. Minimum Efficiency Reporting Value of MERV 10 per ASHRAE standard 52.2.
 - 2. 1 in. thick disposable cotton and synthetic blend filters shall be provided and installed at the factory and located to provide filtration of the outdoor and return air prior to being conditioned. Minimum Efficiency Reporting Value of MERV 13 per ASHRAE standard 52.2.

2.04 DAMPERS (OPTIONAL)

- A. Fresh and Return Air Dampers:
 - 1. Each unit shall be fitted with separate outside air and return air dampers.
 - 2. The dampers shall have the capability of permitting only the outside air into the space, or recycling the return air and allowing only a minimum of outside air to enter the space.
 - 3. Full modulation allowing any mixture of outside air and return air shall be possible.

Third-party trademarks and logos are the property of their respective owners.



- B. Fresh and Return Air Dampers Construction:
 - The outside air damper is constructed of galvanized steel and the return air damper is constructed of aluminum.
 - 2. Dampers shall be gasketed to prevent air bypass and shall pivot on self-lubricating nylon bearings.

C. Face and Bypass Damper:

- Each unit shall be fitted with an optional factory installed face and bypass damper constructed of aluminum and braced for rigidity.
- 2. The damper shall include EPDM rubber end seal and F3 wool felt side seals.
- 3. The damper shall be removable to allow access to the coil(s).

NOTE: For DX Cooling units with Face and Bypass Damper, the damper must be in the full face mode on call for cooling enabling the condensing unit by others. Full airflow must pass across the evaporator coil.

2.05 CONTROLS

A. Standard:

1. 40UV Unit:

a. The control panel is located in the left-hand compartment.

2. 40UH Unit:

- a. The slide-out control panel is located under the bottom access panel.
- 3. The unit shall be fitted with a power disconnect switch sized for the full load amperage of the unit to enable the unit to be disconnected from the power supply prior to any maintenance.
- 4. Field installed and provided by others:
 - a. Controller
 - b. Controls Transformer
 - c. Damper Actuators
- 5. All components located in the panel shall be clearly marked for easy identification.
- All terminal blocks and wires shall be individually numbered.
- 7. All electrical wires in the control panel shall be run in an enclosed trough.
- 8. Wiring outside the control panel shall be run in protective sleeves.

B. Optional:

- 1. The 3-speed selector switch enables adjustment of the supply air volume.
- 2. The supply air volume will be adjusted via a 0-10 vdc signal.
- 3. DDC Ready Controls:
 - a. Factory installed DDC ready controls shall include a fan relay, 24-v control circuit transformer and terminal strip.

- b. Controls also include a 2-10 vdc outside air and/or face and bypass damper actuator where applicable.
- 4. Aquastat: An aquastat shall be fitted to 2-pipe systems to prevent changeover into a heating mode when cooling is required and vice-versa.

5. Condensate Pump:

- a. The unit shall be fitted with a condensate pump.
- b. The pump shall have a 1/30th hp motor capable of 20 gph at 15 ft of lift with rust-proof, ABS plastic tank with built-in flow check valve and safety switch.

6. Condensate Pan Float Switch:

The unit shall be fitted with a float switch mounted on the condensate pan to stop the cooling function should the condensate rise to a predetermined level.

7. Freeze Stat:

- a. The unit shall be fitted with a freeze protection sensor mounted on the discharge side of the first coil to prevent any freezing of the water coil assembly.
- When the sensor detects a freeze up condition it shall shut the damper and force the flow control valve open and prevent the unit supply fan from running.
 NOTE: Carrier recommends full airflow

across coil in cooling mode (no bypass operation) to prevent DX coil from freezing.

2.06 PIPING COMPONENTS

- A. Factory Installed Cooling Piping Components (Optional):
 - 1. The 3/4 in. chilled water (or 2-pipe HW/CW) piping components shall be factory assembled, with all the necessary piping and unions, inside the side compartment and outside of the airstream of the unit ventilator.
 - 2. Two-way modulating valve shall be provided for capacity control of chilled water. The capacity control valve shall be controlled by a 2-10 vdc signal from the unit mounted controller.
 - 3. Three-way modulating valve shall be provided for capacity control of chilled water. The capacity control valve shall be controlled by a 2-10 vdc signal from the unit mounted controller.
 - 4. Two-way 2-position normally closed spring return control valve shall be provided for control of chilled water coil. The control valve shall be controlled by a 24-v signal from the units control panel.
 - Three-way 2-position spring return control valve shall be provided for control of chilled water coil.

Carrier

- 6. The control valve shall be controlled by a 24-v signal from the units control panel:
 - a. Two-way 2-position normally open spring return control valve shall be provided for control of chilled water/hot water coil.
 - b. The control valve shall be controlled by a 24-v signal from the units control panel.
- 7. Heavy duty forged brass ball-valve construction balancing valve.
- 8. Manually adjustable ball-valve construction balancing valve with Schrader¹ style pressure ports and drain port.
- 9. Blowdown valve with hose connector and cap.
- 10. A set of two heavy duty forged brass ball valves, one for the supply and one for the return.
- 11. Heavy duty cast iron strainer with 20 mesh 304 stainless steel screen, gasketed and tapped retainer cap and blow-off outlet.
- B. Factory-Installed Heating Piping Components (Optional):
 - 1. 3/4 in. hot water piping components shall be factory assembled (2-Pipe HW/CW coil), with all the necessary piping and unions, inside the side compartment and outside of the airstream of the unit ventilator.
 - 1/2 in. hot water piping components shall be factory assembled, with all the necessary piping and unions, inside the side compartment and outside of the airstream of the unit ventilator.
 - 3. Two-way modulating valve shall be provided for capacity control of hot water coil.
 - a. The capacity control valve shall be controlled by a 2-10 vdc signal from the unit mounted controller.
 - 4. Three-way modulating valve shall be provided for capacity control of hot water coil.
 - a. The capacity control valve shall be controlled by a 2-10 vdc signal from the unit mounted controller.
 - Two-way 2-position normally closed spring return control valve shall be provided for control of hot water coil.
 - The control valve shall be controlled by a 24-v signal from the units control panel.
 - Three-way 2-position spring return control valve shall be provided for control of hot water coil.
 - The control valve shall be controlled by a 24-v signal from the units control panel.
 - 7. Two-way 2-position normally open spring return control valve shall be provided for control of chilled water/hot water coil.
- Third-party trademarks and logos are the property of their respective owners.

- The control valve shall be controlled by a 24-v signal from the units control panel.
- 8. Heavy duty forged brass ball-valve construction balancing valve.
- 9. Manually adjustable ball-valve construction balancing valve with Schrader style pressure ports and drain port.
- 10. Blowdown valve with hose connector and cap.
- 11. A set of two heavy duty forged brass ball valves, one for the supply and one for the return.
- 12. Heavy duty cast iron strainer with 20 mesh 304 stainless steel screen, gasketed and tapped retainer cap and blow-off outlet.

2.07 FIELD INSTALLED ACCESSORIES

A. Optional:

- Side Panel(s): Factory supplied side panel(s) constructed of 14 gauge sheet steel and painted to match the unit shall be field mounted to the base unit.
- 2. Utility Compartment(s): Factory supplied utility compartment(s) with 14 gauge sheet steel front and top panel(s) and painted to match the unit shall be field mounted to the base unit.
- 3. Filler Section(s):
 - a. Factory supplied filler section(s) constructed of 16 gauge sheet steel and painted to match the unit shall be field mounted.
 - b. Filler section(s) can be field cut for custom widths.
 - c. Filler section includes a kick plate that can be field trimmed to accommodate the unit sub base height up to 6 in.

4. Unit Sub-Base:

- Unit height adjustments can be made with a sub-base field mounted under the standard unit.
- b. The sub-base is fully enclosed, constructed of heavy duty steel and painted to match the base of the standard unit.
- 5. Utility Compartment Sub-Base:
 - a. Utility compartment height adjustments can be made with a sub-base field mounted under the standard utility compartment.
 - b. The sub-base is fully enclosed, constructed of heavy duty steel and painted to match the base of the standard utility compartment.

6. Wall Sleeve:

- a. The wall sleeve shall be constructed from galvanized steel.
- b. The sleeve shall be field assembled and insulated by the installing contractor with foil back insulation.



- 7. Outdoor Louver:
 - a. An outdoor louver suitable for masonry, glass, or panel wall construction.
 - b. The louvers are flanged style with the following finish:
 - Aluminum with bird screen and a clear anodized finish-Greenheck ESU150 Model.
 - Aluminum with bird screen and a clear anodized finish–Greenheck ESD435 Model - AMCA rated.
- 8. Spare Filters: 1 in. spare filter(s) shall be supplied with the unit.

2.08 EXAMINATION

A. Prior to start of installation, examine area and conditions to verify correct location for compliance with

- installation tolerances and other conditions affecting unit performance. See unit Installation and Service Manual.
- B. Examine roughing-in of plumbing, electrical and HVAC services to verify actual location and compliance with unit requirements. See unit Installation and Service Manual.
- C. Proceed with installation only after all unsatisfactory conditions have been corrected.

2.09 INSTALLATION

A. Installation shall be accomplished in accordance with these written specifications, project drawings, manufacturer's installation instructions as documented in manufacturer's Installation and Service Manual, Best Practices and all applicable building codes.

