



Product Data

WeatherExpert® Packaged Multi Zone VAV Rooftops

12.5 to 23 Nominal Tons



Unit shown with economizer and power exhaust.

50LC*B Sizes 14 to 26
Packaged Rooftop Multi Zone VAV (Variable Air Volume)
Cooling Units with Optional Electric Heat

Carrier's new Multi Zone - Variable Air Volume (MZ-VAV) Electric Heat / Electric Cooling WeatherExpert® 50LCB 12.5 to 23 ton Package Rooftop models are designed to help provide total low cost of ownership by providing some of the highest cooling efficiencies in the industry with low installation costs, low maintenance costs, and high reliability.

These MZ-VAV models not only provide comfort control to multi zone applications, they also provide high IEERs (Integrated Energy Efficiency Ratios) which are a measurement of cooling part load performance and where actual buildings operate nearly all of the time. These high part load values are achieved by using Carrier's strategically designed compressor staging, indoor fan motor and condenser fan motor speed control. These models are in addition to the 6 to 10 ton MZ-VAV models with IEERs up to 21.0 to provide a full range offering.

Ultra high efficiency

With IEERs up to 19.3, these new WeatherExpert MZ-VAV models well exceed the latest efficiency standards for ASHRAE 90.1, and exceeds Consortium for Energy Efficiency (CEE) Advanced Tier performance criteria. These models help to contribute in LEED¹ credits and help qualify for rebates. The high IEER efficiencies are

achieved by utilizing a proven staged compressor design on a single refrigerant circuit that provides 3 stages of cooling capacity control.

The indoor fan motors are high efficiency belt drive and controlled by a VFD (Variable Frequency Drive) that adjusts speed based on the duct static pressure sensor and also matches cooling capacity stages for optimum comfort and efficient control. Models also have multiple heat capacities.

Easy to install

Units are designed for dedicated factory-supplied vertical or horizontal air flow duct configuration. No special field kits are required. Designed to fit on pre-installed curbs by another manufacturer, these units also fit on past designed Carrier installed curbs with an authorized adapter curb. The cabinet design also integrates a large control box that gives you room to work and room to mount Carrier accessory controls.

Easy to maintain

Easy access door handles by Carrier provide quick access to all normally serviced components. Our "no-strip" screw system has superior holding power and guides screws into position while preventing the screw from stripping the unit's metal. Units come with accessible 2 in. filter that have a dedicate access door for easy replacement. Optional hinged panels allow easy access with pull tabs and quarter turn latches. Units come with installed supply-air temperature sensor, return-air temperature sensor, outdoor-air temperature sensor and duct static pressure sensor located in the control box for remote positioning in the field.

Reliable

Carrier conducts rigorous testing to ensure your unit will perform as designed. Extensive rain testing is conducted in special designed test areas and under conditions that simulate actual job sites. In addition, units are shake-tested and driven around the country to make sure both the packaging and the unit components within hold up. Condensate pans are made of non corrosive – composite material, motors are permanently lubricated, and compressors use crankcase heaters, all to further strengthen the unit's reliability.

Unit Features

- Three stage cooling capacity control with staged scroll compressors design. Each stage is different in capacity output to better match typical building load profiles.
- Single refrigerant circuit design with precision sized multi TXV refrigerant metering devices to provide optimum operation through the entire operating range.
- Single fully activated faced evaporator coil for full surface utilization, even at part load operation. This allows for better dehumidification than split face coils and helps eliminate the need for additional dehumidification packages.
- Integrated economizer in either standard low leak or ultra-low leak versions to properly help supplement compressor unloading in all operating conditions
- Crankcase heater on each compressor designed to cycle off during the on cycle.
- IEER up to 19.3 and EERs up to 12.6.
- High efficiency permanently lubricated belt driven evaporator-fan motor with VFD (Variable Frequency Drive) controller.
- VAV-RTU Open controller provides:
 - Integrated system control to required Carrier i-Vu® VAV zoning controls for single duct and fan terminals using BACnet² MS/TP protocol.
 - Unit control of all stages of cooling in order to maintain the desired supply air temperature setting.
 - Supply air temperature control including reset algorithm will

Table of contents

	Page
Features/Benefits	2
Model Number Nomenclature	5
AHRI Capacity Ratings	6
Physical Data	9
Options and Accessories	11
Base Unit Dimensions	14
Accessory Dimensions	29
Performance Data	32
Fan Data	65
Electrical Data	76
Typical Wiring Diagrams	111
Sequence of Operation	113
Application Data	115
Guide Specifications	116

1. LEED is a registered trademark of the U.S. Green Building Council.

2. BACnet is a trademark of ASHRAE.

Features/Benefits (cont)




calculate a proportional reset value between occupied cooling setpoint and 1°F above the occupied heating setpoint. The amount of reset is user configurable.

- Control for morning warm-up cycle the first time of transition from unoccupied to occupied periods.
- Provide linkage from the RTU to the VAV zones in morning warm up cycle to ensure sufficient airflow while in the heating mode.
- Provide optional selected “occupied” heating which will allow heating whenever required during the occupied period.
- Configurable setpoint differential between heating and cooling to prevent the unit from prematurely entering the opposite mode.
- The ability to utilize outdoor air for maintaining the supply air setpoint by using the outdoor air temperature average zone temperature
- BACnet test points to activate specific test models that can be used to commission the rooftop and the system. Tests shall include fan test, heat test, cooling test, power exhaust test, and economizer test.
- Linkage to required Carrier i-Vu VAV zoning controls for single duct and fan terminals using BACnet MS/TP protocol.
- Standalone BACnet MS/TP or BAS network capabilities.
- Two economizer minimum position settings to accommodate both minimum and maximum air flow settings.
- Indoor fan motor modulation
- Field and factory wiring connections
- Outdoor fan motor staging
- Crank case heater control
- Sound levels as low as 84 dB.
- Non-corrosive composite condensate pan in accordance with ASHRAE 62 Standard, sloping design; side or bottom drain.
- Single point electrical connections
- Pre-painted exterior panels and primer-coated interior panels tested to 500 hours salt spray protection.
- Fully insulated with foil faced insulation throughout the entire cabinet.
- High ambient cooling operation and ratings up to 125°F (52°C).
- Low ambient mechanical cooling operation down to 45°F (7°C). An economizer shall be the source of cooling in low ambient conditions. When the outside air temperature is below 45°F (7°C), to improve system reliability, reduce energy usage, and improve system efficiency: mechanical cooling shall not be utilized.
- Access panels with easy grip handles.
- Innovative, easy starting, no-strip screw feature on unit access panels.
- Two-inch disposable return air filters.
- Tool-less filter access door.
- Dedicated vertical and horizontal airflow models available ordered as factory option. No special kits required.
- Provisions for thru-the-bottom power entry capability as standard.
- Full perimeter base rail with built-in rigging adapters and fork truck slots.
- 24-volt control circuit protected with resettable circuit breaker.
- Totally enclosed high efficient ECM outdoor fan motor with permanently lubricated bearings.
- Low-pressure switch and high-pressure switch protection.
- Evaporator coil freeze protection
- High capacity liquid line filter drier.
- Standard Limited Parts Warranty: 5 year electric heat, 5 year compressor, 1 year parts.



TYPICAL VAV RTU-OPEN SYSTEM LAYOUT AND COMPONENTS

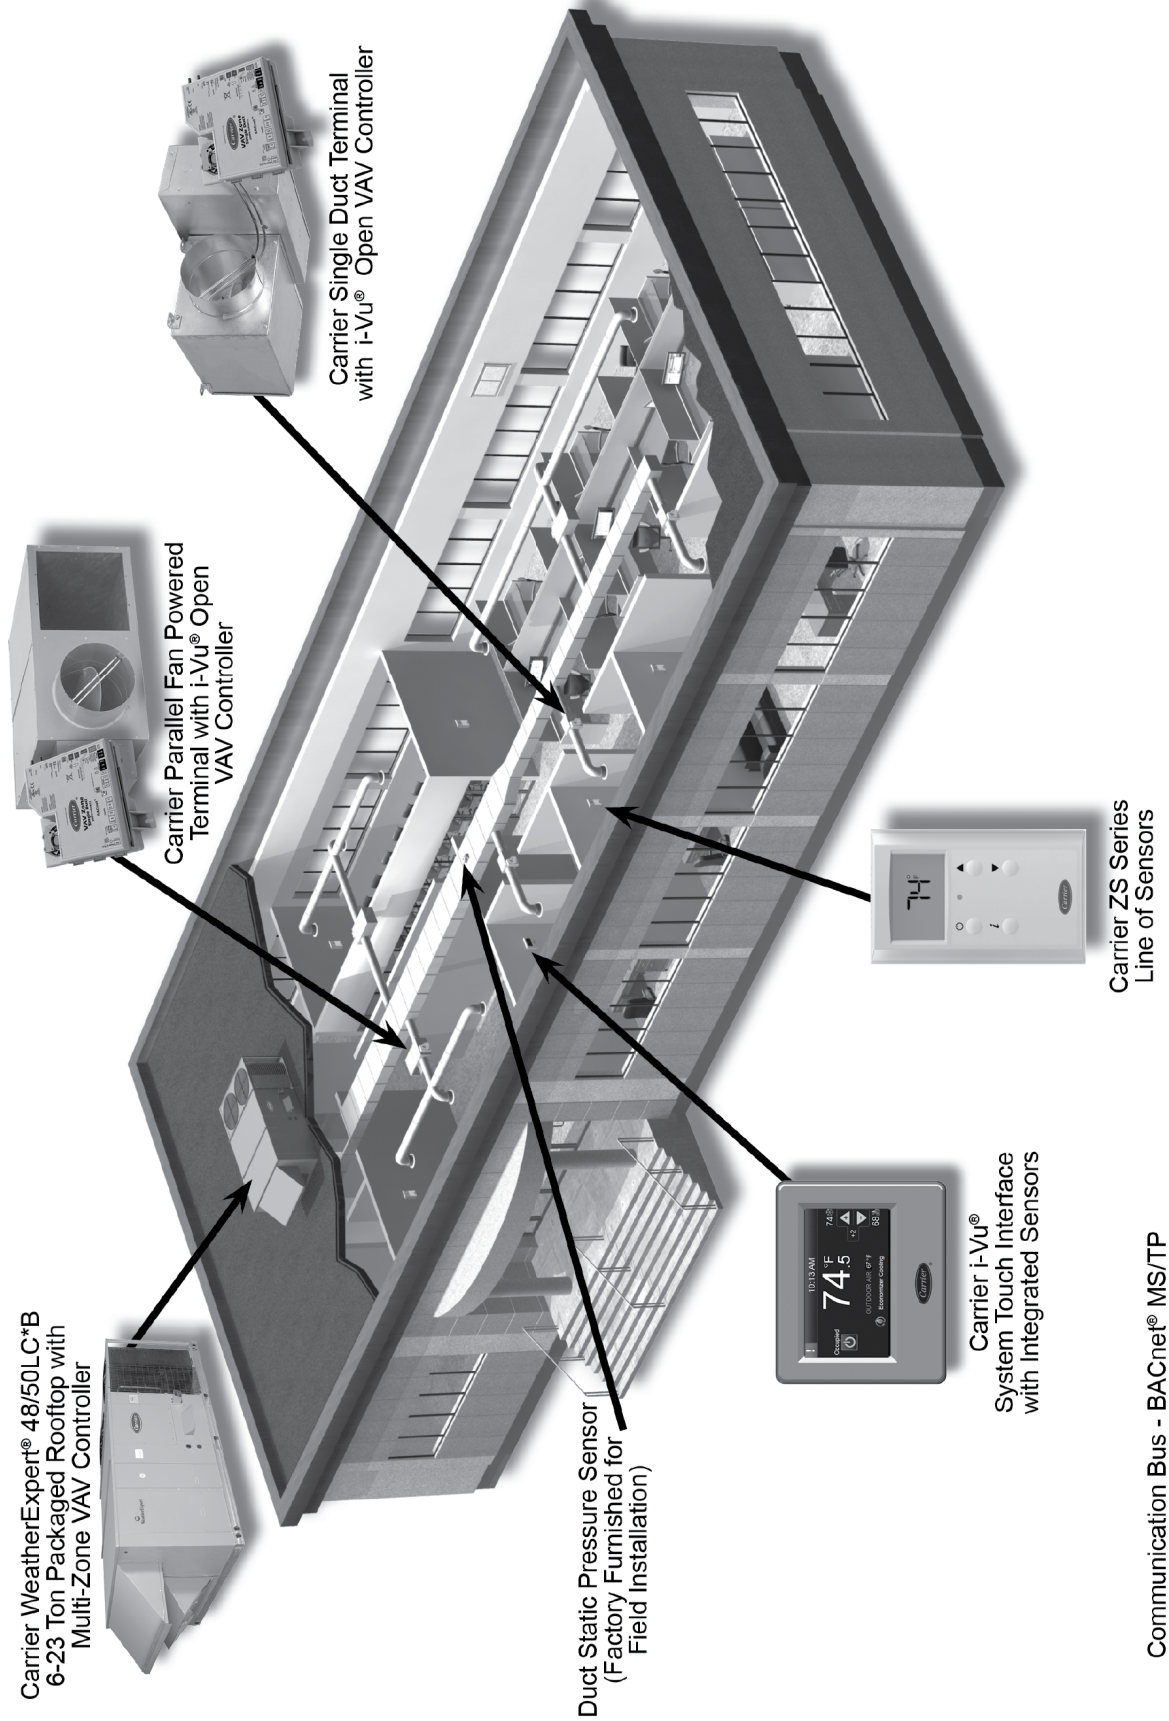

MODEL NUMBER NOMENCLATURE

Position:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
Example:	5	0	L	C	D	B	2	4	A	1	A	5	-	0	N	0	A	0

Unit Heat Type

50 - Electric Cooling
Packaged Rooftop

Model Series - WeatherExpert®

LC - Ultra High Efficiency

Heat Options

0 = Standard - No Electric Heat
D = Low Electric Heat
E = Medium Electric Heat
F = High Electric Heat

Refrig. Systems Options

B = Three stage cooling capacity control with multi-zone VAV operation

Cooling Tons

14 - 12.5 ton
17 - 15 ton
20 - 17.5 ton
24 - 20 ton
26 - 23 ton

Sensor Options

A = None
B = RA Smoke Detector
C = SA Smoke Detector
D = RA + SA Smoke Detector
E = CO₂
F = RA Smoke Detector and CO₂
G = SA Smoke Detector and CO₂
H = RA + SA Smoke Detector and CO₂

Indoor Fan Motor Options

1 = Standard Static / Vertical Supply, Return Air Flow
2 = Medium Static / Vertical Supply, Return Air Flow
3 = High Static / Vertical Supply, Return Air Flow
4 = Ultra High Static / Vertical Supply, Return Air Flow
5 = Standard Static / Horizontal Supply, Return Air Flow
6 = Medium Static / Horizontal Supply, Return Air Flow
7 = High Static / Horizontal Supply, Return Air Flow
8 = Ultra High Static / Horizontal Supply, Return Air Flow

Coil Options (Outdoor – Indoor – Hail Guard)

A = Al/Cu – Al/Cu
B = Precoat Al/Cu – Al/Cu
C = E-coat Al/Cu – Al/Cu
D = E-coat Al/Cu – E-coat Al/Cu
E = Cu/Cu – Al/Cu
F = Cu/Cu – Cu/Cu
M = Al/Cu – Al/Cu – Louvered Hail Guard
N = Precoat Al/Cu – Al/Cu – Louvered Hail Guard
P = E-coat Al/Cu – Al/Cu – Louvered Hail Guard
Q = E-coat Al/Cu – E-coat Al/Cu – Louvered Hail Guard
R = Cu/Cu – Al/Cu – Louvered Hail Guard
S = Cu/Cu – Cu/Cu – Louvered Hail Guard

Packaging

0 = Standard
1 = LTL

Electrical Options

A = None
B = HACR Circuit Breaker
C = Non-Fused Disconnect

Service Options

0 = None
1 = Unpowered Convenience Outlet
2 = Powered Convenience Outlet
3 = Hinged Panels
4 = Hinged Panels and Unpowered Convenience Outlet
5 = Hinged Panels and Powered Convenience Outlet

Intake / Exhaust Options

B = Temperature Low Leak Economizer with Barometric Relief
C = Temperature Low Leak Economizer with Centrifugal Power Exhaust - Vertical Only
E = Enthalpy Low Leak Economizer with Barometric Relief
F = Enthalpy Low Leak Economizer with Centrifugal Power Exhaust - Vertical Only
N = Temperature Ultra Low Leak Economizer with Barometric Relief
P = Temperature Ultra Low Leak Economizer with Centrifugal Power Exhaust - Vertical Only
R = Enthalpy Ultra Low Leak Economizer with Barometric Relief
S = Enthalpy Ultra Low Leak Economizer with Centrifugal Power Exhaust - Vertical Only

Base Unit Controls

1 = VAV-RTU Open controller (required on each model)

Design Revision

- = Factory Design Revision

Voltage

1 = 575/3/60
5 = 208-230/3/60
6 = 460/3/60

AHRI COOLING RATING TABLE (208-v)


50LC*B SIZE	COOLING STAGES	HEATING OPTION	MOTOR OPTION	NOMINAL CAPACITY (tons)	NOM COOLING CAPACITY (MBtuh)	CONFIG	TOTAL POWER (kw)	EER	IEER	RATED INDOOR AIRFLOW (CFM)
14	3	None	1, 3, 4	12.5	146.0	VERTICAL	11.6	12.6	19.3	4375
			2	12.5	146.0	VERTICAL	11.7	12.5	19.2	4375
			5, 7, 8	12.5	146.0	HORIZONTAL	12.0	12.2	18.7	4375
			6	12.5	146.0	HORIZONTAL	12.2	12.0	18.5	4375
		Low, Med, High	1, 3, 4	12.5	146.0	VERTICAL	11.7	12.4	19.2	4375
			2	12.5	146.0	VERTICAL	11.8	12.4	19.1	4375
			5, 7, 8	12.5	146.0	HORIZONTAL	12.3	11.9	18.3	4375
			6	12.5	146.0	HORIZONTAL	12.4	11.8	18.2	4375
17	3	All	—	15.0	172.0	VERTICAL	13.7	12.6	18.5	4875
		None	—	15.0	170.0	HORIZONTAL	14.0	12.1	17.7	4875
		Low	—	15.0	170.0	HORIZONTAL	14.0	12.1	17.7	4875
		Med	—	15.0	170.0	HORIZONTAL	14.0	12.1	17.7	4875
		High	—	15.0	170.0	HORIZONTAL	14.3	11.9	17.5	4875
20	3	All	—	17.5	194.0	VERTICAL	15.9	12.2	17.9	5690
		None	—	17.5	192.0	HORIZONTAL	16.7	11.5	17.2	5690
		Low	—	17.5	192.0	HORIZONTAL	16.7	11.5	17.2	5690
		Med	—	17.5	192.0	HORIZONTAL	16.8	11.4	17.1	5690
		High	—	17.5	192.0	HORIZONTAL	17.0	11.3	17.0	5690
24	3	All	—	20.0	232.0	VERTICAL	19.0	12.2	18.2	6500
		None	—	20.0	230.0	HORIZONTAL	20.2	11.4	17.5	6500
		Low	—	20.0	230.0	HORIZONTAL	20.2	11.4	17.5	6500
		Med	—	20.0	230.0	HORIZONTAL	20.2	11.4	17.5	6500
		High	—	20.0	228.0	HORIZONTAL	20.4	11.2	17.4	6500
26	3	All	—	23.0	274.0	VERTICAL	23.6	11.6	18.3	7500
		None	—	23.0	270.0	HORIZONTAL	25.5	10.6	16.8	7500
		Low	—	23.0	270.0	HORIZONTAL	25.5	10.6	16.8	7500
		Med	—	23.0	268.0	HORIZONTAL	25.3	10.6	16.8	7500
		High	—	23.0	268.0	HORIZONTAL	25.8	10.4	16.5	7500

LEGEND

- AHRI** — Air-Conditioning, Heating and Refrigeration Institute Test Standard
- ASHRAE** — American Society of Heating, Refrigerating and Air-Conditioning Engineers
- EER** — Energy Efficiency Ratio
- IEER** — Integrated Energy Efficiency Ratio

NOTES:

1. Rated in accordance with AHRI 340/360 Standards.
2. Ratings are based on:
Cooling Standard: 80°F (27°C) db, 67°F (19°C) wb indoor air temp and 95°F (35°C) db outdoor air temp.
3. 50LC*B units comply with US Energy Policy Act. To evaluate code compliance requirements, refer to state and local codes.

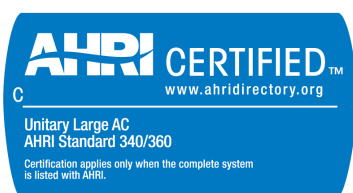

AHRI capacity ratings (cont)



AHRI COOLING RATING TABLE (230/460/575-v)


50LC*B SIZE	COOLING STAGES	HEATING OPTION	MOTOR OPTION	NOMINAL CAPACITY (tons)	NOM COOLING CAPACITY (MBtuh)	CONFIG	TOTAL POWER (kw)	EER	IEER	RATED INDOOR AIRFLOW (CFM)
14	3	None	1,3,4	12.5	146.0	VERTICAL	11.6	12.6	19.3	4375
			2	12.5	146.0	VERTICAL	11.7	12.5	19.2	4375
			5, 7,8	12.5	146.0	HORIZONTAL	12.0	12.2	18.7	4375
			6	12.5	146.0	HORIZONTAL	12.2	12.0	18.5	4375
		Low, Med, High	1, 3,4	12.5	146.0	VERTICAL	11.7	12.4	19.2	4375
			2	12.5	146.0	VERTICAL	11.8	12.4	19.1	4375
			5, 7,8	12.5	146.0	HORIZONTAL	12.3	11.9	18.3	4375
			6	12.5	146.0	HORIZONTAL	12.4	11.8	18.2	4375
17	3	All	—	15.0	174.0	VERTICAL	13.8	12.6	18.5	4875
		None	—	15.0	172.0	HORIZONTAL	14.2	12.1	17.7	4875
		Low	—	15.0	172.0	HORIZONTAL	14.2	12.1	17.7	4875
		Med	—	15.0	172.0	HORIZONTAL	14.2	12.1	17.7	4875
		High	—	15.0	172.0	HORIZONTAL	14.5	11.9	17.5	4875
20	3	All	—	17.5	194.0	VERTICAL	15.9	12.2	17.7	5690
		None	—	17.5	192.0	HORIZONTAL	16.7	11.5	17.0	5690
		Low	—	17.5	192.0	HORIZONTAL	16.7	11.5	17.0	5690
		Med	—	17.5	192.0	HORIZONTAL	16.8	11.4	16.9	5690
		High	—	17.5	192.0	HORIZONTAL	17.0	11.3	16.8	5690
24	3	All	—	20.0	234.0	VERTICAL	19.2	12.2	18.2	6500
		None	—	20.0	232.0	HORIZONTAL	20.4	11.4	17.5	6500
		Low	—	20.0	232.0	HORIZONTAL	20.4	11.4	17.5	6500
		Med	—	20.0	232.0	HORIZONTAL	20.4	11.4	17.5	6500
		High	—	20.0	232.0	HORIZONTAL	20.7	11.2	17.4	6500
26	3	All	—	23.0	274.0	VERTICAL	23.6	11.6	18.3	7500
		None	—	23.0	270.0	HORIZONTAL	25.5	10.6	16.8	7500
		Low	—	23.0	270.0	HORIZONTAL	25.5	10.6	16.8	7500
		Med	—	23.0	268.0	HORIZONTAL	25.3	10.6	16.8	7500
		High	—	23.0	268.0	HORIZONTAL	25.8	10.4	16.5	7500

LEGEND

- AHRI** — Air-Conditioning, Heating and Refrigeration Institute Test Standard
- ASHRAE** — American Society of Heating, Refrigerating and Air-Conditioning Engineers
- EER** — Energy Efficiency Ratio
- IEER** — Integrated Energy Efficiency Ratio

NOTES:

1. Rated in accordance with AHRI 340/360 Standards.
2. Ratings are based on:
Cooling Standard: 80°F (27°C) db, 67°F (19°C) wb indoor air temp and 95°F (35°C) db outdoor air temp.
3. 50LC units comply with US Energy Policy Act. To evaluate code compliance requirements, refer to state and local codes.

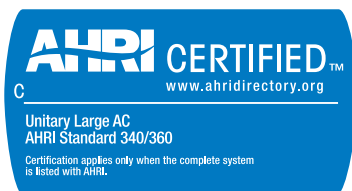

COOLING MINIMUM — MAXIMUM AIRFLOW RATINGS

50LC*B SIZE	COOLING STAGE	MAX CFM	MIN CFM	MAX OD AMBIENT TEMPERATURE °F	MIN OD AMBIENT TEMPERATURE °F
14	Stage 3	6250	3150	125	40
	Stage 2	3750	1900		
	Stage 1	2500	1250		
17	Stage 3	7500	3750	125	40
	Stage 2	4500	2250		
	Stage 1	3000	1500		
20	Stage 3	8750	4400	125	40
	Stage 2	5400	2700		
	Stage 1	4600	2300		
24	Stage 3	10000	5000	125	40
	Stage 2	5700	2850		
	Stage 1	4300	2150		
26	Stage 3	11250	5650	125	40
	Stage 2	8100	4050		
	Stage 1	6750	3400		

NOTE: SystemVu™ controller provides minimum outdoor temperature operation down to 0°F (–18°C).

HEATING MINIMUM — MAXIMUM CFM

UNIT	MIN AIR FLOW (CFM)	MAX AIR FLOW (CFM)
50lc*B14	3,750	6,250
50LC*B17	4,500	7,500
50LC*B20	5,250	8,750
50LC*B24	6,000	10,000
50LC*B26	6,750	11,250

SOUND PERFORMANCE

50LC*B	COOLING STAGES	OUTDOOR SOUND (dB) at 60 Hz									
		A-WEIGHTED	31.5	63	125	250	500	1000	2000	4000	8000
14	3	84	92.6	92.2	83.9	80.4	81.8	78.7	76.5	72.2	65.4
17	3	86	101.3	97.1	88.3	84.4	83.3	80.7	77.4	73.4	67.3
20	3	86	101.3	97.1	88.3	84.4	83.3	80.7	77.4	73.4	67.3
24	3	86	101.3	97.1	88.3	84.4	83.3	80.7	77.4	73.4	67.3
26	3	86	101.3	97.1	88.3	84.4	83.3	80.7	77.4	73.4	67.3

LEGEND

dB — Decibel

NOTES:

1. Outdoor sound data is measured in accordance with AHRI standard 270.
2. Measurements are expressed in terms of sound power. Do not compare these values to sound pressure values because sound pressure depends on specific environmental factors which normally do not match individual applications. Sound power values are independent of the environment and therefore more accurate.
3. A-weighted sound ratings filter out very high and very low frequencies, to better approximate the response of the "average" human ear. A-weighted measurements for Carrier units are taken in accordance with AHRI standard 270.

PHYSICAL DATA (COOLING) 12.5-23 TONS

	50LC*B14	50LC*B17	50LC*B20	50LC*B24	50LC*B26
REFRIGERATION SYSTEM					
# Circuits / # Comp. / Type	1 / 2 / Scroll	1 / 2 / Scroll	1 / 2 / Scroll	1 / 2 / Scroll	1 / 2 / Scroll
RTPF models R-410A charge A/B (lbs-oz)	32-0	33-6	35-6	40-10	43-4
Metering device	TXV	TXV	TXV	TXV	TXV
High-press. Trip / Reset (psig)	630 / 505	630 / 505	630 / 505	630 / 505	630 / 505
Low-press. Trip / Reset (psig)	54 / 117	54 / 117	54 / 117	54 / 117	54 / 117
Loss of charge Trip/Reset (psig)	N/A	N/A	N/A	N/A	N/A
EVAP. COIL					
Material	Cu / Al	Cu / Al	Cu / Al	Cu / Al	Cu / Al
Coil Type	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF
Coil Length (in.)	72	72	72	72	72
Coil Height (in.)	44	52	52	52	52
Rows / FPI	4 / 15	4 / 15	4 / 15	4 / 15	4 / 15
Total face area (ft²)	22.0	26.0	26.0	26.0	26.0
Condensate drain conn. size (in.)	3/4 in.	3/4 in.	3/4 in.	3/4 in.	3/4 in.
EVAPORATOR FAN AND MOTOR, VERTICAL					
STANDARD STATIC 3 PHASE	Motor Qty. / Belt Qty. / Drive Type	1 / 1 Belt	1 / 1 Belt	1 / 1 Belt	1 / 1 Belt
	Max Bhp	2.9	2.9	2.9	7.4
	Rpm range	498-676	498-676	555-753	583-717
	Motor frame size	56	56	56HZ	184T
	Fan Qty. / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal
MEDIUM STATIC 3 PHASE	Fan Diameter (in.)	15 x 15 / 15 X 15	15 x 15 / 15 X 15	15 x 15 / 15 X 15	15 x 15 / 15 X 15
	Motor Qty. / Belt Qty. / Drive Type	1 / 1 Belt	1 / 1 Belt	1 / 1 Belt	1 / 1 Belt
	Max Bhp	4.9	7.4	7.4	7.4
	Rpm range	682-861	651-818	707-888	707-888
	Motor frame size	145TZ	184T	184T	184T
HIGH STATIC 3 PHASE	Fan Qty. / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal
	Fan Diameter (in.)	15 x 15 / 15 X 15	15 x 15 / 15 X 15	15 x 15 / 15 X 15	15 x 15 / 15 X 15
	Motor Qty. / Belt Qty. / Drive Type	1 / 1 Belt	1 / 1 Belt	1 / 1 Belt	1 / 2 Belt
	Max Bhp	7.4	9.9	9.9	9.9
	Rpm range	782-963	804-970	872-1053	872-1053
SUPER STATIC 3 PHASE	Motor frame size	184T	213T	213T	213T
	Fan Qty. / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal
	Fan Diameter (in.)	15 x 15 / 15 X 15	15 x 15 / 15 X 15	15 x 15 / 15 X 15	15 x 15 / 15 X 15
	Motor Qty. / Belt Qty. / Drive Type	1 / 1 Belt	1 / 2 Belt	1 / 2 Belt	1 / 2 Belt
	Max Bhp (208/230/460/575v)	9.9	13.6	13.6	13.6
SUPER STATIC 3 PHASE	Rpm range	933-1113	948-1190	948-1190	1049-1291
	Motor frame size	213T	215T	215T	215T
	Fan Qty. / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal
	Fan Diameter (in.)	15 x 15 / 15 X 15	15 x 15 / 15 X 15	15 x 15 / 15 X 15	15 x 15 / 15 X 15
	Motor Qty. / Belt Qty. / Drive Type	1 / 1 Belt	1 / 2 Belt	1 / 2 Belt	1 / 2 Belt
SUPER STATIC 3 PHASE	Max Bhp (208/230/460/575v)	9.9	13.6	13.6	13.6
	Rpm range	933-1113	948-1190	948-1190	1049-1291
	Motor frame size	213T	215T	215T	215T
	Fan Qty. / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal
	Fan Diameter (in.)	15 x 15 / 15 X 15	15 x 15 / 15 X 15	15 x 15 / 15 X 15	15 x 15 / 15 X 15

PHYSICAL DATA (COOLING) 12.5-23 TONS (CONT)

		50LC*B14	50LC*B17	50LC*B20	50LC*B24	50LC*B26
EVAPORATOR FAN AND MOTOR, HORIZONTAL						
STANDARD STATIC 3 PHASE	Motor Qty. / Belt Qty. / Drive Type	1 / 1 Belt	1 / 1 Belt	1 / 1 Belt	1 / 1 Belt	1 / 1 Belt
	Max Bhp	2.9	2.9	2.9	7.4	7.4
	Rpm range	498-676	498-676	555-753	583-717	707-888
	Motor frame size	56	56	56HZ	184T	184T
	Fan Qty. / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal
	Fan Diameter (in.)	18 x 15 / 15 X 11	18 x 15 / 15 X 11	18 x 15 / 15 X 11	18 x 15 / 15 X 11	18 x 15 / 15 X 11
MEDIUM STATIC 3 PHASE	Motor Qty. / Belt Qty. / Drive Type	1 / 1 Belt	1 / 1 Belt	1 / 1 Belt	1 / 1 Belt	1 / 1 Belt
	Max Bhp	4.9	7.4	7.4	7.4	9.9
	Rpm range	644-808	651-818	651-818	707-888	859-1026
	Motor frame size	184T	213T	213T	213T	213T
	Fan Qty. / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal
	Fan Diameter (in.)	18 x 15 / 15 X 11	18 x 15 / 15 X 11	18 x 15 / 15 X 11	18 x 15 / 15 X 11	18 x 15 / 15 X 11
HIGH STATIC 3 PHASE	Motor Qty. / Belt Qty. / Drive Type	1 / 1 Belt	1 / 1 Belt	1 / 1 Belt	1 / 1 Belt	1 / 2 Belt
	Max Bhp	7.4	9.9	9.9	9.9	13.6
	Rpm range	707-888	804-970	804-970	872-1053	948-1190
	Motor frame size	184T	213T	213T	213T	215T
	Fan Qty. / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal
	Fan Diameter (in.)	18 x 15 / 15 X 11	18 x 15 / 15 X 11	18 x 15 / 15 X 11	18 x 15 / 15 X 11	18 x 15 / 15 X 11
SUPER STATIC 3 PHASE	Motor Qty. / Belt Qty. / Drive Type	1 / 1 Belt	1 / 2 Belt	1 / 2 Belt	1 / 2 Belt	N/A
	Max Bhp (208/230/460/575v)	9.9	13.6	13.6	13.6	N/A
	Rpm range	872-1053	948-1190	948-1190	948-1190	N/A
	Motor frame size	213T	215T	215T	215T	N/A
	Fan Qty. / Type	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	2 / Centrifugal	N/A
	Fan Diameter (in.)	18 x 15 / 15 X 11	18 x 15 / 15 X 11	18 x 15 / 15 X 11	18 x 15 / 15 X 11	N/A
COND. COIL 1						
	Material	Cu / Al	Cu / Al	Cu / Al	Cu / Al	Cu / Al
	Coil Type	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF
	Coil Length (in.)	68	82	82	98	98
	Coil Height (in.)	44	52	52	52	52
	Rows / FPI	2/18	2 / 18	2/18	2 / 18	2 / 18
	Total face area (ft²)	20.8	29.6	29.6	35.4	35.4
COND. COIL 2						
	Material	Cu / Al	Cu / Al	Cu / Al	Cu / Al	Cu / Al
	Coil Type	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF
	Coil Length (in.)	68	82	82	98	98
	Coil Height (in.)	44	52	52	52	52
	Rows / FPI	2/18	2 / 18	2/18	2 / 18	2 / 18
	Total face area (ft²)	20.8	29.6	29.6	35.4	35.4
COND. FAN / MOTOR						
	Qty. / Motor Drive Type	3 / direct	4 / direct	4 / direct	6 / direct	6 / Direct
	Motor HP / Rpm	1/3 / 1000	1/3 / 1000	1/3 /1000	1/3 / 1000	1/3 /1000
	Fan Diameter (in.)	22	22	22	22	22
FILTERS						
	RA Filter # / size (in.)	6 / 20 x 25 x 2	9/16x25x2	9/16x25x2	9/16x25x2	9 / 16x25x2
	OA inlet screen # / size (in.)	4 / 16 x 25 x 1	4/16x25x1	4/16x25x1	4/16x25x1	4 / 16x25x1

FACTORY-INSTALLED OPTIONS AND FIELD-INSTALLED ACCESSORIES

CATEGORY	ITEM	FACTORY-INSTALLED OPTION	FIELD-INSTALLED ACCESSORY
Cabinet	Hinged access panels	X	
Coil options	Cu/Cu indoor and/or outdoor coils	X	
	Pre-coated outdoor coils	X	
	Premium, E-coated outdoor coils	X	
Condenser protection	Condenser coil hail guard (louvered design)	X	X
Controls	VAV-RTU Open	Standard	
	Smoke detector (supply and/or return air)	X	
	Phase Monitor		X
	i-Vu® Equipment Touch; Carrier brand 4.3 in. color touch screen zone sensor and local user interface for a single Open (BACnet MS/TP) equipment controller. Includes built-in temperature and humidity sensor.		X
	i-Vu System Touch; Carrier brand 4.3 in. color touch screen user interface connects to a network of up to 60 Open (BACnet MS/TP) equipment controllers. Includes built-in temperature and humidity sensor.		X
Economizers and outdoor-air dampers	EconoMi\$er 2 for VAV-RTU Open controls, complies with FDD. (Standard and Ultra Low Leak air damper models) ⁶	Standard	
	Barometric relief ¹	X	X
	Power exhaust (Prop design)		X
Economizer sensors and IAQ devices	Single dry bulb temperature sensors ²	X	X
	Differential dry bulb temperature sensors ²		X
	Single enthalpy sensors ²	X	X
	Differential enthalpy sensors ²		X
	CO ₂ sensor (wall, duct, or unit mounted) ²	X	X
Zone air terminal sensors	Full range of Carrier zone air terminal space sensors are available with capabilities of combining: Space temperature, sensors with communication ports, sensors with CO ₂ sensing, sensors with LCD display, sensors with local override and indicating light.		X
VAV zone air terminals	A full range of zone air terminals shall be a i-Vu VAV Zone Single Duct and Fan Terminal type for optimum integrated system solution. This includes: • 35E – Single Duct Air Terminals • 45J – Series Fan Powered Air Terminals • 45K – Quiet Series Fan Powered Air Terminals • 45M – Parallel Fan Powered Air Terminals • 45N – Quiet Parallel Fan Powered Air Terminals • 45Q – Low Profile Series Fan Powered Air Terminals • 45R – Low Profile Parallel Fan Powered Air Terminals • 35J – Single Duct Retrofit Air Terminals		X
Electric heat	Electric Resistance Heaters	X	X
	Single Point Kit	X	X
Indoor motor and drive	Multiple motor and drive packages	X	
Power options	Convenience outlet (powered)	X	
	Convenience outlet (unpowered)	X	
	HACR Circuit Breaker ^{3, 5}	X	
	Non-fused disconnect ⁴	X	
Roof curbs	Roof curb 14 in. (356mm)		X
	Roof curb 24 in. (610mm)		X

NOTES:

1. Included with economizer.
2. Sensors used to optimize economizer performance.
3. On 575V applications, HACR breaker can only be used with WYE power distribution systems. Using on Delta power distribution systems is prohibited.
4. On 208/230-460 units with FIOP Non-Fused Disconnect, and Single Point Box accessory may be required. Refer to Electric Heat-Electrical Data Table for more information.
5. When selecting a factory installed HACR breaker or non-fused disconnect, note they are sized for the unit as ordered from the factory. The sizing of these do not accommodate any field items such as power exhaust devices etc.
6. FDD - (Fault Detection and Diagnostic) capability per California Title 24 section 120.2

Factory-installed options

Economizer (Standard on all models)

Economizers save energy, money and improve comfort levels in the conditioned space. They bring in fresh, outside air for ventilation and provide cool outside air to cool your building. This also is the preferred method of low ambient cooling. When integrated with CO₂ sensors, economizers can provide even more savings by coupling the ventilation air to only the amount required based on space occupancy.

Economizers are available, installed and tested by the factory, with either enthalpy or temperature dry-bulb inputs. Additional sensors are available as accessories to optimize the economizer.

Economizers include gravity controlled barometric relief that helps equalize building pressure and ambient air pressures. This can be a cost effective solution to prevent building pressurization. Economizers are available in ultra low leak and standard low leak versions.

Ultra Low Leak Economizer

This meets low leak requirements for ASHRAE 90.1, IECC, and CA Title 24 standards (3 cfm/ft² at 1 in. wg exterior air, 4 cfm/ft² at 1 in. wg return air). This option allows 100% outdoor air supply from 0-100% modulating dampers and is standard with barometric relief. It can be paired with powered exhaust for additional building pressure relief.

Fault Detection and Diagnostics (FDD)

This offering meets the mandatory requirement of CA Title 24 of fully configurable diagnostics allowing fault history and reading fault codes at the unit. This option provides detection of the following faults: air temperature sensor failure/fault and notification of acceptable economizer mode. The FDD system shall be certified by the Energy Commission as meeting the requirements.

CO₂ Sensor

Improves productivity and saves money by working with the economizer to intake only the correct amount of outside air for ventilation. As occupants fill your building, the CO₂ sensor detects their presence through increasing CO₂ levels, and opens the economizer appropriately.

When the occupants leave, the CO₂ levels decrease, and the sensor appropriately closes the economizer. This intelligent control of the ventilation air, called Demand Controlled Ventilation (DCV), reduces the overall load on the rooftop, saving money.

Smoke Detectors

Trust the experts. Smoke detectors make your application safer and your job easier. Carrier smoke detectors immediately shut down the rooftop unit when smoke is detected. They are available, installed by the factory, for supply air, return air, or both.

Louvered Hail Guards

Sleek, louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact

Convenience Outlet (powered or un-powered)

Reduce service and/or installation costs by including a convenience outlet in your specification. Carrier will install this service feature at our factory. Provides a convenient, 15 amp, 115v GFCI receptacle with "Wet in Use" cover. The "powered" option allows the installer to power the outlet from the line side of the disconnect or load side as required by code. The "unpowered" option is to be powered from a separate 115/120v power source.

Non-fused Disconnect

This OSHA-compliant, factory-installed, safety switch allows a service technician to locally secure power to the rooftop.

When selecting a factory installed non-fused disconnect, note they are sized for the unit as ordered from the factory. The sizing of these do not accommodate any field items such as power exhaust devices, etc.

Power Exhaust

Superior internal building pressure control. This field-installed accessory may eliminate the need for costly, external pressure control fans coordinating with economizer position and supply fan system airflow.

Hinged Access Panels

Allows access to unit's major components with specifically designed hinged access panels. Panels are: filter, control box, fan motor, and compressor. Comes with quarter turn latches and lift tabs.

Alternate Motors and Drives

Some applications need larger horsepower motors, some need more airflow, and some need both. Regardless of the case, your Carrier expert has a factory-installed combination to meet your application. A wide selection of motors and pulleys (drives) are available, factory installed, to handle nearly any application.

Thru-the-Base Connections

Thru-the-base connections, available as either an accessory or as a factory option, are necessary to ensure proper connection and seal when routing wire and piping through the rooftop's basepan and curb. These couplings eliminate roof penetration and should be considered for main power lines, as well as control power.

HACR Breaker

These manual reset devices provide overload and short circuit protection for the unit. They are factory wired and mounted with the units with access cover to help provide environment protection.

When selecting a factory installed non-fused disconnect, note they are sized for the unit as ordered from the factory. The sizing of these do not accommodate any field items such as power exhaust devices etc.

On 575V applications, HACR breaker can only be used with WYE power distribution systems. Use on Delta power distribution systems is prohibited.

Field-installed accessories

Electric Heaters

Carrier offers a full-line of field-installed accessory heaters. The heaters are very easy to use, install and are all pre-engineered and certified.

Zone Terminal Sensors

A full range of Carrier zone air terminal space sensors are available with capabilities of combining:

- Space temperature sensing
- Sensors with communication ports
- Sensors with CO₂ sensing
- Sensors with LCD display
- Sensors with local override and indicating light
- Sensors with humidity sensing

Plus compatibility with:

- i-Vu® Equipment Touch™; Carrier brand 4.3 in. color touch screen zone sensor and local user interface for a

single Open (BACnet MS/TP) equipment controller. Includes built-in temperature and humidity sensor.

- i-Vu System Touch™; Carrier brand 4.3 in. color touch screen user interface connects to a network of up to 60 Open (BACnet MS/TP) equipment controllers. Includes built-in temperature and humidity sensor.

VAV Zone Air Terminals

A full range of zone air terminals shall be a i-Vu VAV Zone Single Duct and Fan Terminal type for optimum integrated system solution. This includes:

- 35E – Single Duct Air Terminals
- 45J – Series Fan Powered Air Terminals
- 45K – Quiet Series Fan Powered Air Terminals
- 45M – Parallel Fan Powered Air Terminals
- 45N – Quiet Parallel Fan Powered Air Terminals
- 45Q – Low Profile Series Fan Powered Air Terminals
- 45R – Low Profile Parallel Fan Powered Air Terminals
- 35J – Single Duct Retrofit Air Terminals

OPTION/ACCESSORY	WEIGHT IN LBS				
	50LC*B14	50LC*B17	50LC*B20	50LC*B24	50LC*B26
Low Electric Heat	85	85	85	85	85
Medium Electric Heat	100	100	100	100	100
High Electric Heat	100	100	100	100	100
Return Smoke Detector	5	5	5	5	5
Supply Smoke Detector	5	5	5	5	5
RA and SA Smoke Detector	10	10	10	10	10
CO ₂ Sensor	5	5	5	5	5
RA Smoke Detector and CO ₂	10	10	10	10	10
SA Smoke Detector and CO ₂	10	10	10	10	10
RA and SA Smoke Detector and CO ₂	15	15	15	15	15
Medium Static Option	5	6	6	10	10
High Static Option	11	16	16	20	20
Cu/Cu Cond and Al/Cu Evap	28	34	34	34	34
Cu/Cu Cond and Cu/Cu Evap	53	64	64	64	64
Al/Cu Cond and Al/Cu Evap + Hail Guard	60	150	150	150	150
Precoat Al/Cu Cond and Al/Cu Evap + Hail Guard	60	150	150	150	150
Ecoat Al/Cu Cond and Al/Cu Evap + Hail Guard	60	150	150	150	150
Ecoat Al/Cu Cond and Ecoat Al/Cu Evap + Hail Guard	60	150	150	150	150
Cu/Cu Cond and Al/Cu Evap + Hail Guard	88	184	184	184	184
Cu/Cu Cond and Cu/Cu Evap + Hail Guard	113	214	214	214	214
Temp Ultra Low Leak Econo with Baro Relief	246	246	246	246	246
Temp Ultra Low Leak Econo with PE (cent) Power Exhaust	371	371	371	371	371
Enthalpy Ultra Low Leak Econo with Baro Relief	246	246	246	246	246
Enthalpy Ultra Low Leak Econo with PE (cent) Power Exhaust	371	371	371	371	371
Unpowered Convenience Outlet	5	5	5	5	5
Powered Convenience outlet	35	35	35	35	35
Hinged Panels	5	5	5	5	5
Hinged Panels with Unpowered Convenience Outlet	10	10	10	10	10
Hinged Panels with Powered Convenience Outlet	40	40	40	40	40
HACR Breaker	10	10	10	10	10
Non-Fused Disconnect	15	15	15	15	15

Carrier

THIS DRAWING IS THE PROPERTY OF A/C CLIMATE. CONTENTS HEREIN ARE TO BE KEPT IN STRICTLY CONFIDENTIAL. NO REPRODUCTION, IN WHOLE OR IN PART, IS PERMITTED WITHOUT THE WRITTEN CONSENT OF A/C CLIMATE. THE CONTENTS WILL NOT BE DISCLOSED OR USED IN ANY MANNER WITHOUT PERMISSION.

50LC 14 SINGLE ZONE ELECTRICAL CONDENSER COILS

50LC500664

REV A

CONNECTION SIZES

	CONNECTION SIZES
A	1 3/8" DIA [38] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT

NOTES:

1. DIMENSIONS ARE IN INCHES. DIMENSIONS IN PARENS ARE IN MILLIMETERS.
2. CENTER OF GRAVITY
3. DIRECTION OF AIR FLOW
4. ALL VIEW DRAWN USING 3RD ANGLE

FRONT

VERTICAL SUPPLY AIR

VERTICAL RETURN AIR

INDOOR BLOWER ACCESS PANEL

ELECTRIC HEAT ACCESS PANEL

CONDENSER COILS ACCESS PANEL

CONVENIENCE OUTLET (OPTIONAL)

OUTSIDE AIR FLOW (OPTIONAL)

DISCONNECT (OPTIONAL)

PANEL LIFTING HANDLE

41-1/8 [1044]

17-3/8 [443]

28-1/2 [723] POWER EXHAUST FLOW (OPTIONAL)

47-3/4 [1214]

17-1/2 [445]

25 [636]

1-1/8 [25]

49-3/8 [1255]

CONDENSER AIR INCHILL GRILLE

86-3/8 [2194]

PANEL LIFTING HANDLE

RIGHT

BACK

ECONOMIZER (TYPICAL TYPE) (OPTIONAL)

POWER EXHAUST (OPTIONAL)

PANELS REQUIRED TO SHOW ECONOMIZER AND POWER EXHAUST OPTIONS

68 [1726]

19-1/4 [489]

53-3/4 [1365]

25-1/2 [649]

6-1/4 [157]

6-1/4 [157]

6-1/4 [158]

68-1/8 [1730]

61-5/8 [1564]

TOP

14-1/8 [359]

4X 1-1/8 [181]

8-1/8 [206]

11 [279]

12-7/8 [329]

14-7/8 [379]

A, B, C

LEFT

SHOWN WITH THE BAROMETRIC RELIEF OPTION INSTALLED

BAROMETRIC RELIEF (OPTIONAL) INCLUDED WITH ECONOMIZER

4-3/4 [122]

45-3/8 [1151]

6-3/8 [1239]

4-3/4 [122]


A, B, C

POWER EXHAUST (OPTIONAL)

SHOWN WITH THE POWER EXHAUST OPTION INSTALLED

Base unit dimensions (cont)

50LC*B14 HORIZONTAL AIRFLOW

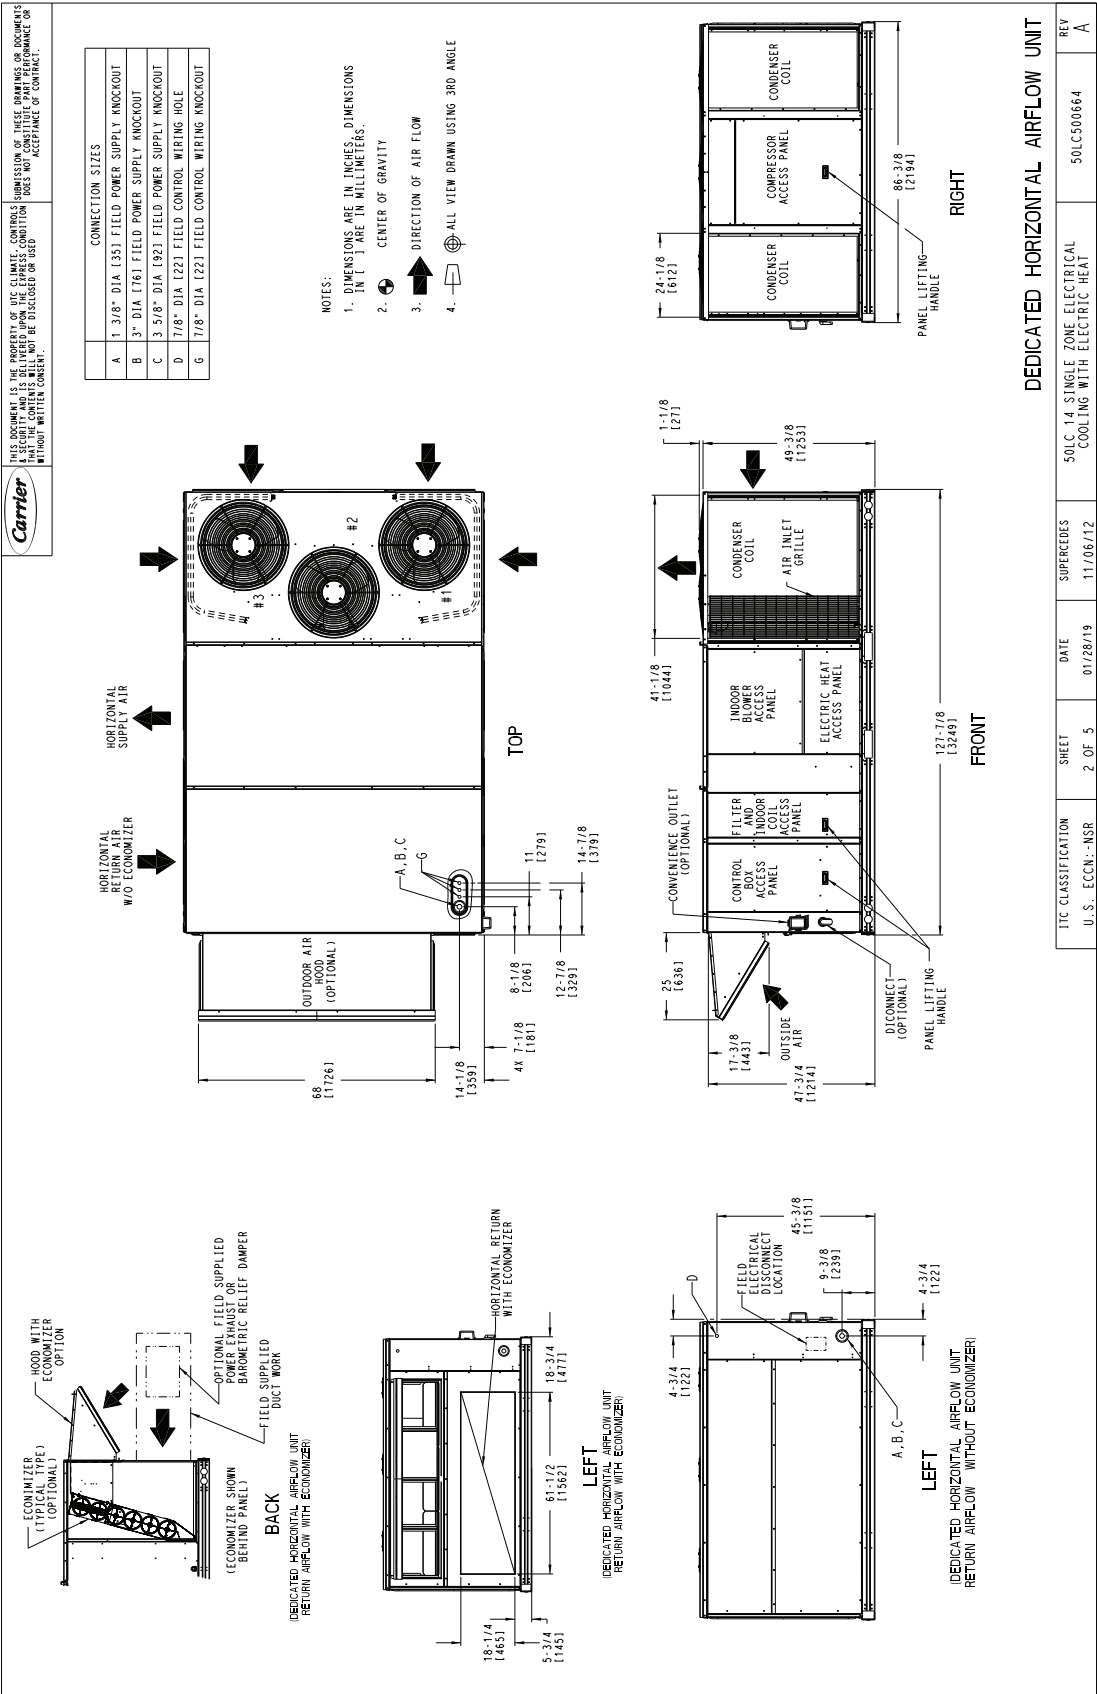

DEDICATED HORIZONTAL AIRFLOW UNIT

TIC CLASSIFICATION	SHEET	DATE	SUPERCEDES	REV
U.S. ECCN: NSR	2 OF 5	01/28/19	11/06/12	A


50LC 14 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	50LC500664	REV
		A

CONNECTION SIZES	SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE AN ENDORSEMENT OR ACCEPTANCE OF CONTRACT.
E	THIS DOCUMENT IS THE PROPERTY OF THE CLIENT. CONTROL & SECURITY AND IS DELIVERED UPON THE EXPRESS CONDITION THAT IT WILL BE KEPT IN THE CLIENT'S POSSESSION AND NOT BE REPRODUCED OR DISCLOSED OR USED IN ANY MANNER WITHOUT WRITTEN CONSENT.


The figure contains four technical drawings of Carrier HVAC units, showing connection sizes and dimensions in feet and inches (Ft) and millimeters (mm).

- Top Left: BACK (DEDICATED HORIZONTAL AIRFLOW UNIT W/O FACTORY ECONOMIZER)**
 - CONDENSER COIL
 - HORIZONTAL SUPPLY
 - HORIZONTAL RETURN WITHOUT ECONOMIZER
 - Dimensions: 41'-3/8" (1049), 5'-3/8" (138), 5'-3/4" (144), 3'-3/8" (85), 23'-1/4" (592), 37'-1/2" (951), 50'-5/8" (1290), 50'-3/4" (1280), 29'-5/8" (754), 15'-3/4" (400), 5'-3/4" (144).
- Top Right: BACK (DEDICATED VERTICAL AIRFLOW UNIT W/ECONOMIZER)**
 - CONDENSER COIL
 - HOOD WITH FACTORY ECONOMIZER OR POWER EXHAUST OPTIONS
 - Dimensions: 5'-3/8" (138), 37'-1/2" (951).
- Bottom Left: BACK (DEDICATED HORIZONTAL AIRFLOW WITH W/O FACTORY ECONOMIZER)**
 - CONDENSER COIL
 - HORIZONTAL SUPPLY
 - HOOD WITH FACTORY ECONOMIZER OR POWER EXHAUST OPTIONS
 - RETURN AIR
 - Dimensions: 29'-5/8" (754), 50'-3/4" (1280), 37'-1/2" (951), 5'-3/8" (138), 5'-3/4" (144), 15'-3/4" (400).
- Bottom Right: BACK (DEDICATED HORIZONTAL AIRFLOW WITH W/O FACTORY ECONOMIZER)**
 - CONDENSER COIL
 - HORIZONTAL SUPPLY
 - HOOD WITH FACTORY ECONOMIZER OR POWER EXHAUST OPTIONS
 - RETURN AIR
 - Dimensions: 29'-5/8" (754), 50'-3/4" (1280), 37'-1/2" (951), 5'-3/8" (138), 5'-3/4" (144), 15'-3/4" (400).


[illegible]

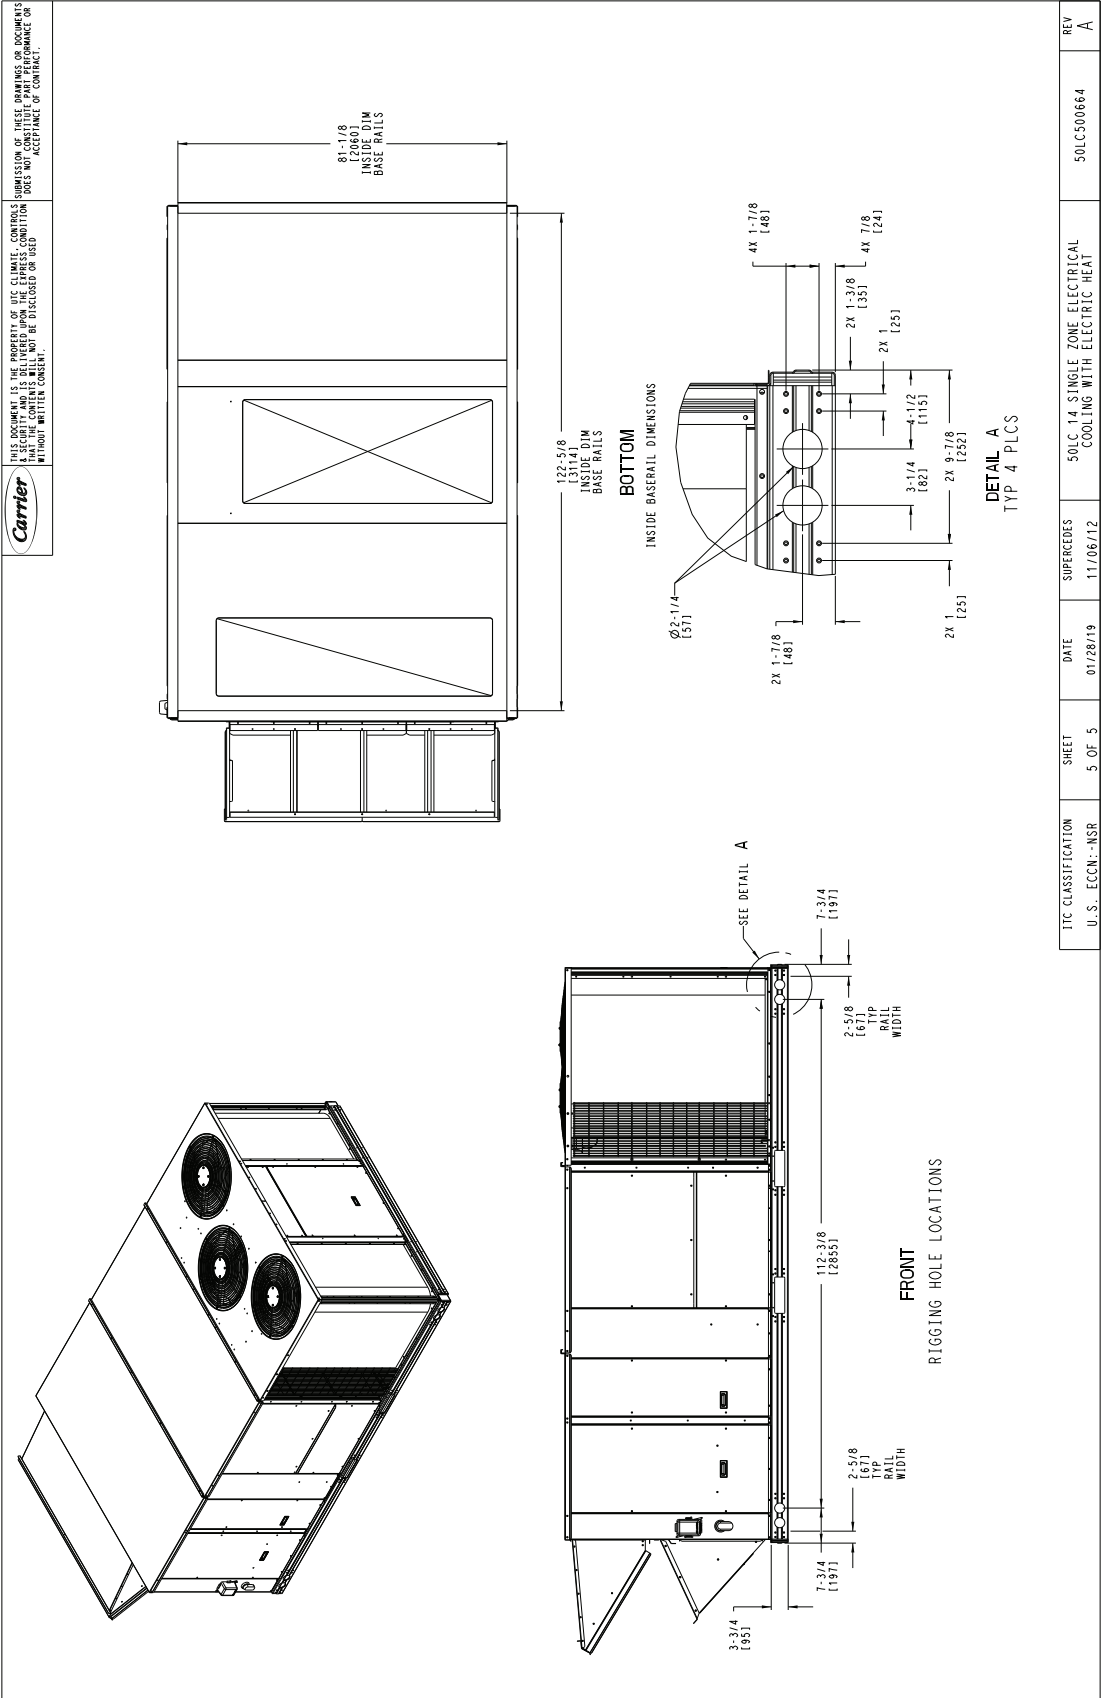

50LC*B17-20 VERTICAL AIRFLOW

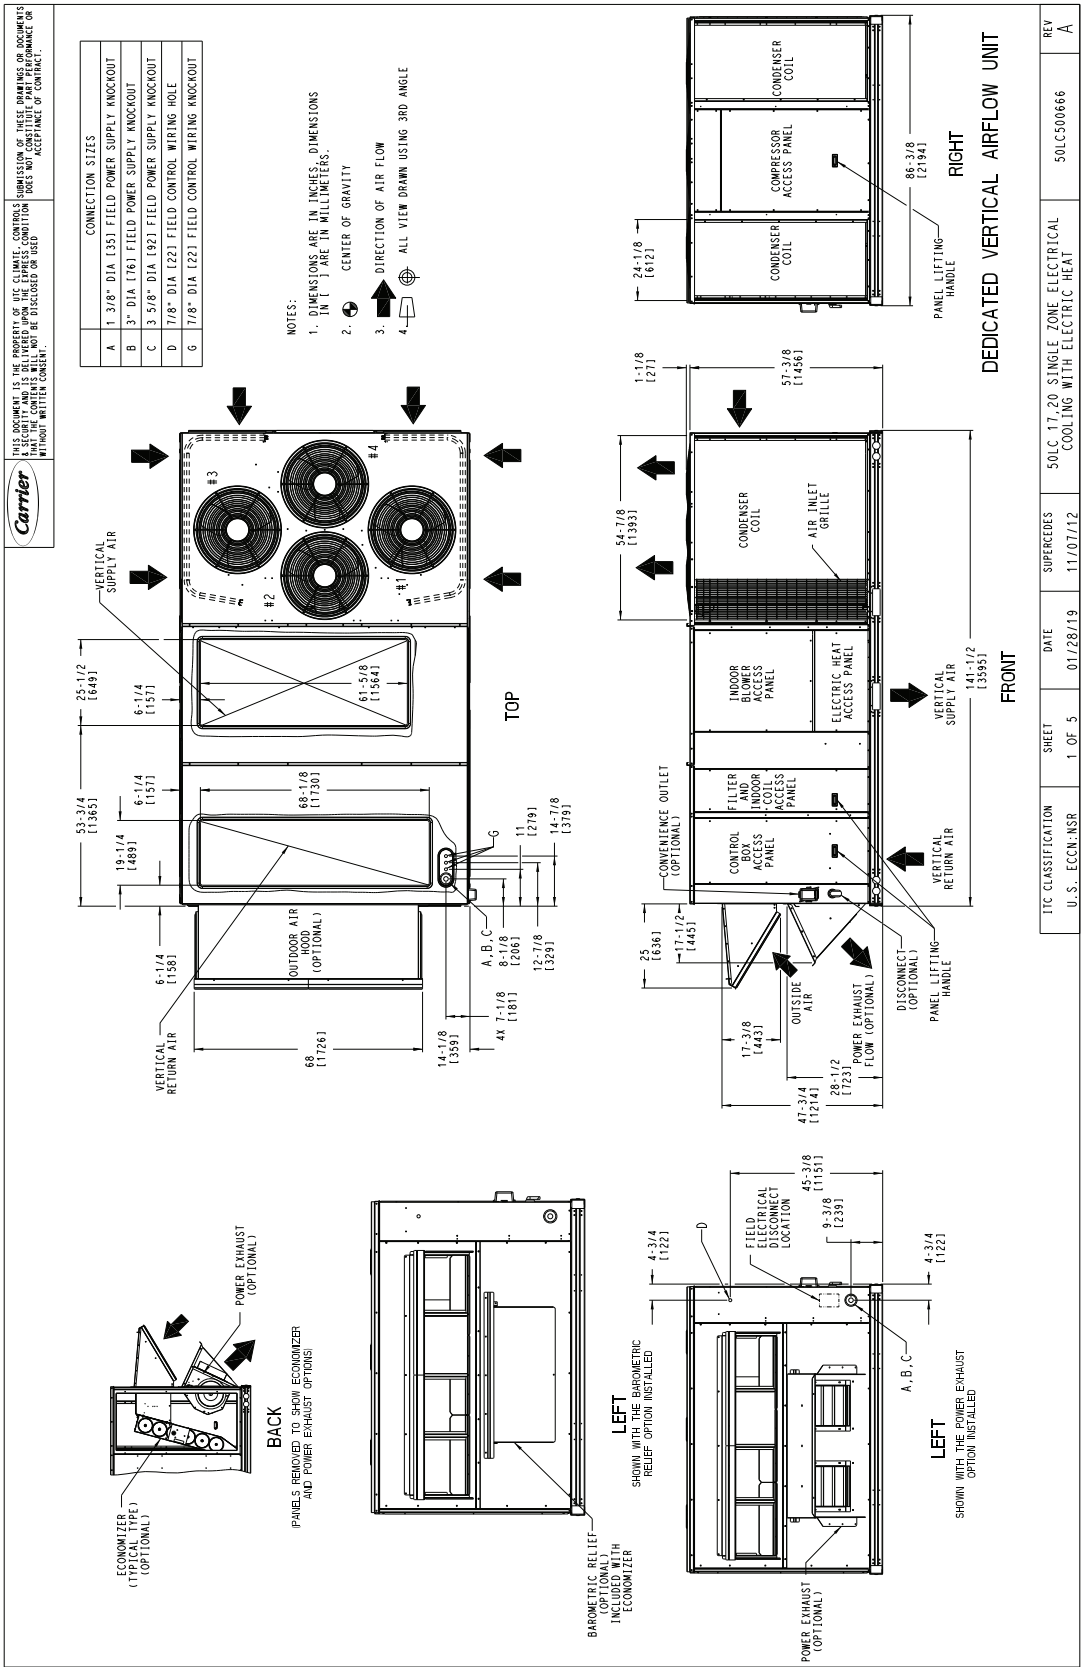

50LC*B17-20 HORIZONTAL AIRFLOW

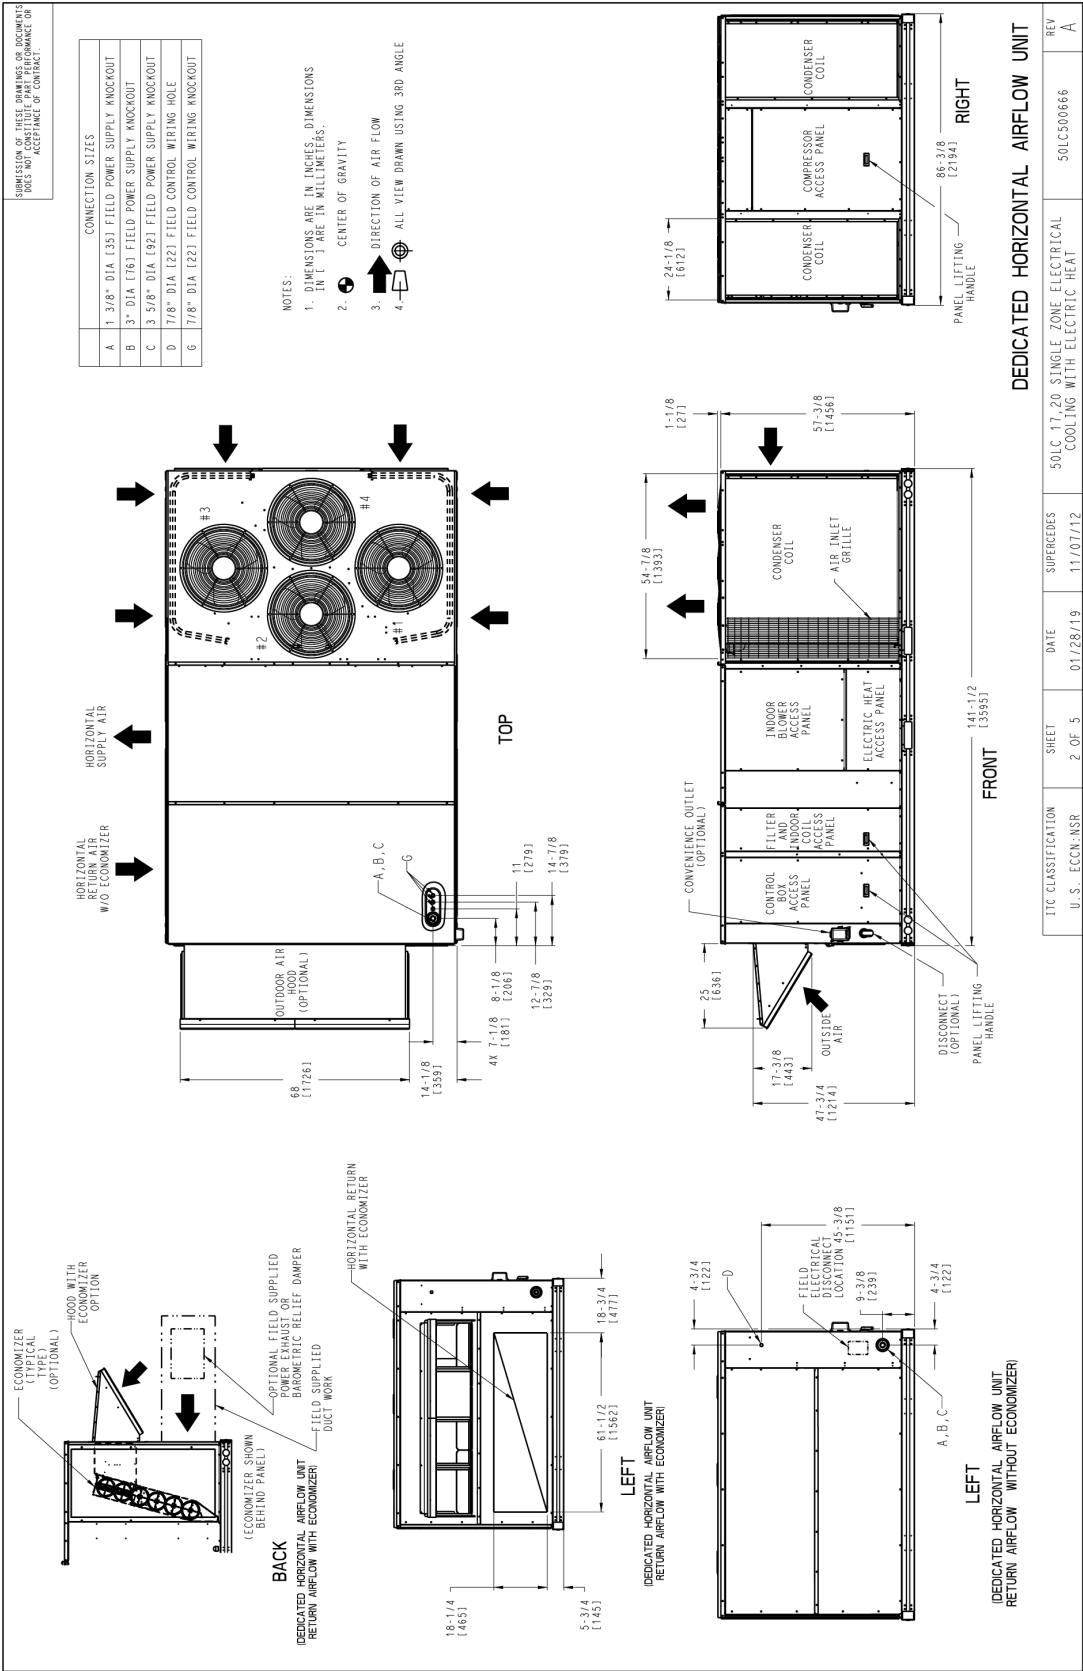

E	CONNECTION SIZES
3/4" - 1 1/4" NPT CONDENSATE DRAIN	

BACK
(DEDICATED HORIZONTAL AIRFLOW UNIT W/O FACTORY ECONOMIZER)

CONDENSER COIL

HORIZONTAL RETURN—WITHOUT ECONOMIZER

HORIZONTAL SUPPLY

HOOD WITH ECONOMIZER OR POWER EXHAUST OPTIONS

HOOD WITH FACTORY ECONOMIZER OR POWER EXHAUST OPTIONS

RETURN AIR

BACK
(DEDICATED HORIZONTAL AIRFLOW UNIT WITH FACTORY ECONOMIZER)

CONDENSER COIL

REV	A
50LC 17-20 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	
50LC500666	


THIS DOCUMENT IS THE PROPERTY OF A/C CLIMATE CONTROLS. IT IS TO BE USED FOR THE PROJECT AND NOT BE DISCLOSED OR REPRODUCED IN ANY MANNER WITHOUT WRITTEN CONSENT.

THESE DRAWINGS ARE THE PROPERTY OF A/C CLIMATE CONTROLS. THEY ARE TO BE USED FOR THE PROJECT AND NOT BE DISCLOSED OR REPRODUCED IN ANY MANNER WITHOUT WRITTEN CONSENT.

[illegible]



50LC*B17-20 BOTTOM VIEW

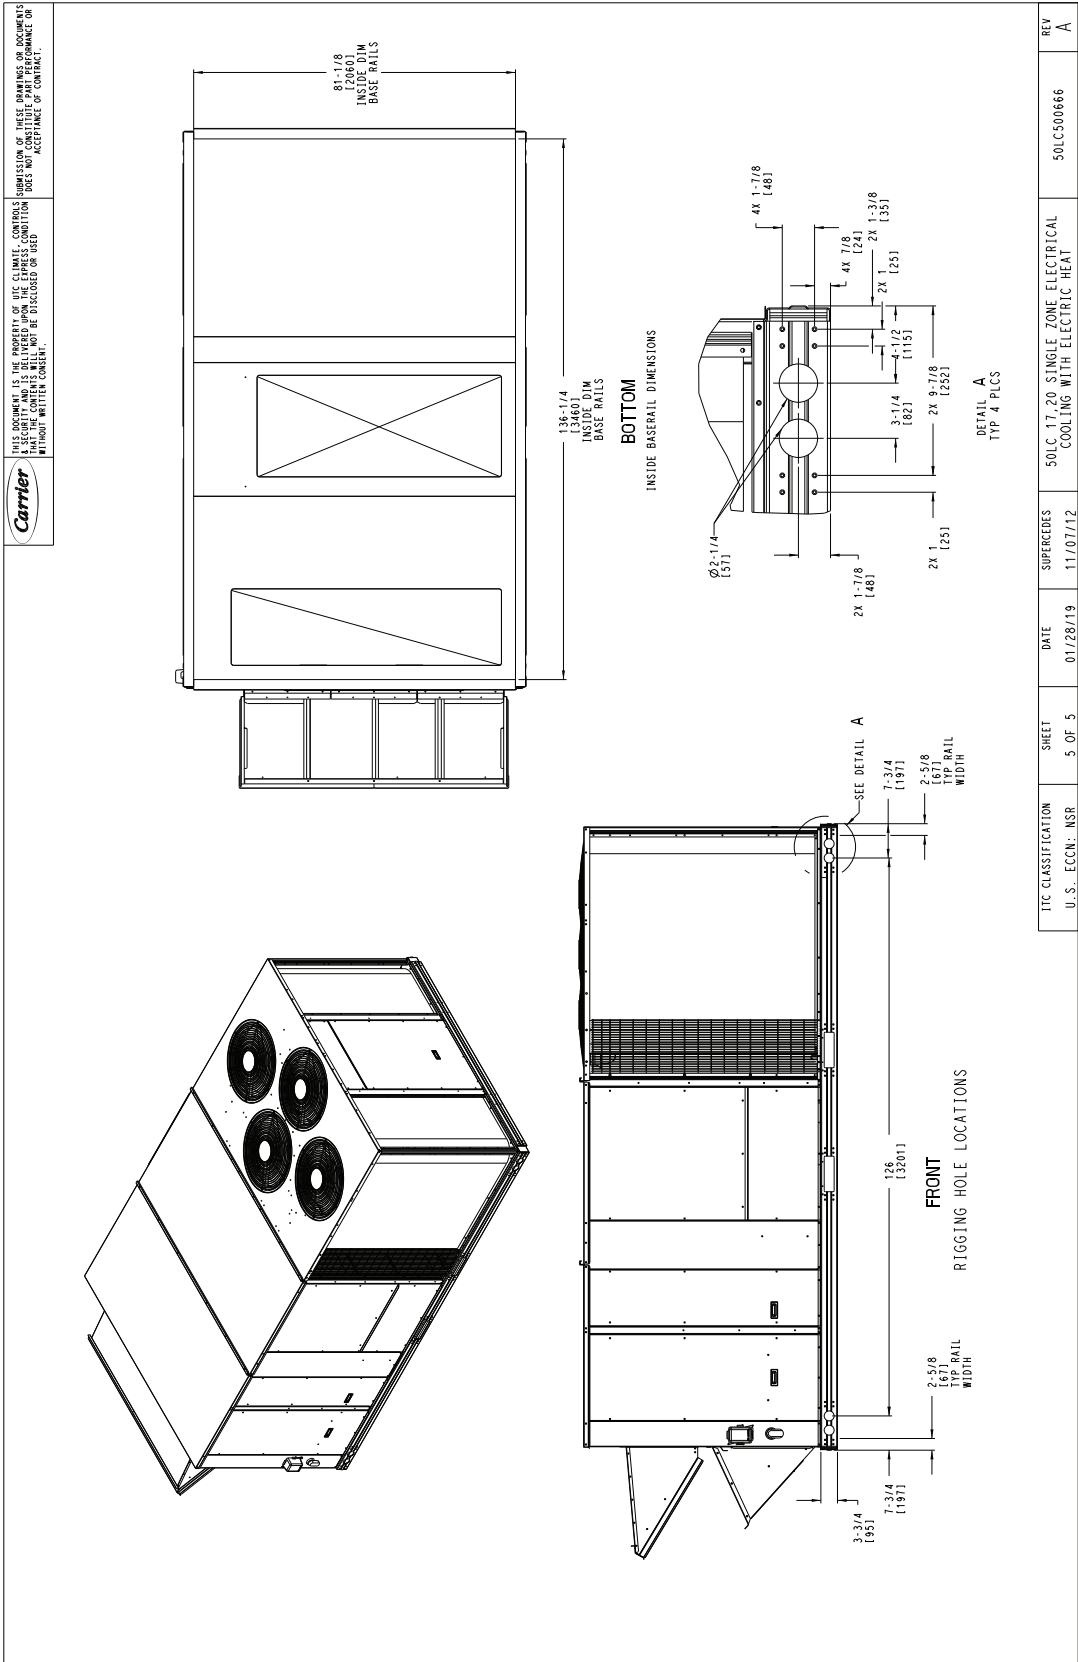

THIS DOCUMENT IS THE PROPERTY OF THE COMPANY. CONSTRUCTION OF THESE DRAWINGS OR DOCUMENTS IS TO BE KEPT IN THE COMPANY'S POSSESSION AND SECURITY AND IS TO BE RETURNED UPON THE EXPRESS OR IMPLIED REQUEST OF THE COMPANY. NO PART OF THIS DOCUMENT SHALL BE REPRODUCED OR USED IN ANY MANNER WITHOUT WRITTEN CONSENT.

Carrier

CONNECTION SIZES

A	1 3/8" DIA [35]	FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76]	FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92]	FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22]	FIELD CONTROL WIRING HOLE
G	7/8" DIA [22]	FIELD CONTROL WIRING KNOCKOUT

NOTES:

- DIMENSIONS ARE IN INCHES, DIMENSIONS IN [] ARE IN MILLIMETERS.
- CENTER OF GRAVITY
- DIRECTION OF AIR FLOW
- ALL VIEW DRAWN USING 3RD ANGLE

BACK

PANELS REMOVED TO SHOW ECONOMIZER AND POWER EXHAUST OPTIONS

LEFT

SHOWN WITH THE BAROMETRIC RELIEF OPTION INSTALLED

RIGHT


TOP

FRONT

LEFT

SHOWN WITH THE POWER EXHAUST OPTION INSTALLED

50LC*B24-26 HORIZONTAL AIRFLOW

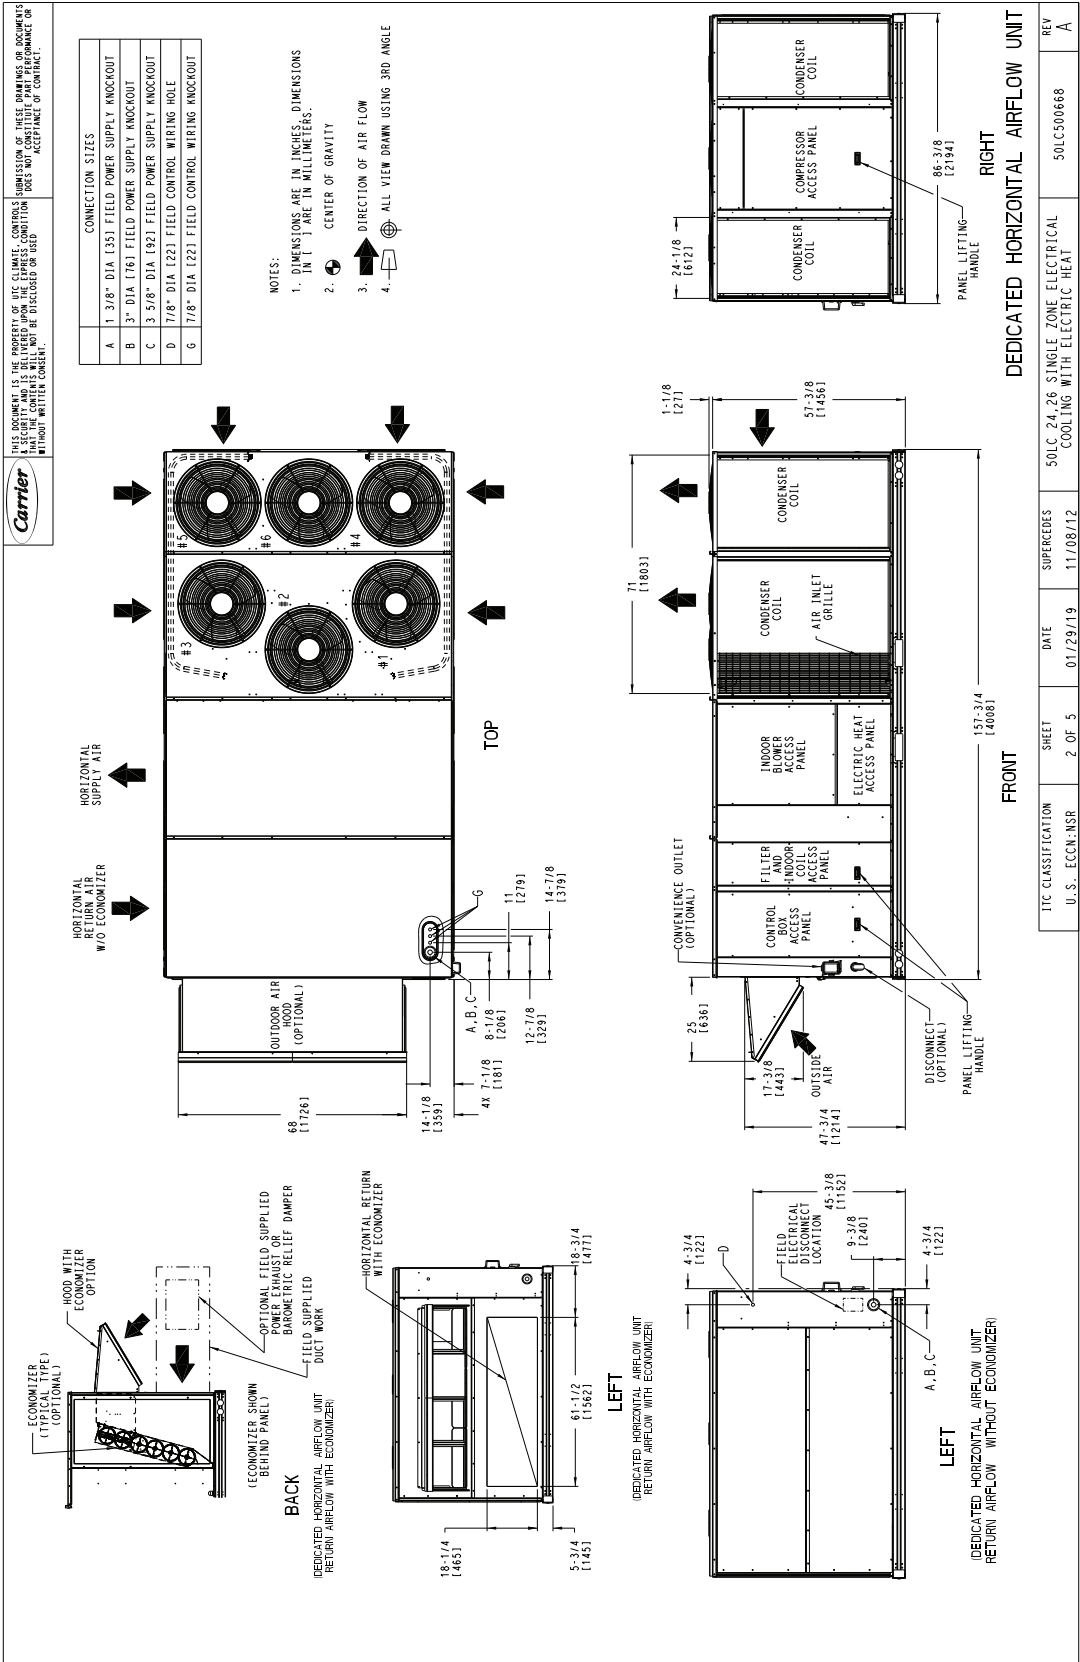

CONNECTION SIZES

3/4" - 1 1/4" NPT CONDENSATE DRAIN

CONNECTION SIZES	
E	3/4" - 1 1/4" NPT CONDENSATE DRAIN

UNIT	STD UNIT WEIGHT		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		C.G.	
	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	X	Y
50LC24	2248	1022.0	458.3	208.3	537.5	244.3	676.2	307.4	576.5	262.1	48 1/2 [1219.79]	85 1/32 [12159.79]
50LC26	2393	1087.6	534.0	242.7	595.1	270.5	666.0	302.7	597.6	271.6	45 1/2 [1155.70]	83 1/32 [12108.99]

* STANDARD UNIT WEIGHT IS WITHOUT ELECTRIC HEAT AND WITHOUT PACKAGING.
 FOR OTHER OPTIONS AND ACCESSORIES REFER TO THE PRODUCT DATA CATALOG.

SURFACE		SERVICE WITH CONDUCTIVE BARRIER		SERVICE WITH NONCONDUCTIVE BARRIER		OPERATING CLEARANCE	
FRONT	FRONT	48 [1219mm]	36 [914mm]	18 [457mm]	18 [457mm]		
	LEFT	48 [1219mm]	42 [1067mm]	18 [457mm]	18 [457mm]		
BACK	BACK	42 [1067mm]	36 [914mm]	18 [457mm]	18 [457mm]		
	RIGHT	36 [914mm]	36 [914mm]	18 [457mm]	18 [457mm]		
TOP		72 [1829mm]	72 [1829mm]	72 [1829mm]	72 [1829mm]		

NOTES:
 1. CLEARANCE ABOVE THE UNIT TO BE 72"
 2. FOR ALL MINIMUM CLEARANCES LOCAL CODES OR JURISDICTIONS MAY PREVAIL.

TTC CLASSIFICATION		SHEET		DATE		SUPERCEDES		REV	
U.S. EPOCH-NEP		A OF 5		01/20/10		50LC 24, 26 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT		50LC500668	

THIS DOCUMENT IS THE PROPERTY OF HFC CLIMATE CONTROLS. IT IS TO BE USED FOR THE PROJECT AND NOT BE DISCLOSED OR USED FOR ANY OTHER PROJECT WITHOUT WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS TO THE PROJECT OR TO THE CLIENT SHALL BE DEEMED TO BE AN ACCEPTANCE OF CONTRACT.

Carrier

THIS DOCUMENT IS THE PROPERTY OF THE CARRIER CORPORATION. IT IS TO BE USED ONLY FOR THE PROJECT AND FOR THE EQUIPMENT SPECIFICALLY IDENTIFIED HEREIN. THE CONTENTS WILL NOT BE DISCLOSED OR USED IN ANY MANNER WITHOUT WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE AN ACCEPTANCE OF CONTRACT.

FRONT

RIGGING HOLE LOCATIONS

142-1/4 (3614)

7-3/4 (197)

2-5/8 (67) TYP RAIL WIDTH

3-3/4 (95)

SEE DETAIL A

INSIDE BASERAIL DIMENSIONS

DETAIL A

TYP 4 PLCS

Ø2-1/4 (51)

2X 1-7/8 (45)

4X 1-7/8 (46)

4X 7/8 (24)

2X 1-3/8 (35)

2X 1 (25)

3-1/4 (82)

4-1/2 (115)

2X 9-7/8 (252)

2X 1 (25)

BOTTOM

INSIDE BASERAIL DIMENSIONS

159-1/2 (3873)


(INSIDE DIM BASE RAILS)

81-1/8 (2060)

(INSIDE DIM BASE RAILS)

ROOF CURB DETAILS FOR 50LC*B14



UNIT SIZE	"A"	ROOF CURB ACCESSORY
14	1'-2" [356.0] 2'-0" [610.0]	CRRFCURB045A00 CRRFCURB046A00

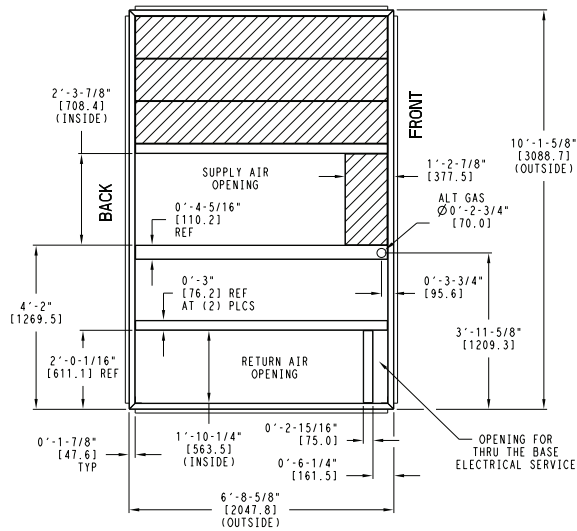







NOTES:

1. ROOF CURB ACCESSORY IS SHIPPED UNASSEMBLED.
2. DIMENSIONS IN [] ARE IN MILLIMETERS.
3. ROOF CURB GALVANIZED STEEL.
4. ATTACH DUCTWORK TO CURB (FLANGES ON DUCT REST ON CURB)
5. SERVICE CLEARANCE 4 ft ON EACH SIDE

➔ DIRECTION OF AIR FLOW




MAX CURB LEVELING TOLERANCES

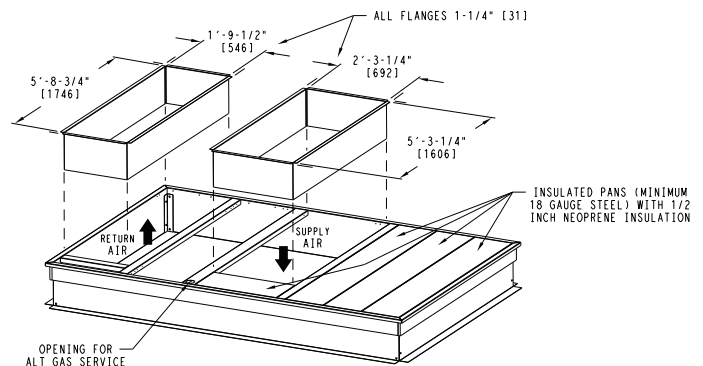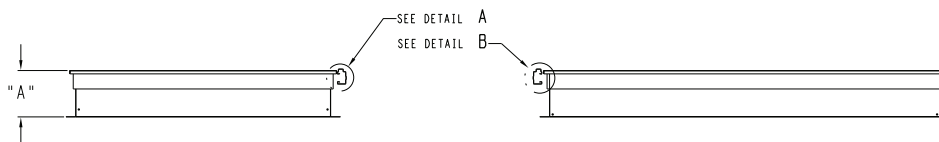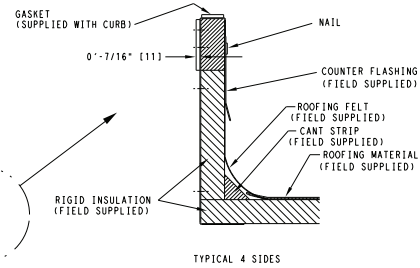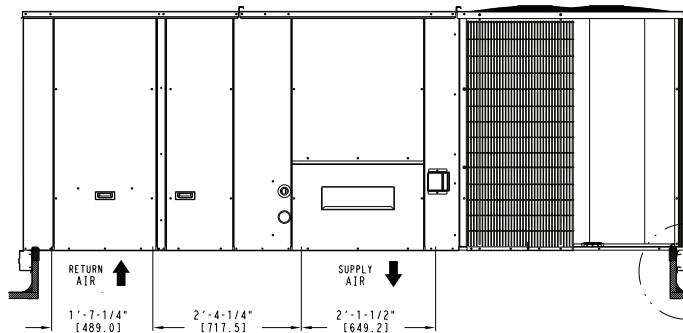

ROOF CURB DETAILS FOR 50LC*B17-20



UNIT SIZE	"A"	ROOF CURB ACCESSORY
17, 20	1'-2" [356.0] 2'-0" [610.0]	CRRFCURB047A00 CRRFCURB048A00

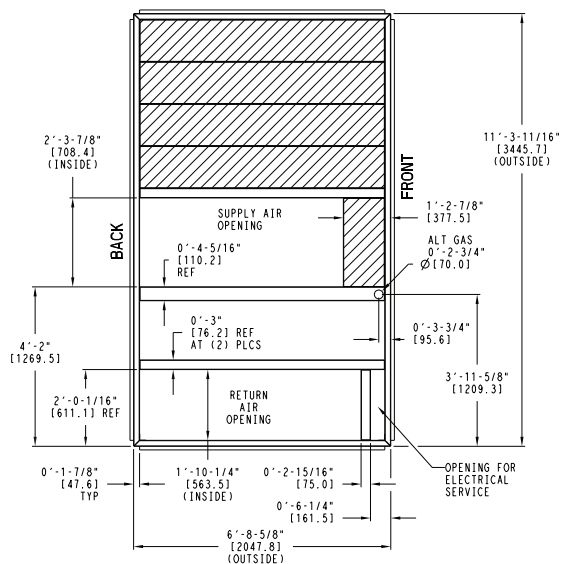







NOTES:

1. ROOF CURB ACCESSORY IS SHIPPED UNASSEMBLED.
2. DIMENSIONS IN [] ARE IN MILLIMETERS.
3. ROOF CURB GALVANIZED STEEL.
4. ATTACH DUCTWORK TO CURB (FLANGES ON DUCT REST ON CURB)
5. SERVICE CLEARANCE 4 FT ON EACH SIDE

➔ DIRECTION OF AIR FLOW




MAX CURB LEVELING TOLERANCES

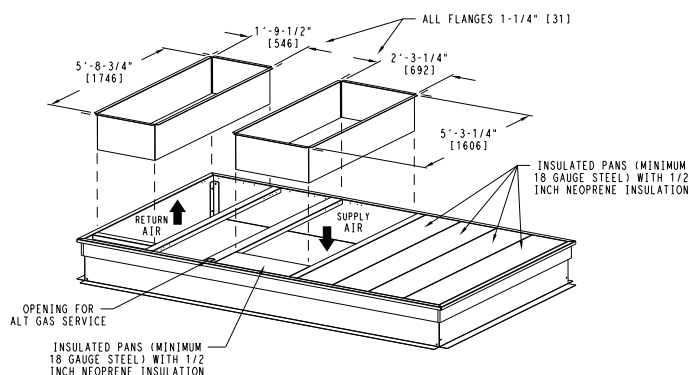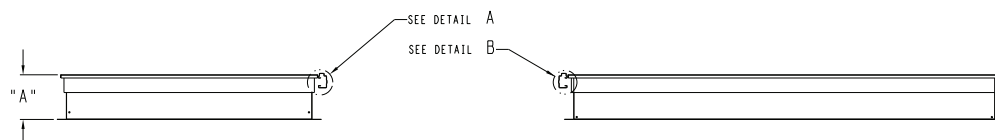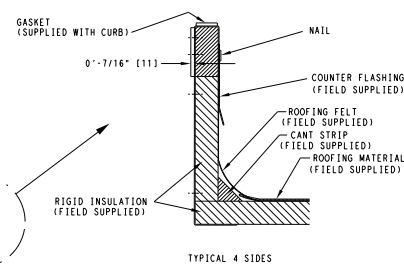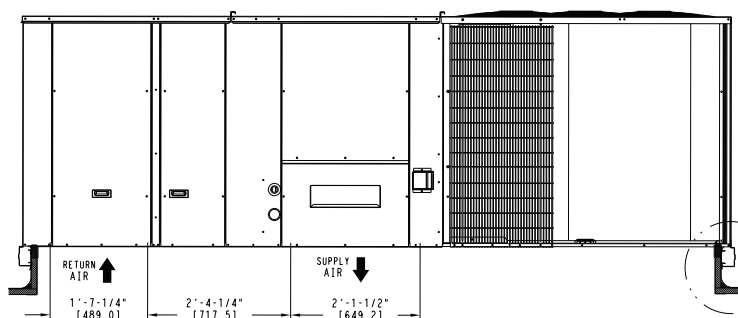


ROOF CURB DETAILS FOR 50LC*B24-26

UNIT SIZE	"A"	ROOF CURB ACCESSORY
24, 26	1'-2" [356.0] 2'-0" [610.0]	CRRFCURB049A00 CRRFCURB050A00




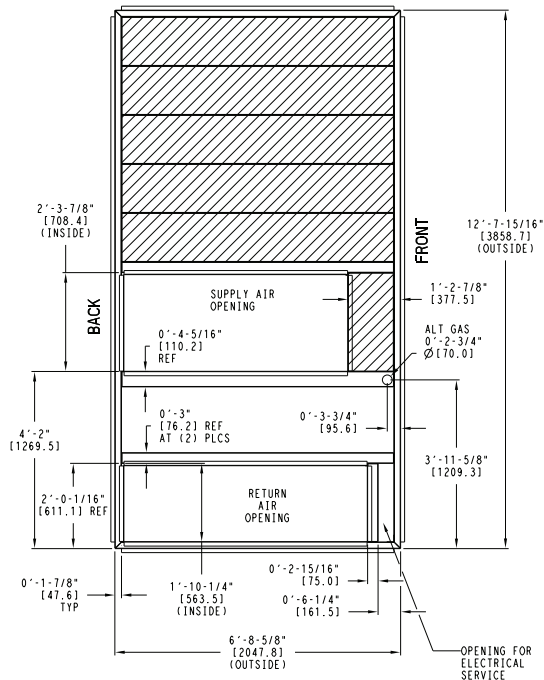


- NOTES:
1. ROOF CURB ACCESSORY IS SHIPPED UNASSEMBLED.
 2. BOLT HEADS TO BE ON INSIDE OF FLANGE. CLEARANCE IS (11) 0'-0-7/16\" TYP ALL CORNERS.
 3. DIMENSIONS IN [] ARE IN MILLIMETERS.
 4. ROOF CURB GALVANIZED STEEL.
 5. ATTACH DUCTWORK TO CURB (FLANGES ON DUCT REST ON CURB).
 6. SERVICE CLEARANCE 4 (1) ON EACH SIDE.
 7. GAS SERVICE PLATE IS PART OF A SEPARATELY SHIPPED ACCESSORY PACKAGE.
 8. GAS SERVICE PLATE CAN BE USED WITH EITHER ACCESSORY ROOFCURB.

➔ DIRECTION OF AIR FLOW



MAX CURB LEVELING TOLERANCES

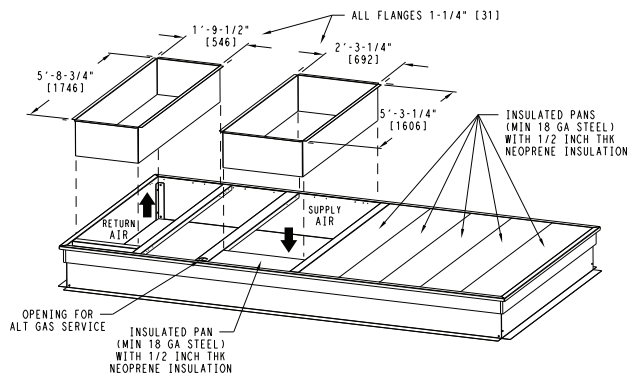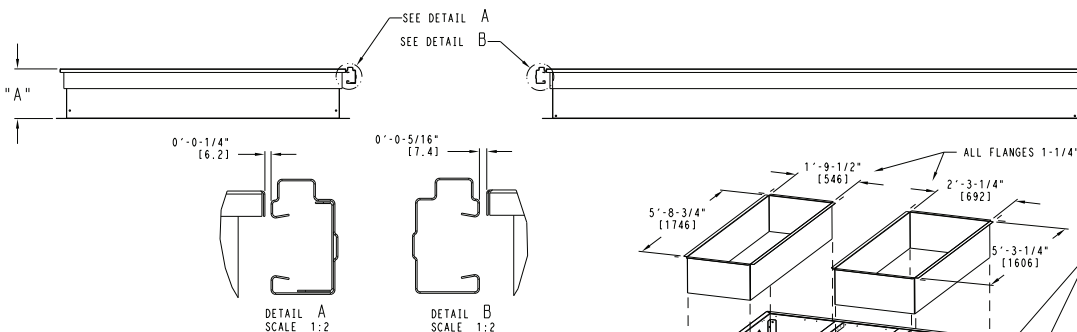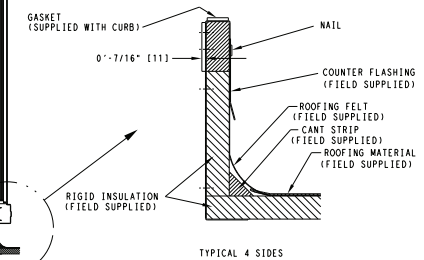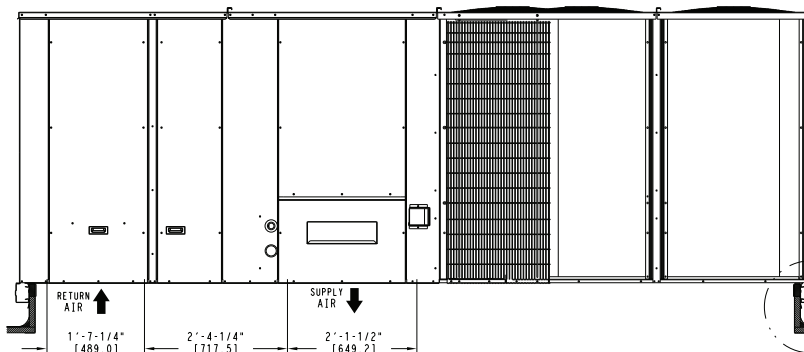

COOLING CAPACITIES — FIRST STAGE, PART LOAD (12.5 TONS)

50LC*B SIZE 14				AMBIENT TEMPERATURE (°F)																							
				65			75			85			95			105			115			125					
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)					
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85			
1000 CFM	EAT (wb)	58	TC	53.5	53.5	53.7	51.8	51.8	52.7	49.8	49.8	51.7	47.9	47.9	50.5	45.7	45.7	49.3	43.4	43.4	48.1	41.0	41.0	46.3			
		SHC	43.1	48.4	53.7	42.0	47.4	52.7	41.0	46.3	51.7	39.9	45.2	50.5	38.7	44.0	49.3	37.3	42.7	48.1	35.9	41.0	46.3				
		62	TC	58.0	58.0	58.0	56.1	56.1	56.1	54.0	54.0	54.0	51.9	51.9	51.9	49.6	49.6	49.6	47.1	47.1	47.1	44.4	44.4	44.4			
		SHC	39.2	44.6	49.9	38.2	43.6	48.9	37.1	42.5	47.9	36.0	41.3	46.7	34.8	40.2	45.5	33.5	38.9	44.3	32.2	37.5	42.9				
		67	TC	64.3	64.3	64.3	62.1	62.1	62.1	59.9	59.9	59.9	57.5	57.5	57.5	55.0	55.0	55.0	52.3	52.3	52.3	49.3	49.3	49.3			
	72	SHC	34.3	39.7	45.0	33.2	38.6	44.0	32.2	37.5	42.9	31.0	36.4	41.7	29.8	35.2	40.6	28.6	33.9	39.3	27.3	32.7	38.0				
	76	TC	71.2	71.2	71.2	68.8	68.8	68.8	66.3	66.3	66.3	63.8	63.8	63.8	61.0	61.0	61.0	58.1	58.1	58.1	54.9	54.9	54.9				
	SHC	29.3	34.6	40.0	28.2	33.5	38.9	27.1	32.5	37.8	25.9	31.3	36.7	24.8	30.1	35.5	23.5	28.9	34.2	22.2	27.6	33.0					
	EAT (wb)	76	TC	—	77.2	77.2	—	74.7	74.7	—	72.1	72.1	—	69.2	69.2	—	66.3	66.3	—	63.1	63.1	—	59.7	59.7			
		SHC	—	30.5	35.9	—	29.4	34.8	—	28.3	33.6	—	27.2	32.6	—	25.9	31.3	—	24.8	30.1	—	23.4	28.8				
58		TC	58.9	58.9	64.8	56.8	56.8	63.6	55.4	55.4	60.9	53.0	53.0	59.8	51.0	51.0	57.4	48.8	48.8	55.0	46.5	46.5	52.4				
SHC		50.6	57.7	64.8	49.3	56.5	63.6	47.5	54.2	60.9	46.3	53.0	59.8	44.6	51.0	57.4	42.6	48.8	55.0	40.6	46.5	52.4					
62		TC	63.7	63.7	63.7	61.3	61.3	61.3	59.0	59.0	59.0	56.5	56.5	56.5	53.7	53.7	54.8	50.9	50.9	53.4	47.8	47.8	52.0				
1350 CFM	EAT (wb)	62	SHC	45.2	52.5	59.7	44.2	51.3	58.5	42.9	50.1	57.3	41.7	48.9	56.1	40.5	47.6	54.8	39.1	46.2	53.4	37.6	44.8	52.0			
		67	TC	70.4	70.4	70.4	67.9	67.9	67.9	65.2	65.2	65.2	62.4	62.4	62.4	59.5	59.5	59.5	56.4	56.4	56.4	52.9	52.9	52.9			
		SHC	38.5	45.7	52.9	37.3	44.6	51.8	36.2	43.4	50.6	34.9	42.1	49.3	33.6	40.9	48.1	32.3	39.5	46.7	30.9	38.1	45.3				
		72	TC	77.9	77.9	77.9	75.1	75.1	75.1	72.1	72.1	72.1	69.0	69.0	69.0	65.8	65.8	65.8	62.4	62.4	62.4	58.8	58.8	58.8			
		SHC	31.6	38.8	46.0	30.4	37.6	44.9	29.2	36.5	43.7	28.0	35.2	42.4	26.7	33.9	41.1	25.4	32.6	39.9	24.0	31.2	38.4				
	76	TC	—	84.3	84.3	—	81.3	81.3	—	78.1	78.1	—	74.8	74.8	—	71.4	71.4	—	67.7	67.7	—	63.9	63.9				
	SHC	—	33.1	40.4	—	31.9	39.2	—	30.7	37.9	—	29.4	36.8	—	28.2	35.5	—	26.9	34.1	—	25.5	32.8					
	EAT (wb)	58	TC	60.8	60.8	68.9	57.4	57.4	65.3	53.9	53.9	61.5	50.3	50.3	57.6	46.6	46.6	53.6	42.7	42.7	49.4	38.7	38.7	45.0			
		SHC	52.7	60.8	68.9	49.5	57.4	65.3	46.3	53.9	61.5	43.0	50.3	57.6	39.5	46.6	53.6	36.0	42.7	49.4	32.3	38.7	45.0				
		62	TC	64.6	64.6	65.8	60.5	60.5	63.1	56.3	56.3	60.3	52.0	52.0	57.4	47.6	47.6	54.5	43.1	43.1	51.3	38.7	38.7	47.3			
SHC		47.9	56.8	65.8	45.0	54.1	63.1	42.3	51.3	60.3	39.5	48.5	57.4	36.6	45.5	54.5	33.5	42.4	51.3	30.1	38.7	47.3					
67		TC	72.3	72.3	72.3	68.0	68.0	68.0	63.5	63.5	63.5	58.9	58.9	58.9	54.1	54.1	54.1	49.2	49.2	49.2	44.1	44.1	44.1				
1700 CFM	EAT (wb)	67	SHC	40.1	49.1	58.2	37.3	46.4	55.4	34.5	43.6	52.7	31.7	40.8	49.8	28.9	37.9	46.9	25.9	35.0	44.0	23.0	32.0	41.0			
		72	TC	80.9	80.9	80.9	76.2	76.2	76.2	71.5	71.5	71.5	66.6	66.6	66.6	61.5	61.5	61.5	56.4	56.4	56.4	50.9	50.9	50.9			
		SHC	32.1	41.2	50.3	29.3	38.4	47.6	26.6	35.7	44.8	23.8	32.9	41.9	21.0	30.0	39.1	18.0	27.1	36.2	15.1	24.2	33.2				
		76	TC	—	88.4	88.4	—	83.5	83.5	—	78.4	78.4	—	73.2	73.2	—	67.9	67.9	—	62.4	62.4	—	56.6	56.6			
		SHC	—	34.7	43.8	—	32.0	41.0	—	29.2	38.3	—	26.3	35.5	—	23.5	32.7	—	20.7	29.7	—	17.7	26.8				
	EAT (wb)	58	TC	65.3	65.3	74.0	61.7	61.7	70.1	58.0	58.0	66.0	54.1	54.1	61.9	50.2	50.2	57.6	46.0	46.0	53.1	41.7	41.7	48.6			
		SHC	56.6	65.3	74.0	53.3	61.7	70.1	49.9	58.0	66.0	46.3	54.1	61.9	42.7	50.2	57.6	38.9	46.0	53.1	35.0	41.7	48.6				
		62	TC	67.4	67.4	73.4	63.1	63.1	70.5	58.8	58.8	67.6	54.4	54.4	64.4	50.3	50.3	60.3	46.1	46.1	55.7	41.8	41.8	50.9			
		SHC	52.5	63.0	73.4	49.6	60.1	70.5	46.7	57.1	67.6	43.7	54.0	64.4	40.3	50.3	60.3	36.7	46.1	55.7	32.8	41.8	50.9				
		67	TC	75.1	75.1	75.1	70.5	70.5	70.5	65.8	65.8	65.8	60.9	60.9	60.9	56.1	56.1	56.1	50.9	50.9	50.9	45.6	45.6	46.8			
2000 CFM	EAT (wb)	67	SHC	43.2	53.8	64.4	40.4	51.0	61.5	37.5	48.1	58.7	34.7	45.2	55.8	31.8	42.3	52.8	28.8	39.3	49.8	25.7	36.3	46.8			
		72	TC	83.9	83.9	83.9	79.0	79.0	79.0	73.9	73.9	73.9	68.8	68.8	68.8	63.6	63.6	63.6	58.1	58.1	58.1	52.5	52.5	52.5			
		SHC	33.7	44.4	55.0	30.9	41.5	52.2	28.1	38.7	49.3	25.2	35.8	46.4	22.3	32.9	43.5	19.3	29.9	40.6	16.4	26.9	37.5				
		76	TC	—	91.4	91.4	—	86.2	86.2	—	80.9	80.9	—	75.5	75.5	—	69.9	69.9	—	64.2	64.2	—	58.2	58.2			
		SHC	—	36.7	47.4	—	33.8	44.6	—	31.0	41.7	—	28.1	38.8	—	25.3	35.9	—	22.2	33.0	—	19.3	29.9				
	EAT (wb)	58	TC	69.7	69.7	78.8	65.8	65.8	74.6	61.8	61.8	70.4	57.8	57.8	66.0	53.6	53.6	61.4	49.2	49.2	56.7	44.7	44.7	51.8			
		SHC	60.5	69.7	78.8	56.9	65.8	74.6	53.3	61.8	70.4	49.6	57.8	66.0	45.7	53.6	61.4	41.7	49.2	56.7	37.6	44.7	51.8				
		62	TC	70.1	70.1	81.3	65.9	65.9	77.7	61.9	61.9	73.3	57.9	57.9	68.8	53.7	53.7	64.2	49.3	49.3	59.3	44.8	44.8	54.2			
		SHC	57.3	69.3	81.3	54.1	65.9	77.7	50.6	61.9	73.3	46.9	57.9	68.8	43.2	53.7	64.2	39.3	49.3	59.3	35.3	44.8	54.2				
		67	TC	77.5	77.5	77.5	72.6	72.6	72.6	67.8	67.8	67.8	62.8	62.8	62.8	57.7	57.7	59.4	52.5	52.5	56.4	47.0	47.0	53.1			
2350 CFM	EAT (wb)	67	SHC	46.6	58.9	71.2	43.7	56.0	68.3	40.8	53.0	65.3	37.8	50.1	62.4	34.9	47.1	59.4	31.9	44.1	56.4	28.8	41.0	53.1			
		72	TC	86.3	86.3	86.3	81.2	81.2	81.2	76.1	76.1	76.1	70.7	70.7	70.7	65.2	65.2	65.2	59.6	59.6	59.6	53.7	53.7	53.7			
		SHC	35.3	47.7	60.1	32.5	44.9	57.2	29.5	41.9	54.3	26.6	39.0	51.4	23.7	36.1	48.4	20.8	33.1	45.4	17.6	30.0	42.3				
		76	TC	—	93.9	93.9	—	88.5	88.5	—	83.1	83.1	—	77.4	77.4	—	71.7	71.7	—	65.7	65.7	—	59.6	59.6			
		SHC	—	38.6	51.1	—	35.8	48.3	—	32.9	45.3	—	29.9	42.4	—	27.0	39.4	—	24.0	36.4	—	21.0	33.3				
	EAT (wb)	58	TC	73.3	73.3	82.8	69.2	69.2	78.4	65.0	65.0	73.9	60.8	60.8	69.3	56.5	56.5	64.5	51.9	51.9	59.6	47.1	47.1	54.4			
		SHC	63.8	73.3	82.8	60.0	69.2	78.4	56.2	65.0	73.9	52.3	60.8	69.3	48.3	56.5	64.5	44.1	51.9	59.6	39.8	47.1	54.4				
		62	TC	73.4	73.4	86.1	69.3	69.3	81.6	65.1	65.1	77.0	60.8	60.8	72.2	56.5	56.5	67.4	51.9	51.9	62.3	47.2	47.2	56.9			
		SHC	60.6	73.4	86.1	57.0	69.3	81.6	53.3	65.1	77.0	49.5	60.8	72.2	45.6	56.5	67.4	41.5	51.9	62.3	37.3	47.2	56.9				
		67	TC	79.3	79.3	79.3	74.3	74.3	74.7	69.3	69.3	71.8	64.3	64													

COOLING CAPACITIES — FIRST STAGE, PART LOAD (12.5 TONS) (cont)

50LC*B SIZE 14				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
3050 CFM	EAT (wb)	58	TC	76.3	76.3	86.2	72.1	72.1	81.6	67.8	67.8	76.9	63.3	63.3	72.2	58.8	58.8	67.2	54.0	54.0	62.0	49.0	49.0	56.6
			SHC	66.4	76.3	86.2	62.5	72.1	81.6	58.6	67.8	76.9	54.5	63.3	72.2	50.3	58.8	67.2	46.0	54.0	62.0	41.5	49.0	56.6
		62	TC	76.4	76.4	89.6	72.2	72.2	84.8	67.9	67.9	80.0	63.4	63.4	75.2	58.8	58.8	70.1	54.1	54.1	64.7	49.1	49.1	59.3
			SHC	63.2	76.4	89.6	59.4	72.2	84.8	55.6	67.9	80.0	51.7	63.4	75.2	47.6	58.8	70.1	43.4	54.1	64.7	39.0	49.1	59.3
		67	TC	80.7	80.7	83.9	75.8	75.8	80.8	70.6	70.6	77.8	65.4	65.4	74.7	60.2	60.2	71.4	54.8	54.8	68.0	49.4	49.4	63.7
			SHC	52.7	68.3	83.9	49.6	65.2	80.8	46.7	62.2	77.8	43.7	59.2	74.7	40.6	56.0	71.4	37.3	52.7	68.0	33.8	48.8	63.7
		72	TC	89.6	89.6	89.6	84.2	84.2	84.2	78.8	78.8	78.8	73.2	73.2	73.2	67.5	67.5	67.5	61.5	61.5	61.5	55.5	55.5	55.5
			SHC	38.1	53.8	69.5	35.1	50.9	66.6	32.2	47.9	63.7	29.3	44.9	60.6	26.2	41.8	57.5	23.1	38.8	54.5	20.0	35.7	51.3
		76	TC	—	97.3	97.3	—	91.7	91.7	—	85.9	85.9	—	80.0	80.0	—	73.9	73.9	—	67.7	67.7	—	61.3	61.3
			SHC	—	42.0	57.8	—	39.1	54.9	—	36.1	51.9	—	33.2	48.8	—	30.1	45.8	—	27.0	42.7	—	23.9	39.6
3350 CFM	EAT (wb)	58	TC	78.6	78.6	88.6	74.2	74.2	83.9	69.7	69.7	79.1	65.1	65.1	74.2	60.5	60.5	69.0	55.6	55.6	63.8	50.5	50.5	58.3
			SHC	68.4	78.6	88.6	64.4	74.2	83.9	60.4	69.7	79.1	56.2	65.1	74.2	51.9	60.5	69.0	47.4	55.6	63.8	42.8	50.5	58.3
		62	TC	78.6	78.6	92.1	74.3	74.3	87.3	69.8	69.8	82.4	65.2	65.2	77.3	60.5	60.5	72.1	55.7	55.7	66.6	50.6	50.6	60.9
			SHC	65.1	78.6	92.1	61.2	74.3	87.3	57.2	69.8	82.4	53.2	65.2	77.3	49.0	60.5	72.1	44.8	55.7	66.6	40.3	50.6	60.9
		67	TC	81.8	81.8	88.9	76.7	76.7	85.9	71.6	71.6	82.7	66.4	66.4	79.5	61.1	61.1	75.9	55.9	55.9	71.8	50.7	50.7	66.2
			SHC	55.0	72.0	88.9	52.1	68.9	85.9	48.9	65.8	82.7	45.9	62.7	79.5	42.7	59.3	75.9	39.3	55.6	71.8	35.2	50.7	66.2
		72	TC	90.6	90.6	90.6	85.1	85.1	85.1	79.6	79.6	79.6	73.9	73.9	73.9	68.2	68.2	68.2	62.1	62.1	62.1	56.0	56.0	56.0
			SHC	39.1	56.3	73.4	36.2	53.3	70.4	33.2	50.3	67.4	30.2	47.3	64.4	27.1	44.2	61.2	24.1	41.1	58.1	21.0	37.9	54.9
		76	TC	—	98.4	98.4	—	92.6	92.6	—	86.8	86.8	—	80.7	80.7	—	74.6	74.6	—	68.3	68.3	—	61.8	61.8
			SHC	—	43.3	60.5	—	40.4	57.6	—	37.3	54.5	—	34.3	51.5	—	31.3	48.4	—	28.2	45.2	—	25.1	42.0

LEGEND

—	Do not operate
CFM	Cubic Feet Per Minute (supply air)
EAT (db)	Entering Air Temperature (dry bulb)
EAT (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — SECOND STAGE, PART LOAD (12.5 TONS)

50LC*B SIZE 14				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
1500 CFM	EAT (wb)	58	TC	77.0	77.0	78.8	74.4	74.4	77.3	71.8	71.8	75.9	68.8	68.8	74.2	65.8	65.8	72.5	63.7	63.7	68.6	59.9	59.9	67.5
		SHC	62.8	70.8	78.8	61.3	69.3	77.3	59.8	67.8	75.9	58.2	66.2	74.2	56.6	64.5	72.5	53.8	61.2	68.6	52.3	59.9	67.5	
		62	TC	83.3	83.3	83.3	80.4	80.4	80.4	77.5	77.5	77.5	74.4	74.4	74.4	71.1	71.1	71.1	67.6	67.6	67.6	63.8	63.8	63.8
		SHC	56.8	64.8	72.8	55.4	63.4	71.4	53.8	61.8	69.9	52.2	60.3	68.3	50.5	58.6	66.6	48.8	56.8	64.8	46.9	55.0	63.0	
		67	TC	91.8	91.8	91.8	88.7	88.7	88.7	85.5	85.5	85.5	82.1	82.1	82.1	78.5	78.5	78.5	74.6	74.6	74.6	70.5	70.5	70.5
	SHC	49.2	57.3	65.3	47.8	55.8	63.9	46.2	54.3	62.3	44.6	52.7	60.6	42.9	51.0	59.0	41.1	49.2	57.2	39.3	47.4	55.4		
	72	TC	101.5	101.5	101.5	98.1	98.1	98.1	94.6	94.6	94.6	90.8	90.8	90.8	86.8	86.8	86.8	82.5	82.5	82.5	77.9	77.9	77.9	
	SHC	41.5	49.5	57.6	40.0	48.1	56.1	38.4	46.5	54.5	36.9	44.9	52.9	35.2	43.2	51.3	33.3	41.4	49.4	31.5	39.6	47.6		
	76	TC	—	109.9	109.9	—	106.3	106.3	—	102.4	102.4	—	98.3	98.3	—	94.0	94.0	—	89.4	89.4	—	84.4	84.4	
	SHC	—	43.2	51.3	—	41.7	49.7	—	40.2	48.3	—	38.5	46.6	—	36.9	44.9	—	35.1	43.2	—	33.2	41.3		
2000 CFM	EAT (wb)	58	TC	85.1	85.1	92.3	81.5	81.5	91.8	79.0	79.0	88.9	76.2	76.2	85.9	73.3	73.3	82.6	70.2	70.2	79.1	66.9	66.9	75.4
		SHC	72.2	82.3	92.3	71.2	81.5	91.8	68.9	79.0	88.9	66.5	76.2	85.9	64.0	73.3	82.6	61.3	70.2	79.1	58.4	66.9	75.4	
		62	TC	90.4	90.4	90.4	87.2	87.2	87.2	83.7	83.7	83.7	80.0	80.0	81.5	76.2	76.2	79.7	72.2	72.2	77.8	68.0	68.0	75.8
		SHC	65.1	75.9	86.5	63.6	74.2	84.9	61.9	72.5	83.3	60.2	70.8	81.5	58.3	69.0	79.7	56.5	67.1	77.8	54.5	65.1	75.8	
		67	TC	99.6	99.6	99.6	96.0	96.0	96.0	92.2	92.2	92.2	88.2	88.2	88.2	84.0	84.0	84.0	79.6	79.6	79.6	74.9	74.9	74.9
	SHC	54.9	65.6	76.3	53.3	64.1	74.7	51.7	62.3	73.0	49.9	60.6	71.3	48.1	58.8	69.5	46.2	56.9	67.6	44.3	54.9	65.6		
	72	TC	109.8	109.8	109.8	105.9	105.9	105.9	101.8	101.8	101.8	97.4	97.4	97.4	92.7	92.7	92.7	87.8	87.8	87.8	82.7	82.7	82.7	
	SHC	44.5	55.2	65.9	42.9	53.6	64.4	41.1	51.9	62.6	39.5	50.2	60.9	37.6	48.4	59.1	35.8	46.5	57.2	33.8	44.6	55.3		
	76	TC	—	118.6	118.6	—	114.5	114.5	—	110.0	110.0	—	105.3	105.3	—	100.3	100.3	—	95.1	95.1	—	89.5	89.5	
	SHC	—	46.6	57.3	—	45.0	55.8	—	43.4	54.1	—	41.6	52.4	—	39.9	50.6	—	38.0	48.8	—	36.1	46.8		
2500 CFM	EAT (wb)	58	TC	83.4	83.4	95.0	76.5	76.5	87.8	69.7	69.7	80.6	62.7	62.7	73.2	55.6	55.6	65.6	48.2	48.2	57.8	40.7	40.7	49.8
		SHC	71.7	83.4	95.0	65.3	76.5	87.8	58.8	69.7	80.6	52.3	62.7	73.2	45.4	55.6	65.6	38.6	48.2	57.8	31.5	40.7	49.8	
		62	TC	87.9	87.9	91.9	80.2	80.2	86.1	72.3	72.3	80.2	64.4	64.4	74.2	56.3	56.3	68.1	48.4	48.4	61.2	40.8	40.8	52.9
		SHC	65.4	78.7	91.9	59.7	72.9	86.1	53.7	67.0	80.2	47.9	61.0	74.2	41.8	55.0	68.1	35.5	48.4	61.2	28.6	40.8	52.9	
		67	TC	99.5	99.5	99.5	91.5	91.5	91.5	83.2	83.2	83.2	74.7	74.7	74.7	66.0	66.0	66.0	57.1	57.1	57.1	48.0	48.0	48.0
	SHC	54.9	68.2	81.5	49.0	62.4	75.7	43.2	56.5	69.8	37.2	50.6	63.9	31.3	44.6	57.9	25.3	38.5	51.8	19.1	32.4	45.6		
	72	TC	112.3	112.3	112.3	103.9	103.9	103.9	95.3	95.3	95.3	86.4	86.4	86.4	77.2	77.2	77.2	67.9	67.9	67.9	58.2	58.2	58.2	
	SHC	44.0	57.4	70.8	38.2	51.6	65.0	32.4	45.7	59.2	26.4	39.9	53.2	20.5	33.8	47.3	14.4	27.8	41.2	8.4	21.7	35.1		
	76	TC	—	123.2	123.2	—	114.7	114.7	—	105.6	105.6	—	96.3	96.3	—	86.9	86.9	—	77.0	77.0	—	67.0	67.0	
	SHC	—	48.6	61.9	—	42.8	56.2	—	37.0	50.4	—	31.0	44.5	—	25.1	38.5	—	19.1	32.5	—	13.0	26.3		
3000 CFM	EAT (wb)	58	TC	91.0	91.0	103.4	83.9	83.9	95.8	76.5	76.5	88.1	69.1	69.1	80.2	61.5	61.5	72.2	53.7	53.7	63.9	45.6	45.6	55.3
		SHC	78.6	91.0	103.4	71.8	83.9	95.8	64.9	76.5	88.1	57.9	69.1	80.2	50.8	61.5	72.2	43.5	53.7	63.9	36.0	45.6	55.3	
		62	TC	92.5	92.5	104.8	84.6	84.6	98.7	76.6	76.6	92.1	69.2	69.2	84.1	61.6	61.6	75.9	53.8	53.8	67.5	45.7	45.7	58.7
		SHC	73.4	89.1	104.8	67.4	83.0	98.7	61.2	76.6	92.1	54.3	69.2	84.1	47.3	61.6	75.9	40.2	53.8	67.5	32.9	45.7	58.7	
		67	TC	103.9	103.9	103.9	95.5	95.5	95.5	86.9	86.9	86.9	78.0	78.0	78.0	68.9	68.9	68.9	59.7	59.7	59.7	50.2	50.2	55.3
	SHC	60.3	76.1	92.0	54.3	70.2	86.1	48.4	64.3	80.0	42.2	58.1	74.0	36.1	52.0	67.9	29.9	45.7	61.6	23.6	39.5	55.3		
	72	TC	116.8	116.8	116.8	108.1	108.1	108.1	99.1	99.1	99.1	89.8	89.8	89.8	80.2	80.2	80.2	70.5	70.5	70.5	60.5	60.5	60.5	
	SHC	46.9	62.9	78.9	41.0	56.9	72.9	35.0	51.0	67.0	29.0	44.9	60.8	22.8	38.8	54.7	16.7	32.6	48.5	10.4	26.3	42.2		
	76	TC	—	127.9	127.9	—	119.0	119.0	—	109.5	109.5	—	99.8	99.8	—	90.0	90.0	—	79.8	79.8	—	69.2	69.2	
	SHC	—	52.0	68.1	—	46.1	62.2	—	40.2	56.3	—	34.1	50.2	—	28.0	44.1	—	21.8	37.8	—	15.5	31.6		
3500 CFM	EAT (wb)	58	TC	97.2	97.2	110.2	89.7	89.7	102.3	82.1	82.1	94.3	74.3	74.3	86.0	66.3	66.3	77.5	58.1	58.1	68.7	49.7	49.7	59.8
		SHC	84.1	97.2	110.2	77.1	89.7	102.3	69.9	82.1	94.3	62.6	74.3	86.0	55.1	66.3	77.5	47.5	58.1	68.7	39.6	49.7	59.8	
		62	TC	97.3	97.3	114.8	89.8	89.8	106.7	82.2	82.2	98.5	74.4	74.4	90.0	66.4	66.4	81.3	58.2	58.2	72.4	49.8	49.8	63.3
		SHC	80.0	97.3	114.8	73.0	89.8	106.7	66.0	82.2	98.5	58.8	74.4	90.0	51.5	66.4	81.3	44.0	58.2	72.4	36.3	49.8	63.3	
		67	TC	107.1	107.1	107.1	98.5	98.5	98.5	89.6	89.6	89.8	80.4	80.4	83.6	71.2	71.2	77.3	61.7	61.7	70.9	52.0	52.0	64.4
	SHC	65.3	83.7	102.1	59.3	77.6	95.9	53.1	71.5	89.8	46.9	65.2	83.6	40.7	59.0	77.3	34.3	52.7	70.9	27.9	46.1	64.4		
	72	TC	120.1	120.1	120.1	111.2	111.2	111.2	101.8	101.8	101.8	92.2	92.2	92.2	82.5	82.5	82.5	72.3	72.3	72.3	62.0	62.0	62.0	
	SHC	49.3	67.9	86.4	43.4	61.9	80.3	37.3	55.8	74.2	31.1	49.6	68.1	24.9	43.4	61.8	18.6	37.1	55.5	12.3	30.6	49.0		
	76	TC	—	131.2	131.2	—	122.1	122.1	—	112.4	112.4	—	102.4	102.4	—	92.2	92.2	—	81.7	81.7	—	70.9	70.9	
	SHC	—	55.0	73.6	—	49.0	67.7	—	43.0	61.6	—	36.8	55.4	—	30.6	49.1	—	24.3	42.8	—	17.9	36.4		
4000 CFM	EAT (wb)	58	TC	102.3	102.3	115.8	94.6	94.6	107.6	86.7	86.7	99.3	78.6	78.6	90.7	70.3	70.3	81.9	61.8	61.8	72.7	53.0	53.0	63.4
		SHC	88.7	102.3	115.8	81.5	94.6	107.6	74.1	86.7	99.3	66.5	78.6	90.7	58.7	70.3	81.9	50.8	61.8	72.7	42.6	53.0	63.4	
		62	TC	102.5	102.5	120.5	94.7	94.7	112.2	86.8	86.8	103.6	78.7	78.7	94.9	70.4	70.4	85.9	61.9	61.9	76.6	53.1	53.1	67.0
		SHC	84.3	102.5	120.5	77.2	94.7	112.2	69.9	86.8	103.6	62.5	78.7	94.9	54.9	70.4	85.9	47.2	61.9	76.6				

COOLING CAPACITIES — SECOND STAGE, PART LOAD (12.5 TONS) (cont)

50LC*B SIZE 14				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
4500 CFM	EAT (wb)	58	TC	106.7	106.7	120.6	98.7	98.7	112.2	90.6	90.6	103.5	82.2	82.2	94.7	73.6	73.6	85.5	64.8	64.8	76.1	55.8	55.8	66.5
			SHC	92.6	106.7	120.6	85.2	98.7	112.2	77.5	90.6	103.5	69.7	82.2	94.7	61.7	73.6	85.5	53.5	64.8	76.1	45.0	55.8	66.5
		62	TC	106.8	106.8	125.5	98.9	98.9	116.9	90.7	90.7	108.0	82.3	82.3	99.0	73.7	73.7	89.6	64.9	64.9	80.0	55.9	55.9	70.1
			SHC	88.0	106.8	125.5	80.7	98.9	116.9	73.3	90.7	108.0	65.6	82.3	99.0	57.8	73.7	89.6	49.8	64.9	80.0	41.5	55.9	70.1
		67	TC	111.7	111.7	120.7	102.8	102.8	114.4	93.6	93.6	107.9	84.2	84.2	101.3	74.8	74.8	94.5	65.3	65.3	87.0	56.2	56.2	76.8
			SHC	74.3	97.5	120.7	68.2	91.3	114.4	61.8	84.9	107.9	55.4	78.4	101.3	48.9	71.8	94.5	42.1	64.5	87.0	34.4	55.6	76.8
		72	TC	124.5	124.5	124.5	115.2	115.2	115.2	105.5	105.5	105.5	95.6	95.6	95.6	85.4	85.4	85.4	74.9	74.9	74.9	64.3	64.3	64.3
			SHC	53.6	76.9	100.3	47.5	70.8	94.2	41.2	64.5	87.9	34.9	58.2	81.5	28.6	51.9	75.2	22.1	45.3	68.6	15.6	38.8	62.0
		76	TC	—	135.8	135.8	—	126.3	126.3	—	116.2	116.2	—	105.9	105.9	—	95.2	95.2	—	84.2	84.2	—	73.0	73.0
			SHC	—	60.2	83.7	—	54.1	77.6	—	47.9	71.3	—	41.5	64.9	—	35.2	58.5	—	28.8	52.0	—	22.1	45.3
4950 CFM	EAT (wb)	58	TC	110.0	110.0	124.3	101.9	101.9	115.7	93.5	93.5	106.9	84.9	84.9	97.7	76.2	76.2	88.3	67.2	67.2	78.8	57.9	57.9	68.8
			SHC	95.6	110.0	124.3	88.0	101.9	115.7	80.2	93.5	106.9	72.2	84.9	97.7	64.1	76.2	88.3	55.7	67.2	78.8	47.0	57.9	68.8
		62	TC	110.1	110.1	129.2	102.0	102.0	120.5	93.6	93.6	111.4	85.1	85.1	102.1	76.3	76.3	92.5	67.3	67.3	82.7	58.0	58.0	72.5
			SHC	91.0	110.1	129.2	83.6	102.0	120.5	75.9	93.6	111.4	68.1	85.1	102.1	60.1	76.3	92.5	51.9	67.3	82.7	43.4	58.0	72.5
		67	TC	113.3	113.3	128.4	104.3	104.3	122.0	95.2	95.2	115.3	85.8	85.8	108.4	76.4	76.4	100.8	67.6	67.6	89.9	58.1	58.1	80.0
			SHC	78.1	103.3	128.4	71.8	96.9	122.0	65.4	90.4	115.3	58.9	83.7	108.4	52.1	76.4	100.8	44.1	67.0	89.9	36.3	58.1	80.0
		72	TC	125.9	125.9	125.9	116.5	116.5	116.5	106.7	106.7	106.7	96.6	96.6	96.6	86.3	86.3	86.3	75.8	75.8	75.8	64.9	64.9	67.6
			SHC	55.3	80.7	106.2	49.1	74.6	100.0	42.9	68.3	93.7	36.5	61.9	87.3	30.1	55.5	80.8	23.6	48.9	74.3	17.1	42.3	67.6
		76	TC	—	137.3	137.3	—	127.6	127.6	—	117.4	117.4	—	107.0	107.0	—	96.1	96.1	—	85.1	85.1	—	73.7	73.7
			SHC	—	62.3	87.9	—	56.2	81.7	—	49.9	75.4	—	43.5	69.0	—	37.1	62.5	—	30.5	55.9	—	24.0	49.1

LEGEND

—	Do not operate
CFM	Cubic Feet Per Minute (supply air)
EAT (db)	Entering Air Temperature (dry bulb)
EAT (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — THIRD STAGE, FULL LOAD (12.5 TONS)

50LC*B SIZE 14				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
2500 CFM	EAT (wb)	58	TC	128.2	128.2	130.7	123.9	123.9	128.3	119.3	119.3	125.7	114.5	114.5	122.9	109.3	109.3	120.0	104.7	104.7	115.2	99.1	99.1	111.6
		SHC	104.2	117.5	130.7	101.8	115.1	128.3	99.3	112.4	125.7	96.5	109.7	122.9	93.6	106.9	120.0	89.9	102.6	115.2	86.5	99.1	111.6	
		62	TC	138.2	138.2	138.2	133.5	133.5	133.5	128.6	128.6	128.6	123.3	123.3	123.3	117.8	117.8	117.8	111.7	111.7	111.7	105.4	105.4	105.4
		SHC	94.3	107.5	120.9	91.7	105.1	118.4	89.2	102.5	115.8	86.5	99.8	113.1	83.7	97.0	110.3	80.7	94.0	107.3	77.6	90.9	104.1	
		67	TC	152.0	152.0	152.0	147.0	147.0	147.0	141.7	141.7	141.7	135.9	135.9	135.9	129.9	129.9	129.9	123.4	123.4	123.4	116.4	116.4	116.4
	SHC	81.5	94.9	108.2	79.1	92.4	105.8	76.5	89.9	103.2	73.8	87.2	100.5	71.1	84.3	97.7	68.1	81.4	94.8	65.0	78.3	91.7		
	72	TC	167.3	167.3	167.3	161.9	161.9	161.9	156.0	156.0	156.0	149.8	149.8	149.8	143.1	143.1	143.1	136.1	136.1	136.1	128.6	128.6	128.6	
	SHC	68.3	81.8	95.2	66.0	79.4	92.8	63.4	76.8	90.2	60.7	74.2	87.6	58.0	71.4	84.8	55.1	68.5	81.9	52.1	65.4	78.9		
	76	TC	—	180.3	180.3	—	174.4	174.4	—	168.2	168.2	—	161.7	161.7	—	154.5	154.5	—	147.0	147.0	—	139.0	139.0	
	SHC	—	70.9	84.2	—	68.4	81.9	—	66.0	79.4	—	63.4	76.8	—	60.6	74.0	—	57.8	71.2	—	54.8	68.2		
2800 CFM	EAT (wb)	58	TC	132.8	132.8	140.1	128.2	128.2	137.5	123.4	123.4	134.7	118.5	118.5	131.7	115.0	115.0	124.8	108.7	108.7	122.6	103.6	103.6	116.8
		SHC	110.6	125.3	140.1	107.9	122.8	137.5	105.3	120.0	134.7	102.4	117.1	131.7	97.6	111.2	124.8	95.0	108.7	122.6	90.5	103.6	116.8	
		62	TC	142.8	142.8	142.8	137.9	137.9	137.9	132.6	132.6	132.6	127.0	127.0	127.0	121.2	121.2	121.2	115.0	115.0	115.0	108.2	108.2	111.7
		SHC	99.3	114.1	128.9	96.7	111.5	126.4	94.1	108.9	123.7	91.3	106.1	120.9	88.3	103.2	118.0	85.3	100.1	115.0	82.1	96.9	111.7	
		67	TC	157.0	157.0	157.0	151.6	151.6	151.6	146.0	146.0	146.0	139.9	139.9	139.9	133.5	133.5	133.5	126.7	126.7	126.7	119.4	119.4	119.4
	SHC	84.9	99.8	114.7	82.4	97.3	112.1	79.8	94.7	109.5	77.0	91.8	106.8	74.1	89.0	103.9	71.2	86.0	100.9	68.0	82.9	97.7		
	72	TC	172.5	172.5	172.5	166.7	166.7	166.7	160.5	160.5	160.5	154.0	154.0	154.0	146.9	146.9	146.9	139.5	139.5	139.5	131.7	131.7	131.7	
	SHC	70.1	85.1	100.1	67.6	82.6	97.6	65.0	80.0	95.1	62.3	77.3	92.3	59.5	74.5	89.4	56.6	71.5	86.5	53.4	68.3	83.4		
	76	TC	—	185.6	185.6	—	179.5	179.5	—	172.9	172.9	—	165.9	165.9	—	158.5	158.5	—	150.6	150.6	—	142.3	142.3	
	SHC	—	72.8	87.8	—	70.4	85.4	—	67.9	82.9	—	65.2	80.2	—	62.4	77.4	—	59.5	74.5	—	56.5	71.5		
3150 CFM	EAT (wb)	58	TC	131.9	131.9	144.9	125.1	125.1	139.9	118.3	118.3	134.5	111.8	111.8	127.4	105.1	105.1	120.1	98.0	98.0	112.4	90.6	90.6	104.3
		SHC	111.9	128.4	144.9	107.1	123.5	139.9	102.0	118.3	134.5	96.1	111.8	127.4	90.0	105.1	120.1	83.6	98.0	112.4	76.8	90.6	104.3	
		62	TC	142.6	142.6	142.6	135.3	135.3	135.3	127.7	127.7	127.7	119.7	119.7	119.7	111.4	111.4	113.6	102.8	102.8	108.3	93.8	93.8	103.0
		SHC	100.1	116.7	133.4	95.4	112.0	128.6	90.5	107.2	123.7	85.5	102.2	118.8	80.4	97.0	113.6	75.3	91.7	108.3	69.8	86.4	103.0	
		67	TC	158.3	158.3	158.3	150.5	150.5	150.5	142.4	142.4	142.4	133.9	133.9	133.9	124.9	124.9	124.9	115.7	115.7	115.7	106.0	106.0	106.0
	SHC	85.1	101.8	118.5	80.4	97.1	113.8	75.6	92.2	108.9	70.7	87.3	103.9	65.5	82.2	98.9	60.4	77.0	93.7	55.1	71.8	88.3		
	72	TC	175.1	175.1	175.1	166.9	166.9	166.9	158.2	158.2	158.2	149.3	149.3	149.3	139.7	139.7	139.7	130.0	130.0	130.0	119.5	119.5	119.5	
	SHC	69.6	86.5	103.3	64.9	81.8	98.6	60.2	77.0	93.8	55.3	72.1	88.9	50.3	67.1	83.9	45.1	61.9	78.7	39.9	56.6	73.4		
	76	TC	—	189.4	189.4	—	180.9	180.9	—	171.8	171.8	—	162.3	162.3	—	152.4	152.4	—	142.1	142.1	—	131.1	131.1	
	SHC	—	73.6	90.6	—	69.0	85.9	—	64.4	81.2	—	59.5	76.3	—	54.5	71.5	—	49.5	66.4	—	44.3	61.1		
3750 CFM	EAT (wb)	58	TC	140.9	140.9	159.3	134.5	134.5	152.4	127.7	127.7	145.1	120.8	120.8	137.6	113.6	113.6	129.6	106.0	106.0	121.3	98.0	98.0	112.6
		SHC	122.4	140.9	159.3	116.5	134.5	152.4	110.4	127.7	145.1	104.0	120.8	137.6	97.5	113.6	129.6	90.6	106.0	121.3	83.5	98.0	112.6	
		62	TC	149.5	149.5	149.5	141.7	141.7	143.9	133.7	133.7	138.8	125.3	125.3	133.7	116.6	116.6	128.3	107.6	107.6	122.8	98.9	98.9	116.2
		SHC	109.5	129.2	148.8	104.7	124.3	143.9	99.6	119.2	138.8	94.6	114.1	133.7	89.3	108.8	128.3	83.9	103.4	122.8	78.1	97.1	116.2	
		67	TC	165.2	165.2	165.2	156.9	156.9	156.9	148.2	148.2	148.2	139.2	139.2	139.2	129.8	129.8	129.8	120.1	120.1	120.1	110.0	110.0	110.0
	SHC	91.5	111.2	130.8	86.6	106.3	126.0	81.6	101.3	121.0	76.5	96.2	115.9	71.4	91.1	110.8	66.1	85.8	105.4	60.6	80.3	99.9		
	72	TC	182.1	182.1	182.1	173.5	173.5	173.5	164.3	164.3	164.3	154.8	154.8	154.8	144.9	144.9	144.9	134.6	134.6	134.6	123.6	123.6	123.6	
	SHC	72.8	92.6	112.5	68.1	87.8	107.7	63.2	83.0	102.9	58.2	78.0	97.8	53.1	72.9	92.6	47.9	67.7	87.5	42.5	62.3	82.0		
	76	TC	—	196.6	196.6	—	187.5	187.5	—	177.9	177.9	—	168.0	168.0	—	157.7	157.7	—	146.6	146.6	—	—	—	
	SHC	—	77.4	97.5	—	72.7	92.8	—	68.0	88.0	—	63.1	83.2	—	58.0	78.1	—	52.8	72.9	—	—	—		
4400 CFM	EAT (wb)	58	TC	150.2	150.2	169.7	143.3	143.3	162.2	136.2	136.2	154.5	128.8	128.8	146.4	121.1	121.1	138.0	113.0	113.0	129.1	104.5	104.5	119.8
		SHC	130.6	150.2	169.7	124.3	143.3	162.2	117.9	136.2	154.5	111.2	128.8	146.4	104.1	121.1	138.0	96.8	113.0	129.1	89.1	104.5	119.8	
		62	TC	155.1	155.1	164.4	147.1	147.1	159.3	138.8	138.8	154.1	130.3	130.3	148.6	121.9	121.9	142.2	113.1	113.1	134.7	104.6	104.6	125.2
		SHC	119.0	141.7	164.4	114.0	136.7	159.3	108.9	131.5	154.1	103.5	126.1	148.6	97.9	120.0	142.2	91.6	113.1	134.7	84.1	104.6	125.2	
		67	TC	170.4	170.4	170.4	161.9	161.9	161.9	152.9	152.9	152.9	143.5	143.5	143.5	133.8	133.8	133.8	123.6	123.6	123.6	113.1	113.1	113.1
	SHC	97.6	120.4	143.3	92.7	115.5	138.5	87.7	110.5	133.4	82.5	105.4	128.2	77.2	100.0	122.9	71.9	94.7	117.5	66.4	89.1	111.9		
	72	TC	187.6	187.6	187.6	178.6	178.6	178.6	169.1	169.1	169.1	159.2	159.2	159.2	148.9	148.9	148.9	138.2	138.2	138.2	126.8	126.8	126.8	
	SHC	75.8	98.8	121.8	71.0	94.0	117.0	66.0	89.0	111.9	60.9	83.9	106.9	55.8	78.7	101.7	50.5	73.4	96.3	45.0	68.0	90.9		
	76	TC	—	202.0	202.0	—	192.7	192.7	—	182.8	182.8	—	172.5	172.5	—	161.8	161.8	—	150.5	150.5	—	—	—	
	SHC	—	81.0	104.6	—	76.3	99.8	—	71.5	94.9	—	66.4	89.8	—	61.3	84.6	—	56.1	79.4	—	—	—		
5000 CFM	EAT (wb)	58	TC	157.3	157.3	177.7	150.2	150.2	169.9	142.6	142.6	161.8	134.8	134.8	153.2	126.8	126.8	144.3	118.3	118.3	135.0	109.4	109.4	125.3
		SHC	136.9	157.3	177.7	130.4	150.2	169.9	123.6	142.6	161.8	116.5	134.8	153.2	109.2	126.8	144.3	101.5	118.3	135.0	93.5	109.4	125.3	
		62	TC	159.6	159.6	177.9	151.5																	

COOLING CAPACITIES — THIRD STAGE, FULL LOAD (12.5 TONS) (cont)

50LC*B SIZE 14				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
5650 CFM	EAT (wb)	58	TC	163.8	163.8	185.0	156.3	156.3	176.8	148.5	148.5	168.3	140.3	140.3	159.3	131.9	131.9	150.1	123.0	123.0	140.4	113.9	113.9	130.3
			SHC	142.6	163.8	185.0	135.8	156.3	176.8	128.8	148.5	168.3	121.4	140.3	159.3	113.7	131.9	150.1	105.8	123.0	140.4	97.4	113.9	130.3
		62	TC	164.2	164.2	190.9	156.5	156.5	183.9	148.7	148.7	175.1	140.5	140.5	165.8	132.0	132.0	156.3	123.2	123.2	146.3	114.0	114.0	135.9
			SHC	135.0	163.0	190.9	129.2	156.5	183.9	122.3	148.7	175.1	115.1	140.5	165.8	107.7	132.0	156.3	100.0	123.2	146.3	92.0	114.0	135.9
		67	TC	177.5	177.5	177.5	168.5	168.5	168.5	159.0	159.0	159.0	149.3	149.3	150.2	139.0	139.0	144.8	128.5	128.5	139.1	117.6	117.6	133.2
			SHC	108.3	137.1	165.8	103.4	132.0	160.8	98.2	126.9	155.6	92.9	121.6	150.2	87.6	116.1	144.8	82.0	110.6	139.1	76.3	104.8	133.2
		72	TC	194.7	194.7	194.7	185.3	185.3	185.3	175.2	175.2	175.2	164.8	164.8	164.8	154.1	154.1	154.1	142.7	142.7	142.7	130.9	130.9	130.9
			SHC	80.5	109.4	138.3	75.7	104.5	133.4	70.6	99.5	128.3	65.5	94.3	123.1	60.3	89.0	117.8	54.8	83.6	112.3	49.2	78.0	106.7
		76	TC	—	209.3	209.3	—	199.5	199.5	—	189.2	189.2	—	178.3	178.3	—	167.1	167.1	—	155.4	155.4	—	—	—
			SHC	—	87.0	116.3	—	82.2	111.4	—	77.2	106.5	—	72.2	101.3	—	67.0	96.0	—	61.6	90.7	—	—	—
6250 CFM	EAT (wb)	58	TC	168.9	168.9	190.5	161.2	161.2	182.1	153.1	153.1	173.4	144.7	144.7	164.2	135.9	135.9	154.5	126.8	126.8	144.6	117.3	117.3	134.1
			SHC	147.1	168.9	190.5	140.1	161.2	182.1	132.8	153.1	173.4	125.2	144.7	164.2	117.3	135.9	154.5	109.0	126.8	144.6	100.4	117.3	134.1
		62	TC	169.1	169.1	198.0	161.3	161.3	189.4	153.2	153.2	180.3	144.9	144.9	170.9	136.0	136.0	161.0	126.9	126.9	150.6	117.4	117.4	139.8
			SHC	140.0	169.1	198.0	133.2	161.3	189.4	126.2	153.2	180.3	118.9	144.9	170.9	111.2	136.0	161.0	103.3	126.9	150.6	95.0	117.4	139.8
		67	TC	180.0	180.0	180.0	170.8	170.8	171.0	161.3	161.3	165.8	151.3	151.3	160.3	141.0	141.0	154.6	130.4	130.4	148.8	119.4	119.4	142.5
			SHC	113.1	144.6	176.1	108.1	139.5	171.0	103.0	134.4	165.8	97.6	129.0	160.3	92.1	123.4	154.6	86.6	117.7	148.8	80.7	111.6	142.5
		72	TC	197.1	197.1	197.1	187.5	187.5	187.5	177.4	177.4	177.4	166.8	166.8	166.8	155.8	155.8	155.8	144.3	144.3	144.3	132.3	132.3	132.3
			SHC	82.6	114.2	145.9	77.7	109.3	140.9	72.6	104.2	135.8	67.5	99.0	130.6	62.2	93.7	125.2	56.7	88.1	119.6	51.1	82.6	114
		76	TC	—	211.9	211.9	—	201.9	201.9	—	191.4	191.4	—	180.4	180.4	—	169.0	169.0	—	157.1	157.1	—	—	—
			SHC	—	89.6	121.7	—	84.8	116.8	—	79.9	111.7	—	74.7	106.6	—	69.4	101.3	—	64.1	95.8	—	—	—

LEGEND

—	Do not operate
CFM	Cubic Feet Per Minute (supply air)
EAT (db)	Entering Air Temperature (dry bulb)
EAT (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — FIRST STAGE, PART LOAD (15 TONS)

50LC*B SIZE 17				AMBIENT TEMPERATURE (°F)																							
				65			75			85			95			105			115			125					
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)					
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85			
1250 CFM	EAT (wb)	58	TC	61.3	61.3	62.6	59.7	59.7	61.6	57.7	57.7	60.6	55.4	55.4	59.4	52.8	52.8	58.0	50.8	50.8	55.2	47.4	47.4	53.7			
		SHC	49.1	55.9	62.6	48.3	55.0	61.6	47.2	53.9	60.6	46.0	52.7	59.4	44.7	51.3	58.0	42.6	48.8	55.2	41.0	47.4	53.7				
		62	TC	67.1	67.1	67.1	65.3	65.3	65.3	63.2	63.2	63.2	60.8	60.8	60.8	58.0	58.0	58.0	54.9	54.9	54.9	51.5	51.5	51.5			
		SHC	44.8	51.5	58.1	43.9	50.5	57.2	42.8	49.4	56.2	41.5	48.3	55.0	40.3	46.9	53.6	38.7	45.4	52.2	37.1	43.8	50.5				
		67	TC	75.2	75.2	75.2	73.2	73.2	73.2	70.9	70.9	70.9	68.3	68.3	68.3	65.3	65.3	65.3	62.0	62.0	62.0	58.2	58.2	58.2			
	SHC	39.1	45.8	52.6	38.2	44.9	51.6	37.1	43.9	50.5	36.0	42.6	49.3	34.6	41.3	48.0	33.2	39.9	46.5	31.6	38.2	44.9					
	72	TC	84.0	84.0	84.0	81.9	81.9	81.9	79.5	79.5	79.5	76.5	76.5	76.5	73.3	73.3	73.3	69.7	69.7	69.7	65.7	65.7	65.7				
	SHC	33.3	40.1	46.7	32.4	39.1	45.8	31.4	38.0	44.8	30.2	36.9	43.6	28.9	35.6	42.3	27.4	34.1	40.9	25.8	32.6	39.3					
	76	TC	—	91.9	91.9	—	89.6	89.6	—	86.9	86.9	—	83.9	83.9	—	80.4	80.4	—	76.5	76.5	—	72.2	72.2				
	SHC	—	35.3	42.0	—	34.4	41.1	—	33.3	40.1	—	32.2	38.9	—	30.9	37.6	—	29.4	36.2	—	27.9	34.6					
1750 CFM	EAT (wb)	58	TC	69.5	69.5	75.4	66.8	66.8	75.7	65.0	65.0	73.6	62.9	62.9	71.2	60.5	60.5	68.5	57.9	57.9	65.5	55.0	55.0	62.2			
		SHC	58.5	67.0	75.4	58.0	66.8	75.7	56.4	65.0	73.6	54.6	62.9	71.2	52.6	60.5	68.5	50.3	57.9	65.5	47.7	55.0	62.2				
		62	TC	74.5	74.5	74.5	72.3	72.3	72.3	69.8	69.8	69.8	67.0	67.0	67.7	63.7	63.7	66.2	60.2	60.2	64.5	56.2	56.2	62.7			
		SHC	53.0	62.1	71.2	52.0	61.0	70.2	50.8	59.9	69.0	49.4	58.6	67.7	48.0	57.0	66.2	46.3	55.5	64.5	44.6	53.6	62.7				
		67	TC	83.2	83.2	83.2	80.8	80.8	80.8	78.0	78.0	78.0	74.9	74.9	74.9	71.5	71.5	71.5	67.5	67.5	67.5	63.2	63.2	63.2			
	SHC	44.9	54.1	63.2	44.0	53.0	62.2	42.8	51.9	61.0	41.4	50.6	59.7	40.0	49.0	58.2	38.4	47.5	56.6	36.7	45.7	54.9					
	72	TC	92.8	92.8	92.8	90.2	90.2	90.2	87.2	87.2	87.2	83.9	83.9	83.9	80.0	80.0	80.0	75.8	75.8	75.8	71.1	71.1	71.1				
	SHC	36.8	45.9	55.0	35.8	44.9	54.0	34.6	43.7	52.8	33.3	42.4	51.6	31.9	41.0	50.1	30.3	39.4	48.6	28.6	37.7	46.8					
	76	TC	—	101.0	101.0	—	98.4	98.4	—	95.2	95.2	—	91.6	91.6	—	87.5	87.5	—	83.0	83.0	—	78.0	78.0				
	SHC	—	39.2	48.3	—	38.2	47.3	—	37.1	46.2	—	35.8	44.9	—	34.3	43.5	—	32.8	41.9	—	31.1	40.3					
2100 CFM	EAT (wb)	58	TC	75.6	75.6	85.4	72.6	72.6	82.2	69.4	69.4	78.7	65.8	65.8	74.9	62.0	62.0	70.7	57.8	57.8	66.1	53.3	53.3	61.2			
		SHC	65.7	75.6	85.4	63.0	72.6	82.2	60.1	69.4	78.7	56.8	65.8	74.9	53.3	62.0	70.7	49.6	57.8	66.1	45.5	53.3	61.2				
		62	TC	79.2	79.2	82.3	75.7	75.7	80.0	71.8	71.8	77.6	67.5	67.5	75.0	62.9	62.9	72.2	58.0	58.0	69.0	53.4	53.4	64.0			
		SHC	59.9	71.1	82.3	57.6	68.8	80.0	55.3	66.4	77.6	52.7	63.9	75.0	49.9	61.0	72.2	46.9	58.0	69.0	43.0	53.4	64.0				
		67	TC	88.1	88.1	88.1	84.3	84.3	84.3	80.1	80.1	80.1	75.6	75.6	75.6	70.6	70.6	70.6	65.2	65.2	65.2	59.4	59.4	59.4			
	SHC	49.7	61.0	72.2	47.5	58.8	70.0	45.1	56.4	67.6	42.6	53.8	65.0	39.9	51.1	62.3	37.1	48.3	59.5	34.0	45.2	56.5					
	72	TC	98.0	98.0	98.0	94.1	94.1	94.1	89.6	89.6	89.6	84.7	84.7	84.7	79.5	79.5	79.5	73.7	73.7	73.7	67.5	67.5	67.5				
	SHC	39.4	50.7	61.9	37.2	48.5	59.8	34.8	46.1	57.3	32.3	43.6	54.8	29.6	41.0	52.2	26.8	38.1	49.3	23.9	35.2	46.4					
	76	TC	—	106.5	106.5	—	102.5	102.5	—	97.9	97.9	—	92.7	92.7	—	87.2	87.2	—	81.1	81.1	—	74.5	74.5				
	SHC	—	42.2	53.4	—	40.1	51.3	—	37.7	48.9	—	35.2	46.5	—	32.6	43.9	—	29.8	41.0	—	26.9	38.1					
2550 CFM	EAT (wb)	58	TC	81.7	81.7	92.3	78.6	78.6	88.9	75.1	75.1	88.1	71.3	71.3	80.9	67.2	67.2	76.3	62.7	62.7	71.5	57.8	57.8	66.1			
		SHC	71.2	81.7	92.3	68.3	78.6	88.9	62.0	75.1	88.1	61.6	71.3	80.9	57.9	67.2	76.3	53.8	62.7	71.5	49.4	57.8	66.1				
		62	TC	82.9	82.9	93.6	79.3	79.3	91.2	75.3	75.3	88.4	71.4	71.4	84.2	67.3	67.3	79.6	62.8	62.8	74.5	57.9	57.9	69.0			
		SHC	66.7	80.1	93.6	64.4	77.8	91.2	61.7	75.1	88.4	58.5	71.4	84.2	54.9	67.3	79.6	51.0	62.8	74.5	46.8	57.9	69.0				
		67	TC	91.7	91.7	91.7	87.8	87.8	87.8	83.4	83.4	83.4	78.5	78.5	78.5	73.3	73.3	73.3	67.7	67.7	67.7	61.5	61.5	65.3			
	SHC	54.3	67.9	81.5	52.0	65.6	79.2	49.5	63.2	76.7	47.0	60.5	74.1	46.6	58.6	70.6	41.3	54.9	68.4	38.2	51.8	65.3					
	72	TC	101.8	101.8	101.8	97.7	97.7	97.7	93.0	93.0	93.0	87.8	87.8	87.8	82.3	82.3	82.3	76.2	76.2	76.2	69.7	69.7	69.7				
	SHC	41.5	55.3	68.9	39.4	53.0	66.7	37.0	50.6	64.3	34.3	48.0	61.7	31.7	45.3	59.0	28.8	42.4	56.1	25.7	39.4	53.0					
	76	TC	—	110.3	110.3	—	106.3	106.3	—	101.4	101.4	—	96.0	96.0	—	90.2	90.2	—	83.9	83.9	—	76.9	76.9				
	SHC	—	44.9	58.5	—	42.7	56.4	—	40.3	54.0	—	37.7	51.5	—	35.1	48.8	—	32.3	45.9	—	29.3	42.9					
2950 CFM	EAT (wb)	58	TC	86.2	86.2	97.3	82.9	82.9	93.7	79.2	79.2	89.7	75.2	75.2	85.3	70.8	70.8	86.7	66.1	66.1	75.3	60.9	60.9	76.6			
		SHC	75.2	86.2	97.3	72.1	82.9	93.7	68.7	79.2	89.7	65.0	75.2	85.3	55.0	70.8	86.7	56.8	66.1	75.3	45.2	60.9	76.6				
		62	TC	86.4	86.4	101.2	83.0	83.0	97.5	79.3	79.3	93.3	75.3	75.3	88.8	70.9	70.9	83.9	66.2	66.2	78.5	61.0	61.0	72.6			
		SHC	71.6	86.4	101.2	68.5	83.0	97.5	65.3	79.3	93.3	61.8	75.3	88.8	58.0	70.9	83.9	53.8	66.2	78.5	49.4	61.0	72.6				
		67	TC	94.1	94.1	94.1	90.0	90.0	90.0	85.4	85.4	85.4	80.4	80.4	81.8	75.1	75.1	79.1	69.2	69.2	76.1	63.0	63.0	72.8			
	SHC	58.0	73.7	89.3	55.8	71.4	87.1	53.2	68.9	84.5	50.6	66.2	81.8	47.9	63.5	79.1	44.9	60.5	76.1	41.7	57.3	72.8					
	72	TC	104.1	104.1	104.1	100.0	100.0	100.0	95.2	95.2	95.2	89.9	89.9	89.9	84.0	84.0	84.0	77.9	77.9	77.9	71.1	71.1	71.1				
	SHC	43.3	59.0	74.8	41.0	56.7	72.5	38.6	54.3	70.1	36.0	51.7	67.5	33.2	48.9	64.6	30.3	46.0	61.8	27.3	43.0	58.7					
	76	TC	—	112.8	112.8	—	108.6	108.6	—	103.7	103.7	—	98.2	98.2	—	92.0	92.0	—	85.5	85.5	—	78.4	78.4				
	SHC	—	46.9	62.8	—	44.9	60.6	—	42.4	58.2	—	39.9	55.7	—	37.1	52.9	—	34.3	50.1	—	31.3	47.1					
3400 CFM	EAT (wb)	58	TC	90.5	90.5	102.1	87.0	87.0	98.3	83.1	83.1	94.0	78.9	78.9	89.4	74.3	74.3	84.3	69.3	69.3	78.9	63.9	63.9	72.9			
		SHC	78.9	90.5	102.1	75.7	87.0	98.3	72.2	83.1	94.0	68.3	78.9	89.4	64.2	74.3	84.3	59.7	69.3	78.9	54.9	63.9	72.9				
		62	TC	90.6	90.6	106.1	87.1	87.1	102.2	83.2	83.2	97.8	79.0	79.0	93.0	74.4	74.4	87.8	69.3	69.3	82.2	64.0	64.0	76.1			
		SHC	75.1	90.6	106.1	72.0	87.1	102.2	68.5	83.2	97.8	64.8	79.0	93.0	60.8	74.4	87.8	56.6	69.3	82.2	51.9	64.0	76.1				
		67	TC	96.1	96.1	97.9	91.9	91.9	95.6	87.3	87.3	92.9	82.2	82.2	90.2	76.7	76.7	87.3	70.8	70.8	84.1	64.5	64.5	80.6			
	SHC	62.1	80.0	97.9	59.8	77.6	95.6	57.2	75.1	92.9	54.5	72.3	90.2	51.7	69.5	87.3	48.7	66.4	84.1	45.4	63.0	80.6					
	72	TC	106.2	106.2	106.2	102.0	102.0	102.0	97.0	97.0	97.0	91.6	91.6	91.6	85.6	85.6	85.6	79.3	79.3	79.3	72.3	72.3	72.3				
	SHC	45.0	63.1	81.1	42.8	60.8	78.9	40.4	58.3	76.3	37.7	55.7	73.7	34.9	52.9	70.9	32.0	50.0	68.0	28.9	46.9	64.8					
	76	TC	—	115.0	115.0	—	110.7	110.7	—	105.6	105.6	—	99.9	99.9	—	93.7	93.7	—	87.0	87.0	—	79.7	79.7				
	SHC	—	49.2	67.4	—	47.1	65.2	—																			

COOLING CAPACITIES — FIRST STAGE, PART LOAD (15 TONS) (cont)

50LC*B SIZE 17				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
3800 CFM	EAT (wb)	58	TC	93.6	93.6	105.6	90.0	90.0	101.6	86.0	86.0	97.2	81.6	81.6	92.4	76.8	76.8	87.3	71.7	71.7	81.5	66.1	66.1	75.4
			SHC	81.6	93.6	105.6	78.3	90.0	101.6	74.7	86.0	97.2	70.7	81.6	92.4	66.4	76.8	87.3	61.8	71.7	81.5	56.7	66.1	75.4
		62	TC	93.7	93.7	109.7	90.1	90.1	105.7	86.1	86.1	101.1	81.7	81.7	96.2	76.9	76.9	90.8	71.8	71.8	84.9	66.2	66.2	78.6
			SHC	77.7	93.7	109.7	74.5	90.1	105.7	71.0	86.1	101.1	67.2	81.7	96.2	63.0	76.9	90.8	58.6	71.8	84.9	53.7	66.2	78.6
		67	TC	97.6	97.6	105.2	93.4	93.4	102.8	88.6	88.6	100.1	83.5	83.5	97.3	78.0	78.0	94.2	72.2	72.2	90.7	66.3	66.3	84.6
			SHC	65.5	85.3	105.2	63.2	83.0	102.8	60.5	80.3	100.1	57.8	77.6	97.3	54.9	74.6	94.2	51.8	71.2	90.7	47.6	66.1	84.6
		72	TC	107.5	107.5	107.5	103.3	103.3	103.3	98.3	98.3	98.3	92.7	92.7	92.7	86.7	86.7	86.7	80.1	80.1	80.1	73.1	73.1	73.1
			SHC	46.4	66.5	86.5	44.3	64.3	84.3	41.7	61.8	81.8	39.1	59.1	79.2	36.3	56.4	76.3	33.3	53.3	73.3	30.2	50.2	70.2
		76	TC	—	116.2	116.2	—	112.0	112.0	—	107.0	107.0	—	101.2	101.2	—	94.9	94.9	—	87.9	87.9	—	80.5	80.5
			SHC	—	51.0	71.3	—	48.9	69.1	—	46.5	66.7	—	43.9	64.1	—	41.1	61.3	—	38.2	58.3	—	35.1	55.3
4250 CFM	EAT (wb)	58	TC	96.6	96.6	108.9	92.9	92.9	104.9	88.7	88.7	100.3	84.2	84.2	95.4	79.3	79.3	90.0	73.9	73.9	84.0	68.2	68.2	77.7
			SHC	84.3	96.6	108.9	80.9	92.9	104.9	77.1	88.7	100.3	73.0	84.2	95.4	68.6	79.3	90.0	63.9	73.9	84.0	58.6	68.2	77.7
		62	TC	96.7	96.7	113.2	93.0	93.0	109.0	88.8	88.8	104.3	84.3	84.3	99.3	79.4	79.4	93.6	74.0	74.0	87.6	68.3	68.3	81.0
			SHC	80.2	96.7	113.2	77.0	93.0	109.0	73.3	88.8	104.3	69.4	84.3	99.3	65.1	79.4	93.6	60.5	74.0	87.6	55.5	68.3	81.0
		67	TC	99.1	99.1	113.0	94.8	94.8	110.6	90.1	90.1	107.7	84.9	84.9	104.6	79.6	79.6	100.7	74.1	74.1	94.4	68.3	68.3	87.5
			SHC	69.1	91.1	113.0	66.8	88.6	110.6	64.2	86.0	107.7	61.3	83.0	104.6	58.1	79.5	100.7	53.8	74.1	94.4	49.2	68.3	87.5
		72	TC	108.7	108.7	108.7	104.4	104.4	104.4	99.4	99.4	99.4	93.7	93.7	93.7	87.7	87.7	87.7	81.0	81.0	81.0	73.9	73.9	76.1
			SHC	48.0	70.2	92.5	45.7	68.1	90.3	43.3	65.5	87.8	40.7	62.9	85.1	37.8	60.1	82.3	34.8	57.0	79.3	31.7	53.8	76.1
		76	TC	—	117.5	117.5	—	113.3	113.3	—	108.1	108.1	—	102.3	102.3	—	95.8	95.8	—	88.8	88.8	—	81.3	81.3
			SHC	—	53.0	75.5	—	50.9	73.3	—	48.6	70.9	—	45.9	68.3	—	43.1	65.5	—	40.2	62.5	—	37.1	59.4

LEGEND

—	Do not operate
CFM	Cubic Feet Per Minute (supply air)
EAT (db)	Entering Air Temperature (dry bulb)
EAT (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — SECOND STAGE, PART LOAD (15 TONS)

50LC*B SIZE 17				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
1900 CFM	EAT (wb)	58	TC	96.9	96.9	99.5	92.9	92.9	97.2	89.2	89.2	95.2	85.5	85.5	93.1	81.7	81.7	91.0	78.1	78.1	87.9	74.4	74.4	83.9
		SHC	79.2	89.3	99.5	76.9	87.1	97.2	74.8	84.9	95.2	72.8	83.0	93.1	70.7	80.8	91.0	68.2	78.1	87.9	64.9	74.4	83.9	
		62	TC	105.0	105.0	105.0	100.5	100.5	100.5	96.4	96.4	96.4	92.3	92.3	92.3	88.2	88.2	88.2	83.9	83.9	83.9	79.0	79.0	79.0
		SHC	71.8	81.9	92.1	69.4	79.6	89.8	67.3	77.4	87.7	65.2	75.4	85.6	63.2	73.3	83.5	60.9	71.2	81.3	58.6	68.7	79.0	
		67	TC	116.2	116.2	116.2	111.2	111.2	111.2	106.6	106.6	106.6	102.0	102.0	102.0	97.4	97.4	97.4	92.6	92.6	92.6	87.4	87.4	87.4
	SHC	62.4	72.5	82.8	60.0	70.1	80.3	57.7	68.0	78.1	55.6	65.8	76.0	53.5	63.7	73.9	51.3	61.5	71.7	49.0	59.2	69.4		
	72	TC	128.6	128.6	128.6	123.0	123.0	123.0	117.9	117.9	117.9	112.8	112.8	112.8	107.6	107.6	107.6	102.4	102.4	102.4	96.6	96.6	96.6	
	SHC	52.7	62.9	73.0	50.2	60.4	70.6	48.0	58.1	68.3	45.8	56.0	66.2	43.7	53.8	64.1	41.4	51.7	61.8	39.2	49.3	59.6		
	76	TC	—	139.5	139.5	—	133.4	133.4	—	127.7	127.7	—	122.2	122.2	—	116.6	116.6	—	110.9	110.9	—	104.7	104.7	
	SHC	—	54.9	65.1	—	52.5	62.6	—	50.1	60.4	—	48.0	58.1	—	45.8	56.0	—	43.6	53.8	—	41.3	51.5		
2500 CFM	EAT (wb)	58	TC	105.8	105.8	118.3	101.6	101.6	114.5	98.0	98.0	110.4	94.5	94.5	106.5	90.9	90.9	102.4	87.0	87.0	98.0	82.8	82.8	93.2
		SHC	91.8	105.0	118.3	88.7	101.6	114.5	85.6	98.0	110.4	82.5	94.5	106.5	79.4	90.9	102.4	76.0	87.0	98.0	72.2	82.8	93.2	
		62	TC	113.9	113.9	113.9	108.6	108.6	108.6	103.7	103.7	103.7	99.1	99.1	101.4	94.3	94.3	99.1	89.3	89.3	96.7	83.9	83.9	94.2
		SHC	81.9	95.3	108.6	79.4	92.6	106.0	76.9	90.3	103.6	74.7	88.0	101.4	72.4	85.8	99.1	70.1	83.5	96.7	67.7	80.9	94.2	
		67	TC	125.9	125.9	125.9	119.9	119.9	119.9	114.4	114.4	114.4	109.1	109.1	109.1	103.8	103.8	103.8	98.4	98.4	98.4	92.4	92.4	92.4
	SHC	69.3	82.7	96.0	66.6	80.0	93.4	64.3	77.6	91.0	61.9	75.3	88.6	59.7	73.0	86.4	57.3	70.7	84.0	54.9	68.3	81.6		
	72	TC	138.9	138.9	138.9	132.4	132.4	132.4	126.3	126.3	126.3	120.4	120.4	120.4	114.6	114.6	114.6	108.5	108.5	108.5	102.1	102.1	102.1	
	SHC	56.4	69.7	83.2	53.6	67.1	80.4	51.2	64.5	78.0	48.8	62.3	75.7	46.6	60.0	73.4	44.3	57.7	71.1	41.9	55.3	68.7		
	76	TC	—	150.3	150.3	—	143.2	143.2	—	136.6	136.6	—	130.2	130.2	—	123.8	123.8	—	117.4	117.4	—	110.5	110.5	
	SHC	—	59.1	72.4	—	56.4	69.8	—	53.9	67.4	—	51.6	65.0	—	49.3	62.8	—	47.1	60.5	—	44.7	58.1		
3100 CFM	EAT (wb)	58	TC	113.4	113.4	128.0	108.2	108.2	122.3	103.4	103.4	116.8	98.5	98.5	111.4	93.7	93.7	106.1	88.6	88.6	100.5	83.2	83.2	94.5
		SHC	98.9	113.4	128.0	94.2	108.2	122.3	89.8	103.4	116.8	85.6	98.5	111.4	81.2	93.7	106.1	76.7	88.6	100.5	71.9	83.2	94.5	
		62	TC	118.7	118.7	122.7	112.0	112.0	119.0	105.9	105.9	115.7	100.0	100.0	112.5	94.3	94.3	109.2	88.7	88.7	104.6	83.3	83.3	98.4
		SHC	89.8	106.2	122.7	86.3	102.7	119.0	83.0	99.4	115.7	79.9	96.1	112.5	76.6	92.9	109.2	72.8	88.7	104.6	68.3	83.3	98.4	
		67	TC	131.1	131.1	131.1	123.8	123.8	123.8	117.0	117.0	117.0	110.5	110.5	110.5	103.9	103.9	103.9	97.3	97.3	97.3	90.2	90.2	90.2
	SHC	74.4	90.9	107.3	70.8	87.4	103.8	67.6	84.0	100.5	64.4	80.8	97.3	61.2	77.7	94.2	58.1	74.6	91.1	54.8	71.3	87.8		
	72	TC	145.1	145.1	145.1	137.1	137.1	137.1	129.7	129.7	129.7	122.5	122.5	122.5	115.3	115.3	115.3	108.1	108.1	108.1	100.4	100.4	100.4	
	SHC	58.6	75.3	91.8	55.1	71.7	88.2	51.8	68.3	84.9	48.6	65.2	81.8	45.5	62.1	78.6	42.3	58.9	75.5	39.1	55.7	72.2		
	76	TC	—	157.0	157.0	—	148.6	148.6	—	140.5	140.5	—	132.8	132.8	—	125.2	125.2	—	117.4	117.4	—	109.3	109.3	
	SHC	—	62.3	78.9	—	58.8	75.5	—	55.5	72.2	—	52.4	68.9	—	49.2	65.8	—	46.1	62.7	—	42.9	59.6		
3700 CFM	EAT (wb)	58	TC	121.4	121.4	136.9	115.6	115.6	130.6	110.2	110.2	124.5	104.9	104.9	118.7	99.6	99.6	112.8	94.2	94.2	106.7	88.3	88.3	100.2
		SHC	105.8	121.4	136.9	100.7	115.6	130.6	95.8	110.2	124.5	91.2	104.9	118.7	86.5	99.6	112.8	81.6	94.2	106.7	76.4	88.3	100.2	
		62	TC	123.4	123.4	137.3	116.6	116.6	133.4	110.4	110.4	129.5	105.1	105.1	123.4	99.7	99.7	117.4	94.3	94.3	111.1	88.4	88.4	104.3
		SHC	98.6	117.9	137.3	94.8	114.1	133.4	91.3	110.4	129.5	86.7	105.1	123.4	82.2	99.7	117.4	77.5	94.3	111.1	72.5	88.4	104.3	
		67	TC	135.7	135.7	135.7	128.0	128.0	128.0	120.7	120.7	120.7	113.8	113.8	113.8	107.0	107.0	107.0	100.0	100.0	102.4	92.6	92.6	99.0
	SHC	80.0	99.6	119.2	76.4	96.0	115.6	73.0	92.6	112.1	69.8	89.3	108.9	66.6	86.2	105.7	63.4	82.9	102.4	60.1	79.6	99.0		
	72	TC	149.9	149.9	149.9	141.4	141.4	141.4	133.5	133.5	133.5	125.9	125.9	125.9	118.5	118.5	118.5	110.9	110.9	110.9	102.9	102.9	102.9	
	SHC	61.2	80.9	100.6	57.6	77.3	97.0	54.2	73.9	93.6	51.0	70.7	90.3	47.8	67.5	87.1	44.7	64.3	83.9	41.3	60.9	80.6		
	76	TC	—	161.9	161.9	—	153.0	153.0	—	144.5	144.5	—	136.4	136.4	—	128.3	128.3	—	120.2	120.2	—	111.8	111.8	
	SHC	—	65.5	85.4	—	62.0	81.8	—	58.6	78.5	—	55.4	75.3	—	52.3	72.1	—	49.0	68.8	—	45.8	65.5		
4300 CFM	EAT (wb)	58	TC	127.9	127.9	144.2	121.7	121.7	137.3	115.8	115.8	130.8	110.2	110.2	124.5	104.4	104.4	118.2	98.6	98.6	111.7	92.4	92.4	104.8
		SHC	111.5	127.9	144.2	106.0	121.7	137.3	100.8	115.8	130.8	95.7	110.2	124.5	90.8	104.4	118.2	85.5	98.6	111.7	80.0	92.4	104.8	
		62	TC	128.0	128.0	149.9	121.8	121.8	142.7	115.9	115.9	136.0	110.3	110.3	129.5	104.6	104.6	122.9	98.8	98.8	116.2	92.5	92.5	109.1
		SHC	106.2	128.0	149.9	100.9	121.8	142.7	95.9	115.9	136.0	91.1	110.3	129.5	86.2	104.6	122.9	81.2	98.8	116.2	76.0	92.5	109.1	
		67	TC	139.1	139.1	139.1	131.0	131.0	131.0	123.5	123.5	123.5	116.3	116.3	120.0	109.3	109.3	116.7	102.1	102.1	113.3	94.6	94.6	109.7
	SHC	85.4	108.0	130.7	81.7	104.3	126.8	78.3	100.8	123.3	75.0	97.5	120.0	71.7	94.2	116.7	68.4	90.9	113.3	64.9	87.4	109.7		
	72	TC	153.3	153.3	153.3	144.5	144.5	144.5	136.3	136.3	136.3	128.4	128.4	128.4	120.6	120.6	120.6	112.8	112.8	112.8	104.6	104.6	104.6	
	SHC	63.6	86.3	109.0	59.9	82.6	105.3	56.5	79.2	101.9	53.1	75.9	98.5	49.9	72.6	95.3	46.7	69.3	92.0	43.4	66.0	88.6		
	76	TC	—	165.5	165.5	—	156.2	156.2	—	147.4	147.4	—	139.0	139.0	—	130.7	130.7	—	122.4	122.4	—	113.7	113.7	
	SHC	—	68.5	91.5	—	64.9	87.8	—	61.5	84.4	—	58.2	81.0	—	55.0	77.8	—	51.8	74.6	—	48.5	71.2		
4900 CFM	EAT (wb)	58	TC	133.3	133.3	150.3	126.7	126.7	142.9	120.4	120.4	136.0	114.5	114.5	129.4	108.4	108.4	122.7	102.3	102.3	115.8	95.7	95.7	108.5
		SHC	116.3	133.3	150.3	110.5	126.7	142.9	104.9	120.4	136.0	99.5	114.5	129.4	94.2	108.4	122.7	88.7	102.3	115.8	83.0	95.7	108.5	
		62	TC	133.5	133.5	156.2	126.8	126.8	148.6	120.6	120.6	141.4	114.6	114.6	134.5	108.5	108.5	127.5	102.4	102.4	120.5	95.8	95.8	112.9
		SHC	110.8	133.5	156.2	105.1	126.8	148.6	99.8	120.6	141.4	94.7	114.6	134.5	89.5	108.5	127.5	84.3	102.4	120.5	78.8	95.8	112.9	
		67	TC	141.8	141.8	141.8	133.5	133.5	137.7	125.7	125.7	134.1	118.4	118.4	130.7	111.2	111.2	127.1	103.9	103.9	123.4	96.4	96.4	119.3
	SHC	90.6	116.0	141.6	86.8	112.2	137.7	83.3	108.7	134.1	79.9	105.2	130.7	76.5	101.8	127.1	73.1	98.3	123.4	69.5	94.5	119.3		
	72	TC	155.9	155.9	155.9	146.8	146.8	146.8	138.5	138.5	138.5	130.3	130.3	130.3</										

COOLING CAPACITIES — SECOND STAGE, PART LOAD (15 TONS) (cont)

50LC*B SIZE 17				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
5550 CFM	EAT (wb)	58	TC	138.3	138.3	155.8	131.2	131.2	148.1	124.7	124.7	140.8	118.4	118.4	133.7	112	112.0	126.7	105.6	105.6	119.5	98.8	98.8	111.9
		SHC	120.6	138.3	155.8	114.5	131.2	148.1	108.6	124.7	140.8	103.0	118.4	133.7	97.4	112.0	126.7	91.7	105.6	119.5	85.6	98.8	111.9	
		62	TC	138.4	138.4	161.9	131.4	131.4	153.9	124.8	124.8	146.3	118.5	118.5	138.9	112.1	112.1	131.7	105.7	105.7	124.3	98.9	98.9	116.4
		SHC	114.9	138.4	161.9	108.9	131.4	153.9	103.4	124.8	146.3	97.9	118.5	138.9	92.5	112.1	131.7	87.1	105.7	124.3	81.2	98.9	116.4	
		67	TC	144.1	144.1	153.0	135.6	135.6	149.0	127.7	127.7	145.2	120.3	120.3	141.4	113.0	113.0	137.5	106.0	106.0	132.8	99.2	99.2	124.5
	SHC	95.8	124.4	153.0	91.9	120.4	149.0	88.3	116.8	145.2	84.8	113.1	141.4	81.4	109.4	137.5	77.5	105.2	132.8	72.3	98.4	124.5		
	72	TC	158.0	158.0	158.0	148.9	148.9	148.9	140.2	140.2	140.2	131.8	131.8	131.8	123.6	123.6	123.6	115.4	115.4	115.4	107.0	107.0	107.0	
	SHC	67.9	96.6	125.5	64.2	92.9	121.7	60.6	89.4	118.2	57.2	86.0	114.8	54.0	82.7	111.3	50.7	79.4	108.0	47.3	76.0	104.6		
	76	TC	—	170.5	170.5	—	160.8	160.8	—	151.5	151.5	—	142.6	142.6	—	133.9	133.9	—	125.1	125.1	—	116.1	116.1	
	SHC	—	74.1	103.1	—	70.4	99.5	—	67.0	95.8	—	63.6	92.4	—	60.3	89.1	—	56.9	85.8	—	53.6	82.4		
6150 CFM	EAT (wb)	58	TC	142.1	142.1	160.2	134.8	134.8	152.1	128.0	128.0	144.4	121.4	121.4	137.1	114.9	114.9	129.8	108.1	108.1	122.4	101.1	101.1	114.6
		SHC	124.0	142.1	160.2	117.6	134.8	152.1	111.5	128.0	144.4	105.6	121.4	137.1	99.8	114.9	129.8	93.9	108.1	122.4	87.7	101.1	114.6	
		62	TC	142.3	142.3	166.3	134.9	134.9	158.0	128.1	128.1	150.1	121.5	121.5	142.4	115.0	115.0	134.9	108.2	108.2	127.2	101.2	101.2	119.1
		SHC	118.1	142.3	166.3	111.9	134.9	158.0	106.1	128.1	150.1	100.4	121.5	142.4	94.9	115.0	134.9	89.2	108.2	127.2	83.2	101.2	119.1	
		67	TC	146.0	146.0	163.0	137.4	137.4	158.7	129.5	129.5	154.6	122.1	122.1	150.3	115.2	115.2	144.2	108.5	108.5	136.0	101.3	101.3	128.2
	SHC	100.4	131.7	163.0	96.5	127.6	158.7	92.7	123.7	154.6	89.1	119.7	150.3	84.7	114.5	144.2	79.6	107.7	136.0	74.4	101.3	128.2		
	72	TC	159.6	159.6	159.6	150.2	150.2	150.2	141.5	141.5	141.5	133.0	133.0	133.0	124.7	124.7	124.7	116.4	116.4	116.4	107.7	107.7	111.9	
	SHC	69.8	101.4	133.0	66.0	97.6	129.2	62.5	94.1	125.6	59.1	90.7	122.2	55.8	87.3	118.8	52.5	83.9	115.4	49.1	80.5	111.9		
	76	TC	—	172.2	172.2	—	162.3	162.3	—	152.9	152.9	—	143.8	143.8	—	134.9	134.9	—	126.1	126.1	—	116.9	116.9	
	SHC	—	76.5	108.4	—	72.9	104.6	—	69.3	101.1	—	66.0	97.6	—	62.7	94.3	—	59.3	90.9	—	56.0	87.5		

LEGEND

- Do not operate
- CFM — Cubic Feet Per Minute (supply air)
- EAT (db) — Entering Air Temperature (dry bulb)
- EAT (wb) — Entering Air Temperature (wet bulb)
- SHC — Sensible Heat Capacity (1000 Btuh) Gross
- TC — Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — THIRD STAGE, FULL LOAD (15 TONS)

50LC*B SIZE 17				AMBIENT TEMPERATURE (°F)																					
				65			75			85			95			105			115			125			
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	
3000 CFM	EAT (wb)	58	TC	156.8	156.8	158.7	151.3	151.3	155.7	145.9	145.9	152.6	140.0	140.0	149.3	133.7	133.7	145.7	126.8	126.8	141.7	120.2	120.2	135.4	
		SHC	126.8	142.8	158.7	123.7	139.7	155.7	120.6	136.6	152.6	117.4	133.3	149.3	113.9	129.8	145.7	110.0	125.9	141.7	104.9	120.2	135.4		
		62	TC	169.1	169.1	169.1	163.2	163.2	163.2	157.3	157.3	157.3	151.0	151.0	151.0	144.2	144.2	144.2	136.7	136.7	136.7	128.4	128.4	128.4	
		SHC	115.0	130.9	146.9	111.8	127.8	143.8	108.7	124.7	140.6	105.4	121.4	137.4	102.0	118.0	134.0	98.2	114.2	130.2	94.2	110.1	126.1		
		67	TC	186.3	186.3	186.3	179.9	179.9	179.9	173.4	173.4	173.4	166.5	166.5	166.5	159.2	159.2	159.2	151.1	151.1	151.1	142.4	142.4	142.4	
	SHC	99.7	115.8	131.8	96.6	112.7	128.7	93.5	109.5	125.6	90.3	106.3	122.3	86.8	102.9	118.9	83.2	99.2	115.1	79.2	95.2	111.2			
	72	TC	205.3	205.3	205.3	198.3	198.3	198.3	191.1	191.1	191.1	183.6	183.6	183.6	175.5	175.5	175.5	166.9	166.9	166.9	157.4	157.4	157.4		
	SHC	84.1	100.2	116.3	81.0	97.1	113.2	77.8	93.9	110.0	74.6	90.7	106.8	71.2	87.3	103.4	67.6	83.7	99.7	63.7	79.8	95.8			
	76	TC	—	221.6	221.6	—	214.0	214.0	—	206.2	206.2	—	198.1	198.1	—	189.5	189.5	—	180.3	180.3	—	170.2	170.2		
	SHC	—	87.2	103.3	—	84.0	100.1	—	80.9	97.0	—	77.7	93.8	—	74.4	90.5	—	70.8	86.9	—	67.0	83.1			
3400 CFM	EAT (wb)	58	TC	163.1	163.1	171.4	157.4	157.4	168.1	151.5	151.5	164.8	145.5	145.5	161.3	140.9	140.9	153.5	133.2	133.2	150.1	126.6	126.6	142.6	
		SHC	135.3	153.4	171.4	132.1	150.2	168.1	128.9	146.8	164.8	125.5	143.3	161.3	120.0	136.7	153.5	116.3	133.2	150.1	110.5	126.6	142.6		
		62	TC	175.6	175.6	175.6	169.4	169.4	169.4	162.9	162.9	162.9	156.2	156.2	156.2	149.0	149.0	149.0	141.1	141.1	141.1	132.5	132.5	136.3	
		SHC	121.7	139.7	157.9	118.5	136.5	154.6	115.2	133.3	151.3	111.8	129.9	148.0	108.3	126.4	144.4	104.4	122.5	140.5	100.3	118.4	136.3		
		67	TC	193.3	193.3	193.3	186.4	186.4	186.4	179.4	179.4	179.4	172.1	172.1	172.1	164.3	164.3	164.3	155.8	155.8	155.8	146.4	146.4	146.4	
	SHC	104.4	122.6	140.6	101.2	119.2	137.4	97.9	116.0	134.2	94.6	112.6	130.7	91.1	109.1	127.2	87.3	105.4	123.4	83.2	101.3	119.4			
	72	TC	212.6	212.6	212.6	205.1	205.1	205.1	197.4	197.4	197.4	189.4	189.4	189.4	180.9	180.9	180.9	171.7	171.7	171.7	161.7	161.7	161.7		
	SHC	86.5	104.7	122.9	83.3	101.5	119.7	80.0	98.3	116.5	76.6	94.9	113.1	73.2	91.5	109.7	69.5	87.8	106.0	65.6	83.8	102.0			
	76	TC	—	229.2	229.2	—	221.0	221.0	—	212.7	212.7	—	204.2	204.2	—	195.1	195.1	—	185.3	185.3	—	174.7	174.7		
	SHC	—	89.9	108.1	—	86.7	104.9	—	83.5	101.7	—	80.1	98.4	—	76.7	95.0	—	73.1	91.4	—	69.2	87.5			
3750 CFM	EAT (wb)	58	TC	161.4	161.4	175.4	153.1	153.1	169.6	144.7	144.7	163.5	136.8	136.8	155.9	128.8	128.8	147.2	120.3	120.3	137.9	111.2	111.2	127.8	
		SHC	135.9	155.7	175.4	130.2	149.9	169.6	124.3	143.9	163.5	117.7	136.8	155.9	110.5	128.8	147.2	102.8	120.3	137.9	94.5	111.2	127.8		
		62	TC	174.9	174.9	174.9	165.8	165.8	165.8	156.7	156.7	156.7	147.3	147.3	147.3	137.4	137.4	138.2	126.8	126.8	131.8	115.6	115.6	125.2	
		SHC	121.9	141.8	161.7	116.1	136.0	155.9	110.4	130.3	150.2	104.5	124.4	144.2	98.5	118.4	138.2	92.2	112.0	131.8	85.6	105.4	125.2		
		67	TC	194.2	194.2	194.2	184.6	184.6	184.6	174.7	174.7	174.7	164.7	164.7	164.7	154.1	154.1	154.1	142.8	142.8	142.8	130.8	130.8	130.8	
	SHC	104.0	124.0	143.9	98.4	118.3	138.2	92.5	112.5	132.4	86.8	106.7	126.6	80.7	100.6	120.5	74.5	94.4	114.3	68.1	87.9	107.8			
	72	TC	215.2	215.2	215.2	204.8	204.8	204.8	194.3	194.3	194.3	183.5	183.5	183.5	172.2	172.2	172.2	160.3	160.3	160.3	147.5	147.5	147.5		
	SHC	85.6	105.8	125.9	79.9	100.0	120.1	74.2	94.3	114.4	68.3	88.4	108.5	62.4	82.5	102.5	56.4	76.3	96.3	49.9	69.9	89.9			
	76	TC	—	233.0	233.0	—	222.1	222.1	—	211.0	211.0	—	199.6	199.6	—	187.7	187.7	—	175.1	175.1	—	161.7	161.7		
	SHC	—	90.5	110.6	—	84.8	104.9	—	79.1	99.3	—	73.3	93.4	—	67.5	87.6	—	61.4	81.5	—	55.1	75.2			
4500 CFM	EAT (wb)	58	TC	172.6	172.6	195.2	164.8	164.8	186.6	156.8	156.8	177.9	148.6	148.6	169.1	139.9	139.9	159.6	130.7	130.7	149.5	120.9	120.9	138.7	
		SHC	150.0	172.6	195.2	142.8	164.8	186.6	135.6	156.8	177.9	128.1	148.6	169.1	120.3	139.9	159.6	111.9	130.7	149.5	103.1	120.9	138.7		
		62	TC	183.9	183.9	183.9	174.3	174.3	175.3	164.6	164.6	169.4	154.6	154.6	163.2	144.2	144.2	157.0	133.3	133.3	150.3	121.8	121.8	143.0	
		SHC	134.0	157.7	181.3	128.1	151.7	175.3	122.2	145.8	169.4	116.1	139.7	163.2	109.9	133.4	157.0	103.4	126.8	150.3	96.5	119.7	143.0		
		67	TC	203.5	203.5	203.5	193.1	193.1	193.1	182.6	182.6	182.6	171.8	171.8	171.8	160.6	160.6	160.6	148.7	148.7	148.7	136.1	136.1	136.1	
	SHC	112.2	136.0	159.7	106.4	130.1	153.8	100.4	124.1	147.8	94.4	118.1	141.8	88.2	111.9	135.6	81.9	105.5	129.2	75.3	98.9	122.6			
	72	TC	224.6	224.6	224.6	213.6	213.6	213.6	202.4	202.4	202.4	191.0	191.0	191.0	179.0	179.0	179.0	166.4	166.4	166.4	153.0	153.0	153.0		
	SHC	89.9	113.8	137.7	83.9	107.8	131.8	78.1	102.0	125.9	72.2	96.0	119.8	66.1	89.9	113.8	59.9	83.7	107.4	53.3	77.1	100.9			
	76	TC	—	242.8	242.8	—	231.1	231.1	—	219.3	219.3	—	207.1	207.1	—	194.5	194.5	—	181.2	181.2	—	167.1	167.1		
	SHC	—	95.5	119.5	—	89.6	113.8	—	83.8	107.9	—	77.9	102.0	—	71.9	96.0	—	65.6	89.8	—	59.3	83.5			
5250 CFM	EAT (wb)	58	TC	183.9	183.9	207.8	175.5	175.5	198.6	166.9	166.9	189.3	158.1	158.1	179.8	149.0	149.0	169.7	139.2	139.2	159.0	128.8	128.8	147.5	
		SHC	159.9	183.9	207.8	152.3	175.5	198.6	144.6	166.9	189.3	136.6	158.1	179.8	128.3	149.0	169.7	119.5	139.2	159.0	110.1	128.8	147.5		
		62	TC	190.9	190.9	199.8	180.9	180.9	193.6	170.8	170.8	187.4	160.6	160.6	181.0	150.1	150.1	174.1	139.4	139.4	165.8	129.0	129.0	154.0	
		SHC	145.2	172.5	199.8	139.1	166.3	193.6	133.0	160.2	187.4	126.8	153.9	181.0	120.3	147.2	174.1	113.1	139.4	165.8	103.9	129.0	154.0		
		67	TC	210.2	210.2	210.2	199.3	199.3	199.3	188.4	188.4	188.4	177.2	177.2	177.2	165.4	165.4	165.4	153.1	153.1	153.1	140.0	140.0	140.0	
	SHC	119.6	147.0	174.4	113.6	141.0	168.4	107.5	134.9	162.3	101.4	128.8	156.2	95.2	122.6	149.9	88.6	116.0	143.4	81.9	109.2	136.6			
	72	TC	231.6	231.6	231.6	220.1	220.1	220.1	208.4	208.4	208.4	196.4	196.4	196.4	184.0	184.0	184.0	170.8	170.8	170.8	157.0	157.0	157.0		
	SHC	93.4	121.1	148.7	87.5	115.1	142.6	81.5	109.1	136.6	75.5	103.0	130.6	69.3	96.8	124.3	62.9	90.4	117.9	56.4	83.8	111.2			
	76	TC	—	249.8	249.8	—	237.5	237.5	—	225.1	225.1	—	212.6	212.6	—	199.5	199.5	—	185.5	185.5	—	170.9	170.9		
	SHC	—	99.7	127.9	—	93.9	122.1	—	87.9	116.1	—	81.9	110.0	—	75.9	103.7	—	69.4	97.3	—	62.9	90.7			
6000 CFM	EAT (wb)	5><																							

COOLING CAPACITIES — THIRD STAGE, FULL LOAD (15 TONS) (cont)

50LC*B SIZE 17				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
6750 CFM	EAT (wb)	58	TC	201.2	201.2	227.2	192.0	192.0	217.0	182.5	182.5	206.7	172.8	172.8	196.1	162.6	162.6	185.0	152.0	152.0	173.3	140.6	140.6	160.7
			SHC	175.3	201.2	227.2	166.9	192.0	217.0	158.3	182.5	206.7	149.6	172.8	196.1	140.4	162.6	185.0	130.7	152.0	173.3	120.5	140.6	160.7
		62	TC	202.2	202.2	233.0	192.1	192.1	225.5	182.7	182.7	215.1	173.0	173.0	204.1	162.8	162.8	192.7	152.2	152.2	180.5	140.8	140.8	167.6
			SHC	165.4	199.2	233.0	158.6	192.1	225.5	150.4	182.7	215.1	142.0	173.0	204.1	133.1	162.8	192.7	123.8	152.2	180.5	114.0	140.8	167.6
		67	TC	219.4	219.4	219.4	207.9	207.9	207.9	196.4	196.4	196.4	184.5	184.5	184.5	172.3	172.3	176.7	159.4	159.4	169.8	145.8	145.8	162.7
			SHC	132.9	167.4	202.0	126.7	161.3	195.8	120.5	155.0	189.5	114.2	148.7	183.1	107.8	142.3	176.7	101.2	135.5	169.8	94.3	128.5	162.7
		72	TC	241.0	241.0	241.0	228.7	228.7	228.7	216.4	216.4	216.4	203.7	203.7	203.7	190.6	190.6	190.6	176.8	176.8	176.8	162.2	162.2	162.2
			SHC	99.5	134.3	169.0	93.4	128.1	162.8	87.3	122.0	156.6	81.1	115.7	150.3	74.8	109.4	143.9	68.3	102.8	137.3	61.5	96.0	130.5
		76	TC	—	259.3	259.3	—	246.3	246.3	—	233.3	233.3	—	220.0	220.0	—	206.1	206.1	—	191.7	191.7	—	176.1	176.1
			SHC	—	107.3	142.5	—	101.2	136.4	—	95.1	130.3	—	88.9	123.9	—	82.7	117.6	—	76.1	111.0	—	69.3	103.9
7500 CFM	EAT (wb)	58	TC	208.0	208.0	234.7	198.3	198.3	224.1	188.5	188.5	213.3	178.4	178.4	202.4	167.9	167.9	190.8	156.9	156.9	178.6	145.1	145.1	165.7
			SHC	181.3	208.0	234.7	172.5	198.3	224.1	163.6	188.5	213.3	154.5	178.4	202.4	145.1	167.9	190.8	135.1	156.9	178.6	124.5	145.1	165.7
		62	TC	208.3	208.3	243.9	198.5	198.5	233.0	188.7	188.7	221.9	178.6	178.6	210.6	168.1	168.1	198.7	157.1	157.1	186.1	145.3	145.3	172.8
			SHC	172.5	208.3	243.9	164.1	198.5	233.0	155.5	188.7	221.9	146.7	178.6	210.6	137.6	168.1	198.7	127.9	157.1	186.1	117.8	145.3	172.8
		67	TC	222.9	222.9	222.9	211.1	211.1	211.1	199.3	199.3	202.5	187.3	187.3	196.0	174.8	174.8	189.2	161.9	161.9	182.2	148.2	148.2	174.7
			SHC	139.0	177.2	215.2	132.8	170.8	208.8	126.6	164.5	202.5	120.2	158.1	196.0	113.7	151.5	189.2	107.0	144.6	182.2	99.8	137.3	174.7
		72	TC	244.4	244.4	244.4	231.9	231.9	231.9	219.2	219.2	219.2	206.3	206.3	206.3	193.0	193.0	193.0	178.9	178.9	178.9	164.1	164.1	164.1
			SHC	102.2	140.4	178.6	96.0	134.2	172.4	89.9	128.0	166.0	83.7	121.7	159.7	77.3	115.2	153.3	70.8	108.6	146.5	64.0	101.8	139.6
		76	TC	—	262.7	262.7	—	249.5	249.5	—	236.1	236.1	—	222.6	222.6	—	208.6	208.6	—	193.8	193.8	—	177.8	177.8
			SHC	—	110.6	149.4	—	104.5	143.1	—	98.4	136.9	—	92.1	130.5	—	85.8	124	—	79.3	117.3	—	72.3	110.2

LEGEND

- Do not operate
- CFM — Cubic Feet Per Minute (supply air)
- EAT (db) — Entering Air Temperature (dry bulb)
- EAT (wb) — Entering Air Temperature (wet bulb)
- SHC — Sensible Heat Capacity (1000 Btuh) Gross
- TC — Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — FIRST STAGE, PART LOAD (17.5 TONS)

50LC*B SIZE 20				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
1450 CFM	EAT (wb)	58	TC	81.1	81.1	81.1	78.8	78.8	78.8	76.1	76.1	76.1	73.3	73.3	74.4	70.2	70.2	72.6	66.9	66.9	70.7	63.3	63.3	68.6
		SHC	64.1	71.5	79.0	62.7	70.1	77.6	61.1	68.5	76.1	59.5	66.9	74.4	57.7	65.1	72.6	55.8	63.3	70.7	53.8	61.2	68.6	
		62	TC	87.4	87.4	87.4	84.9	84.9	84.9	82.2	82.2	82.2	79.2	79.2	79.2	75.9	75.9	75.9	72.3	72.3	72.3	68.4	68.4	68.4
		SHC	58.4	65.9	73.4	57.1	64.5	72.1	55.6	63.1	70.5	53.9	61.4	68.8	52.2	59.7	67.1	50.3	57.8	65.2	48.4	55.8	63.3	
		67	TC	96.0	96.0	96.0	93.4	93.4	93.4	90.5	90.5	90.5	87.3	87.3	87.3	83.8	83.8	83.8	79.9	79.9	79.9	75.8	75.8	75.8
		SHC	51.3	58.8	66.3	50.0	57.4	64.9	48.5	56.0	63.5	46.9	54.4	61.8	45.1	52.7	60.2	43.3	50.8	58.3	41.3	48.8	56.4	
		72	TC	105.7	105.7	105.7	103.0	103.0	103.0	99.8	99.8	99.8	96.3	96.3	96.3	92.5	92.5	92.5	88.3	88.3	88.3	83.9	83.9	83.9
		SHC	44.0	51.5	59.0	42.7	50.2	57.7	41.2	48.8	56.3	39.6	47.1	54.6	37.9	45.4	52.9	36.1	43.6	51.1	34.2	41.7	49.2	
		76	TC	—	114.2	114.2	—	111.2	111.2	—	107.9	107.9	—	104.2	104.2	—	100.2	100.2	—	95.7	95.7	—	91.0	91.0
		SHC	—	45.4	52.9	—	44.2	51.7	—	42.7	50.2	—	41.1	48.7	—	39.5	47.0	—	37.7	45.2	—	35.8	43.3	
1850 CFM	EAT (wb)	58	TC	88.5	88.5	93.2	85.9	85.9	91.7	83.0	83.0	90.0	79.8	79.8	88.0	76.8	76.8	84.6	73.1	73.1	82.4	69.8	69.8	78.7
		SHC	73.7	83.5	93.2	72.2	82.0	91.7	70.5	80.2	90.0	68.6	78.4	88.0	66.0	75.3	84.6	64.0	73.1	82.4	61.0	69.8	78.7	
		62	TC	95.3	95.3	95.3	92.4	92.4	92.4	89.2	89.2	89.2	85.7	85.7	85.7	81.9	81.9	81.9	77.9	77.9	77.9	73.5	73.5	75.0
		SHC	66.2	76.1	85.9	64.7	74.6	84.4	63.2	72.9	82.8	61.4	71.2	81.0	59.5	69.3	79.1	57.5	67.3	77.1	55.4	65.2	75.0	
		67	TC	104.5	104.5	104.5	101.6	101.6	101.6	98.2	98.2	98.2	94.4	94.4	94.4	90.4	90.4	90.4	85.9	85.9	85.9	81.2	81.2	81.2
		SHC	56.6	66.5	76.3	55.3	65.1	75.0	53.7	63.6	73.4	52.0	61.8	71.7	50.1	60.0	69.8	48.2	58.0	67.9	46.1	56.0	65.7	
		72	TC	114.8	114.8	114.8	111.6	111.6	111.6	108.0	108.0	108.0	104.0	104.0	104.0	99.6	99.6	99.6	94.9	94.9	94.9	89.8	89.8	89.8
		SHC	46.9	56.7	66.7	45.5	55.5	65.3	44.0	53.9	63.9	42.3	52.3	62.2	40.6	50.4	60.4	38.6	48.5	58.4	36.6	46.5	56.4	
		76	TC	—	123.6	123.6	—	120.4	120.4	—	116.6	116.6	—	112.4	112.4	—	107.7	107.7	—	102.7	102.7	—	97.1	97.1
		SHC	—	48.7	58.6	—	47.4	57.3	—	45.9	55.9	—	44.3	54.2	—	42.5	52.5	—	40.7	50.6	—	38.6	48.6	
2300 CFM	EAT (wb)	58	TC	92.0	92.0	103.9	89.2	89.2	100.7	86.1	86.1	97.3	82.8	82.8	93.6	79.2	79.2	89.6	75.4	75.4	85.3	71.3	71.3	80.8
		SHC	80.1	92.0	103.9	77.6	89.2	100.7	74.9	86.1	97.3	71.9	82.8	93.6	68.7	79.2	89.6	65.3	75.4	85.3	61.7	71.3	80.8	
		62	TC	98.7	98.7	98.7	95.2	95.2	95.2	91.3	91.3	91.4	87.1	87.1	89.1	82.5	82.5	86.7	77.7	77.7	84.0	72.6	72.6	81.3
		SHC	71.3	83.4	95.5	69.3	81.4	93.5	67.2	79.3	91.4	64.9	77.0	89.1	62.6	74.6	86.7	60.1	72.1	84.0	57.3	69.3	81.3	
		67	TC	108.5	108.5	108.5	104.8	104.8	104.8	100.7	100.7	100.7	96.1	96.1	96.1	91.4	91.4	91.4	86.1	86.1	86.1	80.5	80.5	80.5
		SHC	59.7	71.8	83.9	57.8	69.9	82.0	55.7	67.9	80.0	53.5	65.6	77.7	51.2	63.3	75.4	48.8	60.8	72.9	46.1	58.2	70.4	
		72	TC	119.3	119.3	119.3	115.5	115.5	115.5	111.2	111.2	111.2	106.4	106.4	106.4	101.1	101.1	101.1	95.6	95.6	95.6	89.6	89.6	89.6
		SHC	47.7	60.0	72.2	45.9	58.1	70.4	44.0	56.2	68.3	41.8	54.0	66.2	39.5	51.7	63.9	37.1	49.2	61.4	34.6	46.7	58.9	
		76	TC	—	128.6	128.6	—	124.8	124.8	—	120.2	120.2	—	115.1	115.1	—	109.6	109.6	—	103.6	103.6	—	97.3	97.3
		SHC	—	50.1	62.5	—	48.5	60.8	—	46.5	58.9	—	44.5	56.7	—	42.1	54.5	—	39.8	52.2	—	37.3	49.6	
2750 CFM	EAT (wb)	58	TC	98.4	98.4	111.1	95.5	95.5	107.7	92.1	92.1	104.1	88.5	88.5	100.0	84.6	84.6	95.7	80.4	80.4	91.1	76.0	76.0	86.1
		SHC	85.8	98.4	111.1	83.1	95.5	107.7	80.1	92.1	104.1	76.9	88.5	100.0	73.5	84.6	95.7	69.8	80.4	91.1	65.8	76.0	86.1	
		62	TC	102.7	102.7	106.3	99.0	99.0	104.2	95.0	95.0	102.0	90.5	90.5	99.5	85.8	85.8	96.9	80.9	80.9	93.9	76.1	76.1	89.6
		SHC	77.7	92.0	106.3	75.8	90.0	104.2	73.5	87.8	102.0	71.2	85.4	99.5	68.6	82.8	96.9	65.9	80.0	93.9	62.5	76.1	89.6	
		67	TC	112.5	112.5	112.5	108.7	108.7	108.7	104.3	104.3	104.3	99.5	99.5	99.5	94.4	94.4	94.4	88.8	88.8	88.8	83.1	83.1	83.1
		SHC	63.9	78.2	92.6	62.0	76.3	90.7	59.9	74.2	88.6	57.6	72.0	86.3	55.3	69.6	83.9	52.7	67.1	81.4	50.1	64.4	78.8	
		72	TC	123.5	123.5	123.5	119.6	119.6	119.6	115.1	115.1	115.1	109.9	109.9	109.9	104.4	104.4	104.4	98.5	98.5	98.5	92.2	92.2	92.2
		SHC	49.7	64.2	78.6	47.9	62.4	76.8	45.9	60.4	74.8	43.7	58.1	72.5	41.3	55.8	70.2	38.9	53.3	67.7	36.4	50.7	65.1	
		76	TC	—	133.0	133.0	—	129.0	129.0	—	124.1	124.1	—	118.8	118.8	—	112.9	112.9	—	106.7	106.7	—	99.9	99.9
		SHC	—	52.7	67.4	—	51.0	65.7	—	49.0	63.8	—	46.8	61.5	—	44.5	59.2	—	42.1	56.6	—	39.5	54.1	
3250 CFM	EAT (wb)	58	TC	104.2	104.2	117.6	101.1	101.1	114.1	97.5	97.5	110.2	93.7	93.7	105.9	89.5	89.5	101.2	85.0	85.0	96.2	80.2	80.2	90.9
		SHC	90.9	104.2	117.6	88.0	101.1	114.1	84.9	97.5	110.2	81.4	93.7	105.9	77.8	89.5	101.2	73.8	85.0	96.2	69.6	80.2	90.9	
		62	TC	106.2	106.2	117.4	102.5	102.5	115.1	98.3	98.3	112.6	94.0	94.0	109.6	89.6	89.6	105.2	85.1	85.1	100.0	80.3	80.3	94.6
		SHC	84.3	100.8	117.4	82.3	98.8	115.1	80.0	96.3	112.6	77.2	93.4	109.6	73.9	89.6	105.2	70.1	85.1	100.0	66.1	80.3	94.6	
		67	TC	115.7	115.7	115.7	111.8	111.8	111.8	107.3	107.3	107.3	102.3	102.3	102.3	96.9	96.9	96.9	91.2	91.2	91.2	85.1	85.1	87.6
		SHC	68.3	84.9	101.7	66.3	83.1	99.8	64.2	80.9	97.7	61.9	78.6	95.4	59.5	76.1	92.9	56.9	73.6	90.3	54.2	70.9	87.6	
		72	TC	126.8	126.8	126.8	122.9	122.9	122.9	118.1	118.1	118.1	112.8	112.8	112.8	107.1	107.1	107.1	100.9	100.9	100.9	94.3	94.3	94.3
		SHC	51.6	68.4	85.3	49.8	66.7	83.6	47.8	64.6	81.4	45.6	62.4	79.2	43.2	60.0	76.7	40.8	57.5	74.2	38.1	54.9	71.6	
		76	TC	—	136.4	136.4	—	132.3	132.3	—	127.3	127.3	—	121.7	121.7	—	115.5	115.5	—	109.1	109.1	—	102.1	102.1
		SHC	—	55.1	72.2	—	53.3	70.5	—	51.4	68.4	—	49.1	66.2	—	46.8	63.8	—	44.4	61.2	—	41.7	58.6	
3700 CFM	EAT (wb)	58	TC	108.6	108.6	122.5	105.3	105.3	118.9	101.6	101.6	114.7	97.5	97.5	110.2	93.1	93.1	105.3	88.4	88.4	100.0	83.4	83.4	94.4
		SHC	94.7	108.6	122.5	91.7	105.3	118.9	88.4	101.6	114.7	84.8	97.5	110.2	80.9	93.1	105.3	76.7	88.4	100.0	72.3	83.4	94.4	
		62	TC	109.1	109.1	126.2	105.4	105.4	123.5	101.7	101.7	119.1	97.6	97.6	111.5	93.2	93.2	109.5	88.4	88.4	104.0	83.5	83.5	98.2
		SHC	89.6	107.8	126.2	87.3	105.4	123.5	84.1	101.7	119.1	80.6	97.6	114.5	76.9	93.2	109.5	72.9	88.4	104.0	68.7	83.5	98.2	
		67	TC	118.0	118.0	118.0	113.9	113.9	113.9	109.3	109.3	109.3	104.1	104.1	104.1	98.7	98.7	100.5	92.8	92.8	97.8	86.6	86.6	95.0
		SHC	71.9	90.7	109.6	70.0	88.8	107.6	67.9	86.7	105.5	65.5	84.3	103.1	63.1	81.8	100.5	60.5	79.1	97.8	57.7	76.3	95.0	
		72	TC	129.1	129.1	129.1	125.1	125.1	125.1	120.2	120.2	120.2	114.7	114.7	114.7	108.8	108.8	108.8	102.5	102.5	102.5	95.7	95.7	95.7
		SHC	53.2	72.2	91.1	51.4	70.3	89.2	49.3	68.3	87.2	47.1	66.0	84.8	44.8	63.6	82.4	42.2	61.0	79.9	39.6	58.4	77.1	

COOLING CAPACITIES — FIRST STAGE, PART LOAD (17.5 TONS) (cont)

50LC*B SIZE 20				AMBIENT TEMPERATURE (°F)																					
				65			75			85			95			105			115			125			
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	
4150 CFM	EAT (wb)	58	TC	112.2	112.2	126.7	108.8	108.8	122.9	105.0	105.0	118.6	100.7	100.7	113.8	96.1	96.1	108.7	91.3	91.3	103.3	86.0	86.0	97.4	
			SHC	97.9	112.2	126.7	94.9	108.8	122.9	91.5	105.0	118.6	87.7	100.7	113.8	83.7	96.1	108.7	79.3	91.3	103.3	74.7	86.0	97.4	
		62	TC	112.4	112.4	131.5	109.0	109.0	127.6	105.1	105.1	123.1	100.8	100.8	118.3	96.2	96.2	113.0	91.4	91.4	107.3	86.1	86.1	101.3	
			SHC	93.2	112.4	131.5	90.3	109.0	127.6	87.0	105.1	123.1	83.4	100.8	118.3	79.6	96.2	113.0	75.4	91.4	107.3	71.0	86.1	101.3	
		67	TC	119.7	119.7	119.7	115.6	115.6	115.6	111.0	111.0	112.9	105.7	105.7	110.5	100.1	100.1	107.8	94.2	94.2	105.0	87.9	87.9	102.0	
			SHC	75.4	96.2	117.1	73.4	94.3	115.1	71.3	92.1	112.9	68.9	89.7	110.5	66.4	87.2	107.8	63.8	84.3	105.0	60.9	81.4	102.0	
	72	TC	130.9	130.9	130.9	126.8	126.8	126.8	121.8	121.8	121.8	116.2	116.2	116.2	110.2	110.2	110.2	103.7	103.7	103.7	96.8	96.8	96.8		
		SHC	54.6	75.6	96.5	52.8	73.8	94.8	50.8	71.8	92.6	48.6	69.4	90.3	46.1	67.0	87.8	43.6	64.4	85.2	41.0	61.7	82.5		
	76	TC	—	140.8	140.8	—	136.4	136.4	—	131.1	131.1	—	125.2	125.2	—	118.8	118.8	—	111.9	111.9	—	104.6	104.6		
		SHC	—	59.0	80.1	—	57.2	78.4	—	55.2	76.2	—	52.9	73.9	—	50.5	71.5	—	48.0	68.8	—	45.2	66.1		
	4600 CFM	EAT (wb)	58	TC	115.4	115.4	130.2	111.9	111.9	126.3	107.9	107.9	121.9	103.5	103.5	117.0	98.8	98.8	111.6	93.7	93.7	106.0	88.3	88.3	99.9
				SHC	100.6	115.4	130.2	97.6	111.9	126.3	94.0	107.9	121.9	90.2	103.5	117.0	85.9	98.8	111.6	81.4	93.7	106.0	76.6	88.3	99.9
62			TC	115.5	115.5	135.2	112.0	112.0	131.2	108.0	108.0	126.7	103.6	103.6	121.6	98.9	98.9	116.0	93.8	93.8	110.2	88.3	88.3	103.9	
			SHC	95.8	115.5	135.2	92.8	112.0	131.2	89.5	108.0	126.7	85.7	103.6	121.6	81.7	98.9	116.0	77.4	93.8	110.2	72.8	88.3	103.9	
67			TC	121.2	121.2	124.3	117.1	117.1	122.3	112.3	112.3	120.0	107.1	107.1	117.5	101.4	101.4	114.7	95.5	95.5	111.7	89.2	89.2	108.2	
			SHC	78.7	101.5	124.3	76.7	99.5	122.3	74.6	97.3	120.0	72.2	94.9	117.5	69.6	92.1	114.7	66.9	89.3	111.7	63.9	86.1	108.2	
72		TC	132.3	132.3	132.3	128.2	128.2	128.2	123.1	123.1	123.1	117.4	117.4	117.4	111.2	111.2	111.2	104.7	104.7	104.7	97.7	97.7	97.7		
		SHC	56.1	78.9	101.8	54.3	77.1	100.0	52.2	75.1	97.9	49.9	72.7	95.6	47.5	70.2	93.0	44.9	67.7	90.4	42.2	64.9	87.6		
76		TC	—	142.3	142.3	—	137.9	137.9	—	132.5	132.5	—	126.5	126.5	—	119.9	119.9	—	112.9	112.9	—	105.5	105.5		
		SHC	—	60.7	83.9	—	59.0	82.0	—	56.9	80.0	—	54.6	77.5	—	52.2	75.0	—	49.6	72.3	—	46.9	69.5		

LEGEND

—	Do not operate
CFM	Cubic Feet Per Minute (supply air)
EAT (db)	Entering Air Temperature (dry bulb)
EAT (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — SECOND STAGE, PART LOAD (17.5 TONS)

50LC*B SIZE 20				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
1600 CFM	EAT (wb)	58	TC	90.2	90.2	90.2	86.7	86.7	86.7	83.5	83.5	84.6	80.1	80.1	82.8	76.8	76.8	80.8	73.1	73.1	78.8	69.0	69.0	76.4
		SHC	71.5	80.0	88.5	69.4	78.0	86.5	67.6	76.1	84.6	65.7	74.2	82.8	63.9	72.3	80.8	61.8	70.3	78.8	59.5	68.0	76.4	
		62	TC	97.7	97.7	97.7	93.9	93.9	93.9	90.3	90.3	90.3	86.8	86.8	86.8	83.1	83.1	83.1	79.2	79.2	79.2	74.8	74.8	74.8
		SHC	65.4	73.9	82.5	63.3	71.9	80.3	61.3	69.9	78.5	59.5	68.1	76.5	57.5	66.1	74.7	55.6	64.1	72.6	53.3	61.8	70.4	
		67	TC	108.1	108.1	108.1	103.8	103.8	103.8	99.8	99.8	99.8	95.8	95.8	95.8	91.8	91.8	91.8	87.6	87.6	87.6	82.9	82.9	82.9
	SHC	57.6	66.2	74.8	55.5	64.0	72.5	53.4	62.0	70.6	51.5	60.1	68.6	49.5	58.1	66.7	47.6	56.1	64.6	45.3	53.9	62.5		
	72	TC	119.7	119.7	119.7	115.0	115.0	115.0	110.4	110.4	110.4	106.0	106.0	106.0	101.6	101.6	101.6	96.8	96.8	96.8	91.7	91.7	91.7	
	SHC	49.5	58.1	66.7	47.3	55.9	64.4	45.2	53.8	62.4	43.3	51.9	60.5	41.3	49.9	58.5	39.3	47.9	56.5	37.1	45.7	54.3		
	76	TC	—	130.0	130.0	—	124.6	124.6	—	119.6	119.6	—	114.9	114.9	—	110.0	110.0	—	104.9	104.9	—	99.5	99.5	
	SHC	—	51.5	60.1	—	49.2	57.8	—	47.1	55.7	—	45.1	53.7	—	43.2	51.8	—	41.1	49.7	—	39.0	47.6		
2150 CFM	EAT (wb)	58	TC	99.5	99.5	106.1	95.3	95.3	103.6	91.5	91.5	101.4	88.4	88.4	97.3	84.5	84.5	95.3	81.1	81.1	91.5	77.3	77.3	87.1
		SHC	83.5	94.8	106.1	81.1	92.3	103.6	78.9	90.1	101.4	75.9	86.6	97.3	73.8	84.5	95.3	70.8	81.1	91.5	67.5	77.3	87.1	
		62	TC	107.4	107.4	107.4	102.8	102.8	102.8	98.5	98.5	98.5	94.2	94.2	94.2	89.9	89.9	89.9	85.4	85.4	86.9	80.4	80.4	84.4
		SHC	75.1	86.5	97.9	72.6	84.0	95.5	70.5	81.9	93.3	68.4	79.8	91.2	66.3	77.7	89.0	64.2	75.5	86.9	61.7	73.1	84.4	
		67	TC	118.8	118.8	118.8	113.5	113.5	113.5	108.6	108.6	108.6	103.9	103.9	103.9	99.2	99.2	99.2	94.2	94.2	94.2	88.8	88.8	88.8
	SHC	64.4	75.8	87.3	61.9	73.3	84.7	59.7	71.1	82.5	57.5	68.9	80.3	55.5	66.9	78.3	53.2	64.6	76.1	50.9	62.3	73.7		
	72	TC	131.3	131.3	131.3	125.4	125.4	125.4	119.9	119.9	119.9	114.7	114.7	114.7	109.4	109.4	109.4	103.9	103.9	103.9	98.1	98.1	98.1	
	SHC	53.3	64.8	76.3	50.8	62.4	73.9	48.6	60.1	71.6	46.4	57.9	69.4	44.3	55.8	67.3	42.1	53.6	65.1	39.9	51.3	62.8		
	76	TC	—	142.2	142.2	—	135.7	135.7	—	129.7	129.7	—	123.9	123.9	—	118.2	118.2	—	112.3	112.3	—	106.0	106.0	
	SHC	—	55.8	67.3	—	53.2	64.7	—	50.9	62.4	—	48.8	60.3	—	46.6	58.1	—	44.5	56.0	—	42.2	53.7		
2700 CFM	EAT (wb)	58	TC	104.3	104.3	117.9	99.4	99.4	112.4	94.7	94.7	107.3	90.0	90.0	102.2	85.3	85.3	97.0	80.4	80.4	91.7	75.2	75.2	85.8
		SHC	90.7	104.3	117.9	86.3	99.4	112.4	82.0	94.7	107.3	77.9	90.0	102.2	73.6	85.3	97.0	69.2	80.4	91.7	64.4	75.2	85.8	
		62	TC	111.9	111.9	111.9	105.5	105.5	105.9	99.5	99.5	102.5	93.8	93.8	99.1	88.0	88.0	95.6	82.1	82.1	92.1	75.9	75.9	88.2
		SHC	81.3	95.5	109.6	77.6	91.7	105.9	74.2	88.3	102.5	70.9	84.9	99.1	67.6	81.6	95.6	64.2	78.1	92.1	60.5	74.4	88.2	
		67	TC	124.2	124.2	124.2	117.2	117.2	117.2	110.6	110.6	110.6	104.2	104.2	104.2	97.9	97.9	97.9	91.4	91.4	91.4	84.4	84.4	84.4
	SHC	68.3	82.6	96.7	64.6	78.9	93.0	61.2	75.4	89.6	57.8	72.1	86.2	54.5	68.7	82.9	51.2	65.3	79.6	47.7	61.9	76.1		
	72	TC	137.8	137.8	137.8	130.1	130.1	130.1	122.9	122.9	122.9	115.9	115.9	115.9	109.0	109.0	109.0	102.0	102.0	102.0	94.5	94.5	94.5	
	SHC	55.1	69.4	83.8	51.4	65.6	80.0	47.9	62.2	76.4	44.6	58.8	73.0	41.2	55.5	69.7	37.8	52.2	66.4	34.4	48.7	62.9		
	76	TC	—	149.4	149.4	—	141.2	141.2	—	133.4	133.4	—	125.9	125.9	—	118.4	118.4	—	110.9	110.9	—	103.0	103.0	
	SHC	—	58.5	72.9	—	54.8	69.2	—	51.3	65.7	—	47.9	62.4	—	44.6	59.1	—	41.2	55.8	—	37.8	52.3		
3250 CFM	EAT (wb)	58	TC	112.5	112.5	127.0	107.0	107.0	121.0	101.8	101.8	115.2	96.7	96.7	109.7	91.7	91.7	104.0	86.3	86.3	98.2	80.5	80.5	91.8
		SHC	97.9	112.5	127.0	93.0	107.0	121.0	88.3	101.8	115.2	83.8	96.7	109.7	79.2	91.7	104.0	74.4	86.3	98.2	69.2	80.5	91.8	
		62	TC	117.0	117.0	122.9	110.3	110.3	119.0	103.9	103.9	115.2	97.9	97.9	111.5	92.0	92.0	107.5	86.4	86.4	102.3	80.6	80.6	95.7
		SHC	89.3	106.1	122.9	85.5	102.2	119.0	81.9	98.6	115.2	78.4	95.0	111.5	74.7	91.2	107.5	70.5	86.4	102.3	65.5	80.6	95.7	
		67	TC	129.4	129.4	129.4	121.8	121.8	121.8	114.8	114.8	114.8	108.0	108.0	108.0	101.3	101.3	101.3	94.4	94.4	94.4	87.2	87.2	87.2
	SHC	73.7	90.6	107.4	69.8	86.8	103.6	66.3	83.2	100.0	62.8	79.7	96.6	59.5	76.3	93.2	56.0	72.8	89.7	52.5	69.2	86.1		
	72	TC	143.2	143.2	143.2	134.9	134.9	134.9	127.2	127.2	127.2	119.8	119.8	119.8	112.5	112.5	112.5	105.1	105.1	105.1	97.3	97.3	97.3	
	SHC	57.6	74.7	91.7	53.8	70.9	87.8	50.2	67.2	84.2	46.8	63.8	80.7	43.4	60.4	77.3	40.0	56.9	73.8	36.5	53.3	70.3		
	76	TC	—	154.9	154.9	—	146.2	146.2	—	137.8	137.8	—	129.8	129.8	—	122	122	—	114.1	114.1	—	105.7	105.7	
	SHC	—	61.6	79.1	—	57.8	75.3	—	54.2	71.6	—	50.7	68.0	—	47.3	64.5	—	43.9	61.0	—	40.4	57.4		
3800 CFM	EAT (wb)	58	TC	119.1	119.1	134.6	113.2	113.2	128.0	107.6	107.6	121.8	102.1	102.1	115.7	96.6	96.6	109.7	91.0	91.0	103.4	84.9	84.9	96.7
		SHC	103.8	119.1	134.6	98.5	113.2	128.0	93.4	107.6	121.8	88.5	102.1	115.7	83.6	96.6	109.7	78.5	91.0	103.4	73.0	84.9	96.7	
		62	TC	121.2	121.2	135.0	114.3	114.3	130.7	107.9	107.9	126.2	102.3	102.3	120.4	96.7	96.7	114.2	91.1	91.1	107.7	85.0	85.0	100.8
		SHC	96.6	115.8	135.0	92.5	111.5	130.7	88.5	107.3	126.2	84.0	102.3	120.4	79.3	96.7	114.2	74.4	91.1	107.7	69.2	85.0	100.8	
		67	TC	133.1	133.1	133.1	125.2	125.2	125.2	117.8	117.8	117.8	110.8	110.8	110.8	103.7	103.7	103.7	96.6	96.6	99.3	89.2	89.2	95.5
	SHC	78.5	98.0	117.6	74.6	94.1	113.6	71.0	90.5	109.9	67.5	86.9	106.4	64.0	83.4	102.9	60.5	79.9	99.3	56.8	76.1	95.5		
	72	TC	147.1	147.1	147.1	138.5	138.5	138.5	130.5	130.5	130.5	122.7	122.7	122.7	115.1	115.1	115.1	107.3	107.3	107.3	99.3	99.3	99.3	
	SHC	59.9	79.5	99.1	56.0	75.6	95.2	52.4	71.9	91.5	48.8	68.3	87.8	45.3	64.8	84.3	41.9	61.3	80.8	38.3	57.7	77.2		
	76	TC	—	159.0	159.0	—	149.8	149.8	—	141.0	141.0	—	132.7	132.7	—	124.5	124.5	—	116.2	116.2	—	107.6	107.6	
	SHC	—	64.4	84.4	—	60.5	80.4	—	56.7	76.6	—	53.2	73.0	—	49.7	69.4	—	46.2	65.9	—	42.7	62.2		
4300 CFM	EAT (wb)	58	TC	124.3	124.3	140.3	118.0	118.0	133.3	112.0	112.0	126.7	106.2	106.2	120.3	100.4	100.4	114.0	94.5	94.5	107.3	88.1	88.1	100.3
		SHC	108.3	124.3	140.3	102.7	118.0	133.3	97.3	112.0	126.7	92.1	106.2	120.3	87.0	100.4	114.0	81.6	94.5	107.3	76.0	88.1	100.3	
		62	TC	124.8	124.8	144.6	118.1	118.1	138.5	112.1	112.1	131.7	106.3	106.3	125.2	100.5	100.5	118.6	94.6	94.6	111.7	88.2	88.2	104.5
		SHC	102.5	123.5	144.6	97.6	118.1	138.5	92.4	112.1	131.7	87.5	106.3	125.2	82.5	100.5	118.6	77.3	94.6	111.7	72.0	88.2	104.5	
		67	TC	135.7	135.7	135.7	127.6	127.6	127.6	120.0	120.0	120.0	112.7	112.7	114.8	105.6	105.6	111.2	98.4	98.4	107.4	90.8	90.8	103.5
	SHC	82.7	104.4	126.3	78.7	100.4	122.3	75.0	96.7	118.5	71.4	93.1												

COOLING CAPACITIES — SECOND STAGE, PART LOAD (17.5 TONS) (cont)

50LC*B SIZE 20				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
4850 CFM	EAT (wb)	58	TC	129.1	129.1	145.7	122.4	122.4	138.3	116.1	116.1	131.3	110.0	110.0	124.6	103.9	103.9	117.9	97.7	97.7	111.0	91.1	91.1	103.6
			SHC	112.5	129.1	145.7	106.6	122.4	138.3	100.9	116.1	131.3	95.5	110.0	124.6	90.0	103.9	117.9	84.4	97.7	111.0	78.6	91.1	103.6
		62	TC	129.2	129.2	151.3	122.6	122.6	143.7	116.2	116.2	136.5	110.1	110.1	129.6	104.0	104.0	122.7	97.8	97.8	115.5	91.2	91.2	107.9
			SHC	107.1	129.2	151.3	101.3	122.6	143.7	95.9	116.2	136.5	90.7	110.1	129.6	85.4	104.0	122.7	80.0	97.8	115.5	74.4	91.2	107.9
		67	TC	138.2	138.2	138.2	129.8	129.8	131.3	122.0	122.0	127.4	114.6	114.6	123.6	107.3	107.3	119.8	99.9	99.9	115.9	92.3	92.3	111.6
			SHC	87.0	111.2	135.4	82.9	107.1	131.3	79.1	103.3	127.4	75.5	99.5	123.6	71.9	95.8	119.8	68.2	92.0	115.9	64.4	87.9	111.6
		72	TC	152.3	152.3	152.3	143.1	143.1	143.1	134.6	134.6	134.6	126.4	126.4	126.4	118.3	118.3	118.3	110.3	110.3	110.3	101.8	101.8	101.8
			SHC	63.6	87.8	112.1	59.6	83.9	108.1	55.8	80.0	104.2	52.2	76.3	100.5	48.7	72.7	96.9	45.0	69.2	93.3	41.4	65.4	89.5
		76	TC	—	164.3	164.3	—	154.4	154.4	—	145.2	145.2	—	136.3	136.3	—	127.7	127.7	—	119.0	119.0	—	110.1	110.1
			SHC	—	68.9	93.6	—	64.9	89.5	—	61.1	85.5	—	57.4	81.7	—	53.8	78.0	—	50.2	74.3	—	46.5	70.4
5400 CFM	EAT (wb)	58	TC	133.2	133.2	150.2	126.2	126.2	142.4	119.6	119.6	135.2	113.2	113.2	128.2	107.0	107.0	121.2	100.4	100.4	114.1	93.6	93.6	106.5
			SHC	116.1	133.2	150.2	109.9	126.2	142.4	103.9	119.6	135.2	98.3	113.2	128.2	92.6	107.0	121.2	86.9	100.4	114.1	80.7	93.6	106.5
		62	TC	133.3	133.3	156.1	126.3	126.3	148.1	119.7	119.7	140.6	113.3	113.3	133.3	107.1	107.1	126.1	100.5	100.5	118.7	93.7	93.7	110.9
			SHC	110.5	133.3	156.1	104.5	126.3	148.1	98.9	119.7	140.6	93.4	113.3	133.3	87.9	107.1	126.1	82.4	100.5	118.7	76.5	93.7	110.9
		67	TC	140.1	140.1	144.2	131.6	131.6	139.9	123.7	123.7	135.8	116.2	116.2	131.8	108.8	108.8	127.9	101.5	101.5	123.5	94.1	94.1	118.1
			SHC	91.0	117.6	144.2	86.9	113.4	139.9	83.1	109.5	135.8	79.3	105.6	131.8	75.6	101.8	127.9	71.8	97.7	123.5	67.5	92.7	118.1
		72	TC	154.1	154.1	154.1	144.8	144.8	144.8	136.0	136.0	136.0	127.7	127.7	127.7	119.5	119.5	119.5	111.3	111.3	111.3	102.8	102.8	102.8
			SHC	65.2	91.8	118.6	61.2	87.8	114.5	57.4	83.9	110.6	53.7	80.2	106.8	50.2	76.6	103.1	46.6	73.0	99.4	42.9	69.2	95.6
		76	TC	—	166.2	166.2	—	156.2	156.2	—	146.6	146.6	—	137.7	137.7	—	128.9	128.9	—	120.0	120.0	—	111.0	111.0
			SHC	—	71.1	98.0	—	67.0	93.8	—	63.1	89.8	—	59.4	86.0	—	55.8	82.2	—	52.1	78.3	—	48.4	74.4

LEGEND

—	Do not operate
CFM	Cubic Feet Per Minute (supply air)
EAT (db)	Entering Air Temperature (dry bulb)
EAT (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — THIRD STAGE, FULL LOAD (17.5 TONS)

50LC*B SIZE 20				AMBIENT TEMPERATURE (°F)																					
				65			75			85			95			105			115			125			
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	
3500 CFM	EAT (wb)	58	TC	176.5	176.5	180.7	170.6	170.6	177.3	164.5	164.5	173.7	158.0	158.0	170.1	151.3	151.3	166.1	145.2	145.2	159.4	137.3	137.3	154.6	
			SHC	143.8	162.2	180.7	140.5	158.9	177.3	137.1	155.4	173.7	133.5	151.8	170.1	129.6	147.9	166.1	124.3	141.9	159.4	119.8	137.3	154.6	
		62	TC	189.4	189.4	189.4	183.1	183.1	183.1	176.5	176.5	176.5	169.6	169.6	169.6	162.1	162.1	162.1	154.1	154.1	154.1	145.5	145.5	145.5	
			SHC	129.7	148.1	166.5	126.3	144.8	163.2	122.9	141.3	159.8	119.3	137.8	156.2	115.5	134.0	152.5	111.6	130.1	148.5	107.3	125.8	144.2	
		67	TC	207.8	207.8	207.8	200.9	200.9	200.9	193.5	193.5	193.5	186.0	186.0	186.0	178.0	178.0	178.0	169.4	169.4	169.4	160.1	160.1	160.1	
			SHC	111.6	130.2	148.7	108.2	126.8	145.3	104.8	123.3	141.9	101.3	119.8	138.3	97.6	116.1	134.6	93.7	112.2	130.7	89.5	108.0	126.6	
		72	TC	227.4	227.4	227.4	219.9	219.9	219.9	212.1	212.1	212.1	203.9	203.9	203.9	195.2	195.2	195.2	185.8	185.8	185.8	175.9	175.9	175.9	
			SHC	92.7	111.4	130.3	89.4	108.2	126.9	86.1	104.8	123.5	82.6	101.3	120.0	79.0	97.7	116.4	75.2	93.9	112.5	71.2	89.9	108.5	
		76	TC	—	244.1	244.1	—	236.1	236.1	—	227.9	227.9	—	219.2	219.2	—	209.8	209.8	—	199.9	199.9	—	189.3	189.3	
			SHC	—	95.8	114.7	—	92.6	111.3	—	89.3	108.1	—	86.0	104.7	—	82.4	101.2	—	78.7	97.4	—	74.8	93.6	
3950 CFM	EAT (wb)	58	TC	182.8	182.8	194.0	176.7	176.7	190.4	170.3	170.3	186.6	165.8	165.8	178.2	159.4	159.4	172.3	150.7	150.7	169.9	143.7	143.7	161.9	
			SHC	152.8	173.4	194.0	149.3	169.8	190.4	145.7	166.1	186.6	139.8	159.0	178.2	134.9	153.7	172.3	131.6	150.7	169.9	125.5	143.7	161.9	
		62	TC	195.8	195.8	195.8	189.0	189.0	189.0	182.0	182.0	182.0	174.7	174.7	174.7	178.2	166.9	166.9	166.9	158.5	158.5	159.5	149.6	149.6	155.1
			SHC	136.7	157.4	178.1	133.2	154.0	174.6	129.7	150.4	171.1	126.1	146.7	167.4	122.3	142.9	163.6	118.2	138.8	159.5	113.9	134.5	155.1	
		67	TC	214.3	214.3	214.3	206.9	206.9	206.9	199.2	199.2	199.2	191.3	191.3	191.3	182.7	182.7	182.7	173.7	173.7	173.7	163.9	163.9	163.9	
			SHC	116.2	137.1	157.9	112.8	133.6	154.3	109.3	130.1	150.8	105.7	126.5	147.2	101.9	122.7	143.4	97.9	118.7	139.4	93.7	114.5	135.1	
		72	TC	234.1	234.1	234.1	226.1	226.1	226.1	217.9	217.9	217.9	209.3	209.3	209.3	200.2	200.2	200.2	190.3	190.3	190.3	180.0	180.0	180.0	
			SHC	95.0	116.0	137.1	91.7	112.6	133.7	88.2	109.2	130.3	84.7	105.7	126.7	81.0	102.0	122.9	77.1	98.1	119.0	73.1	94.0	114.9	
		76	TC	—	251.2	251.2	—	242.7	242.7	—	233.9	233.9	—	224.8	224.8	—	214.8	214.8	—	204.5	204.5	—	193.6	193.6	
			SHC	—	98.5	119.7	—	95.3	116.4	—	91.9	113.1	—	88.4	109.7	—	84.8	106.0	—	81.0	102.2	—	77.1	98.3	
4400 CFM	EAT (wb)	58	TC	182.5	182.5	200.4	173.8	173.8	194.0	165.1	165.1	187.4	157.0	157.0	178.6	148.4	148.4	169.2	139.3	139.3	159.3	129.8	129.8	148.7	
			SHC	155.0	177.6	200.4	148.9	171.5	194.0	142.6	165.1	187.4	135.3	157.0	178.6	127.5	148.4	169.2	119.3	139.3	159.3	110.8	129.8	148.7	
		62	TC	196.1	196.1	196.1	186.5	186.5	186.5	176.9	176.9	176.9	166.8	166.8	166.8	156.4	156.4	159.6	145.4	145.4	153.1	133.9	133.9	146.2	
			SHC	138.2	161.1	184.0	132.2	155.1	178.0	126.3	149.2	172.1	120.1	143.0	165.9	113.9	136.8	159.6	107.3	130.2	153.1	100.6	123.3	146.2	
		67	TC	216.0	216.0	216.0	205.8	205.8	205.8	195.4	195.4	195.4	184.7	184.7	184.7	173.5	173.5	173.5	161.7	161.7	161.7	149.3	149.3	149.3	
			SHC	116.6	139.6	162.6	110.8	133.8	156.8	104.8	127.8	150.7	98.8	121.8	144.7	92.5	115.5	138.5	86.1	109.1	132.0	79.6	102.5	125.4	
		72	TC	237.3	237.3	237.3	226.6	226.6	226.6	215.7	215.7	215.7	204.4	204.4	204.4	192.4	192.4	192.4	179.8	179.8	179.8	166.7	166.7	166.7	
			SHC	94.5	117.8	141.0	88.7	111.9	135.1	82.9	106.1	129.3	76.9	100.1	123.2	70.8	93.9	117.1	64.4	87.6	110.7	58.0	81.1	104.2	
		76	TC	—	255.6	255.6	—	244.4	244.4	—	232.9	232.9	—	221.0	221.0	—	208.2	208.2	—	195.1	195.1	—	181.5	181.5	
			SHC	—	99.5	123.1	—	93.8	117.4	—	88.0	111.6	—	82.2	105.8	—	76.1	99.7	—	69.9	93.5	—	63.7	87.3	
5250 CFM	EAT (wb)	58	TC	194.2	194.2	219.6	185.8	185.8	210.5	177.4	177.4	201.2	168.6	168.6	191.6	159.3	159.3	181.4	149.7	149.7	170.8	139.3	139.3	159.4	
			SHC	168.9	194.2	219.6	161.3	185.8	210.5	153.6	177.4	201.2	145.6	168.6	191.6	137.2	159.3	181.4	128.5	149.7	170.8	119.1	139.3	159.4	
		62	TC	204.6	204.6	204.6	194.5	194.5	198.3	184.4	184.4	192.2	173.9	173.9	185.7	163.0	163.0	179.1	151.7	151.7	172.2	140.0	140.0	164.5	
			SHC	150.6	177.5	204.6	144.4	171.4	198.3	138.4	165.3	192.2	132.0	158.9	185.7	125.6	152.4	179.1	118.9	145.5	172.2	111.7	138.1	164.5	
		67	TC	224.3	224.3	224.3	213.6	213.6	213.6	202.7	202.7	202.7	191.4	191.4	191.4	179.6	179.6	179.6	167.2	167.2	167.2	154.2	154.2	154.2	
			SHC	124.8	151.8	178.9	118.8	145.9	172.9	112.7	139.7	166.8	106.5	133.6	160.6	100.2	127.2	154.2	93.6	120.6	147.6	87.0	113.9	140.9	
		72	TC	246.0	246.0	246.0	234.7	234.7	234.7	223.1	223.1	223.1	211.2	211.2	211.2	198.6	198.6	198.6	185.4	185.4	185.4	171.8	171.8	171.8	
			SHC	98.5	125.8	153.1	92.5	119.8	147.1	86.6	113.9	141.1	80.5	107.7	135.0	74.3	101.5	128.7	67.9	95.1	122.2	61.3	88.4	115.5	
		76	TC	—	264.4	264.4	—	252.6	252.6	—	240.5	240.5	—	228.1	228.1	—	215.0	215.0	—	200.9	200.9	—	186.7	186.7	
			SHC	—	104.4	132.6	—	98.7	126.8	—	92.8	121.0	—	86.9	115.0	—	80.7	108.7	—	74.3	102.1	—	67.8	95.6	
6150 CFM	EAT (wb)	58	TC	205.8	205.8	232.5	197.0	197.0	222.9	187.8	187.8	212.8	178.4	178.4	202.6	168.6	168.6	191.8	158.2	158.2	180.5	147.4	147.4	168.5	
			SHC	179.0	205.8	232.5	171.0	197.0	222.9	162.7	187.8	212.8	154.2	178.4	202.6	145.4	168.6	191.8	136.1	158.2	180.5	126.4	147.4	168.5	
		62	TC	211.7	211.7	224.8	201.3	201.3	218.4	190.8	190.8	211.8	180.2	180.2	205.0	169.3	169.3	197.5	158.5	158.5	188.2	147.6	147.6	175.7	
			SHC	162.7	193.8	224.8	156.5	187.5	218.4	150.1	181.0	211.8	143.6	174.3	205.0	136.7	167.1	197.5	128.9	158.5	188.2	119.4	147.6	175.7	
		67	TC	230.7	230.7	230.7	219.6	219.6	219.6	208.3	208.3	208.3	196.5	196.5	196.5	184.3	184.3	184.3	171.5	171.5	171.5	158.2	158.2	158.2	
			SHC	132.6	163.8	195.1	126.5	157.7	189.0	120.3	151.5	182.7	114.1	145.3	176.5	107.6	138.8	170.0	101.0	132.1	163.3	94.2	125.3	156.4	
		72	TC	252.6	252.6	252.6	240.8	240.8	240.8	228.8	228.8	228.8	216.5	216.5	216.5	203.3	203.3	203.3	189.8	189.8	189.8	175.8	175.8	175.8	
			SHC	102.1	133.5	165.0	96.0	127.5	158.9	90.1	121.5	152.9	83.9	115.2	146.6	77.5	108.8	140.2	71.1	102.4	133.6	64.4	95.6	126.8	
		76	TC	—	271.2	271.2	—	259.0	259.0	—	246.4	246.4	—	233.5	233.5	—	220.0	220.0	—	205.3	205.3	—	190.6	190.6	
			SHC	—	109.0	141.5	—	103.1	135.4	—	97.1	129.4	—	91.1	123.1	—	84.8	116.8	—	78.3	110.1	—	71.7	103.4	
7000 CFM	EAT (wb)	58	TC	214.6	214.6	242.4	205.3	205.3	232.2	195.8	195.8	221.7	186.0	186.0	211.0	175.7	175.7	199.7	164.9	164.9	187.8	153.6	153.6	175.3	
			SHC	186.8	214.6	242.4	178.4	205.3	232.2	169.7	195.8	221.7	161.0	186.0	211.0	151.7	175.7	199.7	142.0	164.9	187.8	131.7	153.6	175.3	
		62	TC	217.3	217.3	242.5	206.9	206.9	235.6	196.4	196.4	228.2	186.1	186.1	219.6	175.9	175.9	208.0	165.1	165.1	195.7	153.8	153.8	182.8	
			SHC	173.3	207.9	242.5	166.8	201.2	235.6	160.0	194.1	228.2	152.7	186.1	219.6	143.8	175.9	208.0	134.5	165.1	195.7	124.6	153.8	182.8	
		67	TC	235.4	235.4	235.																			

COOLING CAPACITIES — THIRD STAGE, FULL LOAD (17.5 TONS) (cont)

50LC*B SIZE 20				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
7900 CFM	58	TC	222.4	222.4	251.1	212.7	212.7	240.4	202.8	202.8	229.6	192.7	192.7	218.4	181.9	181.9	206.7	170.7	170.7	194.3	158.9	158.9	181.4	
		SHC	193.7	222.4	251.1	185.0	212.7	240.4	176.0	202.8	229.6	166.8	192.7	218.4	157.2	181.9	206.7	147.1	170.7	194.3	136.5	158.9	181.4	
	62	TC	222.9	222.9	258.8	212.9	212.9	250.0	203.1	203.1	238.9	192.9	192.9	227.3	182.1	182.1	215.2	170.8	170.8	202.4	159.0	159.0	189.0	
		SHC	183.2	220.9	258.8	175.8	212.9	250.0	167.2	203.1	238.9	158.3	192.9	227.3	149.1	182.1	215.2	139.3	170.8	202.4	129.1	159.0	189.0	
	67	TC	239.5	239.5	239.5	227.8	227.8	227.8	215.9	215.9	215.9	203.7	203.7	205.4	190.9	190.9	198.7	177.6	177.6	191.6	163.9	163.9	184.2	
		SHC	146.4	185.5	224.5	140.2	179.3	218.3	134.0	173.0	212.0	127.6	166.5	205.4	121.0	159.8	198.7	114.2	152.9	191.6	107.2	145.7	184.2	
	72	TC	261.5	261.5	261.5	249.1	249.1	249.1	236.6	236.6	236.6	223.7	223.7	223.7	209.7	209.7	209.7	195.6	195.6	195.6	181.0	181.0	181.0	
		SHC	108.1	147.3	186.5	102.0	141.2	180.4	95.9	135.0	174.1	89.7	128.7	167.8	83.1	122.1	161.1	76.5	115.4	154.3	69.8	108.6	147.4	
	76	TC	—	280.5	280.5	—	267.5	267.5	—	254.1	254.1	—	240.5	240.5	—	226.3	226.3	—	211.5	211.5	—	196.0	196.0	
		SHC	—	116.6	156.7	—	110.6	150.5	—	104.4	144.3	—	98.2	138.0	—	91.8	131.4	—	85.3	124.7	—	78.5	117.7	
8750 CFM	58	TC	228.6	228.6	258.1	218.6	218.6	247.1	208.5	208.5	236.0	197.9	197.9	224.3	187.0	187.0	212.3	175.3	175.3	199.4	163.2	163.2	186.1	
		SHC	199.3	228.6	258.1	190.2	218.6	247.1	181.1	208.5	236.0	171.5	197.9	224.3	161.7	187.0	212.3	151.1	175.3	199.4	140.3	163.2	186.1	
	62	TC	228.9	228.9	268.2	218.9	218.9	256.9	208.7	208.7	245.4	198.1	198.1	233.4	187.1	187.1	220.9	175.4	175.4	207.7	163.3	163.3	193.9	
		SHC	189.5	228.9	268.2	180.9	218.9	256.9	172.0	208.7	245.4	162.8	198.1	233.4	153.3	187.1	220.9	143.2	175.4	207.7	132.7	163.3	193.9	
	67	TC	242.6	242.6	242.6	230.7	230.7	231.8	218.7	218.7	225.2	206.3	206.3	218.5	193.4	193.4	211.6	180.0	180.0	204.2	166.1	166.1	196.4	
		SHC	152.7	195.4	238.1	146.4	189.1	231.8	140.1	182.7	225.2	133.7	176.1	218.5	126.9	169.3	211.6	120.0	162.0	204.2	112.8	154.5	196.4	
	72	TC	264.6	264.6	264.6	252.0	252.0	252.0	239.3	239.3	239.3	226.1	226.1	226.1	212.4	212.4	212.4	197.5	197.5	197.5	182.8	182.8	182.8	
		SHC	110.7	153.6	196.4	104.6	147.4	190.1	98.5	141.2	183.9	92.1	134.8	177.5	85.7	128.3	170.8	79.0	121.4	163.9	72.2	114.6	156.9	
	76	TC	—	283.6	283.6	—	270.4	270.4	—	256.9	256.9	—	243.1	243.1	—	228.5	228.5	—	213.5	213.5	—	197.8	197.8	
		SHC	—	119.9	163.6	—	113.9	157.4	—	107.7	151.1	—	101.5	144.7	—	95.0	138.1	—	88.3	131.2	—	81.6	124.1	

LEGEND

—	Do not operate
CFM	Cubic Feet Per Minute (supply air)
EAT (db)	Entering Air Temperature (dry bulb)
EAT (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — FIRST STAGE, PART LOAD (20 TONS)

50LC*B SIZE 24				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
1550 CFM	EAT (wb)	58	TC	90.2	90.2	90.2	87.0	87.0	87.0	83.8	83.8	83.9	80.5	80.5	82.0	77.2	77.2	80.0	73.6	73.6	78.0	69.7	69.7	75.9
		SHC	71.0	79.3	87.6	69.1	77.4	85.7	67.3	75.6	83.9	65.4	73.7	82.0	63.5	71.8	80.0	61.5	69.7	78.0	59.3	67.6	75.9	
		62	TC	97.6	97.6	97.6	94.1	94.1	94.1	90.7	90.7	90.7	87.2	87.2	87.2	83.6	83.6	83.6	79.7	79.7	79.7	75.5	75.5	75.5
		SHC	65.0	73.3	81.6	63.1	71.4	79.7	61.2	69.5	77.8	59.4	67.7	76.0	57.4	65.7	74.0	55.4	63.7	72.0	53.2	61.5	69.8	
		67	TC	107.9	107.9	107.9	104.0	104.0	104.0	100.3	100.3	100.3	96.4	96.4	96.4	92.4	92.4	92.4	88.1	88.1	88.1	83.5	83.5	83.5
	SHC	57.5	65.8	74.1	55.5	63.8	72.2	53.5	61.9	70.2	51.7	60.0	68.3	49.7	58.0	66.3	47.7	56.0	64.3	45.4	53.7	62.0		
	72	TC	119.4	119.4	119.4	115.2	115.2	115.2	111.1	111.1	111.1	106.8	106.8	106.8	102.4	102.4	102.4	97.6	97.6	97.6	92.4	92.4	92.4	
	SHC	49.6	58.0	66.3	47.7	56.0	64.3	45.7	54.0	62.3	43.8	52.1	60.4	41.8	50.1	58.4	39.7	48.1	56.4	37.5	45.8	54.1		
	76	TC	—	129.7	129.7	—	125.1	125.1	—	120.5	120.5	—	115.9	115.9	—	111.1	111.1	—	106.0	106.0	—	100.3	100.3	
	SHC	—	51.6	59.9	—	49.5	57.9	—	47.6	55.9	—	45.6	53.9	—	43.7	52.0	—	41.5	49.9	—	39.4	47.7		
2100 CFM	EAT (wb)	58	TC	100.0	100.0	105.7	96.1	96.1	103.4	92.3	92.3	101.3	89.7	89.7	96.7	85.1	85.1	95.8	81.7	81.7	92.0	77.9	77.9	87.8
		SHC	83.4	94.5	105.7	81.1	92.3	103.4	79.1	90.2	101.3	75.9	86.3	96.7	74.3	85.1	95.8	71.3	81.7	92.0	68.1	77.9	87.8	
		62	TC	108.1	108.1	108.1	103.8	103.8	103.8	99.6	99.6	99.6	95.5	95.5	95.5	91.1	91.1	91.1	86.5	86.5	86.5	81.5	81.5	84.2
		SHC	75.1	86.3	97.4	72.8	84.0	95.3	70.7	81.9	93.1	68.6	79.9	91.0	66.5	77.7	88.8	64.3	75.5	86.7	61.9	73.0	84.2	
		67	TC	119.4	119.4	119.4	114.7	114.7	114.7	110.1	110.1	110.1	105.4	105.4	105.4	100.6	100.6	100.6	95.6	95.6	95.6	90.0	90.0	90.0
	SHC	64.5	75.8	87.0	62.3	73.5	84.7	60.2	71.4	82.6	58.0	69.2	80.4	55.9	67.1	78.3	53.6	64.8	76.1	51.3	62.5	73.7		
	72	TC	132.0	132.0	132.0	126.8	126.8	126.8	121.7	121.7	121.7	116.5	116.5	116.5	111.2	111.2	111.2	105.6	105.6	105.6	99.5	99.5	99.5	
	SHC	53.7	64.9	76.2	51.5	62.7	74.0	49.3	60.5	71.9	47.2	58.4	69.7	45.0	56.3	67.6	42.8	54.0	65.3	40.4	51.7	62.9		
	76	TC	—	142.9	142.9	—	137.4	137.4	—	131.8	131.8	—	126.3	126.3	—	120.5	120.5	—	114.5	114.5	—	107.9	107.9	
	SHC	—	56.1	67.3	—	53.8	65.1	—	51.7	63.0	—	49.6	60.8	—	47.4	58.7	—	45.1	56.5	—	42.8	54.1		
2600 CFM	EAT (wb)	58	TC	94.9	94.9	108.4	86.9	86.9	99.9	78.9	78.9	91.6	70.9	70.9	83.1	62.7	62.7	74.5	54.4	54.4	65.6	45.8	45.8	56.6
		SHC	81.3	94.9	108.4	73.8	86.9	99.9	66.2	78.9	91.6	58.7	70.9	83.1	51.0	62.7	74.5	43.2	54.4	65.6	35.1	45.8	56.6	
		62	TC	104.6	104.6	104.6	95.2	95.2	95.2	85.8	85.8	86.7	76.4	76.4	79.8	66.9	66.9	72.7	57.2	57.2	65.6	47.2	47.2	58.3
		SHC	73.2	87.0	100.7	66.1	80.0	93.7	59.2	72.9	86.7	52.2	66.0	79.8	45.2	59.0	72.7	38.1	51.9	65.6	30.9	44.7	58.3	
		67	TC	119.0	119.0	119.0	109.0	109.0	109.0	99.2	99.2	99.2	89.2	89.2	89.2	79.2	79.2	79.2	68.8	68.8	68.8	58.2	58.2	58.2
	SHC	62.6	76.4	90.3	55.6	69.4	83.3	48.6	62.4	76.2	41.6	55.4	69.2	34.6	48.5	62.2	27.5	41.3	55.2	20.4	34.1	48.0		
	72	TC	134.7	134.7	134.7	124.3	124.3	124.3	113.9	113.9	113.9	103.4	103.4	103.4	92.8	92.8	92.8	81.9	81.9	81.9	70.7	70.7	70.7	
	SHC	51.8	65.7	79.7	44.8	58.7	72.6	37.7	51.7	65.6	30.8	44.7	58.6	23.8	37.7	51.6	16.7	30.6	44.5	9.6	23.4	37.3		
	76	TC	—	148.2	148.2	—	137.4	137.4	—	126.6	126.6	—	115.6	115.6	—	104.6	104.6	—	93.2	93.2	—	81.4	81.4	
	SHC	—	56.8	70.8	—	49.8	63.8	—	42.8	56.7	—	35.9	49.8	—	28.9	42.8	—	21.8	35.8	—	14.6	28.6		
3150 CFM	EAT (wb)	58	TC	105.1	105.1	119.7	96.5	96.5	110.6	87.9	87.9	101.5	79.4	79.4	92.4	70.7	70.7	83.3	61.7	61.7	73.7	52.6	52.6	64.0
		SHC	90.5	105.1	119.7	82.4	96.5	110.6	74.4	87.9	101.5	66.3	79.4	92.4	58.1	70.7	83.3	49.7	61.7	73.7	41.1	52.6	64.0	
		62	TC	111.1	111.1	115.6	101.1	101.1	108.3	91.3	91.3	101.0	81.4	81.4	93.7	71.6	71.6	86.2	61.9	61.9	77.9	52.7	52.7	67.9
		SHC	82.6	99.1	115.6	75.3	91.7	108.3	68.1	84.5	101.0	60.8	77.2	93.7	53.5	69.8	86.2	45.8	61.9	77.9	37.4	52.7	67.9	
		67	TC	125.6	125.6	125.6	115.1	115.1	115.1	104.6	104.6	104.6	94.1	94.1	94.1	83.5	83.5	83.5	72.6	72.6	72.6	61.4	61.4	61.4
	SHC	69.2	85.9	102.5	61.9	78.6	95.2	54.7	71.4	87.9	47.5	64.2	80.7	40.3	56.9	73.5	33.0	49.6	66.2	25.5	42.2	58.8		
	72	TC	141.7	141.7	141.7	130.7	130.7	130.7	119.6	119.6	119.6	108.6	108.6	108.6	97.4	97.4	97.4	86.0	86.0	86.0	74.1	74.1	74.1	
	SHC	55.6	72.3	89.1	48.4	65.0	81.8	41.1	57.8	74.6	33.9	50.6	67.4	26.7	43.4	60.2	19.4	36.2	52.8	12.1	28.8	45.4		
	76	TC	—	155.4	155.4	—	144.0	144.0	—	132.6	132.6	—	121.1	121.1	—	109.4	109.4	—	97.4	97.4	—	85.0	85.0	
	SHC	—	61.1	78.1	—	54.0	70.9	—	46.8	63.7	—	39.6	56.6	—	32.4	49.3	—	25.2	42.0	—	17.7	34.6		
3650 CFM	EAT (wb)	58	TC	112.8	112.8	128.2	103.7	103.7	118.6	94.8	94.8	109.0	85.7	85.7	99.5	76.5	76.5	89.7	67.2	67.2	79.8	57.5	57.5	69.4
		SHC	97.4	112.8	128.2	88.9	103.7	118.6	80.4	94.8	109.0	72.0	85.7	99.5	63.4	76.5	89.7	54.7	67.2	79.8	45.6	57.5	69.4	
		62	TC	115.8	115.8	128.2	105.6	105.6	120.5	95.6	95.6	112.7	85.9	85.9	104.2	76.7	76.7	94.3	67.4	67.4	84.1	57.6	57.6	73.5
		SHC	90.4	109.3	128.2	82.9	101.7	120.5	75.4	94.1	112.7	67.6	85.9	104.2	59.2	76.7	94.3	50.6	67.4	84.1	41.7	57.6	73.5	
		67	TC	130.1	130.1	130.1	119.1	119.1	119.1	108.2	108.2	108.2	97.4	97.4	97.4	86.5	86.5	86.5	75.3	75.3	75.8	63.8	63.8	68.2
	SHC	74.6	93.7	112.9	67.2	86.3	105.4	59.8	78.9	98.0	52.5	71.6	90.7	45.0	64.2	83.3	37.6	56.6	75.8	30.0	49.1	68.2		
	72	TC	146.3	146.3	146.3	134.8	134.8	134.8	123.4	123.4	123.4	112.0	112.0	112.0	100.5	100.5	100.5	88.6	88.6	88.6	76.4	76.4	76.4	
	SHC	58.5	77.7	96.9	51.1	70.3	89.6	43.7	63.0	82.2	36.4	55.6	74.9	29.1	48.3	67.5	21.5	40.8	60.0	14.0	33.2	52.5		
	76	TC	—	160.2	160.2	—	148.4	148.4	—	136.5	136.5	—	124.7	124.7	—	112.6	112.6	—	100.2	100.2	—	87.5	87.5	
	SHC	—	64.6	84.1	—	57.2	76.7	—	49.9	69.4	—	42.6	62.1	—	35.3	54.7	—	27.9	47.2	—	20.3	39.7		
4200 CFM	EAT (wb)	58	TC	119.9	119.9	136.0	110.4	110.4	125.9	101.0	101.0	115.9	91.6	91.6	105.9	82.0	82.0	95.7	72.2	72.2	85.3	62.1	62.1	74.5
		SHC	103.8	119.9	136.0	94.9	110.4	125.9	86.1	101.0	115.9	77.2	91.6	105.9	68.3	82.0	95.7	59.2	72.2	85.3	49.7	62.1	74.5	
		62	TC	120.5	120.5	140.6	110.6	110.6	131.3	101.2	101.2	121.1	91.7	91.7	110.9	82.2	82.2	100.5	72.3	72.3	89.8	62.2	62.2	78.8
		SHC	98.2	119.3	140.6	89.9	110.6	131.3	81.2	101.2	121.1	72.5	91.7	110.9	63.9	82.2	100.5	54.9	72.3	89.8	45.6	62.2	78.8	
		67	TC	133.9	133.9	133.9	122.6	122.6	122.6	111.4	111.4	111.4	100.2	100.2	101.0	89.0	89.0	93.4	77.6	77.6	85.8	65.8	65.8	77.9
	SHC	80.0	101.9	123.7	72.4	94.3	116.1	64.9	86.8	108.5	57.5	79.3	101.0	50.0	71.8	93.4	42.4	64.2	85.8	34.7	56.4	77.9		
	72	TC	150.2	150.2	150.2	138.5	138.5	138.5	126.8	126.8	126.8	115.0	115.0	115.0	103.1	103.1	103.1	90.9	90.9	90.9	78.3	78.3	78.3	
	SHC	61.2	83.2	105.1	53.7	75.7	97.6	46.2	68.2	90.1	38.8	60.7	82.6	31.3	53.2	75.2	23.8	45.6	67.6	16.1				

COOLING CAPACITIES — FIRST STAGE, PART LOAD (20 TONS) (cont)

50LC*B SIZE 24				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
4700 CFM	EAT (wb)	58	TC	125.4	125.4	142.1	115.5	115.5	131.6	105.9	105.9	121.3	96.1	96.1	110.9	86.2	86.2	100.3	76.1	76.1	89.5	65.6	65.6	78.3
		SHC	108.7	125.4	142.1	99.5	115.5	131.6	90.5	105.9	121.3	81.3	96.1	110.9	72.1	86.2	100.3	62.6	76.1	89.5	52.8	65.6	78.3	
		62	TC	125.6	125.6	147.8	115.7	115.7	137.2	106.0	106.0	126.7	96.2	96.2	116.0	86.4	86.4	105.2	76.1	76.1	94.2	65.7	65.7	82.8
		SHC	103.4	125.6	147.8	94.4	115.7	137.2	85.4	106.0	126.7	76.4	96.2	116.0	67.5	86.4	105.2	58.2	76.1	94.2	48.7	65.7	82.8	
		67	TC	136.6	136.6	136.6	125.2	125.2	125.4	113.8	113.8	117.7	102.5	102.5	110.0	91.1	91.1	102.3	79.4	79.4	94.4	67.5	67.5	86.3
	SHC	84.7	108.9	133.1	77.0	101.2	125.4	69.4	93.6	117.7	61.8	85.9	110.0	54.2	78.3	102.3	46.5	70.5	94.4	38.7	62.5	86.3		
	72	TC	153.0	153.0	153.0	141.0	141.0	141.0	129.0	129.0	129.0	117.0	117.0	117.0	104.9	104.9	104.9	92.4	92.4	92.4	79.7	79.7	79.7	
	SHC	63.5	87.8	112.1	55.9	80.2	104.5	48.4	72.6	97.0	40.9	65.1	89.4	33.2	57.5	81.8	25.6	49.8	74.1	17.8	42.1	66.4		
	76	TC	—	167.0	167.0	—	154.7	154.7	—	142.4	142.4	—	129.9	129.9	—	117.2	117.2	—	104.2	104.2	—	90.9	90.9	
	SHC	—	70.6	95.3	—	63.1	87.7	—	55.6	80.1	—	48.1	72.6	—	40.6	65.0	—	32.9	57.3	—	25.2	49.5		
5250 CFM	EAT (wb)	58	TC	130.6	130.6	147.8	120.5	120.5	137.0	110.5	110.5	126.3	100.3	100.3	115.5	90.2	90.2	104.7	79.7	79.7	93.5	68.9	68.9	82.0
		SHC	113.4	130.6	147.8	103.9	120.5	137.0	94.6	110.5	126.3	85.1	100.3	115.5	75.7	90.2	104.7	65.9	79.7	93.5	55.9	68.9	82.0	
		62	TC	130.7	130.7	153.8	120.6	120.6	142.7	110.6	110.6	131.8	100.5	100.5	120.8	90.3	90.3	109.7	79.9	79.9	98.3	69.0	69.0	86.5
		SHC	107.7	130.7	153.8	98.6	120.6	142.7	89.4	110.6	131.8	80.1	100.5	120.8	70.9	90.3	109.7	61.3	79.9	98.3	51.6	69.0	86.5	
		67	TC	139.2	139.2	142.9	127.5	127.5	135.1	115.9	115.9	127.3	104.5	104.5	119.4	92.9	92.9	111.4	81.2	81.2	103.2	69.7	69.7	93.6
	SHC	89.5	116.2	142.9	81.8	108.4	135.1	74.1	100.7	127.3	66.4	92.9	119.4	58.7	85.0	111.4	50.7	76.9	103.2	42.4	68.0	93.6		
	72	TC	155.4	155.4	155.4	143.2	143.2	143.2	131.0	131.0	131.0	118.9	118.9	118.9	106.5	106.5	106.5	93.9	93.9	93.9	80.8	80.8	80.8	
	SHC	65.7	92.6	119.5	58.1	85.0	111.8	50.5	77.3	104.2	42.9	69.7	96.5	35.2	62.1	88.9	27.5	54.3	81.1	19.7	46.5	73.2		
	76	TC	—	169.6	169.6	—	157.1	157.1	—	144.4	144.4	—	131.7	131.7	—	118.9	118.9	—	105.7	105.7	—	92.1	92.1	
	SHC	—	73.4	100.6	—	65.8	93.0	—	58.2	85.3	—	50.7	77.7	—	43.0	70.1	—	35.3	62.3	—	27.5	54.5		

LEGEND

—	Do not operate
CFM	Cubic Feet Per Minute (supply air)
EAT (db)	Entering Air Temperature (dry bulb)
EAT (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — SECOND STAGE, PART LOAD (20 TONS)

50LC*B SIZE 24				AMBIENT TEMPERATURE (°F)																					
				65			75			85			95			105			115			125			
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	
1950 CFM	EAT (wb)	58	TC	116.3	116.3	116.3	113.6	113.6	113.6	109.9	109.9	109.9	105.6	105.6	105.6	100.8	100.8	102.7	95.4	95.4	99.6	89.3	89.3	96.2	
		SHC	91.0	101.3	111.7	89.3	99.7	110.2	87.2	97.6	108.0	84.6	95.1	105.5	81.9	92.3	102.7	78.8	89.2	99.6	75.5	85.8	96.2		
		62	TC	126.1	126.1	126.1	122.7	122.7	122.7	118.8	118.8	118.8	114.3	114.3	114.3	109.1	109.1	109.1	103.4	103.4	103.4	97.0	97.0	97.0	
		SHC	83.8	94.2	104.5	81.8	92.2	102.6	79.6	90.0	100.4	77.1	87.6	98.0	74.4	84.7	95.2	71.3	81.7	92.1	68.0	78.4	88.8		
		67	TC	138.8	138.8	138.8	135.1	135.1	135.1	130.9	130.9	130.9	126.2	126.2	126.2	120.8	120.8	120.8	114.7	114.7	114.7	107.8	107.8	107.8	
		SHC	73.9	84.3	94.8	72.0	82.5	92.9	69.8	80.2	90.7	67.4	77.8	88.3	64.7	75.2	85.6	61.7	72.2	82.6	58.5	68.9	79.4		
		72	TC	153.1	153.1	153.1	149.1	149.1	149.1	144.6	144.6	144.6	139.5	139.5	139.5	133.7	133.7	133.7	127.1	127.1	127.1	119.7	119.7	119.7	
		SHC	63.8	74.3	84.7	61.9	72.3	82.9	59.8	70.2	80.7	57.4	67.9	78.3	54.8	65.2	75.7	51.9	62.3	72.7	48.7	59.1	69.5		
		76	TC	—	165.5	165.5	—	161.4	161.4	—	156.5	156.5	—	151.1	151.1	—	144.9	144.9	—	138.0	138.0	—	130.2	130.2	
		SHC	—	65.9	76.4	—	64.1	74.6	—	62.0	72.4	—	59.7	70.1	—	57.0	67.5	—	54.2	64.6	—	51.1	61.5		
2600 CFM	EAT (wb)	58	TC	128.8	128.8	133.5	125.0	125.0	131.3	120.7	120.7	128.9	115.8	115.8	126.1	110.4	110.4	122.9	104.9	104.9	118.3	99.4	99.4	112.0	
		SHC	105.9	119.6	133.5	103.7	117.5	131.3	101.3	115.1	128.9	98.6	112.3	126.1	95.6	109.2	122.9	91.7	104.9	118.3	86.8	99.4	112.0		
		62	TC	138.6	138.6	138.6	134.6	134.6	134.6	130.0	130.0	130.0	124.8	124.8	124.8	118.9	118.9	118.9	112.3	112.3	112.3	105.0	105.0	106.1	
		SHC	95.4	109.2	123.0	93.3	107.1	120.9	90.9	104.7	118.6	88.2	102.1	115.9	85.3	99.2	112.9	82.0	95.8	109.7	78.5	92.3	106.1		
		67	TC	152.5	152.5	152.5	148.1	148.1	148.1	143.1	143.1	143.1	137.6	137.6	137.6	131.3	131.3	131.3	124.2	124.2	124.2	116.3	116.3	116.3	
		SHC	82.1	95.9	109.8	80.0	93.9	107.7	77.6	91.6	105.4	75.1	88.9	102.8	72.2	86.0	99.9	69.0	82.9	96.7	65.5	79.4	93.2		
		72	TC	167.7	167.7	167.7	163.0	163.0	163.0	157.8	157.8	157.8	151.7	151.7	151.7	145.0	145.0	145.0	137.4	137.4	137.4	129.0	129.0	129.0	
		SHC	68.3	82.3	96.2	66.3	80.2	94.2	64.1	78.0	91.9	61.5	75.5	89.4	58.7	72.6	86.6	55.6	69.5	83.5	52.3	66.2	80.1		
		76	TC	—	181.0	181.0	—	176.0	176.0	—	170.4	170.4	—	164.1	164.1	—	156.9	156.9	—	148.8	148.8	—	139.8	139.8	
		SHC	—	71.0	84.9	—	69.0	83.0	—	66.8	80.7	—	64.4	78.3	—	61.6	75.6	—	58.5	72.4	—	55.3	69.2		
3250 CFM	EAT (wb)	58	TC	131.4	131.4	146.6	125.0	125.0	141.9	118.9	118.9	135.2	112.2	112.2	128.1	105.0	105.0	120.3	97.3	97.3	111.8	89.0	89.0	102.8	
		SHC	112.7	129.7	146.6	108.0	124.9	141.9	102.4	118.9	135.2	96.3	112.2	128.1	89.8	105.0	120.3	82.8	97.3	111.8	75.3	89.0	102.8		
		62	TC	142.1	142.1	142.1	135.2	135.2	135.2	127.8	127.8	127.8	119.7	119.7	120.3	111.0	111.0	115.0	101.6	101.6	109.2	91.5	91.5	103.1	
		SHC	100.6	117.8	134.9	96.0	113.2	130.4	91.2	108.3	125.5	86.1	103.3	120.3	80.6	97.8	115.0	75.0	92.0	109.2	69.0	86.0	103.1		
		67	TC	157.7	157.7	157.7	150.5	150.5	150.5	142.7	142.7	142.7	134.2	134.2	134.2	124.9	124.9	124.9	114.9	114.9	114.9	104.0	104.0	104.0	
		SHC	85.2	102.4	119.6	80.6	97.9	115.1	75.9	93.1	110.3	70.8	88.0	105.2	65.4	82.7	99.8	59.9	77.0	94.3	54.0	71.2	88.3		
		72	TC	174.8	174.8	174.8	167.3	167.3	167.3	159.1	159.1	159.1	150.2	150.2	150.2	140.4	140.4	140.4	129.8	129.8	129.8	118.4	118.4	118.4	
		SHC	69.3	86.8	104.1	64.9	82.3	99.6	60.2	77.5	94.9	55.2	72.5	89.8	49.9	67.3	84.5	44.5	61.7	79.1	38.6	56.0	73.2		
		76	TC	—	189.5	189.5	—	181.8	181.8	—	173.3	173.3	—	163.8	163.8	—	153.6	153.6	—	142.4	142.4	—	130.5	130.5	
		SHC	—	73.7	91.2	—	69.3	86.8	—	64.6	82.1	—	59.7	77.1	—	54.5	72.0	—	49.0	66.5	—	43.4	60.7		
3900 CFM	EAT (wb)	58	TC	141.5	141.5	160.1	135.4	135.4	153.5	128.8	128.8	146.4	121.7	121.7	138.6	114.1	114.1	130.4	105.8	105.8	121.3	96.9	96.9	111.5	
		SHC	122.9	141.5	160.1	117.3	135.4	153.5	111.2	128.8	146.4	104.7	121.7	138.6	97.8	114.1	130.4	90.3	105.8	121.3	82.2	96.9	111.5		
		62	TC	148.9	148.9	151.5	141.8	141.8	146.8	134.0	134.0	141.8	125.6	125.6	136.5	116.5	116.5	130.7	106.8	106.8	124.5	97.0	97.0	116.6	
		SHC	110.8	131.1	151.5	106.1	126.5	146.8	101.1	121.4	141.8	95.8	116.1	136.5	90.3	110.5	130.7	84.3	104.4	124.5	77.4	97.0	116.6		
		67	TC	164.6	164.6	164.6	157.1	157.1	157.1	148.8	148.8	148.8	139.8	139.8	139.8	130.1	130.1	130.1	119.5	119.5	119.5	108.2	108.2	108.2	
		SHC	91.9	112.5	133.0	87.4	107.8	128.3	82.5	103.0	123.4	77.3	97.8	118.3	71.9	92.3	112.8	66.1	86.6	107.1	60.1	80.5	101.0		
		72	TC	182.0	182.0	182.0	174.2	174.2	174.2	165.6	165.6	165.6	156.1	156.1	156.1	145.9	145.9	145.9	134.6	134.6	134.6	122.7	122.7	122.7	
		SHC	72.8	93.5	114.2	68.3	88.9	109.6	63.5	84.1	104.7	58.4	79.0	99.6	53.0	73.6	94.2	47.4	68.0	88.5	41.4	62.0	82.6		
		76	TC	—	197.0	197.0	—	188.8	188.8	—	179.7	179.7	—	169.8	169.8	—	159.1	159.1	—	147.5	147.5	—	134.8	134.8	
		SHC	—	77.8	98.8	—	73.3	94.3	—	68.5	89.5	—	63.6	84.4	—	58.3	79.2	—	52.7	73.6	—	46.9	67.7		
4500 CFM	EAT (wb)	58	TC	149.7	149.7	169.2	143.3	143.3	162.3	136.4	136.4	154.8	129.0	129.0	146.7	120.9	120.9	138.0	112.1	112.1	128.4	102.8	102.8	118.1	
		SHC	130.2	149.7	169.2	124.2	143.3	162.3	118.0	136.4	154.8	111.2	129.0	146.7	103.8	120.9	138.0	95.9	112.1	128.4	87.5	102.8	118.1		
		62	TC	154.0	154.0	165.9	146.5	146.5	161.0	138.6	138.6	155.8	130.2	130.2	150.1	121.0	121.0	143.8	112.3	112.3	134.1	103.0	103.0	123.4	
		SHC	119.4	142.6	165.9	114.7	137.9	161.0	109.5	132.7	155.8	104.0	127.0	150.1	98.2	121.0	143.8	90.7	112.3	134.1	82.5	103.0	123.4		
		67	TC	169.4	169.4	169.4	161.6	161.6	161.6	153.0	153.0	153.0	143.7	143.7	143.7	133.7	133.7	133.7	122.9	122.9	122.9	111.2	111.2	112.1	
		SHC	97.7	121.2	144.6	93.0	116.4	139.9	88.0	111.4	134.9	82.8	106.3	129.7	77.3	100.7	124.1	71.5	94.9	118.3	65.4	88.7	112.1		
		72	TC	187.0	187.0	187.0	178.9	178.9	178.9	169.9	169.9	169.9	160.2	160.2	160.2	149.5	149.5	149.5	138.0	138.0	138.0	125.5	125.5	125.5	
		SHC	75.6	99.2	122.8	71.0	94.6	118.2	66.1	89.7	113.3	60.9	84.5	108.1	55.5	79.1	102.6	49.8	73.3	96.8	43.8	67.4	90.9		
		76	TC	—	201.8	201.8	—	193.4	193.4	—	184.1	184.1	—	173.9	173.9	—	162.8	162.8	—	150.8	150.8	—	137.9	137.9	
		SHC	—	81.2	105.2	—	76.6	100.6	—	71.9	95.7	—	66.7	90.6	—	61.3	85.2	—	55.8	79.6	—	49.8	73.6		
5150 CFM	EAT (wb)	58	TC	157.2	157.2	177.5	150.5	150.5	170.3	143.3	143.3	162.5	135.5	135.5	154.1	127.0	127.0	144.8	118.0	118.0					

COOLING CAPACITIES — SECOND STAGE, PART LOAD (20 TONS) (cont)

50LC*B SIZE 24				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
5800 CFM	EAT (wb)	58	TC	163.5	163.5	184.6	156.6	156.6	177.2	149.2	149.2	169.1	141.1	141.1	160.2	132.3	132.3	150.6	122.8	122.8	140.2	112.5	112.5	129.0
			SHC	142.4	163.5	184.6	136.0	156.6	177.2	129.2	149.2	169.1	121.9	141.1	160.2	113.9	132.3	150.6	105.3	122.8	140.2	96.1	112.5	129.0
		62	TC	163.7	163.7	191.9	156.8	156.8	184.3	149.3	149.3	175.9	141.2	141.2	166.8	132.4	132.4	157.0	122.9	122.9	146.3	112.7	112.7	134.6
			SHC	135.4	163.7	191.9	129.3	156.8	184.3	122.7	149.3	175.9	115.5	141.2	166.8	107.9	132.4	157.0	99.6	122.9	146.3	90.7	112.7	134.6
		67	TC	176.5	176.5	176.5	168.4	168.4	168.4	159.4	159.4	159.4	149.8	149.8	152.9	139.2	139.2	147.1	127.9	127.9	141.0	115.8	115.8	134.5
			SHC	109.0	138.5	168.2	104.2	133.8	163.4	99.2	128.7	158.2	93.8	123.3	152.9	88.1	117.6	147.1	82.2	111.6	141.0	75.9	105.2	134.5
		72	TC	194.2	194.2	194.2	185.7	185.7	185.7	176.3	176.3	176.3	165.9	165.9	165.9	154.8	154.8	154.8	142.7	142.7	142.7	129.8	129.8	129.8
			SHC	80.6	110.4	140.1	76.0	105.7	135.4	71.0	100.7	130.5	65.7	95.5	125.2	60.3	89.9	119.6	54.4	84.0	113.7	48.3	77.9	107.5
		76	TC	—	209.1	209.1	—	200.4	200.4	—	190.6	190.6	—	179.9	179.9	—	168.3	168.3	—	155.8	155.8	—	142.3	142.3
			SHC	—	87.5	117.6	—	82.9	112.9	—	77.9	108.0	—	72.7	102.8	—	67.3	97.3	—	61.6	91.6	—	55.6	85.4
6450 CFM	EAT (wb)	58	TC	168.9	168.9	190.6	161.9	161.9	183.0	154.1	154.1	174.6	145.8	145.8	165.6	136.7	136.7	155.6	126.9	126.9	144.9	116.3	116.3	133.2
			SHC	147.1	168.9	190.6	140.7	161.9	183.0	133.7	154.1	174.6	126.1	145.8	165.6	117.9	136.7	155.6	109.0	126.9	144.9	99.5	116.3	133.2
		62	TC	169.1	169.1	198.1	161.9	161.9	190.2	154.3	154.3	181.6	146.0	146.0	172.3	136.9	136.9	162.1	127.0	127.0	151.0	116.5	116.5	139.0
			SHC	140.0	169.1	198.1	133.7	161.9	190.2	126.9	154.3	181.6	119.5	146.0	172.3	111.6	136.9	162.1	103.2	127.0	151.0	93.9	116.5	139.0
		67	TC	179.2	179.2	179.3	170.9	170.9	174.4	161.9	161.9	169.3	152.0	152.0	163.7	141.5	141.5	157.9	130.1	130.1	151.4	117.9	117.9	144.4
			SHC	114.2	146.7	179.3	109.4	141.9	174.4	104.3	136.8	169.3	98.9	131.3	163.7	93.2	125.5	157.9	87.2	119.3	151.4	80.6	112.5	144.4
		72	TC	196.8	196.8	196.8	188.1	188.1	188.1	178.5	178.5	178.5	168.0	168.0	168.0	156.7	156.7	156.7	144.4	144.4	144.4	131.1	131.1	131.1
			SHC	82.9	115.6	148.3	78.2	110.9	143.6	73.2	105.9	138.5	67.9	100.5	133.2	62.3	95.0	127.6	56.5	89.1	121.7	50.3	82.9	115.4
		76	TC	—	211.7	211.7	—	202.8	202.8	—	192.9	192.9	—	182.0	182.0	—	170.2	170.2	—	157.5	157.5	—	143.8	143.8
			SHC	—	90.2	123.3	—	85.6	118.7	—	80.7	113.7	—	75.5	108.5	—	70.0	103.0	—	64.3	97.1	—	58.2	91.1

LEGEND

—	Do not operate
CFM	Cubic Feet Per Minute (supply air)
EAT (db)	Entering Air Temperature (dry bulb)
EAT (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — THIRD STAGE, FULL LOAD (20 TONS)

50LC*B SIZE 24				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
4,000 CFM	EAT (wb)	58	TC	209.8	209.8	210.9	203.2	203.2	207.0	196.0	196.0	202.9	188.3	188.3	198.4	179.8	179.8	193.6	170.6	170.6	188.1	162.5	162.5	178.4
		SHC	168.9	189.9	210.9	165.1	186.0	207.0	161.0	181.9	202.9	156.6	177.5	198.4	151.8	172.7	193.6	146.5	167.3	188.1	139.2	158.8	178.4	
		62	TC	225.5	225.5	225.5	218.3	218.3	218.3	210.6	210.6	210.6	202.2	202.2	202.2	193.1	193.1	193.1	182.9	182.9	182.9	172.0	172.0	172.0
		SHC	152.9	173.8	194.9	149.0	170.0	191.0	144.9	165.9	186.9	140.5	161.6	182.5	135.8	156.9	177.8	130.7	151.8	172.8	125.3	146.3	167.3	
		67	TC	247.5	247.5	247.5	239.7	239.7	239.7	231.4	231.4	231.4	222.2	222.2	222.2	212.4	212.4	212.4	201.4	201.4	201.4	189.6	189.6	189.6
	SHC	132.5	153.6	174.7	128.6	149.8	170.8	124.6	145.7	166.8	120.2	141.3	162.4	115.6	136.7	157.8	110.6	131.7	152.8	105.2	126.3	147.4		
	72	TC	271.3	271.3	271.3	263.1	263.1	263.1	253.8	253.8	253.8	244.0	244.0	244.0	233.4	233.4	233.4	221.9	221.9	221.9	209.1	209.1	209.1	
	SHC	111.1	132.5	154.0	107.3	128.8	150.2	103.4	124.8	146.2	99.2	120.5	141.9	94.7	116.0	137.3	89.8	111.2	132.4	84.6	105.9	127.1		
	76	TC	—	292.1	292.1	—	283.3	283.3	—	273.8	273.8	—	263.2	263.2	—	251.8	251.8	—	239.5	239.5	—	225.9	225.9	
	SHC	—	114.9	136.3	—	111.2	132.7	—	107.4	128.9	—	103.3	124.7	—	98.8	120.2	—	94.0	115.4	—	88.9	110.4		
4,500 CFM	EAT (wb)	58	TC	217.6	217.6	225.9	210.6	210.6	221.9	203.0	203.0	217.5	194.9	194.9	212.7	186.3	186.3	207.5	180.0	180.0	194.7	168.7	168.7	190.1
		SHC	179.1	202.5	225.9	175.1	198.5	221.9	170.8	194.2	217.5	166.2	189.5	212.7	161.3	184.4	207.5	152.5	173.6	194.7	147.2	168.7	190.1	
		62	TC	233.1	233.1	233.1	225.5	225.5	225.5	217.3	217.3	217.3	208.5	208.5	208.5	198.8	198.8	198.8	188.3	188.3	188.3	176.8	176.8	179.5
		SHC	160.8	184.3	207.8	156.9	180.4	203.9	152.7	176.2	199.7	148.2	171.7	195.2	143.3	166.8	190.3	138.2	161.7	185.2	132.6	156.1	179.5	
		67	TC	255.5	255.5	255.5	247.4	247.4	247.4	238.5	238.5	238.5	228.8	228.8	228.8	218.3	218.3	218.3	206.9	206.9	206.9	194.5	194.5	194.5
	SHC	137.8	161.4	185.0	133.9	157.5	181.1	129.8	153.4	176.9	125.3	148.9	172.5	120.5	144.1	167.7	115.4	139.0	162.5	110.0	133.6	157.1		
	72	TC	279.8	279.8	279.8	271.1	271.1	271.1	261.7	261.7	261.7	251.0	251.0	251.0	239.8	239.8	239.8	227.7	227.7	227.7	214.2	214.2	214.2	
	SHC	113.8	137.9	161.9	110.1	134.1	158.0	106.1	130.0	153.9	101.6	125.5	149.4	97.1	120.9	144.7	92.1	115.9	139.7	86.9	110.6	134.4		
	76	TC	—	301.0	301.0	—	291.4	291.4	—	281.5	281.5	—	270.5	270.5	—	258.5	258.5	—	245.4	245.4	—	231.4	231.4	
	SHC	—	118.1	142.2	—	114.3	138.5	—	110.4	134.6	—	106.2	130.4	—	101.7	125.9	—	96.9	121.0	—	91.7	115.9		
5,000 CFM	EAT (wb)	58	TC	221.0	221.0	236.9	212.5	212.5	231.4	203.6	203.6	225.5	194.0	194.0	219.5	185.2	185.2	209.7	175.4	175.4	198.9	165.0	165.0	187.2
		SHC	185.3	211.2	236.9	180.0	205.7	231.4	174.3	199.9	225.5	168.5	194.0	219.5	160.7	185.2	209.7	152.0	175.4	198.9	142.6	165.0	187.2	
		62	TC	236.8	236.8	236.8	227.6	227.6	227.6	217.8	217.8	217.8	207.3	207.3	207.3	196.0	196.0	196.0	183.8	183.8	188.1	170.8	170.8	181.1
		SHC	165.6	191.6	217.5	160.3	186.2	212.2	154.8	180.8	206.7	149.0	174.9	200.9	142.8	168.8	194.6	136.3	162.1	188.1	129.4	155.2	181.1	
		67	TC	260.1	260.1	260.1	250.3	250.3	250.3	239.7	239.7	239.7	228.3	228.3	228.3	216.2	216.2	216.2	203.1	203.1	203.1	189.0	189.0	189.0
	SHC	140.7	166.7	192.8	135.5	161.6	187.6	130.0	156.0	182.0	124.2	150.2	176.3	118.2	144.1	170.1	111.7	137.8	163.7	105.0	130.9	157.0		
	72	TC	285.6	285.6	285.6	275.1	275.1	275.1	264.0	264.0	264.0	251.6	251.6	251.6	238.7	238.7	238.7	224.7	224.7	224.7	209.6	209.6	209.6	
	SHC	115.0	141.4	167.8	109.9	136.3	162.6	104.6	130.9	157.3	98.9	125.1	151.4	92.9	119.1	145.5	86.7	112.9	139.1	80.1	106.3	132.5		
	76	TC	—	307.3	307.3	—	296.4	296.4	—	284.6	284.6	—	272.0	272.0	—	258.2	258.2	—	243.4	243.4	—	227.4	227.4	
	SHC	—	120.1	146.9	—	115.2	142.1	—	110.0	136.8	—	104.5	131.3	—	98.7	125.5	—	92.5	119.3	—	86.1	112.9		
6,000 CFM	EAT (wb)	58	TC	233.5	233.5	263.5	225.8	225.8	255.0	217.4	217.4	245.6	208.3	208.3	235.6	198.5	198.5	224.7	188.0	188.0	213.0	176.6	176.6	200.3
		SHC	203.6	233.5	263.5	196.7	225.8	255.0	189.2	217.4	245.6	181.1	208.3	235.6	172.4	198.5	224.7	163.0	188.0	213.0	152.9	176.6	200.3	
		62	TC	247.5	247.5	247.5	237.7	237.7	237.7	227.3	227.3	230.2	216.2	216.2	224.2	204.4	204.4	217.6	191.7	191.7	210.8	178.2	178.2	203.0
		SHC	180.1	210.8	241.5	174.6	205.3	236.0	169.0	199.6	230.2	162.9	193.5	224.2	156.6	187.1	217.6	149.9	180.4	210.8	142.6	172.9	203.0	
		67	TC	270.8	270.8	270.8	260.3	260.3	260.3	248.8	248.8	248.8	236.8	236.8	236.8	224.1	224.1	224.1	210.2	210.2	210.2	195.4	195.4	195.4
	SHC	150.2	181.0	211.8	144.8	175.6	206.4	139.0	169.8	200.7	133.2	164.0	194.7	127.0	157.8	188.6	120.5	151.2	182.0	113.7	144.4	175.1		
	72	TC	296.8	296.8	296.8	285.5	285.5	285.5	273.6	273.6	273.6	260.9	260.9	260.9	247.1	247.1	247.1	232.2	232.2	232.2	216.4	216.4	216.4	
	SHC	119.6	150.7	181.8	114.4	145.5	176.6	108.9	140.0	171.0	103.3	134.3	165.3	97.1	128.1	159.1	90.8	121.7	152.7	84.0	115.0	145.9		
	76	TC	—	319.0	319.0	—	307.4	307.4	—	294.8	294.8	—	281.4	281.4	—	266.8	266.8	—	251.1	251.1	—	234.3	234.3	
	SHC	—	126.0	158.1	—	120.9	153.1	—	115.5	147.7	—	110.0	142.2	—	103.9	135.9	—	97.7	129.4	—	91.1	122.7		
7,000 CFM	EAT (wb)	58	TC	247.0	247.0	278.6	238.4	238.4	269.2	229.4	229.4	259.1	219.7	219.7	248.3	209.2	209.2	236.7	198.0	198.0	224.2	185.9	185.9	210.7
		SHC	215.3	247.0	278.6	207.7	238.4	269.2	199.7	229.4	259.1	191.1	219.7	248.3	181.7	209.2	236.7	171.8	198.0	224.2	161.1	185.9	210.7	
		62	TC	255.8	255.8	263.9	245.6	245.6	258.3	234.9	234.9	252.1	223.4	223.4	245.7	211.3	211.3	238.8	199.3	199.3	229.8	186.2	186.2	219.4
		SHC	193.5	228.7	263.9	188.0	223.1	258.3	182.0	217.1	252.1	175.8	210.8	245.7	169.3	204.0	238.8	161.7	195.7	229.8	153.1	186.2	219.4	
		67	TC	278.8	278.8	278.8	267.8	267.8	267.8	256.2	256.2	256.2	243.2	243.2	243.2	229.8	229.8	229.8	215.6	215.6	215.6	200.3	200.3	200.3
	SHC	158.8	194.2	229.6	153.4	188.8	224.2	147.7	183.1	218.5	141.6	177.0	212.3	135.3	170.6	206.0	128.7	164.1	199.4	121.8	157.1	192.4		
	72	TC	304.9	304.9	304.9	293.4	293.4	293.4	281.0	281.0	281.0	267.6	267.6	267.6	253.2	253.2	253.2	237.7	237.7	237.7	221.3	221.3	221.3	
	SHC	123.5	159.3	195.0	118.4	154.1	189.7	112.8	148.5	184.2	107.1	142.6	178.2	100.8	136.4	172.0	94.4	129.9	165.4	87.6	123.0	158.5		
	76	TC	—	327.7	327.7	—	315.5	315.5	—	302.4	302.4	—	288.3	288.3	—	273.1	273.1	—	256.7	256.7	—	239.4	239.4	
	SHC	—	131.0	168.1	—	125.9	162.8	—	120.4	157.2	—	114.7	151.3	—	108.6	145.1	—	102.2	138.5	—	95.5	131.6		
8,000 CFM	EAT (wb)	58	TC	257.7	257.7	290.7	248.8	248.8	280.8	239.2	239.2	270.1	228.9	228.9	258.8	217.9	217.9	246.5	206.2					

COOLING CAPACITIES — THIRD STAGE, FULL LOAD (20 TONS) (cont)

50LC*B SIZE 24				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
9,000 CFM	58	TC	266.9	266.9	300.9	257.5	257.5	290.6	247.4	247.4	279.2	236.7	236.7	267.4	225.3	225.3	254.8	213.0	213.0	241.1	199.9	199.9	226.4	
		SHC	232.7	266.9	300.9	224.4	257.5	290.6	215.4	247.4	279.2	206.0	236.7	267.4	195.9	225.3	254.8	185.1	213.0	241.1	173.4	199.9	226.4	
	62	TC	268.9	268.9	304.0	258.7	258.7	297.3	247.7	247.7	290.4	236.9	236.9	278.0	225.5	225.5	264.8	213.2	213.2	250.7	200.1	200.1	235.5	
		SHC	217.4	260.7	304.0	211.3	254.3	297.3	205.0	247.7	290.4	195.9	236.9	278.0	186.2	225.5	264.8	175.8	213.2	250.7	164.7	200.1	235.5	
	67	TC	289.9	289.9	289.9	278.4	278.4	278.4	266.1	266.1	266.1	252.2	252.2	252.2	238.3	238.3	239.0	223.3	223.3	232.0	207.2	207.2	224.3	
		SHC	174.5	218.9	263.2	169.1	213.3	257.6	163.4	207.6	251.8	157.1	201.2	245.4	150.6	194.8	239.0	143.9	187.9	232.0	136.7	180.5	224.3	
	72	TC	316.7	316.7	316.7	304.4	304.4	304.4	291.1	291.1	291.1	277.0	277.0	277.0	261.8	261.8	261.8	245.4	245.4	245.4	228.1	228.1	228.1	
		SHC	130.6	175.2	219.8	125.3	169.8	214.3	119.6	164.1	208.7	113.7	158.1	202.6	107.3	151.8	196.2	100.7	145.1	189.3	93.8	138.1	182.3	
	76	TC	—	339.7	339.7	—	326.8	326.8	—	313.0	313.0	—	298.1	298.1	—	281.9	281.9	—	264.6	264.6	—	246.3	246.3	
		SHC	—	139.8	185.4	—	134.6	180.2	—	129.0	174.4	—	123.1	168.5	—	116.9	162.1	—	110.4	155.4	—	103.5	148.4	
10,000 CFM	58	TC	274.7	274.7	309.7	265.0	265.0	299.0	254.8	254.8	287.6	243.4	243.4	275.0	231.6	231.6	261.8	218.8	218.8	247.6	205.1	205.1	232.2	
		SHC	239.7	274.7	309.7	231.1	265.0	299.0	222.0	254.8	287.6	211.9	243.4	275.0	201.4	231.6	261.8	190.1	218.8	247.6	177.9	205.1	232.2	
	62	TC	274.7	274.7	321.5	265.3	265.3	310.7	255.1	255.1	298.9	243.6	243.6	285.8	231.8	231.8	272.1	219.0	219.0	257.4	205.2	205.2	241.5	
		SHC	228.0	274.7	321.5	220.0	265.3	310.7	211.2	255.1	298.9	201.4	243.6	285.8	191.5	231.8	272.1	180.7	219.0	257.4	169.1	205.2	241.5	
	67	TC	294.0	294.0	294.0	282.3	282.3	282.3	269.3	269.3	269.3	255.9	255.9	261.1	241.5	241.5	254.3	226.2	226.2	247.0	210.1	210.1	239.0	
		SHC	181.9	230.5	279.0	176.5	224.9	273.5	170.4	218.9	267.3	164.3	212.7	261.1	157.8	206.0	254.3	150.8	198.9	247.0	143.4	191.2	239.0	
	72	TC	320.9	320.9	320.9	308.3	308.3	308.3	294.7	294.7	294.7	280.4	280.4	280.4	264.8	264.8	264.8	248.0	248.0	248.0	230.4	230.4	230.4	
		SHC	133.8	182.5	231.4	128.3	177.2	225.9	122.7	171.4	220.2	116.7	165.4	214.0	110.4	158.9	207.6	103.6	152.2	200.8	96.7	145.1	193.5	
	76	TC	—	344.1	344.1	—	330.9	330.9	—	316.8	316.8	—	301.5	301.5	—	285.1	285.1	—	267.4	267.4	—	248.7	248.7	
		SHC	—	143.8	193.7	—	138.5	188.4	—	133.0	182.6	—	127.0	176.6	—	120.8	170.1	—	114.2	163.4	—	107.3	156.3	

LEGEND

- Do not operate
- CFM — Cubic Feet Per Minute (supply air)
- EAT (db) — Entering Air Temperature (dry bulb)
- EAT (wb) — Entering Air Temperature (wet bulb)
- SHC — Sensible Heat Capacity (1000 Btuh) Gross
- TC — Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — FIRST STAGE, PART LOAD (23 TONS)

50LC*B SIZE 26				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
2100 CFM	EAT (wb)	58	TC	106.4	106.4	108.5	103.1	103.1	106.6	99.5	99.5	104.6	95.8	95.8	102.5	91.9	91.9	100.0	87.9	87.9	96.9	84.0	84.0	91.7
		58	SHC	86.5	97.5	108.5	84.6	95.6	106.6	82.6	93.6	104.6	80.5	91.5	102.5	78.2	89.1	100.0	75.6	86.2	96.9	71.6	81.6	91.7
		62	TC	114.8	114.8	114.8	111.2	111.2	111.2	107.3	107.3	107.3	103.4	103.4	103.4	99.0	99.0	99.0	94.3	94.3	94.3	88.9	88.9	88.9
		62	SHC	78.3	89.4	100.4	76.4	87.5	98.5	74.4	85.5	96.5	72.3	83.4	94.5	70.1	81.2	92.2	67.8	78.8	89.8	65.1	76.1	87.2
		67	TC	126.5	126.5	126.5	122.6	122.6	122.6	118.4	118.4	118.4	114.0	114.0	114.0	109.2	109.2	109.2	104.0	104.0	104.0	98.3	98.3	98.3
	EAT (wb)	67	SHC	67.9	79.0	90.0	65.9	77.0	88.1	64.0	75.0	86.1	61.8	72.9	84.0	59.7	70.7	81.8	57.2	68.3	79.5	54.7	65.7	76.8
		72	TC	139.5	139.5	139.5	135.1	135.1	135.1	130.6	130.6	130.6	125.8	125.8	125.8	120.5	120.5	120.5	114.9	114.9	114.9	108.6	108.6	108.6
		72	SHC	57.0	68.3	79.6	55.1	66.3	77.6	53.1	64.4	75.6	51.0	62.3	73.5	48.8	60.1	71.3	46.5	57.7	68.8	44.0	55.1	66.3
		76	TC	—	150.9	150.9	—	146.2	146.2	—	141.3	141.3	—	136.0	136.0	—	130.4	130.4	—	124.2	124.2	—	117.5	117.5
		76	SHC	—	59.3	70.6	—	57.3	68.6	—	55.4	66.7	—	53.3	64.5	—	51.2	62.4	—	48.8	60.1	—	46.3	57.5
2800 CFM	EAT (wb)	58	TC	115.7	115.7	128.1	112.2	112.2	125.4	109.8	109.8	119.0	106.4	106.4	114.8	101.3	101.3	114.1	97.1	97.1	109.4	92.5	92.5	104.2
		58	SHC	99.7	113.9	128.1	97.3	111.3	125.4	93.2	106.1	119.0	90.0	102.4	114.8	88.4	101.3	114.1	84.8	97.1	109.4	80.7	92.5	104.2
		62	TC	123.9	123.9	123.9	119.7	119.7	119.7	115.4	115.4	115.4	110.9	110.9	111.4	105.9	105.9	109.0	100.5	100.5	106.4	94.8	94.8	103.4
		62	SHC	89.0	103.5	118.0	87.0	101.4	115.8	84.8	99.3	113.7	82.6	97.0	111.4	80.1	94.6	109.0	77.6	91.9	106.4	74.8	89.1	103.4
		67	TC	136.4	136.4	136.4	131.8	131.8	131.8	126.9	126.9	126.9	122.0	122.0	122.0	116.5	116.5	116.5	110.6	110.6	110.6	104.1	104.1	104.1
	EAT (wb)	67	SHC	75.1	89.6	104.1	73.0	87.6	102.1	70.9	85.4	99.9	68.6	83.2	97.7	66.3	80.8	95.3	63.8	78.3	92.7	61.0	75.6	90.0
		72	TC	150.2	150.2	150.2	145.1	145.1	145.1	139.8	139.8	139.8	134.3	134.3	134.3	128.3	128.3	128.3	121.9	121.9	121.9	114.9	114.9	114.9
		72	SHC	60.8	75.5	90.2	58.7	73.4	88.0	56.6	71.3	85.9	54.4	69.0	83.7	52.1	66.7	81.3	49.6	64.2	78.8	46.9	61.5	76.1
		76	TC	—	162.1	162.1	—	156.6	156.6	—	150.9	150.9	—	144.9	144.9	—	138.5	138.5	—	131.5	131.5	—	123.9	123.9
		76	SHC	—	63.8	78.8	—	61.7	76.7	—	59.6	74.6	—	57.4	72.4	—	55.1	70.1	—	52.7	67.7	—	50.0	64.9
3400 CFM	EAT (wb)	58	TC	123.7	123.7	139.4	121.4	121.4	136.7	119.0	119.0	133.8	116.3	116.3	130.7	113.3	113.3	127.0	109.9	109.9	123.1	106.0	106.0	118.6
		58	SHC	107.9	123.7	139.4	106.2	121.4	136.7	104.1	119.0	133.8	102.0	116.3	130.7	99.5	113.3	127.0	96.7	109.9	123.1	93.5	106.0	118.6
		62	TC	129.3	129.3	131.3	126.1	126.1	130.4	122.8	122.8	129.4	119.0	119.0	128.1	115.1	115.1	126.8	111.0	111.0	124.9	106.3	106.3	122.4
		62	SHC	96.9	114.1	131.3	95.9	113.2	130.4	95.1	112.2	129.4	93.9	111.1	128.1	92.6	109.7	126.8	91.2	108.0	124.9	89.1	105.7	122.4
		67	TC	141.3	141.3	141.3	137.5	137.5	137.5	133.6	133.6	133.6	129.5	129.5	129.5	124.9	124.9	124.9	119.8	119.8	119.8	114.3	114.3	114.3
	EAT (wb)	67	SHC	79.5	96.8	114.2	78.6	95.9	113.2	77.7	95.0	112.3	76.6	94.0	111.2	75.5	92.8	110.1	74.2	91.5	108.7	72.6	89.9	107.2
		72	TC	154.7	154.7	154.7	150.5	150.5	150.5	146.1	146.1	146.1	141.4	141.4	141.4	136.3	136.3	136.3	130.7	130.7	130.7	124.5	124.5	124.5
		72	SHC	61.6	79.2	96.6	60.8	78.3	95.7	59.9	77.3	94.8	58.9	76.3	93.8	57.8	75.2	92.6	56.6	73.9	91.3	55.0	72.3	89.7
		76	TC	—	166.3	166.3	—	161.7	161.7	—	156.8	156.8	—	151.6	151.6	—	146.1	146.1	—	139.9	139.9	—	133.2	133.2
		76	SHC	—	64.7	83.0	—	63.9	82.1	—	63.0	81.1	—	62.0	80.0	—	60.8	78.8	—	59.6	77.4	—	58.1	75.9
4050 CFM	EAT (wb)	58	TC	130.7	130.7	147.3	128.0	128.0	144.2	125.3	125.3	141.0	122.3	122.3	137.4	118.9	118.9	133.4	115.1	115.1	129.0	110.8	110.8	123.9
		58	SHC	114.0	130.7	147.3	111.8	128.0	144.2	109.6	125.3	141.0	107.2	122.3	137.4	104.3	118.9	133.4	101.1	115.1	129.0	97.5	110.8	123.9
		62	TC	133.6	133.6	144.6	130.2	130.2	143.4	126.7	126.7	142.1	122.9	122.9	140.4	110.9	119.0	138.5	115.1	115.1	133.8	110.9	110.9	128.5
		62	SHC	104.6	124.6	144.6	103.5	123.5	143.4	102.4	122.3	142.1	101.1	120.7	140.4	99.5	119.0	138.5	96.5	115.1	133.8	93.2	110.9	128.5
		67	TC	145.3	145.3	145.3	141.3	141.3	141.3	137.1	137.1	137.1	132.6	132.6	132.6	127.7	127.7	127.7	122.4	122.4	122.4	116.5	116.5	117.5
	EAT (wb)	67	SHC	84.4	104.6	124.9	83.5	103.7	123.9	82.5	102.7	122.9	81.4	101.6	121.8	80.1	100.4	120.6	78.8	99.0	119.1	77.2	97.3	117.5
		72	TC	159.1	159.1	159.1	154.5	154.5	154.5	149.9	149.9	149.9	144.8	144.8	144.8	139.3	139.3	139.3	133.4	133.4	133.4	126.8	126.8	126.8
		72	SHC	63.7	84.0	104.4	62.8	83.2	103.5	61.8	82.2	102.5	60.8	81.1	101.4	59.7	80.0	100.2	58.3	78.6	98.8	56.7	77.0	97.2
		76	TC	—	170.9	170.9	—	165.9	165.9	—	160.7	160.7	—	155.1	155.1	—	149.2	149.2	—	142.7	142.7	—	135.6	135.6
		76	SHC	—	67.4	88.4	—	66.5	87.5	—	65.5	86.4	—	64.4	85.2	—	63.3	84.0	—	62.0	82.6	—	60.5	81.0
4750 CFM	EAT (wb)	58	TC	136.9	136.9	154.3	133.9	133.9	150.9	130.8	130.8	147.2	127.4	127.4	143.2	123.7	123.7	138.9	119.5	119.5	134.1	114.9	114.9	128.6
		58	SHC	119.3	136.9	154.3	116.9	133.9	150.9	114.4	130.8	147.2	111.5	127.4	143.2	108.5	123.7	138.9	105	119.5	134.1	101.0	114.9	128.6
		62	TC	137.7	137.7	157.3	134.3	134.3	155.4	130.9	130.9	152.9	127.5	127.5	148.7	123.8	123.8	144.1	119.6	119.6	139.0	114.9	114.9	133.3
		62	SHC	112.0	134.6	157.3	110.7	133.1	155.4	108.9	130.9	152.9	106.4	127.5	148.7	103.4	123.8	144.1	100.2	119.6	139.0	96.5	114.9	133.3
		67	TC	148.6	148.6	148.6	144.2	144.2	144.2	139.8	139.8	139.8	135.1	135.1	135.1	130.1	130.1	131.2	124.5	124.5	129.7	118.5	118.5	127.8
	EAT (wb)	67	SHC	89.3	112.6	135.8	88.3	111.5	134.8	87.4	110.6	133.8	86.2	109.4	132.6	84.9	108.1	131.2	83.5	106.6	129.7	81.8	104.8	127.8
		72	TC	162.5	162.5	162.5	157.8	157.8	157.8	152.8	152.8	152.8	147.4	147.4	147.4	141.8	141.8	141.8	135.5	135.5	135.5	128.7	128.7	128.7
		72	SHC	65.7	89.0	112.4	64.7	88.0	111.4	63.8	87.1	110.4	62.7	85.9	109.2	61.4	84.7	107.9	60.1	83.3	106.5	58.5	81.6	104.8
		76	TC	—	174.5	174.5	—	169.3	169.3	—	163.7	163.7	—	158.0	158.0	—	151.7	151.7	—	144.9	144.9	—	137.5	137.5
		76	SHC	—	70.0	93.9	—	69.0	92.9	—	68.1	91.8	—	67.0	90.7	—	65.7	89.4	—	64.4	87.9	—	62.8	86.2
5400 CFM	EAT (wb)	58	TC	141.7	141.7	159.8	138.5	138.5	156.0	135.0	135.0	152.1	131.4	131.4	147.8	127.4	127.4	143.1	122.9	122.9	138.0	118.0	118.0	132.1
		58	SHC	123.4	141.7	159.8	120.8	138.5	156.0	118.1	135.0	152.1	115.1	131.4	147.8	111.7	127.4	143.1	107.9	122.9	138.0	103.7	118.0	132.1
		62	TC	141.8	141.8	166.0	138.5	138.5	162.0	135.1	135.1	157.9	131.5	131.5	153.4	127.5	127.5	148.5	123.0	123.0	143.0	118.0	118.0	137.0
		62	SHC	117.5	141.8	166.0	115.1	138.5	162.0	112.4	135.1	157.9	109.6	131.5	153.4	106.5	127.5	148.5	103.0	123.0	143.0	99.1	118.0	137.0
		67	TC	150.8	150.8	150.8	146.4	146.4	146.4	141.9	141.9	143.3	137.0	137.0	142.0									

COOLING CAPACITIES — FIRST STAGE, PART LOAD (23 TONS) (cont)

50LC*B SIZE 26				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
6100 CFM	EAT (wb)	58	TC	146.0	146.0	164.8	142.5	142.5	160.7	138.9	138.9	156.5	135.0	135.0	151.9	130.7	130.7	146.9	126.1	126.1	141.5	120.7	120.7	135.3
			SHC	127.2	146.0	164.8	124.4	142.5	160.7	121.4	138.9	156.5	118.2	135.0	151.9	114.6	130.7	146.9	110.7	126.1	141.5	106.2	120.7	135.3
		62	TC	146.2	146.2	171.2	142.6	142.6	166.9	139.0	139.0	162.4	135.1	135.1	157.7	130.8	130.8	152.5	126.1	126.1	146.7	120.8	120.8	140.3
			SHC	121.0	146.2	171.2	118.4	142.6	166.9	115.5	139.0	162.4	112.6	135.1	157.7	109.2	130.8	152.5	105.5	126.1	146.7	101.3	120.8	140.3
		67	TC	153.0	153.0	155.4	148.4	148.4	154.2	143.7	143.7	153.1	138.7	138.7	151.6	133.5	133.5	150.1	127.7	127.7	148.0	121.6	121.6	145.4
			SHC	98.1	126.8	155.4	97.1	125.7	154.2	95.9	124.5	153.1	94.8	123.2	151.6	93.4	121.7	150.1	91.7	119.8	148.0	89.7	117.6	145.4
		72	TC	167.1	167.1	167.1	161.9	161.9	161.9	156.6	156.6	156.6	150.8	150.8	150.8	144.8	144.8	144.8	138.3	138.3	138.3	131.0	131.0	131.0
			SHC	69.0	97.8	126.6	68.1	96.8	125.5	67.1	95.6	124.3	65.9	94.5	123.1	64.6	93.2	121.7	63.2	91.7	120.1	61.6	90.0	118.4
		76	TC	—	179.3	179.3	—	173.6	173.6	—	167.8	167.8	—	161.6	161.6	—	154.9	154.9	—	147.8	147.8	—	139.9	139.9
			SHC	—	74.5	103.7	—	73.5	102.7	—	72.4	101.5	—	71.3	100.2	—	70.0	98.9	—	68.5	97.3	—	66.9	95.4
6750 CFM	EAT (wb)	58	TC	149.4	149.4	168.6	145.8	145.8	164.4	142.0	142.0	159.9	137.9	137.9	155.1	133.4	133.4	150.0	128.4	128.4	144.2	122.9	122.9	137.8
			SHC	130.2	149.4	168.6	127.1	145.8	164.4	124.0	142.0	159.9	120.6	137.9	155.1	116.9	133.4	150.0	112.7	128.4	144.2	108.0	122.9	137.8
		62	TC	149.5	149.5	175.2	145.9	145.9	170.7	142.1	142.1	166.0	138.0	138.0	161.0	133.5	133.5	155.6	128.5	128.5	149.6	122.9	122.9	142.8
			SHC	123.8	149.5	175.2	121.0	145.9	170.7	118.1	142.1	166.0	114.9	138.0	161.0	111.3	133.5	155.6	107.4	128.5	149.6	103.1	122.9	142.8
		67	TC	154.6	154.6	164.3	150.1	150.1	163.0	145.2	145.2	161.6	140.2	140.2	160.0	134.8	134.8	158.0	129.2	129.2	155.5	123.1	123.1	151.9
			SHC	102.1	133.2	164.3	101.0	132.0	163.0	99.8	130.7	161.6	98.5	129.3	160.0	97.0	127.5	158.0	95.2	125.4	155.5	92.7	122.4	151.9
		72	TC	168.7	168.7	168.7	163.4	163.4	163.4	157.9	157.9	157.9	152.1	152.1	152.1	145.9	145.9	145.9	139.1	139.1	139.1	131.8	131.8	131.8
			SHC	70.6	101.8	133.0	69.6	100.7	131.9	68.5	99.6	130.7	67.4	98.4	129.4	66.1	97.0	127.9	64.6	95.5	126.4	63.0	93.8	124.5
		76	TC	—	181.0	181.0	—	175.2	175.2	—	169.2	169.2	—	162.7	162.7	—	156.0	156.0	—	148.7	148.7	—	140.7	140.7
			SHC	—	76.5	108.2	—	75.5	107.1	—	74.4	105.9	—	73.2	104.6	—	71.9	103.2	—	70.4	101.5	—	68.7	99.5

LEGEND

—	Do not operate
CFM	Cubic Feet Per Minute (supply air)
EAT (db)	Entering Air Temperature (dry bulb)
EAT (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — SECOND STAGE, PART LOAD (23 TONS)

50LC*B SIZE 26				AMBIENT TEMPERATURE (°F)																								
				65			75			85			95			105			115			125						
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)						
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85				
2400 CFM	EAT (wb)	58	TC	—	—	—	—	—	—	133.4	133.4	133.4	128.6	128.6	128.6	123.4	123.4	124.9	117.7	117.7	121.6	111.2	111.2	117.8				
		58	SHC	—	—	—	—	—	—	105.7	118.3	130.8	102.9	115.4	128.0	99.8	112.4	124.9	96.5	109.0	121.6	92.8	105.3	117.8				
		62	TC	153.3	153.3	153.3	148.7	148.7	148.7	143.9	143.9	143.9	138.8	138.8	138.8	133.2	133.2	133.2	126.9	126.9	126.9	119.9	119.9	119.9				
		62	SHC	101.8	114.4	126.9	99.2	111.7	124.3	96.4	109.0	121.6	93.6	106.2	118.8	90.6	103.2	115.7	87.3	99.8	112.3	83.6	96.1	108.7				
		67	TC	169.0	169.0	169.0	163.9	163.9	163.9	158.6	158.6	158.6	153.0	153.0	153.0	146.7	146.7	146.7	139.9	139.9	139.9	132.3	132.3	132.3				
	EAT (db)	67	SHC	90.1	102.7	115.3	87.4	100.0	112.6	84.6	97.3	109.9	81.8	94.4	107.1	78.7	91.3	103.9	75.4	87.9	100.5	71.7	84.2	96.9				
		72	TC	186.4	186.4	186.4	180.8	180.8	180.8	174.9	174.9	174.9	168.7	168.7	168.7	161.9	161.9	161.9	154.2	154.2	154.2	145.9	145.9	145.9				
		72	SHC	77.7	90.6	103.4	75.0	87.8	100.7	72.2	85.1	98.0	69.3	82.2	95.1	66.2	79.1	91.9	62.9	75.8	88.6	59.4	72.2	84.9				
		76	TC	—	201.6	201.6	—	195.5	195.5	—	189.0	189.0	—	182.1	182.1	—	174.6	174.6	—	166.5	166.5	—	157.5	157.5				
		76	SHC	—	80.3	93.2	—	77.6	90.5	—	74.8	87.7	—	71.9	84.7	—	68.7	81.6	—	65.4	78.3	—	61.8	74.7				
3200 CFM	EAT (wb)	58	TC	156.1	156.1	160.3	151.0	151.0	157.3	145.9	145.9	154.2	140.3	140.3	150.9	134.5	134.5	147.4	129.7	129.7	138.9	123.6	123.6	131.6				
		58	SHC	127.5	143.9	160.3	124.6	141.0	157.3	121.6	138.0	154.2	118.5	134.7	150.9	115.1	131.2	147.4	109.1	124.0	138.9	103.5	117.6	131.6				
		62	TC	168.0	168.0	168.0	162.4	162.4	162.4	156.7	156.7	156.7	150.6	150.6	150.6	144.0	144.0	144.0	136.8	136.8	136.8	128.7	128.7	128.7				
		62	SHC	115.1	131.6	148.0	112.2	128.7	145.1	109.2	125.7	142.2	106.2	122.6	139.0	102.8	119.2	135.6	99.2	115.6	132.0	95.3	111.6	128.0				
		67	TC	185.0	185.0	185.0	178.8	178.8	178.8	172.5	172.5	172.5	165.7	165.7	165.7	158.4	158.4	158.4	150.4	150.4	150.4	141.7	141.7	141.7				
	EAT (db)	67	SHC	99.5	116.0	132.5	96.5	113.0	129.5	93.5	110.0	126.6	90.3	106.9	123.3	87.0	103.4	119.9	83.4	99.8	116.3	79.5	95.9	112.4				
		72	TC	203.6	203.6	203.6	196.8	196.8	196.8	189.7	189.7	189.7	182.0	182.0	182.0	174.0	174.0	174.0	165.3	165.3	165.3	155.6	155.6	155.6				
		72	SHC	83.1	99.9	116.9	80.1	97.0	113.9	77.1	93.9	110.8	73.9	90.7	107.4	70.6	87.3	103.9	67.0	83.7	100.3	63.1	79.8	96.4				
		76	TC	—	219.4	219.4	—	212.0	212.0	—	204.3	204.3	—	196.2	196.2	—	187.4	187.4	—	177.9	177.9	—	167.5	167.5				
		76	SHC	—	86.2	103.4	—	83.3	100.4	—	80.2	97.4	—	77.1	94.3	—	73.7	90.9	—	70.2	87.4	—	66.4	83.6				
4050 CFM	EAT (wb)	58	TC	161.9	161.9	177.5	154.2	154.2	171.8	146.4	146.4	166.1	139.1	139.1	158.2	131.4	131.4	149.9	123.2	123.2	140.8	114.3	114.3	131.0				
		58	SHC	137.6	157.6	177.5	132.1	151.9	171.8	126.7	146.4	166.1	120.0	139.1	158.2	113.1	131.4	149.9	105.6	123.2	140.8	97.5	114.3	131.0				
		62	TC	174.1	174.1	174.1	165.7	165.7	165.7	157.1	157.1	157.1	148.1	148.1	148.1	138.6	138.6	141.7	128.6	128.6	135.5	117.8	117.8	129.0				
		62	SHC	123.0	143.4	163.8	117.8	138.1	158.4	112.3	132.7	153.0	106.9	127.1	147.4	101.1	121.4	141.7	95.2	115.3	135.5	88.7	108.9	129.0				
		67	TC	193.0	193.0	193.0	183.8	183.8	183.8	174.4	174.4	174.4	164.7	164.7	164.7	154.4	154.4	154.4	143.4	143.4	143.4	131.5	131.5	131.5				
	EAT (db)	67	SHC	104.5	125.0	145.4	99.2	119.6	140.0	93.8	114.2	134.6	88.2	108.6	129.0	82.5	102.9	123.2	76.5	96.9	117.3	70.3	90.7	111.0				
		72	TC	213.2	213.2	213.2	203.4	203.4	203.4	193.2	193.2	193.2	182.5	182.5	182.5	171.4	171.4	171.4	159.6	159.6	159.6	146.9	146.9	146.9				
		72	SHC	85.3	106.1	126.8	80.0	100.6	121.3	74.6	95.2	115.8	69.0	89.6	110.2	63.3	83.9	104.4	57.4	77.9	98.5	51.2	71.7	92.2				
		76	TC	—	230.4	230.4	—	220.0	220.0	—	209.1	209.1	—	197.8	197.8	—	186.0	186.0	—	173.5	173.5	—	160.0	160.0				
		76	SHC	—	90.2	111.9	—	84.9	106.7	—	79.6	101.3	—	74.1	95.8	—	68.4	90.0	—	62.5	83.9	—	56.4	77.5				
4850 CFM	EAT (wb)	58	TC	172.4	172.4	194.8	165.0	165.0	186.7	157.5	157.5	178.5	149.6	149.6	169.9	141.2	141.2	160.8	132.3	132.3	151.0	122.7	122.7	140.4				
		58	SHC	150.0	172.4	194.8	143.2	165.0	186.7	136.4	157.5	178.5	129.3	149.6	169.9	121.7	141.2	160.8	113.7	132.3	151.0	105.0	122.7	140.4				
		62	TC	182.0	182.0	182.0	173.1	173.1	176.1	164.0	164.0	170.5	154.5	154.5	164.7	144.7	144.7	158.5	134.4	134.4	151.9	123.3	123.3	144.5				
		62	SHC	134.1	157.9	181.7	128.6	152.4	176.1	123.0	146.7	170.5	117.3	141.0	164.7	111.3	134.9	158.5	105.0	128.4	151.9	98.3	121.4	144.5				
		67	TC	200.9	200.9	200.9	191.3	191.3	191.3	181.1	181.1	181.1	170.7	170.7	170.7	159.8	159.8	159.8	148.2	148.2	148.2	135.8	135.8	135.8				
	EAT (db)	67	SHC	111.9	135.8	159.7	106.5	130.4	154.2	100.8	124.6	148.5	95.1	119.0	142.8	89.2	113.1	136.9	83.1	107.0	130.7	76.7	100.5	124.3				
		72	TC	221.3	221.3	221.3	210.9	210.9	210.9	200.2	200.2	200.2	189.0	189.0	189.0	177.2	177.2	177.2	164.8	164.8	164.8	151.4	151.4	151.4				
		72	SHC	89.1	113.3	137.4	83.7	107.7	131.9	78.1	102.2	126.3	72.4	96.5	120.5	66.5	90.6	114.7	60.5	84.5	108.5	54.2	78.1	102.1				
		76	TC	—	238.7	238.7	—	227.6	227.6	—	216.2	216.2	—	204.3	204.3	—	191.9	191.9	—	178.6	178.6	—	164.6	164.6				
		76	SHC	—	94.8	120.4	—	89.3	114.8	—	83.8	109.0	—	78.1	103.2	—	72.3	97.2	—	66.2	91.0	—	60.0	84.5				
5700 CFM	EAT (wb)	58	TC	183.0	183.0	206.6	175.1	175.1	198.0	167.0	167.0	189.2	158.5	158.5	179.9	149.7	149.7	170.1	140.1	140.1	159.6	129.8	129.8	148.3				
		58	SHC	159.3	183.0	206.6	152.2	175.1	198.0	144.8	167.0	189.2	137.2	158.5	179.9	129.1	149.7	170.1	120.5	140.1	159.6	111.2	129.8	148.3				
		62	TC	188.7	188.7	199.2	179.4	179.4	193.3	170.0	170.0	187.4	160.4	160.4	181.1	150.4	150.4	174.2	140.2	140.2	166.3	130.0	130.0	154.6				
		62	SHC	144.7	172.0	199.2	139.0	166.2	193.3	133.3	160.3	187.4	127.2	154.1	181.1	121.0	147.6	174.2	114.1	140.2	166.3	105.2	130.0	154.6				
		67	TC	207.2	207.2	207.2	197.0	197.0	197.0	186.5	186.5	186.5	175.4	175.4	175.4	164.1	164.1	164.1	152.1	152.1	152.1	139.2	139.2	139.2				
	EAT (db)	67	SHC	118.9	146.3	173.7	113.2	140.7	168.1	107.5	134.9	162.3	101.7	129.0	156.4	95.6	123.0	150.4	89.5	116.8	144.2	83.0	110.3	137.6				
		72	TC	227.8	227.8	227.8	216.7	216.7	216.7	205.5	205.5	205.5	193.9	193.9	193.9	181.6	181.6	181.6	168.7	168.7	168.7	154.9	154.9	154.9				
		72	SHC	92.4	120.1	147.8	86.9	114.6	142.2	81.2	108.8	136.5	75.5	103.1	130.7	69.5	97.0	124.6	63.4	90.9	118.4	56.9	84.4	111.8				
		76	TC	—	245.2	245.2	—	233.6	233.6	—	221.7	221.7	—	209.3	209.3	—	196.5	196.5	—	182.6	182.6	—	168.1	168.1				
		76	SHC	—	98.9	127.6	—																					

COOLING CAPACITIES — SECOND STAGE, PART LOAD (23 TONS) (cont)

50LC*B SIZE 26				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
7300 CFM	58	TC	198.1	198.1	223.5	189.4	189.4	214.0	180.5	180.5	204.3	171.0	171.0	193.8	161.2	161.2	183.0	150.7	150.7	171.6	139.5	139.5	159.2	
		SHC	172.7	198.1	223.5	164.8	189.4	214.0	156.8	180.5	204.3	148.2	171.0	193.8	139.3	161.2	183.0	130.0	150.7	171.6	119.9	139.5	159.2	
	62	TC	199.1	199.1	227.8	189.3	189.3	222.2	180.7	180.7	212.4	171.2	171.2	201.6	161.4	161.4	190.5	150.9	150.9	178.7	139.6	139.6	165.8	
		SHC	162.1	195.0	227.8	156.6	189.3	222.2	148.9	180.7	212.4	140.7	171.2	201.6	132.2	161.4	190.5	123.1	150.9	178.7	113.4	139.6	165.8	
	67	TC	215.2	215.2	215.2	204.3	204.3	204.3	193.2	193.2	193.2	181.7	181.7	181.7	170.0	170.0	173.7	157.4	157.4	167.4	144.1	144.1	160.4	
		SHC	130.6	164.2	197.9	124.7	158.4	192.1	119.0	152.6	186.2	112.9	146.5	180.2	106.8	140.2	173.7	100.4	134.0	167.4	93.7	127.0	160.4	
	72	TC	236.0	236.0	236.0	224.4	224.4	224.4	212.6	212.6	212.6	200.3	200.3	200.3	187.4	187.4	187.4	173.8	173.8	173.8	159.4	159.4	159.4	
		SHC	97.8	131.7	165.7	92.0	126.0	159.9	86.3	120.2	154.1	80.4	114.3	148.0	74.3	108.1	141.9	68.1	101.8	135.4	61.5	95.2	128.8	
	76	TC	—	253.6	253.6	—	241.4	241.4	—	228.9	228.9	—	216.1	216.1	—	202.5	202.5	—	187.8	187.8	—	172.7	172.7	
		SHC	—	105.4	140.3	—	99.7	134.6	—	94.0	128.7	—	88.1	122.8	—	82.1	116.6	—	75.8	110.1	—	69.3	103.5	
8100 CFM	58	TC	204.0	204.0	230.1	194.9	194.9	220.2	185.6	185.6	209.9	175.8	175.8	199.2	165.7	165.7	188.0	154.8	154.8	176.1	143.2	143.2	163.3	
		SHC	177.9	204.0	230.1	169.7	194.9	220.2	161.3	185.6	209.9	152.4	175.8	199.2	143.3	165.7	188.0	133.6	154.8	176.1	123.1	143.2	163.3	
	62	TC	204.1	204.1	238.9	195.1	195.1	228.7	185.8	185.8	218.3	176.0	176.0	207.2	165.8	165.8	195.7	154.9	154.9	183.4	143.3	143.3	170.1	
		SHC	169.2	204.1	238.9	161.4	195.1	228.7	153.3	185.8	218.3	144.7	176.0	207.2	135.9	165.8	195.7	126.6	154.9	183.4	116.5	143.3	170.1	
	67	TC	218.1	218.1	218.1	207.1	207.1	207.1	195.9	195.9	197.6	184.3	184.3	191.3	172.2	172.2	185.0	159.5	159.5	178.1	146.2	146.2	170.6	
		SHC	135.9	172.6	209.3	130.1	166.8	203.6	124.2	160.9	197.6	118.1	154.7	191.3	111.9	148.5	185.0	105.4	141.8	178.1	98.6	134.6	170.6	
	72	TC	239.1	239.1	239.1	227.4	227.4	227.4	215.2	215.2	215.2	202.6	202.6	202.6	189.5	189.5	189.5	175.7	175.7	175.7	161.0	161.0	161.0	
		SHC	100.1	137.1	174.0	94.4	131.3	168.2	88.6	125.5	162.3	82.7	119.4	156.2	76.5	113.3	150.1	70.2	106.9	143.5	63.6	100.2	136.8	
	76	TC	—	256.7	256.7	—	244.3	244.3	—	231.7	231.7	—	218.5	218.5	—	204.7	204.7	—	189.7	189.7	—	174.4	174.4	
		SHC	—	108.3	146.3	—	102.7	140.4	—	96.9	134.6	—	91.0	128.6	—	84.9	122.4	—	78.5	115.8	—	72.0	109.2	

LEGEND

—	Do not operate
CFM	Cubic Feet Per Minute (supply air)
EAT (db)	Entering Air Temperature (dry bulb)
EAT (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

COOLING CAPACITIES — THIRD STAGE, FULL LOAD (23 TONS)

50LC*B SIZE 26				AMBIENT TEMPERATURE (°F)																							
				65			75			85			95			105			115			125					
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)					
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85			
4,500 CFM	58	TC	—	—	—	—	—	—	222.4	222.4	225.8	214.3	214.3	221.0	205.5	205.5	215.9	195.9	195.9	210.1	185.3	185.3	203.5				
		SHC	—	—	—	—	—	—	180.3	203.0	225.8	175.6	198.3	221.0	170.6	193.2	215.9	165.0	187.6	210.1	158.7	181.2	203.5				
	62	TC	254.4	254.4	254.4	246.7	246.7	246.7	238.5	238.5	238.5	229.7	229.7	229.7	220.1	220.1	220.1	209.4	209.4	209.4	197.6	197.6	197.6				
		SHC	171.3	194.0	216.8	167.1	189.8	212.6	162.6	185.4	208.3	158.0	180.8	203.5	152.9	175.7	198.5	147.4	170.2	193.0	141.5	164.3	187.0				
	67	TC	278.8	278.8	278.8	270.3	270.3	270.3	261.3	261.3	261.3	251.7	251.7	251.7	241.4	241.4	241.4	230.0	230.0	230.0	217.4	217.4	217.4				
		SHC	149.1	172.0	195.0	144.8	167.7	190.7	140.4	163.3	186.2	135.7	158.6	181.5	130.7	153.7	176.6	125.4	148.3	171.2	119.6	142.4	165.4				
	72	TC	305.6	305.6	305.6	295.8	295.8	295.8	286.3	286.3	286.3	275.9	275.9	275.9	264.7	264.7	264.7	252.3	252.3	252.3	238.7	238.7	238.7				
		SHC	125.2	149.4	173.5	120.9	144.9	168.9	116.8	140.6	164.4	112.4	136.0	159.6	107.6	131.1	154.6	102.5	125.8	149.2	96.8	120.0	143.3				
	76	TC	—	328.6	328.6	—	318.8	318.8	—	308.5	308.5	—	297.3	297.3	—	285.0	285.0	—	271.7	271.7	—	257.0	257.0				
		SHC	—	129.4	153.5	—	125.4	149.5	—	121.2	145.3	—	116.7	140.9	—	111.9	136.1	—	106.9	130.9	—	101.3	125.4				
5,100 CFM	58	TC	245.9	245.9	250.9	238.4	238.4	246.5	230.6	230.6	241.9	222.1	222.1	236.8	212.9	212.9	231.3	203.1	203.1	224.9	192.7	192.7	217.0				
		SHC	200.1	225.4	250.9	195.7	221.1	246.5	191.2	216.5	241.9	186.3	211.6	236.8	181.1	206.1	231.3	175.1	200.1	224.9	168.2	192.7	217.0				
	62	TC	263.3	263.3	263.3	255.1	255.1	255.1	246.3	246.3	246.3	236.9	236.9	236.9	226.8	226.8	226.8	215.7	215.7	215.7	203.5	203.5	203.5				
		SHC	180.1	205.5	231.1	175.7	201.2	226.7	171.1	196.7	222.1	166.3	191.8	217.2	161.2	186.6	212.1	155.6	181.1	206.5	149.7	175.0	200.5				
	67	TC	288.0	288.0	288.0	279.0	279.0	279.0	269.5	269.5	269.5	259.4	259.4	259.4	248.6	248.6	248.6	236.5	236.5	236.5	223.3	223.3	223.3				
		SHC	154.9	180.6	206.2	150.5	176.2	201.8	146.1	171.7	197.3	141.3	166.9	192.6	136.3	161.9	187.5	130.7	156.4	181.9	124.9	150.4	176.0				
	72	TC	315.8	315.8	315.8	305.6	305.6	305.6	295.4	295.4	295.4	284.3	284.3	284.3	272.4	272.4	272.4	259.3	259.3	259.3	244.8	244.8	244.8				
		SHC	128.8	155.4	181.9	124.4	150.8	177.3	120.1	146.4	172.8	115.4	141.7	167.8	110.5	136.6	162.7	105.1	131.1	157.2	99.4	125.3	151.2				
	76	TC	—	339.3	339.3	—	329.0	329.0	—	317.9	317.9	—	306.0	306.0	—	293.0	293.0	—	278.9	278.9	—	263.4	263.4				
		SHC	—	133.3	160.6	—	129.2	156.5	—	124.9	152.2	—	120.3	147.7	—	115.4	142.7	—	110.2	137.6	—	104.6	131.9				
5,650 CFM	58	TC	245.1	245.1	257.2	234.2	234.2	249.4	222.8	222.8	241.3	211.0	211.0	232.7	198.7	198.7	223.4	186.0	186.0	212.6	173.2	173.2	198.5				
		SHC	201.7	229.5	257.2	194.0	221.7	249.4	186.1	213.7	241.3	177.8	205.3	232.7	169.1	196.3	223.4	159.4	186.0	212.6	147.8	173.2	198.5				
	62	TC	263.5	263.5	263.5	251.6	251.6	251.6	239.3	239.3	239.3	226.3	226.3	226.3	212.6	212.6	212.6	197.9	197.9	197.9	182.2	182.2	186.4				
		SHC	181.0	208.8	236.7	173.3	201.1	229.0	165.4	193.2	221.1	157.3	185.2	213.0	148.9	176.8	204.7	140.1	167.9	195.8	130.8	158.6	186.4				
	67	TC	290.6	290.6	290.6	277.5	277.5	277.5	264.5	264.5	264.5	250.8	250.8	250.8	236.2	236.2	236.2	220.5	220.5	220.5	203.3	203.3	203.3				
		SHC	155.2	183.3	211.4	147.3	175.4	203.4	139.5	167.6	195.6	131.5	159.5	187.5	123.1	151.1	179.1	114.5	142.4	170.3	105.2	133.1	161.0				
	72	TC	319.9	319.9	319.9	306.5	306.5	306.5	292.6	292.6	292.6	277.9	277.9	277.9	262.1	262.1	262.1	245.2	245.2	245.2	227.1	227.1	227.1				
		SHC	128.2	157.0	185.7	120.7	149.4	178.1	113.0	141.7	170.2	105.1	133.6	162.1	96.7	125.2	153.7	88.1	116.5	144.9	79.1	107.3	135.6				
	76	TC	—	345.7	345.7	—	331.6	331.6	—	316.8	316.8	—	301.1	301.1	—	284.3	284.3	—	266.4	266.4	—	247.1	247.1				
		SHC	—	134.8	165.1	—	127.4	157.8	—	119.8	150.2	—	111.9	142.3	—	103.7	134.1	—	95.3	125.6	—	86.4	116.7				
6,750 CFM	58	TC	259.0	259.0	284.5	247.7	247.7	275.9	236.0	236.0	267.5	224.8	224.8	255.5	212.8	212.8	242.3	200.0	200.0	228.2	186.1	186.1	212.9				
		SHC	220.6	252.5	284.5	212.5	244.1	275.9	204.3	236.0	267.5	194.3	224.8	255.5	183.4	212.8	242.3	171.8	200.0	228.2	159.3	186.1	212.9				
	62	TC	275.4	275.4	275.4	262.9	262.9	262.9	249.9	249.9	249.9	236.2	236.2	236.6	222.1	222.1	228.0	206.8	206.8	218.7	190.5	190.5	208.8				
		SHC	196.0	228.4	261.0	188.1	220.5	253.1	180.1	212.6	245.0	171.7	204.2	236.6	163.1	195.6	228.0	154.1	186.4	218.7	144.5	176.7	208.8				
	67	TC	303.3	303.3	303.3	289.2	289.2	289.2	275.4	275.4	275.4	260.8	260.8	260.8	245.4	245.4	245.4	228.7	228.7	228.7	210.9	210.9	210.9				
		SHC	165.5	198.1	230.8	157.3	189.9	222.6	149.4	181.9	214.6	141.1	173.6	206.3	132.5	165.1	197.6	123.5	156.1	188.6	114.1	146.6	179.1				
	72	TC	333.4	333.4	333.4	319.1	319.1	319.1	304.3	304.3	304.3	288.6	288.6	288.6	271.7	271.7	271.7	254.1	254.1	254.1	234.9	234.9	234.9				
		SHC	133.9	167.2	200.5	126.2	159.4	192.7	118.3	151.4	184.6	110.1	143.2	176.3	101.5	134.6	167.6	92.7	125.7	158.5	83.5	116.3	149.2				
	76	TC	—	359.5	359.5	—	344.5	344.5	—	328.7	328.7	—	312.0	312.0	—	294.3	294.3	—	275.2	275.2	—	255.1	255.1				
		SHC	—	141.9	178.0	—	134.3	170.4	—	126.5	162.7	—	118.4	154.2	—	109.8	145.3	—	100.9	135.9	—	91.7	126.4				
7,900 CFM	58	TC	272.4	272.4	307.7	261.4	261.4	295.6	249.9	249.9	283.1	237.8	237.8	269.9	225.1	225.1	256.0	211.5	211.5	241.0	196.9	196.9	224.9				
		SHC	237.1	272.4	307.7	227.1	261.4	295.6	216.6	249.9	283.1	205.7	237.8	269.9	194.3	225.1	256.0	181.9	211.5	241.0	168.8	196.9	224.9				
	62	TC	285.3	285.3	285.3	272.2	272.2	276.6	258.9	258.9	268.2	244.8	244.8	259.5	230.2	230.2	250.4	214.6	214.6	240.4	198.1	198.1	229.5				
		SHC	210.4	247.7	284.8	202.3	239.5	276.6	194.1	231.2	268.2	185.6	222.6	259.5	176.8	213.5	250.4	167.3	203.9	240.4	157.2	193.3	229.5				
	67	TC	313.6	313.6	313.6	298.9	298.9	298.9	284.4	284.4	284.4	269.0	269.0	269.0	252.8	252.8	252.8	235.5	235.5	235.5	216.8	216.8	216.8				
		SHC	175.2	212.5	249.8	166.9	204.3	241.5	158.7	196.1	233.3	150.2	187.5	224.7	141.6	178.7	216.0	132.4	169.6	206.7	122.8	159.9	197.0				
	72	TC	344.1	344.1	344.1	329.2	329.2	329.2	313.6	313.6	313.6	297.1	297.1	297.1	279.6	279.6	279.6	261.0	261.0	261.0	241.1	241.1	241.1				
		SHC	138.9	176.9	214.7	131.0	168.9	206.7	122.9	160.8	198.5	114.7	152.3	190.0	105.9	143.5	181.2	96.9	134.5	172.0	87.5	124.9	162.3				
	76	TC	—	370.5	370.5	—	354.7	354.7	—	338.2	338.2	—	320.7	320.7	—	302.2	302.2	—	282.4	282.4	—	261.4	261.4				
		SHC	—	148.1	189.2																						

COOLING CAPACITIES — THIRD STAGE, FULL LOAD (23 TONS) (cont)

50LC*B SIZE 26				AMBIENT TEMPERATURE (°F)																				
				65			75			85			95			105			115			125		
				EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)		
				75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	75	80	85
10,150 CFM	EAT (wb)	58	TC	295.3	295.3	333.4	282.8	282.8	319.5	270.4	270.4	306.0	257.3	257.3	291.6	243.4	243.4	276.4	228.5	228.5	260.0	212.6	212.6	242.4
			SHC	257.4	295.3	333.4	246.0	282.8	319.5	234.8	270.4	306.0	223.0	257.3	291.6	210.4	243.4	276.4	197.0	228.5	260.0	182.6	212.6	242.4
		62	TC	301.0	301.0	326.6	286.7	286.7	317.2	272.9	272.9	307.7	258.6	258.6	297.6	243.4	243.4	287.3	228.8	228.8	270.9	212.7	212.7	252.6
			SHC	235.9	281.2	326.6	226.9	272.0	317.2	218.1	263.0	307.7	208.8	253.2	297.6	199.4	243.4	287.3	186.7	228.8	270.9	172.9	212.7	252.6
		67	TC	327.1	327.1	327.1	312.2	312.2	312.2	296.7	296.7	296.7	280.3	280.3	280.3	263.0	263.0	263.0	244.5	244.5	244.5	225.1	225.1	229.2
			SHC	191.6	237.5	283.4	183.4	229.3	275.1	175.0	220.8	266.7	166.3	212.1	257.9	157.3	203.0	248.7	147.8	193.5	239.3	138.1	183.6	229.2
		72	TC	358.8	358.8	358.8	342.9	342.9	342.9	326.3	326.3	326.3	308.8	308.8	308.8	290.2	290.2	290.2	270.4	270.4	270.4	249.5	249.5	249.5
			SHC	147.0	193.4	239.9	138.9	185.3	231.8	130.7	177.0	223.3	122.1	168.3	214.5	113.1	159.2	205.3	103.8	149.9	195.9	94.2	140.1	185.9
		76	TC	—	385.6	385.6	—	368.8	368.8	—	351.3	351.3	—	332.7	332.7	—	313.0	313.0	—	292.1	292.1	—	270.0	270.0
			SHC	—	157.9	206.8	—	149.8	198.5	—	141.5	189.9	—	132.9	181.2	—	123.9	172.0	—	114.8	162.5	—	105.1	152.6
11,250 CFM	EAT (wb)	58	TC	304.2	304.2	343.2	291.1	291.1	328.9	278.5	278.5	314.9	264.8	264.8	300.1	250.5	250.5	284.3	235.1	235.1	267.3	218.6	218.6	249.1
			SHC	265.2	304.2	343.2	253.4	291.1	328.9	241.9	278.5	314.9	229.6	264.8	300.1	216.6	250.5	284.3	202.8	235.1	267.3	188.0	218.6	249.1
		62	TC	307.2	307.2	344.3	293.7	293.7	334.6	278.4	278.4	327.1	264.9	264.9	311.9	250.8	250.8	295.9	235.4	235.4	278.4	218.8	218.8	259.5
			SHC	246.6	295.4	344.3	237.7	286.2	334.6	229.6	278.4	327.1	217.9	264.9	311.9	205.5	250.8	295.9	192.3	235.4	278.4	177.9	218.8	259.5
		67	TC	332.2	332.2	332.2	316.9	316.9	316.9	301.0	301.0	301.0	284.3	284.3	284.3	266.6	266.6	266.6	248.0	248.0	254.0	228.2	228.2	243.8
			SHC	199.0	248.9	298.8	190.7	240.5	290.5	182.2	232.1	281.8	173.5	223.2	272.9	164.3	214.0	263.7	154.8	204.5	254.0	144.9	194.3	243.8
		72	TC	364.2	364.2	364.2	347.9	347.9	347.9	330.8	330.8	330.8	313.0	313.0	313.0	293.9	293.9	293.9	273.8	273.8	273.8	252.4	252.4	252.4
			SHC	150.4	200.9	251.3	142.4	192.7	243.0	133.9	184.2	234.4	125.3	175.4	225.5	116.2	166.2	216.3	106.9	156.8	206.7	97.1	146.9	196.7
		76	TC	—	391.1	391.1	—	373.9	373.9	—	356.0	356.0	—	337.0	337.0	—	316.8	316.8	—	295.5	295.5	—	273.0	273.0
			SHC	—	162.0	214.8	—	154.0	206.5	—	145.6	197.9	—	136.9	189.1	—	127.9	179.8	—	118.6	170.2	—	108.8	160.3

LEGEND

- Do not operate
- CFM — Cubic Feet Per Minute (supply air)
- EAT (db) — Entering Air Temperature (dry bulb)
- EAT (wb) — Entering Air Temperature (wet bulb)
- SHC — Sensible Heat Capacity (1000 Btuh) Gross
- TC — Total Capacity (1000 Btuh) Gross

PRESSURE DROP FOR ELECTRIC HEAT — ALL VOLTAGES


CFM	3,750	4,250	4,750	5,250	5,750	6,250	6,750	7,250
25kW	0.00	0.01	0.01	0.01	0.02	0.02	0.03	0.03
50kW	0.01	0.01	0.02	0.03	0.03	0.04	0.05	0.06
75kW	0.01	0.02	0.03	0.04	0.05	0.06	0.08	0.09

CFM	7,750	8,250	8,750	9,250	9,750	10,250	10,750	11,250
25kW	0.04	0.04	0.05	0.05	0.06	0.07	0.08	0.08
50kW	0.07	0.08	0.10	0.11	0.12	0.14	0.15	0.17
75kW	0.11	0.13	0.14	0.16	0.18	0.21	0.23	0.25

ECONOMIZER, BAROMETRIC RELIEF, AND POWER EXHAUST PERFORMANCE


LOW LEAK ECONOMIZER PRESSURE DROP

CFM	3,750	4,250	4,750	5,250	5,750	6,250	6,750	7,250
Pressure drop (in. wg)	0.04	0.04	0.05	0.06	0.06	0.07	0.07	0.08
CFM	7,750	8,250	8,750	9,250	9,750	10,250	10,750	11,250
Pressure drop (in. wg)	0.08	0.09	0.09	0.10	0.10	0.11	0.11	0.12


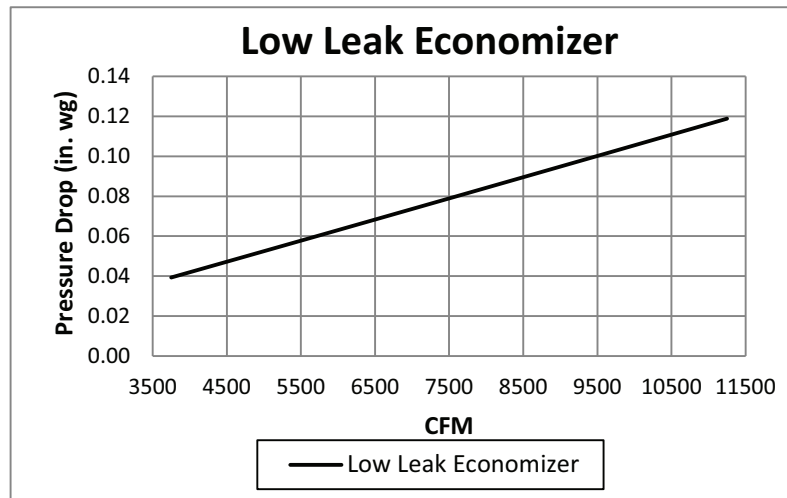


ELECTRIC HEAT PRESSURE DROP FOR 50LC*B14-26, ALL VOLTAGES

CFM	3,750	4,250	4,750	5,250	5,750	6,250	6,750	7,250	7,750	8,250	8,750	9,250	9,750	10,250	10,750	11,250
25kW	0.00	0.01	0.01	0.01	0.02	0.02	0.03	0.03	0.04	0.04	0.05	0.05	0.06	0.07	0.08	0.08
50kW	0.01	0.01	0.02	0.03	0.03	0.04	0.05	0.06	0.07	0.08	0.10	0.11	0.12	0.14	0.15	0.17
75kW	0.01	0.02	0.03	0.04	0.05	0.06	0.08	0.09	0.11	0.13	0.14	0.16	0.18	0.21	0.23	0.25

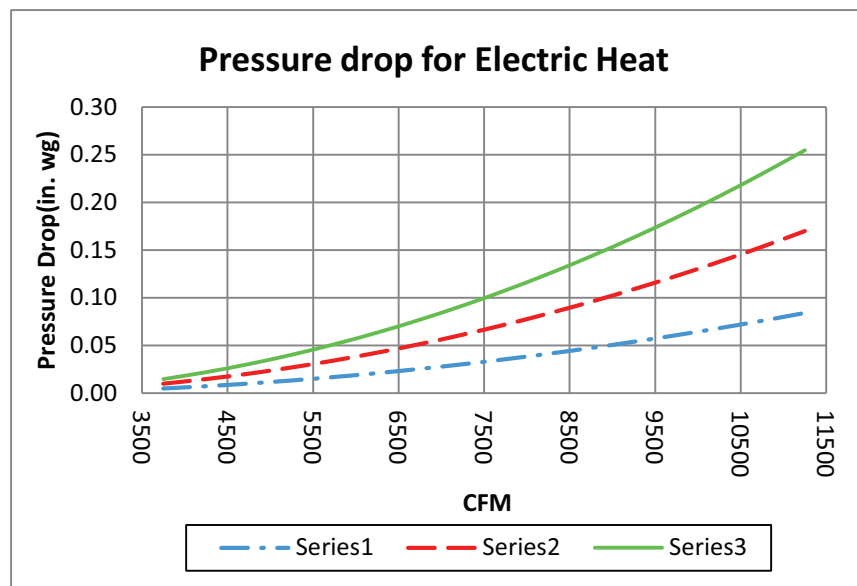

ECONOMIZER, BAROMETRIC RELIEF, AND POWER EXHAUST PERFORMANCE (cont)

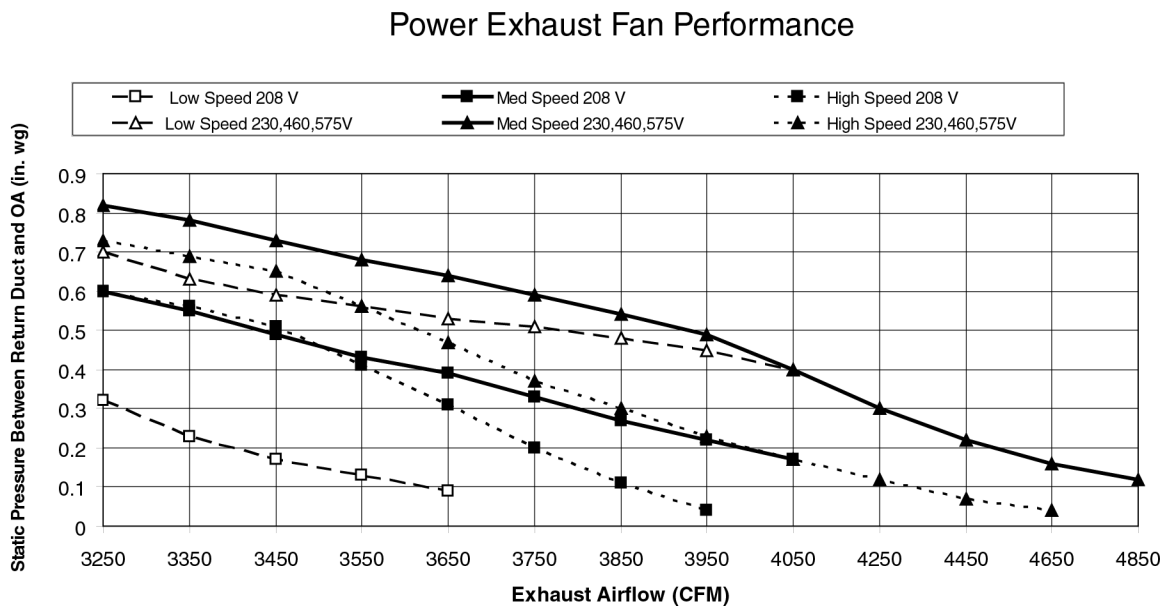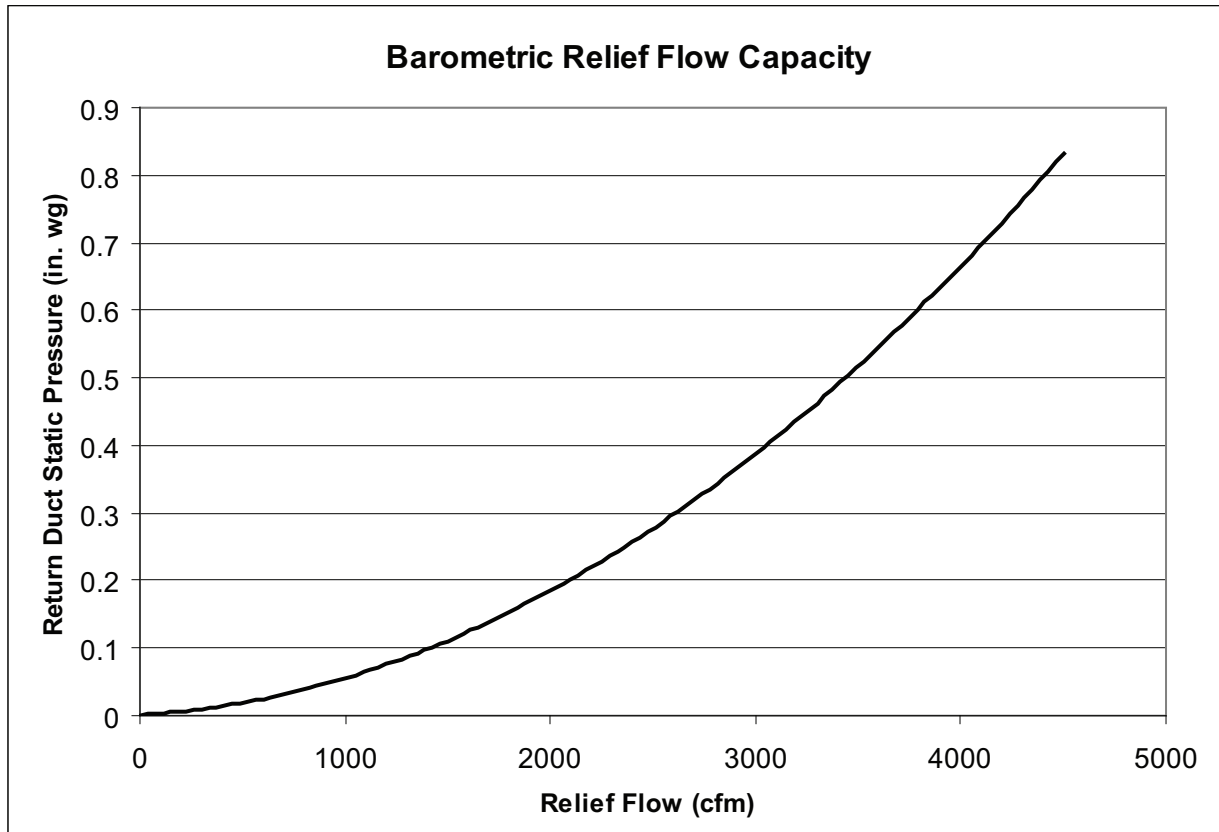

General Fan Performance Notes

1. Interpolation is permissible. Do not extrapolate.
2. External static pressure is the static pressure difference between the return duct and the supply duct plus the static pressure caused by any FIOPs or accessories.
3. Tabular data accounts for pressure loss due to clean filters, unit casing, and wet coils. Factory options and accessories may add static pressure losses. Selection software is available, through your salesperson, to help you select the best motor/drive combination for your application.
4. The fan performance tables offer motor/drive recommendations. In cases when 2 motor/drive combinations would work, Carrier recommends the lower horsepower option.
5. For information on the electrical properties of Carrier motors, please see the electrical information section of this book.
6. For more information on the performance limits of Carrier motors, see the application data section of this book.
7. The EPACT (Energy Policy Act) regulates energy requirements for specific types of indoor fan motors. Motors regulated by EPACT include any general purpose, T-frame (3-digit, 143 and larger), single-speed, foot mounted, polyphase, squirrel cage induction motors of NEMA (National Electrical Manufacturers Association) design A and B, manufactured for use in the United States. Ranging from 1 to 200 Hp, these continuous-duty motors operate on 230 and 460 volt, 60 Hz power. If a motor does not fit into these specifications, the motor does not have to be replaced by an EPACT compliant energy-efficient motor. Variable-speed motors are exempt from EPACT compliance requirements.

50LC*B14 — 12.5 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3750	426	0.62	513	1.01	584	1.43	645	1.88	700	2.36
4063	445	0.72	530	1.13	600	1.58	661	2.05	715	2.55
4375	465	0.83	547	1.27	617	1.74	677	2.24	731	2.75
4688	485	0.95	565	1.41	633	1.91	693	2.43	747	2.97
5000	506	1.09	584	1.58	650	2.09	709	2.64	762	3.21
5313	527	1.25	602	1.75	668	2.29	726	2.86	779	3.45
5625	549	1.42	622	1.95	686	2.51	743	3.10	795	3.72
5938	571	1.61	641	2.16	704	2.74	760	3.36	812	4.00
6250	593	1.82	661	2.39	722	3.00	778	3.64	829	4.30

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3750	749	2.85	794	3.36	836	3.88	875	4.42	913	4.98
4063	764	3.06	809	3.60	851	4.15	891	4.71	928	5.29
4375	780	3.29	825	3.85	867	4.42	906	5.01	944	5.62
4688	795	3.54	840	4.12	882	4.71	922	5.33	959	5.95
5000	811	3.79	856	4.40	898	5.02	937	5.65	974	6.31
5313	827	4.06	871	4.69	913	5.34	953	6.00	990	6.67
5625	843	4.35	887	5.00	929	5.67	968	6.36	1005	7.06
5938	859	4.66	903	5.33	945	6.03	984	6.73	1021	7.46
6250	876	4.98	919	5.68	961	6.40	1000	7.13	1037	7.87

	STD Static (498-676 rpm) 2.9 Max bhp
	MID Static (644-808 rpm) 4.9 Max bhp
	HIGH Static (707-888 rpm) 7.4 Max bhp
	ULTRA HIGH Static (872-1053 rpm) 9.9 Max bhp
	Indicates field-supplied drive is required (Standard motor, motor pulley P/N KR11HY163, blower pulley P/N KR51BM415, belt P/N KR29AF049) for the 368-509 rpm range
Boldface	

50LC*B14 — 12.5 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3750	413	0.41	514	0.61	600	0.82	673	1.03	738	1.25
4063	429	0.49	526	0.70	610	0.93	684	1.15	749	1.39
4375	447	0.57	539	0.80	621	1.04	694	1.28	759	1.53
4688	466	0.67	553	0.91	633	1.16	705	1.42	769	1.69
5000	485	0.78	568	1.03	645	1.30	716	1.57	779	1.85
5313	505	0.90	584	1.16	659	1.44	727	1.74	790	2.03
5625	525	1.04	600	1.31	672	1.61	739	1.91	801	2.22
5938	546	1.20	618	1.48	687	1.78	752	2.10	813	2.42
6250	568	1.37	636	1.66	702	1.97	765	2.30	825	2.64

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3750	797	1.46	851	1.68	901	1.90	948	2.12	992	2.34
4063	807	1.62	861	1.85	912	2.09	958	2.32	1003	2.56
4375	818	1.78	872	2.03	922	2.28	969	2.53	1013	2.79
4688	828	1.95	882	2.22	932	2.49	979	2.76	1024	3.03
5000	838	2.14	892	2.42	942	2.70	990	2.99	1034	3.28
5313	848	2.33	902	2.63	952	2.93	1000	3.23	1045	3.54
5625	859	2.54	912	2.85	963	3.17	1010	3.49	1055	3.81
5938	870	2.75	923	3.09	973	3.42	1020	3.76	1065	4.10
6250	881	2.99	934	3.34	983	3.69	1030	4.04	1075	4.39

	STD Static (498-676 rpm) 2.9 Max bhp
	MID Static (682-861 rpm) 4.9 Max bhp
	HIGH Static (782-963 rpm) 7.4 Max bhp
	ULTRA HIGH Static (933-1113 rpm) 9.9 Max bhp
Boldface	Indicates field-supplied drive is required (Standard motor, motor pulley P/N KR11HY163, blower pulley P/N KR51BM415, belt P/N KR29AF049) for the 368-509 rpm range

50LC*B17 — 15 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	466	1.00	546	1.48	615	2.01	677	2.59	732	3.21
4875	491	1.19	567	1.69	634	2.25	695	2.86	749	3.50
5250	517	1.40	589	1.93	654	2.51	713	3.14	767	3.81
5625	543	1.65	612	2.20	674	2.80	732	3.46	785	4.15
6000	570	1.93	635	2.50	696	3.13	752	3.81	804	4.53
6375	598	2.24	660	2.83	718	3.49	772	4.19	823	4.93
6750	626	2.59	685	3.20	740	3.88	793	4.60	843	5.37
7125	654	2.98	710	3.62	764	4.31	815	5.06	863	5.85
7500	683	3.41	736	4.07	788	4.78	837	5.55	884	6.37

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	783	3.85	829	4.52	873	5.22	914	5.94	953	6.68
4875	799	4.17	846	4.87	889	5.59	930	6.34	969	7.11
5250	817	4.51	863	5.24	906	5.99	947	6.77	986	7.56
5625	834	4.88	880	5.63	923	6.42	964	7.22	1002	8.05
6000	852	5.28	897	6.06	940	6.87	980	7.70	1019	8.55
6375	870	5.71	915	6.52	957	7.35	998	8.21	1036	9.09
6750	889	6.17	933	7.01	975	7.87	1015	8.75	1053	9.66
7125	909	6.67	952	7.53	993	8.42	1033	9.33	1070	10.27
7500	929	7.22	971	8.10	1012	9.01	1051	9.95	1088	10.91

	STD Static (498-676 rpm) 2.9 Max bhp
	MID Static (651-818 rpm) 7.4 Max bhp
	HIGH Static (804-970 rpm) 9.9 Max bhp
	ULTRA HIGH Static (948-1190 rpm) 13.6 Max bhp
Boldface	Indicates field-supplied drive is required (Standard motor (HD58FE654), motor pulley P/N KR11HY216, blower pulley P/N KR51BN615, belt P/N KR29BF052) for the 403-529 rpm range

50LC*B17 — 15 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	420	0.55	535	0.88	620	1.19	689	1.48	751	1.79
4875	439	0.65	547	0.99	634	1.34	703	1.66	764	1.99
5250	460	0.77	557	1.11	647	1.50	717	1.86	778	2.20
5625	483	0.91	568	1.24	659	1.67	731	2.06	793	2.44
6000	508	1.08	580	1.38	670	1.84	745	2.27	807	2.68
6375	534	1.26	595	1.55	681	2.01	757	2.49	821	2.94
6750	560	1.47	613	1.74	691	2.20	769	2.72	834	3.21
7125	587	1.71	633	1.97	702	2.40	779	2.95	847	3.48
7500	615	1.97	655	2.22	716	2.63	790	3.19	858	3.76

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	809	2.10	864	2.43	917	2.78	968	3.14	1018	3.53
4875	821	2.32	874	2.66	925	3.01	975	3.38	1023	3.77
5250	834	2.55	886	2.91	936	3.28	983	3.66	1030	4.05
5625	848	2.81	899	3.18	948	3.56	994	3.96	1039	4.36
6000	862	3.08	913	3.47	961	3.87	1006	4.28	1050	4.70
6375	877	3.37	927	3.79	975	4.21	1019	4.63	1062	5.07
6750	891	3.67	942	4.12	989	4.56	1033	5.01	1076	5.46
7125	904	3.98	956	4.46	1003	4.94	1047	5.41	1090	5.88
7500	917	4.31	970	4.83	1017	5.33	1062	5.83	1104	6.32

	STD Static (498-676 rpm) 2.9 Max bhp
	MID Static (651-818 rpm) 7.4 Max bhp
	HIGH Static (804-970 rpm) 9.9 Max bhp
	ULTRA HIGH Static (948-1190 rpm) 13.6 Max bhp
Boldface	Indicates field-supplied drive is required (Standard motor (HD58FE654), motor pulley P/N KR11HY216, blower pulley P/N KR51BN615, belt P/N KR29BF052) for the 403-529 rpm range

50LC*B20 — 17.5 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
5250	517	1.40	589	1.93	654	2.51	713	3.14	767	3.81
5688	548	1.70	615	2.24	678	2.86	735	3.52	788	4.21
6125	580	2.03	643	2.61	703	3.24	758	3.93	810	4.66
6563	612	2.41	672	3.01	729	3.68	783	4.39	833	5.15
7000	645	2.85	702	3.47	756	4.16	807	4.90	856	5.68
7438	678	3.34	732	3.99	784	4.70	833	5.47	881	6.28
7875	712	3.88	763	4.56	812	5.30	860	6.09	906	6.93
8313	746	4.49	794	5.19	841	5.96	887	6.78	931	7.64
8750	780	5.16	826	5.89	871	6.68	915	7.53	958	8.41

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
5250	817	4.51	863	5.24	906	5.99	947	6.77	986	7.56
5688	837	4.94	883	5.70	926	6.49	966	7.30	1005	8.13
6125	858	5.42	903	6.21	946	7.02	986	7.87	1024	8.73
6563	880	5.94	924	6.76	966	7.60	1006	8.48	1044	9.37
7000	902	6.50	946	7.35	987	8.23	1027	9.14	1064	10.06
7438	925	7.12	968	8.00	1009	8.91	1048	9.84	1085	10.80
7875	949	7.80	991	8.71	1031	9.64	1069	10.61	—	—
8313	974	8.54	1015	9.47	1054	10.44	1092	11.43	—	—
8750	999	9.34	1039	10.30	1077	11.29	—	—	—	—

	STD Static (555-753 rpm) 2.9 Max bhp
	MID Static (651-818 rpm) 7.4 Max bhp
	HIGH Static (804-970 rpm) 9.9 Max bhp
	ULTRA HIGH Static (948-1190 rpm) 13.6 Max bhp
Boldface	Indicates field-supplied drive is required (Standard motor (HD60FE656), motor pulley P/N KR11HY216, blower pulley P/N KR51BM415, belt P/N KR29BF050) for the 435-570 rpm range

50LC*B20 — 17.5 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
5250	460	0.77	557	1.11	647	1.50	717	1.86	778	2.20
5688	487	0.94	569	1.26	661	1.69	734	2.09	795	2.47
6125	517	1.14	584	1.43	674	1.89	749	2.34	812	2.76
6563	547	1.37	603	1.64	686	2.11	763	2.60	828	3.07
7000	578	1.63	626	1.89	698	2.33	776	2.87	842	3.39
7438	610	1.93	651	2.18	713	2.59	788	3.15	856	3.72
7875	642	2.26	678	2.51	731	2.89	800	3.44	869	4.05
8313	675	2.64	707	2.88	752	3.24	814	3.77	881	4.40
8750	707	3.06	737	3.30	776	3.64	830	4.13	893	4.77

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
5250	834	2.55	886	2.91	936	3.27	983	3.66	1030	4.05
5688	850	2.85	901	3.23	950	3.61	996	4.01	1041	4.41
6125	867	3.17	918	3.58	965	3.98	1011	4.40	1054	4.82
6563	884	3.52	934	3.95	982	4.38	1026	4.82	1069	5.26
7000	900	3.88	951	4.35	998	4.81	1043	5.27	1085	5.74
7438	915	4.25	967	4.76	1015	5.26	1059	5.75	1101	6.25
7875	929	4.64	983	5.20	1031	5.74	1076	6.26	1118	6.78
8313	943	5.03	998	5.64	1047	6.23	1092	6.79	1135	7.35
8750	955	5.44	1011	6.10	1062	6.73	1108	7.34	1151	7.94

	STD Static (555-753 rpm) 2.9 Max bhp
	MID Static (707-888 rpm) 7.4 Max bhp
	HIGH Static (872-1053 rpm) 9.9 Max bhp
	ULTRA HIGH Static (948-1190 rpm) 13.6 Max bhp
Boldface	Indicates field-supplied drive is required (Standard motor (HD60FE656), motor pulley P/N KR11HY216, blower pulley P/N KR51BM415, belt P/N KR29BF050) for the 435-570 rpm range

50LC*B24 — 20 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,000	570	1.93	635	2.50	696	3.13	752	3.81	804	4.53
6,500	607	2.36	668	2.95	725	3.61	779	4.32	829	5.07
7,000	645	2.85	702	3.47	756	4.16	807	4.90	856	5.68
7,500	683	3.41	736	4.07	788	4.78	837	5.55	884	6.37
8,000	721	4.05	772	4.74	821	5.48	868	6.28	913	7.12
8,500	760	4.77	808	5.48	854	6.26	899	7.09	943	7.96
9,000	799	5.57	844	6.32	889	7.13	932	7.98	974	8.88
9,500	839	6.46	882	7.25	924	8.08	965	8.97	1005	9.90
10,000	879	7.45	919	8.27	960	9.14	999	10.05	1038	11.01

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,000	852	5.28	897	6.06	940	6.87	980	7.70	1019	8.55
6,500	877	5.86	921	6.68	963	7.52	1003	8.39	1041	9.28
7,000	902	6.50	946	7.35	987	8.23	1027	9.14	1064	10.06
7,500	929	7.22	971	8.10	1012	9.01	1051	9.95	1088	10.91
8,000	956	8.00	998	8.92	1037	9.86	1076	10.84	1112	11.83
8,500	985	8.87	1025	9.82	1064	10.80	1101	11.80	1137	12.83
9,000	1014	9.83	1053	10.80	1091	11.81	1128	12.85	—	—
9,500	1044	10.87	1082	11.88	1119	12.91	—	—	—	—
10,000	1075	12.01	1112	13.05	—	—	—	—	—	—

	STD Static (583-717 rpm) 7.4 Max bhp
	MID Static (707-888 rpm) 7.4 Max bhp
	HIGH Static (872-1053 rpm) 9.9 Max bhp
	ULTRA HIGH Static (948-1190 rpm) 13.6 Max bhp
Boldface	Indicates field-supplied drive is required (Standard motor (HD60FK657), motor pulley P/N KR11HY229, blower pulley P/N KR51BQ415, belt P/N KR29BF056) for the 493-605 rpm range

50LC*B24 — 20 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,000	508	1.08	580	1.38	670	1.84	745	2.27	807	2.68
6,500	543	1.33	600	1.61	684	2.07	761	2.57	825	3.03
7,000	578	1.63	626	1.89	698	2.33	776	2.87	842	3.39
7,500	615	1.97	655	2.22	716	2.63	790	3.19	858	3.76
8,000	651	2.37	686	2.61	737	2.99	804	3.53	872	4.15
8,500	689	2.81	720	3.05	762	3.41	820	3.92	886	4.55
9,000	726	3.32	754	3.56	791	3.89	840	4.37	900	4.99
9,500	764	3.87	789	4.12	822	4.44	864	4.88	917	5.47
10,000	802	4.50	825	4.74	854	5.05	891	5.47	937	6.03

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,000	862	3.08	913	3.47	961	3.87	1006	4.28	1050	4.70
6,500	881	3.47	932	3.90	979	4.33	1024	4.76	1067	5.19
7,000	900	3.88	951	4.35	998	4.81	1043	5.27	1085	5.74
7,500	917	4.31	970	4.83	1017	5.33	1062	5.83	1104	6.32
8,000	933	4.75	987	5.32	1036	5.88	1081	6.41	1123	6.94
8,500	948	5.21	1004	5.84	1054	6.44	1099	7.03	1142	7.60
9,000	962	5.68	1019	6.37	1070	7.03	1117	7.67	1160	8.29
9,500	976	6.18	1033	6.91	1086	7.63	1134	8.33	1178	9.00
10,000	991	6.71	1047	7.48	1100	8.25	1149	9.00	1195	9.73

	STD Static (583-717 rpm) 7.4 Max bhp
	MID Static (707-888 rpm) 7.4 Max bhp
	HIGH Static (872-1053 rpm) 9.9 Max bhp
	ULTRA HIGH Static (1049-1291 rpm) 13.6 Max bhp
Boldface	Indicates field-supplied drive is required (Standard motor (HD60FK657), motor pulley P/N KR11HY229, blower pulley P/N KR51BQ415, belt P/N KR29BF056) for the 493-605 rpm range

50LC*B26 — 23 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,750	626	2.59	685	3.20	740	3.88	793	4.60	843	5.37
7,313	668	3.19	723	3.84	776	4.54	826	5.30	873	6.10
7,875	712	3.88	763	4.56	812	5.30	860	6.09	906	6.93
8,438	755	4.67	803	5.39	850	6.16	895	6.98	939	7.85
9,000	799	5.57	844	6.32	889	7.13	932	7.98	974	8.88
9,563	844	6.58	886	7.37	928	8.21	969	9.10	1009	10.03
10,125	889	7.72	929	8.54	969	9.42	1008	10.34	1046	11.30
10,688	933	8.98	972	9.84	1010	10.75	1047	11.71	1083	12.71
11,250	979	10.38	1015	11.28	1051	12.22	1087	13.21	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,750	889	6.17	933	7.01	975	7.87	1015	8.75	1053	9.66
7,313	919	6.94	962	7.81	1003	8.71	1042	9.64	1079	10.59
7,875	949	7.80	991	8.71	1031	9.64	1069	10.61	1106	11.60
8,438	981	8.76	1021	9.70	1060	10.67	1098	11.68	1134	12.70
9,000	1014	9.83	1053	10.80	1091	11.81	1128	12.85	—	—
9,563	1048	11.01	1086	12.02	1123	13.06	—	—	—	—
10,125	1083	12.31	1120	13.35	—	—	—	—	—	—
10,688	—	—	—	—	—	—	—	—	—	—
11,250	—	—	—	—	—	—	—	—	—	—

 STD Static (707-888 rpm) 7.4 Max bhp
 MID Static (859-1026 rpm) 9.9 Max bhp
 HIGH Static (948-1190 rpm) 13.6 Max bhp
Boldface Indicates field-supplied drive is required (Standard motor (HD60FK657), motor pulley P/N KR11HY232, blower pulley P/N KR51BQ415, belt P/N KR29BF059) for the 583-717 rpm range

50LC*B26 — 23 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,750	560	1.47	613	1.74	691	2.20	769	2.72	834	3.21
7,313	601	1.84	644	2.09	709	2.52	785	3.07	852	3.62
7,875	642	2.27	678	2.51	731	2.89	800	3.45	869	4.05
8,438	684	2.76	715	3.00	759	3.35	818	3.87	884	4.50
9,000	726	3.32	754	3.56	791	3.89	840	4.37	900	4.99
9,563	769	3.95	794	4.19	826	4.51	867	4.95	919	5.54
10,125	811	4.66	834	4.91	862	5.22	898	5.63	942	6.18
10,688	854	5.46	875	5.71	900	6.01	931	6.41	969	6.92
11,250	897	6.34	917	6.59	939	6.90	967	7.28	1000	7.76

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,750	891	3.67	942	4.12	989	4.56	1033	5.01	1076	5.46
7,313	911	4.14	963	4.64	1010	5.13	1055	5.61	1097	6.10
7,875	930	4.64	983	5.20	1031	5.74	1076	6.26	1118	6.79
8,438	947	5.15	1002	5.77	1052	6.37	1097	6.95	1140	7.52
9,000	962	5.68	1019	6.37	1070	7.03	1117	7.67	1160	8.29
9,563	978	6.24	1035	6.98	1088	7.71	1136	8.41	1180	9.09
10,125	995	6.86	1050	7.62	1104	8.41	1153	9.18	1199	9.92
10,688	1015	7.56	1067	8.31	1119	9.13	1169	9.96	1216	10.77
11,250	1039	8.36	1085	9.08	1135	9.90	1185	10.77	1232	11.64

	STD Static (651-818 rpm) 7.4 Max bhp
	MID Static (804-970 rpm) 9.9 Max bhp
	HIGH Static (948-1190 rpm) 13.6 Max bhp
Boldface	Indicates field-supplied drive is required (Standard motor (HD60FK657), motor pulley P/N KR11HY194, blower pulley P/N KR51BQ415, belt P/N KR29BF057) for the 527-661 rpm range
<i>Italics</i>	Indicate field-supplied drive is required (High Static motor, motor pulley P/N KR12HY118, blower pulley P/N KR52BH615, belts P/N KR29BF034) in the 1049-1291rpm range

PULLEY ADJUSTMENT (VERTICAL) - FAN RPM AT MOTOR PULLEY SETTINGS

50LC*B UNIT		MOTOR/DRIVE COMBO	MOTOR PULLEY TURNS OPEN (RPM)												
			0.0	0.5	1.0	1.5	2.0	2.5	3.0	3.5	4.0	4.5	5.0	5.5	6.0
14	3 phase	Standard Static	N/A	N/A	676	658	640	623	605	587	569	551	534	516	498
		Medium Static	N/A	N/A	861	843	825	807	789	772	754	736	718	700	682
		High Static	963	948	933	918	903	888	873	857	842	827	812	797	782
		Super Static	1113	1098	1083	1068	1053	1038	1023	1008	993	978	963	948	933
17	3 phase	Standard Static	N/A	N/A	676	658	640	623	605	587	569	551	534	516	498
		Medium Static	818	804	790	776	762	748	735	721	707	693	679	665	651
		High Static	970	956	942	929	915	901	887	873	859	846	832	818	804
		Super Static	1190	1170	1150	1130	1109	1089	1069	1049	1029	1009	988	968	948
20	3 phase	Standard Static	N/A	N/A	753	733	713	694	674	654	634	614	595	575	555
		Medium Static	888	873	858	843	828	813	798	782	767	752	737	722	707
		High Static	1053	1038	1023	1008	993	978	963	947	932	917	902	887	872
		Super Static	1190	1170	1150	1130	1109	1089	1069	1049	1029	1009	988	968	948
24	3 phase	Standard Static	717	706	695	684	672	661	650	639	628	617	605	594	583
		Medium Static	888	873	858	843	828	813	798	782	767	752	737	722	707
		High Static	1053	1038	1023	1008	993	978	963	947	932	917	902	887	872
		Super Static	1291	1271	1251	1231	1210	1190	1170	1150	1130	1110	1089	1069	1049
26	3 phase	Standard Static	818	804	790	776	762	748	735	721	707	693	679	665	651
		Medium Static	970	956	942	929	915	901	887	873	859	846	832	818	804
		High Static	1190	1170	1150	1130	1109	1089	1069	1049	1029	1009	988	968	948

Factory setting

PULLEY ADJUSTMENT (HORIZONTAL) - FAN RPM AT MOTOR PULLEY SETTINGS

50LC*B UNIT		MOTOR/DRIVE COMBO	MOTOR PULLEY TURNS OPEN (RPM)												
			0.0	0.5	1.0	1.5	2.0	2.5	3.0	3.5	4.0	4.5	5.0	5.5	6.0
14	3 phase	Standard Static	N/A	N/A	676	658	640	623	605	587	569	551	534	516	498
		Medium Static	808	794	781	767	753	740	726	712	699	685	671	658	644
		High Static	888	873	858	843	828	813	798	782	767	752	737	722	707
		Super Static	1053	1038	1023	1008	993	978	963	947	932	917	902	887	872
17	3 phase	Standard Static	N/A	N/A	676	658	640	623	605	587	569	551	534	516	498
		Medium Static	818	804	790	776	762	748	735	721	707	693	679	665	651
		High Static	970	956	942	929	915	901	887	873	859	846	832	818	804
		Super Static	1190	1170	1150	1130	1109	1089	1069	1049	1029	1009	988	968	948
20	3 phase	Standard Static	N/A	N/A	753	733	713	694	674	654	634	614	595	575	555
		Medium Static	818	804	790	776	762	748	735	721	707	693	679	665	651
		High Static	970	956	942	929	915	901	887	873	859	846	832	818	804
		Super Static	1190	1170	1150	1130	1109	1089	1069	1049	1029	1009	988	968	948
24	3 phase	Standard Static	717	706	695	684	672	661	650	639	628	617	605	594	583
		Medium Static	888	873	858	843	828	813	798	782	767	752	737	722	707
		High Static	1053	1038	1023	1008	993	978	963	947	932	917	902	887	872
		Super Static	1190	1170	1150	1130	1109	1089	1069	1049	1029	1009	988	968	948
26	3 phase	Standard Static	888	873	858	843	828	813	798	782	767	752	737	722	707
		Medium Static	1026	1012	998	984	970	956	943	929	915	901	887	873	859
		High Static	1190	1170	1150	1130	1109	1089	1069	1049	1029	1009	988	968	948

Factory setting

50LC*B014-026 ELECTRICAL DATA

UNIT	V-Ph-Hz	VOLTAGE RANGE		COMP 1		COMP 2		OFM (EA)		IFM		
		MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF AT FULL LOAD	FLA
14	208-3-60	187	253	17.6	123	23.2	164	185	1.8	STD	85.0%	8.6
										MED	83.6%	13.6
										HIGH	89.5%	21.2
										SUPER	91.7%	28.0
	230-3-60	187	253	17.6	123	23.2	164	185	1.8	STD	85.0%	7.8
										MED	83.6%	12.7
										HIGH	89.5%	21.2
										SUPER	91.7%	28.0
	460-3-60	414	506	9.6	62	11.2	75	185	1.3	STD	85.0%	3.8
										MED	83.6%	6.4
										HIGH	89.5%	9.7
										SUPER	91.7%	13.7
	575-3-60	518	633	6.1	40	7.9	54	185	1.3	STD	81.1%	4.5
										MED	83.6%	6.2
										HIGH	89.5%	7.2
										SUPER	91.7%	8.9
17	208-3-60	187	253	19.1	123	27.6	191	185	1.8	STD	85.0%	8.6
										MED	89.5%	21.2
										HIGH	91.7%	28.0
										SUPER	91.7%	37.3
	230-3-60	187	253	19.1	123	27.6	191	185	1.8	STD	85.0%	7.8
										MED	89.5%	21.2
										HIGH	91.7%	28.0
										SUPER	91.7%	37.3
	460-3-60	414	506	9.8	62	12.8	100	185	1.3	STD	85.0%	3.8
										MED	89.5%	9.7
										HIGH	91.7%	13.7
										SUPER	91.7%	16.9
	575-3-60	518	633	7.5	50	10.2	78	185	1.3	STD	81.1%	4.5
										MED	89.5%	7.2
										HIGH	91.7%	8.9
										SUPER	91.7%	12.6
20	208-3-60	187	253	25.0	164	27.6	191	185	1.8	STD	85.0%	8.6
										MED	89.5%	21.2
										HIGH	91.7%	28.0
										SUPER	91.7%	37.3
	230-3-60	187	253	25.0	164	27.6	191	185	1.8	STD	85.0%	7.8
										MED	89.5%	21.2
										HIGH	91.7%	28.0
										SUPER	91.7%	37.3
	460-3-60	414	506	12.2	100	12.8	100	185	1.3	STD	85.0%	3.8
										MED	89.5%	9.7
										HIGH	91.7%	13.7
										SUPER	91.7%	16.9
	575-3-60	518	633	9.3	78	10.2	78	185	1.3	STD	81.1%	4.5
										MED	89.5%	7.2
										HIGH	91.7%	8.9
										SUPER	91.7%	12.6

50LC*B014-026 ELECTRICAL DATA (cont)

UNIT	V-Ph-Hz	VOLTAGE RANGE		COMP 1		COMP 2		OFM (EA)		IFM		
		MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF AT FULL LOAD	FLA
24	208-3-60	187	253	29.5	195	33.3	239	190	1.8	STD	89.5%	21.2
										MED	89.5%	21.2
										HIGH	91.7%	28.0
										SUPER	91.7%	37.3
	230-3-60	187	253	29.5	195	33.3	239	190	1.8	STD	89.5%	21.2
										MED	89.5%	21.2
										HIGH	91.7%	28.0
										SUPER	91.7%	37.3
	460-3-60	414	506	14.8	95	18.0	125	190	1.6	STD	89.5%	9.7
										MED	89.5%	9.7
										HIGH	91.7%	13.7
										SUPER	91.7%	16.9
	575-3-60	518	633	12.2	80	12.8	80	190	1.6	STD	89.5%	7.2
										MED	89.5%	7.2
										HIGH	91.7%	8.9
										SUPER	91.7%	12.6
26	208-3-60	187	253	30.1	225	51.2	300	190	1.8	STD	89.5%	21.2
										MED	91.7%	28.0
										HIGH	91.7%	37.3
										STD	89.5%	21.2
	230-3-60	187	253	30.1	225	51.2	300	190	1.8	MED	91.7%	28.0
										HIGH	91.7%	37.3
										STD	89.5%	9.7
										MED	91.7%	13.7
	460-3-60	414	506	16.7	114	23.1	150	190	1.6	HIGH	91.7%	16.9
										STD	89.5%	7.2
										MED	91.7%	8.9
										HIGH	91.7%	12.6

See Legends and Notes on page 110.

ELECTRIC HEATERS 50LC*B14-26

UNIT	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC CRHEATER PART NUMBER	NOMINAL (KW)	APPLICATION (KW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT PART NUMBER			
							NO CO OR UNPWR CO		WITH PWRD CO	
							NO PE	WITH PE (PWRD FR/ UNIT)	NO PE	WITH PE (PWRD FR/ UNIT)
50LC*B 14	208/230-3-60	STD	302A00	15.0	11.3/13.8	38.4/47.0	—	—	—	—
			279A00	25.0	18.8/23.0	64.1/78.3	—	—	—	—
			309A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
		MED	302A00	15.0	11.3/13.8	38.4/47.0	—	—	—	—
			279A00	25.0	18.8/23.0	64.1/78.3	—	—	—	—
			309A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
		HIGH	302A00	15.0	11.3/13.8	38.4/47.0	—	—	—	—
			279A00	25.0	18.8/23.0	64.1/78.3	—	—	—	—
			309A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
		SUPER	302A00	15.0	11.3/13.8	38.4/47.0	—	—	—	—
			279A00	25.0	18.8/23.0	64.1/78.3	—	—	—	056
			309A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
	460-3-60	STD	303A00	15.0	13.8	47.0	—	—	—	—
			282A00	25.0	23.0	78.3	—	—	—	—
			310A00	50.0	45.9	156.7	—	057	057	057
		MED	303A00	15.0	13.8	47.0	—	—	—	—
			282A00	25.0	23.0	78.3	—	—	—	—
			310A00	50.0	45.9	156.7	057	057	057	057
		HIGH	303A00	15.0	13.8	47.0	—	—	—	—
			282A00	25.0	23.0	78.3	—	—	—	—
			310A00	50.0	45.9	156.7	057	057	057	057
		SUPER	303A00	15.0	13.8	47.0	—	—	—	—
			282A00	25.0	23.0	78.3	—	—	—	—
			310A00	50.0	45.9	156.7	057	057	057	057
	575-36-60	STD	304A00	15.0	13.8	47.0	—	—	—	—
			285A00	24.8	22.8	77.7	—	—	—	—
			311A00	49.6	45.6	155.4	—	057	—	057
		MED	304A00	15.0	13.8	47.0	—	—	—	—
			285A00	24.8	22.8	77.7	—	—	—	—
			311A00	49.6	45.6	155.4	—	057	—	057
		HIGH	304A00	15.0	13.8	47.0	—	—	—	—
			285A00	24.8	22.8	77.7	—	—	—	—
			311A00	49.6	45.6	155.4	—	057	057	057
		SUPER	304A00	15.0	13.8	47.0	—	—	—	—
			285A00	24.8	22.8	77.7	—	—	—	—
			311A00	49.6	45.6	155.4	057	057	057	057

ELECTRIC HEATERS 50LC*B14-26 (cont)

UNIT	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC CRHEATER PART NUMBER	NOMINAL (KW)	APPLICATION (KW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT PART NUMBER			
							NO CO OR UNPWR CO		WITH PWRD CO	
							NO PE	WITH PE (PWRD FR/ UNIT)	NO PE	WITH PE (PWRD FR/ UNIT)
50LC*B17	208-230-3-60	STD	279A00	25.0	18.8/23.0	64.1/78.3	—	—	—	—
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		MED	279A00	25.0	18.8/23.0	64.1/78.3	—	—	—	—
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	279A00	25.0	18.8/23.0	64.1/78.3	—	—	—	056
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		SUPER	279A00	25.0	18.8/23.0	64.1/78.3	—	056	056	056
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD	282A00	25.0	23.0	78.3	—	—	—	—
			283A00	50.0	45.9	156.7	—	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
		MED	282A00	25.0	23.0	78.3	—	—	—	—
			283A00	50.0	45.9	156.7	057	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
		HIGH	282A00	25.0	23.0	78.3	—	—	—	—
			283A00	50.0	45.9	156.7	057	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
		SUPER	282A00	25.0	23.0	78.3	—	—	—	—
			283A00	50.0	45.9	156.7	057	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD	285A00	24.8	22.8	77.7	—	—	—	—
			286A00	49.6	45.6	155.4	—	057	—	057
			287A00	74.4	68.3	233.1	057	057	057	057
		MED	285A00	24.8	22.8	77.7	—	—	—	—
			286A00	49.6	45.6	155.4	—	057	057	057
			287A00	74.4	68.3	233.1	057	057	057	057
		HIGH	285A00	24.8	22.8	77.7	—	—	—	—
			286A00	49.6	45.6	155.4	057	057	057	057
			287A00	74.4	68.3	233.1	057	057	057	057
		SUPER	285A00	24.8	22.8	77.7	—	—	—	—
			286A00	49.6	45.6	155.4	057	057	057	057
			287A00	74.4	68.3	233.1	057	057	057	057

ELECTRIC HEATERS 50LC*B14-26 (cont)

UNIT	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC CRHEATER PART NUMBER	NOMINAL (KW)	APPLICATION (KW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT PART NUMBER			
							NO CO OR UNPWR CO		WITH PWRD CO	
							NO PE	WITH PE (PWRD FR/ UNIT)	NO PE	WITH PE (PWRD FR/ UNIT)
50LC*B20	208/230-3-60	STD	279A00	25.0	18.8/23.0	64.1/78.3	—	—	—	—
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		MED	279A00	25.0	18.8/23.0	64.1/78.3	—	—	—	—
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	279A00	25.0	18.8/23.0	64.1/78.3	—	—	—	056
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		SUPER	279A00	25.0	18.8/23.0	64.1/78.3	—	056	056	056
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD	282A00	25.0	23.0	78.3	—	—	—	—
			283A00	50.0	45.9	156.7	—	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
		MED	282A00	25.0	23.0	78.3	—	—	—	—
			283A00	50.0	45.9	156.7	057	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
		HIGH	282A00	25.0	23.0	78.3	—	—	—	—
			283A00	50.0	45.9	156.7	057	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
		SUPER	282A00	25.0	23.0	78.3	—	—	—	—
			283A00	50.0	45.9	156.7	057	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD	285A00	24.8	22.8	77.7	—	—	—	—
			286A00	49.6	45.6	155.4	—	057	—	057
			287A00	74.4	68.3	233.1	057	057	057	057
		MED	285A00	24.8	22.8	77.7	—	—	—	—
			286A00	49.6	45.6	155.4	—	057	057	057
			287A00	74.4	68.3	233.1	057	057	057	057
		HIGH	285A00	24.8	22.8	77.7	—	—	—	—
			286A00	49.6	45.6	155.4	057	057	057	057
			287A00	74.4	68.3	233.1	057	057	057	057
		SUPER	285A00	24.8	22.8	77.7	—	—	—	—
			286A00	49.6	45.6	155.4	057	057	057	057
			287A00	74.4	68.3	233.1	057	057	057	057

ELECTRIC HEATERS 50LC*B14-26 (cont)

UNIT	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC CRHEATER PART NUMBER	NOMINAL (KW)	APPLICATION (KW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT PART NUMBER			
							NO CO OR UNPWR CO		WITH PWRD CO	
							NO PE	WITH PE (PWRD FR/ UNIT)	NO PE	WITH PE (PWRD FR/ UNIT)
50LC*B24	208-230-3-60	STD	279A00	25.0	18.8/23.0	64.1/78.3	—	—	—	056
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		MED	279A00	25.0	18.8/23.0	64.1/78.3	—	—	—	056
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	279A00	25.0	18.8/23.0	64.1/78.3	—	056	—	056
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		SUPER	279A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD	282A00	25.0	23.0	78.3	—	057	—	057
			283A00	50.0	45.9	156.7	057	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
		MED	282A00	25.0	23.0	78.3	—	057	—	057
			283A00	50.0	45.9	156.7	057	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
		HIGH	282A00	25.0	23.0	78.3	—	057	057	057
			283A00	50.0	45.9	156.7	057	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
		SUPER	282A00	25.0	23.0	78.3	057	057	057	057
			283A00	50.0	45.9	156.7	057	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD	285A00	24.8	22.8	77.7	—	—	—	—
			286A00	49.6	45.6	155.4	—	057	057	057
			287A00	74.4	68.3	233.1	057	057	057	057
		MED	285A00	24.8	22.8	77.7	—	—	—	—
			286A00	49.6	45.6	155.4	—	057	057	057
			287A00	74.4	68.3	233.1	057	057	057	057
		HIGH	285A00	24.8	22.8	77.7	—	—	—	—
			286A00	49.6	45.6	155.4	057	057	057	057
			287A00	74.4	68.3	233.1	057	057	057	057
		SUPER	285A00	24.8	22.8	77.7	—	—	—	—
			286A00	49.6	45.6	155.4	057	057	057	057
			287A00	74.4	68.3	233.1	057	057	057	057

ELECTRIC HEATERS 50LC*B14-26 (cont)

UNIT	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC CRHEATER PART NUMBER	NOMINAL (KW)	APPLICATION (KW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT PART NUMBER			
							NO CO OR UNPWR CO		WITH PWRD CO	
							NO PE	WITH PE (PWRD FR/ UNIT)	NO PE	WITH PE (PWRD FR/ UNIT)
50LC*B26	208/230-3-60	STD	279A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		MED	279A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	279A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
			280A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			281A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD	282A00	25.0	23.0	78.3	057	057	057	057
			283A00	50.0	45.9	156.7	057	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
		MED	282A00	25.0	23.0	78.3	057	057	057	057
			283A00	50.0	45.9	156.7	057	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
		HIGH	282A00	25.0	23.0	78.3	057	057	057	057
			283A00	50.0	45.9	156.7	057	057	057	057
			284A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD	285A00	24.8	22.8	77.7	—	—	—	057
			286A00	49.6	45.6	155.4	—	057	057	057
			287A00	74.4	68.3	233.1	057	057	057	057
		MED	285A00	24.8	22.8	77.7	—	057	—	057
			286A00	49.6	45.6	155.4	057	057	057	057
			287A00	74.4	68.3	233.1	057	057	057	057
		HIGH	285A00	24.8	22.8	77.7	—	057	057	057
			286A00	49.6	45.6	155.4	057	057	057	057
			287A00	74.4	68.3	233.1	057	057	057	057

See Legends and Notes on page 110.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (12.5 TONS, NO CO)

UNIT SIZE	NOM. v-Ph-Hz	IFM TYPE	ELECTRIC HEATER			NO CO OR UNPWR CO							
			CRHEATER PART NUMBER	NOM (kW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B14	208/230-3-60	STD	NONE	—	—	60.6/59.8	80/80	63/62	346	72.4/71.6	90/90	77/76	366
			302A00	11.3/15.0	31.3/36.1	60.6/59.8	80/80	63/62	346/346	72.4/71.6	90/90	77/76	366/366
			279A00	18.8/25.0	52.1/60.1	75.9/84.9	80/90	70/78	346/346	90.6/99.6	100/100	83/92	366/366
			309A00	37.6/50.0	104.2/120.3	141.0/130.1	150/150	130/147	346/346	155.8/144.8	175/150	143/161	366/366
		MED	NONE	—	—	65.6/64.7	80/80	69/68	381	77.4/76.5	100/90	82/81	401
			302A00	11.3/15.0	31.3/36.1	65.6/64.7	80/80	69/68	381/381	77.4/76.5	100/90	82/81	401/401
			279A00	18.8/25.0	52.1/60.1	82.1/91.0	90/100	76/84	381/381	96.9/105.8	100/110	89/97	401/401
			309A00	37.6/50.0	104.2/120.3	147.3/136.2	150/150	135/153	381/381	162.0/150.9	175/175	149/167	401/401
		HIGH	NONE	—	—	73.2	90	78	385	85.0	100	91	405
			302A00	11.3/15.0	31.3/36.1	73.2/73.2	90/90	78/78	385/385	85.0/86.4	100/100	91/91	405/405
			279A00	18.8/25.0	52.1/60.1	91.6/101.6	100/110	84/93	385/385	106.4/116.4	110/125	98/107	405/405
			309A00	37.6/50.0	104.2/120.3	156.8/146.8	175/175	144/163	385/385	171.5/161.6	175/175	158/176	405/405
		SUPER	NONE	—	—	81.2	100	85	459	93.0	110	99	479
			302A00	11.3/15.0	31.3/36.1	81.2/81.2	100/100	85/85	459/459	93.0/94.9	110/110	99/99	479/479
			279A00	18.8/25.0	52.1/60.1	100.1/110.1	110/125	92/101	459/459	114.9/124.9	125/125	106/115	479/479
			309A00	37.6/50.0	104.2/120.3	165.3/155.3	175/175	152/171	459/459	180.0/170.1	200/175	166/184	479/479
	460-3-60	STD	NONE	—	—	31.3	40	33	167	37.5	45	40	179
			303A00	15.0	18.0	31.3	40	33	167	37.5	45	40	179
			282A00	25.0	30.1	42.4	45	39	167	50.1	60	46	179
			310A00	50.0	60.1	64.9	70	73	167	72.6	80	81	179
		MED	NONE	—	—	33.9	45	36	184	40.1	50	43	196
			303A00	15.0	18.0	33.9	45	36	184	40.1	50	43	196
			282A00	25.0	30.1	45.6	50	42	184	53.4	60	49	196
			310A00	50.0	60.1	68.1	80	76	184	75.9	80	84	196
		HIGH	NONE	—	—	37.2	45	40	186	43.4	50	47	198
			303A00	15.0	18.0	37.2	45	40	186	43.4	50	47	198
			282A00	25.0	30.1	49.8	50	46	186	57.5	60	53	198
			310A00	50.0	60.1	72.2	80	80	186	80.0	90	87	198
		SUPER	NONE	—	—	41.8	50	44	223	48.0	60	51	235
			303A00	15.0	18.0	41.8	50	44	223	48.0	60	51	235
			282A00	25.0	30.1	54.8	60	50	223	62.5	70	58	235
			310A00	50.0	60.1	77.2	90	85	223	85.0	90	92	235
	575-3-60	STD	NONE	—	—	24.4	30	26	119	29.2	35	31	127
			304A00	15.0	14.4	24.4	30	26	119	29.6	35	31	127
			285A00	24.8	23.9	35.5	40	33	119	41.5	45	38	127
			311A00	49.6	47.7	65.3	70	60	119	71.3	80	66	127
		MED	NONE	—	—	26.1	30	28	133	30.9	35	33	141
			304A00	15.0	14.4	26.1	30	28	133	31.8	35	33	141
			285A00	24.8	23.9	37.6	40	35	133	43.6	45	40	141
			311A00	49.6	47.7	67.4	70	62	133	73.4	80	68	141
		HIGH	NONE	—	—	27.1	30	29	131	31.9	35	34	139
			304A00	15.0	14.4	27.1	30	29	131	33.0	35	34	139
			285A00	24.8	23.9	38.9	40	36	131	44.9	45	41	139
			311A00	49.6	47.7	68.6	70	63	131	74.6	80	69	139
		SUPER	NONE	—	—	29.0	35	31	158	33.8	40	36	166
			304A00	15.0	14.4	29.1	35	31	158	35.1	40	36	166
			285A00	24.8	23.9	41.0	45	38	158	47.0	50	43	166
			311A00	49.6	47.7	70.8	80	65	158	76.8	80	71	166

See Legends and Notes on page 110.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (12.5 TONS, WITH POWERED CO)

UNIT SIZE	NOM. v-Ph-Hz	IFM TYPE	ELECTRIC HEATER			WITH PWRD CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B14	208/230-3-60	STD	NONE	—	—	65.4/64.6	80/80	69/68	351	77.2/76.4	100/90	82/81	371
			302A00	11.3/15.0	31.3/36.1	65.4/64.6	80/80	69/68	351/351	77.2/76.4	100/90	82/81	371/371
			279A00	18.8/25.0	52.1/60.1	81.9/90.9	90/100	75/84	351/351	96.6/105.6	100/110	89/97	371/371
			309A00	37.6/50.0	104.2/120.3	147.0/136.1	150/150	135/153	351/351	161.8/150.8	175/175	149/166	371/371
		MED	NONE	—	—	70.4/69.5	90/90	74/73	386	82.2/81.3	100/100	88/87	406
			302A00	11.3/15.0	31.3/36.1	70.4/69.5	90/90	74/73	386/386	82.2/81.8	100/100	88/87	406/406
			279A00	18.8/25.0	52.1/60.1	88.1/97.0	90/100	81/89	386/386	102.9/111.8	110/125	95/103	406/406
			309A00	37.6/50.0	104.2/120.3	153.3/142.2	175/175	141/158	386/386	168.0/156.9	175/175	155/172	406/406
		HIGH	NONE	—	—	78.0	100	83	390	89.8	100	97	410
			302A00	11.3/15.0	31.3/36.1	78.0/78.0	100/100	83/83	390/390	89.8/92.4	100/100	97/97	410/410
			279A00	18.8/25.0	52.1/60.1	97.6/107.6	100/110	90/99	390/390	112.4/122.4	125/125	103/113	410/410
			309A00	37.6/50.0	104.2/120.3	162.8/152.8	175/175	150/168	390/390	177.5/167.6	200/175	163/182	410/410
		SUPER	NONE	—	—	86.0	100	91	464	97.8	125	104	484
			302A00	11.3/15.0	31.3/36.1	86.0/86.1	100/100	91/91	464/464	97.8/100.9	125/125	104/104	484/484
			279A00	18.8/25.0	52.1/60.1	106.1/116.1	110/125	98/107	464/464	120.9/130.9	125/150	111/120	484/484
			309A00	37.6/50.0	104.2/120.3	171.3/161.3	175/175	158/176	464/464	186.0/176.1	200/200	171/190	484/484
	460-3-60	STD	NONE	—	—	33.5	40	35	169	39.7	50	42	181
			303A00	15.0	18.0	33.5	40	35	169	39.7	50	42	181
			282A00	25.0	30.1	45.1	50	42	169	52.9	60	49	181
			310A00	50.0	60.1	67.6	80	76	169	75.4	80	83	181
		MED	NONE	—	—	36.1	45	38	186	42.3	50	45	198
			303A00	15.0	18.0	36.1	45	38	186	42.3	50	45	198
			282A00	25.0	30.1	48.4	50	45	186	56.1	60	52	198
			310A00	50.0	60.1	70.9	80	79	186	78.6	80	86	198
		HIGH	NONE	—	—	39.4	50	42	188	45.6	50	49	200
			303A00	15.0	18.0	39.4	50	42	188	45.6	50	49	200
			282A00	25.0	30.1	52.5	60	48	188	60.3	70	55	200
			310A00	50.0	60.1	75.0	80	83	188	82.7	90	90	200
		SUPER	NONE	—	—	44.0	50	47	225	50.2	60	54	237
			303A00	15.0	18.0	44.0	50	47	225	50.2	60	54	237
			282A00	25.0	30.1	57.5	60	53	225	65.3	70	60	237
			310A00	50.0	60.1	80.0	90	87	225	87.7	90	95	237
	575-3-60	STD	NONE	—	—	26.1	30	28	121	30.9	35	33	129
			304A00	15.0	14.4	26.1	30	28	121	31.8	35	33	129
			285A00	24.8	23.9	37.6	40	35	121	43.6	45	40	129
			311A00	49.6	47.7	67.4	70	62	121	73.4	80	68	129
		MED	NONE	—	—	27.8	30	30	135	32.6	40	35	143
			304A00	15.0	14.4	27.9	30	30	135	33.9	40	35	143
			285A00	24.8	23.9	39.8	40	37	135	45.8	50	42	143
			311A00	49.6	47.7	69.5	70	64	135	75.5	80	69	143
		HIGH	NONE	—	—	28.8	35	31	133	33.6	40	36	141
			304A00	15.0	14.4	29.1	35	31	133	35.1	40	36	141
			285A00	24.8	23.9	41.0	45	38	133	47.0	50	43	141
			311A00	49.6	47.7	70.8	80	65	133	76.8	80	71	141
		SUPER	NONE	—	—	30.7	35	33	160	35.5	40	38	168
			304A00	15.0	14.4	31.3	35	33	160	37.3	40	38	168
			285A00	24.8	23.9	43.1	45	40	160	49.1	50	45	168
			311A00	49.6	47.7	72.9	80	67	160	78.9	80	73	168

See Legends and Notes on page 110.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (15 TONS, NO CO)

UNIT SIZE	NOM. v-PH-Hz	IFM TYPE	ELECTRIC HEATER			NO CO OR UNPWR CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B17	208/230-3-60	STD	NONE	—	—	69.4/68.6	90/90	72/71	375	81.2/80.4	100/100	85/85	395
			279A00	18.8/25.0	52.1/60.1	75.9/84.9	90/90	72/78	375/375	90.6/99.6	100/100	85/92	395/395
			280A00	37.6/50.0	104.2/120.3	141.0/130.1	150/150	130/147	375/375	155.8/144.8	175/150	143/161	395/395
			281A00	56.3/75.0	156.4/180.4	167.2/190.2	200/200	190/216	375/375	181.9/204.9	200/225	203/230	395/395
		MED	NONE	—	—	82.0	100	86	414	93.8	110	100	434
			279A00	18.8/25.0	52.1/60.1	91.6/101.6	100/110	86/93	414/414	106.4/116.4	110/125	100/107	434/434
			280A00	37.6/50.0	104.2/120.3	156.8/146.8	175/175	144/163	414/414	171.5/161.6	175/175	158/176	434/434
			281A00	56.3/75.0	156.4/180.4	182.9/206.9	200/250	204/232	414/414	197.7/221.7	225/250	218/245	434/434
		HIGH	NONE	—	—	88.9	100	94	488	100.7	125	108	508
			279A00	18.8/25.0	52.1/60.1	100.1/110.1	110/125	94/101	488/488	114.9/124.9	125/125	108/115	508/508
			280A00	37.6/50.0	104.2/120.3	165.3/155.3	175/175	152/171	488/488	180.0/170.1	200/175	166/184	508/508
			281A00	56.3/75.0	156.4/180.4	191.4/215.4	200/250	212/240	488/488	206.2/230.2	225/250	226/253	508/508
		SUPER	NONE	—	—	100.5	125	105	528	112.3	125	118	548
			279A00	18.8/25.0	52.1/60.1	111.8/121.8	125/125	105/112	528/528	126.5/136.5	150/150	118/126	548/548
			280A00	37.6/50.0	104.2/120.3	176.9/166.9	200/200	163/181	528/528	191.6/181.7	200/200	176/195	548/548
			281A00	56.3/75.0	156.4/180.4	203.0/227.0	225/250	223/250	528/528	217.8/241.8	250/250	236/264	548/548
	460-3-60	STD	NONE	—	—	34.8	45	36	193	41.0	50	43	205
			282A00	25.0	30.1	42.4	45	39	193	50.1	60	46	205
			283A00	50.0	60.1	64.9	70	73	193	72.6	80	81	205
			284A00	75.0	90.2	95.0	100	108	193	102.7	110	115	205
		MED	NONE	—	—	40.7	50	43	212	46.9	60	50	224
			282A00	25.0	30.1	49.8	50	46	212	57.5	60	53	224
			283A00	50.0	60.1	72.2	80	80	212	80.0	90	87	224
			284A00	75.0	90.2	102.3	125	115	212	110.1	125	122	224
		HIGH	NONE	—	—	44.9	50	48	249	51.1	60	55	261
			282A00	25.0	30.1	54.8	60	50	249	62.5	70	58	261
			283A00	50.0	60.1	77.2	90	85	249	85.0	90	92	261
			284A00	75.0	90.2	107.3	125	119	249	115.1	125	127	261
		SUPER	NONE	—	—	48.9	60	51	269	55.1	60	59	281
			282A00	25.0	30.1	58.8	60	54	269	66.5	70	61	281
			283A00	50.0	60.1	81.2	90	89	269	89.0	100	96	281
			284A00	75.0	90.2	111.3	125	123	269	119.1	125	130	281
	575-3-60	STD	NONE	—	—	30.0	40	32	154	34.8	40	37	162
			285A00	24.8	23.9	35.5	40	33	154	41.5	45	38	162
			286A00	49.6	47.7	65.3	70	60	154	71.3	80	66	162
			287A00	74.4	71.6	77.2	90	88	154	83.2	90	93	162
		MED	NONE	—	—	32.7	40	35	166	37.5	45	40	174
			285A00	24.8	23.9	38.9	40	36	166	44.9	45	41	174
			286A00	49.6	47.7	68.6	70	63	166	74.6	80	69	174
			287A00	74.4	71.6	80.6	90	91	166	86.6	90	96	174
		HIGH	NONE	—	—	34.4	40	37	193	39.2	45	42	201
			285A00	24.8	23.9	41.0	45	38	193	47.0	50	43	201
			286A00	49.6	47.7	70.8	80	65	193	76.8	80	71	201
			287A00	74.4	71.6	82.7	90	93	193	88.7	90	98	201
		SUPER	NONE	—	—	38.7	50	41	204	43.5	50	46	212
			285A00	24.8	23.9	45.6	50	42	204	51.6	60	47	212
			286A00	49.6	47.7	75.4	80	69	204	81.4	90	75	212
			287A00	74.4	71.6	87.4	100	97	204	93.4	100	102	212

See Legends and Notes on page 110.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (15 TONS, WITH POWERED CO)

UNIT SIZE	NOM. v-Ph-Hz	IFM TYPE	ELECTRIC HEATER			WITH PWRD CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B17	208/230-3-60	STD	NONE	—	—	74.2/73.4	100/100	77/76	380	86.0/85.2	100/100	91/90	400
			279A00	18.8/25.0	52.1/60.1	81.9/90.9	100/100	77/84	380/380	96.6/105.6	100/110	91/97	400/400
			280A00	37.6/50.0	104.2/120.3	147.0/136.1	150/150	135/153	380/380	161.8/150.8	175/175	149/166	400/400
			281A00	56.3/75.0	156.4/180.4	173.2/196.2	200/225	195/222	380/380	187.9/210.9	200/225	209/236	400/400
		MED	NONE	—	—	86.8	100	92	419	98.6	125	105	439
			279A00	18.8/25.0	52.1/60.1	97.6/107.6	100/110	92/99	419/419	112.4/122.4	125/125	105/113	439/439
			280A00	37.6/50.0	104.2/120.3	162.8/152.8	175/175	150/168	419/419	177.5/167.6	200/175	163/182	439/439
			281A00	56.3/75.0	156.4/180.4	188.9/212.9	200/250	210/237	419/419	203.7/227.7	225/250	223/251	439/439
		HIGH	NONE	—	—	93.7	110	100	493	105.5	125	113	513
			279A00	18.8/25.0	52.1/60.1	106.1/116.1	110/125	100/107	493/493	120.9/130.9	125/150	113/120	513/513
			280A00	37.6/50.0	104.2/120.3	171.3/161.3	175/175	158/176	493/493	186.0/176.1	200/200	171/190	513/513
			281A00	56.3/75.0	156.4/180.4	197.4/221.4	225/250	218/245	493/493	212.2/236.2	225/250	231/259	513/513
		SUPER	NONE	—	—	105.3	125	110	533	117.1	150	124	553
			279A00	18.8/25.0	52.1/60.1	117.8/127.8	125/150	110/118	533/533	132.5/142.5	150/150	124/131	553/553
			280A00	37.6/50.0	104.2/120.3	182.9/172.9	200/200	168/187	533/533	197.6/187.7	200/200	182/200	553/553
			281A00	56.3/75.0	156.4/180.4	209.0/233.0	225/250	228/256	533/533	223.8/247.8	250/300	242/269	553/553
	460-3-60	STD	NONE	—	—	37.0	45	39	195	43.2	50	46	207
			282A00	25.0	30.1	45.1	50	42	195	52.9	60	49	207
			283A00	50.0	60.1	67.6	80	76	195	75.4	80	83	207
			284A00	75.0	90.2	97.7	100	111	195	105.5	110	118	207
		MED	NONE	—	—	42.9	50	46	214	49.1	60	53	226
			282A00	25.0	30.1	52.5	60	48	214	60.3	70	55	226
			283A00	50.0	60.1	75.0	80	83	214	82.7	90	90	226
			284A00	75.0	90.2	105.1	125	117	214	112.8	125	125	226
		HIGH	NONE	—	—	47.1	60	50	251	53.3	60	57	263
			282A00	25.0	30.1	57.5	60	53	251	65.3	70	60	263
			283A00	50.0	60.1	80.0	90	87	251	87.7	90	95	263
			284A00	75.0	90.2	110.1	125	122	251	117.8	125	129	263
		SUPER	NONE	—	—	51.1	60	54	271	57.3	70	61	283
			282A00	25.0	30.1	61.5	70	57	271	69.3	70	64	283
			283A00	50.0	60.1	84.0	100	91	271	91.7	100	98	283
			284A00	75.0	90.2	114.1	125	126	271	121.8	125	133	283
	575-3-60	STD	NONE	—	—	31.7	40	33	156	36.5	45	39	164
			285A00	24.8	23.9	37.6	40	35	156	43.6	45	40	164
			286A00	49.6	47.7	67.4	70	62	156	73.4	80	68	164
			287A00	74.4	71.6	79.4	90	89	156	85.4	90	95	164
		MED	NONE	—	—	34.4	40	37	168	39.2	45	42	176
			285A00	24.8	23.9	41.0	45	38	168	47.0	50	43	176
			286A00	49.6	47.7	70.8	80	65	168	76.8	80	71	176
			287A00	74.4	71.6	82.7	90	93	168	88.7	90	98	176
		HIGH	NONE	—	—	36.1	45	39	195	40.9	50	44	203
			285A00	24.8	23.9	43.1	45	40	195	49.1	50	45	203
			286A00	49.6	47.7	72.9	80	67	195	78.9	80	73	203
			287A00	74.4	71.6	84.9	90	95	195	90.9	100	100	203
		SUPER	NONE	—	—	40.4	50	43	206	45.2	50	48	214
			285A00	24.8	23.9	47.8	50	44	206	53.8	60	49	214
			286A00	49.6	47.7	77.5	80	71	206	83.5	90	77	214
			287A00	74.4	71.6	89.5	100	99	206	95.5	100	104	214

See Legends and Notes on page 110.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (17.5 TONS, NO CO)

UNIT SIZE	NOM. v-PH-Hz	IFM TYPE	ELECTRIC HEATER			NO CO OR UNPWR CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B20	208/230-3-60	STD	NONE	—	—	75.3/74.5	100/100	79/78	416	87.1/86.3	100/100	92/91	436
			279A00	18.8/25.0	52.1/60.1	75.9/84.9	100/100	79/78	416/416	90.6/99.6	100/100	92/92	436/436
			280A00	37.6/50.0	104.2/120.3	141.0/130.1	150/150	130/147	416/416	155.8/144.8	175/150	143/161	436/436
			281A00	56.3/75.0	156.4/180.4	167.2/190.2	200/200	190/216	416/416	181.9/204.9	200/225	203/230	436/436
		MED	NONE	—	—	87.9	100	93	455	99.7	125	107	475
			279A00	18.8/25.0	52.1/60.1	91.6/101.6	100/110	93/93	455/455	106.4/116.4	125/125	107/107	475/475
			280A00	37.6/50.0	104.2/120.3	156.8/146.8	175/175	144/163	455/455	171.5/161.6	175/175	158/176	475/475
			281A00	56.3/75.0	156.4/180.4	182.9/206.9	200/250	204/232	455/455	197.7/221.7	225/250	218/245	475/475
		HIGH	NONE	—	—	94.8	110	101	529	106.6	125	115	549
			279A00	18.8/25.0	52.1/60.1	100.1/110.1	110/125	101/101	529/529	114.9/124.9	125/125	115/115	549/549
			280A00	37.6/50.0	104.2/120.3	165.3/155.3	175/175	152/171	529/529	180.0/170.1	200/175	166/184	549/549
			281A00	56.3/75.0	156.4/180.4	191.4/215.4	200/250	212/240	529/529	206.2/230.2	225/250	226/253	549/549
		SUPER	NONE	—	—	106.4	125	112	569	118.2	150	125	589
			279A00	18.8/25.0	52.1/60.1	111.8/121.8	125/125	112/112	569/569	126.5/136.5	150/150	125/126	589/589
			280A00	37.6/50.0	104.2/120.3	176.9/166.9	200/200	163/181	569/569	191.6/181.7	200/200	176/195	589/589
			281A00	56.3/75.0	156.4/180.4	203.0/227.0	225/250	223/250	569/569	217.8/241.8	250/250	236/264	589/589
	460-3-60	STD	NONE	—	—	37.2	50	39	231	43.4	50	46	243
			282A00	25.0	30.1	42.4	50	39	231	50.1	60	46	243
			283A00	50.0	60.1	64.9	70	73	231	72.6	80	81	243
			284A00	75.0	90.2	95.0	100	108	231	102.7	110	115	243
		MED	NONE	—	—	43.1	50	46	250	49.3	60	53	262
			282A00	25.0	30.1	49.8	50	46	250	57.5	60	53	262
			283A00	50.0	60.1	72.2	80	80	250	80.0	90	87	262
			284A00	75.0	90.2	102.3	125	115	250	110.1	125	122	262
		HIGH	NONE	—	—	47.3	60	50	287	53.5	60	58	299
			282A00	25.0	30.1	54.8	60	50	287	62.5	70	58	299
			283A00	50.0	60.1	77.2	90	85	287	85.0	90	92	299
			284A00	75.0	90.2	107.3	125	119	287	115.1	125	127	299
		SUPER	NONE	—	—	51.3	60	54	307	57.5	70	61	319
			282A00	25.0	30.1	58.8	60	54	307	66.5	70	61	319
			283A00	50.0	60.1	81.2	90	89	307	89.0	100	96	319
			284A00	75.0	90.2	111.3	125	123	307	119.1	125	130	319
	575-3-60	STD	NONE	—	—	31.8	40	34	182	36.6	45	39	190
			285A00	24.8	23.9	35.5	40	34	182	41.5	45	39	190
			286A00	49.6	47.7	65.3	70	60	182	71.3	80	66	190
			287A00	74.4	71.6	77.2	90	88	182	83.2	90	93	190
		MED	NONE	—	—	34.5	40	37	194	39.3	45	42	202
			285A00	24.8	23.9	38.9	40	37	194	44.9	45	42	202
			286A00	49.6	47.7	68.6	70	63	194	74.6	80	69	202
			287A00	74.4	71.6	80.6	90	91	194	86.6	90	96	202
		HIGH	NONE	—	—	36.2	45	39	221	41.0	50	44	229
			285A00	24.8	23.9	41.0	45	39	221	47.0	50	44	229
			286A00	49.6	47.7	70.8	80	65	221	76.8	80	71	229
			287A00	74.4	71.6	82.7	90	93	221	88.7	90	98	229
		SUPER	NONE	—	—	40.5	50	43	232	45.3	50	48	240
			285A00	24.8	23.9	45.6	50	43	232	51.6	60	48	240
			286A00	49.6	47.7	75.4	80	69	232	81.4	90	75	240
			287A00	74.4	71.6	87.4	100	97	232	93.4	100	102	240

See Legends and Notes on page 110.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (17.5 TONS, WITH POWERED CO)

UNIT SIZE	NOM. v-Ph-Hz	IFM TYPE	ELECTRIC HEATER			WITH PWRD CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B20	208/230-3-60	STD	NONE	—	—	80.1/79.3	100/100	84/83	421	91.9/91.1	100/100	98/97	441
			279A00	18.8/25.0	52.1/60.1	81.9/90.9	100/100	84/84	421/421	96.6/105.6	100/110	98/97	441/441
			280A00	37.6/50.0	104.2/120.3	147.0/136.1	150/150	135/153	421/421	161.8/150.8	175/175	149/166	441/441
			281A00	56.3/75.0	156.4/180.4	173.2/196.2	200/225	195/222	421/421	187.9/210.9	200/225	209/236	441/441
		MED	NONE	—	—	92.7	100	99	460	104.5	125	112	480
			279A00	18.8/25.0	52.1/60.1	97.6/107.6	100/110	99/99	460/460	112.4/122.4	125/125	112/113	480/480
			280A00	37.6/50.0	104.2/120.3	162.8/152.8	175/175	150/168	460/460	177.5/167.6	200/175	163/182	480/480
			281A00	56.3/75.0	156.4/180.4	188.9/212.9	200/250	210/237	460/460	203.7/227.7	225/250	223/251	480/480
		HIGH	NONE	—	—	99.6	125	106	534	111.4	125	120	554
			279A00	18.8/25.0	52.1/60.1	106.1/116.1	125/125	106/107	534/534	120.9/130.9	125/150	120/120	554/554
			280A00	37.6/50.0	104.2/120.3	171.3/161.3	175/175	158/176	534/534	186.0/176.1	200/200	171/190	554/554
			281A00	56.3/75.0	156.4/180.4	197.4/221.4	225/250	218/245	534/534	212.2/236.2	225/250	231/259	554/554
		SUPER	NONE	—	—	111.2	125	117	574	123.0	150	131	594
			279A00	18.8/25.0	52.1/60.1	117.8/127.8	125/150	117/118	574/574	132.5/142.5	150/150	131/131	594/594
			280A00	37.6/50.0	104.2/120.3	182.9/172.9	200/200	168/187	574/574	197.6/187.7	200/200	182/200	594/594
			281A00	56.3/75.0	156.4/180.4	209.0/233.0	225/250	228/256	574/574	223.8/247.8	250/300	242/269	594/594
	460-3-60	STD	NONE	—	—	39.4	50	42	233	45.6	50	49	245
			282A00	25.0	30.1	45.1	50	42	233	52.9	60	49	245
			283A00	50.0	60.1	67.6	80	76	233	75.4	80	83	245
			284A00	75.0	90.2	97.7	100	111	233	105.5	110	118	245
		MED	NONE	—	—	45.3	50	48	252	51.5	60	56	264
			282A00	25.0	30.1	52.5	60	48	252	60.3	70	56	264
			283A00	50.0	60.1	75.0	80	83	252	82.7	90	90	264
			284A00	75.0	90.2	105.1	125	117	252	112.8	125	125	264
		HIGH	NONE	—	—	49.5	60	53	289	55.7	60	60	301
			282A00	25.0	30.1	57.5	60	53	289	65.3	70	60	301
			283A00	50.0	60.1	80.0	90	87	289	87.7	90	95	301
			284A00	75.0	90.2	110.1	125	122	289	117.8	125	129	301
		SUPER	NONE	—	—	53.5	60	57	309	59.7	70	64	321
			282A00	25.0	30.1	61.5	70	57	309	69.3	70	64	321
			283A00	50.0	60.1	84.0	100	91	309	91.7	100	98	321
			284A00	75.0	90.2	114.1	125	126	309	121.8	125	133	321
	575-3-60	STD	NONE	—	—	33.5	40	36	184	38.3	45	41	192
			285A00	24.8	23.9	37.6	40	36	184	43.6	45	41	192
			286A00	49.6	47.7	67.4	70	62	184	73.4	80	68	192
			287A00	74.4	71.6	79.4	90	89	184	85.4	90	95	192
		MED	NONE	—	—	36.2	45	39	196	41.0	50	44	204
			285A00	24.8	23.9	41.0	45	39	196	47.0	50	44	204
			286A00	49.6	47.7	70.8	80	65	196	76.8	80	71	204
			287A00	74.4	71.6	82.7	90	93	196	88.7	90	98	204
		HIGH	NONE	—	—	37.9	45	41	223	42.7	50	46	231
			285A00	24.8	23.9	43.1	45	41	223	49.1	50	46	231
			286A00	49.6	47.7	72.9	80	67	223	78.9	80	73	231
			287A00	74.4	71.6	84.9	90	95	223	90.9	100	100	231
		SUPER	NONE	—	—	42.2	50	45	234	47.0	60	50	242
			285A00	24.8	23.9	47.8	50	45	234	53.8	60	50	242
			286A00	49.6	47.7	77.5	80	71	234	83.5	90	77	242
			287A00	74.4	71.6	89.5	100	99	234	95.5	100	104	242

See Legends and Notes on page 110.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (20 TONS, NO CO)

UNIT SIZE	NOM. v-Ph-Hz	IFM TYPE	ELECTRIC HEATER			NO CO OR UNPWR CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B24	208/230-3-60	STD	NONE	—	—	103.1	125	109	538	114.9	125	123	558
			279A00	18.8/25.0	52.1/60.1	103.1/103.1	125/125	109/109	538/538	114.9/116.4	125/125	123/123	558/558
			280A00	37.6/50.0	104.2/120.3	156.8/146.8	175/175	144/163	538/538	171.5/161.6	175/175	158/176	558/558
			281A00	56.3/75.0	156.4/180.4	182.9/206.9	200/250	204/232	538/538	197.7/221.7	225/250	218/245	558/558
		MED	NONE	—	—	103.1	125	109	538	114.9	125	123	558
			279A00	18.8/25.0	52.1/60.1	103.1/103.1	125/125	109/109	538/538	114.9/116.4	125/125	123/123	558/558
			280A00	37.6/50.0	104.2/120.3	156.8/146.8	175/175	144/163	538/538	171.5/161.6	175/175	158/176	558/558
			281A00	56.3/75.0	156.4/180.4	182.9/206.9	200/250	204/232	538/538	197.7/221.7	225/250	218/245	558/558
		HIGH	NONE	—	—	109.9	125	117	612	121.7	150	130	632
			279A00	18.8/25.0	52.1/60.1	109.9/110.1	125/125	117/117	612/612	121.7/124.9	150/150	130/130	632/632
			280A00	37.6/50.0	104.2/120.3	165.3/155.3	175/175	152/171	612/612	180.0/170.1	200/175	166/184	632/632
			281A00	56.3/75.0	156.4/180.4	191.4/215.4	200/250	212/240	612/612	206.2/230.2	225/250	226/253	632/632
		SUPER	NONE	—	—	120.2	150	128	652	132.0	150	141	672
			279A00	18.8/25.0	52.1/60.1	120.2/121.8	150/150	128/128	652/652	132.0/136.5	150/150	141/141	672/672
			280A00	37.6/50.0	104.2/120.3	176.9/166.9	200/200	163/181	652/652	191.6/181.7	200/200	176/195	672/672
			281A00	56.3/75.0	156.4/180.4	203.0/227.0	225/250	223/250	652/652	217.8/241.8	250/250	236/264	672/672
	460-3-60	STD	NONE	—	—	56.6	70	60	278	62.8	80	67	290
			282A00	25.0	30.1	56.6	70	60	278	62.8	80	67	290
			283A00	50.0	60.1	72.2	80	80	278	80.0	90	87	290
			284A00	75.0	90.2	102.3	125	115	278	110.1	125	122	290
		MED	NONE	—	—	56.6	70	60	278	62.8	80	67	290
			282A00	25.0	30.1	56.6	70	60	278	62.8	80	67	290
			283A00	50.0	60.1	72.2	80	80	278	80.0	90	87	290
			284A00	75.0	90.2	102.3	125	115	278	110.1	125	122	290
		HIGH	NONE	—	—	60.6	70	65	315	66.8	80	72	327
			282A00	25.0	30.1	60.6	70	65	315	66.8	80	72	327
			283A00	50.0	60.1	77.2	90	85	315	85.0	90	92	327
			284A00	75.0	90.2	107.3	125	119	315	115.1	125	127	327
		SUPER	NONE	—	—	63.8	80	68	335	70.0	80	75	347
			282A00	25.0	30.1	63.8	80	68	335	70.0	80	75	347
			283A00	50.0	60.1	81.2	90	89	335	89.0	100	96	347
			284A00	75.0	90.2	111.3	125	123	335	119.1	125	130	347
	575-3-60	STD	NONE	—	—	45.0	50	48	206	49.8	60	54	214
			285A00	24.8	23.9	45.0	50	48	206	49.8	60	54	214
			286A00	49.6	47.7	68.6	70	63	206	74.6	80	69	214
			287A00	74.4	71.6	80.6	90	91	206	86.6	90	96	214
		MED	NONE	—	—	45.0	50	48	206	49.8	60	54	214
			285A00	24.8	23.9	45.0	50	48	206	49.8	60	54	214
			286A00	49.6	47.7	68.6	70	63	206	74.6	80	69	214
			287A00	74.4	71.6	80.6	90	91	206	86.6	90	96	214
		HIGH	NONE	—	—	46.7	50	50	233	51.5	60	56	241
			285A00	24.8	23.9	46.7	50	50	233	51.5	60	56	241
			286A00	49.6	47.7	70.8	80	65	233	76.8	80	71	241
			287A00	74.4	71.6	82.7	90	93	233	88.7	90	98	241
		SUPER	NONE	—	—	50.4	60	54	244	55.2	60	60	252
			285A00	24.8	23.9	50.4	60	54	244	55.2	60	60	252
			286A00	49.6	47.7	75.4	80	69	244	81.4	90	75	252
			287A00	74.4	71.6	87.4	100	97	244	93.4	100	102	252

See Legends and Notes on page 110.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (20 TONS, WITH POWERED CO)

UNIT SIZE	NOM. v-Ph-Hz	IFM TYPE	ELECTRIC HEATER			WITH PWRD CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B24	208/230-3-60	STD	NONE	—	—	107.9	125	115	543	119.7	150	128	563
			279A00	18.8/25.0	52.1/60.1	107.9/107.9	125/125	115/115	543/543	119.7/122.4	150/150	128/128	563/563
			280A00	37.6/50.0	104.2/120.3	162.8/152.8	175/175	150/168	543/543	177.5/167.6	200/175	163/182	563/563
			281A00	56.3/75.0	156.4/180.4	188.9/212.9	200/250	210/237	543/543	203.7/227.7	225/250	223/251	563/563
		MED	NONE	—	—	107.9	125	115	543	119.7	150	128	563
			279A00	18.8/25.0	52.1/60.1	107.9/107.9	125/125	115/115	543/543	119.7/122.4	150/150	128/128	563/563
			280A00	37.6/50.0	104.2/120.3	162.8/152.8	175/175	150/168	543/543	177.5/167.6	200/175	163/182	563/563
			281A00	56.3/75.0	156.4/180.4	188.9/212.9	200/250	210/237	543/543	203.7/227.7	225/250	223/251	563/563
		HIGH	NONE	—	—	114.7	125	122	617	126.5	150	136	637
			279A00	18.8/25.0	52.1/60.1	114.7/116.1	125/125	122/122	617/617	126.5/130.9	150/150	136/136	637/637
			280A00	37.6/50.0	104.2/120.3	171.3/161.3	175/175	158/176	617/617	186.0/176.1	200/200	171/190	637/637
			281A00	56.3/75.0	156.4/180.4	197.4/221.4	225/250	218/245	617/617	212.2/236.2	225/250	231/259	637/637
		SUPER	NONE	—	—	125.0	150	133	657	136.8	150	147	677
			279A00	18.8/25.0	52.1/60.1	125.0/127.8	150/150	133/133	657/657	136.8/142.5	150/150	147/147	677/677
			280A00	37.6/50.0	104.2/120.3	182.9/172.9	200/200	168/187	657/657	197.6/187.7	200/200	182/200	677/677
			281A00	56.3/75.0	156.4/180.4	209.0/233.0	225/250	228/256	657/657	223.8/247.8	250/300	242/269	677/677
	460-3-60	STD	NONE	—	—	58.8	70	62	280	65.0	80	70	292
			282A00	25.0	30.1	58.8	70	62	280	65.0	80	70	292
			283A00	50.0	60.1	75.0	80	83	280	82.7	90	90	292
			284A00	75.0	90.2	105.1	125	117	280	112.8	125	125	292
		MED	NONE	—	—	58.8	70	62	280	65.0	80	70	292
			282A00	25.0	30.1	58.8	70	62	280	65.0	80	70	292
			283A00	50.0	60.1	75.0	80	83	280	82.7	90	90	292
			284A00	75.0	90.2	105.1	125	117	280	112.8	125	125	292
		HIGH	NONE	—	—	62.8	80	67	317	69.0	80	74	329
			282A00	25.0	30.1	62.8	80	67	317	69.0	80	74	329
			283A00	50.0	60.1	80.0	90	87	317	87.7	90	95	329
			284A00	75.0	90.2	110.1	125	122	317	117.8	125	129	329
		SUPER	NONE	—	—	66.0	80	71	337	72.2	90	78	349
			282A00	25.0	30.1	66.0	80	71	337	72.2	90	78	349
			283A00	50.0	60.1	84.0	100	91	337	91.7	100	98	349
			284A00	75.0	90.2	114.1	125	126	337	121.8	125	133	349
	575-3-60	STD	NONE	—	—	46.7	50	50	208	51.5	60	56	216
			285A00	24.8	23.9	46.7	50	50	208	51.5	60	56	216
			286A00	49.6	47.7	70.8	80	65	208	76.8	80	71	216
			287A00	74.4	71.6	82.7	90	93	208	88.7	90	98	216
		MED	NONE	—	—	46.7	50	50	208	51.5	60	56	216
			285A00	24.8	23.9	46.7	50	50	208	51.5	60	56	216
			286A00	49.6	47.7	70.8	80	65	208	76.8	80	71	216
			287A00	74.4	71.6	82.7	90	93	208	88.7	90	98	216
		HIGH	NONE	—	—	48.4	60	52	235	53.2	60	58	243
			285A00	24.8	23.9	48.4	60	52	235	53.2	60	58	243
			286A00	49.6	47.7	72.9	80	67	235	78.9	80	73	243
			287A00	74.4	71.6	84.9	90	95	235	90.9	100	100	243
		SUPER	NONE	—	—	52.1	60	56	246	56.9	70	62	254
			285A00	24.8	23.9	52.1	60	56	246	56.9	70	62	254
			286A00	49.6	47.7	77.5	80	71	246	83.5	90	77	254
			287A00	74.4	71.6	89.5	100	99	246	95.5	100	104	254

See Legends and Notes on page 110.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (23 TONS, NO CO)

UNIT SIZE	NOM. v-Ph-Hz	IFM TYPE	ELECTRIC HEATER			NO CO OR UNPWR CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B26	208/230-3-60	STD	NONE	—	—	126.1	175	130	629	137.9	175	144	649
			279A00	18.8/25.0	52.1/60.1	126.1/126.1	175/175	130/130	629/629	137.9/137.9	175/175	144/144	649/649
			280A00	37.6/50.0	104.2/120.3	156.8/146.8	175/175	144/163	629/629	171.5/161.6	175/175	158/176	649/649
			281A00	56.3/75.0	156.4/180.4	182.9/206.9	200/250	204/232	629/629	197.7/221.7	225/250	218/245	649/649
		MED	NONE	—	—	132.9	175	138	703	144.7	175	152	723
			279A00	18.8/25.0	52.1/60.1	132.9/132.9	175/175	138/138	703/703	144.7/144.7	175/175	152/152	723/723
			280A00	37.6/50.0	104.2/120.3	165.3/155.3	175/175	152/171	703/703	180.0/170.1	200/175	166/184	723/723
			281A00	56.3/75.0	156.4/180.4	191.4/215.4	200/250	212/240	703/703	206.2/230.2	225/250	226/253	723/723
		HIGH	NONE	—	—	142.2	175	149	743	154.0	200	162	763
			279A00	18.8/25.0	52.1/60.1	142.2/142.2	175/175	149/149	743/743	154.0/154.0	200/200	162/162	763/763
			280A00	37.6/50.0	104.2/120.3	176.9/166.9	200/200	163/181	743/743	191.6/181.7	200/200	176/195	763/763
			281A00	56.3/75.0	156.4/180.4	203.0/227.0	225/250	223/250	743/743	217.8/241.8	250/250	236/264	763/763
	460-3-60	STD	NONE	—	—	64.9	80	68	322	71.1	90	75	334
			282A00	25.0	30.1	64.9	80	68	322	71.1	90	75	334
			283A00	50.0	60.1	72.2	80	80	322	80.0	90	87	334
			284A00	75.0	90.2	102.3	125	115	322	110.1	125	122	334
		MED	NONE	—	—	68.9	90	73	359	75.1	90	80	371
			282A00	25.0	30.1	68.9	90	73	359	75.1	90	80	371
			283A00	50.0	60.1	77.2	90	85	359	85.0	90	92	371
			284A00	75.0	90.2	107.3	125	119	359	115.1	125	127	371
		HIGH	NONE	—	—	72.1	90	76	379	78.3	100	83	391
			282A00	25.0	30.1	72.1	90	76	379	78.3	100	83	391
			283A00	50.0	60.1	81.2	90	89	379	89.0	100	96	391
			284A00	75.0	90.2	111.3	125	123	379	119.1	125	130	391
	575-3-60	STD	NONE	—	—	53.9	60	56	235	58.7	70	62	243
			285A00	24.8	23.9	53.9	60	56	235	58.7	70	62	243
			286A00	49.6	47.7	68.6	70	63	235	74.6	80	69	243
			287A00	74.4	71.6	80.6	90	91	235	86.6	90	96	243
		MED	NONE	—	—	55.6	70	58	262	60.4	80	64	270
			285A00	24.8	23.9	55.6	70	58	262	60.4	80	64	270
			286A00	49.6	47.7	70.8	80	65	262	76.8	80	71	270
			287A00	74.4	71.6	82.7	90	93	262	88.7	90	98	270
		HIGH	NONE	—	—	59.3	70	62	273	64.1	80	68	281
			285A00	24.8	23.9	59.3	70	62	273	64.1	80	68	281
			286A00	49.6	47.7	75.4	80	69	273	81.4	90	75	281
			287A00	74.4	71.6	87.4	100	97	273	93.4	100	102	281

See Legends and Notes on page 110.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (23 TONS, WITH POWERED CO)

UNIT SIZE	NOM. v-Ph-Hz	IFM TYPE	ELECTRIC HEATER			WITH PWRD CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B26	208/230-3-60	STD	NONE	—	—	130.9	175	136	634	142.7	175	149	654
			279A00	18.8/25.0	52.1/60.1	130.9/130.9	175/175	136/136	634/634	142.7/142.7	175/175	149/149	654/654
			280A00	37.6/50.0	104.2/120.3	162.8/152.8	175/175	150/168	634/634	177.5/167.6	200/175	163/182	654/654
			281A00	56.3/75.0	156.4/180.4	188.9/212.9	200/250	210/237	634/634	203.7/227.7	225/250	223/251	654/654
		MED	NONE	—	—	137.7	175	144	708	149.5	200	157	728
			279A00	18.8/25.0	52.1/60.1	137.7/137.7	175/175	144/144	708/708	149.5/149.5	200/200	157/157	728/728
			280A00	37.6/50.0	104.2/120.3	171.3/161.3	175/175	158/176	708/708	186.0/176.1	200/200	171/190	728/728
			281A00	56.3/75.0	156.4/180.4	197.4/221.4	225/250	218/245	708/708	212.2/236.2	225/250	231/259	728/728
		HIGH	NONE	—	—	147.0	175	154	748	158.8	200	168	768
			279A00	18.8/25.0	52.1/60.1	147.0/147.0	175/175	154/154	748/748	158.8/158.8	200/200	168/168	768/768
			280A00	37.6/50.0	104.2/120.3	182.9/172.9	200/200	168/187	748/748	197.6/187.7	200/200	182/200	768/768
			281A00	56.3/75.0	156.4/180.4	209.0/233.0	225/250	228/256	748/748	223.8/247.8	250/300	242/269	768/768
	460-3-60	STD	NONE	—	—	67.1	90	70	324	73.3	90	78	336
			282A00	25.0	30.1	67.1	90	70	324	73.3	90	78	336
			283A00	50.0	60.1	75.0	90	83	324	82.7	90	90	336
			284A00	75.0	90.2	105.1	125	117	324	112.8	125	125	336
		MED	NONE	—	—	71.1	90	75	361	77.3	100	82	373
			282A00	25.0	30.1	71.1	90	75	361	77.3	100	82	373
			283A00	50.0	60.1	80.0	90	87	361	87.7	100	95	373
			284A00	75.0	90.2	110.1	125	122	361	117.8	125	129	373
		HIGH	NONE	—	—	74.3	90	79	381	80.5	100	86	393
			282A00	25.0	30.1	74.3	90	79	381	80.5	100	86	393
			283A00	50.0	60.1	84.0	100	91	381	91.7	100	98	393
			284A00	75.0	90.2	114.1	125	126	381	121.8	125	133	393
	575-3-60	STD	NONE	—	—	55.6	70	58	237	60.4	80	64	245
			285A00	24.8	23.9	55.6	70	58	237	60.4	80	64	245
			286A00	49.6	47.7	70.8	80	65	237	76.8	80	71	245
			287A00	74.4	71.6	82.7	90	93	237	88.7	90	98	245
		MED	NONE	—	—	57.3	70	60	264	62.1	80	66	272
			285A00	24.8	23.9	57.3	70	60	264	62.1	80	66	272
			286A00	49.6	47.7	72.9	80	67	264	78.9	80	73	272
			287A00	74.4	71.6	84.9	90	95	264	90.9	100	100	272
		HIGH	NONE	—	—	61.0	80	64	275	65.8	80	70	283
			285A00	24.8	23.9	61.0	80	64	275	65.8	80	70	283
			286A00	49.6	47.7	77.5	80	71	275	83.5	90	77	283
			287A00	74.4	71.6	89.5	100	99	275	95.5	100	104	283

See Legends and Notes on page 110.

UNIT WIRE SIZING DATA WITH FACTORY-INSTALLED HACR BREAKER (12.5 TONS, NO CO)

UNIT SIZE	NOM. v-Ph-Hz	IFM TYPE	ELECTRIC HEATER			NO CO OR PWR CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	HACR BRKR	DISC. SIZE		MCA	HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B14	208/230-3-60	STD	NONE	—	—	60.6/60.6	80/80	63/62	346	72.4/72.4	90/90	77/76	366
			302A00	11.3/15.0	31.3/36.1	60.6/60.6	80/80	63/62	346/346	72.4/72.4	90/90	77/76	366/366
			279A00	18.8/25.0	52.1/60.1	84.9/84.9	90/90	70/78	346/346	99.6/99.6	100/100	83/92	366/366
			309A00	37.6/50.0	104.2/120.3	141.0/141.0	150/150	130/147	346/346	155.8/155.8	175/175	143/161	366/366
		MED	NONE	—	—	65.6/65.6	80/80	69/68	381	77.4/77.4	100/100	82/81	401
			302A00	11.3/15.0	31.3/36.1	65.6/65.6	80/80	69/68	381/381	77.4/77.4	100/100	82/81	401/401
			279A00	18.8/25.0	52.1/60.1	91.0/91.0	100/100	76/84	381/381	105.8/105.8	110/110	89/97	401/401
			309A00	37.6/50.0	104.2/120.3	147.3/147.3	150/150	135/153	381/381	162.0/162.0	175/175	149/167	401/401
		HIGH	NONE	—	—	73.2	90	78	385	85.0	100	91	405
			302A00	11.3/15.0	31.3/36.1	73.2/73.2	90/90	78/78	385/385	86.4/86.4	100/100	91/91	405/405
			279A00	18.8/25.0	52.1/60.1	101.6/101.6	110/110	84/93	385/385	116.4/116.4	125/125	98/107	405/405
			309A00	37.6/50.0	104.2/120.3	156.8/156.8	175/175	144/163	385/385	171.5/171.5	175/175	158/176	405/405
		SUPER	NONE	—	—	81.2	100	85	459	93.0	110	99	479
			302A00	11.3/15.0	31.3/36.1	81.2/81.2	100/100	85/85	459/459	94.9/94.9	110/110	99/99	479/479
			279A00	18.8/25.0	52.1/60.1	110.1/110.1	125/125	92/101	459/459	124.9/124.9	125/125	106/115	479/479
			309A00	37.6/50.0	104.2/120.3	165.3/165.3	175/175	152/171	459/459	180.0/180.0	200/200	166/184	479/479
	460-3-60	STD	NONE	—	—	31.3	40	33	167	37.5	45	40	179
			303A00	15.0	18.0	31.3	40	33	167	37.5	45	40	179
			282A00	25.0	30.1	42.4	45	39	167	50.1	60	46	179
			310A00	50.0	60.1	64.9	70	73	167	72.6	80	81	179
		MED	NONE	—	—	33.9	45	36	184	40.1	50	43	196
			303A00	15.0	18.0	33.9	45	36	184	40.1	50	43	196
			282A00	25.0	30.1	45.6	50	42	184	53.4	60	49	196
			310A00	50.0	60.1	68.1	80	76	184	75.9	80	84	196
		HIGH	NONE	—	—	37.2	45	40	186	43.4	50	47	198
			303A00	15.0	18.0	37.2	45	40	186	43.4	50	47	198
			282A00	25.0	30.1	49.8	50	46	186	57.5	60	53	198
			310A00	50.0	60.1	72.2	80	80	186	80.0	90	87	198
		SUPER	NONE	—	—	41.8	50	44	223	48.0	60	51	235
			303A00	15.0	18.0	41.8	50	44	223	48.0	60	51	235
			282A00	25.0	30.1	54.8	60	50	223	62.5	70	58	235
			310A00	50.0	60.1	77.2	90	85	223	85.0	90	92	235
	575-3-60	STD	NONE	—	—	24.4	30	26	119	29.2	35	31	127
			304A00	15.0	14.4	24.4	30	26	119	29.6	35	31	127
			285A00	24.8	23.9	35.5	40	33	119	41.5	45	38	127
			311A00	49.6	47.7	65.3	70	60	119	71.3	80	66	127
		MED	NONE	—	—	26.1	30	28	133	30.9	35	33	141
			304A00	15.0	14.4	26.1	30	28	133	31.8	35	33	141
			285A00	24.8	23.9	37.6	40	35	133	43.6	45	40	141
			311A00	49.6	47.7	67.4	70	62	133	73.4	80	68	141
		HIGH	NONE	—	—	27.1	30	29	131	31.9	35	34	139
			304A00	15.0	14.4	27.1	30	29	131	33.0	35	34	139
			285A00	24.8	23.9	38.9	40	36	131	44.9	45	41	139
			311A00	49.6	47.7	68.6	70	63	131	74.6	80	69	139
		SUPER	NONE	—	—	29.0	35	31	158	33.8	40	36	166
			304A00	15.0	14.4	29.1	35	31	158	35.1	40	36	166
			285A00	24.8	23.9	41.0	45	38	158	47.0	50	43	166
			311A00	49.6	47.7	70.8	80	65	158	76.8	80	71	166

See Legends and Notes on page 110.

UNIT WIRE SIZING DATA WITH FACTORY-INSTALLED HACR BREAKER (12.5 TONS, WITH POWERED CO)

UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER			WITH PWRD CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	HACR BRKR	DISC. SIZE		MCA	HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B14	208/230-3-60	STD	NONE	—	—	65.4/65.4	80/80	69/68	351	77.2/77.2	100/100	82/81	371
			302A00	11.3/15.0	31.3/36.1	65.4/65.4	80/80	69/68	351/351	77.2/77.2	100/100	82/81	371/371
			279A00	18.8/25.0	52.1/60.1	90.9/90.9	100/100	75/84	351/351	105.6/105.6	110/110	89/97	371/371
			309A00	37.6/50.0	104.2/120.3	147.0/147.0	150/150	135/153	351/351	161.8/161.8	175/175	149/166	371/371
		MED	NONE	—	—	70.4/70.4	90/90	74/73	386	82.2/82.2	100/100	88/87	406
			302A00	11.3/15.0	31.3/36.1	70.4/70.4	90/90	74/73	386/386	82.2/82.2	100/100	88/87	406/406
			279A00	18.8/25.0	52.1/60.1	97.0/97.0	100/100	81/89	386/386	111.8/111.8	125/125	95/103	406/406
			309A00	37.6/50.0	104.2/120.3	153.3/153.3	175/175	141/158	386/386	168.0/168.0	175/175	155/172	406/406
		HIGH	NONE	—	—	78.0	100	83	390	89.8	100	97	410
			302A00	11.3/15.0	31.3/36.1	78.0/78.0	100/100	83/83	390/390	92.4/92.4	100/100	97/97	410/410
			279A00	18.8/25.0	52.1/60.1	107.6/107.6	110/110	90/99	390/390	122.4/122.4	125/125	103/113	410/410
			309A00	37.6/50.0	104.2/120.3	162.8/162.8	175/175	150/168	390/390	177.5/177.5	200/200	163/182	410/410
		SUPER	NONE	—	—	86.0	100	91	464	97.8	125	104	484
			302A00	11.3/15.0	31.3/36.1	86.1/86.1	100/100	91/91	464/464	100.9/100.9	125/125	104/104	484/484
			279A00	18.8/25.0	52.1/60.1	116.1/116.1	125/125	98/107	464/464	130.9/130.9	150/150	111/120	484/484
			309A00	37.6/50.0	104.2/120.3	171.3/171.3	175/175	158/176	464/464	186.0/186.0	200/200	171/190	484/484
	460-3-60	STD	NONE	—	—	33.5	40	35	169	39.7	50	42	181
			303A00	15.0	18.0	33.5	40	35	169	39.7	50	42	181
			282A00	25.0	30.1	45.1	50	42	169	52.9	60	49	181
			310A00	50.0	60.1	67.6	80	76	169	75.4	80	83	181
		MED	NONE	—	—	36.1	45	38	186	42.3	50	45	198
			303A00	15.0	18.0	36.1	45	38	186	42.3	50	45	198
			282A00	25.0	30.1	48.4	50	45	186	56.1	60	52	198
			310A00	50.0	60.1	70.9	80	79	186	78.6	80	86	198
		HIGH	NONE	—	—	39.4	50	42	188	45.6	50	49	200
			303A00	15.0	18.0	39.4	50	42	188	45.6	50	49	200
			282A00	25.0	30.1	52.5	60	48	188	60.3	70	55	200
			310A00	50.0	60.1	75.0	80	83	188	82.7	90	90	200
		SUPER	NONE	—	—	44.0	50	47	225	50.2	60	54	237
			303A00	15.0	18.0	44.0	50	47	225	50.2	60	54	237
			282A00	25.0	30.1	57.5	60	53	225	65.3	70	60	237
			310A00	50.0	60.1	80.0	90	87	225	87.7	90	95	237
	575-3-60	STD	NONE	—	—	26.1	30	28	121	30.9	35	33	129
			304A00	15.0	14.4	26.1	30	28	121	31.8	35	33	129
			285A00	24.8	23.9	37.6	40	35	121	43.6	45	40	129
			311A00	49.6	47.7	67.4	70	62	121	73.4	80	68	129
		MED	NONE	—	—	27.8	30	30	135	32.6	40	35	143
			304A00	15.0	14.4	27.9	30	30	135	33.9	40	35	143
			285A00	24.8	23.9	39.8	40	37	135	45.8	50	42	143
			311A00	49.6	47.7	69.5	70	64	135	75.5	80	69	143
		HIGH	NONE	—	—	28.8	35	31	133	33.6	40	36	141
			304A00	15.0	14.4	29.1	35	31	133	35.1	40	36	141
			285A00	24.8	23.9	41.0	45	38	133	47.0	50	43	141
			311A00	49.6	47.7	70.8	80	65	133	76.8	80	71	141
		SUPER	NONE	—	—	30.7	35	33	160	35.5	40	38	168
			304A00	15.0	14.4	31.3	35	33	160	37.3	40	38	168
			285A00	24.8	23.9	43.1	45	40	160	49.1	50	45	168
			311A00	49.6	47.7	72.9	80	67	160	78.9	80	73	168

See Legends and Notes on page 110.

UNIT WIRE SIZING DATA WITH FACTORY-INSTALLED HACR BREAKER (15 TONS, NO CO)

UNIT SIZE	NOM. v-Ph-Hz	IFM TYPE	ELECTRIC HEATER			NO CO OR PWR CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	HACR BRKR	DISC. SIZE		MCA	HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B17	208/230-3-60	STD	NONE	—	—	69.4/69.4	90/90	72/71	375	81.2/81.2	100/100	85/85	395
			279A00	18.8/25.0	52.1/60.1	84.9/84.9	90/90	72/78	375/375	99.6/99.6	100/100	85/92	395/395
			280A00	37.6/50.0	104.2/120.3	141.0/141.0	150/150	130/147	375/375	155.8/155.8	175/175	143/161	395/395
			281A00	56.3/75.0	156.4/180.4	190.2/190.2	200/200	190/216	375/375	204.9/204.9	225/225	203/230	395/395
		MED	NONE	—	—	82.0	100	86	414	93.8	110	100	434
			279A00	18.8/25.0	52.1/60.1	101.6/101.6	110/110	86/93	414/414	116.4/116.4	125/125	100/107	434/434
			280A00	37.6/50.0	104.2/120.3	156.8/156.8	175/175	144/163	414/414	171.5/171.5	175/175	158/176	434/434
			281A00	56.3/75.0	156.4/180.4	206.9/206.9	225/250	204/232	414/414	221.7/221.7	225/250	218/245	434/434
		HIGH	NONE	—	—	88.9	100	94	488	100.7	125	108	508
			279A00	18.8/25.0	52.1/60.1	110.1/110.1	125/125	94/101	488/488	124.9/124.9	125/125	108/115	508/508
			280A00	37.6/50.0	104.2/120.3	165.3/165.3	175/175	152/171	488/488	180.0/180.0	200/200	166/184	508/508
			281A00	56.3/75.0	156.4/180.4	215.4/215.4	225/250	212/240	488/488	230.2/230.2	250/250	226/253	508/508
		SUPER	NONE	—	—	100.5	125	105	528	112.3	125	118	548
			279A00	18.8/25.0	52.1/60.1	121.8/121.8	125/125	105/112	528/528	136.5/136.5	150/150	118/126	548/548
			280A00	37.6/50.0	104.2/120.3	176.9/176.9	200/200	163/181	528/528	191.6/191.6	200/200	176/195	548/548
			281A00	56.3/75.0	156.4/180.4	227.0/227.0	250/250	223/250	528/528	241.8/241.8	250/250	236/264	548/548
	460-3-60	STD	NONE	—	—	34.8	45	36	193	41.0	50	43	205
			282A00	25.0	30.1	42.4	45	39	193	50.1	60	46	205
			283A00	50.0	60.1	64.9	70	73	193	72.6	80	81	205
			284A00	75.0	90.2	95.0	100	108	193	102.7	110	115	205
		MED	NONE	—	—	40.7	50	43	212	46.9	60	50	224
			282A00	25.0	30.1	49.8	50	46	212	57.5	60	53	224
			283A00	50.0	60.1	72.2	80	80	212	80.0	90	87	224
			284A00	75.0	90.2	102.3	125	115	212	110.1	125	122	224
		HIGH	NONE	—	—	44.9	50	48	249	51.1	60	55	261
			282A00	25.0	30.1	54.8	60	50	249	62.5	70	58	261
			283A00	50.0	60.1	77.2	90	85	249	85.0	90	92	261
			284A00	75.0	90.2	107.3	125	119	249	115.1	125	127	261
		SUPER	NONE	—	—	48.9	60	51	269	55.1	60	59	281
			282A00	25.0	30.1	58.8	60	54	269	66.5	70	61	281
			283A00	50.0	60.1	81.2	90	89	269	89.0	100	96	281
			284A00	75.0	90.2	111.3	125	123	269	119.1	125	130	281
	575-3-60	STD	NONE	—	—	30.0	40	32	154	34.8	40	37	162
			285A00	24.8	23.9	35.5	40	33	154	41.5	45	38	162
			286A00	49.6	47.7	65.3	70	60	154	71.3	80	66	162
			287A00	74.4	71.6	77.2	90	88	154	83.2	90	93	162
		MED	NONE	—	—	32.7	40	35	166	37.5	45	40	174
			285A00	24.8	23.9	38.9	40	36	166	44.9	45	41	174
			286A00	49.6	47.7	68.6	70	63	166	74.6	80	69	174
			287A00	74.4	71.6	80.6	90	91	166	86.6	90	96	174
		HIGH	NONE	—	—	34.4	40	37	193	39.2	45	42	201
			285A00	24.8	23.9	41.0	45	38	193	47.0	50	43	201
			286A00	49.6	47.7	70.8	80	65	193	76.8	80	71	201
			287A00	74.4	71.6	82.7	90	93	193	88.7	90	98	201
		SUPER	NONE	—	—	38.7	50	41	204	43.5	50	46	212
			285A00	24.8	23.9	45.6	50	42	204	51.6	60	47	212
			286A00	49.6	47.7	75.4	80	69	204	81.4	90	75	212
			287A00	74.4	71.6	87.4	100	97	204	93.4	100	102	212

See Legends and Notes on page 110.

UNIT WIRE SIZING DATA WITH FACTORY-INSTALLED HACR BREAKER (15 TONS, WITH POWERED CO)

UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER			WITH PWRD CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	HACR BRKR	DISC. SIZE		MCA	HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B17	208/230-3-60	STD	NONE	—	—	74.2/74.2	100/100	77/76	380	86.0/86.0	100/100	91/90	400
			279A00	18.8/25.0	52.1/60.1	90.9/90.9	100/100	77/84	380/380	105.6/105.6	110/110	91/97	400/400
			280A00	37.6/50.0	104.2/120.3	147.0/147.0	150/150	135/153	380/380	161.8/161.8	175/175	149/166	400/400
			281A00	56.3/75.0	156.4/180.4	196.2/196.2	200/225	195/222	380/380	210.9/210.9	225/225	209/236	400/400
		MED	NONE	—	—	86.8	100	92	419	98.6	125	105	439
			279A00	18.8/25.0	52.1/60.1	107.6/107.6	110/110	92/99	419/419	122.4/122.4	125/125	105/113	439/439
			280A00	37.6/50.0	104.2/120.3	162.8/162.8	175/175	150/168	419/419	177.5/177.5	200/200	163/182	439/439
			281A00	56.3/75.0	156.4/180.4	212.9/212.9	225/250	210/237	419/419	227.7/227.7	250/250	223/251	439/439
		HIGH	NONE	—	—	93.7	110	100	493	105.5	125	113	513
			279A00	18.8/25.0	52.1/60.1	116.1/116.1	125/125	100/107	493/493	130.9/130.9	150/150	113/120	513/513
			280A00	37.6/50.0	104.2/120.3	171.3/171.3	175/175	158/176	493/493	186.0/186.0	200/200	171/190	513/513
			281A00	56.3/75.0	156.4/180.4	221.4/221.4	225/250	218/245	493/493	236.2/236.2	250/250	231/259	513/513
		SUPER	NONE	—	—	105.3	125	110	533	117.1	150	124	553
			279A00	18.8/25.0	52.1/60.1	127.8/127.8	150/150	110/118	533/533	142.5/142.5	150/150	124/131	553/553
			280A00	37.6/50.0	104.2/120.3	182.9/182.9	200/200	168/187	533/533	197.6/197.6	200/200	182/200	553/553
			281A00	56.3/75.0	156.4/180.4	233.0/233.0	250/250	228/256	533/533	247.8/247.8	250/300	242/269	553/553
	460-3-60	STD	NONE	—	—	37.0	45	39	195	43.2	50	46	207
			282A00	25.0	30.1	45.1	50	42	195	52.9	60	49	207
			283A00	50.0	60.1	67.6	80	76	195	75.4	80	83	207
			284A00	75.0	90.2	97.7	100	111	195	105.5	110	118	207
		MED	NONE	—	—	42.9	50	46	214	49.1	60	53	226
			282A00	25.0	30.1	52.5	60	48	214	60.3	70	55	226
			283A00	50.0	60.1	75.0	80	83	214	82.7	90	90	226
			284A00	75.0	90.2	105.1	125	117	214	112.8	125	125	226
		HIGH	NONE	—	—	47.1	60	50	251	53.3	60	57	263
			282A00	25.0	30.1	57.5	60	53	251	65.3	70	60	263
			283A00	50.0	60.1	80.0	90	87	251	87.7	90	95	263
			284A00	75.0	90.2	110.1	125	122	251	117.8	125	129	263
		SUPER	NONE	—	—	51.1	60	54	271	57.3	70	61	283
			282A00	25.0	30.1	61.5	70	57	271	69.3	70	64	283
			283A00	50.0	60.1	84.0	100	91	271	91.7	100	98	283
			284A00	75.0	90.2	114.1	125	126	271	121.8	125	133	283
	575-3-60	STD	NONE	—	—	31.7	40	33	156	36.5	45	39	164
			285A00	24.8	23.9	37.6	40	35	156	43.6	45	40	164
			286A00	49.6	47.7	67.4	70	62	156	73.4	80	68	164
			287A00	74.4	71.6	79.4	90	89	156	85.4	90	95	164
		MED	NONE	—	—	34.4	40	37	168	39.2	45	42	176
			285A00	24.8	23.9	41.0	45	38	168	47.0	50	43	176
			286A00	49.6	47.7	70.8	80	65	168	76.8	80	71	176
			287A00	74.4	71.6	82.7	90	93	168	88.7	90	98	176
		HIGH	NONE	—	—	36.1	45	39	195	40.9	50	44	203
			285A00	24.8	23.9	43.1	45	40	195	49.1	50	45	203
			286A00	49.6	47.7	72.9	80	67	195	78.9	80	73	203
			287A00	74.4	71.6	84.9	90	95	195	90.9	100	100	203
		SUPER	NONE	—	—	40.4	50	43	206	45.2	50	48	214
			285A00	24.8	23.9	47.8	50	44	206	53.8	60	49	214
			286A00	49.6	47.7	77.5	80	71	206	83.5	90	77	214
			287A00	74.4	71.6	89.5	100	99	206	95.5	100	104	214

See Legends and Notes on page 110.

UNIT WIRE SIZING DATA WITH FACTORY-INSTALLED HACR BREAKER (17.5 TONS, NO CO)

UNIT SIZE	NOM. v-Ph-Hz	IFM TYPE	ELECTRIC HEATER			NO CO OR PWR CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	HACR BRKR	DISC. SIZE		MCA	HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B20	208/230-3-60	STD	NONE	—	—	75.3/75.3	100/100	79/78	416	87.1/87.1	100/100	92/91	436
			279A00	18.8/25.0	52.1/60.1	84.9/84.9	100/100	79/78	416/416	99.6/99.6	100/100	92/92	436/436
			280A00	37.6/50.0	104.2/120.3	141.0/141.0	150/150	130/147	416/416	155.8/155.8	175/175	143/161	436/436
			281A00	56.3/75.0	156.4/180.4	190.2/190.2	200/200	190/216	416/416	204.9/204.9	225/225	203/230	436/436
		MED	NONE	—	—	87.9	100	93	455	99.7	125	107	475
			279A00	18.8/25.0	52.1/60.1	101.6/101.6	110/110	93/93	455/455	116.4/116.4	125/125	107/107	475/475
			280A00	37.6/50.0	104.2/120.3	156.8/156.8	175/175	144/163	455/455	171.5/171.5	175/175	158/176	475/475
			281A00	56.3/75.0	156.4/180.4	206.9/206.9	225/250	204/232	455/455	221.7/221.7	225/250	218/245	475/475
		HIGH	NONE	—	—	94.8	110	101	529	106.6	125	115	549
			279A00	18.8/25.0	52.1/60.1	110.1/110.1	125/125	101/101	529/529	124.9/124.9	125/125	115/115	549/549
			280A00	37.6/50.0	104.2/120.3	165.3/165.3	175/175	152/171	529/529	180.0/180.0	200/200	166/184	549/549
			281A00	56.3/75.0	156.4/180.4	215.4/215.4	225/250	212/240	529/529	230.2/230.2	250/250	226/253	549/549
		SUPER	NONE	—	—	106.4	125	112	569	118.2	150	125	589
			279A00	18.8/25.0	52.1/60.1	121.8/121.8	125/125	112/112	569/569	136.5/136.5	150/150	125/126	589/589
			280A00	37.6/50.0	104.2/120.3	176.9/176.9	200/200	163/181	569/569	191.6/191.6	200/200	176/195	589/589
			281A00	56.3/75.0	156.4/180.4	227.0/227.0	250/250	223/250	569/569	241.8/241.8	250/250	236/264	589/589
	460-3-60	STD	NONE	—	—	37.2	50	39	231	43.4	50	46	243
			282A00	25.0	30.1	42.4	50	39	231	50.1	60	46	243
			283A00	50.0	60.1	64.9	70	73	231	72.6	80	81	243
			284A00	75.0	90.2	95.0	100	108	231	102.7	110	115	243
		MED	NONE	—	—	43.1	50	46	250	49.3	60	53	262
			282A00	25.0	30.1	49.8	50	46	250	57.5	60	53	262
			283A00	50.0	60.1	72.2	80	80	250	80.0	90	87	262
			284A00	75.0	90.2	102.3	125	115	250	110.1	125	122	262
		HIGH	NONE	—	—	47.3	60	50	287	53.5	60	58	299
			282A00	25.0	30.1	54.8	60	50	287	62.5	70	58	299
			283A00	50.0	60.1	77.2	90	85	287	85.0	90	92	299
			284A00	75.0	90.2	107.3	125	119	287	115.1	125	127	299
		SUPER	NONE	—	—	51.3	60	54	307	57.5	70	61	319
			282A00	25.0	30.1	58.8	60	54	307	66.5	70	61	319
			283A00	50.0	60.1	81.2	90	89	307	89.0	100	96	319
			284A00	75.0	90.2	111.3	125	123	307	119.1	125	130	319
	575-3-60	STD	NONE	—	—	31.8	40	34	182	36.6	45	39	190
			285A00	24.8	23.9	35.5	40	34	182	41.5	45	39	190
			286A00	49.6	47.7	65.3	70	60	182	71.3	80	66	190
			287A00	74.4	71.6	77.2	90	88	182	83.2	90	93	190
		MED	NONE	—	—	34.5	40	37	194	39.3	45	42	202
			285A00	24.8	23.9	38.9	40	37	194	44.9	45	42	202
			286A00	49.6	47.7	68.6	70	63	194	74.6	80	69	202
			287A00	74.4	71.6	80.6	90	91	194	86.6	90	96	202
		HIGH	NONE	—	—	36.2	45	39	221	41.0	50	44	229
			285A00	24.8	23.9	41.0	45	39	221	47.0	50	44	229
			286A00	49.6	47.7	70.8	80	65	221	76.8	80	71	229
			287A00	74.4	71.6	82.7	90	93	221	88.7	90	98	229
		SUPER	NONE	—	—	40.5	50	43	232	45.3	50	48	240
			285A00	24.8	23.9	45.6	50	43	232	51.6	60	48	240
			286A00	49.6	47.7	75.4	80	69	232	81.4	90	75	240
			287A00	74.4	71.6	87.4	100	97	232	93.4	100	102	240

See Legends and Notes on page 110.

UNIT WIRE SIZING DATA WITH FACTORY-INSTALLED HACR BREAKER (17.5 TONS, WITH POWERED CO)

UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER			WITH PWRD CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	HACR BRKR	DISC. SIZE		MCA	HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B20	208/230-3-60	STD	NONE	—	—	80.1/80.1	100/100	84/83	421	91.9/91.9	100/100	98/97	441
			279A00	18.8/25.0	52.1/60.1	90.9/90.9	100/100	84/84	421/421	105.6/105.6	110/110	98/97	441/441
			280A00	37.6/50.0	104.2/120.3	147.0/147.0	150/150	135/153	421/421	161.8/161.8	175/175	149/166	441/441
			281A00	56.3/75.0	156.4/180.4	196.2/196.2	200/225	195/222	421/421	210.9/210.9	225/225	209/236	441/441
		MED	NONE	—	—	92.7	100	99	460	104.5	125	112	480
			279A00	18.8/25.0	52.1/60.1	107.6/107.6	110/110	99/99	460/460	122.4/122.4	125/125	112/113	480/480
			280A00	37.6/50.0	104.2/120.3	162.8/162.8	175/175	150/168	460/460	177.5/177.5	200/200	163/182	480/480
			281A00	56.3/75.0	156.4/180.4	212.9/212.9	225/250	210/237	460/460	227.7/227.7	250/250	223/251	480/480
		HIGH	NONE	—	—	99.6	125	106	534	111.4	125	120	554
			279A00	18.8/25.0	52.1/60.1	116.1/116.1	125/125	106/107	534/534	130.9/130.9	150/150	120/120	554/554
			280A00	37.6/50.0	104.2/120.3	171.3/171.3	175/175	158/176	534/534	186.0/186.0	200/200	171/190	554/554
			281A00	56.3/75.0	156.4/180.4	221.4/221.4	225/250	218/245	534/534	236.2/236.2	250/250	231/259	554/554
		SUPER	NONE	—	—	111.2	125	117	574	123.0	150	131	594
			279A00	18.8/25.0	52.1/60.1	127.8/127.8	150/150	117/118	574/574	142.5/142.5	150/150	131/131	594/594
			280A00	37.6/50.0	104.2/120.3	182.9/182.9	200/200	168/187	574/574	197.6/197.6	200/200	182/200	594/594
			281A00	56.3/75.0	156.4/180.4	233.0/233.0	250/250	228/256	574/574	247.8/247.8	250/300	242/269	594/594
	460-3-60	STD	NONE	—	—	39.4	50	42	233	45.6	50	49	245
			282A00	25.0	30.1	45.1	50	42	233	52.9	60	49	245
			283A00	50.0	60.1	67.6	80	76	233	75.4	80	83	245
			284A00	75.0	90.2	97.7	100	111	233	105.5	110	118	245
		MED	NONE	—	—	45.3	50	48	252	51.5	60	56	264
			282A00	25.0	30.1	52.5	60	48	252	60.3	70	56	264
			283A00	50.0	60.1	75.0	80	83	252	82.7	90	90	264
			284A00	75.0	90.2	105.1	125	117	252	112.8	125	125	264
		HIGH	NONE	—	—	49.5	60	53	289	55.7	60	60	301
			282A00	25.0	30.1	57.5	60	53	289	65.3	70	60	301
			283A00	50.0	60.1	80.0	90	87	289	87.7	90	95	301
			284A00	75.0	90.2	110.1	125	122	289	117.8	125	129	301
		SUPER	NONE	—	—	53.5	60	57	309	59.7	70	64	321
			282A00	25.0	30.1	61.5	70	57	309	69.3	70	64	321
			283A00	50.0	60.1	84.0	100	91	309	91.7	100	98	321
			284A00	75.0	90.2	114.1	125	126	309	121.8	125	133	321
	575-3-60	STD	NONE	—	—	33.5	40	36	184	38.3	45	41	192
			285A00	24.8	23.9	37.6	40	36	184	43.6	45	41	192
			286A00	49.6	47.7	67.4	70	62	184	73.4	80	68	192
			287A00	74.4	71.6	79.4	90	89	184	85.4	90	95	192
		MED	NONE	—	—	36.2	45	39	196	41.0	50	44	204
			285A00	24.8	23.9	41.0	45	39	196	47.0	50	44	204
			286A00	49.6	47.7	70.8	80	65	196	76.8	80	71	204
			287A00	74.4	71.6	82.7	90	93	196	88.7	90	98	204
		HIGH	NONE	—	—	37.9	45	41	223	42.7	50	46	231
			285A00	24.8	23.9	43.1	45	41	223	49.1	50	46	231
			286A00	49.6	47.7	72.9	80	67	223	78.9	80	73	231
			287A00	74.4	71.6	84.9	90	95	223	90.9	100	100	231
		SUPER	NONE	—	—	42.2	50	45	234	47.0	60	50	242
			285A00	24.8	23.9	47.8	50	45	234	53.8	60	50	242
			286A00	49.6	47.7	77.5	80	71	234	83.5	90	77	242
			287A00	74.4	71.6	89.5	100	99	234	95.5	100	104	242

See Legends and Notes on page 110.

UNIT WIRE SIZING DATA WITH FACTORY-INSTALLED HACR BREAKER (20 TONS, NO CO)

UNIT SIZE	NOM. v-Ph-Hz	IFM TYPE	ELECTRIC HEATER			NO CO OR PWR CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	HACR BRKR	DISC. SIZE		MCA	HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B24	208/230-3-60	STD	NONE	—	—	103.1	125	109	538	114.9	125	123	558
			279A00	18.8/25.0	52.1/60.1	103.1/103.1	125/125	109/109	538/538	116.4/116.4	125/125	123/123	558/558
			280A00	37.6/50.0	104.2/120.3	156.8/156.8	175/175	144/163	538/538	171.5/171.5	175/175	158/176	558/558
			281A00	56.3/75.0	156.4/180.4	206.9/206.9	225/250	204/232	538/538	221.7/221.7	225/250	218/245	558/558
		MED	NONE	—	—	103.1	125	109	538	114.9	125	123	558
			279A00	18.8/25.0	52.1/60.1	103.1/103.1	125/125	109/109	538/538	116.4/116.4	125/125	123/123	558/558
			280A00	37.6/50.0	104.2/120.3	156.8/156.8	175/175	144/163	538/538	171.5/171.5	175/175	158/176	558/558
			281A00	56.3/75.0	156.4/180.4	206.9/206.9	225/250	204/232	538/538	221.7/221.7	225/250	218/245	558/558
		HIGH	NONE	—	—	109.9	125	117	612	121.7	150	130	632
			279A00	18.8/25.0	52.1/60.1	110.1/110.1	125/125	117/117	612/612	124.9/124.9	150/150	130/130	632/632
			280A00	37.6/50.0	104.2/120.3	165.3/165.3	175/175	152/171	612/612	180.0/180.0	200/200	166/184	632/632
			281A00	56.3/75.0	156.4/180.4	215.4/215.4	225/250	212/240	612/612	230.2/230.2	250/250	226/253	632/632
		SUPER	NONE	—	—	120.2	150	128	652	132.0	150	141	672
			279A00	18.8/25.0	52.1/60.1	121.8/121.8	150/150	128/128	652/652	136.5/136.5	150/150	141/141	672/672
			280A00	37.6/50.0	104.2/120.3	176.9/176.9	200/200	163/181	652/652	191.6/191.6	200/200	176/195	672/672
			281A00	56.3/75.0	156.4/180.4	227.0/227.0	250/250	223/250	652/652	241.8/241.8	250/250	236/264	672/672
	460-3-60	STD	NONE	—	—	56.6	70	60	278	62.8	80	67	290
			282A00	25.0	30.1	56.6	70	60	278	62.8	80	67	290
			283A00	50.0	60.1	72.2	80	80	278	80.0	90	87	290
			284A00	75.0	90.2	102.3	125	115	278	110.1	125	122	290
		MED	NONE	—	—	56.6	70	60	278	62.8	80	67	290
			282A00	25.0	30.1	56.6	70	60	278	62.8	80	67	290
			283A00	50.0	60.1	72.2	80	80	278	80.0	90	87	290
			284A00	75.0	90.2	102.3	125	115	278	110.1	125	122	290
		HIGH	NONE	—	—	60.6	70	65	315	66.8	80	72	327
			282A00	25.0	30.1	60.6	70	65	315	66.8	80	72	327
			283A00	50.0	60.1	77.2	90	85	315	85.0	90	92	327
			284A00	75.0	90.2	107.3	125	119	315	115.1	125	127	327
		SUPER	NONE	—	—	63.8	80	68	335	70.0	80	75	347
			282A00	25.0	30.1	63.8	80	68	335	70.0	80	75	347
			283A00	50.0	60.1	81.2	90	89	335	89.0	100	96	347
			284A00	75.0	90.2	111.3	125	123	335	119.1	125	130	347
	575-3-60	STD	NONE	—	—	45.0	50	48	206	49.8	60	54	214
			285A00	24.8	23.9	45.0	50	48	206	49.8	60	54	214
			286A00	49.6	47.7	68.6	70	63	206	74.6	80	69	214
			287A00	74.4	71.6	80.6	90	91	206	86.6	90	96	214
		MED	NONE	—	—	45.0	50	48	206	49.8	60	54	214
			285A00	24.8	23.9	45.0	50	48	206	49.8	60	54	214
			286A00	49.6	47.7	68.6	70	63	206	74.6	80	69	214
			287A00	74.4	71.6	80.6	90	91	206	86.6	90	96	214
		HIGH	NONE	—	—	46.7	50	50	233	51.5	60	56	241
			285A00	24.8	23.9	46.7	50	50	233	51.5	60	56	241
			286A00	49.6	47.7	70.8	80	65	233	76.8	80	71	241
			287A00	74.4	71.6	82.7	90	93	233	88.7	90	98	241
		SUPER	NONE	—	—	50.4	60	54	244	55.2	60	60	252
			285A00	24.8	23.9	50.4	60	54	244	55.2	60	60	252
			286A00	49.6	47.7	75.4	80	69	244	81.4	90	75	252
			287A00	74.4	71.6	87.4	100	97	244	93.4	100	102	252

See Legends and Notes on page 110.

UNIT WIRE SIZING DATA WITH FACTORY-INSTALLED HACR BREAKER (20 TONS, WITH POWERED CO)

UNIT SIZE	NOM. v-Ph-Hz	IFM TYPE	ELECTRIC HEATER			WITH PWRD CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	HACR BRKR	DISC. SIZE		MCA	HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B24	208/230-3-60	STD	NONE	—	—	107.9	125	115	543	119.7	150	128	563
			279A00	18.8/25.0	52.1/60.1	107.9/107.9	125/125	115/115	543/543	122.4/122.4	150/150	128/128	563/563
			280A00	37.6/50.0	104.2/120.3	162.8/162.8	175/175	150/168	543/543	177.5/177.5	200/200	163/182	563/563
			281A00	56.3/75.0	156.4/180.4	212.9/212.9	225/250	210/237	543/543	227.7/227.7	250/250	223/251	563/563
		MED	NONE	—	—	107.9	125	115	543	119.7	150	128	563
			279A00	18.8/25.0	52.1/60.1	107.9/107.9	125/125	115/115	543/543	122.4/122.4	150/150	128/128	563/563
			280A00	37.6/50.0	104.2/120.3	162.8/162.8	175/175	150/168	543/543	177.5/177.5	200/200	163/182	563/563
			281A00	56.3/75.0	156.4/180.4	212.9/212.9	225/250	210/237	543/543	227.7/227.7	250/250	223/251	563/563
		HIGH	NONE	—	—	114.7	125	122	617	126.5	150	136	637
			279A00	18.8/25.0	52.1/60.1	116.1/116.1	125/125	122/122	617/617	130.9/130.9	150/150	136/136	637/637
			280A00	37.6/50.0	104.2/120.3	171.3/171.3	175/175	158/176	617/617	186.0/186.0	200/200	171/190	637/637
			281A00	56.3/75.0	156.4/180.4	221.4/221.4	225/250	218/245	617/617	236.2/236.2	250/250	231/259	637/637
		SUPER	NONE	—	—	125.0	150	133	657	136.8	150	147	677
			279A00	18.8/25.0	52.1/60.1	127.8/127.8	150/150	133/133	657/657	142.5/142.5	150/150	147/147	677/677
			280A00	37.6/50.0	104.2/120.3	182.9/182.9	200/200	168/187	657/657	197.6/197.6	200/200	182/200	677/677
			281A00	56.3/75.0	156.4/180.4	233.0/233.0	250/250	228/256	657/657	247.8/247.8	250/300	242/269	677/677
	460-3-60	STD	NONE	—	—	58.8	70	62	280	65.0	80	70	292
			282A00	25.0	30.1	58.8	70	62	280	65.0	80	70	292
			283A00	50.0	60.1	75.0	80	83	280	82.7	90	90	292
			284A00	75.0	90.2	105.1	125	117	280	112.8	125	125	292
		MED	NONE	—	—	58.8	70	62	280	65.0	80	70	292
			282A00	25.0	30.1	58.8	70	62	280	65.0	80	70	292
			283A00	50.0	60.1	75.0	80	83	280	82.7	90	90	292
			284A00	75.0	90.2	105.1	125	117	280	112.8	125	125	292
		HIGH	NONE	—	—	62.8	80	67	317	69.0	80	74	329
			282A00	25.0	30.1	62.8	80	67	317	69.0	80	74	329
			283A00	50.0	60.1	80.0	90	87	317	87.7	90	95	329
			284A00	75.0	90.2	110.1	125	122	317	117.8	125	129	329
		SUPER	NONE	—	—	66.0	80	71	337	72.2	90	78	349
			282A00	25.0	30.1	66.0	80	71	337	72.2	90	78	349
			283A00	50.0	60.1	84.0	100	91	337	91.7	100	98	349
			284A00	75.0	90.2	114.1	125	126	337	121.8	125	133	349
	575-3-60	STD	NONE	—	—	46.7	50	50	208	51.5	60	56	216
			285A00	24.8	23.9	46.7	50	50	208	51.5	60	56	216
			286A00	49.6	47.7	70.8	80	65	208	76.8	80	71	216
			287A00	74.4	71.6	82.7	90	93	208	88.7	90	98	216
		MED	NONE	—	—	46.7	50	50	208	51.5	60	56	216
			285A00	24.8	23.9	46.7	50	50	208	51.5	60	56	216
			286A00	49.6	47.7	70.8	80	65	208	76.8	80	71	216
			287A00	74.4	71.6	82.7	90	93	208	88.7	90	98	216
		HIGH	NONE	—	—	48.4	60	52	235	53.2	60	58	243
			285A00	24.8	23.9	48.4	60	52	235	53.2	60	58	243
			286A00	49.6	47.7	72.9	80	67	235	78.9	80	73	243
			287A00	74.4	71.6	84.9	90	95	235	90.9	100	100	243
		SUPER	NONE	—	—	52.1	60	56	246	56.9	70	62	254
			285A00	24.8	23.9	52.1	60	56	246	56.9	70	62	254
			286A00	49.6	47.7	77.5	80	71	246	83.5	90	77	254
			287A00	74.4	71.6	89.5	100	99	246	95.5	100	104	254

See Legends and Notes on page 110.

UNIT WIRE SIZING DATA WITH FACTORY-INSTALLED HACR BREAKER (23 TONS, NO CO)

UNIT SIZE	NOM. v-PH-Hz	IFM TYPE	ELECTRIC HEATER			NO CO OR PWR CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	HACR BRKR	DISC. SIZE		MCA	HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B26	208/230-3-60	STD	NONE	—	—	126.1	175	130	629	137.9	175	144	649
			279A00	18.8/25.0	52.1/60.1	126.1/126.1	175/175	130/130	629/629	137.9/137.9	175/175	144/144	649/649
			280A00	37.6/50.0	104.2/120.3	156.8/156.8	175/175	144/163	629/629	171.5/171.5	175/175	158/176	649/649
			281A00	56.3/75.0	156.4/180.4	206.9/206.9	225/250	204/232	629/629	221.7/221.7	225/250	218/245	649/649
		MED	NONE	—	—	132.9	175	138	703	144.7	175	152	723
			279A00	18.8/25.0	52.1/60.1	132.9/132.9	175/175	138/138	703/703	144.7/144.7	175/175	152/152	723/723
			280A00	37.6/50.0	104.2/120.3	165.3/165.3	175/175	152/171	703/703	180.0/180.0	200/200	166/184	723/723
			281A00	56.3/75.0	156.4/180.4	215.4/215.4	225/250	212/240	703/703	230.2/230.2	250/250	226/253	723/723
		HIGH	NONE	—	—	142.2	175	149	743	154.0	200	162	763
			279A00	18.8/25.0	52.1/60.1	142.2/142.2	175/175	149/149	743/743	154.0/154.0	200/200	162/162	763/763
			280A00	37.6/50.0	104.2/120.3	176.9/176.9	200/200	163/181	743/743	191.6/191.6	200/200	176/195	763/763
			281A00	56.3/75.0	156.4/180.4	227.0/227.0	250/250	223/250	743/743	241.8/241.8	250/250	236/264	763/763
	460-3-60	STD	NONE	—	—	64.9	80	68	322	71.1	90	75	334
			282A00	25.0	30.1	64.9	80	68	322	71.1	90	75	334
			283A00	50.0	60.1	72.2	80	80	322	80.0	90	87	334
			284A00	75.0	90.2	102.3	125	115	322	110.1	125	122	334
		MED	NONE	—	—	68.9	90	73	359	75.1	90	80	371
			282A00	25.0	30.1	68.9	90	73	359	75.1	90	80	371
			283A00	50.0	60.1	77.2	90	85	359	85.0	90	92	371
			284A00	75.0	90.2	107.3	125	119	359	115.1	125	127	371
		HIGH	NONE	—	—	72.1	90	76	379	78.3	100	83	391
			282A00	25.0	30.1	72.1	90	76	379	78.3	100	83	391
			283A00	50.0	60.1	81.2	90	89	379	89.0	100	96	391
			284A00	75.0	90.2	111.3	125	123	379	119.1	125	130	391
	575-3-60	STD	NONE	—	—	53.9	60	56	235	58.7	70	62	243
			285A00	24.8	23.9	53.9	60	56	235	58.7	70	62	243
			286A00	49.6	47.7	68.6	70	63	235	74.6	80	69	243
			287A00	74.4	71.6	80.6	90	91	235	86.6	90	96	243
		MED	NONE	—	—	55.6	70	58	262	60.4	80	64	270
			285A00	24.8	23.9	55.6	70	58	262	60.4	80	64	270
			286A00	49.6	47.7	70.8	80	65	262	76.8	80	71	270
			287A00	74.4	71.6	82.7	90	93	262	88.7	90	98	270
		HIGH	NONE	—	—	59.3	70	62	273	64.1	80	68	281
			285A00	24.8	23.9	59.3	70	62	273	64.1	80	68	281
			286A00	49.6	47.7	75.4	80	69	273	81.4	90	75	281
			287A00	74.4	71.6	87.4	100	97	273	93.4	100	102	281

See Legends and Notes on page 110.

UNIT WIRE SIZING DATA WITH FACTORY-INSTALLED HACR BREAKER (23 TONS, WITH POWERED CO)

UNIT SIZE	NOM. v-PH-Hz	IFM TYPE	ELECTRIC HEATER			WITH PWRD CO							
			CRHEATER PART NUMBER	NOM (KW)	FLA	NO PE				WITH PE (PWRD FR/UNIT)			
						MCA	HACR BRKR	DISC. SIZE		MCA	HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
50LC*B26	208/230-3-60	STD	NONE	—	—	130.9	175	136	634	142.7	175	149	654
			279A00	18.8/25.0	52.1/60.1	130.9/130.9	175/175	136/136	634/634	142.7/142.7	175/175	149/149	654/654
			280A00	37.6/50.0	104.2/120.3	162.8/162.8	175/175	150/168	634/634	177.5/177.5	200/200	163/182	654/654
			281A00	56.3/75.0	156.4/180.4	212.9/212.9	225/250	210/237	634/634	227.7/227.7	250/250	223/251	654/654
		MED	NONE	—	—	137.7	175	144	708	149.5	200	157	728
			279A00	18.8/25.0	52.1/60.1	137.7/137.7	175/175	144/144	708/708	149.5/149.5	200/200	157/157	728/728
			280A00	37.6/50.0	104.2/120.3	171.3/171.3	175/175	158/176	708/708	186.0/186.0	200/200	171/190	728/728
			281A00	56.3/75.0	156.4/180.4	221.4/221.4	225/250	218/245	708/708	236.2/236.2	250/250	231/259	728/728
		HIGH	NONE	—	—	147.0	175	154	748	158.8	200	168	768
			279A00	18.8/25.0	52.1/60.1	147.0/147.0	175/175	154/154	748/748	158.8/158.8	200/200	168/168	768/768
			280A00	37.6/50.0	104.2/120.3	182.9/182.9	200/200	168/187	748/748	197.6/197.6	200/200	182/200	768/768
			281A00	56.3/75.0	156.4/180.4	233.0/233.0	250/250	228/256	748/748	247.8/247.8	250/300	242/269	768/768
	460-3-60	STD	NONE	—	—	67.1	90	70	324	73.3	90	78	336
			282A00	25.0	30.1	67.1	90	70	324	73.3	90	78	336
			283A00	50.0	60.1	75.0	90	83	324	82.7	90	90	336
			284A00	75.0	90.2	105.1	125	117	324	112.8	125	125	336
		MED	NONE	—	—	71.1	90	75	361	77.3	100	82	373
			282A00	25.0	30.1	71.1	90	75	361	77.3	100	82	373
			283A00	50.0	60.1	80.0	90	87	361	87.7	100	95	373
			284A00	75.0	90.2	110.1	125	122	361	117.8	125	129	373
		HIGH	NONE	—	—	74.3	90	79	381	80.5	100	86	393
			282A00	25.0	30.1	74.3	90	79	381	80.5	100	86	393
			283A00	50.0	60.1	84.0	100	91	381	91.7	100	98	393
			284A00	75.0	90.2	114.1	125	126	381	121.8	125	133	393
	575-3-60	STD	NONE	—	—	55.6	70	58	237	60.4	80	64	245
			285A00	24.8	23.9	55.6	70	58	237	60.4	80	64	245
			286A00	49.6	47.7	70.8	80	65	237	76.8	80	71	245
			287A00	74.4	71.6	82.7	90	93	237	88.7	90	98	245
		MED	NONE	—	—	57.3	70	60	264	62.1	80	66	272
			285A00	24.8	23.9	57.3	70	60	264	62.1	80	66	272
			286A00	49.6	47.7	72.9	80	67	264	78.9	80	73	272
			287A00	74.4	71.6	84.9	90	95	264	90.9	100	100	272
		HIGH	NONE	—	—	61.0	80	64	275	65.8	80	70	283
			285A00	24.8	23.9	61.0	80	64	275	65.8	80	70	283
			286A00	49.6	47.7	77.5	80	71	275	83.5	90	77	283
			287A00	74.4	71.6	89.5	100	99	275	95.5	100	104	283

See Legends and Notes on page 110.

3-STAGE COOLING WITH 3-SPEED INDOOR FAN MOTOR, SIZES 14-26 (12.5-23 TONS) — HIGH SCCR

50LC** UNIT	V-Ph-Hz	VOLTAGE		HIGH SCCR kA	COMP 1		COMP 2		OFM (ea)		IFM		
		RANGE			RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF AT FULL LOAD	FLA
		MIN	MAX										
14	208-3-60	253	187	60	17.6	123	23.2	164	185	1.3	STD	85.0%	8.6
											MED	83.6%	13.6
											HIGH	89.5%	21.2
											SUPER	91.7%	28.0
	230-3-60	253	187	60	17.6	123	23.2	164	185	1.3	STD	85.0%	7.8
											MED	83.6%	12.7
											HIGH	89.5%	21.2
											SUPER	91.7%	28.0
	460-3-60	506	414	65	9.6	62	11.2	75	185	1.3	STD	85.0%	3.8
											MED	83.6%	6.4
											HIGH	89.5%	9.7
											SUPER	91.7%	13.7
17	208-3-60	253	187	60	19.1	123	27.6	191	185	1.3	STD	85.0%	8.6
											MED	89.5%	21.2
											HIGH	91.7%	28.0
											SUPER	91.7%	37.3
	230-3-60	253	187	60	19.1	123	27.6	191	185	1.3	STD	85.0%	7.8
											MED	89.5%	21.2
											HIGH	91.7%	28.0
											SUPER	91.7%	37.3
	460-3-60	506	414	65	9.8	62	12.8	100	185	1.3	STD	85.0%	3.8
											MED	89.5%	9.7
											HIGH	91.7%	13.7
											SUPER	91.7%	16.9
20	208-3-60	253	187	60	25.0	164	27.6	191	185	1.3	STD	85.0%	8.6
											MED	89.5%	21.2
											HIGH	91.7%	28.0
											SUPER	91.7%	37.3
	230-3-60	253	187	60	25.0	164	27.6	191	185	1.3	STD	85.0%	7.8
											MED	89.5%	21.2
											HIGH	91.7%	28.0
											SUPER	91.7%	37.3
	460-3-60	506	414	65	12.2	100	12.8	100	185	1.3	STD	85.0%	3.8
											MED	89.5%	9.7
											HIGH	91.7%	13.7
											SUPER	91.7%	16.9
24	208-3-60	253	187	60	29.5	195	33.3	239	190	1.6	STD	89.5%	21.2
											MED	89.5%	21.2
											HIGH	91.7%	28.0
											SUPER	91.7%	37.3
	230-3-60	253	187	60	29.5	195	33.3	239	190	1.6	STD	89.5%	21.2
											MED	89.5%	21.2
											HIGH	91.7%	28.0
											SUPER	91.7%	37.3
	460-3-60	506	414	65	14.8	95	18.0	125	190	1.6	STD	89.5%	9.7
											MED	89.5%	9.7
											HIGH	91.7%	13.7
											SUPER	91.7%	16.9

3-STAGE COOLING WITH 3-SPEED INDOOR FAN MOTOR, SIZES 14-26 (12.5-23 TONS) — HIGH SCCR (cont)

50LC** UNIT	V-Ph-Hz	VOLTAGE		HIGH SCCR kA	COMP 1		COMP 2		OFM (ea)		IFM		
		RANGE			RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF AT FULL LOAD	FLA
		MIN	MAX										
26	208-3-60	253	187	60	30.1	225	51.2	300	190	1.6	STD	89.5%	21.2
											MED	91.7%	28.0
											HIGH	91.7%	37.3
	230-3-60	253	187	60	30.1	225	51.2	300	190	1.6	STD	89.5%	21.2
											MED	91.7%	28.0
											HIGH	91.7%	37.3
	460-3-60	506	414	65	16.7	114	23.1	150	190	1.6	STD	89.5%	9.7
											MED	91.7%	13.7
											HIGH	91.7%	16.9

See Legends and Notes on page 110.

NOTE: High SCCR is not available for units with 575v.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA, 3-SPEED INDOOR FAN MOTOR, SIZE 14 (12.5 TONS) — HIGH SCCR

50LC** UNIT	NOM. V-Ph-Hz	IFM TYPE	HIGH SCCR kA	CRHEATER PART NUMBER	NOM (kW)	FLA	NO CO OR UNPWR CO							
							NO PE				W/ PE (PWRD FR/UNIT)			
							MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
									FLA	LRA			FLA	LRA
14	208/230-3-60	STD	60	—	—	—	59.1/ 58.3	80/80	61/60	343	70.9/ 70.1	90/90	75/74	363
				400A00	11.3/15.0	31.3/36.1	59.1/ 58.3	80/80	61/60	343/343	70.9/ 70.1	90/90	75/74	363/363
				402A00	18.8/25.0	52.1/60.1	75.9/ 84.9	80/90	70/78	343/343	90.6/ 99.6	100/100	83/92	363/363
				404A00	37.6/50.0	104.2/120.3	141.0/ 130.1	150/150	130/147	343/343	155.8/ 144.8	175/150	143/161	363/363
		MED	60	—	—	—	64.1/ 63.2	80/80	67/66	378	75.9/ 75.0	90/90	81/80	398
				400A00	11.3/15.0	31.3/36.1	64.1/ 63.2	80/80	67/66	378/378	75.9/ 75.8	90/90	81/80	398/398
				402A00	18.8/25.0	52.1/60.1	82.1/ 91.0	90/100	76/84	378/378	96.9/ 105.8	100/110	89/97	398/398
				404A00	37.6/50.0	104.2/120.3	147.3/ 136.2	150/150	135/153	378/378	162.0/ 150.9	175/175	149/167	398/398
		HIGH	60	—	—	—	71.7	90	76	382	83.5	100	89	402
				400A00	11.3/15.0	31.3/36.1	71.7/ 71.7	90/90	76/76	382/382	83.5/ 86.4	100/100	89/89	402/402
				402A00	18.8/25.0	52.1/60.1	91.6/ 101.6	100/110	84/93	382/382	106.4/ 116.4	110/125	98/107	402/402
				404A00	37.6/50.0	104.2/120.3	156.8/ 146.8	175/175	144/163	382/382	171.5/ 161.6	175/175	158/176	402/402
		SUPER	60	—	—	—	79.7	100	84	456	91.5	100	97	476
				400A00	11.3/15.0	31.3/36.1	79.7/ 80.1	100/100	84/84	456/456	91.5/ 94.9	100/100	97/97	476/476
				402A00	18.8/25.0	52.1/60.1	100.1/ 110.1	110/125	92/101	456/456	114.9/ 124.9	125/125	106/115	476/476
				404A00	37.6/50.0	104.2/120.3	165.3/ 155.3	175/175	152/171	456/456	180.0/ 170.1	200/175	166/184	476/476
	460-3-60	STD	65	—	—	—	31.3	40	33	167	37.5	45	40	179
				401A00	15.0	18.0	31.3	40	33	167	37.5	45	40	179
				403A00	25.0	30.1	42.4	45	39	167	50.1	60	46	179
				405A00	50.0	60.1	64.9	70	73	167	72.6	80	81	179
		MED	65	—	—	—	33.9	45	36	184	40.1	50	43	196
				401A00	15.0	18.0	33.9	45	36	184	40.1	50	43	196
				403A00	25.0	30.1	45.6	50	42	184	53.4	60	49	196
				405A00	50.0	60.1	68.1	80	76	184	75.9	80	84	196
		HIGH	65	—	—	—	37.2	45	40	186	43.4	50	47	198
				401A00	15.0	18.0	37.2	45	40	186	43.4	50	47	198
				403A00	25.0	30.1	49.8	50	46	186	57.5	60	53	198
				405A00	50.0	60.1	72.2	80	80	186	80.0	90	87	198
		SUPER	65	—	—	—	41.8	50	44	223	48.0	60	51	235
				401A00	15.0	18.0	41.8	50	44	223	48.0	60	51	235
				403A00	25.0	30.1	54.8	60	50	223	62.5	70	58	235
				405A00	50.0	60.1	77.2	90	85	223	85.0	90	92	235

See Legends and Notes on page 110.

NOTE: High SCCR is not available for units with 575v.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA, 3-SPEED INDOOR FAN MOTOR, SIZE 17 (15 TONS) — HIGH SCCR

50LC** UNIT	NOM. V-ph-Hz	IFM TYPE	HIGH SCCR kA	CRHEATER PART NUMBER	NOM (kW)	FLA	NO CO OR UNPWR CO							
							NO PE				W/ PE (PWRD FR/UNIT)			
							MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
									FLA	LRA			FLA	LRA
17	208/230-3-60	STD	60	—	—	—	67.4/ 66.6	90/90	70/69	371	79.2/ 78.4	100/100	83/82	391
				402A00	18.8/25.0	52.1/60.1	75.9/ 84.9	90/90	70/78	371/371	90.6/ 99.6	100/100	83/92	391/391
				406A00	37.6/50.0	104.2/120.3	141.0/ 130.1	150/150	130/147	371/371	155.8/ 144.8	175/150	143/161	391/391
				408A00	56.3/75.0	156.4/180.4	167.2/ 190.2	200/200	190/216	371/371	181.9/ 204.9	200/225	203/230	391/391
		MED	60	—	—	—	80.0	100	84	410	91.8	100	98	430
				402A00	18.8/25.0	52.1/60.1	91.6/ 101.6	100/110	84/93	410/410	106.4/ 116.4	110/125	98/107	430/430
				406A00	37.6/50.0	104.2/120.3	156.8/ 146.8	175/175	144/163	410/410	171.5/ 161.6	175/175	158/176	430/430
				408A00	56.3/75.0	156.4/180.4	182.9/ 206.9	200/250	204/232	410/410	197.7/ 221.7	225/250	218/245	430/430
		HIGH	60	—	—	—	86.9	100	92	484	98.7	125	105	504
				402A00	18.8/25.0	52.1/60.1	100.1/ 110.1	110/125	92/101	484/484	114.9/ 124.9	125/125	106/115	504/504
				406A00	37.6/50.0	104.2/120.3	165.3/ 155.3	175/175	152/171	484/484	180.0/ 170.1	200/175	166/184	504/504
				408A00	56.3/75.0	156.4/180.4	191.4/ 215.4	200/250	212/240	484/484	206.2/ 230.2	225/250	226/253	504/504
		SUPER	60	—	—	—	98.5	125	103	524	110.3	125	116	544
				402A00	18.8/25.0	52.1/60.1	111.8/ 121.8	125/125	103/112	524/524	126.5/ 136.5	150/150	116/126	544/544
				406A00	37.6/50.0	104.2/120.3	176.9/ 166.9	200/200	163/181	524/524	191.6/ 181.7	200/200	176/195	544/544
				408A00	56.3/75.0	156.4/180.4	203.0/ 227.0	225/250	223/250	524/524	217.8/ 241.8	250/250	236/264	544/544
	460-3-60	STD	65	—	—	—	34.8	45	36	193	41.0	50	43	205
				403A00	25.0	30.1	42.4	45	39	193	50.1	60	46	205
				407A00	50.0	60.1	64.9	70	73	193	72.6	80	81	205
				409A00	75.0	90.2	95.0	100	108	193	102.7	110	115	205
		MED	65	—	—	—	40.7	50	43	212	46.9	60	50	224
				403A00	25.0	30.1	49.8	50	46	212	57.5	60	53	224
				407A00	50.0	60.1	72.2	80	80	212	80.0	90	87	224
				409A00	75.0	90.2	102.3	125	115	212	110.1	125	122	224
		HIGH	65	—	—	—	44.9	50	48	249	51.1	60	55	261
				403A00	25.0	30.1	54.8	60	50	249	62.5	70	58	261
				407A00	50.0	60.1	77.2	90	85	249	85.0	90	92	261
				409A00	75.0	90.2	107.3	125	119	249	115.1	125	127	261
		SUPER	65	—	—	—	48.9	60	51	269	55.1	60	59	281
				403A00	25.0	30.1	58.8	60	54	269	66.5	70	61	281
				407A00	50.0	60.1	81.2	90	89	269	89.0	100	96	281
				409A00	75.0	90.2	111.3	125	123	269	119.1	125	130	281

See Legends and Notes on page 110.

NOTE: High SCCR is not available for units with 575v.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA, 3-SPEED INDOOR FAN MOTOR, SIZE 20 (17.5 TONS) — HIGH SCCR

50LC** UNIT	NOM. V-Ph-Hz	IFM TYPE	HIGH SCCR kA	CRHEATER PART NUMBER	NOM (kW)	FLA	NO CO OR UNPWR CO							
							NO PE				W/ PE (PWRD FR/UNIT)			
							MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
									FLA	LRA			FLA	LRA
20	208/230-3-60	STD	60	—	—	—	73.3/ 72.5	100/100	76/75	412	85.1/ 84.3	100/100	90/89	432
				402A00	18.8/25.0	52.1/60.1	75.9/ 84.9	100/100	76/78	412/412	90.6/ 99.6	100/100	90/92	432/432
				406A00	37.6/50.0	104.2/120.3	141.0/ 130.1	150/150	130/147	412/412	155.8/ 144.8	175/150	143/161	432/432
				408A00	56.3/75.0	156.4/180.4	167.2/ 190.2	200/200	190/216	412/412	181.9/ 204.9	200/225	203/230	432/432
		MED	60	—	—	—	85.9	100	91	451	97.7	125	104	471
				402A00	18.8/25.0	52.1/60.1	91.6/ 101.6	100/110	91/93	451/451	106.4/ 116.4	125/125	104/107	471/471
				406A00	37.6/50.0	104.2/120.3	156.8/ 146.8	175/175	144/163	451/451	171.5/ 161.6	175/175	158/176	471/471
				408A00	56.3/75.0	156.4/180.4	182.9/ 206.9	200/250	204/232	451/451	197.7/ 221.7	225/250	218/245	471/471
		HIGH	60	—	—	—	92.8	100	99	525	104.6	125	112	545
				402A00	18.8/25.0	52.1/60.1	100.1/ 110.1	110/125	99/101	525/525	114.9/ 124.9	125/125	112/115	545/545
				406A00	37.6/50.0	104.2/120.3	165.3/ 155.3	175/175	152/171	525/525	180.0/ 170.1	200/175	166/184	545/545
				408A00	56.3/75.0	156.4/180.4	191.4/ 215.4	200/250	212/240	525/525	206.2/ 230.2	225/250	226/253	545/545
		SUPER	60	—	—	—	104.4	125	109	565	116.2	150	123	585
				402A00	18.8/25.0	52.1/60.1	111.8/ 121.8	125/125	109/112	565/565	126.5/ 136.5	150/150	123/126	585/585
				406A00	37.6/50.0	104.2/120.3	176.9/ 166.9	200/200	163/181	565/565	191.6/ 181.7	200/200	176/195	585/585
				408A00	56.3/75.0	156.4/180.4	203.0/ 227.0	225/250	223/250	565/565	217.8/ 241.8	250/250	236/264	585/585
	460-3-60	STD	65	—	—	—	37.2	50	39	231	43.4	50	46	243
				403A00	25.0	30.1	42.4	50	39	231	50.1	60	46	243
				407A00	50.0	60.1	64.9	70	73	231	72.6	80	81	243
				409A00	75.0	90.2	95.0	100	108	231	102.7	110	115	243
		MED	65	—	—	—	43.1	50	46	250	49.3	60	53	262
				403A00	25.0	30.1	49.8	50	46	250	57.5	60	53	262
				407A00	50.0	60.1	72.2	80	80	250	80.0	90	87	262
				409A00	75.0	90.2	102.3	125	115	250	110.1	125	122	262
		HIGH	65	—	—	—	47.3	60	50	287	53.5	60	58	299
				403A00	25.0	30.1	54.8	60	50	287	62.5	70	58	299
				407A00	50.0	60.1	77.2	90	85	287	85.0	90	92	299
				409A00	75.0	90.2	107.3	125	119	287	115.1	125	127	299
		SUPER	65	—	—	—	51.3	60	54	307	57.5	70	61	319
				403A00	25.0	30.1	58.8	60	54	307	66.5	70	61	319
				407A00	50.0	60.1	81.2	90	89	307	89.0	100	96	319
				409A00	75.0	90.2	111.3	125	123	307	119.1	125	130	319

See Legends and Notes on page 110.

NOTE: High SCCR is not available for units with 575v.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA, 3-SPEED INDOOR FAN MOTOR, SIZE 24 (20 TONS) — HIGH SCCR

50LC** UNIT	NOM. V-Ph-Hz	IFM TYPE	HIGH SCCR kA	CRHEATER PART NUMBER	NOM (kW)	FLA	NO CO OR UNPWR CO							
							NO PE				W/ PE (PWRD FR/UNIT)			
							MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
									FLA	LRA			FLA	LRA
24	208/230-3-60	STD	60	—	—	—	101.9	125	108	538	113.7	125	121	558
				402A00	18.8/25.0	52.1/60.1	101.9/ 101.9	125/125	108/108	538/538	113.7/ 116.4	125/125	121/121	558/558
				406A00	37.6/50.0	104.2/120.3	156.8/ 146.8	175/175	144/163	538/538	171.5/ 161.6	175/175	158/176	558/558
				408A00	56.3/75.0	156.4/180.4	182.9/ 206.9	200/250	204/232	538/538	197.7/ 221.7	225/250	218/245	558/558
		MED	60	—	—	—	101.9	125	108	538	113.7	125	121	558
				402A00	18.8/25.0	52.1/60.1	101.9/ 101.9	125/125	108/108	538/538	113.7/ 116.4	125/125	121/121	558/558
				406A00	37.6/50.0	104.2/120.3	156.8/ 146.8	175/175	144/163	538/538	171.5/ 161.6	175/175	158/176	558/558
				408A00	56.3/75.0	156.4/180.4	182.9/ 206.9	200/250	204/232	538/538	197.7/ 221.7	225/250	218/245	558/558
		HIGH	60	—	—	—	108.7	125	115	612	120.5	150	129	632
				402A00	18.8/25.0	52.1/60.1	108.7/ 110.1	125/125	115/115	612/612	120.5/ 124.9	150/150	129/129	632/632
				406A00	37.6/50.0	104.2/120.3	165.3/ 155.3	175/175	152/171	612/612	180.0/ 170.1	200/175	166/184	632/632
				408A00	56.3/75.0	156.4/180.4	191.4/ 215.4	200/250	212/240	612/612	206.2/ 230.2	225/250	226/253	632/632
		SUPER	60	—	—	—	119.0	150	126	652	130.8	150	140	672
				402A00	18.8/25.0	52.1/60.1	119.0/ 121.8	150/150	126/126	652/652	130.8/ 136.5	150/150	140/140	672/672
				406A00	37.6/50.0	104.2/120.3	176.9/ 166.9	200/200	163/181	652/652	191.6/ 181.7	200/200	176/195	672/672
				408A00	56.3/75.0	156.4/180.4	203.0/ 227.0	225/250	223/250	652/652	217.8/ 241.8	250/250	236/264	672/672
	460-3-60	STD	65	—	—	—	56.6	70	60	278	62.8	80	67	290
				403A00	25.0	30.1	56.6	70	60	278	62.8	80	67	290
				407A00	50.0	60.1	72.2	80	80	278	80.0	90	87	290
				409A00	75.0	90.2	102.3	125	115	278	110.1	125	122	290
		MED	65	—	—	—	56.6	70	60	278	62.8	80	67	290
				403A00	25.0	30.1	56.6	70	60	278	62.8	80	67	290
				407A00	50.0	60.1	72.2	80	80	278	80.0	90	87	290
				409A00	75.0	90.2	102.3	125	115	278	110.1	125	122	290
		HIGH	65	—	—	—	60.6	70	65	315	66.8	80	72	327
				403A00	25.0	30.1	60.6	70	65	315	66.8	80	72	327
				407A00	50.0	60.1	77.2	90	85	315	85.0	90	92	327
				409A00	75.0	90.2	107.3	125	119	315	115.1	125	127	327
		SUPER	65	—	—	—	63.8	80	68	335	70.0	80	75	347
				403A00	25.0	30.1	63.8	80	68	335	70.0	80	75	347
				407A00	50.0	60.1	81.2	90	89	335	89.0	100	96	347
				409A00	75.0	90.2	111.3	125	123	335	119.1	125	130	347

See Legends and Notes on page 110.

NOTE: High SCCR is not available for units with 575v.

UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA, 3-SPEED INDOOR FAN MOTOR, SIZE 26 (23 TONS) — HIGH SCCR

50LC** UNIT	NOM. V-Ph-Hz	IFM TYPE	HIGH SCCR kA	CRHEATER PART NUMBER	NOM (kW)	FLA	NO CO OR UNPWR CO							
							NO PE				W/ PE (PWRD FR/UNIT)			
							MCA	FUSE OR HACR BRKR	DISC. SIZE		MCA	FUSE OR HACR BRKR	DISC. SIZE	
									FLA	LRA			FLA	LRA
26	208/230-3-60	STD	60	—	—	—	124.9	175	129	629	136.7	175	142	649
				402A00	18.8/25.0	52.1/60.1	124.9/ 124.9	175/175	129/129	629/629	136.7/ 136.7	175/175	142/142	649/649
				406A00	37.6/50.0	104.2/120.3	156.8/ 146.8	175/175	144/163	629/629	171.5/ 161.6	175/175	158/176	649/649
				408A00	56.3/75.0	156.4/180.4	182.9/ 206.9	200/250	204/232	629/629	197.7/ 221.7	225/250	218/245	649/649
		MED	60	—	—	—	131.7	175	137	703	143.5	175	150	723
				402A00	18.8/25.0	52.1/60.1	131.7/ 131.7	175/175	137/137	703/703	143.5/ 143.5	175/175	150/150	723/723
				406A00	37.6/50.0	104.2/120.3	165.3/ 155.3	175/175	152/171	703/703	180.0/ 170.1	200/175	166/184	723/723
				408A00	56.3/75.0	156.4/180.4	191.4/ 215.4	200/250	212/240	703/703	206.2/ 230.2	225/250	226/253	723/723
		HIGH	60	—	—	—	141.0	175	147	743	152.8	200	161	763
				402A00	18.8/25.0	52.1/60.1	141.0/ 141.0	175/175	147/147	743/743	152.8/ 152.8	200/200	161/161	763/763
				406A00	37.6/50.0	104.2/120.3	176.9/ 166.9	200/200	163/181	743/743	191.6/ 181.7	200/200	176/195	763/763
				408A00	56.3/75.0	156.4/180.4	203.0/ 227.0	225/250	223/250	743/743	217.8/ 241.8	250/250	236/264	763/763
	460-3-60	STD	65	—	—	—	64.9	80	68	322	71.1	90	75	334
				403A00	25.0	30.1	64.9	80	68	322	71.1	90	75	334
				407A00	50.0	60.1	72.2	80	80	322	80.0	90	87	334
				409A00	75.0	90.2	102.3	125	115	322	110.1	125	122	334
		MED	65	—	—	—	68.9	90	73	359	75.1	90	80	371
				403A00	25.0	30.1	68.9	90	73	359	75.1	90	80	371
				407A00	50.0	60.1	77.2	90	85	359	85.0	90	92	371
				409A00	75.0	90.2	107.3	125	119	359	115.1	125	127	371
		HIGH	65	—	—	—	72.1	90	76	379	78.3	100	83	391
				403A00	25.0	30.1	72.1	90	76	379	78.3	100	83	391
				407A00	50.0	60.1	81.2	90	89	379	89.0	100	96	391
				409A00	75.0	90.2	111.3	125	123	379	119.1	125	130	391

See Legends and Notes on page 110.

NOTE: High SCCR is not available for units with 575v.

LEGEND AND NOTES

Applicable for Electrical Data Tables on pages 76-109

LEGEND


BRKR	— Circuit Breaker
CO	— Convenience Outlet
DISC	— Disconnect
FLA	— Full Load Amps
HACR	— Heating, Air Conditioning, and Refrigeration
IFM	— Indoor Fan Motor
LRA	— Locked Rotor Amps
MCA	— Minimum Circuit Amps
PE	— Power Exhaust
PWRD FR/ UNIT	— Powered from Unit
PWRD CO	— Powered Convenience Outlet
SCCR	— Short Circuit Current Rating
UNPWR CO	— Unpowered Convenience Outlet

NOTES:

1. In compliance with NEC requirements for multimotor and combination load equipment (refer to NEC Articles 430 and 440), the over-current protective device for the unit shall be fuse or HACR breaker. Canadian units may be fuse or circuit breaker.
2. For 208/230 v units, where one value is shown it is the same for either 208 or 230 volts.
3. **Unbalanced 3-Phase Supply Voltage**
Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percentage of voltage imbalance.

$$\% \text{ Voltage Imbalance} = 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

Example: Supply voltage is 230-3-60



AB = 224-v
BC = 231-v
AC = 226-v

$$\text{Average Voltage} = \frac{(224 + 231 + 226)}{3} = \frac{681}{3} = 227$$

Determine maximum deviation from average voltage.

(AB) 227-224 = 3-v

(BC) 231-227 = 4-v

(AC) 227-226 = 1-v

Maximum deviation is 4-v.

Determine percent of voltage imbalance.


$$\% \text{ Voltage Imbalance} = 100 \times \frac{4}{227} = 1.76\%$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.


50LC*B14-26 VAV-RTU OPEN CONTROL WIRING DIAGRAM

HIGH TIER PAC CONTROL VAV 208/230V, 460V, 575V

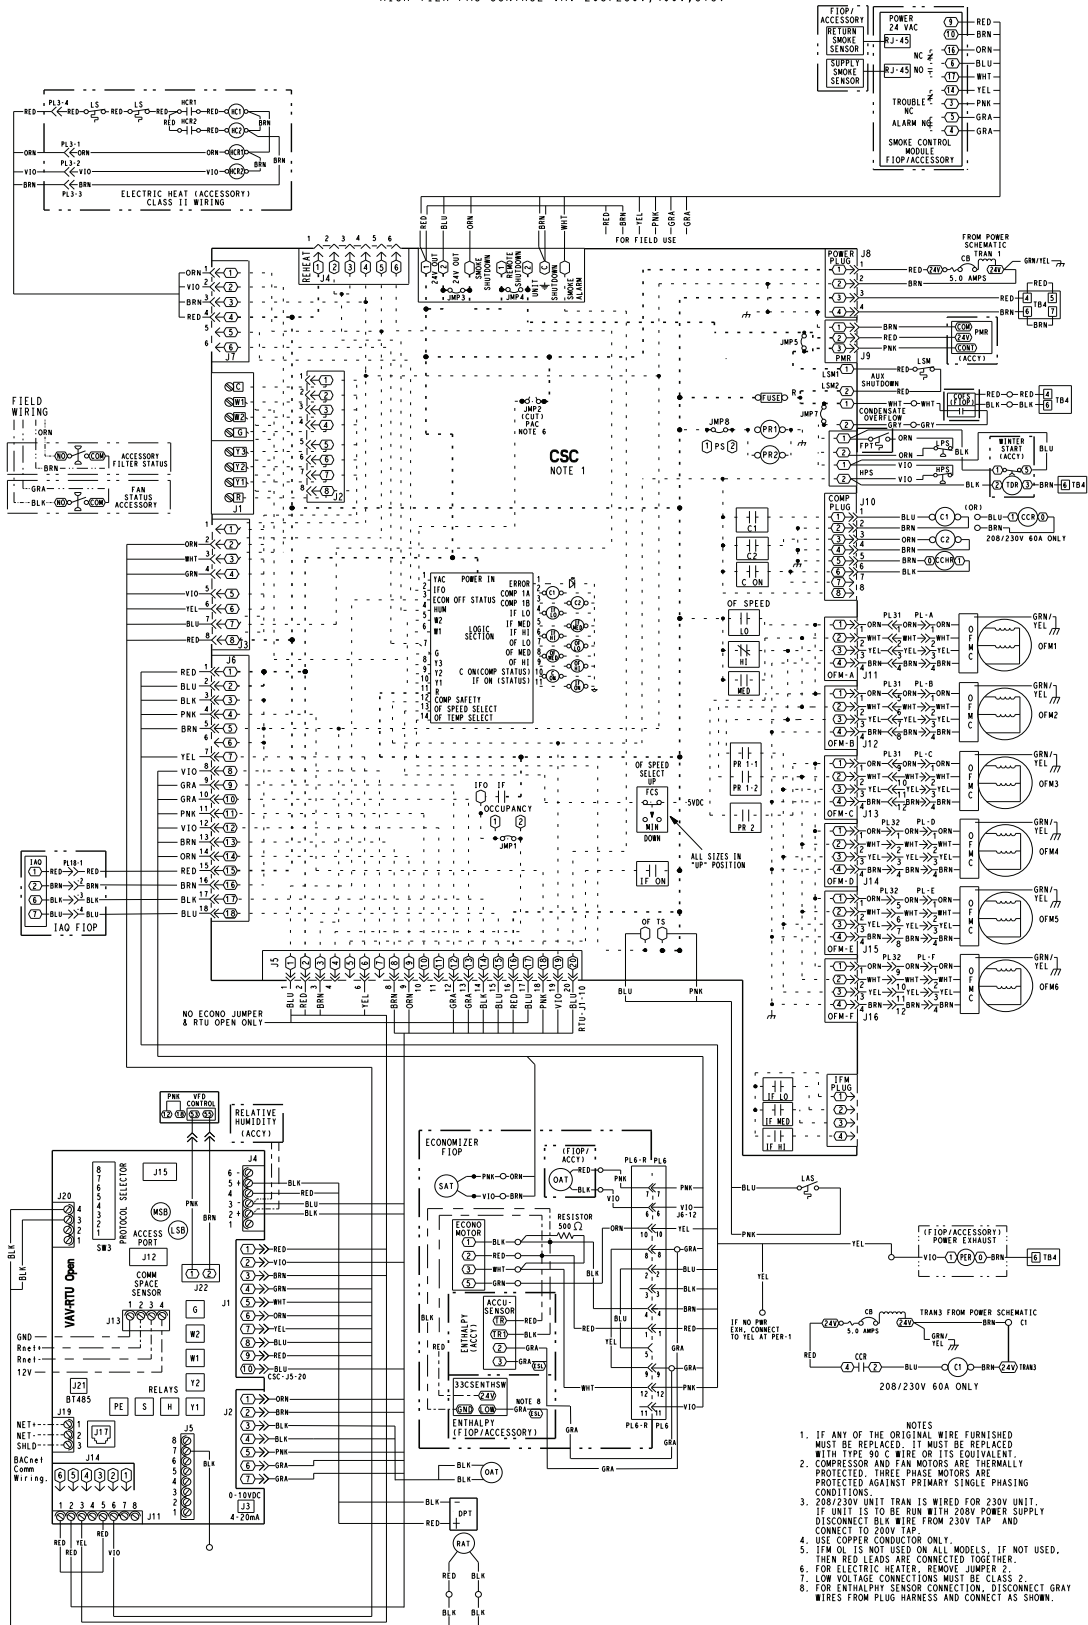

50LC000142 F

12.5 - 22.5 TON YAC, PAC POWER 460, 575V 3 PH
WITH/WITHOUT HOT GAS REHEAT FIOP

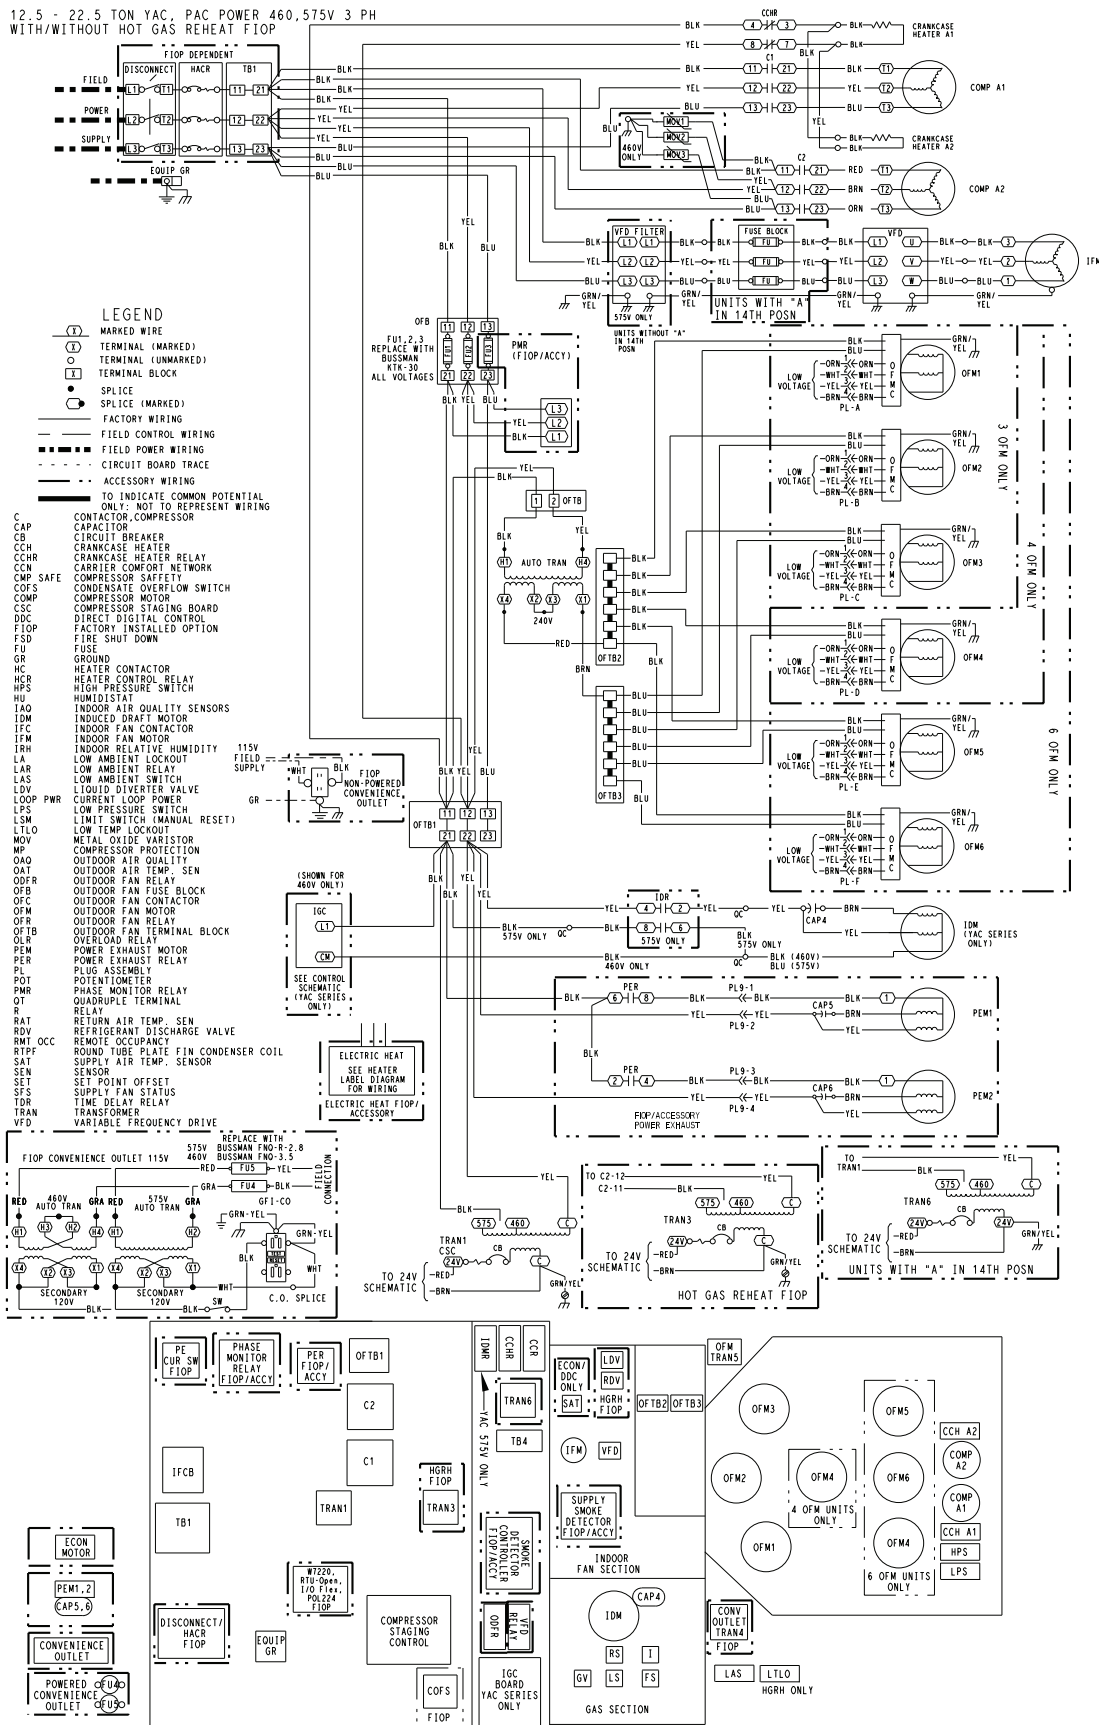

VAV-RTU Open

The VAV-RTU Open control is designed to provide VAV system operation when using a 50LC*B chassis small packaged rooftop and Carrier i-Vu® Open VAV terminal controls. Functionality includes:

- Duct Static Pressure Control (with optional Reset function)
- Supply Air Temperature Control (with optional Reset function)
- Morning Warm-up Cycle
- Occupied Heating (available)
- Heating and Cooling Setpoint Separation
- Economizer Cooling Cycle
- Mechanical Cooling Cycle
- Integrated Cooling Cycle
- Minimum Ventilation
- Unoccupied Free Cooling
- Supply Air Tempering
- Demand Controlled Ventilation [DCV]
- Open Airside Linkage
- Field Test/Commissioning

Duct Static Pressure Control (with optional Reset function)

The supply fan VFD will be controlled using a PID and an analog input from a duct static pressure transducer. The supply fan will modulate its speed to maintain the desired duct static pressure setpoint.

Supply Air Temperature Control (with optional Reset function)

The control will maintain the desired supply air temperature setpoint whenever cooling is required. A user configurable setpoint will be provided (default 53°F). The control will use the appropriate method (economizer cooling, mechanical cooling, or a combination of both) to achieve this setpoint whenever the zone temperature is greater than the current cooling setpoint (occupied or unoccupied). If Supply Air Reset is enabled, the reset algorithm will calculate a proportional reset value between the Occupied Cooling setpoint and 1°F above the Occupied Heating setpoint. The amount of reset (reset ratio and maximum reset limit value) is user configurable.

Morning Warm-up

The control will provide a Morning Warm-up cycle the first time if transition from unoccupied to occupied and if the heating is required and the unit goes into heating immediately. Whenever the unit enters the heating mode, before any heat stage is enabled, the control will provide a Linkage mode to the system that will cause the terminals to maintain sufficient airflow. The Linkage mode of Warm-up (2) will be sent to the terminal system to ensure sufficient airflow while in the heating mode but also providing a controlled warm-up cycle to prevent overheating of some zones. As a safety measure, should the heating cycle continue and the SAT approach the “Maximum Heating SAT” limit, the Linkage mode sent will change to Pressurization (6) to ensure all terminals open to their maximum airflow. The Linkage mode will remain as Pressurization until that heating cycle ends. Once the heating demand is met and the heat cycle is completed or if cooling is required, heating will be locked out until the beginning of the next occupied period.

Occupied Heating

Optionally, the user may enable occupied heating, which will allow heating whenever heating is needed during the

occupied period. The cycle will operate exactly the same as Morning Warm-up above, except it will not be limited by the transition into an occupied period.

Heating and Cooling Setpoint Separation

By default, the control will maintain a 5°F (configurable) separation between the heating and cooling setpoints. This will prevent the unit from prematurely entering the opposite mode.

Economizer Cooling Cycle

The VAV-RTU Open provides variable supply airflow to the VAV system and maintain constant minimum ventilation. As the supply airflow changes, the economizer minimum position is adjusted to provide a constant amount of outdoor air. The control will provide the ability to utilize outdoor air for maintaining the supply air setpoint should the outdoor air be suitable. The economizer control will utilize an OAT temperature check, a RAT temperature check if RAT is available or a SPT temperature check comparison and optionally, an OA enthalpy check to determine if OA conditions are suitable for economizing. Economizer operation, if available, will begin whenever cooling is required. The economizer will modulate the position of the OA damper to maintain the desired calculated economizer setpoint. The economizer will be controlled to meet CEC Title 24 requirements so that it will remain open 100% during integrated cooling and only partially close if required. The VAV-RTU Open also provides FDD (Fault Detection and Diagnostics) for economizer operation. The FDD logic will detect an economizer that fails to close, fails to open, is stuck fully open, and fails to fully open. Each condition will cause an Economizer Operation alarm to occur and the specific fault condition will be displayed.

Mechanical Cooling Cycle

The control will operate 3 stages of mechanical cooling in order to maintain the desired supply air temperature whenever economizer cooling operation is unavailable but cooling is required. This condition will be determined if the OA has high enthalpy or at a temperature above the Economizer Lockout temperature. The 2 compressors will be staged in a binary fashion so that 3 stages of cooling are provided. Mechanical cooling stages will be added as required to meet the desired SA setpoint. The number of stages will depend on the return air conditions and the system load (airflow through the coil). Stages will be added or dropped as required to maintain the setpoint while also maintaining the minimum on time and minimum off time for compressor operation. Anytime the SA falls below the desired SA setpoint, stages will be dropped until only stage 1 is operating. At that point, should the SA fall below 45°F (7°C), the economizer will modulate to increase the amount of outdoor air in order to maintain this minimum SA temperature. Should the economizer reach the maximum OA position and if the SA is still below the minimum SA temperature, the first cooling stage will be disabled and the economizer will return to the minimum position.

Integrated Cooling Cycle

If economizer cooling operation is insufficient to maintain the desired SA setpoint, mechanical cooling will be activated to supplement the free economizer cooling. This condition will be determined if the OA has low enthalpy but is at a temperature at least 5°F above the desired SA setpoint and below the Economizer Lockout temperature. Mechanical cooling stages will be added as required to meet the desired SA setpoint. The number of stages will

depend on the return air conditions and the system load (airflow through the coil). Stages will be added or dropped as required to maintain the setpoint while also maintaining the minimum on time and minimum off time for compressor operation. Anytime the SA falls below the desired SA setpoint, stages will be dropped until only stage 1 is operating. At that point, should the SA fall below the minimum SA temperature, the economizer will modulate to increase the amount of return air in order to maintain this minimum SA temperature. Should the economizer reach the minimum OA position and if the SA is still below the minimum SA temperature, the first cooling stage will be disabled.

Minimum Ventilation

The economizer minimum position will be adjusted as required based on the supply fan speed. Two user configurable minimum economizer positions will be provided. The economizer will be positioned at the “Low Fan Econ Min Pos” when the fan is operating at its slowest speed. When the fan is operating at its maximum speed, the economizer will be positioned at the “Vent Dmpr Pos / DCV Min Pos”. For any supply fan speed between these 2 points, the economizer minimum position will be calculated proportionally.

Unoccupied Free Cooling

Unoccupied Free Cooling allows the rooftop with the economizer damper to use outdoor air for free cooling during unoccupied periods.

When the VAV-RTU Open is unoccupied and the space temperature rises at least 2°F above the Occupied Cooling Setpoint, the supply fan starts. The economizer damper opens as necessary to maintain the Supply Air Setpoint and cool the space. The VAV-RTU Open continues to operate in this mode until the space temperature drops to 1°F below the Occupied Cooling Setpoint or the outside air conditions are no longer suitable for free cooling.

Demand Controlled Ventilation [DCV]

Whenever the unit is in an occupied mode and “DCV Control” is set to enable, a unique economizer minimum position will be calculated based on the output of the DCV algorithm. The algorithm monitors the CO₂ sensor value and compares that value to the user-defined setpoint. A control algorithm calculates the required minimum economizer position required to satisfy the ventilation requirements of the space. A user-adjustable DCV Max Vent Damper Position is provided to limit the maximum amount of outdoor air that can be brought into the unit due to the DCV algorithm. Demand Controlled Ventilation can be used in either a differential mode where both the indoor air and outdoor air CO₂ levels are provided to the control or it may be used in a single indoor air mode with only the indoor air CO₂ level. In the latter case, the outdoor air CO₂ level is assumed at 400 ppm.

Supply Air Tempering

The VAV-RTU Open provides the capability to operate the optional electric heat, if equipped, to maintain a minimum

supply air temperature during conditions where very cold outdoor air causes the supply air temperature to fall below the configured Supply Air (SA) Tempering Setpoint. This occurs during periods where DCV is active and increasing the amount of outdoor air or in cases where the system is operating at very low airflow and the calculated economizer position has increased to maintain a constant ventilation rate.

Heat operation is subject to anti-recycle timers to protect the equipment from short-cycling. There are fixed application specific minimum on and off times for each heating output (15 seconds on and 10 seconds off).

Open Airside Linkage

The control will support Airside Linkage to accommodate system operation using Carrier VAV terminal controls. The VAV-RTU Open will receive zone information (occupancy status, occupied and unoccupied zone temperatures, occupied and unoccupied heating and cooling setpoints, zone CO₂ level for DCV, and zone RH level). The VAV-RTU Open will operate in the mode required to satisfy the zones. Airside Linkage will provide operating mode information to the zones so that the system operation is fully coordinated between the rooftop and the terminal zones. The VAV air terminals offer a minimum airflow setting in AHU heating mode. This shall be configured to maintain the required airflow (cfm) whenever the VAV RTU is in a heating mode per the unit's specification. The VAV terminals will recognize the Heating or Warm-up modes as a heat mode and utilize the higher airflow minimum setpoint as configured. For heating cycles, initially utilize the Linkage Morning Warm-Up mode to open dampers on all zones below the midpoint of the occupied heating and cooling setpoints. This provides a controlled heat cycle and prevents the overheating of random zones where heating may not be required. Any zone below this middle setpoint will have its airflow at the maximum value. Further monitor the SAT of the VAV RTU to determine if the SAT is approaching the configured maximum limit. As the limit is approached, the Linkage mode is changed to Linkage Pressurization to ensure all terminals open to their maximum airflow.

Field Test/Commissioning

The control will provide BACnet test points to activate specific test modes that can be used to commission the rooftop and the system. Test modes will be available in the Service Test screen on the Property pages and shall also be available on the local Equipment Touch device for stand-alone commissioning. Tests include: Fan Test, Low Heat Test, High Heat Test, Cooling Test, Power Exhaust Test, and an Economizer Test. When any test is active, the appropriate Linkage mode will be sent to the system's terminals. This will ensure appropriate system operation and airflow during any test mode.

Min operating ambient temp (cooling)

In mechanical cooling mode, your Carrier rooftop can safely operate down to an outdoor ambient temperature of 45°F (7°C).

An economizer shall be the source of cooling in low ambient conditions. When the outside air temperature is below 45°F (7°C), to improve system reliability, reduce energy usage, and improve system efficiency: mechanical cooling shall not be utilized. Therefore, an economizer shall be used in these conditions to provide efficient low ambient cooling. Using an economizer for low ambient cooling merely requires fan energy to satisfy space requirements. The compressors shall not be required to run, which will provide exceptional energy savings due to less power draw, improved system reliability due to fewer compressor run hours, improved reliability through fewer starts/stops, and lower life cycle costs due to reduced compressor maintenance.

Max operating ambient temp (cooling)

The maximum operating ambient temperature for cooling mode is 125°F (52°C). While cooling operation above 125°F (52°C) may be possible, it could cause either a reduction in performance, reliability, or a protective action by the unit's internal safety devices.

Min and max airflow (heating and cooling)

To maintain safe and reliable operation of your rooftop, operate within the heating airflow limits during heating mode and cooling airflow limits during cooling mode. Operating above the maximum may cause blow-off, undesired airflow noise, or airflow related problems with the rooftop unit. Operating below the minimum may cause problems with coil freeze-up and unsafe heating operation. For proper minimum and maximum cfm values, see the tables on page 8.

Airflow

All units are draw-through in cooling mode.

Outdoor air application strategies

Economizers reduce operating expenses and compressor run time by providing a free source of cooling and a means of ventilation to match application changing needs. Consider the various economizer control methods and their benefits, as well as sensors required to accomplish your application goals. Please contact your local Carrier representative for assistance.

Motor limits, break horsepower (Bhp)

Due to Carrier's internal unit design, air path, and specially designed motors, the full horsepower (maximum continuous bhp) band, as listed in the Physical Data table on page 9, can be used with the utmost confidence. There is no need for extra safety factors, as Carrier's motors are designed and rigorously tested to use the entire, listed bhp range without either nuisance tripping or premature motor failure.

Sizing a rooftop

Bigger isn't necessarily better. While an air conditioner needs to have enough capacity to meet the load, it doesn't need excess capacity. In fact, having excess capacity typically results in very poor part load performance and humidity control.

Using higher design temperatures than ASHRAE recommends for your location, adding "safety factors" to the calculated load, and rounding up to the next largest unit are all signs of oversizing air conditioners. Oversizing can cause short-cycling, and short cycling leads to poor humidity control, reduced efficiency, higher utility bills, drastic indoor temperature swings, excessive noise, and increased wear and tear on the air conditioner.

Rather than oversizing an air conditioner, wise contractors and engineers "right-size" or even slightly undersize air conditioners. Correctly sizing an air conditioner controls humidity better; promotes efficiency; reduces utility bills; extends equipment life, and maintains even, comfortable temperatures.

SYSTEM OVERVIEW

	STANDALONE NO BAS	CARRIER I-VU® BAS	THIRD PARTY BAS
VAV-RTU Open Controller Accessible points	X	X	Limited (see Controls, Start-up, Operation and Troubleshooting manual)
Average Space Temperature	X	X	X
Supply Air Temperature	X	X	X
Return Air Temperature	Monitor only	Monitor only	Monitor only
Duct Static Pressure	X	X	X
Zone Setpoints	X	X	—
i-Vu VAV Zone space/CO ₂ /RH	X	X	—
System Touch	X	X	—
Equipment Touch	X	X	—

Note about this specification:

This specification is in the "Masterformat" as published by the Construction Specification Institute. Please feel free to copy this specification directly into your building spec.

WeatherExpert® Ultra High Efficient Cooling Only/Electric Heat Packaged Variable Air Volume (VAV) Rooftop HVAC Guide Specifications

Size Range: **12.5 to 23 Nominal Tons**

Carrier Model Number: **50LCB*14-26**

Part 1 — 23 06 80 Schedules for Packaged VAV HVAC Equipment

1.01 23 06 80.13 Unitary Packaged VAV HVAC Equipment Schedule

A. 23 06 80.13.A. Rooftop unit schedule

1. Schedule is per the project specification requirements.

Part 2 — 23 07 16 HVAC Equipment Insulation

2.01 23 07 16.13 Decentralized, Rooftop Units:

A. 23 07 16.13.A. Evaporator fan compartment:

1. Interior cabinet surfaces shall be insulated with a minimum 1/2 in. thick, minimum 1-1/2 lb density aluminum foil-faced insulation on the air side.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

B. 23 07 16.13.B. Electric heat compartment:

1. Aluminum foil-faced fiberglass insulation shall be used.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

Part 3 — 23 09 13 Instrumentation and Control Devices for HVAC

3.01 23 09 13.23 Sensors and Zone Air Terminals:

A. 23 09 13.23.A. Space terminal sensors:

1. Carrier zone air terminal space sensors shall be available with capabilities of combining:
 - a. Space temperature sensing
 - b. Sensors with communication port
 - c. Sensors with CO₂ sensing
 - d. Sensors with LCD display
 - e. Sensors with RH sensing
 - f. Sensors with local override and indicating light

2. i-Vu® Equipment Touch™; Carrier brand 4.3 in. color touch screen zone sensor and local user interface for a single Open (BACnet¹ MS/TP) equipment controller. Includes built-in temperature sensor.

3. i-Vu System Touch™; Carrier brand 4.3 in. color touch screen user interface connects to a network of up to 60 Open (BACnet MS/TP) equipment controllers. Includes built-in temperature sensor.

B. 23 09 13.23.B. Zone terminals:

1. Zone air terminals shall be a i-Vu VAV Zone Single Duct and Fan Terminal type for optimum integrated system solution. This includes:
 - a. 35E – Single Duct Air Terminals
 - b. 45J – Series Fan Powered Air Terminals
 - c. 45K – Quiet Series Fan Powered Air Terminals
 - d. 45M – Parallel Fan Powered Air Terminals
 - e. 45N – Quiet Parallel Fan Powered Air Terminals
 - f. 45Q – Low Profile Series Fan Powered Air Terminals
 - g. 45R – Low Profile Parallel Fan Powered Air Terminals
 - h. 35J – Single Duct Retrofit Air Terminals

Part 4 — 23 09 33 Integrated Staging Control (ISC) Board System for HVAC

4.01 23 09 33.13 Packaged VAV, Rooftop Units:

A. 23 09 33.13.A. General:

1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side. Transformer shall have 75VA capability.
2. Shall utilize color-coded wiring.
3. Shall include an electro-mechanical control board, to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, and safety switches. Shall control all 3 stages of compressor logic, fully variable the indoor fan motor logic as well as staging of the outdoor fan motor. Shall also have a green LED indicator to indicate GO operation as well as a fault LED indicator for thermostat mis-wiring, no fan operation and safety switches.
4. Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.

B. 23 09 33.13.B. Safeties:

1. Compressor over-temperature, over current.
2. Low-pressure protection switch.
 - a. Low pressure switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.

1. BACnet is a trademark of ASHRAE.

3. High-pressure protection switch.
 - a. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
4. Automatic reset, motor thermal overload protector.

Part 5 — 23 09 93 Sequence of Operations for HVAC Controls

5.01 23 09 93.13 Packaged VAV, Rooftop Units:

- A. 23 09 93.13.A Duct Static Pressure Control (with optional Reset function) — The supply fan VFD will be controlled using a PID and an analog input from a duct static pressure transducer. The supply fan will modulate its speed to maintain the desired duct static pressure setpoint.
- B. 23 09 93.13.B Supply Air Temperature Control (with optional Reset function) — The control will maintain the desired supply air temperature setpoint whenever cooling is required. A user configurable setpoint will be provided (default 53°F). The control will use the appropriate method (economizer cooling, mechanical cooling, or a combination of both) to achieve this setpoint whenever the zone temperature is greater than the current cooling setpoint (occupied or unoccupied). If Supply Air Reset is enabled, the reset algorithm will calculate a proportional reset value between the Occupied Cooling setpoint and 1°F above the Occupied Heating setpoint. The amount of reset (reset ratio and maximum reset limit value) is user configurable.
- C. 23 09 93.13.C Morning Warm-up — The control will provide a Morning Warm-up cycle the first time if transition from unoccupied to occupied and if the heating is required and the unit goes into heating immediately. Whenever the unit enters the heating mode, before any heat stage is enabled, the control will provide a Linkage mode to the system that will cause the terminals to maintain sufficient airflow. The Linkage mode of Warm-up (2) will be sent to the terminal system to ensure sufficient airflow while in the heating mode but also providing a controlled warm-up cycle to prevent overheating of some zones. As a safety measure, should the heating cycle continue and the SAT approach the “Maximum Heating SAT” limit, the Linkage mode sent will change to Pressurization (6) to ensure all terminals open to their maximum airflow. The Linkage mode will remain Pressurization until that heating cycle ends. Once the heating demand is met and the heat cycle is completed or if cooling is required, heating will be locked out until the beginning of the next occupied period.
- D. 23 09 93.13.D Occupied Heating — Optionally, the user may enable occupied heating which will allow heating whenever heating is needed during the occupied period. The cycle will operate exactly the

same as Morning Warm-up above, except it will not be limited by the transition into an occupied period.

- E. 23 09 93.13.E Heating and Cooling Setpoint Separation — By default, the control will maintain a 5°F (configurable) separation between the heating and cooling setpoints. This will prevent the unit from prematurely entering the opposite mode.
- F. 23 09 93.13.F Economizer Cooling Cycle — The VAV-RTU Open provides variable supply airflow to the VAV system and maintain constant minimum ventilation. As the supply airflow changes, the economizer minimum position is adjusted to provide a constant amount of outdoor air. The control will provide the ability to utilize outdoor air for maintaining the supply air setpoint should the outdoor air be suitable. The economizer control will utilize an OAT temperature check, a RAT temperature check if RAT is available or a SPT temperature check comparison and optionally, an OA enthalpy check to determine if OA conditions are suitable for economizing. Economizer operation, if available, will begin whenever cooling is required. The economizer will modulate the position of the OA damper to maintain the desired calculated economizer setpoint. The economizer will be controlled to meet CEC Title 24 requirements so that it will remain open 100% during integrated cooling and only partially close if required. The VAV-RTU Open also provides FDD (Fault Detection and Diagnostics) for economizer operation. The FDD logic will detect an economizer that fails to close, fails to open, is stuck fully open, and fails to fully open. Each condition will cause an Economizer Operation alarm to occur and the specific fault condition will be displayed.
- G. 23 09 93.13.G Mechanical Cooling Cycle — The control will operate 3 stages of mechanical cooling in order to maintain the desired supply air temperature whenever economizer cooling operation is unavailable but cooling is required. This condition will be determined if the OA has high enthalpy or at a temperature above the Economizer Lockout temperature. The 2 compressors will be staged in a binary fashion so that 3 stages of cooling are provided. Mechanical cooling stages will be added as required to meet the desired SA setpoint. The number of stages will depend on the return air conditions and the system load (airflow through the coil). Stages will be added or dropped as required to maintain the setpoint while also maintaining the minimum on time and minimum off time for compressor operation. Anytime the SA falls below the desired SA setpoint, stages will be dropped until only stage 1 is operating. At that point, should the SA fall below 45°F, the economizer will modulate to increase the amount of outdoor air in order to maintain this minimum SA temperature. Should the economizer reach the maximum OA position and if the SA is still below the minimum SA temperature, the first cooling stage will be disabled and the economizer will return to the minimum position.

- H. 23 09 93.13.H Integrated Cooling Cycle — If economizer cooling operation is insufficient to maintain the desired SA setpoint, mechanical cooling will be activated to supplement the free economizer cooling. This condition will be determined if the OA has low enthalpy but is at a temperature at least 5°F above the desired SA setpoint and below the Economizer Lockout temperature. Mechanical cooling stages will be added as required to meet the desired SA setpoint. The number of stages will depend on the return air conditions and the system load (airflow through the coil). Stages will be added or dropped as required to maintain the setpoint while also maintaining the minimum on time and minimum off time for compressor operation. Anytime the SA falls below the desired SA setpoint, stages will be dropped until only stage 1 is operating. At that point, should the SA fall below the minimum SA temperature, the economizer will modulate to increase the amount of return air in order to maintain this minimum SA temperature. Should the economizer reach the minimum OA position and if the SA is still below the minimum SA temperature, the first cooling stage will be disabled.
- I. 23 09 93.13.I Minimum Ventilation — The economizer minimum position will be adjusted as required based on the supply fan speed. Two user configurable minimum economizer positions will be provided. The economizer will be positioned at the “Low Fan Econ Min Pos” when the fan is operating at its slowest speed. When the fan is operating at its maximum speed, the economizer will be positioned at the “Vent Dmpr Pos / DCV Min Pos”. For any supply fan speed between these 2 points, the economizer minimum position will be calculated proportionally.
- J. 23 09 93.13.J Unoccupied Free Cooling — Unoccupied Free Cooling allows the rooftop with the economizer damper to use outdoor air for free cooling during unoccupied periods. When the VAV-RTU Open is unoccupied and the space temperature rises at least 2°F above the Occupied Cooling Setpoint, the supply fan starts. The economizer damper opens as necessary to maintain the Supply Air Setpoint and cool the space. The VAV-RTU Open continues to operate in this mode until the space temperature drops to 1°F below the Occupied Cooling Setpoint or the outside air conditions are no longer suitable for free cooling.
- K. 23 09 93.13.K Demand Controlled Ventilation [DCV] — Whenever the unit is in an occupied mode and “DCV Control” is set to enable, a unique economizer minimum position will be calculated based on the output of the DCV algorithm. The algorithm monitors the CO₂ sensor value and compares that value to the user defined setpoint. A control algorithm calculates the required minimum economizer position required to satisfy the ventilation requirements of the space. A user adjustable DCV Max Vent Damper Position is provided to limit the maximum amount of outdoor air that can be brought into the unit due to the DCV algorithm. Demand Controlled Ventilation can be used in either a differential mode where both the indoor air and outdoor air CO₂ levels are provided to the control or it may be used in a single indoor air mode with only the indoor air CO₂ level. In the latter case, the outdoor air CO₂ level is assumed at 400 ppm.
- L. 23 09 93.13.L Supply Air Tempering — The VAV-RTU Open provides the capability to operate the optional electric heat, if equipped, to maintain a minimum supply air temperature during conditions where very cold outdoor air causes the supply air temperature to fall below the configured Supply Air (SA) Tempering Setpoint. This occurs during periods where DCV is active and increasing the amount of outdoor air or in cases where the system is operating at very low airflow and the calculated economizer position has increased to maintain a constant ventilation rate. Heat operation is subject to anti-recycle timers to protect the equipment from short-cycling. There are fixed application specific minimum on and off times for each heating output (15 seconds on and 10 seconds off).
- M. 23 09 93.13.M Open Airside Linkage — The control will support Airside Linkage to accommodate system operation using Carrier VAV terminal controls. The VAV-RTU Open will receive zone information (occupancy status, occupied and unoccupied zone temperatures, occupied and unoccupied heating and cooling setpoints, zone CO₂ level for DCV, and zone RH level). The VAV-RTU Open will operate in the mode required to satisfy the zones. Airside Linkage will provide operating mode information to the zones so that the system operation is fully coordinated between the rooftop and the terminal zones. The VAV air terminals offer a minimum airflow setting in AHU heating mode. This shall be configured to maintain the required airflow (cfm) whenever the VAV RTU is in a heating mode per the unit’s specification. The VAV terminals will recognize the Heating or Warm-up modes as a heat mode and utilize the higher airflow minimum setpoint as configured. For heating cycles, initially utilize the Linkage Morning Warm-Up mode to open dampers on all zones below the midpoint of the occupied heating and cooling setpoints. This provides a controlled heat cycle and prevents the overheating of random zones where heating may not be required. Any zone below this middle setpoint will have its airflow at the maximum value. Further monitor the SAT of the VAV RTU to determine if the SAT is approaching the configured maximum limit. As the limit is approached, the Linkage mode is changed to Linkage Pressurization to ensure all terminals open to their maximum airflow.
- N. 23 09 93.13.N Field Test/Commissioning — The control will provide BACnet test points to activate specific test modes that can be used to commission the rooftop and the system. Test modes will be available in the Service Test screen on the Property pages and shall also be available on the local Equipment Touch device for standalone

commissioning. Tests include: fan test, low heat test, high heat test, cooling test, power exhaust test, and an economizer test. When any test is active, the appropriate Linkage mode will be sent to the system's terminals. This will ensure appropriate system operation and airflow during any test mode.

Part 6 — 23 40 13 Panel Air Filters

6.01 23 40 13.13 Packaged VAV, Rooftop Units:

A. 23 40 13.13.A. Standard filter section:

1. Shall consist of factory-installed, low velocity, throwaway 2 in. thick fiberglass filters of commercially available sizes.
2. Unit shall use only one filter size. Multiple sizes are not acceptable.
3. Filters shall be accessible through an access panel with "no-tool" removal as described in the unit cabinet section of this specification (23 81 19.13.G).
4. 4 in. filter capabilities shall be capable with pre-engineered and approved Carrier filter track field installed accessory. This kit requires field furnished filters.

Part 7 — 23 81 19 Self-Contained Air Conditioners

7.01 23 81 19.13 Small-Capacity Self-Contained Air Conditioners (50LC*B14-26)

A. 23 81 19.13.A. General:

1. Outdoor, rooftop mounted, DDC electrically controlled, heating and cooling VAV unit utilizing fully hermetic scroll compressors for cooling duty and electrical elements for heating duty. VAV-RTU Open - BACnet, direct digital controller:
 - a. Shall be ASHRAE 62-2001 compliant.
 - b. Shall accept 18-30VAC, 50-60Hz, and consumer 15VA or less power.
 - c. Shall have an operating temperature range from -40°F (-40°C) to 130°F (54°C), 10-90% RH (non-condensing).
 - d. Shall include built-in protocol for BACnet MS/TP.
 - e. Shall allow access of up to 62 network variables (SNVT). Shall be compatible with all open controllers.
 - f. Baud rate controller shall be selectable using a dipswitch.
 - g. Shall have an LED display independently showing the status of serial communication, running, errors, power, all digital outputs, and all analog inputs.
 - h. Shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air quality, compressor lock-out, fire shut-down, enthalpy switch, and fan status/filter status/ humidity/ remote occupancy.

- i. Shall provide the following outputs: Economizer, Fan Speed, Fan Start/Stop, Cooling Stage 1, Cooling Stage 2, Cooling Stage 3, Heating Stage 1, Heating Stage 2, Power Exhaust.
 - j. Shall have built-in surge protection circuitry through solid state polyswitches. Polyswitches shall be used on incoming power and network connections. Polyswitches will return to normal when the "trip" condition clears.
 - k. Shall have a battery back-up capable of a minimum of 10,000 hours of data and time clock retention during power outages.
 - l. Shall have built-in support for Carrier technician tool.
 - m. Shall include an EIA-485 protocol communication port (BACnet MS/TP only), an access port for connection of either a computer or a Carrier technician tool, an EIA-485 port for network communication to intelligent space sensors and displays.
 - n. Software upgrades will be accomplished by either local or remote download. No software upgrades through chip replacements are allowed.
2. Factory assembled, single-piece heating and VAV cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
 - a. Return air temperature sensor to control multi stage of cooling capacity.
 - b. Supply air temperature sensor to control multi stage of cooling capacity.
 - c. Duct static pressure transducer, located in control box for remote field mounting.
 - d. Evaporator coil freeze protection.
 3. Unit shall use Puron® (R-401A) refrigerant.
 4. Unit shall be installed in accordance with the manufacturer's instructions.
 5. Unit must be selected and installed in compliance with local, state, and federal codes.
 6. To properly control to the desired supply air temperature comfort setting, an integrated EconoMi\$er2 is provided standard. Two versions shall be available: standard air leak and ultra-low leak versions.
 - a. Integrated Standard Leak:
 - 1) Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
 - 2) Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory-installed option.

- 3) Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
 - 4) Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
 - 5) Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
 - 6) Standard leak rate models shall be equipped with leakage dampers, not to exceed 2% leakage at 1 in. wg pressure differential.
 - 7) Economizer controller shall be a 4 to 20mA design controlled directly by the VAV - RTU Open controller. VAV - RTU Open meets California Title 24 Fault Detection and Diagnostic (FDD) requirements.
 - 8) Shall be capable of introducing up to 100% outdoor air.
 - 9) Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
 - 10) Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
 - 11) Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory installed only. Outdoor air sensor setpoint shall be adjustable and shall range from 40°F to 100°F (4°C to 38°C). Additional sensor options shall be available as accessories.
 - 12) VAV-RTU Open controller shall also provide control of an accessory power exhaust unit function.
 - 13) The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
 - 14) Dampers shall be completely closed when the unit is in the unoccupied mode.
 - 15) Economizer controller shall accept a 2 to 10 vdc CO₂ sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
 - 16) Compressor lockout temperature is adjustable from 45°F to 80°F, set at a factory default of 45°F. Others shall open at 35°F (2°C) and closes at 50°F (10°C).
 - 17) Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
 - 18) Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
- b. Integrated Ultra Low Leak Models:
- 1) Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
 - 2) Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory installed option.
 - 3) Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
 - 4) Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
 - 5) Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
 - 6) Ultra Low Leak design meets California Title 24 section 140.4 and ASHRAE 90.1 requirements of 4cfm per sq. ft. on the outside dampers and 10cfm per sq. ft. on the return dampers.
 - 7) Economizer controller shall be a 4 to 20mA design controlled directly by the VAV - RTU Open controller. VAV - RTU Open meets California Title 24 Fault Detection and Diagnostic (FDD) requirements.
 - 8) Shall be capable of introducing up to 100% outdoor air.
 - 9) Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
 - 10) Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
 - 11) Dry bulb outdoor air temperature sensor is also available on factory installed only. Outdoor air sensor setpoint shall be adjustable and shall range from 40°F to 100°F (4°C to 38°C). Additional sensor options shall be available as accessories.
 - 12) The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
 - 13) The economizer shall maintain minimum airflow into the building during occupied period and provide design

ventilation rate over the entire system airflow range.

- 14) Dampers shall be completely closed when the unit is in the unoccupied mode.
- 15) Economizer controller shall accept a 2 to 10 vdc CO₂ sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
- 16) Compressor lockout temperature is adjustable from 45°F to 80°F, set at a factory default of 45°F.
- 17) Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
- 18) Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.

B. 23 81 19.13.B. Quality Assurance:

1. Unit meets and exceeds ASHRAE 90.1 minimum efficiency requirements.
2. Unit meets and exceeds Consortium for Energy Efficiency (CEE) performance criteria.
3. Unit shall be rated in accordance with AHRI Standards 340/360.
4. Unit shall be designed to conform to ASHRAE 15.
5. Unit shall be ETL/UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
6. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
7. Unit casing shall be capable of withstanding 500 hour salt spray exposure per ASTM B117 (scribed specimen).
8. Unit shall be designed in accordance with ISO 9001, and shall be manufactured in a facility registered by ISO 9001.
9. Roof curb shall be designed to conform to NRCA Standards.
10. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
11. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
12. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.
13. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.

14. High Efficient Motors listed shall meet section 313 of the Energy Independence and Security Act of 2007 (EISA 2007).

C. 23 81 19.13.C. Delivery, Storage, and Handling:

1. Unit shall be stored and handled per manufacturer's recommendations.
2. Lifted by crane requires either shipping top panel or spreader bars.
3. Unit shall only be stored or positioned in the upright position.

D. 23 81 19.13.D. Project Conditions:

1. As specified in the contract.

E. 23 81 19.13.E. Operating Characteristics:

1. Unit shall be capable of starting and running at 125°F (52°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 340/360 at ± 10% voltage.
2. Compressor with standard controls shall be capable of operation down to 45°F (7°C) ambient outdoor temperatures. For lower operation, an integrated economizer shall be utilized to allow lower temperatures and accommodate indoor air quality initiatives.
3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
4. Unit shall be factory configured and ordered for vertical supply and return configurations.
5. Unit shall be factory furnished for either vertical or horizontal configuration without the use of special conversion kits. No field kits conversion is possible.
6. Unit shall be capable of mixed operation: vertical supply with horizontal return or horizontal supply with vertical return.

F. 23 81 19.13.F. Electrical Requirements:

1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

G. 23 81 19.13.G. Unit Cabinet:

1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a pre-painted baked enamel finish on all externally exposed surfaces.
2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 in. minimum, gloss (per ASTM D523, 60°F): 60, Hardness: H-2H Pencil hardness.
3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2 in. thick, 1 lb density, aluminum foil faced fiberglass insulation, Aluminum foil-faced fiberglass insulation shall also be used in the heat compartment.
4. Base of unit shall have a minimum of 4 locations for thru-the-base gas and electrical

connections (factory installed or field installed), standard.

5. Base Rail:

- a. Unit shall have base rails on a minimum of 4 sides.
- b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
- c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
- d. Base rail shall be a minimum of 16 gauge thickness.

6. Condensate pan and connections:

- a. Shall be an internally sloped condensate drain pan made of a non-corrosive material.
- b. Shall comply with ASHRAE Standard 62.
- c. Shall use a 3/4 in. 14 NPT drain connection, possible either through the bottom or end of the drain pan. Connection shall be made per manufacturer's recommendations.

7. Top panel:

- a. Shall be a multi-piece top panel linked with water tight flanges and interlocking systems.

8. Electrical Connections:

- a. All unit power wiring shall enter unit cabinet at a single, factory-prepared, knockout location.
- b. Thru-the-base capability
 - 1) Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
 - 2) No basepan penetration, other than those authorized by the manufacturer, is permitted.

9. Component access panels (standard):

- a. Cabinet panels shall be easily removable for servicing.
- b. Unit shall have one factory installed, tool-less, removable, filter access panel.
- c. Panels covering control box, indoor fan, indoor fan motor and compressors shall have molded composite handles.
- d. Handles shall be UV modified, composite, permanently attached, and recessed into the panel.
- e. Screws on the vertical portion of all removable access panel shall engage into heat resistant, molded composite collars.
- f. Collars shall be removable and easily replaceable using manufacturer recommended parts.

H. 23 81 19.13.H. Coils:

1. Standard Aluminum Fin/Copper Tube Coils:

- a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally

grooved 5/16 in. diameter copper tubes with all joints brazed.

- b. Evaporator coils shall be leak tested to 150 psig, pressure tested to 450 psig, and qualified to UL 1995 burst test at 1775 psig.
- c. Condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to UL 1995 burst test at 1980 psig.

2. Optional Pre-coated aluminum-fin condenser coils:

- a. Shall have a durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments.
- b. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.
- c. Epoxy-phenolic barrier shall minimize galvanic action between dissimilar metals.
- d. Corrosion durability of fin stock shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117-90.
- e. Corrosion durability of fin stock shall be confirmed through testing to have no visible corrosion after 48 hour immersion in a room temperature solution of 5% salt, 1% acetic acid.
- f. Fin stock coating shall pass 2000 hours of the following: one week exposure in the prohesion chamber followed by one week in a QUV. Prohesion chamber: the solution shall contain 3.5% sodium chloride and 0.35% ammonium sulfate. The exposure cycle is one hour of salt fog application at ambient followed by one hour drying at 95°F (35°C).
- g. Corrosion durability shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117-90.

3. Optional Copper-fin evaporator and condenser coils:

- a. Shall be constructed of copper fins mechanically bonded to copper tubes and copper tube sheets.
- b. Galvanized steel tube sheets shall not be acceptable.
- c. A polymer strip shall prevent coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan.

4. Optional E-coated aluminum-fin evaporator and condenser coils:

- a. Shall have a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins.
- b. Coating process shall ensure complete coil encapsulation of tubes, fins and headers.

- c. Color shall be high gloss black with gloss per ASTM D523-89.
 - d. Uniform dry film thickness from 0.8 to 1.2 mil on all surface areas including fin edges.
 - e. Superior hardness characteristics of 2H per ASTM D3363-92A and cross-hatch adhesion of 4B-5B per ASTM D3359-93.
 - f. Impact resistance shall be up to 160 in.-lb (ASTM D2794-93).
 - g. Humidity and water immersion resistance shall be up to minimum 1000 and 250 hours respectively (ASTM D2247-92 and ASTM D870-92).
 - h. Corrosion durability shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117-90.
- I. 23 81 19.13.I. Refrigerant Components:
- 1. Refrigerant circuit shall include the following control, safety, and maintenance features:
 - a. Multi Thermostatic Expansion Valve (TXV) system shall help provide optimum performance across the entire operating range. Shall contain removable power element to allow change out of power element and bulb without removing the valve body.
 - b. Refrigerant filter drier.
 - c. Service gauge connections on suction and discharge lines.
 - d. Pressure gauge access through a specially designed screen on the side of the unit.
 - e. Single circuit design with tandem compressor and fully activated evaporator coil.
 - 2. Compressors:
 - a. Models shall use fully hermetic tandem scroll compressors optimized for comfort staging and IEER energy savings.
 - b. Models shall be available with a single refrigerant circuit and 3 stages of cooling operation on all models.
 - c. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
 - d. Compressors shall be internally protected from high discharge temperature conditions.
 - e. Compressors shall be protected from an over-temperature and over-amperage conditions by an internal, motor overload device.
 - f. Compressor shall be factory mounted on rubber grommets.
 - g. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
 - h. Crankcase heater shall be standard on each compressor and deactivated whenever a compressor is in operation.
- J. 23 81 19.13.J. Filter Section:
- 1. Filters access is specified in the unit cabinet section of this specification.
 - 2. Filters shall be held in place by a pivoting filter tray, facilitating easy removal and installation.
 - 3. Shall consist of factory-installed, low velocity, throw-away 2 in. thick fiberglass filters.
 - 4. Filters shall be standard, commercially available sizes.
 - 5. Only one size filter per unit is allowed.
 - 6. 4 in. filter capability is possible with a field installed pre-engineered slide out filter track accessory. 4 in. filters are field furnished.
- K. 23 81 19.13.K. Evaporator Fan and Motor:
- 1. Evaporator fan motor:
 - a. Shall have permanently lubricated bearings.
 - b. Shall have inherent automatic-reset thermal overload protection or circuit breaker.
 - c. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.
 - d. Shall be Variable Frequency duty to match the 3 stage compression logic.
 - e. Shall contain motor shaft grounding ring to prevent electrical bearing fluting damage by safely diverting harmful shaft voltages and bearing currents to ground.
 - 2. Variable Frequency Drive (VFD). For indoor fan motor controlled by duct static pressure transducer:
 - a. Shall be installed inside the unit cabinet, mounted, wired and tested.
 - b. Shall contain Electromagnetic Interference (EMI) frequency protection.
 - c. Insulated Gate Bi-Polar Transistors (IGBT) used to produce the output pulse width modulated (PWM) waveform, allowing for quiet motor operation.
 - d. Self diagnostics with fault and power code LED indicator. Field accessory Display Kit available for further diagnostics and special setup applications.
 - e. RS485 capability standard.
 - f. Electronic thermal overload protection.
 - g. 5% swinging chokes for harmonic reduction and improved power factor.
 - h. All printed circuit boards shall be conformal coated.
 - i. Shall not contain visual display to adjust internal setting. Only available as field installed kit.

3. Belt-driven Evaporator Fan:
 - a. Belt drive shall include an adjustable-pitch motor pulley.
 - b. Shall use sealed, permanently lubricated ball-bearing type.
 - c. Blower fan shall be double-inlet type with forward-curved blades.
 - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.
- L. 23 81 19.13.L. Condenser Fans and Motors:
 1. Condenser fan motors:
 - a. Shall be a totally enclosed - multi speed ECM motor.
 - b. Shall use permanently lubricated bearings.
 - c. Shall have inherent thermal overload protection with an automatic reset feature.
 - d. Shall use a shaft-down design.
 2. Condenser Fans:
 - a. Shall be a direct-driven propeller type fan.
 - b. Shall have galvanized aluminum (galvalume) blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.
- M. 23 81 19.13.M. Special Features, Options and Accessories:
 1. Condenser Coil Hail Guard Assembly (Factory or field installed):
 - a. Shall protect against damage from hail.
 - b. Shall be louvered design.
 2. Unit-Mounted, Non-Fused Disconnect Switch:
 - a. Switch shall be factory-installed, internally mounted.
 - b. National Electric Code (NEC) and ETL/UL approved non-fused switch shall provide unit power shutoff.
 - c. Shall be accessible from outside the unit.
 - d. Shall provide local shutdown and lockout capability.
 - e. Sized only for the unit as ordered from the factory. Does not accommodate field installed devices.
 3. HACR Breaker:
 - a. These manual reset devices provide overload and short circuit protection for the unit. Factory wired and mounted with the units, with access cover to help provide environmental protection. On 575v applications, HACR breaker can only be used with WYE power distribution systems. Use on Delta power distribution systems is prohibited.
 - b. Sized only for the unit as ordered from the factory. Does not accommodate field installed devices.
4. Convenience Outlet:
 - a. Powered convenience outlet:
 - 1) Outlet shall be powered from main line power to the rooftop unit.
 - 2) Outlet shall be powered from line side or load side of disconnect by installing contractor, as required by code. If outlet is powered from load side of disconnect, unit electrical ratings shall be ETL/UL certified and rated for additional outlet amperage.
 - 3) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
 - 4) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
 - 5) Voltage required to operate convenience outlet shall be provided by a factory-installed step-down transformer.
 - 6) Outlet shall be accessible from outside the unit.
 - 7) Outlet shall include a field-installed "Wet in Use" cover.
 - b. Non-powered convenience outlet.
 - 1) Outlet shall be powered from a separate 115/120v power source.
 - 2) A transformer shall not be included.
 - 3) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
 - 4) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
 - 5) Outlet shall be accessible from outside the unit.
 - 6) Outlet shall include a field-installed "Wet in Use" cover.
5. Fan/Filter Status Switch:
 - a. Switch shall provide status of indoor evaporator fan (ON/OFF) or filter (CLEAN/DIRTY).
 - b. Status shall be displayed either over communication bus (when used with direct digital controls) or with an indicator light at the thermostat.
6. Centrifugal Power Exhaust:
 - a. Power exhaust shall be used in conjunction with an integrated economizer.
 - b. Independent modules for vertical or horizontal return configurations shall be available.
 - c. Horizontal power exhaust is shall be mounted in return ductwork.
 - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past

the 0-100% adjustable setpoint on the economizer control.

7. Roof Curbs (Vertical):
 - a. Full perimeter roof curb with exhaust capability providing separate air streams for energy recovery from the exhaust air without supply air contamination.
 - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
 - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
8. High-Static Indoor Fan Motor(s) and Drive(s):
 - a. High-static motor(s) and drive(s) shall be factory-installed to provide additional performance range.
9. Outdoor Air Enthalpy Sensor:
 - a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
10. Return Air Enthalpy Sensor:
 - a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
11. Indoor Air Quality (CO₂) Sensor:
 - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
 - b. The IAQ sensor shall be available in duct mount, wall mount, or wall mount with LED display. The setpoint shall have adjustment capability.
12. Smoke detectors (factory-installed only):
 - a. Shall be a 4-Wire Controller and Detector.
 - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
 - c. Shall use magnet-activated test/reset sensor switches.
 - d. Shall have tool-less connection terminal access.
 - e. Shall have a recessed momentary switch for testing and resetting the detector.
 - f. Controller shall include:
 - 1) One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
 - 2) Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
 - 3) One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
 - 4) Capable of direct connection to 2 individual detector modules.
 - 5) Can be wired to up to 14 other duct smoke detectors for multiple fan shutdown applications.
13. Electric Heat:
 - a. Heating Section
 - 1) Heater element open coil resistance wire, nickel-chrome alloy, 0.29 in. inside diameter, strung through ceramic insulators mounted on metal frame. Coil ends are staked and welded to terminal screw slots.
 - 2) Heater assemblies are provided with integral fusing for protection of internal heater circuits not exceeding 48 amps each. Auto reset thermo limit controls, magnetic heater contactors (24 v coil) and terminal block all mounted in electric heater control box (minimum 18 ga galvanized steel) attached to end of heater assembly.
14. Barometric Hood (Horizontal Economizer Applications):
 - a. Shall be required when a horizontal economizer and barometric relief are required. Barometric relief damper must be installed in the return air (horizontal) duct work. This hood provides weather protection.
15. Hinged access panels:
 - a. Shall provide easy access through integrated quarter turn latches.
 - b. Shall be on major panels of; filter, control box, fan motor and compressor.
16. Display Kit for Variable Frequency Drive:
 - a. Kit allows the ability to access the VFD controller programs to provide special setup capabilities and diagnostics.
 - b. Kit contains display module, mounting bracket and communication cable.
 - c. Display Kit can be permanently installed in the unit or used on any VFD controller as needed.
17. High Short Circuit Current Rating (SCCR):
 - a. An optional SCCR of 65kA shall be provided for 460 volt and 60kA for 208/230 volt units.

