
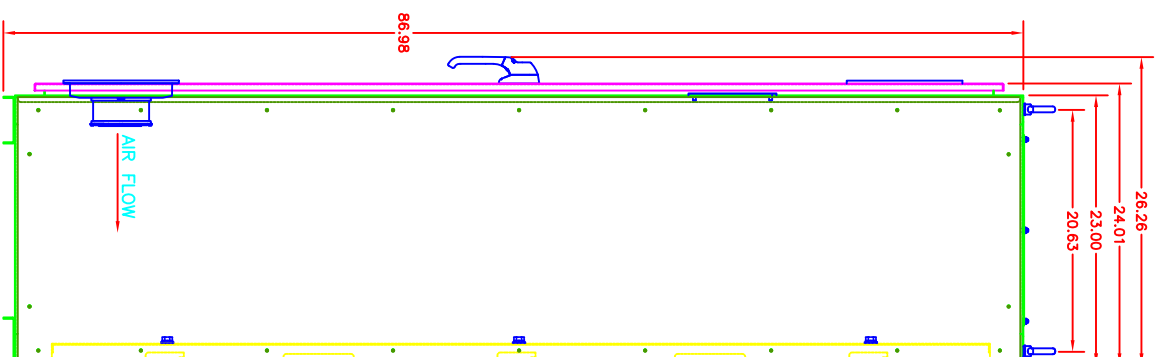
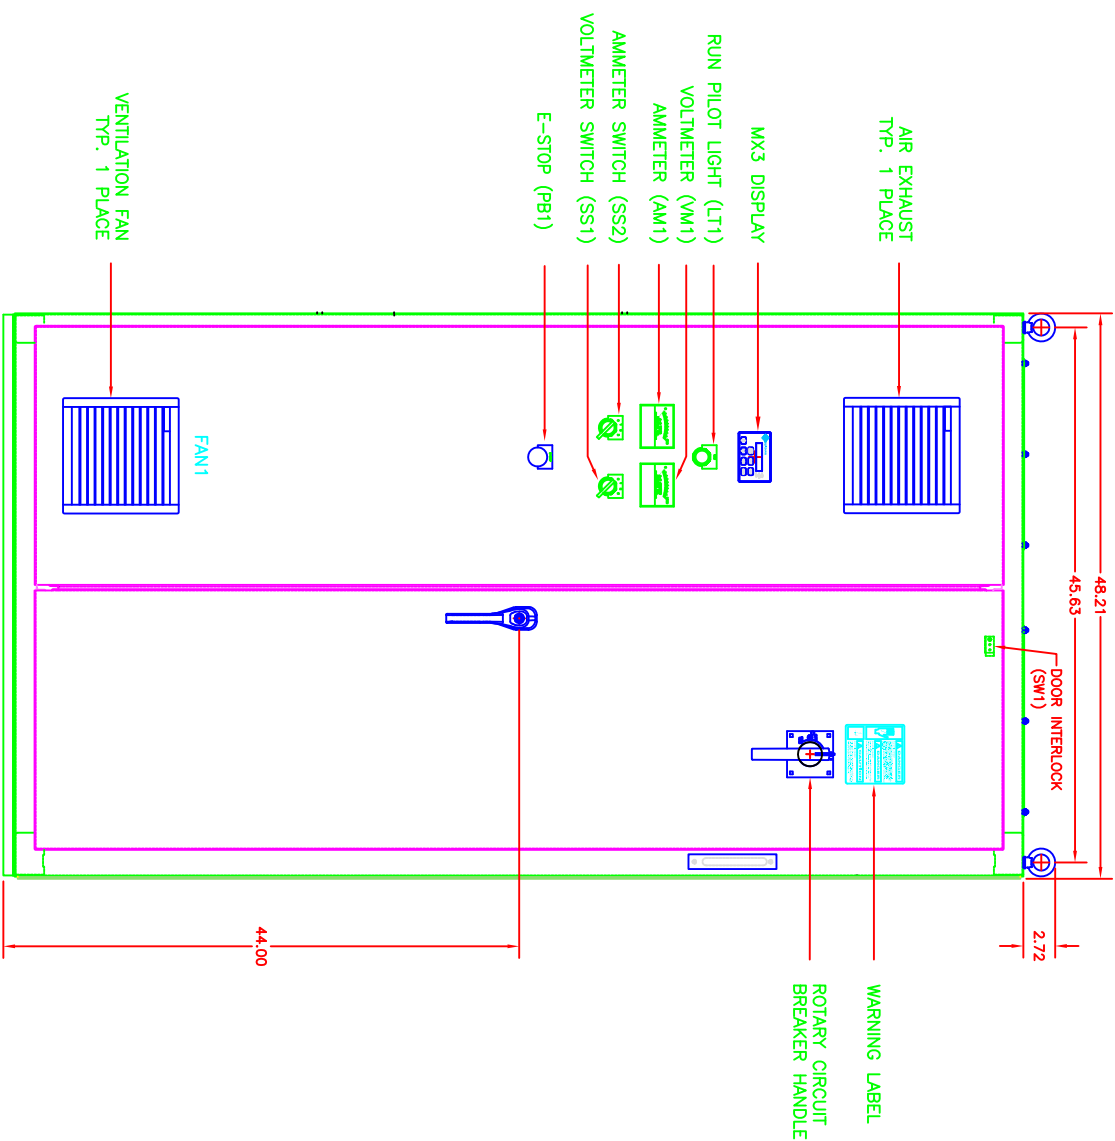


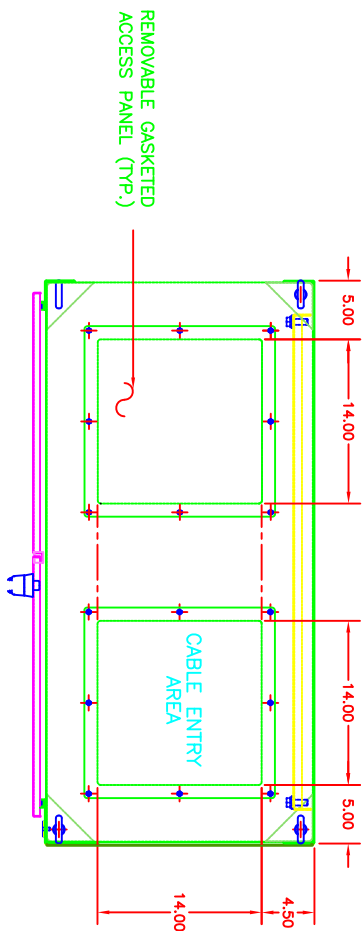

BENSHAW (SOLID STATE)		
STARTER RLA	CIRCUIT BREAKER LUG CAPACITY (PER PHASE)	
	# CONDUCTORS	CONDUCTOR RANGE
95—200A	1	6AWG—350MCM
201—398A	2	3/0—500MCM

NOTES:

1. ALL DIMENSIONS ARE IN INCHES/MM UNLESS OTHERWISE NOTED.
2. MINIMUM WIRE BENDING SPACE SHALL BE 12" FROM TOP OF LUGS, TO TOP OF ENCLOSURE.
3. MINIMUM WIRE BENDING SPACE SHALL BE 12" FROM BOTTOM OF LUGS, TO BOTTOM OF ENCLOSURE.
4. ENSURE THAT ALL RIBBON CABLES ARE ROUTED AWAY FROM POWER CONNECTIONS.
5. ENSURE LEFT DOOR IS HELD CLOSED BY RIGHT DOOR.
6. ENCLOSURE RATING=NEMA TYPE 1
7. APPROXIMATE WEIGHT= 500lbs. (BASE STARTER ONLY)
8. FREE STANDING FLOOR MOUNTED ENCLOSURE LAG BOLT TO CONCRETE FLOOR RECOMMENDED.
9. THIS UNIT IS CONFIGURED FOR TOP CABLE ENTRY / BOTTOM CABLE EXIT. *BOTTOM CABLE ENTRY IS POSSIBLE IF PFCC OPTION IS NOT REQUIRED. FOR ALL OTHER CONFIGURATIONS CONSULT FACTORY FOR ENCLOSURE SIZING.

REVISIONS DO NOT SCALE DWG		THIRD ANGLE PROJECTION 		THIS DRAWING AND ALL INFORMATION CONTAINED HEREIN, IS THE PROPERTY OF BENSCHAW INC. AND IS TO BE KEPT IN CONFIDENCE AND NOT TO BE LOANED, REPRODUCED OR DULGED TO UNAUTHORIZED PERSONS WITHOUT THE EXPRESS WRITTEN PERMISSION OF BENSCHAW INC. IT IS PROVIDED SOLELY FOR THE CONVENIENCE OF THE USER AND SHALL BE RETURNED UPON REQUEST.	
UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS IN INCHES ARE TO BE HOLD PER ASME Y14.5M-1994 TOLERANCES: .XX ± .02 XXX ± .005 ANGLES ± 1° MATERIAL: FINISH:		SIGNATURES DATE		TITLE: ENCLOSURE LAYOUT CARRIER CORPORATION FREE STANDING 96"-480 R/LA	
SCALE: NTS SHEET 1 OF 4		SIZE DWG NO. D E9-10-162 REV B		 BENSCHAW 160 E. SUTTER RD. WALLACE INDUSTRIAL PARK GRANDVIEW, PA. 15116 HRR050	