

SHOP NOTES:

- △S1 ADD BUINS-PMIC1203 INSULATION SLEEVING TO POWER CABLE THRU CTS, 2" MINIMUM PAST EDGE OF CT EACH SIDE. TWIRAP CTS TO BRACKET BRKT-100302-01.
- S2. ENSURE ENCL. SIDE HOLES ARE PLUGGED WHEN NOT USED TO BOLT ADJACENT ENCLOSURES TOGETHER.

NOTES:


- 1 REMOVABLE LIFTING EYEBOLTS, PLUG HOLES IF REMOVED.
- 2 CABLE ENTRY/EXIT AREA. CUTOUT AND COVERPLATE SUPPLIED.
- 3 CABLE ENTRY/EXIT AREA. NO CUTOUT SUPPLIED. CUSTOMER TO CUT AS REQUIRED.
4. ENCLOSURE COLOR: ANSI 61 GREY

5. TIGHTEN BOLTS PER CHART BELOW


STEEL BOLT				
TORQUE IN POUND-FOOT [NEWTON-METER]				
1/4-20	5/16-18	3/8-16	1/2-13	5/8-11
5 [6.8]	12 [16.3]	20 [27]	50 [67.8]	95 [128.8]

6. APPROXIMATE WEIGHT IS 1800LBS [816.5KG]


- 7 ITEMS SHIPPED LOOSE. CUSTOMER TO INSTALL IN FIELD. REFERENCE APPROPRIATE ASSEMBLY AND SCHEMATIC DRAWINGS FOR PROPER INSTALLATION. CALL BENSCHAW CUSTOMER SERVICE WITH QUESTIONS, 1-800-203-2416.

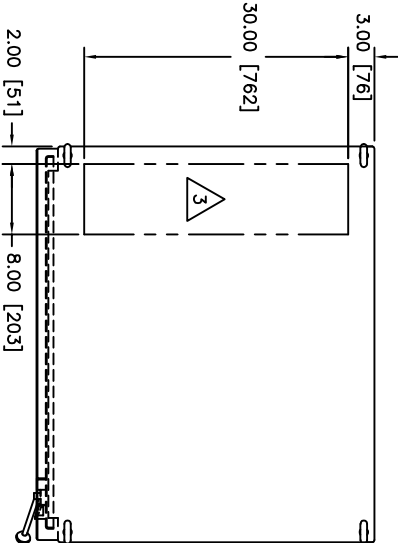


TOP VIEW

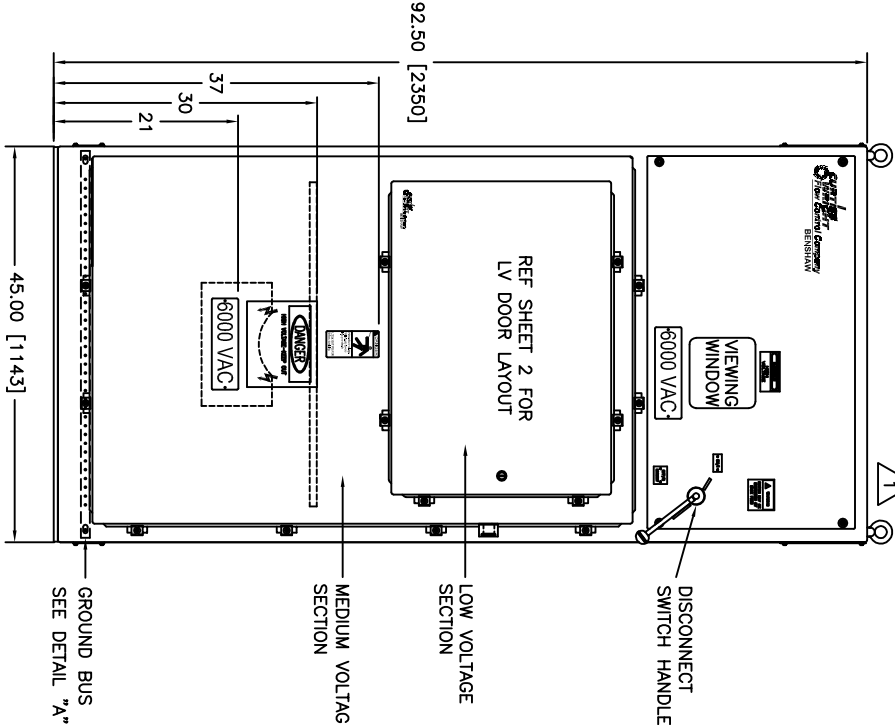


FRONT VIEW

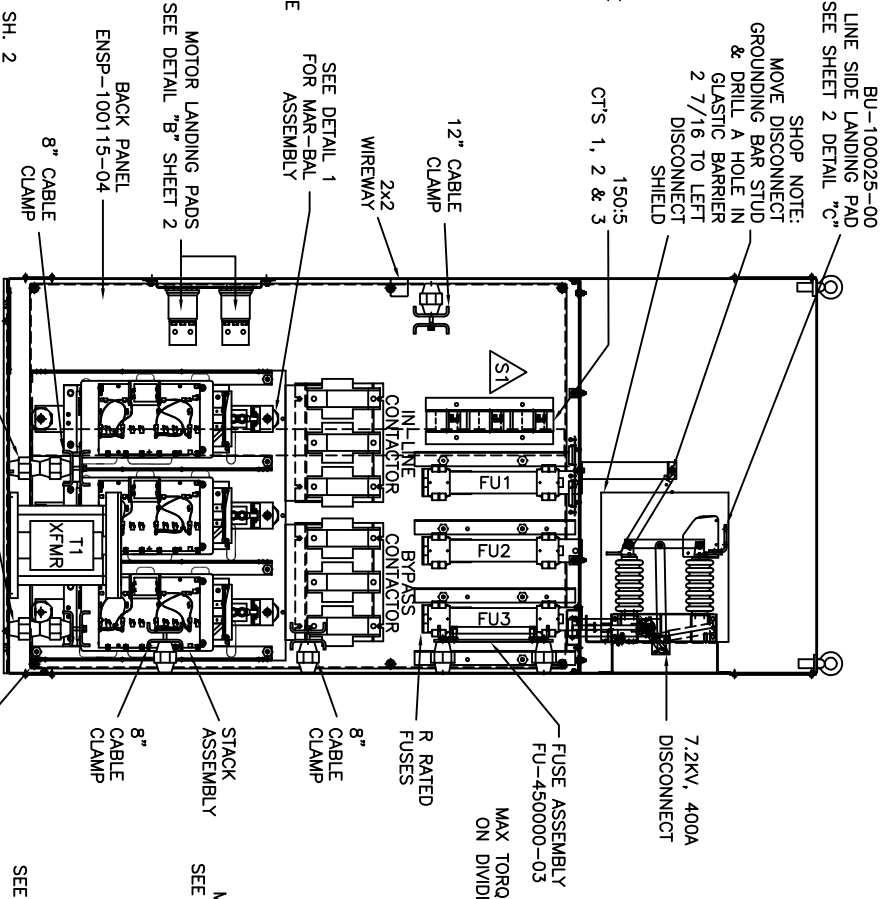


FRONT INTERIOR VIEW

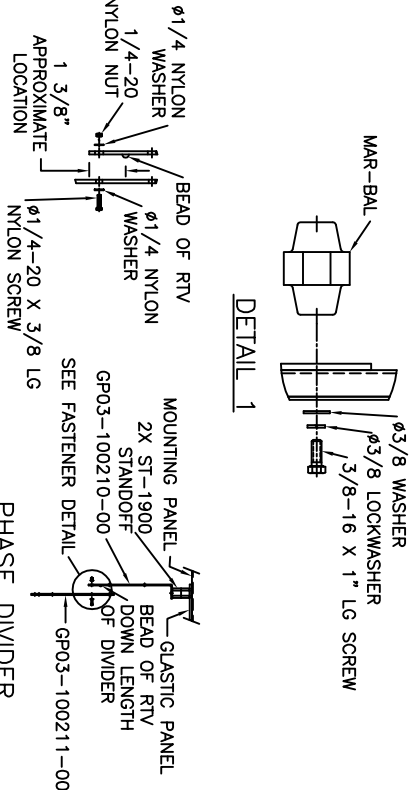


FASTENER DETAIL

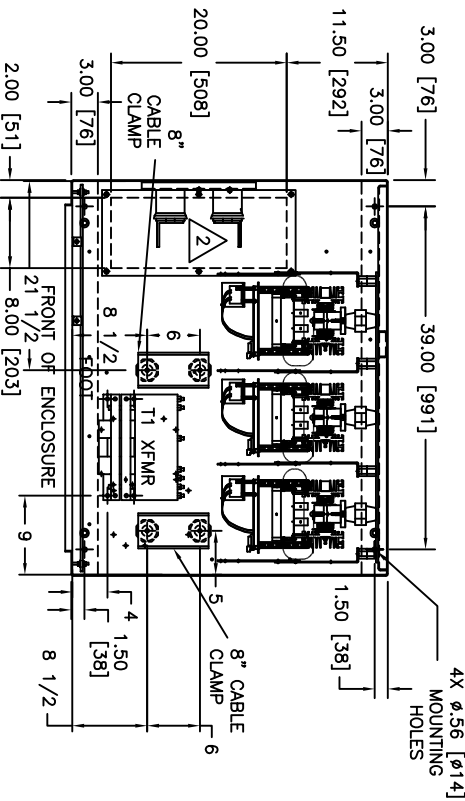

PLAN VIEW

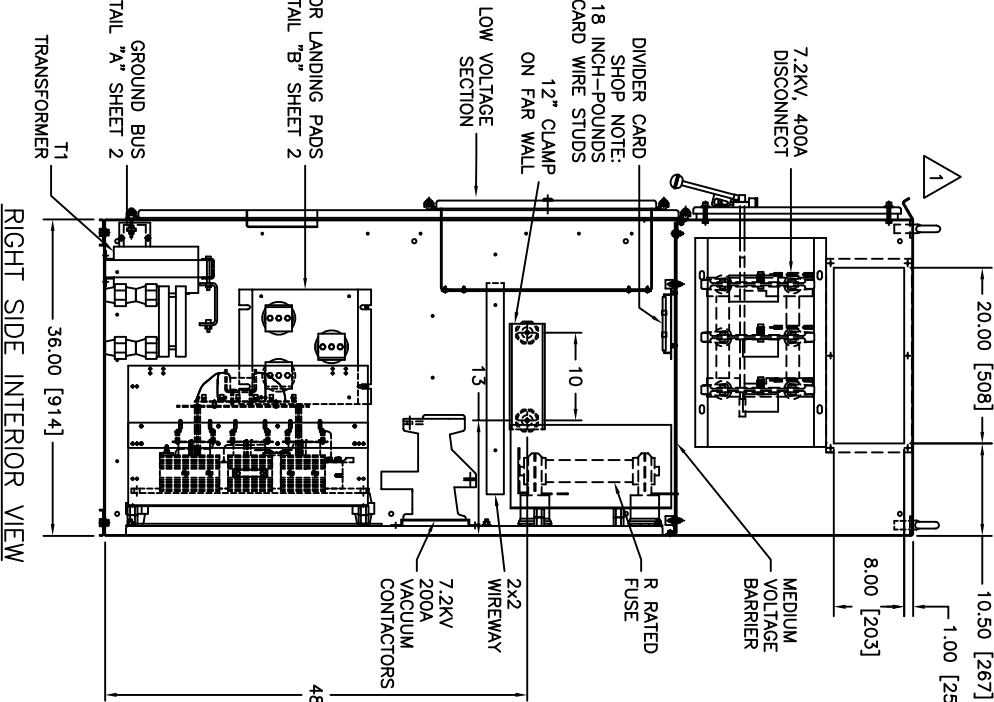

RIGHT SIDE INTERIOR VIEW

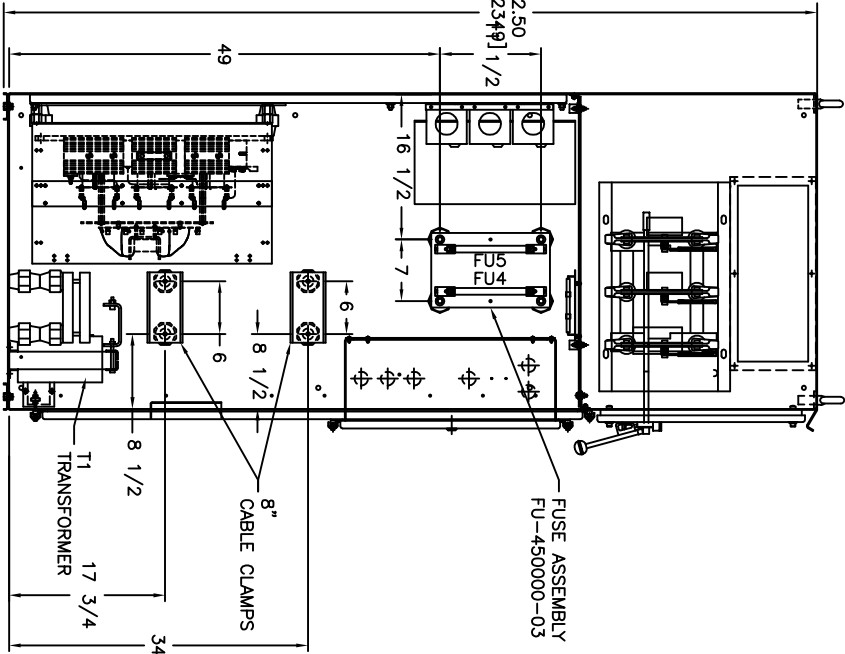

LEFT SIDE INTERIOR VIEW

SHOP NOTE:
KEEP ALL 7.5KV CABLE & WIRE SUPPORTED OFF OF THE ENCLOSURE.

PRODUCTION PRINT

1	APPRD:JWH 11/26/13
	CHG BY:JWH 11/26/13
	CHANGE: INITIAL DWGS