

VRF Multiport Distribution Controller (MDC) 40VMD006S--3 — Sub MDC



Submittal Data

Job Name _____ Location _____
Tag _____



STANDARD FEATURES

- Allows the connection of multiple indoor units to the Heat Recovery VRF system
- MDC allows up to 6 zones
- Main MDCs have refrigerant ports that feed sub MDCs (if used)
- Heat Recovery VRF System can support one Main MDC and two sub MDCs, maximum
- Separate 208-230/1/60 power required
- MDC ports may be twinned to serve high-capacity units (sizes greater than 54 kBtu/h)
- MDC has individual “home run” communication port plugs for each indoor unit
- Liquid and gas pipe adapters are provided with MDCs to accommodate various indoor unit capacities
- High-pressure, low-pressure, and gas pipe adapters are provided with Sub MDCs to accommodate various MDC total capacities


MDC MODEL		40VMD006S--3
NUMBER OF PORTS		6
MAX CAPACITY PER INDOOR UNIT PORT	kBtu/h	54
ELECTRICAL		
Power Supply	V-Ph-Hz	208/230-1-60
Minimum Circuit Amps	A	0.69
Maximum Overcurrent Protection	A	15
Motor Type		DC
Power Wiring		Sized per NEC and local codes based on nameplate electrical data
Signal Wiring		2-core shielded twisted pair cable 18 AWG
DESIGN PRESSURE, HIGH/LOW	psig	580/320
DRAINAGE WATER PIPE DIAMETER, OD	in.	1
PIPE SIZE - MAIN MDC to SUB MDC		
High Pressure (Gas)	in.	5/8 - 7/8
Low Pressure (Gas)	in.	3/4 - 1-1/8
Liquid	in.	3/8 - 5/8

PIPE SIZE - SUB MDC TO IDU		
Liquid	in.	1/4 - 3/8
Gas	in.	1/2 - 7/8
PHYSICAL DATA		
Refrigerant		R-410A
Unit Dimensions (W x H x D)	in.	37 x 12-7/8 x 22-5/8
Packing Dimensions (W x H x D)	in.	44-1/2 x 18 x 33-1/8
Net Weight	lb	126


LEGEND
 AWG — American Wire Gage
 IDU — Indoor Unit
 MDC — Multiport Distribution Controller
 NEC — National Electrical Code
 ODU — Outdoor Unit

Manufacturer reserves the right to discontinue, or change at any time, specifications or designs without notice and without incurring obligations.

DIMENSIONAL DRAWING SUB MDC 40VMD006S--3

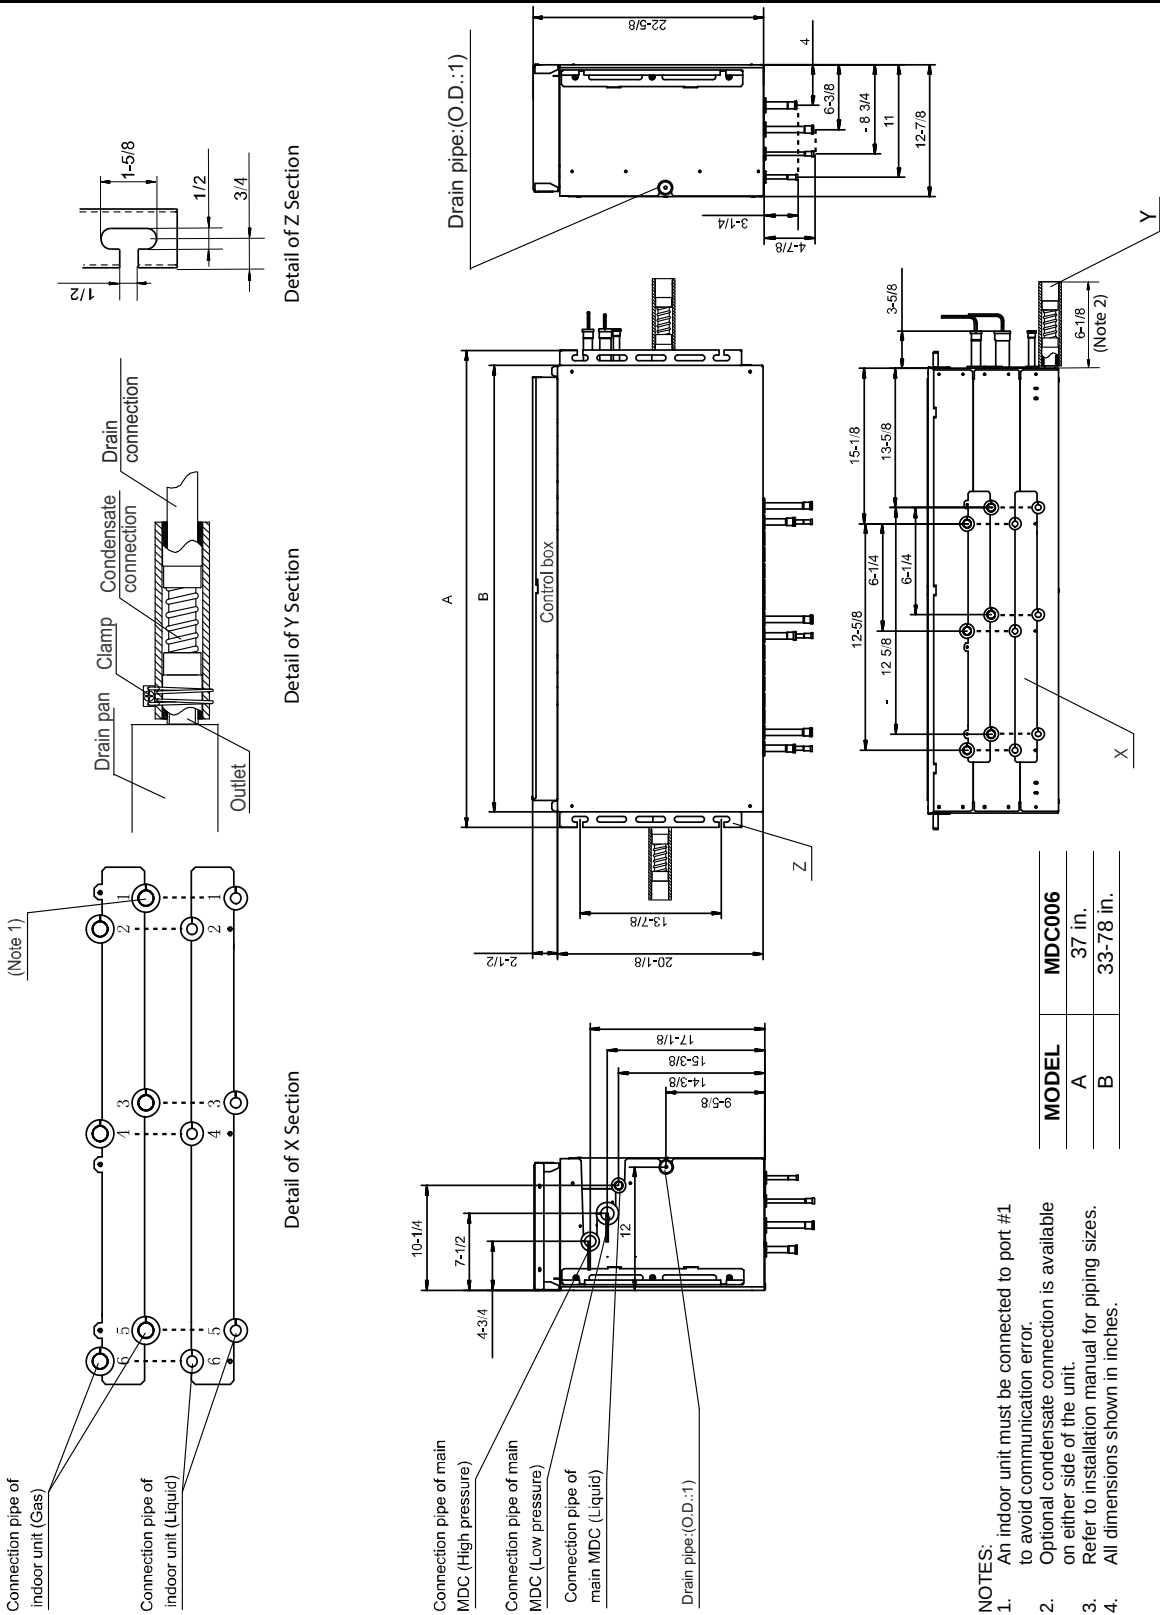

RECOMMENDED SERVICE CLEARANCE

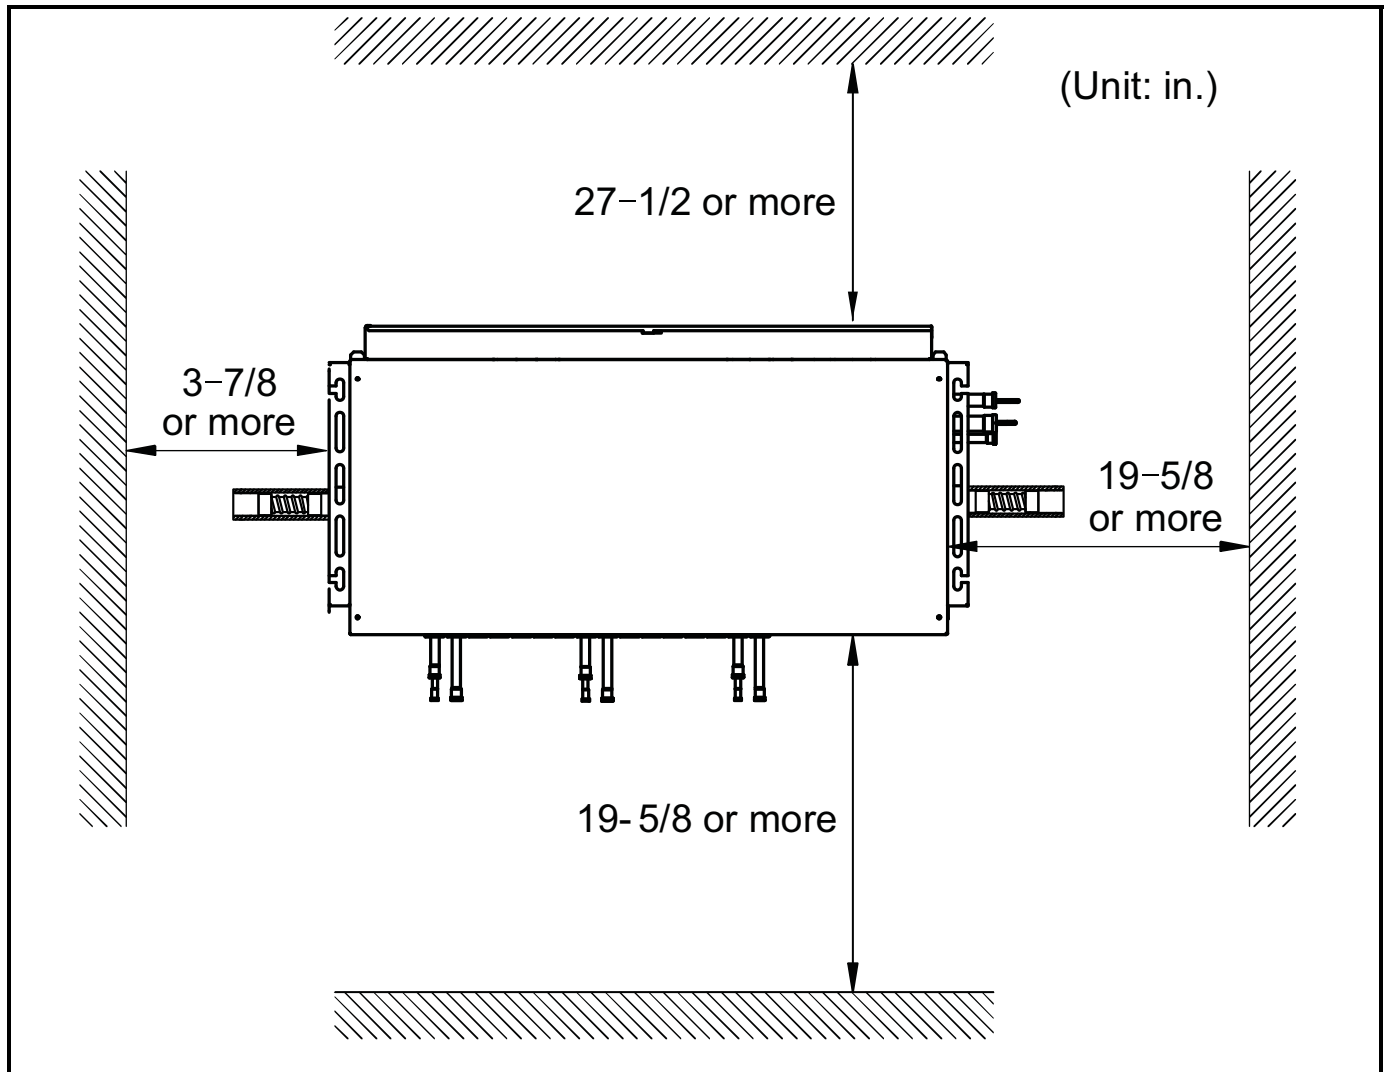

RECOMMENDATION FOR GRAVITY DRAIN INSTALLATION

