



Installation, Start-Up and Service Instructions

CONTENTS

	Page
SAFETY CONSIDERATIONS	1
INSTALLATION	1-29
Step 1 — Provide Unit Support	1
• ROOF CURB	
• ALTERNATE UNIT SUPPORT	
Step 2 — Rig and Place Unit	8
• POSITIONING	
• ROOF MOUNT	
Step 3 — Field Fabricate Ductwork	13
Step 4 — Make Unit Duct Connections	13
Step 5 — Trap Condensate Drain	13
Step 6 — Controls Options	14
• CONSTANT VOLUME APPLICATIONS	
• VARIABLE AIR VOLUME (VAV) APPLICATIONS	
Step 7 — Make Electrical Connections	18
• POWER WIRING	
• FIELD POWER SUPPLY	
• FIELD CONTROL WIRING	
Step 8 — Make Outdoor-Air Inlet Adjustments	25
• ECONOMIZER	
• ECONOMIZER SETTINGS	
Step 9 — Position Power Exhaust/Barometric Relief Damper Hood	28
Step 10 — Install Accessories	28
START-UP	29-41
SERVICE	41-44
TROUBLESHOOTING	45-49
START-UP CHECKLIST	CL-1, CL-2

SAFETY CONSIDERATIONS

Installation and servicing of air-conditioning equipment can be hazardous due to system pressure and electrical components. Only trained and qualified service personnel should install, repair, or service air-conditioning equipment.

Untrained personnel can perform basic maintenance functions of cleaning coils and filters and replacing filters. All other operations should be performed by trained service personnel. When working on air-conditioning equipment, observe precautions in the literature, tags and labels attached to the unit, and other safety precautions that may apply.

Follow all safety codes. Wear safety glasses and work gloves. Use quenching cloth for unbrazing operations. Have fire extinguishers available for all brazing operations.

⚠ WARNING

Before performing service or maintenance operations on unit, turn off main power switch to unit. Electrical shock could cause personal injury.

IMPORTANT — READ BEFORE INSTALLING

IMPORTANT: Due to upgrades in unit control software and hardware, units produced currently are slightly different than original design units. The unit control software (which has changed) is designated with a sticker on the unit control board, chip U8 (the large chip in the center of the board), which states the software Version number. Version 1.0 is the original version. Version 2.0 is the current version. Differences in installation, configuration, and start-up procedures in this manual will be identified by Version number.

INSTALLATION

Step 1 — Provide Unit Support

⚠ CAUTION


All panels must be in place when rigging. Unit is not designed for handling by fork truck.

ROOF CURB — Assemble and install accessory roof curb in accordance with instructions shipped with the curb. Accessory roof curb and information required to field fabricate a roof curb or horizontal adapter are shown in Fig. 1 and 2. Install insulation, cant strips, roofing, and counter flashing as shown. Ductwork can be secured to roof curb before unit is set in place.

IMPORTANT: The gasketing of the unit to the roof curb is critical for a leak-proof seal. Install gasket supplied with the roof curb as shown in Fig. 1 and 2. Improperly applied gasket can result in air leaks and poor unit performance.

Curb should be level. This is necessary to permit unit drain to function properly. Unit leveling tolerance is shown in Fig 1 and 2. Refer to Accessory Roof Curb Installation Instructions for additional information as required. When accessory roof curb is used, unit may be installed on class A, B, or C roof covering material.

ALTERNATE UNIT SUPPORT — When the curb or adapter cannot be used, support unit with sleepers using unit curb or adapter support area. If sleepers cannot be used, support long sides of unit (refer to Fig. 3-6) with a minimum number of equally spaced 100 mm × 100 mm (4-in. x 4-in.) pads as follows: 50EJ,EK,EW,EY024-034 units require 3 pads on each side; 50EJ,EK,EW,EY044 units require 4 pads on each side. Unit may sag if supported by corners only.

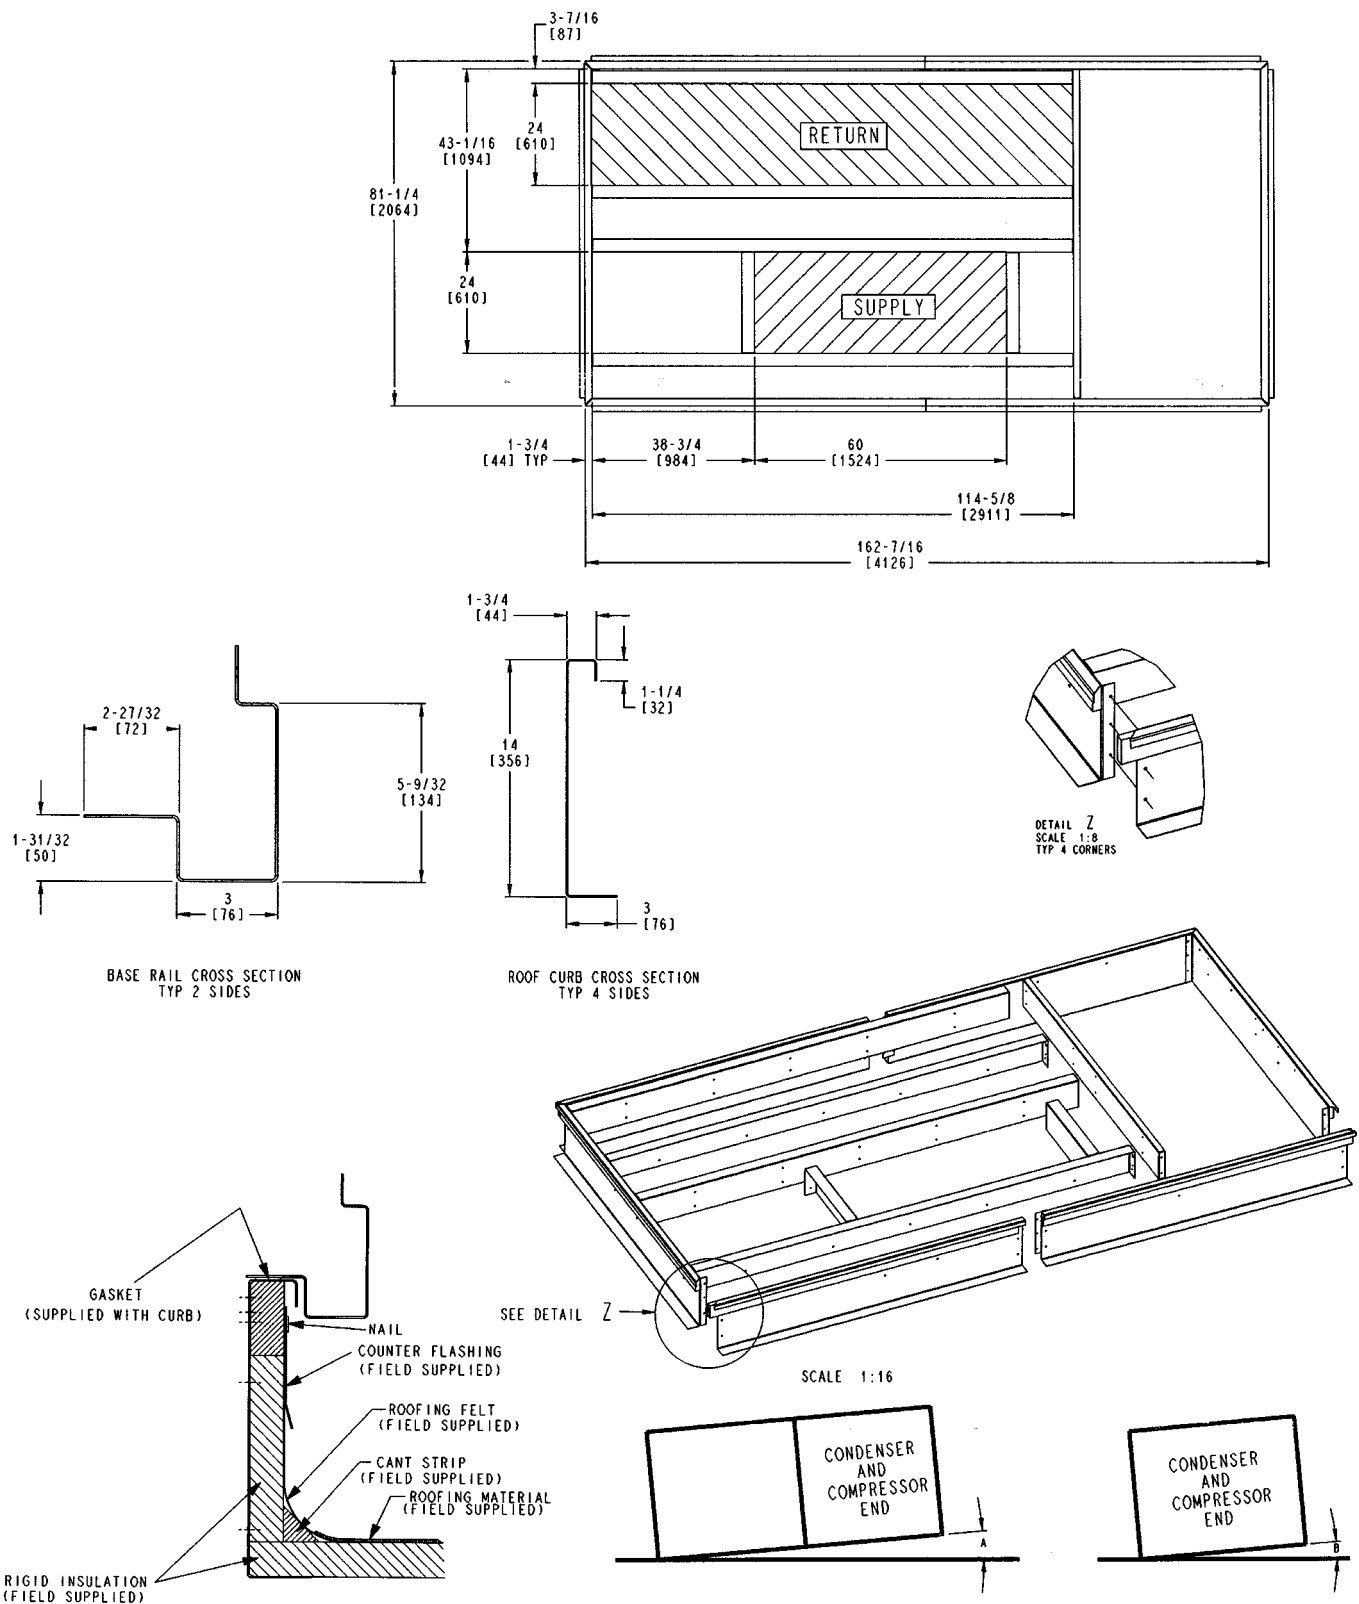

NOTES:


1. Unless otherwise specified, all dimensions are to outside of part.
2. Roof curb accessory is shipped disassembled.
3. All roof curb parts are to be 16 gage galvanized steel.
4. Units with electric heat must be installed with 90° elbow on the supply duct prior to any supply take offs or branches.
5. Dimensions in [] are in millimeters.

NOTE: To prevent standing water in the drain pan of the indoor section and the heat exchangers, UNIT CAN ONLY BE PITCHED AS SHOWN.

DIMENSIONS
(Degrees and Inches)

A			B		
Deg.	in.	mm	Deg.	in.	mm
1.0	2.9	73	.50	.75	19

Fig. 1 — Roof Curb (Sizes 024-034)

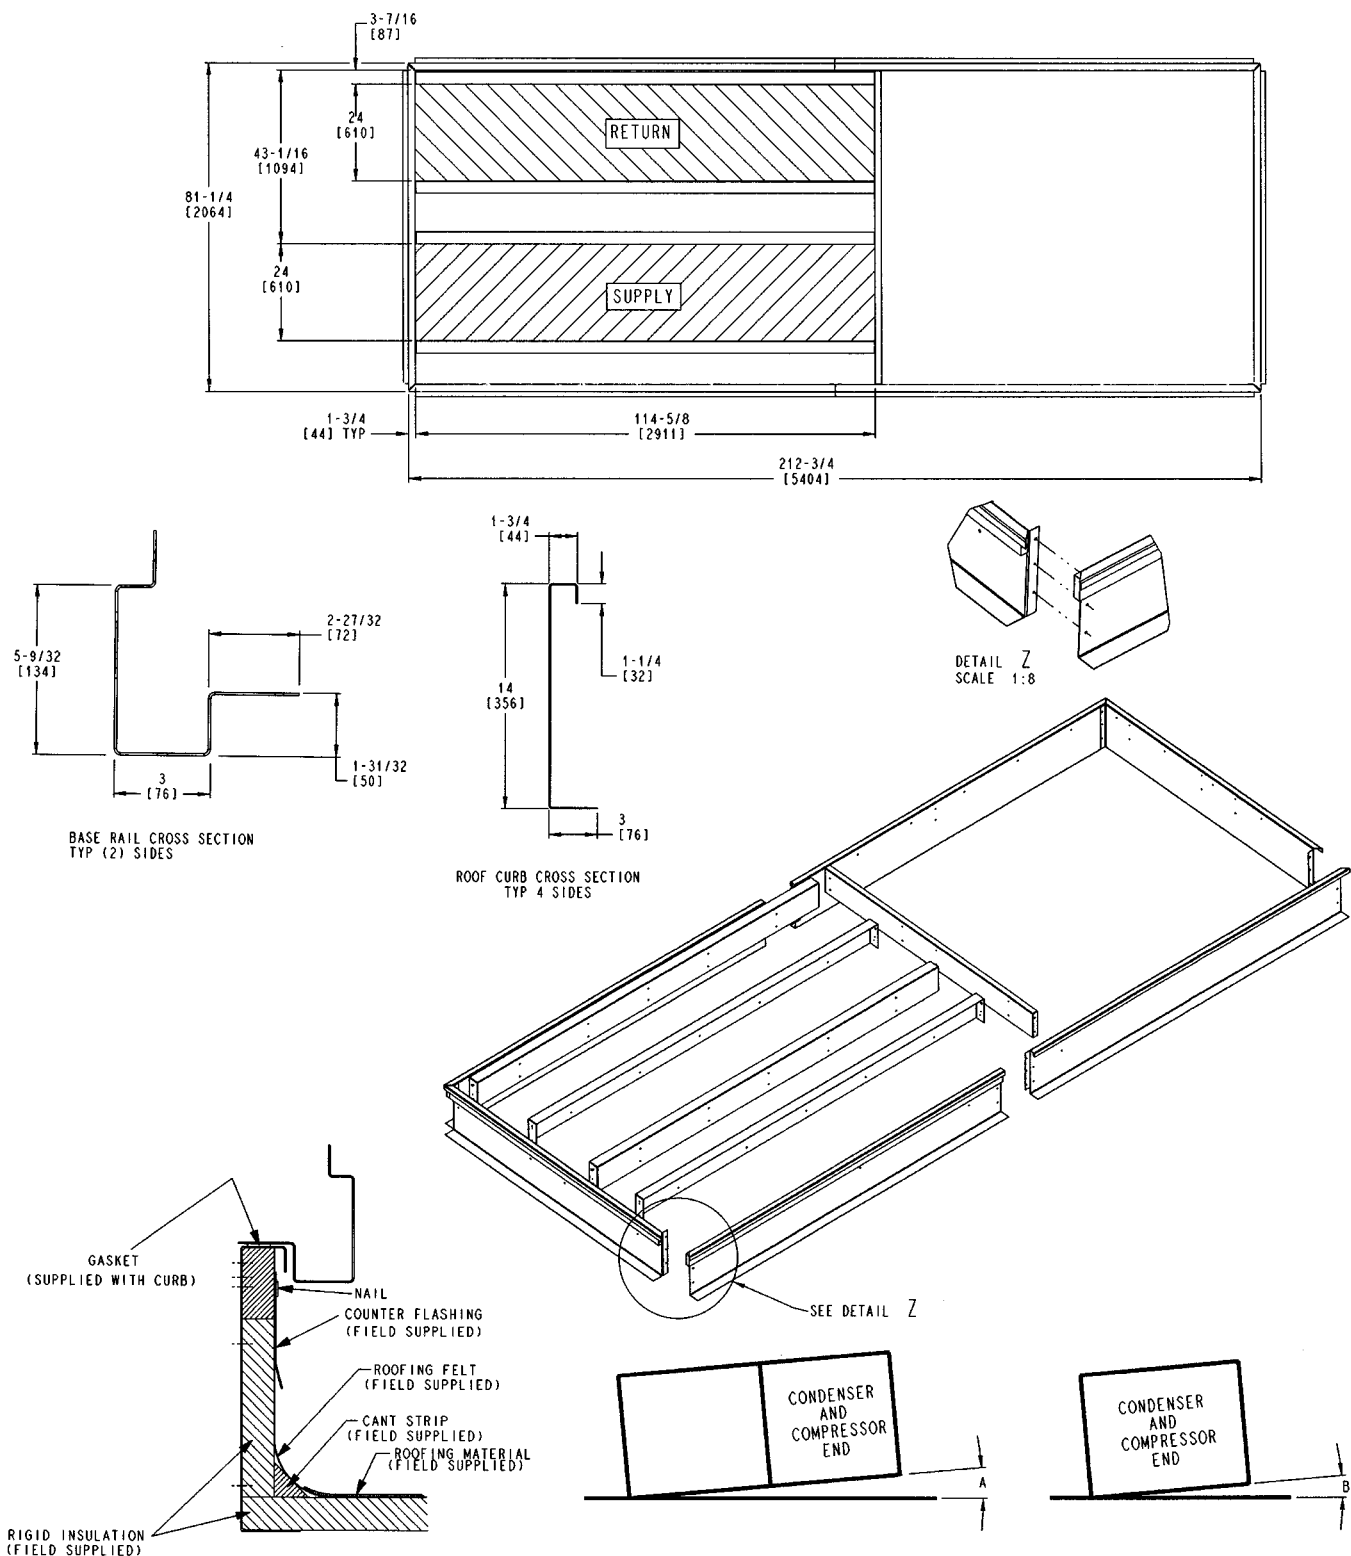

NOTES:

1. Unless otherwise specified, all dimensions are to outside of part.
2. Roof curb accessory is shipped disassembled.
3. All roof curb parts are to be 16 gage galvanized steel.
4. Units with electric heat must be installed with 90° elbow on the supply duct prior to any supply take offs or branches.
5. Dimensions in [] are in millimeters.





UNIT LEVELING TOLERANCES (FROM EDGE OF UNIT TO HORIZONTAL)

NOTE: To prevent standing water in the drain pan of the indoor section and the heat exchangers, UNIT CAN ONLY BE PITCHED AS SHOWN.

DIMENSIONS (Degrees and Inches)

A			B		
Deg.	in.	mm	Deg.	in.	mm
1.0	2.9	73	.50	.75	19

Fig. 2 — Roof Curb (Size 044)

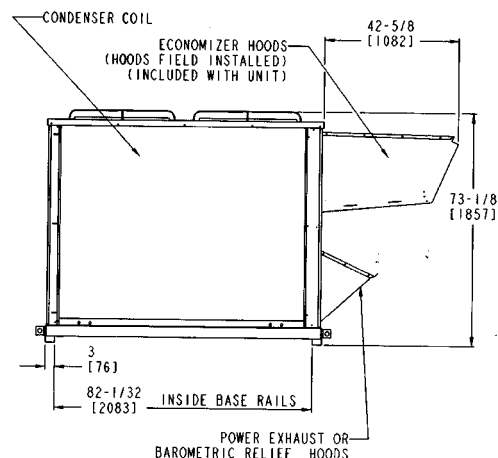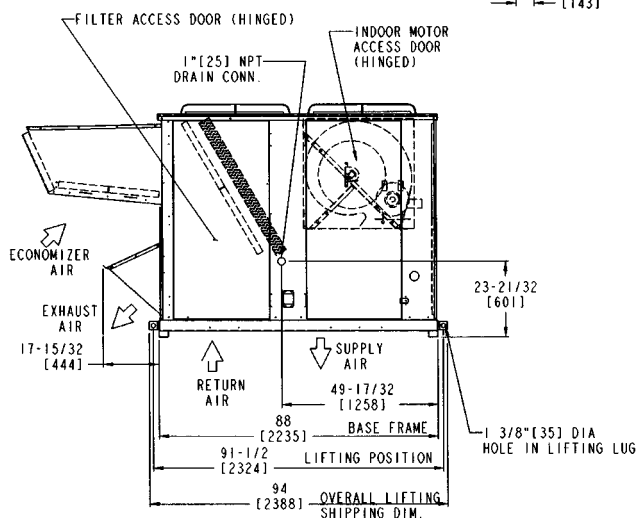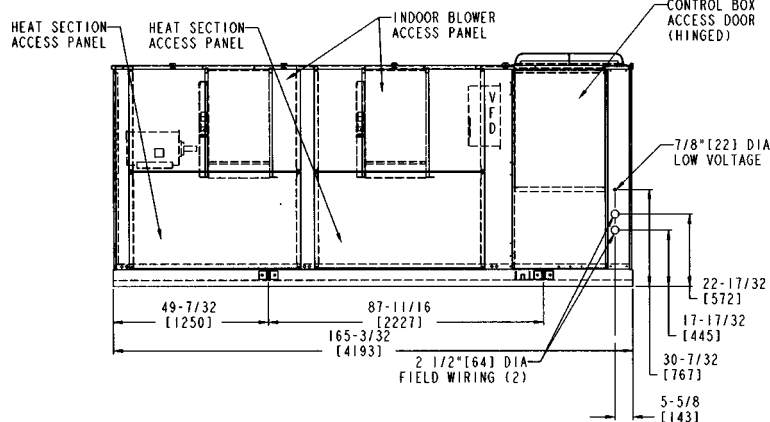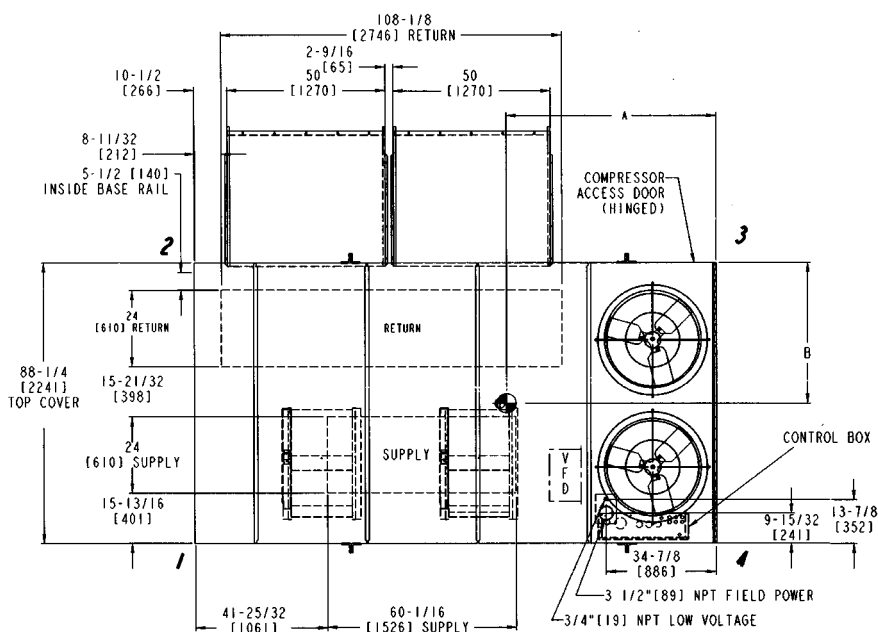

NOTES:


- Weights include economizer (Std)
-  Center of gravity.
- Do not locate adjacent units with discharge facing economizer inlet. Minimum clearances to be:
Adjacent Units: 15'-0" (4.6 m)
Top of Units: No overhang
Condenser Coil: 4'-0" (1.2 m)
Economizer Side: 6'-0" (1.8 m)
Filter Access Side: 10'-0" (3.0 m) (for removal of evaporator coil)
- For smaller service and operational clearances, contact Carrier Application Engineering department.
- Bottom ducts designed to be attached to accessory roof curb. If unit is mounted on dunnage, it is recommended the ducts be supported by cross braces as done on accessory roof curb.
- Dimensions are in inches. Dimensions in [] are in millimeters.
- For units with electric heat, a field-supplied 90° elbow must be installed in the supply ductwork below the unit discharge.

LEGEND

VFD — Variable Frequency Drive

UNIT SIZE 50EJ,EK	OPERATING WEIGHT		A		B		CORNER WEIGHT							
							1		2		3		4	
	lb	kg	in.	mm	in.	mm	lb	kg	lb	kg	lb	kg	lb	kg
024	4016	1822	71.34	1813	41.69	1059	823	373	914	415	1199	544	1080	490
028	4102	1860	68.5	1740	43.63	1108	844	383	859	390	1210	549	1189	539
030	4102	1860	68.5	1740	43.63	1108	844	383	859	390	1210	549	1189	539
034	4102	1860	68.5	1740	43.63	1108	844	383	859	390	1210	549	1189	539

Fig. 3 — Base Unit Dimensions, 50EJ,EK024-034

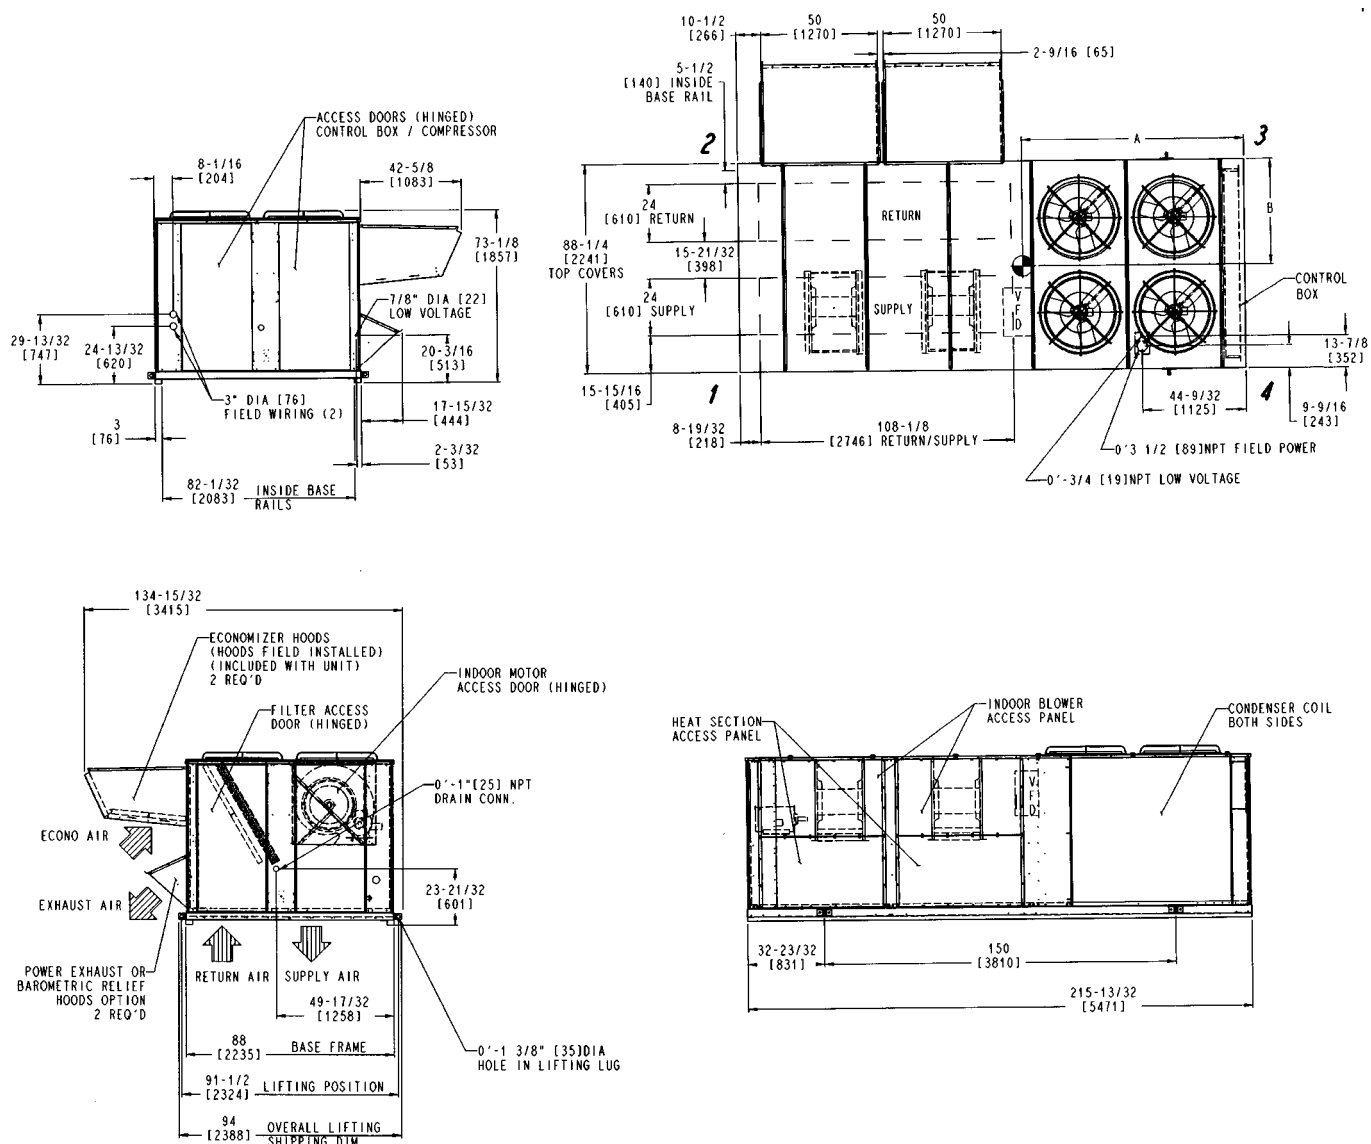

NOTES:




- Weights include economizer (Std)
- Center of gravity.
- Do not locate adjacent units with discharge facing economizer inlet. Minimum clearances to be:
 Adjacent Units: 15'-0" (4.6 m)
 Top of Units: No overhang
 Condenser Coil: 4'-0" (1.2 m)
 Economizer Side: 6'-0" (1.8 m)
 Filter Access Side: 10'-0" (3.0 m) (for removal of evaporator coil)
- For smaller service and operational clearances, contact Carrier Application Engineering department.
- Bottom ducts designed to be attached to accessory roof curb. If unit is mounted on dunnage, it is recommended the ducts be supported by cross braces as done on accessory roof curb.
- Dimensions are in inches. Dimensions in [] are in millimeters.
- For units with electric heat, a field-supplied 90° elbow must be installed in the supply ductwork below the unit discharge.

LEGEND

VFD — Variable Frequency Drive

UNIT SIZE 50EJ,EK	OPERATING WEIGHT		A		B		CORNER WEIGHT							
	lb	kg	in.	mm	in.	mm	1		2		3		4	
044	4508	2045	87.81	2230	47.50	1207	973	441	868	394	1258	571	1409	639

Fig. 4 — Base Unit Dimensions, 50EJ,EK044

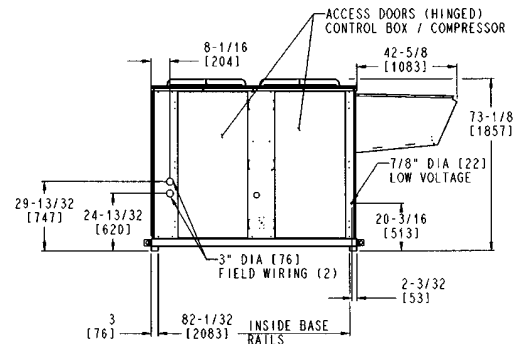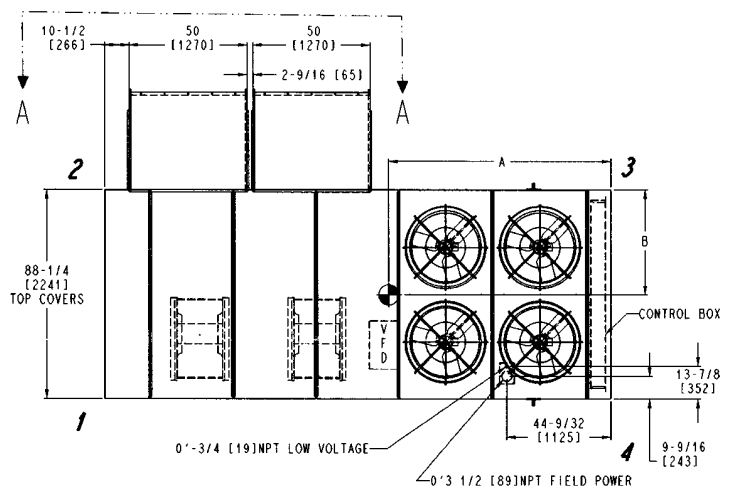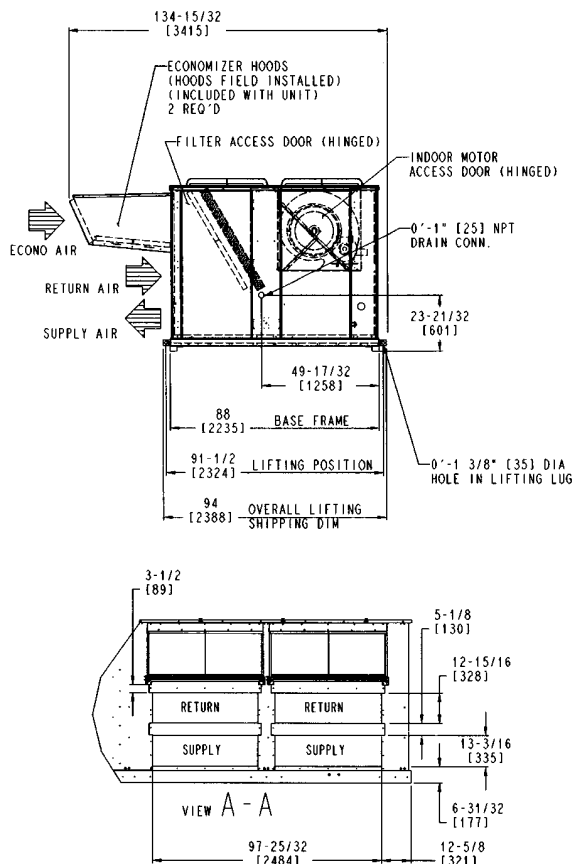

NOTES:

- Weights include economizer (Std)
- Center of gravity.
- Do not locate adjacent units with discharge facing economizer inlet. Minimum clearances to be:
 Adjacent Units: 15'-0" (4.6 m)
 Top of Units: No overhang
 Condenser Coil: 4'-0" (1.2 m)
 Economizer Side: 6'-0" (1.8 m)
 Filter Access Side: 10'-0" (3.0 m) (for removal of evaporator coil)
- For smaller service and operational clearances, contact Carrier Application Engineering department.
- Dimensions are in inches. Dimensions in [] are in millimeters.
- For units equipped with electric heat, a field-supplied 90° elbow must be installed in the supply ductwork below the unit discharge.
- For side-supply/return applications, a single return and supply ductwork connection is recommended for covering both return and both supply air openings.

LEGEND

VFD — Variable Frequency Drive

UNIT SIZE 50EW,EY	OPERATING WEIGHT		A		B		CORNER WEIGHT							
							1		2		3		4	
	lb	kg	in.	mm	in.	mm	lb	kg	lb	kg	lb	kg	lb	kg
044	4508	2045	87.81	2230	47.50	1207	973	441	868	394	1258	571	1409	639

Fig. 6 — Base Unit Dimensions, 50EW,EY044

Step 2 — Rig and Place Unit — Inspect unit for transportation damage. File any claim with transportation agency. Keep unit upright, and do not drop. Use spreader bars over unit to prevent sling or cable damage. Rollers may be used to move unit across a roof. Level by using unit frame as a reference; leveling tolerance is shown in Fig. 1 and 2. See Fig. 7 for additional information. Unit weight is shown in Tables 1A and 1B.


NOTE: On retrofit jobs, ductwork may be attached to old unit instead of roof curb. Be careful not to damage ductwork when removing unit. Attach existing ductwork to roof curb instead of unit.

Four lifting lugs are provided on the unit base rails as shown in Fig. 7. Refer to rigging instructions on unit.

POSITIONING — Provide clearance around and above unit for airflow, safety, and service access (Fig. 3-6).

Do not install unit in an indoor location. Do not locate air inlets near exhaust vents or other sources of contaminated air.

Although unit is weatherproof, guard against water from higher level runoff and overhangs.

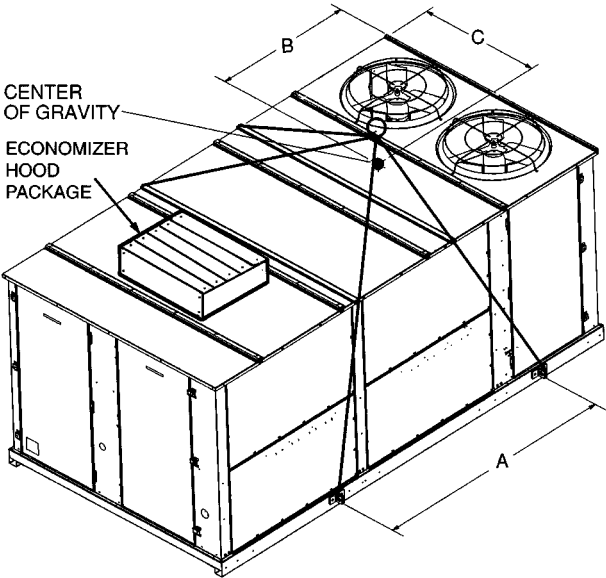

⚠ CAUTION

NOTICE TO RIGGERS:
ALL PANELS MUST BE IN PLACE
WHEN RIGGING.

NOTE: Rig with four cables and spread with two 92 in. (2337 mm) spreader bars. Maintain a distance of 74 in. (1880 mm) from top of unit to eyehook.

NOTE:
 Add 32 lb (14.5 kg) for domestic crating.
 Add 312 lb (142 kg) for export crating (024-034 units).
 Add 346 lb (157 kg) for export crating (044 units).
 Add 250 lb (113 kg) for power exhaust.
 Add 220 lb (100 kg) for copper condenser coil (024-034 units).
 Add 285 lb (129 kg) for copper condenser coil (044 units).

UNIT 50EJ,EK,EW,EY	WEIGHT		A		B		C	
	lb	kg	in.	mm	in.	mm	in.	mm
024	4016	1822	87.68	2227	71.4	1814	41.7	1059
028	4102	1860	87.68	2227	68.5	1740	43.6	1107
030								
034								
044	4508	2045	150	3810	87.8	2230	46.5	1181

Fig. 7 — Rigging Label

Table 1A — Physical Data (SI)

UNIT 50EJ,EK,EW,EY	024	028	030
NOMINAL CAPACITY (kW) 60 Hz/50 Hz	70/67	88/81	95/91
OPERATING WEIGHT (kg)*			
Unit			
Al/Al†	1822	1860	1860
Al/Cu†	1922	1960	1960
Roof Curb (356-mm curb)	166	166	166
COMPRESSOR			
Type Ckt 1	06D328	06D328	06D537
Ckt 2	06D818	06D328	06D328
Number of Refrigerant Circuits	2	2	2
Oil (ml) (Ckt1, Ckt 2)	3400, 2600	3400 ea.	3400 ea.
REFRIGERANT TYPE		R-22	
Operating Charge (kg)			
Circuit 1**	11.34	11.34	11.34
Circuit 2	14.06	11.34	11.34
CONDENSER COIL	Cross-Hatched 3/8" Copper Tubes, Aluminum Lanced, Aluminum Precoated, or Copper Fins		
Quantity	1	1	1
Rows...Fins/m	4...590	4...590	4...590
Total Face Area (sq m)	3.09	3.09	3.09
CONDENSER FAN		Propeller Type	
Nominal L/s 60 Hz/50 Hz	6330/5470	6330/5470	6330/5470
Quantity...Diameter (mm)	2...762	2...762	2...762
Motor kW	.75	.75	.75
EVAPORATOR COIL	Cross-Hatched 3/8" Copper Tubes, Aluminum Plate Fins, Intertwined Circuits		
Rows...Fins/mm	4...590	4...590	4...590
Total Face Area (sq m)	2.94	2.94	2.94
EVAPORATOR FAN		Centrifugal Type	
Quantity...Size (mm)	2...508 × 381	2...508 × 381	2...508 × 381
Type Drive	Belt	Belt	Belt
Nominal L/s 60 Hz/50 Hz	3775/3540	4720/4340	5190/4815
Motor kW	3.73 7.46†† 11.19	5.60 7.46†† 11.19	7.46 11.19†† 14.92
Motor Frame Size	184T 215T 254T	213T 215T 254T	215T 254T 256T
Motor Bearing Type	Ball	Ball	Ball
Maximum Allowable r/s	20	20	20
Motor Pulley Pitch Diameter (mm)	117 168 175	124 155 180	168 170 191
Nominal Motor Shaft Diameter (mm)	28 35 41	35 35 41	35 41 41
Fan Pulley Pitch Diameter (mm)	282 318 282	282 282 282	348 282 282
Nominal Fan Shaft Diameter (mm)	34	34	34
Belt, Quantity...Type	1...BX59 1...BX60 1...SVX590	1...BX56 1...BX56 1...SVX590	1...BX62 1...SVX590 1...SVX600
Belt Length (mm)	1575 1600 1499	1499 1499 1499	1651 1499 1524
Pulley Center Line Distance (mm)	406-475 396-467 381-455	396-467 396-467 381-455	396-467 381-455 381-455
Factory Speed Setting (r/s) 60 Hz/50 Hz	12.1/10.1 15.4/12.8 18.1/15.1	12.9/10.8 16.0/13.3 18.7/15.6	14.1/11.8 17.6/14.7 19.7/16.4
HIGH-PRESSURE SWITCH (kPa)			
Cutout	2951	2951	2951
Reset (Auto.)	2206	2206	2206
LOW-PRESSURE SWITCH (kPa)			
Cutout	48	48	48
Reset (Auto.)	152	152	152
RETURN-AIR FILTERS			
Quantity...Size (mm)	10...508x610x51	10...508x610x51	10...508x610x51
OUTDOOR-AIR FILTERS		8...406 × 635	
Quantity...Size (mm)		4...508 × 635	
POWER EXHAUST	Direct Drive, 3-Speed, Single Phase Motor (Factory Wired For High Speed) and Forward Curved Fan		
Motor Quantity...kW		4...0.75	
Fan, Diameter...Width (mm)		279...254	

LEGEND

Al — Aluminum
 Bhp — Brake Horsepower
 Cu — Copper

*Weight of unit does not include variable frequency drive (VFD). If a VFD is installed, add the VFD weight in the table at right.

†Evaporator coil fin material/condenser coil fin material.

**Sizes 024-034: Circuit 1 uses the lower portion of condenser coil, Circuit 2 uses the upper portion. Size 044: Circuit 1 uses the left condenser coil, Circuit 2 the right. All units have intertwined evaporator coils.

††Motor and drive shown will deliver approximately 17.2 kPa (2.5 in. wg) net external static. For more drive information, see Tables 2A and 2B.

NOTE: See Tables 2A and 2B for optional evaporator fan motor data.

VFD (kW)	VFD WEIGHTS (kg)
	380 v and 400 v
3.73	9.98
5.60	16.78
7.46	27.67
11.19	28.58
14.92	50.35
18.65	50.80

Table 1A — Physical Data (SI) (cont)

UNIT 50EJ,EK,EW,EY	034			044		
NOMINAL CAPACITY (kW) 60 Hz/50 Hz	105/98			141/123		
OPERATING WEIGHT (kg)*						
Unit						
Al/Al†	1860			2045		
Al/Cu†	1960			2174		
Roof Curb (356-mm curb)	166			186		
COMPRESSOR						
Type Ckt 1	06D537			06EA250		
Ckt 2	06D537			06EA250		
Number of Refrigerant Circuits	2			2		
Oil (ml) (Ckt1, Ckt 2)	3400 ea.			6625 ea.		
REFRIGERANT TYPE	R-22					
Operating Charge (kg)						
Circuit 1**	11.34			15.88		
Circuit 2	11.34			15.88		
CONDENSER COIL	Cross-Hatched 3/8" Copper Tubes, Aluminum Lanced, Aluminum Precoated, or Copper Fins					
Quantity	1			2		
Rows...Fins/m	4...590			3...590		
Total Face Area (sq m)	3.09			5.42		
CONDENSER FAN	Propeller Type					
Nominal L/s 60 Hz/50 Hz	6330/5470			12,770/11,740		
Quantity...Diameter (mm)	2...762			4...762		
Motor kW	.75			.75		
EVAPORATOR COIL	Cross-Hatched 3/8" Copper Tubes, Aluminum Plate Fins, Intertwined Circuits					
Rows...Fins/mm	4...590			3...590		
Total Face Area (sq m)	2.94			3.22		
EVAPORATOR FAN	Centrifugal Type					
Quantity...Size (mm)	2...508 × 381			4...508 × 381		
Type Drive	Belt			Belt		
Nominal L/s 60 Hz/50 Hz	5660/5290			7550/6600		
Motor kW	7.46	11.19††	14.92	11.19	14.92††	18.65
Motor Frame Size	215T	254T	256T	254T	256T	284T
Motor Bearing Type	Ball			Ball		
Maximum Allowable r/s	20			20		
Motor Pulley Pitch Diameter (mm)	163	175	191	175	206	231
Nominal Motor Shaft Diameter (mm)	35	41	41	41	41	48
Fan Pulley Pitch Diameter (mm)	318	282	282	318	348	348
Nominal Fan Shaft Diameter (mm)	34			34		
Belt, Quantity...Type	1...BX60	1...5VX590	1...5VX600	1...5VX630	1...5VX670	1...5VX680
Belt Length (mm)	1600	1499	1524	1600	1702	1727
Pulley Center Line Distance (mm)	396-467	381-455	381-455	381-455	381-455	371-447
Factory Speed Setting (r/s) 60 Hz/50 Hz	14.9/12.4	18.1/15.1	19.7/16.4	16.1/13.4	17.3/14.4	19.4/16.2
HIGH-PRESSURE SWITCH (kPa)						
Cutout	2951			2951		
Reset (Auto.)	2206			2206		
LOW-PRESSURE SWITCH (kPa)						
Cutout	48			48		
Reset (Auto.)	152			152		
RETURN-AIR FILTERS						
Quantity...Size (mm)	10...508 x 610 x 51			10...508 x 610 x 51		
OUTDOOR-AIR FILTERS						
Quantity...Size (mm)	8...406 × 635 4...508 × 635					
POWER EXHAUST						
Motor Quantity...kW	Direct Drive, 3-Speed, Single Phase Motor (Factory Wired For High Speed) and Forward Curved Fan					
Fan, Diameter...Width (mm)	4...0.75 279...254					

LEGEND

Al — Aluminum
Bhp — Brake Horsepower
Cu — Copper

NOTE: See Tables 2A and 2B for optional evaporator fan motor data.

*Weight of unit does not include variable frequency drive (VFD). If a VFD is installed, add the VFD weight in the table at right.

†Evaporator coil fin material/condenser coil fin material.

**Sizes 024-034: Circuit 1 uses the lower portion of condenser coil, Circuit 2 uses the upper portion. Size 044: Circuit 1 uses the left condenser coil, Circuit 2 the right. All units have intertwined evaporator coils.

††Motor and drive shown will deliver approximately 17.2 kPa (2.5 in. wg) net external static. For more drive information, see Tables 2A and 2B.

VFD (kW)	VFD WEIGHTS (kg)
	380 v and 400 v
3.73	9.98
5.60	16.78
7.46	27.67
11.19	28.58
14.92	50.35
18.65	50.80

Table 1B — Physical Data (English)

UNIT 50EJ,EK,EW,EY	024	028	030
NOMINAL CAPACITY (tons) 60 Hz/50 Hz	20/19	25/23	27/26
OPERATING WEIGHT (lb)* Unit			
Al/Al†	4016	4102	4102
Al/Cu†	4236	4322	4322
Roof Curb (14-in. curb)	365	365	365
COMPRESSOR			
Type Ckt 1	06D328	06D328	06D537
Ckt 2	06D818	06D328	06D328
Number of Refrigerant Circuits	2	2	2
Oil (oz) (Ckt 1, Ckt 2)	115, 88	115 ea.	115 ea.
REFRIGERANT TYPE		R-22	
Operating Charge (lb-oz)			
Circuit 1**	25-0	25-0	25-0
Circuit 2	31-0	25-0	25-0
CONDENSER COIL	Cross-Hatched 3/8" Copper Tubes, Aluminum Lanced, Aluminum Precoated or Copper Fins		
Quantity	1	1	1
Rows...Fins/in.	4...15	4...15	4...15
Total Face Area (sq ft)	33.3	33.3	33.3
CONDENSER FAN		Propeller Type	
Nominal Cfm 60 Hz/50 Hz	13,420/11,590	13,420/11,590	13,420/11,590
Quantity...Diameter (in.)	2...30	2...30	2...30
Motor Hp (1075 Rpm)	1	1	1
EVAPORATOR COIL	Cross-Hatched 3/8" Copper Tubes, Aluminum Plate Fins, Intertwined Circuits		
Rows...Fins/in.	4...15	4...15	4...15
Total Face Area (sq ft)	31.7	31.7	31.7
EVAPORATOR FAN		Centrifugal Type	
Quantity...Size (in.)	2...20x15	2...20x15	2...20x15
Type Drive	Belt	Belt	Belt
Nominal Cfm 60 Hz/50 Hz	8,000/7,500	10,000/9,200	11,000/10,200
Motor Hp	5 10†† S184T 15 S254T	7.5 10†† S213T 15 S254T	10 15†† S215T 20 256T
Motor Frame Size			
Motor Bearing Type	Ball	Ball	Ball
Maximum Allowable Rpm	1200	1200	1200
Motor Pulley Pitch Diameter	4.6 6.6 6.9	4.9 6.1 7.1	6.6 6.7 7.5
Nominal Motor Shaft Diameter (in.)	1 1/8 1 3/8 1 5/8	1 3/8 1 3/8 1 5/8	1 3/8 1 3/8 1 5/8
Fan Pulley Pitch Diameter (in.)	11.1 12.5 11.1	11.1 11.1 11.1	13.7 11.1 11.1
Nominal Fan Shaft Diameter (in.)	1 1/16	1 1/16	1 1/16
Belt, Quantity...Type	1...BX59 62	1...BX56 59	1...BX62 65
Belt, Length (in.)	1...BX60 63	1...BX56 59	1...5VX590 59
Pulley Center Line Distance (in.)	1...5VX590 60	1...5VX590 60	1...5VX600 60
Factory Speed Setting (rpm) 60 Hz/50 Hz	16.0-18.7 725/604	15.6-18.4 773/644	15.6-18.4 843/703
HIGH-PRESSURE SWITCH (psig)			
Cutout	426	426	426
Reset (Auto.)	320	320	320
LOW-PRESSURE SWITCH (psig)			
Cutout	7	7	7
Reset (Auto.)	22	22	22
RETURN-AIR FILTERS			
Quantity...Size (in.)	10...20x24x2	10...20x24x2	10...20x24x2
OUTDOOR-AIR FILTERS			
Quantity...Size (in.)	8...16x25 4...20x25	8...16x25 4...20x25	8...16x25 4...20x25
POWER EXHAUST	Direct Drive, 3-Speed, Single-Phase Motor (Factory-Wired For High Speed) and Forward Curved Fan		
Motor, Quantity...Hp		4...1	
Fan, Diameter...Width (in.)		11...10	

LEGEND

Al — Aluminum
Cu — Copper

*Weight of unit does not include variable frequency drive (VFD), barometric relief, or power exhaust. If a VAV unit (a VFD is installed), add the VFD weight in the table at right.

†Evaporator coil fin material/condenser coil fin material.

**Sizes 024-034: Circuit 1 uses the lower portion of condenser coil, Circuit 2 uses the upper portion. Size 044: Circuit 1 uses the left condenser coil, Circuit 2 the right. All units have intertwined evaporator coils.

††Motor and drive shown will deliver approximately 2.5 in. wg net external static. For more drive information, see Tables 2A and 2B.

NOTE: See Tables 2A and 2B for optional evaporator fan motor data.

VFD (Hp)	VFD WEIGHTS (lb)
	380 v and 400 v
5	22
7.5	37
10	61
15	63
20	111
25	112

Table 1B — Physical Data (English) (cont)

UNIT 50EJ,EK,EW,EY	034	044
NOMINAL CAPACITY (tons) 60 Hz/50 Hz	30/28	40/35
OPERATING WEIGHT (lb)*		
Unit		
Al/Al†	4102	4508
Al/Cu†	4322	4793
Roof Curb (14-in. curb)	365	410
COMPRESSOR		
Type Ckt 1	06D537	06EA250
Ckt 2	06D537	06EA250
Number of Refrigerant Circuits	2	2
Oil (oz) (Ckt 1, Ckt 2)	115 ea.	224 ea.
REFRIGERANT TYPE	R-22	
Operating Charge (lb-oz)		
Circuit 1**	25-0	35-0
Circuit 2	25-0	35-0
CONDENSER COIL	Cross-Hatched 3/8" Copper Tubes, Aluminum Lanced, Aluminum Precoated or Copper Fins	
Quantity	1	2
Rows...Fins/in.	4...15	3...15
Total Face Area (sq ft)	33.3	58.3
CONDENSER FAN	Propeller Type	
Nominal Cfm 60 Hz/50 Hz	13,420/11,590	27,064/24,880
Quantity...Diameter (in.)	2...30	4...30
Motor Hp (1075 Rpm)	1	1
EVAPORATOR COIL	Cross-Hatched 3/8" Copper Tubes, Aluminum Plate Fins, Intertwined Circuits	
Rows...Fins/in.	4...15	3...15
Total Face Area (sq ft)	31.7	34.7
EVAPORATOR FAN	Centrifugal Type	
Quantity...Size (in.)	2...20x15	4...20x15
Type Drive	Belt	Belt
Nominal Cfm 60 Hz/50 Hz	12,000/11,200	16,000/14,000
Motor Hp	10 15†† 20	15 20†† 25
Motor Frame Size	S215T S254T S256T	S254T S256T S284T
Motor Bearing Type	Ball	Ball
Maximum Allowable Rpm	1200	1200
Motor Pulley Pitch Diameter	6.4	6.9
Nominal Motor Shaft Diameter (in.)	13/8	15/8
Fan Pulley Pitch Diameter (in.)	12.5	11.1
Nominal Fan Shaft Diameter (in.)	11/16	11/16
Belt, Quantity...Type	1...BX60	1...5VX590 1...5VX600
Belt, Length (in.)	63	63 60
Pulley Center Line Distance (in.)	15.6-18.4	15.0-17.9
Factory Speed Setting (rpm) 60 Hz/50 Hz	896/747	1088/907 1182/985
HIGH-PRESSURE SWITCH (psig)		
Cutout	426	426
Reset (Auto.)	320	320
LOW-PRESSURE SWITCH (psig)		
Cutout	7	7
Reset (Auto.)	22	22
RETURN-AIR FILTERS		
Quantity...Size (in.)	10...20x24x2	10...20x24x2
OUTDOOR-AIR FILTERS		
Quantity...Size (in.)	8...16x25 4...20x25	8...16x25 4...20x25
POWER EXHAUST	Direct Drive, 3-Speed, Single-Phase Motor (Factory-Wired For High Speed) and Forward Curved Fan	
Motor, Quantity...Hp	4...1	
Fan, Diameter...Width (in.)	11...10	

LEGEND

Al — Aluminum
Cu — Copper

*Weight of unit does not include variable frequency drive (VFD), barometric relief, or power exhaust. If a VAV unit (a VFD is installed), add the VFD weight in the table at right.

†Evaporator coil fin material/condenser coil fin material.

**Sizes 024-034: Circuit 1 uses the lower portion of condenser coil, Circuit 2 uses the upper portion. Size 044: Circuit 1 uses the left condenser coil, Circuit 2 the right. All units have intertwined evaporator coils.

††Motor and drive shown will deliver approximately 2.5 in. wg net external static. For more drive information, see Tables 2A and 2B.

NOTE: See Tables 2A and 2B for optional evaporator fan motor data.

VFD (Hp)	VFD WEIGHTS (lb)
	380 v and 400 v
5	22
7.5	37
10	61
15	63
20	111
25	112

Table 2A — Evaporator Fan Motor Data (SI)

UNIT SIZE 50E	MOTOR KW	MOTOR SHAFT DIAMETER (mm)	FAN SHAFT SPEED, 50/60 Hz (r/s)	MOTOR SHEAVE	MOTOR SHEAVE PITCH DIAMETER (mm)	BUSHING DIAMETER (mm)	FAN SHEAVE	FAN SHEAVE PITCH DIAMETER (mm)	BUSHING DIAMETER (mm)	BELT	OUTSIDE BELT LENGTH	BELT TENSION (Newtons at 6 mm)
024	3.73	28	10.1/12.1	BK52	117	None-29	1B5V110	282	B-43	BX59	1575	22.33
	7.46	35	12.8/15.4	BK72	168	None-35	1B5V124	318	B-43	BX60	1600	31.36
	11.19	41	15.1/18.1	1B5V68	175	B-41	1B5V110	282	B-43	5VX590	1499	41.72
028	5.60	35	10.8/12.9	BK55H	124	H-35	1B5V110	282	B-43	BX56	1499	30.56
	7.46	35	13.3/16.0	BK67H	155	H-35	1B5V110	282	B-43	BX56	1499	32.29
	11.19	41	15.6/18.7	1B5V70	180	B-41	1B5V110	282	B-43	5VX590	1499	40.79
030	7.46	35	11.8/14.1	BK72	168	None-35	1B5V136	348	B-43	BX62	1651	30.96
	11.19	41	14.7/17.6	1B5V66	170	B-41	1B5V110	282	B-43	5VX590	1499	42.70
	14.92	41	16.4/19.7	1B5V74	191	B-41	1B5V110	282	B-43	5VX600	1524	51.91
034	7.46	35	12.4/14.9	BK70H	163	H-35	1B5V124	318	B-43	BX60	1600	32.03
	11.19	41	15.1/18.1	1B5V68	175	B-41	1B5V110	282	B-43	5VX590	1499	41.72
	14.92	41	16.4/19.7	1B5V74	191	B-41	1B5V110	282	B-43	5VX600	1524	49.69
044	11.19	41	13.4/16.1	1B5V68	175	B-41	1B5V124	318	B-43	5VX630	1600	42.44
	14.92	41	14.4/17.3	1B5V80	206	B-41	1B5V136	348	B-43	5VX670	1702	46.13
	18.65	48	16.2/19.4	1B5V90	231	B-48	1B5V136	348	B-43	5VX680	1727	48.40

NOTE: Motor shaft speed is 29.2 r/s. The fan shaft diameter is 26 mm.

Table 2B — Evaporator Fan Motor Data (English)

UNIT SIZE 50E	MOTOR HP	MOTOR SHAFT DIAMETER (in.)	FAN SHAFT SPEED, 60/50 Hz (rpm)	MOTOR SHEAVE	MOTOR SHEAVE PITCH DIAMETER (in.)	BUSHING DIAMETER (in.)	FAN SHEAVE	FAN SHEAVE PITCH DIAMETER (in.)	BUSHING DIAMETER (in.)	BELT	OUTSIDE BELT LENGTH	BELT TENSION (Lb at .24 in. wg)
024	5	1.12	725/604	BK52	4.6	None-1.125	1B5V110	11.1	B-1.6875	BX59	62	5.02
	10	1.38	924/770	BK72	6.6	None-1.375	1B5V124	12.5	B-1.6875	BX60	63	7.05
	15	1.62	1088/907	1B5V68	6.9	B-1.625	1B5V110	11.1	B-1.6875	5VX590	59	9.38
028	7.5	1.38	773/644	BK55H	4.9	H-1.375	1B5V110	11.1	B-1.6875	BX56	59	6.87
	10	1.38	962/802	BK67H	6.1	H-1.375	1B5V110	11.1	B-1.6875	BX56	59	7.26
	15	1.62	1119/933	1B5V70	7.1	B-1.625	1B5V110	11.1	B-1.6875	5VX590	59	9.17
030	10	1.38	843/703	BK72	6.6	None-1.375	1B5V136	13.7	B-1.6875	BX62	65	6.96
	15	1.62	1056/880	1B5V66	6.7	B-1.625	1B5V110	11.1	B-1.6875	5VX590	59	9.60
	20	1.62	1182/985	1B5V74	7.5	B-1.625	1B5V110	11.1	B-1.6875	5VX600	60	11.67
034	10	1.38	896/747	BK70H	6.4	H-1.375	1B5V124	12.5	B-1.6875	BX60	63	7.20
	15	1.62	1088/907	1B5V68	6.9	B-1.625	1B5V110	11.1	B-1.6875	5VX590	59	9.38
	20	1.62	1182/985	1B5V74	7.5	B-1.625	1B5V110	11.1	B-1.6875	5VX600	60	11.17
044	15	1.62	1066/888	1B5V68	6.9	B-1.625	1B5V124	12.5	B-1.6875	5VX630	63	9.54
	20	1.62	1035/862	1B5V80	8.1	B-1.625	1B5V136	13.7	B-1.6875	5VX670	67	10.37
	25	1.88	1162/968	1B5V90	9.1	B-1.875	1B5V136	13.7	B-1.6875	5VX680	68	10.88

NOTE: Motor shaft speed is 1750 rpm. The fan shaft diameter is 1¹³/₁₆ inches.

ROOF MOUNT — Check building codes for weight distribution requirements.

Step 3 — Field Fabricate Ductwork — Secure all ducts to building structure. Use flexible duct connectors between unit and ducts as required. Insulate and weatherproof all external ductwork, joints, and roof openings with counter flashing and mastic in accordance with applicable codes.

Ducts passing through an unconditioned space must be insulated and covered with a vapor barrier.

To attach ductwork to roof curb, insert ductwork approximately 254 to 279 mm (10 to 11 in.) up into the curb. Connect ductwork to 14-gage roof curb material using sheet metal screw driven from inside the duct.

The units with electric heat require a 25 mm (1-in.) clearance for the first 610 mm (24 in.) of ductwork.

NOTE: A 90-degree elbow must be provided in the ductwork to comply with UL (Underwriters' Laboratories, U.S.A. Standard) codes for use with electric heat.

Outlet grilles must not lie directly below unit discharge.

All CV (constant volume) units are equipped with a supply air thermistor located in the indoor fan compartment. The sensor is used to measure supply-air temperature for economizer control.

Step 4 — Make Unit Duct Connections

50EJ,EK UNITS — Unit is shipped for through-the-bottom duct connections. Ductwork openings are shown in Fig. 3 and 4. **Attach all ductwork to roof curb.** Air distribution is shown in Fig. 8. Refer to installation instructions shipped with accessory roof curb for more information.

50EW,EY UNITS — Remove shipping covers from supply and return air openings. Attach field-supplied ductwork to unit. Use a single duct over **both** return openings and a single duct over both supply openings. See Fig. 5 and 6 for duct opening dimensions. Secure all ducts to the building structure. See Fig. 9. Use flexible duct connectors between unit and ducts as required.

Install accessory barometric relief or power exhaust in the field-fabricated return ductwork. Refer to Position Power Exhaust/Barometric Relief Damper Hood Section on page 28 for more information.

Step 5 — Trap Condensate Drain — See Fig. 3-6 and 10 for drain location. Condensate drain is open to the atmosphere and must be trapped. Install a trapped drain at the drain location. One 1-in. FPT coupling is provided inside unit evaporator section for condensate drain connection. A trap at least 102 mm (4-in.) deep must be used. Trap must be installed to prevent freeze-up.

Condensate pans are sloped so that water will completely drain from the condensate pan to comply with indoor air quality guidelines.

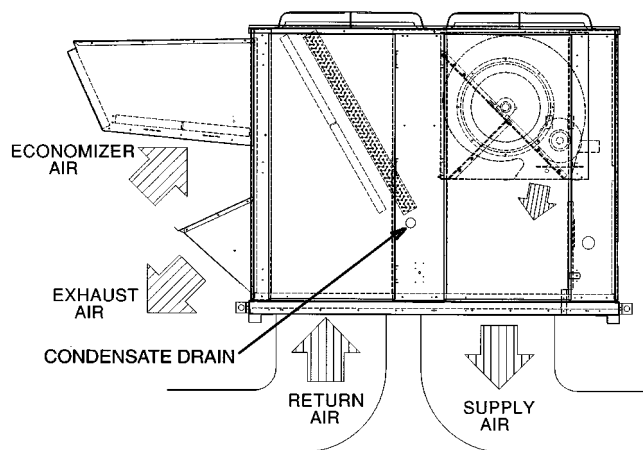


Fig. 8 — Air Distribution — Thru-the-Bottom


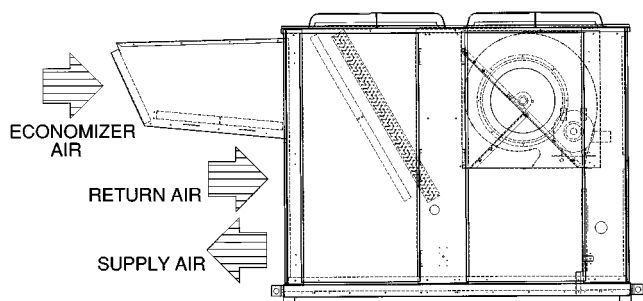


Fig. 9 — Air Distribution — Thru-the-Side

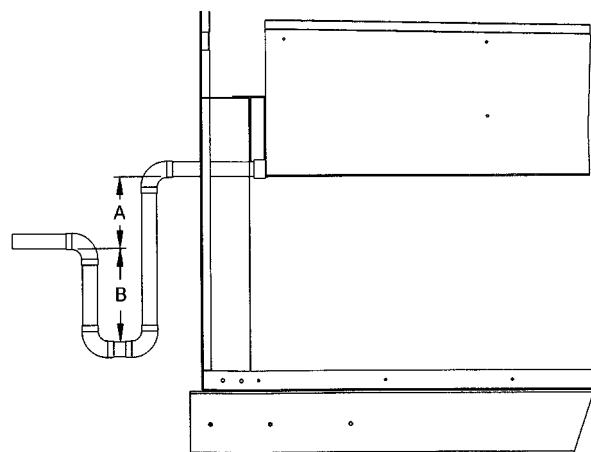

DIM.	LENGTH	
	mm	in.
A	76	3
B	102	4

**Fig. 10 — Condensate Drain Connections
(Typical Roof Curb or Slab Mount Shown)**

Step 6 — Controls Options — The control options that the units can provide are based on the following parameters: CV (constant volume) or VAV (variable air volume) operation; stand-alone unit with field-supplied sensors installed (CV or VAV); as a system via the Carrier Comfort System (TEMP or VVT®); optional electronic expansion board

installed (CV or VAV); linked to the Carrier Comfort Network; and availability of a computer and software (Comfort Works, Building Supervisor, and Service Tool) to access the base control board. See Table 3.

NOTE: Access to the base control board allows unit occupancy schedules, unit timeclock, and various set points to be changed from their factory-defined default settings.

CONSTANT VOLUME APPLICATIONS — The standard CV unit is capable of being operated with either a Carrier-approved thermostat or a field-supplied sensor. (See Price Pages for ordering information.)

Features with Thermostat Control of Unit

- two-stage heating (if installed)
- two-stage cooling
- control of unit using Y1, Y2, W1, W2, and G thermostat inputs
- control of the indoor fan
- outdoor air temperature/supply air temperature monitoring
- control of an outdoor air condenser fan based on outdoor air temperature
- control of modulating economizer damper to provide free cooling when outdoor conditions are suitable, using supply air temperature as a control point
- control of the economizer damper and indoor fan to obtain unoccupied free cooling
- provide power exhaust output to an external power exhaust controller
- support a field test for field checkout
- control of 2 stages of CV power exhaust
- compressor Time Guard® (power up and minimum off and on times)

Additional features are provided by accessing the standard unit control board via software with a computer. These features are:

- electronic expansion board features (if installed)
- compressor lockout during low supply air temperature
- control board diagnostics
- ability to change supply air set point (economizer control)
- ability to change high outdoor air temperature lockout set point (economizer control)
- ability to change power exhaust set points

NOTE: A CV unit without a thermostat requires a field-supplied sensor for operation.

Features with Sensor Control of Unit (Stand-Alone Applications) — Unit control is limited to CV unoccupied default set points, 32 C (90 F) for cooling, 13 C (55 F) for heating. There are 3 sensor options available:

- T57 sensor will monitor room temperature
- T55 sensor will monitor room temperature and provide unoccupied override capability (1 hour)
- T56 sensor will monitor room temperature, provide unoccupied override capability (1 hour), and provide a temperature offset of 3° C (5° F).

Standard features are:

- support of remote occupied/unoccupied input to start and stop the unit
- cooling capacity control of 3 stages using economizer and 2 compressors to maintain space temperature to an occupied or unoccupied set point
- enable heating (if installed) or cooling during unoccupied periods as required to maintain space temperature within the unoccupied set points
- adjustment of space temperature set points of $\pm 3^{\circ}$ C (5° F) when using a T56 sensor

Table 3 — Controls Options and Configurations (Non-Thermostat Applications)

UNIT CONFIGURATION	DEFAULT COOLING	DEFAULT HEATING
UNITS RUNNING VERSION 1.0 UNIT CONTROL SOFTWARE		
CV or VAV Unit with SPT Sensor	Unoccupied Cooling — 32 C (90 F) (SPT) Occupied Cooling — NA	Unoccupied Heating — 13 C (55 F) (SPT) Occupied Heating — NA
CV Unit with SPT Sensor and Remote Start/Stop Switch	Unoccupied Cooling — 32 C (90 F) (SPT) Occupied Cooling — 26 C (78 F) (SPT)	Unoccupied Heating — 13 C (55 F) (SPT) Occupied Heating — 20 C (68 F) (SPT)
VAV Unit Remote Start/Switch Only	Unoccupied Cooling — NA Occupied Cooling — 13 C (55 F) (SAT)	Unoccupied Heating — NA Occupied Heating — NA
VAV Unit with SPT Sensor and Remote Start/Stop Switch	Unoccupied Cooling — 32 C (90 F) (SPT) Occupied Cooling — 13 C (55 F) (SAT)	Unoccupied Heating — 13 C (55 F) (SPT) Occupied Heating — NA
UNITS RUNNING VERSION 2.0 UNIT CONTROL SOFTWARE		
CV or VAV Unit with SPT Sensor	Unoccupied Cooling — 32 C (90 F) (SPT) Occupied Cooling — NA	Unoccupied Heating — 13 C (55 F) (SPT) Occupied Heating — NA
CV Unit with SPT Sensor and Remote Start/Stop Switch	Unoccupied Cooling — 32 C (90 F) (SPT) Occupied Cooling — 26 C (78 F) (SPT)	Unoccupied Heating — 13 C (55 F) (SPT) Occupied Heating — 20 C (68 F) (SPT)
VAV Unit Remote Start/Stop Switch Only	Unoccupied Cooling — 32 C (90 F) (RAT) Occupied Cooling — 13 C (55 F) (SAT)	Unoccupied Heating — 13 C (55 F) (RAT) Occupied Heating — 20 C (68 F) (RAT)*
VAV Unit with SPT Sensor and Remote Start/Stop Switch	Unoccupied Cooling — 32 C (90 F) (SPT) Occupied Cooling — 13 C (55 F) (SAT)	Unoccupied Heating — 13 C (55 F) (SPT) Occupied Heating — 20 C (68 F) (RAT)*

LEGEND

CV — Constant Volume	SAT — Supply-Air Temperature
NA — Not Available	SPT — Space Temperature
RAT — Return-Air Temperature	VAV — Variable Air Volume

*With DIP Switch No. 5 configured to OPEN (Occupied Heat Enabled).

NOTE: Space temperature sensor and remote stop/switch are field-supplied.

Features with sensor control of unit are:

- 365-day timeclock with backup (supports minute, hour, day of week, date, month, and year)
- daylight savings time function
- occupancy control with 8 periods for unit operation
- holiday table containing up to 18 holiday schedules
- ability to initiate timed override from T55 or T56 sensors
- ability to use multiple space temperature sensors to average the space temperature
- supply air temperature reset for the supply air temperature set point
- temperature compensated start to calculate early start times before occupancy
- access to the Display, Maintenance, Configuration, Service, and Set Point data table through network software

When the unit is equipped with a field-supplied space temperature sensor and a remote contact closure (remote start/stop) on the base control board, the occupied default set points will monitor unit operation. The occupied default set points are 26 C (78 F) cooling and 20 C (68 F) heating (if electric heat is installed). See Fig. 11 for remote start/stop wiring.

NOTE: For units (with a field-supplied space temperature sensor) which have not had the base unit control board accessed via software to set an occupancy schedule, the remote start/stop closure will allow the unit to operate in the pre-configured occupied default set points (based on return-air temperature) of 26 C (78 F) cooling and 20 C (68 F) heating. Without this feature, the unit will control to the unoccupied default set points of 32 C (90 F) cooling and 13 C (55 F) heating (if electric heat is installed).

An electronic expansion board may be field-installed to provide the following features:

- control of modulating economizer damper to maintain indoor air quality (IAQ) when outdoor conditions are suitable
- provide discrete inputs for fan status, filter status, field-applied status, and demand limit
- provide an output for the external alarm light indicator

When the unit is connected to the CCN (Carrier Comfort Network), the following expansion board features can be utilized.

- perform Demand Limit functions based on CCN loadshed commands or the state of the discrete input
- alarm monitoring of all key parameters
- CCN protocol
- provides power exhaust fire outputs for direct control of modulated power exhaust stages during fire or smoke modes
- smoke control modes including evacuation, smoke purge, pressurization, and fire shutdown (modulating power exhaust required)
- provides CCN IAQ participation


See Carrier TEMP or VVT® (Variable Volume and Temperature) literature for complete TEMP (single zone) or VVT (multi-zone) application information.

Features with Sensor Control of Unit (Network Applications) — The base control board provides, as standard, a connection for use with a Carrier VVT system and can also be integrated into a Carrier Comfort Network.

When the unit is accessed via a PC equipped with Comfort Works, Building Supervisor, or Service Tool, the following features can be accessed:

- on-board timeclock can be programmed
- occupancy schedules can be programmed
- unit set points can be changed
- alarms can be monitored

This access is available on the base control board via a RJ-11 phone jack or a 3-wire connection to the communication bus. See Fig. 12. The timeclock has a 10-hour minimum back-up time to provide for unit power off for servicing unit or during unexpected power outages. For complete Carrier Comfort System (CCS) or Carrier Comfort Network (CCN) features and benefits, refer to the product literature.

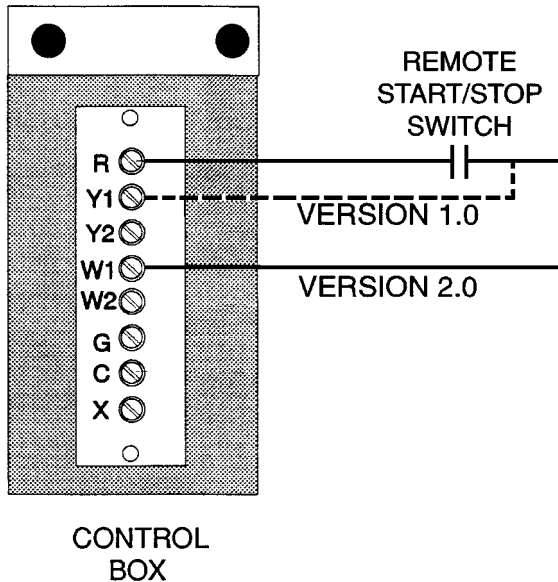

NOTE: On units running Version 1.0 of the Unit Control Software, the remote start/stop switch is connected to R and Y1. On units running Version 2.0 of the Unit Control Software, the remote start/stop switch is connected to R and W1.

Fig. 11 — Field Control Remote Start/Stop (CV or VAV Units)

VARIABLE AIR VOLUME (VAV) APPLICATIONS

Features with Stand-Alone Applications — A VAV unit is capable of providing unoccupied cooling controlling to a 32 C (90 F) return-air temperature utilizing the factory-supplied return-air thermistor located below the return-air damper in the return-air section for unit control. The unit will provide unoccupied heating (if electric heat is installed)


controlling to a 13 C (55 F) space temperature with a field-supplied sensor (Version 1.0) or 13 C (55 F) return-air temperature (Version 2.0). Also provided is a morning warm-up which is initiated by the Occupied mode (if electric heat is installed) and continues until the return-air temperature rises to 20 C (68 F). The unit will provide occupied cooling with a default temperature of 13 C (55 F) for the supply air. The supply-air temperature is measured by the supply-air thermistor, located in the indoor fan compartment.

Standard features of a VAV unit with a remote start/stop switch are:

- control of an outdoor condenser fan based upon outdoor air temperature
- control of modulating economizer to provide free cooling when outdoor conditions are suitable, using supply air temperature as a set point
- support of remote occupied/unoccupied input to start or stop the unit
- provide power exhaust output to an external power exhaust controller
- support supply air temperature reset to offset supply air set point
- support a field test for field check out
- support linkage to DAV (digital air volume) systems
- cooling capacity control of 6 stages plus economizer with compressors and unloaders to maintain supply air temperature set point during occupied periods
- control of one stage of heat to maintain supply air temperature at supply air set point during occupied periods
- provide a variable frequency drive (VFD) high voltage relay output to enable VFD
- control of heat interlock relay
- compressor Time Guard® override (power up, minimum off and on times)

With the addition of a remote start/stop switch heating or cooling is enabled during unoccupied periods as required to maintain space temperature to within unoccupied set points.

DIP SWITCHES

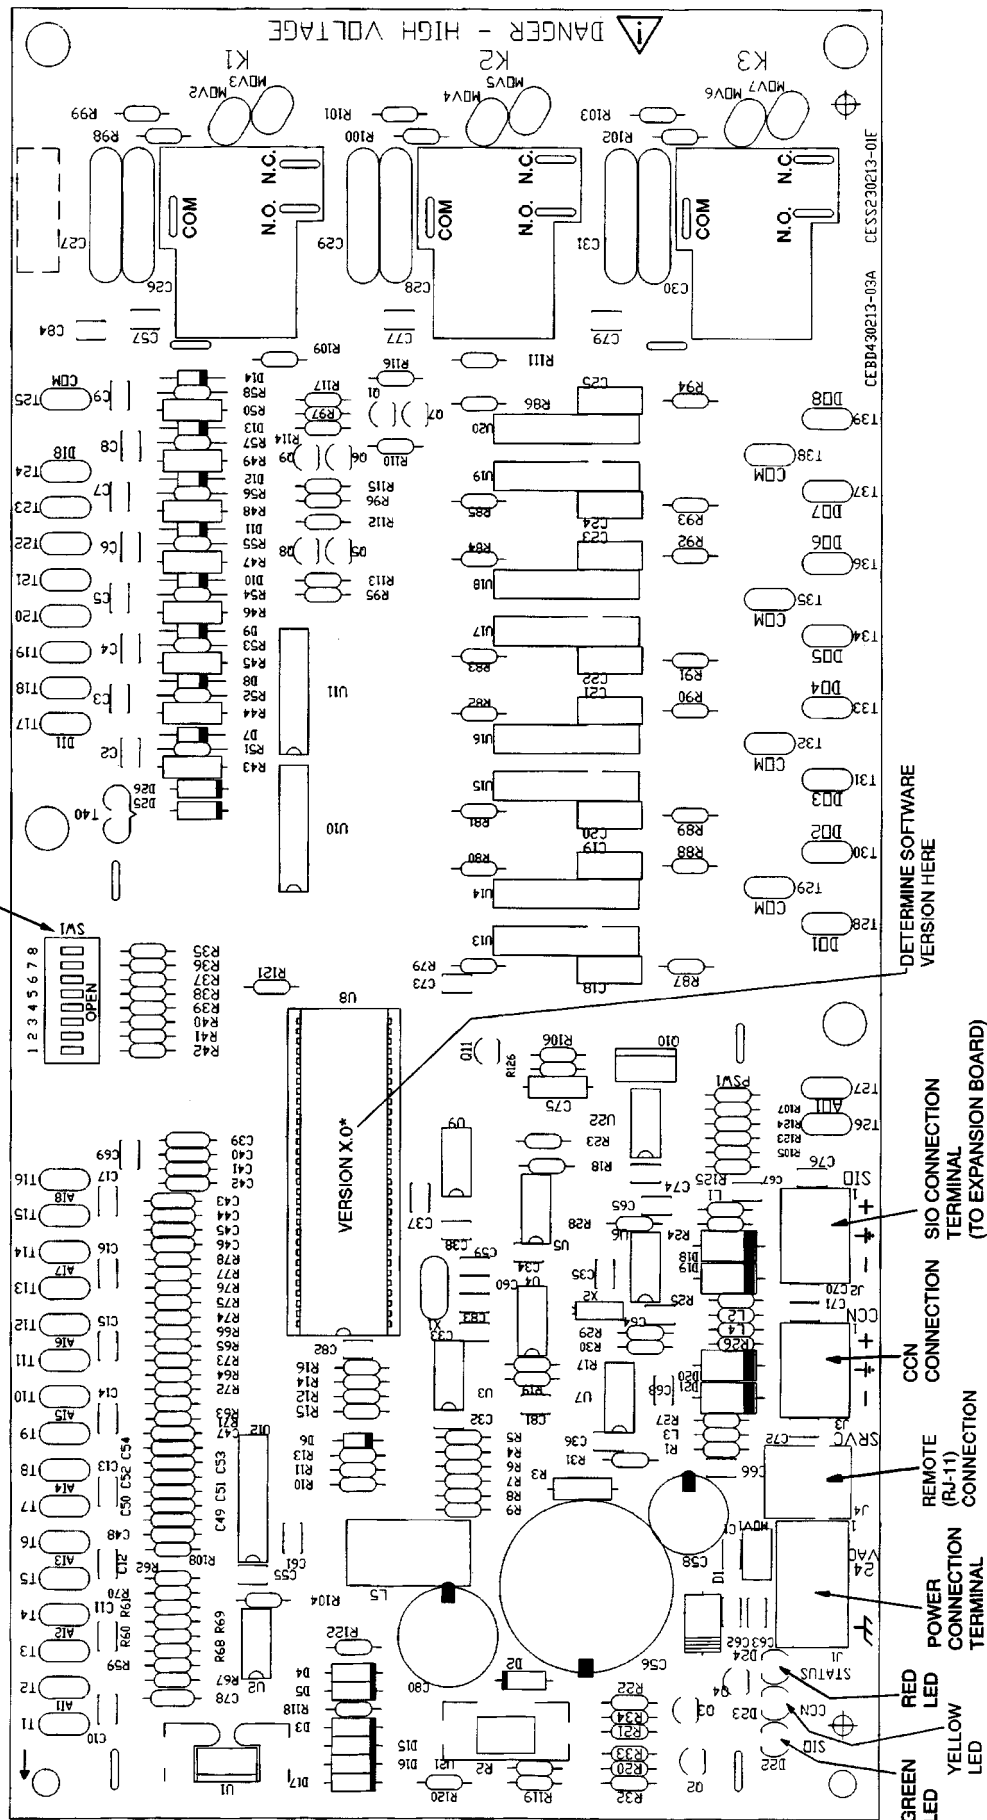

For units running Version 1.0 of the unit control software, network access software is required to enable occupied heating. For units running Version 2.0 of the unit control software, occupied heating is enabled or disabled by the position of DIP (dual in-line package) switch no. 5.

Additional features may be provided with electronic access to unit control board. These features are:

- control board diagnostics
- compressor Time Guard® override (power up, minimum off and on times)
- compressor lockout during low supply-air temperature
- electronic expansion board features (if installed)
- control of the economizer damper and indoor fan to option unoccupied free cooling
- 365-day timeclock with backup (supports minute, hour, day, month, and year)
- holiday table containing up to 18 holiday schedules
- occupancy control with 8 periods for unit operation
- support a set of display, maintenance, configuration, service, and set point data tables for interface with Building Supervisor, Comfort Works, or Service Tool

When a VAV unit with a space temperature sensor is accessed via a computer, the following additional features are available:

- ability to initiate timed override from T55 sensors
- ability to use multiple space temperature sensors to average space temperature
- temperature compensated start to calculate early start time before occupancy
- provide space temperature reset to reset the supply air set point upward when the temperature falls below the occupied cooling set point

An electronic expansion board may be field-installed to provide the following features:

- fan status
- filter status
- field-applied status
- demand limiting
- IAQ (indoor air quality) sensor
- OAQ (outdoor air quality) sensor
- alarm light

When the unit is connected to the CCN (Carrier Comfort Network), the following expansion board features can be utilized:

- CCN IAQ participation
- CCN OAQ participation
- CCN demand limit participation
- fire unit shutdown
- fire pressurization
- fire evacuation
- fire smoke purge
- modulated power exhaust override

A field-supplied space temperature sensor can be added to provide the following:

- T57 sensor will monitor room temperature
- T55 sensor will monitor room temperature and provide unoccupied override capability (1 hour)

When the unit is equipped with a field-supplied space temperature sensor and a remote contact closure (remote start/stop), the occupied default set points will monitor unit operation. The occupied default set points are 13 C (55 F) (supply air) cooling and 20 C (68 F) (return air temperature) heating (if electric heat is installed). See Fig. 11 for remote start/stop wiring.

NOTE: For units without a space temperature sensor and which have not had the base unit control board accessed via software to set an occupancy schedule, the remote start/stop closure will allow the unit to operate in the pre-configured occupied default set points of 13 C (55 F) (supply-air temperature)

cooling and 20 C (68 F) (return-air temperature) heating (Version 2.0 of unit control software). Without an occupancy schedule, the unit will control to the unoccupied default set points of 32 C (90 F) (return air) cooling and 13 C (55 F) (return air) heating (if electric heat is installed) (Version 2.0 of unit control software).

Features with Network Applications — The base control board provides, as standard, a connection for use with a Carrier Comfort System and can also be integrated into a Carrier Comfort Network. When the unit is accessed via a PC equipped with Comfort Works, Building Supervisor, or Service Tool software, the following features can be accessed:

- on-board timeclock can be programmed
- occupancy schedules can be programmed
- unit set points can be changed
- alarms can be monitored

This access is available on the base control board via a RJ-11 phone jack or a 3-wire connection to the communication bus. See Fig. 12. The timeclock has a 10-hour minimum back-up time to provide for unit power off for servicing unit or during unexpected power outages. For complete Carrier Comfort System (CCS) or Carrier Comfort Network (CCN) features and benefits, refer to the product literature.

Step 7 — Make Electrical Connections

POWER WIRING — Units are factory wired for the voltage shown on the unit nameplate. The main terminal block is suitable for use with aluminum or copper wires and is sized for single-point electric heat.

When installing units, provide a disconnect per local codes of adequate size (MOCP [maximum overcurrent protection] of unit is on the informative plate). All field wiring must comply with all local codes. Size wire based on MCA (minimum circuit amps) on the unit informative plate. See Fig. 13 for power wiring connections to the unit power terminal block and equipment ground.

The main power terminal block is suitable for use with aluminum or copper wire. See Fig. 13. Units have circuit breakers for compressors, fan motors, and control circuit. If required by local codes, provide an additional disconnect, per local codes requirements, of adequate size (Table 4). Whenever external electrical sources are used, unit must be electrically grounded in accordance with local codes.

All field wiring must comply with local code requirements.

FIELD POWER SUPPLY — Unit is factory wired for voltage shown on nameplate. See Table 4 for electrical data.

Field wiring can be brought into the unit from bottom (through basepan and roof curb) or through side of unit (corner post next to control box).

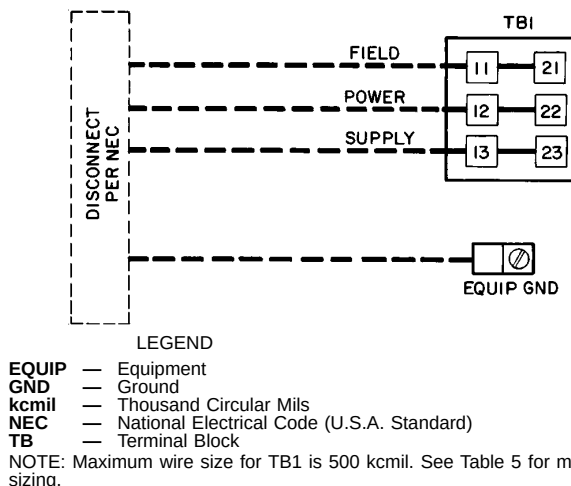


Fig. 13 — Field Power Wiring Connections

A 3½-in. NPT coupling for field power wiring and a ¾-in. NPT coupling for 24-v control wiring are provided in basepan. In the side post, there are two 2½-in. (sizes 024-034) or 3-in. (044) knockouts for the field power wiring. See Fig. 3-6. If control wiring is to be brought in through the side of unit, a 7/8-in. diameter hole is provided in the condenser side post next to the control box.

If disconnect box is mounted to corner post, be careful not to drill any screws into the condenser coil.

Routing Through Bottom of Unit — If wiring is brought in through bottom of unit, use field-supplied watertight conduit to run power wiring from basepan out through bottom 3½-in. hole to the disconnect box and back into unit to the main control box.

Use strain relief going into control box through 2½-in. diameter hole provided. After wires are in unit control box, connect to power terminal block (see Power Wiring section on this page 18).

Low-voltage wiring must be run in watertight conduit from the basepan to control box and through 7/8-in. diameter hole provided in bottom of unit control box. Field-supplied strain relief must be used going into the box. After wiring is in control box, make connections to proper terminals on terminal blocks (see Field Control Wiring section on this page).

Install conduit connector in unit basepan or side panel openings provided. Route power and ground lines through connector to connections in unit control box as shown on unit wiring diagram and Fig. 13.

Routing Through Side of Unit — Route power wiring in field-supplied watertight conduit into unit through 2½- or 3-in. hole. Strain relief (field supplied) must be used in hole. See Fig. 13.

Use field-supplied strain relief going into control box through 2½- or 3-in. diameter hole provided. After wires are in unit control box, connect to power terminal block (see Power Wiring section on page 18).

Bring low-voltage control wiring through factory-drilled 7/8-in. diameter hole in condenser side post. Use strain relief going into 7/8-in. diameter hole in bottom of unit control box.

After wiring is in control box, make connection to proper terminals on terminal blocks (see Field Control Wiring section on this page).

IMPORTANT: The VAV units incorporate VFD (variable frequency drives) which generate, use, and can radiate radio frequency energy. If units are not installed and used in accordance with these instructions, they may cause radio interference. They have been tested and found to comply with limits of a Class A computing device as defined by FCC (Federal Communications Commission, U.S.A. Standard) regulations, Subpart J of Part 15, which are designed to provide reasonable protection against such interference when operated in a commercial environment.

⚠ WARNING

The unit must be electrically grounded in accordance with local codes.

Operating voltage to compressor must be within voltage range indicated on unit nameplate. On 3-phase units, voltages between phases must be balanced within 2% and the current must be balanced within 10%.

Use the formula in Table 4 to determine the percentage of voltage imbalance.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

Unit failure as a result of operation on improper line voltage or excessive phase imbalance constitutes abuse and may cause damage to electrical components.

FIELD CONTROL WIRING — Install either a Carrier-approved accessory thermostat or a CCN (Carrier Comfort Network) compatible temperature sensor. Thermostats are used on CV (constant volume) units only. Control box diagrams are shown in Fig. 14 and 15.

Thermostat Wiring (CV Only) — Install a Carrier-approved accessory thermostat assembly (per current price pages) according to the installation instructions included with the accessory or these instructions. Locate thermostat assembly on a solid wall in the conditioned space to sense average temperature.

Route thermostat cable or equivalent single leads of colored wire from subbase terminals to low-voltage connections as shown on unit label wiring diagram and in Fig. 16.

NOTE: For wire runs up to 15 m (50 ft), use no. 18 AWG (American Wire Gage, U.S.A. Standard) insulated wire (35 C minimum). For 15 to 23 m (50 to 75 ft), use no. 16 AWG insulated wire (35 C minimum). For over 23 m (75 ft), use no. 14 AWG insulated wire (35 C minimum). All wire larger than no. 18 AWG cannot be directly connected to the thermostat and will require a junction box and splice at the thermostat. See Table 5 for European Wire Conversions.

Set heat anticipators settings to 0.1 for all voltages. Settings may be changed slightly to provide a greater degree of comfort for a particular installation.

Sensor Wiring (CV or VAV) — The temperature sensor is wired into the unit control board. See Fig. 17.

The unit is controlled with a T55, T56 (CV only), or T57 zone sensor. Terminal TH on the sensor is connected to T1 of the base module board. Terminal COM on the sensor is connected to T2 on the base module board. If a T56 set point override sensor is used, the override connection SW on the sensor is connected to T3 on the base module board.

VAV units using Version 1.0 of the unit control software may operate without a space temperature sensor during occupied schedules, but unit will not provide unoccupied heating or cooling.

VAV Units — VAV units require a field-supplied heat interlock relay (HIR) to drive the air terminal wide open when in heat mode. The HIR part number is HN61KK041.

Remote Field Control (Units Running Version 1.0 of Unit Control Software) — A switch closure across terminals R and Y1 on TB-3 will initiate the Occupied mode. This can be done manually as well as through a field-supplied timeclock.

Remote Field Control (Units Running Version 2.0 of Unit Control Software) — A switch closure across terminals R and W1 on TB-3 will initiate the Occupied mode. This can be done manually (dry contact closure) as well as through a field-supplied timeclock.

Service Tool, Building Supervisor, and Comfort Works — Access to the control board can be achieved through the terminal marked CCN via a 3-wire bus.

IMPORTANT: Default bus address is 0. Default element number is 1. Refer to CCN literature for information on network addressing or changing CCN communication defaults.

Table 4 — Electrical Data — 50EJ,EK,EW,EY024-044

UNIT 50EJ,EK, EW,EY	NOMINAL VOLTAGE (V-Ph-Hz)	VOLTAGE RANGE		COMPRESSOR				OFM			IFM		POWER EXHAUST		ELECTRIC HEAT*		POWER SUPPLY	
				No. 1		No. 2												
		Min	Max	RLA	LRA	RLA	LRA	Qty	Hp	FLA (ea)	Hp	FLA	FLA	LRA	kW	FLA	MCA	MOCP†
024	380-3-60	342	418	19.9	71	11.5	51	2	1	2.6	5	11	— 23.6	— 41.6	— —	— —	52.6 76.2	70 90
													— 23.6	— 41.6	23 23	34.2 34.2	56.5 86.0	70 90
													— 23.6	— 41.6	45 45	68.4 68.4	99.2 128.7	100 150
													— 23.6	— 41.6	— —	— —	62.3 85.9	80 100
											10	20.7	— 23.6	— 41.6	23 23	34.2 34.2	68.6 98.1	80 100
													— 23.6	— 41.6	45 45	68.4 68.4	111.3 140.8	125 150
													— 23.6	— 41.6	— —	— —	68.6 92.2	80 110
													— 23.6	— 41.6	23 23	34.2 34.2	76.5 106.0	90 110
											15	27	— 23.6	— 41.6	45 45	68.4 68.4	119.2 148.7	125 150
													— 23.6	— 41.6	— —	— —	68.6 92.2	80 110
													— 23.6	— 41.6	23 23	34.2 34.2	76.5 106.0	90 110
													— 23.6	— 41.6	45 45	68.4 68.4	119.2 148.7	125 150
	400-3-50	342	440	19.9	114	11.5	80	2	1	2.8	5	7.9	— 26.0	— 45.8	— —	— —	49.9 75.8	60 90
													— 26.0	— 45.8	25 25	36.1 36.1	55.0 87.4	60 90
													— 26.0	— 45.8	50 50	72.2 72.2	100.1 132.5	110 150
													— 26.0	— 45.8	— —	— —	56.6 82.5	70 100
											10	14.6	— 26.0	— 45.8	25 25	36.1 36.1	63.4 95.8	70 100
													— 26.0	— 45.8	50 50	72.2 72.2	108.5 140.9	110 150
													— 26.0	— 45.8	— —	— —	63.9 89.8	80 100
													— 26.0	— 45.8	25 25	36.1 36.1	72.5 104.9	80 100
											15	21.9	— 26.0	— 45.8	50 50	72.2 72.2	117.6 150.0	125 175
													— 26.0	— 45.8	— —	— —	63.9 89.8	80 100
													— 26.0	— 45.8	25 25	36.1 36.1	72.5 104.9	80 100
													— 26.0	— 45.8	50 50	72.2 72.2	117.6 150.0	125 175
028	380-3-60	342	418	19.9	71	19.9	71	2	1	2.6	7.5	15	— 23.6	— 41.6	— —	— —	64.9 88.5	80 100
													— 23.6	— 41.6	23 23	34.2 34.2	64.9 91.0	80 100
													— 23.6	— 41.6	45 45	68.4 68.4	104.2 133.7	110 150
													— 23.6	— 41.6	— —	— —	70.6 94.2	90 110
											10	20.7	— 23.6	— 41.6	23 23	34.2 34.2	70.6 98.1	90 110
													— 23.6	— 41.6	45 45	68.4 68.4	111.3 140.8	125 150
													— 23.6	— 41.6	— —	— —	76.9 100.5	90 110
													— 23.6	— 41.6	23 23	34.2 34.2	76.9 106.0	90 110
											15	27	— 23.6	— 41.6	45 45	68.4 68.4	119.2 148.7	125 150
													— 23.6	— 41.6	— —	— —	76.9 100.5	90 110
													— 23.6	— 41.6	23 23	34.2 34.2	76.9 106.0	90 110
													— 23.6	— 41.6	45 45	68.4 68.4	119.2 148.7	125 150
	400-3-50	342	440	19.9	114	19.9	114	2	1	2.8	7.5	13	— 26.0	— 45.8	— —	— —	63.3 89.3	80 100
													— 26.0	— 45.8	25 25	36.1 36.1	63.3 93.8	80 100
													— 26.0	— 45.8	50 50	72.2 72.2	106.5 138.9	110 150
													— 26.0	— 45.8	— —	— —	76.9 90.9	90 110
											10	14.6	— 26.0	— 45.8	25 25	36.1 36.1	64.9 95.8	80 110
													— 26.0	— 45.8	50 50	72.2 72.2	108.5 140.9	110 150
													— 26.0	— 45.8	— —	— —	72.2 98.2	90 110
													— 26.0	— 45.8	25 25	36.1 36.1	72.5 104.9	90 110
											15	21.9	— 26.0	— 45.8	50 50	72.2 72.2	117.6 150.0	125 175
													— 26.0	— 45.8	— —	— —	72.2 98.2	90 110
													— 26.0	— 45.8	25 25	36.1 36.1	72.5 104.9	90 110
													— 26.0	— 45.8	50 50	72.2 72.2	117.6 150.0	125 175

NOTE: See legend and notes on page 22.

Table 4 — Electrical Data — 50EJ,EK,EW,EY024-044 (cont)

UNIT 50EJ,EK, EW,EY	NOMINAL VOLTAGE (V-Ph-Hz)	VOLTAGE RANGE		COMPRESSOR				OFM			IFM		POWER EXHAUST		ELECTRIC HEAT*		POWER SUPPLY	
				No. 1		No. 2												
		Min	Max	RLA	LRA	RLA	LRA	Qty	Hp	FLA (ea)	Hp	FLA	FLA	LRA	kW	FLA	MCA	MOCP†
030	380-3-60	342	418	25.6	99	19.9	71	2	1	2.6	10	20.7	— 23.6	— 41.6	— —	— —	77.8 101.4	100 125
													— 23.6	— 41.6	23 23	34.2 34.2	77.8 101.4	100 125
													— 23.6	— 41.6	45 45	68.4 68.4	111.3 140.8	125 150
													— 23.6	— 41.6	— —	— —	84.1 107.7	100 125
													— 23.6	— 41.6	23 23	34.2 34.2	84.1 107.7	100 125
													— 23.6	— 41.6	45 45	68.4 68.4	119.2 148.7	125 150
											15	27	— 23.6	— 41.6	— —	— —	84.1 107.7	100 125
													— 23.6	— 41.6	23 23	34.2 34.2	84.1 107.7	100 125
													— 23.6	— 41.6	45 45	68.4 68.4	119.2 148.7	125 150
													— 23.6	— 41.6	— —	— —	94.5 118.1	110 125
													— 23.6	— 41.6	23 23	34.2 34.2	94.5 119.0	110 125
													— 23.6	— 41.6	45 45	68.4 68.4	132.2 161.7	150 175
	20	37.4	— 23.6	— 41.6	— —	— —	94.5 118.1	110 125										
			— 23.6	— 41.6	23 23	34.2 34.2	94.5 119.0	110 125										
			— 23.6	— 41.6	45 45	68.4 68.4	132.2 161.7	150 175										
			— 26.0	— 45.8	— —	— —	72.1 98.1	90 110										
			— 26.0	— 45.8	25 25	36.1 36.1	72.1 98.1	90 110										
			— 26.0	— 45.8	50 50	72.2 72.2	108.5 140.9	110 150										
	400-3-50	342	440	25.6	120	19.9	114	2	1	2.8	10	14.6	— 26.0	— 45.8	— —	— —	72.1 98.1	90 110
													— 26.0	— 45.8	25 25	36.1 36.1	72.1 98.1	90 110
													— 26.0	— 45.8	50 50	72.2 72.2	108.5 140.9	110 150
													— 26.0	— 45.8	— —	— —	79.4 105.4	100 125
													— 26.0	— 45.8	25 25	36.1 36.1	79.4 105.4	100 125
													— 26.0	— 45.8	50 50	72.2 72.2	117.6 150.0	125 175
15											21.9	— 26.0	— 45.8	— —	— —	79.4 105.4	100 125	
												— 26.0	— 45.8	25 25	36.1 36.1	79.4 105.4	100 125	
												— 26.0	— 45.8	50 50	72.2 72.2	117.6 150.0	125 175	
												— 26.0	— 45.8	— —	— —	86.2 112.2	110 125	
												— 26.0	— 45.8	25 25	36.1 36.1	86.2 113.4	110 125	
												— 26.0	— 45.8	50 50	72.2 72.2	126.1 158.5	150 175	
20	28.7	— 26.0	— 45.8	— —	— —	86.2 112.2	110 125											
		— 26.0	— 45.8	25 25	36.1 36.1	86.2 113.4	110 125											
		— 26.0	— 45.8	50 50	72.2 72.2	126.1 158.5	150 175											
		— 23.6	— 41.6	— —	— —	83.6 107.2	100 125											
		— 23.6	— 41.6	23 23	34.2 34.2	83.6 107.2	100 125											
		— 23.6	— 41.6	45 45	68.4 68.4	111.3 140.8	125 150											
034	380-3-60	342	418	25.6	99	25.6	99	2	1	2.6	10	20.7	— 23.6	— 41.6	— —	— —	83.6 107.2	100 125
													— 23.6	— 41.6	23 23	34.2 34.2	83.6 107.2	100 125
													— 23.6	— 41.6	45 45	68.4 68.4	111.3 140.8	125 150
													— 23.6	— 41.6	— —	— —	89.9 113.5	110 125
													— 23.6	— 41.6	23 23	34.2 34.2	89.9 113.5	110 125
													— 23.6	— 41.6	45 45	68.4 68.4	119.2 148.7	125 150
											15	27	— 23.6	— 41.6	— —	— —	89.9 113.5	110 125
													— 23.6	— 41.6	23 23	34.2 34.2	89.9 113.5	110 125
													— 23.6	— 41.6	45 45	68.4 68.4	119.2 148.7	125 150
													— 23.6	— 41.6	— —	— —	100.3 123.9	125 125
													— 23.6	— 41.6	23 23	34.2 34.2	100.3 123.9	125 125
													— 23.6	— 41.6	45 45	68.4 68.4	132.2 161.7	150 175
	20	37.4	— 23.6	— 41.6	— —	— —	100.3 123.9	125 125										
			— 23.6	— 41.6	23 23	34.2 34.2	100.3 123.9	125 125										
			— 23.6	— 41.6	45 45	68.4 68.4	132.2 161.7	150 175										
			— 26.0	— 45.8	— —	— —	77.9 103.9	100 125										
			— 26.0	— 45.8	25 25	36.1 36.1	77.9 103.9	100 125										
			— 26.0	— 45.8	50 50	72.2 72.2	108.5 140.9	110 150										
	400-3-50	342	440	25.6	120	25.6	120	2	1	2.8	10	14.6	— 26.0	— 45.8	— —	— —	77.9 103.9	100 125
													— 26.0	— 45.8	25 25	36.1 36.1	77.9 103.9	100 125
													— 26.0	— 45.8	50 50	72.2 72.2	108.5 140.9	110 150
													— 26.0	— 45.8	— —	— —	85.2 111.2	110 125
													— 26.0	— 45.8	25 25	36.1 36.1	85.2 111.2	110 125
													— 26.0	— 45.8	50 50	72.2 72.2	117.6 150.0	125 175
15											21.9	— 26.0	— 45.8	— —	— —	85.2 111.2	110 125	
												— 26.0	— 45.8	25 25	36.1 36.1	85.2 111.2	110 125	
												— 26.0	— 45.8	50 50	72.2 72.2	117.6 150.0	125 175	
												— 26.0	— 45.6	— —	— —	92.0 118.0	110 125	
												— 26.0	— 45.8	25 25	36.1 36.1	92.0 118.0	110 125	
												— 26.0	— 45.8	50 50	72.2 72.2	126.1 158.5	150 175	

NOTE: See legend and notes on page 22.

Table 4 — Electrical Data — 50EJ,EK,EW,EY024-44 (cont)

UNIT 50EJ,EK, EW,EY	NOMINAL VOLTAGE (V-Ph-Hz)	VOLTAGE RANGE		COMPRESSOR				OFM			IFM		POWER EXHAUST		ELECTRIC HEAT*		POWER SUPPLY	
				No. 1		No. 2												
		Min	Max	RLA	LRA	RLA	LRA	Qty	Hp	FLA (ea)	Hp	FLA	FLA	LRA	kW	FLA	MCA	MOCPT†
044	380-3-60	342	418	28.8	143	28.8	143	4	1	2.6	15	27	— 23.6	— 41.6	— —	— —	102.3 125.9	125 150
													— 23.6	— 41.6	23 23	34.2 34.2	102.3 125.9	125 150
													— 23.6	— 41.6	45 45	68.4 68.4	119.2 148.7	125 150
													— 23.6	— 41.6	— —	— —	112.7 136.3	125 150
													— 23.6	— 41.6	23 23	34.2 34.2	112.7 136.3	125 150
													— 23.6	— 41.6	45 45	68.4 68.4	132.2 161.7	150 175
											20	37.4	— 23.6	— 41.6	— —	— —	112.7 136.3	125 150
													— 23.6	— 41.6	23 23	34.2 34.2	112.7 136.3	125 150
													— 23.6	— 41.6	45 45	68.4 68.4	132.2 161.7	150 175
													— 23.6	— 41.6	— —	— —	112.7 136.3	125 150
													— 23.6	— 41.6	23 23	34.2 34.2	112.7 136.3	125 150
													— 23.6	— 41.6	45 45	68.4 68.4	132.2 161.7	150 175
											25	37.4	— 23.6	— 41.6	— —	— —	112.7 136.3	125 150
													— 23.6	— 41.6	23 23	34.2 34.2	112.7 136.3	125 150
													— 23.6	— 41.6	45 45	68.4 68.4	132.2 161.7	150 175
													— 26.0	— 45.8	— —	— —	98.0 124.0	125 150
													— 26.0	— 45.8	25 25	36.1 36.1	98.0 124.0	125 150
													— 26.0	— 45.8	50 50	72.2 72.2	117.6 150.0	125 175
	400-3-50	342	440	28.8	173	28.8	173	4	1	2.8	15	21.9	— 26.0	— 45.8	— —	— —	98.0 124.0	125 150
													— 26.0	— 45.8	25 25	36.1 36.1	98.0 124.0	125 150
													— 26.0	— 45.8	50 50	72.2 72.2	117.6 150.0	125 175
													— 26.0	— 45.8	— —	— —	104.8 130.8	125 150
													— 26.0	— 45.8	25 25	36.1 36.1	104.8 130.8	125 150
													— 26.0	— 45.8	50 50	72.2 72.2	126.1 158.5	150 175
											20	28.7	— 26.0	— 45.8	— —	— —	104.8 130.8	125 150
													— 26.0	— 45.8	25 25	36.1 36.1	104.8 130.8	125 150
													— 26.0	— 45.8	50 50	72.2 72.2	126.1 158.5	150 175
													— 26.0	— 45.8	— —	— —	113.5 139.5	125 150
													— 26.0	— 45.8	25 25	36.1 36.1	113.5 139.5	125 150
													— 26.0	— 45.8	50 50	72.2 72.2	137.0 169.4	150 175

LEGEND

FLA — Full Load Amps
HACR — Heating, Air Conditioning and Refrigeration
IFM — Indoor (Evaporator) Fan Motor
LRA — Locked Rotor Amps
MCA — Minimum Circuit Amps
MOCPT — Maximum Overcurrent Protection
NEC — National Electrical Code (U.S.A. Standard)
OFM — Outdoor (Condenser) Fan Motor
RLA — Rated Load Amps

*Heater capacity (kW) is based on heater voltage of 380 and 400 v. If power distribution voltage to unit varies from rated heater voltage, heater kW will vary accordingly.

†Fuse or HACR circuit breaker.

NOTES:

1. In compliance with NEC requirements (U.S.A. requirements) for multimotor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be fuse or HACR breaker.


2. Unbalanced 3-Phase Supply Voltage

Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percent of voltage imbalance.

% Voltage Imbalance

$$= 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

EXAMPLE: Supply voltage is 400-3-50.



$$\begin{aligned}
 AB &= 393 \text{ v} \\
 BC &= 403 \text{ v} \\
 AC &= 396 \text{ v} \\
 \text{Average Voltage} &= \frac{393 + 403 + 396}{3} \\
 &= \frac{1192}{3} \\
 &= 397
 \end{aligned}$$

Determine maximum deviation from average voltage.

$$\begin{aligned}
 (AB) \quad 397 - 393 &= 4 \text{ v} \\
 (BC) \quad 403 - 397 &= 6 \text{ v} \\
 (AC) \quad 397 - 396 &= 1 \text{ v}
 \end{aligned}$$


Maximum deviation is 6 v.

Determine percent of voltage imbalance.

$$\begin{aligned}
 \% \text{ Voltage Imbalance} &= 100 \times \frac{6}{397} \\
 &= 1.5\%
 \end{aligned}$$


This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

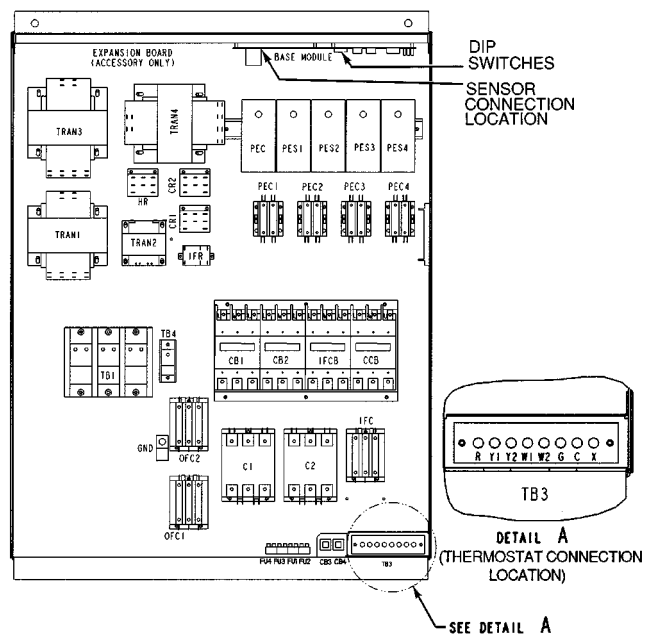

DIP — Dual In-Line Package
 PEC — Power Exhaust Controller

Fig. 14 — Control Box Diagram (Sizes 024-034)

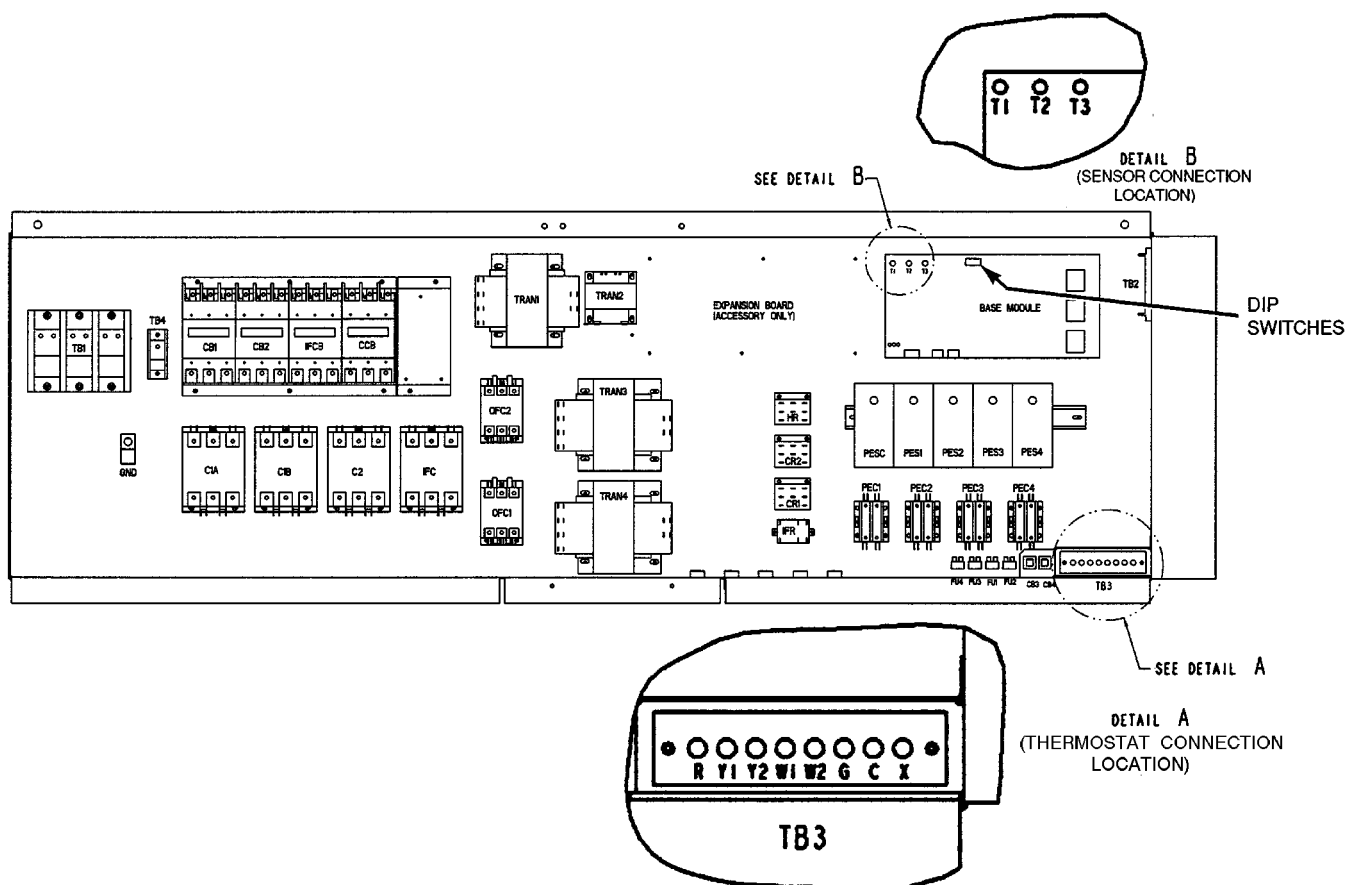

DIP — Dual In-Line Package
 PEC — Power Exhaust Controller

Fig. 15 — Control Box Diagram (Size 044)

Table 5 — American/European Wire Conversions

AMERICAN		EUROPEAN
Industry Standard Size	American Conversion Size (mm ²)	Industry Standard Size (mm ²)
18 AWG	0.82	1.0
16 AWG	1.30	1.5
14 AWG	2.08	2.5
12 AWG	3.30	4.0
10 AWG	5.25	6.0
8 AWG	6.36	10.0
6 AWG	13.29	16.0
4 AWG	21.14	25.0
3 AWG	26.65	—
2 AWG	33.61	35.0
1 AWG	42.39	50.0
1/0 AWG	53.49	—
2/0 AWG	67.42	70.0
3/0 AWG	85.00	95.0
4/0 AWG	107.19	120.0
250 kcmil	126.64	150.0
300 kcmil	151.97	—
350 kcmil	177.90	185.0
400 kcmil	202.63	240.0
500 kcmil	253.29	300.0
600 kcmil	303.95	—

LEGEND

AWG — American Wire Gage, U.S.A. Standard
kcmil — Thousand Circular Mills

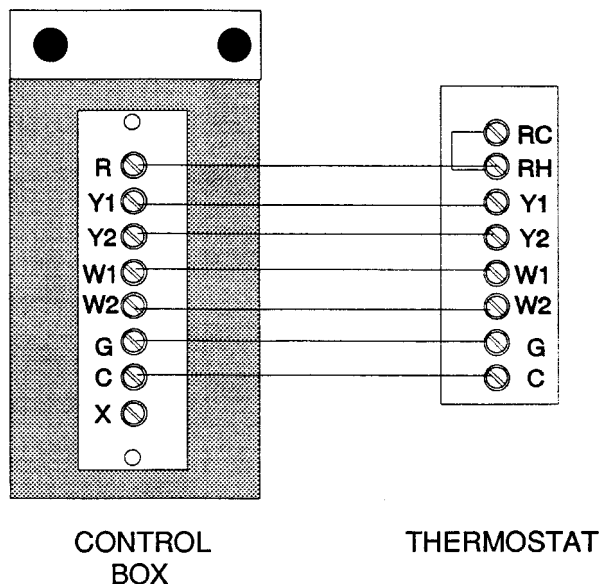


Fig. 16 — Field Control Thermostat Wiring

Carrier Comfort Network Interface — The 50E units can be connected to the CCN. The communication bus wiring is supplied and installed in the field. Wiring consists of shielded, 3-conductor cable with drain wire.

The system elements are connected to the communication bus in a daisy chain arrangement. The positive pin of each system element communication connector must be wired to the positive pins of the system element on either side of it, the negative pins must be wired to the negative pins, and the signal pins must be wired to signal ground pins. Wiring connections for CCN should be made at the 3-pin plug (CCN) located at the base board. Consult CCN literature for further information.

Conductors and drain wire must be 20 AWG minimum stranded, tinned copper. Individual conductors must be insulated with PVC, PVC/nylon, vinyl, Teflon, or polyethylene. An aluminum/polyester 100% foil shield and an outer jacket of PVC, PVC/nylon, chrome vinyl, or Teflon with a minimum operating temperature range of -20 C to 60 C (-4 F to 140 F) is required. Table 6 lists cables that meet the requirements.

Table 6 — CCN Connection Approved Shielded Cables

MANUFACTURER	CABLE PART NO.
Alpha	2413 or 5463
American	A22503
Belden	8772
Columbia	02525

IMPORTANT: When connecting the CCN communication bus to a system element, use a color coding system for the entire network to simplify installation and checkout. See Table 7.

Table 7 — Color Code Recommendations

SIGNAL TYPE	CCN BUS CONDUCTOR INSULATION COLOR	CCN PLUG PIN NO.
Positive (+)	RED	1
Ground	WHITE	2
Negative (-)	BLACK	3

NOTE: If a cable with a different color scheme is selected, a similar color code should be adopted for the entire network.

At each system element, the shields of the communication bus cables must be tied together. If the communication bus is entirely within one building, the resulting continuous shield must be connected to a ground **at one point only**. If the communication bus cable exits from one building and enters another, the shields must be connected to grounds at the lightning suppressor in each building where the cable enters or exits the building (one point per building only).

To connect the unit to the network:

1. Turn off power to the control box.
2. Cut the CCN wire and strip the ends of the red (+), white (ground), and black (-) conductors. (If a different network color scheme is used, substitute appropriate colors.)
3. Remove the 3-pin male plug from the base module in the main control box, and connect the wires as follows:
 - a. Insert and secure the red (+) wire to terminal 1 of the 3-pin plug.
 - b. Insert and secure the white (ground) wire to terminal 2 of the 3-pin plug.
 - c. Insert and secure the black (-) wire to terminal 3 of the 3-pin plug.
4. Insert the plug into the existing 3-pin mating connector on the base module in the main control box.

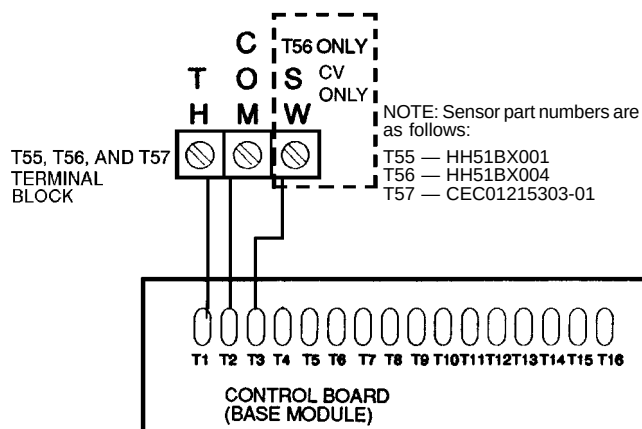


Fig. 17 — Field Control Temperature Sensor Wiring

Step 8 — Make Outdoor-Air Inlet Adjustments

ECONOMIZER

NOTE: If accessory power exhaust or barometric relief packages are being added to the unit, install power exhaust or barometric relief before installing economizer hoods.

Economizer Hood Assembly — The economizer hood is shipped in a package secured to the outside of the unit and must be field-assembled. There are 2 hoods on every unit. The 50EW/EY units are side supply and side return. The return duct limits access to economizer filters from below. Filter tracks (mounting angle without tabs) must be installed correctly to allow access to economizer filters from each side. Perform the following procedure to assemble the economizer hood.

NOTE: Before assembly of the economizer hood, check along the outer edges of the economizer assembly for any seal strip protruding past the flanges. Trim the excess seal strip so that it is flush with the economizer assembly flanges.

1. Apply black seal strip (provided in package) to outside top-edge of hood sides. Wrap seal strip over edge to cover top flange (4 hood sides). Make sure seal strip covers screw holes. Allow strip to overhang 3 mm ($\frac{1}{8}$ -in.) past the end opposite the mounting flange. See Fig. 18.
 2. Assemble hood sides, top, and cross member with gasketed screws provided. See Fig. 19.
 3. Attach 10 green speed clips (provided) to hood top.
 4. Apply black seal strip (provided) to mounting flanges of hood sides being sure to cover mounting holes. See Fig. 20.
- NOTE: Each hood assembly has a slotted side that should be adjacent to the other hood when mounted to the unit.
5. Apply black seal strip (provided) to hood top mounting flange. Seal strip of hood top mounting flange must press tightly against seal strip of hood side mounting flanges. See Fig. 21.
 6. Add gray foam strip (provided in package) to cross members on bottom tray. See Fig. 22.
 7. Place gray foam strip (provided) on inside of slotted hood side between filter and cross member opposite the mounting end. See Fig. 23.
 8. Attach gray foam strip (provided) to block-off baffle on outer face of flange. See Fig. 24.
 9. Remove the screws on each end and along top of damper assembly of unit. Remove top 2 screws on each side of filter panel under damper assembly. Set hood assembly in place and attach to unit using these screws.


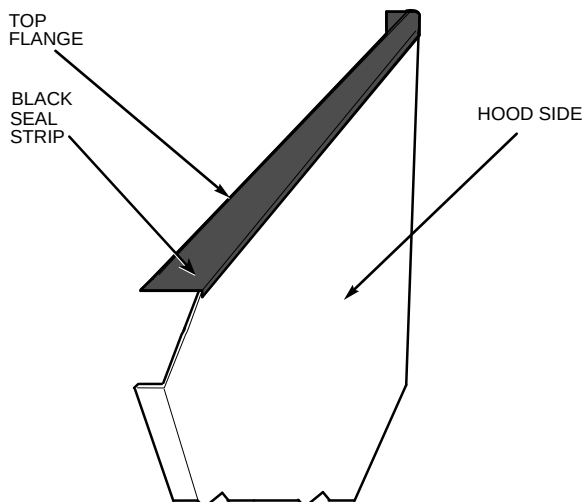


Fig. 18 — Adding Seal Strip to Top of Hood Sides

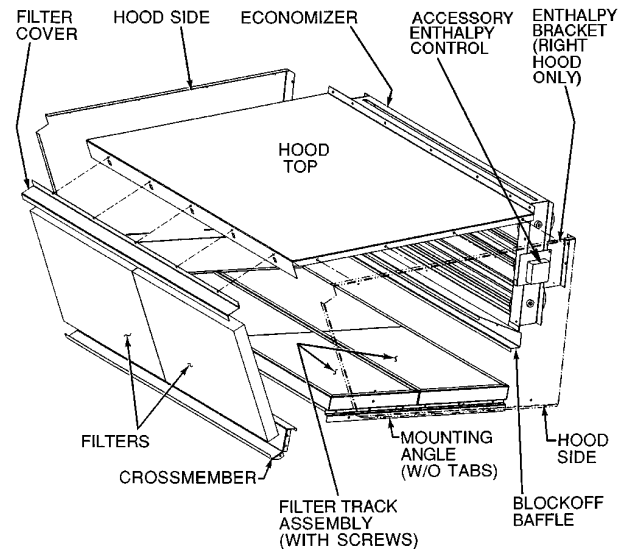

NOTE: Left side economizer hood has mounting angle without tabs and filter track assembled end on the opposite side.

Fig. 19 — Economizer Hood Assembly (Right-Side Economizer Hood Shown)

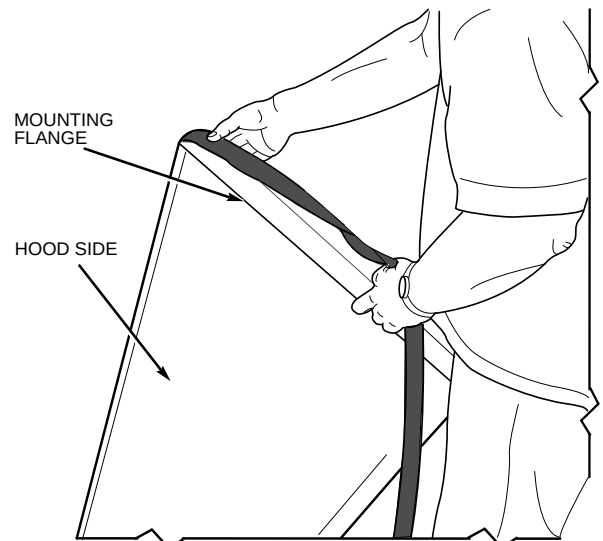


Fig. 20 — Adding Seal Strip to Mounting Flange of Hood Sides

10. Attach accessory enthalpy bracket on hood side furthest from control box end. Locate bracket on inside upper right-hand corner of economizer hood using hood mounting holes. Mount outdoor-air thermistor to enthalpy bracket (if purchased). Attach and wire enthalpy assembly. Place quick connects on enthalpy wires.
11. Remove screws along bottom of damper assembly. Locate and mount blockoff baffle using these screws.
12. Assemble 2 filter tracks side-by-side with the assembled ends together.
13. Attach mounting angle (without tabs) to the assembled end of the filter track. See Fig. 25.
14. Attach 6 green speed clips (provided) to mounting angles. Engagement section of clip faces inside of rack.
15. Attach remaining mounting angle (with tabs) to other end of the filter track with no. 10 screws provided. See Fig. 26.
16. Place filter track assembly in bottom of hood by placing tabbed end into slotted side (with tab on bottom) and attaching opposite end to hood with speed clips and gasketed screws provided. Tabs can be hand bent after they have been inserted into the side.

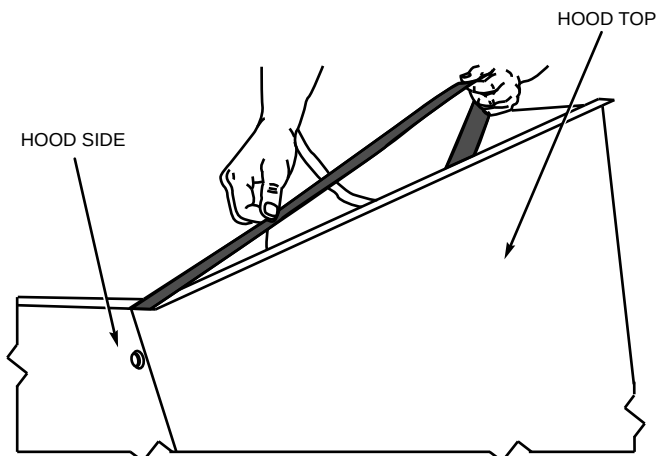


Fig. 21 — Adding Seal Strip to Hood Top Mounting Flange

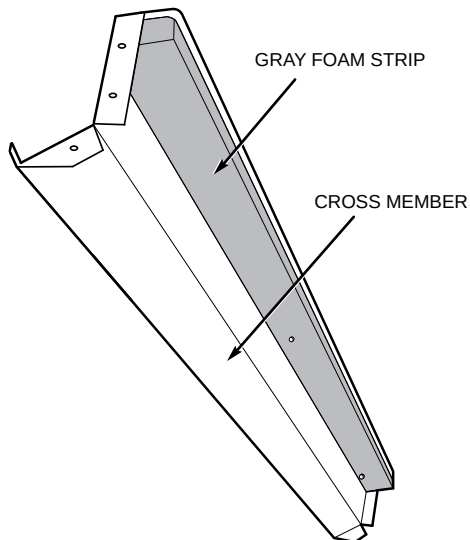


Fig. 22 — Adding Foam Strip to Cross Member

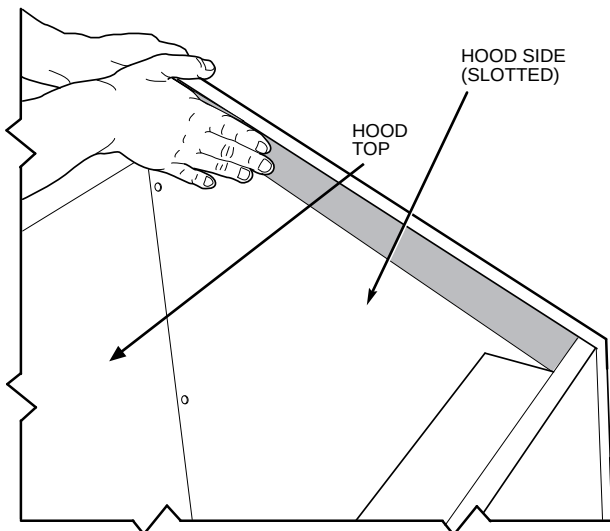


Fig. 23 — Adding Foam Strip to Hood Side

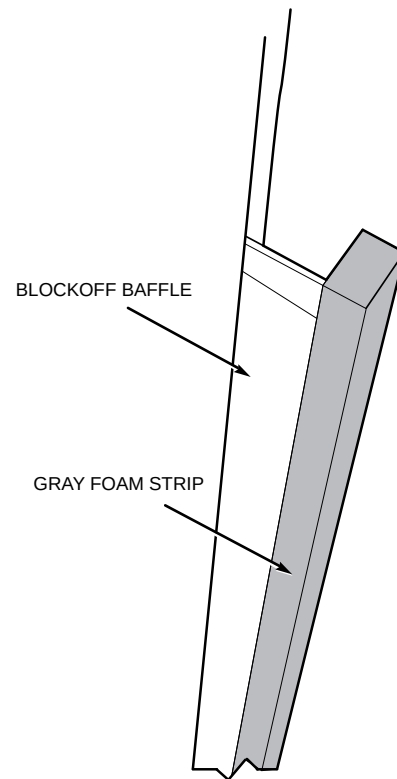


Fig. 24 — Adding Foam Strip to Blockoff Baffle

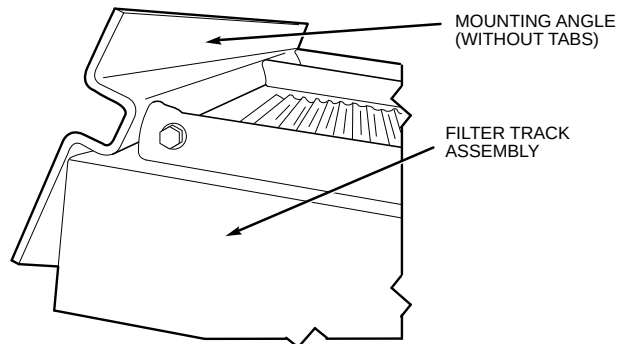


Fig. 25 — Mounting Angle (Without Tabs) Attached to Filter Track Assembly

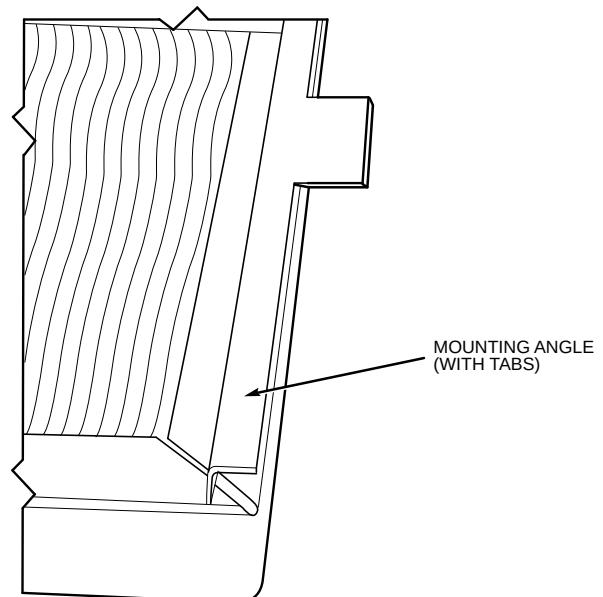


Fig. 26 — Mounting Angle (With Tabs) Attached to Filter Track Assembly

NOTE: The filter track assembly end with screws should face away from the other hood when mounted on the unit.
NOTE: Tabs from both filter tracks will be in the same space. After one filter track has been inserted into board, bend the tabs so they will not interfere with installation of the second hood.

17. Attach black seal strip (provided) to filter cover. Seal strip should be applied to the center of the large flange making sure to cover holes. See Fig. 27.
18. Slide two 508 × 635 mm (20 × 25-in.) filters into cross members of hood assembly. Attach filter cover over filters with screws and speed clips provided.

Minimum Damper Position Setting — Setting of the outdoor air damper position is performed in conjunction with a shortened version of the field-run test. This is performed by first opening DIP (Dual In-Line Package) switch no. 6 then no. 4. See Fig. 12 and Direct Digital Controls DIP Switch Configuration section on page 31.

The outdoor-air damper closes. The control allows 90 seconds for the damper to close in case it is in the full open

position. Next, the indoor-fan contactor will energize. The outdoor-air damper will remain at 0% for 30 seconds. It will then move to the 10% position for another 30 seconds. This will be repeated at every 10% increment for 30 seconds until the damper reaches 100% open. Close DIP switch no. 6 during the 30 seconds immediately after the desired outdoor air minimum damper position. The 30-second time period is to allow time where DIP switch no. 6 can be closed. The default value of the minimum outdoor air damper position is 20%. If the desired minimum position is 30%, allow the damper position to go to 10% for 30 seconds, then 20% for 30 seconds, and when it reaches 30% close DIP switch no. 6 during the 30-second period following the 30% position.

The minimum outdoor air damper position is now set.

ECONOMIZER SETTINGS

Accessory Enthalpy Control (Fig. 28) — The control (HH57AC077) is mounted in the economizer hood. See Fig. 19. The enthalpy setting adjustment is on the enthalpy control. For maximum benefit of outdoor air, set enthalpy control to A. See Fig. 29 and 30.



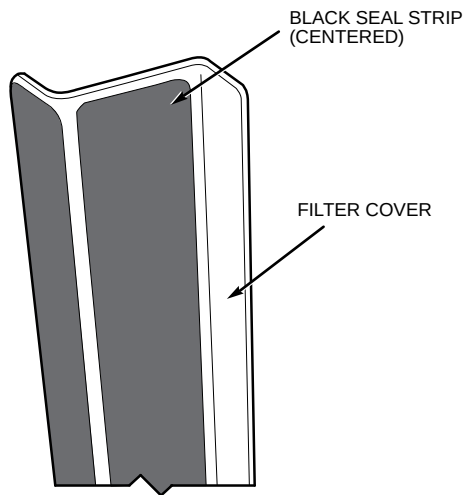


Fig. 27 — Attaching Seal Strip to Filter Cover

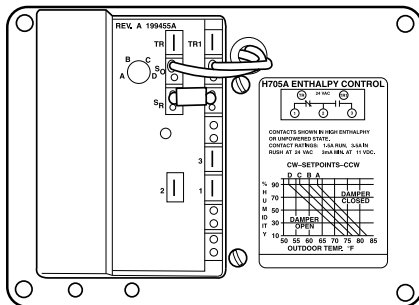


**HH57AC077
ENTHALPY CONTROL**




**HH537AC078
ENTHALPY SENSOR
(USED WITH ENTHALPY
CONTROL FOR DIFFERENTIAL
ENTHALPY OPERATION)**

Fig. 28 — Differential Enthalpy Control and Sensor

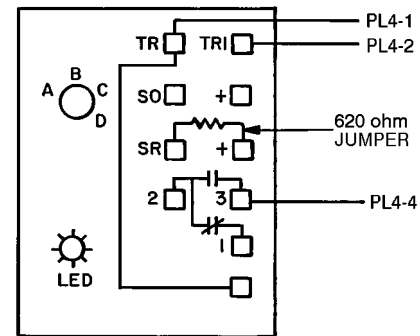

NOTE: Switches shown in high enthalpy state. Terminals 2 and 3 close on enthalpy decrease.

Fig. 29 — Wire Connections for Solid State Enthalpy Control (HH57AC077)

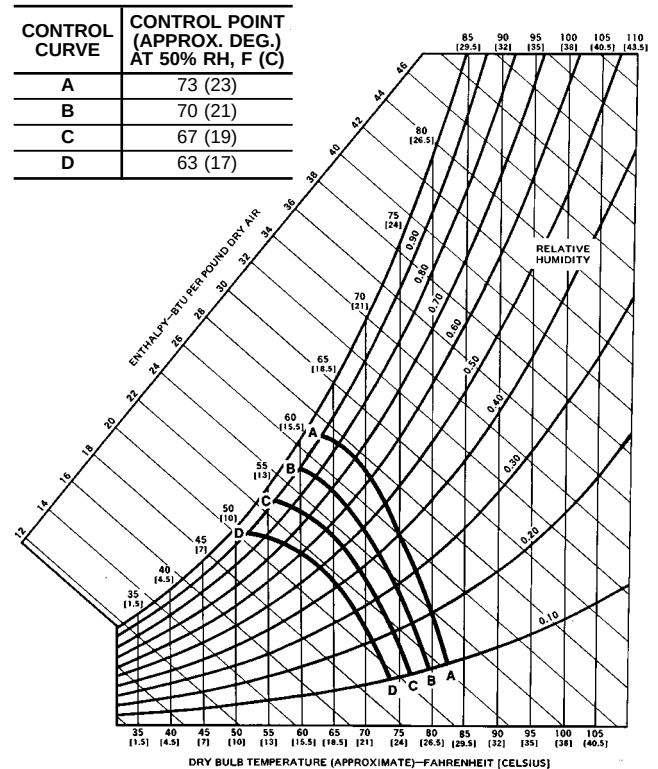

RH — Relative Humidity

Fig. 30 — Psychrometric Chart for Enthalpy Control

4. With screws saved from Step 1, install brackets on each side of damper assembly.
5. Remove tape from damper blades.


VAV DUCT PRESSURE TRANSDUCER — The VAV duct pressure transducer (VAV inverter pressure transducer) is located behind the filter access door on the lower inner panel. See Fig. 32. A section of 6 mm (¼-in.) plastic tubing must be run from the high-pressure tap on the differential pressure switch and connected to a tap in the supply-air duct. The tap is usually located ⅔ of the way out on the main supply duct. Remove plug button in panel to route tubing.

VAV BUILDING PRESSURE TRANSDUCER — The VAV building pressure transducer (modulating power exhaust pressure transducer) is located behind the filter access door on the inner panel. See Fig. 32. A section of 6 mm ($\frac{1}{4}$ -in.) plastic tubing must be run from the high-pressure tap on the differential pressure switch to the conditioned space. The pressure tube must be terminated in the conditioned space where a constant pressure is required. This location is usually in an entrance lobby so that the building exterior doors will open and close properly. Remove plug button in panel to route tubing.

- Step 10 — Install Accessories** — After all the factory-installed options have been adjusted, install all field-installed accessories. Refer to the accessory installation instructions included with each accessory.


⚠ CAUTION

- Secure each damper assembly to unit with 6 screws across top (3 screws provided) and bottom (3 screws from Step 1) of damper.

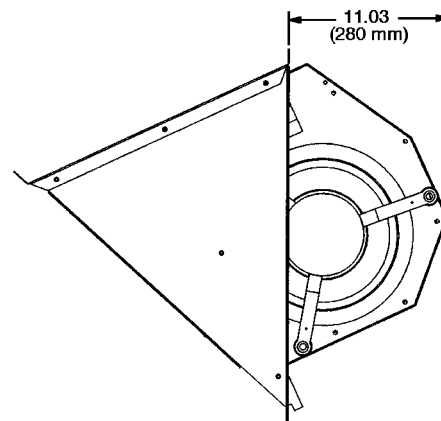

1. Unless otherwise specified, all dimensions are to outside of part.
2. Dimensions are in inches.
3. There are 2 assemblies per unit.

28

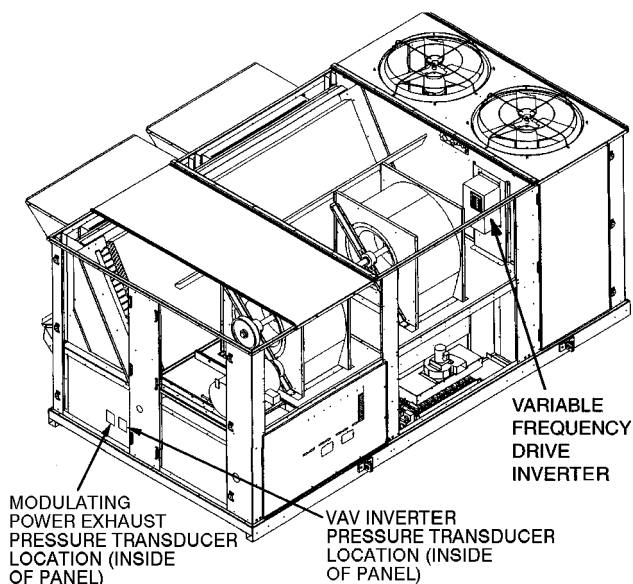

VAV — Variable Air Volume

Fig. 32 — Pressure Transducer Locations

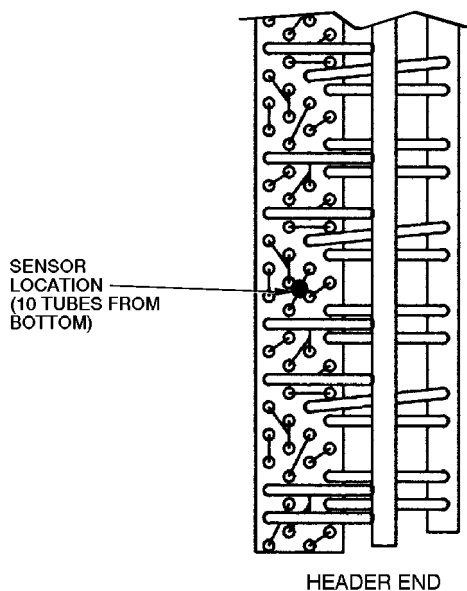



Fig. 33A — Motormaster® III Sensor Location (Sizes 024-034)

START-UP

Use the following information and Start-Up Checklist on pages CL-1 and CL-2 to check out unit PRIOR to start-up.

Unit Preparation — Check that unit has been installed in accordance with these installation instructions and applicable codes.

Compressor Mounting — Loosen the compressor hold-down bolts until sidewise movement of the washer under each hold-down bolt head can be obtained. Do not loosen completely as bolts are self-locking and will maintain adjustment.

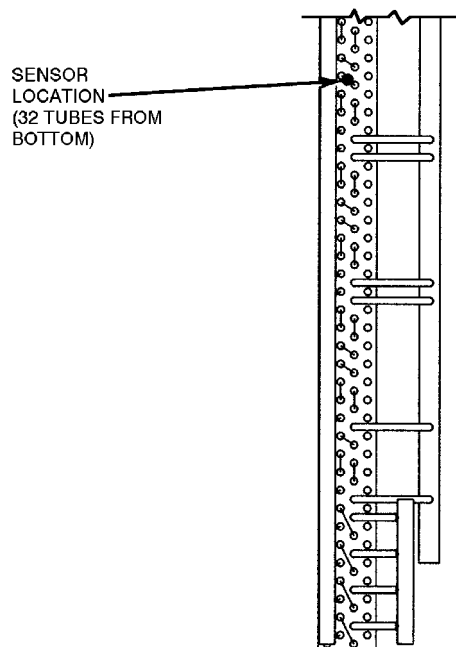

LEFT HAND CONDENSER COIL
VIEWED FROM ACCESS PANEL

Fig. 33B — Motormaster III Sensor Location (Size 044)

Service Valves — Ensure that the suction, discharge, and liquid line service valves are open. Damage to the compressor could result if they are left closed.

Internal Wiring — Check all electrical connections in unit control boxes; tighten as required.

Refrigerant Service Ports — Each refrigerant system has one suction port located in the top of the compressor motor casing. All units also have one service port on the liquid line valve and one on the compressor discharge valve. Be sure that caps on the ports are tight.


Variable Frequency Drive (VFD) — The variable frequency drives are factory set. These settings include factory-installed jumpers and software configurations. The only configured set point is duct static pressure. An Operation Manual is shipped with each VAV unit. This manual should be used to adjust the drive for each particular application.

To set the duct static pressure, perform the following steps. The factory setting is zero. The duct transducer has a range from 0.000 to 1.245 kPa (0 to 5 in. wg.) The transducer output is 2 to 10 vdc, therefore, 0.000 to 1.245 kPa (0 to 5 in. wg) is proportional to the 2 to 10 vdc and must be expressed to the VFD in terms of percentage of the frequency range. To do this, refer to Table 8. The set point value is a percentage of the maximum output frequency. Locate the duct static pressure closest to that desired and use the corresponding set point value. If necessary, interpolation between duct static pressures is permissible.

To set the VFD, the VFD must be powered up, however, since it is located near the indoor air fan, operation of the fan is not desirable. To disable the fan, perform the following procedure:

1. Open the indoor fan circuit breaker.
2. Remove the jumper between CC and ST on the terminal strip of the VFD (see Fig. 34).
3. Close the indoor fan circuit breaker. The VFD now is powered but the fan will not operate.
4. On the front of the VFD is a keypad and display which will be used to enter the set point. To access this field, press “SETUP” key, then press the “SETUP” key 6 times to scroll to the sixth parameter, which will display “Sr1.” This is the VFD set point listed in Table 8.
5. Press the “READ/WRITE” key. The set point value will be displayed. Use the up-arrow or down-arrow key to adjust the set point value to the value desired.
6. Press the “READ/WRITE” key again to enter the new value.
7. Open the indoor fan circuit breaker.
8. Replace the jumper between CC and ST on the terminal strip of the VFD.
9. Close the indoor fan circuit breaker, the VFD now is powered and the fan will operate.

NOTE: Any field measurement of supply fan amps must be taken with an RMS meter between the fan circuit breaker and fan contactor (upstream of VFD).

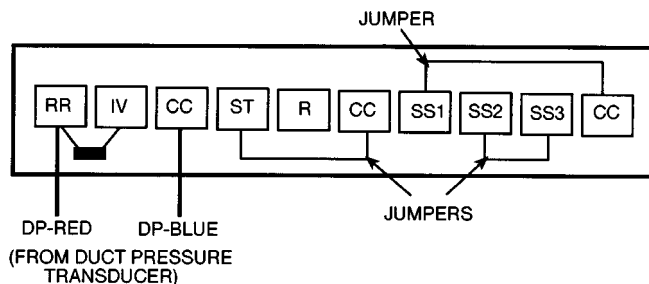

NOTE: Terminal strip is located inside the VFD (Variable Frequency Drive) at the bottom.

Fig. 34 — VFD Factory-Installed Jumpers

Power Exhaust — The optional non-modulating power exhaust (CV only) is a two-stage design where the operation of the exhaust fans is linked to economizer position. When the supply fan is running and the economizer is 25% open, the base module closes contacts, activating 2 exhaust fans. When the economizer position reaches 75% open, the base module activates the other 2 exhaust fans. The fans will turn off when the economizer closes below the same points. The economizer position set points that trigger the exhaust fans can be modified, but only through use of the Service Tool, Comfort Works, or Building Supervisor Software. If single-stage operation is desired, adjust the economizer set points to identical values at the desired point to activate all exhaust fans.

The optional modulating power exhaust (VAV standard, CV optional) is controlled by a modular electronic sequencer system. This system consists of a model R353 signal input module and 4 model S353 staging modules. The signal input module receives a 0 to 10 vdc signal from the building pressure transducer, which is mounted adjacent to the supply static transducer behind the filter access panel. The modules are mounted just below the unit control board. The left module is the R353, and the 4 modules on the right are S353 modules for stages 1 through 4. On the unit wiring label, the R353 is designated PES3, and the S353 modules are designated PES1 through PES4.

The building pressure transducer range is -0.124 to $+0.124$ kPa (-0.5 to $+0.5$ in. wg). It is powered by a 0 to 10 vdc signal. A factory-installed hose at the “Lo” connection leads to atmosphere, and a field-supplied hose must be connected to the “Hi” connection and led into the building to a point where building pressure is to be controlled. There is a plug button in the bulkhead just above the transducers, for use in leading the hoses into the building via the return air ductwork.

There are 3 adjustments at the R353 module, all of which have been factory set. In the center of the circuit board is a set of 4 pins with a jumper, labeled J2. This determines the mode of operation. The bottom 2 pins must be jumpered for direct operation. Direct operation means that the staging modules are activated in sequence as the input signal increases.

Table 8 — VFD Set Point

PRESSURE		VOLTAGE (vdc)	VFD SET POINT
in. wg	kPa		
0.00	0.000	2.0	12.0
0.25	0.062	2.4	14.4
0.50	0.124	2.8	16.8
0.75	0.187	3.2	19.2
1.00	0.249	3.6	21.6
1.25	0.311	4.0	24.0
1.50	0.373	4.4	26.4
1.75	0.435	4.8	28.8
2.00	0.498	5.2	31.2
2.25	0.560	5.6	33.6
2.50	0.622	6.0	36.0
2.75	0.684	6.4	38.4
3.00	0.747	6.8	40.8
3.25	0.809	7.2	43.2
3.50	0.871	7.6	45.6

VFD — Variable Frequency Drive

NOTE: For values above 0.871 kPa (3.50 in. wg) interpolation from table is permissible.

At the upper right corner of the board is a set of 5 pins and jumper, which determines the time constant for the control. The time constant is the delay in response built into the controls. The jumper should be on the middle or bottom 2 pins, for the maximum time constant. The delay can be decreased, if desired, by moving the jumper progressively upward, always jumpering adjacent pins.

At the lower left corner of the board below the terminal strip is a resistor marked R27. This must be removed in order to obtain the 0 to 10 vdc signal output. There will not be a resistor on a factory-supplied module, but a resistor may be present on a replacement module and must be removed.

The R353 module has a terminal block with 7 connections available for wiring. The 2 right-hand terminals are for the 24 vac and common connections. The next 2 terminals are for the 0 to 10 vdc signal. Consult the wiring label for wire identification if replacing the module. The 3 left-hand terminals are not used for this application.

The S353 module has an LED (light-emitting diode), a set of 4 jumper pins, and 2 potentiometers. The LED will light whenever the module is activated, providing a visual indication of the number of exhaust fans running. The jumper pins are arranged in a square format. Two jumpers are used to determine the mode of operation (direct or reverse). The 2 jumpers must be arranged horizontally for direct action (factory set).

At the top of the module are 2 potentiometers. The left potentiometer adjusts the **offset**. The right potentiometer adjusts **differential**. The potentiometers are factory set for a nominal 0 in. wg building pressure.

The **offset** set point is defined as the point at which a module turns off a fan, and is measured in terms of percent of the input signal. For control purposes, 0 offset is at an arbitrary “floor” which is established at 10% of the input signal, or 1 vdc. In this example, the first stage will turn off at 30% (3 vdc), and the offset potentiometer will be set at 20%. The second stage will turn off at 50% signal (5 vdc), and the offset potentiometer will be set at 40%. The fourth stage is at the maximum 75% offset, which equates to 85% signal or 8.5 vdc. The offset potentiometer is calibrated in 10% increments.

Table 9 relates building pressure to signal level.

Table 9 — Potentiometer Signal Levels

BUILDING PRESSURE		SIGNAL LEVEL (vdc)
in. wg	kPa	
-0.50	-0.124	2
-0.25	-0.062	4
0.00	0.000	6
0.25	0.062	8
0.50	0.124	10

If the building pressure is controlled at 0 in. wg, offset of the first stage should be set at 50%, which equates to 60% of the input signal, or 6 vdc. The other stages can then be set as desired between 50% and 75%.

The default offset set points for modulating power exhaust are shown in Table 10.

Table 10 — Power Exhaust Default Set Points

STAGE	OFFSET	DIFFE- RENTIAL	OFF VOLTAGE	ON VOLTAGE	OFF STATIC PRESSURE	
					in. wg	kPa
1	50%	3%	6.0	6.3	0.00	0.000
2	55%	3%	6.5	6.8	0.06	0.015
3	60%	3%	7.0	7.3	0.12	0.030
4	64%	3%	7.4	7.7	0.18	0.045

The **differential** set point is the difference between the turn off point and the turn on point for each module. It also is calibrated in terms of percent of input signal, and has a range of 1% to 7%. The differential potentiometer is calibrated in 1% increments, and is factory set at approximately 3%. It is recommended to leave the set point at 3%, to minimize cycling of the fans.

The offset and differential potentiometers have been factory set for atmospheric pressure. Do not change these settings until there is some experience with the building. In most cases the factory settings will be satisfactory. However, if the building pressure is not being maintained as desired, then some minor adjusting on a trial and error basis can be made.

Direct Digital Controls DIP Switch Configuration

The Direct Digital Control (DDC) board must be configured for each application. The DDC board is configured through the DIP switches located on the board. There are 8 DIP switches which configure 8 different applications of the DDC. See Tables 11A and 11B. DIP switch 1 is on the left of the block. DIP switch 8 is on the right of the block. To set a DIP switch, push the switch with suitable tool (small-blade screwdriver). The open side of the DIP switch is marked “OPEN.” When the rocker switch is on the “OPEN” side of the switch, the switch is open. Factory settings are shown in Tables 12A and 12B.

Table 11A — DIP Switch Configuration (Version 1.0 of Unit Control Software)

SETTING	1	2	3	4	5	6	7	8
OPEN	VAV	CCN/ Sensors	Expansion I/O Board	Field Test ON	Modulated Power Exhaust	Time Guard® Override ON/ Set Min. Damper Pos. ON	Gas Heat	Factory Test ON
CLOSED	CV	TSTAT	Base Board Only	Field Test OFF	CV Power Exhaust	Time Guard Override OFF/ Set Min. Damper Pos. OFF	Electric Heat	Factory Test OFF

LEGEND

CCN — Carrier Comfort Network
CV — Constant Volume
I/O — Input/Output
Pos. — Position
TSTAT — Thermostat
VAV — Variable Air Volume

NOTES:

1. The Factory Test DIP switch should not be enabled in the field.
2. The OPEN side of the DIP switch is marked "OPEN." When the rocker switch is on the "OPEN" side of the switch, the switch is open.
3. If DIP switch no. 1 is open, DIP switch no. 2 is ignored, since VAV units control to supply-air temperature.

Table 11B — DIP Switch Configuration (Version 2.0 of Unit Control Software)

SETTING	1	2	3	4	5	6	7	8
OPEN	VAV	VAV — Space Sensor Installed	Expansion Board	Field Test ON	VAV — Occupied Heat Enabled	Time Guard Override ON	Gas Heat	Heat Pump Operation
		CV — CCN or Sensors Used			CV — Modulated Power Exhaust	IN CONJUNCTION WITH FIELD TEST — Set Minimum Damper Position		
CLOSED	CV	VAV — No Space Sensor	Base Control Board Only	Field Test OFF	VAV — Occupied Heat Disabled	Time Guard Override OFF	Electric Heat	Air Conditioner Operation
		CV — Thermostat			CV — Constant Volume Power Exhaust			

LEGEND

CCN — Carrier Comfort Network
CV — Constant Volume
VAV — Variable Air Volume

NOTES:

1. The OPEN side of the DIP switch is marked "OPEN." When the rocker switch is on the "OPEN" side of the switch, the switch is OPEN.
2. The configuration of DIP switches 2 and 5 are dependent on DIP switch 1. If DIP switch 1 is set to OPEN (VAV operation), then DIP switches 2 and 5 will configure VAV functions.
3. When the unit is field-tested (DIP switch 4 to OPEN), the function of DIP switch 6 changes and it is used to set the minimum damper position.

Table 12A — DIP Switch Factory Settings (Version 1.0 of Unit Control Software)

UNIT	1	2	3	4	5	6	7	8
50EJ,EW	Closed	Closed	Closed	Closed	Closed	Closed	Closed	Closed
50EK,EY	Open	Closed	Closed	Closed	Open	Closed	Closed	Closed

Table 12B — DIP Switch Factory Settings (Version 2.0 of Unit Control Software)

UNIT	1	2	3	4	5	6	7	8
50EJ,EW	Closed	Closed	Closed	Closed	Closed	Closed	Closed	Closed
50EK,EY	Open	Closed	Closed	Closed	Closed	Closed	Closed	Closed

DIP switch configurations for Version 1.0 of the Unit Control Software are as follows:

- DIP switch 1 configures the unit to operate as a variable air volume (VAV) or constant volume (CV) unit
- DIP switch 2 configures what type of sensors or thermostats are used with the unit
- DIP switch 3 configures the DDC for use with the electronic expansion board
- DIP switch 4 is used to field test the unit
- DIP switch 5 configures the unit to use constant volume or modulated power exhaust
- DIP switch 6 configures the Time Guard® override and the minimum damper position
- DIP switch 7 configures the unit for gas heat or electric heat
- DIP switch 8 is used to factory test the unit

The DIP switch configurations for Version 2.0 of the unit control software are as follows:

- DIP switch 1 configures the unit to operate as a VAV or CV unit
- DIP switch 2 configures the unit to use a space sensor (VAV units) or a thermostat (CV units)
- DIP switch 3 configures the DDC for use with an electronic expansion board
- DIP switch 4 is used to field test the unit
- DIP switch 5 is used to enable occupied heating (VAV units) or specify the type of power exhaust (CV units)
- DIP switch 6 configures the Time Guard override and, when used with the field test function, sets the minimum damper position
- DIP switch 7 configures the unit for gas heat or electric heat
- DIP switch 8 configures the unit for heat pump or air conditioner operation

Crankcase Heater(s) — Heater(s) is energized as long as there is power to the unit, except when the compressors are operating.

IMPORTANT: Unit power must be on for 24 hours prior to start-up. Otherwise, damage to compressor may result.

Evaporator Fan — Fan belt and fixed pulleys are factory-installed. See Tables 13-16 for Fan Performance Data. See Table 17 for Air Quantity Limits. See Table 18 for Motor Limitation data. Be sure that fans rotate in the proper direction. Static pressure drop for power exhaust, barometric relief damper, and electric heat is negligible. To alter fan performance, see Evaporator Fan Performance Adjustment section on page 42.

Condenser Fans and Motors — Fans and motors are factory set. Refer to Condenser-Fan Adjustment section (page 43) as required.

Return-Air Filters — Check that correct filters are installed in filter tracks. See Tables 1A and 1B. Do not operate unit without return-air filters.

Filter Replacement — To replace filters, open filter access door (marked with label). Remove inner access panel. Remove plastic filter retainer in between filter tracks by sliding and pulling outward. Remove first filter by sliding it out of the opening in filter track. Locate filter removal tool, which is shipped next to the return air dampers. Use the filter removal tool to remove the remaining filters.

Outdoor-Air Inlet Screens — Outdoor-air inlet screens must be in place before operating unit.

Economizer Adjustment — Remove filter access panel. Check that outdoor-air damper is closed and return-air damper is open.

Economizer operation and adjustment is described in Sequence of Operation and Make Outdoor Air Inlet Adjustments sections (this page and page 25), respectively.

Sequence of Operation

NOTE: Unit is shipped with default values that can be changed through Service Tool or CCN software.

COOLING, CONSTANT VOLUME (CV) UNITS — On power up, the control module will activate the initialization software. The initialization software reads each DIP switch to determine the unit configuration. See Table 11A for units running Version 1.0 of the unit control software. See Table 11B for units running Version 2.0 of the unit control software. The initialization sequence: clears all alarms and alerts; re-maps the input/output database for CV operation; sets maximum heat stages to 2; and sets maximum cool stages to 3. The control module reads DIP switch no. 3 and determines if the unit will use expansion mode operation.

The TSTAT function performs a thermostat based control by monitoring Y1, Y2, W1, W2, and G inputs. These functions control stages: cool1, cool2, heat1, heat2, and the indoor fan, respectively. If the TSTAT function is not selected, the control module determines the occupancy state based on the system time schedules with a field-supplied sensor installed, or with remote occupied/unoccupied input. If Temperature Compensated Start is active, the unit will be controlled as in the Occupied mode. Version 1.0 of the unit control software requires an accessory sensor space temperature sensor control. User defined set points are shown in Table 19.

Occupied or unoccupied comfort set points must be selected. Use of the space temperature offset input can also be configured. The control module will set appropriate operating mode and fan control. The control module will turn on indoor fan if in Occupied mode or if the unit is in Unoccupied mode and the space temperature is outside of the unoccupied comfort set points (Unoccupied Heat or Unoccupied Cool). The control module will then monitor space temperature against comfort set points and control heating or cooling stages as required. If the system is in the Occupied mode, the economizer will operate as required. If the system is in Unoccupied mode, the system will perform night-time free cool and IAQ (indoor air quality) pre-occupancy purge as required (when functions are enabled via software). Whenever the DX (direct expansion) cooling is requested, the outdoor fan will operate.

Table I3 — Fan Performance, 50EJ,EK024-034 — Vertical Discharge Units (SI)

FOR EW,EY UNITS, REDUCE NET AVAILABLE EXTERNAL STATIC PRESSURE BY 75 PA

AIRFLOW (L/s)	AVAILABLE EXTERNAL STATIC PRESSURE (Pa)															
	50		100		150		200		250		300		350		400	
	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW
1900	5.4	0.60	6.7	0.80	7.8	1.10	8.7	1.30	9.6	1.60	10.4	1.90	11.1	2.10	11.8	2.40
2400	6.0	0.80	7.2	1.10	8.2	1.40	9.1	1.70	10.0	2.00	10.7	2.20	11.4	2.50	12.1	2.80
2800	6.7	1.20	7.8	1.50	8.8	1.80	9.6	2.10	10.4	2.40	11.1	2.70	11.8	3.00	12.5	3.30
3300	7.5	1.70	8.5	2.00	9.3	2.30	10.2	2.60	10.9	2.90	11.6	3.30	12.3	3.60	12.9	3.90
3800	8.2	2.20	9.2	2.60	10.0	2.90	10.7	3.20	11.5	3.60	12.1	3.90	12.8	4.30	13.4	4.60
3900	8.4	2.40	9.3	2.70	10.1	3.10	10.9	3.40	11.6	3.70	12.3	4.10	12.9	4.40	13.5	4.80
4200	9.1	2.90	9.9	3.20	10.7	3.60	11.4	4.00	12.0	4.30	12.7	4.70	13.3	5.00	13.9	5.40
4700	9.9	3.70	10.6	4.00	11.4	4.40	12.0	4.80	12.7	5.20	13.3	5.50	13.9	5.90	14.4	6.30
5200	10.7	4.60	11.4	5.00	12.1	5.30	12.7	5.70	13.3	6.10	13.9	6.50	14.5	6.90	15.0	7.30
5700	11.5	5.60	12.2	6.00	12.8	6.40	13.4	6.80	14.0	7.20	14.6	7.70	15.1	8.10	15.6	8.50
5900	12.0	6.10	12.6	6.60	13.2	7.00	13.8	7.40	14.4	7.80	14.9	8.30	15.4	8.70	15.9	9.10
6100	12.4	6.70	13.0	7.20	13.6	7.60	14.2	8.00	14.7	8.50	15.3	8.90	15.8	9.30	16.3	9.80
6500	13.0	7.70	13.6	8.10	14.2	8.60	14.7	9.00	15.3	9.50	15.8	9.90	16.3	10.40	16.8	10.80
6600	13.3	8.00	13.8	8.50	14.4	8.90	14.9	9.40	15.5	9.80	16.0	10.30	16.4	10.70	16.9	11.20
7100	14.1	9.50	14.7	9.90	15.2	10.40	15.7	10.90	16.2	11.30	16.7	11.80	17.2	12.30	17.6	12.70

AIRFLOW (L/s)	AVAILABLE EXTERNAL STATIC PRESSURE (Pa)															
	450		500		550		600		650		700		750		800	
	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW
1900	12.4	2.70	13.0	3.00	13.6	3.30	14.2	3.60	14.7	3.90	15.3	4.20	15.8	4.60	16.3	4.90
2400	12.7	3.10	13.3	3.40	13.9	3.80	14.5	4.10	15.0	4.40	15.5	4.70	16.0	5.10	16.5	5.40
2800	13.1	3.60	13.7	4.00	14.2	4.30	14.8	4.60	15.3	5.00	15.8	5.30	16.3	5.60	16.8	6.00
3300	13.5	4.30	14.1	4.60	14.6	4.90	15.1	5.30	15.6	5.60	16.1	6.00	16.6	6.30	17.1	6.70
3800	13.9	5.00	14.5	5.30	15.0	5.70	15.5	6.00	16.0	6.40	16.5	6.80	17.0	7.10	17.4	7.50
3900	14.1	5.20	14.6	5.50	15.1	5.90	15.6	6.20	16.1	6.60	16.6	7.00	17.1	7.30	17.5	7.70
4200	14.4	5.80	15.0	6.10	15.5	6.50	16.0	6.90	16.5	7.30	16.9	7.60	17.4	8.00	17.8	8.40
4700	15.0	6.70	15.5	7.10	16.0	7.50	16.5	7.90	16.9	8.20	17.4	8.60	17.8	9.00	18.3	9.40
5200	15.5	7.70	16.0	8.10	16.5	8.50	17.0	8.90	17.4	9.40	17.9	9.80	18.3	10.20	18.7	10.60
5700	16.1	8.90	16.6	9.30	17.1	9.70	17.5	10.20	18.0	10.60	18.4	11.00	18.8	11.40	19.2	11.80
5900	16.4	9.50	16.9	10.00	17.4	10.40	17.8	10.80	18.2	11.20	18.7	11.70	19.1	12.10	19.5	12.50
6100	16.7	10.20	17.2	10.60	17.7	11.10	18.1	11.50	18.5	11.90	18.9	12.40	19.4	12.80	19.8	13.20
6500	17.2	11.30	17.7	11.70	18.1	12.10	18.5	12.60	19.0	13.00	19.4	13.50	19.8	13.90	—	—
6600	17.4	11.60	17.8	12.10	18.3	12.50	18.7	13.00	19.1	13.40	19.5	13.90	19.9	14.30	—	—
7100	18.1	13.20	18.5	13.70	18.9	14.10	19.3	14.60	19.7	15.10	—	—	—	—	—	—

AIRFLOW (L/s)	AVAILABLE EXTERNAL STATIC PRESSURE (Pa)					
	850		900		950	
	r/s	BkW	r/s	BkW	r/s	BkW
1900	16.7	5.20	17.2	5.50	17.6	5.90
2400	17.0	5.70	17.4	6.10	17.9	6.40
2800	17.2	6.30	17.7	6.70	18.1	7.00
3300	17.5	7.00	18.0	7.40	18.4	7.80
3800	17.9	7.90	18.3	8.20	18.7	8.60
3900	18.0	8.10	18.4	8.50	18.8	8.80
4200	18.3	8.80	18.7	9.20	19.1	9.60
4700	18.7	9.80	19.1	10.20	19.5	10.60
5200	19.2	11.00	19.6	11.40	20.0	11.80
5700	19.6	12.30	20.0	12.70	—	—
5900	19.9	13.00	—	—	—	—
6100	—	—	—	—	—	—
6500	—	—	—	—	—	—
6600	—	—	—	—	—	—
7100	—	—	—	—	—	—

LEGEND

BkW — Motor Brake (Output) Power (kW)
r/s — Fan Wheel Speed, Revolutions per Second

NOTES:

1. Fan performance is based on wet coils, economizer, roof curb, cabinet losses, and clean 51 mm (2-in.) filters.
2. Conversion — Bhp to Watts:

$$\text{Watts} = \frac{\text{Bhp} \times 746}{\text{Motor efficiency}}$$

3. Variable air volume (VAV) units will operate down to 9.39 l/s per kW (70 cfm/ton).

Table 14 — Fan Performance, 50EJ,EK044 — Vertical Discharge Units (SI)
FOR EW,EY UNITS, REDUCE NET AVAILABLE EXTERNAL STATIC PRESSURE BY 125 PA

AIRFLOW (L/s)	AVAILABLE EXTERNAL STATIC PRESSURE (Pa)															
	50		100		150		200		250		300		350		400	
	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW
3800	7.5	1.60	8.3	2.10	9.1	2.40	9.8	2.70	10.5	3.00	11.2	3.30	11.8	3.60	12.5	3.90
4200	8.2	2.10	8.9	2.70	9.7	3.00	10.3	3.40	11.0	3.70	11.6	4.00	12.2	4.30	12.8	4.60
4700	8.9	2.80	9.6	3.50	10.3	3.80	10.9	4.10	11.5	4.40	12.1	4.80	12.7	5.10	13.2	5.40
5200	9.7	3.50	10.3	4.30	10.9	4.60	11.5	5.00	12.1	5.30	12.7	5.70	13.2	6.00	13.7	6.40
5600	10.5	4.30	11.1	5.20	11.6	5.60	12.2	6.00	12.7	6.30	13.2	6.70	13.7	7.10	14.2	7.40
6100	11.3	5.20	11.8	6.30	12.3	6.70	12.8	7.10	13.3	7.50	13.8	7.80	14.3	8.20	14.8	8.60
6600	12.0	6.30	12.5	7.50	13.0	7.90	13.5	8.30	14.0	8.70	14.5	9.10	14.9	9.50	15.4	9.90
7100	12.8	7.50	13.3	8.90	13.8	9.30	14.2	9.70	14.7	10.10	15.1	10.50	15.5	11.00	16.0	11.40
7600	13.6	8.80	14.1	10.40	14.5	10.80	14.9	11.30	15.4	11.70	15.8	12.10	16.2	12.50	16.6	13.00
8000	14.4	10.20	14.8	12.10	15.3	12.50	15.7	13.00	16.1	13.40	16.5	13.80	16.9	14.30	17.2	14.70
8500	15.2	11.80	15.6	13.90	16.0	14.40	16.4	14.80	16.8	15.30	17.2	15.70	17.5	16.20	17.9	16.60
9000	16.0	13.50	16.4	15.90	16.8	16.40	17.1	16.80	17.5	17.30	17.9	17.80	18.2	18.20	18.6	18.70
9400	16.8	15.40	17.2	18.10	17.5	18.50	17.9	19.00	18.2	19.50	18.6	20.00	18.9	20.50	19.3	21.00

AIRFLOW (L/s)	AVAILABLE EXTERNAL STATIC PRESSURE (Pa)															
	450		500		550		600		650		700		750		800	
	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW	r/s	BkW
3800	13.0	4.20	13.6	4.60	14.2	4.90	14.7	5.20	15.3	5.60	15.8	5.90	16.3	6.20	16.8	6.60
4200	13.4	5.00	13.9	5.30	14.5	5.60	15.0	6.00	15.5	6.30	16.0	6.70	16.5	7.00	17.0	7.40
4700	13.8	5.80	14.3	6.10	14.8	6.50	15.3	6.80	15.8	7.20	16.3	7.60	16.8	7.90	17.2	8.30
5200	14.2	6.70	14.7	7.10	15.2	7.50	15.7	7.80	16.2	8.20	16.6	8.60	17.1	9.00	17.5	9.30
5600	14.7	7.80	15.2	8.20	15.7	8.60	16.1	8.90	16.6	9.30	17.0	9.70	17.4	10.10	17.8	10.50
6100	15.2	9.00	15.7	9.40	16.1	9.80	16.6	10.20	17.0	10.60	17.4	11.00	17.8	11.40	18.2	11.80
6600	15.8	10.30	16.2	10.70	16.7	11.10	17.1	11.50	17.5	12.00	17.9	12.40	18.3	12.80	18.7	13.20
7100	16.4	11.80	16.8	12.20	17.2	12.60	17.6	13.00	18.0	13.50	18.4	13.90	18.8	14.30	19.1	14.80
7600	17.0	13.40	17.4	13.80	17.8	14.30	18.1	14.70	18.5	15.10	18.9	15.60	19.3	16.00	19.6	16.50
8000	17.6	15.20	18.0	15.60	18.4	16.10	18.7	16.50	19.1	17.00	19.4	17.40	19.8	17.90	—	—
8500	18.3	17.10	18.6	17.60	19.0	18.00	19.3	18.50	19.7	18.90	—	—	—	—	—	—
9000	18.9	19.20	19.3	19.70	19.6	20.10	19.9	20.60	—	—	—	—	—	—	—	—
9400	19.6	21.40	19.9	21.90	—	—	—	—	—	—	—	—	—	—	—	—

AIRFLOW (L/s)	AVAILABLE EXTERNAL STATIC PRESSURE (Pa)					
	850		900		950	
	r/s	BkW	r/s	BkW	r/s	BkW
3800	17.3	6.90	17.7	7.30	18.2	7.60
4200	17.4	7.70	17.9	8.10	18.3	8.50
4700	17.7	8.70	18.1	9.00	18.5	9.40
5200	17.9	9.70	18.4	10.10	18.8	10.50
5600	18.3	10.90	18.7	11.30	19.1	11.70
6100	18.6	12.20	19.0	12.60	19.4	13.00
6600	19.1	13.60	19.4	14.00	19.8	14.50
7100	19.5	15.20	19.9	15.60	—	—
7600	20.0	16.90	—	—	—	—
8000	—	—	—	—	—	—
8500	—	—	—	—	—	—
9000	—	—	—	—	—	—
9400	—	—	—	—	—	—

LEGEND

BkW — Motor Brake (Output) Power (kW)
r/s — Fan Wheel Speed, Revolutions per Second

NOTES:

- Fan performance is based on wet coils, economizer, roof curb, cabinet losses, and clean 51 mm (2-in.) filters.
- Conversion — Bhp to Watts:

$$\text{Watts} = \frac{\text{Bhp} \times 746}{\text{Motor efficiency}}$$

- Variable air volume (VAV) units will operate down to 9.39 l/s per kW (70 cfm/ton).

Table 15 — Fan Performance, 50EJ,EK024-034 — Vertical Discharge Units (English)

FOR EW,EY UNITS, REDUCE NET AVAILABLE EXTERNAL STATIC PRESSURE BY 0.3 IN. WG

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)															
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
4,000	322	0.77	401	1.09	466	1.43	523	1.78	575	2.13	622	2.50	666	2.87	707	3.25
5,000	361	1.14	433	1.50	494	1.86	548	2.23	598	2.62	643	3.00	686	3.40	726	3.80
6,000	403	1.62	468	2.01	526	2.41	577	2.81	624	3.21	668	3.62	709	4.04	748	4.46
7,000	448	2.22	508	2.65	561	3.08	609	3.50	654	3.93	696	4.37	736	4.81	773	5.25
8,000	495	2.97	549	3.42	599	3.88	645	4.33	687	4.79	727	5.25	765	5.71	801	6.18
8,250	507	3.18	560	3.64	609	4.10	654	4.56	696	5.02	735	5.49	773	5.96	809	6.43
9,000	543	3.85	593	4.34	639	4.82	682	5.30	723	5.78	761	6.27	797	6.76	832	7.24
10,000	592	4.90	638	5.41	682	5.91	722	6.42	760	6.93	797	7.44	832	7.95	865	8.46
11,000	642	6.10	685	6.64	725	7.17	764	7.70	800	8.24	835	8.77	868	9.30	900	9.84
12,000	693	7.48	733	8.04	771	8.60	807	9.15	841	9.71	874	10.26	906	10.82	937	11.38
12,500	718	8.23	757	8.80	794	9.37	829	9.94	862	10.51	895	11.08	926	11.64	956	12.21
13,000	744	9.03	781	9.62	817	10.20	851	10.78	884	11.36	915	11.93	946	12.51	975	13.09
13,750	783	10.32	818	10.92	852	11.52	885	12.12	917	12.71	947	13.31	977	13.90	1005	14.50
14,000	795	10.77	831	11.38	864	11.98	896	12.59	928	13.19	958	13.79	987	14.39	1015	14.99
15,000	847	12.71	880	13.34	912	13.96	943	14.59	972	15.21	1001	15.83	1029	16.45	1056	17.08

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)															
	1.8		2.0		2.2		2.4		2.6		2.8		3.0		3.2	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
4,000	746	3.64	783	4.03	818	4.44	852	4.85	884	5.26	916	5.68	946	6.11	975	6.54
5,000	764	4.21	800	4.62	834	5.04	868	5.46	900	5.89	930	6.33	960	6.77	989	7.22
6,000	785	4.89	820	5.32	854	5.76	886	6.21	918	6.65	948	7.11	977	7.56	1006	8.02
7,000	809	5.70	843	6.16	876	6.61	908	7.08	939	7.54	968	8.01	997	8.49	1025	8.96
8,000	836	6.65	869	7.12	901	7.60	932	8.08	962	8.57	991	9.05	1019	9.55	1046	10.04
8,250	843	6.91	876	7.39	908	7.87	938	8.36	968	8.84	997	9.34	1025	9.83	1052	10.33
9,000	865	7.74	898	8.23	929	8.73	959	9.23	988	9.74	1016	10.24	1043	10.75	1070	11.27
10,000	897	8.98	928	9.49	958	10.01	987	10.53	1016	11.06	1043	11.58	1070	12.11	1096	12.64
11,000	931	10.37	961	10.91	990	11.45	1018	11.99	1046	12.54	1073	13.08	1099	13.63	1124	14.18
12,000	967	11.94	996	12.49	1024	13.06	1051	13.62	1078	14.18	1104	14.75	1129	15.31	1154	15.88
12,500	985	12.78	1014	13.35	1041	13.92	1068	14.49	1094	15.07	1120	15.64	1145	16.22	1169	16.80
13,000	1004	13.67	1032	14.25	1059	14.83	1086	15.42	1111	16.00	1137	16.59	1161	17.17	1185	17.76
13,750	1033	15.09	1060	15.69	1087	16.29	1112	16.88	1138	17.48	1162	18.08	1186	18.68	—	—
14,000	1043	15.59	1070	16.19	1096	16.79	1122	17.40	1147	18.00	1171	18.60	1195	19.21	—	—
15,000	1083	17.70	1109	18.32	1134	18.94	1159	19.56	1183	20.19	—	—	—	—	—	—

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)					
	3.4		3.6		3.8	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
4,000	1004	6.97	1032	7.41	1059	7.86
5,000	1017	7.67	1045	8.12	1072	8.58
6,000	1034	8.49	1061	8.96	1087	9.43
7,000	1052	9.44	1079	9.93	1105	10.42
8,000	1073	10.54	1099	11.04	1125	11.55
8,250	1079	10.84	1105	11.34	1130	11.85
9,000	1096	11.78	1122	12.30	1147	12.82
10,000	1122	13.18	1147	13.71	1171	14.25
11,000	1149	14.73	1173	15.29	1197	15.84
12,000	1178	16.45	1202	17.03	—	—
12,500	1193	17.38	—	—	—	—
13,000	—	—	—	—	—	—
13,750	—	—	—	—	—	—
14,000	—	—	—	—	—	—
15,000	—	—	—	—	—	—

LEGEND

Bhp — Brake Horsepower

NOTES:

1. Fan performance is based on wet coils, economizer, roof curb, cabinet losses, and clean 2-in. filters.
2. Conversion — Bhp to watts:

$$\text{Watts} = \frac{\text{Bhp} \times 746}{\text{Motor efficiency}}$$

3. Variable air volume (VAV) units will operate down to 70 cfm/ton.

Table 16 — Fan Performance, 50EJ,EK044 — Vertical Discharge Units (English)

For EW,EY UNITS, REDUCE NET AVAILABLE EXTERNAL STATIC PRESSURE BY 0.5 IN. WG

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)															
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
8,000	448	2.18	498	2.87	544	3.25	589	3.64	631	4.04	671	4.44	710	4.86	747	5.27
9,000	492	2.87	537	3.68	580	4.09	621	4.50	660	4.92	698	5.35	734	5.78	769	6.22
10,000	537	3.69	578	4.63	617	5.07	655	5.50	692	5.95	727	6.39	761	6.85	795	7.30
11,000	582	4.65	620	5.75	657	6.20	692	6.66	726	7.13	759	7.60	792	8.07	823	8.55
12,000	629	5.75	664	7.02	698	7.50	730	7.98	763	8.47	794	8.96	824	9.45	854	9.95
13,000	675	7.00	708	8.48	739	8.98	770	9.48	800	9.99	830	10.50	859	11.01	887	11.53
14,000	722	8.42	753	10.11	782	10.63	811	11.16	840	11.69	868	12.22	895	12.75	922	13.29
15,000	770	10.00	798	11.94	826	12.48	853	13.03	880	13.57	907	14.13	932	14.68	958	15.24
16,000	817	11.76	844	13.96	870	14.53	896	15.09	922	15.66	947	16.23	971	16.81	995	17.38
17,000	865	13.70	890	16.19	915	16.78	940	17.37	964	17.95	988	18.54	1011	19.14	1034	19.73
18,000	913	15.83	937	18.64	961	19.25	984	19.85	1007	20.46	1030	21.07	1052	21.68	1074	22.30
19,000	961	18.16	984	21.32	1006	21.94	1029	22.56	1050	23.19	1072	23.82	1093	24.45	1115	25.08
20,000	1009	20.69	1031	24.22	1052	24.86	1074	25.50	1095	26.15	1115	26.80	1136	27.45	1156	28.10

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)															
	1.8		2.0		2.2		2.4		2.6		2.8		3.0		3.2	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
8,000	783	5.70	818	6.13	852	6.56	884	7.00	916	7.45	947	7.90	978	8.36	1007	8.82
9,000	803	6.66	836	7.11	869	7.56	900	8.02	930	8.48	960	8.95	989	9.42	1018	9.90
10,000	827	7.77	858	8.23	889	8.70	919	9.18	948	9.66	977	10.15	1005	10.64	1032	11.13
11,000	854	9.03	884	9.51	913	10.00	941	10.50	969	11.00	997	11.50	1024	12.01	1050	12.52
12,000	883	10.45	911	10.96	939	11.47	967	11.98	993	12.50	1020	13.02	1046	13.54	1071	14.07
13,000	914	12.05	942	12.57	968	13.10	994	13.63	1020	14.17	1045	14.71	1070	15.25	1094	15.79
14,000	948	13.83	974	14.37	999	14.92	1024	15.47	1049	16.02	1073	16.58	1096	17.14	1120	17.70
15,000	983	15.80	1007	16.36	1032	16.92	1056	17.49	1079	18.06	1102	18.64	1125	19.21	1148	19.79
16,000	1019	17.96	1043	18.54	1066	19.13	1089	19.71	1111	20.30	1134	20.89	1156	21.49	1177	22.08
17,000	1057	20.33	1079	20.93	1102	21.53	1124	22.14	1145	22.75	1167	23.35	1188	23.97	—	—
18,000	1096	22.91	1117	23.53	1138	24.15	1160	24.78	1180	25.40	—	—	—	—	—	—
19,000	1135	25.72	1156	26.36	1176	26.99	1197	27.63	—	—	—	—	—	—	—	—
20,000	1176	28.75	1196	29.41	—	—	—	—	—	—	—	—	—	—	—	—

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)					
	3.4		3.6		3.8	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
8,000	1036	9.29	1065	9.76	1092	10.24
9,000	1046	10.38	1073	10.87	1100	11.36
10,000	1059	11.63	1086	12.13	1112	12.64
11,000	1076	13.03	1102	13.55	1127	14.07
12,000	1096	14.60	1121	15.13	1145	15.67
13,000	1118	16.34	1142	16.89	1165	17.45
14,000	1143	18.26	1166	18.83	1188	19.40
15,000	1170	20.37	1192	20.96	—	—
16,000	1199	22.68	—	—	—	—
17,000	—	—	—	—	—	—
18,000	—	—	—	—	—	—
19,000	—	—	—	—	—	—
20,000	—	—	—	—	—	—

LEGEND

Bhp — Brake Horsepower

NOTES:

- Fan performance is based on wet coils, economizer, roof curb, cabinet losses, and clean 2-in. filters.
- Conversion – Bhp to watts:

$$\text{Watts} = \frac{\text{Bhp} \times 746}{\text{Motor efficiency}}$$
- Variable air volume (VAV) units will operate down to 70 cfm/ton.

Table 17 — Air Quantity Limits

UNIT 50EJ,EK,EW,EY	MINIMUM HEATING AIRFLOW		MINIMUM COOLING AIRFLOW (VAV)		MINIMUM COOLING AIRFLOW (CV)		MAXIMUM AIRFLOW	
	L/s	CFM	L/s	CFM	L/s	CFM	L/s	CFM
024	2,800	6,000	900	2000	2800	6,000	4,700	10,000
028	3,500	7,500	1200	2500	3500	7,500	5,900	12,500
030	3,900	8,250	1300	2750	3900	8,250	6,500	13,750
034	4,200	9,000	1400	3000	4200	9,000	7,100	15,000
044	5,600	12,000	1900	4000	5600	12,000	9,400	20,000

LEGEND

CV — Constant Volume
VAV — Variable Air Volume

Table 18 — Motor Limitations

STANDARD EFFICIENCY MOTORS						
Nominal		Maximum		Maximum Amps	Maximum Watts*	Motor Efficiency*
kW	Hp	BkW	Bhp	380/400 v		
3.73	5	4.4	5.9	11.0/ 7.9	5,240	84.0
5.60	7.5	7.1	9.5	15.0/13.0	8,549	82.9
7.46	10	8.8	11.8	20.7/14.6	10,284	85.6
11.19	15	13.4	18.0	27.0/21.9	15,891	84.5
14.92	20	17.5	23.4	37.4/28.7	19,950	87.5
18.65	25	21.9	29.4	37.4/37.4	25,181	87.1

LEGEND

Bhp — Brake Horsepower

*400-v only. 380-v data unavailable at this time.

NOTE: Extensive motor and electrical testing on the Carrier units has ensured that the full kW and horsepower range of the motor can be utilized with confidence. Using your fan motors up to the kW and horsepower ratings shown on the Motor Limitations table will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected.

Table 19 — User Defined Set Points

SET POINT	FORMAT	DESCRIPTION	LIMITS	DEFAULT	
OHSP	xx.xF	Occupied Heat Set Point	13 to 27 C (55 to 80 F)	20 C	68 F
OCSP	xx.xF	Occupied Cool Set Point	13 to 27 C (55 to 80 F)	26 C	78 F
UHSP	xx.xF	Unoccupied Heat Set Point	4 to 27 C (40 to 80 F)	13 C	55 F
UCSP	xx.xF	Unoccupied Cool Set Point	24 to 35 C (75 to 95 F)	32 C	90 F
SASP	xx.xF	Supply Air Set Point	7 to 21 C (45 to 70 F)	13 C	55 F
OATL	xx.xF	Hi OAT Lockout Temperature	13 to 35 C (55 to 75 F)	18 C	65 F
NTLO	xx.xF	Unoccupied OAT Lockout Temperature	4 to 21 C (40 to 70 F)	10 C	50 F
RTIO	xx.x	Reset Ratio	0 to 10	3	3
LIMT	xx.x°F	Reset Limit	-18 to -7 C (0 to 20 F)	-12 C	10 F
MDP	xxx%	Minimum Damper Position	0 to 100%	20%	20%
IAQS	xxxx	IAQ Set Point	1 to 5000 PPM	650 PPM	650 PPM
UHDB	xx.x°F	Unoccupied Heating Deadband	-18 to -12 C (0 to 10 F)	-17 C	1 F
UCDB	xx.x°F	Unoccupied Cooling Deadband	-18 to -12 C (0 to 10 F)	-17 C	1 F
LTMP	xx.xF	Low Temp. Min. Position	-18 to 38 C (0 to 100 F)	-12 C	10 F
HTMP	xx.xF	High Temp. Min. Position	-18 to 38 C (0 to 100 F)	2 C	35 F
PES1	xx.xF	CV Power Exhaust Stage 1 Point	0 to 100%	25%	25%
PES2	xx.xF	CV Power Exhaust Stage 2 Point	0 to 100%	75%	75%

LEGEND

CV — Constant Volume
IAQ — Indoor Air Quality
OAT — Outdoor Air Temperature

The control module will operate economizer, run diagnostics to monitor alarms/alerts at all times, and respond to CCN communications to perform any configured network POC (product outboard control) functions such as time/outdoor-air temperature broadcast and global occupancy broadcast. When the optional expansion I/O board is employed, it will: perform a periodic scan and maintain a database of expanded I/O points; perform Fire/Smoke control (power exhaust required); if in Occupied mode, perform IAQ control and monitor the fan, filter, demand limit, and field-applied status (with accessories).

If thermostats are used to energize the G input, the control module will turn on the indoor fan without delay and open the economizer dampers to minimum position. If thermostats are used to deenergize the G input, the control module will turn off the indoor fan without delay and close the economizer dampers.

When cooling, G must be energized before cooling can operate. The control module determines if outdoor conditions are suitable for economizer cooling using the standard outdoor air thermistor. For the economizer to function for outside air cooling: the enthalpy must be below the enthalpy set point; the outdoor-air temperature must be equal to or less than the High Outdoor Air Temperature Lockout (default is 18 C [65 F]); the SAT (supply-air temperature) thermistor must not be in alarm; and the outdoor air reading is available. When these conditions are satisfied, the control module will use economizer as the first stage of cooling.

When Y1 input is energized, the economizer will be modulated to maintain SAT at the defined set point. (The default is 13 C [55 F].) When SAT is above the set point, the economizer will be 100% open. When SAT is below the set point, the economizer will modulate between minimum and 100% open position. When Y2 is energized, the control module will turn on compressor 1 and continue to modulate the economizer as described above. If the Y2 remains energized and the SAT reading remains above the set point for 15 minutes, compressor 2 will turn on. If Y2 is deenergized at any time, only the last stage of compression that was energized will be turned off. If outdoor conditions are not suitable for economizer cooling, the economizer will go to minimum position and cycle compressors 1 and 2 based on demand from Y1 and Y2 respectively. The compressors will be locked out when the SAT temperature is too low (less than 4 C [40 F] for compressor 1 and less than 7 C [45 F] for compressor 2). After a compressor is locked out, it can restart after normal time-guard period.

The Time Guard® function maintains a minimum off time of 5 minutes, a minimum on time of 10 seconds, and a minimum delay before starting the second compressor of 10 seconds.

When heating, the heat stages respond to the demand from W1 and W2 of the thermostat input. Heating and cooling will be mutually locked out on demand on a first call basis. The heating and the cooling functions cannot operate simultaneously.

COOLING, VARIABLE VOLUME UNITS — On power up, the control module will activate the initialization software. The initialization software reads each DIP switch to determine the unit configuration. See Table 10A for units running Version 1.0 of the unit control software. See Table 10B for units running Version 2.0 of the unit control software. The initialization sequence: clears all alarms and alerts; re-maps the input/output database for VAV operation; sets maximum heat stages to 1; and sets maximum cool stages to 6. The control module reads DIP switch no. 3 and determines if the unit will use expansion mode operation. Power up takes a random time of 1 to 63 seconds plus 5 minutes the first time power is sent to the control board after a power outage.

The control module will determine if an interface (linkage) is active and if the unit will operate in a Digital Air Volume (DAV) mode. In a DAV system, the room terminals are equipped with microprocessor controls that give commands to the base unit module. If a linkage is active, the control module will replace local comfort set points, space and return air temperatures, and occupancy status with the linkage data supplied.

The control module will determine occupancy status from Time Schedules (if programmed), Remote Occupied/Unoccupied input, global occupancy schedules, or DAV. If temperature compensated start is active, the unit will be controlled as in the Occupied mode.

NOTE: The temperature compensated start is a period of time calculated to bring the unit on while in Unoccupied mode to reach the occupied set point when occupancy occurs.

The control module will set the appropriate operating mode and fan control. The control module will turn on the VFD if Occupied mode is evident. If in Unoccupied mode and a valid space temperature (units running Version 1.0 of unit control software) or return-air temperature (units running Version 2.0 of unit control software) reading is available (either from a sensor or DAV), the control module will monitor SPT (space temperature) (units running Version 1.0 of unit control software) or return-air temperature (units running Version 2.0 of unit control software) against unoccupied heat and cool set points. The control module will start the VFD whenever SPT (units running Version 1.0 of unit control software) or return-air temperature (units running Version 2.0 of unit control software) is outside of the set points (Unoccupied Heat or Unoccupied Cool). The VFD may also be started by nighttime thermostat via remote Occupied/Unoccupied input or by a temperature compensated start algorithm. When the VFD is running in a normal mode, the control module will start heating or cooling as required to maintain supply-air temperature at the supply air set point plus the reset (when enabled). The reset value is determined by SAT (supply-air temperature) reset and/or space temperature reset algorithms. The reset is only available when enabled through software.

When cooling, the control module will energize the power exhaust enable output to the external power exhaust controller (when power exhaust is used).

The control module will run continuous diagnostics for alarms/alerts; respond to CCN (Carrier Comfort Network) communications; perform any configured network POC (Product Outboard Control) functions such as time/outdoor air temperature broadcast and global broadcast; and perform Fire/Smoke control.

HEATING, CONSTANT VOLUME (CV) UNITS — The control module is powered by 24 vac. If the unit is controlled with a room sensor, the fan will run continuously in the Occupied mode, with the outside-air damper in the minimum position. If the unit is controlled through a room thermostat (with FAN set to AUTO), upon a call for heat the first stage of heat is energized, the indoor-fan motor will turn on, and the outdoor-air damper will move to the minimum position. Upon a call for additional heat (if the unit is equipped with a two-stage heater), the second stage of heat is energized. When the call for heat is satisfied, the heaters will deenergize. The indoor-fan motor will also deenergize (unless controlled by a room sensor) and the outdoor-air damper will move to the closed position.

If the unit is controlled with a room sensor the fan will not run in the unoccupied mode. Upon a call for heat, the first stage of heat is energized, the indoor-fan motor will turn on, and the outdoor air damper will move to the Unoccupied IAQ position (generally set to zero in the unoccupied mode).

The IAQ feature is enabled through system software. Upon a call for additional heat (if the unit is equipped with a two-stage heater), the second stage of heat is energized. When the call for heat is satisfied, the heaters and indoor-fan motor will deenergize and the outdoor-air damper will move to the closed position (if open).

HEATING, VARIABLE AIR VOLUME (VAV) UNITS — The control board is powered by 24 vac. When there is a call for heating (from Morning Warm-Up, Unoccupied, or Occupied modes), power is sent from the control module to energize the first stage of electric heat. A field-supplied heat interlock relay signals for the air terminals to fully open. See Fig. 35. In the Occupied mode, the indoor-fan motor will operate continuously and the outdoor-air dampers will be in the minimum position. In the Unoccupied mode, the indoor-fan motor will be off, but will energize upon the call for heat. The outdoor-air dampers will move to the IAQ unoccupied position (generally set to zero in the Unoccupied mode). The IAQ feature is enabled through system software. The duct pressure sensor will signal to the variable frequency drive to operate at full speed. Upon a call for additional heat (if the unit is equipped with a two-stage heater), the second stage of heat will be energized. When the call for heat is satisfied, the heaters will deenergize.

NOTE: The HIR is not needed in a DAV system.

If the unit is in the Unoccupied mode, the indoor-fan motor will deenergize and the outdoor-air damper will move to the closed position (if open).

MORNING WARM-UP (VAV ONLY WITH PC ACCESSED/CCN OPERATION) — Morning warm-up occurs when the control module has been programmed to turn on heat, prior to the Occupied mode, to be ready for the occupancy. Morning warm-up is a condition in VAV systems that occurs when the Temperature Compensated Start algorithm calculates a biased occupied start time and the unit has a demand for heating. The warm-up will continue into the occupied period as long as there is a need for heat. During warm-up, the unit can continue heating into the occupied period, even if occupied heating is disabled. When the heating demand is satisfied, the warm-up condition will terminate. To increase or decrease the heating demand, use the network access software to change the occupied heating set point.

NOTE: To utilize morning warm-up mode, the unit occupancy schedule must be accessed via Service Tool, Comfort Works, or Building Supervisor software (units running Version 1.0 of unit control software).

MORNING WARM-UP (VAV ONLY WITH STAND-ALONE OPERATION) — When a unit running version 2.0 of the unit control software operates in stand-alone mode, morning warm-up occurs when the unit is energized in Occupied mode and return-air temperature (RAT) is below 20 C (68 F). Warm-up will not terminate until the RAT reaches 20 C (68 F). The heat interlock relay output is energized during morning warm-up. (A field-installed 24-vdc heat interlock relay is required.) The output will be energized until the morning warm-up cycle is complete. Refer to Fig. 35 for heat interlock relay wiring.

SPACE TEMPERATURE RESET (VAV ONLY) — An accessory space temperature sensor is required. Space temperature reset is used to reset the supply-air temperature set point of a VAV system higher, as the space temperature falls below the Occupied Cool set point. As the space temperature falls below the cool set point, the supply-air temperature will be reset upward as a function of the reset ratio.

Reset ratio is expressed in degrees change in supply-air temperature per degree of space temperature change. A reset limit will exist which will limit the maximum number of degrees the supply-air temperature may be raised. Both the reset ratio and the reset limit are user definable. The sequence of operation is as follows:

1. The on/off status of the unit supply fan is determined.
2. If the fan is on, the sequence will check if the system is in Occupied mode.
3. If the system is in Occupied mode, the sequence will determine if the reset option is enabled.
4. If the reset option is enabled, the sequence will read the space temperature and compare it to the Occupied Cool set point. If the temperature is below the Occupied Cool set point, the algorithm will compute the reset value and compare this value against the reset limit. If it is greater than the reset limit, the sequence will use the reset limit as the reset value.

The field-supplied space temperature sensor input signal (4 to 20 Ma and 2 to 10 vdc) enables the space temperature reset function. Refer to Fig. 36 for sensor wiring.

POWER EXHAUST OPERATION — The optional power exhaust packages are factory- or field-installed with vertical units and optionally installed in the return air ductwork for horizontal applications. The standard (only offered with constant volume units) and modulating power exhaust (offered

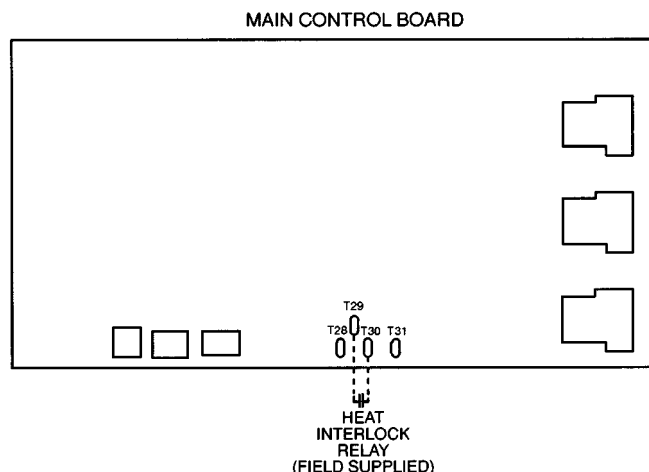


Fig. 35 — Heat Interlock Relay Wiring

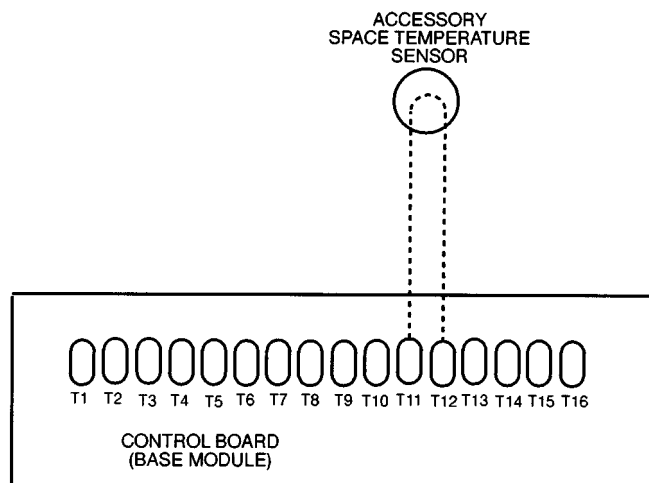


Fig. 36 — Space Temperature Sensor Wiring

on VAV units and CV units with non-modulating to modulating accessory conversion kit) are the 2 packages available. The modulating power exhaust package is equipped with a field-adjustable static pressure controller which will control up to 4 power exhaust stages to maintain a building static pressure. The blue sequencer located in the control box below the control board can be adjusted by removing the covers and adjusting the set point dial to the desired building pressure. The standard power exhaust package controls up to 2 stages of power exhaust to maintain building pressure. These power exhaust stages are staged according to a percentage of the economizer damper position. The default values are 25% for Stage 1 and 75% for Stage 2. This package has set points that are adjustable through software (such as Service Tool, Building Supervisor, or Comfort Works).

CAPACITY CONTROL, COOLING — The cooling capacity staging tables are shown in Tables 20 and 21.

**Table 20 — Cooling Capacity Staging Table
CV Units with 2 Compressors**

STAGES	0	1 ECONOMIZER	2	3
Compressor 1	Off	Off	On	On
Compressor 2	Off	Off	Off	On

NOTE: On CV units that require additional unloading, add suction pressure unloaders on compressor 1 only.

**Table 21 — Cooling Capacity Staging Table
VAV Units with 2 Compressors
and 2 Unloaders***

STAGES	0	1	2	3	4	5	6
Compressor 1	Off	On	On	On	On	On	On
Unloader 1	Off	On	On	Off	On	On	Off
Unloader 2	Off	On	Off	Off	On	Off	Off
Compressor 2	Off	Off	Off	Off	On	On	On

*Size 044 units have only 1 unloader.

FIELD TEST — The field test program is initiated by moving up DIP switch no. 4 to the OPEN position. The outdoor-air damper will close. The control allows 90 seconds for the damper to close in case it was in the full open position. Next, the indoor-fan contactor will be energized, and the outside-air damper will begin to open to its default value of 20% and stay at that position for a short period of time. The outdoor-air damper will then open to its full open position and stay at that position for a short period of time. The outdoor-air damper will then close.

If the unit is equipped with power exhaust, stage 1 will be energized for 5 seconds. If the unit is configured for stage 2 of power exhaust, stage 2 will be energized for 5 seconds after the first stage is deenergized.

The first stage of heat will be energized for 30 seconds, after which the second stage heat will be energized for an additional 30 seconds. Heat is then deenergized.

The last step is the Cooling mode. Outdoor-fan contactor no. 1 is energized. This is followed by each stage of cooling energized with a 10-second delay between stages. After this is complete, outdoor-fan contactor no. 2 is energized for 10 seconds.

The compressors will now deenergize, followed by the outdoor-fan contactors and indoor-fan contactors.

The field test is then complete.

TIME GUARD® CIRCUIT — The Time Guard function (built into the rooftop's control module board) maintains a minimum off time of 5 minutes and a minimum on time of 10 seconds.

CRANKCASE HEATER — The unit main power supply must remain on to provide crankcase heater operation. The crankcase heater in each compressor keeps oil free of refrigerant while compressor is off.

HEAD PRESSURE CONTROL — Each unit has a fan cycling, outdoor thermostat to shut off outdoor-fan motor(s) at 13 C (55 F) (one outdoor-fan motor on 024-034 units and 2 outdoor-fan motors on 044 units). The head pressure control permits the unit to operate with correct condensing temperatures down to 2 C (35 F) outdoor-air temperature.

MOTORMASTER® III DEVICE — The Motormaster III Solid-State Head Pressure Control is a field-installed accessory, fan speed control device actuated by a temperature sensor. The Motormaster III device is specifically designed for use on Carrier equipment and controls the outdoor-fan motor speed in response to the saturated condensing temperature. For outdoor temperatures down to -29 C (-20 F), the Motormaster III device maintains condensing temperature at 38 C (100 F).

SERVICE

⚠ WARNING

Before performing service or maintenance operations on unit, turn off main power switch to unit. Turn off accessory heater power switch if applicable. Electrical shock could cause personal injury.

Service Access — All unit components can be reached through clearly labelled hinged access doors. These doors are not equipped with tiebacks, so if heavy duty servicing is needed, either remove them or prop them open to prevent accidental closure.

Each door is held closed with 3 latches. The latches are secured to the unit with a single ¼-in. - 20 x ½-in. long bolt. See Fig. 37.

To open, loosen the latch bolt using a 7/16-in. wrench. Pivot the latch so it is not in contact with the door. Open the door. To shut, reverse the above procedure.

NOTE: Disassembly of the top cover may be required under special service circumstances. It is very important that the orientation and position of the top cover be marked on the unit prior to disassembly. This will allow proper replacement of the top cover onto the unit and prevent rainwater from leaking into the unit.

IMPORTANT: After servicing is completed, make sure door is closed and relatched properly, and that the latches are tight. Failure to do so can result in water leakage into the evaporator section of the unit.

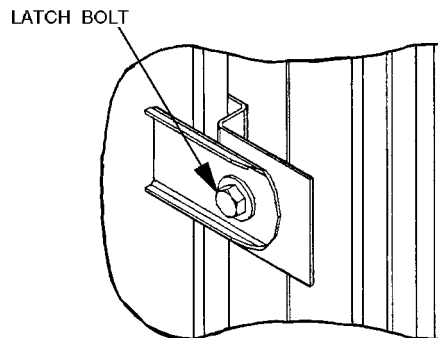


Fig. 37 — Door Latch

Cleaning — Inspect unit interior at beginning of each heating and cooling season and as operating conditions require. Remove unit top panel and/or side panels for access to unit interior.

EVAPORATOR COIL — Clean as required with a commercial coil cleaner.

CONDENSER COIL — Clean condenser coil annually and as required by location and outdoor-air conditions. Inspect coil monthly — clean as required.

CONDENSATE DRAIN — Check and clean each year at start of cooling season. In winter, keep drains and traps dry.

FILTERS — Clean or replace at start of each heating and cooling season, or more often if operating conditions require. Refer to Tables 1A and 1B for type and size.

NOTE: The unit requires industrial grade throwaway filters capable of withstanding face velocities up to 3.175 m/s (625 fpm).

OUTDOOR-AIR INLET SCREENS — Clean screens with steam or hot water and a mild detergent. Do not use throw-away filters in place of screens.

Lubrication

COMPRESSORS — Each compressor is charged with the correct amount of oil at the factory. The correct oil charge is shown in Tables 1A and 1B. If oil is visible in the compressor sight glass, check unit for operating readiness as described in Start-Up section, then start the unit. Observe oil level and add oil, if required, to bring oil level in compressor crankcase up to between ¼ and ⅓ of sight glass during steady operation.

If oil charge is above ⅓ sight glass, do not remove any oil until the compressor crankcase heater has been energized for at least 24 hours with compressor off.

When additional oil or a complete charge is required, use only Carrier-approved compressor oil:

- Petroleum Specialties, Inc. Cryol 150
- Texaco, Inc. Capella WF-32
- Witco Chemical Corp. Suniso 3GS

IMPORTANT: Do not use reclaimed oil or oil that has been exposed to the atmosphere. Refer to Carrier Standard Service Techniques Manual, Chapter 1, Refrigerants section, for procedures to add or remove oil.

FAN SHAFT BEARINGS — Lubricate the bearings at least twice annually with suitable bearing grease. Do not over grease. Typical lubricants are show below:

MANUFACTURER	LUBRICANT
Texaco	Regal AFB-2*
Mobil	Mobilplex EP No. 1
Sunoco	Prestige 42
Texaco	Multifak 2

*Preferred lubricant because it contains rust and oxidation inhibitors.

CONDENSER AND EVAPORATOR-FAN MOTOR BEARINGS — The condenser and evaporator-fan motors have permanently-sealed bearings, so no field lubrication is necessary.

Evaporator Fan Performance Adjustment (Fig. 38) — Fan motor pulleys are factory set for speed shown in Tables 1A and 1B (factory speed setting).

To change fan speeds, change pulleys.

To align fan and motor pulleys:

1. Shut off unit power supply.
2. Loosen fan shaft pulley bushing.
3. Slide fan pulley along fan shaft.
4. Make angular alignment by loosening motor from mounting plate.
5. Retighten pulley.

IMPORTANT: Check to ensure that the unit drive matches the duct static pressure in Tables 13 to 16.

Evaporator Fan Service and Replacement

1. Turn off unit power.
2. Remove supply-air section panels.
3. Remove belt and blower pulley.
4. Loosen set screws in blower wheels.
5. Remove locking collars from bearings.
6. Remove shaft.
7. Remove venturi on opposite side of bearing.
8. Lift out wheel.
9. Reverse above procedure to reinstall fan.
10. Check and adjust belt tension as necessary.

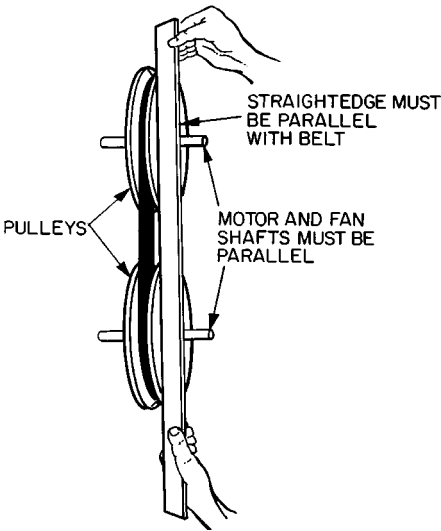


Fig. 38 — Evaporator-Fan Pulley Alignment and Adjustment

Belt Tension Adjustment — To adjust belt tension:

1. Remove power to unit.
2. Remove motor mount nuts and bolts.
3. Loosen fan motor nuts. See Fig. 39.
4. Turn motor jacking bolts to move motor mounting plate left or right for proper belt tension. A slight bow should be present in the belt on the slack side of the drive while running under full load.
5. Tighten nuts.
6. Adjust bolts and nut on mounting plate to secure motor in fixed position. Recheck belt tension after 24 hours of operation. Adjust as necessary.

Condenser-Fan Adjustment

1. Shut off unit power supply.
2. Remove fan guard.
3. Loosen fan hub setscrews.
4. Adjust fan height on shaft using a straightedge placed across venturi and measure per Fig. 40.
5. Tighten setscrews and replace fan guard.
6. Turn on unit power.

Evaporator-Fan Motor Replacement

1. Shut off unit power supply.
2. Remove upper outside panel and open hinged door to gain access to motor.

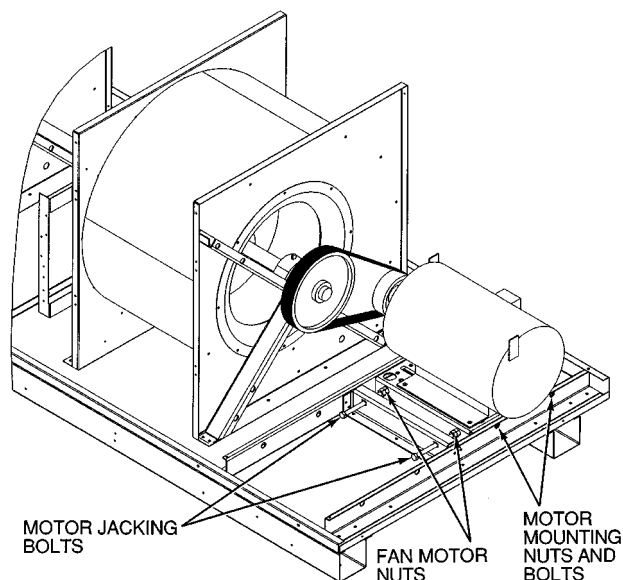


Fig. 39 — Belt Tension Adjustment

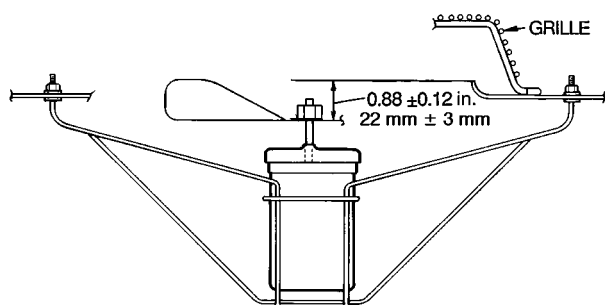


Fig. 40 — Condenser-Fan Adjustment

3. Fully retract motor plate adjusting bolts.
4. Loosen the 2 rear (nearest the evaporator coil) motor plate nuts.
5. Remove the 2 front motor plate nuts and carriage bolts.
6. Slide motor plate to the rear (toward the coil) and remove fan belt(s).
7. Slide motor plate to the front and hand tighten one of the rear motor plate nuts (tight enough to prevent the motor plate from sliding back but loose enough to allow the plate to pivot upward).
8. Pivot the front of the motor plate upward enough to allow access to the motor mounting hex bolts and secure in place by inserting a prop.
9. Remove the nuts from the motor mounting hex bolts and remove motor.
10. Reverse above steps to install new motor.

Power Failure — Dampers have a spring return. In event of power failure, dampers will return to fully closed position until power is restored.

Refrigerant Charge — Amount of refrigerant charge is listed on unit nameplate and in Table 1. Refer to Carrier GTAC II; Module 5; Charging, Recovery, Recycling, and Reclamation section for charging methods and procedures.

Unit panels must be in place when unit is operating during charging procedure.

NO CHARGE — Use standard evacuating techniques. After evacuating system, weigh in the specified amount of refrigerant (refer to Tables 1A and 1B).

LOW CHARGE COOLING — Using appropriate cooling charging chart (see Fig. 41 and 42), add or remove refrigerant until conditions of the appropriate chart are met. Note that charging chart is different from those normally used. An accurate pressure gage and temperature sensing device are required. Measure liquid line pressure at the liquid line service valve using pressure gage. Connect temperature sensing device to liquid line near the liquid line service valve and insulate it so that outdoor ambient temperature does not affect reading. Indoor-air cfm must be within normal operating range of unit. Take outdoor ambient temperature and read the suction pressure gage. Refer to appropriate chart to determine correct suction temperature. If intersection point on chart is above the curve, add refrigerant. If intersection point on chart is below curve, carefully recover some of the charge. Recheck suction pressure as charge is adjusted.

Filter Drier — Replace whenever refrigerant system is exposed to atmosphere.

Thermostatic Expansion Valve (TXV) — Each circuit has one. It is nonadjustable and is factory set to maintain 5 to 7° C (10 to 13° F) superheat leaving the evaporator coil. Controls flow of liquid refrigerant to the evaporator coils.

Protective Devices

COMPRESSOR PROTECTION

Overcurrent — Each compressor has one manual reset, calibrated trip, magnetic circuit breaker. Do not bypass connections or increase the size of the circuit breaker to correct trouble. Determine the cause and correct it before resetting the breaker.

Overtemperature — Each 06D type compressor (024-034 units only) has an internal protector to protect it against excessively high discharge gas temperatures.

Crankcase Heater — Each compressor has a crankcase heater to prevent absorption of liquid refrigerant by oil in the crankcase when the compressor is idle. Since power for the crankcase heaters is drawn from the unit incoming power, main unit power must be on for the heaters to be energized.

IMPORTANT: After a prolonged shutdown or service job, energize the crankcase heaters for 24 hours before starting the compressors.

EVAPORATOR-FAN MOTOR PROTECTION — A manual reset, calibrated trip, magnetic circuit breaker protects against overcurrent. Do not bypass connections or increase the size of the breaker to correct trouble. Determine the cause and correct it before resetting the breaker. If the evaporator-fan motor is replaced with a different horsepower motor, re-sizing of the circuit breaker is required. Contact Carrier Application Engineering.

CONDENSER-FAN MOTOR PROTECTION — Each condenser-fan motor is internally protected against overtemperature.

HIGH- AND LOW-PRESSURE SWITCHES — If either switch trips, or if the compressor overtemperature switch activates, that refrigerant circuit will be automatically locked out. To reset, manually move the thermostat setting.

FREEZE PROTECTION THERMOSTAT (FPT) — An FPT is located on the evaporator coil for each circuit. It detects frost build-up and turns off the compressor, allowing the coil to clear. Once the frost has melted, the compressor can be reenergized.

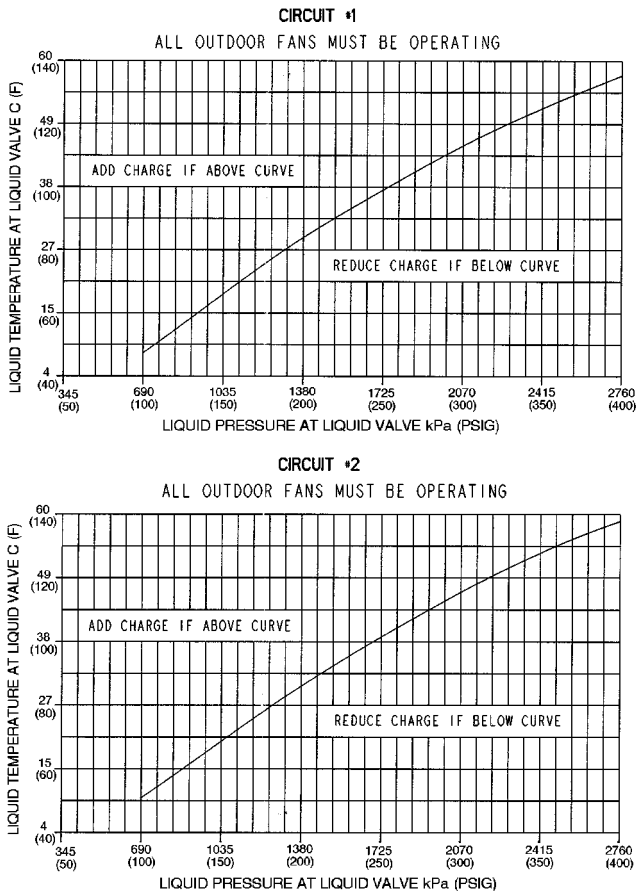


**Fig. 41 — Cooling Charging Chart,
Sizes 024-034**

Relief Devices — All units have relief devices to protect against damage from excessive pressures (i.e., fire). These devices are installed on the suction line, liquid line, and on the compressor.

Control Circuit, 24-V — This control circuit is protected against overcurrent by a 3.2-amp circuit breaker (CB4). Breaker can be reset. If it trips, determine cause of trouble before resetting.

Control Circuit, 115-V — This control circuit is protected against overcurrent by a 5.0-amp circuit breaker (CB3). Breaker can be reset. If it trips, determine cause of trouble before resetting.

Compressor Lockout Logic — If any of the safeties trip, the circuit will automatically reset (providing the safety has reset) and restart the compressor in 15 minutes. If any of the safeties trip 3 times within a 90-minute period, then the circuit will be locked out and will require manual resetting by turning off either the unit disconnect or the control circuit breaker, or opening the thermostat.

Replacement Parts — A complete list of replacement parts may be obtained from any Carrier distributor upon request.


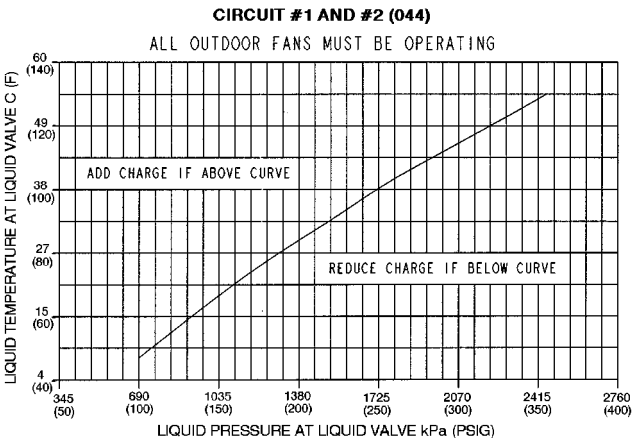


**Fig. 42 — Cooling Charging Chart,
Size 044**

TROUBLESHOOTING

Typical refrigerant circuiting diagrams are shown in Fig. 43 and 44.

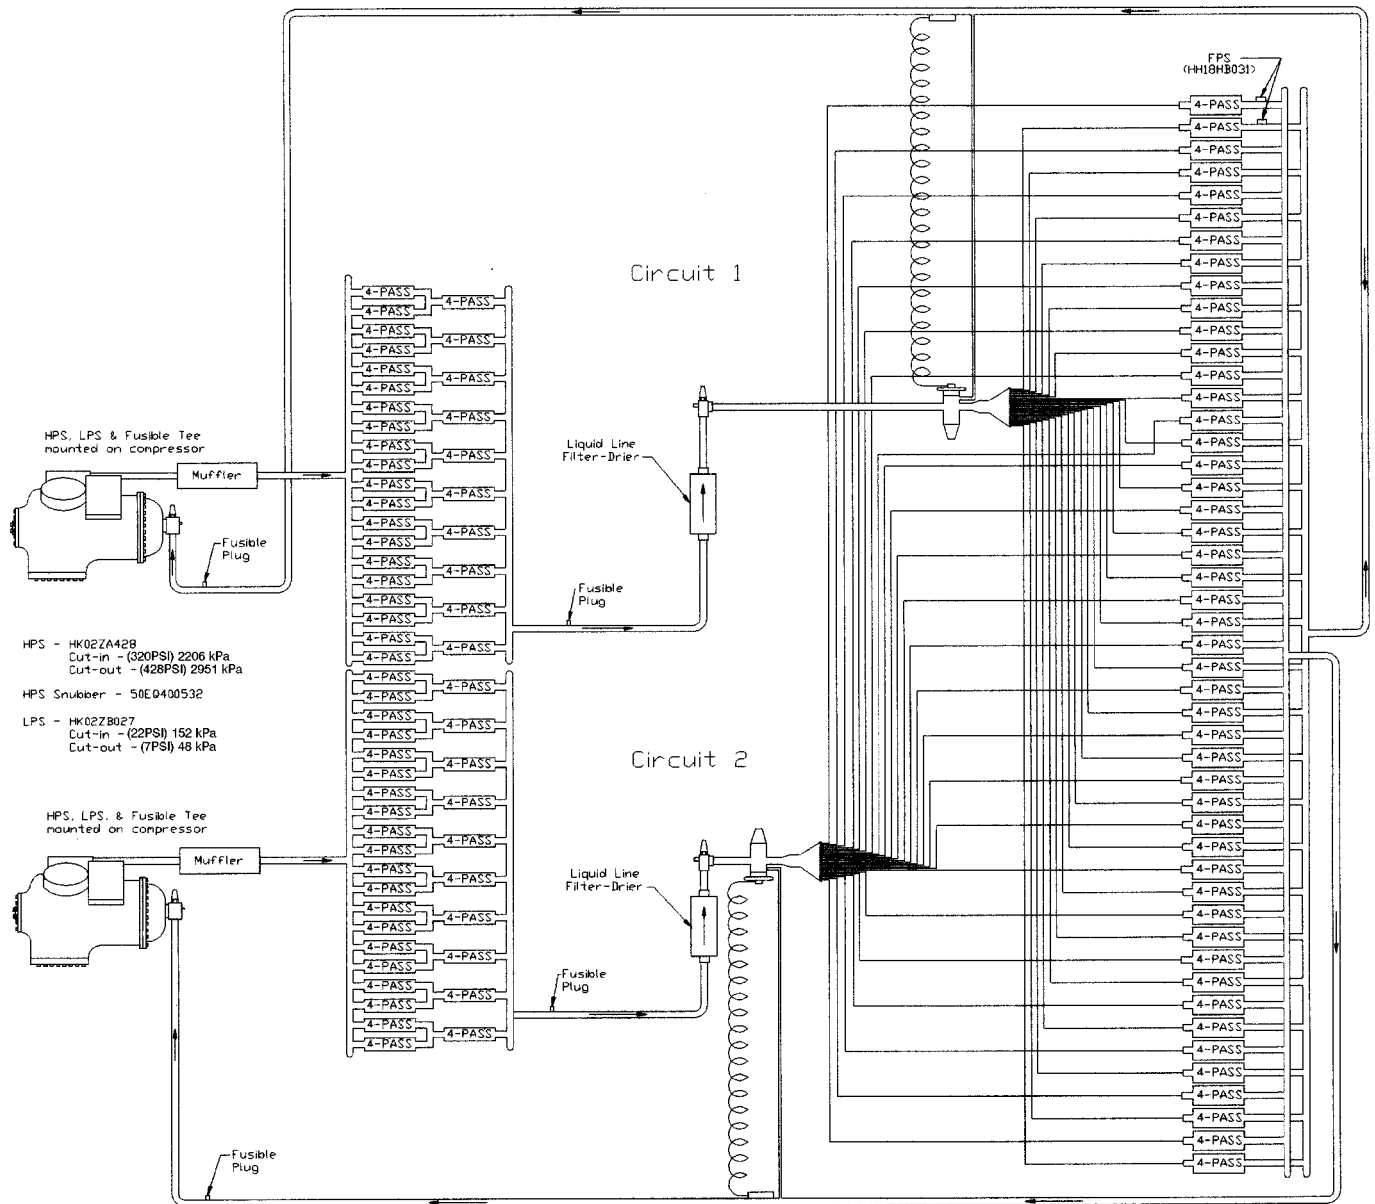

LEGEND

- FPS — Freeze Protection Switch
- HPS — High-Pressure Switch
- LPS — Low-Pressure Switch

**Fig. 43 — Typical Refrigerant Circuiting
(50EJ,EK,EW,EY024-034)**

Diagnostic LEDs (Light-Emitting Diodes) — There are 3 LEDs (red, yellow, and green) on the lower right hand side of the control board. The red light is used to check unit operation and alarms. A constant pulse is normal unit operation. A series of quick blinks indicates an alarm. Refer

to Table 22 below for a description of alarms. The yellow LED blinks during transmission with the CCN (Carrier Comfort Network). The green LED blinks during transmission with the expansion board.

Table 22 — Control Board LED Alarms

LED BLINKS	ERROR CODE	DESCRIPTION	TROUBLESHOOTING COMMENTS
1	—	Normal Operation	The expansion board and control board flash the red LED in one-second intervals when the board is operating properly.
2	HF-13	Compressor 1 Safety	The high or low pressure safety switch for compressor no. 1 has opened for 3 seconds. The error will be cleared and compressor no. 1 will be allowed to turn on in 15 minutes. If the safeties have been tripped 3 times in 90 minutes, compressor no. 1 will be locked out until the control board has been manually reset.
3	HF-14	Compressor 2 Safety	The high or low pressure safety switch for compressor no. 2 has opened for 3 seconds. The error will be cleared and compressor no. 2 will be allowed to turn on in 15 minutes. If the safeties have been tripped 3 times in 90 minutes, compressor no. 2 will be locked out until the control board has been manually reset.
4	HF-15	Thermostat Failure	The thermostat is calling for both heating and cooling at the same time. The unit will operate on a first call basis and will automatically reset.
5	HF-05	SAT Thermistor Failure	The supply-air temperature (SAT) sensor has failed. First check for wiring errors, then replace sensor.
6	HF-06	OAT Thermistor Failure	The outside-air temperature (OAT) sensor has failed. First check for wiring errors, then replace sensor.
7	HF-03	Space Temp. Sen. Failure	The space temperature sensor has failed. First check for wiring errors, then replace sensor.
8	HF-12	RAT Thermistor Failure	The return-air temperature (RAT) sensor has failed. Ensure that the unit is a VAV unit. If NOT a VAV unit set DIP switch position 1 to the closed position and reset power. Then check for wiring errors. Finally, replace sensor.
9	SE-05	Loss of Communications with Expansion board	Communications between the expansion board and the control board have been interrupted. Ensure that an expansion board is installed and wired using the wire harness supplied with the expansion module. If an expansion board is not used ensure that DIP switch position 3 is in the closed position, and reset power.
10	HF-16	Control Board Failure	Generated when hardware has failed on control board. Replace the control board.
11	HF-17	Expansion Board Failure	Generated when hardware has failed on the expansion board. Replace the expansion board.

LEGEND

DIP — Dual In-Line Package
LED — Light-Emitting Diode
VAV — Variable Air Volume

Tables 23-25 show the input and output channel designations.

**Table 23 — I/O Channel Designations
Base Module — CV**

TERMINAL NO.	ASSIGNMENT
T1-2	SPT (CCN) — 10K Ω Thermistor
T3-4	STO (CCN) — 10K Ω Thermistor
T5-6	OAT — 5K Ω Thermistor
T7-8	SAT — 5K Ω Thermistor
T9-10	—
T11-12	SAT Reset — AI (2-10 vdc)
T13-14	—
T15-16	—
T17-25	Y1 or Remote Start/Stop — DI (24 vac)
T18-25	Y2 — DI (24 vac)
T19-25	W1 — DI (24 vac)
T20-25	W2 — DI (24 vac)
T21-25	G — DI (24 vac)
T22-25	Compressor 1 Safety — DI (24 vac)
T23-25	Compressor 2 Safety — DI (24 vac)
T24-25	Outside Air Enthalpy — DI (24 vac)
T26-27	Economizer Pos. — AO (4-20 mA)
T28-29	Heat 1 Relay — DO (24 vac)
T30-29	Heat 2 Relay — DO (24 vac)
T31-32	CV Power Exhaust 1/Modulating Pwr Exht — DO (115 vac)
T33-32	CV Power Exhaust 2 — DO (115 vac)
T34-35	Condenser Fan — DO (115 vac)
T36-35	OFC2 — DO (115 vac)
T37-38	—
T39-38	—
K1	Indoor Fan Relay — DO (HV)
K2	Compr. 1 — DO (HV)
K3	Compr. 2 — DO (HV)

**Table 24 — I/O Channel Designations
Base Module — VAV**

TERMINAL NO.	ASSIGNMENT
T1-2	SPT (CCN) — 10K Ω Thermistor
T3-4	RAT — 5K Ω Thermistor
T5-6	OAT — 5K Ω Thermistor
T7-8	SAT — 5K Ω Thermistor
T9-10	—
T11-12	SAT Reset — AI (2-10 vdc)
T13-14	—
T15-16	—
T17-25	Remote Start/Stop — DI (24 vac)
T18-25	—
T19-25	—
T20-25	—
T21-25	—
T22-25	Compressor 1 Safety — DI (24 vac)
T23-25	Compressor 2 Safety — DI (24 vac)
T24-25	Outside Air Enthalpy — DI (24 vac)
T26-27	Economizer Pos. — AO (4-20 mA)
T28-29	Heat 1 Relay — DO (115 vac)
T30-29	Heat Interlock Relay — DO (115 vac)
T31-32	Modulated Power Exhaust — DO (115 vac)
T33-32	—
T34-35	Condenser Fan — DO (115 vac)
T36-35	OFC2 — DO (115 vac)
T37-38	Unloader 1 — DO (115 vac)
T39-38	Unloader 2 — DO (115 vac)
K1	Indoor Fan Relay — DO (HV)
K2	Compr. 1 — DO (HV)
K3	Compr. 2 — DO (HV)

LEGEND
(Tables 23 and 24)

AI — Analog Input
AO — Analog Output
CCN — Carrier Comfort Network
CV — Constant Volume
DI — Direct Input
DO — Direct Output
HV — High Voltage
K Ω — Kilo-Ohms
OAT — Outdoor-Air Temperature
OFC — Outdoor Fan Contactor
RAT — Return-Air Temperature
SAT — Supply-Air Temperature
SPT — Space Temperature
STO — Space Temperature Offset
T — Terminal
VAV — Variable Air Volume

**Table 25 — I/O Channel Designations Expansion
Module — CV and VAV**

TERMINAL NO.	ASSIGNMENT
T1-2	—
T3-4	—
T5-6	—
T7-8	—
T9-10	—
T11-12	IAQ Indoor — AI (2-10 vdc)
T13-14	IAQ Outdoor — AI (2-10 vdc)
T15-16	—
T17-25	Fan Status — DI (24 vac)
T18-25	Filter Status — DI (24 vac)
T19-25	Field Applied Status — DI (24 vac)
T20-25	Demand Limit — DI (24 vac)
T21-25	Fire — Unit Shutdown — DI (24 vac)
T22-25	Fire — Pressurization — DI (24 vac)
T23-25	Fire — Evacuation — DI (24 vac)
T24-25	Fire — Smoke Purge — DI (24 vac)
T26-27	—
T28-29	—
T30-29	Alarm Light Indicator — DO (24 vac)
T31-32	Power Exhaust Fire #1 — DO (115 vac)
T33-32	Power Exhaust Fire #2 — DO (115 vac)
T34-35	Power Exhaust Fire #3 — DO (115 vac)
T36-35	Power Exhaust Fire #4 — DO (115 vac)
T37-38	—
T39-38	—
K1	—
K2	—
K3	—

LEGEND

AI — Analog Input
DI — Direct Input
DO — Direct Output
IAQ — Indoor Air Quality
T — Terminal

START-UP CHECKLIST

MODEL NO.: _____

SERIAL NO.: _____

SOFTWARE VERSION (SEE FIG. 12) _____

TECHNICIAN: _____

DATE: _____

PRE-START-UP:

- ☐ VERIFY THAT DIP SWITCH SETTINGS ARE CORRECT
- ☐ VERIFY THAT ALL PACKING MATERIALS HAVE BEEN REMOVED FROM UNIT
- ☐ REMOVE ALL SHIPPING HOLDDOWN BOLTS AND BRACKETS PER INSTRUCTIONS
- ☐ VERIFY INSTALLATION OF ECONOMIZER HOOD
- ☐ VERIFY INSTALLATION OF ALL OPTIONS AND ACCESSORIES
- ☐ VERIFY THAT CONDENSATE CONNECTION IS INSTALLED PER INSTRUCTIONS
- ☐ VERIFY THAT ALL ELECTRICAL CONNECTIONS AND TERMINALS ARE TIGHT
- ☐ CHECK THAT INDOOR-AIR FILTER IS CLEAN AND IN PLACE
- ☐ VERIFY THAT UNIT IS LEVEL WITHIN TOLERANCES
- ☐ CHECK FAN WHEELS AND PROPELLERS FOR LOCATION IN HOUSING/ORIFICE, AND VERIFY SET SCREW IS TIGHT
- ☐ VERIFY THAT FAN SHEAVES ARE ALIGNED AND BELTS ARE PROPERLY TENSIONED
- ☐ VERIFY THAT SUCTION, DISCHARGE, AND LIQUID LINE SERVICE VALVES ON EACH CIRCUIT ARE OPEN

START-UP

ELECTRICAL

SUPPLY VOLTAGE L1-L2 _____ L2-L3 _____ L3-L1 _____

COMPRESSOR AMPS — COMPRESSOR NO. 1 L1 _____ L2 _____ L3 _____

— COMPRESSOR NO. 2 L1 _____ L2 _____ L3 _____

SUPPLY FAN AMPS (CV) _____ EXHAUST FAN AMPS _____

(VAV) _____*

*VAV fan supply amps reading must be taken with a true RMS meter for accurate readings.

ELECTRIC HEAT AMPS (IF SO EQUIPPED) L1 _____ L2 _____ L3 _____

TEMPERATURES

OUTDOOR-AIR TEMPERATURE _____ C (F) DB (Dry-Bulb)

RETURN-AIR TEMPERATURE _____ C (F) DB _____ C (F) WB (Wet-Bulb)

COOLING SUPPLY AIR _____ C (F)

ELECTRIC HEAT SUPPLY AIR (IF SO EQUIPPED) _____ C (F)

PRESSURES

REFRIGERANT SUCTION CIRCUIT NO. 1 _____ kPa (PSIG) CIRCUIT NO. 2 _____ kPa (PSIG)

REFRIGERANT DISCHARGE CIRCUIT NO. 1 _____ kPa (PSIG) CIRCUIT NO. 2 _____ kPa (PSIG)

- ☐ VERIFY REFRIGERANT CHARGE USING CHARGING CHARTS ON PAGE 44

START-UP CHECKLIST (cont)

GENERAL

- ☐ ECONOMIZER MINIMUM VENT AND CHANGEOVER SETTINGS TO JOB REQUIREMENTS
- ☐ ENSURE DRIVES OPERATE WITHIN LIMITS OF FAN PERFORMANCE TABLES

HIGH-PRESSURE SWITCH SETTING _____ kPa (PSIG)

LOW-PRESSURE SWITCH SETTING _____ kPa (PSIG)

MOTOR PULLEY PART NUMBER _____

FAN PULLEY PART NUMBER _____

BELT PART NUMBER _____

BELT SIZE _____ mm (in.)

FILTER QUANTITY _____

FILTER SIZES _____ mm (in.)

ADDITIONAL NOTES:

CUT ALONG DOTTED LINE

CUT ALONG DOTTED LINE