

**Small Rooftop Units  
Gas Heating/Electric Cooling,  
Electric Cooling, and Heat Pump Units  
3 to 12½ Tons (50/60 Hz)  
Accessory Outdoor Air Opening Panel**

Cancels: New

IIK 548-36-15  
8/1/94

# Installation Instructions

Part Numbers CRPANELS001A00 and CRPANELS002A00

## PACKAGE USAGE AND CONTENTS


UNIT SIZE	PACKAGE PART NO.	PACKAGE CONTENTS
3 to 6 Tons	CRPANELS001A00	1 — Outdoor-Air Opening Panel
7½ to 12½ Tons	CRPANELS002A00	1 — Outdoor-Air Opening Panel

## INSTALLATION


### **WARNING**

Turn off unit power. Electrical shock and personal injury could result.

1. Remove filter access panel from unit. No tools are required. Save panel.
2. Remove evaporator air panel from unit (located directly below filter access panel). Discard panel and save screws. See Fig. 1.
3. Install outdoor air accessory. Follow instructions found with accessory package.
4. Install outdoor-air opening panel on unit with screws saved from Step 2. See Fig. 2.
5. Reinstall filter access panel. No tools are needed. Ensure the filter access panel slides along the tracks and is securely engaged.

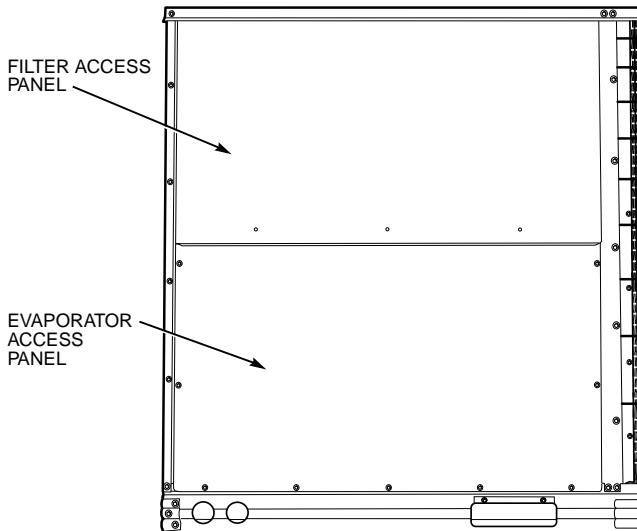

**Fig. 1 — Access Panel Locations**

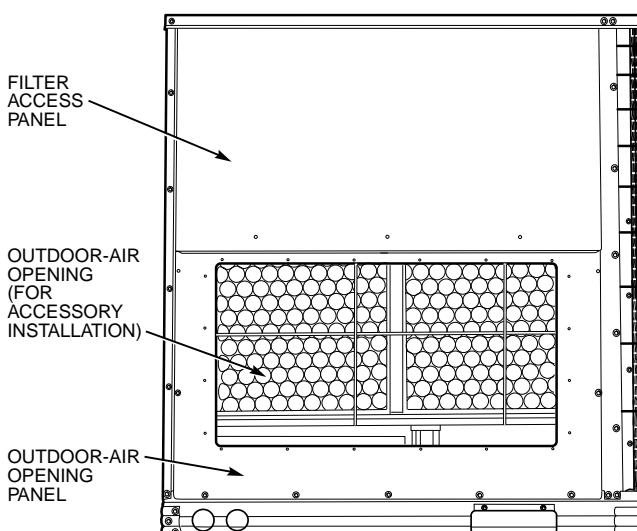

**Fig. 2 — Accessory Panel Locations**