



Installation Instructions

Part No. 30MP-900---002

SAFETY CONSIDERATIONS

Installation of this accessory can be hazardous due to system pressures, electrical components, and equipment location (such as a roof or elevated structure). Only trained, qualified installers and service technicians should install, start-up, and service this equipment.

When installing this accessory, observe precautions in the literature, labels attached to the equipment, and any other safety precautions that apply:

- Follow all safety codes
- Wear safety glasses and work gloves
- Use care in handling and installing this accessory

It is important to recognize safety information. This is the safety-alert symbol: . When you see this symbol on the unit and in instructions or manuals, be alert to the potential for personal injury.

Understand the signal words DANGER, WARNING, CAUTION, and NOTE. These words are used with the safety-alert symbol. DANGER identifies the most serious hazards which **will** result in severe personal injury or death. WARNING signifies hazards which **could** result in personal injury or death. CAUTION is used to identify unsafe practices, which **may** result in minor personal injury or product and property damage. NOTE is used to highlight suggestions which **will** result in enhanced installation, reliability, or operation.

USAGE

This package can be used on 30MPA, MPW017-080, and MPE units.

INTRODUCTION

Install this package after bringing unit into the building. The unit must be raised off from the floor by approximately 7 inches. Be sure to block the unit securely so that it cannot fall during installation of the assemblies. After the accessory height adjustment package is installed, the unit can be set in its final location. See Table 1 for assembly contents.

Table 1 — Package Contents (Each)

QUANTITY	ITEM
6	Height Adjustment Assemblies (includes leveling pad, nuts, and washer)

INSTALLATION

IMPORTANT: Securely lift unit until installation of the kit is completed. Be sure to block the unit securely so that it cannot fall during the installation.

Step 1 — Examine Package Contents

Check to be sure there are 6 assemblies in the carton. Notify your Carrier representative if there are pieces missing or if the accessory is damaged.

Step 2 — Mount Assemblies to Unit Base

Mount one assembly to each corner of the unit and one in the center of the base (each side) as shown in Fig. 1 and 2. Tighten the top nut just enough to hold the assembly loosely once the assembly is mounted on the unit.

Step 3 — Set Unit

Once all 6 assemblies are in place, set unit into final location.

Step 4 — Adjust for Level

Without tightening the top nut, adjust the jam nut until the unit is at the appropriate level. Once adjusted, securely tighten the top nut. A minimum of 30 ft-lb (41 Nm) is required.

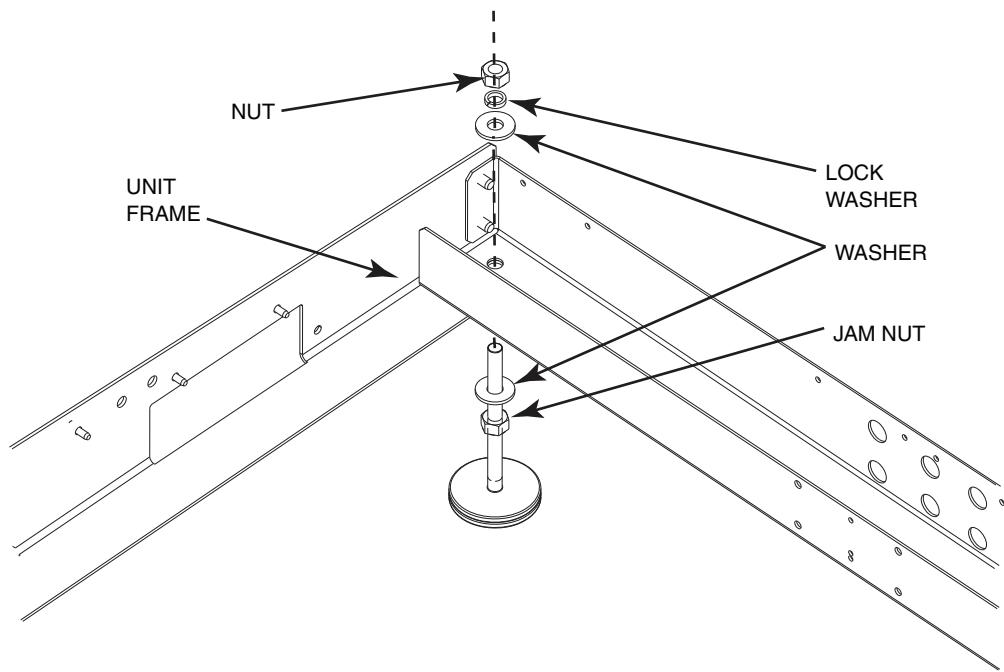


Fig. 1 — Mounting Height Adjustment Assembly

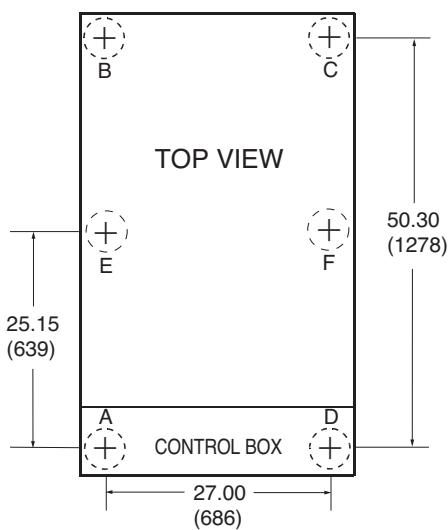


Fig. 2 — Height Adjustment Assembly Installation Points