



Turn to the experts

Product Data

WeatherMaker®

Applied Rooftop Units

20 to 60 Nominal Tons



WeatherMaker®



48/50A020-060
Single-Package Gas Heating/Electric Cooling
Rooftop Units and Electric Cooling
Rooftop Units with Optional Electric Heat with *ComfortLink* Controls
and Puron® Refrigerant (R-410A)

Standard features/benefits



Carrier's 48/50A applied packaged units offer design flexibility, quality, reliability, and ComfortLink controls.

Carrier's 48/50A Series commercial applied rooftops standard features include:

- Commercial grade construction
- Dedicated vertical or horizontal supply and return configurations
- Non-ozone depleting Puron® refrigerant (R-410A)
- Al/Cu round tube plate fin condenser coil
- Large face area Al/Cu evaporator coil for improved performance
- High efficiency scroll compressors
- Thermostatic expansion valve (TXV) for reliable operation
- Up to 4 stages of cooling capacity
- Dual, independent refrigerant circuits
- Cooling operation up to 115°F ambient and down to 32°F ambient
- Efficient forward curve supply fan with belt drive motor
- Multiple supply fan motor horsepower (HP) options
- Constant volume (CV), staged air volume (SAV™) or variable air volume (VAV) supply fan control
- Factory-installed and configured ComfortLink controls
- Easy to read Scrolling Marquee display
- Multiple cooling and heating control methods as standard
- Multiple voltage options
- Standard 5 kA short circuit current rating (SCCR)
- 2 in. filter rack with throwaway filters
- Aluminized steel condensate pan

Design flexibility

Dedicated vertical supply/return units (A2, A3, A6, A7) are ideal for new construction or retrofit to existing installations. The low unit profile is maintained when the unit is installed on the accessory roof curb. The supply and return ducts are attached directly to the roof curb to allow all ductwork to be completed before the unit is positioned.

Dedicated horizontal units (A4, A5, A8, A9) are ideal for new construction or retrofit through-the-wall applications or for applications requiring sound attenuation or additional filtration before the duct work penetrates the roof. Supply and return ducts connect directly to the unit. Horizontal units may be curb, slab, or structure mounted.

Units are selectable in a variety of supply fan control methodologies to meet project requirements, including constant volume (CV), staged air volume (SAV), and variable air volume (VAV). Units selected for SAV or VAV include a supply fan variable frequency drive (VFD).

With SAV control, ComfortLink automatically stages the fan speed during part load cooling or heating to provide energy savings, improved dehumidification, and reduced sound output. Additionally, ComfortLink can be configured to optimize SAV for dehumidification or sensible capacity.

VAV units include a pressure transducer that allows ComfortLink to modulate the supply fan speed based on duct static pressure. VAV supply fan operation can be used for a variety of applications, including multi-zone VAV with air terminal units, single zone VAV, or CV with filter loading.

ComfortLink controls

Factory-installed ComfortLink controls provide the capability for free-standing operation or may be linked with a more extensive system. The ComfortLink controls have the capability to communicate with the Carrier Comfort Network® (CCN) system and other building automation systems (BAS). This communication flexibility allows simple system integration with Carrier CCN systems and other BAS systems, as well as data collection, trending, monitoring, and alarm displays.

The ComfortLink controls are your link to a world of simple and easy-to-use rooftop units that offer outstanding performance and value. ComfortLink can be configured for a wide variety of applications, including single zone systems, multi-zone systems with VAV air terminal units, or multi-zone variable air volume and temperature (VVT) systems with VVT air terminal units. ComfortLink maintains control over the compressors, condenser fans, indoor fans, and the unit heat source (if equipped) for optimized operation and temperature control.

The ComfortLink scrolling marquee display is very easy to use. Messages are presented in easy to understand language. No decoding is required. A scrolling readout provides detailed explanations of control information. Only 4, large, easy-to-use buttons are required to maneuver through the entire menu. The readout is designed to be visible even in the brightest sunlight.

Environmentally balanced

Making an environmentally responsible decision is possible when using Carrier's Puron® refrigerant (R-410A). Puron refrigerant (R-410A) is an HFC refrigerant that does not contain chlorine that is damaging to the ozone layer. This refrigerant is a safe, efficient, and environmentally balanced refrigerant.

Table of contents

	Page
Standard Features/Benefits	2
Model Number Nomenclature	4
Ratings and Capacities	6
Physical Data	9
Options and Accessories	13
Base Unit Dimensions	18
Accessory Dimensions	26
Selection Procedure	31
Performance Data	32
Controls	71
Application Data	86
Typical Wiring Schematics	88
Guide Specifications	95

Standard features/benefits (cont)



Quality and reliability

The unit cabinet features commercial grade construction from galvanized steel. The base pan, corner posts, side panels, and top cover are made from thick gauge steel to stand up to the rigors of transportation and installation. All units undergo a thorough factory run test and a quality review prior to shipment.

The compressors are equipped with crankcase heaters and protected by *ComfortLink* to control minimum on and off times and protect against reverse rotation. The refrigerant circuits are both electrically and mechanically independent, to provide standby capability should one circuit require service. Totally enclosed condenser fan motors are designed for many years of trouble-free operation.

Positive-locking bearings for the indoor fan reduce vibration of the supply fan assembly and remain locked during the life of the bearing. Supply fan bearings are pre-lubricated from the factory and are designed with an operating life of 200,000 hours at design conditions. The supply fan assembly also features a heavy duty shaft for reliable operation.

Gas heating units (48 series)

48A series units include a factory-installed natural gas heater with a tubular, dimpled gas heat exchanger to optimize heat transfer for improved efficiency. The tubular design permits hot gases to make multiple passes across the path of the supply air. The dimpled design creates a turbulent gas flow to increase heating efficiency. The extra thick Alumagard™ heat exchanger coating provides corrosion resistance to lengthen coil life.

All 48 series gas heaters are induced draft style combustion, which minimizes the need for flue stacks. The inducer fan draws hot combustion gas through the heat exchanger at the optimum rate for the most effective heat transfer. Induced draft heating systems are safer than positive pressure, forced draft heating systems. With the induced draft heating system, the heat exchanger operates under negative pressure, preventing flue gas leakage into the indoor supply air.

All ignition components are contained in the compact integrated gas controller

(IGC), which is easily accessible for servicing and can improve heating efficiency. The IGC control board, designed and manufactured exclusively for Carrier rooftop units, provides built-in diagnostic capability. An LED simplifies troubleshooting by providing visual fault notification and system status confirmation, which can help reduce troubleshooting costs.

The IGC also contains anti-cycle protection and safety monitoring for gas heat operation. After 4 continuous cycles on the unit high-temperature limit switch, the gas heat operation is disabled, and an error code is issued. All units have a flame rectification sensor to quickly sense the burner flame and ignite burners almost immediately. The controls are designed to shut down the unit during any flame outage or circuit failure. The flame sensor reacts quickly to these events. In the event of a shutdown, an error code is issued at the IGC board.

During the heating mode, the supply fan relay automatically starts the evaporator fan after the heat exchanger warms up to a suitable temperature. To increase efficiency and comfort, the 30-second fan delay prevents cold air from entering the supply duct system when the conditioned space is calling for heat. The direct-spark ignition system saves operating expense when compared to pilot ignition systems. No crossover tube is required; therefore, no sooting or pilot-fouling problems can occur.

Installation and serviceability

Units are easy to rig using the included lifting points in the unit base rail. The baserail design allows the unit to be installed on curbs, slabs, pads, beams, or sleeper rails. The unique footprint of the 48/50A units allows for the unit to straddle a structural beam, which can reduce the need for a separate structural support for roof mounted applications. A special order for double wall bottom is available to protect the unit bottom insulation for applications not installed on roof curbs.

All units feature single point electrical connections as standard. Connections can be made through the base of the unit (from the curb) or from the side of the unit. Gas connections are made at the side of the unit for easy access.

Hinged access panels are provided for easy access to standard maintainable items or for service.

No fasteners need to be removed and no specialized tools are required, which reduces servicing time and helps prevent roof leaks caused by discarded screws. Color-coded wiring permits easy tracing and diagnostics. The supply fan motor is strategically located near the exterior of the unit, making belt changes and pulley changes a breeze. The supply fan bearings include a grease port for easy lubrication.

Unit setup, commissioning, and troubleshooting are simplified with the included *ComfortLink* controls. *ComfortLink* supports a wide variety of cooling and heating control methodologies, including space temperature (SPT) control for single zone systems, return air temperature (RAT) control for multi-zone systems, and third party input control (TSTAT). Third party input control provides versatility for cooling and heating control, allowing simple operation based on a two-stage cooling/heating thermostat or advanced operation from a third party control system using hardwired inputs or network points.

ComfortLink can also support multiple supply fan control and occupancy control methods. All units with a supply fan VFD are configurable for SAV, CV, or VAV supply fan control. VAV requires a field or factory provided and installed duct pressure transducer. Occupancy control can be accomplished using the internal unit scheduling function, occupancy switch, or occupancy signal from a CCN system or other BAS system.


The *ComfortLink* controls provide unparalleled service diagnostic information. Temperature and pressure can be read from the display with no need for separate gages. Other data, such as compressor cycles, unit run time hours, and current alarms can also be accessed. A history of alarms is also available for viewing.

A service run test can be very helpful when troubleshooting. The user can run test major components to help determine the root cause of a problem. The unit can be run-tested before an installation is complete to support a satisfactory start-up.

Model number nomenclature



48A UNITS

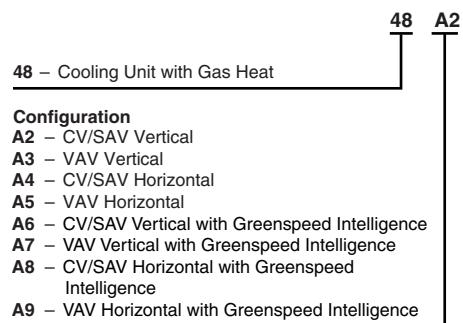

Heat Options

- D – Low Gas Heat
- E – High Gas Heat
- F – Low Gas Heat with Humidi-Mizer
- G – High Gas Heat with Humidi-Mizer
- M – Low Gas Heat Stainless
- N – High Gas Heat Stainless
- S – Staged Low Gas Heat Stainless
- T – Staged High Gas Heat Stainless
- V – Staged Low Gas Heat Stainless with Humidi-Mizer
- W – Staged High Gas Heat Stainless with Humidi-Mizer

Unit Size - Nominal Tons

- 020 – 20
- 025 – 25
- 027 – 27
- 030 – 30
- 035 – 35
- 040 – 40
- 050 – 50
- 060 – 60

Control Options

- No Features
- A – Controls Expansion Module with Phase Monitor
- B – CO₂ Sensor
- C – Smoke Detector
- D – CO₂ Sensor and Smoke Detector
- E – Plugged Filter Indicator and Lube Lines
- F – Plugged Filter Indicator, Lube Lines and CO₂ Sensor
- G – Plugged Filter Indicator, Lube Lines and Smoke Detector
- H – Plugged Filter Indicator, Lube Lines, CO₂ Sensor and Smoke Detector
- J – CO₂ Sensor with Controls Expansion Module and Phase Monitor
- K – Smoke Detector with Controls Expansion Module and Phase Monitor
- L – CO₂ Sensor and Smoke Detector with Controls Expansion Module and Phase Monitor
- M – Plugged Filter Indicator and Lube Lines with Controls Expansion Module and Phase Monitor
- N – Plugged Filter Indicator, Lube Lines and CO₂ Sensor with Controls Expansion Module and Phase Monitor
- P – Plugged Filter Indicator, Lube Lines and Smoke Detector with Controls Expansion Module and Phase Monitor
- Q – Plugged Filter Indicator, Lube Lines, CO₂ Sensor and Smoke Detector with Controls Expansion Module and Phase Monitor

LEGEND

- Al — Aluminum
- Cu — Copper
- CV — Constant Volume
- MCHX — Microchannel Heat Exchanger
- SAV — Staged Air Volume
- VAV — Variable Air Volume
- VFDB — Variable Frequency Drive Bypass

NOTES:

1. VAV and SAV models are equipped with a supply fan motor variable frequency drive (VFD).
2. All indoor fan motors meet the minimum efficiency requirements as established by the Energy Independence and Security Act (EISA) 2007.

48A UNITS

Factory-Installed Options
Refer to price pages for available option codes.

Packaging/Communication

- 1 – Domestic
- 3 – Export
- A – Domestic with BACnet Communication Option
- C – Export with BACnet Communication Option

Design Series
4 – A Series

Voltage

- 1 – 575-3-60
- 5 – 208/230-3-60
- 6 – 460-3-60

Coil Options

- Al/Cu Cond, Al/Cu Evap
- A – Al/Cu Cond, Al/Cu Evap with Digital Compressor
- B – Cu/Cu Cond, Al/Cu Evap with Digital Compressor
- C – Cu/Cu Cond, Al/Cu Evap
- D – Al/Cu Cond Precoat, Al/Cu Evap with Digital Compressor
- E – Al/Cu Cond Precoat, Al/Cu Evap
- F – E-coated Al/Cu, Al/Cu Evap
- G – MCHX Cond, Al/Cu Evap
- H – E-coated MCHX Cond, Al/Cu Evap
- J – MCHX Cond with Coil Grilles, Al/Cu Evap
- K – E-coated MCHX Cond with Coil Grilles, Al/Cu Evap
- L – E-coated Al/Cu Cond, Al/Cu Evap with Digital Compressor
- M – MCHX Cond, Al/Cu Evap with Digital Compressor
- N – E-coated MCHX Cond, Al/Cu Evap with Digital Compressor
- P – MCHX Cond with Coil Grilles, Al/Cu Evap with Digital Compressor
- Q – Al/Cu Cond, Al/Cu Evap with Hot Gas Bypass
- R – Al/Cu Cond, Al/Cu Evap with Hot Gas Bypass
- S – Al/Cu Cond Precoat, Al/Cu Evap with Hot Gas Bypass
- T – E-coated Al/Cu, Al/Cu Evap with Hot Gas Bypass
- V – MCHX Cond, Al/Cu Evap with Hot Gas Bypass (No Humidifier)
- W – E-coated MCHX Cond, Al/Cu Evap with Hot Gas Bypass (No Humidifier)
- X – MCHX Cond with Coil Grilles, Al/Cu Evap with Hot Gas Bypass (No Humidifier)
- Y – E-coated MCHX Cond with Coil Grilles, Al/Cu Evap with Hot Gas Bypass (No Humidifier)
- Z – E-coated MCHX Cond with Coil Grilles, Al/Cu Evap with Digital Compressor
- 2 – E-coated Al/Cu Cond, Al/Cu E-Coat Evap
- 3 – E-coated MCHX Cond, Al/Cu E-Coat Evap
- 4 – E-coated MCHX Cond with Coil Grilles, Al/Cu E-Coat Evap
- 5 – E-coated Al/Cu Cond, Al/Cu E-Coat Evap with Digital Compressor
- 6 – E-coated MCHX Cond, Al/Cu E-Coat Evap with Digital Compressor
- 7 – E-coated MCHX Cond with Coil Grilles, Al/Cu E-Coat Evap with Digital Compressor

Motor Options

No	VFD	VFDB	VFD
A	5 HP	J	5 HP
C	10 HP	1	10 HP
D	15 HP	2	15 HP
E	20 HP	3	20 HP
F	25 HP	4	25 HP
G	30 HP	5	30 HP
H	40 HP	6	40 HP

Quality Assurance

ISO 9001:2015-certified processes



When equipped with SAV™ or VAV supply fan



Unitary Large AC
AHRI Standard 340/360

Certification applies only when the complete system is listed with AHRI

www.ahridirectory.org


4

All units with SAV™, VAV, or CV with Greenspeed®

Model number nomenclature (cont)



50A UNITS

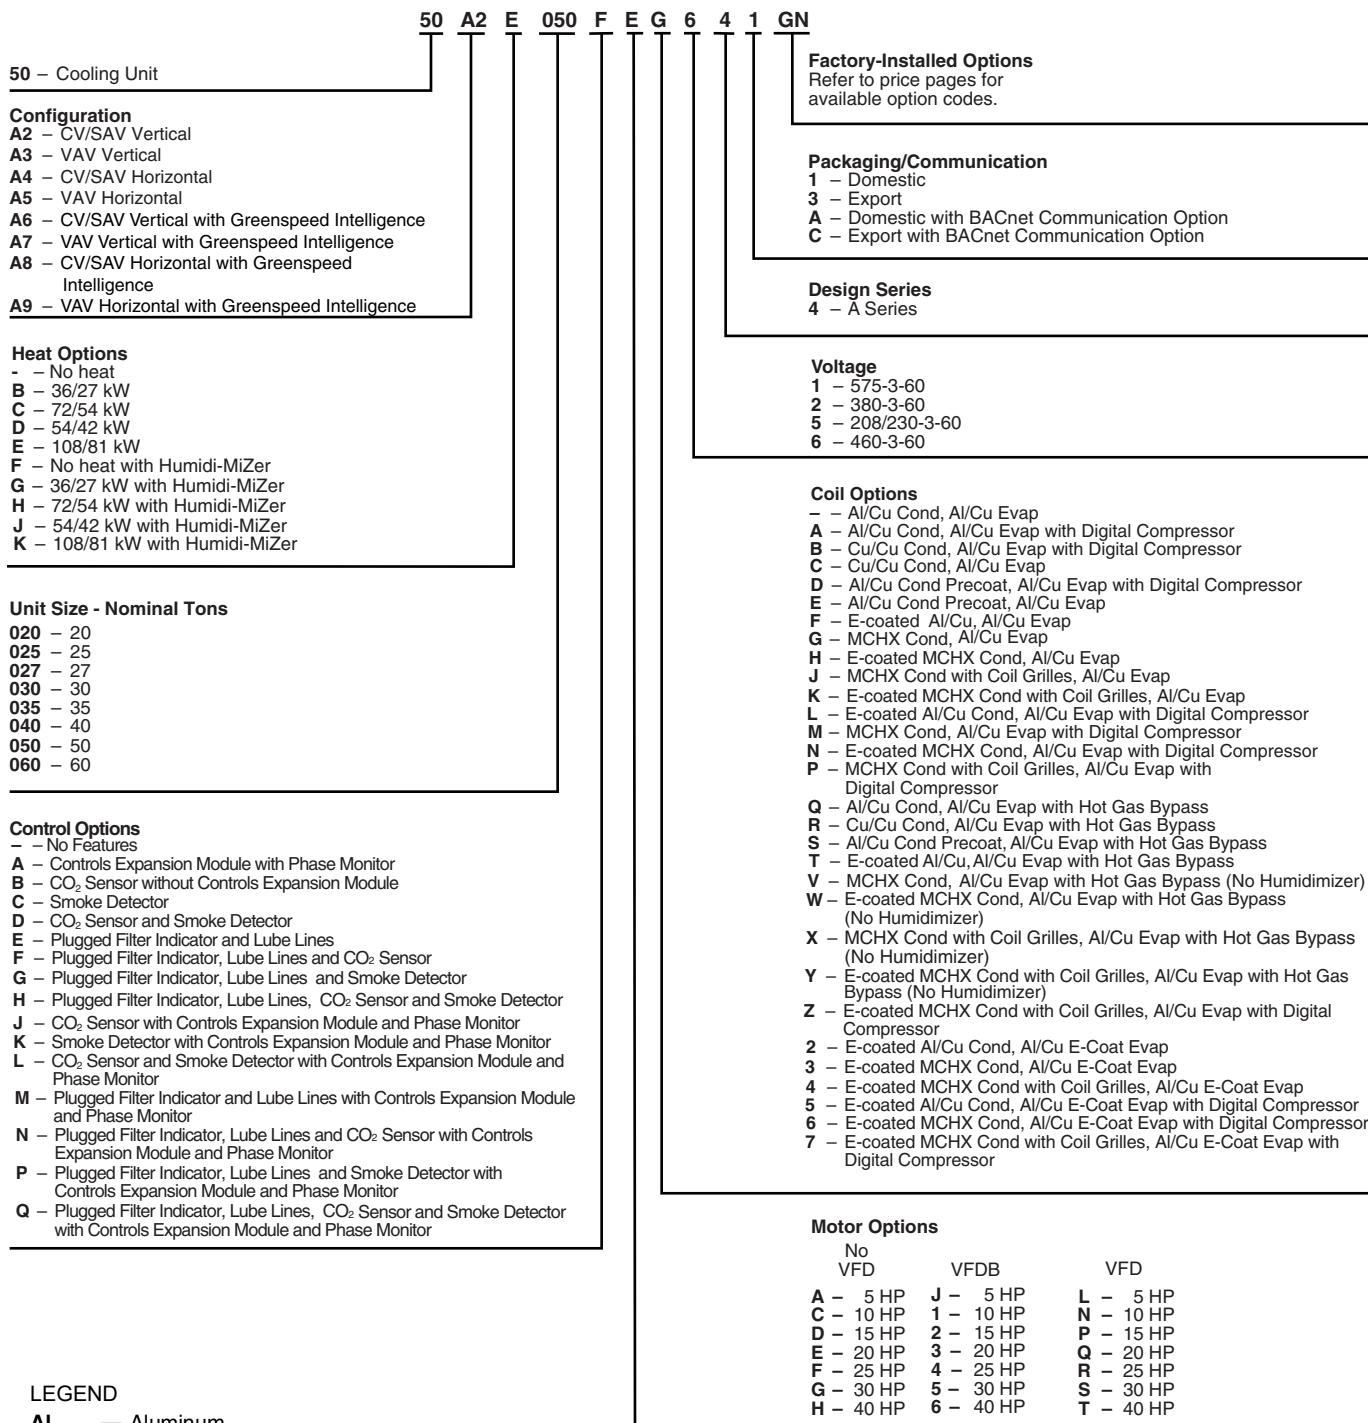

LEGEND

Al	— Aluminum
Cu	— Copper
CV	— Constant Volume
MCHX	— Microchannel Heat Exchanger
SAV	— Staged Air Volume
VAV	— Variable Air Volume
VFDB	— Variable Frequency Drive Bypass

NOTES:

1. VAV and SAV models are equipped with a supply fan motor variable frequency drive (VFD).
2. All indoor fan motors meet the minimum efficiency requirements as established by the Energy Independence and Security Act (EISA) 2007.

Quality Assurance

ISO 9001:2015-certified processes



When equipped with SAV™ or VAV supply fan



All units with SAV™, VAV, or CV with Greenspeed®

Ratings and capacities



ELECTRIC RESISTANCE HEATER DATA

UNIT 50A	HEATER kW				HEATER STAGES	% HEAT PER STAGE	DESIGN RANGE			
	Unit Voltages						Min CFM	Max CFM		
	208	230	460	575						
020-035 LO HEAT	27	36	36	36	1	100	6,000	15,000		
020-035 HIGH HEAT	54	72	72	72	2	50/100	6,000	15,000		
040,050 LO HEAT	27	36	36	36	1	100	10,500	20,000		
040,050 HIGH HEAT	54	72	72	72	2	50/100	10,500	20,000		
060 LO HEAT	41	54	54	54	1	100	15,000	27,000		
060 HIGH HEAT	81	108	108	108	2	50/100	15,000	27,000		

NOTE: Due to the open design of the electric heaters, the airside pressure drop is negligible.

COOLING CFM OPERATING RANGE

UNIT	MIN CFM*	MAX CFM*
48/50A2,A4,A6,A8020	6,000	10,000
48/50A3,A5,A7,A9020	4,000†	10,000
48/50A2,A4,A6,A8025	7,000	12,500
48/50A3,A5,A7,A9025	5,000†	12,500
48/50A2,A4,A6,A8027	8,100	13,500
48/50A3,A5,A7,A9027	5,400†	13,500
48/50A2,A4,A6,A8030	9,000	15,000
48/50A3,A5,A7,A9030	6,000†	15,000
48/50A2,A4,A6,A8035	10,500	17,500
48/50A3,A5,A7,A9035	7,000†	17,500
48/50A2,A4,A6,A8040	12,000	20,000
48/50A3,A5,A7,A9040	8,000†	20,000
48/50A2,A4,A6,A8050	13,500	20,000
48/50A3,A5,A7,A9050	10,000†	20,000
48/50A2,A4,A6,A8060	18,000	27,000
48/50A3,A5,A7,A9060	12,000†	27,000

* Operation at these levels may be limited by entering evaporator air wet bulb temperatures. See Cooling Capacities tables on pages 33-56 for further details.

† VAV units with variable capacity compressor can operate down to 100 cfm/ton. VAV units with standard scroll compressor or Humidi-MiZer are limited to 200 cfm/ton. Operation may be additionally limited by entering coil conditions.

GAS HEATING CAPACITIES AND EFFICIENCIES STANDARD UNITS

UNITS 48A	INPUT (Btuh)		MAXIMUM OUTPUT (Btuh)	TEMPERATURE RISE (F)	STEADY-STATE EFFICIENCY (%)	DESIGN RANGE	
	Stage 1	Stage 2				Min Cfm	Max Cfm*
020-030 LO HEAT	262,500	350,000	283,500	15 to 45	81	5,900	15,000
020-030 HIGH HEAT	394,000	525,000	425,250	35 to 65	81	6,100	11,400
035 LO HEAT	262,500	350,000	283,500	15 to 45	81	5,900	15,000
035 HIGH HEAT	600,000	800,000	648,500	30 to 60	81	10,100	20,200
040,050 LO HEAT	300,000	400,000	324,000	10 to 40	81	7,600	22,500
040,050 HIGH HEAT	600,000	800,000	648,000	30 to 60	81	10,100	20,200
060 LO HEAT	582,000	776,000	628,560	10 to 40	81	11,000	27,000
060 HIGH HEAT	873,000	1,164,000	931,200	30 to 60	80	14,550	27,000

UNITS WITH STAGED GAS OPTION

UNITS 48A	STAGES OF GAS CONTROL (% of Full Heat Output)		MIN. OUTPUT (Btuh)	MAX. OUTPUT (Btuh)	DESIGN RANGE	
	Min Cfm	Max Cfm*			Min Cfm	Max Cfm*
020-030 LO HEAT	38, 50, 75, 88, 100		107,730	283,500	5,900	15,000
020-030 HIGH HEAT	25, 33, 50, 67, 75, 83, 100		106,313	425,250	6,100	11,400
035 LO HEAT	38, 50, 75, 88, 100		107,730	283,500	5,900	15,000
035 HIGH HEAT	38, 50, 75, 88, 100		246,240	648,000	10,100	20,200
040,050 LO HEAT	38, 50, 75, 88, 100		123,120	324,000	7,600	22,500
040,050 HIGH HEAT	38, 50, 75, 88, 100		246,240	648,000	10,100	20,200
060 LO HEAT	19, 25, 38, 44, 50, 56, 63, 75, 88, 94, 100		119,426	628,560	11,000	27,000
060 HIGH HEAT	25, 33, 50, 58, 67, 75, 83, 92, 100		232,800	931,200	14,550	27,000

* In some cases, maximum cfm may be limited by maximum cooling airflow value.

NOTES:

1. Ratings are approved for altitudes to 2000 feet. At altitudes over 2000 ft, ratings are 4% less for each 1000 ft greater than 2000 ft above sea level.
2. At altitudes up to 2000 ft, the following formula may be used to calculate air temperature rise:

$$\Delta t = \frac{\text{Output capacity}}{1.10 \times \text{air quantity}}$$

3. At altitudes above 2000 ft, the following formula may be used:

$$\Delta t = \frac{\text{Output capacity}}{(0.24 \times \text{specific weight of air} \times 60) \times (\text{air quantity})}$$

4. On standard gas heat with aluminized heat exchangers, the minimum allowable mixed air entering the heat exchanger during half-rate (first stage) operation is 50°F. There is no minimum limitation for full-rate operation.

5. Total unit design is listed by ETL Testing Laboratories Inc.



Ratings and capacities (cont)



CAPACITY CONTROL STAGING OPTIONS

APPLICATION	UNIT	DEMAND SOURCE	COOLING CONTROL METHOD	COMPRESSOR SEQUENCE					
				SIZE 020-027 UNITS			SIZE 030-060 UNITS		
				WITHOUT HOT GAS BYPASS	WITH HOT GAS BYPASS	WITH VARIABLE CAPACITY COMPRESSOR	WITHOUT HOT GAS BYPASS	WITH HOT GAS BYPASS	WITH VARIABLE CAPACITY COMPRESSOR
VAV	48/50A3,A5, A7,A9	RAT	Multiple Stage EDT	Table A	Table B	Table C	Table D	Table E	Table F
		SPT	Multiple Stage EDT	Table A	Table B	Table C	Table D	Table E	Table F
SAV/CV Sensor	48/50A2,A4, A6,A8	SPT	Multiple Adaptive Demand	Table A	Table B	Table C	Table D	Table E	Table F
SAV/CV, Mech Thermostat		Y1,Y2	Multiple Adaptive Demand	Table A	Table B	Table C	Table D	Table E	Table F

LEGEND

- CV — Constant Volume
 EDT — Evaporator Discharge Temperature
 RAT — Return Air Temperature
 SAV — Staged Air Volume
 SPT — Space Temperature
 VAV — Variable Air Volume

CAPACITY CONTROL STAGING OPTIONS TABLE A

48/50A020-027 UNITS VAV AND ADAPTIVE CV/SAV STAGING SEQUENCE WITHOUT HOT GAS BYPASS

STAGE	SEQUENCE 1				SEQUENCE 2			
	0	1	2	3	0	1	2	3
COMP	Compressor Status							
A1	OFF	ON	OFF	ON	OFF	OFF	ON	ON
A2	OFF	OFF	ON	ON	OFF	ON	OFF	ON
B1	OFF	OFF	ON	ON	OFF	OFF	ON	ON
UNIT	Capacity 48/50A							
020	0%	30%	70%	100%	0%	30%	70%	100%
025	0%	33%	67%	100%	0%	33%	67%	100%
027	0%	33%	67%	100%	0%	33%	67%	100%

CAPACITY CONTROL STAGING OPTIONS TABLE B

48/50A020-027 UNIT VAV AND ADAPTIVE CV STAGING SEQUENCE WITH HOT GAS BYPASS

STAGE	SEQUENCE 1					SEQUENCE 2				
	0	1	2	3	4	0	1	2	3	4
COMP	Compressor Status									
A1	OFF	ON*	ON	OFF	ON	OFF	OFF	OFF	ON	ON
A2	OFF	OFF	OFF	ON	ON	OFF	ON*	ON	OFF	ON
B1	OFF	OFF	OFF	ON	ON	OFF	OFF	OFF	ON	ON
UNIT	Capacity 48/50A									
020	0%	10%	30%	70%	100%	0%	10%	30%	70%	100%
025	0%	17%	33%	67%	100%	0%	17%	33%	67%	100%
027	0%	17%	33%	67%	100%	0%	17%	33%	67%	100%

*Hot gas bypass activated.

CAPACITY CONTROL STAGING OPTIONS TABLE C

48/50A020-027 UNITS VAV AND ADAPTIVE CV/SAV STAGING SEQUENCE WITH VARIABLE CAPACITY COMPRESSOR

COMP	STAGE			
	0	1	2	3
COMP	Compressor Status			
A1	OFF	OFF	ON	ON
A2	OFF	OFF	OFF	ON
B1*	OFF	ON	ON	ON
UNIT	Capacity 48/50A			
020	0%	20% to 40%	50% to 70%	80% to 100%
025	0%	17% to 33%	50% to 66%	83% to 100%
027	0%	17% to 33%	50% to 66%	83% to 100%

*On units with optional digital scroll compressor, compressor B1 modulates from minimum to maximum capacity to provide increased stages.

Ratings and capacities (cont)



**CAPACITY CONTROL STAGING OPTIONS TABLE D
48/50A030-060 UNITS VAV AND ADAPTIVE CV/SAV STAGING SEQUENCE WITHOUT HOT GAS BYPASS**

STAGE	SEQUENCE 1					SEQUENCE 2				
	0	1	2	3	4	0	1	2	3	4
COMP	Compressor Status					Compressor Status				
A1	OFF	ON	OFF	OFF	ON	OFF	OFF	ON	ON	ON
A2	OFF	OFF	ON	ON	ON	OFF	ON	OFF	ON	ON
B1	OFF	OFF	ON	ON	ON	OFF	OFF	ON	ON	ON
B2	OFF	OFF	ON	ON	ON	OFF	OFF	OFF	ON	ON
UNIT	Capacity 48/50A					Capacity 48/50A				
030	0%	25%	50%	75%	100%	0%	25%	50%	75%	100%
035	0%	20%	50%	80%	100%	0%	20%	50%	70%	100%
040	0%	25%	50%	75%	100%	0%	25%	50%	75%	100%
050	0%	25%	50%	75%	100%	0%	25%	50%	75%	100%
060	0%	25%	50%	75%	100%	0%	25%	50%	75%	100%

CAPACITY CONTROL STAGING OPTIONS TABLE E

48/50A030-060 UNITS VAV AND ADAPTIVE CV/SAV STAGING SEQUENCE WITH HOT GAS BYPASS STAGING SEQUENCE

STAGE	SEQUENCE 1					SEQUENCE 2						
	0	1	2	3	4	5	0	1	2	3	4	5
COMP	Compressor Status					Compressor Status						
A1	OFF	ON*	ON	OFF	OFF	ON	OFF	OFF	ON	ON	ON	
A2	OFF	OFF	OFF	ON	ON	ON	OFF	ON*	ON	OFF	ON	
B1	OFF	OFF	OFF	ON	ON	ON	OFF	OFF	OFF	ON	ON	
B2	OFF	OFF	OFF	OFF	ON	ON	OFF	OFF	OFF	OFF	ON	
UNIT	Capacity 48/50A					Capacity 48/50A						
030	0%	10%	25%	50%	75%	100%	0%	10%	25%	50%	75%	100%
035	0%	7%	20%	50%	80%	100%	0%	7%	20%	50%	70%	100%
040	0%	14%	25%	50%	75%	100%	0%	14%	25%	50%	75%	100%
050	0%	16%	25%	50%	75%	100%	0%	16%	25%	50%	75%	100%
060	0%	18%	25%	50%	75%	100%	0%	18%	25%	50%	75%	100%

*Hot gas bypass activated.

CAPACITY CONTROL STAGING OPTIONS TABLE F

48/50A030-060 UNITS VAV AND ADAPTIVE CV/SAV STAGING SEQUENCE WITH VARIABLE CAPACITY COMPRESSOR

STAGE	SEQUENCE 1				
	0	1	2	3	4
COMP	Compressor Status				
A1*	OFF	ON	ON	ON	ON
A2	OFF	OFF	OFF	ON	ON
B1	OFF	OFF	ON	ON	ON
B2	OFF	OFF	OFF	OFF	ON
UNIT	Capacity 48/50A				
030	0%	12.5% to 25%	37.5% to 50%	62.5% to 75%	87.5% to 100%
035	0%	9.8% to 19.6%	29.4% to 39.4%	59.8% to 69.6%	90.2% to 100%
040	0%	12.5% to 25%	37.5% to 50%	62.5% to 75%	87.5% to 100%
050	0%	12.5% to 25%	37.5% to 50%	62.5% to 75%	87.5% to 100%
060	0%	12.5% to 25%	37.5% to 50%	62.5% to 75%	87.5% to 100%

*On units with optional digital scroll compressor, compressor A1 modulates from minimum to maximum capacity to provide increased stages.

ALTITUDE COMPENSATION — 48A UNITS

ELEVATION (ft)	SIZES 020-035		SIZES 040-060	
	Natural Gas Orifice Drill Bit Size*	Liquid Propane Orifice Drill Bit Size*	Natural Gas Orifice Drill Bit Size*	Liquid Propane Orifice Drill Bit Size*
0-2,000	34	43	31	41
2,001- 3,000	7/64"	44	32	3/32"
3,001- 4,000	36	45	33	43
4,001- 5,000	37	45	33	43
5,001- 6,000	38	45	34	44
6,001- 7,000	39	47	36	44
7,001- 8,000	40	47	36	45
8,001- 9,000	41	48	37	45
9,001-10,000	3/32"	48	38	45
10,001-11,000	42	49	39	47
11,001-12,000	43	49	40	5/64"
12,001-13,000	43	50	41	48
13,001-14,000	44	50	3/32"	49

*Orifices available through your local Carrier distributor.

Physical data — 48A units



UNIT 48A	020	025	027	030							
NOMINAL CAPACITY (tons)	20	25	27	30							
BASE UNIT OPERATING WEIGHT (lb)		See Applied RTU Builder									
COMPRESSOR Quantity ... Type (Ckt 1/Ckt 2) Number of Refrigerant Circuits Oil	2 ... ZP67/1...ZP91 2 Precharged	2 ... ZP91/1...ZP91 2 Precharged	2 ... ZP91/1...ZP91 2 Precharged	2...ZP72, 2...ZP72 2 Precharged							
REFRIGERANT Operating Charge (lb), Ckt 1/Ckt 2 RTPF Coils MCHX Coils MCHX Coils with Humidi-MiZer	25.8/18.6 14.5/11.6 21.7/11.6	30.2/15.2 16.5/11.0 23.7/11.0	32.8/16.5 16.5/11.0 23.7/11.0	30.5/34.3 15.1/15.3 15.1/22.5							
MCHX CONDENSER*	1 32.9	1 32.9	1 32.9	1 32.9							
RTPF CONDENSER Quantity Rows ... Fins/in. Total Face Area (sq ft)	1 2...15 33.3	1 3...15 33.3	1 3...15 33.3	1 4...15 33.3							
CONDENSER FAN Nominal Cfm Quantity... Diameter (in.) Motor Hp	19,500 2 ... 30 1	19,500 2 ... 30 1	19,500 2 ... 30 1	19,500 2 ... 30 1							
EVAPORATOR COIL Tube Size (in.) Rows ... Fins/in. Total Face Area (sq ft)	3/8 3 ... 15 31.7	Cross-Hatched Copper Tubes, Aluminum Plate Fins with Intertwined Circuits 3/8 4 ... 14 31.7	3/8 4 ... 15 31.7	3/8 4 ... 15 31.7							
HUMIDI-MIZER COIL Coil Construction Quantity Face Area (sq ft)	1 14.4	E-Coated Aluminum Novation® Heat Exchanger with Microchannel Coil Technology 1 14.4	1 14.4	1 14.4							
EVAPORATOR FAN Quantity ... Size (in.) Type Drive Nominal Cfm Motor Hp Motor Frame Size Motor Bearing Type Maximum Allowable Rpm Motor Pulley Pitch Diameter Nominal Motor Shaft Diameter (in.) Fan Pulley Pitch Diameter (in.) Nominal Fan Shaft Diameter (in.) Belt Quantity Belt Type Belt Length (in.) Pulley Center Line Distance (in.) Factory Speed Setting (rpm)	2 ... 20 X 15 Belt 8,000 5 184T 215T 254T 15 1200 4.8 1 1/8 12.4 1 15/16 1 BX56 56 16.0- 18.7 717	2 ... 20 X 15 Belt 10,000 5 184T 215T 254T 10 1200 5.2 1 1/8 12.4 1 15/16 1 BX56 56 15.6- 18.4 924 1096	2 ... 20 X 15 Belt 11,000 10 215T 254T 15 1200 5.5 1 1/8 8.7 2 5VX530 57 15.6-18.4 773	2 ... 20 X 15 Belt 12,000 10 215T 254T 15 1200 4.4 1 1/8 9.4 2 5VX530 53 15.0- 962	2 ... 20 X 15 Belt 12,000 10 215T 254T 15 1200 5.9 1 1/8 8.7 2 5VX530 50 15.0- 1106	2 ... 20 X 15 Belt 12,000 10 215T 254T 15 1200 4.4 1 1/8 9.0 2 5VX530 53 15.6- 848	2 ... 20 X 15 Belt 12,000 10 215T 254T 15 1200 5.7 1 1/8 9.1 2 5VX530 53 15.0- 1059	2 ... 20 X 15 Belt 12,000 10 215T 254T 15 1200 5.9 1 1/8 8.7 2 5VX530 53 15.0- 1187	2 ... 20 X 15 Belt 12,000 10 215T 254T 15 1200 5.7 1 1/8 8.7 2 5VX530 53 15.0- 856	2 ... 20 X 15 Belt 12,000 10 215T 254T 15 1200 5.9 1 1/8 8.7 2 5VX530 53 15.0- 1096	2 ... 20 X 15 Belt 12,000 10 215T 254T 15 1200 5.9 1 1/8 8.7 2 5VX530 53 15.0- 1187
FURNACE SECTION Supply Line Pressure Range Rollout Switch Cutout Temp (F)† Burner Orifice Diameter (in. ...drill size) Natural Gas Std Liquid Propane Alt Thermostat Heat Anticipator Setting Stage 1 (amps) Stage 2 (amps) Gas Input (Btuh) Stage 1 (Low Heat/High Heat) Stage 2 (Low Heat/High Heat) Efficiency (Steady State) (%) Temperature Rise Range Manifold Pressure (in. wg) Natural Gas Std Liquid Propane Alt Gas Valve Quantity			5.0-in. wg min/13.5-in. wg max.								
HIGH-PRESSURE SWITCH (psig) Cutout Reset (Auto.)	225 650 500	225 650 500	225 650 500	225 650 500	225 650 500						
MIXED-AIR FILTERS Quantity ... Size (in.) Standard Pleated	10 ... 20 x 24 x 2 5 ... 20 x 20 x 4 5 ... 20 x 24 x 4	10 ... 20 x 24 x 2 5 ... 20 x 20 x 4 5 ... 20 x 24 x 4	10 ... 20 x 24 x 2 5 ... 20 x 20 x 4 5 ... 20 x 24 x 4	10 ... 20 x 24 x 2 5 ... 20 x 20 x 4 5 ... 20 x 24 x 4	10 ... 20 x 24 x 2 5 ... 20 x 20 x 4 5 ... 20 x 24 x 4						
OUTDOOR-AIR FILTERS Quantity...Size (in.)			8...16 x 25 x 2 4...20 x 25 x 2								
POWER EXHAUST Motor, Quantity...Hp Fan, Diameter...Width (in.)		Direct Drive, Single-Phase Motors (Factory-Wired for High Speed Operation), Forward-Curved Fan Wheels with Backdraft Dampers on Each Fan Housing 4...1 11 x 10									

LEGEND

Al — Aluminum
 Cu — Copper
 MCHX— Microchannel Heat Exchanger
 RTPF — Round Tube Plate Fin

* Sizes 020 to 027: Circuit 1 uses the lower portion of condenser coil, Circuit 2 uses the upper portion. Sizes 030 and 035: Circuit 1 uses the upper portion of condenser coil, Circuit 2 uses the lower portion. Sizes 040 and 050: Circuit 1 uses the left condenser coil, Circuit 2 the right. Size 060: Circuit A uses the two MCHX coils near the bulkhead, Circuit B uses the two MCHX coils near the control box.

† Rollout switch is manual reset.

Physical data — 48A units (cont)



UNIT 48A	035	040	050	060
NOMINAL CAPACITY (tons)	35	40	50	60
BASE UNIT OPERATING WEIGHT (lb)		See Applied RTU Builder		
COMPRESSOR				
Quantity ... Type (Ckt 1/Ckt 2)	2 ... ZP67/2...ZP104	2...ZP104/2...ZP104	2...ZP122/2...ZP122	2...ZP154/2...ZP154
Number of Refrigerant Circuits	2	2	2	2
Oil	Precharged	Precharged	Precharged	Precharged
REFRIGERANT		R-410A		
Operating Charge (lb), Ckt 1/Ckt 2				
RTPF Coils	28.7 / 44.0	44.0 / 44.0	56.3 / 57.3	78.5 / 82.0
MCHX Coils	17.9 / 26.0	23.0 / 23.5	27.0 / 28.0	36.3 / 37.8
MCHX Coils with Humidi-Mizer	17.9 / 31.5	23.0 / 30.5	26.5 / 34.5	36.3 / 47.6
MCHX CONDENSER*				
Quantity	1	2	2	4
Total Face Area (sq ft)	32.9	65.8	65.8	105.2
RTPF CONDENSER				
Quantity	1	2	2	2
Rows...Fins/in.	4..15	3..15	4..15	6..30
Total Face Area (sq ft)	33.3	66.7	66.7	100.0
CONDENSER FAN		Propeller Type		
Nominal Cfm	19,500	32,000	35,000	40,000
Quantity ... Diameter (in.)	2 ... 30	4 ... 30	4 ... 30	4...30.5(MCHX), 6...30(RTPF)
Motor Hp	1	1	1	1
EVAPORATOR COIL		Cross-Hatched Copper Tubes, Aluminum Plate Fins with Intertwined Circuits		
Tube Size (in.)	1/2	1/2	1/2	1/2
Rows ... Fins/in.	6 ... 16	4 ... 17	6 ... 16	4...17
Total Face Area (sq ft)	31.3	31.3	31.3	48.1
HUMIDI-MIZER COIL		E-Coated Aluminum Novation® Heat Exchanger with Microchannel Coil Technology		
Coil Construction				
Quantity	1	1	1	1
Face Area (sq ft)	14.4	14.4	14.4	14.1
EVAPORATOR FAN		Centrifugal Type		
Quantity ... Size (in.)	2 ... 20 X 15	2 ... 20 X 15	2 ... 20 X 15	3 ... 20 X 15
Type Drive	Belt	Belt	Belt	Belt
Nominal Cfm	14,000	16,000	18,000	24,000
Motor Hp	15 254T	20 256T	25 284T	30 286T
Motor Frame Size	254T	256T	284T	286T
Motor Bearing Type	Ball	Ball	Ball	Ball
Maximum Allowable Rpm	1300	1300	1300	1200
Motor Pulley Pitch Diameter (in.)	5.1	5.7	6.2	6.7
Nominal Motor Shaft Diameter (in.)	1 5/8	1 5/8	1 7/8	1 7/8
Fan Pulley Pitch Diameter (in.)	8.7	8.7	8.7	9.1
Nominal Fan Shaft Diameter (in.)	1 15/16	1 15/16	1 15/16	1 15/16
Belt Quantity	2	2	2	3
Belt Type	5VX500 50	5VX530 53	5VX550 55	5VX550 55
Belt Length (in.)	15.0-17.9	15.0-17.9	15.0-17.9	15.0-17.9
Pulley Center Line Distance (in.)	15.0-17.9	15.0-17.9	15.0-17.9	15.0-17.9
Factory Speed Setting (rpm)	1025	1147	1247	1019
FURNACE SECTION		5.0-in. wg min/13.5-in. wg max.		
Supply Line Pressure Range				
Rollout Switch Cutout				
Temp (F)†	225	225	225	225
Burner Orifice Diameter (in ...drill size)				
Natural Gas	Std Alt	.11134 (low)/.12031 (high) .08943	.12031 .09641	.12031 .09641
Liquid Propane				
Thermostat Heat Anticipator Setting				
Stage 1 (amps)	0.1	0.24	0.1	0.1
Stage 2 (amps)	0.1	0.13	0.1	0.1
Gas Input (Btu/h) Stage 1 (Low Heat/High Heat)	262,500/600,000	300,000/600,000	300,000/600,000	582,000/873,000
Stage 2 (Low Heat/High Heat)	350,000/800,000	400,000/800,000	400,000/800,000	776,000/1,164,000
Efficiency (Steady State) (%)	81	81	81	81
Temperature Rise Range	15-45/30-60	10-40/30-60	10-40/30-60	10-40/30-60
Manifold Pressure (in. wg)				
Natural Gas	Std Alt	3.5	3.5	3.3
Liquid Propane		3.5	3.5	3.3
Gas Valve Quantity	2	2	2	3
HIGH-PRESSURE SWITCH (psig)				
Cutoff	650	650	650	650
Reset (Auto.)	500	500	500	500
MIXED-AIR FILTERS				
Quantity ... Size (in.) Standard	10 ... 20 x 24 x 2	10 ... 20 x 24 x 2	10 ... 20 x 24 x 2	16...20 x 24 x 2
Pleated	5 ... 20 x 20 x 4	5 ... 20 x 20 x 4	5 ... 20 x 20 x 4	8...20 x 20 x 4
	5 ... 20 x 24 x 4	5 ... 20 x 24 x 4	5 ... 20 x 24 x 4	8...20 x 24 x 4
OUTDOOR-AIR FILTERS				
Quantity...Size (in.)	8...16 x 25 x 2 4...20 x 25 x 2	8...16 x 25 x 2 4...20 x 25 x 2	8...16 x 25 x 2 4...20 x 25 x 2	12...16 x 25 x 2 6...20 x 25 x 2
POWER EXHAUST		Direct Drive, Single-Phase Motors (Factory-Wired for High Speed Operation), Forward-Curved Fan Wheels with Backdraft Dampers on Each Fan Housing		
Motor, Quantity...Hp	4...1	4...1	4...1	6...1
Fan, Diameter...Width (in.)	11 x 10	11 x 10	11 x 10	11 x 10

LEGEND

Al — Aluminum
 Cu — Copper
 MCHX— Microchannel Heat Exchanger
 RTPF — Round Tube Plate Fin

* Sizes 020 to 027: Circuit 1 uses the lower portion of condenser coil, Circuit 2 uses the upper portion. Sizes 030 and 035: Circuit 1 uses the upper portion of condenser coil, Circuit 2 uses the lower portion. Sizes 040 and 050: Circuit 1 uses the left condenser coil, Circuit 2 the right. Size 060: Circuit A uses the two MCHX coils near the bulkhead, Circuit B uses the two MCHX coils near the control box.

† Rollout switch is manual reset.

Physical data — 50A units



UNIT 50A	020	025	027	030			
NOMINAL CAPACITY (tons)	20	25	27	30			
BASE UNIT OPERATING WEIGHT (lb)	See Applied RTU Builder						
COMPRESSOR Quantity ... Type (Ckt 1/Ckt 2) Number of Refrigerant Circuits Oil	2 ... ZP67/1...ZP91 2 Precharged	2 ... ZP91/1...ZP91 2 Precharged	2 ... ZP91/1...ZP91 2 Precharged	2...ZP72, 2...ZP72 2 Precharged			
REFRIGERANT Operating Charge (lb), Ckt 1/Ckt 2 RTPF Coils MCHX Coils MCHX Coils with Humidi-Mizer	25.8/18.6 14.5/11.6 21.7/11.6	30.2/15.2 16.5/11.0 23.7/11.0	32.8/16.5 16.5/11.0 23.7/11.0	30.5/34.3 15.1/15.3 15.1/22.5			
MCHX CONDENSER* Quantity Total Face Area (sq ft)	1 32.9	1 32.9	1 32.9	1 32.9			
RTPF CONDENSER Quantity Rows...Fins/in. Total Face Area (sq ft)	1 2...15 33.3	1 3...15 33.3	1 3...15 33.3	1 4...15 33.3			
CONDENSER FAN Nominal Cfm Quantity... Diameter (in.) Motor Hp	19,500 2 ... 30 1	19,500 2 ... 30 1	19,500 2 ... 30 1	19,500 2 ... 30 1			
EVAPORATOR COIL Tube Size (in.) Rows ... Fins/in. Total Face Area (sq ft)	^{3/8} 3 ... 15 31.7	Cross-Hatched Copper Tubes, Aluminum Plate Fins with Intertwined Circuits ^{3/8} 4 ... 14 31.7	^{3/8} 4 ... 15 31.7	^{3/8} 4 ... 15 31.7			
HUMIDI-MIZER COIL Coil Construction Quantity Face Area (sq ft)	1 14.4	E-Coated Aluminum Novation® Heat Exchanger with Microchannel Coil Technology 1 14.4	1 14.4	1 14.4			
EVAPORATOR FAN Quantity ... Size (in.) Type Drive Nominal Cfm Motor Hp Motor Frame Size Motor Bearing Type Maximum Allowable Rpm Motor Pulley Pitch Diameter Nominal Motor Shaft Diameter (in.) Fan Pulley Pitch Diameter (in.) Nominal Fan Shaft Diameter (in.) Belt Quantity Belt Type Belt Length (in.) Pulley Center Line Distance (in.) Factory Speed Setting (rpm)	2 ... 20 X 15 Belt 8,000 5 184T 10 215T 15 254T 5 184T 10 215T 15 254T 4.8 12.4 11/8 12.4 115/16 1 BX56 56 16.0 18.7 717	2 ... 20 X 15 Belt 10,000 5 184T 10 215T 15 254T 5.2 12.4 11/8 12.4 115/16 2 BX50 63 15.6- 18.4 924 1096	2 ... 20 X 15 Belt 11,000 10 215T 15 254T 10 215T 15 254T 5.5 8.7 15/8 9.4 115/16 2 BX50 57 15.6-18.4 773	2 ... 20 X 15 Belt 12,000 10 215T 15 254T 1200 1200 1200 1200 1200 20 256T 20 256T 4.4 9.4 15/8 9.4 115/16 2 BX50 50 15.0- 848	2 ... 20 X 15 Belt 12,000 10 215T 15 254T 1200 1200 1200 1200 1200 20 256T 20 256T 4.9 8.7 15/8 9.0 115/16 2 BX50 53 15.0- 856	2 ... 20 X 15 Belt 12,000 10 215T 15 254T 1200 1200 1200 1200 1200 20 256T 20 256T 5.7 9.1 15/8 9.1 115/16 2 BX50 53 15.0- 1096	2 ... 20 X 15 Belt 12,000 10 215T 15 254T 1200 1200 1200 1200 1200 20 256T 20 256T 5.9 8.7
HIGH-PRESSURE SWITCH (psig) Cutout Reset (Auto.)	650 500	650 500	650 500	650 500			
MIXED-AIR FILTERS Quantity ... Size (in.) Standard Pleated	10 ... 20 x 24 x 2 5 ... 20 x 20 x 4 5 ... 20 x 24 x 4	10 ... 20 x 24 x 2 5 ... 20 x 20 x 4 5 ... 20 x 24 x 4	10 ... 20 x 24 x 2 5 ... 20 x 20 x 4 5 ... 20 x 24 x 4	10 ... 20 x 24 x 2 5 ... 20 x 20 x 4 5 ... 20 x 24 x 4			
OUTDOOR-AIR FILTERS Quantity...Size (in.)	8...16 x 25 x 2 4...20 x 25 x 2						
POWER EXHAUST Motor, Quantity...Hp Fan, Diameter...Width (in.)	Direct Drive, Single-Phase Motors (Factory-Wired for High Speed Operation), Forward-Curved Fan Wheels with Backdraft Dampers on Each Fan Housing 4...1 11 x 10						

LEGEND

Al — Aluminum
 Cu — Copper
 MCHX — Microchannel Heat Exchanger
 RTPF — Round Tube Plate Fin

* Sizes 020 to 027: Circuit 1 uses the lower portion of condenser coil, Circuit 2 uses the upper portion. Sizes 030 and 035: Circuit 1 uses the upper portion of condenser coil, Circuit 2 uses the lower portion. Sizes 040 and 050: Circuit 1 uses the left condenser coil, Circuit 2 the right. Size 060: Circuit A uses the two MCHX coils near the bulkhead, Circuit B uses the two MCHX coils near the control box.

† Rollout switch is manual reset.

Physical data — 50A units (cont)



UNIT 50A	035	040	050	060				
NOMINAL CAPACITY (tons)	35	40	50	60				
BASE UNIT OPERATING WEIGHT (lb)	See Applied RTU Builder							
COMPRESSOR Quantity ... Type (Ckt 1/Ckt 2) Number of Refrigerant Circuits Oil	2 ... ZP67/2...ZP104 2 Precharged	2...ZP104/2...ZP104 2 Precharged	2...ZP122/2...ZP122 2 Precharged	2...ZP154/2...ZP154 2 Precharged				
REFRIGERANT Operating Charge (lb), Ckt 1/Ckt 2 RTPF Coils MCHX Coils MCHX Coils with Humidi-Mizer	28.7 / 44.0 17.9 / 26.0 17.9 / 31.5	44.0 / 44.0 23.0 / 23.5 23.0 / 30.5	56.3 / 57.3 27.0 / 28.0 26.5 / 34.5	78.5 / 82.0 36.3 / 37.8 36.3 / 47.6				
MCHX CONDENSER* Quantity Total Face Area (sq ft)	1 32.9	2 65.8	2 65.8	4 105.2				
RTPF CONDENSER Quantity Rows...Fins/in Total Face Area (sq ft)	1 4...15 33.3	2 3...15 66.7	2 4...15 66.7	2 6...30 100.0				
CONDENSER FAN Nominal Cfm Quantity... Diameter (in.) Motor Hp	19,500 2 ... 30 1	32,000 4 ... 30 1	35,000 4 ... 30 1	40,000 4...30.5(MCHX), 6...30(RTPF) 1				
EVAPORATOR COIL Tube Size (in.) Rows ... Fins/in. Total Face Area (sq ft)	1/2 6 ... 16 31.3	Cross-Hatched Copper Tubes, Aluminum Plate Fins with Intertwined Circuits						
HUMIDI-MIZER COIL Coil Construction Quantity Face Area (sq ft)	E-Coated Aluminum Novation® Heat Exchanger with Microchannel Coil Technology							
EVAPORATOR FAN Quantity ... Size (in.) Type Drive Nominal Cfm Motor Hp Motor Frame Size Motor Bearing Type Maximum Allowable Rpm Motor Pulley Pitch Diameter Nominal Motor Shaft Diameter (in.) Fan Pulley Pitch Diameter (in.) Nominal Fan Shaft Diameter (in.) Belt Quantity Belt Type Belt Length (in.) Pulley Center Line Distance (in.) Factory Speed Setting (rpm)	2 ... 20 X 15 Belt 14,000 15 254T 256T Ball 1300 5.1 15 ¹ / ₈ 8.7 11 ⁵ / ₁₆ 2 50 15.0- 17.9 1025	2 ... 20 X 15 Belt 16,000 15 254T 256T Ball 1300 5.3 15 ¹ / ₈ 9.5 11 ⁵ / ₁₆ 2 53 15.0- 17.9 976	2 ... 20 X 15 Belt 18,000 20 256T 284T Ball 1300 7.5 17 ¹ / ₈ 11.1 11 ⁵ / ₁₆ 2 55 15.0- 17.9 1050	2 ... 20 X 15 Belt 24,000 25 284T 286T Ball 1200 6.2 17 ¹ / ₈ 9.5 11 ⁵ / ₁₆ 2 57 14.6- 17.6 1050	3 ... 20 X 15 Belt 24,000 30 286T Ball 1200 6.7 17 ¹ / ₈ 9.1 11 ⁵ / ₁₆ 2 57 14.6- 17.6 1142	3 ... 20 X 15 Belt 30 286T Ball 1200 5.3 17 ¹ / ₈ 9.5 11 ⁵ / ₁₆ 3 53 14.6- 17.2 1019	3 ... 20 X 15 Belt 30 324T Ball 1200 5.9 17 ¹ / ₈ 9.5 11 ⁵ / ₁₆ 3 55 14.7- 17.0 1087	3 ... 20 X 15 Belt 30 324T Ball 1200 6.5 17 ¹ / ₈ 9.5 11 ⁵ / ₁₆ 3 57 14.2- 17.0 1197
HIGH-PRESSURE SWITCH (psig) Cutout Reset (Auto.)	650 500	650 500	650 500	650 500				
MIXED-AIR FILTERS Quantity ... Size (in.) Standard Pleated	10 ... 20 x 24 x 2 5 ... 20 x 20 x 4 5 ... 20 x 24 x 4	10 ... 20 x 24 x 2 5 ... 20 x 20 x 4 5 ... 20 x 24 x 4	10 ... 20 x 24 x 2 5 ... 20 x 20 x 4 5 ... 20 x 24 x 4	16...20 x 24 x 2 8...20 x 20 x 4 8...20 x 24 x 4				
OUTDOOR-AIR FILTERS Quantity...Size (in.)	8...16 x 25 x 2 4...20 x 25 x 2	8...16 x 25 x 2 4...20 x 25 x 2	8...16 x 25 x 2 4...20 x 25 x 2	12...16 x 25 x 2 6...20 x 25 x 2				
POWER EXHAUST Motor, Quantity...Hp Fan, Diameter...Width (in.)	Direct Drive, Single-Phase Motors (Factory-Wired for High Speed Operation), Forward-Curved Fan Wheels with Backdraft Dampers on Each Fan Housing							
	4...1 11 x 10	4...1 11 x 10	4...1 11 x 10	6...1 11 x 10				

LEGEND

Al — Aluminum

Al — Aluminum **Cu** — Copper

MCHX— Microchannel Heat Exchanger

RTPF — Round Tube Plate Fin

- * Sizes 020 to 027: Circuit 1 uses the lower portion of condenser coil, Circuit 2 uses the upper portion. Sizes 030 and 035: Circuit 1 uses the upper portion of condenser coil, Circuit 2 uses the lower portion. Sizes 040 and 050: Circuit 1 uses the left condenser coil, Circuit 2 the right. Size 060: Circuit A uses the two MCHX coils near the bulkhead, Circuit B uses the two MCHX coils near the control box.
- + Rollout switch is manual reset.

T Rollout switch is manual reset.

Options and accessories



ITEM	FACTORY-INSTALLED OPTIONS				FIELD-INSTALLED ACCESSORIES			
	A2,A6	A3,A7	A4,A8	A5,A9	A2,A6	A3,A7	A4,A8	A5,A9
GAS HEAT OPTIONS (48A Only)								
Low Gas Heat - Aluminized	X	X	X	X				
High Gas Heat - Aluminized	X	X	X	X				
Low Gas Heat - Stainless Steel	X	X	X	X				
High Gas Heat - Stainless Steel	X	X	X	X				
Staged Gas Heat - Low - Stainless Steel	X	X	X	X				
Staged Gas Heat - High - Stainless Steel	X	X	X	X				
LP Conversion Kit					X	X	X	X
ELECTRIC HEAT (50A Only)								
Low Electric Heat	X	X	X	X				
High Electric Heat	X	X	X	X				
INDOOR AIR QUALITY								
2-inch Filters	X	X	X	X				
4-inch Filters	X	X	X	X				
Double Wall in the Airstream (Special Order)	X	X	X	X				
ECONOMIZER								
Manual Outside Air Self-Closing Damper	X	X	X	X				
Modulating Ultra Low-Leak Economizer	X	X	X	X				
Outdoor or Return Humidity Sensor (Enthalpy)					X	X	X	X
EXHAUST AIR CONTROL								
Barometric Relief	X	X			X	X	X	X
Non-Modulating Power Exhaust	X				X	X	X	X
Staged Power Exhaust	X	X			X	X	X	X
Building Pressure Control Board (ECB2)					X			
Building Pressure Control Sensor					X	X	X	X
CONDENSER AND EVAPORATOR COIL OPTIONS								
Al/Cu Condenser and Evaporator	X	X	X	X				
Al/Cu Pre-Coat Condenser	X	X	X	X				
Al/Cu E-Coat Evaporator and/or Condenser	X	X	X	X				
Cu/Cu Condenser and Al/Cu Evaporator	X	X	X	X				
MCHX Condenser and Al/Cu Evaporator	X	X	X	X				
E-Coat MCHX Condenser and Al/Cu Evaporator	X	X	X	X				
E-Coat MCHX Condenser and Al/Cu E-Coat Evaporator	X	X	X	X				
Variable Capacity Compressor (Lead Circuit)	X	X	X	X				
Hot Gas Bypass - Circuit A (includes ECB2)	X	X	X	X				
Condenser Coil Hail Guard Assembly					X	X	X	X
Low Sound Condenser Fan	X	X	X	X				
Low Ambient Control	X	X	X	X				
Greenspeed® Intelligence	X	X	X	X				
Humidi-MiZer® Adaptive Dehumidification System	X	X	X	X				
CONTROLS								
Controls Expansion Module (CEM)	X	X	X	X	X	X	X	X
BACnet ¹ Communications	X	X	X	X				
System Pilot™ Interface					X	X	X	X
Touch Pilot™ Interface					X	X	X	X
Navigator™ Display					X	X	X	X
Return Air CO ₂ Sensor	X	X	X	X	X	X	X	X
CO ₂ Space Sensor					X	X	X	X
CO ₂ Aspirator Box					X	X	X	X
Return Air Smoke Detector	X	X	X	X				
Filter Switch	X	X	X	X	X	X	X	X
Fan Status Switch (requires CEM)					X	X	X	X
T55 Thermostat					X	X	X	X
T56 Thermostat					X	X	X	X
ZS Communicating Sensor (with BACnet)					X	X	X	X
Space Temperature Sensor with CO ₂ Override					X	X	X	X
Space Temperature Sensor Setpoint and CO ₂ Override					X	X	X	X
Two-Stage Heat/Cool Thermostats					X		X	
Modbus ² Carrier Translator					X	X	X	X
LonWorks ³ Carrier Translator					X	X	X	X

Options and accessories (cont)



ITEM	FACTORY-INSTALLED OPTIONS				FIELD-INSTALLED ACCESSORIES			
	A2,A6	A3,A7	A4,A8	A5,A9	A2,A6	A3,A7	A4,A8	A5,A9
POWER CIRCUIT								
GFI Convenience Outlet (powered)	X	X	X	X				
GFI Convenience Outlet (not powered)	X	X	X	X				
Power Terminal Block	X	X	X	X				
Non-Fused Disconnect	X	X	X	X				
INDOOR MOTOR OPTIONS								
Low HP	X	X	X	X				
Medium HP	X	X	X	X				
High HP	X	X	X	X				
Bypass on Indoor Fan Motor VFD	X	X	X	X				
PACKAGING								
Domestic	X	X	X	X				
Export	X	X	X	X				
MISCELLANEOUS OPTIONS								
Stainless Steel Drain Pan	X	X	X	X				
14-inch Roof Curb					X	X	X	X
Full-perimeter Roof Curb					X	X	X	X
Security Grille (60 Ton Unit Only)	X	X	X	X				
Extended Lube Lines	X	X	X	X				
Compressor Sound Blanket (factory installed with Greenspeed)					X	X	X	X
High SCCR (Special Order)	X	X	X	X				

NOTE(S):

1. BACnet is a trademark of ASHRAE.
2. Modbus is a registered trademark of Schneider Electric.
3. LonWorks is a registered trademark of Echelon Corporation.

Stainless steel gas heat exchanger

Units with two-stage gas heat are available with an optional factory-installed stainless steel gas heat exchanger for improved resistance to corrosion and longer service life. Units with staged gas heat are standard with stainless steel heat exchanger.

Stainless steel gas heat exchangers are recommended for applications with low mixed air temperature operation.

Staged (multi-stage) gas heat

The staged gas heat factory-installed option adds the capability to control the heat output between multiple, discrete output capacities to allow for improved supply air temperature control during heating operation or during supply air tempering operation. Staged gas heat can also be used for reheat operation when using the mechanical cooling system for dehumidification without Humidi-MiZer (if allowed by code).

The staged gas heating system employs multiple heating sections. Each section is equipped with a two-stage gas valve. The gas valves are sequenced by a factory-installed staged gas controller (SGC), as required, to maintain the user-specified supply air set point. Up to 11 stages of heating control are available, based on quantity and heating capacity sizes of the individual heat exchanger sections provided in the base unit. The SGC provides Demand Heating control for the first stage (W1 or low-heat) heating mode. The heating capacity will always go to 100% for second stage (W2 or high-heat) operation.

Tempering supply air is desirable when rooftop units are operating in ventilation mode (economizer only operation) at low outdoor temperatures. At low outdoor temperatures, the mixed-air temperature (combination of return-from-space temperature and outdoor/ventilation air temperature) may become too low for the comfort of the occupants or for the terminal reheat systems. The tempering function adds incremental steps of heat capacity to raise the temperature of the mixed air up to levels suitable for

direct admission into the occupied space or to levels consistent with reheat capabilities of the space terminals.

Staged gas heat is recommended for VAV applications, applications with low mixed air temperatures, tempering applications, or applications where overheating the space is a concern during heating operation.

Electric heat

50 series units are available with a factory-installed two-stage electric heater. The electric heater is single point power and is fed from the unit power feed. Electric heat is available for heating duty and cannot be used for dehumidification reheat or tempering operation.

Humidi-MiZer® adaptive dehumidification system

Carrier's Humidi-MiZer adaptive dehumidification system is an all-inclusive factory-installed option that can be ordered with the WeatherMaker® 48/50A rooftop unit. This system expands the envelope of operation of the A Series rooftop to provide unprecedented flexibility that will meet year-round comfort conditions.

The Humidi-MiZer adaptive dehumidification system has the industry's only dual dehumidification mode setting. The WeatherMaker rooftop, coupled with the Humidi-MiZer adaptive dehumidification system, is capable of modulating between normal design cooling mode, subcooling mode, and hot gas reheat mode.

The Humidi-MiZer system includes a factory-installed three-way reheat valve, modulating condenser and condenser bypass valves, a large face area, e-coated Humidi-MiZer coil, CEM module, and a factory-installed return air relative humidity sensor. The Humidi-MiZer system control is integrated into ComfortLink.

Humidi-MiZer is recommended for single zone applications where a dedicated dehumidification cycle is required. Humidi-MiZer cannot be field installed.

Options and accessories (cont)



Variable capacity (digital) scroll compressor

In air conditioning applications, the load may vary significantly, requiring a means to vary the system capacity for optimal performance and control.

The A Series large rooftop units with optional factory-installed lead circuit variable capacity scroll compression provide a highly efficient means of capacity control using scroll compressors. The digital compressor technology provides smooth, vibration-free operation by axially unloading the compliant scrolls.

By varying the amount of time that the scrolls are unloaded, the A Series unit can precisely match the system capacity to the space load. This feature can reduce energy consumption, provide better dehumidification, reduce compressor cycling, and improve comfort in the space.

Variable capacity compressor is recommended for VAV applications or applications with a wide cooling load range.

Hot gas bypass

For applications without variable compressor where unloading is required, a factory-installed hot gas bypass (HGBP) valve is available. The hot gas bypass valve is installed on the lead circuit and can operate at the lowest stage of capacity to reduce compressor output for additional unloading at low load conditions.

HGBP is recommended for low load applications without variable capacity compressor

Control expansion module (CEM)

The CEM is available as a factory-installed option or field-installed accessory and provides additional control inputs and outputs to facility control operation, including fire, smoke, and purge control modes, fan status switch, demand limiting, IAQ switch, OA IAQ sensor, SAT and SP reset, and dehumidification.

Phase monitor

A factory-installed phase monitor helps protect against phase reversal, phase loss, or voltage imbalance. Phase monitor is recommended for applications with poor power quality.

Return air smoke detector

A return air smoke detector can be ordered as factory installed or for field installation as an accessory. When smoke is detected, a signal is sent to the *ComfortLink* control.

Extended lube lines

Provides nylon lines connected to the grease fittings for the far side bearings to allow easy greasing from the supply fan motor access panel. A grease access point for the far bearings is located near the near bearing.

Return air CO₂ sensor

A factory-installed or field-installed return air CO₂ sensor is available for applications requiring indoor air quality (IAQ) control to increase ventilation air or demand control ventilation (DVC) to decrease ventilation air for energy savings. The IAQ sensor is connected to the *ComfortLink* control and can be used with multiple IAQ functions within the control program.

Pre-coated Al/Cu condenser

A durable epoxy-phenolic coating to provide condenser coil protection in mildly corrosive environments. The coating minimizes galvanic action between dissimilar metals. Coating is

applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.

Pre-coated condensers are recommended for mildly corrosive environments.

Novation® microchannel heat exchanger (MCHX) condenser

The Novation heat exchanger design with MCHX condenser coil is a robust, cost-effective alternative to traditional coil design for standard applications. MCHX coils are also sturdier than other coil types, making them easier to clean without causing damage to the coil.

Due to the compact, all-aluminum design, microchannel coils reduce overall unit operating weight. The streamlined MCHX coil also reduces refrigerant charge by up to 40%.

Microchannel coils are not recommended by Carrier for marine, coastal, or industrial environments, unless Carrier-approved coating is applied. Variable speed head pressure is required when using MCHX coils in applications requiring low ambient mechanical cooling. Contact application engineer when using MCHX condensers in low ambient mechanical cooling applications.

E-coated evaporator and/or condenser

A flexible epoxy polymer coating uniformly applied to all coil surfaces to provide full coil protection in mildly corrosive environments. Coating process shall ensure complete coil encapsulation of tubes, fins and headers.

When applying equipment in high outdoor air applications in mildly corrosive environments, coating all coils is recommended. E-coated coil is required when using MCHX coils in coastal or semi-corrosive applications.

Security grill (60 ton MCHX only)

A factory-installed metal grid security grill is available to restrict ingress into the condenser section of the unit. Security grills are recommended for applications where the unit is mounted near the ground or is otherwise easily accessible.

Stainless steel drain pan

A factory-installed stainless steel drain pan is available for applications requesting additional corrosion resistance from condensate.

BACnet communication option

Includes a factory-installed UPC Open control module that interfaces with *ComfortLink* and facilitates BACnet communication. The UPC controller also allows compatibility with Carrier ZS sensors, Carrier i-Vu control interfaces, and Carrier Open controllers. The UPC supports airside linkage when used with Carrier Open VAV or VVT air terminal controllers.

Low ambient control

The low ambient package includes condenser fan VFDs, for variable speed heat pressure operation by the unit *ComfortLink* control. Mechanical cooling down to -20°F is possible under certain operation conditions with low ambient control.

Low ambient is recommended in applications where low ambient cooling is required and an economizer is not present or not in use. Low ambient control is also recommended for units with Humidi-MiZer.

Options and accessories (cont)



NOTE: On previous units with MotorMaster low ambient control, low ambient operation could be field installed. The current generation (revision 4) uses a new system for low ambient control, which cannot be field installed.

Low sound condenser fan

Select units are available with an optional low sound condenser fan assembly, which includes an AeroAcoustic™ composite condenser fan with a specially designed, low sound, extended shroud to reduce radiated sound. Low sound fans are standard on select 35 and 50 ton configurations.

Low sound condenser fans are recommended for any application that is sensitive to unit radiated sound.

Greenspeed® Intelligence

Greenspeed Intelligence is a special equipment and control configuration that maximizes unit part load efficiency, provides low ambient mechanical cooling operation down to -20°F , and reduces full load and part load radiated sound. The Greenspeed package includes a special *ComfortLink* configuration to optimize condenser fan speed operation for increased energy savings at part load conditions and provides low ambient operation. The Greenspeed package also includes condenser fan VFDs, low sound condenser fans, and compressor sound blankets.

Greenspeed is recommended for applications requiring energy savings, low ambient mechanical cooling operation, or low sound operation.

4 in. filter rack

Provides a factory-installed 4 in. filter rack to allow the use of higher rating or lower pressure drop filters. The 4 in. filter rack option is available with factory-installed 4 in. MERV 8 filter. Accessory filters up to 4 in. MERV 13 are available for field installation.

The 4 in. rack is recommended for applications requiring MERV 8 filters or higher.

Plugged filter indicator

Available as a factory-installed option or field-installed accessory, the plugged filter indicator measures the pressure drop across the filter assembly and provides a signal to *ComfortLink* indicating that the filter is dirty, when the set pressure drop is exceeded.

Non-fused Disconnect

This OSHA-compliant, factory-installed, safety switch allows a service technician to locally disconnect and secure power to the unit with the included lock point for lockout/tagout.

Powered Convenience Outlet

Includes a factory-installed 15A, 115V GFCI covered outlet that is fed by a 115V transformer connected to the load side of the unit terminal block.

Non-powered Convenience Outlet

Includes a factory-installed 15A, 115V GFCI covered outlet that is fed by a 115V transformer for field power connection.

Manual outdoor air damper

The factory-installed manual outdoor air damper provides provision for the introduction of small amounts of outdoor air for applications that don't require free cooling or IAQ control. The non-powered damper operates on gravity and is closed when the supply fan is off and opens to a field set position when the supply fan is on, due to the suction created from the supply fan.

Factory-installed ultra low leak economizer

For applications requiring free cooling, ventilation control, or IAQ control, a factory-installed ultra low leak economizer is available. The economizer uses ultra-low leak blades for tight sealing and a robust drive design for long life. Fault detection and diagnostic (FDD) and multiple free cooling and control methodologies, including integrated economizer and mechanical cooling, are possible with *ComfortLink*. The outdoor air hood and inlet screens are shipped knocked down for field installation.

Barometric relief damper

The factory-installed or field-installed barometric relief package is used in conjunction with the factory-installed economizer to provide building pressure relief during free cooling or IAQ operation when excess outdoor air is introduced to the building. The barometric relief damper is intended for use in low return static pressure applications, such as single story buildings.

When ordered as a factory-installed option, the barometric relief damper and relief hood ship inside the unit in the shipping position to reduce possible shipping damage. The relief hood must be tipped out and the relief assembly tipped up for final installation. For horizontal return applications, the barometric relief must be relocated from the factory-installed position or field installed as an accessory to the horizontal return duct.

Barometric relief is recommended for applications with economizer and very low return duct static pressures.

Non-modulating power exhaust

The factory-installed or field-installed non-modulating power exhaust systems is used for applications with economizer and a high return duct static pressure, such as multi-story buildings. The non-modulating power exhaust provides up to two stages of operation based on economizer position and includes a barometric damper

When ordered as a factory-installed option, the non-modulating power exhaust and exhaust hood ship inside the unit in the shipping position to reduce possible shipping damage. The exhaust hood must be tipped out and the exhaust assembly tipped up for final installation. For horizontal return applications, the power exhaust must be relocated from the factory-installed position or field installed as an accessory to the horizontal return duct. The power exhaust power and wiring are tied back to the main unit, when field installing or relocating the power exhaust to the duct system.

The non-modulating power exhaust is recommended for applications with economizer and mild return duct static pressures.

Modulating Power Exhaust

The factory-installed or field-installed modulating power exhaust systems is used for applications with economizer that require space pressure control. The modulating power exhaust provides up to six stages of power exhaust operation based on building pressure as measured by the included building pressure transducer.

When ordered as a factory-installed option, the modulating power exhaust and exhaust hood ship inside the unit in the shipping position to reduce possible shipping damage. The exhaust hood must be tipped out and the exhaust assembly tipped up for final installation. For horizontal return applications, the power exhaust must be relocated from the factory-installed position or field installed as an accessory to the horizontal return duct. The power exhaust power and

Options and accessories (cont)



wiring are tied back to the main unit, when field installing or relocating the power exhaust to the duct system.

The modulating power exhaust is recommended for applications with economizer that require space pressure control.

High Capacity Power Exhaust (HCPE)

When the factory-installed non-modulating or modulating power exhaust can't meet the airflow or static requirements for the project, the high capacity power exhaust accessory is available. The HCPE can be powered from the main unit power feed (single point) and includes a VFD driven power exhaust assembly that be controlled by *ComfortLink* based on economizer position or building pressure control for fully modulating operation. A field-installed modulating power exhaust conversion kit may be required for building pressure control. The HCPE is ordered as individual modules and up to two (20-50 ton) or three (60 ton) modules can be used at once.

For vertical applications, the HCPE can be installed in the exhaust/relief section of the unit. For horizontal return applications, the HCPE must be installed in the return duct.

Compressor sound blankets

Are available as a field-installed accessory or as part of the Greenspeed package as field installed. The sound blanket reduces the radiated sound from the compressor.

Double wall construction

The 0.5-in., R-4 fiberglass insulation on the top and side panels of the air handling section are covered by a galvanized liner to provide a fiber-free operation and wipe down capability.

The following additional items are available as accessories for select 48/50A models:

- Hail guard

- Propane heat conversion kit (48 series)
- Filter kits
- Roof curbs
- Space temperature, CO₂, or humidity sensors
- Navigator interface
- Modbus translator
- LonWorks translator
- Carrier ZS communicating sensors (units with BACnet communication option)
- i-Vu Equipment Touch (units with BACnet communication option)

The following options may be available as a special order:

- Horizontal return/vertical supply
- Double wall construction with Agion¹ coating
- Double wall bottom (for installations other than curbs)
- SCR electric heat
- Access door retainer
- UVC light fixtures
- TEFC supply fan motor
- Hot water coil
- Shaft grounding rings
- Condensate overflow switch
- Refrigerant relief valves
- Cu/Cu evaporator coil
- 65kA high short circuit current rating (SCCR)
- Configure for MicroMetl field-installed ERV
- Marine lights
- Dual point power
- Fused disconnect


1. Agion is a trademark of Sciessent.

Base unit dimensions 48/50A2,A3,A6,A7020-035



NOTES:

1. FOR MULTIPLE UNIT APPLICATIONS SEE LITERATURE.
2. UNIT CLEARANCES:
 - TOP OF UNITS: NO OVERHANG
 - CONDENSER COIL: 4' 0" [1121.9]
 - ECONOMIZER SIDE: 6' 0" [1822.9]
 - HEAT SIDE: 1' 0" [219]
 - FILTER ACCESS SIDE: 10'-0" [3048] (FOR REMOVAL OF EVAPORATOR COIL)
3. BOTTOM DUCTS DESIGNED TO BE ATTACHED TO ACCESSORY ROOF CURB. IF UNIT IS MOUNTED ON DUNNAGE, IT IS RECOMMENDED THE DUCTS MUST BE SUPPORTED BY CROSS BRACES AS DONE ON ACCESSORY ROOF CURB.
4. FOR UNIT WEIGHTS, REFER UNIT SUBMITTAL DATA, ELECTRONIC SECTION PROGRAM (OR) PD.

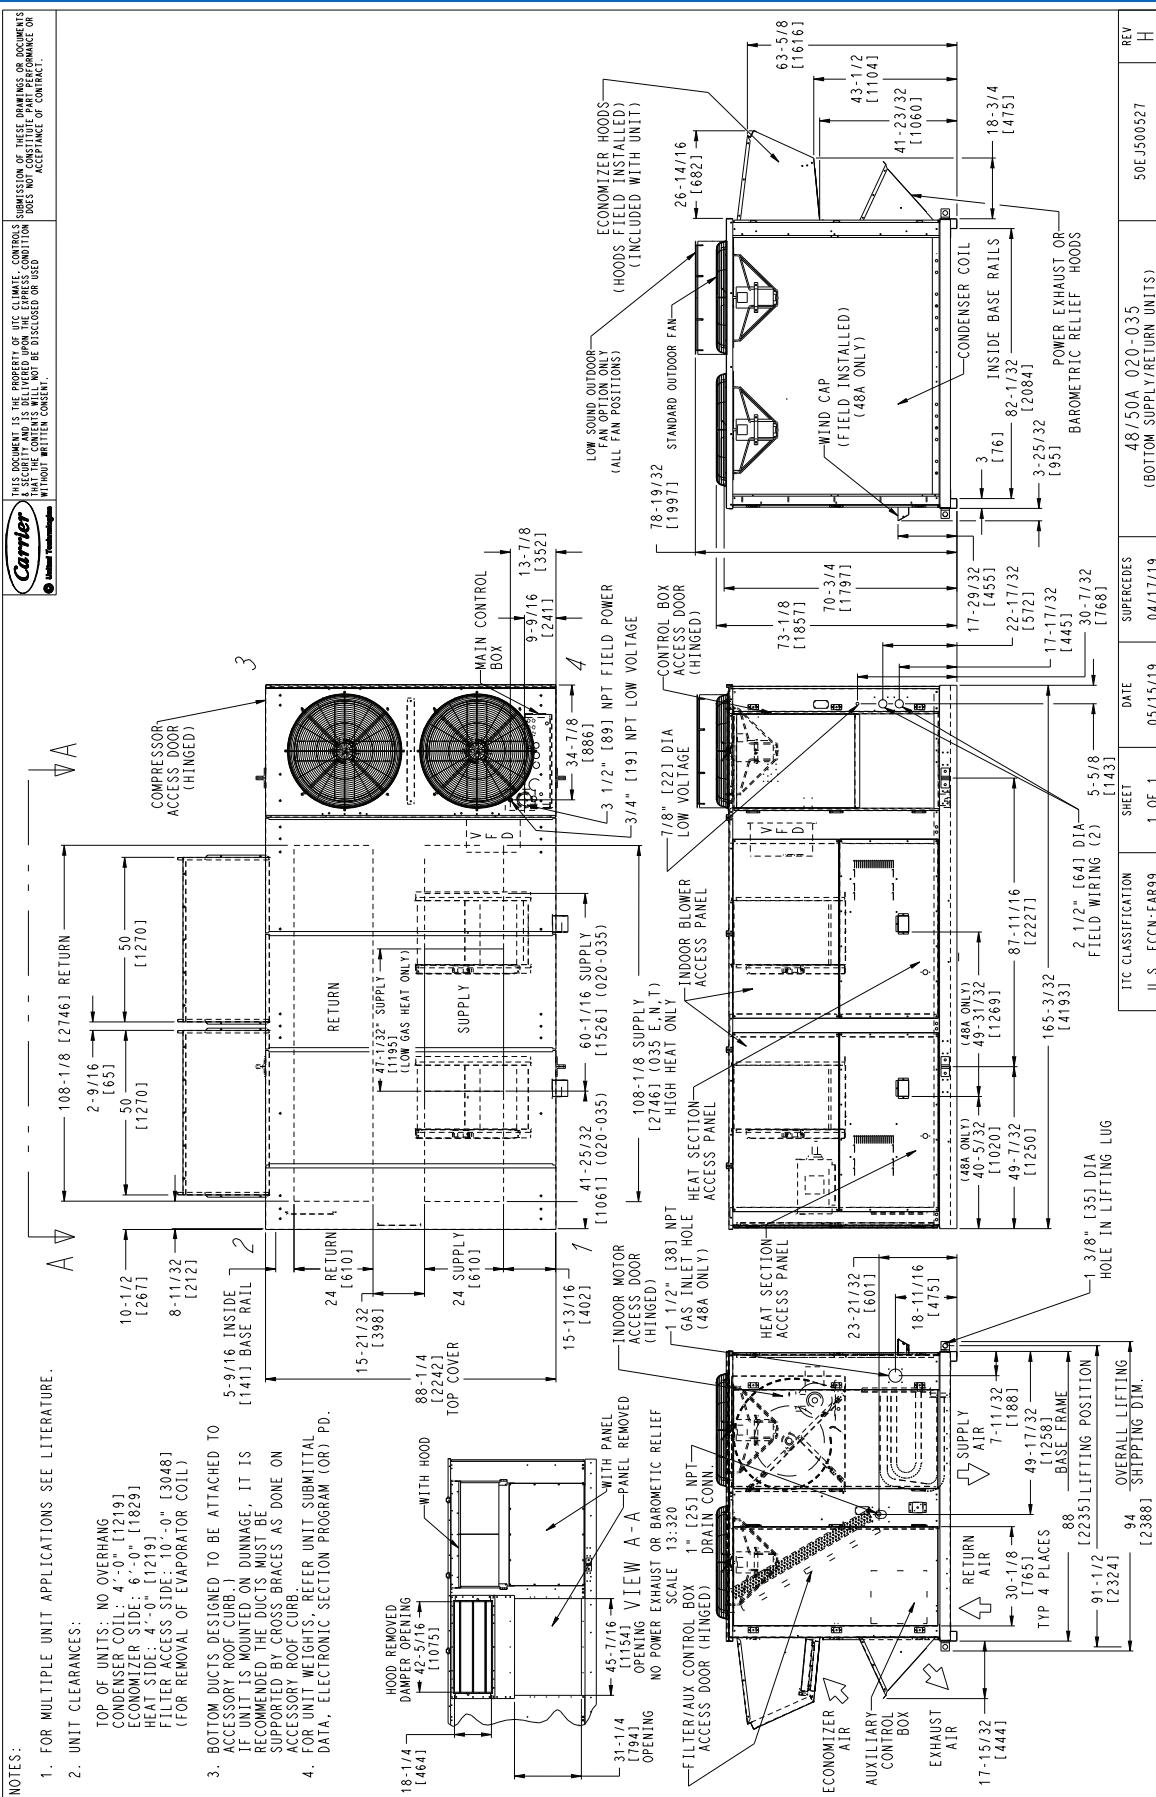

REV H

J

K

L

M

N

O

P

Q

R

S

T

U

V


W

X

Y

Z


Base unit dimensions 48/50A2,A3,A6,A7040,050

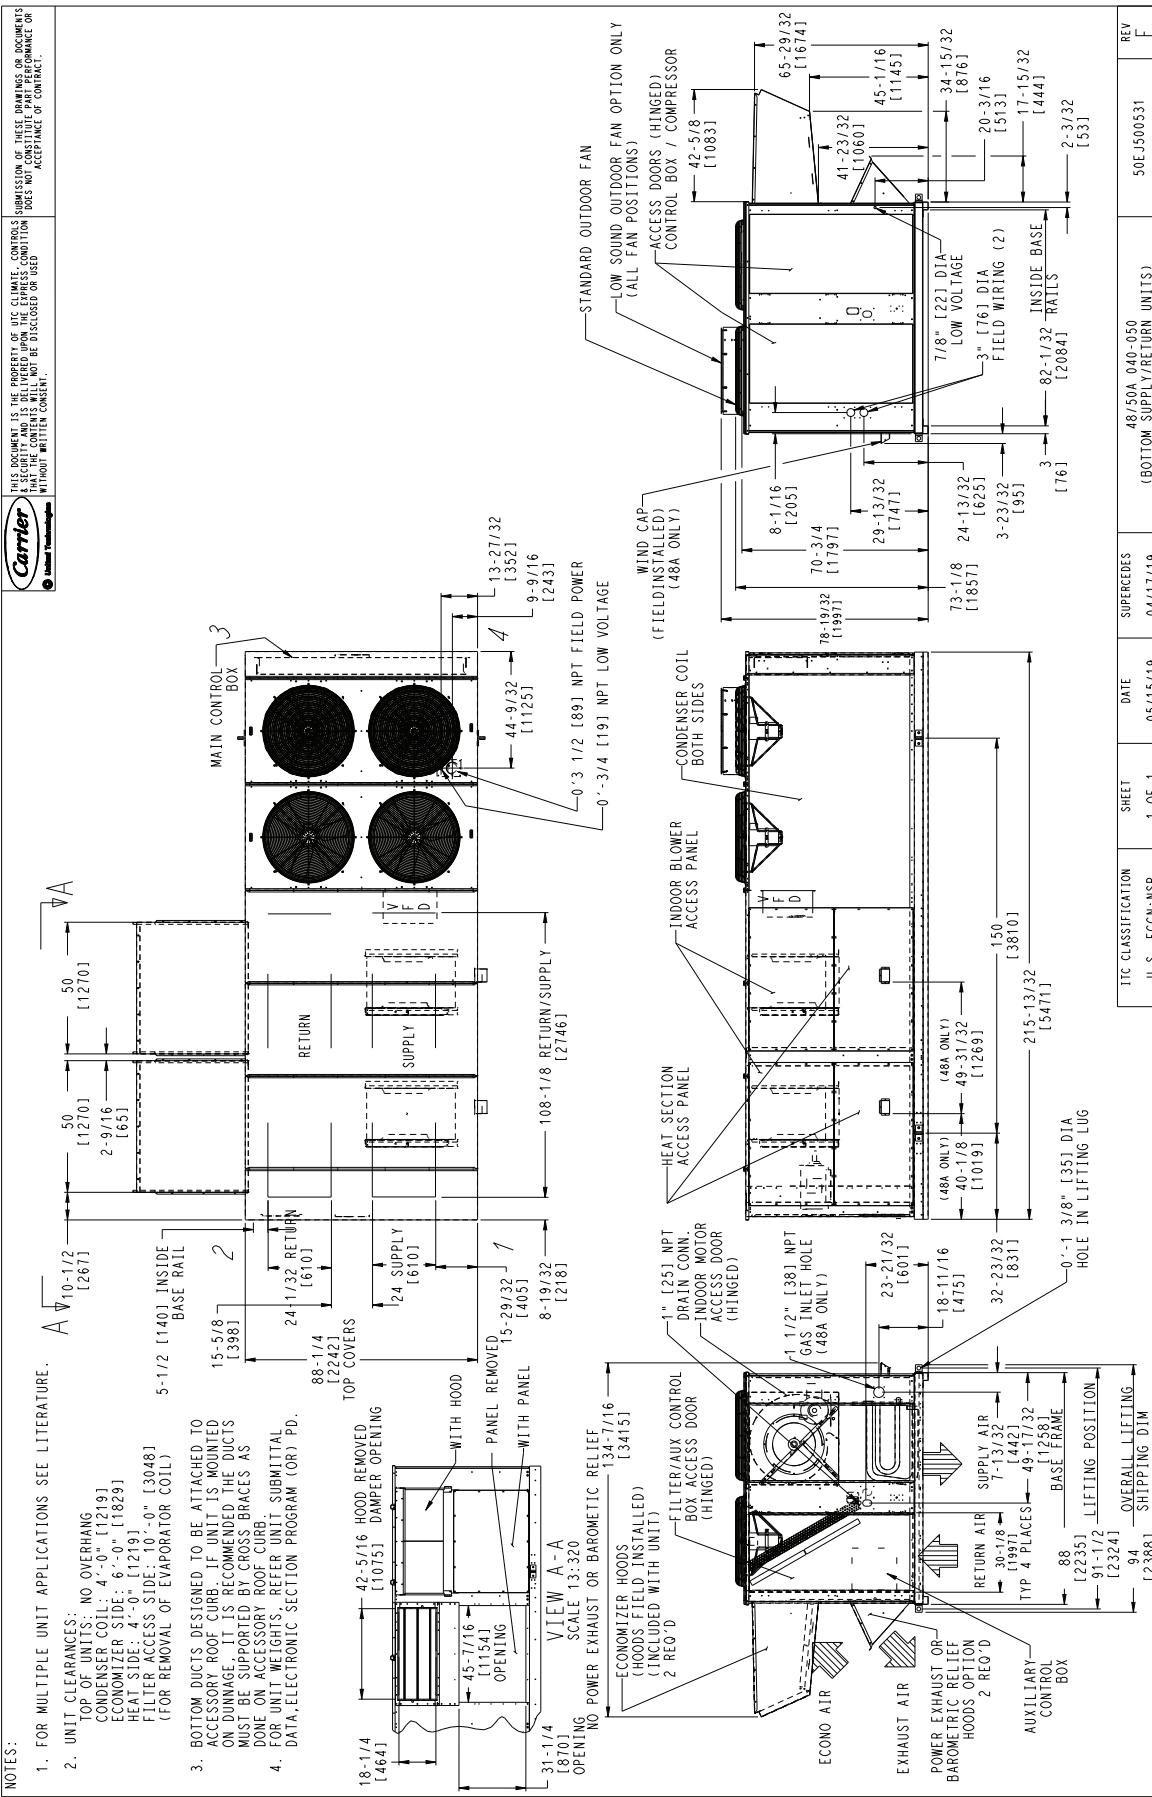

Base unit dimensions 48/50A2,A3,A6,A7060 MCHX

Carrier


This document is furnished for the purpose of furnishing information on the dimensions of the equipment. Substitution of these drawings or any part thereof, or the express or implied incorporation of any other documents, without the written consent of Carrier Corporation will not be deemed or used without Carrier's written consent.

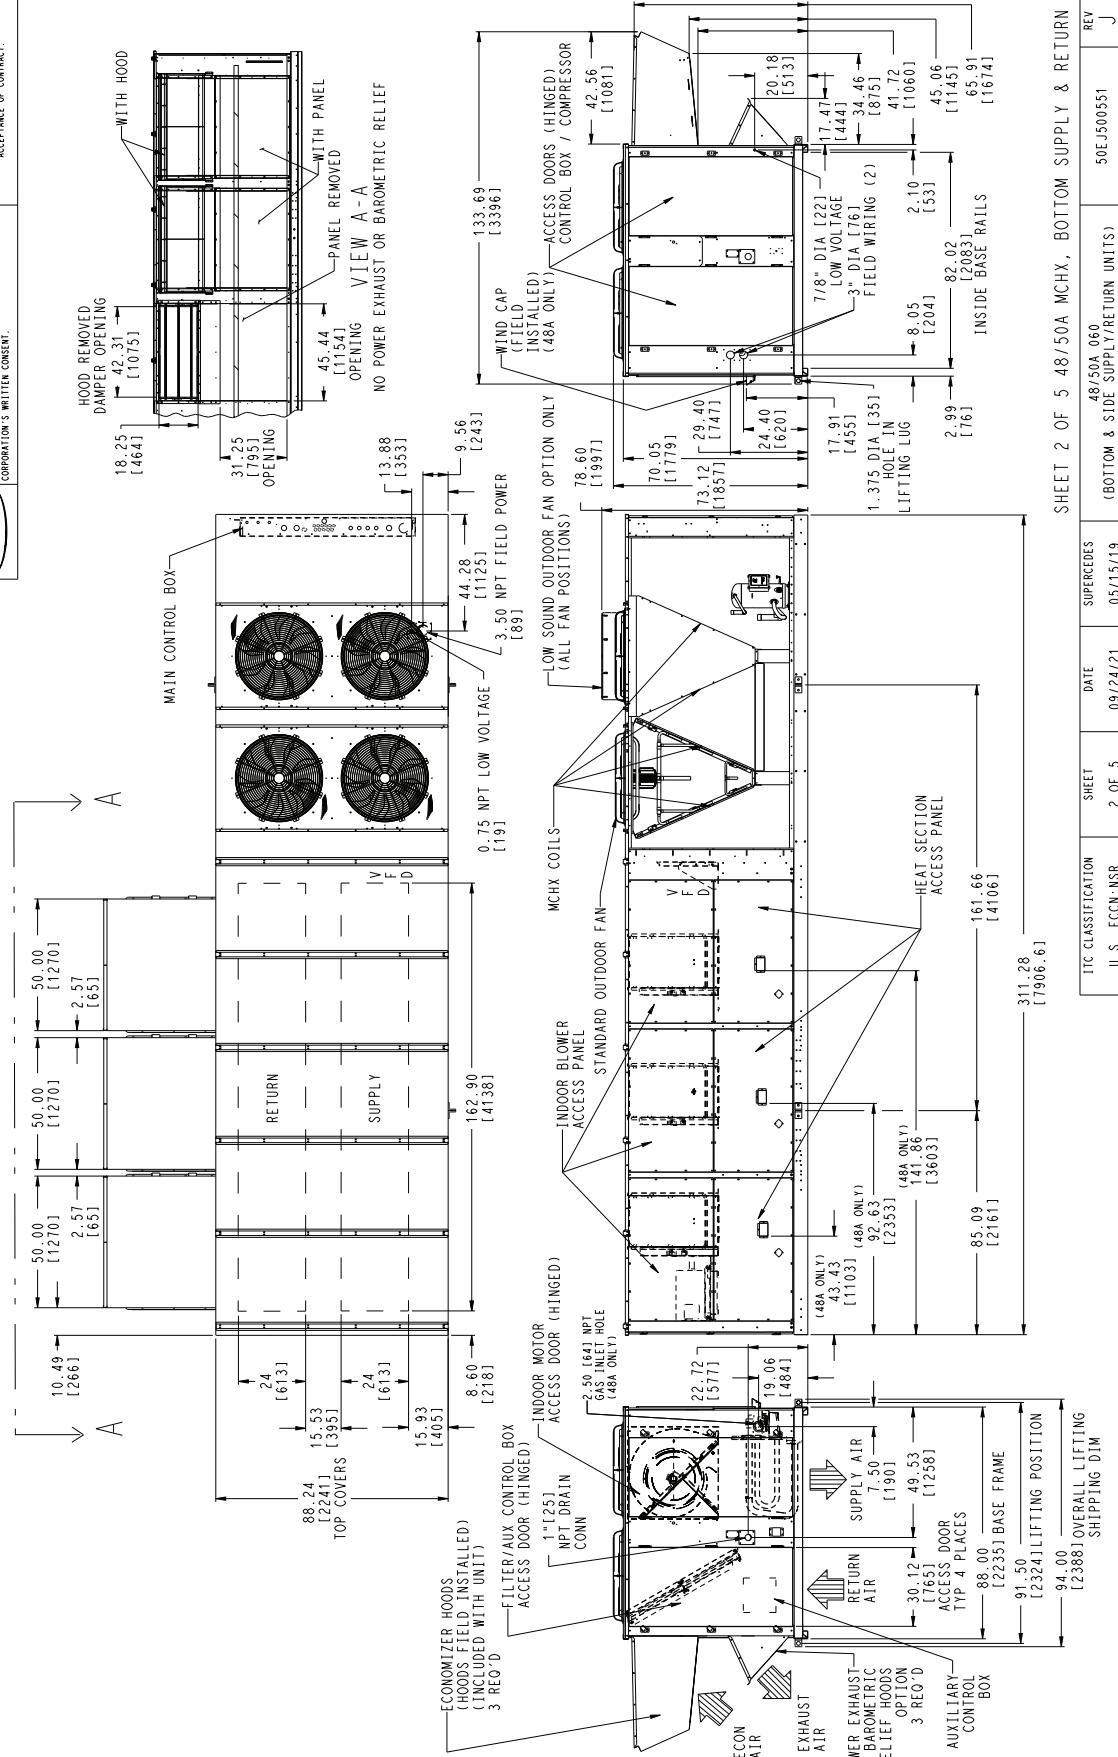


Base unit dimensions 48/50A2,A3,A6,A7060 RTPF



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT. CARRIER CORPORATION'S WRITTEN CONSENT IS REQUIRED.

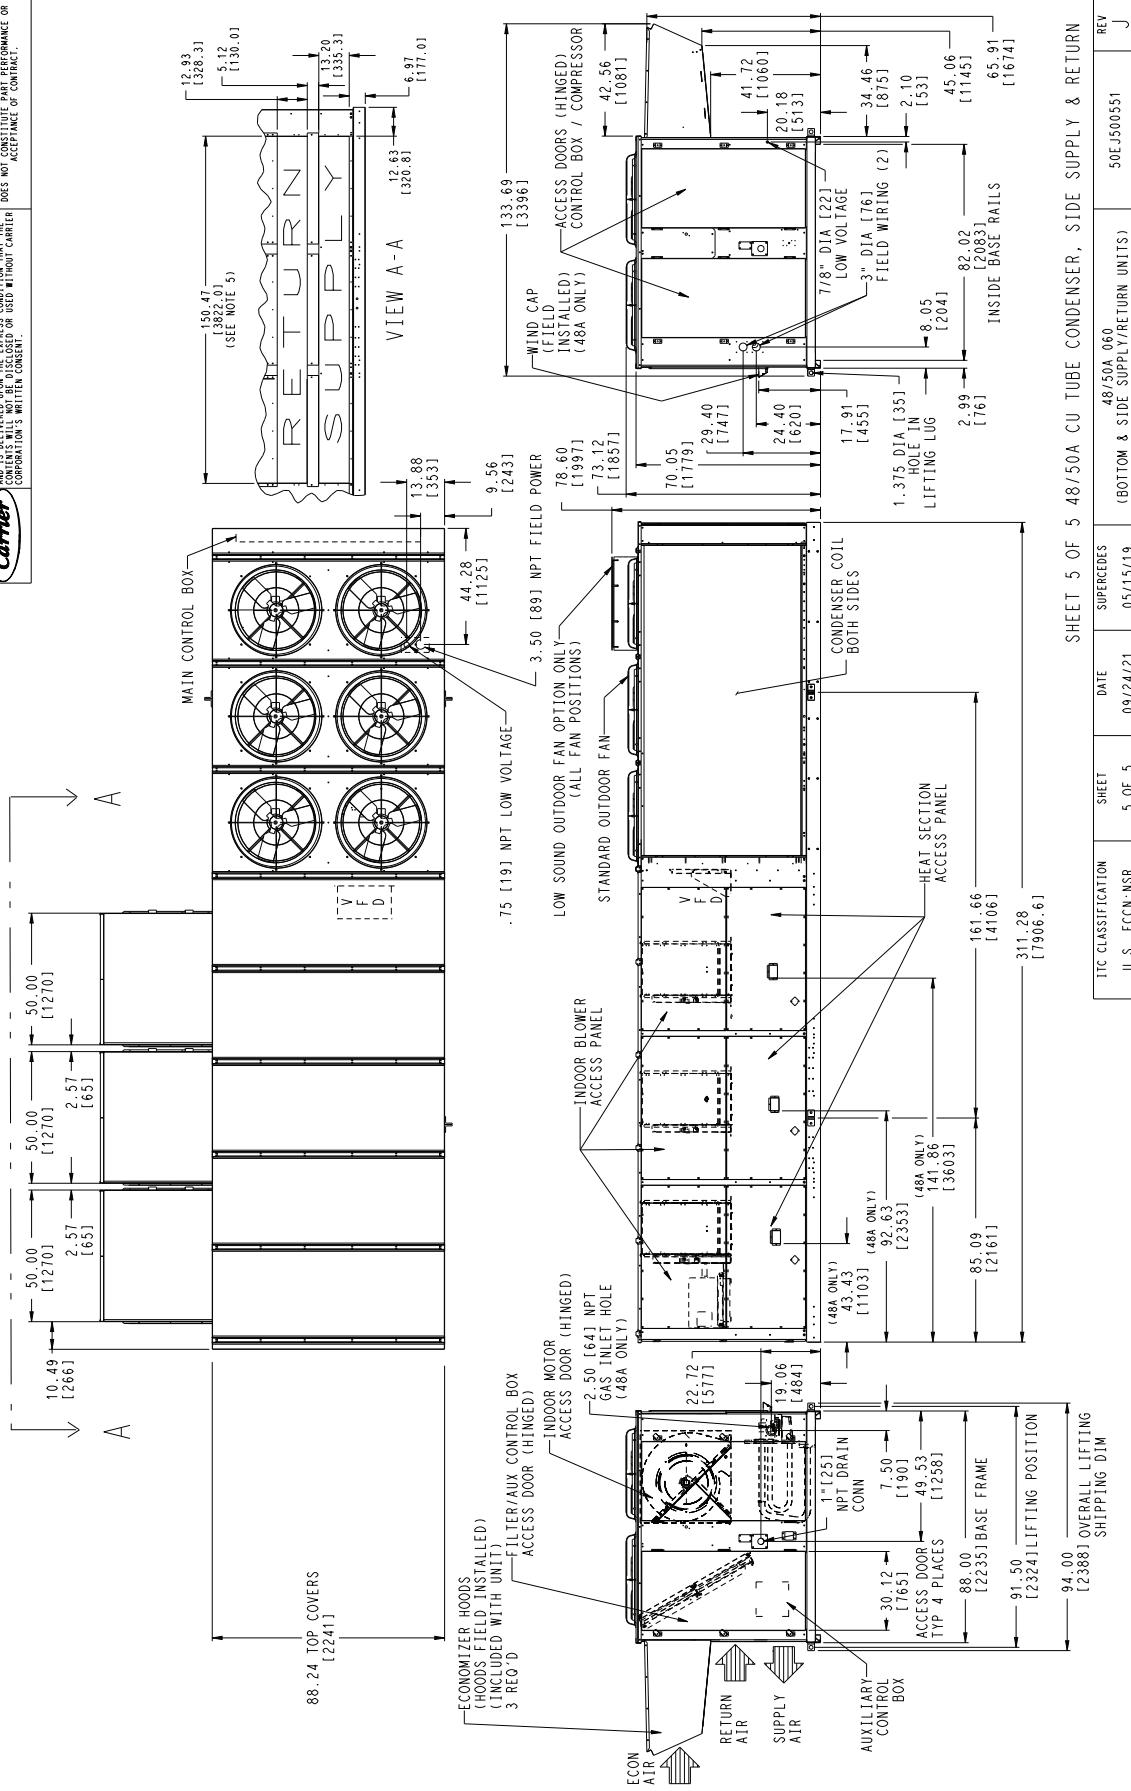

Base unit dimensions 48/50A4,A5,A8,A9020-035

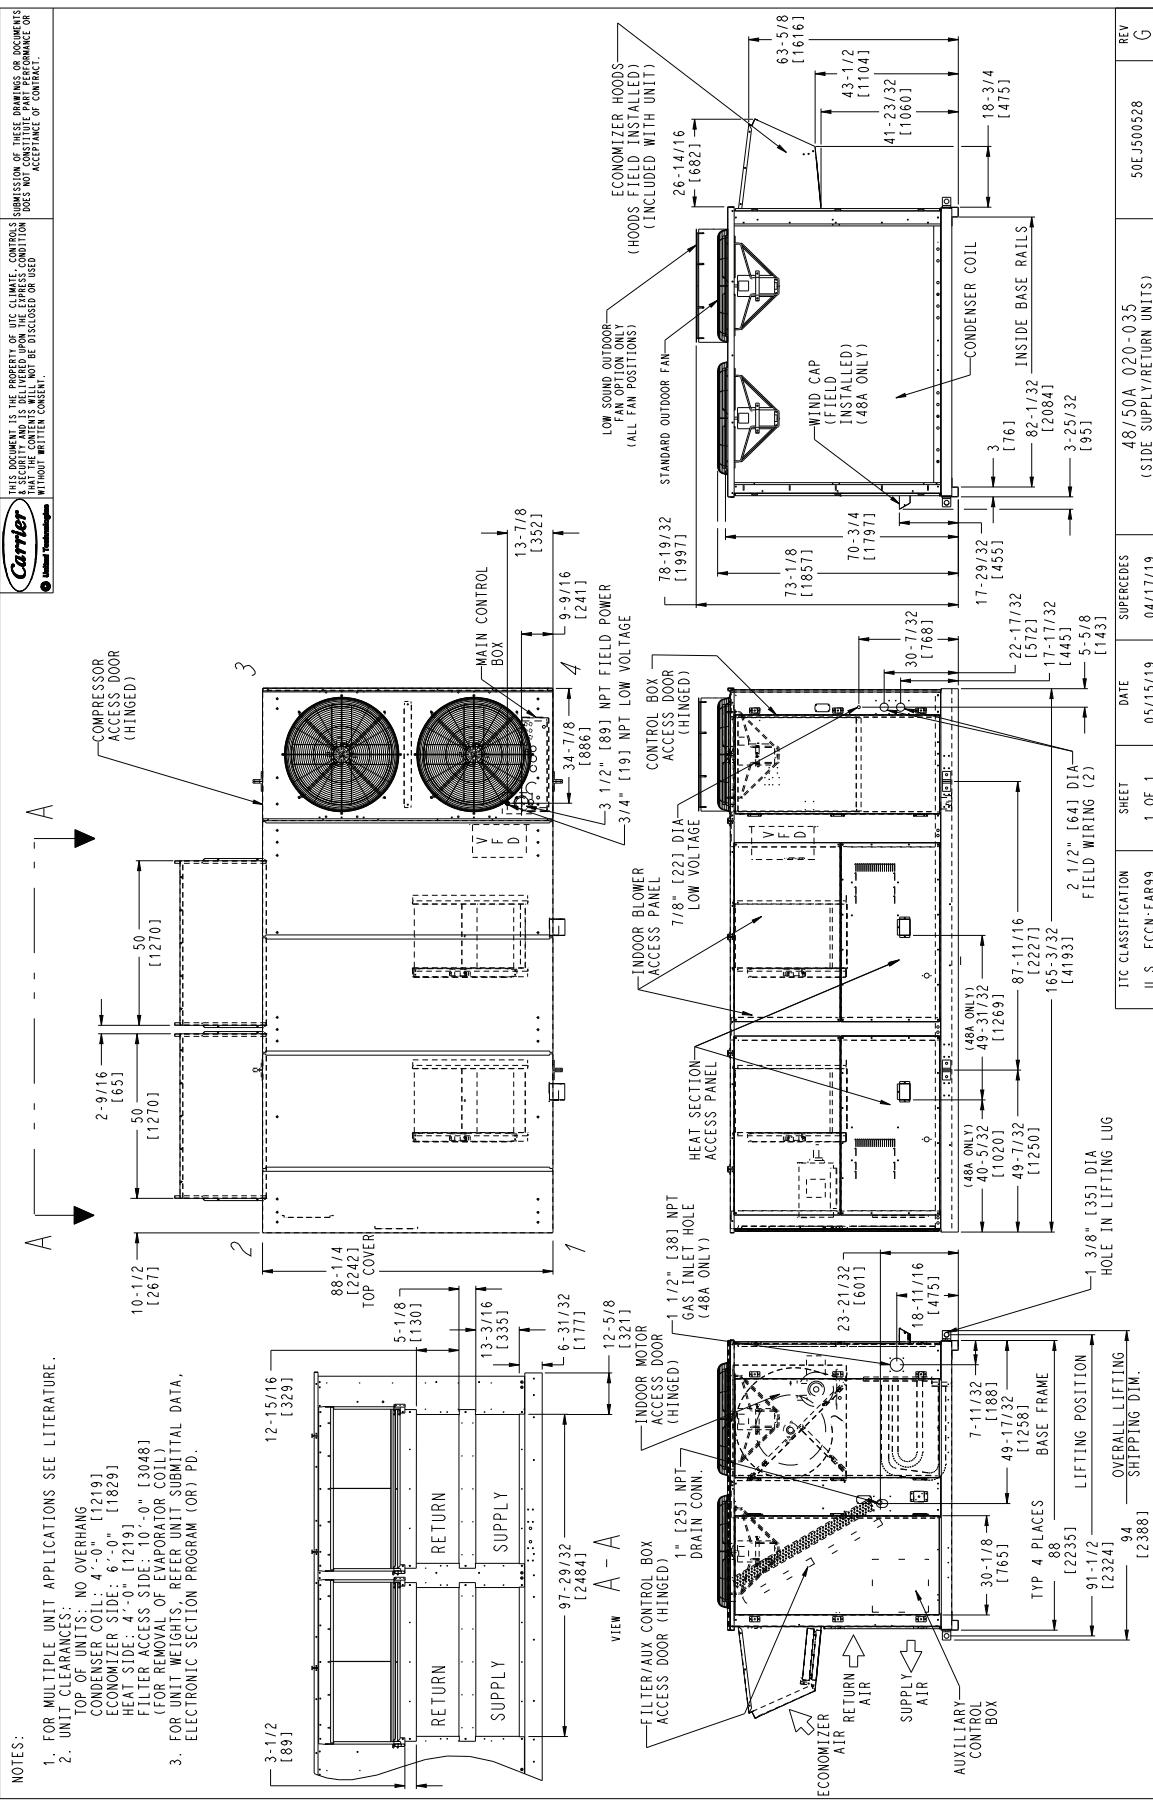

Base unit dimensions 48/50A4,A5,A8,A9040,050



NOTES:

1. FOR MULTIPLE UNIT APPLICATIONS SEE LITERATURE.

2. UNIT CLEARANCES:

- TOP OF UNITS: NO OVERHANG
- CONDENSER COIL: 4'-0" [1219]
- ECONOMIZER SIDE: 6'-0" [1829]
- HEAT SIDE: 4'-0" [1121]
- FILTER ACCESS SIDE: 4'-0" [1120] (FOR REMOVAL OF EVAPORATOR COIL)


3. FOR UNIT WEIGHTS, REFER UNIT SUBMITTAL DATA, ELECTRONIC SECTION PROGRAM (OR) PD.

THIS DOCUMENT IS THE PROPERTY OF U.S. CLIMATE CONTROLS. DOWNGRADING OR DIMINISHING OF THESE DRAWINGS OR DOCUMENTS IN WHOLE OR IN PART, BY WHOMEVER IT MAY BE HELD, IS AN VIOLATION OF THE EXPRESS CONDITION THAT USES NOT BE DISCLOSED OR USED WITHOUT WRITTEN CONSENT.



TOP OF UNITS: NO OVERHANG
 ECONOMIZER SIDE: 6'-0" [1829]
 HEAT SIDE: 4'-0" [1121]
 FILTER ACCESS SIDE: 4'-0" [1120] (FOR REMOVAL OF EVAPORATOR COIL)

3. FOR UNIT WEIGHTS, REFER UNIT SUBMITTAL DATA, ELECTRONIC SECTION PROGRAM (OR) PD.

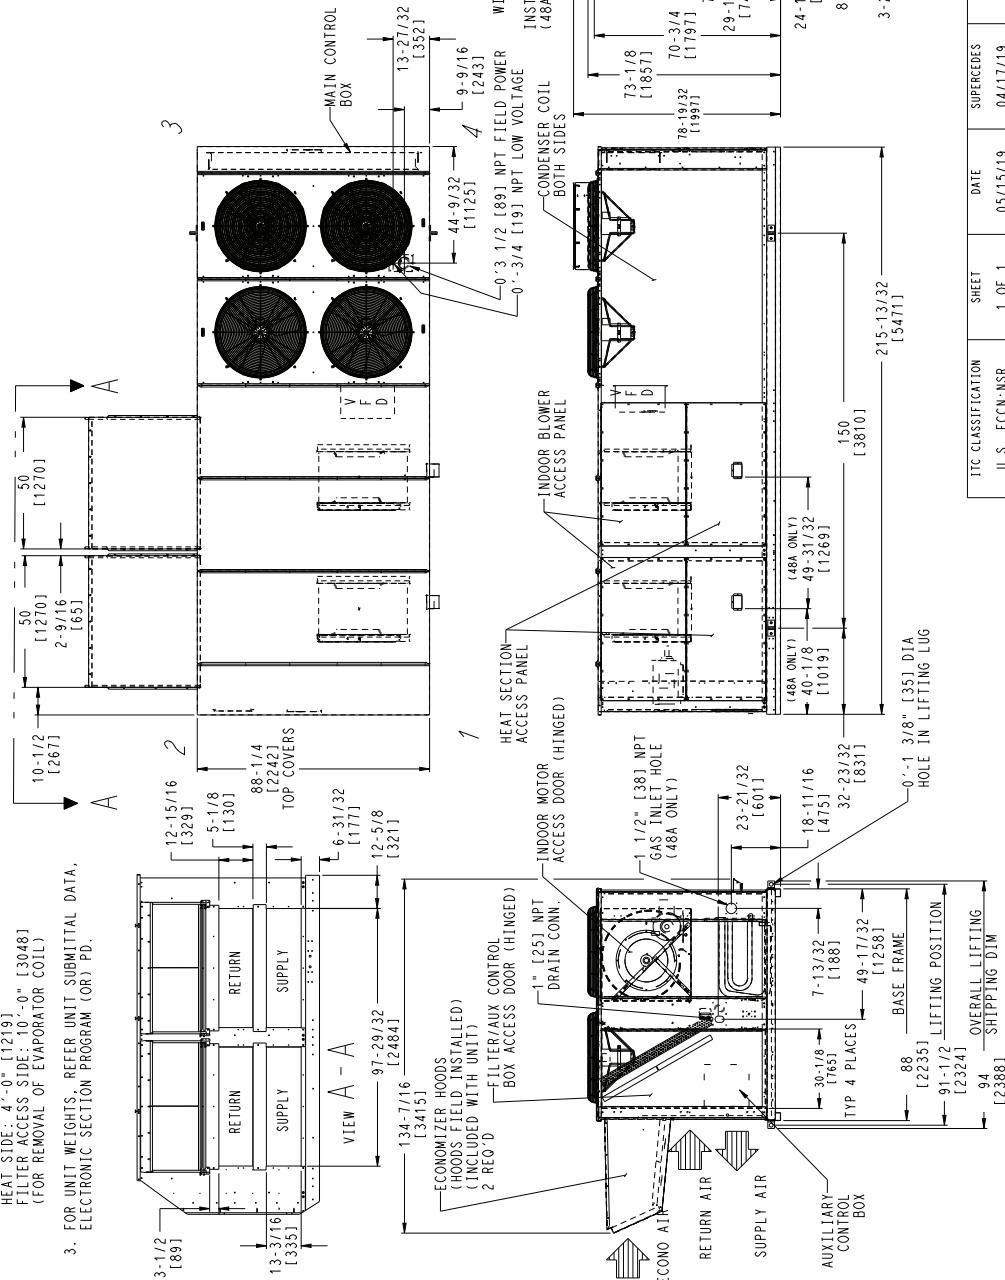


ITC CLASSIFICATION	SHEET	DATE	SUPERSEDES	REV
U.S. ECCN NSR	1 OF 1	05/15/19	04/11/19	[F]

48/50A4 040-050 (SIDE SUPPLY/RETURN UNITS)	50EJ500548	REV
--	------------	-----

Base unit dimensions 48/50A4,A5,A8,A9060 MCHX



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS TO ANYONE OTHER THAN THE ADDRESSEE WILL BE DEemed A BREACH OF CONTRACT AND CARRIER'S CONFIDENTIAL INFORMATION WILL BE DISCLOSED OR USED WITHOUT CARRIER'S WRITTEN CONSENT.

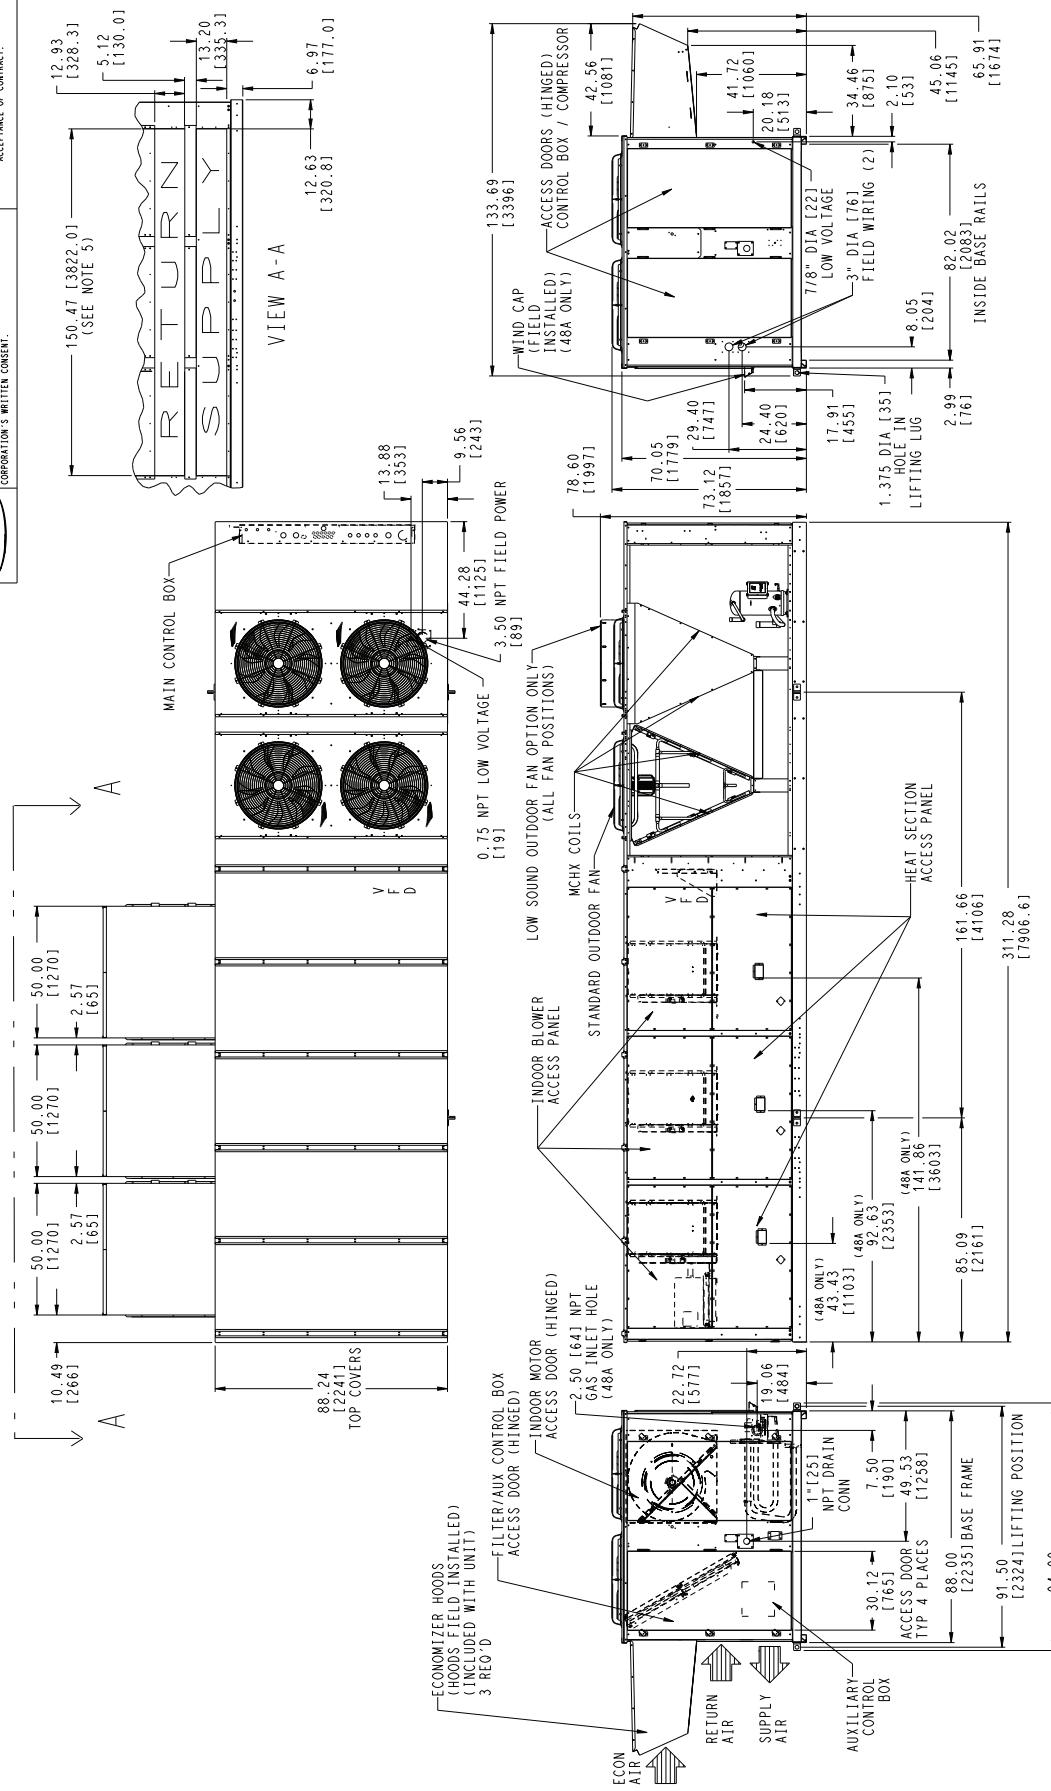


SHEET 3 OF 5 48/50A MCHX, SIDE SUPPLY & RETURN

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	REV
U.S. ECCN: NSR	3 OF 5	09/24/21	05/15/19	J

Base unit dimensions 48/50A4,A5,A8,A9060 RTPF



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS FOR GOVERNMENT CONTRACTING PURPOSES SHALL NOT BE CONSTRUED AS GRANTING TO THE GOVERNMENT ANY RIGHTS IN AND TO THESE DRAWINGS OR DOCUMENTS EXCEPT UNDER THE TERMS OF THE CONTRACT.

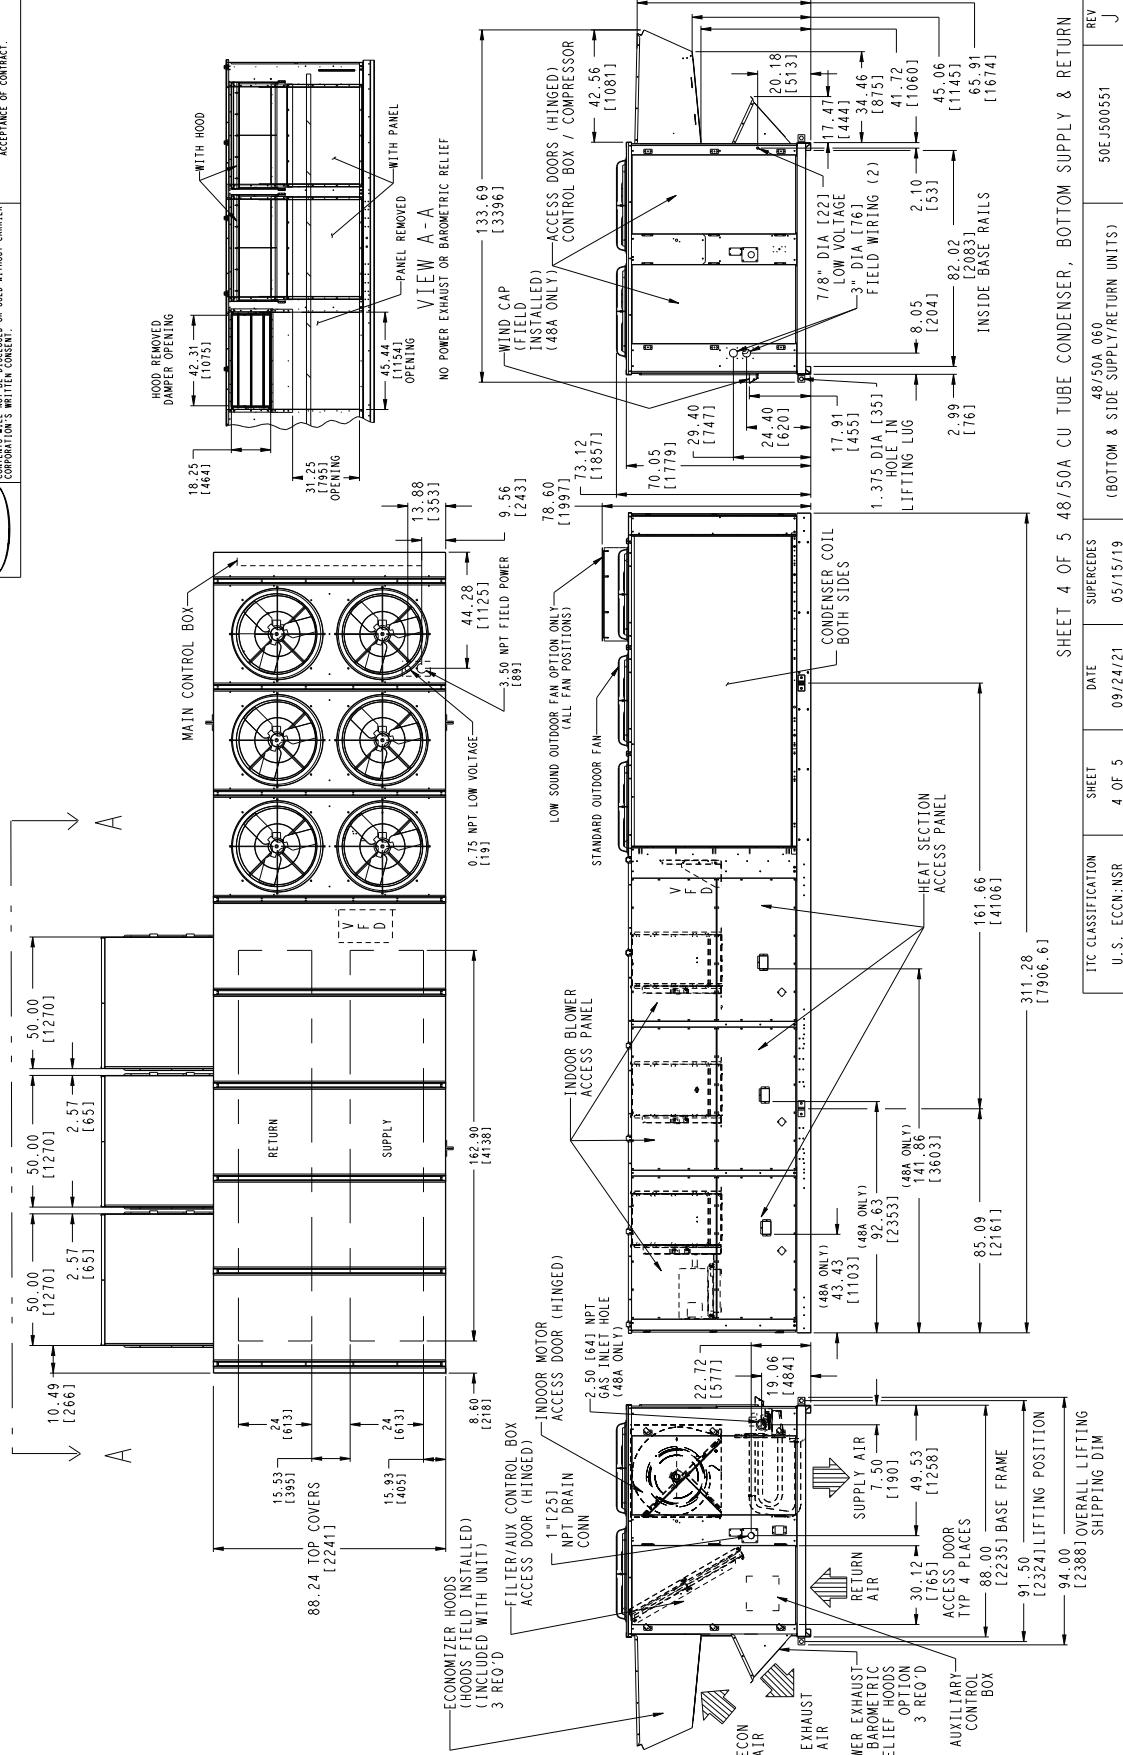

SHEET 4 OF 5 48/50A CU TUBE CONDENSER, BOTTOM SUPPLY & RETURN
ITC CLASSIFICATION
U.S. ECCN: NSR
SHEET 4 OF 5
DATE 09/24/21
SUPERSEDES 05/15/19
(BOTTOM & SIDE SUPPLY/RETURN UNITS)
50J500551 REV J


Accessory dimensions

Carrier

ROOF CURB SIZES 020-035

NOTES:

1. Unless otherwise specified, all dimensions are to outside of part.
2. Roof curb accessory CRRFCURB05A00 is shipped disassembled.
3. All roof curb parts are to be 14 ga. galvanized steel.
4. Units with electric heat must be installed with a 90° elbow on the supply duct prior to any supply take-offs or branches.
5. Dimensions in [] are in millimeters. All other dimensions are in inches.

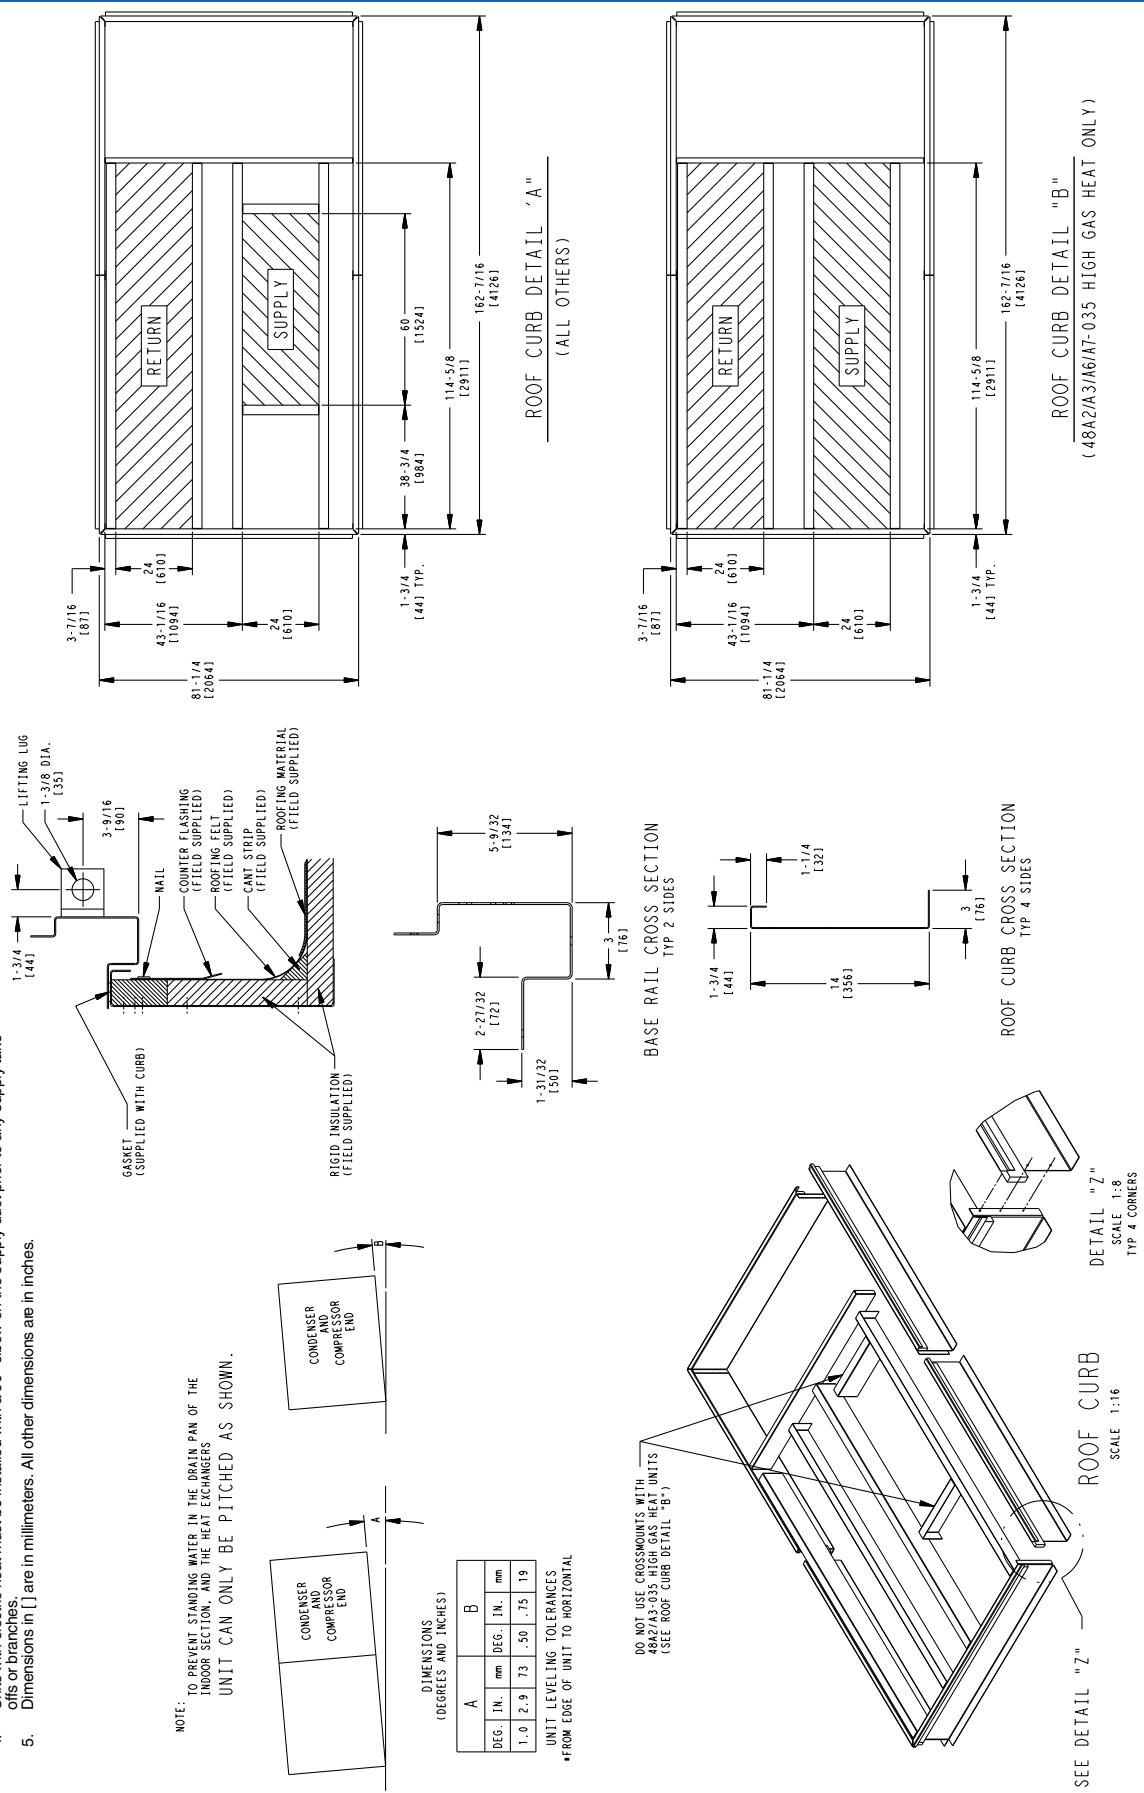


Accessory dimensions (cont)



ROOF CURB SIZES 040 AND 050

- NOTES:
1. Unless otherwise specified, all dimensions are to outside of part.
 2. Root curb accessory CRRFCURB06A00 is shipped disassembled.
 3. All root curb parts are to be 14 ga. galvanized steel.
 4. Units with electric heat must be installed with a 90° elbow on the supply duct prior to any supply take offs or branches.
 5. Dimensions in [] are in millimeters. All other dimensions are in inches.

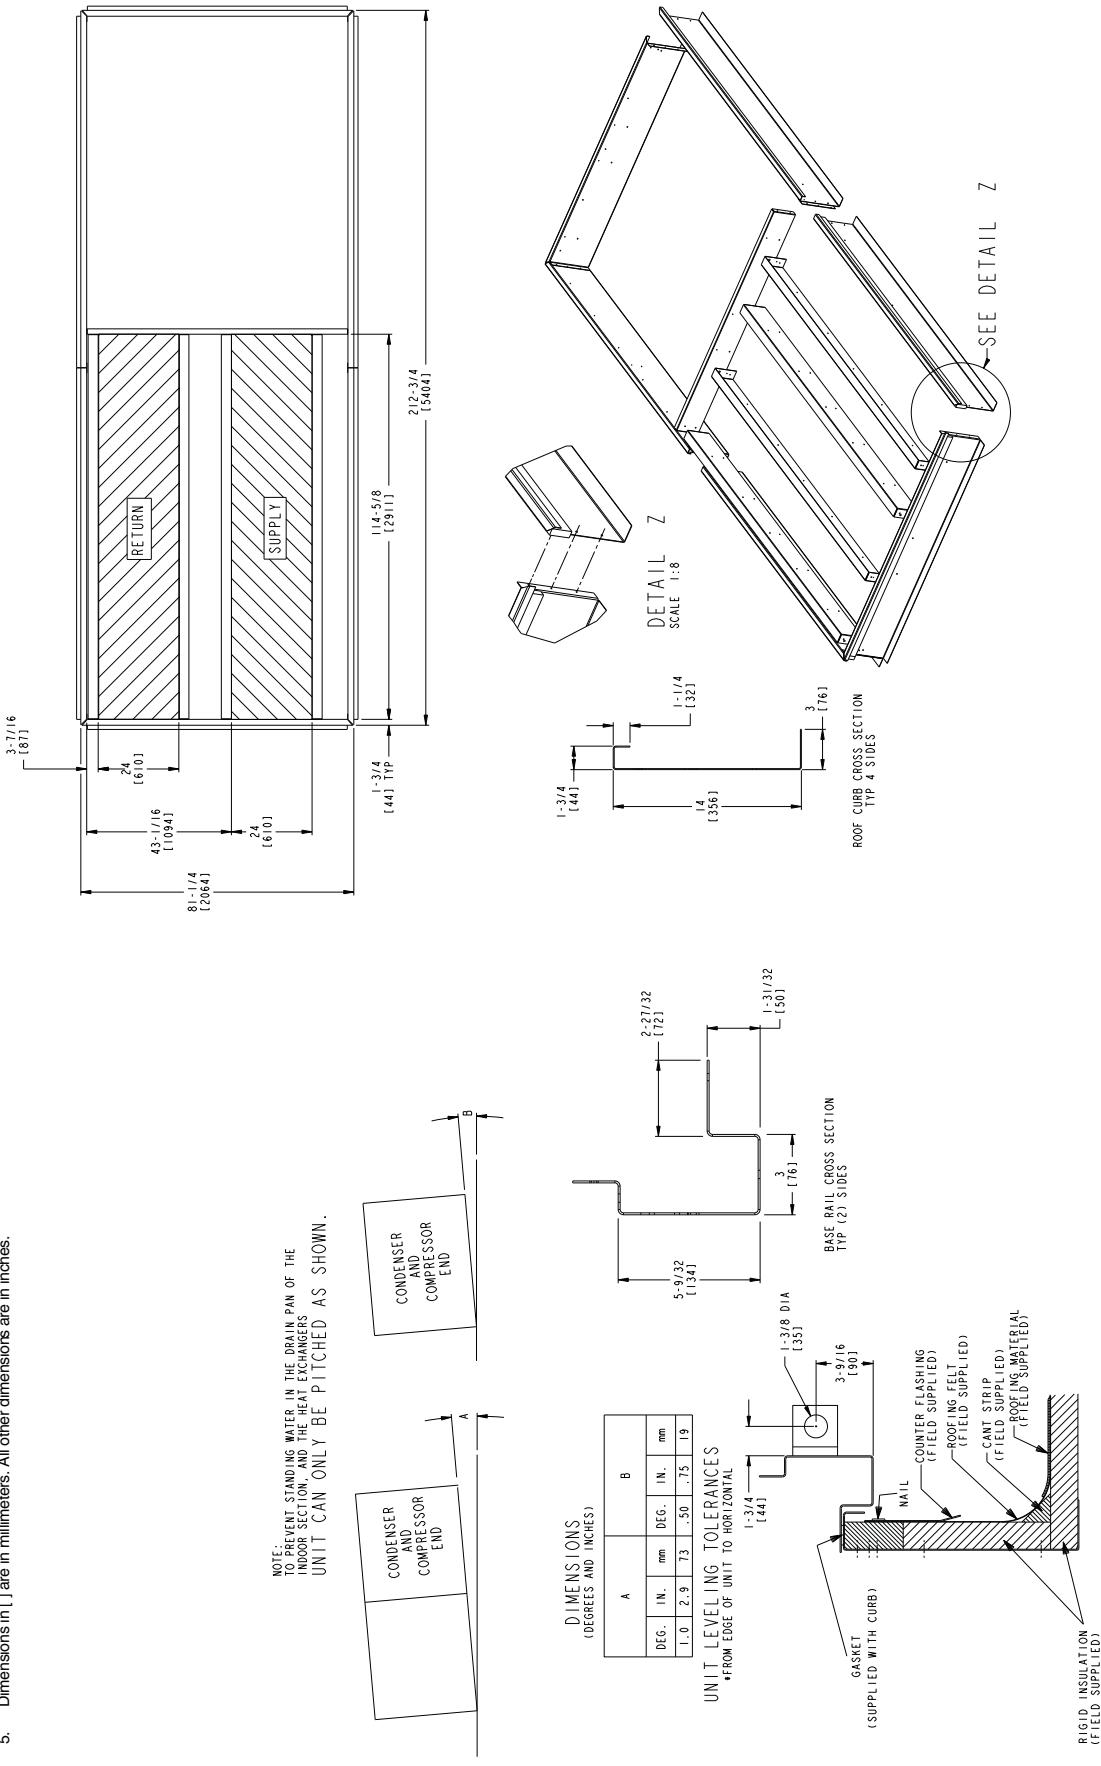


Accessory dimensions (cont)



ROOF CURB 48A2,A3,A6,A7060, 50A2,A3,A6,A7060 WITHOUT ELECTRIC HEAT/UNIT SUPPORT 48/50A4,A5,A8,A9060

NOTES:

1. Unless otherwise specified, all dimensions are to outside of part.
2. Roof curb accessory CRRFCURB014A00 is shipped disassembled.
3. All roof curb parts are to be 14 ga. galvanized steel.
4. Dimensions in [] are in millimeters. All other dimensions are in inches.

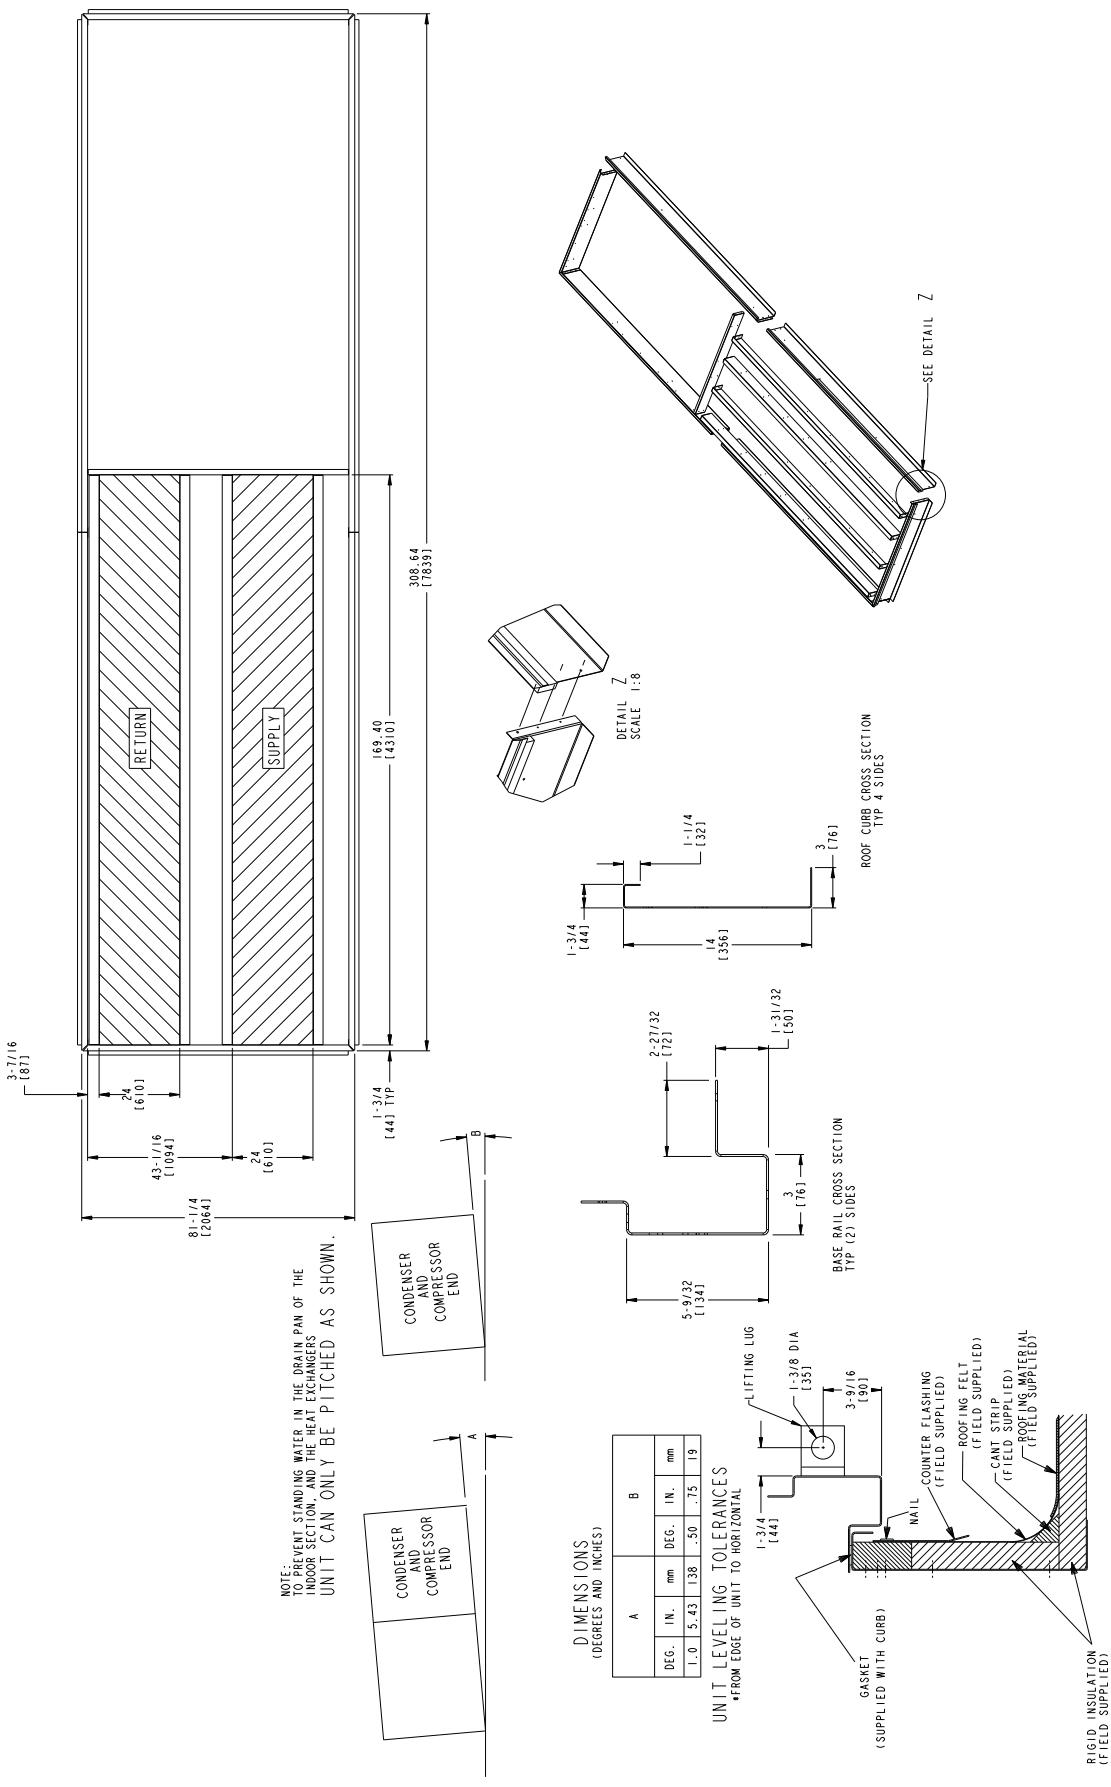


Accessory dimensions (cont)



ROOF CURB 50A2,A3,A6,A7060 WITH ELECTRIC HEAT


- NOTES:
- Unless otherwise specified, all dimensions are to outside of part.
 - Roof curb accessory CRRFCURB009A00 is shipped disassembled.
 - All roof curb parts are to be 14 ga. galvanized steel.
 - Units with electric heat must be installed with a 90° elbow on the supply duct prior to any supply take offs or branches.
 - Dimensions in [] are in millimeters. All other dimensions are in inches.

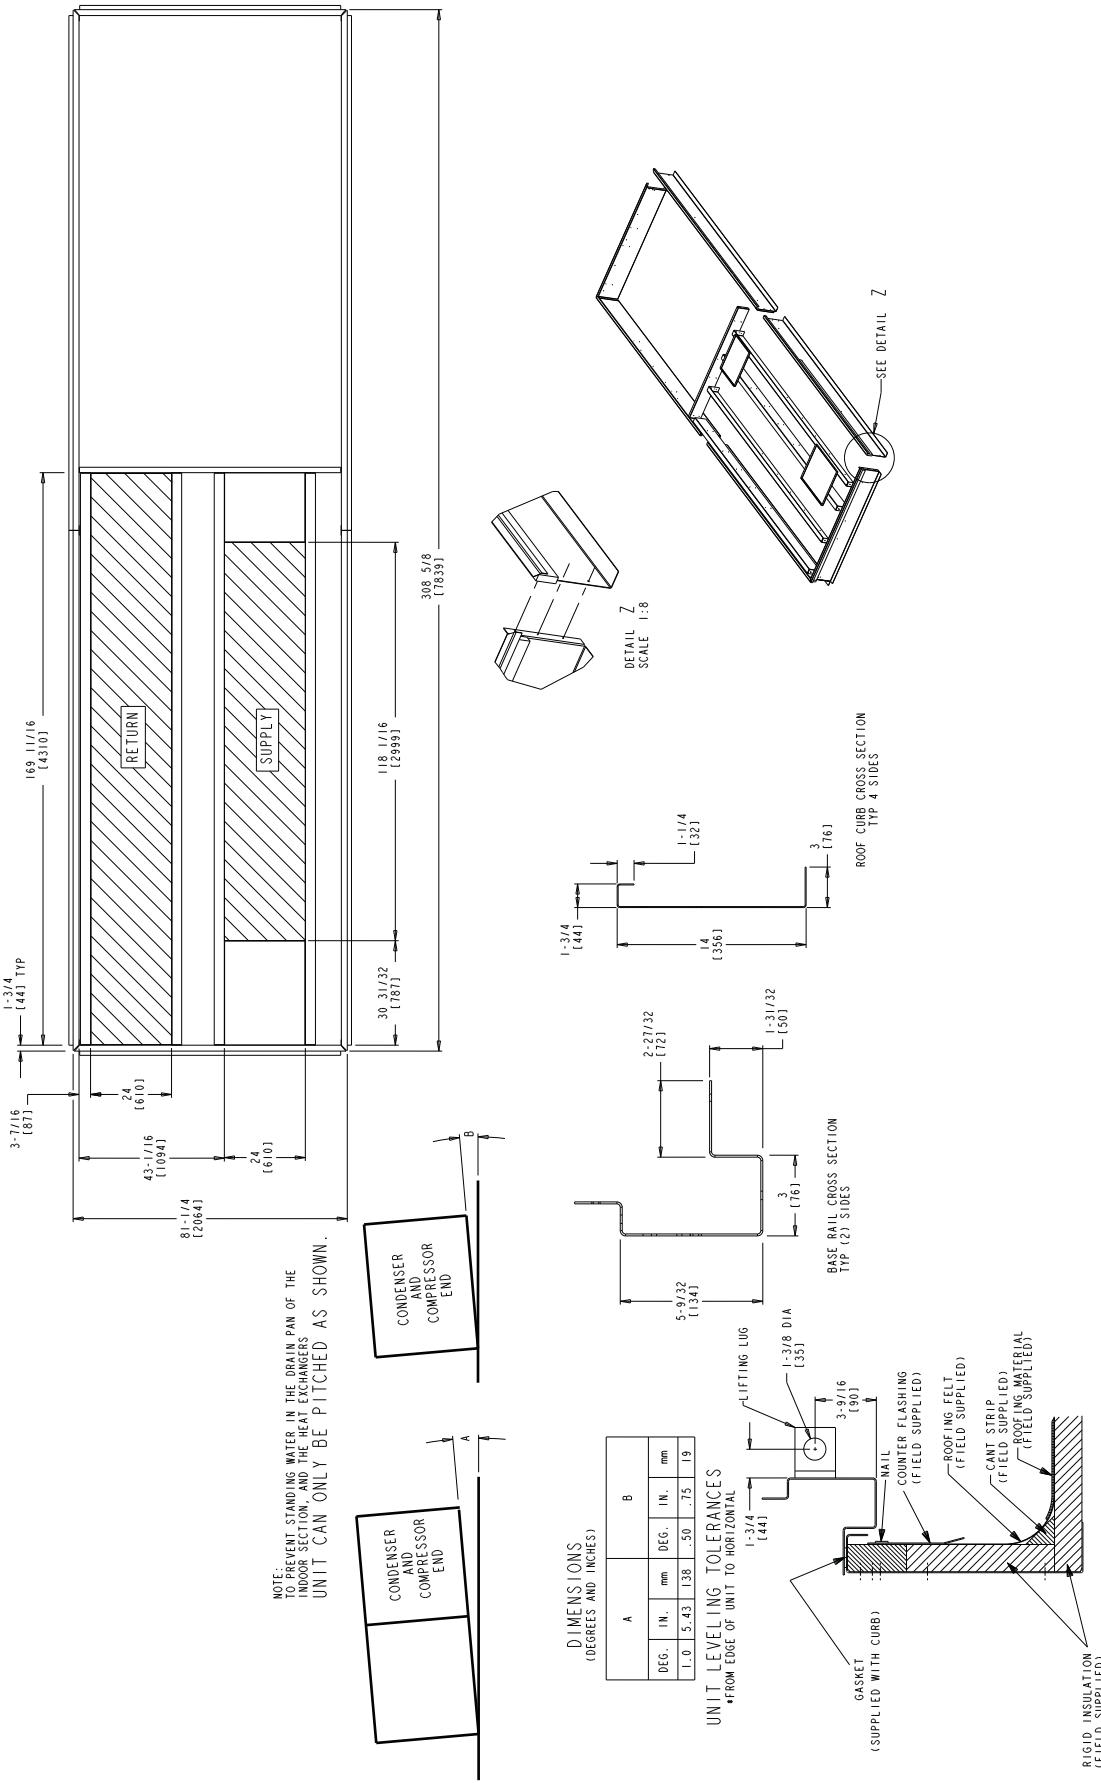


Accessory dimensions (cont)



STANDARD AND MODULATING POWER EXHAUST AND BAROMETRIC RELIEF

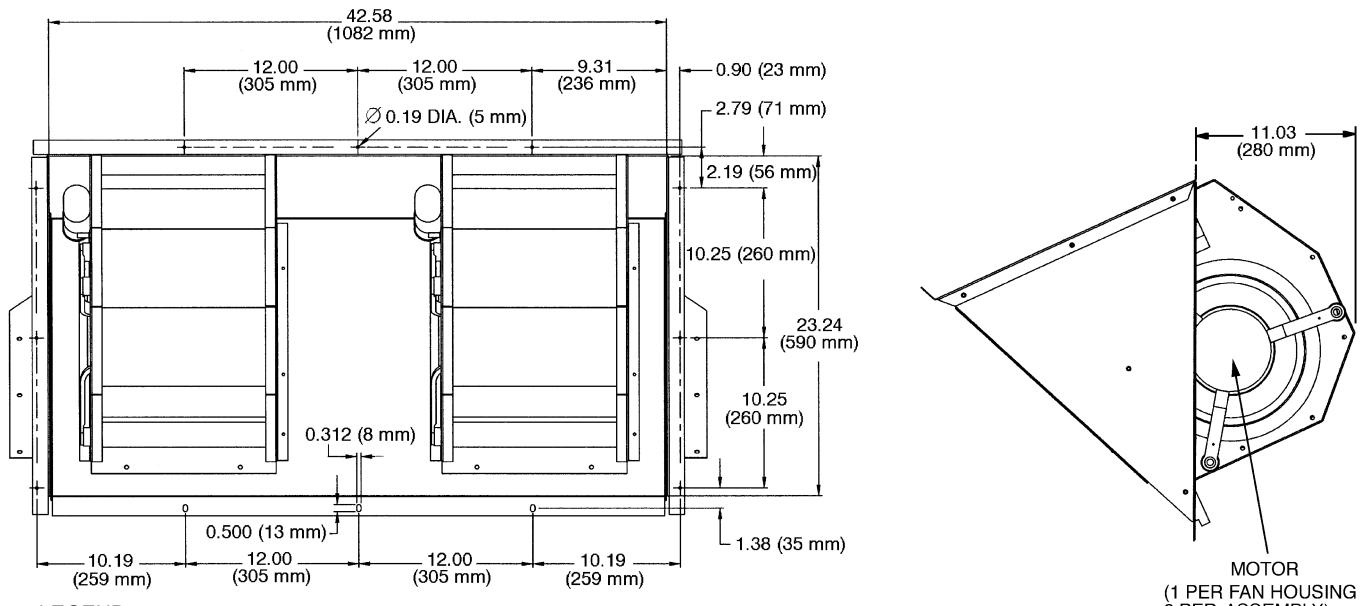

HIGH CAPACITY POWER EXHAUST ACCESSORY

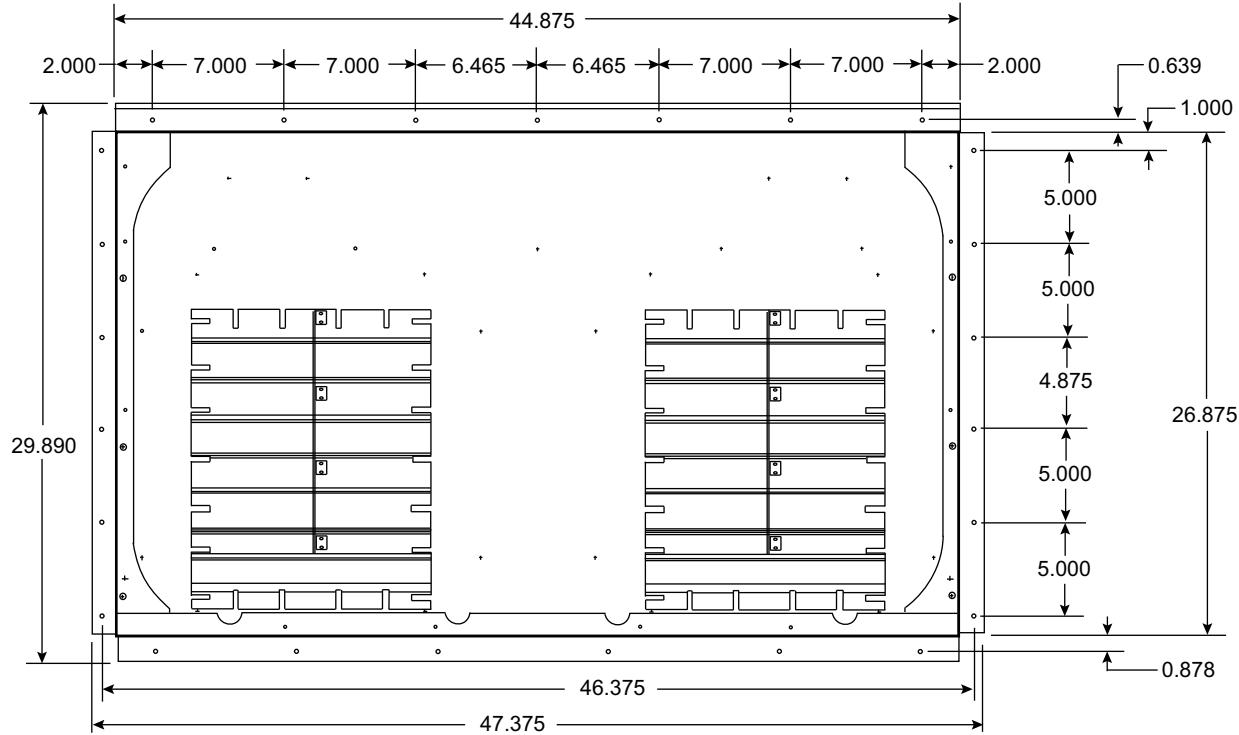

NOTE: Dimensions are in inches.

Selection procedure (with example)



I Determine cooling and heat requirements at design conditions.

Given:

Type Application VAV
Required Cooling Capacity (TC) 480,000 Btuh
Sensible Heat Capacity (SHC) 338,000 Btuh
Required Heating Capacity 300,000 Btuh
Design Outdoor Air db Temperature 95°F
Design Outdoor Air wb Temperature 67°F
Climate Type (as per ASHRAE 90.1 Table D).... Dry
Indoor-Air Temperature 80°F edb, 67°F ewb
Evaporator Air Quantity..... 16,000 cfm
External Static Pressure 1.4 in. wg
Electrical Characteristics (V-Ph-Hz) 460-3-60
Unit Type Gas Heating Vertical Discharge

II Select the unit based on required cooling capacity.

Entering Cooling Capacity table at air condenser entering temperature of 95°F. Unit 48A3D040 at 16,000 cfm and 67°F ewb will provide the total capacity of 485,000 Btuh and a SHC of 380,000 Btuh. Calculate SHC correction, if required, using notes under cooling capacity table.

III Select heat capacity of unit to provide design condition requirements.

In the Gas Heating Capacities and Efficiencies table, note that unit 48A3D040 will provide 324,000 Btuh with an input of 400,000 Btuh.

IV Select supply fan to provide design condition requirements.

Tabulated fan performance includes 2-in. throw-away filters, wet evaporator coil, economizer, cabinet losses, and roof curb. Find fan rpm and bhp at 1.4 in. wg and 16,000 cfm on 48A3D040 Fan Performance table for vertical applications. Find that the fan speed is 1063 rpm and the power required is 19.06 bhp. Refer to the Motor Limitations table which shows the 20 hp motor is required.

V Select unit that corresponds to the power source available.

The model number nomenclature shows that a 460-3-60 unit is available.

VI Select the options and accessories.

As per the ASHRAE 90.1 requirements, this unit is located in a dry climate and therefore is required to have an economizer. As this is a dry climate, either differential dry bulb changeover, outdoor air change-over or differential enthalpy should be used. Outside air enthalpy cannot be used.

Select the options and model number using the options summary and model number charts in the price pages.

Note, as an alternative, a computerized selection program, Applied RTUBuilder, is available for use in selecting and optimizing the unit for your application.

Performance data



Humidi-MiZer® performance data

Carrier's Humidi-MiZer adaptive dehumidification system is an all-inclusive factory-installed option that can be ordered with WeatherMaker® 48/50A rooftop units.

This system expands the envelope of operation of the A Series rooftop to provide unprecedented flexibility that will meet year-round comfort conditions.

The Humidi-MiZer adaptive dehumidification system has the industry's only dual dehumidification mode setting. The WeatherMaker rooftop, coupled with the Humidi-MiZer adaptive dehumidification system, is capable of modulating between normal design cooling mode, subcooling mode, and hot gas reheat mode.

Normal design cooling mode will operate under the normal sequence of operation. Subcooling mode will operate to satisfy part load type conditions. Hot Gas Reheat mode will


operate when outdoor temperatures diminish and the need for latent capacity is required for sole humidity control. Hot Gas Reheat mode will provide neutral air for maximum dehumidification operation.

The WeatherMaker A Series next generation version of Carrier's Humidi-MiZer system includes refrigerant modulating valves that provide variable flow bypass around the condenser. This innovative feature ensures exact control of the supply-air temperature as the unit lowers the evaporator temperature to increase latent capacity.

Additionally, when the space requires dehumidification only, the Humidi-MiZer system can increase hot discharge gas bypass to the Humidi-MiZer coil in order to heat the air to the exact neutral state required—no overcooling or overheating with latent capacity similar to that provided in the full subcooling mode.

Variable Sensible Heat Ratio (SHR) Example

80°F db/67°F wb Ent Air, 95°F Outdoor, Constant Volume CFM

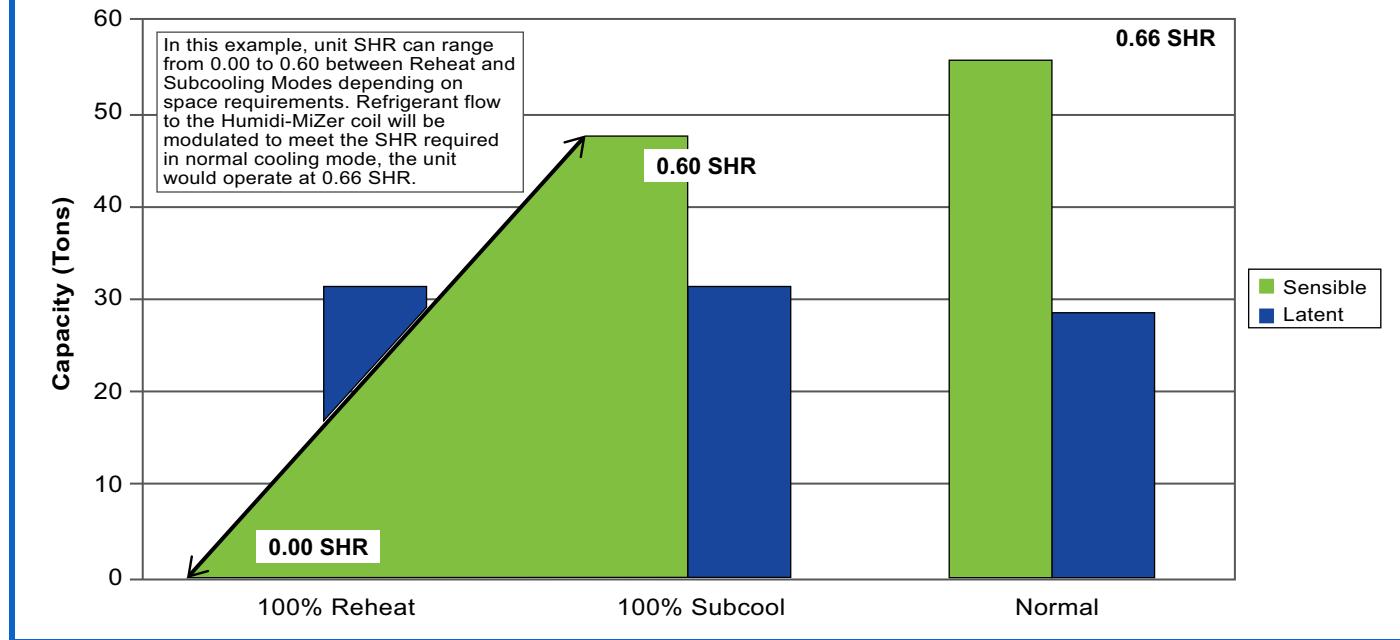

Legend and notes for Cooling Capacities tables on pages 33-56.

LEGEND

BF	— Bypass Factor
Edb	— Entering Dry Bulb
Ewb	— Entering Wet Bulb
kW	— Compressor Motor Power Input
RH	— Relative Humidity
SCFM	— Standard Cubic Feet per Minute
SHC	— Sensible Heat Capacity (1000 Btuh)
TC	— Total Capacity (1000 Btuh) Gross
VAV	— Variable Air Volume

Boldface — VAV Units Only

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
2. The following formulas may be used:

$$t_{edb} = t_{edeb} - \frac{\text{sensible capacity (Btu/h)}}{1.10 \times \text{cfm}}$$

$$t_{lwb} = \text{Wet-bulb temperature corresponding to enthalpy of air leaving evaporator coil (hlwb)}$$

$$hlwb = h_{ewb} - \frac{\text{total capacity (Btu/h)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil.

3. The SHC is based on 80°F edb temperature of air entering evaporator coil. Below 80°F edb, subtract (corr factor x cfm) from SHC. Above 80°F edb, add (corr factor x cfm) to SHC.

BF	ENTERING AIR DRY-BULB TEMP (F)					
	79	78	77	76	75	under 75
	81	82	83	84	85	over 85
Correction Factor						
.05	1.04	2.07	3.11	4.14	4.18	Use formula shown below.
.10	.98	1.96	2.94	3.92	4.91	
.20	.87	1.74	2.62	3.49	4.36	

Interpolation is permissible.

Correction Factor = $1.10 \times (1 - BF) \times (edb - 80)$.

4. Cooling capacities are gross and do not include deduction for indoor fan motor heat.

5. Units with Humidi-MiZer system are only able to operate in dehumidification mode down to 200 cfm/ton. Operation may be additionally limited based on entering coil conditions.

Performance data (cont)



COOLING CAPACITIES

48/50A020 (20 TONS) — STANDARD MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm																				
	4,000					5,000					6,000					7,000					
	Evaporator Air — Ewb (F)																				
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC KW BF	268 109 14.1 0.00	258 119 14.0 0.00	236 141 13.8 0.09	214 161 13.7 0.15	195 179 13.6 0.14	284 113 14.3 0.00	272 128 14.2 0.00	250 155 14.0 0.19	228 180 13.8 0.16	208 201 13.7 0.17	294 116 14.5 0.00	282 136 14.3 0.27	260 168 14.1 0.18	239 197 13.9 0.17	224 224 13.8 0.24	302 121 14.6 0.00	289 144 14.4 0.23	268 180 14.1 0.19	246 213 13.9 0.17	232 232 13.8 0.28
85	TC SHC KW BF	261 106 16.0 0.02	250 115 16.0 0.00	228 138 15.8 0.21	207 158 15.7 0.15	188 176 16.2 0.13	276 110 16.2 0.00	264 125 16.1 0.14	242 152 15.9 0.18	221 176 15.8 0.15	200 194 16.4 0.00	286 112 16.4 0.24	273 133 16.2 0.18	252 164 16.0 0.16	230 193 15.8 0.26	218 218 16.5 0.15	293 118 16.3 0.22	280 141 16.1 0.18	259 210 15.9 0.17	238 226 15.8 0.30	
95	TC SHC KW BF	253 102 18.2 0.00	242 112 18.2 0.00	220 134 18.0 0.18	200 154 17.9 0.14	181 172 17.9 0.13	267 106 18.4 0.00	254 122 18.3 0.12	233 148 18.2 0.17	212 172 18.0 0.15	198 198 18.5 0.20	277 109 18.4 0.00	264 130 18.2 0.22	242 161 18.1 0.16	221 190 18.0 0.25	207 207 18.6 0.13	283 115 18.5 0.13	271 137 18.3 0.18	249 206 18.1 0.17	228 218 18.0 0.32	
105	TC SHC KW BF	244 97 20.7 0.00	232 109 20.6 0.00	211 130 20.6 0.17	191 150 20.7 0.13	174 168 20.8 0.13	257 101 20.8 0.00	244 118 20.8 0.25	223 144 20.6 0.16	203 168 20.8 0.14	187 187 20.9 0.00	266 106 20.8 0.20	253 126 20.7 0.16	232 156 20.6 0.15	211 185 20.7 0.28	200 200 21.0 0.28	272 112 20.9 0.20	260 134 20.7 0.17	238 211 20.6 0.35		
115	TC SHC KW BF	234 93 23.4 0.00	222 105 23.4 0.00	201 126 23.6 0.15	182 146 23.9 0.13	166 162 24.3 0.15	246 97 23.5 0.00	233 114 24.3 0.21	212 144 23.4 0.15	193 139 23.5 0.14	180 180 24.0 0.22	254 103 23.6 0.13	241 125 23.5 0.19	220 152 23.5 0.16	201 180 23.7 0.31	192 192 23.8 0.24	260 108 23.7 0.19	247 129 23.6 0.17	227 164 23.5 0.18	202 202 23.7 0.38	
120	TC SHC KW BF	228 91 24.9 0.00	216 103 25.1 0.12	196 124 25.4 0.14	178 143 25.7 0.12	161 159 26.3 0.15	240 95 24.9 0.00	227 112 25.0 0.20	207 137 25.2 0.15	188 161 25.8 0.14	175 175 25.8 0.24	247 101 25.0 0.29	235 120 25.0 0.18	215 150 25.1 0.16	195 178 25.4 0.15	188 188 25.6 0.32	253 106 25.1 0.23	241 127 25.0 0.17	220 162 25.3 0.18	198 198 25.4 0.39	

48/50A020 (20 TONS) — STANDARD MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm															
	8,000					9,000					10,000					
	Evaporator Air — Ewb (F)															
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC KW BF	308 126 14.7 0.34	295 151 14.5 0.22	274 191 14.2 0.19	252 228 14.0 0.19	243 243 13.9 0.34	313 130 14.8 0.28	299 158 14.5 0.22	278 202 14.3 0.20	257 242 14.0 0.21	251 251 14.0 0.40	317 135 14.8 0.26	303 164 14.6 0.23	282 212 14.3 0.21	262 251 14.1 0.25	259 259 14.1 0.44
85	TC SHC KW BF	298 123 16.6 0.29	286 148 16.4 0.21	265 188 16.1 0.19	243 224 16.0 0.19	236 127 15.9 0.36	302 155 16.6 0.26	290 199 16.4 0.22	269 236 16.2 0.20	248 244 16.0 0.22	244 244 16.7 0.41	306 131 16.5 0.25	294 161 16.2 0.22	273 209 16.1 0.25	253 247 16.0 0.46	
95	TC SHC KW BF	288 120 18.7 0.27	276 145 18.5 0.21	255 184 18.3 0.18	234 219 18.2 0.19	228 124 18.1 0.38	293 151 18.7 0.25	280 195 18.6 0.19	259 230 18.4 0.23	239 236 18.2 0.43	236 129 18.8 0.24	296 158 18.6 0.22	284 205 18.4 0.20	262 239 18.2 0.28	245 243 18.3 0.47	
105	TC SHC KW BF	277 116 21.1 0.24	265 141 20.9 0.20	243 180 20.8 0.18	223 213 20.6 0.21	220 121 20.6 0.41	281 148 21.1 0.23	269 191 21.0 0.20	248 223 20.8 0.19	227 227 20.6 0.45	227 125 20.6 0.23	284 154 21.2 0.21	272 201 21.0 0.20	251 232 20.7 0.29	234 234 20.7 0.49	
115	TC SHC KW BF	264 113 23.7 0.22	252 137 23.6 0.19	231 175 23.5 0.18	213 206 23.6 0.22	211 117 23.8 0.43	268 144 23.6 0.22	256 186 23.7 0.20	235 216 23.5 0.19	219 218 23.5 0.48	218 121 23.7 0.22	271 150 23.5 0.21	258 197 23.0 0.20	238 221 22.4 0.32	224 224 22.4 0.52	
120	TC SHC KW BF	257 110 25.1 0.22	245 134 25.1 0.19	225 173 25.1 0.18	207 202 25.2 0.23	206 115 25.3 0.44	261 141 25.2 0.22	248 184 25.1 0.20	229 215 25.0 0.19	215 213 25.2 0.29	213 119 25.1 0.49	263 148 25.1 0.22	251 194 25.1 0.21	232 219 25.1 0.20	225 219 25.1 0.32	219 219 25.1 0.53

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A020 (20 TONS) — SUBCOOLING MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM																				
	4,000				5,000				6,000				7,000								
	Evaporator Air Ewb (F)																				
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC KW BF	265 96 14.0 0.00	249 109 13.8 0.02	223 126 13.6 0.09	204 147 13.5 0.10	184 166 13.4 0.10	285 107 14.1 0.00	269 121 14.0 0.08	239 140 13.7 0.11	220 168 13.6 0.12	199 191 14.2 0.03	293 109 14.0 0.11	277 126 13.8 0.13	251 153 13.7 0.14	232 186 13.6 0.19	212 209 14.1 0.08	303 115 13.9 0.14	286 134 14.3 0.15	260 166 13.7 0.15	236 197 13.7 0.25	222 222 13.6 0.25
85	TC SHC KW BF	249 83 15.5 0.00	234 96 15.4 0.03	201 106 15.1 0.09	193 139 15.0 0.10	173 157 15.0 0.10	265 91 15.7 0.01	250 105 15.5 0.09	219 123 15.2 0.12	207 157 15.2 0.12	187 179 15.8 0.14	277 97 15.6 0.05	262 114 15.4 0.12	240 145 15.2 0.13	214 170 15.2 0.14	199 197 15.1 0.20	286 102 15.9 0.10	270 122 15.7 0.14	248 157 15.5 0.15	226 191 15.3 0.15	212 212 15.3 0.26
95	TC SHC KW BF	235 72 17.3 0.00	222 87 17.2 0.05	201 108 17.0 0.10	177 125 16.8 0.10	162 148 16.7 0.10	251 80 17.5 0.02	237 95 17.3 0.10	214 121 17.1 0.12	192 145 16.9 0.12	177 170 16.9 0.16	262 86 17.6 0.07	247 103 17.4 0.12	223 132 17.2 0.13	204 163 17.0 0.14	188 188 17.0 0.20	270 90 17.7 0.10	255 110 17.5 0.14	231 144 17.3 0.15	210 179 17.1 0.16	199 199 17.0 0.28
105	TC SHC KW BF	221 61 19.3 0.00	207 75 19.2 0.07	186 97 19.0 0.10	167 118 18.9 0.10	150 138 19.0 0.11	226 58 19.3 0.03	220 82 19.3 0.10	199 109 19.2 0.12	176 132 18.9 0.17	163 158 18.9 0.08	246 72 19.6 0.12	231 90 19.4 0.14	209 121 19.2 0.14	189 151 19.1 0.22	176 176 19.0 0.11	214 38 19.0 0.14	238 97 19.5 0.14	215 131 19.3 0.15	196 168 19.1 0.30	181 181 19.0 0.30
115	TC SHC KW BF	205 50 21.6 0.00	191 63 21.5 0.08	170 84 21.3 0.10	150 104 21.1 0.10	136 126 21.1 0.11	219 55 21.7 0.04	205 71 21.6 0.11	184 97 21.4 0.12	165 124 21.3 0.12	151 147 21.2 0.18	199 31 21.4 0.09	215 78 21.4 0.13	192 108 21.7 0.14	173 140 21.5 0.14	157 157 21.2 0.24	222 50 21.6 0.12	200 63 21.4 0.14	198 119 21.5 0.15	178 153 21.4 0.16	168 168 21.3 0.32

48/50A020 (20 TONS) — SUBCOOLING MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM																			
	8,000				9,000				10,000											
	Evaporator Air Ewb (F)																			
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57					
75	TC SHC KW BF	317 126 14.4 0.12	299 147 14.3 0.16	267 177 13.9 0.17	242 213 13.7 0.17	235 235 13.7 0.32	317 126 14.4 0.14	300 149 14.2 0.18	273 188 14.0 0.18	248 227 13.8 0.19	243 243 13.8 0.37	322 130 14.4 0.17	305 156 14.3 0.19	280 202 14.1 0.20	258 246 13.9 0.21	251 251 13.8 0.42				
85	TC SHC KW BF	294 108 15.9 0.13	277 129 15.8 0.16	252 166 15.5 0.17	232 205 15.4 0.17	222 222 15.3 0.33	299 112 16.0 0.15	284 138 15.8 0.18	260 180 15.6 0.18	238 220 15.5 0.20	231 231 15.4 0.38	307 120 16.1 0.17	290 146 16.1 0.19	264 190 15.9 0.20	238 225 15.7 0.24	234 234 15.4 0.43				
95	TC SHC KW BF	277 95 17.7 0.13	262 118 17.6 0.16	236 153 17.3 0.17	217 194 17.2 0.18	209 209 17.1 0.34	282 99 0.15	267 124 0.18	241 165 0.18	221 206 0.20	216 216 0.40	287 104 0.40	270 130 0.40	246 176 0.40	226 214 0.25	223 223 0.44				
105	TC SHC KW BF	248 70 19.6 0.14	224 84 19.3 0.16	221 142 19.3 0.17	198 178 19.1 0.18	195 195 19.2 0.36	230 51 0.16	240 101 0.18	225 153 0.18	186 171 0.22	199 199 0.41	256 177 0.18	217 83 0.19	229 163 0.19	213 203 0.26	207 207 0.45				
115	TC SHC KW BF	186 14 21.1 0.14	182 46 21.1 0.16	204 130 21.6 0.17	185 166 21.5 0.20	178 178 21.4 0.38	237 63 0.16	185 51 0.18	208 140 0.18	189 175 0.24	186 186 0.43	205 31 0.18	187 56 0.19	195 133 0.19	195 187 0.27	192 192 0.47				

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

50A020 (20 TONS) — HOT GAS REHEAT MODE

Temp (F) Air Entering Condenser (Edb)		Air Entering Evaporator — Ewb (F)													
		75 Dry Bulb						75 Dry Bulb							
		62.5 Wet Bulb (50% RH)						65.3 Wet Bulb (60% RH)							
		Air Entering Evaporator — SCFM													
		4,000	5,000	6,000	7,000	8,000	9,000	10,000	4,000	5,000	6,000	7,000	8,000	9,000	10,000
40	TC SHC kW BF	78 0 15.8 0.07	87 8 15.1 0.09	94 16 14.8 0.11	99 25 14.5 0.13	104 33 14.4 0.14	107 41 14.3 0.15	109 49 14.2 0.17	83 -17 16.6 0.05	93 -11 15.8 0.08	101 -5 15.4 0.10	106 1 15.1 0.12	111 6 14.9 0.14	114 12 14.8 0.14	117 18 14.7 0.17
50	TC SHC kW BF	72 -4 16.4 0.07	81 4 15.7 0.09	87 12 15.3 0.11	92 21 15.0 0.13	95 29 14.9 0.14	98 36 14.8 0.15	100 44 14.7 0.17	76 -21 17.1 0.06	86 -15 16.3 0.08	92 -10 15.9 0.10	97 -4 15.6 0.12	101 2 15.4 0.14	104 7 15.3 0.15	107 13 15.2 0.17
60	TC SHC kW BF	66 -8 17.0 0.07	75 1 16.2 0.09	81 9 15.8 0.11	85 17 15.5 0.13	88 25 15.4 0.14	91 33 15.3 0.15	93 40 15.2 0.17	71 -24 17.7 0.06	80 -19 16.9 0.09	87 -13 16.4 0.11	91 -7 16.1 0.12	94 -2 15.9 0.14	97 3 15.8 0.15	99 9 15.7 0.17
70	TC SHC kW BF	61 -11 17.6 0.07	69 -3 16.8 0.09	75 5 16.4 0.11	79 14 16.1 0.13	82 22 16.0 0.14	85 29 15.8 0.15	86 37 15.8 0.17	65 -28 18.4 0.06	74 -22 17.5 0.09	80 -17 17.0 0.11	85 -11 16.7 0.12	88 -5 16.5 0.14	90 0 16.3 0.15	92 6 16.2 0.17
75	TC SHC kW BF	58 -13 17.9 0.07	67 -4 17.2 0.09	72 4 16.7 0.11	76 12 16.5 0.13	79 20 16.3 0.14	81 28 16.2 0.15	83 35 16.1 0.17	63 -29 18.7 0.06	71 -24 17.8 0.09	77 -18 17.3 0.11	81 -13 17.0 0.12	84 -7 16.8 0.14	87 -2 16.7 0.15	89 4 16.6 0.17
80	TC SHC kW BF	56 -14 18.3 0.07	64 -6 17.5 0.09	70 2 17.1 0.11	73 10 16.8 0.13	76 18 16.6 0.14	78 26 16.5 0.15	80 34 16.4 0.17	60 -31 19.1 0.07	69 -25 18.2 0.09	74 -20 17.6 0.11	78 -14 17.3 0.12	81 -9 17.1 0.14	84 -3 17.0 0.15	85 2 16.9 0.17

50A020 (20 TONS) — HOT GAS REHEAT MODE (cont)

Temp (F) Air Entering Condenser (Edb)		Air Entering Evaporator — Ewb (F)													
		75 Dry Bulb						75 Dry Bulb							
		68.0 Wet Bulb (70% RH)						70.5 Wet Bulb (80% RH)							
		Air Entering Evaporator — SCFM													
		4,000	5,000	6,000	7,000	8,000	9,000	10,000	4,000	5,000	6,000	7,000	8,000	9,000	10,000
40	TC SHC kW BF	87 -34 17.4 0.02	99 -30 16.5 0.04	107 -27 16.0 0.08	113 -23 15.6 0.11	117 -20 15.4 0.12	121 -16 15.3 0.14	123 -13 15.2 0.16	92 -50 18.2 0.00	104 -49 17.1 0.03	112 -47 16.5 0.05	119 -46 16.2 0.09	123 -44 15.9 0.11	127 -43 15.8 0.13	130 -41 15.6 0.17
50	TC SHC kW BF	81 -38 17.9 0.02	91 -34 17.0 0.06	98 -31 16.4 0.09	104 -28 16.1 0.11	108 -24 15.9 0.13	111 -21 15.8 0.14	114 -17 15.6 0.16	85 -54 0.00	96 -53 0.00	104 -51 0.03	110 -50 0.06	114 -49 0.09	117 -47 0.12	120 -46 0.14
60	TC SHC kW BF	75 -41 18.5 0.02	85 -38 17.5 0.06	92 -35 17.0 0.09	96 -31 16.6 0.11	100 -28 16.4 0.13	103 -25 16.3 0.15	105 -22 16.2 0.16	79 -57 0.00	90 -55 0.01	96 -54 0.03	101 -53 0.07	105 -51 0.10	108 -50 0.12	111 -50 0.14
70	TC SHC kW BF	70 -44 19.1 0.03	79 -41 18.1 0.07	85 -38 17.6 0.09	90 -35 17.2 0.11	93 -32 17.0 0.13	95 -29 16.8 0.15	97 -25 16.7 0.16	74 -60 0.00	83 -59 0.01	90 -58 0.04	95 -57 0.08	98 -56 0.10	101 -55 0.12	103 -54 0.14
75	TC SHC kW BF	67 -46 19.5 0.03	76 -43 18.4 0.07	82 -40 17.9 0.09	86 -37 17.5 0.11	90 -33 17.3 0.13	92 -30 17.1 0.15	94 -27 17.0 0.16	71 -62 0.00	80 -61 0.01	87 -60 0.04	91 -59 0.08	95 -58 0.10	97 -57 0.13	99 -55 0.14
80	TC SHC kW BF	64 -48 19.8 0.03	73 -44 18.8 0.07	79 -41 18.2 0.09	83 -38 17.9 0.11	86 -35 17.6 0.13	89 -32 17.5 0.15	91 -28 17.4 0.16	68 -64 0.00	77 -62 0.01	84 -61 0.05	88 -60 0.08	91 -59 0.11	94 -58 0.13	96 -57 0.15

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A025 (25 TONS) — STANDARD MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm																				
	5,000					6,250					7,500					8,750					
	Evaporator Air — Ewb (F)																				
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC kW BF	318 128 18.7 0.00	305 142 18.4 0.00	281 173 17.9 0.18	260 201 17.6 0.13	239 226 17.2 0.11	335 133 19.0 0.00	320 154 18.7 0.11	296 190 18.2 0.16	274 224 17.8 0.13	253 251 17.4 0.16	347 138 19.3 0.00	331 165 18.9 0.22	307 205 18.4 0.17	284 242 18.0 0.15	268 268 17.7 0.24	354 145 19.4 0.13	339 175 19.1 0.21	315 220 18.6 0.21	292 264 18.1 0.17	280 280 17.9 0.32
85	TC SHC kW BF	308 124 20.8 0.00	295 139 20.5 0.00	274 170 20.1 0.17	253 197 19.8 0.12	232 222 19.5 0.12	324 127 21.1 0.00	309 151 20.8 0.10	287 186 20.3 0.16	266 220 19.6 0.13	248 248 19.0 0.18	334 135 21.3 0.00	319 161 21.0 0.21	297 205 20.5 0.16	275 242 20.1 0.26	261 261 21.2 0.11	341 141 20.7 0.20	327 216 20.3 0.17	305 260 20.1 0.16	283 273 20.1 0.33	
95	TC SHC kW BF	298 119 23.1 0.00	286 136 22.8 0.00	265 166 22.5 0.15	244 193 22.3 0.12	224 217 22.0 0.12	312 124 23.4 0.00	300 147 23.1 0.24	278 182 22.8 0.15	257 216 22.5 0.13	241 241 22.2 0.20	321 131 23.6 0.13	309 157 23.4 0.20	288 198 22.6 0.16	266 236 22.4 0.28	254 254 22.4 0.26	328 137 23.8 0.19	316 166 23.5 0.17	295 212 23.1 0.17	273 255 22.7 0.35	
105	TC SHC kW BF	289 116 25.7 0.00	277 133 25.6 0.00	256 162 25.3 0.14	235 188 25.1 0.11	214 208 24.9 0.12	302 121 26.0 0.00	290 144 25.9 0.21	268 178 25.6 0.15	247 211 25.3 0.13	231 228 25.0 0.22	311 128 26.2 0.11	298 153 26.0 0.18	277 193 25.8 0.15	255 231 25.5 0.30	245 245 26.4 0.24	318 134 26.2 0.18	304 163 25.9 0.17	283 208 25.5 0.17	262 249 25.4 0.37	
115	TC SHC kW BF	278 111 28.7 0.00	266 128 28.6 0.09	245 157 28.5 0.13	224 183 28.3 0.11	207 203 28.3 0.16	289 117 29.0 0.00	278 139 28.9 0.19	256 173 28.7 0.14	236 205 28.7 0.13	223 223 28.5 0.24	298 124 29.2 0.26	285 149 29.1 0.17	264 188 29.1 0.15	243 225 28.7 0.33	236 236 28.7 0.22	305 130 29.4 0.17	290 158 29.1 0.16	270 203 28.7 0.18	250 242 247 0.40	

48/50A025 (25 TONS) — STANDARD MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm															
	10,000					11,250					12,500					
	Evaporator Air — Ewb (F)															
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC kW BF	361 152 19.6 0.28	346 184 19.2 0.20	321 234 18.7 0.18	297 281 18.2 0.19	291 291 18.1 0.38	367 158 19.7 0.25	351 192 19.3 0.21	326 248 18.8 0.19	303 295 18.4 0.21	300 300 18.3 0.43	372 163 19.8 0.25	355 201 19.4 0.22	330 261 18.9 0.20	309 305 18.5 0.26	307 307 18.4 0.48
85	TC SHC kW BF	348 148 21.6 0.25	332 179 21.3 0.20	310 230 20.8 0.18	288 275 20.4 0.19	283 283 20.3 0.40	353 153 21.8 0.24	337 188 21.4 0.21	315 244 20.9 0.19	294 288 20.5 0.23	291 291 20.4 0.45	357 159 21.8 0.24	341 197 21.5 0.21	318 257 21.0 0.20	299 296 20.6 0.26	299 299 20.6 0.49
95	TC SHC kW BF	335 144 23.9 0.24	321 175 23.6 0.19	300 226 23.2 0.18	278 270 22.8 0.19	275 275 22.7 0.41	340 150 24.0 0.23	325 184 23.7 0.19	304 240 23.3 0.24	284 281 22.9 0.24	283 283 22.9 0.46	343 155 24.1 0.23	330 192 23.8 0.21	308 253 23.4 0.20	290 290 23.0 0.50	290 290 23.0 0.50
105	TC SHC kW BF	323 140 26.6 0.22	310 172 26.3 0.18	288 222 26.0 0.22	268 260 25.5 0.43	266 266 25.5 0.22	328 146 26.7 0.20	314 180 26.4 0.19	292 235 26.0 0.27	275 268 25.6 0.27	274 274 25.7 0.48	331 151 26.8 0.22	318 188 26.5 0.21	296 248 26.1 0.20	280 280 25.8 0.31	280 280 25.8 0.52
115	TC SHC kW BF	309 136 29.6 0.21	297 167 29.4 0.19	275 217 29.0 0.18	256 254 28.7 0.23	255 255 28.7 0.46	313 142 29.7 0.21	300 175 29.4 0.20	278 230 29.1 0.19	263 261 28.8 0.30	263 263 28.8 0.50	317 147 29.8 0.21	303 184 29.5 0.21	281 243 29.1 0.20	269 269 28.9 0.34	269 269 28.9 0.54

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A025 (25 TONS) — SUBCOOLING MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM																				
	5,000				6,250				7,500				8,750								
	Evaporator Air Ewb (F)																				
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC kW BF	331 118 18.0 0.00	298 121 17.2 0.01	284 162 17.2 0.05	253 183 16.5 0.06	233 212 16.4 0.07	338 115 17.9 0.00	321 136 17.6 0.05	292 170 17.0 0.08	276 213 16.6 0.10	251 242 18.2 0.02	359 130 18.2 0.08	334 147 17.8 0.09	317 198 17.7 0.10	290 236 17.3 0.16	267 267 18.2 0.06	367 134 18.4 0.10	358 170 18.4 0.11	316 202 17.5 0.12	288 246 17.0 0.24	271 271 16.8 0.24
85	TC SHC kW BF	314 105 19.9 0.00	294 120 19.4 0.02	265 145 18.8 0.06	231 163 18.2 0.06	222 203 18.4 0.07	330 111 20.1 0.00	314 134 19.9 0.05	283 163 18.9 0.08	261 200 18.1 0.12	229 220 19.9 0.03	332 107 0.08	315 132 0.08	288 173 0.09	274 223 0.10	252 252 19.2 0.18	356 128 18.8 0.07	337 154 20.7 0.10	305 195 20.3 0.11	272 233 19.5 0.12	260 260 18.6 0.26
95	TC SHC kW BF	285 79 21.5 0.00	281 110 21.7 0.02	255 138 21.2 0.06	232 166 20.8 0.06	208 190 20.3 0.07	312 98 22.4 0.01	297 120 22.0 0.06	265 149 21.2 0.08	248 189 21.1 0.13	226 218 20.8 0.04	325 105 0.08	309 129 0.09	271 159 0.10	258 211 0.10	239 239 20.9 0.19	336 112 22.9 0.07	318 139 22.4 0.10	280 174 21.4 0.11	256 219 21.2 0.12	254 254 21.2 0.27
105	TC SHC kW BF	267 66 23.9 0.00	264 97 24.1 0.02	229 115 23.1 0.06	217 153 23.1 0.06	196 180 23.1 0.07	294 83 0.01	279 106 0.06	253 140 0.08	231 176 0.15	212 205 0.04	293 76 0.08	278 102 0.08	254 145 0.09	228 183 0.12	222 222 0.22	309 93 0.22	293 120 24.6 0.09	267 166 24.0 0.12	235 201 23.2 0.13	236 236 23.7 0.30
115	TC SHC kW BF	253 58 26.6 0.00	245 83 26.9 0.04	221 112 26.4 0.07	189 129 25.2 0.08	170 155 24.7 0.11	259 55 26.7 0.02	252 85 0.08	223 114 0.10	201 149 0.10	184 178 0.18	268 60 0.06	255 86 0.10	244 140 0.12	211 169 0.12	196 196 0.24	276 271 0.10	262 164 0.12	239 93 0.13	218 141 0.15	220 187 0.32

48/50A025 (25 TONS) — SUBCOOLING MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM															
	10,000				11,250				12,500							
	Evaporator Air Ewb (F)															
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC kW BF	371 136 18.4 0.09	353 166 18.1 0.12	336 229 18.0 0.13	306 276 17.6 0.14	295 295 17.4 0.31	378 142 18.4 0.12	342 189 18.6 0.14	313 294 18.1 0.14	306 306 17.7 0.37	383 148 18.6 0.14	365 184 18.3 0.15	348 258 18.2 0.16	309 299 17.4 0.20	316 316 17.7 0.42	
85	TC SHC kW BF	349 119 20.2 0.10	332 151 19.9 0.12	305 203 19.5 0.13	279 252 19.0 0.14	269 269 18.8 0.33	355 125 20.3 0.12	338 159 20.1 0.14	311 217 19.6 0.14	285 268 19.1 0.17	289 289 19.4 0.38	374 144 21.0 0.14	343 168 21.0 0.15	316 230 19.7 0.22	303 294 19.7 0.43	288 288 19.2 0.43
95	TC SHC kW BF	327 103 22.2 0.10	312 135 22.0 0.12	286 188 21.6 0.13	262 237 21.1 0.15	254 254 20.9 0.34	333 108 22.5 0.12	317 143 22.2 0.14	291 202 21.7 0.14	268 252 21.2 0.19	263 263 21.1 0.39	352 128 23.1 0.14	333 163 22.7 0.15	304 223 22.0 0.15	274 265 21.3 0.23	271 271 21.3 0.44
105	TC SHC kW BF	315 98 25.2 0.12	290 119 24.4 0.14	263 169 23.8 0.15	254 231 24.0 0.18	246 246 23.8 0.36	323 106 25.5 0.14	307 139 25.1 0.16	269 182 24.1 0.17	260 244 24.0 0.23	254 254 24.0 0.42	325 109 25.5 0.16	296 132 24.5 0.17	273 195 24.0 0.18	253 244 23.6 0.26	251 251 23.5 0.46
115	TC SHC kW BF	281 69 27.2 0.12	281 114 27.5 0.14	257 167 27.0 0.15	237 214 26.7 0.20	230 230 26.5 0.38	286 73 27.4 0.15	285 121 27.6 0.16	249 167 26.5 0.17	230 215 26.1 0.24	238 238 26.6 0.43	290 77 27.4 0.17	289 129 27.7 0.18	266 192 27.2 0.18	235 227 26.2 0.27	233 233 26.1 0.47

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

50A025 (25 TONS) — HOT GAS REHEAT MODE

Temp (F) Air Entering Condenser (Edb)		Air Entering Evaporator — Ewb (F)													
		75 Dry Bulb						75 Dry Bulb							
		62.5 Wet Bulb (50% RH)						65.3 Wet Bulb (60% RH)							
		Air Entering Evaporator — SCFM													
		5,000	6,250	7,500	8,750	10,000	11,250	12,500	5,000	6,250	7,500	8,750	10,000	11,250	12,500
40	TC SHC kW BF	75 -13 18.5 0.04	84 -3 17.6 0.06	92 7 17.0 0.08	97 18 16.7 0.09	101 29 16.4 0.11	105 39 16.2 0.12	107 50 16.1 0.13	79 -35 19.4 0.03	90 -28 18.4 0.05	98 -21 17.8 0.07	104 -14 17.4 0.09	108 -6 17.1 0.10	112 1 16.9 0.12	115 9 16.7 0.13
50	TC SHC kW BF	69 -17 19.0 0.04	78 -7 18.1 0.06	85 3 17.5 0.08	90 14 17.1 0.09	94 25 16.9 0.11	96 35 16.7 0.12	99 45 16.5 0.13	73 -39 20.0 0.03	83 -32 18.9 0.06	90 -26 18.3 0.07	95 -18 17.8 0.09	99 -11 17.5 0.11	103 -4 17.3 0.12	105 4 17.1 0.13
60	TC SHC kW BF	63 -20 19.5 0.04	72 -10 18.6 0.06	78 0 18.0 0.08	82 10 17.6 0.09	85 20 17.4 0.11	88 31 17.2 0.12	90 41 17.0 0.13	67 -43 20.5 0.04	76 -36 19.4 0.06	83 -30 18.8 0.07	87 -23 18.3 0.09	91 -15 18.0 0.11	94 -8 17.8 0.12	96 0 17.6 0.13
70	TC SHC kW BF	58 -24 20.2 0.04	66 -14 19.2 0.06	72 -4 18.6 0.08	76 6 18.2 0.09	79 17 17.9 0.11	81 27 17.7 0.12	82 37 17.6 0.13	61 -46 21.1 0.04	70 -40 20.0 0.06	76 -33 19.3 0.07	80 -26 18.9 0.09	83 -19 18.6 0.10	86 -12 18.3 0.12	88 -4 18.2 0.13
75	TC SHC kW BF	55 -26 20.5 0.04	63 -16 19.5 0.06	69 -6 18.9 0.08	73 5 18.5 0.09	76 15 18.2 0.11	78 25 18.0 0.12	79 35 17.8 0.13	58 -48 21.5 0.04	67 -42 20.3 0.06	73 -35 19.6 0.07	77 -28 19.2 0.09	80 -21 18.9 0.10	82 -14 18.6 0.12	84 -6 18.4 0.13
80	TC SHC kW BF	52 -27 20.8 0.05	60 -18 19.8 0.06	66 -8 19.2 0.08	70 3 18.8 0.09	72 13 18.5 0.10	74 24 18.3 0.12	76 34 18.1 0.13	56 -49 21.8 0.04	64 -43 20.7 0.06	70 -37 20.0 0.07	74 -30 19.5 0.09	77 -23 19.2 0.10	79 -15 18.9 0.12	81 -8 18.7 0.13

50A025 (25 TONS) — HOT GAS REHEAT MODE (cont)

Temp (F) Air Entering Condenser (Edb)		Air Entering Evaporator — Ewb (F)													
		75 Dry Bulb						75 Dry Bulb							
		68.0 Wet Bulb (70% RH)						70.5 Wet Bulb (80% RH)							
		Air Entering Evaporator — SCFM													
		5,000	6,250	7,500	8,750	10,000	11,250	12,500	5,000	6,250	7,500	8,750	10,000	11,250	12,500
40	TC SHC kW BF	83 -57 20.5 0.02	95 -53 19.3 0.03	104 -49 18.6 0.06	110 -46 18.1 0.10	115 -41 17.7 0.12	118 -37 17.5 0.13	121 -33 17.3 0.00	88 -78 21.6 0.00	100 -77 20.2 0.02	109 -76 19.3 0.02	116 -75 18.8 0.04	121 -74 18.4 0.07	124 -73 18.1 0.09	128 -71 17.9 0.12
50	TC SHC kW BF	77 -61 21.0 0.02	88 -57 19.8 0.04	95 -54 19.0 0.06	101 -50 18.5 0.10	105 -46 18.2 0.12	109 -42 17.9 0.13	111 -37 17.8 0.00	80 -82 22.1 0.00	92 -81 20.7 0.02	100 -80 19.8 0.05	106 -79 19.2 0.07	111 -77 18.9 0.10	115 -76 18.6 0.12	118 -76 18.3 0.12
60	TC SHC kW BF	71 -64 21.6 0.02	80 -61 20.3 0.04	87 -58 19.6 0.06	93 -54 19.0 0.08	97 -50 18.7 0.10	100 -46 18.4 0.12	102 -41 18.2 0.13	74 -86 22.7 0.00	85 -85 21.2 0.02	92 -84 20.3 0.05	98 -83 19.7 0.08	102 -81 19.3 0.10	105 -80 19.0 0.12	108 -80 18.8 0.12
70	TC SHC kW BF	65 -68 22.2 0.02	74 -65 20.9 0.04	80 -62 20.1 0.06	85 -58 19.6 0.08	89 -54 19.2 0.10	91 -50 19.0 0.12	94 -45 18.8 0.13	68 -89 23.3 0.00	78 -89 21.8 0.01	85 -88 21.8 0.03	90 -88 20.9 0.06	94 -87 20.3 0.08	97 -85 19.9 0.10	99 -84 19.6 0.12
75	TC SHC kW BF	62 -70 22.5 0.02	71 -67 21.2 0.04	77 -63 20.4 0.07	82 -60 19.9 0.08	85 -56 19.5 0.10	88 -52 19.3 0.12	90 -47 19.0 0.13	65 -91 23.6 0.00	75 -90 22.1 0.01	81 -90 21.2 0.03	86 -89 20.6 0.06	90 -89 20.2 0.08	93 -87 19.9 0.10	95 -86 19.6 0.12
80	TC SHC kW BF	59 -71 22.8 0.02	68 -68 21.5 0.04	74 -65 20.7 0.07	78 -62 20.2 0.08	81 -58 19.8 0.10	84 -54 19.6 0.12	86 -49 19.4 0.13	62 -92 23.9 0.00	72 -92 22.4 0.01	78 -92 21.5 0.03	82 -91 21.5 0.06	86 -91 20.9 0.08	89 -89 20.5 0.10	91 -88 19.9 0.12

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A027 (27 TONS) — STANDARD MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm																				
	5,500					6,875					8,250					9,625					
	Evaporator Air — Ewb (F)																				
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC KW BF	339 138 19.0 0.00	324 154 18.7 0.00	297 186 18.3 0.15	273 215 17.9 0.11	251 242 17.6 0.11	356 145 19.4 0.00	340 168 19.0 0.07	312 204 18.5 0.14	288 240 18.1 0.12	268 265 17.8 0.19	368 153 19.6 0.11	351 180 19.3 0.19	323 222 18.7 0.15	298 263 18.3 0.13	283 283 18.1 0.26	377 161 19.8 0.27	359 190 19.4 0.18	331 238 18.9 0.16	305 284 18.5 0.15	296 296 18.3 0.34
85	TC SHC KW BF	329 134 21.1 0.00	313 151 20.8 0.09	289 182 20.4 0.13	265 211 20.1 0.11	243 237 19.8 0.11	344 141 21.5 0.00	329 164 21.2 0.21	303 201 20.7 0.14	279 236 20.4 0.12	262 262 20.1 0.20	355 149 21.7 0.09	339 175 21.4 0.18	313 218 20.9 0.14	289 262 20.5 0.14	276 276 21.9 0.28	364 156 21.5 0.24	346 186 21.1 0.24	321 234 21.1 0.17	295 279 20.6 0.15	288 288 20.5 0.36
95	TC SHC KW BF	319 130 23.5 0.08	305 148 23.3 0.08	280 178 23.0 0.13	256 207 22.7 0.10	235 230 22.4 0.13	333 137 23.8 0.13	319 160 23.6 0.19	293 196 23.3 0.13	270 234 22.6 0.12	254 254 24.1 0.08	344 145 23.8 0.17	328 172 23.4 0.14	303 214 23.1 0.13	278 254 22.9 0.13	268 268 24.3 0.30	352 153 24.0 0.23	335 182 23.6 0.17	309 230 23.1 0.15	285 280 23.1 0.16	280 280 23.1 0.37
105	TC SHC KW BF	309 125 26.3 0.07	294 144 26.1 0.12	269 173 25.9 0.10	246 202 25.7 0.10	228 133 25.4 0.16	322 156 26.6 0.10	307 192 26.4 0.17	282 192 26.2 0.13	258 226 25.7 0.12	244 244 25.7 0.24	332 142 26.9 0.16	316 168 26.7 0.14	290 209 26.3 0.14	266 248 25.8 0.33	258 149 25.8 0.20	339 178 27.0 0.20	323 225 26.8 0.16	297 225 26.4 0.15	274 270 26.0 0.18	270 270 26.0 0.40
115	TC SHC KW BF	296 120 29.3 0.00	281 139 29.3 0.20	257 168 29.4 0.12	235 196 29.5 0.10	220 218 29.3 0.19	309 129 29.7 0.08	293 151 29.6 0.15	269 186 29.5 0.12	246 221 29.5 0.12	235 235 29.4 0.27	317 137 29.5 0.21	302 162 29.6 0.15	277 203 29.4 0.13	254 242 29.5 0.14	249 249 29.4 0.35	324 144 30.2 0.19	308 172 30.2 0.16	282 219 29.7 0.15	262 254 29.4 0.20	259 259 29.4 0.42

48/50A027 (27 TONS) — STANDARD MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm																			
	11,000					12,375					13,750									
	Evaporator Air — Ewb (F)																			
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57
75	TC SHC KW BF	384 168 19.9 0.23	365 201 19.6 0.18	337 254 19.0 0.17	311 301 18.6 0.18	307 307 18.5 0.40	389 174 20.0 0.22	371 210 19.7 0.19	342 269 19.1 0.18	319 309 18.7 0.24	316 316 18.7 0.45	394 181 20.1 0.22	375 219 19.8 0.20	346 284 19.2 0.19	324 324 18.8 0.27	324 324 18.8 0.49	324 324 18.8 0.49	324 324 18.8 0.49	324 324 18.8 0.49	324 324 18.8 0.49
85	TC SHC KW BF	370 163 22.0 0.22	353 196 21.7 0.18	326 250 21.2 0.19	302 294 20.8 0.41	299 299 20.7 0.21	375 170 22.1 0.19	358 206 21.8 0.18	331 265 21.3 0.26	309 301 20.9 0.46	307 307 20.8 0.21	307 176 22.2 0.20	307 215 21.9 0.19	307 279 21.3 0.29	334 315 21.0 0.51	315 315 21.0 0.51	315 315 21.0 0.51	315 315 21.0 0.51	315 315 21.0 0.51	315 315 21.0 0.51
95	TC SHC KW BF	358 160 24.4 0.21	342 192 24.1 0.18	315 245 23.7 0.16	292 284 23.3 0.22	290 290 23.2 0.43	363 166 24.5 0.20	346 202 24.2 0.19	319 260 23.8 0.27	299 295 23.4 0.27	298 298 24.7 0.48	368 173 24.7 0.21	350 211 24.3 0.19	322 275 23.8 0.19	306 306 23.5 0.31	305 305 23.5 0.31	305 305 23.5 0.31	305 305 23.5 0.31	305 305 23.5 0.31	
105	TC SHC KW BF	345 155 27.2 0.17	328 188 26.9 0.17	301 240 26.5 0.16	281 275 26.1 0.24	280 280 26.1 0.45	350 162 27.4 0.20	332 197 27.1 0.18	305 255 26.6 0.28	288 285 26.3 0.50	288 288 26.3 0.20	353 186 27.1 0.20	336 206 27.1 0.19	336 269 26.6 0.19	308 308 26.4 0.35	295 295 26.4 0.35	295 295 26.4 0.35	295 295 26.4 0.35	295 295 26.4 0.35	
115	TC SHC KW BF	329 151 30.4 0.19	312 183 30.0 0.16	287 235 29.7 0.16	268 268 29.5 0.47	268 157 29.5 0.19	333 192 30.2 0.18	316 250 29.7 0.17	290 276 29.5 0.31	276 276 29.5 0.52	276 276 29.5 0.19	336 163 30.7 0.19	320 201 30.3 0.19	293 263 29.8 0.19	283 283 29.6 0.37	282 282 29.6 0.37	282 282 29.6 0.37	282 282 29.6 0.37	282 282 29.6 0.37	

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A027 (27 TONS) — SUBCOOLING MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM																				
	5,400					6,750					8,100					9,450					
	Evaporator Air Ewb (F)																				
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC KW BF	329 117 17.7 0.00	312 135 17.5 0.03	279 159 16.8 0.08	257 190 16.6 0.09	232 215 16.3 0.09	343 121 17.8 0.01	320 138 17.5 0.08	292 172 17.0 0.10	265 206 16.6 0.11	251 245 16.7 0.15	363 137 18.4 0.06	343 159 18.0 0.11	313 198 17.4 0.12	284 236 16.9 0.13	263 263 16.6 0.22	360 336 18.2 0.10	343 131 17.8 0.13	312 159 17.5 0.14	286 204 17.0 0.14	271 251 16.7 0.30
85	TC SHC KW BF	311 103 19.6 0.00	295 122 19.4 0.04	267 150 18.9 0.08	234 169 18.2 0.09	211 196 17.8 0.10	329 112 20.0 0.02	310 132 19.6 0.08	284 168 19.3 0.10	258 202 18.8 0.11	227 222 18.0 0.17	342 120 20.2 0.06	324 144 19.9 0.11	295 184 19.3 0.12	269 225 18.9 0.13	242 242 18.3 0.23	339 114 20.0 0.10	322 143 19.7 0.13	305 200 19.5 0.14	278 246 19.1 0.15	255 255 18.5 0.31
95	TC SHC KW BF	283 78 21.4 0.00	267 97 21.1 0.05	242 127 20.6 0.08	219 156 20.2 0.08	197 184 19.8 0.09	309 96 22.1 0.02	292 117 21.7 0.08	266 153 21.2 0.10	233 180 20.5 0.11	213 208 20.1 0.18	316 98 22.1 0.07	293 117 21.6 0.11	267 160 21.1 0.12	243 201 20.7 0.13	237 237 20.8 0.25	329 109 22.5 0.11	309 134 22.0 0.14	284 184 21.5 0.14	260 230 21.1 0.16	251 251 21.1 0.33
105	TC SHC KW BF	275 74 24.2 0.00	260 93 23.8 0.05	229 116 23.0 0.08	204 144 22.5 0.08	192 179 22.5 0.12	278 69 24.0 0.03	263 92 23.7 0.09	247 137 23.5 0.10	217 166 22.8 0.11	208 204 22.8 0.19	294 81 24.4 0.08	282 110 24.2 0.11	258 154 23.8 0.12	236 197 23.3 0.13	222 222 23.1 0.26	299 84 24.5 0.11	289 118 24.3 0.14	265 168 23.9 0.14	241 215 23.4 0.16	233 233 23.3 0.34
115	TC SHC KW BF	245 48 26.4 0.00	241 78 26.4 0.05	217 108 25.9 0.08	196 139 25.5 0.08	169 157 24.7 0.13	267 63 27.0 0.03	251 84 26.6 0.09	230 124 26.1 0.10	200 152 25.4 0.11	192 189 25.4 0.20	276 67 27.2 0.08	253 85 26.5 0.11	230 130 26.0 0.12	209 172 25.6 0.14	196 196 25.3 0.28	283 72 27.3 0.11	267 101 27.0 0.14	245 152 26.4 0.14	216 189 25.7 0.19	216 216 25.9 0.36

48/50A027 (27 TONS) — SUBCOOLING MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM															
	10,800					12,150					13,500					
	Evaporator Air Ewb (F)															
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC KW BF	368 137 18.2 0.13	351 169 18.0 0.15	332 232 17.8 0.16	302 278 17.3 0.18	284 284 16.9 0.36	375 144 18.4 0.15	359 181 18.0 0.17	338 246 17.9 0.18	311 298 17.5 0.20	302 302 17.2 0.42	393 163 18.9 0.17	374 199 18.5 0.19	343 260 18.0 0.19	315 309 17.5 0.25	303 303 17.2 0.46
85	TC SHC KW BF	346 120 20.1 0.13	329 152 19.8 0.16	302 205 19.4 0.16	284 263 19.2 0.18	276 276 19.1 0.38	351 126 20.2 0.15	340 167 20.0 0.17	317 229 19.7 0.18	288 275 19.1 0.23	288 288 20.2 0.43	356 131 20.0 0.18	340 170 20.0 0.19	312 233 19.5 0.19	288 283 19.1 0.27	286 286 19.1 0.47
95	TC SHC KW BF	328 107 22.2 0.13	317 144 22.1 0.16	290 198 21.7 0.16	267 247 21.3 0.20	250 250 20.8 0.39	342 121 22.8 0.16	324 155 22.3 0.17	295 252 21.7 0.18	264 269 21.1 0.24	269 125 21.3 0.44	345 164 22.7 0.18	329 164 22.4 0.18	300 225 21.8 0.19	270 265 21.2 0.28	278 278 21.5 0.49
105	TC SHC KW BF	310 94 24.8 0.14	295 127 24.5 0.16	262 174 23.7 0.16	240 221 23.3 0.22	244 244 23.5 0.40	306 90 24.6 0.16	301 137 24.6 0.17	274 194 23.7 0.18	255 244 23.7 0.26	242 242 23.3 0.45	310 95 24.7 0.18	295 135 24.4 0.19	271 201 24.4 0.19	257 255 23.7 0.29	250 250 23.5 0.50
115	TC SHC KW BF	288 77 27.4 0.14	273 110 27.1 0.16	242 158 26.3 0.16	222 204 25.8 0.23	226 226 26.1 0.42	295 84 27.7 0.16	277 117 27.1 0.17	253 178 26.6 0.18	237 228 26.3 0.27	234 234 26.3 0.47	296 86 27.6 0.18	281 126 27.3 0.19	257 191 26.7 0.20	241 241 26.4 0.30	241 241 26.4 0.51

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

50A027 (27 TONS) — HOT GAS REHEAT MODE

Temp (F) Air Entering Condenser (Edb)	Air Entering Evaporator — Ewb (F)														
	75 Dry Bulb							75 Dry Bulb							
	62.5 Wet Bulb (50% RH)							65.3 Wet Bulb (60% RH)							
	Air Entering Evaporator — SCFM														
	5,400	6,750	8,100	9,450	10,800	12,150	13,500	5,400	6,750	8,100	9,450	10,800	12,150	13,500	
40	TC SHC kW BF	73 -18 18.8 0.05	84 -6 17.7 0.07	91 7 17.0 0.08	97 18 16.7 0.10	101 29 16.4 0.11	104 41 16.3 0.13	106 51 16.1 0.14	77 -42 19.9 0.04	89 -33 18.6 0.06	97 -25 17.8 0.08	103 -16 17.4 0.10	107 -9 17.1 0.11	110 -1 16.9 0.13	113 8 16.7 0.14
50	TC SHC kW BF	67 -22 19.3 0.05	77 -9 18.2 0.07	84 2 17.5 0.08	89 14 17.2 0.10	92 25 16.9 0.11	95 36 16.7 0.13	97 47 16.6 0.14	71 -46 20.4 0.04	82 -37 19.1 0.06	89 -29 18.3 0.08	94 -21 17.9 0.10	98 -13 17.6 0.11	101 -5 17.3 0.13	104 3 17.2 0.14
60	TC SHC kW BF	62 -25 19.9 0.05	72 -13 18.7 0.07	78 -1 18.0 0.08	82 10 17.7 0.10	85 21 17.4 0.11	87 32 17.2 0.13	89 43 17.1 0.14	66 -49 20.9 0.04	76 -41 19.6 0.06	82 -33 18.8 0.08	87 -25 18.4 0.10	90 -17 18.1 0.11	93 -9 17.8 0.13	95 -1 17.7 0.14
70	TC SHC kW BF	57 -28 20.5 0.05	66 -16 19.3 0.07	71 -5 18.6 0.08	75 6 18.2 0.10	78 17 18.0 0.11	80 28 17.8 0.13	81 39 17.6 0.14	60 -53 17.6 0.04	69 -44 21.6 0.06	75 -36 20.2 0.08	79 -28 19.4 0.10	82 -21 18.9 0.11	85 -13 18.6 0.13	87 -5 18.4 0.14
75	TC SHC kW BF	54 -30 20.9 0.05	63 -18 19.6 0.07	69 -6 18.9 0.08	72 5 18.5 0.10	75 16 18.3 0.11	77 27 18.1 0.13	79 37 17.9 0.14	57 -54 17.9 0.04	67 -46 21.9 0.06	73 -38 20.5 0.08	77 -30 19.7 0.10	79 -22 19.2 0.11	82 -15 18.9 0.13	83 -7 18.7 0.14
80	TC SHC kW BF	52 -31 21.2 0.05	61 -19 20.0 0.07	66 -8 19.3 0.08	70 3 18.9 0.10	72 14 18.6 0.11	74 25 18.4 0.13	76 36 18.2 0.14	55 -55 18.2 0.04	64 -47 22.2 0.06	70 -39 20.8 0.08	74 -31 20.0 0.10	77 -24 19.6 0.11	79 -16 19.2 0.13	80 -8 19.0 0.14

50A027 (27 TONS) — HOT GAS REHEAT MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Air Entering Evaporator — Ewb (F)														
	75 Dry Bulb							75 Dry Bulb							
	68.0 Wet Bulb (70% RH)							70.5 Wet Bulb (80% RH)							
	Air Entering Evaporator — SCFM														
	5,400	6,750	8,100	9,450	10,800	12,150	13,500	5,400	6,750	8,100	9,450	10,800	12,150	13,500	
40	TC SHC kW BF	81 -66 21.0 0.02	94 -61 19.5 0.04	103 -56 18.7 0.07	109 -51 18.1 0.09	113 -46 0.11	117 -41 0.12	120 -36 0.14	85 -89 0.00	99 -87 0.01	108 -85 0.03	114 -83 0.06	119 -81 0.08	123 -79 0.11	126 -77 0.13
50	TC SHC kW BF	75 -70 21.6 0.02	86 -65 20.0 0.05	94 -60 19.1 0.07	100 -55 0.09	104 -50 0.11	108 -45 0.12	110 -40 0.14	78 -93 0.00	91 -91 0.01	99 -89 0.03	105 -87 0.06	110 -86 0.09	113 -83 0.11	116 -81 0.13
60	TC SHC kW BF	69 -73 22.1 0.02	79 -69 20.6 0.05	87 -64 19.7 0.07	92 -59 0.09	96 -54 0.11	99 -49 0.13	101 -44 0.14	72 -97 0.00	84 -95 0.01	92 -93 0.03	97 -91 0.07	101 -89 0.09	105 -87 0.11	107 -85 0.13
70	TC SHC kW BF	63 -76 22.7 0.02	73 -72 21.1 0.05	79 -67 20.2 0.07	84 -63 0.09	88 -58 0.11	91 -53 0.13	93 -48 0.14	66 -99 0.00	77 -98 0.01	84 -97 0.04	90 -95 0.07	94 -93 0.09	97 -91 0.11	99 -89 0.13
75	TC SHC kW BF	60 -78 23.0 0.02	70 -73 21.4 0.05	77 -69 20.5 0.07	81 -64 0.09	84 -60 0.11	87 -55 0.13	89 -50 0.14	63 -101 0.00	74 -100 0.01	80 -98 0.04	85 -97 0.07	89 -95 0.09	92 -93 0.11	94 -91 0.13
80	TC SHC kW BF	58 -80 23.4 0.02	68 -75 21.8 0.05	74 -70 20.9 0.07	78 -66 20.3 0.09	81 -61 0.11	83 -56 0.13	85 -52 0.14	60 -103 0.00	71 -101 0.01	78 -100 0.04	82 -98 0.07	86 -97 0.09	88 -95 0.12	91 -93 0.13

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A030 (30 TONS) — STANDARD MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm																				
	6,000					7,500					9,000					10,500					
	Evaporator Air — Ewb (F)																				
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC kW BF	370 151 20.2 0.00	354 169 19.9 0.00	325 203 19.5 0.12	298 234 19.2 0.10	272 263 18.8 0.10	389 157 20.6 0.00	371 184 20.3 0.19	342 224 19.8 0.12	314 262 19.4 0.11	293 287 18.9 0.20	401 167 20.9 0.13	384 196 20.6 0.16	354 243 20.1 0.13	325 288 19.6 0.12	309 309 19.3 0.13	411 211 20.7 0.22	392 208 20.2 0.16	362 261 19.8 0.14	334 311 19.5 0.14	323 323 19.5 0.34
85	TC SHC kW BF	362 147 22.8 0.00	345 166 22.5 0.00	316 199 22.1 0.12	288 230 21.8 0.09	263 257 21.4 0.10	379 154 23.2 0.00	361 180 22.9 0.17	332 219 22.5 0.12	303 257 22.1 0.11	276 276 21.6 0.13	391 164 23.5 0.26	373 193 23.2 0.16	343 238 22.7 0.13	314 282 22.3 0.12	300 300 22.0 0.28	400 172 23.4 0.21	381 204 22.9 0.16	351 256 22.4 0.14	322 305 22.2 0.35	315 315 22.2 0.35
95	TC SHC kW BF	351 143 25.7 0.00	334 162 25.5 0.10	305 194 25.1 0.11	278 225 25.1 0.09	255 250 24.7 0.12	367 151 26.1 0.00	349 176 25.9 0.16	320 214 25.5 0.12	292 252 25.3 0.10	274 274 25.0 0.21	379 160 26.4 0.23	360 188 26.2 0.15	330 233 25.8 0.13	302 277 25.4 0.12	291 291 26.7 0.30	387 168 26.3 0.19	368 200 25.9 0.14	338 251 25.4 0.15	310 298 25.3 0.37	305 305 25.3 0.37
105	TC SHC kW BF	339 138 29.0 0.00	322 157 28.9 0.20	293 189 29.0 0.11	267 219 29.3 0.09	247 242 28.7 0.15	353 147 0.13	336 171 0.15	307 209 0.15	280 246 0.11	265 265 0.24	364 155 0.20	346 183 0.20	317 228 0.12	290 271 0.33	281 281 0.18	372 163 0.14	353 246 0.14	324 246 0.16	297 294 0.40	294 294 0.40
115	TC SHC kW BF	326 132 32.8 0.00	309 153 33.1 0.16	281 184 33.8 0.10	256 214 34.3 0.08	237 235 34.3 0.09	339 142 0.13	322 166 0.11	294 204 0.10	268 241 0.26	256 256 0.18	349 150 0.18	331 178 0.13	303 222 0.12	277 264 0.13	271 271 0.35	356 158 0.14	338 240 0.14	309 280 0.13	286 283 0.19	283 283 0.42

48/50A030 (30 TONS) — STANDARD MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm																			
	12,000					13,500					15,000									
	Evaporator Air — Ewb (F)																			
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57
75	TC SHC kW BF	419 183 21.3 0.20	399 219 20.9 0.16	369 278 20.4 0.15	340 330 19.9 0.17	336 336 19.7 0.40	426 191 21.4 0.20	406 229 21.0 0.18	374 294 20.5 0.16	347 343 19.9 0.22	346 346 19.9 0.45	430 198 21.5 0.20	411 240 21.1 0.18	379 310 20.6 0.17	356 351 20.1 0.28	354 354 20.1 0.49	354 354 20.1 0.49	354 354 20.1 0.49	354 354 20.1 0.49	354 354 20.1 0.49
85	TC SHC kW BF	408 180 23.9 0.19	388 215 23.5 0.16	357 273 23.0 0.15	329 322 22.5 0.19	326 326 22.4 0.41	414 187 24.0 0.19	394 226 23.7 0.17	362 290 23.1 0.16	338 331 22.6 0.26	336 336 22.6 0.46	418 194 24.1 0.19	398 236 23.8 0.18	366 305 23.2 0.17	344 337 22.7 0.28	345 345 22.7 0.50	345 345 22.7 0.50	345 345 22.7 0.50	345 345 22.7 0.50	345 345 22.7 0.50
95	TC SHC kW BF	394 175 26.9 0.18	375 211 26.6 0.16	344 268 26.0 0.15	318 312 25.4 0.21	316 316 25.5 0.43	399 182 27.0 0.18	380 221 26.7 0.17	348 284 26.1 0.16	328 320 25.6 0.28	326 326 25.6 0.48	403 189 27.2 0.19	384 231 26.8 0.18	352 300 26.2 0.17	334 334 25.8 0.31	334 334 25.8 0.52	334 334 25.8 0.52	334 334 25.8 0.52	334 334 25.8 0.52	334 334 25.8 0.52
105	TC SHC kW BF	378 170 30.3 0.17	359 205 30.0 0.16	329 262 29.6 0.15	307 301 29.0 0.24	305 305 29.2 0.45	383 177 30.5 0.18	364 215 30.1 0.17	334 278 29.6 0.16	314 314 29.3 0.28	314 314 29.3 0.50	387 184 30.7 0.18	367 225 30.2 0.18	337 294 29.7 0.17	322 322 29.4 0.34	322 322 29.4 0.54	322 322 29.4 0.54	322 322 29.4 0.54	322 322 29.4 0.54	
115	TC SHC kW BF	361 165 34.4 0.17	343 200 34.2 0.16	314 257 33.9 0.15	295 290 33.4 0.26	293 293 33.6 0.47	366 172 34.7 0.17	347 210 34.3 0.17	318 272 33.9 0.16	302 302 33.6 0.31	302 302 33.6 0.52	369 179 34.9 0.18	351 220 34.4 0.18	321 288 34.4 0.18	310 310 34.4 0.36	309 309 34.4 0.56	309 309 34.4 0.56	309 309 34.4 0.56	309 309 34.4 0.56	

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A030 (30 TONS) — SUBCOOLING MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM																				
	6,000				7,500				9,000				10,500								
	Evaporator Air Ewb (F)																				
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC	347	329	302	276	248	360	342	314	292	265	373	355	329	304	285	387	367	337	313	298
	SHC	126	146	178	208	234	132	155	193	235	260	140	167	215	260	285	152	181	231	282	298
	kW	19.8	19.4	18.9	18.5	18.1	20.1	19.7	19.2	18.8	18.3	20.3	20.0	19.4	19.0	18.7	20.6	20.2	19.6	19.1	18.9
	BF	0.00	0.05	0.09	0.10	0.11	0.02	0.09	0.11	0.12	0.17	0.08	0.12	0.14	0.14	0.25	0.12	0.15	0.16	0.17	0.33
85	TC	326	309	285	262	239	345	322	301	277	251	354	337	311	287	271	365	347	318	295	285
	SHC	109	130	164	197	226	121	139	183	223	247	126	153	200	246	271	135	165	215	267	285
	kW	22.0	21.6	21.2	20.8	20.5	22.3	21.9	21.4	21.0	20.6	22.5	22.2	21.6	21.2	21.0	22.7	22.4	21.8	21.3	21.2
	BF	0.00	0.05	0.09	0.09	0.11	0.03	0.10	0.11	0.12	0.18	0.08	0.12	0.14	0.14	0.27	0.12	0.15	0.16	0.17	0.34
95	TC	309	294	267	243	224	325	308	282	259	242	335	319	293	270	252	343	327	300	276	269
	SHC	97	118	149	182	214	105	129	168	209	239	112	140	186	232	252	119	150	202	251	269
	kW	24.6	24.2	23.8	23.4	23.1	24.9	24.5	24.0	23.6	23.4	25.1	24.7	24.2	23.8	23.5	25.3	24.9	24.3	23.9	23.8
	BF	0.00	0.06	0.09	0.09	0.11	0.04	0.10	0.11	0.12	0.19	0.09	0.13	0.14	0.14	0.28	0.12	0.15	0.16	0.17	0.35
105	TC	295	257	236	228	210	305	278	264	242	227	315	295	274	252	241	323	307	284	259	253
	SHC	87	86	122	170	201	90	103	155	195	225	97	121	172	219	241	104	135	191	239	253
	kW	27.6	26.9	26.5	26.4	26.3	27.8	27.3	27.0	26.6	26.4	28.0	27.6	27.2	26.8	26.6	28.2	27.8	27.3	26.9	26.8
	BF	0.00	0.06	0.09	0.09	0.13	0.04	0.10	0.11	0.12	0.21	0.09	0.13	0.14	0.15	0.29	0.13	0.15	0.16	0.17	0.37
115	TC	271	254	233	212	196	274	268	246	223	207	293	279	256	233	224	287	286	262	241	235
	SHC	69	88	124	157	187	66	99	141	180	207	81	111	159	203	224	73	120	174	220	235
	kW	30.9	30.6	30.3	30.0	29.9	31.0	30.8	30.4	30.1	29.9	31.4	31.0	30.5	30.2	30.1	31.2	31.1	30.6	30.2	30.2
	BF	0.01	0.07	0.09	0.09	0.15	0.05	0.10	0.11	0.12	0.21	0.10	0.13	0.14	0.15	0.31	0.13	0.15	0.16	0.20	0.38

48/50A030 (30 TONS) — SUBCOOLING MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM															
	12,000				13,500				15,000							
	Evaporator Air Ewb (F)															
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC	395	375	346	320	313	396	381	348	321	322	401	387	355	328	326
	SHC	159	192	248	301	313	160	202	260	311	322	166	211	277	324	326
	kW	20.8	20.4	19.8	19.3	19.1	20.8	20.5	19.8	19.3	19.3	20.9	20.6	19.9	19.4	19.4
	BF	0.14	0.17	0.18	0.20	0.39	0.17	0.19	0.19	0.24	0.45	0.19	0.21	0.28	0.49	
85	TC	369	352	324	298	296	378	357	330	309	306	379	362	334	315	312
	SHC	139	174	231	284	296	149	183	246	300	306	151	192	261	314	312
	kW	22.9	22.5	21.9	21.4	21.4	23.0	22.6	22.0	21.6	21.5	23.1	22.7	22.1	21.7	21.6
	BF	0.15	0.17	0.18	0.19	0.40	0.17	0.19	0.19	0.25	0.45	0.19	0.21	0.28	0.50	
95	TC	350	333	307	285	280	354	338	311	289	286	359	342	315	294	296
	SHC	125	159	218	270	280	130	169	233	280	286	137	178	247	294	296
	kW	25.4	25.0	24.5	24.0	24.0	25.5	25.1	24.6	24.1	24.1	25.6	25.2	24.6	24.2	24.2
	BF	0.15	0.17	0.18	0.21	0.41	0.17	0.19	0.19	0.26	0.46	0.19	0.21	0.29	0.51	
105	TC	331	315	273	266	260	337	301	294	274	271	341	321	296	278	277
	SHC	112	147	189	252	260	119	137	221	267	271	124	162	233	278	277
	kW	28.4	28.0	27.2	27.0	26.9	28.5	27.8	27.5	27.1	27.1	28.6	28.1	27.5	27.2	27.2
	BF	0.15	0.17	0.18	0.23	0.43	0.17	0.19	0.19	0.27	0.48	0.19	0.21	0.31	0.52	
115	TC	307	291	268	248	243	311	295	271	254	251	313	299	274	258	258
	SHC	94	129	190	235	243	99	138	203	248	251	104	147	217	258	258
	kW	31.7	31.3	30.7	30.3	30.3	31.8	31.4	30.8	30.4	30.4	31.9	31.4	30.8	30.5	30.5
	BF	0.15	0.17	0.17	0.24	0.44	0.18	0.19	0.19	0.28	0.49	0.20	0.21	0.32	0.53	

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

50A030 (30 TONS) — HOT GAS REHEAT MODE

Temp (F) Air Entering Condenser (Edb)		Air Entering Evaporator — Ewb (F)													
		75 Dry Bulb						75 Dry Bulb							
		62.5 Wet Bulb (50% RH)						65.3 Wet Bulb (60% RH)							
		Air Entering Evaporator — SCFM													
		6,000	7,500	9,000	10,500	12,000	13,500	15,000	6,000	7,500	9,000	10,500	12,000	13,500	15,000
40	TC SHC KW BF	138 35 17.0 0.07	148 48 16.7 0.09	154 61 16.6 0.11	159 73 16.5 0.12	164 86 16.5 0.14	167 99 16.5 0.16	169 111 16.5 0.17	145 10 17.8 0.06	155 19 17.4 0.08	162 28 17.3 0.10	168 38 17.2 0.12	172 47 17.1 0.14	176 56 17.1 0.16	179 66 17.1 0.17
50	TC SHC KW BF	133 31 17.9 0.07	142 44 17.5 0.09	149 57 17.4 0.11	153 70 17.3 0.12	157 83 17.3 0.14	159 95 17.3 0.16	161 107 17.3 0.17	139 7 18.7 0.06	149 16 18.2 0.08	156 25 18.1 0.10	161 34 18.0 0.12	165 43 17.9 0.14	168 52 17.9 0.16	170 62 17.9 0.17
60	TC SHC KW BF	127 28 18.8 0.07	136 41 18.5 0.09	142 54 18.3 0.11	147 67 18.2 0.12	150 79 18.2 0.14	153 92 18.2 0.16	155 104 18.1 0.17	133 3 19.6 0.06	143 12 19.2 0.08	150 21 19.0 0.10	154 30 18.8 0.12	158 40 18.8 0.14	161 49 18.7 0.16	163 58 18.7 0.17
70	TC SHC KW BF	120 24 19.9 0.07	129 37 19.5 0.09	135 50 19.3 0.11	140 63 19.2 0.12	143 75 19.2 0.14	145 88 19.1 0.16	147 100 19.1 0.17	127 0 20.7 0.06	136 9 20.2 0.08	143 18 20.0 0.10	147 27 19.8 0.12	151 36 19.8 0.14	153 45 19.7 0.16	155 54 19.7 0.17
75	TC SHC KW BF	117 22 20.5 0.07	126 35 20.1 0.09	132 48 19.9 0.11	136 61 19.8 0.12	139 74 19.7 0.14	142 86 19.7 0.16	143 98 19.7 0.17	124 21.3 20.8 0.06	133 7 20.5 0.08	139 16 20.5 0.10	143 25 20.4 0.12	147 34 20.4 0.14	149 43 20.3 0.16	151 52 20.2 0.17
80	TC SHC KW BF	114 20 21.1 0.07	123 33 20.7 0.09	128 46 20.5 0.11	133 59 20.4 0.12	136 72 20.3 0.14	138 84 20.3 0.16	139 96 20.3 0.17	120 -4 21.9 0.06	129 5 21.4 0.08	135 14 21.4 0.10	140 23 21.1 0.12	143 32 21.0 0.14	145 41 20.9 0.16	147 51 20.8 0.17

50A030 (30 TONS) — HOT GAS REHEAT MODE (cont)

Temp (F) Air Entering Condenser (Edb)		Air Entering Evaporator — Ewb (F)													
		75 Dry Bulb						75 Dry Bulb							
		68.0 Wet Bulb (70% RH)						70.5 Wet Bulb (80% RH)							
		Air Entering Evaporator — SCFM													
		6,000	7,500	9,000	10,500	12,000	13,500	15,000	6,000	7,500	9,000	10,500	12,000	13,500	15,000
40	TC SHC KW BF	151 -14 18.6 0.02	162 -9 18.2 0.06	170 -3 18.0 0.09	176 2 17.8 0.12	181 8 17.8 0.14	185 14 17.7 0.16	188 20 17.7 0.17	158 -38 0.00	170 -35 0.00	178 -33 0.04	184 -31 0.08	189 -28 0.11	193 -25 0.14	196 -22 0.16
50	TC SHC KW BF	146 -17 19.5 0.02	156 -12 19.0 0.06	163 -7 18.7 0.09	169 -1 18.6 0.12	173 4 18.5 0.14	176 10 18.5 0.16	179 16 18.4 0.17	152 -41 0.00	163 -37 0.00	171 -37 0.05	176 -34 0.09	181 -32 0.11	184 -29 0.14	187 -26 0.16
60	TC SHC KW BF	140 -21 20.4 0.03	150 -16 19.9 0.07	157 -10 19.6 0.09	162 -5 19.5 0.12	166 1 19.4 0.14	169 7 19.3 0.16	171 13 19.3 0.17	146 -44 0.00	156 -42 0.00	164 -40 0.05	169 -38 0.09	173 -35 0.12	176 -33 0.14	179 -30 0.16
70	TC SHC KW BF	133 -24 21.5 0.03	143 -19 20.9 0.07	150 -14 20.6 0.09	155 -8 20.5 0.12	158 -3 20.4 0.14	161 3 20.3 0.16	163 9 20.2 0.17	139 -48 0.00	150 -45 0.01	157 -44 0.06	162 -41 0.09	166 -39 0.12	169 -36 0.14	171 -33 0.16
75	TC SHC KW BF	130 -26 22.1 0.04	140 -21 21.5 0.07	146 -16 21.2 0.09	151 -10 21.0 0.12	154 -5 20.9 0.14	157 1 20.8 0.16	159 7 22.9 0.17	136 -49 0.00	146 -47 0.01	153 -47 0.06	158 -43 0.09	162 -41 0.12	165 -38 0.14	167 -35 0.16
80	TC SHC KW BF	127 -28 22.7 0.04	136 -23 22.1 0.07	142 -18 21.8 0.10	147 -12 21.6 0.12	150 -6 21.5 0.14	153 -1 21.4 0.16	155 5 21.4 0.17	132 -51 0.00	142 -49 0.02	149 -47 0.06	154 -45 0.09	158 -43 0.12	161 -40 0.14	163 -37 0.16

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A035 (35 TONS) — STANDARD MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm																				
	7,000				8,750				10,500				12,250								
	Evaporator Air — Ewb (F)																				
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC KW BF	442 179 24.8 0.00	423 206 24.3 0.00	394 250 23.6 0.00	366 291 23.2 0.01	338 329 23.1 0.02	459 189 25.3 0.00	440 222 24.7 0.00	410 275 24.0 0.01	383 327 23.2 0.01	363 363 25.6 0.10	471 199 25.1 0.01	452 237 24.3 0.01	421 299 23.6 0.02	395 359 23.4 0.01	383 383 25.8 0.21	479 208 25.3 0.01	460 252 24.5 0.02	430 323 23.8 0.02	403 389 23.7 0.29	399 399 23.8 0.29
85	TC SHC KW BF	428 174 27.8 0.00	412 201 27.3 0.01	384 245 26.9 0.01	354 285 26.7 0.02	326 322 27.0 0.00	444 184 28.2 0.00	426 217 27.7 0.01	399 270 27.1 0.13	372 321 26.7 0.01	352 193 28.5 0.01	455 231 28.0 0.01	437 294 27.3 0.01	410 354 26.9 0.03	384 374 26.8 0.23	374 203 28.8 0.02	463 246 28.2 0.02	444 318 27.5 0.02	417 384 27.0 0.05	393 389 26.9 0.31	
95	TC SHC KW BF	417 170 31.3 0.00	400 197 31.1 0.01	371 239 30.8 0.01	341 279 31.3 0.03	312 312 31.3 0.00	432 179 32.9 0.00	415 212 31.2 0.00	387 265 30.9 0.01	358 314 30.8 0.16	341 341 31.2 0.01	441 188 31.4 0.01	424 227 31.0 0.02	397 289 30.8 0.03	370 348 30.7 0.25	362 362 32.1 0.02	447 197 31.6 0.02	431 241 31.0 0.02	405 376 30.8 0.05	378 378 30.8 0.33	
105	TC SHC KW BF	403 165 35.5 0.00	385 191 35.4 0.01	356 232 36.0 0.01	325 271 37.7 0.12	308 308 39.3 0.00	417 174 35.7 0.01	400 207 35.5 0.01	372 258 35.5 0.02	343 307 35.5 0.19	328 328 35.9 0.01	427 184 35.5 0.01	410 222 35.3 0.02	381 283 35.8 0.03	355 340 36.1 0.28	349 349 36.0 0.02	433 193 35.6 0.02	417 236 35.3 0.02	389 365 35.5 0.35		
115	TC SHC KW BF	380 156 39.4 0.00	364 182 39.7 0.01	337 224 40.9 —	— — —	391 165 39.5 0.00	376 198 39.5 0.01	351 250 40.1 0.01	— — —	— — —	398 174 39.5 0.01	384 213 39.4 0.01	360 274 39.8 0.02	335 330 40.9 0.04	332 332 41.1 0.31	403 183 39.6 0.01	389 227 39.4 0.02	366 298 40.2 0.02	347 347 40.2 0.39		

48/50A035 (35 TONS) — STANDARD MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm															
	14,000				15,750				17,500							
	Evaporator Air — Ewb (F)															
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC KW BF	485 217 26.0 0.02	466 266 25.5 0.02	436 347 24.7 0.03	412 411 24.0 0.09	411 411 24.0 0.36	490 226 26.1 0.03	471 281 25.6 0.03	442 369 24.8 0.04	422 422 24.3 0.17	422 422 24.3 0.42	— — — 0.04	475 295 25.7 0.05	446 391 24.9 0.23	432 432 24.5 0.23	432 432 24.5 0.46
85	TC SHC KW BF	469 212 29.0 0.02	451 261 28.4 0.02	422 341 27.6 0.03	402 402 27.1 0.11	401 — 0.38	— — —	455 275 28.6 0.03	426 363 27.7 0.04	411 411 0.19	411 411 0.43	— — —	459 290 28.7 0.05	431 384 27.8 0.26	419 419 27.5 0.48	
95	TC SHC KW BF	— — — —	436 256 31.7 0.02	410 336 31.1 0.03	391 391 30.9 0.13	390 390 30.9 0.39	— — — —	439 270 31.8 0.03	414 358 31.2 0.04	401 401 0.21	400 400 0.45	— — —	443 284 31.9 0.04	418 379 31.3 0.06	409 409 31.1 0.27	408 408 31.1 0.49
105	TC SHC KW BF	— — — —	421 251 35.7 0.03	394 330 35.3 0.03	377 377 35.3 0.16	377 377 0.42	— — — —	425 265 35.7 0.03	399 352 35.3 0.04	387 387 0.24	386 386 0.47	— — —	428 279 35.8 0.04	403 373 35.3 0.06	395 395 35.3 0.30	395 395 35.3 0.51
115	TC SHC KW BF	— — — —	393 242 39.4 0.02	371 321 39.4 0.03	358 358 39.7 0.21	358 358 0.45	— — —	396 256 39.5 0.03	375 342 39.4 0.05	367 367 0.28	367 367 0.49	— — —	399 270 39.5 0.04	378 362 39.3 0.07	374 374 39.4 0.34	374 374 39.4 0.54

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A035 (35 TONS) — SUBCOOLING MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM																				
	7,000					8,750					10,500					12,250					
	Evaporator Air Ewb (F)																				
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC KW BF	413 132 23.6 0.00	378 145 23.0 0.00	346 188 22.8 0.02	305 220 22.3 0.02	268 249 22.0 0.03	417 125 23.7 0.00	409 171 23.5 0.02	369 216 23.0 0.02	329 259 22.6 0.03	286 282 21.7 0.09	450 153 24.1 0.02	404 166 23.4 0.03	385 242 23.2 0.03	346 22.2 22.7 0.04	318 161 23.9 0.18	460 199 23.2 0.04	433 260 22.9 0.04	389 327 22.8 0.06	360 327 22.8 0.27	345 345 22.8 0.27
85	TC SHC KW BF	373 96 25.9 0.00	356 126 25.8 0.01	316 161 25.3 0.02	277 194 24.7 0.02	240 224 24.7 0.03	397 109 0.00	353 119 0.02	337 187 0.02	288 221 0.03	257 254 24.2 0.10	393 101 26.3 0.02	386 152 26.1 0.03	351 212 25.7 0.03	314 265 25.2 0.04	291 291 24.9 0.19	402 146 26.5 0.04	377 217 26.0 0.04	343 297 25.5 0.07	327 304 25.4 0.28	304 304 24.9 0.28
95	TC SHC KW BF	347 75 29.0 0.00	324 98 28.7 0.01	285 134 28.2 0.02	246 167 27.9 0.02	200 184 26.8 0.05	344 61 0.01	320 90 0.02	303 158 0.02	267 203 0.03	222 220 0.11	355 67 0.02	329 100 0.03	297 162 0.03	280 235 0.05	263 263 0.21	361 72 0.04	337 112 28.8 0.04	303 181 28.2 0.07	292 265 27.8 0.29	272 272 27.8 0.29
105	TC SHC KW BF	306 38 32.1 0.00	281 60 31.7 0.01	253 106 31.6 0.02	214 139 31.3 0.02	182 168 31.2 0.02	307 30 0.01	278 53 0.02	269 129 0.03	234 174 0.13	206 206 0.13	314 31 0.02	313 89 0.03	249 119 0.03	247 206 0.05	231 231 0.23	319 35 0.04	296 75 32.4 0.04	284 167 31.8 0.09	259 233 31.6 0.31	250 250 31.5 0.31
115	TC SHC KW BF	281 20 36.5 0.00	249 34 35.7 0.01	221 79 35.7 0.02	173 102 34.8 0.02	143 130 34.6 0.09	291 19 0.01	242 23 0.02	226 91 0.02	201 146 0.03	165 165 0.15	272 4 0.02	251 33 0.02	219 95 0.03	213 175 0.06	172 172 0.24	275 -3 0.04	253 39 35.5 0.04	247 136 35.5 0.11	223 199 35.4 0.32	204 204 34.9 0.32

48/50A035 (35 TONS) — SUBCOOLING MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM																		
	14,000					15,750					17,500								
	Evaporator Air Ewb (F)																		
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57				
75	TC SHC KW BF	452 154 24.2 0.05	443 214 24.0 0.05	399 284 23.4 0.05	372 356 23.1 0.10	365 365 23.0 0.34	460 163 24.4 0.06	434 213 24.0 0.06	410 311 23.5 0.07	383 379 23.2 0.14	381 381 23.2 0.39	465 171 24.5 0.08	438 225 24.1 0.07	414 330 23.6 0.08	384 384 23.1 0.20	394 394 23.4 0.44			
85	TC SHC KW BF	409 115 26.6 0.05	384 159 26.2 0.05	351 240 25.7 0.05	338 323 25.5 0.11	333 333 25.5 0.35	415 123 26.8 0.06	391 175 26.3 0.06	371 276 25.9 0.07	349 345 25.7 0.15	337 337 25.4 0.40	420 131 26.9 0.08	394 185 26.4 0.07	378 299 26.1 0.08	350 350 25.6 0.21	358 358 25.9 0.45			
95	TC SHC KW BF	367 78 29.4 0.05	342 122 28.9 0.05	299 193 28.1 0.05	304 290 28.4 0.12	299 299 28.3 0.36	371 84 29.5 0.06	347 135 29.0 0.06	313 221 28.4 0.07	304 301 28.3 0.17	303 303 28.2 0.41	374 91 29.6 0.08	351 147 29.1 0.08	318 242 28.5 0.07	316 316 28.4 0.08	323 323 28.6 0.46			
105	TC SHC KW BF	320 37 32.5 0.05	299 85 32.0 0.05	291 189 31.9 0.06	260 247 31.4 0.13	254 254 31.3 0.37	325 44 32.7 0.07	302 95 32.0 0.06	268 182 31.4 0.07	278 275 31.8 0.18	275 50 31.7 0.42	328 50 32.8 0.08	305 107 32.1 0.07	262 191 31.3 0.08	287 287 31.9 0.24	281 281 31.7 0.47			
115	TC SHC KW BF	277 0 36.2 0.05	256 48 35.5 0.05	227 130 34.9 0.06	234 222 35.5 0.15	229 229 35.5 0.38	279 4 36.4 0.07	257 57 35.6 0.06	268 188 36.1 0.07	238 238 35.5 0.19	240 240 35.5 0.44	278 7 36.5 0.08	256 64 36.5 0.08	270 205 36.0 0.07	243 243 35.4 0.09	249 249 35.6 0.26	249 249 35.6 0.48		

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

50A035 (35 TONS) — HOT GAS REHEAT MODE

Temp (F) Air Entering Condenser (Edb)		Air Entering Evaporator — Ewb (F)													
		75 Dry Bulb						75 Dry Bulb							
		62.5 Wet Bulb (50% RH)						65.3 Wet Bulb (60% RH)							
		Air Entering Evaporator — SCFM													
		7,000	8,750	10,500	12,250	14,000	15,750	17,500	7,000	8,750	10,500	12,250	14,000	15,750	17,500
40	TC SHC kW BF	162 46 23.4 0.00	170 61 23.0 0.01	176 77 22.8 0.01	180 94 22.7 0.02	184 111 22.6 0.03	186 128 22.5 0.04	189 144 22.4 0.05	173 18 24.6 0.00	182 27 24.2 0.01	188 37 23.9 0.01	193 48 23.7 0.02	197 60 23.6 0.03	200 71 23.5 0.04	202 83 23.4 0.05
50	TC SHC kW BF	143 31 24.1 0.00	151 45 23.8 0.01	156 61 23.6 0.01	160 78 23.4 0.02	163 95 23.3 0.03	165 111 23.2 0.04	167 128 23.2 0.05	155 3 25.4 0.00	163 12 24.9 0.01	169 22 24.7 0.01	173 32 24.5 0.02	177 44 24.3 0.03	179 55 24.3 0.04	181 67 24.2 0.05
60	TC SHC kW BF	125 15 24.9 0.00	132 29 24.6 0.01	137 45 24.4 0.01	140 62 24.2 0.02	142 78 24.1 0.03	144 95 24.1 0.04	146 111 24.0 0.05	137 -12 26.2 0.00	144 -4 25.8 0.01	150 6 25.5 0.01	153 16 25.3 0.02	156 28 25.2 0.03	158 39 25.1 0.04	160 51 25.0 0.05
70	TC SHC kW BF	108 -1 24.8 0.01	114 14 25.5 0.01	118 29 25.3 0.02	121 46 25.1 0.03	123 62 25.0 0.03	125 79 25.0 0.04	126 95 24.9 0.05	118 -27 27.2 0.00	125 -20 26.7 0.01	129 -10 26.4 0.01	132 0 26.2 0.02	135 11 26.1 0.03	137 23 26.0 0.04	139 35 25.9 0.05
75	TC SHC kW BF	99 -7 26.4 0.00	105 6 26.0 0.01	108 21 25.8 0.01	111 38 25.6 0.02	113 54 25.5 0.03	114 71 25.4 0.04	116 87 25.4 0.05	109 -35 27.7 0.00	115 -27 27.2 0.01	119 -18 26.9 0.01	122 -8 26.7 0.02	125 4 26.6 0.03	127 15 26.5 0.04	128 27 26.4 0.05
80	TC SHC kW BF	90 -15 26.9 0.00	96 -1 26.5 0.01	99 14 26.3 0.01	101 30 26.2 0.02	103 46 26.0 0.03	104 63 26.0 0.04	106 78 25.9 0.05	100 -43 28.2 0.00	106 -35 27.7 0.01	110 -26 27.4 0.01	112 -16 27.2 0.02	115 -4 27.1 0.03	117 7 27.0 0.04	118 19 26.9 0.05

50A035 (35 TONS) — HOT GAS REHEAT MODE (cont)

Temp (F) Air Entering Condenser (Edb)		Air Entering Evaporator — Ewb (F)													
		75 Dry Bulb						75 Dry Bulb							
		68.0 Wet Bulb (70% RH)						70.5 Wet Bulb (80% RH)							
		Air Entering Evaporator — SCFM													
		7,000	8,750	10,500	12,250	14,000	15,750	17,500	7,000	8,750	10,500	12,250	14,000	15,750	17,500
40	TC SHC kW BF	184 -10 26.2 0.00	193 -8 25.6 0.01	200 -4 25.4 0.02	205 1 25.2 0.03	209 7 25.2 0.04	212 13 25.1 0.05	215 19 25.2 0.06	193 -39 0.00	204 -42 0.00	211 -44 0.01	215 -44 0.03	220 -42 0.05	222 -40 0.07	223 -38 0.09
50	TC SHC kW BF	165 -25 26.9 0.00	175 -23 26.4 0.01	181 -20 26.1 0.02	185 -15 26.0 0.03	189 -9 25.9 0.04	192 -3 25.9 0.05	195 4 25.9 0.07	175 -54 0.00	184 -58 0.00	191 -60 0.01	196 -59 0.03	201 -58 0.05	203 -56 0.07	204 -54 0.09
60	TC SHC kW BF	147 -41 27.8 0.00	155 -39 27.2 0.01	161 -35 26.9 0.02	165 -31 26.8 0.03	169 -25 26.7 0.04	172 -19 26.7 0.05	175 -12 26.7 0.07	157 -69 0.00	165 -73 0.00	172 -75 0.01	177 -75 0.03	181 -73 0.05	183 -72 0.07	184 -70 0.09
70	TC SHC kW BF	129 -56 28.7 0.00	136 -55 28.2 0.01	141 -51 27.8 0.02	145 -46 27.7 0.03	149 -41 27.6 0.04	152 -35 27.6 0.05	154 -28 27.7 0.07	138 -84 0.00	146 -89 0.00	152 -90 0.01	157 -90 0.03	160 -89 0.05	162 -88 0.07	162 -86 0.09
75	TC SHC kW BF	119 -64 29.2 0.00	126 -62 28.7 0.01	131 -59 28.3 0.02	135 -54 28.2 0.03	139 -49 28.1 0.04	141 -43 28.1 0.05	143 -36 28.1 0.07	129 -92 0.00	137 -96 0.00	142 -98 0.01	147 -98 0.03	150 -97 0.05	151 -96 0.07	152 -94 0.09
80	TC SHC kW BF	110 -71 29.7 0.00	117 -70 29.2 0.01	122 -67 28.9 0.02	125 -62 28.7 0.03	128 -57 28.6 0.04	131 -51 28.6 0.05	133 -44 28.7 0.07	119 -99 0.00	127 -104 0.00	133 -106 0.01	137 -106 0.03	139 -105 0.05	141 -104 0.07	141 -102 0.09

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A040 (40 TONS) — STANDARD MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm																			
	8,000					10,000					12,000					14,000				
	Evaporator Air — Ewb (F)																			
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57
75	TC SHC kW BF	517 235 25.9 0.00	495 284 25.5 0.00	459 330 25.0 0.06	423 371 24.7 0.04	388 216 24.3 0.05	542 253 26.3 0.00	518 313 25.9 0.10	482 370 25.4 0.06	445 408 25.0 0.05	415 228 24.5 0.13	558 270 26.6 0.15	533 341 26.2 0.08	498 408 25.6 0.06	461 24.8 26.8 0.20	439 439 24.8 0.11	570 287 26.4 0.08	546 368 25.8 0.07	509 441 25.3 0.08	473 441 25.1 0.29
85	TC SHC kW BF	503 199 29.2 0.00	481 230 28.8 0.13	446 278 28.5 0.06	410 325 28.0 0.03	376 364 27.7 0.05	525 210 29.6 0.00	504 248 28.3 0.09	467 307 28.4 0.06	431 363 28.4 0.05	405 297 27.9 0.16	541 222 29.9 0.13	519 265 29.5 0.08	483 29.0 28.6 0.06	447 400 28.3 0.23	427 427 29.7 0.10	552 233 29.2 0.08	531 362 28.7 0.07	494 434 32.5 0.08	458 448 32.5 0.31
95	TC SHC kW BF	489 193 33.0 0.00	467 224 32.6 0.10	431 272 32.3 0.05	395 317 32.0 0.04	363 356 31.7 0.06	510 205 33.4 0.10	488 242 33.1 0.08	452 301 32.6 0.05	416 356 32.3 0.15	390 217 31.8 0.11	525 260 33.7 0.08	503 328 33.4 0.06	466 414 32.9 0.25	429 228 32.5 0.10	414 276 32.1 0.08	536 355 33.5 0.07	514 425 33.0 0.09	477 434 32.6 0.33	
105	TC SHC kW BF	473 187 37.2 0.00	451 218 36.8 0.08	414 264 36.8 0.05	381 311 36.2 0.03	350 346 36.5 0.07	492 200 37.6 0.15	470 236 37.4 0.08	434 293 37.0 0.05	399 348 37.0 0.18	378 378 36.6 0.10	506 211 37.9 0.07	484 253 37.6 0.06	447 321 37.2 0.07	412 384 37.1 0.27	401 401 38.1 0.09	516 269 37.8 0.08	493 347 37.4 0.07	457 419 37.0 0.35	
115	TC SHC kW BF	453 180 42.0 0.00	432 211 41.4 0.07	397 257 42.2 0.05	364 302 42.1 0.03	337 332 41.8 0.11	471 193 42.5 0.12	450 228 42.4 0.07	415 286 42.4 0.05	381 340 42.4 0.21	364 364 42.2 0.09	483 204 42.6 0.07	462 245 42.6 0.06	427 313 42.5 0.07	394 375 42.5 0.30	386 386 42.2 0.08	492 214 42.8 0.07	472 262 42.8 0.06	436 339 42.7 0.11	405 403 42.2 0.37
120	TC SHC kW BF	442 177 44.6 0.00	422 207 44.8 0.07	389 255 44.1 0.03	354 297 45.8 0.04	330 327 45.1 0.12	460 189 45.2 0.11	440 225 45.3 0.07	405 281 45.3 0.05	372 336 45.2 0.04	356 356 45.2 0.23	473 200 45.5 0.09	451 241 45.4 0.09	417 309 45.4 0.07	384 369 45.4 0.06	378 378 45.2 0.32	481 211 45.6 0.08	460 258 45.6 0.07	425 335 45.2 0.06	395 395 45.2 0.39

48/50A040 (40 TONS) — STANDARD MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm														
	16,000					18,000					20,000				
	Evaporator Air — Ewb (F)														
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57
75	TC SHC kW BF	579 249 26.9 0.10	555 304 26.5 0.09	519 394 25.9 0.07	483 470 25.4 0.11	477 477 25.3 0.11	587 259 27.1 0.09	563 320 26.6 0.08	526 419 26.1 0.15	491 491 25.5 0.41	491 269 27.2 0.11	593 335 27.2 0.10	569 443 26.7 0.09	532 443 26.1 0.23	504 499 25.7 0.45
85	TC SHC kW BF	560 243 30.2 0.10	539 298 29.9 0.09	503 388 29.3 0.07	468 461 28.8 0.12	464 464 28.7 0.37	568 253 30.4 0.11	546 314 29.0 0.09	510 412 28.9 0.18	479 476 28.9 0.42	574 478 28.9 0.11	552 330 29.1 0.09	515 437 29.5 0.25	491 486 29.1 0.47	
95	TC SHC kW BF	543 238 34.0 0.09	522 292 33.7 0.08	485 380 33.2 0.08	451 449 32.6 0.13	450 450 32.6 0.39	551 248 34.1 0.10	528 308 33.8 0.09	492 458 33.3 0.08	465 463 32.8 0.22	463 258 34.2 0.44	556 324 33.9 0.11	534 427 33.4 0.09	497 427 33.4 0.29	477 465 32.9 0.48
105	TC SHC kW BF	523 232 38.2 0.09	501 285 38.0 0.08	464 373 37.5 0.07	435 432 36.9 0.16	434 434 37.0 0.41	529 301 38.4 0.10	507 397 38.1 0.09	470 440 37.6 0.08	447 447 37.0 0.25	534 251 37.1 0.46	512 317 38.2 0.10	475 420 37.7 0.30	459 454 37.3 0.50	
115	TC SHC kW BF	500 224 43.1 0.09	479 278 42.9 0.08	443 365 42.7 0.07	420 412 42.0 0.21	417 417 42.2 0.43	505 234 43.2 0.10	484 294 43.0 0.09	449 389 42.8 0.31	434 434 42.3 0.48	429 429 42.3 0.10	510 309 43.3 0.09	489 411 43.1 0.09	453 440 42.4 0.32	440 439 42.4 0.52
120	TC SHC kW BF	488 220 45.9 0.09	467 274 45.7 0.08	432 361 45.5 0.07	412 404 44.4 0.23	408 408 45.2 0.45	493 230 46.0 0.10	473 290 45.8 0.09	437 384 45.7 0.33	425 425 45.2 0.49	420 420 45.2 0.10	497 420 45.9 0.10	477 406 45.9 0.09	442 430 45.6 0.10	430 430 45.2 0.33

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A040 (40 TONS) — SUBCOOLING MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM																				
	8,000				10,000				12,000				14,000								
	Evaporator Air Ewb (F)																				
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC	501	473	429	379	352	528	499	455	403	374	549	519	474	420	387	562	534	488	446	408
	SHC	189	214	253	281	327	202	231	281	319	368	214	249	307	352	387	224	265	331	395	408
	kW	26.5	26.1	25.7	24.9	25.0	26.8	26.4	25.9	25.2	25.1	27.1	26.7	26.2	25.4	25.0	27.3	26.9	26.3	26.0	25.3
	BF	0.00	0.07	0.09	0.09	0.10	0.07	0.10	0.11	0.11	0.14	0.10	0.12	0.13	0.22	0.12	0.13	0.14	0.15	0.16	0.30
85	TC	478	444	410	369	330	497	477	422	382	344	523	492	440	397	363	527	498	462	424	383
	SHC	172	190	239	276	309	177	215	253	302	338	195	229	279	334	363	196	236	311	378	383
	kW	29.4	28.9	28.9	28.4	27.9	29.5	29.4	28.6	28.2	27.9	30.0	29.6	28.9	28.4	28.1	30.1	29.7	29.2	29.1	28.2
	BF	0.00	0.07	0.09	0.09	0.11	0.07	0.10	0.11	0.11	0.16	0.10	0.12	0.13	0.24	0.12	0.13	0.14	0.16	0.17	0.32
95	TC	442	416	375	348	310	476	451	398	358	332	484	457	426	386	344	506	480	437	395	363
	SHC	142	168	209	259	292	164	196	235	284	326	164	201	271	328	344	184	226	293	354	363
	kW	32.6	32.3	31.9	31.9	31.6	33.1	32.9	32.1	31.7	31.7	33.1	32.8	32.6	32.3	31.7	33.5	33.2	32.7	32.3	31.8
	BF	0.02	0.07	0.09	0.09	0.11	0.08	0.10	0.11	0.11	0.18	0.11	0.12	0.13	0.25	0.13	0.13	0.14	0.16	0.17	0.33
105	TC	415	402	363	314	288	438	413	384	347	316	464	439	400	361	325	467	449	410	374	342
	SHC	122	160	203	231	275	133	165	227	278	311	153	190	252	309	325	153	202	274	338	342
	kW	36.6	36.7	36.4	35.9	35.9	36.8	36.6	36.5	36.4	36.2	37.2	37.0	36.7	36.4	36.0	37.2	37.1	36.8	36.5	36.1
	BF	0.03	0.08	0.09	0.09	0.11	0.08	0.10	0.11	0.19	0.11	0.12	0.12	0.14	0.27	0.13	0.13	0.14	0.16	0.17	0.34
115	TC	388	376	339	304	273	410	394	356	311	295	433	410	371	324	303	445	421	383	334	330
	SHC	103	141	184	226	260	113	154	207	247	291	130	169	231	277	303	140	183	254	303	330
	kW	41.2	41.5	41.4	41.4	41.5	41.4	41.5	41.4	40.9	41.3	41.8	41.6	41.4	41.0	40.9	41.9	41.7	41.6	41.0	41.4
	BF	0.03	0.08	0.09	0.09	0.13	0.08	0.10	0.10	0.11	0.21	0.11	0.12	0.12	0.14	0.29	0.13	0.13	0.14	0.17	0.36

48/50A040 (40 TONS) — SUBCOOLING MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM															
	16,000				18,000				20,000							
	Evaporator Air Ewb (F)															
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC	568	537	490	445	416	583	553	509	465	452	591	554	516	469	464
	SHC	228	272	345	410	416	243	293	377	445	452	252	300	400	465	464
	kW	27.4	26.9	26.3	25.7	25.4	27.6	27.2	26.6	26.1	25.9	27.7	27.2	26.8	26.0	26.0
	BF	0.14	0.15	0.15	0.18	0.37	0.15	0.16	0.17	0.21	0.42	0.17	0.18	0.24	0.47	
85	TC	539	509	463	421	405	553	519	469	439	433	561	531	478	46	444
	SHC	206	251	325	391	405	222	266	345	422	433	231	285	368	45	444
	kW	30.2	29.8	29.2	28.7	28.5	30.5	29.9	29.2	29.1	30.6	30.1	29.4	29.2	29.2	
	BF	0.14	0.15	0.15	0.18	0.38	0.16	0.16	0.17	0.22	0.43	0.17	0.18	0.25	0.48	
95	TC	515	489	448	409	394	517	488	455	404	409	525	495	449	424	425
	SHC	192	239	317	384	394	194	244	338	394	409	204	257	347	423	425
	kW	33.6	33.3	32.9	32.6	32.4	33.7	33.2	32.9	32.2	32.5	33.8	33.3	32.7	32.7	32.9
	BF	0.14	0.15	0.15	0.19	0.39	0.16	0.16	0.17	0.22	0.44	0.17	0.18	0.26	0.49	
105	TC	484	460	420	369	359	488	464	426	384	385	491	471	431	399	396
	SHC	169	218	297	351	359	175	229	318	374	385	179	243	337	399	396
	kW	37.5	37.2	36.9	36.2	36.1	37.5	37.2	37.0	36.4	36.6	37.5	37.3	37.0	36.8	36.7
	BF	0.14	0.15	0.15	0.19	0.41	0.16	0.16	0.17	0.24	0.46	0.17	0.18	0.28	0.50	
115	TC	445	429	390	357	335	458	435	397	365	355	464	432	401	375	366
	SHC	139	195	275	339	335	153	208	296	356	355	161	212	314	375	366
	kW	41.8	41.8	41.6	41.5	40.9	42.0	41.8	41.6	41.5	41.4	42.1	41.7	41.7	41.6	41.4
	BF	0.14	0.15	0.15	0.21	0.42	0.16	0.16	0.17	0.26	0.47	0.17	0.18	0.29	0.51	

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

50A040 (40 TONS) — HOT GAS REHEAT MODE

Temp (F) Air Entering Condenser (Edb)	Air Entering Evaporator — Ewb (F)													
	75 Dry Bulb							75 Dry Bulb						
	62.5 Wet Bulb (50% RH)							65.3 Wet Bulb (60% RH)						
	Air Entering Evaporator — SCFM													
	8,000	10,000	12,000	14,000	16,000	18,000	20,000	8,000	10,000	12,000	14,000	16,000	18,000	20,000
40	TC SHC KW BF	243 100 23.4 0.06	259 118 23.3 0.08	269 136 23.3 0.10	277 153 23.3 0.11	283 171 23.3 0.13	288 188 23.3 0.15	291 205 24.4 0.05	259 73 24.2 0.07	275 85 24.1 0.10	286 97 24.0 0.11	294 110 24.0 0.13	300 122 24.0 0.15	305 135 24.0 0.16
50	TC SHC KW BF	224 84 24.3 0.06	239 101 24.2 0.08	249 119 24.2 0.10	256 137 24.2 0.11	262 154 24.2 0.13	266 172 24.2 0.14	270 189 24.2 0.16	240 57 25.3 0.05	255 69 25.1 0.07	265 81 25.0 0.09	273 93 24.9 0.11	278 106 24.9 0.13	283 119 24.9 0.15
60	TC SHC KW BF	204 67 25.4 0.06	217 84 25.2 0.08	227 102 25.2 0.09	234 120 25.1 0.11	239 137 25.1 0.13	243 155 25.1 0.14	247 172 25.1 0.16	219 40 26.4 0.05	233 52 26.1 0.07	243 64 26.0 0.09	250 76 25.9 0.11	256 89 25.9 0.13	260 102 25.8 0.15
70	TC SHC KW BF	184 51 26.5 0.06	196 67 26.4 0.08	205 85 26.3 0.09	211 102 26.2 0.11	216 120 26.2 0.13	220 137 26.2 0.14	223 154 26.2 0.16	198 23 27.5 0.05	211 34 27.2 0.07	220 47 27.1 0.09	227 59 27.0 0.11	232 72 27.0 0.13	235 84 26.9 0.14
75	TC SHC KW BF	175 42 27.2 0.06	186 59 27.0 0.08	194 76 26.9 0.09	200 94 26.9 0.11	204 111 26.8 0.13	208 128 26.8 0.14	211 145 26.8 0.16	188 15 28.2 0.05	200 26 27.9 0.07	209 38 27.7 0.09	215 50 27.6 0.11	220 63 27.6 0.13	223 76 27.5 0.14
80	TC SHC KW BF	165 34 27.9 0.06	176 51 27.7 0.08	183 68 27.6 0.09	188 85 27.5 0.11	193 102 27.5 0.13	196 120 27.5 0.14	199 136 27.5 0.16	178 6 28.8 0.05	189 17 28.5 0.07	197 29 28.5 0.09	203 42 28.4 0.11	208 54 28.3 0.13	211 67 28.2 0.14

50A040 (40 TONS) — HOT GAS REHEAT MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Air Entering Evaporator — Ewb (F)													
	75 Dry Bulb							75 Dry Bulb						
	68.0 Wet Bulb (70% RH)							70.5 Wet Bulb (80% RH)						
	Air Entering Evaporator — SCFM													
	8,000	10,000	12,000	14,000	16,000	18,000	20,000	8,000	10,000	12,000	14,000	16,000	18,000	20,000
40	TC SHC KW BF	275 47 25.5 0.02	291 53 25.1 0.05	302 60 25.0 0.08	310 68 24.9 0.10	316 76 24.8 0.13	321 84 24.8 0.14	325 92 24.7 0.16	290 20 26.5 0.00	305 23 26.1 0.00	316 26 25.8 0.02	324 29 25.7 0.06	331 33 25.6 0.09	335 37 25.5 0.11
50	TC SHC KW BF	255 30 26.4 0.02	271 37 26.0 0.05	281 44 25.8 0.08	289 51 25.7 0.10	295 59 25.6 0.12	299 67 25.6 0.14	303 76 25.5 0.16	270 5 27.4 0.00	286 7 26.9 0.00	296 10 26.7 0.02	304 13 26.7 0.06	310 17 26.5 0.09	315 21 26.4 0.11
60	TC SHC KW BF	235 14 27.4 0.02	249 20 27.0 0.05	259 27 26.8 0.08	266 34 26.7 0.10	272 42 26.6 0.12	276 51 26.5 0.14	279 59 26.5 0.16	249 -12 28.4 0.00	264 -10 27.9 0.00	274 -7 27.6 0.03	281 -4 27.4 0.06	287 0 27.3 0.09	291 4 27.2 0.11
70	TC SHC KW BF	213 -4 28.5 0.02	227 3 28.1 0.05	236 10 27.9 0.08	243 17 27.8 0.10	248 25 27.7 0.12	252 33 27.6 0.14	255 42 27.6 0.16	227 -29 29.6 0.00	241 -27 29.0 0.00	251 -24 28.7 0.03	257 -21 28.5 0.06	263 -17 28.4 0.09	267 -9 28.3 0.11
75	TC SHC KW BF	202 -12 29.2 0.02	215 -6 28.8 0.05	224 1 28.5 0.08	231 8 28.4 0.10	235 16 28.3 0.12	239 25 28.2 0.14	242 33 28.2 0.16	216 -38 28.8 0.00	230 -36 30.2 0.00	239 -33 29.7 0.03	245 -30 29.3 0.06	250 -26 29.1 0.09	254 -22 28.9 0.11
80	TC SHC KW BF	191 -21 29.8 0.02	203 -15 29.4 0.05	212 -8 29.2 0.08	218 0 29.0 0.10	223 8 28.9 0.12	226 16 28.9 0.14	229 24 28.8 0.16	205 -46 28.8 0.00	218 -45 30.9 0.00	227 -42 30.3 0.03	233 -39 30.0 0.06	238 -35 29.8 0.09	241 -31 29.7 0.11

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A050 (50 TONS) — STANDARD MODE

Temp (F) Air Entering Condenser (Edb)		Evaporator Air Quantity — Cfm														
		10,000					12,500					15,000				
		Evaporator Air — Ewb (F)														
75	TC SHC kW BF	636 255 31.3 0.00	602 287 30.7 0.07	545 340 29.9 0.06	495 391 29.2 0.04	450 438 28.5 0.05	669 271 31.8 0.00	633 314 31.2 0.10	575 379 30.3 0.06	525 443 29.6 0.05	489 482 29.0 0.16	692 289 32.2 0.18	658 338 31.6 0.09	602 418 30.8 0.06	550 493 30.1 0.06	523 523 29.6 0.23
85	TC SHC kW BF	611 237 34.6 0.00	574 270 33.9 0.17	524 322 33.3 0.06	476 371 32.8 0.04	432 413 32.2 0.06	639 253 35.0 0.00	605 293 34.5 0.09	553 357 33.8 0.05	504 417 33.2 0.05	471 450 32.6 0.17	662 266 35.4 0.15	628 312 34.9 0.08	576 387 34.2 0.06	525 456 33.6 0.06	503 481 33.1 0.25
95	TC SHC kW BF	584 227 38.4 0.00	553 261 38.0 0.13	502 315 37.5 0.05	454 365 37.4 0.04	411 408 36.8 0.07	613 246 38.9 0.08	581 287 38.5 0.08	530 354 38.1 0.05	480 416 37.9 0.05	450 450 37.2 0.18	633 263 39.3 0.13	601 311 38.9 0.08	549 390 38.5 0.06	499 463 38.1 0.06	482 482 37.6 0.28
105	TC SHC kW BF	559 213 43.0 0.00	527 248 42.9 0.10	477 301 42.9 0.05	429 351 43.5 0.04	393 387 42.4 0.11	585 233 43.8 0.20	553 274 43.5 0.08	502 339 43.8 0.05	453 401 43.0 0.05	429 429 43.0 0.21	603 249 44.1 0.12	572 297 43.9 0.07	519 375 43.7 0.06	471 447 43.2 0.07	459 447 43.2 0.30
115	TC SHC kW BF	529 201 49.0 0.00	498 234 49.3 0.09	449 286 50.0 0.04	402 335 51.1 0.04	368 367 50.1 0.13	554 219 49.8 0.15	523 259 49.9 0.07	472 324 50.6 0.05	425 385 51.2 0.05	406 406 50.4 0.24	572 235 50.2 0.11	540 283 50.3 0.07	489 360 51.0 0.05	442 428 50.8 0.08	435 435 50.4 0.33
120	TC SHC kW BF	514 194 52.5 0.00	484 227 53.0 0.08	435 278 54.3 0.04	386 326 55.3 0.04	357 357 54.6 0.15	538 212 53.3 0.13	507 252 53.7 0.07	457 316 54.7 0.05	409 376 55.5 0.05	393 393 54.2 0.05	555 228 54.2 0.26	524 275 53.8 0.10	472 351 54.1 0.07	427 418 55.3 0.05	421 421 54.7 0.08

48/50A050 (50 TONS) — STANDARD MODE (cont)

Temp (F) Air Entering Condenser (Edb)		Evaporator Air Quantity — Cfm									
		17,500					20,000				
		Evaporator Air — Ewb (F)									
75	TC SHC kW BF	709 305 32.4 0.13	674 361 31.9 0.08	618 453 31.0 0.06	566 537 30.3 0.08	550 550 30.0 0.31	740 326 32.6 0.12	685 383 32.1 0.08	629 486 31.2 0.07	577 570 30.4 0.12	573 573 30.3 0.37
85	TC SHC kW BF	678 276 35.7 0.12	645 328 35.3 0.08	591 413 34.4 0.06	540 488 33.7 0.09	529 499 33.5 0.33	691 284 35.9 0.11	656 341 35.4 0.08	600 435 34.6 0.07	552 504 33.8 0.15	550 510 33.8 0.39
95	TC SHC kW BF	648 278 39.6 0.11	616 334 39.2 0.08	563 425 38.8 0.06	512 501 37.9 0.10	506 506 37.9 0.35	658 292 39.8 0.10	625 355 38.9 0.08	572 457 38.9 0.07	530 522 38.0 0.18	527 527 38.1 0.41
105	TC SHC kW BF	617 264 44.4 0.10	585 320 44.2 0.07	532 409 44.3 0.06	487 481 43.2 0.12	483 483 43.4 0.37	628 279 44.6 0.10	595 341 44.4 0.08	542 442 44.5 0.07	506 499 43.3 0.20	503 503 43.5 0.43
115	TC SHC kW BF	584 250 50.6 0.10	553 305 50.7 0.07	500 394 51.4 0.06	463 451 50.1 0.17	458 458 50.4 0.40	594 265 50.8 0.09	562 327 50.9 0.07	508 425 51.7 0.07	476 476 50.4 0.22	474 474 50.2 0.46
120	TC SHC kW BF	567 243 54.1 0.09	535 297 54.4 0.07	482 385 55.3 0.06	447 440 53.6 0.18	444 444 54.3 0.41	577 257 54.3 0.09	545 319 54.7 0.09	492 417 56.0 0.07	465 459 53.8 0.07	462 462 54.2 0.25

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A050 (50 TONS) — SUBCOOLING MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM																				
	10,000					12,500					15,000					17,500					
	Evaporator Air Ewb (F)																				
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC kW BF	601 218 31.4 0.00	568 251 30.8 0.02	523 311 30.1 0.03	479 367 29.5 0.03	438 418 28.9 0.05	624 229 31.9 0.01	596 342 30.5 0.04	547 416 29.9 0.04	507 468 29.4 0.05	471 241 32.5 0.12	643 287 31.8 0.04	608 377 30.9 0.05	567 455 30.1 0.06	521 494 29.7 0.07	494 247 32.6 0.21	651 494 31.7 0.06	604 289 31.2 0.07	582 410 30.4 0.07	542 501 30.1 0.09	524 524 30.1 0.30
85	TC SHC kW BF	567 192 34.6 0.00	541 230 34.2 0.02	498 291 33.5 0.03	455 348 32.8 0.03	417 399 32.3 0.06	596 209 35.2 0.02	570 254 34.7 0.04	522 324 33.9 0.04	481 396 33.2 0.05	449 429 32.8 0.14	620 272 35.8 0.04	586 356 35.0 0.05	540 434 34.2 0.06	495 472 33.4 0.07	472 428 33.1 0.23	610 426 35.5 0.06	599 414 34.5 0.07	554 474 33.7 0.10	510 496 33.4 0.31	
95	TC SHC kW BF	540 172 38.6 0.00	513 209 38.1 0.02	469 268 37.3 0.03	428 326 36.7 0.03	395 380 36.4 0.07	565 185 39.1 0.02	497 189 38.0 0.04	495 304 37.8 0.04	454 375 37.1 0.05	426 426 36.7 0.14	565 180 39.2 0.05	555 250 38.9 0.05	512 336 38.1 0.06	470 415 37.3 0.07	452 452 37.0 0.24	591 205 39.0 0.06	568 269 38.3 0.07	524 367 37.6 0.10	482 451 37.5 0.32	
105	TC SHC kW BF	512 153 43.2 0.00	484 189 42.7 0.02	444 250 42.1 0.03	405 309 41.6 0.03	378 364 41.5 0.08	533 163 43.6 0.02	506 207 43.0 0.04	465 281 42.4 0.04	424 352 41.8 0.05	400 400 41.5 0.16	548 174 43.9 0.05	523 227 43.3 0.05	482 315 42.6 0.06	440 392 42.0 0.08	423 423 41.7 0.26	524 205 43.6 0.07	535 246 43.6 0.07	494 346 42.8 0.07	455 430 42.2 0.11	445 445 42.0 0.34
115	TC SHC kW BF	477 127 48.5 0.00	454 167 48.1 0.02	421 236 47.8 0.03	385 296 47.5 0.04	350 337 47.2 0.10	500 139 48.9 0.03	474 184 48.4 0.04	432 257 47.8 0.04	398 332 47.5 0.05	377 377 47.3 0.18	515 150 49.2 0.05	489 203 48.7 0.05	450 292 48.0 0.06	413 372 47.6 0.08	401 401 47.4 0.08	533 292 49.5 0.06	502 372 48.9 0.07	459 404 48.1 0.07	427 421 47.7 0.13	421 421 47.6 0.35

48/50A050 (50 TONS) — SUBCOOLING MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM															
	20,000					22,500					25,000					
	Evaporator Air Ewb (F)															
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC kW BF	657 255 32.7 0.08	628 320 32.2 0.08	564 412 31.0 0.08	549 530 30.6 0.08	544 544 30.5 0.13	666 267 32.9 0.10	640 343 32.4 0.10	592 460 31.5 0.10	561 557 30.8 0.18	559 559 30.7 0.42	671 276 33.0 0.11	646 360 32.5 0.11	604 493 31.8 0.11	575 575 31.0 0.23	574 574 31.0 0.46
85	TC SHC kW BF	613 428 35.7 0.08	586 422 35.2 0.08	527 409 34.1 0.08	523 407 33.9 0.13	517 406 33.8 0.37	641 437 36.4 0.10	614 430 35.8 0.10	573 418 34.8 0.19	536 409 34.1 0.43	532 433 34.1 0.11	630 430 35.8 0.11	620 416 34.7 0.12	568 553 34.4 0.25	553 552 34.4 0.47	
95	TC SHC kW BF	608 224 39.9 0.08	579 289 39.3 0.08	534 397 38.5 0.09	499 486 37.8 0.15	494 494 37.7 0.39	615 236 40.0 0.10	588 309 39.5 0.10	535 419 38.5 0.10	508 505 38.0 0.20	506 506 38.0 0.44	599 222 0.11 0.11	598 329 0.11 0.11	549 454 0.12 0.12	520 520 38.2 0.26	524 524 38.2 0.48
105	TC SHC kW BF	568 194 44.3 0.08	517 237 43.3 0.08	501 374 42.9 0.09	473 461 42.4 0.16	462 462 42.2 0.40	579 210 44.5 0.10	553 284 43.9 0.10	509 402 43.0 0.10	478 478 42.5 0.21	476 476 42.5 0.45	562 198 44.3 0.11	548 292 43.9 0.11	516 430 43.2 0.12	494 494 42.7 0.28	494 494 42.7 0.49
115	TC SHC kW BF	496 134 49.0 0.08	481 211 48.5 0.08	469 350 48.2 0.09	443 432 47.8 0.18	439 439 47.7 0.41	514 155 49.3 0.10	490 204 48.7 0.10	476 378 48.3 0.11	452 452 47.9 0.23	452 452 47.9 0.46	533 179 49.5 0.11	506 231 48.9 0.11	482 404 48.4 0.13	461 461 48.0 0.29	462 462 48.1 0.51

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

50A050 (50 TONS) — HOT GAS REHEAT MODE

Temp (F) Air Entering Condenser (Edb)		Air Entering Evaporator — Ewb (F)														
		75 Dry Bulb							75 Dry Bulb							
		62.5 Wet Bulb (50% RH)							65.3 Wet Bulb (60% RH)							
		Air Entering Evaporator — SCFM														
		10,000	12,500	15,000	17,500	20,000	22,500	25,000	10,000	12,500	15,000	17,500	20,000	22,500	25,000	
40	TC	192	208	218	225	230	234	238	203	219	230	238	243	247	251	
	SHC	40	67	93	118	142	166	188	-1	18	37	55	74	93	112	
	kW	37.0	36.0	35.5	35.2	35.0	34.9	34.8	38.5	37.3	36.7	36.3	36.1	35.9	35.8	
	BF	0.02	0.03	0.04	0.06	0.07	0.09	0.11	0.02	0.03	0.04	0.05	0.07	0.08	0.09	
50	TC	197	213	223	231	236	240	243	209	226	237	244	250	254	258	
	SHC	43	70	96	121	145	169	191	2	21	40	59	78	97	115	
	kW	36.1	35.1	34.6	34.3	34.1	34.0	33.9	37.6	36.4	35.8	35.4	35.2	35.0	34.9	
	BF	0.02	0.03	0.04	0.06	0.07	0.09	0.11	0.02	0.03	0.04	0.05	0.07	0.08	0.09	
60	TC	203	219	229	237	242	246	250	214	231	242	250	255	260	263	
	SHC	47	73	99	124	149	173	195	5	24	43	62	80	99	118	
	kW	35.3	34.3	33.8	33.5	33.3	33.2	33.2	36.8	35.6	35.0	34.7	34.4	34.3	34.1	
	BF	0.02	0.03	0.04	0.06	0.07	0.09	0.11	0.02	0.03	0.04	0.05	0.07	0.08	0.09	
70	TC	212	228	239	246	252	256	259	222	240	251	259	265	270	273	
	SHC	52	78	104	129	154	178	200	10	29	48	67	86	105	124	
	kW	33.8	32.9	32.4	32.1	32.0	31.9	31.8	35.3	34.2	33.6	33.3	33.1	32.9	32.8	
	BF	0.02	0.03	0.04	0.05	0.07	0.08	0.10	0.02	0.03	0.04	0.05	0.06	0.08	0.09	
75	TC	219	235	246	254	260	265	269	230	247	259	268	275	281	285	
	SHC	57	83	109	134	159	183	206	15	34	53	72	91	110	129	
	kW	32.6	31.7	31.2	31.0	30.8	30.8	30.7	34.1	33.0	32.5	32.2	32.0	31.8	31.7	
	BF	0.02	0.03	0.04	0.05	0.07	0.08	0.10	0.02	0.03	0.04	0.05	0.06	0.08	0.09	
80	TC	225	243	255	264	271	276	280	236	256	269	279	286	292	297	
	SHC	61	87	114	140	165	189	212	19	39	58	78	97	116	135	
	kW	31.5	30.7	30.3	30.0	29.9	29.8	29.8	33.0	32.0	31.5	31.2	31.0	30.9	30.8	
	BF	0.02	0.03	0.04	0.05	0.07	0.08	0.10	0.02	0.03	0.04	0.05	0.06	0.08	0.09	

50A050 (50 TONS) — HOT GAS REHEAT MODE (cont)

Temp (F) Air Entering Condenser (Edb)		Air Entering Evaporator — Ewb (F)														
		75 Dry Bulb							75 Dry Bulb							
		68.0 Wet Bulb (70% RH)							70.5 Wet Bulb (80% RH)							
		Air Entering Evaporator — SCFM														
		10,000	12,500	15,000	17,500	20,000	22,500	25,000	10,000	12,500	15,000	17,500	20,000	22,500	25,000	
40	TC	213	231	242	250	256	260	264	223	241	253	262	268	273	277	
	SHC	-42	-30	-18	-6	6	18	31	-81	-76	-71	-65	-59	-52	-45	
	kW	40.0	38.6	37.9	37.4	37.1	36.9	36.8	41.6	40.0	39.1	38.6	38.2	38.0	37.8	
	BF	0.01	0.03	0.04	0.05	0.07	0.08	0.09	0.00	0.01	0.03	0.05	0.07	0.08	0.10	
50	TC	219	237	248	257	263	267	271	229	248	260	268	275	280	284	
	SHC	-39	-27	-15	-3	9	22	34	-78	-73	-68	-62	-56	-49	-42	
	kW	39.1	37.8	37.0	36.6	36.3	36.1	36.0	40.7	39.1	38.3	37.8	37.4	37.1	36.9	
	BF	0.01	0.03	0.04	0.05	0.07	0.08	0.09	0.00	0.01	0.03	0.05	0.07	0.08	0.10	
60	TC	224	242	254	262	268	273	277	234	253	265	274	281	286	290	
	SHC	-36	-24	-12	0	12	24	37	-75	-70	-65	-59	-53	-46	-40	
	kW	38.3	37.0	36.3	35.8	35.5	35.3	35.2	39.9	38.3	37.5	37.0	36.6	36.4	36.2	
	BF	0.01	0.03	0.04	0.05	0.07	0.08	0.09	0.00	0.01	0.03	0.05	0.07	0.08	0.10	
70	TC	233	251	263	272	278	283	287	243	262	275	284	291	296	300	
	SHC	-31	-19	-7	5	17	29	42	-70	-65	-60	-54	-48	-41	-35	
	kW	36.8	35.5	34.9	34.5	34.2	34.0	33.9	38.4	36.9	36.1	35.6	35.3	35.0	34.9	
	BF	0.01	0.03	0.04	0.05	0.07	0.08	0.09	0.00	0.01	0.03	0.05	0.07	0.08	0.10	
75	TC	241	259	273	282	290	295	300	251	271	285	296	303	309	314	
	SHC	-26	-15	-2	10	23	35	48	-66	-60	-55	-49	-42	-35	-28	
	kW	35.6	34.4	33.8	33.4	33.1	32.9	32.8	37.3	35.8	35.0	34.5	34.2	34.0	33.8	
	BF	0.01	0.03	0.04	0.05	0.07	0.08	0.09	0.00	0.01	0.03	0.05	0.07	0.08	0.10	
80	TC	249	269	283	294	301	307	312	260	282	297	307	316	322	327	
	SHC	-22	-9	3	16	29	41	54	-61	-55	-49	-43	-36	-29	-22	
	kW	34.6	33.4	32.8	32.4	32.2	32.0	31.9	36.3	34.8	34.1	33.6	33.3	33.1	32.9	
	BF	0.01	0.03	0.04	0.05	0.07	0.08	0.09	0.00	0.01	0.03	0.05	0.07	0.08	0.10	

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A060 (60 TONS) — STANDARD MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm															
	12,000					15,000					18,000					
	Evaporator Air — Ewb (F)															
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC kW BF	738 293 40.0 0.00	705 334 39.2 0.00	653 406 38.1 0.10	603 474 37.1 0.08	554 533 36.3 0.08	773 305 40.7 0.00	736 361 39.9 0.15	684 447 38.7 0.10	633 530 37.7 0.09	592 578 36.9 0.19	796 324 41.2 0.23	759 386 40.4 0.13	706 486 39.2 0.11	655 582 38.2 0.10	622 622 37.5 0.25
85	TC SHC kW BF	716 284 44.4 0.00	686 327 43.7 0.12	635 398 42.7 0.10	585 465 41.7 0.07	537 522 40.9 0.09	748 298 45.1 0.00	715 353 44.4 0.14	664 439 43.3 0.10	615 521 42.3 0.22	579 562 41.5 0.20	768 315 45.6 0.12	737 378 44.9 0.12	685 478 43.7 0.11	635 572 42.7 0.10	607 607 42.1 0.27
95	TC SHC kW BF	695 276 49.5 0.00	666 320 48.8 0.19	615 389 47.8 0.09	566 456 46.9 0.07	519 510 46.1 0.10	725 292 50.2 0.00	694 346 49.5 0.13	643 430 48.4 0.09	593 511 47.5 0.09	557 557 46.8 0.20	745 308 50.7 0.18	713 370 50.0 0.12	662 469 48.8 0.10	613 561 47.9 0.10	590 590 47.4 0.29
105	TC SHC kW BF	673 264 55.3 0.00	643 311 54.6 0.15	593 380 53.7 0.09	545 446 52.8 0.07	502 493 51.8 0.13	699 283 55.9 0.24	669 337 55.3 0.12	619 420 54.2 0.09	570 500 53.3 0.08	539 539 52.6 0.22	718 300 56.4 0.16	687 361 55.7 0.12	638 460 54.7 0.10	587 549 53.7 0.31	570 570 53.3 0.31
115	TC SHC kW BF	647 255 61.7 0.00	617 301 61.1 0.13	567 369 60.3 0.08	521 434 60.0 0.07	484 474 59.2 0.17	670 274 62.3 0.18	641 327 61.7 0.11	592 410 60.9 0.09	544 488 60.4 0.08	519 519 59.9 0.25	687 290 62.8 0.14	657 350 62.2 0.11	609 448 61.3 0.10	561 536 60.6 0.11	549 549 60.2 0.34
120	TC SHC kW BF	632 251 65.2 0.00	603 296 64.8 0.12	554 364 64.3 0.08	508 428 64.1 0.07	471 461 63.3 0.17	654 269 65.8 0.17	626 322 65.5 0.17	578 404 64.9 0.10	531 482 64.5 0.09	509 509 64.0 0.09	670 285 66.4 0.09	641 345 65.8 0.13	594 443 65.2 0.11	547 528 64.7 0.10	538 538 64.4 0.35

48/50A060 (60 TONS) — STANDARD MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity — Cfm															
	21,000					24,000					27,000					
	Evaporator Air — Ewb (F)															
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	
75	TC SHC kW BF	813 340 41.6 0.18	776 409 40.7 0.13	722 523 39.5 0.11	671 627 38.5 0.12	651 651 38.1 0.33	826 432 41.9 0.16	789 560 39.8 0.12	735 665 38.7 0.16	683 674 38.5 0.39	674 674 42.2 0.16	837 369 41.3 0.14	800 454 40.1 0.13	745 594 39.0 0.21	695 689 38.9 0.44	693 693 38.9 0.44
85	TC SHC kW BF	784 331 46.0 0.16	752 401 45.2 0.13	700 515 44.1 0.11	650 617 43.0 0.13	634 634 0.35	796 423 46.3 0.15	764 552 44.3 0.14	713 648 43.2 0.12	662 656 43.1 0.18	656 806 41.5 0.15	774 723 46.5 0.14	774 665 44.6 0.13	678 665 43.6 0.25	675 675 43.5 0.46	675 675 43.5 0.46
95	TC SHC kW BF	759 323 51.1 0.15	728 393 50.4 0.13	678 507 49.2 0.11	627 604 48.2 0.14	616 616 0.36	770 338 51.4 0.15	739 415 50.6 0.13	689 543 49.5 0.12	640 630 48.4 0.20	638 638 48.3 0.42	780 353 51.6 0.15	748 437 50.9 0.14	698 577 49.7 0.13	659 644 48.8 0.27	656 656 48.7 0.47
105	TC SHC kW BF	731 315 56.8 0.14	701 384 56.1 0.12	651 497 55.0 0.11	602 589 54.0 0.15	596 596 0.39	742 330 57.1 0.14	711 406 56.4 0.13	662 533 55.3 0.12	620 608 54.2 0.23	616 616 54.2 0.44	750 344 57.3 0.14	720 428 56.6 0.14	670 566 55.5 0.13	637 622 54.6 0.30	634 634 54.6 0.49
115	TC SHC kW BF	699 305 63.2 0.13	670 373 62.5 0.12	622 485 61.5 0.11	576 568 60.6 0.17	573 573 0.41	709 320 63.5 0.13	679 396 62.7 0.12	631 521 61.8 0.12	596 583 60.8 0.26	592 334 60.8 0.47	716 418 63.6 0.14	687 555 62.9 0.14	639 596 62.0 0.13	612 609 61.1 0.33	609 609 61.1 0.51
120	TC SHC kW BF	682 300 66.7 0.13	653 368 66.1 0.12	607 480 65.4 0.11	564 555 64.4 0.19	561 561 0.42	691 315 66.3 0.13	662 390 65.7 0.13	616 515 64.7 0.12	584 570 64.8 0.28	580 580 64.8 0.48	698 329 67.1 0.13	670 412 66.5 0.13	623 549 65.8 0.13	600 584 65.0 0.35	595 595 65.4 0.52

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

48/50A060 (60 TONS) — SUBCOOLING MODE

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM																					
	12,000				15,000				18,000				21,000									
	Evaporator Air Ewb (F)																					
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57		
75	TC SHC kW BF	708 253 39.7 0.00	671 294 39.0 0.03	616 361 38.0 0.06	563 425 37.1 0.07	513 483 36.2 0.08	742 271 40.4 0.01	706 320 39.7 0.07	649 400 38.6 0.08	596 481 37.7 0.09	549 542 36.9 0.15	767 288 40.8 0.05	732 346 40.2 0.09	675 441 39.1 0.10	620 531 38.0 0.11	583 583 37.4 0.23	787 303 41.2 0.08	751 368 40.5 0.11	693 303 39.4 0.12	639 368 38.4 0.14	613 578 38.0 0.31	
85	TC SHC kW BF	676 229 43.8 0.00	642 272 43.1 0.04	588 340 42.1 0.06	539 406 41.2 0.07	492 466 40.4 0.09	709 247 44.4 0.02	675 297 42.7 0.07	620 379 41.7 0.08	568 459 41.0 0.09	525 519 44.9 0.16	730 260 44.2 0.06	697 320 43.1 0.09	643 416 42.1 0.11	590 508 41.5 0.11	556 556 45.2 0.24	748 275 44.5 0.09	714 341 43.5 0.11	660 341 42.4 0.12	607 552 42.0 0.14	585 585 42.0 0.32	
95	TC SHC kW BF	643 205 48.4 0.00	608 245 47.7 0.04	559 317 46.7 0.06	511 384 45.8 0.07	464 445 45.0 0.08	674 220 49.0 0.02	641 271 48.3 0.07	589 356 47.3 0.08	539 437 46.3 0.09	500 494 45.6 0.17	695 235 49.5 0.06	663 294 48.8 0.09	610 392 47.7 0.10	560 485 46.7 0.11	531 531 49.8 0.26	711 249 49.1 0.09	679 316 48.0 0.11	626 427 47.0 0.12	576 528 46.6 0.33	556 556 46.6 0.33	
105	TC SHC kW BF	609 179 53.6 0.00	574 220 52.8 0.04	528 294 51.9 0.06	481 362 51.0 0.07	439 420 50.2 0.10	636 193 54.2 0.03	606 245 53.5 0.07	556 331 52.5 0.08	508 413 51.5 0.09	473 469 50.8 0.18	654 205 54.6 0.07	625 267 52.9 0.09	575 366 51.9 0.10	527 459 51.4 0.11	501 501 55.0 0.27	671 219 54.3 0.09	640 288 53.2 0.11	590 401 52.2 0.15	543 501 51.9 0.35	526 526 51.9 0.35	
115	TC SHC kW BF	571 153 59.4 0.01	538 193 58.7 0.05	494 268 57.8 0.06	450 338 56.9 0.07	413 395 56.1 0.12	594 162 59.9 0.04	566 217 59.3 0.07	519 304 58.3 0.08	474 387 57.4 0.09	443 443 56.7 0.19	614 177 60.4 0.09	585 238 59.7 0.07	538 339 58.7 0.09	492 433 57.7 0.10	470 470 57.3 0.12	628 189 60.7 0.29	599 259 60.0 0.09	551 373 59.0 0.11	506 472 58.0 0.15	494 494 57.8 0.36	556 556 57.8 0.36

48/50A060 (60 TONS) — SUBCOOLING MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Evaporator Air Quantity – SCFM																	
	24,000				27,000				30,000									
	Evaporator Air Ewb (F)																	
	75	72	67	62	57	75	72	67	62	57	75	72	67	62	57			
75	TC SHC kW BF	804 320 41.5 0.11	768 392 40.9 0.13	708 512 39.7 0.13	654 618 38.7 0.17	637 637 38.4 0.38	814 413 41.8 0.14	779 546 41.1 0.15	720 652 39.9 0.20	665 657 38.9 0.43	657 346 38.8 0.14	825 434 42.0 0.16	789 578 41.3 0.16	729 678 40.1 0.24	678 678 39.2 0.47	674 674 39.1 0.47	674 674 39.1 0.47	674 674 39.1 0.47
85	TC SHC kW BF	761 289 45.5 0.11	729 364 44.8 0.13	674 591 43.7 0.13	621 607 42.7 0.17	607 302 42.5 0.39	772 385 45.7 0.14	740 520 43.9 0.15	684 621 43.0 0.21	634 627 42.8 0.44	627 317 46.0 0.14	783 406 45.3 0.16	749 552 44.1 0.16	693 647 43.2 0.26	647 646 43.2 0.48	646 646 43.2 0.48	646 646 43.2 0.48	
95	TC SHC kW BF	722 260 50.1 0.11	691 337 49.4 0.13	639 461 48.3 0.13	589 565 47.3 0.17	578 578 47.1 0.40	734 275 50.3 0.13	702 358 49.6 0.14	647 492 48.5 0.23	599 588 47.5 0.45	597 597 47.4 0.14	742 287 50.5 0.15	709 377 49.8 0.15	656 524 48.6 0.16	612 612 47.7 0.27	613 613 47.8 0.49	613 613 47.8 0.49	
105	TC SHC kW BF	682 232 55.3 0.11	651 308 54.5 0.12	601 434 53.4 0.13	556 533 52.5 0.19	547 547 52.3 0.41	692 245 52.3 0.13	661 328 55.5 0.14	608 464 53.6 0.24	569 559 52.7 0.46	565 525 52.7 0.14	700 349 54.9 0.15	669 496 53.8 0.16	618 582 53.0 0.29	582 582 53.0 0.50	580 580 53.0 0.50	580 580 53.0 0.50	
115	TC SHC kW BF	639 202 61.0 0.11	610 279 60.3 0.12	562 406 59.2 0.13	521 501 58.3 0.21	514 514 58.2 0.42	647 299 61.2 0.13	618 437 60.5 0.14	570 527 59.4 0.15	535 531 58.6 0.25	531 527 58.5 0.47	655 349 61.4 0.14	625 349 61.4 0.15	575 496 59.5 0.17	546 582 58.8 0.30	545 545 58.8 0.51	545 545 58.8 0.51	

See legend on page 32.

Performance data (cont)



COOLING CAPACITIES (cont)

50A060 (60 TONS) — HOT GAS REHEAT MODE

Temp (F) Air Entering Condenser (Edb)	Air Entering Evaporator — Ewb (F)														
	75 Dry Bulb						75 Dry Bulb								
	62.5 Wet Bulb (50% RH)						65.3 Wet Bulb (60% RH)								
	Air Entering Evaporator — SCFM														
	12,000	15,000	18,000	21,000	24,000	27,000	30,000	12,000	15,000	18,000	21,000	24,000	27,000	30,000	
40	TC SHC kW BF	298 80 36.2 0.04	322 111 36.0 0.06	339 141 36.0 0.07	352 171 36.1 0.08	362 201 36.1 0.09	369 230 36.2 0.11	375 258 36.3 0.12	314 30 37.8 0.03	339 52 37.5 0.05	357 74 37.4 0.07	370 97 37.4 0.08	380 119 37.4 0.09	388 141 37.5 0.10	395 163 37.5 0.12
50	TC SHC kW BF	287 74 37.7 0.04	308 104 37.5 0.06	324 134 37.4 0.07	336 164 37.4 0.08	345 194 37.5 0.09	351 223 37.5 0.11	357 250 37.6 0.12	301 24 39.3 0.04	325 46 38.9 0.05	341 68 38.8 0.07	353 90 38.8 0.08	363 112 38.8 0.09	370 134 38.8 0.10	376 156 38.8 0.12
60	TC SHC kW BF	277 70 39.4 0.04	297 99 39.1 0.06	311 128 39.0 0.07	320 157 39.0 0.08	328 187 39.0 0.09	335 216 39.0 0.11	340 243 39.1 0.12	291 19 40.9 0.04	311 40 40.5 0.05	326 61 40.3 0.07	337 83 40.3 0.08	346 105 40.3 0.09	352 127 40.3 0.10	358 149 40.3 0.11
70	TC SHC kW BF	267 65 41.2 0.04	287 94 40.9 0.06	299 123 40.8 0.07	309 153 40.7 0.08	316 182 40.7 0.09	321 210 40.7 0.11	325 237 40.7 0.12	280 15 40.8 0.04	300 35 42.3 0.05	314 56 42.3 0.07	324 78 42.3 0.08	331 100 42.0 0.09	336 121 42.0 0.10	341 143 42.0 0.11
75	TC SHC kW BF	262 62 42.2 0.04	281 92 41.9 0.06	294 121 41.7 0.07	303 150 41.7 0.08	309 180 41.7 0.09	314 207 41.7 0.11	319 234 41.7 0.13	275 12 43.7 0.04	295 33 43.3 0.05	308 54 43.3 0.07	317 75 43.1 0.08	324 97 43.0 0.09	330 119 42.9 0.10	334 141 42.9 0.11
80	TC SHC kW BF	257 60 43.3 0.04	275 89 42.9 0.06	288 118 42.8 0.07	296 148 42.7 0.08	303 177 42.7 0.09	308 205 42.7 0.11	312 232 42.7 0.13	270 10 42.7 0.04	289 30 44.3 0.05	302 51 44.3 0.07	311 73 44.1 0.08	318 95 44.0 0.09	323 116 44.0 0.10	327 138 43.9 0.11

50A060 (60 TONS) — HOT GAS REHEAT MODE (cont)

Temp (F) Air Entering Condenser (Edb)	Air Entering Evaporator — Ewb (F)														
	75 Dry Bulb						75 Dry Bulb								
	68.0 Wet Bulb (70% RH)						70.5 Wet Bulb (80% RH)								
	Air Entering Evaporator — SCFM														
	12,000	15,000	18,000	21,000	24,000	27,000	30,000	12,000	15,000	18,000	21,000	24,000	27,000	30,000	
40	TC SHC kW BF	330 -19 39.4 0.02	357 -5 39.0 0.04	375 10 38.8 0.06	389 24 38.8 0.07	400 39 38.8 0.09	408 54 38.8 0.10	414 69 38.8 0.11	345 -65 41.0 0.00	373 -58 40.4 0.01	393 -51 40.2 0.03	407 -43 40.0 0.05	418 -35 40.0 0.07	426 -27 39.9 0.09	433 -18 39.9 0.10
50	TC SHC kW BF	316 -25 40.9 0.02	341 -11 40.4 0.04	359 3 40.2 0.06	372 18 40.1 0.07	381 32 40.1 0.09	389 48 40.1 0.10	395 63 40.1 0.11	331 -72 40.1 0.00	358 -64 41.8 0.01	376 -57 41.5 0.03	389 -50 41.4 0.05	399 -42 41.3 0.07	407 -33 41.2 0.09	413 -25 41.2 0.10
60	TC SHC kW BF	304 -30 42.5 0.02	326 -17 42.0 0.04	342 -3 41.7 0.06	354 11 41.6 0.07	363 26 41.6 0.09	370 41 41.6 0.10	376 56 41.5 0.11	318 -77 44.1 0.00	342 -71 43.4 0.01	358 -64 43.1 0.03	371 -56 42.9 0.05	380 -48 42.8 0.07	387 -40 42.7 0.09	393 -31 42.6 0.10
70	TC SHC kW BF	294 -35 44.3 0.02	315 -22 43.8 0.04	329 -9 43.5 0.06	339 5 43.3 0.07	347 20 43.3 0.09	353 35 43.2 0.10	357 49 43.2 0.11	307 -82 45.9 0.00	329 -75 45.2 0.01	343 -69 44.8 0.03	354 -62 44.6 0.05	363 -54 44.5 0.07	369 -46 44.4 0.09	374 -37 44.3 0.10
75	TC SHC kW BF	288 -37 45.3 0.02	309 -24 44.7 0.04	323 -11 44.5 0.06	332 3 44.3 0.07	340 18 44.2 0.09	346 32 44.2 0.10	350 47 44.1 0.11	301 -84 46.9 0.00	323 -78 46.1 0.01	337 -71 45.7 0.03	348 -64 45.5 0.05	356 -56 45.4 0.07	362 -48 45.3 0.09	367 -40 45.3 0.10
80	TC SHC kW BF	283 -39 46.4 0.02	303 -27 45.8 0.04	316 -13 45.5 0.06	326 1 45.3 0.07	333 15 45.2 0.09	339 30 45.2 0.10	343 44 45.1 0.11	295 -86 47.9 0.00	316 -80 47.2 0.01	330 -74 46.8 0.03	341 -67 46.6 0.05	348 -59 46.4 0.07	355 -50 46.3 0.09	360 -42 46.3 0.10

See legend on page 32.

Performance data (cont)



FAN PERFORMANCE – VERTICAL DISCHARGE UNITS

Available External Static Pressure (in. wg)																				
Airflow (Cfm)	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp																		
4,000	328	0.62	406	0.84	472	1.07	529	1.30	580	1.54	626	1.78	668	2.02	708	2.27	745	2.51	780	2.76
5,000	369	0.97	439	1.19	500	1.43	554	1.69	604	1.95	650	2.21	692	2.48	731	2.74	769	3.01	804	3.28
6,000	415	1.43	477	1.65	533	1.90	584	2.17	631	2.45	676	2.73	717	3.01	756	3.30	793	3.59	828	3.88
7,000	463	2.01	519	2.25	570	2.50	618	2.78	662	3.06	704	3.36	744	3.65	782	3.96	818	4.27	852	4.58
7,500	488	2.36	541	2.60	590	2.86	636	3.13	679	3.42	720	3.72	759	4.02	796	4.33	832	4.65	866	4.96
8,000	513	2.74	564	2.98	611	3.24	655	3.52	697	3.81	737	4.11	775	4.42	811	4.74	846	5.06	879	5.38
9,000	564	3.61	612	3.87	655	4.13	696	4.42	735	4.71	772	5.02	808	5.33	843	5.65	876	5.98	909	6.32
10,000	616	4.64	661	4.91	701	5.18	739	5.47	776	5.77	811	6.08	845	6.40	878	6.72	909	7.06	940	7.40

48A2,A3,A6,A7 020 (20 TONS) (cont)																				
Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
4,000	814	3.01	845	3.26	876	3.51	905	3.76	934	4.02	961	4.28	987	4.54	1013	4.80	1038	5.06	1062	5.32
5,000	837	3.55	869	3.82	900	4.10	929	4.37	958	4.64	985	4.92	1012	5.20	1038	5.48	1063	5.76	1087	6.04
6,000	861	4.17	893	4.46	923	4.76	953	5.05	981	5.35	1009	5.65	1036	5.94	1062	6.24	1087	6.54	1111	6.84
7,000	885	4.89	917	5.20	947	5.51	977	5.83	1005	6.14	1033	6.46	1059	6.78	1085	7.09	1110	7.41	1135	7.73
7,500	898	5.28	930	5.61	960	5.93	989	6.25	1017	6.58	1045	6.90	1071	7.23	1097	7.56	1122	7.88	1147	8.21
8,000	912	5.71	943	6.04	973	6.37	1002	6.70	1030	7.04	1057	7.37	1083	7.71	1109	8.04	1134	8.38	1159	8.72
9,000	940	6.66	970	7.00	999	7.35	1028	7.69	1055	8.04	1082	8.39	1109	8.75	1134	9.10	1159	9.45	1183	9.81
10,000	971	7.75	1000	8.10	1028	8.46	1056	8.82	1083	9.18	1109	9.54	1135	9.91	1160	10.28	1185	10.65	—	—

Available External Static Pressure (in. wg)																				
Airflow (Cfm)	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
	5,000	374	0.98	443	1.20	503	1.45	558	1.70	607	1.96	653	2.23	695	2.49	734	2.76	771	3.03	806
6,000	421	1.45	482	1.68	538	1.93	589	2.20	636	2.47	680	2.75	721	3.04	759	3.33	796	3.62	831	3.91
7,000	471	2.04	526	2.28	576	2.54	623	2.81	668	3.10	710	3.39	749	3.69	787	4.00	823	4.31	857	4.62
8,000	522	2.78	572	3.03	619	3.29	662	3.57	704	3.86	743	4.16	781	4.47	817	4.79	851	5.11	885	5.44
9,000	574	3.66	621	3.92	664	4.19	704	4.47	743	4.77	780	5.08	815	5.40	850	5.72	883	6.05	915	6.39
10,000	628	4.71	671	4.97	711	5.25	748	5.54	784	5.84	819	6.15	853	6.47	885	6.81	917	7.14	948	7.49
11,000	682	5.91	722	6.19	759	6.48	795	6.77	828	7.08	861	7.40	893	7.72	924	8.06	954	8.40	983	8.75
12,000	736	7.30	774	7.59	809	7.88	842	8.18	874	8.49	905	8.82	935	9.15	965	9.48	993	9.83	1021	10.19
13,000	791	8.86	827	9.16	860	9.46	891	9.78	922	10.09	951	10.42	979	10.75	1007	11.10	1034	11.45	1061	11.80
14,000	846	10.61	880	10.93	912	11.24	941	11.56	970	11.88	998	12.21	1025	12.56	1052	12.90	1078	13.26	1103	13.62
15,000	902	12.56	934	12.89	964	13.21	992	13.54	1020	13.87	1046	14.21	1072	14.55	1098	14.91	1122	15.26	1147	15.63

LEGEND

Bhp — Brake Horsepower

NOTES:

1. Fan performance is based on wet coils, economizer, roof curb, cabinet losses, and clean 2-in. filters.

2. Conversion — Bhp to watts:

$$\text{Watts} = \frac{\text{Bhp} \times 746}{\text{Motor efficiency}}$$

3. VAV units with variable capacity compressor can operate down to 100 cfm/ton. VAV units with standard scroll compressor or Humidi-MiZer are limited to 200 cfm/ton. Operation may be additionally limited by entering coil conditions.

Performance data (cont)



FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

48A2,A3,A6,A7 035 (35 TONS)

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
7,000	534	2.46	584	2.80	630	3.13	674	3.48	716	3.82	756	4.16	793	4.50	829	4.83	863	5.17	896	5.49
8,000	590	3.27	635	3.63	677	3.99	718	4.35	757	4.72	794	5.08	830	5.45	864	5.81	897	6.18	929	6.54
9,000	646	4.23	687	4.62	726	5.00	764	5.38	800	5.76	835	6.15	869	6.54	902	6.93	934	7.31	964	7.70
10,000	704	5.35	742	5.77	778	6.17	812	6.57	846	6.97	879	7.38	911	7.78	942	8.19	972	8.60	1002	9.01
10,500	733	5.97	769	6.40	804	6.82	837	7.23	870	7.64	902	8.05	933	8.46	963	8.88	992	9.30	1021	9.72
11,000	762	6.63	797	7.08	830	7.51	863	7.93	894	8.35	925	8.77	955	9.19	984	9.62	1013	10.04	1041	10.47
12,000	820	8.09	853	8.56	884	9.01	915	9.46	944	9.90	973	10.34	1001	10.78	1029	11.22	1056	11.66	1083	12.10
13,000	879	9.72	909	10.22	939	10.70	968	11.17	996	11.63	1023	12.09	1050	12.55	1076	13.01	1102	13.46	1127	13.92
14,000	938	11.54	967	12.07	995	12.58	1022	13.07	1048	13.55	1074	14.03	1099	14.51	1124	14.98	1149	15.46	1173	15.93
15,000	997	13.56	1024	14.11	1051	14.64	1076	15.16	1102	15.67	1126	16.17	1150	16.66	1174	17.16	1197	17.65	1220	18.14
16,000	1056	15.78	1082	16.35	1107	16.91	1132	17.45	1156	17.98	1179	18.50	1202	19.02	1225	19.53	1247	20.04	1269	20.55
17,000	1116	18.20	1140	18.80	1164	19.38	1188	19.95	1210	20.50	1233	21.05	1255	21.58	1276	22.11	1298	22.64	—	—
17,500	1145	19.49	1170	20.10	1193	20.70	1216	21.28	1238	21.84	1260	22.40	1282	22.94	—	—	—	—	—	—

48A2,A3,A6,A7 035 (35 TONS) (cont)

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
7,000	927	5.81	956	6.13	985	6.45	1012	6.76	1039	7.06	1065	7.37	1090	7.67	1114	7.97	1138	8.26	1161	8.56
8,000	960	6.89	989	7.25	1018	7.60	1045	7.94	1072	8.29	1098	8.63	1122	8.96	1147	9.29	1170	9.62	1193	9.95
9,000	994	8.09	1023	8.47	1051	8.85	1078	9.23	1104	9.61	1130	9.98	1155	10.35	1179	10.71	1203	11.08	1226	11.44
10,000	1030	9.42	1058	9.82	1085	10.23	1112	10.64	1138	11.04	1163	11.44	1188	11.84	1212	12.24	1235	12.64	1258	13.03
10,500	1049	10.14	1077	10.56	1103	10.97	1129	11.39	1155	11.81	1180	12.23	1204	12.64	1228	13.05	1251	13.46	1274	13.87
11,000	1069	10.90	1095	11.33	1122	11.76	1147	12.18	1173	12.61	1197	13.04	1221	13.47	1245	13.89	1268	14.31	1291	14.73
12,000	1109	12.55	1135	13.00	1160	13.44	1185	13.89	1209	14.34	1233	14.79	1256	15.24	1279	15.69	—	—	—	—
13,000	1152	14.38	1176	14.84	1200	15.31	1224	15.77	1248	16.24	1271	16.70	1293	17.17	—	—	—	—	—	—
14,000	1196	16.41	1220	16.88	1243	17.36	1266	17.84	1288	18.32	—	—	—	—	—	—	—	—	—	—
15,000	1243	18.63	1265	19.12	1287	19.61	—	—	—	—	—	—	—	—	—	—	—	—	—	—
16,000	1290	21.06	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
17,000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
17,500	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

48A2,A3,A6,A7040 (40 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
8,000	502	2.90	550	3.30	596	3.71	639	4.12	680	4.54	720	4.97	759	5.40	796	5.85	832	6.31	867	6.77
9,000	552	3.81	595	4.24	637	4.67	677	5.11	715	5.55	752	6.00	788	6.45	823	6.92	857	7.39	890	7.87
10,000	602	4.89	642	5.34	680	5.80	717	6.26	752	6.73	787	7.20	821	7.67	854	8.16	886	8.64	917	9.14
11,000	653	6.15	689	6.62	725	7.11	759	7.59	792	8.08	825	8.58	856	9.07	887	9.57	918	10.08	947	10.59
12,000	704	7.60	738	8.09	771	8.60	803	9.11	834	9.63	865	10.14	895	10.66	924	11.18	952	11.71	980	12.24
13,000	756	9.24	788	9.76	818	10.29	848	10.83	878	11.36	906	11.90	935	12.44	962	12.99	989	13.53	1016	14.08
14,000	808	11.10	838	11.64	867	12.19	895	12.74	922	13.30	950	13.87	976	14.43	1002	15.00	1028	15.57	1053	16.14
15,000	861	13.18	888	13.74	915	14.31	942	14.88	968	15.46	994	16.05	1019	16.63	1044	17.22	1068	17.81	1093	18.40
16,000	914	15.49	940	16.06	965	16.65	990	17.24	1015	17.85	1039	18.45	1063	19.06	1087	19.67	1110	20.28	1133	20.89
17,000	967	18.03	991	18.62	1015	19.23	1039	19.85	1062	20.47	1086	21.09	1109	21.72	1131	22.35	1153	22.98	1175	23.61
18,000	1020	20.82	1043	21.43	1066	22.06	1088	22.69	1111	23.33	1133	23.97	1155	24.62	1176	25.27	1197	25.92	1219	26.58
19,000	1073	23.87	1095	24.50	1117	25.14	1138	25.79	1159	26.44	1180	27.11	1201	27.77	1222	28.45	1242	29.12	—	—
20,000	1127	27.18	1147	27.82	1168	28.48	1188	29.15	—	—	—	—	—	—	—	—	—	—	—	—

LEGEND

Bhp — Brake Horsepower

NOTES:

1. Fan performance is based on wet coils, economizer, roof curb, cabinet losses, and clean 2-in. filters.

2. Conversion — Bhp to watts:

$$\text{Watts} = \frac{\text{Bhp} \times 746}{\text{Motor efficiency}}$$

3. VAV units with variable capacity compressor can operate down to 100 cfm/ton. VAV units with standard scroll compressor or Humidi-Mizer are limited to 200 cfm/ton. Operation may be additionally limited by entering coil conditions.

Performance data (cont)



FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

48A2,A3,A6,A7050 (50 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
10,000	611	5.00	651	5.45	689	5.91	725	6.37	761	6.84	795	7.31	829	7.79	861	8.27	893	8.76	925	9.26
11,000	662	6.27	699	6.75	734	7.23	768	7.72	801	8.21	833	8.71	865	9.20	895	9.71	925	10.21	955	10.73
12,000	714	7.74	748	8.24	780	8.75	812	9.26	843	9.77	873	10.29	903	10.81	932	11.33	960	11.86	988	12.39
13,000	766	9.41	798	9.93	828	10.46	858	11.00	887	11.54	916	12.08	944	12.62	971	13.16	998	13.71	1024	14.26
14,000	819	11.29	848	11.84	877	12.39	905	12.95	932	13.51	959	14.07	986	14.63	1012	15.20	1037	15.77	1062	16.34
15,000	872	13.40	899	13.96	926	14.54	953	15.11	979	15.70	1004	16.28	1029	16.87	1054	17.46	1078	18.05	1102	18.64
16,000	925	15.74	951	16.32	976	16.91	1001	17.51	1026	18.12	1050	18.72	1074	19.33	1097	19.94	1121	20.55	1143	21.17
17,000	979	18.32	1003	18.92	1027	19.53	1051	20.15	1074	20.77	1097	21.40	1120	22.03	1142	22.66	1164	23.29	1186	23.93
18,000	1032	21.15	1055	21.77	1078	22.40	1100	23.04	1123	23.68	1145	24.33	1166	24.98	1188	25.63	1209	26.28	1230	26.93
19,000	1086	24.24	1108	24.88	1129	25.52	1151	26.18	1172	26.84	1193	27.51	1214	28.18	1234	28.85	1255	29.52	1275	30.19
20,000	1140	27.60	1161	28.25	1181	28.92	1202	29.59	1222	30.27	1242	30.95	1262	31.64	1281	32.33	—	—	—	—

48A2,A3,A6,A7050 (50 TONS) (cont)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
10,000	955	9.76	985	10.27	1014	10.79	1043	11.31	1071	11.84	1098	12.37	1125	12.91	1151	13.46	1177	14.01	1202	14.56
11,000	984	11.25	1012	11.77	1040	12.30	1068	12.84	1095	13.38	1121	13.93	1147	14.49	1172	15.05	1197	15.61	1222	16.18
12,000	1016	12.93	1043	13.47	1069	14.02	1095	14.57	1121	15.13	1147	15.69	1172	16.26	1196	16.83	1220	17.41	1244	18.00
13,000	1050	14.82	1076	15.38	1101	15.94	1126	16.51	1151	17.08	1175	17.66	1199	18.24	1223	18.83	1246	19.42	1269	20.02
14,000	1087	16.92	1111	17.49	1136	18.07	1159	18.66	1183	19.25	1206	19.84	1229	20.44	1252	21.04	1274	21.64	1296	22.25
15,000	1126	19.23	1149	19.83	1172	20.43	1195	21.03	1217	21.64	1239	22.25	1261	22.86	1283	23.48	—	—	—	—
16,000	1166	21.78	1188	22.40	1210	23.01	1232	23.64	1253	24.26	1275	24.89	1296	25.52	—	—	—	—	—	—
17,000	1208	24.56	1229	25.20	1250	25.84	1271	26.48	1291	27.12	—	—	—	—	—	—	—	—	—	—
18,000	1250	27.59	1271	28.25	1291	28.91	—	—	—	—	—	—	—	—	—	—	—	—	—	—
19,000	1294	30.87	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
20,000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

48A2,A3,A6,A7060 (60 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
12,000	476	4.33	534	5.04	585	5.78	632	6.56	674	7.39	714	8.24	751	9.12	786	10.02	819	10.93	851	11.85
14,000	536	6.19	588	6.96	636	7.74	680	8.56	720	9.41	758	10.30	793	11.21	827	12.15	859	13.11	890	14.08
15,000	566	7.28	617	8.09	662	8.90	704	9.73	744	10.59	781	11.50	816	12.42	849	13.38	881	14.36	911	15.35
16,000	597	8.48	645	9.34	689	10.17	730	11.02	768	11.90	804	12.82	839	13.76	871	14.73	902	15.72	932	16.73
17,000	628	9.80	674	10.71	717	11.58	756	12.45	793	13.34	829	14.27	862	15.23	894	16.21	925	17.21	954	18.24
18,000	659	11.25	704	12.21	745	13.11	783	14.00	819	14.91	853	15.85	886	16.82	918	17.82	948	18.84	977	19.88
19,000	691	12.82	734	13.84	773	14.77	810	15.69	845	16.62	879	17.58	911	18.56	942	19.57	971	20.60	1000	21.65
20,000	723	14.53	764	15.60	802	16.57	838	17.52	872	18.47	905	19.44	936	20.44	966	21.45	995	22.50	1023	23.57
21,000	755	16.37	794	17.49	831	18.51	866	19.49	899	20.47	931	21.46	961	22.47	991	23.50	1019	24.55	1047	25.63
22,000	787	18.35	825	19.53	861	20.59	894	21.60	927	22.61	958	23.62	987	24.64	1016	25.69	1044	26.76	1071	27.84
23,000	819	20.48	856	21.71	890	22.81	923	23.87	954	24.90	985	25.93	1014	26.97	1042	28.03	1069	29.11	1096	30.21
24,000	851	22.75	887	24.04	920	25.19	952	26.28	983	27.34	1012	28.40	1041	29.46	1068	30.54	1095	31.63	1121	32.74
25,000	883	25.17	918	26.52	951	27.72	982	28.84	1011	29.94	1040	31.02	1068	32.11	1095	33.21	1121	34.31	1147	35.44
26,000	916	27.76	950	29.15	981	30.40	1011	31.57	1040	32.70	1068	33.81	1095	34.92	1122	36.04	1147	37.16	1172	38.30
27,000	948	30.49	981	31.95	1012	33.24	1041	34.46	1070	35.62	1097	36.76	1123	37.90	1149	39.04	1174	40.18	1199	41.34

48A2,A3,A6,A7060 (60 TONS) (cont)

Airflow (Cfm)	Available External Static Pressure (in. wg)				
------------------	---	--	--	--	--

Performance data (cont)



FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

50A2,A3,A6,A7 020 (20 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
4,000	311	0.54	390	0.71	457	0.88	515	1.05	567	1.21	613	1.38	656	1.55	696	1.71	733	1.88	768	2.04
5,000	347	0.84	417	1.02	480	1.21	536	1.40	587	1.59	633	1.78	676	1.97	716	2.16	753	2.34	788	2.52
6,000	387	1.25	450	1.43	507	1.63	560	1.84	609	2.05	654	2.26	696	2.47	735	2.68	773	2.88	808	3.09
7,000	430	1.77	488	1.96	540	2.17	588	2.38	634	2.61	677	2.83	718	3.06	756	3.29	793	3.51	828	3.74
7,500	452	2.07	507	2.27	557	2.48	604	2.70	648	2.93	690	3.16	730	3.40	768	3.63	804	3.87	839	4.10
8,000	474	2.41	528	2.61	576	2.82	620	3.04	663	3.28	704	3.52	743	3.76	780	4.00	816	4.24	850	4.48
9,000	519	3.19	570	3.39	614	3.60	656	3.83	696	4.07	734	4.32	771	4.57	806	4.82	840	5.08	873	5.34
10,000	565	4.10	613	4.31	655	4.53	694	4.76	731	5.00	767	5.26	802	5.51	835	5.78	868	6.04	900	6.31

50A2,A3,A6,A7 020 (20 TONS) (cont)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
4,000	802	2.21	833	2.38	864	2.55	893	2.71	921	2.88	949	3.06	975	3.23	1001	3.40	1026	3.58	1050	3.75
5,000	822	2.71	854	2.89	885	3.08	914	3.26	943	3.45	970	3.64	997	3.82	1023	4.01	1048	4.20	1072	4.39
6,000	842	3.29	874	3.50	905	3.70	934	3.90	963	4.10	991	4.31	1017	4.51	1043	4.71	1069	4.91	1093	5.12
7,000	862	3.96	894	4.19	924	4.41	954	4.63	983	4.85	1010	5.07	1037	5.29	1063	5.51	1089	5.72	1113	5.94
7,500	872	4.33	904	4.56	934	4.79	964	5.02	993	5.25	1020	5.48	1047	5.71	1073	5.94	1099	6.16	1123	6.39
8,000	883	4.73	914	4.97	945	5.21	974	5.45	1003	5.68	1030	5.92	1057	6.16	1083	6.39	1108	6.63	1133	6.87
9,000	905	5.60	936	5.85	966	6.11	995	6.37	1023	6.62	1051	6.88	1077	7.13	1103	7.38	1129	7.64	1153	7.89
10,000	931	6.58	961	6.85	990	7.13	1018	7.40	1046	7.67	1073	7.94	1099	8.21	1124	8.48	1149	8.75	1174	9.02

50A2,A3,A6,A7 025-030 (25 THRU 30 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
5,000	352	0.85	422	1.03	484	1.22	540	1.42	590	1.61	636	1.79	678	1.98	718	2.17	755	2.35	791	2.54
6,000	394	1.26	456	1.45	513	1.65	565	1.86	613	2.07	658	2.28	700	2.49	739	2.70	776	2.90	811	3.11
7,000	438	1.79	495	1.98	546	2.19	594	2.41	640	2.64	682	2.86	723	3.09	761	3.32	798	3.54	833	3.77
8,000	483	2.44	536	2.64	583	2.85	628	3.08	670	3.32	710	3.55	749	3.80	786	4.04	821	4.28	855	4.52
9,000	530	3.23	579	3.43	623	3.65	664	3.88	704	4.12	741	4.37	778	4.62	813	4.88	847	5.13	880	5.39
10,000	577	4.15	624	4.36	665	4.58	703	4.82	740	5.06	776	5.32	810	5.58	843	5.84	876	6.11	907	6.38
11,000	625	5.22	669	5.44	708	5.67	744	5.91	779	6.16	813	6.41	845	6.68	877	6.95	907	7.22	937	7.50
12,000	674	6.45	715	6.67	753	6.90	787	7.15	820	7.40	851	7.67	882	7.93	912	8.21	941	8.49	970	8.78
13,000	722	7.85	762	8.07	798	8.30	831	8.55	862	8.81	892	9.08	921	9.35	950	9.63	977	9.92	1005	10.21
14,000	771	9.41	810	9.64	844	9.88	875	10.13	905	10.39	934	10.66	962	10.94	989	11.22	1015	11.51	1041	11.81
15,000	821	11.15	857	11.38	890	11.62	921	11.88	949	12.14	977	12.42	1004	12.70	1030	12.99	1055	13.28	1080	13.58

LEGEND

Bhp — Brake Horsepower

NOTES:

1. Fan performance is based on wet coils, economizer, roof curb, cabinet losses, and clean 2-in. filters.

2. Conversion — Bhp to watts:

$$\text{Watts} = \frac{\text{Bhp} \times 746}{\text{Motor efficiency}}$$

3. VAV units with variable capacity compressor can operate down to 100 cfm/ton. VAV units with standard scroll compressor or Humidi-Mizer are limited to 200 cfm/ton. Operation may be additionally limited by entering coil conditions.

Performance data (cont)



FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

50A2,A3,A6,A7035 (35 TONS)

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
7,000	503	1.96	553	2.22	601	2.47	646	2.72	689	2.97	730	3.22	768	3.46	804	3.70	839	3.94	872	4.17
8,000	553	2.62	599	2.89	643	3.16	684	3.43	724	3.70	763	3.97	799	4.23	834	4.50	868	4.76	901	5.02
9,000	605	3.39	647	3.68	687	3.97	726	4.26	763	4.55	798	4.83	833	5.12	867	5.40	899	5.68	930	5.96
10,000	657	4.29	696	4.61	733	4.91	769	5.22	803	5.52	837	5.82	870	6.12	901	6.42	932	6.72	962	7.02
10,500	684	4.80	721	5.12	757	5.43	791	5.75	825	6.06	857	6.37	889	6.68	920	6.98	950	7.29	979	7.60
11,000	710	5.33	747	5.66	781	5.99	814	6.31	847	6.63	878	6.95	909	7.26	939	7.58	968	7.89	997	8.21
12,000	764	6.52	798	6.86	830	7.21	861	7.54	891	7.88	921	8.21	950	8.54	978	8.87	1006	9.20	1033	9.53
13,000	818	7.85	849	8.21	880	8.57	909	8.92	938	9.27	966	9.62	993	9.97	1020	10.31	1046	10.66	1072	11.00
14,000	872	9.33	901	9.71	930	10.09	958	10.45	985	10.82	1012	11.19	1037	11.55	1063	11.91	1088	12.27	1113	12.63
15,000	926	10.98	954	11.37	981	11.76	1008	12.15	1033	12.53	1059	12.91	1083	13.28	1108	13.66	1131	14.03	1155	14.40
16,000	980	12.79	1007	13.20	1033	13.60	1058	14.00	1082	14.40	1106	14.79	1130	15.18	1153	15.57	1176	15.96	1199	16.35
17,000	1035	14.77	1060	15.19	1085	15.61	1109	16.03	1132	16.44	1155	16.84	1178	17.25	1200	17.65	1222	18.05	1243	18.46
17,500	1062	15.83	1087	16.25	1111	16.68	1134	17.10	1157	17.52	1180	17.94	1202	18.35	1224	18.76	1245	19.17	1266	19.58

50A2,A3,A6,A7035 (35 TONS) (cont)

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
7,000	903	4.40	933	4.62	962	4.84	990	5.06	1017	5.27	1043	5.48	1068	5.69	1092	5.89	1116	6.09	1139	6.28
8,000	932	5.27	962	5.52	991	5.77	1019	6.02	1045	6.26	1071	6.50	1097	6.73	1121	6.96	1145	7.19	1168	7.42
9,000	961	6.24	990	6.52	1019	6.79	1047	7.06	1073	7.33	1099	7.59	1125	7.85	1149	8.11	1173	8.37	1196	8.62
10,000	992	7.32	1020	7.62	1048	7.91	1075	8.20	1102	8.49	1127	8.78	1152	9.07	1177	9.35	1201	9.63	1224	9.91
10,500	1008	7.90	1036	8.21	1063	8.51	1090	8.82	1116	9.12	1142	9.41	1166	9.71	1191	10.01	1214	10.30	1238	10.59
11,000	1025	8.52	1052	8.84	1079	9.15	1105	9.46	1131	9.77	1156	10.08	1181	10.39	1205	10.69	1228	10.99	1252	11.29
12,000	1060	9.86	1086	10.19	1112	10.52	1137	10.85	1162	11.17	1187	11.50	1211	11.82	1234	12.15	1257	12.47	1280	12.79
13,000	1097	11.35	1122	11.69	1147	12.03	1171	12.37	1195	12.72	1219	13.06	1242	13.40	1265	13.74	1287	14.08	—	—
14,000	1137	12.98	1161	13.34	1184	13.69	1208	14.05	1231	14.41	1253	14.76	1276	15.12	1298	15.47	—	—	—	—
15,000	1178	14.77	1201	15.15	1223	15.51	1246	15.88	1268	16.25	1289	16.62	—	—	—	—	—	—	—	—
16,000	1221	16.73	1243	17.11	1264	17.50	1286	17.88	—	—	—	—	—	—	—	—	—	—	—	—
17,000	1265	18.85	1286	19.25	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
17,500	1287	19.98	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

50A2,A3,A6,A7040 (40 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
8,000	475	2.69	523	3.08	569	3.47	612	3.86	653	4.26	692	4.66	730	5.07	767	5.49	802	5.92	836	6.36
9,000	521	3.53	565	3.94	606	4.36	646	4.78	684	5.20	721	5.63	757	6.06	791	6.49	825	6.94	857	7.39
10,000	568	4.52	608	4.96	646	5.40	683	5.84	719	6.29	753	6.74	787	7.20	819	7.65	851	8.11	882	8.58
11,000	615	5.68	652	6.14	687	6.60	722	7.07	755	7.55	788	8.02	819	8.50	850	8.97	880	9.46	909	9.94
12,000	663	7.01	697	7.49	730	7.98	762	8.47	794	8.97	824	9.47	854	9.96	883	10.47	912	10.97	939	11.48
13,000	712	8.55	743	9.03	774	9.54	804	10.05	834	10.57	862	11.09	891	11.61	918	12.13	945	12.66	972	13.19
14,000	760	10.24	790	10.76	819	11.29	847	11.82	875	12.36	902	12.90	929	13.45	955	13.99	981	14.54	1006	15.09
15,000	809	12.15	837	12.69	864	13.24	891	13.79	917	14.35	943	14.91	968	15.48	993	16.04	1018	16.62	1042	17.18
16,000	859	14.27	885	14.83	910	15.40	936	15.97	960	16.55	985	17.13	1009	17.71	1033	18.30	1056	18.89	1079	19.48
17,000	908	16.61	933	17.19	957	17.77	981	18.36	1004	18.96	1028	19.56	1051	20.16	1073	20.77	1096	21.38	1118	21.99
18,000	958	19.18	981	19.77	1004	20.37	1027	20.98	1049	21.60	1071	22.22	1093	22.84	1115	23.46	1136	24.09	1157	24.72
19,000	1007	21.98	1030	22.59	1052	23.21	1073	23.84	1095	24.47	1116	25.10	1137	25.74	1157	26.39	1178	27.04	1198	27.68
20,000	1057	25.02	1079	25.65	1099	26.29	1120	26.93	1140	27.58	1161	28.23	1181	28.89	—	—	—	—	—	—

LEGEND

Bhp — Brake Horsepower

NOTES:

1. Fan performance is based on wet coils, economizer, roof curb, cabinet losses, and clean 2-in. filters.
2. Conversion — Bhp to watts:
Watts = $\frac{\text{Bhp} \times 746}{\text{Motor efficiency}}$
3. VAV units with variable capacity compressor can operate down to 100 cfm/ton. VAV units with standard scroll compressor or Humidi-Mizer are limited to 200 cfm/ton. Operation may be additionally limited by entering coil conditions.

Performance data (cont)



FAN PERFORMANCE — VERTICAL DISCHARGE UNITS (cont)

50A2,A3,A6,A7050 (50 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
10,000	577	4.62	617	5.06	655	5.50	692	5.95	727	6.40	761	6.85	794	7.30	827	7.76	858	8.22	889	8.69
11,000	625	5.80	661	6.26	697	6.73	731	7.20	764	7.67	796	8.14	827	8.62	858	9.10	888	9.58	917	10.07
12,000	673	7.15	707	7.63	740	8.12	772	8.62	803	9.11	833	9.61	863	10.11	891	10.61	920	11.12	947	11.62
13,000	722	8.69	753	9.19	784	9.70	814	10.22	843	10.74	872	11.26	900	11.78	927	12.31	954	12.83	980	13.36
14,000	771	10.43	800	10.95	829	11.48	857	12.01	885	12.55	912	13.10	938	13.64	964	14.19	990	14.74	1015	15.29
15,000	821	12.37	848	12.91	875	13.46	901	14.01	928	14.57	953	15.14	978	15.70	1003	16.27	1028	16.84	1052	17.41
16,000	870	14.52	896	15.08	922	15.65	947	16.22	971	16.80	996	17.39	1020	17.97	1043	18.56	1066	19.15	1089	19.75
17,000	920	16.89	945	17.48	969	18.06	993	18.65	1016	19.25	1039	19.86	1062	20.46	1084	21.07	1107	21.68	1129	22.30
18,000	971	19.50	994	20.10	1017	20.71	1039	21.32	1061	21.93	1083	22.55	1105	23.18	1126	23.80	1148	24.44	1169	25.07
19,000	1021	22.35	1043	22.96	1065	23.59	1086	24.21	1107	24.85	1128	25.49	1149	26.13	1170	26.78	1190	27.42	1210	28.08
20,000	1071	25.43	1092	26.07	1113	26.71	1133	27.36	1154	28.01	1174	28.66	1194	29.33	1213	29.99	1233	30.65	1252	31.33

50A2,A3,A6,A7050 (50 TONS) (cont)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
10,000	919	9.17	948	9.64	977	10.13	1005	10.62	1032	11.12	1059	11.63	1086	12.14	1112	12.66	1137	13.18	1162	13.71
11,000	945	10.56	973	11.05	1001	11.55	1027	12.06	1054	12.57	1080	13.09	1105	13.61	1130	14.14	1155	14.67	1179	15.21
12,000	975	12.13	1001	12.64	1027	13.16	1053	13.68	1078	14.21	1103	14.74	1128	15.27	1152	15.81	1176	16.35	1199	16.90
13,000	1006	13.89	1032	14.42	1057	14.96	1081	15.49	1105	16.03	1129	16.58	1153	17.12	1176	17.68	1199	18.23	1221	18.80
14,000	1040	15.84	1064	16.39	1088	16.94	1112	17.50	1135	18.06	1158	18.62	1180	19.18	1203	19.75	1225	20.32	1246	20.90
15,000	1075	17.99	1098	18.56	1121	19.13	1144	19.71	1166	20.29	1188	20.86	1210	21.45	1231	22.03	1253	22.62	1274	23.21
16,000	1112	20.34	1134	20.93	1156	21.53	1178	22.12	1199	22.72	1221	23.32	1241	23.92	1262	24.52	1283	25.13	—	—
17,000	1150	22.91	1172	23.52	1193	24.14	1214	24.76	1234	25.37	1255	25.99	1275	26.61	1295	27.23	—	—	—	—
18,000	1190	25.70	1210	26.34	1230	26.97	1250	27.61	1270	28.25	1290	28.89	—	—	—	—	—	—	—	—
19,000	1230	28.73	1250	29.38	1269	30.04	1289	30.70	—	—	—	—	—	—	—	—	—	—	—	—
20,000	1271	31.99	1290	32.67	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

50A2,A3,A6,A7060 (60 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
12,000	450	4.02	509	4.71	560	5.41	605	6.12	647	6.86	686	7.62	723	8.40	757	9.21	790	10.04	821	10.89
14,000	505	5.74	558	6.49	606	7.24	649	8.01	689	8.79	727	9.59	762	10.40	795	11.24	827	12.09	857	12.96
15,000	533	6.75	584	7.53	630	8.32	672	9.11	711	9.91	748	10.73	782	11.56	815	12.41	846	13.28	876	14.17
16,000	561	7.88	610	8.68	655	9.50	696	10.32	734	11.14	770	11.98	803	12.84	836	13.71	866	14.59	896	15.49
17,000	590	9.12	637	9.95	680	10.79	720	11.64	757	12.49	792	13.35	825	14.23	857	15.12	887	16.02	916	16.94
18,000	619	10.48	664	11.33	706	12.20	744	13.07	781	13.96	815	14.84	847	15.74	878	16.65	908	17.57	937	18.50
19,000	648	11.96	692	12.84	732	13.74	769	14.64	805	15.54	838	16.45	870	17.37	900	18.30	930	19.24	958	20.19
20,000	678	13.57	719	14.47	758	15.40	795	16.32	829	17.25	862	18.19	893	19.13	923	20.08	952	21.04	979	22.01
21,000	707	15.30	748	16.24	785	17.19	821	18.14	854	19.09	886	20.05	917	21.02	946	22.00	974	22.98	1001	23.97
22,000	737	17.18	776	18.14	812	19.11	847	20.09	879	21.07	911	22.06	940	23.05	969	24.04	997	25.05	1024	26.06
23,000	767	19.20	804	20.18	840	21.17	873	22.17	905	23.18	935	24.19	965	25.21	993	26.23	1020	27.25	1046	28.28
24,000	797	21.35	833	22.36	867	23.38	900	24.40	931	25.43	961	26.47	989	27.51	1017	28.55	1044	29.60	1070	30.65
25,000	827	23.66	862	24.68	895	25.72	927	26.78	957	27.83	986	28.89	1014	29.95	1041	31.02	1068	32.09	1093	33.17
26,000	857	26.11	891	27.16	923	28.23	954	29.30	984	30.38	1012	31.46	1040	32.55	1066	33.64	1092	34.73	1117	35.83
27,000	888	28.72	920	29.79	952	30.88	982	31.97	1011	33.08	1038	34.19	1065	35.29	1091	36.40	1117	37.52	1141	38.64

LEGEND

Bhp — Brake Horsepower

NOTES:

- Fan performance is based on wet coils, economizer, roof curb, cabinet losses, and clean 2-in. filters.

- Conversion — Bhp to watts:

$$\text{Watts} = \frac{\text{Bhp} \times 746}{\text{Motor efficiency}}$$
- VAV units with variable capacity compressor can operate down to 100 cfm/ton. VAV units with standard scroll compressor or Humidi-Mizer are limited to 200 cfm/ton. Operation may be additionally limited by entering coil conditions.

Performance data (cont)



FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS

48A4,A5,A8,A9 020 (20 TONS)		Available External Static Pressure (in. wg)																			
Airflow (Cfm)	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0		
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	
4,000	339	0.71	414	0.97	478	1.25	534	1.54	585	1.84	631	2.14	674	2.44	714	2.75	751	3.06	787	3.37	
5,000	384	1.10	452	1.37	510	1.66	563	1.96	611	2.28	656	2.60	698	2.93	738	3.27	775	3.60	811	3.94	
6,000	433	1.61	494	1.89	548	2.19	597	2.51	643	2.84	686	3.18	726	3.52	764	3.88	800	4.23	835	4.60	
7,000	484	2.27	540	2.56	590	2.87	636	3.19	679	3.53	719	3.88	757	4.24	794	4.61	829	4.98	863	5.36	
7,500	511	2.66	563	2.95	612	3.26	656	3.59	698	3.94	737	4.29	775	4.66	810	5.03	845	5.41	877	5.79	
8,000	538	3.09	588	3.38	634	3.70	678	4.03	718	4.38	756	4.74	793	5.11	827	5.49	861	5.87	893	6.26	
9,000	593	4.07	639	4.37	682	4.69	722	5.03	760	5.39	796	5.76	831	6.13	864	6.52	896	6.91	927	7.32	
10,000	649	5.23	691	5.54	731	5.87	769	6.21	805	6.58	839	6.95	872	7.34	904	7.73	934	8.13	964	8.54	

48A4,A5,A8,A9 020 (20 TONS) (cont)		Available External Static Pressure (in. wg)																			
Airflow (Cfm)	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0		
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	
4,000	820	3.68	852	3.99	883	4.30	912	4.62	940	4.93	967	5.25	993	5.57	1019	5.89	1043	6.21	1067	6.53	
5,000	844	4.28	877	4.63	907	4.97	937	5.31	966	5.66	993	6.01	1020	6.35	1046	6.70	1071	7.05	1095	7.40	
6,000	869	4.96	901	5.33	931	5.70	961	6.07	990	6.44	1017	6.81	1044	7.19	1070	7.57	1096	7.94	1121	8.32	
7,000	895	5.74	926	6.13	956	6.52	986	6.91	1014	7.30	1042	7.70	1068	8.10	1094	8.50	1120	8.90	1145	9.30	
7,500	909	6.18	940	6.57	970	6.97	999	7.37	1027	7.78	1054	8.18	1081	8.59	1107	9.00	1132	9.41	1157	9.82	
8,000	925	6.66	955	7.06	984	7.46	1013	7.87	1040	8.28	1067	8.69	1094	9.11	1119	9.53	1144	9.95	1169	10.37	
9,000	957	7.72	986	8.13	1015	8.55	1042	8.97	1069	9.39	1096	9.82	1121	10.25	1146	10.69	1171	11.12	1195	11.56	
10,000	993	8.96	1021	9.38	1048	9.80	1075	10.23	1101	10.67	1126	11.11	1151	11.55	1176	12.00	1200	12.45	—	—	

48A4,A5,A8,A9 025-030 (25 THRU 30 TONS)		Available External Static Pressure (in. wg)																			
Airflow (Cfm)	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0		
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	
5,000	389	1.11	456	1.38	514	1.68	566	1.98	614	2.30	659	2.62	701	2.95	740	3.29	777	3.62	813	3.96	
6,000	439	1.64	499	1.92	553	2.22	602	2.54	647	2.87	689	3.21	730	3.56	768	3.91	804	4.27	838	4.63	
7,000	492	2.31	546	2.60	596	2.91	641	3.24	684	3.58	724	3.93	762	4.29	798	4.66	833	5.03	867	5.41	
8,000	546	3.14	596	3.43	642	3.75	684	4.09	724	4.44	762	4.80	798	5.17	833	5.55	866	5.93	898	6.32	
9,000	602	4.13	647	4.43	690	4.76	730	5.10	768	5.46	803	5.83	838	6.21	871	6.60	903	7.00	933	7.40	
10,000	659	5.31	701	5.62	740	5.95	777	6.30	813	6.67	847	7.04	880	7.43	911	7.83	942	8.23	971	8.64	
11,000	717	6.67	755	6.99	792	7.33	827	7.68	860	8.06	893	8.44	924	8.83	954	9.24	983	9.65	1011	10.07	
12,000	775	8.23	811	8.56	845	8.90	878	9.27	909	9.64	940	10.03	970	10.43	999	10.84	1026	11.26	1054	11.69	
13,000	834	9.99	867	10.33	899	10.68	930	11.05	960	11.44	989	11.83	1017	12.24	1045	12.65	1072	13.08	1098	13.51	
14,000	893	11.97	924	12.32	954	12.68	983	13.06	1012	13.44	1039	13.85	1066	14.26	1093	14.68	1118	15.11	1143	15.54	
15,000	953	14.17	982	14.53	1010	14.90	1037	15.28	1064	15.68	1091	16.08	1116	16.50	1142	16.93	1166	17.36	1190	17.80	

48A4,A5,A8,A9 025-030 (25 THRU 30 TONS) (cont)		Available External Static Pressure (in. wg)																			
Airflow (Cfm)	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0		
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	
5,000	846	4.31	879	4.65	909	4.99	939	5.34	968	5.68	995	6.03	1022	6.38	1048	6.73	1073	7.08	1097	7.43	
6,000	872	5.00	903	5.36	934	5.73	964	6.10	992	6.48	1020	6.85	1047	7.22	1073	7.60	1098	7.98	1123	8.36	
7,000	899	5.79	930	6.18	960	6.57	989	6.96	1018	7.36	1045	7.75	1072	8.15	1098	8.55	1123	8.95	1148	9.35	
8,000	930	6.72	960	7.12	989	7.53	1017	7.94	1045	8.35	1072	8.76	1098	9.18	1124	9.60	1148	10.02	1173	10.44	
9,000	963	7.80	992	8.22	1020	8.63	1048	9.06	1075	9.48	1101	9.91	1126	10.34	1151	10.78	1176	11.21	1200	11.65	
10,000	1000	9.06	1028	9.48	1055	9.91	1081	10.34	1107	10.77	1133	11.22	1157	11.66	1182	12.11	—	—	—	—	
11,000	1039	10.49	1066	10.92	1092	11.36	1117	11.80	1142	12.24	1167	12.69	1191	13.15	—	—	—	—	—	—	
12,000	1080	12.12	1106	12.56	1131	13.00	1156	13.45	1180												

Performance data (cont)

Carrier

FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)

48A4,A5,A8,A9 035 (35 TONS)

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
7,000	553	2.59	602	2.92	648	3.26	691	3.61	732	3.95	770	4.29	807	4.63	842	4.96	875	5.29	907	5.62
8,000	612	3.45	656	3.81	698	4.17	738	4.53	776	4.90	812	5.27	847	5.63	881	6.00	913	6.36	944	6.72
9,000	672	4.47	712	4.86	750	5.24	787	5.62	823	6.01	857	6.39	890	6.78	922	7.17	953	7.56	983	7.95
10,000	733	5.67	769	6.08	805	6.48	839	6.88	872	7.28	904	7.69	935	8.10	966	8.51	995	8.92	1024	9.33
10,500	763	6.33	798	6.75	832	7.17	865	7.58	897	7.99	929	8.40	959	8.82	989	9.24	1017	9.66	1046	10.08
11,000	794	7.04	828	7.47	861	7.90	892	8.32	923	8.74	954	9.16	983	9.59	1012	10.01	1040	10.44	1067	10.87
12,000	855	8.60	887	9.06	918	9.51	948	9.95	977	10.39	1005	10.83	1033	11.27	1060	11.71	1087	12.16	1113	12.60
13,000	917	10.36	947	10.84	976	11.31	1004	11.77	1031	12.23	1058	12.69	1084	13.14	1110	13.60	1135	14.06	1160	14.52
14,000	980	12.32	1008	12.82	1035	13.31	1061	13.79	1087	14.27	1112	14.75	1137	15.22	1161	15.70	1185	16.17	1209	16.65
15,000	1042	14.49	1069	15.01	1094	15.52	1119	16.03	1143	16.53	1167	17.02	1191	17.51	1214	18.01	1237	18.50	1260	18.99
16,000	1105	16.88	1130	17.42	1154	17.96	1178	18.48	1201	19.00	1224	19.51	1246	20.02	1268	20.53	1290	21.04	—	—
17,000	1168	19.49	1191	20.06	1214	20.61	1237	21.16	1259	21.69	1281	22.23	—	—	—	—	—	—	—	—
17,500	1200	20.88	1222	21.46	1245	22.03	1267	22.58	1288	23.13	—	—	—	—	—	—	—	—	—	—

48A4,A5,A8,A9 035 (35 TONS) (cont)

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
7,000	937	5.94	967	6.26	995	6.57	1022	6.87	1048	7.18	1073	7.48	1098	7.78	1122	8.07	1145	8.36	1168	8.66
8,000	974	7.08	1003	7.43	1031	7.77	1058	8.12	1084	8.46	1109	8.79	1134	9.13	1158	9.46	1181	9.78	1204	10.11
9,000	1012	8.33	1041	8.72	1068	9.10	1094	9.47	1120	9.85	1145	10.22	1169	10.58	1193	10.95	1216	11.31	1239	11.66
10,000	1052	9.74	1080	10.15	1106	10.55	1132	10.96	1157	11.36	1182	11.76	1206	12.16	1229	12.55	1252	12.95	1275	13.34
10,500	1073	10.50	1100	10.92	1126	11.34	1151	11.75	1176	12.17	1201	12.59	1224	13.00	1248	13.41	1271	13.82	1293	14.22
11,000	1094	11.30	1120	11.73	1146	12.16	1171	12.59	1196	13.02	1220	13.45	1243	13.87	1266	14.30	1289	14.72	—	—
12,000	1138	13.05	1163	13.50	1188	13.95	1212	14.40	1236	14.84	1259	15.30	1282	15.74	—	—	—	—	—	—
13,000	1184	14.99	1208	15.45	1232	15.92	1255	16.39	1278	16.85	—	—	—	—	—	—	—	—	—	—
14,000	1232	17.13	1255	17.61	1278	18.09	—	—	—	—	—	—	—	—	—	—	—	—	—	—
15,000	1282	19.48	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
16,000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
17,000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
17,500	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

48A4,A5,A8,A9 040 (40 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
8,000	526	3.10	573	3.50	617	3.91	660	4.33	700	4.75	740	5.18	778	5.62	814	6.07	850	6.53	884	7.00
9,000	579	4.08	621	4.51	662	4.95	701	5.39	738	5.83	775	6.28	810	6.74	845	7.21	878	7.69	911	8.17
10,000	633	5.24	671	5.70	709	6.16	744	6.62	779	7.09	813	7.57	846	8.05	879	8.53	910	9.03	941	9.53
11,000	687	6.59	723	7.07	757	7.56	790	8.05	823	8.54	854	9.04	885	9.54	916	10.05	945	10.56	974	11.08
12,000	742	8.15	775	8.65	807	9.17	838	9.68	868	10.20	898	10.72	927	11.24	955	11.77	983	12.30	1011	12.84
13,000	797	9.92	827	10.45	857	10.98	887	11.52	915	12.07	943	12.61	970	13.15	997	13.70	1024	14.25	1050	14.81
14,000	852	11.92	881	12.47	909	13.03	936	13.59	963	14.15	990	14.72	1016	15.29	1041	15.86	1066	16.43	1091	17.01
15,000	908	14.15	935	14.72	961	15.31	987	15.89	1013	16.48	1038	17.06	1062	17.65	1086	18.25	1110	18.84	1134	19.44
16,000	964	16.63	989	17.23	1014	17.83	1039	18.43	1063	19.04	1086	19.65	1110	20.26	1133	20.88	1156	21.49	1178	22.11
17,000	1021	19.37	1044	19.98	1068	20.60	1091	21.23	1114	21.86	1136	22.49	1158	23.12	1180	23.76	1202	24.39	1223	25.03
18,000	1077	22.37	1099	23.01	1122	23.64	1144	24.29	1165	24.94	1187	25.59	1208	26.25	1229	26.90	1250	27.56	1270	28.22
19,000	1133	25.65	1155	26.30	1176	26.96	1197	27.62	1217	28.29	1238	28.96	—	—	—	—	—	—	—	—
20,000	1190	29.21	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

LEGEND

Bhp — Brake Horsepower

NOTES:

1. Fan performance is based on wet coils, economizer, roof curb, cabinet losses, and clean 2-in. filters.

2. Conversion — Bhp to watts:

$$\text{Watts} = \frac{\text{Bhp} \times 746}{\text{Motor efficiency}}$$

3. VAV units with variable capacity compressor can operate down to 100 cfm/ton. VAV units with standard scroll compressor or Humidi-Mizer are limited to 200 cfm/ton. Operation may be additionally limited by entering coil conditions.

Performance data (cont)



FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)

48A4,A5,A8,A9 050 (50 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
10,000	642	5.35	680	5.80	717	6.27	753	6.73	787	7.20	821	7.68	854	8.16	886	8.65	917	9.14	948	9.65
11,000	696	6.72	732	7.20	766	7.69	799	8.18	831	8.67	863	9.17	893	9.68	923	10.18	953	10.70	982	11.21
12,000	751	8.29	784	8.80	816	9.32	847	9.83	877	10.35	906	10.87	935	11.40	964	11.92	991	12.46	1019	12.99
13,000	807	10.09	837	10.62	867	11.16	896	11.70	924	12.24	952	12.78	979	13.33	1006	13.88	1032	14.43	1058	14.99
14,000	863	12.12	891	12.67	919	13.23	946	13.79	973	14.36	999	14.92	1025	15.49	1050	16.06	1075	16.64	1100	17.21
15,000	919	14.38	946	14.96	972	15.54	997	16.12	1023	16.71	1047	17.30	1072	17.89	1096	18.48	1120	19.08	1143	19.68
16,000	975	16.90	1000	17.49	1025	18.09	1049	18.70	1073	19.31	1097	19.92	1120	20.53	1143	21.15	1165	21.76	1188	22.38
17,000	1032	19.67	1056	20.29	1079	20.91	1102	21.54	1125	22.17	1147	22.80	1169	23.44	1191	24.07	1213	24.71	1234	25.35
18,000	1089	22.71	1111	23.35	1134	23.99	1155	24.64	1177	25.29	1198	25.95	1219	26.60	1240	27.26	1261	27.92	1281	28.58
19,000	1146	26.04	1167	26.69	1188	27.35	1209	28.02	1230	28.69	1250	29.37	1270	30.04	1290	30.72	—	—	—	—
20,000	1203	29.65	1224	30.32	1244	31.00	1263	31.69	1283	32.38	—	—	—	—	—	—	—	—	—	—

48A4,A5,A8,A9 050 (50 TONS) (cont)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
10,000	978	10.15	1008	10.67	1036	11.19	1064	11.72	1092	12.25	1119	12.79	1145	13.33	1171	13.88	1196	14.43	1221	14.99
11,000	1010	11.74	1038	12.27	1066	12.81	1093	13.35	1119	13.90	1145	14.45	1171	15.01	1196	15.57	1220	16.14	1245	16.72
12,000	1046	13.53	1072	14.08	1098	14.63	1124	15.19	1149	15.76	1174	16.32	1199	16.90	1223	17.48	1247	18.06	1270	18.65
13,000	1084	15.55	1109	16.11	1134	16.68	1158	17.26	1182	17.84	1206	18.42	1230	19.01	1253	19.60	1276	20.20	1299	20.80
14,000	1124	17.79	1148	18.38	1171	18.97	1195	19.55	1218	20.15	1241	20.75	1263	21.35	1285	21.96	—	—	—	—
15,000	1166	20.27	1189	20.88	1211	21.49	1234	22.09	1256	22.71	1277	23.32	1299	23.94	—	—	—	—	—	—
16,000	1210	23.00	1231	23.62	1253	24.25	1274	24.88	1295	25.51	—	—	—	—	—	—	—	—	—	—
17,000	1255	25.99	1276	26.63	1296	27.27	—	—	—	—	—	—	—	—	—	—	—	—	—	—
18,000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
19,000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
20,000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

48A4,A5,A8,A9 060 (60 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
12,000	516	4.81	569	5.54	617	6.30	660	7.10	701	7.93	739	8.79	774	9.68	808	10.59	841	11.52	872	12.46
14,000	584	6.90	632	7.69	676	8.50	716	9.33	754	10.20	790	11.10	824	12.02	857	12.97	888	13.94	917	14.92
15,000	619	8.13	664	8.96	706	9.79	745	10.65	782	11.53	817	12.44	850	13.38	882	14.35	912	15.33	941	16.34
16,000	654	9.49	697	10.36	737	11.22	775	12.10	811	13.00	845	13.93	877	14.88	908	15.86	938	16.86	966	17.88
17,000	689	10.99	730	11.90	769	12.79	806	13.69	840	14.61	873	15.56	904	16.53	935	17.52	964	18.54	992	19.58
18,000	725	12.64	764	13.58	801	14.51	837	15.43	870	16.38	902	17.34	933	18.32	962	19.33	990	20.36	1018	21.41
19,000	760	14.43	798	15.41	834	16.37	868	17.32	900	18.29	932	19.27	961	20.27	990	21.29	1018	22.34	1045	23.40
20,000	796	16.37	833	17.39	867	18.39	900	19.37	931	20.36	962	21.36	991	22.38	1019	23.42	1046	24.48	1072	25.56
21,000	832	18.47	867	19.54	901	20.56	932	21.57	963	22.59	992	23.61	1020	24.65	1048	25.71	1074	26.78	1100	27.87
22,000	869	20.74	902	21.84	934	22.90	965	23.94	995	24.98	1023	26.03	1051	27.09	1077	28.17	1103	29.26	1129	30.36
23,000	905	23.17	937	24.31	968	25.40	998	26.48	1027	27.55	1055	28.62	1081	29.70	1107	30.79	1133	31.90	1157	33.02
24,000	942	25.78	973	26.95	1003	28.08	1032	29.18	1059	30.28	1086	31.38	1113	32.48	1138	33.59	1163	34.72	1187	35.86
25,000	978	28.56	1008	29.77	1037	30.93	1065	32.07	1092	33.20	1119	34.32	1144	35.44	1169	36.58	1193	37.72	—	—
26,000	1015	31.52	1044	32.76	1072	33.96	1099	35.13	1125	36.29	1151	37.44	1176	38.59	—	—	—	—	—	—
27,000	1052	34.66	1080	35.94	1107	37.18	1133	38.38	1159	39.57	1184	40.75	—	—	—	—	—	—	—	—

LEGEND

Bhp — Brake Horsepower

NOTES:

1. Fan performance is based on wet coils, economizer, roof curb, cabinet losses, and clean 2-in. filters.

2. Conversion — Bhp to watts:

$$\text{Watts} = \frac{\text{Bhp} \times 746}{\text{Motor efficiency}}$$

3. VAV units with variable capacity compressor can operate down to 100 cfm/ton. VAV units with standard scroll compressor or Humidi-Mizer are limited to 200 cfm/ton. Operation may be additionally limited by entering coil conditions.

Performance data (cont)



FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)

50A4,A5,A8,A9 020 (20 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
4,000	322	0.62	399	0.82	464	1.04	521	1.26	572	1.48	619	1.71	662	1.93	702	2.16	739	2.38	774	2.61
5,000	361	0.95	431	1.17	491	1.41	545	1.65	594	1.89	640	2.14	682	2.39	722	2.64	759	2.89	795	3.14
6,000	405	1.41	467	1.64	524	1.88	574	2.14	621	2.40	664	2.67	705	2.93	744	3.20	780	3.47	816	3.75
7,000	451	2.00	508	2.22	559	2.48	607	2.75	651	3.02	693	3.30	732	3.58	769	3.87	804	4.16	839	4.45
7,500	475	2.34	529	2.57	579	2.82	625	3.10	668	3.38	708	3.66	746	3.96	783	4.25	818	4.55	851	4.84
8,000	500	2.72	551	2.95	598	3.21	643	3.48	685	3.77	724	4.06	762	4.36	797	4.66	832	4.96	864	5.27
9,000	550	3.60	596	3.83	640	4.09	682	4.36	721	4.66	759	4.96	795	5.27	829	5.58	862	5.90	893	6.22
10,000	601	4.63	644	4.86	684	5.12	723	5.40	760	5.70	796	6.01	830	6.33	863	6.65	894	6.98	925	7.31

50A4,A5,A8,A9 020 (20 TONS) (cont)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
4,000	808	2.84	840	3.06	870	3.29	900	3.52	928	3.75	955	3.98	981	4.21	1007	4.44	1031	4.67	1055	4.91
5,000	829	3.39	861	3.64	892	3.89	922	4.14	950	4.40	978	4.65	1005	4.90	1031	5.16	1056	5.41	1080	5.67
6,000	849	4.02	881	4.29	912	4.57	942	4.84	971	5.12	999	5.39	1026	5.67	1052	5.94	1077	6.22	1102	6.49
7,000	871	4.74	903	5.03	933	5.33	963	5.62	991	5.92	1019	6.21	1046	6.51	1072	6.80	1098	7.10	1123	7.40
7,500	883	5.14	915	5.44	945	5.75	974	6.05	1002	6.35	1030	6.66	1057	6.96	1083	7.27	1108	7.58	1133	7.88
8,000	896	5.58	927	5.89	957	6.20	985	6.51	1014	6.82	1041	7.13	1067	7.45	1093	7.76	1118	8.08	1143	8.39
9,000	924	6.54	954	6.86	983	7.19	1011	7.51	1038	7.84	1064	8.17	1090	8.50	1116	8.83	1141	9.16	1165	9.49
10,000	954	7.64	983	7.98	1011	8.31	1038	8.65	1065	8.99	1091	9.34	1116	9.68	1141	10.02	1165	10.37	1189	10.72

50A4,A5,A8,A9 025-030 (25 THRU 30 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
5,000	366	0.97	435	1.19	495	1.42	548	1.67	597	1.91	642	2.16	685	2.41	724	2.65	762	2.90	797	3.16
6,000	411	1.43	473	1.66	529	1.91	579	2.16	625	2.43	668	2.69	709	2.96	747	3.23	784	3.50	819	3.77
7,000	459	2.02	515	2.25	566	2.51	613	2.78	657	3.06	698	3.34	737	3.62	774	3.91	809	4.20	843	4.49
8,000	508	2.76	559	2.99	606	3.25	650	3.53	691	3.82	731	4.11	768	4.41	803	4.71	837	5.01	870	5.32
9,000	560	3.64	605	3.88	649	4.14	690	4.42	729	4.72	766	5.02	802	5.33	835	5.64	868	5.96	900	6.28
10,000	612	4.68	654	4.92	694	5.19	732	5.47	769	5.77	804	6.09	838	6.40	870	6.73	902	7.06	932	7.39
11,000	665	5.89	703	6.14	740	6.41	776	6.69	811	7.00	844	7.31	876	7.64	907	7.97	937	8.31	967	8.65
12,000	718	7.28	754	7.53	788	7.80	822	8.09	854	8.39	886	8.71	916	9.04	946	9.38	975	9.72	1003	10.07
13,000	772	8.85	806	9.11	838	9.38	869	9.67	899	9.98	929	10.30	958	10.63	987	10.97	1014	11.32	1041	11.68
14,000	826	10.61	858	10.87	888	11.15	917	11.44	946	11.75	974	12.07	1002	12.41	1029	12.75	1055	13.10	1081	13.46
15,000	881	12.57	910	12.84	939	13.12	967	13.41	994	13.72	1021	14.05	1047	14.38	1073	14.73	1098	15.08	1123	15.45

50A4,A5,A8,A9 025-030 (25 THRU 30 TONS) (cont)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
5,000	831	3.41	863	3.66	894	3.91	924	4.16	952	4.41	980	4.67	1007	4.92	1032	5.17	1057	5.43	1082	5.68
6,000	852	4.05	884	4.32	915	4.59	945	4.87	974	5.14	1001	5.42	1028	5.69	1054	5.97	1080	6.24	1105	6.52
7,000	875	4.78	907	5.07	937	5.37	967	5.66	995	5.95	1023	6.25	1049	6.55	1076	6.84	1101	7.14	1126	7.44
8,000	901	5.63	932	5.94	961	6.25	990	6.56	1018	6.87	1045	7.18	1072	7.50	1097	7.81	1123	8.13	1147	8.44
9,000	930	6.60	960	6.93	988	7.25	1016	7.58	1043	7.91	1070	8.23	1096	8.57	1121	8.90	1146	9.23	1170	9.56
10,000	961	7.72	990	8.06	1018	8.40	1045	8.74	1071	9.08	1097	9.42	1122	9.76	1147	10.11	1171	10.46	1194	10.80
11,000	995	8.99	1022	9.34	1049	9.69	1075	10.04	1101	10.39	1126	10.75	1151	11.11	1175	11.47	1198	11.82	—	—
12,000	1030	10.43	1057	10.78	1083	11.14	1108	11.51	1133	11.87	1157	12.24	1181	12.61	—	—	—	—		

Performance data (cont)



FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)

50A4,A5,A8,A9 035 (35 TONS)

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
7,000	522	2.06	573	2.32	620	2.57	664	2.82	705	3.06	744	3.30	780	3.54	815	3.78	849	4.01	881	4.24
8,000	576	2.75	622	3.03	665	3.30	706	3.57	745	3.84	782	4.10	817	4.36	850	4.62	883	4.87	914	5.12
9,000	630	3.57	672	3.86	712	4.16	750	4.45	787	4.74	822	5.02	855	5.30	888	5.58	919	5.86	949	6.13
10,000	686	4.52	724	4.84	761	5.15	797	5.46	831	5.77	864	6.07	896	6.37	927	6.67	957	6.97	986	7.26
10,500	714	5.05	750	5.38	786	5.70	821	6.02	854	6.34	886	6.65	917	6.96	947	7.27	977	7.57	1005	7.87
11,000	742	5.62	777	5.95	811	6.28	845	6.61	877	6.94	909	7.26	939	7.58	968	7.90	997	8.21	1025	8.52
12,000	799	6.88	831	7.22	863	7.57	894	7.91	925	8.25	954	8.60	983	8.93	1011	9.27	1039	9.60	1065	9.93
13,000	856	8.29	886	8.65	916	9.01	945	9.37	974	9.72	1002	10.08	1029	10.44	1056	10.79	1082	11.14	1108	11.49
14,000	914	9.87	942	10.24	969	10.61	997	10.98	1024	11.36	1050	11.73	1076	12.10	1102	12.47	1127	12.84	1152	13.20
15,000	971	11.62	998	12.00	1024	12.39	1050	12.77	1075	13.16	1100	13.54	1125	13.93	1149	14.31	1173	14.70	1197	15.08
16,000	1029	13.55	1054	13.94	1079	14.34	1103	14.74	1127	15.13	1151	15.53	1174	15.93	1198	16.33	1220	16.73	1243	17.12
17,000	1088	15.66	1111	16.07	1134	16.47	1157	16.88	1180	17.29	1203	17.70	1225	18.11	1247	18.53	1269	18.93	1290	19.34
17,500	1117	16.79	1140	17.20	1162	17.61	1184	18.02	1207	18.44	1229	18.86	1250	19.27	1272	19.69	1293	20.11	—	—

50A4,A5,A8,A9 035 (35 TONS) (cont)

AIRFLOW (Cfm)	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)																			
	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
7,000	912	4.46	942	4.68	970	4.90	998	5.12	1025	5.33	1051	5.54	1076	5.75	1101	5.96	1124	6.16	1148	6.36
8,000	944	5.37	973	5.62	1001	5.86	1029	6.11	1055	6.35	1081	6.58	1106	6.82	1130	7.05	1154	7.28	1177	7.51
9,000	978	6.40	1006	6.67	1034	6.93	1060	7.20	1086	7.46	1112	7.72	1136	7.98	1160	8.23	1184	8.49	1207	8.74
10,000	1014	7.55	1041	7.84	1068	8.12	1094	8.41	1119	8.69	1144	8.97	1168	9.25	1192	9.52	1215	9.80	1238	10.07
10,500	1033	8.17	1059	8.47	1086	8.77	1111	9.06	1136	9.35	1161	9.64	1184	9.93	1208	10.22	1231	10.50	1253	10.79
11,000	1052	8.83	1078	9.14	1104	9.44	1129	9.75	1154	10.05	1178	10.35	1201	10.64	1224	10.94	1247	11.23	1269	11.53
12,000	1091	10.26	1117	10.58	1142	10.90	1166	11.23	1190	11.54	1213	11.86	1236	12.18	1259	12.49	1281	12.80	—	—
13,000	1133	11.83	1157	12.17	1181	12.51	1205	12.85	1228	13.19	1251	13.52	1273	13.86	1295	14.19	—	—	—	—
14,000	1176	13.56	1199	13.92	1222	14.28	1245	14.63	1268	14.99	1290	15.34	—	—	—	—	—	—	—	—
15,000	1220	15.45	1243	15.83	1265	16.20	1287	16.58	—	—	—	—	—	—	—	—	—	—	—	—
16,000	1265	17.52	1287	17.91	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
17,000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
17,500	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

50A4,A5,A8,A9 040 (40 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
8,000	499	2.88	546	3.27	590	3.66	632	4.06	672	4.46	711	4.87	748	5.28	784	5.70	819	6.14	853	6.58
9,000	548	3.78	591	4.20	631	4.62	670	5.04	708	5.47	744	5.90	778	6.33	812	6.77	845	7.22	877	7.67
10,000	599	4.86	637	5.30	675	5.74	711	6.19	746	6.64	779	7.09	812	7.55	844	8.01	875	8.47	905	8.94
11,000	649	6.11	685	6.57	720	7.04	753	7.51	786	7.99	817	8.47	848	8.94	878	9.43	907	9.91	936	10.40
12,000	701	7.54	734	8.03	766	8.52	797	9.02	828	9.52	857	10.02	886	10.52	915	11.03	943	11.53	970	12.04
13,000	753	9.18	783	9.69	813	10.21	842	10.72	871	11.25	899	11.77	927	12.30	953	12.82	980	13.35	1006	13.88
14,000	805	11.03	833	11.56	861	12.09	889	12.63	916	13.18	942	13.73	968	14.27	994	14.82	1019	15.37	1044	15.92
15,000	857	13.09	884	13.64	910	14.20	936	14.76	962	15.32	987	15.89	1011	16.46	1036	17.03	1060	17.61	1083	18.18
16,000	910	15.38	935	15.95	960	16.53	984	17.11	1008	17.69	1032	18.28	1056	18.87	1079	19.47	1101	20.06	1124	20.66
17,000	963	17.91	986	18.50	1010	19.09	1033	19.69	1056	20.30	1078	20.91	1101	21.52	1123	22.13	1145	22.75	1166	23.36
18,000	1016	20.68	1038	21.29	1060	21.90	1082	22.52	1104	23.15	1126	23.77	1147	24.41	1168	25.04	1189	25.67	1209	26.31
19,000	1069	23.71	1090	24.33	1111	24.96	1132	25.60	1153	26.25	1173	26.89	1194	27.54	1214	28.19	1234	28.85	—	—
20,000	1122	26.99	1142	27.64	1162	28.29	1182	28.95	—	—	—	—	—	—	—	—	—	—	—	—

LEGEND

Bhp — Brake Horsepower

NOTES:

1. Fan performance is based on wet coils, economizer, roof curb, cabinet losses, and clean 2-in. filters.
2. Conversion — Bhp to watts:

$$\text{Watts} = \frac{\text{Bhp} \times 746}{\text{Motor efficiency}}$$
3. VAV units with variable capacity compressor can operate down to 100 cfm/ton. VAV units with standard scroll compressor or Humidi-Mizer are limited to 200 cfm/ton. Operation may be additionally limited by entering coil conditions.

Performance data (cont)



FAN PERFORMANCE — HORIZONTAL DISCHARGE UNITS (cont)

50A4,A5,A8,A9 050 (50 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
10,000	608	4.96	646	5.40	683	5.85	719	6.30	754	6.75	787	7.20	819	7.66	851	8.12	882	8.58	912	9.06
11,000	659	6.23	694	6.69	728	7.16	762	7.64	794	8.11	825	8.59	856	9.07	886	9.55	915	10.04	943	10.53
12,000	710	7.68	743	8.17	775	8.67	806	9.17	836	9.67	866	10.17	895	10.67	923	11.17	950	11.68	978	12.19
13,000	763	9.35	793	9.86	823	10.37	852	10.89	880	11.42	908	11.94	935	12.47	962	12.99	988	13.52	1014	14.05
14,000	815	11.22	843	11.75	871	12.29	899	12.83	925	13.38	952	13.92	978	14.47	1003	15.02	1028	15.57	1052	16.12
15,000	868	13.31	895	13.86	921	14.42	946	14.98	972	15.55	997	16.12	1021	16.69	1045	17.26	1069	17.83	1092	18.41
16,000	921	15.64	946	16.21	971	16.78	995	17.37	1019	17.96	1043	18.54	1066	19.14	1089	19.73	1111	20.32	1134	20.92
17,000	974	18.20	998	18.79	1021	19.39	1044	19.99	1067	20.60	1089	21.21	1112	21.82	1134	22.43	1155	23.05	1176	23.66
18,000	1028	21.01	1050	21.62	1072	22.24	1094	22.86	1116	23.49	1137	24.12	1158	24.75	1179	25.38	1200	26.02	1220	26.65
19,000	1081	24.08	1103	24.71	1124	25.35	1145	25.99	1165	26.63	1185	27.28	1206	27.93	1226	28.58	1245	29.24	1265	29.90
20,000	1135	27.42	1155	28.06	1175	28.72	1195	29.38	1215	30.04	1234	30.71	1254	31.38	1273	32.05	1292	32.72	—	—

50A4,A5,A8,A9 050 (50 TONS) (cont)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	2.2		2.4		2.6		2.8		3.0		3.2		3.4		3.6		3.8		4.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
10,000	941	9.53	970	10.02	998	10.51	1026	11.00	1053	11.51	1080	12.01	1106	12.53	1131	13.05	1156	13.58	1181	14.11
11,000	971	11.02	999	11.52	1026	12.02	1052	12.53	1078	13.05	1103	13.57	1132	14.09	1153	14.63	1177	15.16	1201	15.71
12,000	1004	12.70	1030	13.22	1056	13.74	1081	14.26	1106	14.79	1130	15.33	1154	15.86	1178	16.41	1201	16.96	1224	17.51
13,000	1039	14.59	1064	15.12	1088	15.66	1113	16.20	1136	16.74	1160	17.29	1183	17.85	1206	18.40	1228	18.96	1250	19.53
14,000	1076	16.68	1100	17.23	1123	17.79	1147	18.35	1169	18.91	1192	19.48	1214	20.04	1236	20.62	1257	21.19	1279	21.77
15,000	1115	18.98	1138	19.56	1160	20.14	1182	20.72	1204	21.30	1226	21.88	1247	22.47	1268	23.05	1289	23.65	—	—
16,000	1156	21.52	1178	22.11	1199	22.71	1220	23.31	1241	23.91	1262	24.51	1282	25.12	—	—	—	—	—	—
17,000	1198	24.28	1218	24.90	1239	25.52	1259	26.14	1279	26.76	1299	27.38	—	—	—	—	—	—	—	—
18,000	1240	27.29	1260	27.93	1280	28.57	1300	29.21	—	—	—	—	—	—	—	—	—	—	—	—
19,000	1284	30.55	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
20,000	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

50A4,A5,A8,A9 060 (60 TONS)

Airflow (Cfm)	Available External Static Pressure (in. wg)																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp	Rpm	Bhp
12,000	490	4.48	543	5.17	591	5.88	634	6.61	674	7.37	711	8.14	746	8.94	779	9.76	811	10.60	841	11.45
14,000	554	6.41	602	7.17	645	7.94	686	8.72	723	9.51	759	10.33	792	11.16	824	12.01	855	12.88	884	13.76
15,000	586	7.56	632	8.34	674	9.14	713	9.94	749	10.77	784	11.60	816	12.45	848	13.32	878	14.21	906	15.11
16,000	619	8.83	663	9.64	703	10.46	741	11.30	776	12.14	810	13.00	841	13.87	872	14.76	901	15.66	929	16.58
17,000	652	10.23	694	11.07	733	11.92	769	12.78	803	13.65	836	14.53	867	15.42	897	16.33	926	17.25	953	18.19
18,000	685	11.76	725	12.63	763	13.51	798	14.39	831	15.29	863	16.20	893	17.11	922	18.04	950	18.98	978	19.93
19,000	719	13.44	757	14.33	793	15.23	827	16.14	860	17.07	890	18.00	920	18.94	949	19.88	976	20.84	1003	21.81
20,000	753	15.26	789	16.18	824	17.10	857	18.04	888	18.99	918	19.94	947	20.90	975	21.87	1002	22.85	1028	23.84
21,000	787	17.23	822	18.17	855	19.12	887	20.08	918	21.05	947	22.03	975	23.02	1002	24.01	1029	25.01	1054	26.02
22,000	821	19.35	855	20.32	887	21.29	918	22.28	947	23.28	976	24.28	1003	25.28	1030	26.30	1056	27.32	1081	28.35
23,000	855	21.63	888	22.62	919	23.62	949	24.63	977	25.65	1005	26.68	1032	27.71	1058	28.75	1083	29.79	1108	30.85
24,000	889	24.07	921	25.08	951	26.11	980	27.14	1008	28.19	1035	29.24	1061	30.29	1086	31.35	1111	32.42	1135	33.49
25,000	924	26.67	954	27.71	983	28.76	1011	29.82	1038	30.89	1065	31.96	1090	33.04	1115	34.12	1139	35.21	1163	36.31
26,000	958	29.45	987	30.51	1016	31.59	1043	32.67	1069	33.76	1095	34.85	1120	35.95	1144	37.06	1168	38.17	1191	39.29
27,000	993	32.40	1021	33.49	1048	34.58	1075	35.69	1101	36.80	1126	37.92	1150	39.04	1174	40.17	1197	41.30	—	—

LEGEND

Bhp — Brake Horsepower

NOTES:

1. Fan performance is based on wet coils, economizer, roof curb, cabinet losses, and clean 2-in. filters.

2. Conversion — Bhp to watts:

$$\text{Watts} = \frac{\text{Bhp} \times 746}{\text{Motor efficiency}}$$

3. VAV units with variable capacity compressor can operate down to 100 cfm/ton. VAV units with standard scroll compressor or Humidi-Mizer are limited to 200 cfm/ton. Operation may be additionally limited by entering coil conditions.

Performance data (cont)



FAN PERFORMANCE — STANDARD AND MODULATING POWER EXHAUST

48/50A020-050 (20 to 50 Tons)

Airflow (Cfm)	208 V			230, 460, 575 V		
	ESP	Bhp	Watts	ESP	Bhp	Watts
7,700	0.60	3.69	4140	0.73	3.98	4460
7,900	0.56	3.74	4190	0.69	4.02	4510
8,100	0.51	3.78	4240	0.65	4.07	4560
8,500	0.41	3.83	4290	0.56	4.12	4620
8,900	0.31	3.93	4410	0.47	4.23	4740
9,300	0.20	4.07	4560	0.37	4.37	4900
9,700	0.11	4.17	4670	0.30	4.47	5010
10,100	0.04	4.25	4770	0.23	4.56	5110
10,500	—	—	—	0.17	4.66	5220
10,900	—	—	—	0.12	4.75	5330
11,300	—	—	—	0.07	4.80	5380
11,700	—	—	—	0.04	4.83	5420

48/50A060 (60 Tons)

Airflow (Cfm)	208 V			230, 460, 575 V		
	ESP	Bhp	Watts	ESP	Bhp	Watts
11,550	0.60	5.54	6210	0.73	5.97	6690
11,850	0.56	5.61	6285	0.69	6.03	6765
12,150	0.51	5.67	6360	0.65	6.10	6840
12,750	0.41	5.74	6435	0.56	6.18	6930
13,350	0.31	5.90	6615	0.47	6.34	7110
13,950	0.20	6.10	6840	0.37	6.56	7350
14,550	0.11	6.25	7005	0.30	6.70	7515
15,150	0.04	6.38	7155	0.23	6.84	7665
15,750	—	—	—	0.17	6.98	7830
16,350	—	—	—	0.12	7.13	7995
16,950	—	—	—	0.07	7.20	8070
17,550	—	—	—	0.04	7.25	8130

LEGEND

Bhp — Brake Horsepower
 ESP — External Static Pressure (in. wg)
 Watts — Input Watts to Motor

HIGH CAPACITY POWER EXHAUST ACCESSORY

PART NO.	VOLTAGE	CFM PERFORMANCE VS. STATIC PRESSURE				TOTAL AMPS	NOISE (dB)	
		1/4 in.	3/8 in.	1/2 in.	5/8 in.		at 1 foot	at 10 foot
Single Module								
CRPWREXH071A00	230V/3PH					12.8		
CRPWREXH072A00	460V/3PH	9,817	9,631	9,591	8,964	6.4	88	77
CRPWREXH073A00	575V/3PH					4.8		
Two Module								
CRPWREXH074A00	230V/3PH					25.6		
CRPWREXH075A00	460V/3PH	19,634	19,262	19,182	17,928	12.8	88	77
CRPWREXH076A00	575V/3PH					9.6		
Three Module								
CRPWREXH077A00	230V/3PH					38.4		
CRPWREXH078A00	460V/3PH	29,451	28,893	28,773	26,892	19.2	88	77
CRPWREXH079A00	575V/3PH					14.4		

HUMIDI-MIZER SYSTEM COMPONENT PRESSURE DROPS (in. wg) SIZE 020-035 UNITS

COMPONENT	AIRFLOW (cfm)					
	4,000	6,000	8,000	10,000	12,000	14,000
HUMIDI-MIZER	0.012	0.022	0.035	0.050	0.068	0.089

HUMIDI-MIZER SYSTEM COMPONENT PRESSURE DROPS (in. wg) SIZE 040,050 UNITS

COMPONENT	AIRFLOW (cfm)					
	8,000	10,000	12,000	14,000	16,000	18,000
HUMIDI-MIZER	0.035	0.050	0.068	0.089	0.112	0.137

HUMIDI-MIZER SYSTEM COMPONENT PRESSURE DROPS (in. wg) SIZE 060 UNITS

COMPONENT	AIRFLOW (cfm)					
	12,000	14,000	16,000	18,000	20,000	22,000
HUMIDI-MIZER	0.002	0.004	0.010	0.023	0.044	0.077

Performance data (cont)



SUPPLY MOTOR LIMITATIONS

Nominal		Maximum		Maximum Amps		Maximum Efficiency
Bhp	BkW	Bhp	BkW	230 v	460 v	
5	3.73	5.9	4.40	15.8	7.9	89.5
10	7.46	10.2	7.61	30.0	—	91.7
		11.8	8.80	—	15.0	91.7
15	11.19	15.3	11.41	46.0	—	93.0
		18.0	13.43	—	22.0	93.0
20	14.92	22.4	16.71	59.0	—	93.6
		23.4	17.46	—	28.7	93.6
25	18.65	28.9	21.56	73.0	—	93.6
		29.4	21.93	—	36.3	93.6
30	22.38	35.6	26.56	82.6	—	93.6
		34.7	25.89	—	41.7	93.6
40	29.84	42.0	31.33	110.0	55.0	94.5

LEGEND

Bhp — Brake Horsepower
BkW — Brake Kilowatts

NOTES:

- Extensive motor and electrical testing on the Carrier units has ensured that the full horsepower range of the motor can be utilized with confidence. Using the fan motors up to the horsepower ratings shown in the Motor Limitations table will not result in nuisance tripping or premature motor failures. Unit warranty will not be affected.
- All motors comply with Energy Policy Act (EPACT) Standards effective October 24, 1997.

AIR QUANTITY LIMITS (48A)

UNIT 48A	MINIMUM HEATING AIRFLOW CFM (Low Heat)	MINIMUM HEATING AIRFLOW CFM (High Heat)	MINIMUM COOLING AIRFLOW (VAV) CFM AT FULL LOAD	MINIMUM COOLING AIRFLOW CFM (CV)	MAXIMUM AIRFLOW CFM
020	5,900	6,100	4,000	6,000	10,000
025	5,900	6,100	5,000	7,500	12,500
027	5,900	6,100	5,400	8,100	13,500
030	5,900	6,100	6,000	9,000	15,000
035	5,900	10,100	7,000	10,500	17,500
040	7,600	10,100	8,000	12,000	20,000
050	7,600	10,100	10,000	13,500	20,000
060	11,000	14,700	12,000	18,000	27,000

LEGEND

CV — Constant Volume
Edb — Entering Dry Bulb
Ewb — Entering Wet Bulb
VAV — Variable Air Volume

NOTE: VAV units with variable capacity compressor can operate down to 100 cfm/ton. VAV units with standard scroll compressor or Humidi-MiZer are limited to 200 cfm/ton. Operation may be additionally limited by entering coil conditions.

AIR QUANTITY LIMITS (50A)

UNIT	COOLING		ELECTRIC HEAT	
	Min CFM	Max CFM*	Min CFM	Max CFM
50A2,A4,A6,A8020	6,000	10,000		
50A3,A5,A7,A9020	4,000	10,000		
50A2,A4,A6,A8025	7,500	12,500		
50A3,A5,A7,A9025	5,000	12,500		
50A2,A4,A6,A8027	8,100	13,500		
50A3,A5,A7,A9027	5,400	13,500	6,000	15,000
50A2,A4,A6,A8030	9,000	15,000		
50A3,A5,A7,A9030	6,000	15,000		
50A2,A4,A6,A8035	10,500	17,500		
50A3,A5,A7,A9035	7,000	17,500		
50A2,A4,A6,A8040	12,000	20,000		
50A3,A5,A7,A9040	8,000	20,000		
50A2,A4,A6,A8050	13,500	20,000	10,500	20,000
50A3,A5,A7,A9050	10,000	20,000		
50A2,A4,A6,A8060	18,000	27,000		
50A3,A5,A7,A9060	12,000	27,000	15,000	27,000

* Operation at these levels may be limited by entering evaporator air wet bulb temperatures.

NOTES:

- Extensive motor and electrical testing on the Carrier units has ensured that the full horsepower range of the motor can be utilized with confidence. Using the fan motors up to the horsepower ratings shown in the Motor Limitations table will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected.
- All motors comply with Energy Policy Act (EPACT) Standards effective October 24, 1997.

Control components

The 48/50A Series rooftops use the *ComfortLink* control system that has been developed for use in Carrier Commercial equipment. The control system monitors all operating conditions in the rooftop unit, as well as controlling the compressors, economizers, fans, heat, and other devices. It also has the capability of communicating with the Carrier Comfort Network® devices using the CCN protocol and other popular protocols including BACnet, MODBUS, LonWorks, etc.

The system uses a microprocessor and a series of boards, each with inputs and outputs. A local network communications bus (LEN) ties all the boards together into a system and enables the boards to communicate.

For in-depth detail on the control operation, set points, and configurations, see the 48/50A controls, start-up, service and troubleshooting manual.

For the 48/50A Series, the control consists of the following key components:

Main base board (MBB)

The MBB is the center of the *ComfortLink* control system. It contains the major portion of the operating software and controls the operation of the unit. The MBB continuously monitors inputs and outputs as well as data from the LEN and CCN communications channels. The MBB also controls 11 output relays. A complete list of the MBB and system I/O are contained in the table on page 72. The board is located in the main control box.

Economizer control board (ECB1)

The ECB1 controls the economizer actuator. The ECB1 controls the economizer motor using a digital communications signal that also provides operation and diagnostic data on the economizer motor. The ECB1 also controls the operation of the power exhaust motors and provides up to 6 stages of digitally sequenced power exhaust. Exhaust sequencing can be based on either the economizer motor position or the building pressure. On the A Series unit, the ECB1 board is located in an auxiliary box located at the end of the unit near the economizer motor. The board also contains a second LEN port that can be used with the handheld Navigator™ display.

Supply and building pressure control board (ECB2 or RXB)

The board, which is the same hardware as the ECB1, is used to control the supply fan inverter on the VAV units. It sends a 4 to 20 mA signal to the inverter based on a supply duct pressure sensor connected to the board. The board also accepts a signal from another pressure sensor that monitors building pressure and controls the operation of the optional modulating power exhaust system.

On units equipped with the variable capacity compressor and/or Humidi-MiZer system, this board is called the RXB. The RXB performs the same functions as the ECB2 and has additional inputs and outputs to control the variable

capacity compressor as well as the Humidi-MiZer adaptive dehumidification system. The ECB2/RXB is located in the auxiliary control box.

Staged gas heat board (SCB)

When the optional staged gas heat is used, the SCB board will be installed and will control the operation of the gas valves. It also provides additional sensors for monitoring the supply air temperature. This board is located in the gas heat section of the unit.

Integrated gas controller (IGC)

One IGC is provided with each bank of gas heat exchangers. It controls the direct spark ignition system and monitors the rollout switch, limit switches, and induced-draft motor Hall Effect sensor. It is equipped with an LED for diagnostics.

Controls expansion module (CEM)

The optional expansion module is used to provide inputs for demand limiting, remote set point, and other optional inputs. It is located in the main control box.

Compressor protection Cycle-LOC™ board (CS)

This board monitors the status of the compressor by sensing the current flow to the compressors; it then provides digital status signal to the MBB.

Expansion valve control board (EXV)

The optional EXV board controls both the condenser and bypass modulation valves of the Humidi-MiZer. This board also receives inputs to sense the evaporative discharge temperature if the unit has the Humidi-MiZer option. This board is located in the auxiliary control box.

Scrolling marquee display

This device is the keypad interface used to access the control information, read sensor values, test the unit, and monitor alarm status. The marquee display is a 4-key, 4-character, 16-segment LED (light-emitting diode) display. The display is very easy to operate using 4 buttons and a group of 11 LEDs that indicate the following menu structures:

- Run Status
- Service Test
- Temperatures
- Pressures
- Set Points
- Inputs
- Outputs
- Configuration
- Timeclock
- Operating Modes
- Alarms

Through the display, inputs and outputs can be checked for their value or status. Because the unit is equipped with suction pressure transducers and discharge saturation temperature sensors, it can also display pressures typically obtained from gages. The control includes a full alarm history which can be accessed from the display. Through the display, a built-in test routine can be used at start-up commission and during maintenance inspections to help diagnose operational problems with the unit.

Controls (cont)



MAIN BASE BOARD (MBB) INPUTS AND OUTPUTS

POINT NAME	POINT DESCRIPTION	I/O POINT NAME	PLUG AND PIN REFERENCE	SIGNAL PIN(S)	PORT STATE
INPUTS					
GASFAN	YAC Indoor Fan relay (fan request from YAC)	DI1	J6, 3-4	4	0 = 24vac, 1= 0vac
FSD	Fire Shutdown switch input	DI2	J6, 5-6	6	0 = 24vac, 1= 0vac
G	Thermostat 'G' input/Remote Occupied	DI3	J7, 1-2	2	0 = 24vac, 1= 0vac
W2	Thermostat 'W2' input	DI4	J7, 3-4	4	0 = 24vac, 1= 0vac
W1	Thermostat 'W1' input	DI5	J7, 5-6	6	0 = 24vac, 1= 0vac
Y2	Thermostat 'Y2' input	DI6	J7, 7-8	8	0 = 24vac, 1= 0vac
Y1	Thermostat 'Y1' input	DI7	J7, 9-10	10	0 = 24vac, 1= 0vac
CSB_A1	Compressor A1 current sensor	DIG1	J9, 10-12	10=5v, 11=Vin, 12=GND	0 = 5vdc, 1= 0vdc
CSB_A2	Compressor A2 current sensor	DIG2	J9, 7-9	7=5v, 8=Vin, 9=GND	0 = 5vdc, 1= 0vdc
CSB_B1	Compressor B1 current sensor	DIG3	J9, 4-6	4=5v, 5=Vin, 6 =GND	0 = 5vdc, 1= 0vdc
CSB_B2	Compressor B2 current sensor	DIG4	J9, 1-3	1=5v, 2=Vin, 3=GND	0 = 5vdc, 1= 0vdc
DP_A/SCTA	Circuit A saturated condensing pressure/temp	AN1	J8, 21-23	21=5v, 22=Vin, 23=GND (thermistor 21-22)	(0-5vdc, thermistor, ohms)
DP_B/SCTB	Circuit B saturated condensing pressure/temp	AN2	J8, 24-26	24=5v, 25=Vin, 26=GND (thermistor 24-25)	(0-5vdc, thermistor, ohms)
SP_A/SSTA	Circuit A saturated suction pressure/temp	AN3	J8, 15-17	15=5v, 16=Vin, 17=GND (thermistor 15-16)	(0-5vdc, thermistor, ohms)
SP_B/SSTB	Circuit B saturated suction pressure/temp	AN4	J8, 18-20	18=5v, 19=Vin, 20=GND (thermistor 18-20)	(0-5vdc, thermistor, ohms)
RAT	Return air temperature	AN5	J8, 9-10	9	(thermistor, ohms)
SA_TEMP	Supply air temperature	AN6	J8, 11-12	11	(thermistor, ohms)
OAT	Outdoor air temperature	AN7	J8, 13-14	13	(thermistor, ohms)
SPT	Space temperature (T55/56)	AN8	J8, 1-2	1	(thermistor, ohms)
SPTO	Space temperature offset (T56)	AN9	J8, 3-4	3	(thermistor, ohms)
IAQ/IAQMINOV	IAQ analog input	AN10	J8, 5-6	5	(thermistor, ohms)
FLTS	Filter Status	AN11	J8, 7-8	7	(thermistor, ohms)
OUTPUTS					
CMPB2	Compressor B2	RLY 1	J10, 20-21	20 = RLY1A (=RLY2A), 21 = RLY1B	1 = Closes RLY1A/RLY1B
CMPB1	Compressor B1	RLY 2	J10, 22-23	22 = RLY2A (=RLY1A), 23 = RLY2B	1 = Closes RLY2A/RLY2B
CMPA2	Compressor A2	RLY 3	J10, 24-25	24 = RLY3A (=RLY4A), 25 = RLY3B	1 = Closes RLY3A/RLY3B
CMPA1	Compressor A1	RLY 4	J10, 26-27	26 = RLY4A (=RLY3A), 27 = RLY4B	1 = Closes RLY4A/RLY4B
CONDFANB	Condenser fan B	RLY 5	J10, 10-11	10 = RLY5A (=RLY6A), 11 = RLY5B	1 = Closes RLY5A/RLY5B
CONDFANA	Condenser fan A	RLY 6	J10, 12-13	12 = RLY6A (=RLY5A), 13 = RLY6B	1 = Closes RLY6A/RLY6B
HS2	Heat stage 2	RLY7	J10, 14-16	14 = 15 = RLY7A, 16 = RLY7B	1 = Closes RLY7A/RLY7B
HS1	Heat stage 1	RLY 8	J10, 17-19	17 = 18 = RLY8A, 19 = RLY8B	1 = Closes RLY8A/RLY8B
HIR	Heat interlock relay	RLY 9	J10, 4-6	4 = 5 = RLY9A, 6 = RLY9B	1 = Closes RLY9A/RLY9B
SF	Supply fan	RLY 10	J10, 7-9	7 = 8 = RLY10A, 9 = RLY10B	1 = Closes RLY10A/RLY10B
ALRM	Alarm output relay	RLY 11	J10, 1-3	1 = 2 = RLY11A, 3 = RLY11B	1 = Closes RLY11A/RLY11B

LEGEND

IAQ — Indoor-Air Quality
YAC — Gas Heat Unit

CONTROLS EXPANSION MODULE (CEM) INPUTS

POINT NAME	POINT DESCRIPTION	I/O POINT NAME	PLUG AND PIN REFERENCE	SIGNAL PIN(S)	PORT STATE
INPUTS					
SFS	Supply Fan Status switch	DI 1	J7, 1-2	2	0 = 24vac, 1= 0vac
DMD_SW1	Demand Limit - SW1	DI 2	J7, 3-4	4	0 = 24vac, 1= 0vac
DMD_SW2/DHDDISCIN	Demand Limit - SW2 / Dehumidification Switch Input	DI 3	J7, 5-6	6	0 = 24vac, 1= 0vac
PRES	Pressurization	DI 4	J7, 7-8	8	0 = 24vac, 1= 0vac
EVAC	Evacuation	DI 5	J7, 9-10	10	0 = 24vac, 1= 0vac
PURG	Purge	DI 6	J7, 11-12	12	0 = 24vac, 1= 0vac
IAQIN	Indoor Air Quality Switch	DI 7	J7, 13-14	14	0 = 24vac, 1= 0vac
		AN7	J6, 1-3	2 (1 = loop power)	(0-20mA input)
DMDLMTMA	4-20mA Demand Limit	AN8	J6, 4-6	5 (4 = loop power)	(0-20mA input)
EDTRESMA	4-20mA Evaporator Discharge SP Reset	AN9	J6, 7-9	8 (7 = loop power)	(0-20mA input)
OAQ	Outside Air CO ₂ Sensor	AN10	J6, 10-12	11 (10 = loop power)	(0-20mA input)
SPRESET	SP Reset millamps	AN10	J6, 10-12	11 (10 = loop power)	(0-20mA input)
CEM_10K1/CEM_4201	CEM AN1 10k temp J5,1-2/CEM AN1 4-20 ma J5,1-2	AN1	J5, 1-2	1	(thermistor, ohms)
CEM_10K2/CEM_4202	CEM AN2 10k temp J5,3-4/CEM AN2 4-20 ma J5,3-4	AN2	J5, 3-4	3	(thermistor, ohms)
CEM_10K3/CEM_4203	CEM AN3 10k temp J5,5-6/CEM AN3 4-20 ma J5,5-6	AN3	J5, 5-6	5	(thermistor, ohms)
CEM_10K4/CEM_4204	CEM AN4 10k temp J5,7-8/CEM AN4 4-20 ma J5,7-8	AN4	J5, 7-8	7	(thermistor, ohms)
		AN5	J5, 9-10	9	(thermistor, ohms)
		AN6	J5, 11-12	11	(thermistor, ohms)

Controls (cont)



ECONOMIZER CONTROL BOARD (ECB1) INPUTS AND OUTPUTS

POINT NAME	POINT DESCRIPTION	I/O POINT NAME	PLUG AND PIN REFERENCE	SIGNAL PIN(S)	PORT STATE
INPUTS					
RMTIN	Remote occupancy	DI1	J4, 1-2	2	24VAC = 1, 0VAC = 0
ECONENBL, ECOORIDE	Economizer enable	DI2	J4, 3-4	4	24VAC = 1, 0VAC = 0
RARH	Return air relative humidity	AN1	J5, 1-3	1=24VDC, 2=0-20mA in, 3=GND	0-20mA
OARH	Outdoor air relative humidity	AN2	J5, 4-6	4=24VDC, 5=0-20mA in, 6=GND	0-20mA
OUTPUTS					
ECB1_AO1	ECB1, analog output 1	AO1	J9, 1-2	1=0-20mA, 2=GND	0-20mA OUT
ECONOCMD	Economizer actuator (digital control)	PP/MP	J7, 1-3	1=PP/MP Data, 2=24VAC, 3=GND	Belimo PP/MP Protocol
PE_A	Power Exhaust stage A	RLY1	J8, 1-3	1 = 2 = RLY1A, 3 = RLY1B	1 = Closes RLY1A/RLY1B
PE_B	Power Exhaust stage B	RLY 2	J8, 4-6	4 = 5 = RLY2A, 6 = RLY2B	1 = Closes RLY2A/RLY2B
PE_C	Power Exhaust stage C	RLY 3	J8, 7-9	7 = 8 = RLY3A, 9 = RLY3B	1 = Closes RLY3A/RLY3B
ECON_PWR	Economizer Power	RLY 6	J8, 16-18	16 = 17 = RLY6A, 18 = RLY6B	1 = Closes RLY6A/RLY6B

RXB CONTROL BOARD (ECB2) INPUTS AND OUTPUTS

POINT NAME	POINT DESCRIPTION	I/O POINT NAME	PLUG AND PIN REFERENCE	SIGNAL PIN(S)	PORT STATE
INPUTS					
		DI1	J4, 1-2	2=Vin, 1=24VAC	24VAC = 1, 0VAC = 0
		DI2	J4, 3-4	4=Vin, 3=24vac	24VAC = 1, 0VAC = 0
		DI3	J4, 5-6	6=Vin, 5=24vac	
		DI4	J4, 7-8	8=Vin, 7=24vac	
		DI5	J4, 9-10	10=Vin, 9=24vac	
		DI6	J4, 11-12	12=Vin, 11=24vac	
BP	Building static pressure	AN1	J5, 1-3	1=24VDC, 2=0-20mA in, 3=GND	0-20mA
SP	Supply Duct static pressure	AN2	J5, 4-6	4=24VDC, 5=0-20mA in, 6=GND	0-20mA
CCT	Air Temp Lvg Evap Coil	AN3	J6, 1-2	1=Vin, 2=GND	(thermistor, ohms)
DSDT	DS Discharge Temperature	AN4	J6, 3-4	3=Vin, 4=GND	(thermistor, ohms)
		AN5	J6, 5-6	5=Vin, 6=GND	(thermistor, ohms)
		AN6	J6, 7-8	7=Vin, 8=GND	(thermistor, ohms)
OUTPUTS					
SFAN_VFD	Supply Fan Inverter speed	AO1	J9, 1-2	1=0-20mA, 2=GND	0-20mA OUT
CMPDSCAP	Digital Scroll Solenoid	PP/MP	J7, 1-3	1=PP/MP Data, 2=24VAC, 3=GND	Belimo PP/MP Protocol
		RLY1	J8, 1-3	1 = 2 = RLY1A, 3 = RLY1B	1 = Closes RLY1A / RLY1B
		RLY2	J8, 4-6	4 = 5 = RLY2A, 6 = RLY2B	1 = Closes RLY2A / RLY2B
HUM3WVAL	Humidifier 3 Way Valve	RLY3	J8, 7-9	7 = 8 = RLY3A, 9 = RLY3B	1 = Closes RLY3A / RLY3B
		RLY4	J8, 10-12	10 = 11 = RLY4A, 12 = RLY4B	1 = Closes RLY4A / RLY4B
		RLY5	J8, 13-15	13 = 14 = RLY5A, 15 = RLY5B	1 = Closes RLY5A / RLY5B
HGBP	Hot gas bypass	RLY 6	J8, 16-18	16 = 17 = RLY6A, 18 = RLY6B	1 = Closes RLY6A / RLY6B

NOTE: RXB is required for Digital Scroll or Humidi-MiZer option.

Controls (cont)



STAGED GAS HEAT BOARD (SCB) INPUTS AND OUTPUTS

POINT NAME	POINT DESCRIPTION	I/O POINT NAME	PLUG AND PIN REFERENCE	SIGNAL PIN(S)	PORT STATE
INPUTS					
		AN1	J5, 1-3	1=5v, 2=Vin, 3=GND (thermistor 1-2)	(0-5VDC, thermistor, ohms)
		AN2	J5, 4-6	4=5v, 5=Vin, 6=GND (thermistor 4-5)	(0-5VDC, thermistor, ohms)
LAT1SGAS	Leaving air temperature 1	AN3	J5, 7-9	7=5v, 8=Vin, 9=GND (thermistor 7-8)	(0-5VDC, thermistor, ohms)
LAT2SGAS	Leaving air temperature 2	AN4	J5, 10-12	10=5v, 11=Vin, 12=GND (thermistor 10-11)	(0-5VDC, thermistor, ohms)
LAT3SGAS	Leaving air temperature 3	AN5	J5, 13-15	13=5v, 14=Vin, 15=GND (thermistor 13-14)	(0-5VDC, thermistor, ohms)
		AN6	J6, 1-3	1=5v, 2=Vin, 3=GND (thermistor 1-2)	(0-5VDC, thermistor, ohms)
		AN7	J6, 4-6	4=5v, 5=Vin, 6=GND (thermistor 4-5)	(0-5VDC, thermistor, ohms)
		AN8	J6, 7-9	7=5v, 8=Vin, 9=GND (thermistor 7-8)	(0-5VDC, thermistor, ohms)
		AN9	J7, 1-2	1	(thermistor, ohms)
		AN10	J7, 3-4	3	(thermistor, ohms)
OUTPUTS					
		AO1	J8, 1-2	1=0-20mA, 2=GND	0-20mA OUT
		AO2	J8, 3-4	3=0-20mA, 4=GND	0-20mA OUT
HS3	Heat Stage 3	RLY1	J9, 1-3	1 = 2 = RLY1A, 3 = RLY1B	1 = Closes RLY1A/RLY1B
HS4	Heat Stage 4	RLY 2	J9, 4-6	4 = 5 = RLY2A, 6 = RLY2B	1 = Closes RLY2A/RLY2B
HS5	Heat Stage 5	RLY 3	J9, 7-9	7 = 8 = RLY3A, 9 = RLY3B	1 = Closes RLY3A/RLY3B
HS6	Heat Stage 6	RLY 4	J9, 10-12	10 = 11 = RLY4A, 12 = RLY4B	1 = Closes RLY4A/RLY4B
		RLY 5	J9, 13-15	13 = 14 = RLY5A, 15 = RLY5B	1 = Closes RLY5A/RLY5B

Controls (cont)



HUMIDI-MIZER CONTROL BOARD (EXV) INPUTS AND OUTPUTS

POINT NAME	POINT DESCRIPTION	I/O POINT NAME	PLUG AND PIN REFERENCE	SIGNAL PIN(S)	PORT STATE
INPUTS					
CCT	Air Temp Lvg Evap Coil	AN1	J5, 5-6	5=Vin, 6=GND	(Thermistor, ohms)
		AN2	J5, 7-8	7=Vin, 8=GND	(Thermistor, ohms)
		AN3	J5, 9-10	9=Vin, 10=GND	(Thermistor, ohms)
		AN4	J5, 11-12	11=Vin, 12=GND	(Thermistor, ohms)
		AN5	J5, 1-2	1=Vin, 2=GND	0-20mA INPUT
		AN6	J5, 3-4	3=Vin, 4=GND	0-20mA INPUT
OUTPUTS					
COND_EXV	Condenser EXV Position	OUTA			
		Coil1A	J6,1	1	HI Z when P5.7 and P5.6 = 0 +12 vdc when P5.7 = 1 and P5.6 = 0 0 vdc when P5.7 = 0 and P5.6 = 1 PROHIBITED when P5.7 = 1 and P5.6 = 1
		Coil2A	J6,2	2	HI Z when P5.5 and P5.4 = 0 +12 vdc when P5.5 = 1 and P5.4 = 0 0 vdc when P5.5 = 0 and P5.4 = 1 PROHIBITED when P5.5 = 1 and P5.4 = 1
		12VDC	J6, 3	3	Power Output
		Coil3A	J6,4	4	HI Z when P5.3 and P5.2 = 0 +12 vdc when P5.3 = 1 and P5.2 = 0 0 vdc when P5.3 = 0 and P5.2 = 1 PROHIBITED when P5.3 = 1 and P5.2 = 1
		Coil4A	J6,5	5	HI Z when P5.1 and P5.0 = 0 +12 vdc when P5.1 = 1 and P5.0 = 0 0 vdc when P5.1 = 0 and P5.0 = 1 PROHIBITED when P5.1 = 1 and P5.0 = 1
COND_EXV	Bypass EXV Position	OUTB			
		Coil1B	J7,1	1	HI Z when P8.7 and P8.6 = 0 +12 vdc when P8.7 = 1 and P8.6 = 0 0 vdc when P8.7 = 0 and P8.6 = 1 PROHIBITED when P8.7 = 1 and P8.6 = 1
		Coil2B	J7,2	2	HI Z when P8.5 and P8.4 = 0 +12 vdc when P8.5 = 1 and P8.4 = 0 PROHIBITED when P8.5 = 1 and P8.4 = 1
		12VDC	J7,3	3	Power Output
		Coil3B	J7,4	4	HI Z when P8.3 and P8.2 = 0 +12 vdc when P8.3 = 1 and P8.2 = 0 0 vdc when P8.3 = 0 and P8.2 = 1 PROHIBITED when P8.3 = 1 and P8.2 = 1
		Coil4B	J7,5	5	HI Z when P8.1 and P8.0 = 0 +12 vdc when P8.1 = 1 and P8.0 = 0 0 vdc when P8.1 = 0 and P8.0 = 1 PROHIBITED when P8.1 = 1 and P8.0 = 1

Controls (cont)



INPUT/OUTPUT CHANNEL DESIGNATIONS — FIELD CONNECTION TERMINAL STRIPS

TERMINAL BOARD	TERMINAL NO.	DESCRIPTION	TYPE
TB-1 - POWER CONNECTION OR DISCONNECT (in Main Control Box)			
TB1	11	L1 power supply	208-230/460/575/380/-3-60
	12	L2 power supply	208-230/460/575/380/-3-60
	13	L3 power supply	208-230/460/575/380/-3-60
TB-2 - GROUND (in Main Control Box)			
TB2	1	Neutral Power	
TB-3 - CCN COMMUNICATIONS (HY84HA096) (in Main Control Box)			
TB3	1	LEN +	5 VDC, logic
	2	LEN C	5 VDC, logic
	3	LEN -	5 VDC, logic
	4	24 VAC	24 VAC
	5	CCN +	5 VDC, logic
	6	CCN C	5 VDC, logic
	7	CCN -	5 VDC, logic
	8	Grd	ground
TB-4 - THERMOSTAT CONNECTIONS (HY84HA090) (in Main Control Box)			
TB4	1	Thermostat R	24 VAC Power
	2	Thermostat Y1	24 VAC Input
	3	Thermostat Y2	24 VAC Input
	4	Thermostat W1	24 VAC Input
	5	Thermostat W2	24 VAC Input
	6	Thermostat G	24 VAC Input
	7	Thermostat C	24 VAC Common
	8	Thermostat X (Alarm Contact)	24 VAC Output
TB-5 - FIELD CONNECTIONS (HY84HA101) (in Main Control Box)			
TB5	1	VAV Heater Interlock Relay, Ground	Dry Contact, Max 1 Amp
	2	VAV Heater Interlock Relay, 24 VAC	Dry Contact, Max 1 Amp
	3	T55/T56 10 K Thermistor	Thermistor Input
	4	T55/T56 10 K Thermistor	Thermistor Input
	5	T56 Set Point Adjustment (100,000 ohm)	Thermistor Input
	6	Indoor Air IAQ Remote Sensor/Remote Pot/Remote 4-20 mA	4-20 mA, ext. powered w/res or 0-5 VDC, +
	7	Indoor Air IAQ Remote Sensor/Remote Pot/Remote 4-20 mA	4-20 mA, ext. powered w/res or 0-5 VDC, -
	8	Smoke Detector Remote Alarm	external contacts
	9	Smoke Detector Remote Alarm	external contacts
	10	Fire Shutdown	24 VAC Power
	11	Fire Shutdown	24 VAC Input
	12	Fire Control*	24 VAC Power
	13	Fire Pressurization*	24 VAC Input
	14	Fire Evacuation*	24 VAC Input
	15	Fire Smoke Purge*	24 VAC Input
	16	Not Used	—
TB-6 - FIELD CONNECTIONS (HY84HA101) (in Main Control Box)			
TB6	1	Remote Occupied/Economizer Enable 24 VAC	24 VAC Power
	2	Remote Economizer Contact	24 VAC Input
	3	Remote Occupied Contact	24 VAC Input
	4	Demand Limit Contacts Common*	24 VAC Power
	5	Demand Limit SW1*	24 VAC Input
	6	Demand Limit SW2 / Dehumidification Switch*	24 VAC Input
	7	Demand Limit 4-20 mA*	externally powered 4-20 mA
	8	Demand Limit 4-20 mA*	externally powered 4-20 mA
	9	Remote Supply Air Setpoint 4-20 mA*	externally powered 4-20 mA
	10	Remote Supply Air Setpoint 4-20 mA*	externally powered 4-20 mA
	11	Outdoor Air IAQ 4-20 mA*	externally powered 4-20 mA
	12	Outdoor Air IAQ 4-20 mA*	externally powered 4-20 mA
	13	IAQ Remote Switch*	24 VAC Power
	14	IAQ Remote Switch*	24 VAC Input
	15	Supply Fan Status Switch*	24 VAC Power
	16	Supply Fan Status Switch*	24 VAC Input
TB-7 - ELECTRIC HEAT POWER BLOCK (in Electric Heat section)			
TB7	1	L1 Power Supply	208-230/460/575/380/-3-60, 400-3-50
	2	L2 Power Supply	208-230/460/575/380/-3-60, 400-3-50
	3	L3 Power Supply	208-230/460/575/380/-3-60, 400-3-50

* Requires optional Controls Expansion Module (CEM).

Controls (cont)

Cooling control options

The 48/50A series is available with the following cooling capacity control options

- 3 cooling stages on 20-27 ton units
- 4 cooling stages on 30-60 ton units
- Optional lead circuit variable capacity digital compressor
- Optional hot gas bypass (HGBP) valve on lead circuit
- Full economizer or integrated economizer cooling

ComfortLink is designed to optimize cooling staging for each configuration to maximize comfort control and ensure reliable operation. To help meet a variety of application, the A series *ComfortLink* can be configured for three different control types:

- Space temperature multiple stage (SPT-MULTI)
- Variable air volume return air temperature control (VAV-RAT) with optional unoccupied space temperature sensing (VAV-SPT)
- Thermostat multiple stage (TSTAT-MULTI)

The cooling control method can be selected independently of the fan control method for maximum flexibility.

CONTROL TYPE	COOLING DEMAND SOURCE	INTENDED APPLICATION
SPT-MULTI	Space temperature	Single zone
VAV-RAT/SPT	Return air temperature	Multi-zone
TSTAT-MULTI	Thermostat	Single zone
	DDC control	Single zone or multi-zone

Control type

The control type determines the selection of the type of cooling control as well as the technique for selecting a cooling mode. The control types are:

VAV-RAT and VAV-SPT

Both configurations are intended for multi-zone VAV applications. If the control is occupied, the supply fan is run continuously, and return air temperature will be used in the determination of a cooling demand based on a calculated occupied cooling set point.

When in occupied VAV COOL mode, the capacity of the economizer and compressors are controlled to maintain the supply air temperature at the occupied cooling supply air set point. The cooling capacity control method uses an adaptive PID (proportional, integral, derivative) algorithm (referred to as SumZ) to calculate the estimated change in supply air temperature before engaging or disengaging the next stage of cooling. The algorithm compensates for varying conditions, including changing flow rates across the evaporator coil, to provide better overall control of compressor staging.

Unoccupied cooling will follow the same demand determination as SPT-MULTI, but uses return air temperature instead of space temperature. If the unit is configured for VAV-SPT, the supply fan will be enabled for 10 minutes when the space temperature is above the unoccupied cooling set point. After 10 minutes, the unit will use return air temperature to determine demand.

SPT-MULTI

This configuration is intended for single zone applications. The supply fan can be configured to operate continuously or intermittently with demand during occupied mode and intermittently with demand or off during unoccupied mode.

The space temperature is compared to the occupied or unoccupied cooling set point to determine cooling demand. When the space temperature is slightly above the cooling set point, the unit will operate in LOW COOL mode. When the space temperature is well above the cooling set point, the unit will operate in HIGH COOL mode.

When in LOW COOL or HIGH COOL mode, the cooling capacity of the economizer and compressors are controlled to maintain the supply air temperature at the low cool or high cool supply air set point. SPT-MULTI uses the same SumZ cooling capacity control algorithm as VAV RAT/SPT.

TSTAT-MULTI

This configuration is intended for single zone applications with a two stage heat/cool thermostat or single or multi-zone applications with field provided DDC control. The supply fan can be configured to operate continuously or intermittently with demand during occupied mode and intermittently with demand or off during unoccupied mode.

The unit will monitor the physical or network thermostatic inputs to determine cooling demand. An active Y1 input will enable LOW COOL mode, and an active Y2 signal will enable HIGH COOL mode.

When in LOW COOL or HIGH COOL mode, the cooling capacity of the economizer and compressors are controlled to maintain the supply air temperature at the low cool or high cool supply air set point. TSTAT-MULTI uses the same SumZ cooling capacity control algorithm as VAV RAT/SPT and SPT-MULTI.

Integrated economizer

For each of the above modes of operation, all mechanical cooling will first be delayed while the unit attempts to use the economizer for free cooling. Once the economizer is at full capacity, the control will then supplement the free cooling with as much mechanical cooling as required. To prevent any rapid changes in cooling, the control will also use the economizer to trim the cooling supplied.

Cooling tempering control

Multi-staged gas heat is required for applications with low mixed air temperatures but with constant building cooling loads. In LOW COOL, or HIGH COOL mode when the economizer dampers are at their minimum ventilation position and the mixed-air temperature is below the supply air set point, the multi-staged gas heat is enabled and will stage to heat the air up to the occupied cooling supply air set point.

Heating control options

When heating is required, the A Series units can be provided with 2-stage electric heat, 2-stage gas heat, or multi-stage (staged) gas heat. Depending on unit size and heating capacity, the multiple-stage option may have between 5 and 11 stages of heating capacity control.

The A Series *ComfortLink* controls have the capability to control the heating capacity based the unit control type (VAV-RAT/SPT, SPT-MULTI, TSTAT-MULTI) and heat type (two-stage or multi-stage).

VAV-RAT/SPT

Both configurations are intended for multi-zone VAV applications. VAV air terminals can be commanded to open to the heating airflow position through Airside Linkage (with CCN or Open VAV control) or the heat interlock relay.

Controls (cont)

If the control is occupied, the supply fan is run continuously, and return air temperature will be used in the determination of a heating demand based on the occupied or unoccupied heating set point. Multi-stage heat is recommended for VAV-RAT/SPT applications.

Multi-stage heat: When the return air temperature is slightly below the occupied or unoccupied heating set point, the unit enters LOW HEAT mode. The unit will stage the heater to maintain the heating supply air temperature set point. When the return air temperature is well below the occupied or unoccupied heating set points or the supply air temperature is below 50°F, the unit enters HIGH HEAT mode and the heater is operated at full capacity.

Two-stage heat: When the return air temperature is slightly below the occupied or unoccupied heating set point, the unit enters LOW HEAT mode. The unit will enable the lowest heater stage, which is 50% capacity for electric or 75% capacity for gas heat. When the return air temperature is well below the occupied or unoccupied heating set points or the supply air temperature is below 50°F, the unit enters HIGH HEAT mode and the heater is operated at full capacity. Two-stage heat is not recommended for VAV applications.

SPT-MULTI

This configuration is intended for single zone applications. The supply fan can be configured to operate continuously or intermittently with demand during occupied mode and intermittently with demand or off during unoccupied mode.

Multi-stage heat: When the return air temperature is slightly below the occupied or unoccupied heating set point, the unit enters LOW HEAT mode. The unit will stage the heater to maintain the heating supply air temperature set point. When the return air temperature is well below the occupied or unoccupied heating set points or the supply air temperature is below 50°F, the unit enters HIGH HEAT mode and the heat is operated at full capacity.

Two-stage heat: When the return air temperature is slightly below the occupied or unoccupied heating set point, the unit enters LOW HEAT mode. The unit enable the lowest heater stage, which is 50% capacity for electric or 75% capacity for gas heat. When the return air temperature is well below the occupied or unoccupied heating set points or the supply air temperature is below 50°F, the unit enters HIGH HEAT mode and the heater is operated at full capacity.

TSTAT-MULTI

This configuration is intended for single zone applications with a two stage heat/cool thermostat or single or multi-zone applications with field provided DDC control. The unit will monitor the physical or network thermostatic inputs to determine heating demand. The supply fan can be configured to operate continuously or intermittently with demand during occupied mode and intermittently with demand or off during unoccupied mode.

Multi-stage heat: When the W1 input is active, the unit enters LOW HEAT mode. The unit will stage the heater to maintain the heating supply air temperature set point. When W2 is active or the supply air temperature is below 50°F, the unit enters HIGH HEAT mode and the heater is operated at full capacity. Multi-stage heat is recommended for multi-zone VAV applications.

Two-stage heat: When the W1 input is active, the unit enters LOW HEAT mode. The unit enable the lowest heater stage, which is 50% capacity for electric or 75% capacity for gas heat. When W2 is active or the supply air temperature is below 50°F, the unit enters HIGH HEAT mode and the heater is operated at full capacity.

Tempering control

When a unit is equipped with multi-staged gas heat, tempering operation is available during VENT, LOW COOL, or HIGH COOL modes to prevent from discharging very cold air when the outdoor air damper is at the minimum position and the mixed air temperature is very cold. Tempering can also be used during a preoccupancy purge to prevent low temperature air from being delivered to the space.

Economizer and IAQ options

The controls have been designed to support the requirements of indoor air quality control through the use of outside air. Units can be equipped either with an adjustable, self-closing outdoor air damper or with a fully modulating economizer with ultra-low leak dampers. The economizer can be configured for a full modulation mode or 3-position mode of operation. The control includes logic for a minimum ventilation position and different set points for occupied and unoccupied minimum position set points. This control also has logic built in to calibrate the economizer position to the actual percentage of outside air introduced. During periods when the compressors are not being used, the control will use the RAT, SAT and OAT to calibrate the economizer. This will allow for setting the outside air actual percentage, not just the percent damper position.

The use of the economizer will depend on the mode of change selected. This control integrates the changeover directly into the control. Four types of changeover are available:

- Outdoor air dry bulb
- Differential dry bulb
- Outdoor air enthalpy
- Differential enthalpy

The units are provided with an outdoor air and return air temperature sensor so the first two changeover methods are available as standard. To use the enthalpy changeover options, the control supports the addition of highly reliable electronic humidity or enthalpy sensors. The humidity sensor input is then used with the dry bulb sensors to calculate the enthalpy. For outdoor enthalpy changeover the control also has the ASHRAE 90.1 A, B, C, D economizer changeover curves built into the software.

Building pressure control — When operating with outside air economizers, large amounts of air can be introduced into the building and a means must be provided for building pressure relief. The 48/50A Series control supports the following three types of building pressure control:

- Relief Dampers — Can be used on low return duct static applications
- Non-Modulating Two-Stage Power Exhaust — The unit can be equipped with multiple power exhaust fans—four on sizes 020-050 and six on size 060. The software controls the power exhaust stages based on the economizer position (percent open).
- Modulating Power Exhaust — Both the VAV and CV/SAV units can be equipped with power exhaust fans that are controlled by a building pressure sensor that is connected

Controls (cont)

to the *ComfortLink* controller. The fans are in groups which allow for 4 stages on sizes 020-050 and 6 stages on size 060.

- High Capacity Power Exhaust (field-installed) — Both the VAV and CV/SAV units can be equipped with the field-installed high capacity power exhaust. These motors are modulated via VFDs which are controlled by a building pressure sensor that is connected to the *ComfortLink* controller. The VFDs provide full modulation and precise building pressure control.

The units are capable of using either 2-in. or optional 4-in. pleated filters and can have an optional filter pressure drop switch to warn of dirty filter conditions.

The indoor air quality (IAQ) function provides a demand-based control for ventilation air quantity, by providing a modulating outside air damper position that is proportional to the space CO₂ level. The ventilation damper position is varied between a minimum ventilation level (based on internal sources of contaminants and CO₂ levels other than the effect of people) and the maximum design ventilation level (determined at maximum populated status in the building). During a less-than-fully populated space period, the CO₂ level will be lower than that at full-load design condition and will require less ventilation air. Reduced quantities of ventilation air will result in reduced operating costs. Space CO₂ levels are monitored and compared to user-configured set points. Accessory CO₂ sensor for space (or return duct mounting) is required. The IAQ routine can be enhanced by also installing a sensor for outdoor air (CEM required).

During the occupied period, in the absence of a demand for cooling using outside air, if CO₂ levels are below the set point for the minimum ventilation level, the outside-air damper will open to the minimum ventilation level damper position set point. The minimum damper position will be maintained as long as the CO₂ level remains below the set point.

When the space CO₂ level exceeds set point for the minimum ventilation level condition, the *ComfortLink* controls will begin to open the outside air damper position to admit more ventilation air and remove the additional contaminants. As the space CO₂ level approaches the set point for maximum design ventilation level condition, the outside air damper position will reach the maximum ventilation level damper position set point limit. Damper position will be modulated in a directly proportional relationship between these two CO₂ set point limits and their corresponding damper position limits.

In most applications a fixed reference value can be set for the outdoor air quality level, but the control also supports (with optional CEM) the addition of an outdoor air quality sensor that will be compared to the indoor or return IAQ sensor. If an OAQ (outdoor air quality) sensor is connected, the demand set point levels will be adjusted automatically as the outdoor CO₂ levels vary. Also, if the outdoor CO₂ level exceeds a user-configured maximum limit value, then outside air damper position will be limited to the minimum ventilation damper set point value. The control can also receive these signals through the CCN system.

The IAQ and OAQ measurement levels are displayed by the *ComfortLink* scrolling marquee in parts per million (ppm).

Fire and smoke controls interface

The unit can be equipped with an optional return air smoke detector. The smoke detector is wired to stop the unit and

send a message to a remote alarm system if a fault condition is detected. If the controls expansion module (CEM) is added, the control will support smoke control modes including evacuation, smoke purge, and pressurization.

Demand limiting

The control supports demand limiting using one or two fixed capacity limits initiated by discrete input switches or a variable capacity limit function based on an analog input signal. On CCN systems this can be done through the network, or for non-CCN network jobs this can be done by adding the controls expansion module.

Diagnostics

The *ComfortLink* controls have fully integrated all controls and sensors into a common control system. The control monitors these inputs as well as many of the routines to provide advanced diagnostics and prognostics. These include adaptive logic to allow the unit to continue to operate in a reduced output mode and automatic resets where applicable. The last 10 alarms and alerts are stored in memory and can be accessed through the display. The alarms can also be monitored through the Carrier Comfort Network® connection or building automation system. The unit also supports the use of the hand-held Navigator™ display which can be plugged in at the main control box and auxiliary control box at the opposite end of the unit.

Some of the diagnostics that are included are:

- Monitoring of all sensors
- Suction pressure transducers to provide compressor protection and coil freeze protection
- Monitoring of the economizer actuator via digital communication
- Monitoring of compressor status using compressor protection boards
- Adaptive logic for low supply-air temperatures
- Compressor lockout at low ambient conditions
- Storage of compressor run hours and starts
- Low refrigerant charge protection
- Compressor reverse rotation protection

Control interface

The *ComfortLink* controller can interface with the i-Vu® Open Control System, a BACnet building automation system, or Carrier Comfort Network® devices. This will allow for the use of all system control programs. These include:

- Network Service Tool
- System Pilot™ device
- Touch Pilot™ device
- i-Vu® Open Interfaces (units with BACnet)
- ComfortView™ software
- Field Assistant (units with BACnet)
- ComfortID™ system

Contact Carrier Controls Marketing for more information.

The control can also provide interface with other energy management systems with the addition of either the BACnet communication option, the MODBUS Carrier translator, or the LonWorks Carrier translator.

Several contact connection points have been provided in the main control box for interface to external controls and for easy third party control. These are summarized in the

Controls (cont)

Interface Connections table on page 81. External controls use the following interface points:

- Start/Stop (On/Off) — Start/Stop is accomplished with a contact closure between terminals 1 and 3 on TB6.
- Remote Economizer Enable — Enabling and disabling of the economizer can be done by connecting a contact closure to terminals 1 and 2 on TB6. The economizer can be configured for a switch closure changeover for 3-position operation.
- VAV Heating Interlock — Interface with non-linkage terminals can be done through TB5 terminal 1 and 2.
- Remote IAQ Inputs — External IAQ demand inputs can be connected through terminals 6 and 7 on TB5.
- Smoke Detectors Alarm Output — Remote detector alarm outputs can be connected through terminals 8 and 9 on TB5.
- Fire Shutdown — A remote fire shutdown signal can be connected to 10 and 11 on TB5. The software can be configured to shut unit down on an open or closed signal.
- Fire Pressurization — For remote control of pressurization, a contact closer can be connected to terminals 12 and 13 on TB5. In this mode the economizer damper will be fully opened and the supply fan turned on to pressurize the space.
- Fire Evacuation — For this mode a remote contact closure can be connected to terminal 12 and 14 on TB5. For remote evacuation of a space the outside-air dampers will be opened and the power exhaust fans turned on to evacuate the space of smoke.
- Fire Purge — For this mode external contacts can be connected to terminals 12 and 15 on TB5. In this mode the supply fan and return fans will be turned on with the economizer at a full open position.
- Demand Limiting — For demand limiting the controls expansion module (CEM) must be used. Connections are provided on TB6 for switch input demand limiting and for 4 to 20 mA demand limit signals.
- Dehumidification — A discrete input is available on TB6 to initiate the Dehumidification mode. This input is shared with one of the demand limiting inputs and requires the controls expansion module.
- Remote Supply Air Set Point — A remote supply air temperature set point can be supported when the controls expansion module is used. It can be connected to terminals 9 and 10 on TB6.
- Outdoor Air IAQ Signal — If an external outdoor air signal is being used then it can be connected to terminals 11 and 12 on TB6.
- IAQ Switch Input — If an external control will be controlling IAQ then it can be connected as a contact closure through terminals 13 and 14 on TB6.

Carrier can also support electronic interface to other systems using the following:

- MODBUS Carrier translator (read/write, provides CCN to MODBUS remote terminal unit [RTU] protocol conversion)
- LonWorks Carrier translator (read/write, provides CCN to LON FT-10A ANSI/EIA-709.1 protocol conversion)

Constant volume/staged volume applications

The 48/50A2,A4,A6,A8 units are designed to operate in CV/SAV applications. The units are shipped as operable, stand-alone units using either a standard (mechanical or electronic) 2-stage heat or 2-stage cool thermostat, or with a field-installed space temperature sensor.

With a standard thermostat (programmable is optional), heating and cooling operation is based on the active inputs from the thermostat and the unit occupancy.

With a space temperature sensor, heating and cooling operation is based on the space temperature sensor reading, the occupancy status of the equipment, and the occupied/unoccupied cooling and heating set points.

Supply air can be supplied at a constant volume, static pressure control, or at a staged air volume (SAV) corresponding to two configurable speeds for cooling and one configurable speed for heating. SAV can also be configured to optimize fan speed for latent capacity or sensible capacity during cooling operation.

Features with thermostat control of unit:

- Thermostatic inputs for two stage heat/cool thermostat or DDC control
- Occupied and unoccupied cooling and heating control
- High cool/low cool supply air temperature control from Y1 and Y2 inputs
- Adaptive cooling with multiple scroll compressors, hot gas bypass, or variable capacity scroll compressor
- Control of unit using Y1, Y2, W1, W2, and G thermostat
- High heat/low heat control from W1 and W2 inputs and staged heat option
- Heating supply air temperature control from W1 input and multi-staged heat
- Tempering operation during ventilation or cooling modes with multi-staged heat
- Ventilation mode control from G input
- Constant volume, staged air volume, or supply duct static pressure control of supply fan
- Staged power exhaust or modulated power exhaust control based on building pressure
- Modulated outdoor air damper operation for ventilation or indoor air quality control with economizer
- Discrete input for dehumidification control with Humidi-MiZer and CEM
- Remote occupancy switch control

Features with sensor control of unit:

- There are multiple sensor options, including:
 - T55 sensor will monitor room temperature and provide unoccupied override capability (1 to 4 hours).
 - T56 sensor will monitor room temperature, provide unoccupied override capability (1 to 4 hours), and provide a temperature offset of 5°F maximum.
 - Carrier ZS communicating sensor (units with BACnet) are configurable to monitor space temperature, relative humidity, or CO₂. The Equipment Touch is also capable of acting as a space temperature and relative humidity sensor.
- Network space temperature sensor

Controls (cont)



INTERFACE CONNECTIONS

TB-3 — CCN COMMUNICATIONS (HY84HA096)

TB3	1 LEN +
	2 LEN C
	3 LEN -
	4 24 VAC
	5 CCN +
	6 CCN c
	7 CCN -
	8 Grd

TB-4 — THERMOSTAT CONNECTIONS (HY84HA090)

TB4	1 Thermostat R
	2 Thermostat Y1
	3 Thermostat Y2
	4 Thermostat W1
	5 Thermostat W2
	6 Thermostat G
	7 Thermostat C
	8 Thermostat X

TB-5 — FIELD CONNECTIONS (HY84HA101)

TB5	1 VAV Heater Interlock Relay, Ground
	2 VAV Heater Interlock Relay, 24 VAC
	3 T55/T56 10K Thermistor
	4 T55/T56 10K Thermistor
	5 T56 Set Point Adjustment (100,000 ohm)
	6 Indoor Air IAQ Remote Sensor/Remote Pot/Remote 4-20 mA
	7 Indoor Air IAQ Remote Sensor/Remote Pot/Remote 4-20 mA
	8 Smoke Detector Remote Alarm
	9 Smoke Detector Remote Alarm
	10 Fire Shutdown
	11 Fire Shutdown
	12 Fire Control Common*
	13 Fire Pressurization*
	14 Fire Evacuation*
	15 Fire Smoke Purge*
	16 Not Used

TB-6 — FIELD CONNECTIONS (HY84HA101)

TB6	1 Remote Occupied/Economizer Enable 24 VAC
	2 Remote Occupied Contact
	3 Remote Economizer Contact
	4 Demand Limit Contacts Common*
	5 Demand Limit Switch 1*
	6 Demand Limit Switch 2/Dehumidify Switch*
	7 Demand Limit 4-20 mA*
	8 Demand Limit 4-20 mA*
	9 Remote Supply Air Set Point 4-20 mA*
	10 Remote Supply Air Set Point 4-20 mA*
	11 Outdoor Air IAQ 4-20 mA*
	12 Outdoor Air IAQ 4-20 mA*
	13 IAQ Remote Switch Common*
	14 IAQ Remote Switch*
	15 Supply Fan Status Switch*
	16 Supply Fan Status Switch*

* Optional controls expansion module (CEM) is required.

- Occupied and unoccupied cooling and heating with adjustable set points
- High cool/low cool supply air temperature control with adjustable set points
- Adaptive cooling with multiple scroll compressors, hot gas bypass, or variable capacity scroll compressor
- Modulating, free cooling and integrated free cooling control with economizer
- High heat/low heat control with adjustable set points

- Heating supply air temperature control with multi-staged heat
- Tempering operation during ventilation or cooling modes with multi-staged heat
- Ventilation mode operation when cooling and heating are inactive
- Constant volume, staged air volume, or supply duct static pressure control of supply fan
- Staged power exhaust or modulated power exhaust control based on building pressure
- Modulated outdoor air damper operation for ventilation or indoor air quality control with economizer
- Return air relative humidity sensor for dehumidification control with Humidi-MiZer
- 365-day timeclock with backup (supports minute, hour, and day of week, date, month, and year access). The timeclock includes the following features:
 - Daylight savings time function
 - Occupancy control with 8 periods for unit operation
 - Holiday table containing up to 18 holiday schedules
 - Ability to initiate timed override from T55 or T56 sensors (for a timed period of 1 to 4 hours)
 - Temperature-compensated start to calculate early start times before occupancy
 - For units connected into a CCN network, the timeclock can be integrated into the overall building energy management system and be updated remotely
- For units connected to the CCN network or BACnet network (with BACnet option) the user can also display unit information including I/O values Maintenance, Configuration, Service, and Set Point data tables and can adjust some set points and settings.

Variable air volume (VAV) applications

The 48/50A3,A5,A7,A9 units are designed to operate in multi-zone VAV applications. All VAV units include a variable frequency drive to modulate the supply fan speed based on a supply duct static pressure set point and continuous fan operation in occupied mode. Cooling and heating modes are enabled based on return air temperature and mode operation is to a supply air temperature set point (cooling or with multi-staged heat). Some of the features for VAV units in a stand-alone application are:

- The units are shipped as operable, stand-alone units with the addition of a field-supplied timeclock to establish unit start and stop times or they can use *ComfortLink* time of day scheduling routine
- Provides cooling and heating control (if equipped with heat) in both occupied and unoccupied modes
- Supports an optional space temperature sensor for unoccupied mode control and supply air temperature reset
- If space sensor is equipped with an override feature, the sensor will allow operation during the unoccupied period for a fixed length of time
- Base unit control supports a heat interlock relay (field supplied) to signal the VAV terminal devices to fully open during heating operation
- Control board diagnostics
- Control of modulating economizer for free cooling
- Control to maximize the use of outside air cooling to reduce part load operating costs
- Support of remote occupied/unoccupied input to start

Controls (cont)

- Controls the operation of the supply fan inverter to maintain a configurable supply duct static pressure set point. Inverter is configured and controlled directly by *ComfortLink* controls
- Support of IAQ sensor
- Support a field test for field check out
- Support linkage to *ComfortID™* systems
- Cooling capacity control of up to 5 stages plus economizer
- Control of heat to maintain return-air temperature
- Control of heat interlock relay
- Compressor time delays to prevent rapid cycling of compressors
- Automatic lead-lag control of compressors to reduce the number of compressor cycles
- With the addition of a remote start/stop switch, heating or cooling is enabled during unoccupied periods as required to maintain space temperature to within unoccupied set points
- With the addition of the controls expansion board, the *ComfortLink* controls will also support demand limiting and remote set point control

When the unit is connected to a CCN (Carrier Comfort Network®) system or i-Vu Open system (with BACnet option), additional features can be used:

- Interface of the unit clock with the CCN network clock and allow for remote configuration of the schedules
- CCN or i-Vu Open demand limit participation
- Airside Linkage operation with Carrier CCN or Carrier i-Vu Open VAV or VVT zone controllers.

Sequence of operation

Cooling, constant volume (CV)/staged air volume (SAV) units

On power up, the initialization software will determine the unit configuration and also initialize any controls loops and input/output devices. All alarms and configurations are saved in memory and maintained during power outages. All alarms will be maintained in memory and must be cleared through the display.

On SAV units equipped with a supply fan VFD, the fan is controlled at discrete speeds based on the operation mode of the unit and the SAV configuration.

For units configured to optimize SAV for dehumidification, the supply fan will operate in low speed when:

- Cooling capacity is less than 60% and SAT is below SST
- Unit is in vent mode
- Heating capacity is less than 75%

For units configured to optimize SAV for dehumidification, the supply fan will operate in high speed when:

- Cooling capacity is less than 60% and SAT is near SST
- Cooling capacity is greater than 60%
- Heating capacity is greater than 75%

For units configured to optimize SAV for sensible control (SAV dehum disabled), the supply fan will operate in low speed when:

- Unit is in low cool mode
- Unit is in vent mode
- Heating capacity is less than 75%

For units configured to optimize SAV for sensible control (SAV dehum disabled), the supply fan will operate in high speed when:

- Unit is in high cool mode
- Heating capacity is greater than 75%

Constant volume/staged air volume conventional thermostat control

If the unit is equipped with a conventional thermostat with Y1, Y2, W1, W2, and G connections, then the control will perform the following sequence.

When G is closed the indoor fan will turn on. G must be closed for heating or cooling to occur.

If Y1 is closed, then the control will first check the ability to use the economizer. If the economizer can be used, the control will modulate the damper open to maintain the low load economizer leaving air temperature set point.

If Y2 closes, then the control will lower the leaving air temperature set point to the configured set point. If the economizer cannot satisfy the load, then compressors will be sequenced on to maintain either the low or high load temperature set points. If the economizer cannot be used or the enable control disables the economizer, then the control will sequence the compressors based on the Y1 and Y2 signals.

If two-stage control has been selected, then the control will map the compressors to the Y1 and Y2 inputs as defined in the loading sequence.

If Adaptive mode has been selected, then the control will add and remove compressor stages to maintain the low and high demand leaving air set points. If Y1 is closed, at least one compressor stage will be turned on.

Heating — If W1 closes, then it will indicate that the units should be in the Heating mode. The economizer will be closed to the minimum position, and if the unit is equipped with gas or electric heat then the first stage of heat will be energized. If W2 closes, then the control will turn on the second stage of heat. If the unit is equipped with a staged gas heat control option, then the W1 signal will be used to control the gas heat to the configurable low heat load leaving air temperature set point. When W2 is energized, the unit will fire all stages of heat capacity. If the unit is equipped with gas heat, then the IGC board will control the operation of the gas heat. See the 48 Series Gas Heat units section for the IGC board sequence of operation.

Constant volume/staged air volume space temperature sensor control

If the space temperature operation has been selected using a T55, T56, or ZS sensor, then the following logic will be used to control the operation of the unit. If a space temperature is used, then a wire jumper must be added between R, W1, and W2. If a remote occupancy control method has been selected, then the input must first be closed for the unit to go into Heat, Vent or Cooling mode.

If the internal timeclock is used, the control module determines the occupancy state based on the system time schedules.

If Temperature Compensated Start is active, the unit will be controlled as in the occupied mode and will start a time as determined by prior operation to have the space at set point by the occupied time.

Controls (cont)

If the unit has been configured for a preoccupancy purge, then the control will start the unit in Vent mode prior to the occupancy time to vent the space. If an IAQ sensor is being used and the low IAQ set point is satisfied, then the occupancy purge mode will be terminated. The set points for heat and cooling are configurable through the display. If a T56 sensor is being used, then the set point can be shifted by as much as 5 degrees.

Cooling — If the space temperature goes above the cooling set point, then the unit will go into Cooling mode. If the economizer can be used, the control will first try to control to the leaving air temperature set point. The set point will depend on the space temperature. If the temperature is above the low demand set point, then the low economizer load discharge air temperature set point will be used. If the temperature is above the high load space temperature set point, then the high load leaving air temperature set point will be used. If the economizer cannot satisfy the load, then compressors will be sequenced on to maintain either the low or high load temperature set points.

If the economizer cannot be used or the enable control disables the economizer, then the control will sequence the compressors based on the low and high load space temperature variables. If two-stage control has been selected, then the control will map the compressors to the low and high loads as defined in the loading sequence. If Adaptive mode has been selected, then the control will add and remove compressor stages to maintain the high and low demand leaving air set points.

Heating — If the space temperature goes below the heating space temperature set points, then it will indicate that the units should be in the Heating mode. The economizer will be closed to the minimum position and if the unit is equipped with gas or electric heat then the first stage of heat will be energized. If the space temperature goes below the high load space temperature set point, then the control will turn on the second stage of heat. If the unit is equipped with a staged gas heat control option, then the low load demand signal will turn on heating stages to maintain the leaving air temperature set point. A high demand signal will energize all stages of heat.

Unoccupied Mode — If the unit is configured for unoccupied free cooling, mechanical cooling, or heating, and the temperature goes beyond the unoccupied configuration set points, then the control will turn on free cooling, mechanical cooling, or heat as needed to get within the unoccupied set points. When in this mode, the economizer dampers will be maintained fully closed or to the minimum unoccupied ventilation set point.

Variable air volume control

On power up, the initialization software will determine the unit configuration and also initialize any controls loops and input/output devices. All alarms and configurations are saved in memory and maintained during power outages. All alarms will be maintained in memory and must be cleared through the display.

The unit will first determine the mode of operation. If the unit has been configured for space temperature demand, then the control will determine, based on the configurable set points, if the unit should be in heat mode, vent mode, or cooling mode. If the unit is configured for return air temperature control, then it will start the fan and monitor the return air temperature vs. the configurable set point to determine if the unit should be in cooling, vent, or heating mode.

If the control is connected to a ComfortID™ system, the room terminals are equipped with microprocessor controls that give commands to the base module. If linkage is active, the control module will replace local *ComfortLink* set points and occupancy data with linkage-supplied data.

If temperature compensated start is active, then advance pre-cool or heat of the space is enabled. If the unit is configured to use a pre-purge cycle, then the *ComfortLink* controls will start the unit in Vent mode based on a pre-start time interval. If an IAQ sensor is being used and the low IAQ control point is satisfied, then the mode will be terminated.

Cooling — If Cooling mode is required, then the controlling set point will be the leaving air temperature set point. If an economizer is present and the changeover control allows the economizer to be used, then it will first attempt to control the leaving-air temperature using free cooling. If this cannot satisfy the load, then additional compressor stages will be turned on to maintain the leaving-air temperature. When both compressors and economizers are being used, the control will use the economizer dampers to maintain better control of the leaving air and to help prevent high compressor cycling. If the economizer cannot be used, then it will be set to the minimum vent position. When using compressors, the leaving-air temperature will sequence to compressors on and off using a PID control loop.

If the unit is equipped with an optional hot gas bypass valve, the control will use the hot gas as an additional stage of capacity. When the first stage of cooling is required the control will turn on a circuit "A" compressor and the hot gas bypass valve. When additional cooling is called for it will turn off the hot gas bypass valve. The valve will also be used for additional freeze protection of the coils when low evaporator refrigerant temperatures are detected using the suction pressure transducers.

When operating in cooling mode, the control will also monitor the supply duct pressure and send a 4 to 20 mA signal to the factory-supplied inverter to control the speed of the fan and the delivered cfm. If on a linkage system, the control will also support static pressure reset based on the needs of the zones.

Heating — If the unit has been enabled for occupied heat and the space temperature sensor (SPT), return air temperature sensor (RAT), or linkage demand calls for heat, the control will energize the electric heat or gas heat (if present) to warm the space. In this mode the control will energize the heat interlock relay which will signal the terminals to open to the heating position. Note that for the linkage systems the interlock relay connection is not required. Once the Heat mode is enabled, the heat capacity will be controlled by the return air temperature set point. Heating will continue until the return temperature set point is satisfied. If the unit is configured for morning warm-up and the heating demand is below the set point during the first 10 minutes of operation, the control will energize full heating capacity until the return air temperature set point is satisfied.

If the space temperature sensor (SPT), return air temperature sensor (RAT), or linkage demand requires that the unit be in heating, then the control will energize the electric heat or gas heat (if present) to warm the space. In this mode the control will energize the heat interlock relay which should be connected to the terminals to indicate that they should open to the heating position. The interlock relay connection is not required for the linkage systems. Heating will continue until the mode selection sensor is satisfied.

Controls (cont)

Dehumidification mode

A Dehumidification mode can be initiated by either a discrete input on TB6 or by a direct measurement of humidity levels with an optional space or return air humidity sensor. When the Dehumidification mode is active, the evaporator coil leaving air temperature will be controlled to the Dehumidify Cool set point, which is typically colder than the normal cool mode leaving air set points.

In this mode, comfort condition set points, which are based on dry bulb temperature, will be overridden. If a source of reheat is available, then the leaving-air temperature can be raised to a more desirable temperature. Available methods of reheat are internal gas heat if the unit is equipped with the staged gas heating option or an external heat source that can be controlled by an auxiliary alarm relay switch.

Humidi-MiZer operation

The design of the Humidi-MiZer adaptive dehumidification system allows for two humidity control modes of operation of the rooftop unit, utilizing a common subcooling/reheat dehumidification coil located downstream of the standard evaporator coil.

This unique and innovative design provides the capability for the rooftop unit to operate in both a subcooling mode and a hot gas reheat mode for maximum system flexibility. The Humidi-MiZer package is factory installed and will operate whenever there is a dehumidification requirement.

The Humidi-MiZer system is initiated based on input from a factory-installed return air humidity sensor to the large rooftop unit controller. Additionally, the unit controller may receive an input from a field-installed space humidity sensor, a discrete input from a mechanical humidistat, or input from a third-party controller.

A unit equipped with a Humidi-MiZer system can operate in the following modes:

Conventional Cooling mode

Conventional operation of the A series large rooftop unit allows the unit to cycle up to six compressors to maintain comfort conditions, with expanded cycling operation offered by the optional digital compressor. This mode is the conventional DX (direct expansion) cooling method used on Carrier's standard large rooftops and provides equivalent capacity to a non-Humid-MiZer equipped unit. It is used when there is a call for cooling only, such as at design AHRI (Air-Conditioning, Heating, and Refrigeration Institute) cooling conditions of 95°F ambient and 80°F/67°F db/wb entering air conditions. The SHR (sensible heat ratio) for equipment in this scenario is typically 0.7 or higher.

Subcooling mode

This modulating mode will operate to satisfy part load type conditions when there is a space call for cooling and dehumidification. Although the temperature (sensible) may have dropped and decreased the sensible load in the space, the outdoor and/or space humidity levels may have risen.

A typical scenario might be when the outside air is 85°F and 70 to 80% relative humidity (RH). Desired SHR for equipment in this scenario is typically 0.4 to 0.7. Carrier's A Series Humidi-MiZer adaptive dehumidification system will increase subcooling entering the evaporator and cycle on enough compressors to meet the latent load requirement, while simultaneously adjusting refrigerant flow to the Humidi-MiZer coil to reheat the air to the required supply

air set point. This will allow the unit to provide variable SHR to meet space requirements.

Conversely, a standard unit might overcool the space or stage down to meet set point, sacrificing latent capacity control. The Humidi-MiZer unit will initiate subcooling mode when the space temperature and humidity are both above the temperature and humidity set points, and attempt to meet both requirements. Once the humidity requirement is met, the unit can continue to operate in normal cooling mode to meet any remaining sensible capacity load. Alternatively, if the sensible load is met and humidity levels remain high, the unit can switch to Hot Gas Reheat mode to provide neutral, dehumidified air.

Hot Gas Reheat mode

This modulating mode is used when dehumidification is required without a need for cooling, such as when the outside air is at a neutral temperature (70 to 75°F) but high humidity exists. This situation requires the equipment to operate at a SHR of 0.0 to 0.2.

With no cooling requirement and a call for dehumidification, the A Series Humidi-MiZer adaptive dehumidification system will cycle on enough compressors to meet the latent load requirement, while simultaneously modulating refrigerant flow to the Humidi-MiZer coil to reheat the air to the desired neutral air set point.

The A-Series Humid-MiZer system controls allow for the discharge air to be reheated either to the return-air temperature minus a configurable offset or to a configurable Reheat set point (default 70°F). The Hot Gas Reheat mode will be initiated when only the humidity is above the humidity set point, without a demand for cooling.

Mode control

The essential difference between the Subcooling mode and the Hot Gas Reheat mode is in the supply air set point. In Subcooling mode, the supply air set point is the temperature required to provide cooling to the space. In Reheat mode, the supply air set point is the temperature required to provide neutral air to the space. In both cases, the unit will decrease the evaporator discharge temperature to meet the latent load and reheat the air to the required cooling or reheat set point (i.e., 50, 60, 70°F, etc.).

48 series gas heat units

The gas heat units incorporate 2 (3 on size 060) separate systems to provide gas heat. Each system incorporates its own induced-draft motor, integrated gas control (IGC) board, 2-stage gas valve, manifold, and safeties. For 2-stage heat control, the systems are operated in parallel. For example, when there is a call for first stage heat, both induced-draft motors operate, both gas valves are energized, and both IGC boards initiate spark.

With the staged gas control, the systems are operated independently to allow for a greater range of capacity control. All of the gas heating control is performed through the IGC boards (located in the heating section). The MBB module board serves only to initiate and terminate heating operation and monitor the status of the requirements for indoor fan operation.

The fan will be controlled directly by the MBB board. The base module board is powered by 24 vac. When the thermostat or room sensor calls for heating, the MBB board

Controls (cont)

will close heating relays and send power to W on each of the IGC boards.

An LED on the IGC board will be on during normal operation. A check is made to ensure that the rollout switches and limit switches are closed and the induced-draft motors are not running. After the induced-draft motors are energized and speed is proven with the Hall Effect sensor on the motor, the ignition activation period begins. The burners will ignite within 5 seconds.

When ignition occurs, the IGC board will continue to monitor the condition of the rollout and limit switches, the Hall Effect sensor, and the flame sensor. If the unit is controlled through a room thermostat set for fan auto, 45 seconds after ignition occurs the indoor-fan motor will be energized and the outdoor-air dampers will open to their minimum position.

If the overtemperature limit opens prior to the start of the indoor fan blower, on the next attempt the 45-second delay will be shortened to 5 seconds less than the time from initiation of heat to when the limit tripped. Gas will not be interrupted to the burners and heating will continue. Once modified, the fan on delay will not change back to 45 seconds unless power is reset to the control.

If the unit is controlled through a room sensor, the indoor fan will be operating in the occupied mode and the outdoor-air dampers will be in the minimum position. If the unit is controlled with a room sensor in the unoccupied mode, the indoor fan will be energized through the IGC board with a 45-second delay and the outside-air dampers will move to the minimum unoccupied set point.

When additional heat is required, the second stage MBB output relay closes and initiates power to the second stage of all main gas valves in all sections. When the demand is satisfied, MBB heat output relays will open and the gas valves close, interrupting the flow of gas to the main burners. If the call for stage 1 heat lasts less than 1 minute, the heating cycle will not terminate until 1 minute after W1 became active. If the unit is configured for intermittent fan, the indoor-fan motor will continue to operate for an additional 45 seconds, then stop, and the outdoor-air dampers will close. If the overtemperature limit opens after the indoor motor is stopped within 10 minutes of W1 becoming inactive, on the next cycle the time will be extended by 15 seconds. The maximum delay is 3 minutes. Once modified, the fan off delay will not change back to 45 seconds unless power is reset to the control.

Application data



Ductwork — Secure vertical discharge ductwork to roof curb. Interior installation may proceed before unit is set in place on roof. For horizontal discharge applications, attach ductwork to unit, or field-supplied flanges can be attached to horizontal discharge openings and all ductwork attached to flanges. Units equipped with electric heat require a 90-degree elbow below the unit supply duct connection.

Unit support — The unique basepan of the 48/50A allows for a wide array of unit support. The base unit is designed for curb mounting using Carrier curbs or third party curbs. The unit can also be mounted on steel supports or slab mounted with vibration pads. The special order double wall bottom option is recommended for installations other than curbs to protect the unit bottom insulation.

Thru-the-curb service connections — Roof curb connections allow field power wires and control wires to enter through the roof curb opening.

Thermostat (CV/SAV only) — Use of a thermistor-type room sensor is recommended on all CCN or BACnet installations. A thermistor-type room sensor or a 2-stage heating/cooling thermostat may be used for all other units.

Heating-to-cooling changeover — All units are automatic changeover from heating to cooling when automatic changeover thermostat and subbase or a thermistor-type room sensor are used.

Airflow — Units are draw-thru on cooling and blow-thru on heating.

Maximum airflow — To minimize the possibility of condensate blow-off from evaporator, airflow through units should not exceed values shown in Cooling Cfm Operating Range table and Cooling Capacities tables.

Minimum airflow — The minimum full load cooling airflow for SAV/CV units is 300 cfm/ton. The minimum part load airflow for SAV/CV units, or VAV units with standard scroll compressor, or units with Humidi-MiZer is 200 cfm/ton. VAV units with variable capacity compressor can operate down to 100 cfm/ton. The minimum airflow can be additionally limited by entering coil conditions and unit configuration. All airflow listings are per nominal unit tonnage.

Minimum ambient cooling operation temperature — All units are equipped with factory economizers to allow free cooling at any outdoor ambient. If mechanical cooling is required, the units are designed to operate at outdoor temperatures down to 32°F. Greenspeed or low ambient control units can operate at outdoor temperatures down to -20°F.

Carrier recommends the installation of field-fabricated wind baffles on all vertically oriented condenser coil surfaces when operating in environments with prevailing winds of more than 5 mph and where temperatures drop below 32°F.

Maximum operating outdoor-air temperature — The maximum operating outdoor-air temperature is 115°F. Some models will operate up to 125°F depending on model and operating conditions.

High altitude (gas heat units only) — A change to the gas orifice may be required at high altitudes. Refer to Altitude Compensation table on page 8.

Minimum temperature — Minimum allowable temperature of mixed air entering the heat exchanger during half

rate (first stage) operation is 50°F. There is no minimum mixture temperature during full-rate operation. Comfort conditioning may be compromised at temperatures below 50°F. Below 50°F entering-air temperature (EAT) both stages of heat are engaged.

Internal unit design — Due to Carrier's internal unit design (draw-thru over the motor), air path, and specially designed motors, the full horsepower listed in the Physical Data table and Motor Limitations table can be used with extreme confidence. Using Carrier motors with the values listed in the Physical Data and Motor Limitations tables will not result in nuisance tripping or premature motor failure. The unit warranty will not be affected.

Electric heat — A field-supplied 90-degree elbow must be installed in the supply ductwork below the unit discharge.

Acoustical considerations

In order to minimize sound transmitted to the space, please conform to the following recommendations:

Location

- Avoid locating the unit above sound-sensitive areas. Instead, locate the unit above restrooms, storage areas, corridors, or other noise-tolerant areas.
- Avoid mounting the unit in the middle of large roof expanses between vertical supports. This will minimize the phenomenon known as roof bounce.
- Install the units close to vertical roof supports (columns or load bearing walls).
- Locate the units at least 25 feet away from critical areas. If this is not possible, the ductwork and ceiling structure should be acoustically treated.
- Consider the use of vibration isolators or an acoustic curb.

Ductwork

- Use flexible connectors between the unit and the supply and return ducts.
- Supply and return air main trunk ducts should be located over hallways and/or public areas.
- Provide trailing edge turning vanes in ductwork elbows and tees to reduce air turbulence.
- Make the ductwork as stiff as possible.
- Use round duct wherever possible because it is less noisy.
- Seal all penetrations around ductwork entering the space.
- Make sure that ceiling and wall contractors do not attach hangers or supports to ductwork.
- Provide as smooth and gradual transition as possible when connecting the rooftop unit discharge to the supply duct.
- If a ceiling plenum return is used, provide a return elbow or tee to eliminate line-of-sight noise to the space. Face the entrance of the return duct away from other adjacent units.

Acoustic insulation

- Provide acoustic interior lining for first 20 feet of supply and return duct or until the first elbow is encountered. The elbow prevents line-of-sight transmission in the supply and return ducts.


Application data (cont)




- Install a double layer of 2-in. low density quilted fiberglass acoustical pad with a 1/8-in. barium-loaded vinyl facing on top of the roof deck before building insulation and roofing installation occur. Place the material inside the curb and for 4 to 8 ft beyond the unit perimeter, dependent upon unit

size (larger units require a wider apron outside the curb). Openings in the pad should only be large enough for the supply and return ducts. An alternate approach is to use two layers of gypsum board with staggered seams in addition to the acoustical pad.

ACOUSTICAL CONSIDERATIONS

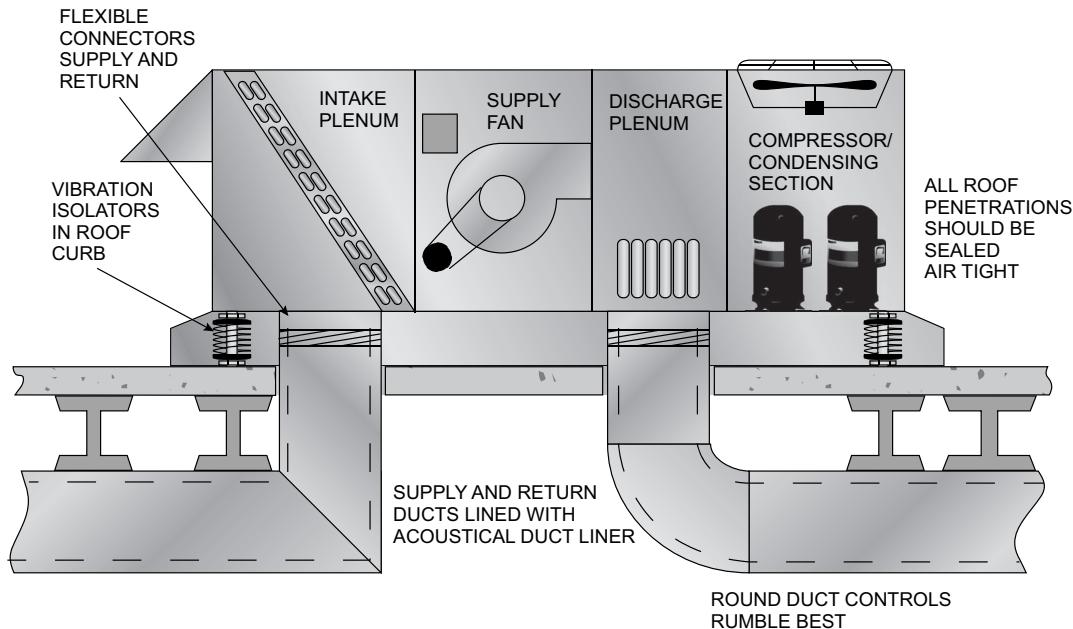

MULTIPLE UNIT APPLICATION SPACING

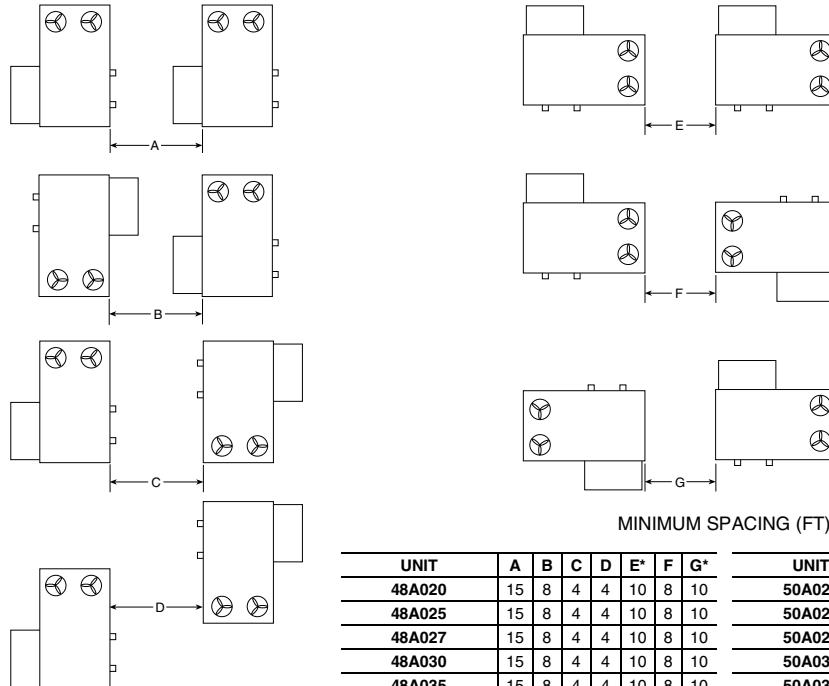

MINIMUM SPACING (FT)


UNIT	A	B	C	D	E*	F	G*	UNIT	A	B	C	D	E*	F	G*
48A020	15	8	4	4	10	8	10	50A020	8	8	4	4	10	8	10
48A025	15	8	4	4	10	8	10	50A025	8	8	4	4	10	8	10
48A027	15	8	4	4	10	8	10	50A027	8	8	4	4	10	8	10
48A030	15	8	4	4	10	8	10	50A030	8	8	4	4	10	8	10
48A035	15	8	4	4	10	8	10	50A035	8	8	4	4	10	8	10
48A040	15	8	4	8	10	4	10	50A040	8	8	4	8	10	4	10
48A050	15	8	4	8	10	4	10	50A050	8	8	4	8	10	4	10
48A060	15	8	4	8	15	4	15	50A060	8	8	4	8	15	4	15

* Required for coil removal. Can reduce to 6 ft if coil removed from top.

Typical wiring schematics

Carrier


TYPICAL POWER SCHEMATIC (48/50A2,3,4,5 040 Shown)

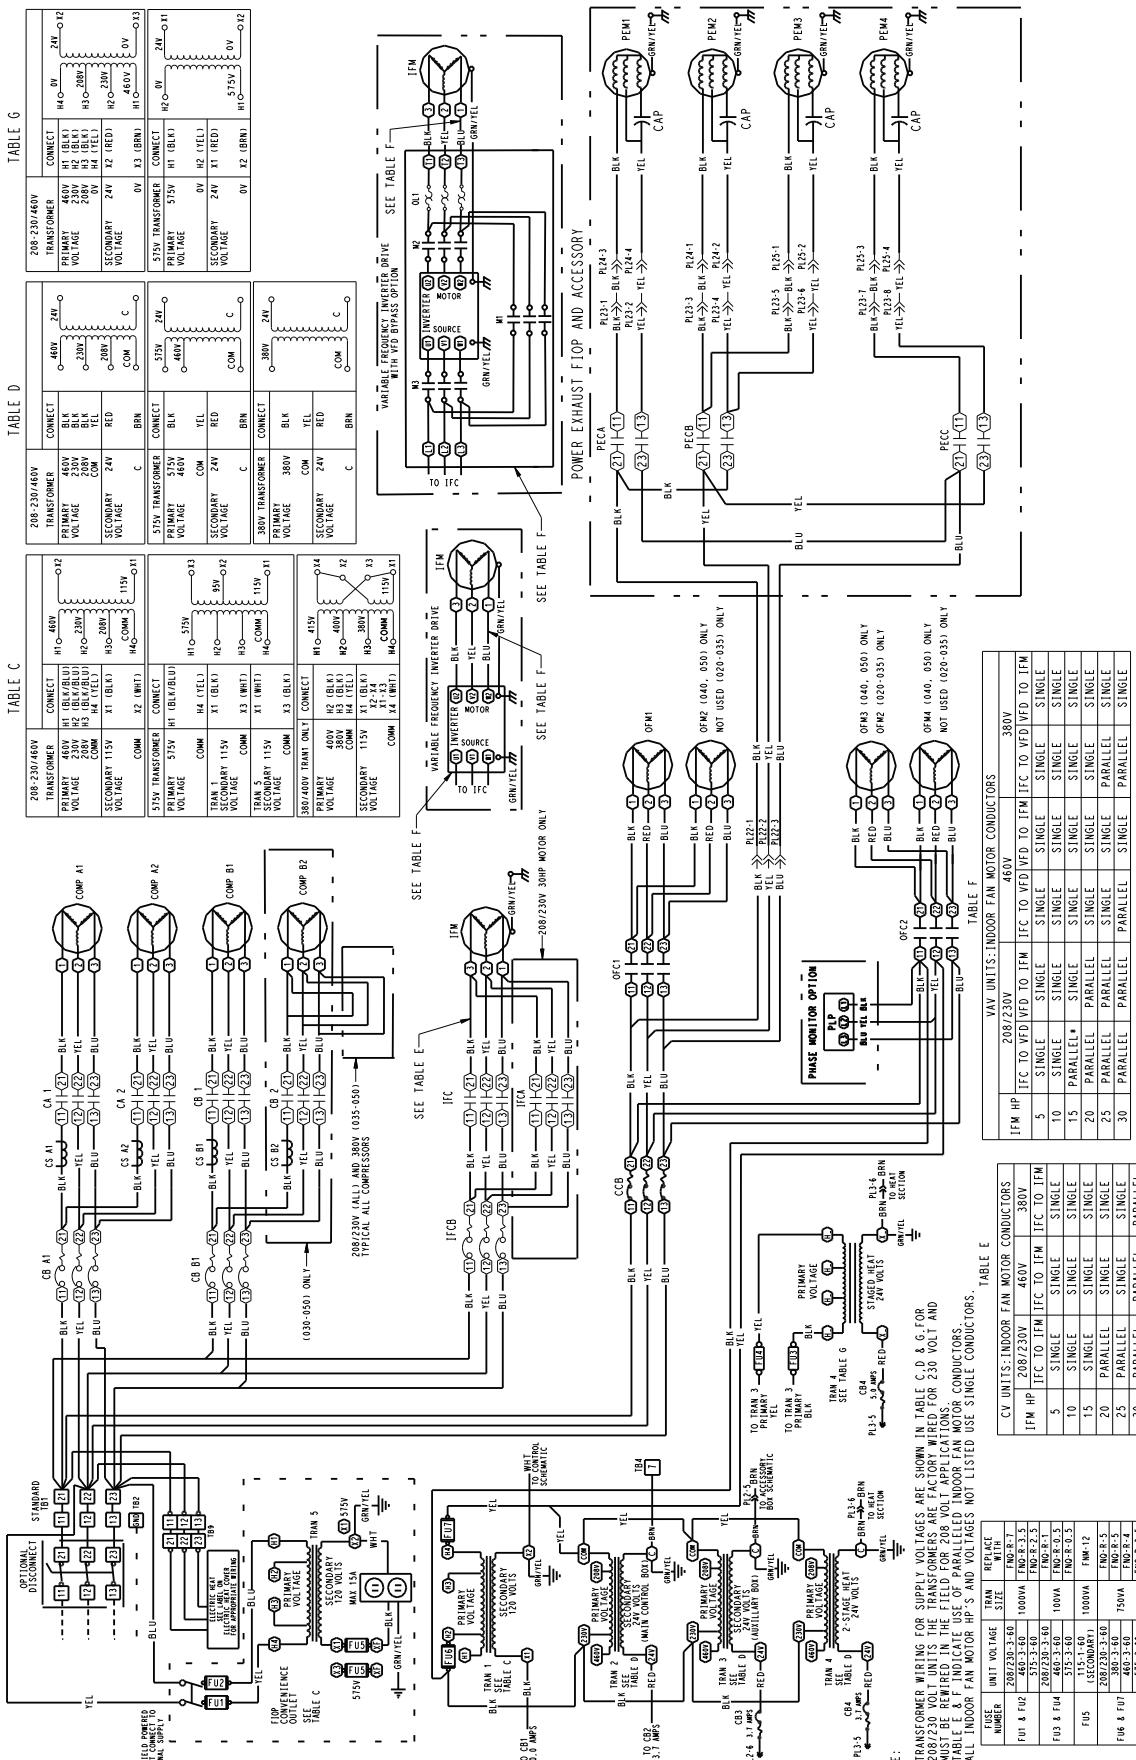

Typical wiring schematics (cont)


Carrier

MAIN BOX CONTROL SCHEMATIC 48/50A020-060

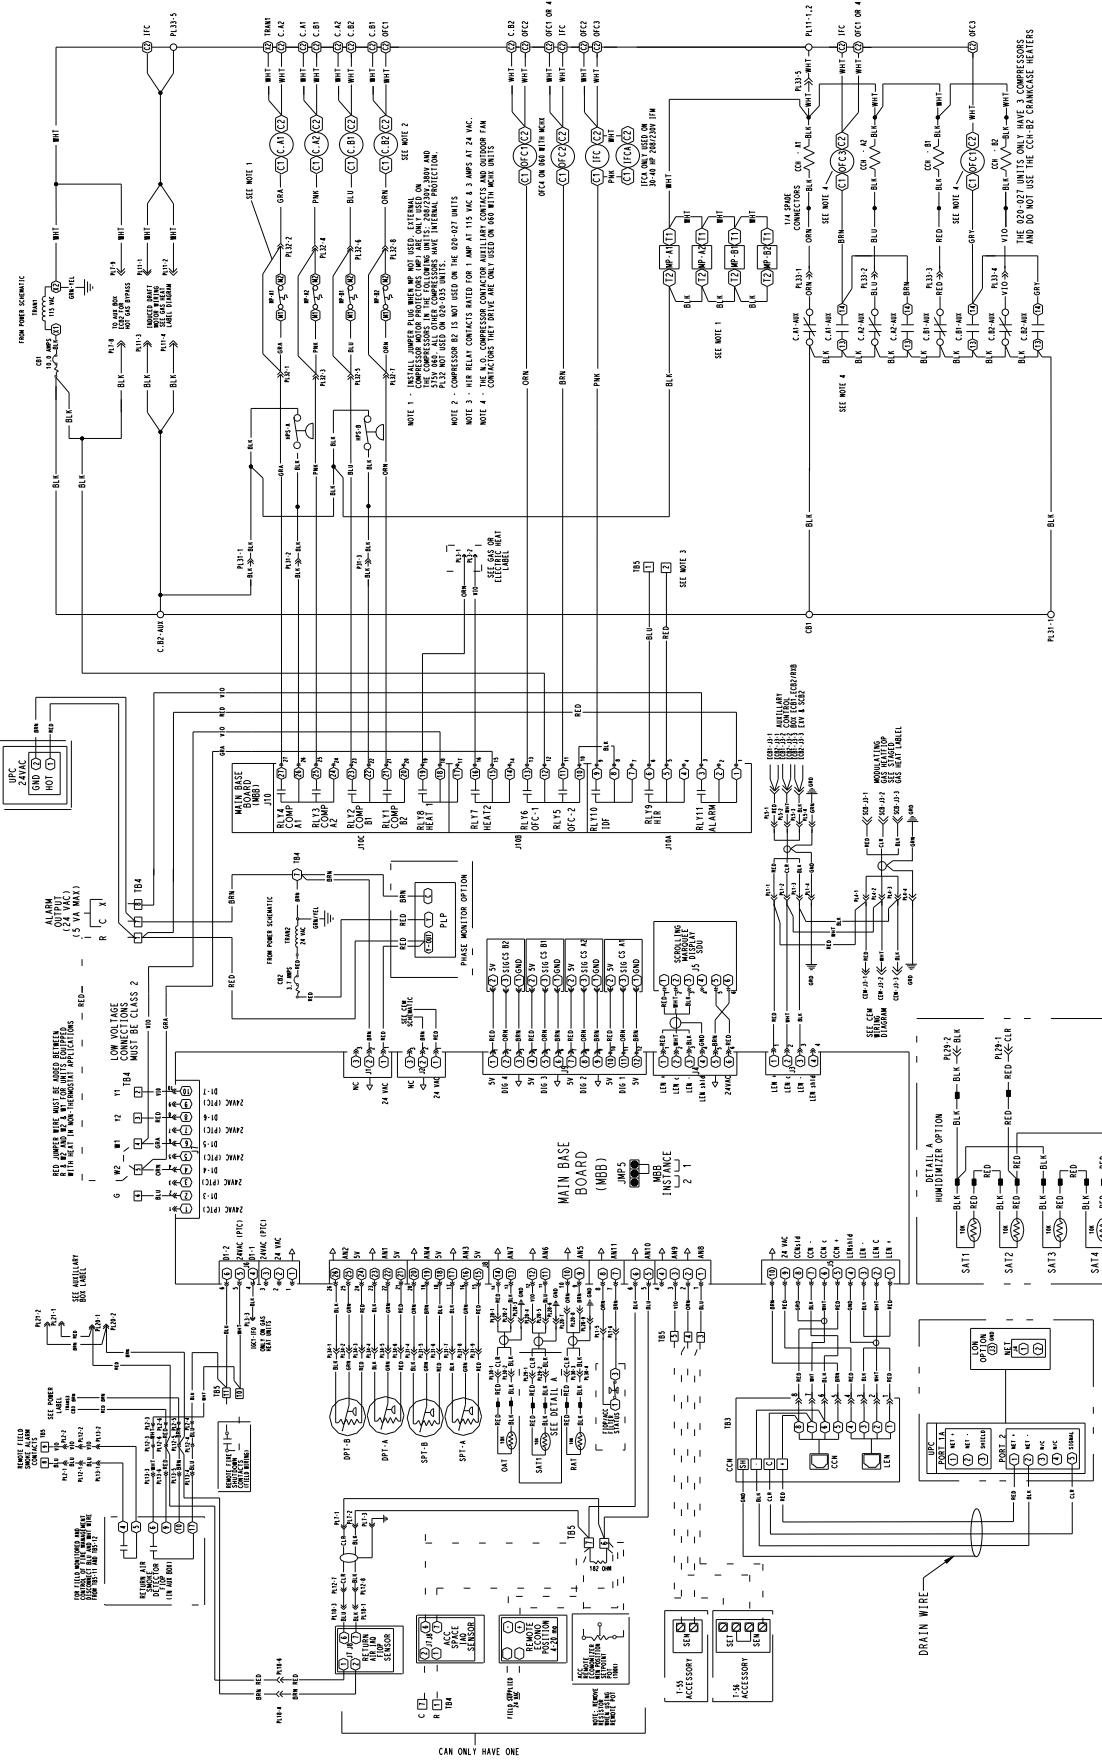


Typical wiring schematics (cont)

AUXILIARY CONTROL BOX SCHEMATIC 48/50A020-060

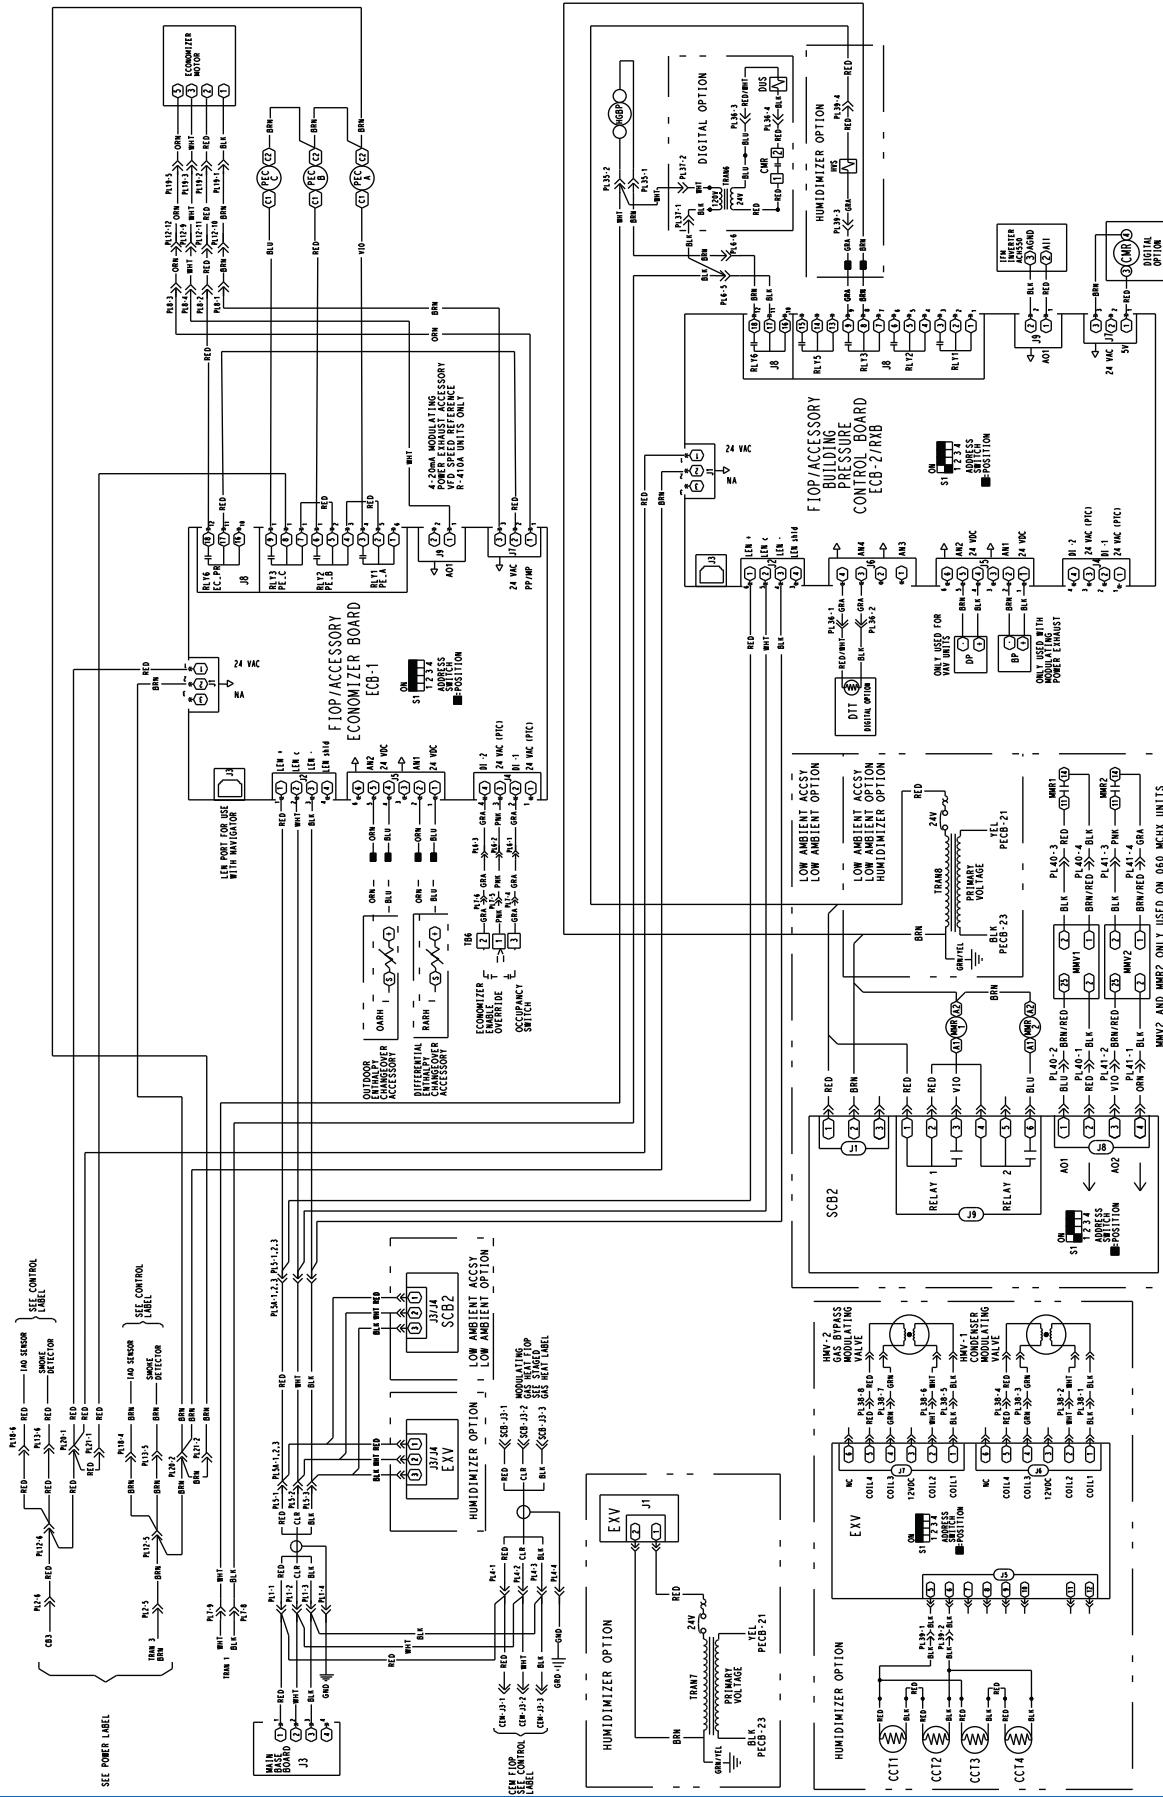

Typical wiring schematics (cont)


Carrier

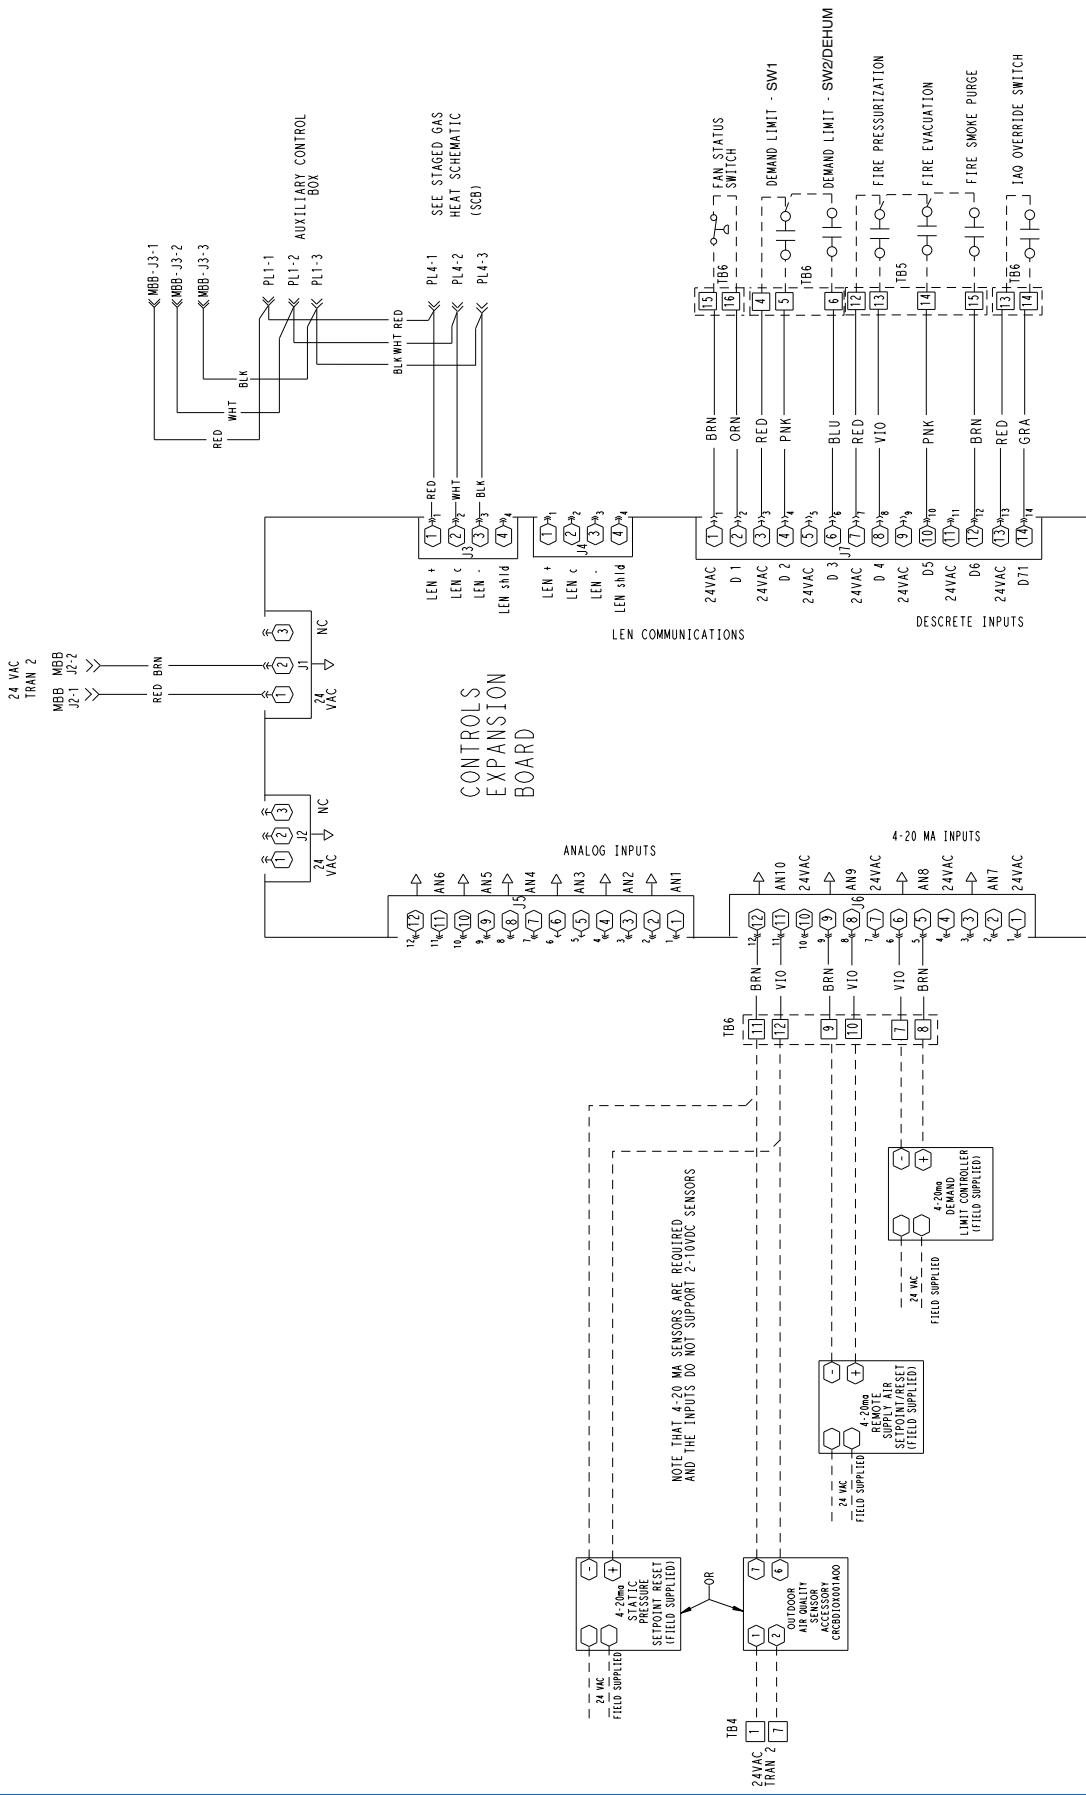

Typical wiring schematics (cont)



GAS HEAT CONTROL SCHEMATIC (TWO-STAGE HEAT) 48A2,A3,A6,A7020-060

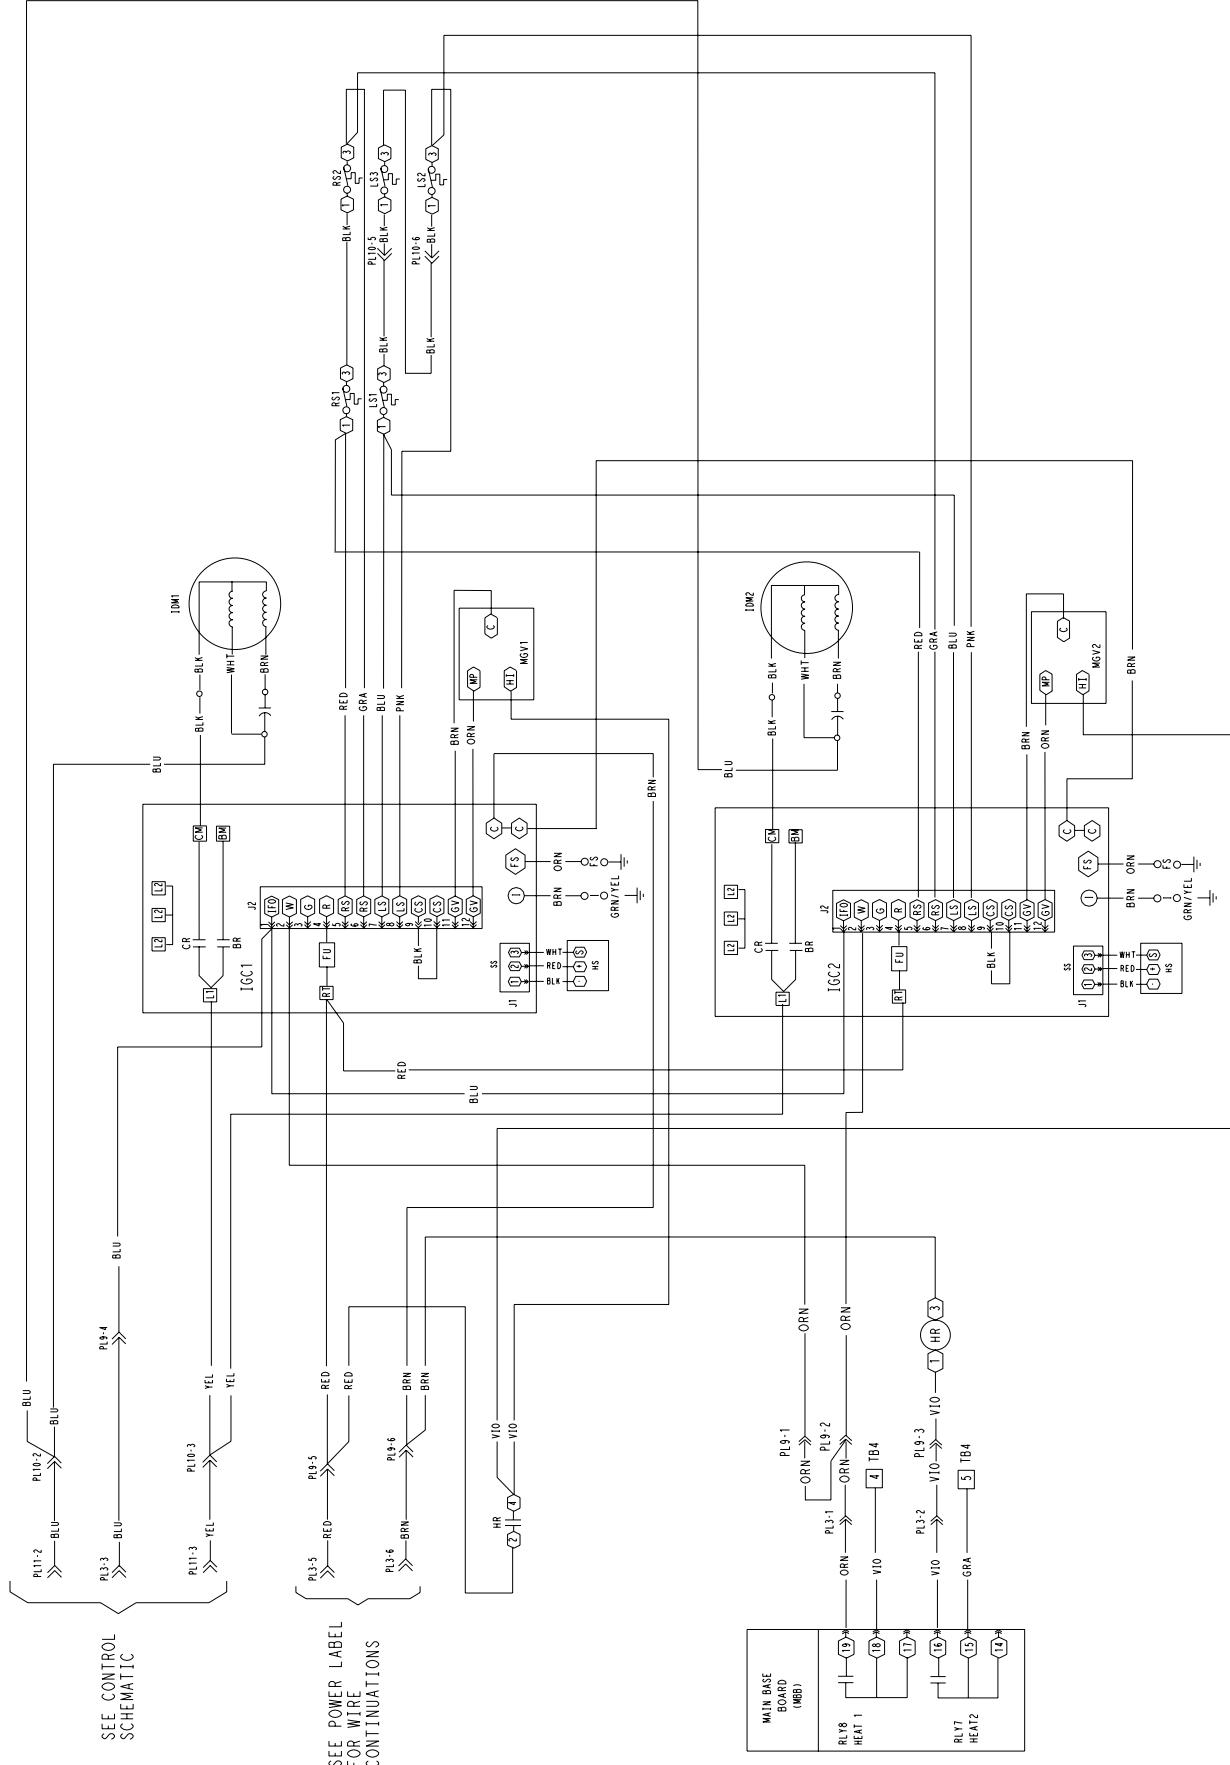

Typical wiring schematics (cont)



LEGEND FOR TYPICAL WIRING SCHEMATICS

A	—	Circuit A
AUX	—	Auxiliary Contact
BP	—	Building Pressure Transducer
C	—	Compressor Contactor
CAP	—	Capacitor
CB	—	Circuit Breaker
CCB	—	Control Circuit Breaker
CCH	—	Crankcase Heater
CCN	—	Carrier Comfort Network®
CCT	—	Cooling Coil Thermistor
CEM	—	Controls Expansion Module
CMR	—	Compressor Modulation Relay
COMP	—	Compressor
CS	—	Compressor Current Sensor Board
DP	—	Discharge Pressure Transducer
DPT	—	Discharge Pressure Transducer
DTT	—	Digital Scroll Discharge Temperature Thermistor
DUS	—	Digital Unloader Solenoid
ECB-1	—	Economizer Control Board
ECB-2	—	VAV Control Board
EDT	—	Evaporator Discharge Temperature
EXV	—	Expansion Valve Control Board
FIOP	—	Factory-Installed Option
FS	—	Flame Sensor
FU	—	Fuse
GND	—	Ground
HGBP	—	Hot Gas Bypass
HMV	—	Humidi-MiZer Valve
HPS	—	High-Pressure Switch
HR	—	Heat Relay
HS	—	Hall Effect Induced Draft Motor Switch
HVS	—	Humidi-MiZer Valve Solenoid
IAQ	—	Indoor Air Quality

IDM	—	Induced-Draft Motor
IFC	—	Indoor-Fan Contactor
IFCB	—	Indoor-Fan Circuit Breaker
IFM	—	Indoor-Fan Motor
IGC	—	Integrated Gas Control Board
IP	—	Internal Compressor Protector
LEN	—	Local Equipment Network
LS	—	Limit Switch
MBB	—	Main Base Board
MGV	—	Main Gas Valve
OARH	—	Outdoor Air Relative Humidity
OAT	—	Outdoor Air Temperature Sensor
OFC	—	Outdoor-Fan Contactor
OFM	—	Outdoor-Fan Motor
OL	—	Overload
PEC	—	Power Exhaust Contactor
PEM	—	Power Exhaust Motor
PL	—	Plug
PLP	—	Phase Loss Protection
PTC	—	Positive Temperature Coefficient
RARH	—	Return Air Relative Humidity
RAT	—	Return Air Temperature Sensor
RS	—	Rollout Switch
RXB	—	Rooftop Control Board
SCB	—	Staged Gas Heat Control Board
SDU	—	Scrolling Marquee Display
SPT	—	Suction Pressure Transducer
T-55	—	Room Temperature Sensor
T-56	—	Room Temperature Sensor with Set Point
TB	—	Terminal Block
TRANS	—	Transformer
UPC	—	Universal Protocol Converter
VAV	—	Variable Air Volume
VFD	—	Variable Frequency Drive

THERMOSTAT MARKINGS

BM	—	Blower Motor
C	—	Common
CM	—	Inducer Motor
CS	—	Centrifugal Switch
G	—	Fan
IFO	—	Indoor Fan On
L1	—	Line 1
R	—	Thermostat Power
RT	—	Power Supply
SS	—	Speed Sensor
W1	—	Thermostat Heat Stage 1
W2	—	Thermostat Heat Stage 2
X	—	Alarm Output
Y1	—	Thermostat Cooling Stage 1
Y2	—	Thermostat Cooling Stage 2

Terminal (Marked)

Terminal (Unmarked)

Terminal Block

Splice

Factory Wiring

Field Wiring

To indicate common potential only, not to represent wiring.

Guide specifications — 48/50A2,A4,A6,A8



Applied Packaged Cooling Unit and Applied Packaged Cooling Unit with Gas Heat — Constant Volume or Staged Air Volume Application

HVAC Guide Specifications — Section 48/50A2,A4,A6,A8

Size Range: **20 to 60 Tons, Nominal (Cooling)**
Carrier Model Number: **48A2, 48A4, 48A6, 48A8, 50A2, 50A4, 50A6, 50A8**

Part 1 — General

1.01 SYSTEM DESCRIPTION

Outdoor roof curb or slab mounted, electronically controlled heating and cooling unit utilizing hermetic scroll compressors with crankcase heaters for cooling duty and with optional gas heat or electric heat. Units shall discharge supply and return air vertically or horizontally as shown on contract drawings.

1.02 QUALITY ASSURANCE

- A. Unit shall be rated in accordance with AHRI (Air Conditioning, Heating, and Refrigeration Institute) Standard 340/360, latest edition.
 - B. Unit shall be designed to conform to ANSI (American National Standards Institute)/ASHRAE 15, ASHRAE 62, and UL (Underwriters Laboratories) Standard 1995.
 - C. Unit shall be listed by ETL and ETL, Canada as a total package.
 - D. The 48A2,A4,A6,A8 units shall be designed to conform with ANSI Standard Z21.47 (U.S.A.) / CSA (Canadian Standards Association) Standard 2.3 (Canada), Gas-Fired Central Furnaces.
 - E. Roof curb shall be designed to NRCA (National Roofing Contractors Association) criteria per Bulletin B-1986.
 - F. Insulation and adhesive shall meet NFPA (National Fire Protection Association) 90A requirements for flame spread and smoke generation.
 - G. The management system governing the manufacture of this product is ISO (International Organization for Standardization) 9001:2015 certified.
- ##### 1.03 DELIVERY, STORAGE AND HANDLING
- Unit shall be stored and handled per manufacturer's recommendations. All exposed coils shall have protective shipping covers.

Part 2 — Products

2.01 EQUIPMENT

A. General:

Factory-assembled, single-piece heating and cooling unit. Contained within the unit enclosure shall be all factory wiring, piping, refrigerant charge (R-410A), operating oil charge, dual refrigerant circuits, microprocessor based control system and associated hardware, and all special features required prior to field start-up.

B. Unit Cabinet:

1. Constructed of galvanized steel, bonderized and precoated with a baked enamel finish.
 - a. Top cover shall be 18-gage sheet metal with 0.75-in. thick, 1.5-lb density, fiberglass insulation.
 - b. Access panels and doors shall be 20-gage sheet metal with 0.5-in. thick, 1.5-lb density, fiberglass insulation.
 - c. Corner and center posts shall be 16-gage galvanized steel.
 - d. Basepans in the heating and return air sections shall be 16-gage galvanized steel.
 - e. Basepans in the condenser section shall be 16-gage galvanized steel.
 - f. Compressor rail shall be 12-gage galvanized steel.
 - g. Condensate pan shall be 16-gage aluminized steel.
 - h. Air baffles shall be 18-gage galvanized steel with 0.5-in. thick, 1.5-lb density, fiberglass insulation.
 - i. Base rail shall be 14-gage galvanized steel.
 - j. Fan deck (indoor and outdoor section) shall be 16-gage galvanized steel.
2. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM (American Society for Testing and Materials) B117 (scribed specimen).
3. Sides shall have person-sized insulated hinged access doors for easy access to the control box and other areas requiring servicing. Each door shall seal against a rubber gasket to help prevent air and water leakage and be equipped to permit ease and safety during servicing.
4. Interior cabinet surfaces shall be sheet metal lined or insulated with flexible fire-retardant material, coated on the air side.
5. Unit shall have a factory-installed sloped condensate drain connection made from an aluminized steel or optional stainless steel.
6. Equipped with lifting lugs to facilitate overhead rigging.
7. Filters shall be accessible through a hinged access panel.

C. Fans:

1. Indoor Evaporator Fans:
 - a. Double-width/double-inlet, centrifugal, belt driven, forward-curved type with single outlet discharge.
 - b. Fan shaft bearings shall be of the pillow-block type with positive locking collar and lubrication provisions.
 - c. Statically and dynamically balanced.

Guide specifications — 48/50A2,A4,A6,A8 (cont)



- d. Evaporator fan shaft bearings shall have a life of 200,000 hours at design operating conditions in accordance with ANSI B3.15.
- e. Solid fan shaft construction for size 020-050 units and two-piece solid fan shaft construction on the size 060 unit.
- 2. Condenser Fans:
 - a. Fans shall be direct-driven propeller type only, with corrosion-resistant blades riveted to corrosion resistant steel supports for all size 020-050 units and the size 060 unit with optional condenser coil. Size 060 units with the microchannel condenser coil shall have a direct driven, 9-blade airfoil cross section, reinforced polymer construction, and shrouded-axial type fans with inherent corrosion resistance.
 - b. Fans discharge air vertically upward and are protected by PVC coated steel wire safety guards.
 - c. Statically and dynamically balanced.
- 3. Fan Drive for SAV™ (Staged Air Volume) Units:

Staged air volume units shall be equipped with variable frequency drive (VFD) inverter. The VFD shall control motor speed to user-configurable speeds. The high and low fan speeds shall be user configurable between 0 and 100% of 60 Hz. The control shall also include dedicated heating fan speeds. The heating low fan speed shall be configurable between 75% and 100%. The high heating fan speed shall be 100%. The VFD shall be factory mounted, wired, and tested. The variable speed drive shall include the following features.

 - a. Full digital control with direct control from the unit *ComfortLink* controls.
 - b. Insulated gate bi-polar transistors (IGBT) used to produce the output pulse width modulated (PWM) waveform, allowing for quiet motor operation.
 - c. Inverters capable of operation at a frequency of 8 kHz so no acoustic noise shall be produced by the motor.
 - d. Critical frequency avoidance.
 - e. Self diagnostics.
 - f. On-board storage of unit manufacturer's customer user settings, retrievable from the keypad.
 - g. RS485 communications capability.
 - h. Electronic thermal overload protection.
 - i. 5% swinging chokes for harmonic reduction and improved power factor.
 - j. All printed circuit boards shall be conformal coated.
 - k. Shall, through ABB, qualify for a 24-month warranty from date of commissioning or 30 months from date of sale, whichever comes first.
- D. Compressors:
 - 1. Fully hermetic, scroll type compressors with overload protection and short cycle protection with minimum on and off timers.
 - 2. Factory rubber-in-shear mounted for vibration isolation.
 - 3. Reverse rotation protection capability.
 - 4. Crankcase heaters shall only be activated during compressor off mode.
- E. Coils:
 - 1. Standard evaporator coil shall have aluminum plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
 - 2. Standard condenser coil shall be microchannel design. The coil shall have a series of flat tubes containing a series of multiple, parallel flow microchannels layered between the refrigerant manifolds. Microchannel coils shall consist of a two-pass arrangement. Coil construction shall consist of aluminum alloys for the fins, tubes, and manifolds.
 - 3. Coils shall be leak tested at 150 psig and pressure tested at 650 psig.
 - 4. Optional condenser coil shall have aluminum plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
 - 5. Optional pre-coated aluminum-fin coils shall have a durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube. Epoxy-phenolic barrier shall minimize galvanic action between dissimilar metals.
 - 6. Copper-fin coils shall be constructed of copper fins mechanically bonded to copper tubes and copper tube sheets. Galvanized steel tube sheets shall not be acceptable. A polymer strip shall prevent coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan. All copper construction shall provide protection in moderate coastal environments.
 - 7. E-coated coils shall have a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins. Coating process shall ensure complete coil encapsulation. Color shall be high gloss black with gloss — 60 deg of 65 to 90% per ASTM D523-89. Uniform dry film thickness from 0.8 to 1.2 mil on all surface areas including fin edges. Superior hardness characteristics of 2H per ASTM D3363-92A and cross-hatch adhesion of 4B-5B per

ASTM D3359-93. Impact resistance shall be up to 160 in./lb (ASTM D2794-93). Humidity and water immersion resistance shall be up to minimum 1000 and 250 hours respectively (ASTM D2247-92 and ASTM D870-92). Corrosion durability shall be confirmed through testing to be no less than 6000 hours salt spray per ASTM B117-90. Coil construction shall be aluminum fins mechanically bonded to copper tubes.

F. Gas Heating Section (48 Series Only):

1. Induced-draft combustion type with energy-saving direct spark ignition systems and redundant main gas valves.
2. The heat exchanger shall be of the tubular section type constructed of a minimum of 20-gage steel coated with a nominal 1.2 mil aluminum-silicone alloy for corrosion resistance. Optional stainless steel heat exchangers shall be available.
3. Burners shall be of the in-shot type constructed of aluminum coated steel.
4. All gas piping shall enter the unit cabinet at a single location.
5. Induced Draft Fans:
 - a. Direct-driven, single inlet, forward-curved centrifugal type.
 - b. Statically and dynamically balanced.
 - c. Made from steel with a corrosion-resistant finish.
6. High-corrosion areas such as flue gas collection and exhaust areas shall be lined with corrosion resistant material.

G. Refrigerant Components:

Unit shall be equipped with dual refrigerant circuits, each containing:

1. Solid core filter drier.
2. Thermostatic expansion valve.
3. Fusible plug.

H. Filter Section:

Standard filter section shall be supplied with 2-in. thick disposable fiberglass filters.

I. Controls and Safeties:

1. Unit ComfortLink Controls:
 - a. Scrolling marquee display.
 - b. CCN (Carrier Comfort Network®) capable.
 - c. Unit control with standard suction pressure and condensing pressure transducers.
 - d. Shall provide a minimum 5°F temperature difference between cooling and heating set points to meet ASHRAE 90.1 energy standard.
 - e. Shall provide and display a current alarm list and an alarm history list.
 - f. Automatic compressor lead/lag control.

- g. Service run test capability.
- h. Shall accept input from a CO₂ sensor (both indoor and outdoor).
- i. Configurable alarm light shall be provided which activates when certain types of alarms occur.
- j. Compressor minimum run time (3 minutes) and minimum off time (3 minutes) are provided.
- k. Service diagnostic mode.
- l. Optional integrated economizer control or two-position self-closing adjustable outside air damper.
- m. Minimum of 3 capacity stages of mechanical capacity control (excluding hot gas bypass) controlled by the following method:
A control algorithm to maintain either high-cool or low-cool supply air temperature set point. Cooling mode (off, low, or high) to be determined from space temperature sensor or standard 2-stage mechanical thermostat input.
- n. Optional minimum load valve for additional capacity stage.
- o. Unit shall be complete with self-contained low voltage control circuit.
- p. Control of evaporator leaving air temperature through compressor and economizer control.

2. Safeties:

- a. Unit shall incorporate a solid-state compressor lockout which provides optional reset capability at the space thermostat should any of the following safety devices trip and shut off compressor:
 - 1) Compressor lockout protection provided for either internal or external overload.
 - 2) Low-pressure protection.
 - 3) Freeze protection (evaporator coil).
 - 4) High-pressure protection (high pressure switch or internal).
 - 5) Compressor reverse rotation protection.
 - 6) Loss-of-charge protection.
 - 7) Welded contactor protection.
- b. Supply-air sensor shall be located in the unit and should be used for economizer control and compressor stage control.
- c. Induced draft heating section (48 Series) shall be provided with the following minimum protections:
 - 1) High-temperature limit switch.
 - 2) Induced-draft motor speed sensor.
 - 3) Flame rollout switch.
 - 4) Flame proving controls.
 - 5) Redundant gas valve.

Guide specifications — 48/50A2,A4,A6,A8 (cont)



J. Operating Characteristics:

1. Unit shall be capable of starting and running at 115°F ambient outdoor temperature per maximum load criteria of AHRI Standard 340/360.
2. Unit with standard controls will operate in cooling down to an outdoor ambient temperature of 32°F.
3. Unit shall be provided with fan time delay to help prevent cold air delivery.

K. Electrical Requirements:

1. All unit power wiring shall enter unit cabinet at a single location.
2. Unit shall have a short circuit current rating (SCCR) of 5 kA.

L. Motors:

1. Compressor motors shall be cooled by refrigerant gas passing through motor windings and shall have either internal line break thermal and current overload protection or external current overload modules with compressor temperature sensors.
2. All condenser-fan motors shall be totally enclosed 3-phase type with permanently lubricated ball bearings, class F insulation and internal, automatic-reset thermal overload protection or manual reset calibrated circuit breakers.
3. All indoor fan and power exhaust motors 5 hp and larger shall meet the minimum efficiency requirements as established by the Energy Independence and Security Act (EISA) of 2007.

M. Special Features:

Certain features are not applicable when the features designated * are specified. For assistance in amending the specifications, contact your local Carrier Sales Office.

1. Variable Capacity Compressor:

A lead circuit variable capacity compressor shall be available for constant volume, staged air volume, and variable air volume configurations. The *ComfortLink* control system shall be capable of unloading this compressor in an infinite number of steps from 100% of compressor capacity down to 50% of compressor capacity.

2. Humidi-MiZer® Adaptive Dehumidification:

The Humidi-MiZer dehumidification system shall be factory installed with an e-coated reheat coil and shall provide greater dehumidification of the occupied space by using two modes of dehumidification instead of the normal design cooling mode of the unit:

- a. Subcooling mode shall further subcool the hot liquid refrigerant leaving the condenser coil when both temperature and humidity in the space are not satisfied.
- b. Hot gas reheat mode shall mix a portion of the hot gas from the discharge of the compressor with the hot liquid refrigerant leaving the condenser coil to create a two-phase

heat transfer in the system, resulting in a neutral leaving-air temperature.

- c. The system shall be equipped with modulating control valves to provide precise leaving-air temperature control. On-off, cycling type control shall not be acceptable.

- d. Reheat coil shall be e-coated as standard.

3. Integrated Ultra Low Leak Economizer:

- a. Economizer shall meet the requirements of ASHRAE 90.1 (latest revision) and California Energy Commission Title 24.

- b. Economizer shall be furnished and installed complete with recirculated air dampers, outdoor air dampers, and controls.

- c. All dampers shall be ultra-low leakage type with blade and edge seals. Dampers shall be 1A certified and exhibit a maximum leakage rate of 3 cfm per square foot of area at 1 in. wg pressure differential when tested per AMCA (Air Movement and Control Association) Std 511.

- d. Dampers shall continue to operate as intended after 100,000 cycles when tested in accordance with Section 8, UL (Underwriters Laboratories) standard 555S.

- e. Actuator shall have a spring return feature which closes the outdoor air dampers upon a power interruption or unit shutdown. Actuators shall be of the communicating type and capable of internal diagnostics.

- f. Economizer shall be capable of introducing up to 100% outdoor air for ventilation or free cooling.

- g. Economizer outdoor air hoods shall be constructed of pre-painted steel.

4. Barometric Relief Damper Package:

- a. Package shall include damper, seals, hardware, and hoods to relieve excess internal pressure.

- b. Damper shall close due to gravity upon unit shutdown.

5. Power Exhaust:

Package shall include a multiple exhaust fan (centrifugal style) fan, 1 Hp 208-230, 460 v direct-drive motor, and damper for vertical flow units with economizer to control overpressurization of building. Control shall be through *ComfortLink* controls based on damper position or through an optional building pressure sensor. On size 020-050 units, 4 stages of control shall be available. On size 060 units, 6 stages of control shall be available.

6. Thermostats and Subbases:

To provide staged heating and cooling in addition to automatic (or manual) changeover and fan control.

Guide specifications — 48/50A2,A4,A6,A8 (cont)



7. Electronic Programmable Thermostat:
Capable of using deluxe full-featured electronic thermostat.
8. Liquefied Propane Conversion Kit (48 Series):
Kit shall contain all the necessary hardware and instructions to convert a standard natural gas unit for use with liquefied propane gas.
9. Convenience Outlet:
Shall be factory installed and internally mounted with an externally accessible 115-v, 15 amp. GFI (Ground Fault Interrupter), female receptacle with hinged cover. A step-down transformer and overload protection shall be included so no additional wiring is necessary unless the field-wired outlet has been requested. When applied with a unit-mounted disconnect, the outlet shall be wired to the load side of the disconnect so the outlet will shut off with the disconnect.
10. Non-Fused Disconnect Switch:
Shall be factory installed, internally mounted, and UL approved. Non-fused switch shall provide unit power shutoff. Shall be accessible from outside the unit and shall provide power-off lockout capability.
11. Electric Heater (50 Series Units Only):
Electric resistance heaters shall be factory installed, nichrome element type, open wire coils with 0.29 in. inside diameter, insulated with ceramic bushings, and shall include operating and safety controls. Coil ends are staked and welded to terminal screw slots.
12. Hail Guard, Condenser Coil Grille:
Shall protect the condenser coil from hail, flying debris, and damage by large objects without increasing unit clearances.
13. CO₂ Sensor:
The CO₂ sensor shall have the ability to monitor CO₂ levels and relay information to the controller. The controller will use CO₂ level information to modulate the economizer and provide demand controlled ventilation. The sensor shall be available as a field-installed or factory-installed return air sensor or a remote space sensor.
14. Return Air Smoke Detector:
The smoke detector shall send input to the controller to shut down the unit in case smoke is detected. The smoke detector shall be factory installed in the return air section or shall be available as a field-installed accessory.
15. Filter Status:
The filter status switch shall be a pressure differential switch and will indicate a dirty filter. The switch shall be available as field or factory installed.
16. Humidity Sensor:
A humidity sensor will allow for outside air enthalpy changeover control using the standard outside air dry bulb sensor and the accessory humidity sensor. When both an outside and return air humidity sensor are used, differential enthalpy changeover can be supported.
17. Two-Position Damper:
A two-position damper shall admit up to 25% outdoor air during fan operation and shall close when the fan is off. The damper position shall be mechanically adjustable.
18. 4-Inch Filters:
Optional filter section shall be supplied with 4-in. thick MERV (Minimum Efficiency Reporting Value) 7 pleated fiberglass filters.
19. Control Expansion Module (CEM):
Shall provide the following additional optional features:
 - a. Remote set point
 - b. Demand limit control
 - c. Remote economizer position
 - d. Fire and smoke control override control
 - e. Remote sensor monitoring
 - f. Fan status switch monitoring
20. Staged Gas Heat (48A2,A4 only):
The control shall have the option for control of the gas heat to a discharge air temperature by sequencing on the gas cells to provide up to 11 stages of capacity. The control shall be integrated directly into the main unit controls and shall include leaving air temperature sensors to ensure that high temperatures do not occur during the operation of the staged gas heat.
21. Navigator™ Display Module:
The Navigator display module shall be a portable hand-held display module with a minimum of 4 lines and 20 characters per line, of clear English, Spanish, Portuguese, or French language. Display menus shall provide clear language descriptions of all menu items, operating modes, configuration points, and alarm diagnostics. Reference to factory codes shall not be accepted. An industrial grade coiled extension cord shall allow the display module to be moved around the chiller. Magnets shall hold the display module to any sheet metal panel to allow hands-free operation. Display module shall have NEMA (National Electrical Manufacturers Association) 4x housing suitable for use in outdoor environments. Display shall have back light and contrast adjustment for easy viewing in bright sunlight or night conditions. The display module shall have raised surface buttons with positive tactile response.

Guide specifications — 48/50A2,A4,A6,A8 (cont)



22. BACnet¹ Communication Option:
Shall provide factory-installed communication capability with a BACnet MS/TP network. Allows integration with i-Vu® Open Control System or a BACnet Building Automation System.
23. Modbus² Protocol Translator:
A controller-based accessory module shall provide CCN to MODBUS Remote Terminal Unit (RTU) protocol conversion.
24. LonWorks³ Protocol Translator:
A controller-based accessory module shall provide CCN to LON FT-10A ANSI/EIA-709.1 protocol conversion.
25. Full Perimeter Roof Curbs (Horizontal and Vertical):
Shall be formed of 14-gage galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
26. Security Grille (48/50A060 Unit with MCHX [microchannel heat exchanger] Only):
Factory-installed grille shall limit access to compressor and condenser coil area to authorized personnel only.
27. Double Wall Option:
Unit cabinet shall have double wall construction featuring flexible fire retardant fiberglass insulation sandwiched between pre-painted exterior panels and galvanized steel inner panels.
28. Compressor Sound Blanket:
Field-installed accessory, consisting of compressor sound blankets which are used to mitigate the level of outdoor sound. Available in both single and tandem arrangements.
29. Low Outdoor Sound Condenser Fans:
Low sound condenser fan system shall be provided to reduce outdoor sound levels.
30. Low Ambient Control:
 - This factory-installed option shall regulate outdoor fan motor speeds in response to the saturated condensing temperature of the refrigeration circuits and local ambient conditions.
 - The control shall be capable of operating the rooftop unit mechanical cooling with outdoor temperature at -20°F.
31. Greenspeed® Intelligence:
 - This factory-installed option shall regulate outdoor fan motor speeds in response to the saturated condensing temperature of the refrigeration circuits and local ambient conditions.
 - The control shall be capable of operating the rooftop unit with outdoor temperature at -20°F.
 - Fans shall be direct-driven shrouded-axial propeller type fans only, with 9-blade Aero-Acoustic™ airfoil cross section, reinforced polymer construction blades bolted to corrosion resistant steel supports for all size 020-050 units and the size 060 unit with optional condenser coil.
 - Fans discharge air vertically upward and are protected by PVC coated steel wire safety guards.
 - Fans are statically and dynamically balanced.
 - The condenser fan motors will be VFD driven.
 - Compressor blankets will be applied to mitigate the level of outdoor sound on all refrigerant compressors. They shall be weather resistant are applied in both single and tandem arrangements.
 - Unit efficiency is maximized by monitoring the refrigerant system and ambient conditions and controlling condenser fan performance.
32. Phase Loss Protection:
If the phases of the electric supply are out of sequence, or if one phase is missing, the contacts will never close. If a phase is lost while the phase monitor is energized, the contacts will open immediately and will remain open until the error is corrected.
33. Extended Lube Lines:
Factory-installed nylon lube line extensions shall be provided to the far side fan motor bearings to allow bearing lubrication from the fan motor access door.
34. Hot Gas Bypass (HGBP):
A factory-installed hot gas bypass valve shall be available on the lead circuit to provide additional unloading capability for standard scroll compressors. HGBP shall only be active at the lowest stage of capacity.

1. BACnet is a trademark of ASHRAE.

2. Modbus is a registered trademark of Schneider Electric.

3. LonWorks is a registered trademark of Echelon Corporation.

Guide specifications — 48/50A3,A5,A7,A9



Applied Packaged Cooling Unit and Applied Packaged Cooling Unit with Gas Heat — Variable Air Volume Application

HVAC Guide Specifications — Section 48/50A3,A5,A7,A9

Size Range: **20 to 60 Tons, Nominal (Cooling)**

Carrier Model Number: **48A3, 48A5, 48A7, 48A9, 50A3, 50A5, 50A7, 50A9**

Part 1 — General

1.01 SYSTEM DESCRIPTION

Outdoor roof curb or slab mounted, electronically controlled heating and cooling unit utilizing hermetic scroll compressors with crankcase heaters for cooling duty and gas heat or electric heat. Units shall discharge supply and return air vertically or horizontally as shown on contract drawings. EERs (Energy Efficiency Ratios) shall meet requirements of ASHRAE (American Society of Heating, Refrigeration, and Air-Conditioning Engineers) Standard 90.1-2013.

1.02 QUALITY ASSURANCE

- A. Unit shall be rated in accordance with AHRI (Air-Conditioning, Heating, and Refrigeration Institute) Standard 340/360, latest edition.
- B. Unit shall be designed to conform to ANSI/ASHRAE 15 (latest edition), ASHRAE 62, and UL (Underwriters Laboratories) Standard 1995.
- C. Unit shall be listed by ETL and ETL, Canada as a total package.
- D. The 48A3,A5,A7,A9 units shall be designed to conform with ANSI (American National Standards Institute) Standard Z21.47 (U.S.A.) / CSA (Canadian Standards Association) Standard 2.3, Gas-Fired Central Furnaces.
- E. Roof curb shall be designed to NRCA (National Roofing Contractors Association) criteria per Bulletin B-1986.
- F. Insulation and adhesive shall meet NFPA (National Fire Protection Association) 90A requirements for flame spread and smoke generation.
- G. The management system governing the manufacture of this product is ISO (International Organization for Standardization) 9001:2008 certified.

1.03 DELIVERY, STORAGE AND HANDLING

Unit shall be stored and handled per manufacturer's recommendations.

Part 2 — Products

2.01 EQUIPMENT

A. General:

Factory-assembled, single-piece heating and cooling unit. Contained within the unit enclosure shall be all factory wiring, piping, refrigerant charge (R-410A), operating oil charge, dual refrigerant circuits, microprocessor-based control system and associated hardware, and all special features required prior to field start-up.

B. Unit Cabinet:

1. Constructed of galvanized steel, bonderized and precoated with a baked enamel finish.
 - a. Top cover shall be 18-gage sheet metal with 0.75-in. thick, 1.5-lb density, fiberglass insulation.
 - b. Access panels and doors shall be 20-gage sheet metal with 0.5-in. thick, 1.5-lb density, fiberglass insulation.
 - c. Corner and center posts shall be 16-gage galvanized steel.
 - d. Basepans in the heating and return air sections shall be 16-gage galvanized steel.
 - e. Basepans in the condenser section shall be 16-gage galvanized steel.
 - f. Compressor rail shall be 12-gage galvanized steel.
 - g. Condensate pan shall be 16-gage aluminized steel.
 - h. Air baffles shall be 18-gage galvanized steel with 0.5-in. thick, 1.5-lb density, fiberglass insulation.
 - i. Base rail shall be 14-gage galvanized steel.
 - j. Fan deck (indoor and outdoor section) shall be 16-gage galvanized steel.
2. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM (American Society for Testing and Materials) B117 (scribed specimen).
3. Sides shall have person-sized insulated hinged access doors for easy access to the control box and other areas requiring servicing. Each door shall seal against a rubber gasket to help prevent air and water leakage and be equipped to permit ease and safety during servicing.
4. Interior cabinet surfaces shall be sheet metal lined or insulated with flexible fire-retardant material, coated on the air side.
5. Unit shall have a factory-installed sloped condensate drain connection made from an aluminized steel or optional stainless steel.
6. Equipped with lifting lugs to facilitate overhead rigging.
7. Filters shall be accessible through a hinged access panel.

C. Fans:

1. Indoor Evaporator Fans:
 - a. Double-width/double-inlet, centrifugal, belt driven, forward-curved type with single outlet discharge.
 - b. Fan shaft bearings shall be of the pillow-block type with positive locking collar and lubrication provisions.
 - c. Statically and dynamically balanced.

- d. Evaporator fan shaft bearings shall have a life of 200,000 hours at design operating conditions in accordance with ANSI B3.15.
- e. Solid fan shaft construction for size 020-050 units and two-piece solid fan shaft construction on the size 060 unit.
- 2. Condenser Fans:
 - a. Fans shall be direct-driven propeller type only, with corrosion-resistant blades riveted to corrosion-resistant steel supports for all size 020-050 units and the size 060 unit with optional condenser coil. Size 060 units with the micro-channel condenser coil shall have a direct driven, 9-blade airfoil cross section, reinforced polymer construction, and shrouded-axial type fans with inherent corrosion resistance.
 - b. Fans discharge air vertically upward and are protected by PVC coated steel wire safety guards.
 - c. Statically and dynamically balanced.
- 3. Supply Fan Drive:

Unit shall be equipped with variable frequency drive (VFD) inverter. The VFD shall be installed inside the unit cabinet and shall be factory mounted, wired, and tested. The VFD shall control motor speed to maintain set point static pressure at the sensor tube location of the supply duct pressure transducer (the transducer is factory provided and installed; sensor tube must be field routed). The control system may be field-adjusted to maintain supply duct static pressure set points from 0 in. wg to 3.5 in. wg. The variable frequency drive shall include the following features:

 - a. Full digital control with direct control from the unit *ComfortLink* controls.
 - b. Insulated Gate Bi-Polar Transistors (IGBT) used to produce the output pulse width modulated (PWM) waveform, allowing for quiet motor operation.
 - c. Inverters capable of operation at a frequency of 8 kHz, so no acoustic noise shall be produced by the motor.
 - d. Self diagnostics.
 - e. Personal lockout code for additional security.
 - f. Critical frequency avoidance.
 - g. RS485 capability standard.
 - h. Electronic thermal overload protection.
 - i. 5% swinging chokes for harmonic reduction and improved power factor.
 - j. All printed circuit boards shall be conformal coated.
 - k. Shall, through ABB, qualify for a 24-month warranty from date of commissioning or 30 months from date of sale, whichever comes first.
- D. Compressors:
 - 1. Fully hermetic, scroll type compressors with overload protection and short cycle protection with minimum on and off timers.
 - 2. Factory rubber-in-shear mounted for vibration isolation.
 - 3. Reverse rotation protection capability.
 - 4. Crankcase heaters shall only be activated during compressor off mode.
- E. Coils:
 - 1. Standard evaporator coil shall have aluminum plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
 - 2. Standard condenser coil shall be microchannel design. The coil shall have a series of flat tubes containing a series of multiple, parallel flow microchannels layered between the refrigerant manifolds. Microchannel coils shall consist of a two-pass arrangement. Coil construction shall consist of aluminum alloys for the fins, tubes, and manifolds.
 - 3. Coils shall be leak tested at 150 psig and pressure tested at 650 psig.
 - 4. Optional condenser coil shall have aluminum plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
 - 5. Optional pre-coated aluminum-fin coils shall have a durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube. Epoxy-phenolic barrier shall minimize galvanic action between dissimilar metals.
 - 6. Copper-fin coils shall be constructed of copper fins mechanically bonded to copper tubes and copper tube sheets. Galvanized steel tube sheets shall not be acceptable. A polymer strip shall prevent coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan. All copper construction shall provide protection in moderate coastal environments.
 - 7. E-coated coils shall have a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins. Coating process shall ensure complete coil encapsulation. Color shall be high gloss black with gloss—60 deg of 65 to 90% per ASTM D523-89. Uniform dry film thickness from 0.8 to 1.2 mil on all surface areas including fin edges. Superior hardness characteristics of 2H per ASTM D3363-92A and cross-hatch adhesion of 4B-5B per ASTM D3359-93. Impact resistance shall be up to 160 in./lb (ASTM D2794-93). Humidity and water immersion resistance shall be up to minimum 1000 and 250 hours respectively (ASTM

Guide specifications — 48/50A3,A5,A7,A9 (cont)



D2247-92 and ASTM D870-92). Corrosion durability shall be confirmed through testing to be no less than 6000 hours salt spray per ASTM B117-90. Coil construction shall be aluminum fins mechanically bonded to copper tubes.

F. Gas Heating Section (48 Series Only):

1. Induced-draft combustion type with energy-saving direct spark ignition systems and redundant main gas valves.
2. The heat exchanger shall be of the tubular section type constructed of a minimum of 20-gage steel coated with a nominal 1.2 mil aluminum-silicone alloy for corrosion resistance. Optional stainless steel heat exchangers shall be available.
3. Burners shall be of the in-shot type constructed of aluminum coated steel.
4. All gas piping shall enter the unit cabinet at a single location.
5. Induced Draft Fans:
 - a. Direct-driven, single inlet, forward-curved centrifugal type.
 - b. Statically and dynamically balanced.
 - c. Made from steel with a corrosion-resistant finish.
6. High-corrosion areas such as flue gas collection and exhaust areas shall be lined with corrosion resistant material.

G. Refrigerant Components:

Unit shall be equipped with dual refrigerant circuits each containing:

1. Solid core filter drier.
2. Thermostatic expansion valve.
3. Fusible plug.

H. Filter Section:

Standard filter section shall be supplied with 2-in. thick disposable fiberglass filters.

I. Controls and Safeties:

1. Unit *ComfortLink* Controls:
 - a. Scrolling marquee display.
 - b. CCN (Carrier Comfort Network®) capable.
 - c. Unit control with standard suction pressure and condensing pressure transducers.
 - d. Shall provide a 5°F temperature difference between cooling and heating set points to meet ASHRAE 90.1, energy standard.
 - e. Shall provide and display a current alarm list and an alarm history list.
 - f. Automatic compressor redundancy.
 - g. Service run test capability.
 - h. Shall accept input from a CO₂ sensor (both indoor and outdoor).

- i. Configurable alarm light shall be provided which activates when certain types of alarms occur.
- j. Compressor minimum run time (3 minutes) and minimum off time (3 minutes) are provided.
- k. Service diagnostic mode.
- l. Optional integrated economizer control or two-position self-closing adjustable outside-air damper.
- m. Minimum of 3 capacity stages of mechanical capacity control (excluding hot gas bypass) controlled with logic to maintain supply air temperature set point.
- n. Optional minimum load valve for additional capacity stage.
- o. Unit shall be complete with self-contained low voltage control circuit.

2. Safeties:

- a. Unit shall incorporate a solid-state compressor lockout which provides optional reset capability at the space thermostat should any of the following safety devices trip and shut off compressor:
 - 1) Compressor lockout protection provided for either internal or external overload.
 - 2) Low-pressure protection.
 - 3) Freeze protection (evaporator coil).
 - 4) High-pressure protection (high pressure switch or internal).
 - 5) Compressor reverse rotation protection.
 - 6) Loss of charge protection.
 - 7) Welded contactor protection.
- b. Supply-air sensor shall be located in the unit and should be used for economizer control and compressor stage control.
- c. Induced draft heating section (48 Series) shall be provided with the following minimum protections:
 - 1) High-temperature limit switch.
 - 2) Induced-draft motor speed sensor.
 - 3) Flame rollout switch.
 - 4) Flame proving controls.
 - 5) Redundant gas valve.

J. Operating Characteristics:

1. Unit shall be capable of starting and running at 115°F ambient outdoor temperature per maximum load criteria of AHRI Standard 340/360.
2. Unit with standard controls will operate in cooling down to an outdoor ambient temperature of 32°F.
3. Unit shall be provided with fan time delay to prevent cold air delivery.

K. Electrical Requirements:

1. All unit power wiring shall enter unit cabinet at a single location.

Guide specifications — 48/50A3,A5,A7,A9 (cont)



2. Unit shall have a short circuit current rating (SCCR) of 5 kA.

L. Motors:

1. Compressor motors shall be cooled by refrigerant gas passing through motor windings and shall have either internal line break thermal and current overload protection or external current overload modules with compressor temperature sensors.
2. All condenser-fan motors shall be totally enclosed 3-phase type with permanently lubricated ball bearings, class F insulation and internal, automatic-reset thermal overload protection or manual reset calibrated circuit breakers.
3. All indoor fan and power exhaust motors 5 hp and larger shall meet the minimum efficiency requirements as established by the Energy Independence and Security Act (EISA) of 2007.

M. Special Features:

Certain features are not applicable when the features designated * are specified. For assistance in amending the specifications, contact your local Carrier Sales Office.

1. Variable Capacity Compressor:

A lead circuit variable capacity compressor shall be available for constant volume, staged air volume, and variable air volume configurations. The *ComfortLink* control system shall be capable of unloading this compressor in an infinite number of steps from 100% of compressor capacity down to 50% of compressor capacity.

2. Humidi-MiZer® Adaptive Dehumidification:

The Humidi-MiZer dehumidification system shall be factory installed with an e-coated reheat coil and shall provide greater dehumidification of the occupied space by using two modes of dehumidification instead of the normal design cooling mode of the unit:

- a. Subcooling mode shall further subcool the hot liquid refrigerant leaving the condenser coil when both temperature and humidity in the space are not satisfied.
- b. Hot gas reheat mode shall mix a portion of the hot gas from the discharge of the compressor with the hot liquid refrigerant leaving the condenser coil to create a two-phase heat transfer in the system, resulting in a neutral leaving-air temperature.
- c. The system shall be equipped with modulating control valves to provide precise leaving air temperature control. On-off, cycling type control shall not be acceptable.
- d. Reheat coil shall be e-coated as standard.

3. Ultra Low Leak Economizer:

Dry bulb, differential dry bulb temperature, optional enthalpy, or optional differential enthalpy controlled integrated type consisting

of dampers, actuator, and linkages in conjunction with control system to provide primary cooling using outdoor air, conditions permitting, supplemented with mechanical cooling when necessary.

- a. Economizer shall meet the requirements of the California Energy Commission Title 24 economizer requirements.

- b. Dampers shall be a gear-driven ultra low leakage type with blade and edge seals. Dampers shall exhibit a maximum leakage rate of 3 cfm per square foot of area at 1 in. wg pressure differential when tested in accordance with AMCA (Air Movement and Control Association) Standard 500.

4. Barometric Relief Damper Package:

- a. Package shall include damper, seals, hardware, and hoods to relieve excess internal pressure.
- b. Damper shall close due to gravity upon unit shutdown.

5. Power Exhaust:

Package shall include a multiple exhaust fan (centrifugal style) fan, 1 Hp 208-230, 460 v direct-drive motor, and damper for vertical flow units with economizer to control over-pressurization of building. Control shall be through *ComfortLink* controls based on optional building pressure sensor. On size 020-050 units, 4 stages of control shall be available. On size 060 units, 6 stages of control shall be available.

6. Liquefied Propane Conversion Kit (48 Series):

Kit shall contain all the necessary hardware and instructions to convert a standard natural gas unit for use with liquefied propane gas.

7. Convenience Outlet:

Shall be factory installed and internally mounted with an externally accessible 115-v, 15 amp GFI (ground fault interrupter), female receptacle with hinged cover. A step-down transformer and overload protection shall be included so no additional wiring is necessary unless the field-wired outlet has been requested. When applied with a unit-mounted disconnect, the outlet shall be wired to the load side of the disconnect so the outlet will shut off with the disconnect.

8. Non-Fused Disconnect Switch:

Shall be factory installed, internally mounted, and UL approved. Non-fused switch shall provide unit power shutoff. Shall be accessible from outside the unit and shall provide power off lockout capability.

9. Electric Heater (50 Series Units Only):

Electric resistance heaters shall be factory-installed, nichrome element type, open wire coils with 0.29 in. inside diameter, insulated with ceramic bushings, and include operating

- and safety controls. Coil ends are staked and welded to terminal screw slots.
10. Hail Guard, Condenser Coil Grille:
Shall protect the condenser coil from hail, flying debris, and damage by large objects without increasing unit clearances.
 11. CO₂ Sensor:
The CO₂ sensor shall have the ability to monitor CO₂ levels and relay information to the controller. The controller will use CO₂ level information to modulate the economizer and provide demand controlled ventilation. The sensor shall be available as a field-installed or factory-installed return air sensor or a remote space sensor.
 12. Return Air Smoke Detector:
The smoke detector shall send input to the controller to shut down the unit in case smoke is detected. The smoke detector shall be factory installed in the return air section or shall be available as a field-installed accessory.
 13. Filter Status:
The filter status switch shall be a pressure differential switch and will indicate a dirty filter. The switch shall be available as field or factory installed.
 14. Humidity Sensor:
A humidity sensor will allow for outside air enthalpy changeover control using the standard outside air dry bulb sensor and the accessory humidity sensor. When both an outside and return air humidity sensor are used, differential enthalpy changeover can be supported.
 15. Two-Position Damper:
A two-position damper shall admit up to 25% outdoor air during fan operation and shall close when the fan is off. The damper position shall be mechanically adjustable.
 16. 4-Inch Filters:
Optional filter section shall be supplied with 4-in. thick MERV (Minimum Efficiency Reporting Value) 7 pleated fiberglass filters.
 17. Control Expansion Module (CEM):
Shall provide the following additional optional features:
 - a. Remote set point.
 - b. Demand limit control.
 - c. Remote economizer position.
 - d. Fire and smoke control override control.
 - e. Remote sensor monitoring.
 - f. Fan status switch monitoring.
 18. Bypass for Supply Fan VFD (Variable Frequency Drive):
Units may be equipped with an optional manual bypass switch which allows the supply fan VFD to be electrically bypassed.
 19. BACnet¹ Communication Option:
Shall provide factory-installed communication capability with a BACnet MS/TP network. Allows integration with i-Vu® Open Control System or a BACnet Building Automation System.
 20. Modbus² Protocol Translator:
A controller-based module shall provide CCN to MODBUS Remote Terminal Unit (RTU) protocol conversion.
 21. LonWorks³ Protocol Translator:
A controller-based module shall provide CCN to LON FT-10A ANSI/EIA-709.1 protocol conversion.
 22. Navigator™ Display Module:
The Navigator display module shall be a portable hand-held display module with a minimum of 4 lines and 20 characters per line, of clear English, Spanish, Portuguese, or French language. Display menus shall provide clear language descriptions of all menu items, operating modes, configuration points and alarm diagnostics. Reference to factory codes shall not be accepted. An industrial grade coiled extension cord shall allow the display module to be moved around the chiller. Magnets shall hold the display module to any sheet metal panel to allow hands-free operation. Display module shall have NEMA (National Electrical Manufacturers Association) 4x housing suitable for use in outdoor environments. Display shall have back light and contrast adjustment for easy viewing in bright sunlight or night conditions. The display module shall have raised surface buttons with positive tactile response.
 23. Staged Gas Heat (48A3,A5 only):
The control shall have the option for control of the gas heat to a discharge air temperature by sequencing on the gas cells to provide up to 11 stages of capacity. The control shall be integrated directly into the main unit controls and shall include leaving air temperature sensors to ensure that high temperatures do not occur during the operation of the staged gas heat.
 24. Full Perimeter Roof Curbs (Horizontal and Vertical):
Shall be formed of 14-gage galvanized steel with wood nailing strip and shall be capable of supporting entire unit weight.

1. BACnet is a trademark of ASHRAE.
 2. Modbus is a registered trademark of Schneider Electric.
 3. LonWorks is a registered trademark of Echelon Corporation.

25. Security Grille (48/50A060 Unit with MCHX [microchannel heat exchanger] Only):

Factory-installed grille shall limit access to compressor and condenser coil area to authorized personnel only.
26. Double Wall Option:

Unit cabinet shall have double wall construction featuring flexible fire retardant fiberglass insulation sandwiched between pre-painted exterior panels and galvanized steel inner panels.
27. Compressor Sound Blanket:

Field-installed accessory, consisting of compressor sound blankets which are used to mitigate the level of outdoor sound. Available in both single and tandem arrangements.
28. Low Outdoor Sound Condenser Fans:

Low sound condenser fan system shall be provided to reduce outdoor sound levels.
29. Greenspeed® Intelligence:
 - a. This factory-installed option shall regulate outdoor fan motor speeds in response to the saturated condensing temperature of the refrigeration circuits and local ambient conditions.
 - b. The control shall be capable of operating the rooftop unit with outdoor temperature at -20°F.
 - c. Fans shall be direct-driven shrouded-axial propeller type fans only, with 9-blade Aero-Acoustic™ airfoil cross section, reinforced polymer construction blades bolted to corrosion resistant steel supports for all size 020-050 units and the size 060 unit with optional condenser coil.
 - d. Fans discharge air vertically upward and are protected by PVC coated steel wire safety guards.
- e. Fans are statically and dynamically balanced.
- f. The condenser fan motors will be VFD driven.
- g. Compressor blankets will be applied to mitigate the level of outdoor sound on all refrigerant compressors. They shall be weather resistant and applied in both single and tandem arrangements.
- h. Unit efficiency is maximized by monitoring refrigerant system and ambient conditions and controlling condenser fan performance.
30. Low Ambient Control:
 - a. This factory-installed option shall regulate outdoor fan motor speeds in response to the saturated condensing temperature of the refrigeration circuits and local ambient conditions.
 - b. The control shall be capable of operating the rooftop unit mechanical cooling with outdoor temperature at -20°F.
31. Phase Loss Protection:

If the phases of the electric supply are out of sequence, or if one phase is missing, the contacts will never close. If a phase is lost while the phase monitor is energized, the contacts will open immediately and will remain open until the error is corrected.
32. Extended Lube Lines:

factory-installed nylon lube line extensions shall be provided to the far side fan motor bearings to allow bearing lubrication from the fan motor access door.
33. Hot Gas Bypass (HGBP):

A factory-installed hot gas bypass valve shall be available on the lead circuit to provide additional unloading capability for standard scroll compressors. HGBP shall only be active at the lowest stage of capacity.

Carrier Corporation • Syracuse, New York 13221

11-21



Manufacturer reserves the right to discontinue, or change at any time, specifications or designs without notice and without incurring obligations.

Pg 108

Catalog No. 04-52480076-01

Printed in U.S.A.

Form 48-50A-20PD

Replaces: 48/50A-19PD