


FACTORY PIPING
FIELD WIRING
FACTORY WIRING

CONTROL CODE 4412

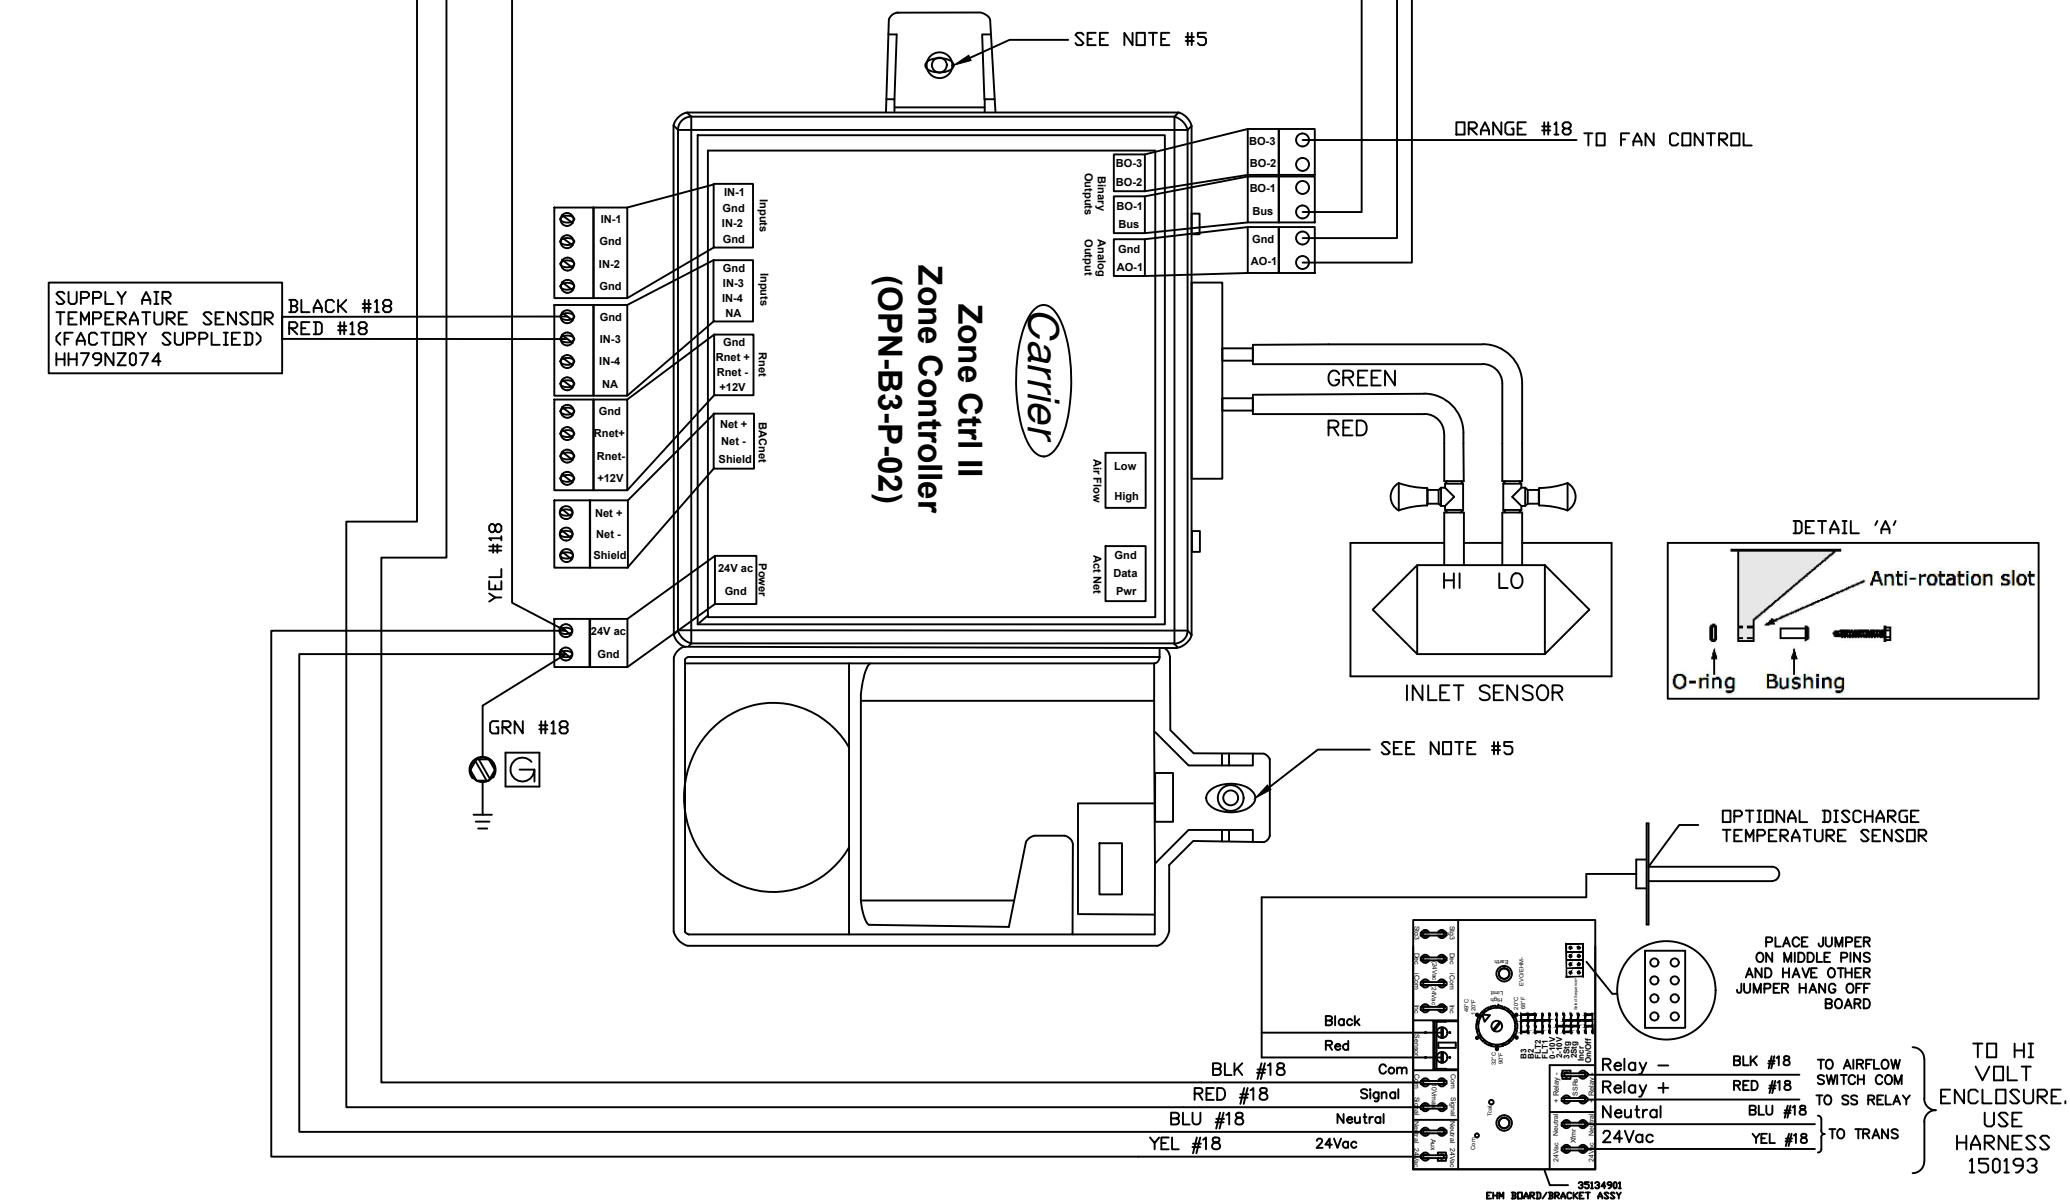

1. ACTUATOR NOTE: VERIFY ACTUATOR BUSHING IS IN THE FULL CW POSITION. ROTATE DAMPER CW TO THE FULLY CLOSED POSITION. MOUNT ACTUATOR OVER DAMPER SHAFT AND SECURE TO SHAFT ENCLOSURE. ENGAGE CLUTCH AND ROTATE DAMPER CCW TO THE FULLY OPEN POSITION.
2. SHOP NOTE: USE INSULATED QUICK CONNECTS.
3. CAUTION: ELECTRIC SHOCK MAY RESULT. DISCONNECT UNIT PRIOR TO SERVICING UNIT.
4. THESE CONTROLS HAVE BEEN WIRED TO COMPLY WITH UL-1995.
5. SECURE WITH SCREWS, BUSHINGS, AND O-RINGS SUPPLIED WITH CONTROLLER. CENTER THE BUSHING IN THE ANTI-ROTATION SLOT. SEE DETAIL 'A'.

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF AIR SYSTEM COMPONENTS. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF AIR SYSTEM COMPONENTS IS PROHIBITED.	DIMENSIONS ARE IN INCHES TOLERANCES: ANGULAR: MACH $\pm 1^\circ$ BEND $\pm 2^\circ$ TWO PLACE DECIMAL $\pm .03$ THREE PLACE DECIMAL $\pm .015$	MATERIAL N/A FINISH N/A	LATEST ECD K0004352 WORKFLOW STATE Released	RELEASED ON 08/21/20 RELEASED BY KAM	TITLE WIRE DIAGRAM, FAN POWERED ZONE CTRL II, OPN-B3-P-02 PROP 0-10 VDC SSR HEAT	DWG NO 753543	
						REV A	SHEET 12 OF 12