



Installation Instructions

CONTENTS

	PAGE
GENERAL	1
SAFETY CONSIDERATIONS	1
ACOUSTICAL CONSIDERATIONS	3
Location	3
Ductwork	3
Acoustic Insulation	3
INSTALLATION	4
Step 1 — Perform Jobsite Survey	4
Step 2 — Place Unit	4
Step 3 — Roof Mount Unit	4
• ROOF CURB	
• STEEL BEAMS	
Step 4 — Slab Mount Unit	4
Step 5 — Install Curb Gasketing	18
Step 6 — Install Field-Fabricated Ductwork	18
Step 7 — Rig Unit	18
Step 8 — Connect Condensate Drain	27
Step 9 — Install Outdoor Air Hoods	28
Step 10 — Route Field Wiring	29
Step 11 — Make Field Electrical Connections	29
• POWER WIRING	
Step 12 — Connect Air Pressure Tubing	31
• VARIABLE FREQUENCY DRIVE	
• POWER EXHAUST	
• RETURN FAN	
Step 13 — Remove Supply-Fan Shipping Bracket Screws	33
Step 14 — Remove PE Shipping Bracket Screws	33
Step 15 — Remove Return-Fan Shipping Brackets	33
Step 16 — Connect Gas Piping	33
Step 17 — Configure Modulating Gas Control	34
Step 18 — Install Flue/Inlet Hoods	34
Step 19 — Install Supply-Air Thermistors (Modulating Gas Units Only)	35
Step 20 — Install Unit Accessories	35
CONTROLS INSTALLATION	40
Constant Volume / Staged Air Volume Units	40
• CONTROL WIRING	
Variable Air Volume Units	40
• VAV CONTROL WIRING	
• SENSORS	
• HUMIDITY CONTROL AND HOT WATER AND STEAM VALVES	
• SPACE TEMPERATURE SENSOR (T-55)	
• SPACE TEMPERATURE SENSOR (T-56)	
• SPACE TEMPERATURE SENSOR (T-58)	
• SPACE TEMPERATURE AVERAGING	
• HEAT INTERLOCK RELAY (VAV UNITS ONLY)	

Option and Accessory Control Wiring	41
Carrier Comfort Network® (CCN) Interface	45
Optional UPC Open Installation	46

• WIRING THE UPC OPEN TO THE MS/TP NETWORK	
• MS/TP WIRING RECOMMENDATIONS	
• USING ZS SENSOR OR EQUIPMENT TOUCH	

Smoke Control Modes	49
----------------------------------	----

• FIRE SHUTDOWN	
• PRESSURIZATION	
• EVACUATION	
• SMOKE PURGE	
• SMOKE CONTROL INSTALLATION	

GENERAL

This installation instruction contains basic unit installation information, installation of thermostats, and installation of remote temperature sensors. For additional information and service instructions, refer to the Controls, Start-Up, Operation, Service and Troubleshooting literature.

SAFETY CONSIDERATIONS

Installation and servicing of air-conditioning equipment can be hazardous due to system pressure and electrical components. Only trained and qualified service personnel should install, repair, or service air-conditioning equipment.

Untrained personnel can perform basic maintenance functions of cleaning coils and filters and replacing filters. All other operations should be performed by trained service personnel. When working on air-conditioning equipment, observe precautions in the literature, tags and labels attached to the unit, and other safety precautions that may apply.

Follow all safety codes, including ANSI (American National Standards Institute) Z223.1. Wear safety glasses and work gloves. Use quenching cloth for unbrazing operations. Have fire extinguisher available for all brazing operations.

It is important to recognize safety information. This is the safety-alert symbol . When you see this symbol on the unit and in instructions or manuals, be alert to the potential for personal injury.

Understand the signal words DANGER, WARNING, CAUTION, and NOTE. These words are used with the safety-alert symbol. DANGER identifies the most serious hazards which **will** result in severe personal injury or death. WARNING signifies hazards which **could** result in personal injury or death. CAUTION is used to identify unsafe practices, which **may** result in minor personal injury or product and property damage. NOTE is used to highlight suggestions which **will** result in enhanced installation, reliability, or operation.

⚠ WARNING

DO NOT USE TORCH to remove any component. System contains oil and refrigerant under pressure.

To remove a component, wear protective gloves and goggles and proceed as follows:

- a. Shut off electrical power to unit.
- b. Recover refrigerant to relieve all pressure from system using both high-pressure and low pressure ports.
- c. Traces of vapor should be displaced with nitrogen and the work area should be well ventilated. Refrigerant in contact with an open flame produces toxic gases.
- d. Cut component connection tubing with tubing cutter and remove component from unit. Use a pan to catch any oil that may come out of the lines and as a gage for how much oil to add to the system.
- e. Carefully un-sweat remaining tubing stubs when necessary. Oil can ignite when exposed to torch flame.

Failure to follow these procedures may result in personal injury or death.

⚠ WARNING

Before performing service or maintenance operations on unit, turn off main power switch to unit. Electrical shock could cause personal injury.

⚠ WARNING

If the information in this manual is not followed exactly, a fire or explosion may result causing property damage, personal injury or loss of life.

Do not store or use gasoline or other flammable vapors and liquids in the vicinity of this or any other appliance.

WHAT TO DO IF YOU SMELL GAS

- Do not try to light any appliance.
- Do not touch any electrical switch; do not use any phone in your building.
- Immediately call your gas supplier from a neighbor's phone. Follow the gas supplier's instructions.
- If you cannot reach your gas supplier, call the fire department.

Installation and service must be performed by a qualified installer, service agency or the gas supplier.

⚠ AVERTISSEMENT

RISQUE D'INCENDIE OU D'EXPLOSION

Si les consignes de sécurité ne sont pas suivies à la lettre, cela peut entraîner la mort, de graves blessures ou des dommages matériels.

Ne pas entreposer ni utiliser d'essence ni autres vapeurs ou liquides inflammables à proximité de cet appareil ou de tout autre appareil.

QUE FAIRE SI UNE ODEUR DE GAZ EST DÉTECTÉE

- Ne mettre en marche aucun appareil.
- Ne toucher aucun interrupteur électrique; ne pas utiliser de téléphone dans le bâtiment.
- Quitter le bâtiment immédiatement.
- Appeler immédiatement le fournisseur de gaz en utilisant le téléphone d'un voisin. Suivre les instructions du fournisseur de gaz.
- Si le fournisseur de gaz n'est pas accessible, appeler le service d'incendie.

L'installation et l'entretien doivent être effectués par un installateur ou une entreprise d'entretien qualifié, ou le fournisseur de gaz.

⚠ WARNING

Improper installation, adjustment, alteration, service, or maintenance can cause injury or property damage. Refer to this manual. For assistance or additional information, consult a qualified installer, service agency, or the gas supplier.

⚠ WARNING

FIRE, EXPLOSION HAZARD

Failure to follow this warning could result in death, serious personal injury and/or property damage.

Disconnect gas piping from unit when pressure testing at pressure greater than 0.5 psig (3450 Pa). Pressures greater than 0.5 psig will cause gas valve damage resulting in hazardous condition. If gas valve is subjected to pressure greater than 0.5 psig, it must be replaced before use. When pressure testing field-supplied gas piping at pressures of 0.5 psig or less, a unit connected to such piping must be isolated by closing the manual gas valve(s).

⚠ WARNING

CARBON-MONOXIDE POISONING HAZARD

Failure to follow instructions could result in severe personal injury or death due to carbon-monoxide poisoning, if combustion products infiltrate into the building.

Check that all openings in the outside wall around the vent (and air intake) pipe(s) are sealed to prevent infiltration of combustion products into the building.

Check that furnace vent (and air intake) terminal(s) are not obstructed in any way during all seasons.

⚠ AVERTISSEMENT

RISQUE D'INTOXICATION AU MONOXYDE DE CARBONE

Si ces directives ne sont pas suivies, cela peut entraîner des blessures graves ou une intoxication au monoxyde de carbone pouvant causer la mort, si des produits de combustion s'infiltrent dans le bâtiment.

Vérifier que toutes les ouvertures pratiquées dans le mur extérieur autour du ou des tuyaux d'évent (et de la prise d'air) sont scellées de manière à empêcher l'infiltration de produits de combustion dans le bâtiment.


Veiller à ce que la ou les sorties de l'évent de l'appareil de chauffage (et la prise d'air) ne soient, en aucune façon, obstruées, quelle que soit la saison.

⚠ WARNING

FIRE HAZARD

Failure to follow this warning could result in severe personal injury and/or property damage.

Inlet pressure tap set screw must be tightened and 1/8 in. NPT pipe plug must be installed to prevent gas leaks.

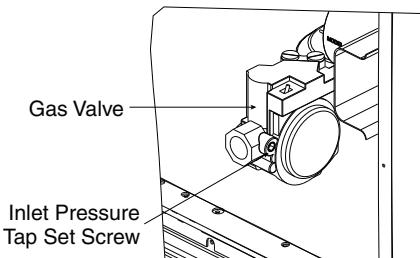


⚠ WARNING

FIRE HAZARD

Failure to follow this warning could result in severe personal injury and/or property damage.

Manifold pressure tap set screw must be tightened and 1/8 in. NPT pipe plug must be installed to prevent gas leaks.

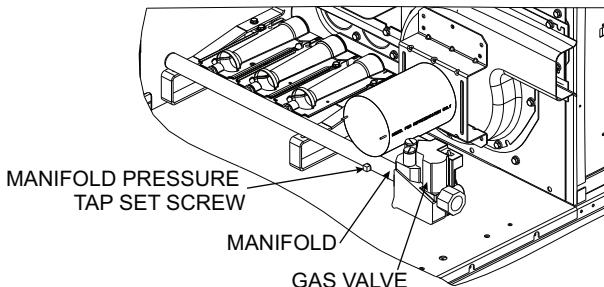

⚠ CAUTION

DO NOT re-use compressor oil or any oil that has been exposed to the atmosphere. Dispose of oil per local codes and regulations. DO NOT leave refrigerant system open to air any longer than the actual time required to service the equipment. Seal circuits being serviced and charge with dry nitrogen to prevent oil contamination when timely repairs cannot be completed. Failure to follow these procedures may result in damage to equipment.

ACOUSTICAL CONSIDERATIONS

In order to minimize sound transmitted to the space, please conform to the following recommendations (see Fig. 1):

Location

- Avoid locating the unit above sound-sensitive areas. Instead, locate the unit above restrooms, storage areas, corridors, or other noise-tolerant areas.
- Avoid mounting the unit in the middle of large roof expanses between vertical supports. This will minimize the phenomenon known as roof bounce.
- Install the units close to vertical roof supports (columns or load bearing walls).
- Locate the units at least 25 feet away from critical areas. If this is not possible, the ductwork and ceiling structure should be acoustically treated.
- Consider the use of vibration isolators or an acoustic curb.

Ductwork

- Utilize flexible connectors between the unit and the supply and return ducts.
- Supply and return air main trunk ducts should be located over hallways and/or public areas.
- Provide trailing edge turning vanes in ductwork elbows and tees to reduce air turbulence.
- Make the ductwork as stiff as possible.
- Use round duct wherever possible because it is less noisy.
- Seal all penetrations around ductwork entering the space.
- Make sure that ceiling and wall contractors do not attach hangers or supports to ductwork.
- Provide as smooth and gradual transition as possible when connecting the rooftop unit discharge to the supply duct.
- If a ceiling plenum return is utilized, provide a return elbow or tee to eliminate line-of-sight noise to the space. Face the entrance of the return duct away from other adjacent units.

Acoustic Insulation

- Provide acoustic interior lining for first 20 feet of supply and return duct or until the first elbow is encountered. The elbow prevents line-of-sight transmission in the supply and return ducts.
- Install a double layer of 2 in. low density quilted fiberglass acoustical pad with a 1/8 in. barium-loaded vinyl facing on top of the roof deck before building insulation and roofing installation occur. Place the material inside the curb and for 4 to 8 ft beyond the unit perimeter, dependent upon unit size (larger units require a wider apron outside the curb). Openings in the pad should only be large enough for the supply and return ducts. An alternate approach is to use two layers of gypsum board with staggered seams in addition to the acoustical pad.

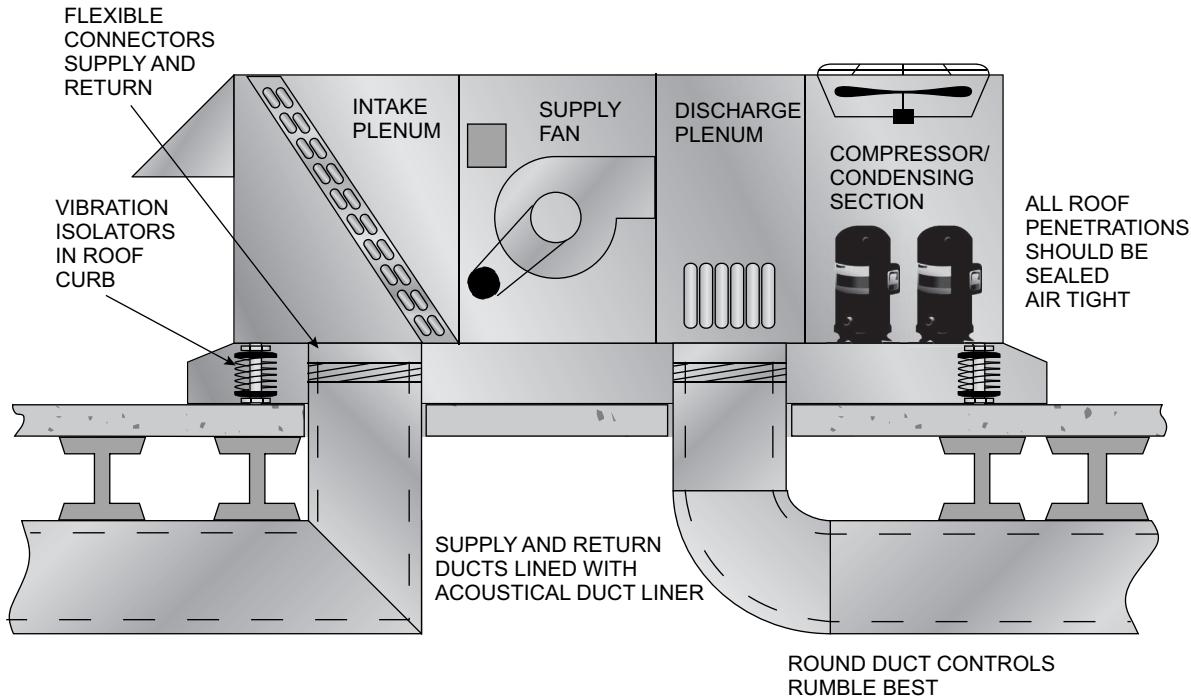


Fig. 1 — Acoustical Considerations

INSTALLATION

Step 1 — Perform Jobsite Survey

Complete the following checks before installation.

1. Consult local building codes and the NEC (National Electrical Code) (ANSI/NFPA [American National Standards Institute/National Fire Protection Association] 70) for special installation requirements.
2. Determine unit location (from project plans) or select unit location. Refer to Acoustical Considerations section.
3. Check for possible overhead obstructions which may interfere with unit lifting or rigging.

CAUTION

Do not lift unit with forklift truck. Move unit with overhead rigging only.

Step 2 — Place Unit

Inspect unit for transportation damage. If any damage is found, file a claim with the transportation agency.

Provide clearance around and above unit for airflow, safety, and service access. Do not restrict top (area above condenser fans) in any way. Allow at least 6 ft on all sides for rated performance, code compliance, and service. On units equipped with power exhaust (PE) option, high velocity air is exhausted out the hood. Unit should be positioned with at least 10 ft clearance between the exhaust hood and any obstruction. See Fig. 2 for multiple unit minimum separation. See Tables 1-6 for additional unit and fan data.

Check unit dimensional drawings on pages 23-25 for unit arrangement and minimum performance and service clearances.

Do not install unit in an indoor location. Do not locate air inlets near exhaust vents or other sources of contaminated air.

Although unit is weatherproof, guard against water from higher level runoff and overhangs.

Level by using unit frame as a reference.

Step 3 — Roof Mount Unit

Check building codes for weight distribution requirements. Refer to Acoustical Considerations section. Unit and accessory weights are shown in Tables 1 and 2. Unit may be mounted on class A, B, or C roofing material.

ROOF CURB

Assemble and install roof curb as described in instructions shipped with the accessory. Accessory roof curb and information required to field fabricate a roof curb is shown in Fig. 3 and 4. Install insulation, cant strips, roofing, and counter flashing as required. For unit condensate drain to function properly, curb must be level or within tolerances shown in Fig. 3.

NOTE: Units with double-wall floor design ("Double Wall on-the-bottom") are not compatible with roof curbs.

STEEL BEAMS

If roof curb is not used, support unit with steel beams along its entire length and then support steel as required. Cross members are required to support across its width at each lifting lug location; use more cross members for support as needed. See Fig. 4.

Step 4 — Slab Mount Unit

Provide a level concrete slab that extends beyond unit cabinet at least 6 inches. Use gravel apron in front of condenser coil air inlet to prevent grass and foliage from obstructing airflow. Provide a slab minimum 8 in. thick with sufficient height above grade to allow for condensate trap as described in Step 8.

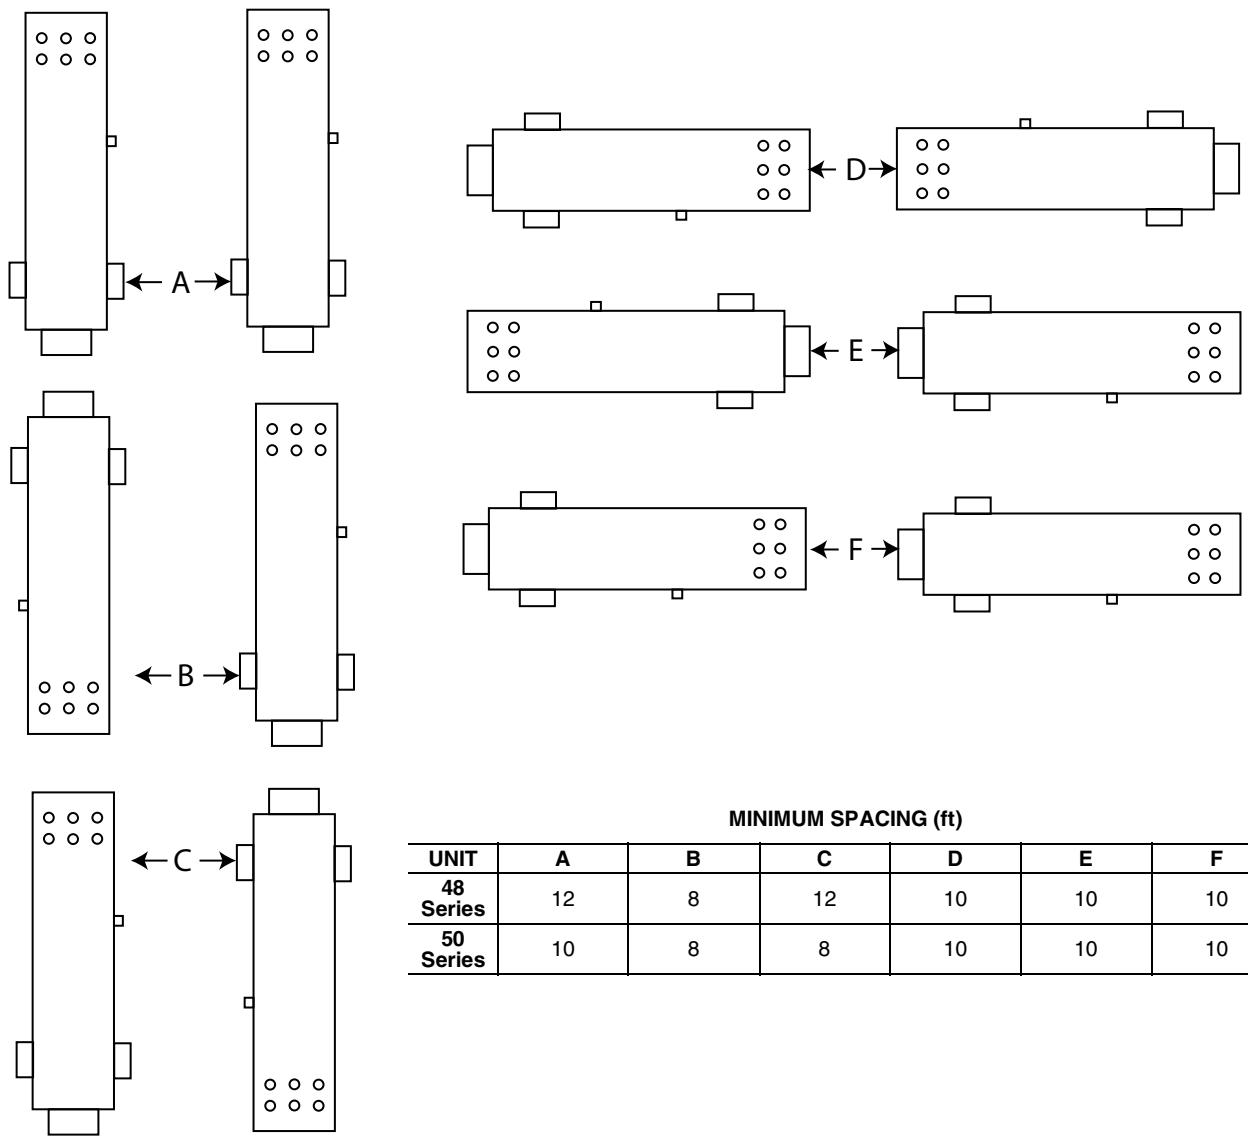


Fig. 2 — Multiple Unit Minimum Separation

Table 1 — Physical Data 48N — 75-150 Tons Nominal Capacity

BASE UNIT (Model Number - Pos.6) * †	N	P	Q	R	S	T
NOMINAL CAPACITY (tons)	75	90	105	120	130	150
WEIGHT (lb)						
Base Unit *	12,000	12,455	12,455	16,170	16,860	17,040
Split Unit - Main Section	9,110	9,565	9,565	12,880	13,570	13,750
Split Unit - Return Section	2,890	2,890	2,890	3,290	3,290	3,290
COMPRESSORS			Scroll			
Quantity	5	6	6	8	8	8
Oil Charge (oz) per Compressor	110	110	110	110	110	110
Compressor A1	ZP182	ZP154	ZP182	ZP182	ZP154	ZP182
Compressor A2	ZP182	ZP154	ZP182	ZP154	ZP182	ZP182
Compressor A3	0	ZP154	ZP182	ZP154	ZP182	ZP182
Compressor A4	0	0	0	ZP154	ZP182	ZP182
Compressor B1	ZP137	ZP182	ZP182	ZP182	ZP154	ZP182
Compressor B2	ZP137	ZP182	ZP182	ZP154	ZP182	ZP182
Compressor B3	ZP137	ZP182	ZP182	ZP154	ZP182	ZP182
Compressor B4	0	0	0	ZP154	ZP182	ZP182
Stages of Capacity, % Total Capacity	0,18,23,41,65, 82,100	0,11,15,33,49, 67,82,100	0,13,17,33,50, 67,83,100	0,11,14,28,40, 52,64,76,88,100	0,8,11,22,35, 48,61,74,87,100	0,9,13,25,38, 50,63,75,88,90
Number of Refrigerant Circuits	2	2	2	2	2	2
REFRIGERANT						
Type				R-410A		
Charge Amount				See Table 6		
METERING DEVICE						
Type... Quantity per Circuit				Electronically controlled expansion devices... two (2) per circuit		
STANDARD EFFICIENCY UNIT CONDENSER				MCHX		
Material	Aluminum	Aluminum	Aluminum	Aluminum	Aluminum	Aluminum
Number of Total Coils	4	4	4	4	6	6
Total Face Area (sq ft)	138.7	173.3	173.3	173.3	173.3	260.0
HIGH EFFICIENCY UNIT CONDENSER				MCHX		
Material	Aluminum	Aluminum	Aluminum	Aluminum	Aluminum	
Number of Total Coils	4	6	6	6	6	NA
Total Face Area (sq ft)	138.7	173.3	260.0	260.0	260.0	
EVAP-STANDARD CAPACITY with STD EFF				RTPF		
Material	CU-AL	CU-AL	CU-AL	CU-AL	CU-AL	CU-AL
Quantity	2	2	2	2	2	2
Tube Type	Cross Hatched	Cross Hatched	Cross Hatched	Cross Hatched	Cross Hatched	Cross Hatched
Rows (each)	4	4	6	4	6	6
FPI	16	16	16	16	16	16
Total Face Area (sq ft)	78.8	78.8	78.8	99.6	99.6	99.6
EVAP-STANDARD CAPACITY with HIGH EFF				RTPF		
Material	CU-AL	CU-AL	CU-AL	CU-AL	CU-AL	
Quantity	2	2	2	2	2	NA
Tube Type	Cross Hatched	Cross Hatched	Cross Hatched	Cross Hatched	Cross Hatched	
Rows (each)	4	4	6	4	6	
FPI	16	16	16	16	16	
Total Face Area (sq ft)	78.8	78.8	78.8	99.6	99.6	
EVAP-HIGH CAPACITY with STD EFFICIENCY				RTPF		
Material	CU-AL	CU-AL	CU-AL	CU-AL	CU-AL	CU-AL
Quantity	2	2	2	2	2	2
Tube Type	Cross Hatched	Cross Hatched	Cross Hatched	Cross Hatched	Cross Hatched	Cross Hatched
Rows (each)	6	6	8	6	8	8
FPI	16	16	16	16	16	16
Total Face Area (sq ft)	78.8	78.8	78.8	99.6	99.6	99.6
EVAP-HIGH CAPACITY with HIGH EFFICIENCY				RTPF		
Material	CU-AL	CU-AL	CU-AL	CU-AL	CU-AL	
Quantity	2	2	2	2	2	NA
Tube Type	Cross Hatched	Cross Hatched	Cross Hatched	Cross Hatched	Cross Hatched	
Rows (each)	6	6	8	6	8	
FPI	16	16	16	16	16	
Total Face Area (sq ft)	78.8	78.8	78.8	99.6	99.6	

LEGEND

Cu-Al	Copper-to-Aluminum
DWDI	Double Width Double Inlet
EFF	Efficiency
FPI	Fins per Inch
MBtuh	Btuh in Thousands
MCHX	Microchannel Heat Exchanger
RTPF	Round Tube Plate Fin
SWSI	Single Width Single Inlet

* Base unit includes: economizer, dampers and hoods, filter tracks less filters, evaporator coil mounting less the evaporator, extended plenum, and standard efficiency condenser. For 75-105 nominal ton units only, base unit weight also includes the short supply fan section.

†	48	N2	D	N	6	0	Option Code
	48 - Cooling Unit with Gas Heat						Factory Options
							Design Revision Level
							Voltage Options
							1 - 575-3-60 6 - 460-3-60
							Unit Size - Nominal Tons
							N - 75 Q - 105 S - 130
							P - 90 R - 120 T - 150

Table 1 — Physical Data 48N — 75-150 Tons Nominal Capacity (cont)

BASE UNIT (Model Number - Pos. 6) *†	N	P	Q	R	S	T
NOMINAL CAPACITY (tons)	75	90	105	120	130	150
CONDENSER FAN, STANDARD EFFICIENCY						
Number of Fans	4	6	6	6	9	9
Type	Prop/Metal	Prop/Metal	Prop/Plastic	Prop/Plastic	Prop/Metal	Prop/Plastic
Diameter (in.)	30.5	30	30.5	30.5	30	30.5
Motor Hp	1	1	1	1	1	1
Nominal Cfm	41,000	81,000	81,000	81,000	93,000	122,400
Motor Rpm	1140	1140	1140	1140	1140	1140
CONDENSER FAN, HIGH EFFICIENCY						
Number of Fans	6	9	9	9	9	
Type	Prop/Metal	Prop/Plastic	Prop/Plastic	Prop/Plastic	Prop/Plastic	
Diameter (in.)	30.5	30.5	30.5	30.5	30.5	
Motor Hp	1	1	1	1	1	
Nominal Cfm	61,000	93,000	93,000	93,000	93,000	
Motor Rpm	1140	1140	1140	1140	1140	
HUMIDI-MIZER® COIL						
Type				MCHX		
Material				Aluminum		
Quantity				1		
Surface				E-Coated		
Total Face Area (sq ft)	34.5	43	43	43	43	43
STANDARD AND HIGH CAPACITY HOT WATER COILS						
Type				RTPF		
Material				Aluminum Fin, Copper Tube		
Quantity				2		
Tube Type				Smooth		
Rows (each)				2		
FPI				12		
Total Face Area (sq ft)		22.4			26.4	
STANDARD AND HIGH CAPACITY STEAM COIL						
Type				RTPF		
Material				Aluminum Fin, Copper Tube, Steel Header, Sloped Casing		
Quantity				2		
Tube Type				Smooth		
Connection Size, Length (in.)			40.1	2.50, 3.00		
Total Face Area (sq ft)					49.0	
HEATING SECTION LOW (48N ONLY)						
Heating Section	2	2	2	3	3	3
Number of Heat Exchangers	18	18	18	27	27	27
Output (MBtuh)	648	648	648	972	972	972
Temperature Rise Range (F)	10-40	10-40	10-40	15-45	15-45	15-45
Efficiency (%)	81	81	81	81	81	81
Burner Orifice Quantity, Diameter (in.), Drill No.	18, 0.1285, 30	18, 0.1285, 30	18, 0.1285, 30	27, 0.1285, 30	27, 0.1285, 30	27, 0.1285, 30
Manifold Pressure (in. wg)	3.1	3.1	3.1	3.1	3.1	3.1
Line Pressure (in. wg) (min...max)	5.8-11	5.8-11	5.8-11	6.2-11	6.2-11	6.2-11
Firing Stages (Standard)	2	2	2	2	2	2
Firing Stages (Modulating)	14-100%	14-100%	14-100%	9-100%	9-100%	9-100%
Number of Gas Valves	2	2	2	3	3	3
HEATING SECTION MED (48N ONLY)						
Heating Section		3	3	4	4	4
Number of Heat Exchangers		27	27	36	36	36
Input/Output (MBtuh)		972	972	1296	1296	1296
Temperature Rise Range (F)		20-50	20-50	20-50	20-50	20-50
Efficiency (%)		81	81	81	81	81
Burner Orifice Quantity, Diameter (in.), Drill No.		27, 0.1285, 30	27, 0.1285, 30	36, 0.1285, 30	36, 0.1285, 30	36, 0.1285, 30
Manifold Pressure (in. wg)		3.1	3.1	3.1	3.1	3.1
Line Pressure (in. wg) (min...max)		6.3-11	6.3-11	6.2-11	6.2-11	6.2-11
Firing Stages (Standard)		2	2	2	2	2
Firing Stages (Modulating)		9-100%	9-100%	7-100%	7-100%	7-100%
Number of Gas Valves		3	3	4	4	4
HEATING SECTION HIGH (48N ONLY)						
Heating Section	3	4	4	5	5	5
Number of Heat Exchangers	27	36	36	45	45	45
Input/Output (MBtuh)	972	1296	1296	1620	1620	1620
Temperature Rise Range (F)	20-50	25-65	25-65	25-55	25-55	25-55
Efficiency (%)	81	81	81	81	81	81
Burner Orifice Quantity, Diameter (in.), Drill No.	27, 0.1285, 30	36, 0.1285, 30	36, 0.1285, 30	45, 0.1285, 30	45, 0.1285, 30	45, 0.1285, 30
Manifold Pressure (in. wg)	3.1	3.1	3.1	3.1	3.1	3.1
Line Pressure (in. wg) (min...max)	6.3-11	6.3-11	6.3-11	6.2-11	6.2-11	6.2-11
Firing Stages (Standard)	2	2	2	2	2	2
Firing Stages (Modulating)	9-100%	7-100%	7-100%	5-100%	5-100%	5-100%
Number of Gas Valves	3	4	4	5	5	5

LEGEND

Cu-Al	Copper-to-Aluminum
DWDI	Double Width Double Inlet
EFF	Efficiency
FPI	Fins per Inch
MBtuh	Btuh in Thousands
MCHX	Microchannel Heat Exchanger
RTPF	Round Tube Plate Fin
SWSI	Single Width Single Inlet

* Base unit includes: economizer dampers and hoods, filter tracks less filters, evaporator coil mounting less the evaporator, extended plenum, and standard efficiency condenser. For 75-105 nominal ton units only, base unit weight also includes the short supply fan section.

†	48	N2	D	N	6	0	Option Code
	48	N2	D	N	6	0	Factory Options
	48	N2	D	N	6	0	Design Revision Level
							Voltage Options
							1 — 575-3-60 6 — 460-3-60
							Unit Size — Nominal Tons
							N — 75 Q — 105 S — 130
							P — 90 R — 120 T — 150

Table 1 — Physical Data 48N — 75-150 Tons Nominal Capacity (cont)

BASE UNIT (Model Number - Pos. 6) *†	N	P	Q	R	S	T
NOMINAL CAPACITY (tons)	75	90	105	120	130	150
SUPPLY FAN						
Standard Supply Fan						
Diameter (in.)	28				32	
Wheel and Blade Type	DWDI Airfoil				DWDI Airfoil	
Maximum Allowable Cfm	42,000				60,000	
Maximum Allowable Speed (rpm)	1,800				1,550	
Shaft Diameter at Pulley (in.)	2.25				2.5	
High Static Supply Fan						
Diameter (in.)	40				40	
Wheel and Blade Type	DWDI Airfoil				DWDI Airfoil	
Maximum Allowable Cfm	52,500				60,000	
Maximum Allowable Speed (rpm)	1,250				1,250	
Shaft Diameter at Pulley (in.)	3				3	
OPTIONAL POWER EXHAUST						
Power Exhaust						
Diameter (in.)	20				23	
Wheel and Blade Type					DWDI Forward Curve	
Maximum Allowable Cfm	42,000				60,000	
Maximum Allowable Speed (rpm)	1,200				1,200	
Shaft Diameter at Pulley (in.)	1.75				1.75	
High Static Power Exhaust						
Diameter (in.)	36				40	
Wheel and Blade Type	DWDI Forward Curve				DWDI Forward Curve	
Maximum Allowable Cfm	42,000				60,000	
Maximum Allowable Speed (rpm)	650				600	
Shaft Diameter at Pulley (in.)	2.5				3	
OPTIONAL RETURN FAN						
Return Fan						
Diameter (in.)	40				40	
Wheel and Blade Type					SWSI Plenum Airfoil	
Maximum Allowable Cfm	52,500				60,000	
Maximum Allowable Speed (rpm)	1236				1236	
Shaft Diameter at Pulley (in.)	2.5				2.5	
High Static Return Fan						
Diameter (in.)	45		50		56	
Wheel and Blade Type					SWSI Plenum Airfoil	
Maximum Allowable Cfm	60,000		60,000		60,000	
Maximum Allowable Speed (rpm)	850		780		720	
					3	
MIXED AIR FILTERS						
MERV 7 Pleated Filters						
Quantity	2 inch, MERV 7				2 inch, MERV 7	
Size (in.)	28				28	
Size (in.)	20x24x2				20x25x2	
MERV 8 Pleated Filters						
Quantity	4 inch, MERV 8				4 inch, MERV 8	
Size (in.)	28				28	
Size (in.)	20x24x4				20x25x4	
MERV 14 Pleated Filters						
Quantity	4 inch, MERV 14				4 inch, MERV 14	
Size (in.)	28				28	
Size (in.)	20x24x4				20x25x4	
MERV 14 Cartridge Filters, 2 or 4 in. in Pre-Filters						
Quantity	12 inch, MERV 14 Cartridge Filters				12 inch, MERV 14 Cartridge Filters	
Size (in.)	20				20	
Size (in.)	(15) 20x24x12, (5) 24x24x12				24x24x12	
MERV 14 Bag, 2 or 4 in. in Pre-Filters						
Quantity	12 inch, MERV 14 Bag Filters				12 inch, MERV 14 Bag Filters	
Size (in.)	20				20	
Size (in.)	(15) 20x24x12, (5) 24x24x12				24x24x12	
MERV 15 Bag, 2 or 4 in. in Pre-Filters						
Quantity	19 inch, MERV 15 Bag Filters				19 inch, MERV 15 Bag Filters	
Size (in.)	20				20	
Size (in.)	(15) 20x24x19, (5) 24x24x19				24x24x19	
FINAL FILTERS						
MERV 14 Cartridge Filters, 2 or 4 in. in Pre-Filters						
Quantity	12 inch, MERV 14 Cartridge Filters				12 inch, MERV 14 Cartridge Filters	
Size (in.)	19				19	
Size (in.)	(14) 20x24x12, (5) 24x24x12				24x24x12	
MERV 15 Bag, 2 or 4 in. in Pre-Filters						
Quantity	19 inch, MERV 15 Bag Filters				19 inch, MERV 15 Bag Filters	
Size (in.)	19				19	
Size (in.)	(14) 20x24x19, (5) 24x24x19				24x24x19	
MERV 17 HEPA, 2 or 4 in. in Pre-Filters						
Quantity	12 inch, MERV 17 HEPA Filters, 99.99%				12 inch, MERV 17 HEPA Filters, 99.99%	
Size (in.)	19				19	
Size (in.)	(14) 24x12x12, (5) 24x24x12				24x24x12	

LEGEND

Cu-Al	— Copper-to-Aluminum
DWDI	— Double Width Double Inlet
EFF	— Efficiency
FPI	— Fins per Inch
MBtuh	— Btuh in Thousands
MCHX	— Microchannel Heat Exchanger
RTPF	— Round Tube Plate Fin
SWSI	— Single Width Single Inlet

* Base unit includes: economizer dampers and hoods, filter tracks less filters, evaporator coil mounting less the evaporator, extended plenum, and standard efficiency condenser. For 75-105 nominal ton units only, base unit weight also includes the short supply fan section.

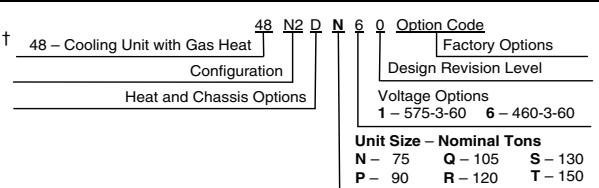


Table 1 — Physical Data 48N — 75-150 Tons Nominal Capacity (cont)

BASE UNIT (Model Number - Pos. 6) [†]	N	P	Q	R	S	T
NOMINAL CAPACITY (tons)	75	90	105	120	130	150
OUTSIDE AIR SCREENS						
Standard Hood (Motorized OA and Economizer Options)						
Quantity	12 Screens			16 Screens		
Size (in.)	16 7/8 x 31			16 7/8 x 31		
Outside Air Filters	Type (Standard) (Optional)	MERV 8		MERV 8		
		MERV 14		MERV 14		
	Size (in.).... Qty	16 x 20 x 2.....16		16 x 20 x 2.....16		
Accessory Exhaust Air Filters	Type	MERV 8		MERV 8		
		MERV 14		MERV 14		
	Size (in.).... Qty	24 x 24 x 4.....9		24 x 24 x 4.....9		
Outside Air Dampers	Qty	2		2		
	Size (in.)	35 x 70.8		35 x 83.25		
Optional Intake Bypass Dampers	Qty	2		2		
	Size (in.)	35 x 70.8		35 x 83.25		

LEGEND

Cu-Al	— Copper-to-Aluminum
DWDI	— Double Width Double Inlet
EFF	— Efficiency
FPI	— Fins per Inch
MBtuh	— Btuh in Thousands
MCHX	— Microchannel Heat Exchanger
RTPF	— Round Tube Plate Fin
SWSI	— Single Width Single Inlet

* Base unit includes: economizer dampers and hoods, filter tracks less filters, evaporator coil mounting less the evaporator, extended plenum, and standard efficiency condenser. For 75-105 nominal ton units only, base unit weight also includes the short supply fan section.

† 48 – Cooling Unit with Gas Heat Configuration	48	N2	D	N	6	0	Option Code
							Factory Options
							Design Revision Level
Heat and Chassis Options							
Voltage Options							
1 – 575-3-60				6 – 460-3-60			
Unit Size – Nominal Tons							
N – 75		Q – 105		S – 130			
P – 90		R – 120		T – 150			

Table 2 — Operating Weights of Options and Accessories (lb)

OPTION OR ACCESSORY	48N UNIT SIZE (TON NOMINAL CAPACITY) (for MODEL NUMBER Pos. 6)*					
	N (75)	P (90)	Q (105)	R (120)	S (130)	T (150)
Economizer	140	140	140	140	140	140
Filters						
2 in. MERV 7	90	90	90	100	100	100
4 in. MERV 8	150	150	150	175	175	175
4 in. MERV 14	175	175	175	210	210	210
12 in. MERV 14 Bag with 2 in. Pre-Filter	200	200	200	225	225	225
12 in. MERV 14 Bag with 4 in. Pre-Filter	260	260	260	300	300	300
19 in. MERV 15 Bag with 2 in. Pre-Filter	300	300	300	335	335	335
19 in. MERV 15 Bag with 4 in. Pre-Filter	320	320	320	350	350	350
12 in. MERV 14 Cartridge with 2 in. Pre-Filter	350	350	350	375	375	375
12 in. MERV 14 Cartridge with 4 in. Pre-Filter	370	370	370	400	400	400
Field Use Filter Section	635	635	635	665	665	665
Evaporator						
Standard Capacity	625	625	832	795	1053	1053
High Capacity	832	832	1110	1053	1402	1402
High-Efficiency Condenser	310	691	691	691	N/A	N/A
Extended Chassis	320	320	320	335	335	335
Humidi-MiZer® Dehumidification System	475	495	495	510	510	510
Gas Heat						
Low	937	937	937	1099	1099	1099
Medium	N/A	1067	1067	1229	1229	1229
High	1067	1197	1197	1469	1469	1469
Modulating	50	50	50	50	50	50
Blank Section						
4 ft	530	530	530	555	555	555
8 ft	1060	1060	1060	1110	1110	1110
Post Filters						
19 in. MERV 15 Bag with 2 in. Pre-Filter	830	830	830	890	890	890
19 in. MERV 15 Bag with 4 in. Pre-Filter	850	850	850	905	905	905
12 in. MERV 14 Cart with 2 in. Pre-Filter	880	880	880	930	930	930
12 in. MERV 14 Cart with 4 in. Pre-Filter	900	900	900	955	955	955
12 in. MERV 17 HEPA with 2 in. Pre-Filter	905	905	905	965	965	965
12 in. MERV 17 HEPA with 4 in. Pre-Filter	930	930	930	980	980	980
Supply Fan						
High-Static Supply Fan	1274	1274	1274	1169	1169	1169
Standard Supply Fan	965	965	965	1071	1071	1071
PE (Power Exhaust) Fan						
High-Static PE Fan	927	927	927	927	927	927
Standard PE Fan	619	727	727	727	727	727
Return Fan						
High-Static Return Fan	974	1086	1298	1298	1298	1298
Standard Return Fan	895	895	895	895	895	895
Supply/PE/Return Motor Includes VFD - 460 Volt ODP						
5 Hp	162	N/A	N/A	N/A	N/A	N/A
7.5 Hp	183	183	183	183	183	183
10 Hp	209	209	209	209	209	209
15 Hp	320	320	320	320	320	320
20 Hp	374	374	374	374	374	374
25 Hp	417	417	417	417	417	417
30 Hp	456	456	456	456	456	456
40 Hp	697	697	697	697	697	697
50 Hp	784	784	784	784	784	784
60 Hp	897	897	897	897	897	897
75 Hp	1275	1275	1275	1275	1275	1275
100 Hp	1488	1488	1488	1488	1488	1488

LEGEND

ODP	— Open Drip Proof
TEFC	— Totally Enclosed, Fan Cooled
VFD	— Variable Frequency Drive

NOTE: Please refer to E-CAT for selection.

Table 2 — Operating Weights of Options and Accessories (lb) (cont)

OPTION OR ACCESSORY	48N UNIT SIZE (TON NOMINAL CAPACITY) (for MODEL NUMBER Pos. 6)*					
	N (75)	P (90)	Q (105)	R (120)	S (130)	T (150)
Supply/PE/Return Motor Includes VFD - 460 Volt TEFC						
5 Hp	227	N/A	N/A	N/A	N/A	N/A
7.5 Hp	267	267	267	267	267	267
10 Hp	283	283	283	283	283	283
15 Hp	368	368	368	368	368	368
20 Hp	437	437	437	437	437	437
25 Hp	576	576	576	576	576	576
30 Hp	604	604	604	604	604	604
40 Hp	991	991	991	991	991	991
50 Hp	925	925	925	925	925	925
60 Hp	1163	1163	1163	1163	1163	1163
75 Hp	1275	1275	1275	1275	1275	1275
100 Hp	1488	1488	1488	1488	1488	1488
Supply/PE/Return Motor Includes VFD - 575 Volt ODP						
5 Hp	157	N/A	N/A	N/A	N/A	N/A
7.5 Hp	186	186	186	186	186	186
10 Hp	204	204	204	204	204	204
15 Hp	327	327	327	327	327	327
20 Hp	369	369	369	369	369	369
25 Hp	433	433	433	433	433	433
30 Hp	456	456	456	456	456	456
40 Hp	697	697	697	697	697	697
50 Hp	784	784	784	784	784	784
60 Hp	897	897	897	897	897	897
75 Hp	1194	1194	1194	1194	1194	1194
100 Hp	1488	1488	1488	1488	1488	1488
Supply/PE/Return Motor Includes VFD - 575 Volt TEFC						
5 Hp	195	N/A	N/A	N/A	N/A	N/A
7.5 Hp	228	228	228	228	228	228
10 Hp	277	277	277	277	277	277
15 Hp	382	382	382	382	382	382
20 Hp	436	436	436	436	436	436
25 Hp	616	616	616	616	616	616
30 Hp	652	652	652	652	652	652
40 Hp	795	795	795	795	795	795
50 Hp	897	897	897	897	897	897
60 Hp	933	933	933	933	933	933
75 Hp	1194	1194	1194	1194	1194	1194
100 Hp	1488	1488	1488	1488	1488	1488
Supply/PE/Return Motor Includes VFD Bypass						
5 Hp	10	N/A	N/A	N/A	N/A	N/A
7.5 Hp	10	10	10	10	10	10
10 Hp	10	10	10	10	10	10
15 Hp	10	10	10	10	10	10
20 Hp	20	20	20	20	20	20
25 Hp	20	20	20	20	20	20
30 Hp	40	40	40	40	40	40
40 Hp	40	40	40	40	40	40
50 Hp	40	40	40	40	40	40
60 Hp	40	40	40	40	40	40
75 Hp	60	60	60	60	60	60
100 Hp	75	75	75	75	75	75
Condenser Grilles						
Standard Efficiency	100	100	100	100	125	125
High Efficiency	100	125	125	125	125	NA
Condenser Louvers						
Standard Efficiency	225	225	225	225	290	290
High Efficiency	225	290	290	290	290	NA
Service Valves and Replaceable Core Filter Drier	40	45	45	50	50	50
Low Ambient	50	50	50	50	50	50
UV Lights	100	100	100	130	130	130
Marine Lights	75	75	75	75	75	75
Split - 2 Piece Unit	268	268	268	280	280	280
Evaporator Condenser						
Standard Efficiency	635	635	635	685	865	865
High Efficiency	635	805	805	865	865	NA

LEGEND

ODP — Open Drip Proof
TEFC — Totally Enclosed, Fan Cooled
VFD — Variable Frequency Drive

NOTE: Please refer to E-CAT for selection.

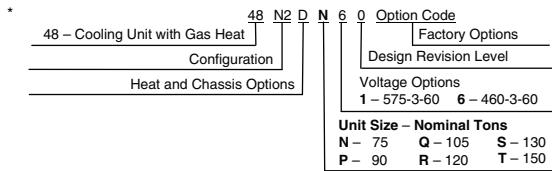


Table 3 — Supply Fan and Drive Data

FAN	MOTOR HP	MOTOR RPM	MOTOR SHAFT SIZE (in.)	FAN RPM	FAN SHAFT SIZE (in.)	DRIVE SHEAVE BROWNING	BUSHING TYPE	DRIVEN SHEAVE BROWNING	BUSHING TYPE	BELTS	QTY OF BELTS	FAN SPEED (rpm)
Standard Fan 75-105 Tons Nominal Capacity	50	1770	2.125	1800	2.25	4B5V70	B 2 1/8	4B5V68	B 2 1/4	5VX530	4	1821/1821
	40	1770	2.125	1600		3B5V68	B 2 1/8	3B5V74	B 2 1/4	5VX540	3	1628/1628
	30	1765	1.875	1450		3B5V70	B 1 7/8	3B5V86	B 2 1/4	BX55	3	1448/1448
	25	1765	1.875	1400		3B5V64	B 1 7/8	3B5V80	B 2 1/4	BX53	3	1425/1425
	20	1765	1.625	1250		3B5V56	B 1 5/8	3B5V80	B 2 1/4	BX53	3	1255/1255
Standard Fan 120-150 Tons Nominal Capacity	60	1775	2.375	1550	2.5	4B5V70	B 2 3/8	4R5V80	R1 2 1/2	5VX600	4	1595/1595
	50	1770	2.125	1400		4B5V70	B 2 1/8	4R5V90	R1 2 1/2	5VX630	4	1412/1412
	40	1770	2.125	1300		3B5V68	B 2 1/8	3R5V92	R1 2 1/2	5VX630	3	1328/1328
	30	1765	1.875	1200		3B5V70	B 1 7/8	3R5V103	R1 2 1/2	5VX670	3	1229/1229
	25	1765	1.875	1100		3B5V64	B 1 7/8	3R5V103	R1 2 1/2	5VX660	3	1125/1125
High Static 75-150 Tons Nominal Capacity	100	1775	2.875	1250	3	5R5V90	R1 2 7/8	5B5V124	R1 3	5VX830	5	1264/1264
	75	1775	2.375	1100		4B5V80	B 2 3/8	4R5V132	R1 3	5VX840	4	1098/1098
	60	1775	2.375	1050		4B5V70	B 2 3/8	4R5V118	R1 3	5VX800	4	1077/1077
	50	1770	2.125	1000		4B5V70	B 2 1/8	4R5V125	R1 3	5VX830	4	1013/1013
	40	1770	2.125	900		3B5V68	B 2 1/8	3R5V140	R1 3	5VX850	3	918/918
	30	1765	1.875	800		3B5V70	B 1 7/8	3B154R	R1 3	BX88	3	821/821
	25	1765	1.875	750		3B5V64	B 1 7/8	3B154R	R1 3	BX87	3	753/753

NOTE: Supply fan shaft bearings are pre-lubricated by the bearing manufacturer, or again at the time of production. Check for a small bead around the bearing seal and relubricate as necessary.

Table 4 — Power Exhaust Fan and Drive Data

FAN	MOTOR HP	MOTOR RPM	MOTOR SHAFT SIZE (in.)	FAN RPM	FAN SHAFT SIZE (in.)	DRIVE SHEAVE BROWNING	BUSHING TYPE	DRIVEN SHEAVE BROWNING	BUSHING TYPE	BELTS	QTY OF BELTS	FAN SPEED (rpm)
Standard Fan 75 Tons Nominal Capacity	30	1765	1.875	1200	1.75	3B5V70	B 1 7/8	3R5V103	R1 1 3/4	5VX570	3	1229/1229
	25	1765	1.875	1150		3B5V64	B 1 7/8	3R5V103	R1 1 3/4	5VX560	3	1125/1125
	20	1765	1.625	1125		3B5V56	B 1 5/8	3B5V90	B 1 3/4	BX52	3	1120/1120
	15	1770	1.625	1100		2B5V64	B 1 5/8	2Q5V103	Q1 1 3/4	5VX580	2	1128/1128
	10	1755	1.375	1100		2BK52H	H 1 3/8	2B5V74	B 1 3/4	BX51	2	1117/1117
	7.5	1760	1.375	1100		2BK52H	H 1 3/8	2B5V74	B 1 3/4	BX51	2	1120/1120
Standard Fan 90-150 Tons Nominal Capacity	50	1770	2.125	1200	1.75	4B5V70	B 2 1/8	4R5V103	R1 1 3/4	5VX540	4	1225/1225
	40	1770	2.125	1175		3B5V68	B 2 1/8	3R5V103	R1 1 3/4	5VX540	3	1197/1197
	30	1765	1.875	1150		3B5V70	B 1 7/8	3B5V110	B 1 3/4	5VX580	3	1129/1129
	25	1765	1.875	1125		3B5V64	B 1 7/8	3R5V103	R1 1 3/4	5VX550	3	1125/1125
	20	1765	1.625	1100		3B5V56	B 1 5/8	3B5V90	B 1 3/4	BX52	3	1120/1120
	15	1770	1.625	1050		2B5V64	B 1 5/8	2B5V110	B 1 3/4	5VX590	2	1036/1036
	10	1755	1.375	1000		2BK52H	H 1 3/8	2B5V80	B 1 3/4	BX51	2	1036/1036
High Static 75-090 Tons Nominal Capacity	7.5	1760	1.375	950	2.5	2BK52H	H 1 3/8	2B5V90	B 1 3/4	BX53	2	927/927
	40	1770	2.125	650		3B5V68	B 2 1/8	35V1870E	E 2 1/2	5VX830	3	657/657
	30	1765	1.875	625		3B5V70	B 1 7/8	3TB200	Q1 2 1/2	BX86	3	635/635
	25	1765	1.875	600		3B5V64	B 1 7/8	3TB200	Q1 2 1/2	BX85	3	583/583
	20	1765	1.625	550		3B5V56	B 1 5/8	3TB184	Q1 2 1/2	BX82	3	557/557
	15	1770	1.625	500		2B5V64	B 1 5/8	25V2360E	E 2 1/2	5VX950	2	490/490
	10	1755	1.375	450		2BK52H	H 1 3/8	2TB184	Q1 2 1/2	BX82	2	460/460
High Static 105-150 Tons Nominal Capacity	7.5	1760	1.375	425	3	2BK52H	H 1 3/8	2TB184	Q1 2 1/2	AX81	2	425/425
	60	1775	2.375	600		4B5V70	B 2 3/8	4R5V212	R1 3	5VX930	4	597/597
	50	1770	2.125	575		4B5V70	B 2 1/8	4R5V212	R1 3	5VX950	4	596/596
	40	1770	2.125	550		3B5V68	B 2 1/8	3R5V212	R1 3	5VX930	3	579/579
	30	1765	1.875	525		3B5V70	B 1 7/8	3B250R	R1 3	BX103	3	509/509
	25	1765	1.875	500		3B5V64	B 1 7/8	35V2360E	E 3	5VX1000	3	488/488
	20	1765	1.625	450		3B5V56	B 1 5/8	35V2360E	E 3	5VX1000	3	428/428
	15	1770	1.625	400		2B5V64	B 1 5/8	2B300R	R1 3	BX112	2	391/391

NOTE: Fan shaft bearings are pre-lubricated by the bearing manufacturer, or again at the time of production. Check for a small bead around the bearing seal and relubricate as necessary.

Table 5 — Return Fan Drive Data

FAN	MOTOR HP	MOTOR RPM	MOTOR SHAFT SIZE (in.)	FAN RPM	FAN SHAFT SIZE (in.)	DRIVE SHEAVE BROWNING	BUSHING TYPE	DRIVEN SHEAVE BROWNING	BUSHING TYPE	BELTS	QTY OF BELTS	FAN SPEED (rpm)
STANDARD RETURN FAN ALL SIZES	50	1770	2.125	1236	2.5	4B5V70	B 2 1/8	4R5V103	R1 2 1/2	5VX1000	4	1232/1232
	40	1770	2.125	1149		3B5V68	B 2 1/8	3R5V109	R1 2 1/2	5VX1000	3	1131/1131
	30	1765	1.875	1025		3B5V70	B 1 7/8	3TB124	Q1 2 1/2	BX98	3	1015/1015
	25	1765	1.875	940		3B5V64	B 1 7/8	3TB124	Q1 2 1/2	BX98	3	931/931
	20	1765	1.625	930		3B5V56	B 1 5/8	3TB110	Q1 2 1/2	BX93	3	922/922
	15	1770	1.625	890		2B5V64	B 1 5/8	2Q5V132	Q1 2 1/2	5VX1000	2	878/878
	10	1755	1.375	770		2BK52H	H 1 3/8	2TB110	Q1 2 1/2	BX90	2	761/761
	7.5	1760	1.375	720		2BK52H	H 1 3/8	2TB110	Q1 2 1/2	AX89	2	717/717
	30	1765	1.875	850		3B5V70	B 1 7/8	3R5V150	R1 3	5VX1120	3	841/841
HIGH STATIC RETURN FAN 75 TONS NOMINAL CAPACITY	25	1765	1.875	825	3	3B5V64	B 1 7/8	3R5V140	R1 3	5VX1120	3	825/825
	15	1770	1.625	680		2B5V64	B 1 5/8	2B160R	R1 3	BX112	2	728/728
	10	1755	1.375	600		2BK52H	H 1 3/8	2B154R	R1 3	BX105	2	548/548
	7.5	1760	1.375	550		2BK52H	H 1 3/8	2B154R	R1 3	BX105	2	549/549
	40	1770	2.125	780		3B5V68	B 2 1/8	3R5V160	R1 3	5VX1230	3	768/768
HIGH STATIC RETURN FAN 90 TONS NOMINAL CAPACITY	30	1765	1.875	750	3	3B5V70	B 1 7/8	3B160R	R1 3	BX120	3	790/790
	25	1765	1.875	720		3B5V64	B 1 7/8	3B160R	R1 3	BX120	3	725/725
	20	1765	1.625	650		3B5V56	B 1 5/8	3B154R	R1 3	BX113	3	663/663
	15	1770	1.625	600		2B5V64	B 1 5/8	2B200R	R1 3	BX123	2	584/584
	10	1755	1.375	520		2BK52H	H 1 3/8	2B160R	R1 3	BX112	2	528/528
	7.5	1760	1.375	480		2BK52H	H 1 3/8	2B184R	R1 3	BX116	2	461/461
	60	1775	2.375	720		4B5V70	B 2 3/8	4B174R	R1 3	BX133	4	693/693
HIGH STATIC RETURN FAN 105-150 TONS NOMINAL CAPACITY	50	1770	2.125	680	3	4B5V70	B 2 1/8	45V1870E	E 3	5VX1320	4	676/676
	40	1770	2.125	650		3B5V68	B 2 1/8	35V1870E	E 3	5VX1320	3	657/657
	30	1765	1.875	580		3B5V70	B 1 7/8	3R5V212	R1 3	5VX1400	3	594/594
	25	1765	1.875	550		3B5V64	B 1 7/8	3B200R	R1 3	AX128	3	555/555
	20	1765	1.625	500		3B5V56	B 1 5/8	3B200R	R1 3	BX128	3	513/513
	15	1770	1.625	450		2B5V64	B 1 5/8	2B250R	R1 3	AX136	2	444/444
	10	1755	1.375	400		2BK52H	H 1 3/8	2B200R	R1 3	AX128	2	392/392

NOTE: Fan shaft bearings are pre-lubricated by the bearing manufacturer, or again at the time of production. Check for a small bead around the bearing seal and relubricate as necessary.

NOTES:
 1. ROOF CURB ACCESSORY CRRFCUBB201A00-285A00 ARE SHIPPED DISASSEMBLED.
 2. ROOF CURB: 14 GA. [VA03-56] STL.
 3. DIMENSIONS ARE SHOWN IN INCHES. DIMENSIONS IN [] ARE IN MILLIMETERS.
 4. CROSS SUPPORTS EQUALLY SPACED APPROX 5'-6' APART

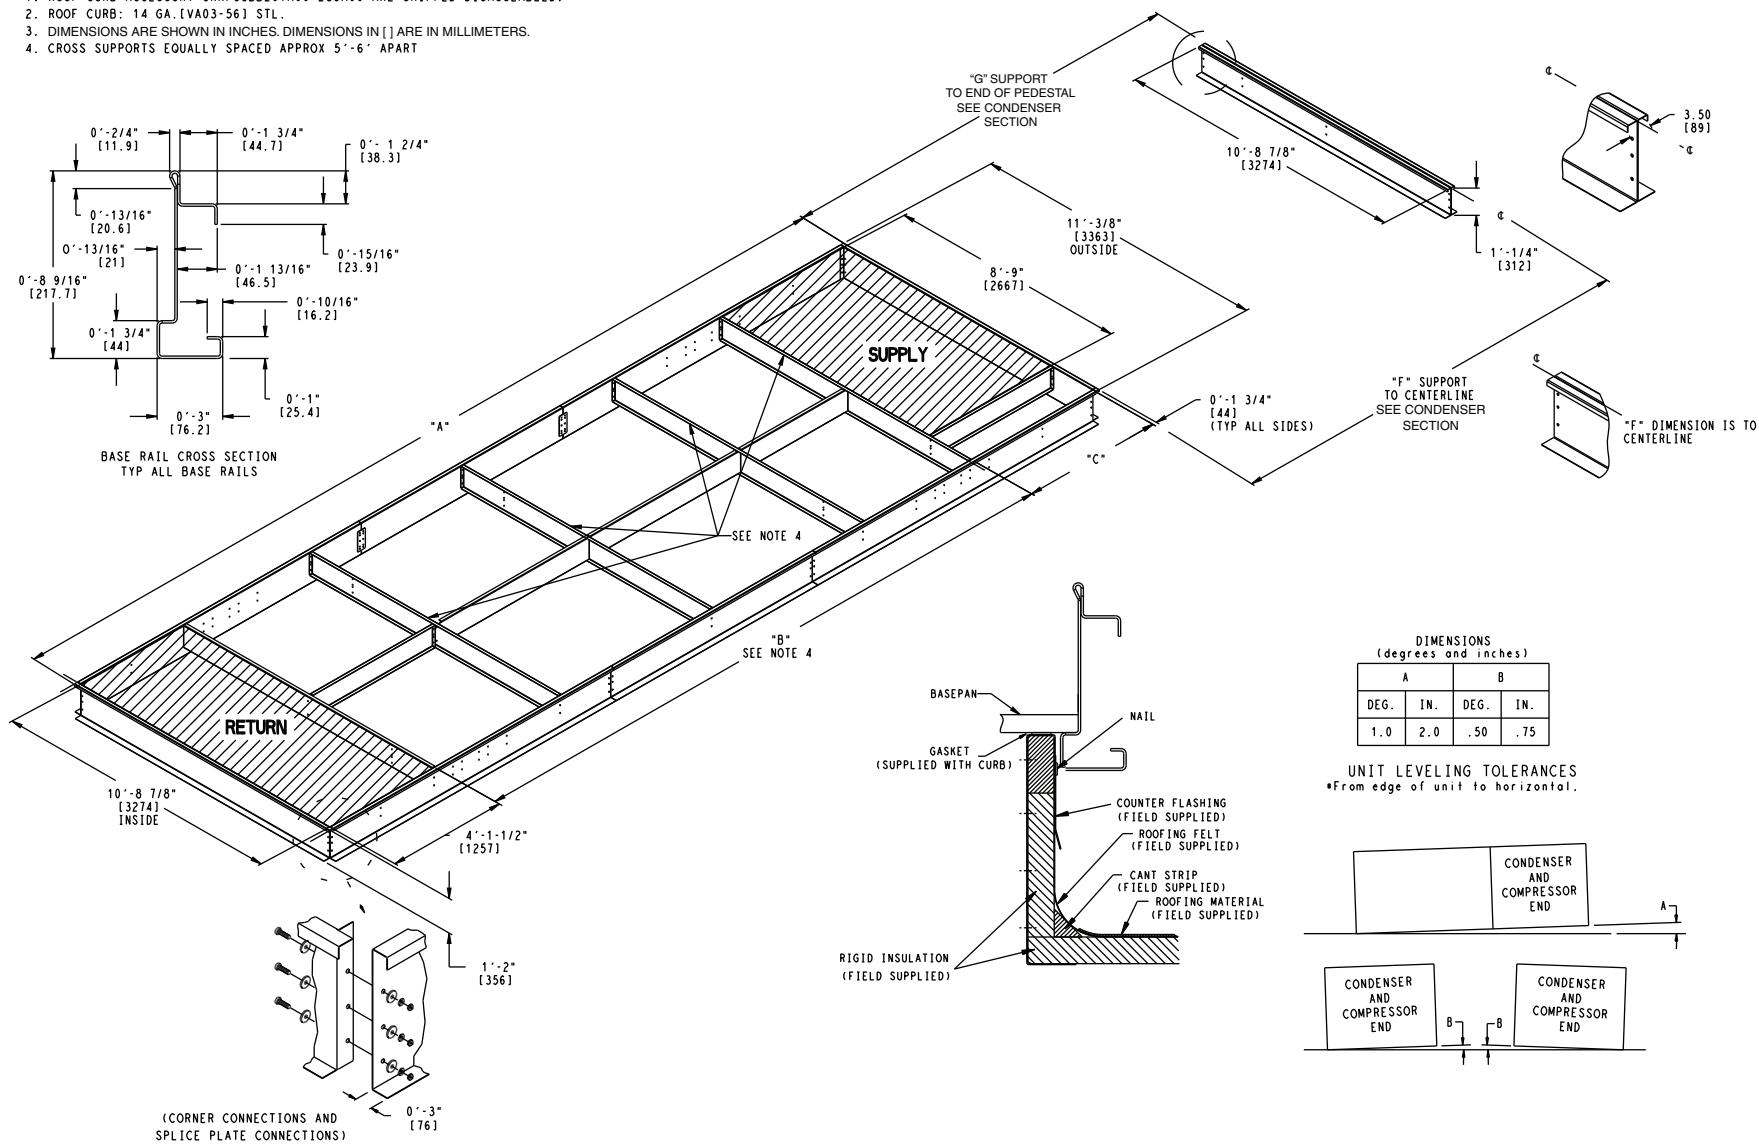


Fig. 3 — Roof Curb Units

**48N Roof Curb Sizes N, P, Q
(75-105 Ton Nominal Capacity)**

PART NUMBER*	DIMENSION A (in.)	DIMENSION B (in.)	DIMENSION C (in.)
CRRFCURB225A00	361.11	258.61	49.50
CRRFCURB226A00	376.20	273.70	49.50
CRRFCURB227A00	385.11	282.61	49.50
CRRFCURB228A00	400.20	297.70	49.50
CRRFCURB229A00	427.61	325.11	49.50
CRRFCURB230A00	439.86	337.36	49.50
CRRFCURB231A00	442.70	340.20	49.50
CRRFCURB232A00	451.61	349.11	49.50
CRRFCURB233A00	454.95	352.45	49.50
CRRFCURB234A00	463.86	361.36	49.50
CRRFCURB235A00	466.70	364.20	49.50
CRRFCURB236A00	475.86	373.36	49.50
CRRFCURB237A00	478.95	376.45	49.50
CRRFCURB238A00	488.11	385.61	49.50
CRRFCURB239A00	490.95	388.45	49.50
CRRFCURB240A00	499.86	397.36	49.50
CRRFCURB241A00	503.20	400.70	49.50
CRRFCURB242A00	512.11	409.61	49.50
CRRFCURB243A00	514.95	412.45	49.50
CRRFCURB244A00	527.20	424.70	49.50
CRRFCURB245A00	536.36	433.86	49.50
CRRFCURB246A00	551.45	448.95	49.50
CRRFCURB247A00	560.36	457.86	49.50
CRRFCURB248A00	575.45	472.95	49.50

* Use Applied Rooftop Builder program to select the proper roof curb.


**48N Roof Curb Sizes R, S, T
(120-150 Ton Nominal Capacity)**

PART NUMBER*	DIMENSION A (in.)	DIMENSION B (in.)	DIMENSION C (in.)
CRRFCURB261A00	386.04	283.54	49.50
CRRFCURB262A00	398.04	283.54	61.50
CRRFCURB263A00	410.04	307.54	49.50
CRRFCURB264A00	422.04	307.54	61.50
CRRFCURB265A00	440.29	325.79	61.50
CRRFCURB266A00	452.54	350.04	49.50
CRRFCURB267A00	464.54	350.04	61.50
CRRFCURB268A00	464.79	362.29	49.50
CRRFCURB269A00	476.54	374.04	49.50
CRRFCURB270A00	476.79	362.29	61.50
CRRFCURB271A00	488.54	374.04	61.50
CRRFCURB272A00	488.79	386.29	49.50
CRRFCURB273A00	500.79	398.29	49.50
CRRFCURB274A00	500.79	386.29	61.50
CRRFCURB275A00	512.79	398.29	61.50
CRRFCURB276A00	513.04	410.54	49.50
CRRFCURB277A00	524.79	422.29	49.50
CRRFCURB278A00	525.04	410.54	61.50
CRRFCURB279A00	536.79	422.29	61.50
CRRFCURB280A00	537.04	434.54	49.50
CRRFCURB281A00	549.04	434.54	61.50
CRRFCURB282A00	561.29	458.79	49.50
CRRFCURB283A00	573.29	458.79	61.50
CRRFCURB284A00	585.29	482.79	49.50
CRRFCURB285A00	597.29	482.79	61.50

Fig. 3 — Roof Curb Units (cont)

NOTES:

1. ROOF CURB ACCESSORY CRRFCURB286A00 & 287A00 ARE SHIPPED DISASSEMBLED.
2. DIMENSIONS ARE SHOWN IN INCHES. DIMENSIONS IN [] ARE IN MILLIMETERS.
3. ROOF CURB: 14 GA. [VA03-56] STL.
- ROOF CURB PANS: 16 GA. [VA03-56] STL.
- CROSS SUPPORTS: 14 GA. [VA03-56] STL.

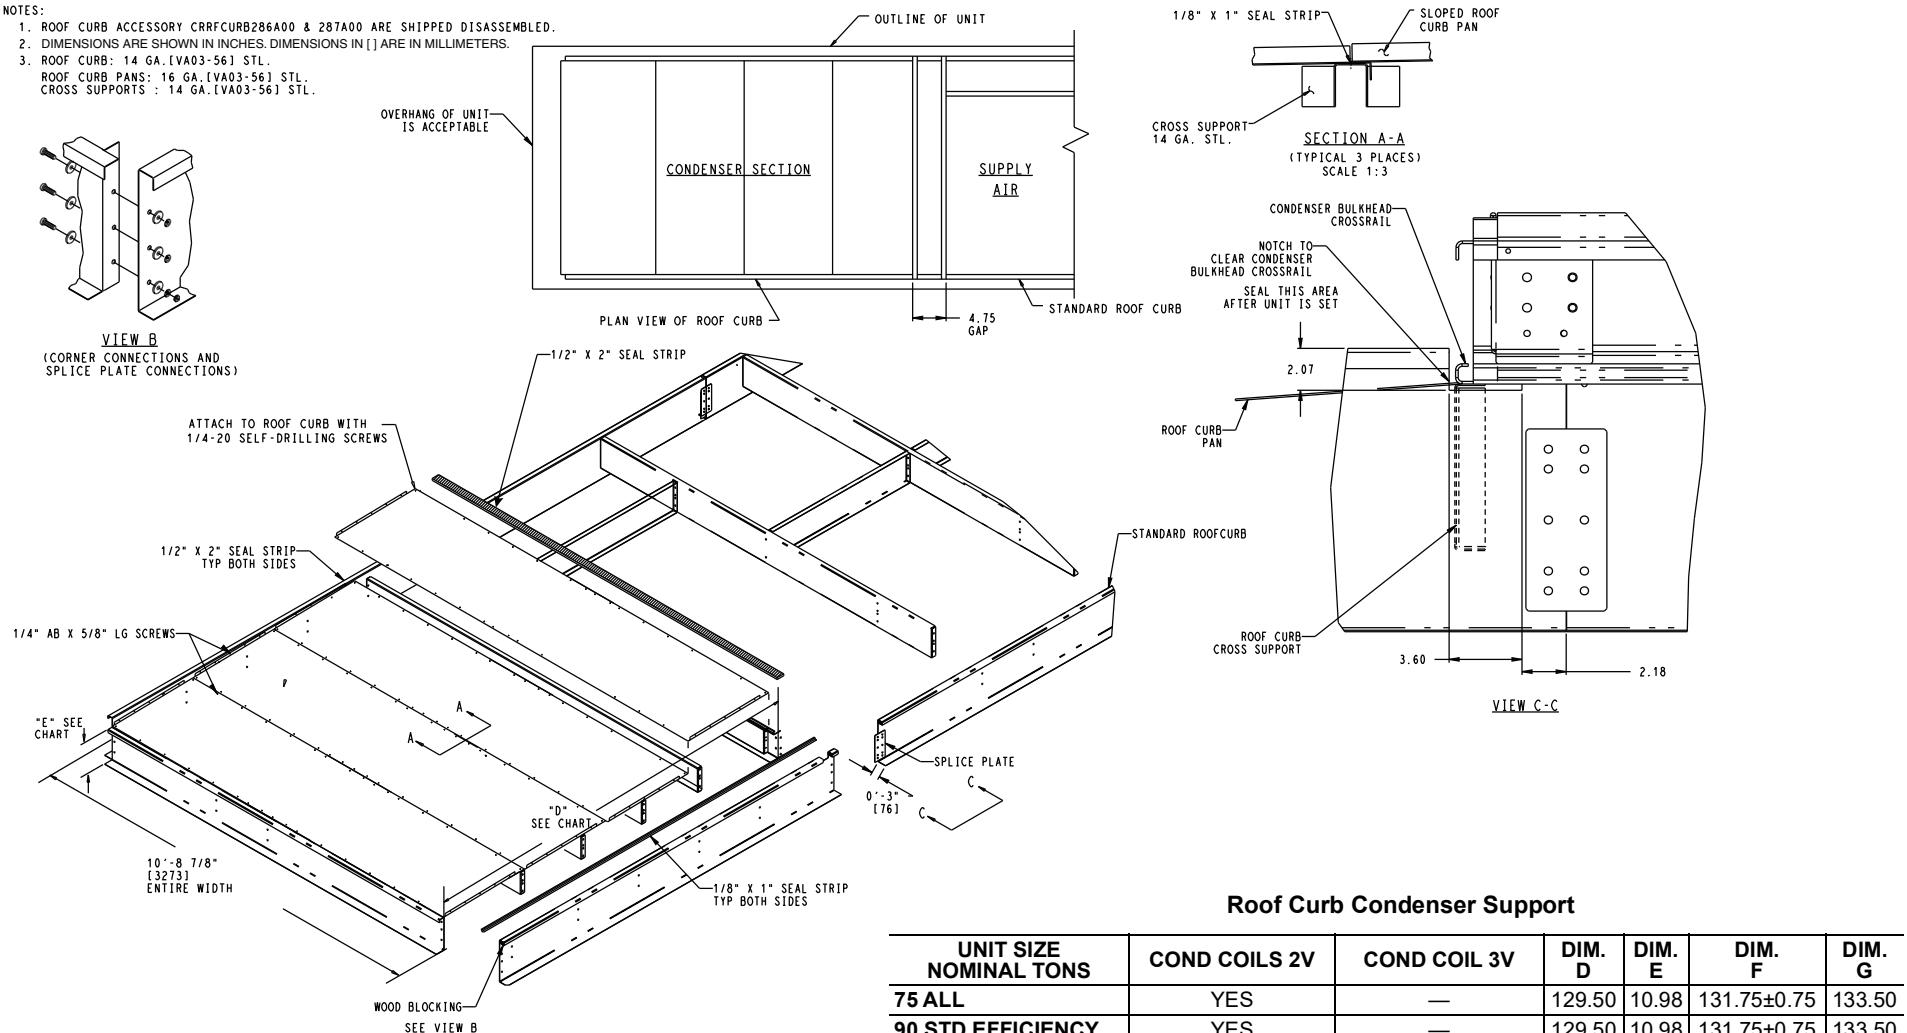

Roof Curb Condenser Support

UNIT SIZE NOMINAL TONS	COND COILS 2V	COND COIL 3V	DIM. D	DIM. E	DIM. F	DIM. G
75 ALL	YES	—	129.50	10.98	131.75±0.75	133.50
90 STD EFFICIENCY	YES	—	129.50	10.98	131.75±0.75	133.50
90 HIGH EFFICIENCY	—	YES	181.50	10.36	183.75±0.75	183.25
105 STD EFFICIENCY	YES	—	129.50	10.98	131.75±0.75	133.50
105 HIGH EFFICIENCY	—	YES	181.50	10.36	183.75±0.75	183.25
120 STD EFFICIENCY	YES	—	129.50	10.98	131.75±0.75	133.50
120 HIGH EFFICIENCY	—	YES	181.50	10.36	183.75±0.75	183.25
130 ALL	—	YES	181.50	10.36	183.75±0.75	183.25
150 ALL	—	YES	181.50	10.36	183.75±0.75	183.25
ACCESSORY PART NUMBER	CRRFCURB286A00	—	129.50	10.98	—	—
	—	CRRFCURB287A00	181.50	10.36	—	—

Fig. 3 — Roof Curb Units (cont)

Table 6 — Refrigerant Charge

UNIT SIZE (NOMINAL CAPACITY, TONS)	UNIT CONFIGURATION	CHARGE (LB)		CHARGE (LB)	
		UNITS WITHOUT HUMIDI-MIZER® SYSTEM		UNITS WITH HUMIDI-MIZER® SYSTEM	
		Circuit A	Circuit B	Circuit A	Circuit B
N (75)	Standard Capacity Standard Efficiency	46.5	52.6	46.5	69.6
	High Capacity Standard Efficiency	62.9	69.0	62.9	86.0
	Standard Capacity High Efficiency	50.2	56.5	50.2	73.5
	High Capacity High Efficiency	67.0	73.5	67.0	90.5
P (90)	Standard Capacity Standard Efficiency	55.4	52.0	55.4	71.5
	High Capacity Standard Efficiency	67.8	68.5	67.8	88.3
	Standard Capacity High Efficiency	59.0	57.2	59.0	76.7
	High Capacity High Efficiency	73.8	73.8	73.8	94.0
Q (105)	Standard Capacity Standard Efficiency	71.5	67.9	71.5	87.4
	High Capacity Standard Efficiency	89.5	81.9	89.5	101.4
	Standard Capacity High Efficiency	77.5	72.9	77.5	92.4
	High Capacity High Efficiency	91.6	88.2	91.6	107.7
R (120)	Standard Capacity Standard Efficiency	59.9	57.1	59.9	76.6
	High Capacity Standard Efficiency	80.3	77.1	80.3	96.6
	Standard Capacity High Efficiency	66.5	63.3	66.5	82.8
	High Capacity High Efficiency	87.1	83.3	87.1	102.8
S (130)	Standard Capacity Standard Efficiency	84.9	81.2	84.9	100.7
	High Capacity Standard Efficiency	106.0	99.5	106.0	119.0
	Standard Capacity High Efficiency	84.5	80.7	84.5	100.2
	High Capacity High Efficiency	105.5	99.0	105.5	118.5
T (150)	Standard Capacity Standard Efficiency	82.5	82.0	82.5	101.5
	High Capacity Standard Efficiency	103.5	101.2	103.5	121.7

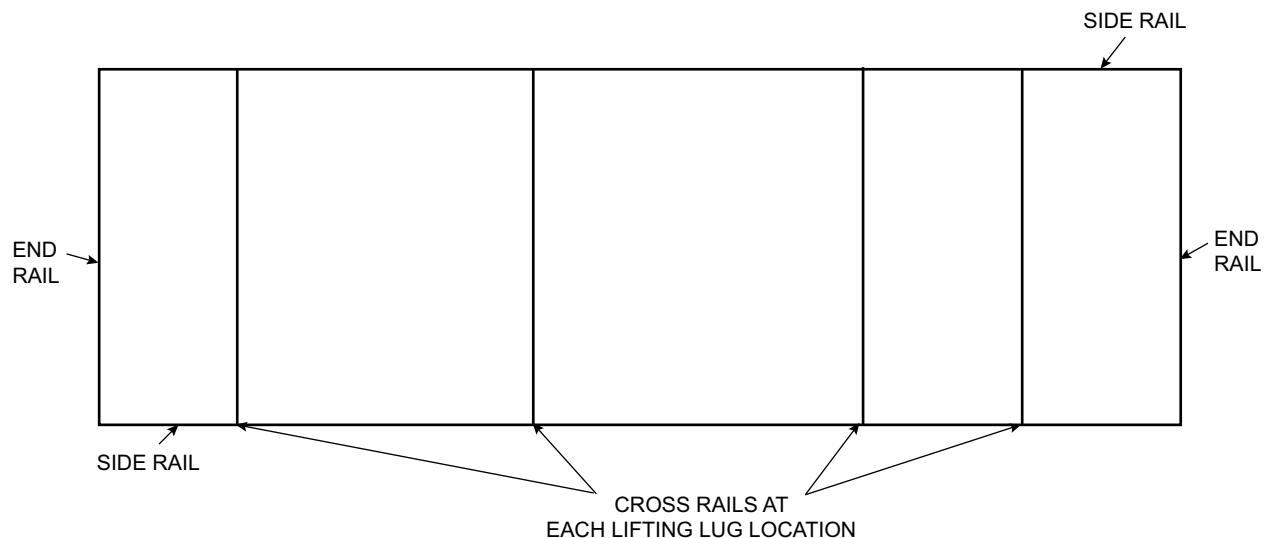


Fig. 4 — Steel Beam Mounting

Step 5 — Install Curb Gasketing

After ductwork has been connected to the roof curb, apply gasket material (1/2 in. thick x 1-1/2 in. wide neoprene) where indicated.

Single-Thickness Gasketing (See Fig. 5 for Item Numbers)

Apply gasketing in the following places:

1. Along both side rails (1) — 2 places, full length
2. Along return air end rail (2) — 1 place
3. Around return air internal duct flange (3) — 1 or 2 places
4. Around supply air internal duct flanges (4) — 3 places
5. Along supply section base rail (5) — 1 place

Condenser Section Roof Curb (See Fig. 6)

Apply single-thickness gasket along both side rails (5).

Step 6 — Install Field-Fabricated Ductwork

WARNING

PERSONAL INJURY HAZARD

Failure to follow this warning could cause personal injury.

For vertical supply and return units, tools or parts could drop into ductwork and cause an injury. Install a 90 degree turn in the return ductwork between the unit and the conditioned space. If a 90 degree elbow cannot be installed, then a grille of sufficient strength and density should be installed to prevent objects from falling into the conditioned space. Due to electric heater, supply duct will require 90 degree elbow.

Field-fabricated ductwork for vertical supply/vertical return units must be attached to the roof curb, or to the support steel, prior to the final rigging and installation of the unit. Supply and return duct dimensions are shown in Fig. 3.

To attach ductwork to roof curb, insert duct approximately 10 to 11 in. up into roof curb. Connect ductwork to 14-gauge roof curb material with sheet metal screws driven from inside the duct.

Secure all ducts to the building structure, using flexible duct connectors between roof curbs and ducts as required. Ducts passing through an unconditioned space must be insulated and covered with a vapor barrier. Outlet grilles must not lie directly below unit discharge.

Design supply duct strong enough to handle expected static pressures. Field-fabricated ductwork for horizontal supply/return units must be attached to the unit.

Step 7 — Rig Unit

Do not drop unit; keep upright. Use spreader bars over the unit to prevent sling or cable damage. Sheets of plywood placed along the condenser coils will provide additional protection. All lifting lugs MUST be used when lifting unit. Level by using unit frame as a reference. See Fig. 7-9 for information. Unit and accessory weights are shown in Tables 1 and 2. Weight distribution and center of gravity can be found in Fig. 10. Additional unit dimensional data can be found in Fig. 11-13.

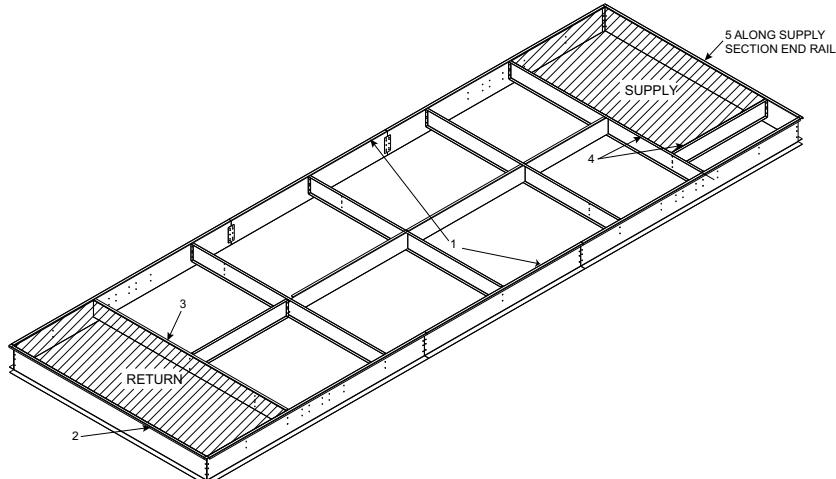


Fig. 5 — Gasket Location on Roof Curb

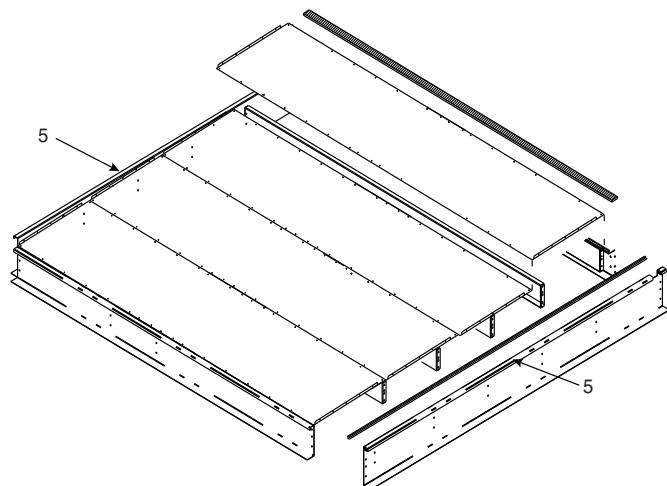


Fig. 6 — Gasket Location — Condenser Section Roof Curb



CAUTION - NOTICE TO RIGGERS:

ALL PANELS MUST BE IN PLACE WHEN RIGGINIG.

NOTE: 1. Rig with 10 cables and spread with 5 spreader bars of minimum length 3759 MM (148 Inch).
 2. Weights are for typical featured unit as listed below, Actual unit weight and lug location will vary based on options selected

UNIT TYPE	SIZE	TOTAL WEIGHT		CENTER OF GRAVITY				LIFTING LUG LOCATION										UNIT LENGTH	
				A		B		L1		L2		L3		L4		L5			
		LBS	KGS	IN	MM	IN	MM	IN	MM	IN	MM	IN	MM	IN	MM	IN	MM	IN	MM
50 Series Non-Split Econ. Bar Rel. Standard Filters, High Cap Evap, High Efficiency High Static Supply Fan w/ largest motor, High Static PE w/ largest motor, No Heat, No Post section, No Humidifier, No Extended Chassis, No Split, No Field Filter Section	75	16927	7678	238.3	6058	67.2	1707	51.8	1316	144.8	3678	213.4	5420	299.9	7618	393.2	9987	443.8	11273
	90	18382	8338	269.4	6843	67.2	1707	103.8	2637	196.8	4999	265.4	6741	351.9	8938	445.2	11308	495.8	12593
	105	18873	8561	270.5	6871	67.2	1707	103.8	2637	196.8	4999	265.4	6741	351.9	8938	445.2	11308	495.8	12593
	120	22523	10226	271.9	6906	67.2	1707	103.8	2637	196.8	4999	265.4	6741	361.7	9187	455.0	11557	505.6	12842
	130	22871	10383	277.9	7059	67.2	1707	103.8	2637	196.8	4999	265.4	6741	361.7	9187	455.0	11557	505.6	12842
	150	23164	10517	278.6	7076	67.2	1707	103.8	2637	196.8	4999	265.4	6741	361.7	9187	455.0	11557	505.6	12842
48 Series Non-Split Econ. Bar Rel. Standard Filters, High Cap Evap, High Efficiency, High Static Supply Fan w/ largest motor, High Static Power Exhaust w/ Largest motor, Low gas heat, No Post section, No Extended chassis, No humidifier, No Split, No Field filter section	75	17864	8103	275.9	7008	67.2	1707	51.8	1316	201.5	5118	278.4	7071	364.9	9269	458.3	11641	508.8	12924
	90	19319	8763	308.1	7826	67.2	1707	103.8	2637	253.5	6439	330.4	8392	416.9	10589	509.3	12936	560.8	14244
	105	19810	8986	309.8	7869	67.2	1707	103.8	2637	253.5	6439	330.4	8392	416.9	10589	509.3	12936	560.8	14244
	120	23622	10724	309.7	7866	67.2	1707	103.8	2637	253.5	6439	330.4	8392	426.7	10838	519.3	13190	570.6	14493
	130	23970	10882	316.7	8044	67.2	1707	103.8	2637	253.5	6439	330.4	8392	426.7	10838	519.3	13190	570.6	14493
	150	24263	11015	317.5	8065	67.2	1707	103.8	2637	253.5	6439	330.4	8392	426.7	10838	519.3	13190	570.6	14493

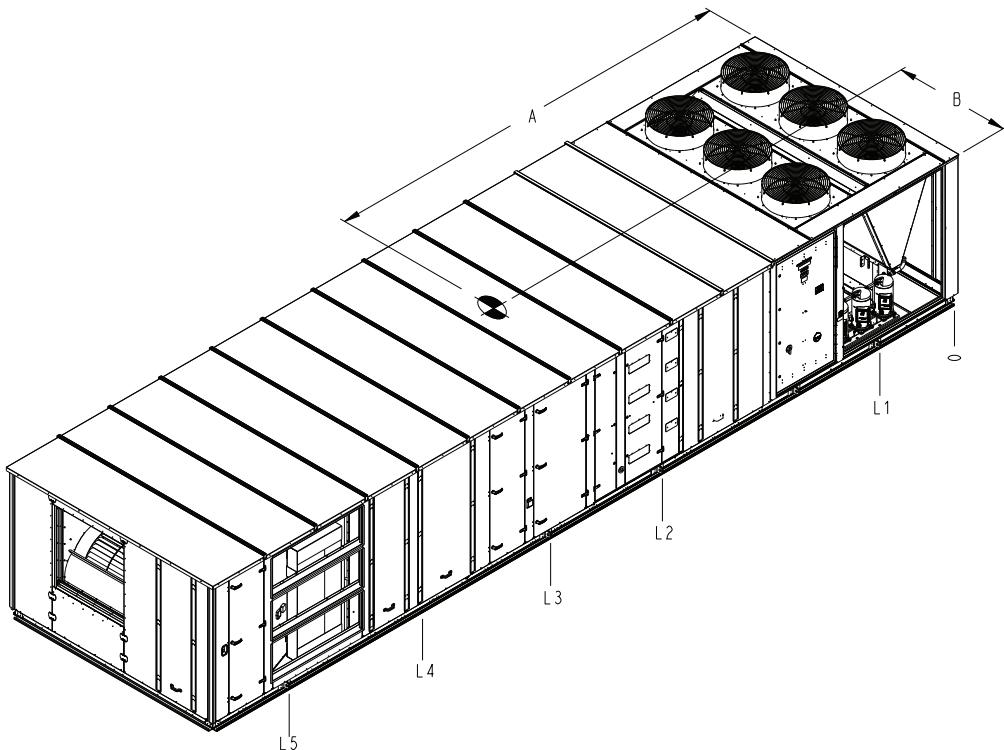


Fig. 7 — 48N 75-150 Ton Non-Split Rigging



CAUTION - NOTICE TO RIGGERS:

ALL PANELS MUST BE IN PLACE WHEN RIGGINIG.

NOTE: 1. Rig with 10 cables and spread with minimum 3759 MM (148 Inch) spreader bars.
 2. Weights are for typical featured unit as listed below, Actual unit weight and lug locations will vary based on options selected.

UNIT TYPE	SIZE	TOTAL WEIGHT		CENTER OF GRAVITY				LIFTING LUG LOCATION								UNIT LENGTH	
			A		B		L1		L2		L3		L4		L5		
		LBS	KGS	IN	MM	IN	MM	IN	MM	IN	MM	IN	MM	IN	MM	IN	MM
50 Series Split - Main Section Econ, Bar Rel, Cartridge filters, Hi Cap Evap, High Efficiency, High Static Supply Fan w/ largest motor, Hi Static Return Fan w/ largest motor, High Electric Heat, 8' Blank section w/ post filters, Extended chassis w/ humidifier, Split, No Field filter section	75	14529	6590	279	7087	67	1702	56	1422	149	3785	302.2	7676	370.9	9421	481.4	12228
	90	15778	7157	310	7874	67	1702	108	2743	201	5105	354.2	8997	422.9	10742	533.4	13548
	105	16269	7379	315	8001	67	1702	108	2743	201	5105	354.2	8997	422.9	10742	533.4	13548
	120	19527	8865	310	7874	67	1702	108	2743	201	5105	354.2	8997	422.9	10742	543.2	13548
	130	19875	9023	320	8128	67	1702	108	2743	201	5105	354.2	8997	422.9	10742	543.2	13548
	150	20055	9105	320	8128	67	1702	108	2743	201	5105	354.2	8997	422.9	10742	543.2	13548
48 Series Split - Main Section Econ, Bar Rel, Cartridge filters, Hi Cap Evap, High Efficiency, High Static Supply Fan w/ largest motor, Hi Static Return Fan w/ largest motor, High gas heat, 8' Blank section w/ post filters, Extended chassis w/ humidifier, Split, No Field filter	75	15446	7006	285	7239	67	1702	56	1422	149	3785	302.25	7677	379.2	9632	489.6	12436
	90	16810	7625	318	8077	67	1702	108	2743	201	5105	354.2	8997	431	10947	541	13741
	105	17301	7848	323	8204	67	1702	108	2743	201	5105	354.2	8997	431	10947	541	13741
	120	20821	9453	326	8280	67	1702	108	2743	201	5105	366.2	9302	443.2	11257	563.5	14313
	130	21169	9611	336	8534	67	1702	108	2743	201	5105	366.2	9302	443.2	11257	563.5	14313
	150	21349	9693	335	8509	67	1702	108	2743	201	5105	366.2	9302	443.2	11257	563.5	14313

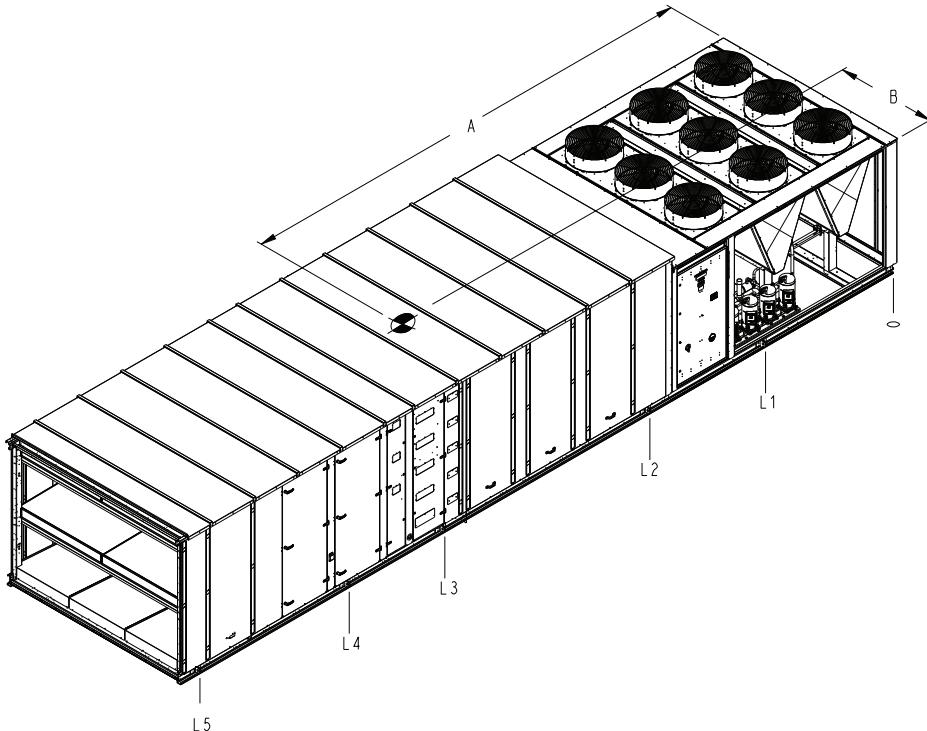


Fig. 8 — 48N 75-150 Ton Split (Main Unit) Rigging



CAUTION - NOTICE TO RIGGERS:

ALL PANELS MUST BE IN PLACE WHEN RIGGINIG.

NOTE: 1. Rig with 4 cables and spread with two 3759 MM [148 Inch] spreader bars.

2. Weights are for typical featured unit as listed below, Actual unit weight will vary based on options selected

UNIT TYPE	SIZE	TOTAL WEIGHT		CENTER OF GRAVITY				LIFTING LUG LOCATION				UNIT LENGTH	
		LBS	KGS	IN	MM	IN	MM	IN	MM	IN	MM		
50 Series Split - Return Section High Efficiency, High Static Supply Fan w/ largest motor, Hi Static Return Fan w/ largest motor, High Electric Heat, 8' Blank section w/ post filters, Extended chassis w/ humidimizer, Split, No Field filter section	75	5098	2315	76	1930	67	1702	5.4	137	98.2	2494	148.8	3780
	90	5451	2475	78	1981	67	1702	5.4	137	98.2	2494	148.8	3780
	105	5663	2571	78	1981	67	1702	5.4	137	98.2	2494	148.8	3780
	120	6150	2792	78	1981	67	1702	5.4	137	98.2	2494	148.8	3780
	130	6150	2792	78	1981	67	1702	5.4	137	98.2	2494	148.8	3780
	150	6305	2863	78	1981	67	1702	5.4	137	98.2	2494	148.8	3780
48 Series Split - Return Section Econ, Bar Rel, Cartridge filters, Hi Cap Evap, High Efficiency, High Static Supply Fan w/ largest motor, Hi Static Return Fan w/ largest motor, High gas heat, 8' Blank section w/ post filters, Extended chassis w/ humidimizer, Split, No Field filter	75	5098	2315	76	1930	67	1702	5.4	137	98.2	2494	148.8	3780
	90	5451	2475	78	1981	67	1702	5.4	137	98.2	2494	148.8	3780
	105	5663	2571	78	1981	67	1702	5.4	137	98.2	2494	148.8	3780
	120	6192	2811	78	1981	67	1702	5.4	137	98.2	2494	148.8	3780
	130	6192	2811	78	1981	67	1702	5.4	137	98.2	2494	148.8	3780
	150	6305	2863	78	1981	67	1702	5.4	137	98.2	2494	148.8	3780


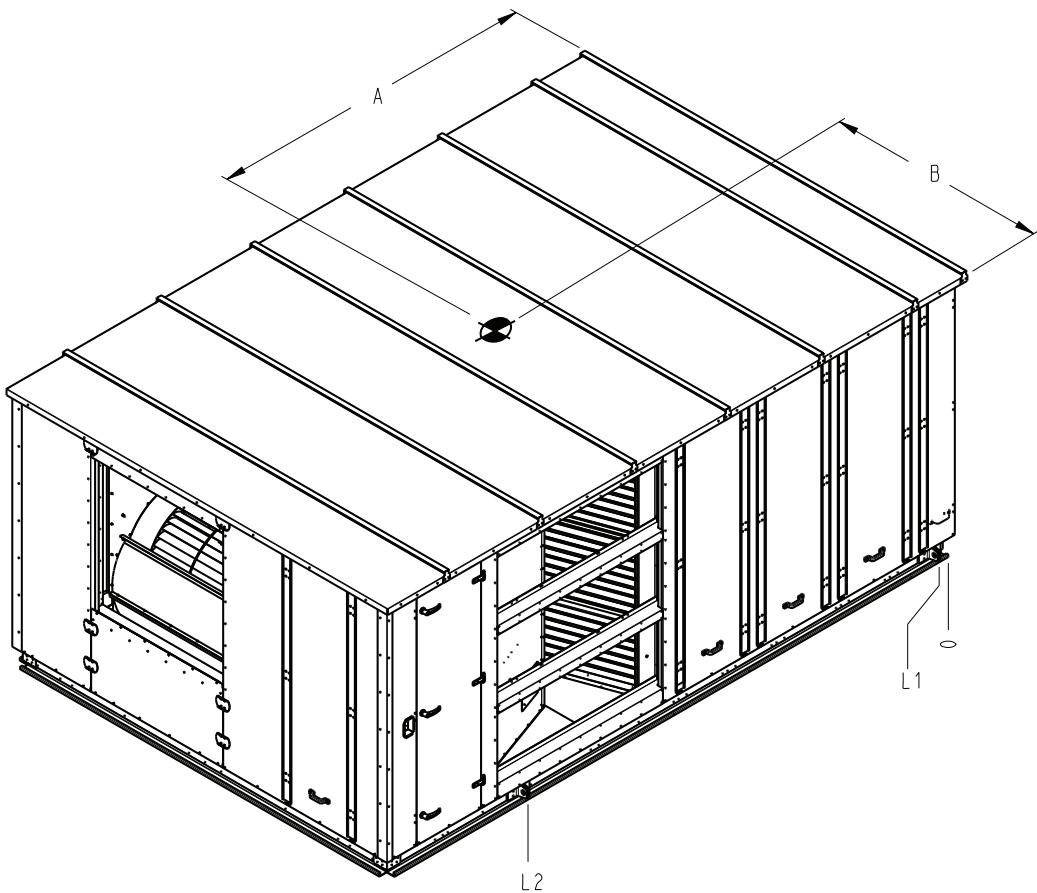


Fig. 9 — 48N 75-150 Ton Split (Return Section) Rigging

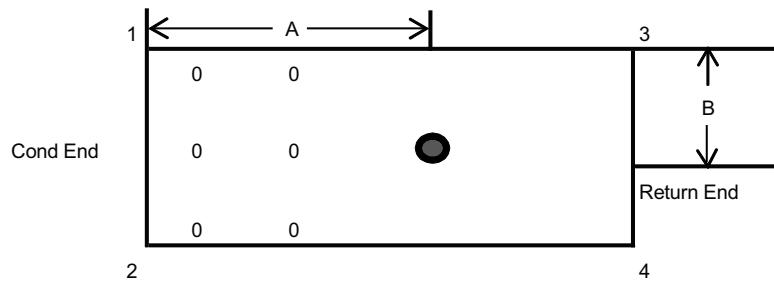

	NOMINAL CAPACITY (tons)	CORNER WEIGHTS (lb)				TOTAL (lb)	CENTER OF GRAVITY	
		1	2	3	4		A (in.)	B (in.)
48 Series Non-Split	75	4,129	4,047	4,892	4,796	17,864	275.9	67.2
	90	4,396	4,310	5,359	5,254	19,319	308.1	67.2
	105	4,478	4,390	5,526	5,417	19,810	309.8	67.2
	120	5,455	5,347	6,474	6,346	23,622	309.7	67.2
	130	5,385	5,279	6,719	6,587	23,970	316.7	67.2
	150	5,436	5,329	6,816	6,682	24,263	317.5	67.2
48 Series Split	75	4,684	4,592	5,690	5,578	20,544	355.1	67.2
	90	4,969	4,871	6,273	6,149	22,261	390.3	67.2
	105	5,052	4,952	6,544	6,415	22,964	394.8	67.2
	120	6,058	5,939	7,583	7,443	27,013	401.0	67.2
	130	5,972	5,854	7,845	7,691	27,361	409.6	67.2
	150	6,021	5,903	7,944	7,787	27,654	410.3	67.2

Fig. 10 — Weight Distribution and Center of Gravity

NOTES:

1. DIMENSIONS ARE IN INCHES.
2. UNIT WEIGHT AND CENTER OF GRAVITY INCLUDES ECONOMIZER, LARGEST INDOOR FAN MOTOR AND HIGH CAPACITY EVAPORATOR COIL.
3. UNIT CLEARANCES
4. THE FANS DO NOT RESTRICT CONDENSER FANS
5. ECONOMIZER FAN IS 18" x 18"
6. ECONOMIZER FAN HOURS ARE SHIPPED INSIDE OF UNIT.
7. HEAT RECLAM COIL DIMENSIONS (MAXIMUM)
 - LENGTH (HEADER INCLUDED): 121"
 - WIDTH: 6.00"
 - HEIGHT: 64.50"
8. HEAT RECLAM COIL FIELD SUPPLIED OR FACTORY INSTALLED.
9. PIPE CHASE LOCATIONS ARE RECOMMENDATIONS ONLY. OPENINGS ARE NOT FACTORY PROVIDED.
10. PIPE CHASE LOCATIONS ARE FACTORY SUPPLIED HOT WATER AND STEAM COILS ON UNITS WITHOUT ELECTRIC HEAT.
11. ON UNITS EQUIPPED WITH FACTORY SUPPLIED POST FILTER OPTION, THE POST FILTERS ARE INSTALLED IN THE BLANK SECTION AS FAR DOWNSTREAM AS POSSIBLE, ADJACENT TO THE DISCHARGE PLenum. THERE IS NO AVAILABLE SPACE BETWEEN THE POST FILTERS AND THE DISCHARGE OPENING.

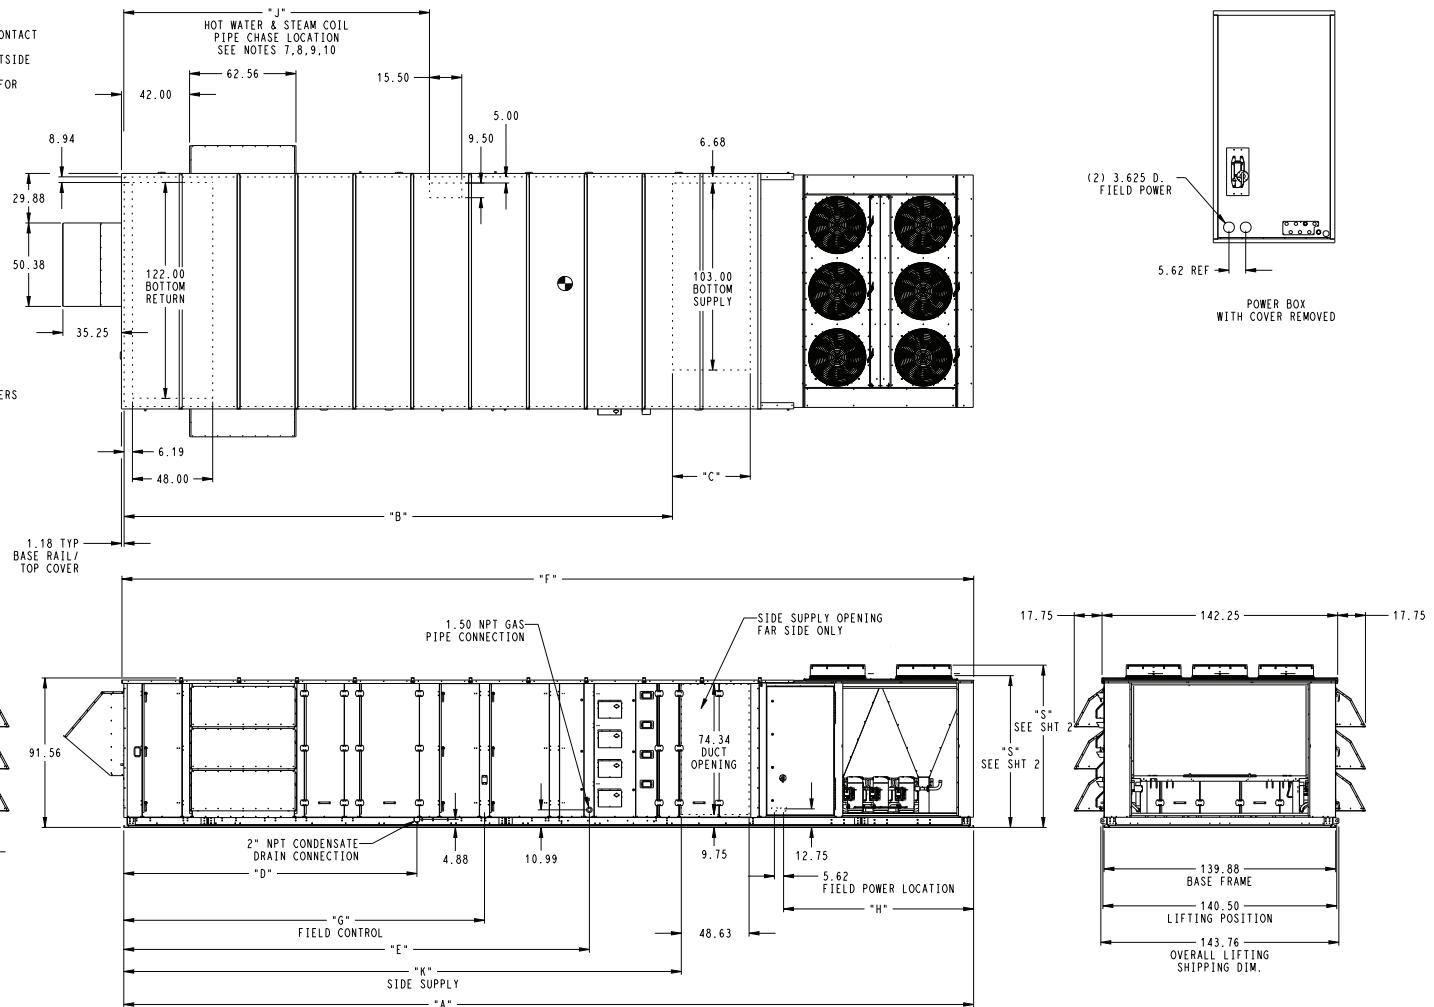


Fig. 11 — 48N Unit Sizes N, P, Q (75-105 Ton Nominal Capacity)

NOMINAL CAPACITY/ EFFICIENCY	EXTENDED CHASSIS	SUPPLY FAN	FIELD USE FILTER SECTION	BLANK SECTION	2-PIECE UNIT	COND	A (in.)	B (in.)	C (in.)	D (in.)	E (in.)	F (in.)	G (in.)	H (in.)	J (in.)	K (in.)
75 ALL 90 STD EFF 105 STD EFF	NO	STD	NO	NO	NO	2	498.11	314.42	48	177.02	266.07	499.35	202.75	119.76	—	313.36
				4 FT	YES	2	564.61	380.92	48	195.27	284.32	565.85	221.00	119.76	—	379.86
				8 FT	YES	2	612.86	429.17	48	195.27	284.32	614.10	221.00	119.76	—	428.11
			YES	NO	YES	2	576.86	393.17	48	255.77	344.82	578.10	281.50	119.76	—	392.11
				4 FT	YES	2	625.11	441.42	48	255.77	344.82	626.35	281.50	119.76	—	440.36
				8 FT	YES	2	673.36	489.67	48	255.77	344.82	674.60	281.50	119.76	—	488.61
		HIGH	NO	NO	NO	2	513.20	329.51	48	177.02	281.16	514.44	217.84	119.76	—	328.45
				4 FT	YES	2	579.70	396.01	48	195.27	299.41	580.94	236.09	119.76	—	394.95
				8 FT	YES	2	627.95	444.26	48	195.27	299.41	629.19	236.09	119.76	—	443.20
			YES	NO	YES	2	591.95	408.26	48	255.77	359.91	593.19	296.59	119.76	—	407.20
				4 FT	YES	2	640.20	456.51	48	255.77	359.91	641.44	296.59	119.76	—	455.45
				8 FT	YES	2	688.45	504.76	48	255.77	359.91	689.69	296.59	119.76	—	503.70
		YES	STD	NO	NO	2	522.11	338.42	48	177.02	290.07	523.35	226.75	119.76	185.75	337.36
				4 FT	YES	2	588.61	404.92	48	195.27	308.32	589.85	245.00	119.76	204.00	403.86
				8 FT	YES	2	636.86	453.17	48	195.27	308.32	638.10	245.00	119.76	204.00	452.11
			YES	NO	YES	2	600.86	417.17	48	255.77	368.82	602.10	305.50	119.76	264.50	416.11
				4 FT	YES	2	649.11	465.42	48	255.77	368.82	650.35	305.50	119.76	264.50	464.36
				8 FT	YES	2	697.36	513.67	48	255.77	368.82	698.60	305.50	119.76	264.50	512.61
			HIGH	NO	NO	2	537.20	353.51	48	177.02	305.16	538.44	241.84	119.76	185.75	352.45
				4 FT	YES	2	603.70	420.01	48	195.27	323.41	604.94	260.09	119.76	204.00	418.95
				8 FT	YES	2	651.95	468.26	48	195.27	323.41	653.19	260.09	119.76	204.00	467.20
			YES	NO	YES	2	615.95	432.26	48	255.77	383.91	617.19	320.59	119.76	264.50	431.20
				4 FT	YES	2	664.20	480.51	48	255.77	383.91	665.44	320.59	119.76	264.50	479.45
				8 FT	YES	2	712.45	528.76	48	255.77	383.91	713.69	320.59	119.76	264.50	527.70
90 HI EFF 105 HI EFF	NO	STD	NO	NO	NO	3	550.11	314.42	48	177.02	266.07	551.35	202.75	171.76	—	313.36
				4 FT	YES	3	616.61	380.92	48	195.27	284.32	617.85	221.00	171.76	—	379.86
				8 FT	YES	3	664.86	429.17	48	195.27	284.32	666.10	221.00	171.76	—	428.11
			YES	NO	YES	3	628.86	393.17	48	255.77	344.82	630.10	281.50	171.76	—	392.11
				4 FT	YES	3	677.11	441.42	48	255.77	344.82	678.35	281.50	171.76	—	440.36
				8 FT	YES	3	725.36	489.67	48	255.77	344.82	726.60	281.50	171.76	—	488.61
		HIGH	NO	NO	NO	3	565.20	329.51	48	177.02	281.16	566.44	217.84	171.76	—	328.45
				4 FT	YES	3	631.70	396.01	48	195.27	299.41	632.94	236.09	171.76	—	394.95
				8 FT	YES	3	679.95	444.26	48	195.27	299.41	681.19	236.09	171.76	—	443.20
			YES	NO	YES	3	643.95	408.26	48	255.77	359.91	645.19	296.59	171.76	—	407.20
				4 FT	YES	3	692.20	456.51	48	255.77	359.91	693.44	296.59	171.76	—	455.45
				8 FT	YES	3	740.45	504.76	48	255.77	359.91	741.69	296.59	171.76	—	503.70
		YES	STD	NO	NO	3	574.11	338.42	48	177.02	290.07	575.35	226.75	171.76	185.75	337.36
				4 FT	YES	3	640.61	404.92	48	195.27	308.32	641.85	245.00	171.76	204.00	403.86
				8 FT	YES	3	688.86	453.17	48	195.27	308.32	690.10	245.00	171.76	204.00	452.11
			YES	NO	YES	3	652.86	417.17	48	255.77	368.82	654.10	305.50	171.76	264.50	416.11
				4 FT	YES	3	701.11	465.42	48	255.77	368.82	702.35	305.50	171.76	264.50	464.36
				8 FT	YES	3	749.36	513.67	48	255.77	368.82	750.60	305.50	171.76	264.50	512.61
			HIGH	NO	NO	3	589.20	353.51	48	177.02	305.16	590.44	241.84	171.76	185.75	352.45
				4 FT	YES	3	655.70	420.01	48	195.27	323.41	656.94	260.09	171.76	204.00	418.95
				8 FT	YES	3	703.95	468.26	48	195.27	323.41	705.19	260.09	171.76	204.00	467.20
			YES	NO	YES	3	667.95	432.26	48	255.77	383.91	669.19	320.59	171.76	264.50	431.20
				4 FT	YES	3	716.20	480.51	48	255.77	383.91	717.44	320.59	171.76	264.50	479.45
				8 FT	YES	3	764.45	528.76	48	255.77	383.91	765.69	320.59	171.76	264.50	527.70

Condenser Detail

UNIT	COND COILS 2V	COND COIL 3V	LOW SOUND	DIMENSION "S" (in.)
75 ALL	YES	—	NO	92.62
75 ALL	YES	—	YES	98.06
90 STANDARD EFFICIENCY	YES	—	NO	92.62
90 HIGH EFFICIENCY	—	YES	YES	98.06
90 STANDARD EFFICIENCY	YES	—	YES	98.06
105 STANDARD EFFICIENCY	YES	—	NO	98.06
105 HIGH EFFICIENCY	—	YES	YES	98.06
105 STANDARD EFFICIENCY	YES	—	YES	98.06

Fig. 11 — 48N Unit Sizes N, P, Q (75-105 Ton Nominal Capacity) (cont)

NOTES:

1. DIMENSIONS ARE IN INCHES.
2. UNIT WEIGHT AND CENTER OF GRAVITY INCLUDES ECONOMIZER, LARGEST INDOOR FAN MOTOR AND HIGH CAPACITY EVAPORATOR COIL.
3. UNIT CLEARANCES
- TOP - DO NOT RESTRICT CONDENSER FANS
- ECONOMIZED END - 10'-0"
- SIDES AND CONDENSER END 6'-0"
- FOR SLEWER SERVICE AND OPERATIONAL CLEARANCES, CONTACT CARRIER APPLICATION ENGINEERING DEPARTMENT.
4. SUGGESTED FIELD CONNECTIONS TO MAKE INSIDE OR OUTSIDE OF DUCT FLANGES
5. WHEN UNIT IS SLAB MOUNTED ALLOW ADEQUATE HEIGHT FOR CONDENSATE DRAIN TRAP.
6. ECONOMIZER SIDE HOODS ARE SHIPPED INSIDE OF UNIT.
7. HEAT RECLAIM COIL DIMENSIONS (MAXIMUM)
 - LENGTH (HEADER INCLUDED): 121"
 - WIDTH: 6.00"
 - HEIGHT: 74.50"
8. HEAT RECLAIM COIL FIELD SUPPLIED OR FACTORY INSTALLED
9. PIPE CHASE LOCATIONS ARE RECOMMENDATIONS ONLY. OPENINGS ARE NOT FACTORY PROVIDED. 29.88
10. OPERATIONAL FACTORY SUPPLIED HOT WATER AND STEAM COILS ON UNITS WITHOUT ELECTRIC HEAT.
- HOT WATER COIL DIMENSIONS:
 - LENGTH: 108.75" WIDTH: 6.00" HEIGHT: 74.50"
 - TUBE O. D.: 1/2" ROWS 2
 - PIPE SIZE 1 1/2" NPT
- STEAM COIL DIMENSIONS:
 - LENGTH: 110.00" WIDTH: 5.00" HEIGHT: 66.00"
 - TUBE O. D.: 1.00" ROWS 2
 - PIPE SIZE 2 1/2" NPT

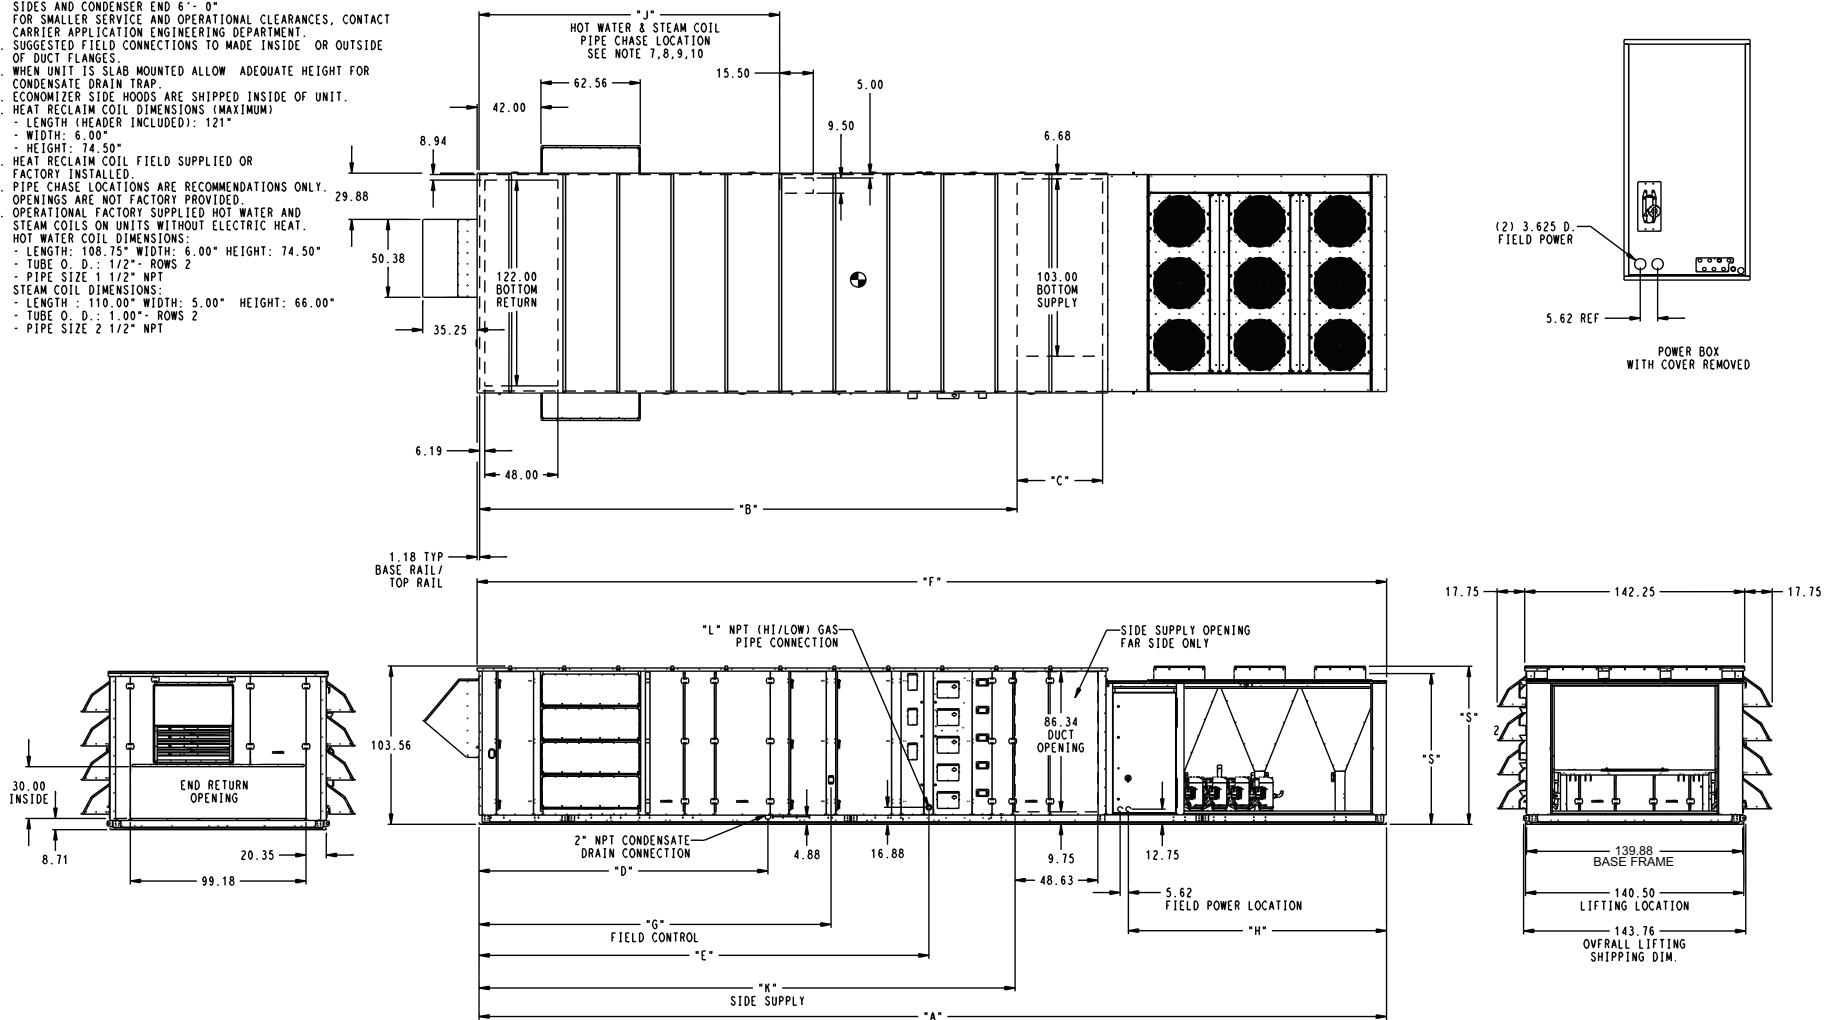


Fig. 12 — 48N Unit Sizes R, S, T (120-150 Ton Nominal Capacity)

NOMINAL CAPACITY/ EFFICIENCY	EXTENDED CHASSIS	HIGH GAS HEAT*	FIELD USE FILTER SECTION	BLANK SECTION	2-PIECE UNIT	COND	A (in.)	B (in.)	C (in.)	D (in.)	E (in.)	F (in.)	G (in.)	H (in.)	J (in.)	K (in.)	L HI (in.)	L MED LOW (in.)
120 STD EFF	NO	NO	NO	NO	2	523.04	339.35	48	186.86	291.00	524.28	227.68	119.76	—	338.29	2	1.5	
			4 FT	YES	2	589.54	405.85	48	205.11	309.25	590.78	245.93	119.76	—	404.79	2	1.5	
			8 FT	YES	2	637.79	454.10	48	205.11	309.25	639.03	245.93	119.76	—	453.04	2	1.5	
		YES	NO	YES	2	601.79	418.10	48	265.61	369.75	603.03	306.43	119.76	—	417.04	2	1.5	
			4 FT	YES	2	650.04	466.35	48	265.61	369.75	651.28	306.43	119.76	—	465.29	2	1.5	
			8 FT	YES	2	698.29	514.60	48	265.61	369.75	699.53	306.43	119.76	—	513.54	2	1.5	
	YES	NO	NO	NO	2	535.04	339.35	60	186.86	291.00	536.28	227.68	119.76	—	—	2	—	
			4 FT	YES	2	601.54	405.85	60	205.11	309.25	602.78	245.93	119.76	—	—	2	—	
			8 FT	YES	2	649.79	454.10	60	205.11	309.25	651.03	245.93	119.76	—	—	2	—	
		YES	NO	YES	2	613.79	418.10	60	265.61	369.75	615.03	306.43	119.76	—	—	2	—	
			4 FT	YES	2	662.04	466.35	60	265.61	369.75	663.28	306.43	119.76	—	—	2	—	
			8 FT	YES	2	710.29	514.60	60	265.61	369.75	711.53	306.43	119.76	—	—	2	—	
			NO	NO	2	547.04	363.35	48	186.86	315.00	548.28	251.68	119.76	195.56	362.29	2	1.5	
	YES	NO	4 FT	YES	2	613.54	429.85	48	205.11	333.25	614.78	269.93	119.76	213.81	428.79	2	1.5	
			8 FT	YES	2	661.79	478.10	48	205.11	333.25	663.03	269.93	119.76	213.81	477.04	2	1.5	
			NO	YES	2	625.79	442.10	48	265.61	393.75	627.03	330.43	119.76	274.31	441.04	2	1.5	
			4 FT	YES	2	674.04	490.35	48	265.61	393.75	675.28	330.43	119.76	274.31	489.29	2	1.5	
		YES	8 FT	YES	2	722.29	538.60	48	265.61	393.75	723.53	330.43	119.76	274.31	537.54	2	1.5	
			NO	NO	2	559.04	363.35	60	186.86	315.00	560.28	251.68	119.76	195.56	—	2	—	
			4 FT	YES	2	625.54	429.85	60	205.11	333.25	626.78	269.93	119.76	213.81	—	2	—	
			8 FT	YES	2	673.79	478.10	60	205.11	333.25	675.03	269.93	119.76	213.81	—	2	—	
	NO	NO	NO	YES	2	637.79	442.10	60	265.61	393.75	639.03	330.43	119.76	274.31	—	2	—	
			4 FT	YES	2	686.04	490.35	60	265.61	393.75	687.28	330.43	119.76	274.31	—	2	—	
			8 FT	YES	2	734.29	538.60	60	265.61	393.75	735.53	330.43	119.76	274.31	—	2	—	
		YES	NO	NO	3	575.04	339.35	48	186.86	291.00	576.28	227.68	171.76	—	338.29	2	1.5	
			4 FT	YES	3	641.54	405.85	48	205.11	309.25	642.78	245.93	171.76	—	404.79	2	1.5	
			8 FT	YES	3	689.79	454.10	48	205.11	309.25	691.03	245.93	171.76	—	453.04	2	1.5	
			NO	YES	3	653.79	418.10	48	265.61	369.75	655.03	306.43	171.76	—	417.04	2	1.5	
	YES	NO	4 FT	YES	3	702.04	466.35	48	265.61	369.75	703.28	306.43	171.76	—	465.29	2	1.5	
			8 FT	YES	3	750.29	514.60	48	265.61	369.75	751.53	306.43	171.76	—	513.54	2	1.5	
			NO	NO	3	587.04	339.35	60	186.86	291.00	588.28	227.68	171.76	—	—	2	—	
			4 FT	YES	3	653.54	405.85	60	205.11	309.25	654.78	245.93	171.76	—	—	2	—	
		YES	8 FT	YES	3	701.79	454.10	60	205.11	309.25	703.03	245.93	171.76	—	—	2	—	
			NO	YES	3	665.79	418.10	60	265.61	369.75	667.03	306.43	171.76	—	—	2	—	
			4 FT	YES	3	714.04	466.35	60	265.61	369.75	715.28	306.43	171.76	—	—	2	—	
			8 FT	YES	3	762.29	514.60	60	265.61	369.75	763.53	306.43	171.76	—	—	2	—	
120 HI EFF 130 ALL 150 STD EFF	NO	NO	NO	NO	3	599.04	363.35	48	186.86	315.00	600.28	251.68	171.76	195.56	362.29	2	1.5	
			4 FT	YES	3	665.54	429.85	48	205.11	333.25	666.78	269.93	171.76	213.81	428.79	2	1.5	
			8 FT	YES	3	713.79	478.10	48	205.11	333.25	715.03	269.93	171.76	213.81	477.04	2	1.5	
		YES	NO	YES	3	677.79	442.10	48	265.61	393.75	679.03	330.43	171.76	274.31	441.04	2	1.5	
			4 FT	YES	3	726.04	490.35	48	265.61	393.75	727.28	330.43	171.76	274.31	489.29	2	1.5	
			8 FT	YES	3	774.29	538.60	48	265.61	393.75	775.53	330.43	171.76	274.31	537.54	2	1.5	
			NO	YES	3	629.29	381.60	60	205.11	333.25	630.53	269.93	171.76	213.81	—	2	—	
	YES	NO	4 FT	YES	3	677.54	429.85	60	205.11	333.25	678.78	269.93	171.76	213.81	—	2	—	
			8 FT	YES	3	725.79	478.10	60	205.11	333.25	727.03	269.93	171.76	213.81	—	2	—	
			NO	YES	3	689.79	442.10	60	265.61	393.75	691.03	330.43	171.76	274.31	—	2	—	
			4 FT	YES	3	738.04	490.35	60	265.61	393.75	739.28	330.43	171.76	274.31	—	2	—	
		YES	8 FT	YES	3	786.29	538.60	60	265.61	393.75	787.53	330.43	171.76	274.31	—	2	—	

*Vertical discharge only

Condenser Detail

UNIT	COND COILS 2V	COND COIL 3V	LOW SOUND	DIMENSION "S" (in.)
120 STANDARD EFFICIENCY	YES	—	NO	96.62
120 HIGH EFFICIENCY	—	YES	YES	102.06
120 STANDARD EFFICIENCY	YES	—	YES	102.06
130 STANDARD EFFICIENCY	—	YES	NO	96.62
130 HIGH EFFICIENCY	—	YES	YES	102.06
150 STANDARD EFFICIENCY	—	YES	YES	102.06

Fig. 12 — 48N Unit Sizes R, S, T (120-150 Ton Nominal Capacity) (cont)

Step 8 — Connect Condensate Drain

The drain is a 2 in. FPT pipe connection located on the right-hand side of the unit looking at the unit from the return air end. See Fig. 11 and 12. Figure 13 shows the additional length of units with an extended chassis.

With field-supplied fittings and pipe sections, plumb the primary condensate drain to the 2 in. FPT connector on the base rail. Use a trap height of at least 7 inches. See Fig. 14 and 15. Apply a bead of RTV or similar sealant around the pipe joint at the connector in the base rail.

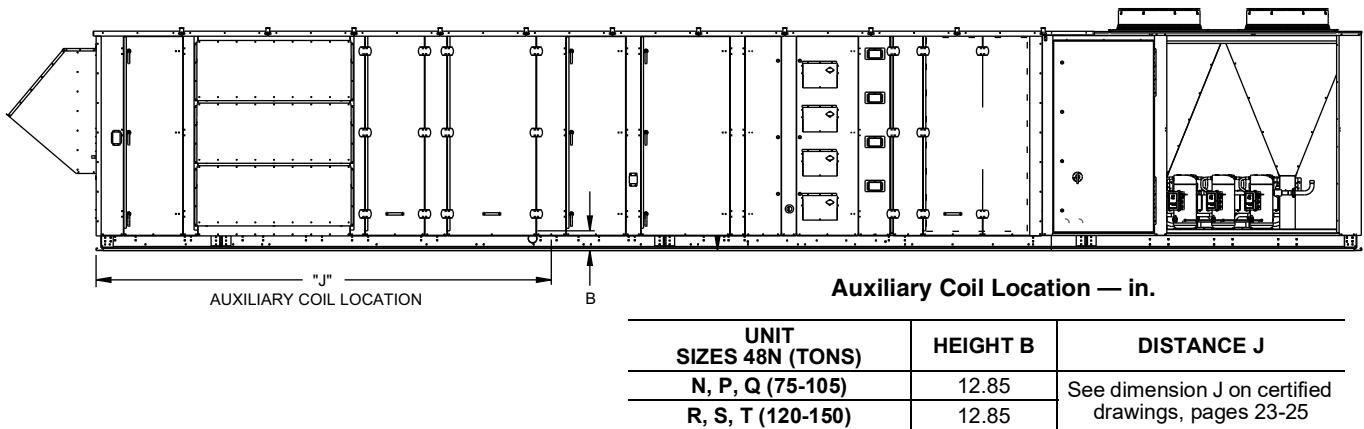


Fig. 13 — Units with Optional Extended Chassis — Location of Coil Tracks

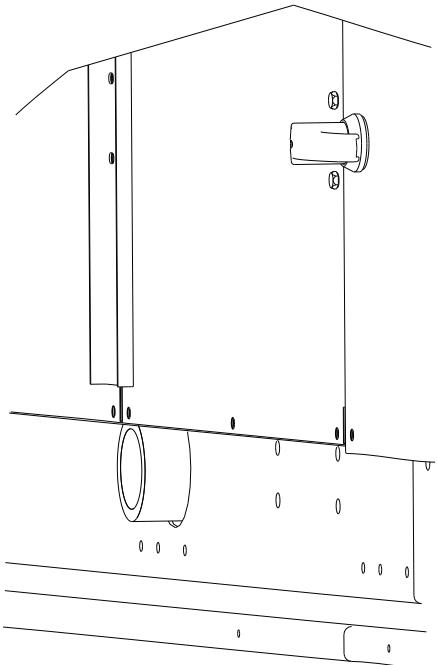


Fig. 14 — Primary Drain Connection

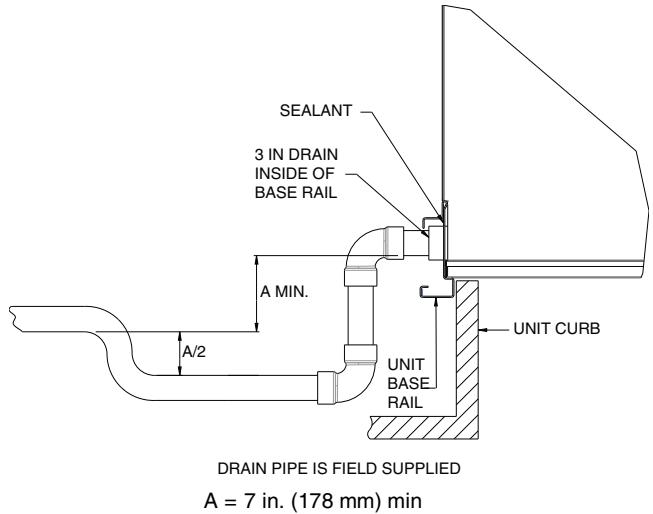


Fig. 15 — Condensate Drain Piping Details (Slab and Curb Mounted)

Step 9 — Install Outdoor Air Hoods

Unit sizes 75 to 105 nominal tons have three hoods on both sides. Unit sizes 120 to 150 nominal tons have four hoods on both sides. Reference images shown are for three hoods. However, assembly of four hoods for the larger units is the same. Instructions for unpacking and assembly of hoods are below.

1. Remove the box from the unit (see Fig. 16).
 - a. Shipping support straps are bolted to the unit. Remove four bolts on each, and discard straps.
 - b. Remove the hood supports (quantity 2 or 3) (see Fig. 17).
 - c. Remove packaging from the unit.
 - d. Reinstall hood supports (Fig. 17).
2. Remove filters located between return/exhaust fan and economizer dampers, these are packaged separately from hoods for shipping (see Fig. 16). Screws, other hardware and seal strips are packaged with the outdoor hoods.
3. Apply seal strip to the unit. Strip should extend around entire openings (see Fig. 18).

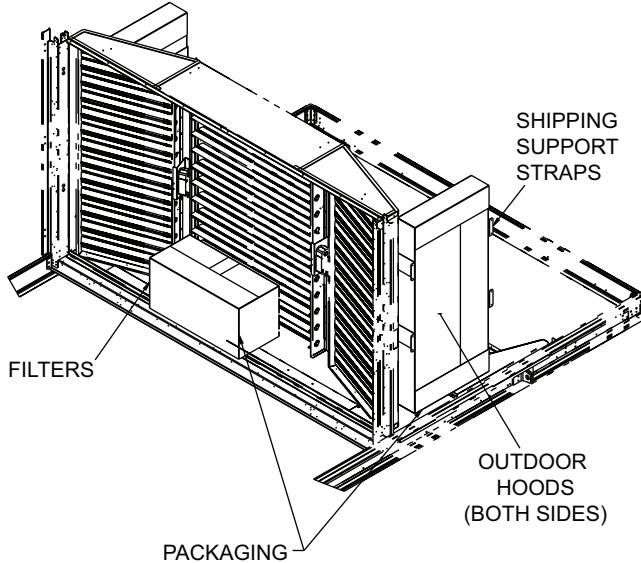


Fig. 16 — Packaging Locations

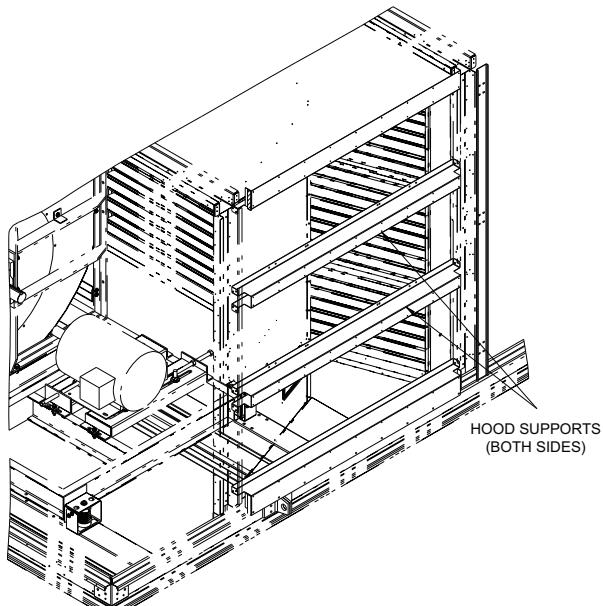


Fig. 17 — Hood Supports

4. Assemble hoods (see Fig. 19).

- a. Attach hood sides (Items 1 and 2) to the hood top (Item 3). Fasten hood using six screws on each side.
- b. Attach hood support (Item 4) to hood top (Item 3).
- c. Attach angle (Item 5) to hood sides (two per hood). Fasten angle to the hood side using three screws per side.
- d. Attach hood support (Item 7) to top (Item 3) using six screws.
- e. Attach clips (Item 8) to hood support (Item 7).
- f. Attach angle (Item 10) to hood support (Item 7) using eight screws.
- g. Attach angle (Item 9) to angle (Item 10) using two pop rivets.
- h. Place RTV or similar sealant on all of the 6 corners to prevent water leaks.
- i. Install hood assembly to unit using four screws on each side and nine screws on the top.
- j. Install filters (Item 6) to hood assembly.

5. Repeat Step 4 for each hood.

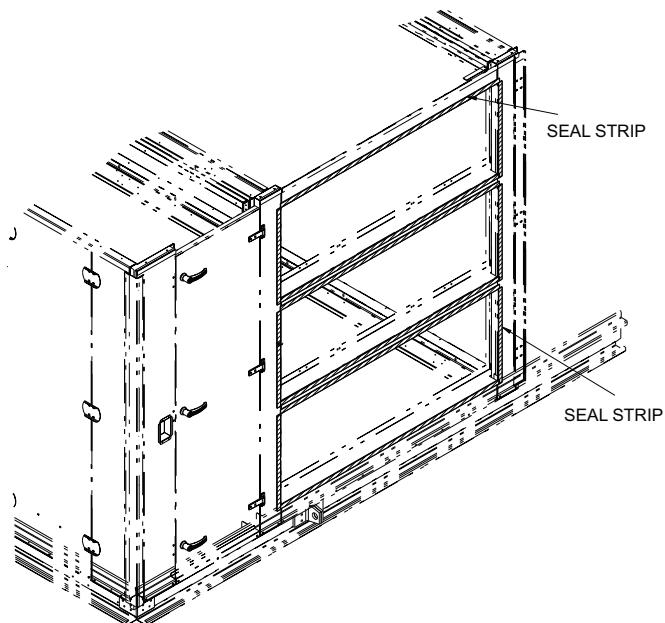


Fig. 18 — Seal Strips


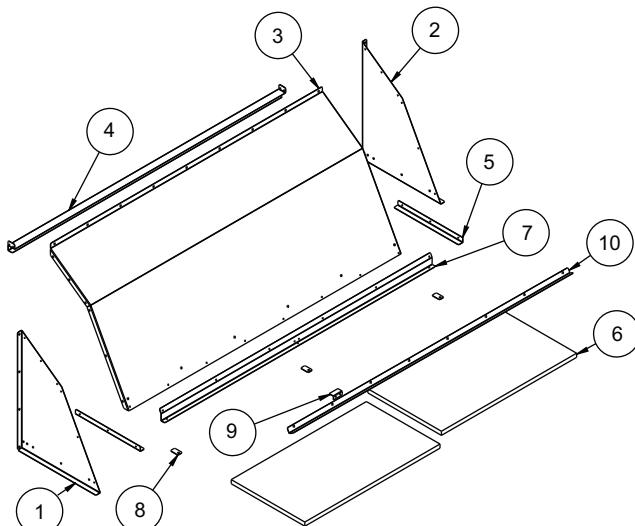


Fig. 19 — Hood Assembly

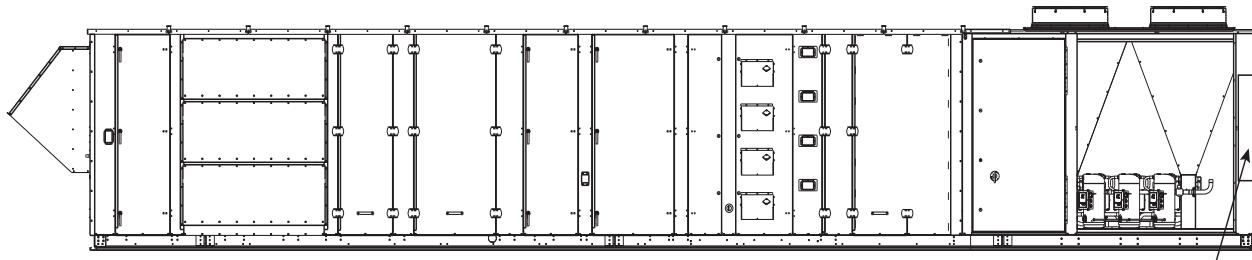

CAUTION

Use care when drilling into corner post to avoid damage to condenser coil.

Fig. 20 — Disconnect Location

Step 10 — Route Field Wiring

Field power wiring is brought into the unit through the back of the power box near the bottom. Wiring can be brought through the roof curb through field-supplied watertight connections. There are two 3-5/8 in. holes for field power wiring in the power box and a 7/8 in. hole in the side post for 24-v control wiring provided. Field-supplied couplings must be used when routing wiring into the control box.

See Fig. 20 for recommended disconnect location.

Step 11 — Make Field Electrical Connections

IMPORTANT: All units have variable frequency drives (VFD) factory installed. VFDs generate, use, and can radiate radio frequency energy. If units are not installed and used in accordance with these instructions, they may cause radio interference. They have been tested and found to comply with limits of a Class A computing device pursuant to International Standard EN 61000-2-3, which are designed to provide reasonable protection against such interference when operated in a commercial environment.

POWER WIRING

Units are factory-wired for the voltage shown on unit nameplate. The main terminal block is suitable for use with copper wires only. Maximum wire size varies according to disconnect size.

DISCONNECT SIZE	QUANTITY...MAXIMUM WIRE SIZE (MCM)
400 Amps	2...500
600 Amps	2...500
800 Amps	2...500

NOTE: Conduit used for field wiring must be sealed at the unit end of the conduit. Failure to do so could cause the conduit to act as a chimney in cold climates causing warm building air to condense in the power box.

Units without Factory-Installed Disconnect

When installing units, provide a disconnect per NEC (National Electrical Code) of adequate size (MOCP [maximum overcurrent protection] of unit is on the informative plate). All field-wiring must comply with NEC and all local codes. Size wire based on MCA (minimum circuit amps) on the unit informative plate. See Fig. 21 for power wiring connections to the unit power terminal block and equipment ground. Maximum wire size is two (2) 500 MCM (maximum wire size) conductors per pole.

Units with Factory-Installed Disconnect

The factory-installed disconnect is an interlocking, door-type. The disconnect handle locks the door when it is in the ON position. The disconnect handle must be in the OFF position to open the

control box door. The disconnect is located in the power box behind the power box door for all units. See Fig. 22.

All field wiring must comply with NEC and all local codes. Wire must be sized based on MCA (minimum circuit amps) on the unit informative plate. See Fig. 23 for power wiring connections to the unit disconnect and equipment ground.

Operating Voltage

Operating voltage to the unit must be within the voltage range indicated on the unit nameplate. Voltages between phases must be balanced within 2%, and the current must be balanced within 10%. See Table 7 for motor limits.

Use the following formula to determine the percentage of voltage imbalance.

Voltage Imbalance

$$= 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

Example: Supply voltage is 460-3-60.

AB = 452 v

BC = 464 v

AC = 455 v

$$\begin{aligned} \text{Average Voltage} &= \frac{452 + 464 + 455}{3} \\ &= \frac{1371}{3} \\ &= 457 \end{aligned}$$

Determine maximum deviation from average voltage:

$$(AB) 457 - 452 = 5 \text{ v}$$

$$(BC) 464 - 457 = 7 \text{ v}$$

$$(AC) 457 - 455 = 2 \text{ v}$$

Maximum deviation is 7 v.

Determine percent voltage imbalance:

$$\begin{aligned} \% \text{ Voltage Imbalance} &= 100 \times \frac{7}{457} \\ &= 1.53\% \end{aligned}$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact local utility immediately.

Unit failure as a result of operation on improper line voltage or excessive phase imbalance constitutes abuse and may cause damage to electrical components.

Determine percent voltage imbalance:

$$\% \text{ Voltage Imbalance} = 100 \times \frac{7}{457} = 1.53\%$$

Check proper rotation of the compressors. If they rotate in reverse change the phasing of the main power not the compressors.

NOTE: Do not depend on fan rotation for proper phasing; the VFDs will correct for swapped phases.

Check current draw of VFD and motor for proper phase balance. All currents at 60 Hz should be within 5% of each other and the rated load amps or a line reactor may be required to correct for building or grid phase shifts. Check the building supply for proper phasing of 120 degrees.

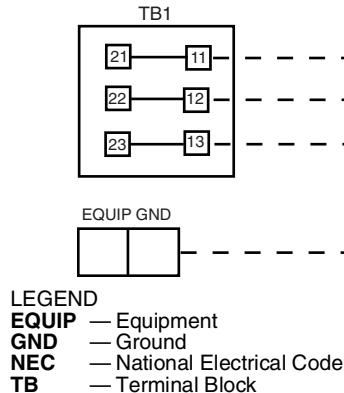


Fig. 21 — Field Power Wiring Connections

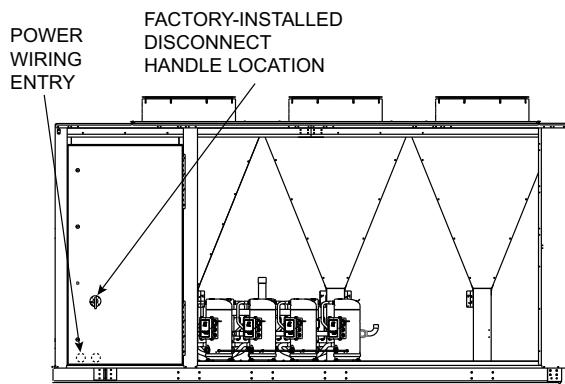


Fig. 22 — Factory-Installed Disconnect Location (End of Unit Shown)

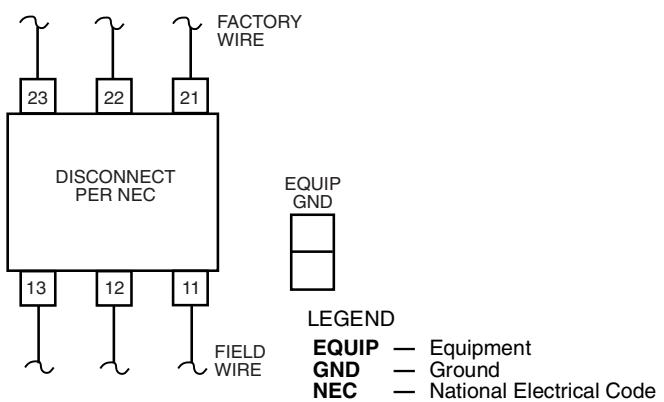


Fig. 23 — Field Power Wiring Connections for Factory-Installed Disconnect

Table 7 — Motor Limit

NOMINAL HP	BkW	MAX BHP	MAX BkW	MAX AMPS (EA)		RATED EFFICIENCY
				460 V	575 V	
7.5	5.6	8.6	6.39	12.0	10.0	91.7
10	7.5	11.5	8.56	14.3	12.0	91.7
15	11.2	17.3	12.89	22.0	19.0	93.0
20	14.9	22.9	17.10	28.7	23.0	93.6
25	18.7	28.7	21.41	36.3	28.4	93.6
30	22.4	34.5	25.71	41.7	36.3	94.1
40	29.8	45.9	34.27	55.0	43.8	94.1
50	37.3	57.4	42.83	71.0	52.8	94.5
60	44.8	68.9	51.41	83.0	60.5	95.0
75	59.5	86.1	64.25	101.0	80.5	95.0
100	74.6	114.8	85.67	132.0	106.0	95.4

LEGEND

Bhp — Brake Horsepower
BkW — Brake Kilowatts

NOTE: Extensive motor and electrical testing on the Carrier units has ensured that the full horsepower range of the motor can be utilized with confidence. Using fan motors up to the horsepower ratings shown in the Motor Limitations table will not result in nuisance tripping or premature motor failure. Unit warranty will not be affected.

Step 12 — Connect Air Pressure Tubing

Before options such as the variable frequency drive (VFD) and/or modulating power exhaust (PE) can operate properly, the pneumatic tubing for pressure sensing must be installed. Use fire-retardant plenum tubing (field-supplied). All control devices use 1/4 in. tubing. Tubing must be run from the appropriate sensing location (in the duct or in the building space) to the control device location in the unit.

VARIABLE FREQUENCY DRIVE

The tubing for the duct pressure (DP) control option should sample supply duct pressure approximately 2/3 of the way out from the unit in the main trunk duct, at a location where a constant duct pressure is desired.

On these units, the duct pressure is sensed by a pressure transducer. The pressure transducer output is directed to the unit control module. On all sizes, the DP transducer is located in the unit control box. See Fig. 24 and Fig. 25 for control box details. Use a nominal 1/4 in. plastic tubing.

Refer to appropriate base unit Controls, Start-Up, Operation, Service and Troubleshooting book for instructions on adjusting set points for duct pressure controls.

POWER EXHAUST

The tubing for the building pressure (BP) control (achieved via the modulating power exhaust option) should sample building pressure in the area near the entrance lobby (or other appropriate and sensitive location) so that location is controlled as closely to design pressures as possible.


These units use a pressure transducer for sensing building pressure. The BP transducer is located in the unit control box. Use a nominal 1/4 in. plastic tubing.

For instructions on adjusting BP control set points, refer to the Controls, Start-Up, Operation, Service, and Troubleshooting book.

RETURN FAN

The tubing for the BP control (achieved via the return fan option) should sample building pressure in the area near the entrance lobby (or other appropriate and sensitive location) so that location is controlled as closely to design pressures as possible.


The units use a pressure transducer for sensing building pressure. The BP transducer is located in the unit control box. Use a nominal 1/4 in. plastic tubing. For instructions on adjusting BP control set points, refer to the Controls, Start-Up, Operation, Service, and Troubleshooting book.

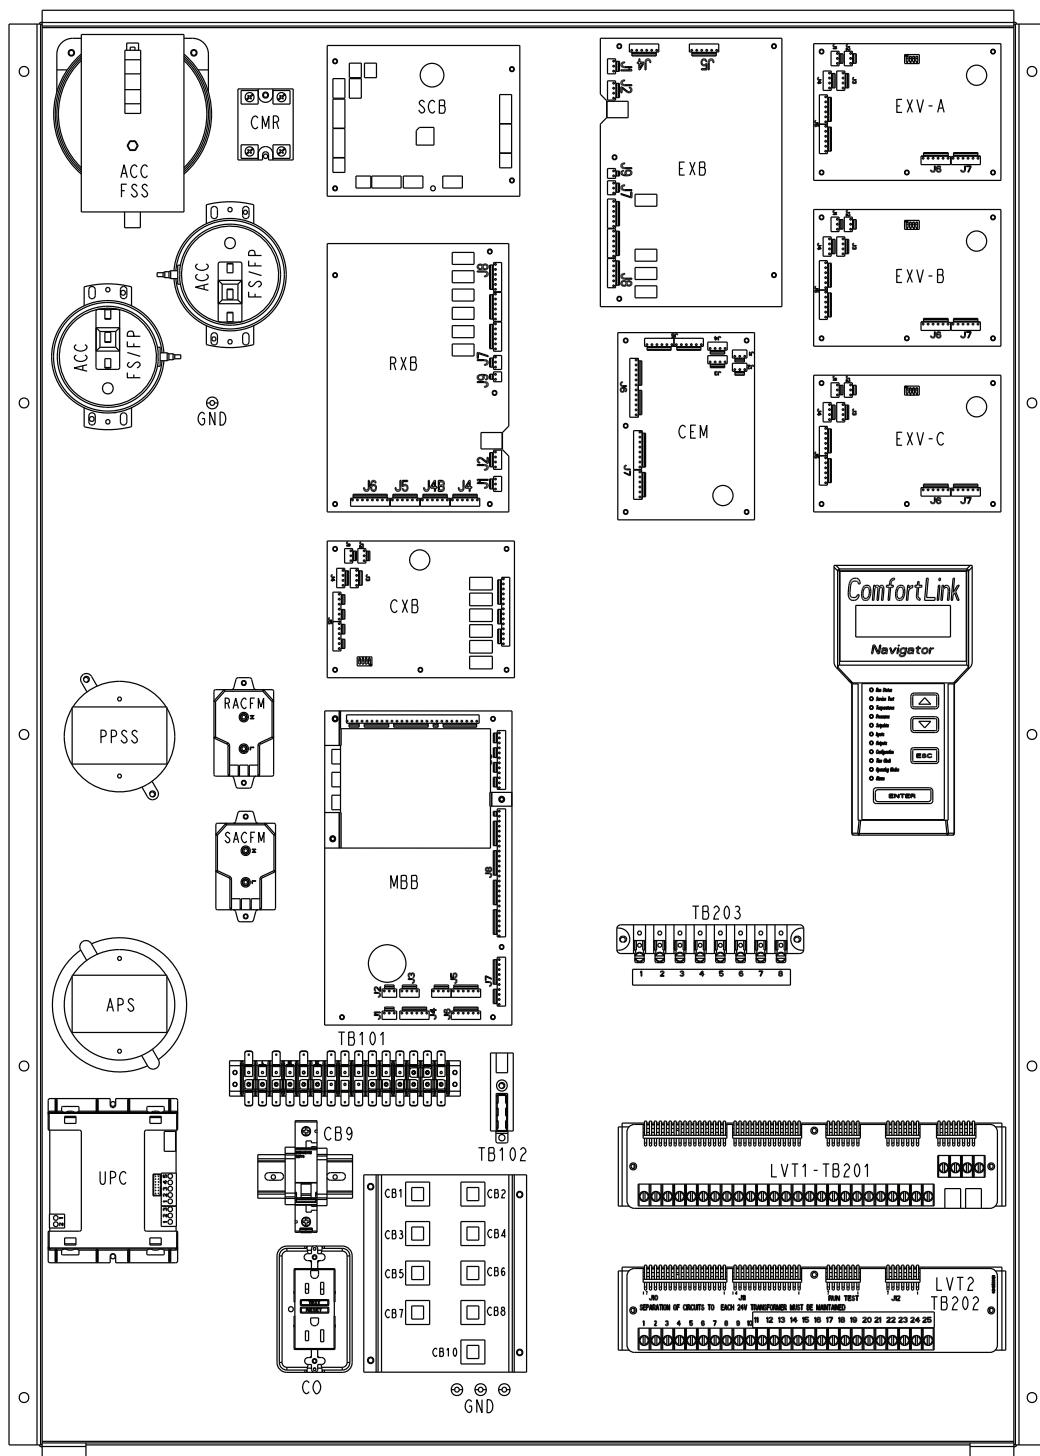

LEGEND

ACC FSS	— Accessory Fan Status Switch	GND	— Ground
APS	— Air Pressure Switch	LVT	— Low Volume Terminal
CB	— Circuit Breaker	MBB	— Main Base Board
CEM	— Controls Expansion Module	PPSS	— Plenum Pressure Safety Switch
CMR	— Compressor Modulation Relay	RACFM	— Return Air cfm
CO	— Convenience Outlet	RXB	— Rooftop Control Board
CXB	— Compressor Expansion Board	SACFM	— Supply Air cfm
EXB	— Economizer Control Board	SCB	— Staged Gas Control Board
EXV	— Expansion Valve Control Board	TB	— Terminal Block
FS/FP	— Filter Switch/Filter Pressure	UPC	— Unitary Protocol Converter

Fig. 24 — Control Box Component Arrangement

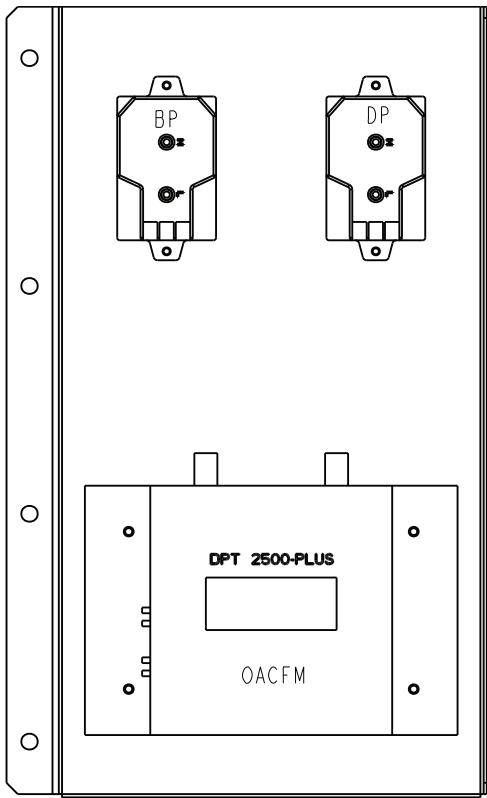

LEGEND

BP	— Building Pressure
DP	— Duct pressure
OACFM	— Outdoor air CFM

Fig. 25 — Auxiliary Control Box Arrangement

Step 13 — Remove Supply-Fan Shipping Bracket Screws

Supply-fan shipping bracket screws must be removed from each corner of the fan sled before starting unit. See Fig. 26.

1. To remove shipping bracket screws, raise fan sled by turning adjusting bolt counterclockwise until spring is compressed slightly.
2. Remove screws holding shipping bracket to spring support. NOTE: It is not necessary to remove the shipping bracket, only remove the screws.
3. After removing all shipping bracket screws, level fan sled using the adjusting screws.

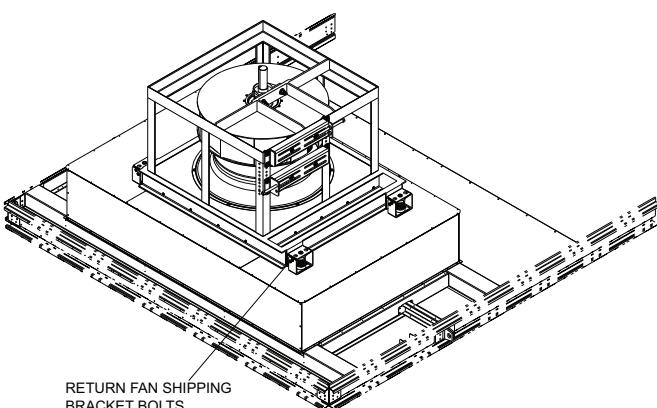


Fig. 26 — Return Fan Shipping Bracket Bolts

Fan shaft bearings are pre-lubricated by the bearing manufacturer, or again at the time of production. Check for a small bead around the bearing seal and relubricate as necessary.

Step 14 — Remove PE Shipping Bracket Screws

Optional power exhaust (PE) shipping bracket screws must be removed from each corner of the fan sled before starting unit.

1. To remove shipping bracket screws, raise fan sled by turning adjusting bolt counterclockwise until spring is compressed slightly.
2. Remove screws holding shipping bracket to spring support. NOTE: It is not necessary to remove the shipping bracket, only remove the screws.
3. After removing all shipping bracket screws, level fan sled using the adjusting screws.

Step 15 — Remove Return-Fan Shipping Brackets

Optional return fan shipping brackets must be removed from each corner of the fan sled before starting unit. See Fig. 27.

To remove shipping brackets, remove 2 screws holding each bracket to the cross rail. There are 4 brackets per unit.

After removing all shipping brackets, level the fan using the adjustment screws.

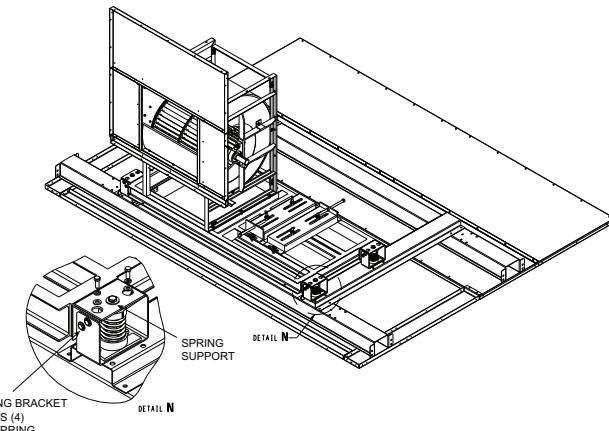


Fig. 27 — Supply Fan and Power Exhaust Fan Shipping Bracket Bolts

Step 16 — Connect Gas Piping

Unit is equipped for use with natural gas only. Installation must conform with local building codes, or in the absence of local codes, with the National Fuel Gas Code (NFGC), ANSI Z223.1.

A 1/8 in. NPT tapping plug, accessible for test gauge connection, must be field-installed immediately upstream of gas supply connection to unit, but after manual gas valve. See Fig. 28. Natural gas pressure at unit gas connection must not be less than 5 in. wg or greater than 13 in. wg.

Size gas supply piping for 0.5 in. wg maximum pressure drop. Do not use supply pipe smaller than unit gas connection.

CAUTION

Disconnect gas piping from unit when leak testing at pressures greater than 0.5 psig. Pressures greater than 0.5 psig will cause gas valve damage resulting in a hazardous condition. If gas valve is subjected to pressure greater than 0.5 psig, it must be replaced.

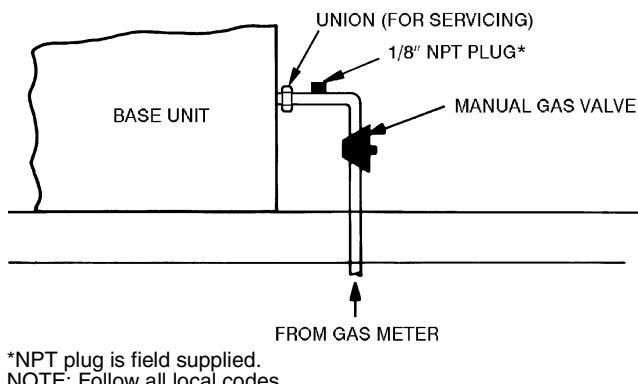


Fig. 28 — Gas Piping Details

Step 17 — Configure Modulating Gas Control

The 48N Series large rooftop units may be ordered with an optional factory-installed modulating gas control system that monitors heating operation of the rooftop.

Refer to the Controls, Start-Up, Operation, Service, and Troubleshooting book for information on configuring the modulating gas control.

Step 18 — Install Flue/Inlet Hoods

The flue/inlet hoods are shipped in a package taped to the basepan in the fan section. The flue (outlet) hoods are pre-assembled. The inlet hoods require assembly.

The hoods are to be installed on the heating section access panel as shown in Fig. 29. See Table 8 for a list of parts used to assemble each hood and quantities of each hood type used with each unit.

1. Remove shipping block-offs and shipping tape from all openings in the access panel.
2. Attach flue outlet hoods (see Fig. 29) to access panel using screws provided. Hoods are placed over each combustion outlet.
3. Inlet hoods are shipped unassembled and must be assembled on the access panel (see Fig. 30-32). Flanges of the hood top and sides should be installed on the inside of the access panel openings with the screws provided. The sides should be placed on the inside of the top hoods for all hood assemblies

(6 in. and 14 in.). Attach speed clips to screen. Insert screen into bottom opening of 6 in. and 14 in. hoods and secure it with 3 screws. Attach view port cover over 14 in. inlet hood opening (Fig. 32). Secure with two screws.

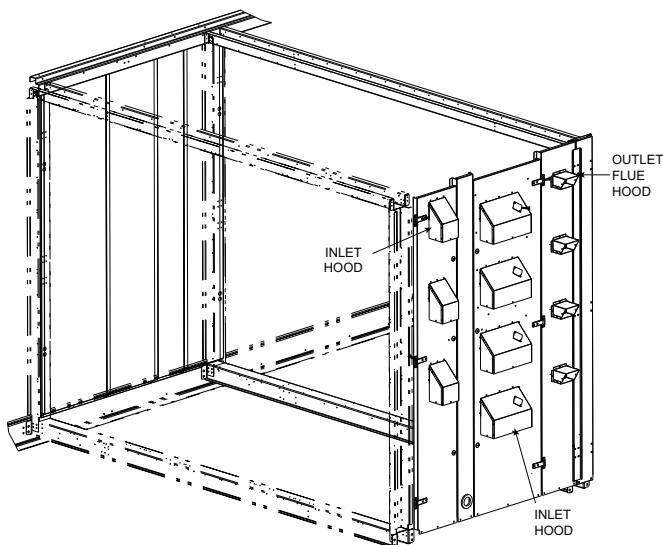


Fig. 29 — Flue/Inlet Hood Locations

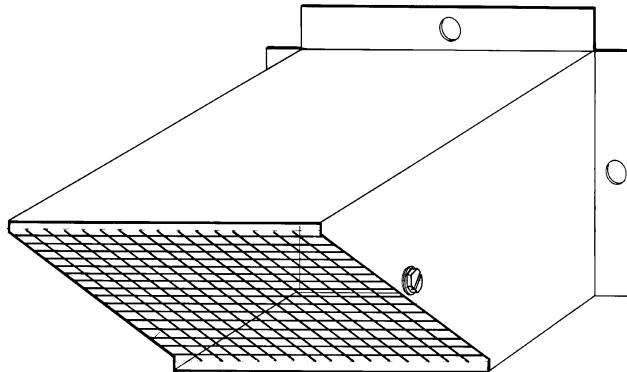


Fig. 30 — Flue Outlet Hood

Table 8 — Flue Hood and Inlet Hood Usage

HOOD TYPE	PART LIST	QUANTITY USED						
		Sizes 75-105 (Low Heat)	Size 75 (High Heat)	Sizes 90, 105 (Medium Heat)	Sizes 90, 105 (High Heat)	Sizes 120-150 (Low Heat)	Sizes 120-150 (Medium Heat)	Sizes 120-150 (High Heat)
6 in. Inlet Hood	Top (6 in.) Side (Left) Side (Right) Screen Speed Clips Screws	—	—	—	—	3	3	3
14 in. Inlet Hood	Top (14 in.) Side (Left) Side (Right) Screen Speed Clips Screws View Port Cover	2	3	3	4	3	4	4
Flue Outlet Hood	Pre-assembled	2	3	3	4	3	4	5

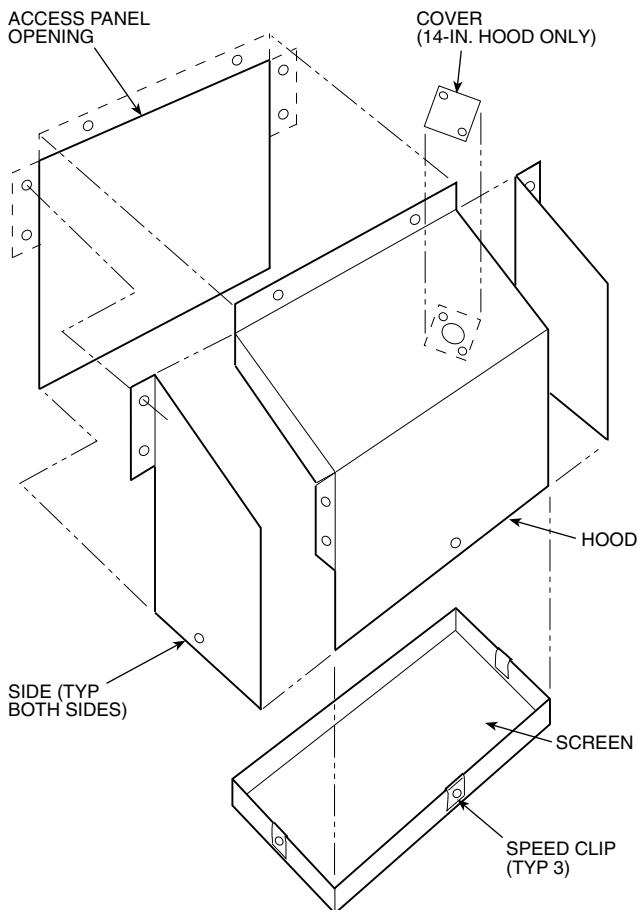


Fig. 31 — Inlet Hood Assembly (6 in. and 14 in.)

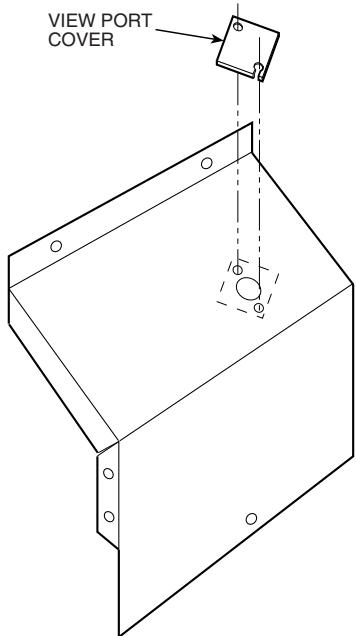


Fig. 32 — Inlet Hood View Port Cover Installation (14 in.)

Step 19 — Install Supply-Air Thermistors (Modulating Gas Units Only)

Supply-air thermistors are a field-installed, factory-provided component. Three supply-air thermistors are shipped with modulating gas units inside the unit control box. Thermistor wires must be connected to the SGC (staged gas control) in the unit control box.

See Table 9. The supply-air thermistors should be located in the supply duct with the following criteria:

- downstream of the heat exchanger cells
- equally spaced as far as possible from heat exchanger cells
- a duct location where none of the supply air thermistors are within sight of the heat exchanger cells
- a duct location with good mixed supply air

Step 20 — Install Unit Accessories

For applications requiring accessories, the following packages are available:

All units:

- space temperature sensor
- CO₂ sensor
- space temperature sensor with CO₂ sensor
- airflow switch
- filter switch
- smoke detector

Refer to the individual accessory installation instructions in each accessory package for information on installing accessories.

Two-Piece Unit Fit Up

1. Locate and remove split parts package from return section of unit. Open package and remove split unit parts. See Tables 10 and 11 for parts list.
2. Rig main unit section and return section separately.
3. Do not assemble main unit section and return section on ground and attempt to lift. Unit pieces must be assembled on roof curb.
4. Insert base rail guides into the base rails of the main unit section. Do not attach with screws yet. See Fig. 33 and 34.
5. Insert top rail guides into top rails of the main unit section. Do not attach with screws yet. See Fig. 34 and 35.
6. Rig and set the main unit section on the unit roof curb. Align the unit bulkhead with the supply opening in the roof curb.
7. Remove the roof cap, top cover and L brackets from the filter end of the return section. Save these parts for later installation. See Fig. 36 and 37.
8. Rig and set return section onto the roof curb using rail guides as an alignment aid. The return section must be within 2 in. of the main unit section. Slide base rail and top rail guides from main unit section rails partially into return section rails.
9. Install tar tape on edge of main unit base rails to seal base rail splice. See Fig. 38.
10. Using 3/4 in. x 30 in. threaded rod, nuts, washers and backing plates provided, pull and secure the base rails together. See Fig. 39.
11. Attach (4) brackets to top rails. Using 3/8 in. x 6 in. threaded rods, nuts, washers and backing plates provided, pull the top rails together and secure with top rail guide from Step 5. See Fig. 40. Remove threaded rods and brackets after securing top rail guide.
12. Place seal strip along both sides of basepan joint. Attach basepan covers to basepan joint. See Fig. 41.
13. Install L brackets, top cover and top cap joining main unit section and return section top cover assemblies. See Fig. 42 and 43.
14. Connect control wiring plugs located at unit split. All same color plugs should be connected together.

On units equipped with return air fan or power exhaust fan option, locate black, yellow, and blue power wires located at the split in main section. Run the wires through the grommet below the return air filters and through the grommet at the economizer damper. See Fig. 44. Run wires through wire

trays, separate from control wires, to the return fan/power exhaust fan VFD on back wall of return section. Connect wires to VFD power terminal connections: Black to UL1, Yellow to V1, and Blue to W1. On units equipped with VFD bypass option connect the wires to the power distribution in the VFD bypass box: Black to L1, Yellow to L2, and Blue to L3. See Fig. 45.

Connect air pressure tubes located at split. All same numbered tubes should be connected together. See Table 12 for tubes associated with unit options.

15. Install side post on far side of unit. See Fig. 46.
16. Install side panels at main unit section/return section split. Install panel side brackets, 2 on each panel. See Fig. 46.

Table 9 — SGC Thermistor Designations

THERMISTOR	PIN CONNECTION POINT	FUNCTION AND LOCATION		PART NO.
		Thermistors		
SAT1	J8 – 1,2 (SGC)	Supply-Air Thermistor (SAT) — Inserted into supply section underneath the gas heat section (factory-provided, field-installed)		HH79NZ034
SAT2	J8 – 3,4 (SGC)	Supply-Air Thermistor (SAT) — Inserted into supply section underneath the gas heat section (factory-provided, field-installed)		
SAT3	J8 – 5,6 (SGC)	Supply-Air Thermistor (SAT) — Inserted into supply section underneath the gas heat section (factory-provided, field-installed)		
LIMTEMP	J8 – 15,16 (SGC)	Limit switch Thermistor (LIMTEMP) — Inserted next to the lower limit switch (factory-installed)		

Table 10 — 75-105 Nominal Ton Units Parts List

ITEM	COMPONENT NUMBER	QUANTITY	COMPONENT NAME	COMPONENT QUALIFIER
1	48NG501939	2	RAIL,MOUNTING	SPLIT,BASE,GUIDE
2	48NG501935	2	ROD,THREADED	3/4-10 UNC 2A 30 in. L
3	48NG501937	8	WASHER,PLATE	3/4 in. LRT SPLIT
4	AU02AB361	4	WASHER,FLAT	3/4
5	AT11AB361	6	NUT,HEAVY HEX	3/4-10
6	48NG501938	4	BRACKET,TIE	LRT SPLIT TOP
7	AL48AM307	12	SCREW,HEXHD SR	1/4 X 5/8
8	48NG501936	2	ROD,THREADED	3/8-16 UNC 2A 6" L
9	AU02AB242	4	WASHER,FLAT	3/8
10	AT39AB241	4	NUT,HEX	3/8-16
11	48NG501940	1	PLATE,COVER	SPLIT,BASEPAN
12	48NG501941	1	PLATE,COVER	SPLIT,BASEPAN
15	AL31AY308	34	SCREW	
16	AL79AU216	2	SCREW,HEXHD TF	#10 X 1/2
17	48NG401017	1	POST ASSY,SIDE	6 in. (75-105 T)
18	48NG401072	2	PANEL ASSY,SIDE	12 in. (75-105 T)
19	48NG501897	3	BRACKET,PANEL	SKIN JOINT 75-105T
21	AA06BS168	40	BOLT,HEXHD	1/4 X 0.75
28	AL56ZA003	42	SCREW	1/4 AB-14 X 5/8 in. SERR.
31	99SR120216142001	2	SEAL STRIP	
33	48NG501629	2	PLATE	JOIN SPLIT UNITS
40	PF0144	3	SEALER,PRESTITE	2 in. WIDE ROLL

Table 11 — 120-150 Nominal Ton Units Parts List

ITEM	COMPONENT NUMBER	QUANTITY	COMPONENT NAME	COMPONENT QUALIFIER
1	48NG501939	2	RAIL, MOUNTING	SPLIT,BASE,GUIDE
2	48NG501935	2	ROD, THREADED	3/4-10 UNC 2A 30 in. L
3	48NG501937	8	WASHER, PLATE	3/4 in. LRT SPLIT
4	AU02AB361	4	WASHER, FLAT	3/4
5	AT11AB361	6	NUT, HEAVY HEX	3/4-10
6	48NG501938	4	BRACKET, TIE	LRT SPLIT TOP
7	AL48AM307	12	SCREW, HEXHD SR	1/4 X 5/8
8	48NG501936	2	ROD, THREADED	3/8-16 UNC 2A 6 in. L
9	AU02AB242	4	WASHER, FLAT	3/8
10	AT39AB241	4	NUT, HEX	3/8-16
11	48NG501940	1	PLATE, COVER	SPLIT,BASEPAN
12	48NG501941	1	PLATE, COVER	SPLIT,BASEPAN
15	AL31AY308	34	SCREW	
16	AL79AU216	2	SCREW, HEXHD TF	#10 X 1/2
17	48NG401018	1	POST ASSY, SIDE	6 in. (120-150 T)
18	48NG401070	2	PANEL ASSY, SIDE	12 in. (120-150 T)
19	48NG501896	3	BRACKET, PANEL	SKIN JOINT 120-150T
20	48NG500998	2	HANDLE	
21	AA06BS168	40	BOLT, HEXHD	1/4 X 0.75
38	AL56ZA003	42	SCREW	1/4 AB-14 X 5/8 in. SERR.
33	48NG501629	2	PLATE	JOIN SPLIT UNITS
40	PF0144	3	SEALER, PRESTITE	2 in. WIDE ROLL

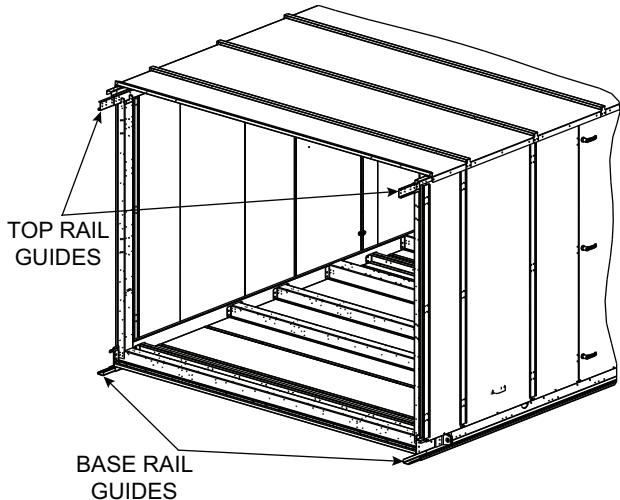


Fig. 33 — Base and Top Rail Guide Locations

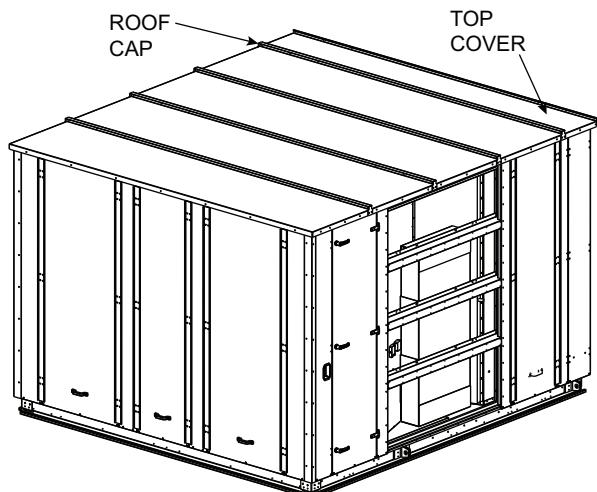


Fig. 36 — Roof Cap and Top Cover Removal

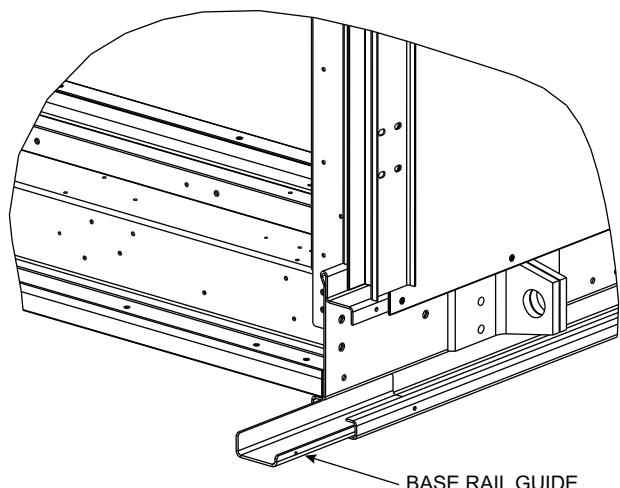


Fig. 34 — Base Rail Guide

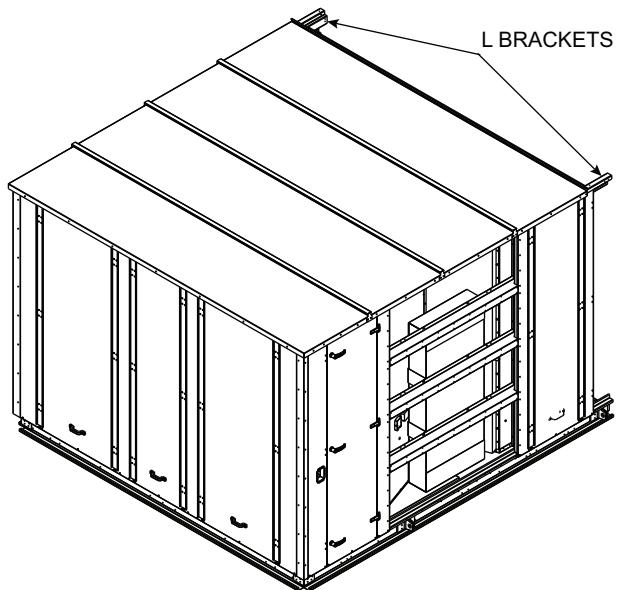


Fig. 37 — L Bracket Removal

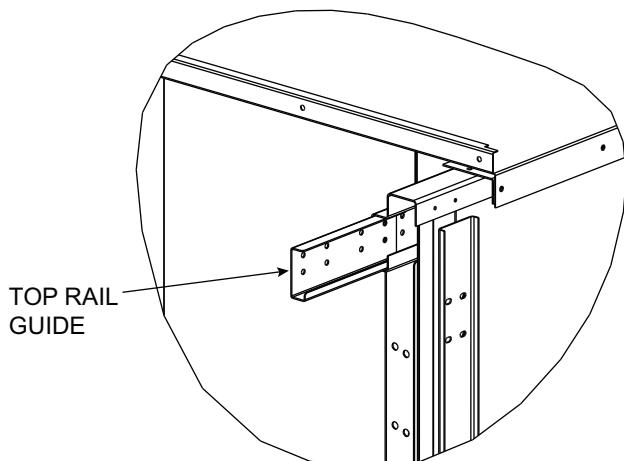


Fig. 35 — Top Rail Guide

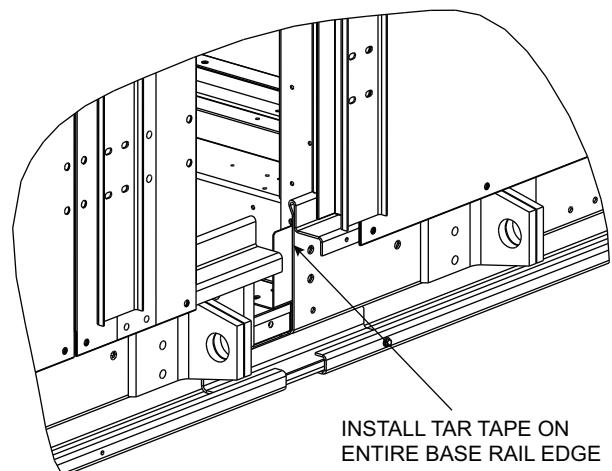


Fig. 38 — Tar Tape Location

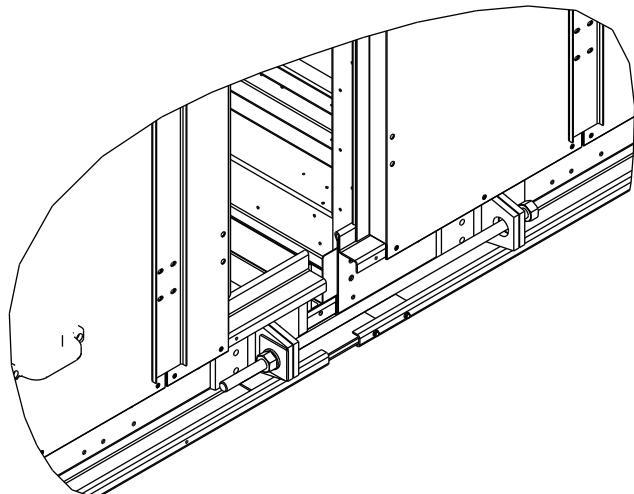


Fig. 39 — Secure Base Rails

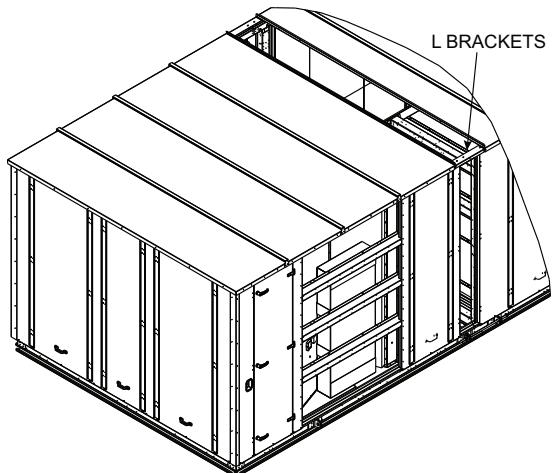


Fig. 42 — L Bracket Installation

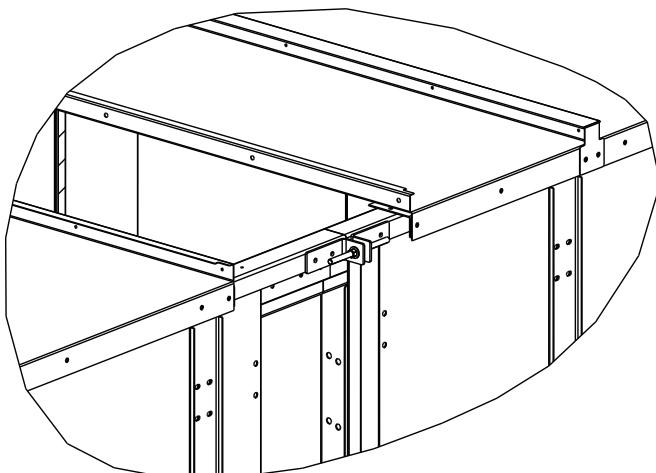


Fig. 40 — Top Rail Brackets

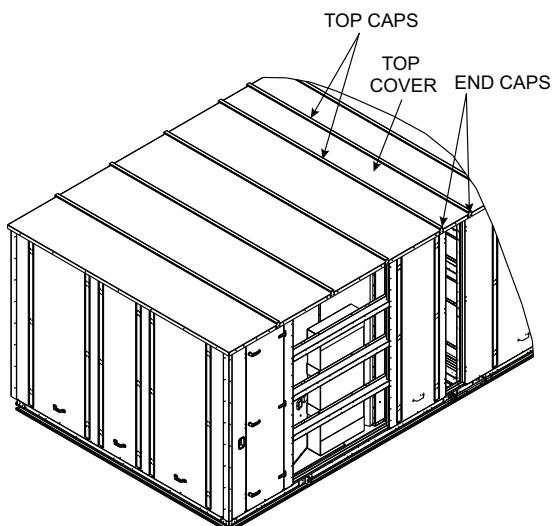


Fig. 43 — Main Unit and Return Section Top Cover Assemblies

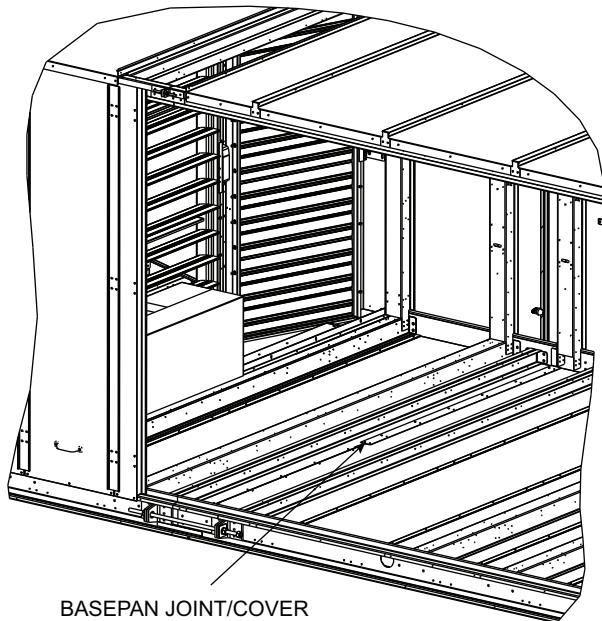


Fig. 41 — Basepan Joint/Cover

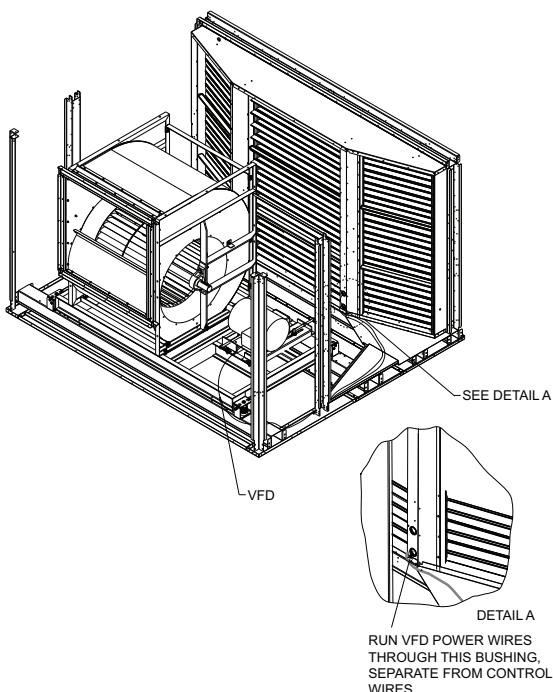


Fig. 44 — Wire Routing

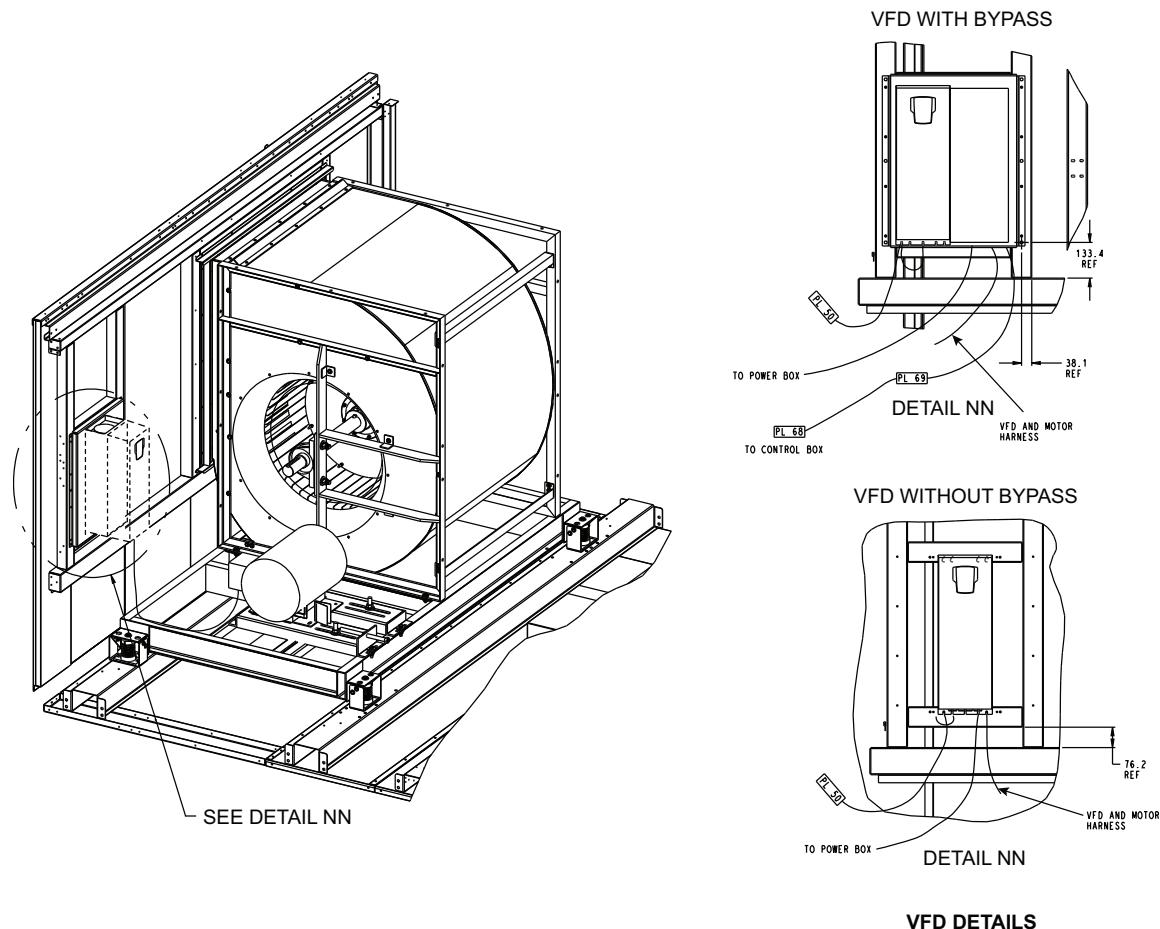


Fig. 45 — Return Section Component Locations

Table 12 — Air Pressure Tube Connections

OPTION	CONTROL	TUBE NUMBER
Return Air Fan	RACFM Control PPSS	4, 5 and 6
Power Exhaust Fan with CFM Sensor	EACFM Control	5 and 6

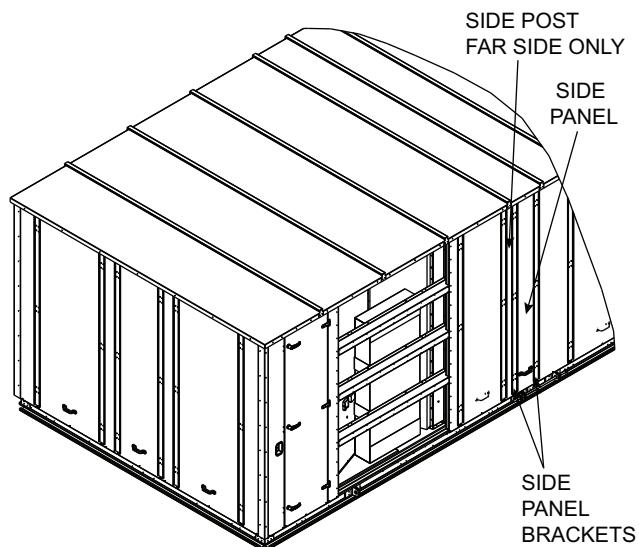


Fig. 46 — Side Post and Panel Installation

CONTROLS INSTALLATION

Constant Volume / Staged Air Volume Units

The 48N units may be used in applications with additional control features, options, or accessories. Refer to the appropriate accessory installation instructions for more information on installing that accessory. Control options and accessories available for Constant Volume (CV) / Staged Air Volume (SAV™) units are:

- thermostats
- differential enthalpy sensor
- return air humidity sensor
- outdoor air humidity sensor
- relative humidity space sensor
- CO₂ sensors
- fan status switch
- filter pressure transducer
- return smoke detector
- CEM (controls expansion module)
- EXB (economizer control board) module

CONTROL WIRING

The unit can be controlled with a Carrier-approved accessory electro-mechanical or electronic thermostat that has two stages of cooling, two stages of heating control, and an output for fan control. The thermostat may also include time of day scheduling or use scheduling routines built into the *ComfortLink* controls.

Install the thermostat according to the installation instructions shipped with the accessory thermostat. Locate thermostat assembly on a solid interior wall to sense average temperature.

Route thermostat cable or equivalent leads of colored wire from subbase terminals through conduit into the low voltage connections in the main control box. For thermostat TB201 connections, see Fig. 47.

NOTE: For wire runs up to 50 ft, use no. 18 AWG (American Wire Gauge) insulated wire (35°C minimum). For over 75 ft, use no. 14 AWG insulated wire (35°C minimum). All wire larger than no. 18 AWG cannot be directly connected at the thermostat and will require a junction box and splice at the thermostat.

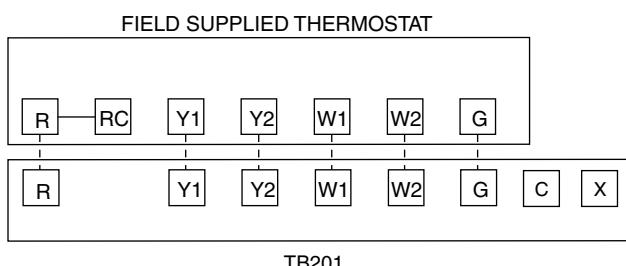


Fig. 47 — Field Control Thermostat Wiring

Variable Air Volume Units

The 48N units may be used in applications with additional control features, options, or accessories. Refer to the appropriate accessory installation instructions for more information on installing that accessory. Refer to the Controls and Troubleshooting manual for more information concerning installation and configuration of options and accessories. Control options and accessories available for Variable Air Volume (VAV) units are:

- thermostats
- differential enthalpy sensor
- return air humidity sensor
- outdoor air humidity sensor
- relative humidity space sensor
- CO₂ sensors

- fan status switch
- filter pressure transducer
- return smoke detector
- CEM (controls expansion module)
- EXB (economizer control board) module

VAV CONTROL WIRING

The recommended types of control wiring are shown below:

MANUFACTURER	PART NO.	
	Regular Wiring	Plenum Wiring
Alpha	1895	—
American	A21451	A48301
Belden	8205	884421
Columbia	D6451	—
Manhattan	M13402	M64430
Quabik	6130	—

SENSORS

Sensors should be wired using single twisted pairs of 20 AWG (American Wire Gauge) conductor cable rated for the application, except for the T-56 accessory sensor which requires 3-conductor cable.

HUMIDITY CONTROL AND HOT WATER AND STEAM VALVES

These devices require 20 AWG twisted pair conductor cables rated for the application for the 4 to 20 mA signal.

SPACE TEMPERATURE SENSOR (T-55)

The space temperature sensor (P/N 33ZCT55SPT), if used, is wired to terminals in the unit main control box. To connect the space temperature sensor, see Fig. 48.

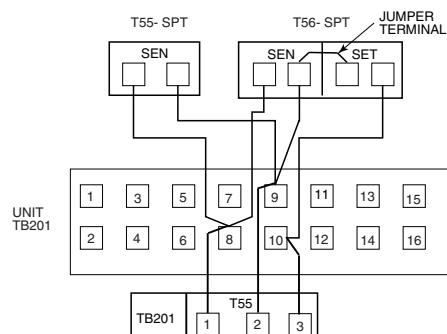


Fig. 48 — T-55 or T-56 Wiring

SPACE TEMPERATURE SENSOR (T-56)

The space temperature sensor (P/N 33ZCT56SPT), if used, is wired to terminals in the unit main control box. To connect the space temperature sensor, see Fig. 48.

SPACE TEMPERATURE SENSOR (T-58)

The communicating space temperature sensor (P/N 33ZCT58SPT) is wired to the Carrier Comfort Network® (CCN) connections on TB202.

SPACE TEMPERATURE AVERAGING

Applications that require averaging using multiple space temperature sensors can be satisfied using either 4 or 9 sensors as shown in Fig. 49.

NOTE: Only Carrier sensors may be used for standard T-55 space averaging. Sensors must be used in multiples of 1, 4, and 9 only, with total sensors wiring not to exceed 1000 ft.

NOTE: Do not use T-56 sensors for space temperature averaging because the 5-degree offset function will not work in a multiple sensor application.

HEAT INTERLOCK RELAY (VAV UNITS ONLY)

The heat interlock relay is not necessary for digital air volume applications.

Variable air volume (VAV) units using morning warm-up and/or occupied heating require that room terminals be controlled to a position that provides the minimum required heating cfm or greater when the unit goes into Heating mode. The HIR (heat interlock relay) function is provided for this control. When the unit goes into Heating mode, the HIR is energized to provide switch closure or opening (depending on how the field-supplied power source is set up) to open the room terminals. The field connections for the HIR are at TB201 terminals 9 and 10. See Fig. 50.


Option and Accessory Control Wiring

The 48N Series units may be used in applications with additional control features, options, or accessories. Refer to the Controls, Start-Up, Operation, Service and Troubleshooting manual for more information concerning installation and configuration of options and accessories.


See Fig. 50-60 for wiring information on the following features:

- heat interlock relay (Fig. 50)
- outdoor air enthalpy switch (Fig. 51)
- CO₂ space sensor (Fig. 52)
- filter status switch (Fig. 53)
- fan status switch (Fig. 54)
- space humidity sensor (Fig. 55)
- return air humidity sensor (Fig. 55)
- return air CO₂ sensor (Fig. 56)
- return air smoke detector (Fig. 57)
- smoke control — fire shutdown (Fig. 58)
- smoke control — purge (Fig. 59)
- smoke control — evacuation (Fig. 59)
- smoke control — pressurization (Fig. 59)
- CCN connections (Fig. 60)

NOTE: When enabling these options in the control make sure the CEM or other required board were shipped in the unit. Otherwise the sensor will not function and communications errors to non-existent boards will result.

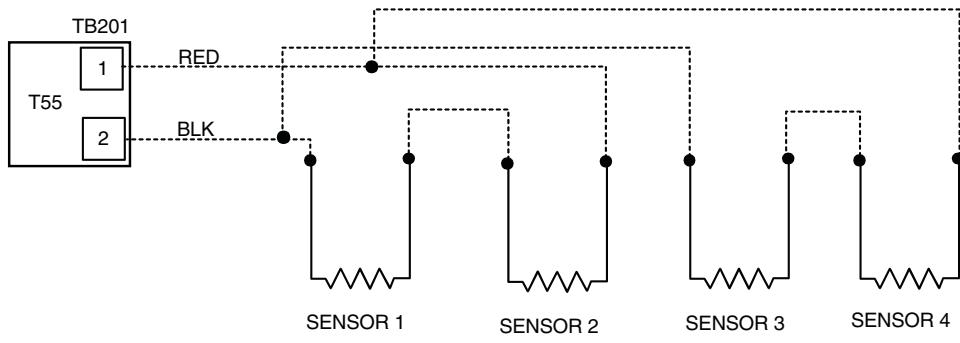

SPACE TEMPERATURE AVERAGING (4 SENSOR APPLICATION)

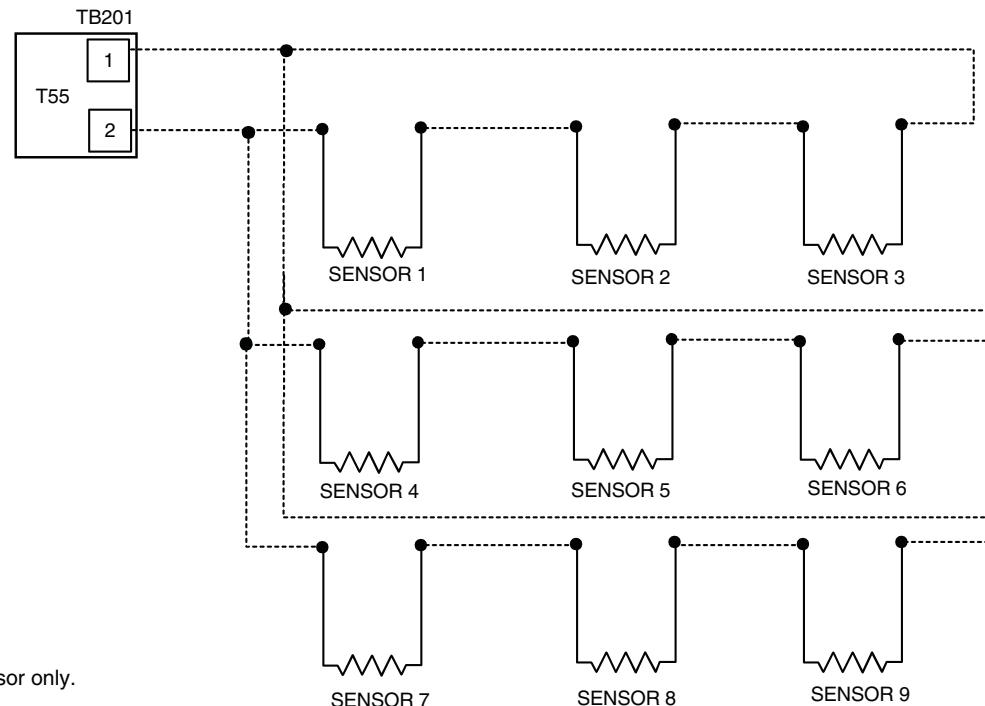

NOTE: Use T-55 sensor only.

SPACE TEMPERATURE AVERAGING (9 SENSOR APPLICATION)

Fig. 49 — Space Temperature Averaging Wiring

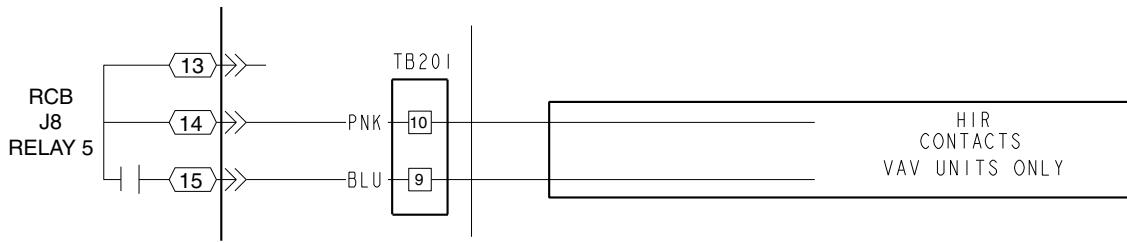


Fig. 50 — Heat Interlock Relay Wiring

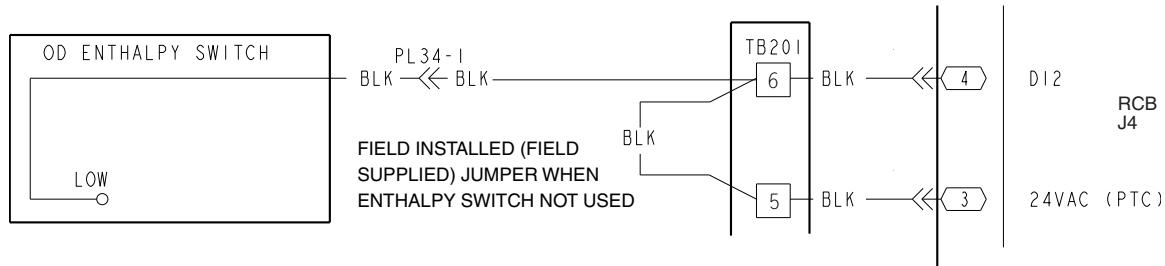


Fig. 51 — Outdoor Air Enthalpy Switch Wiring

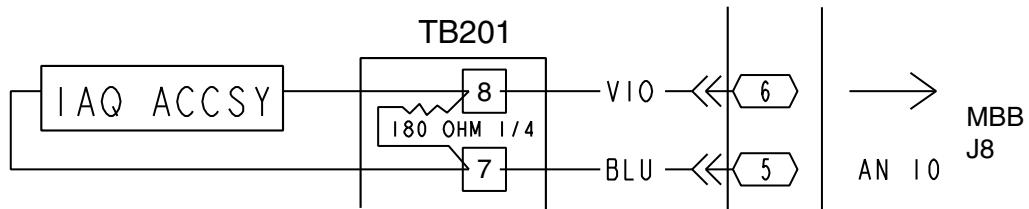


Fig. 52 — CO₂ Space Sensor Wiring

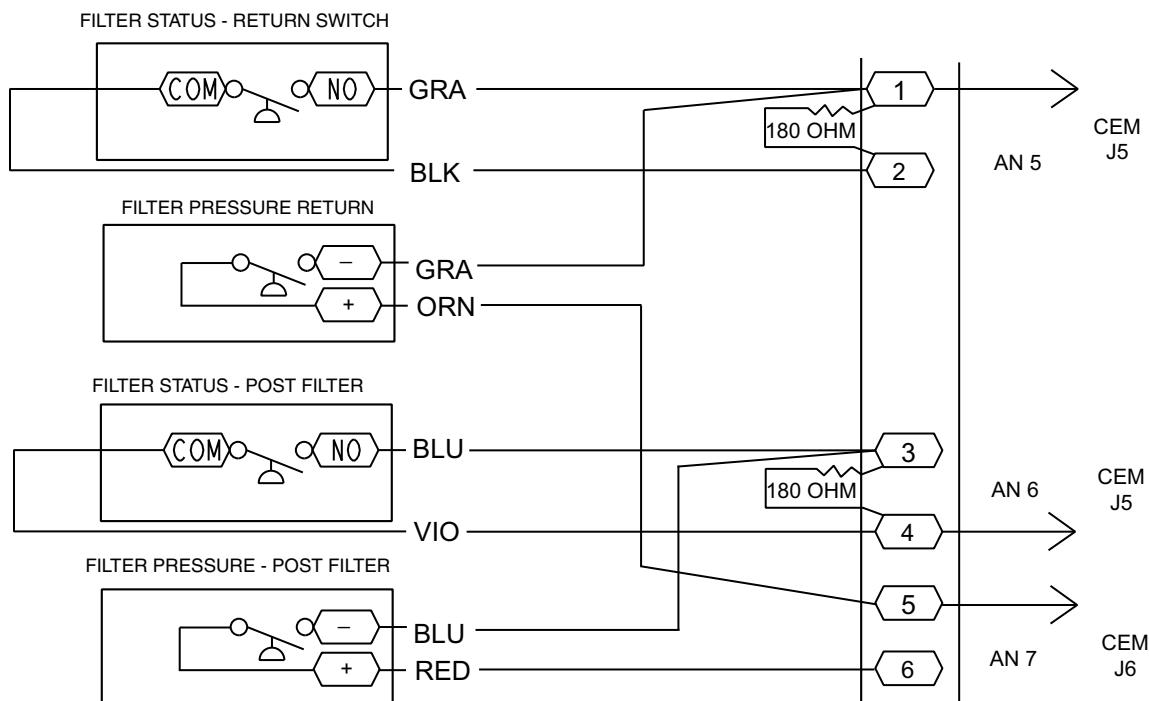


Fig. 53 — Filter Status Wiring

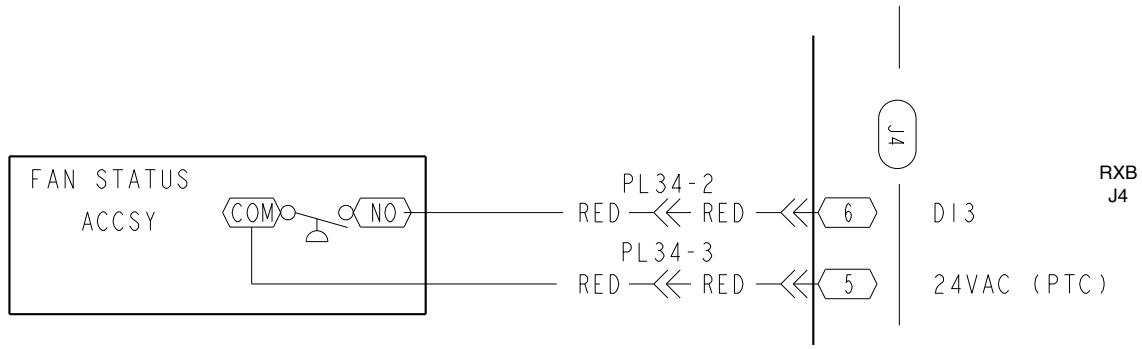


Fig. 54 — Fan Status Switch Wiring

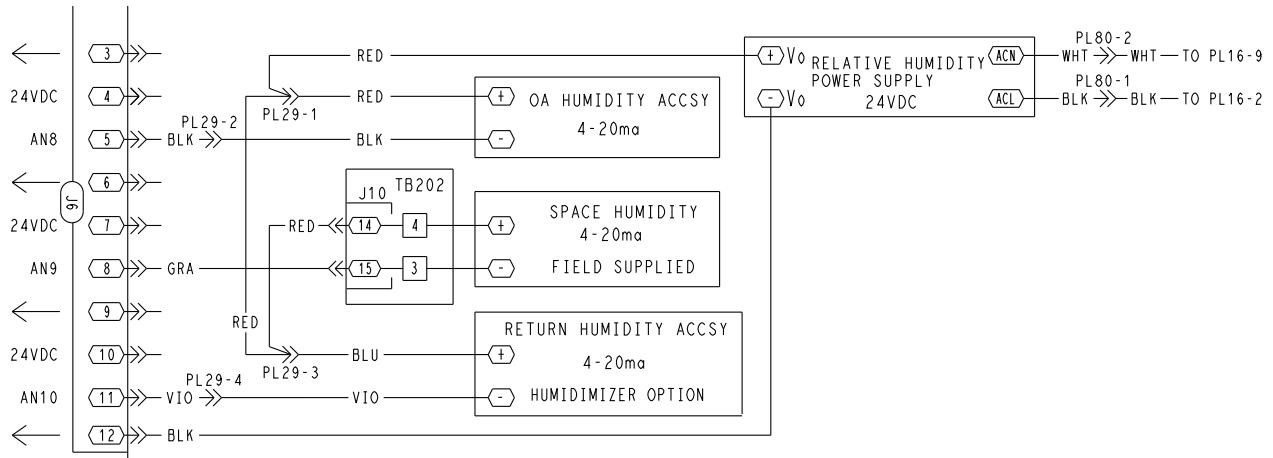


Fig. 55 — Space and Return Air Humidity Sensor Wiring

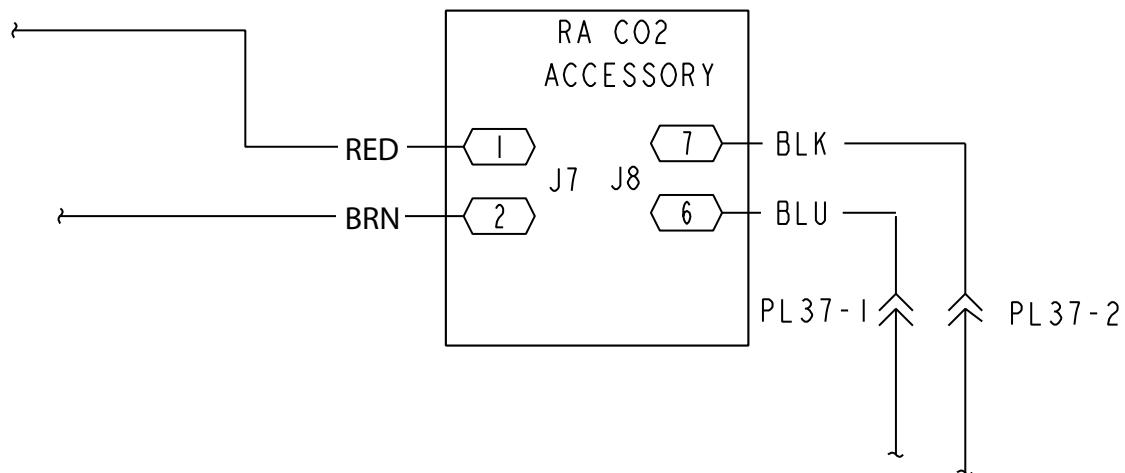


Fig. 56 — Return Air CO₂ Sensor Wiring

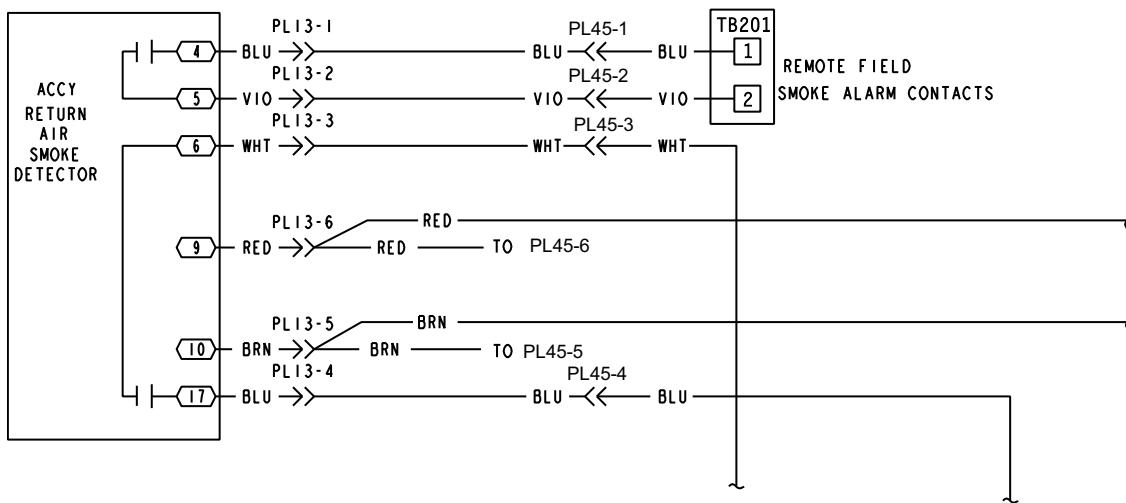


Fig. 57 — Return Air Smoke Detector Wiring

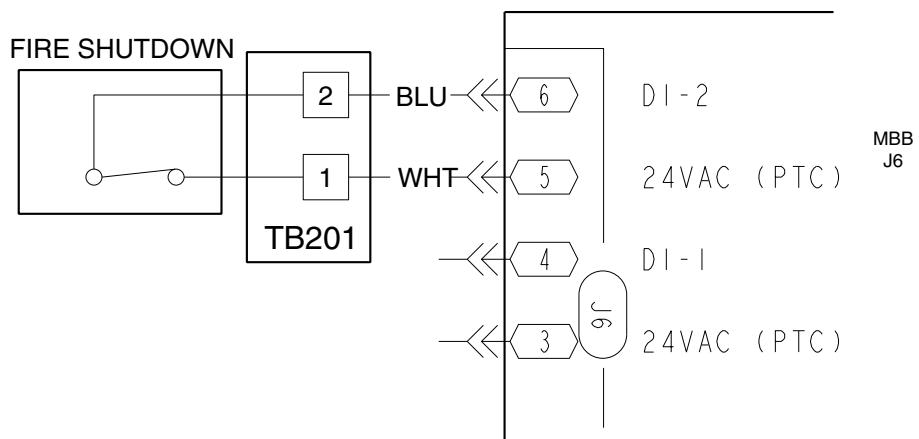


Fig. 58 — Fire Shutdown Wiring

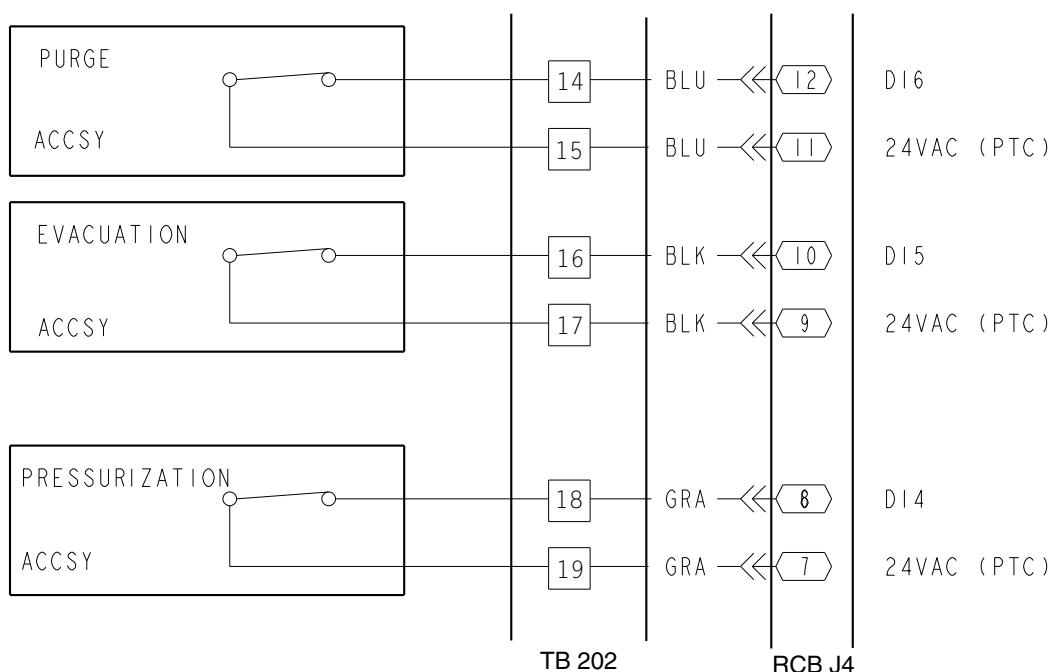


Fig. 59 — Purge, Evacuation, and Pressurization Wiring

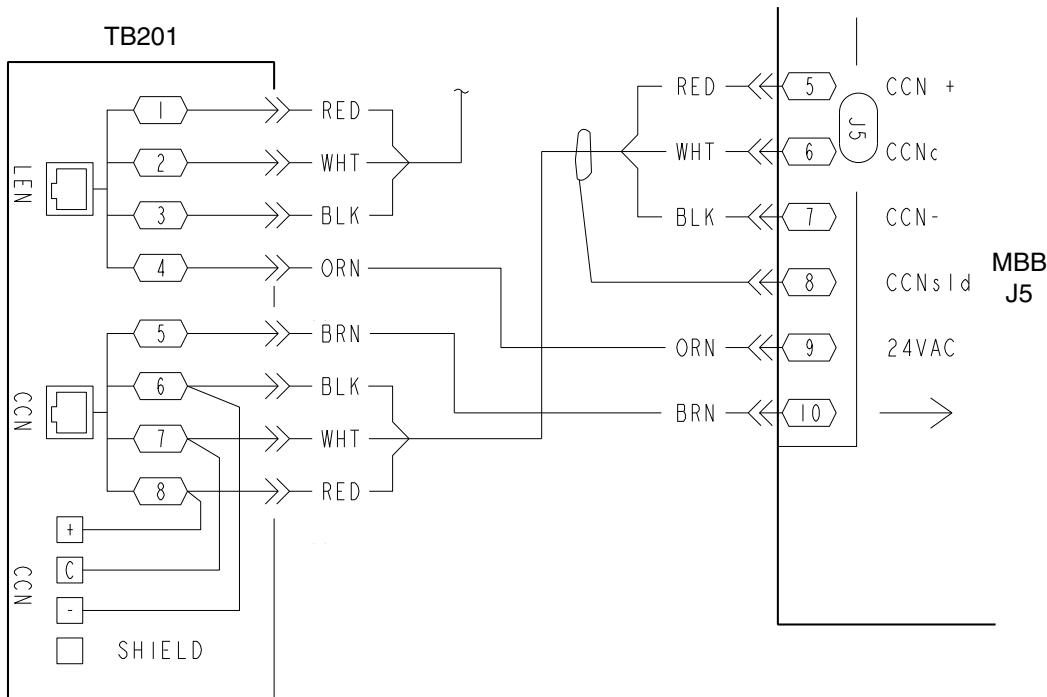


Fig. 60 — CCN Connections

Carrier Comfort Network® (CCN) Interface

The 48N Series units can be connected to the CCN system if desired. The communication bus wiring is supplied and installed in the field. It consists of shielded, 3-conductor cable with shield wire.

The system elements are connected to the communication bus in a daisy chain arrangement. The positive pin of each system element communication connector must be wired to the positive pins of the system element on either side of it, the negative pins must be wired to the negative pins, and the signal pins must be wired to common pins. Wiring connections for the CCN system should be made at the terminal block using the screw terminals. The board also contains an RJ14 CCN plug that can be used to connect a field service computer. There is also another RJ14 LEN (Local Equipment Network) connection that is used to download software or connect a Navigator™ device.

NOTE: Conductors and drain wire must be 20 AWG minimum stranded, tinned copper. Individual conductors must be insulated with PVC, PVC/nylon, vinyl, Teflon¹, or polyethylene. An aluminum/polyester 100% foil shield and an outer jacket of PVC, PVC/nylon, chrome vinyl, or Teflon with a minimum operating temperature range of -4 to 140°F (-20°C to 60°C) is required. See Table 13 for cables that meet the requirements.

Table 13 — CCN Connection Approved Shielded Cables

MANUFACTURER	CABLE PART NO.
Alpha	2413 or 5463
American	A22503
Belden	8772
Columbia	02525

IMPORTANT: When connecting the CCN communication bus to a system element, use a color coding system for the entire network to simplify installation and checkout.

The following color code is recommended:

SIGNAL TYPE	CCN BUS CONDUCTOR INSULATION COLOR	COMM1 PLUG PIN NO.
+	RED	1
COMMON	WHITE	2
-	BLACK	3

NOTE: If a cable with a different color scheme is selected, a similar color code should be adopted for the entire network.

At each system element, the shields of its communication bus cables must be tied together. If the communication bus is entirely within one building, the resulting continuous field must be connected to a ground at one point only. If the communication bus cable exits from one building and enters another, the shields must be connected to grounds at the lightning suppressor in each building where the cable enters or exits the building (one point per building only).

To connect the unit to the network (Fig. 60):

1. Turn off power to the control box.
2. Cut the CCN wire and strip the ends of the red (+), white (common) and black (-) conductors. (If a different network color scheme is used, substitute appropriate colors.)
3. Wire the CCN to the screw terminals on the COMM board as follows:
 - a. Secure the red (+) wire to CCN screw terminal + on the COMM board.
 - b. Secure the white (common) wire to CCN screw terminal C on the COMM board.
 - c. Secure the black (-) wire to CCN screw terminal - on the COMM board.
 - d. Secure shield wire to CCN screw terminal SHIELD on the COMM board.

1. Teflon is a registered trademark of DuPont.

IMPORTANT: A shorted CCN bus cable will prevent some routines from running and may prevent unit from starting. If abnormal conditions occur, unplug the connector. If conditions return to normal, check CCN connector, and run new cable if necessary. A short in one section of the bus can cause problems with all system elements on the bus.

Optional UPC Open Installation

WIRING THE UPC OPEN TO THE MS/TP NETWORK

The UPC Open controller communicates using BACnet¹ on an MS/TP network segment communications at 9600 bps, 19.2 kbps, 38.4 kbps, or 76.8 kbps.

Wire the controllers on an MS/TP network segment in a daisy-chain configuration. Wire specifications for the cable are 22 AWG (American Wire Gauge) or 24 AWG, low-capacitance, twisted, stranded, shielded copper wire. The maximum length is 2000 ft.

Install a BT485 terminator on the first and last controller on a network segment to add bias and prevent signal distortions due to echoing. See Fig. 61-63.

To wire the UPC Open controller to the BAS network:

1. Pull the screw terminal connector from the controller's BAS Port.
2. Check the communications wiring for shorts and grounds.
3. Connect the communications wiring to the BAS port's screw terminals labeled Net +, Net -, and Shield.
4. Insert the power screw terminal connector into the UPC Open controller's power terminals if they are not currently connected.
5. Verify communication with the network by viewing a module status report. Use Field assistant to set up the

1. BACnet is a trademark of ASHRAE.

UPC, then perform a Modstat using the i-Vu tools Field Assistant.

To install a BT485 terminator, push the BT485 on to the BT485 connector located near the BACnet connector.

NOTE: The BT485 terminator has no polarity associated with it.

To order a BT485 terminator, consult Commercial Products i-Vu® Open Control System Master Prices.

MS/TP WIRING RECOMMENDATIONS

Recommendations are shown in Tables 14 and 15. The wire jacket and UL temperature rating specifications list two acceptable alternatives. The Halar² specification has a higher temperature rating and a tougher outer jacket than the SmokeGard³ specification, and it is appropriate for use in applications where the user is concerned about abrasion. The Halar jacket is also less likely to crack in extremely low temperatures.

NOTE: Use the specified type of wire and cable for maximum signal integrity.

USING ZS SENSOR OR EQUIPMENT TOUCH

The ZS sensors or Equipment Touch will connect to the UPC via the UPC's RNET connector. Be sure to follow the ZS sensor and Equipment Touch installation instructions available for the specific devices being used.

If the ZS sensor will provide space temperature feedback for equipment operation, then the control mode to best use for the equipment is Space temperature multi. Otherwise be aware of the differences in mode trip of the rooftop product vs. the displayed setpoint microblock.

If use linkage is set to Yes in the UPC, then the ZS sensor values will only be displayed in the Linkage values shared between the UPC and the RTU. When set to No, the SPT of the RTU will be forced and the setpoint microblock and the RTU's Occupied and Unoccupied setpoints will be shared values.

2. Halar is a registered trademark of Solvay Plastics.

3. SmokeGard is a trademark of AlphaGary-Mexichem Corp.

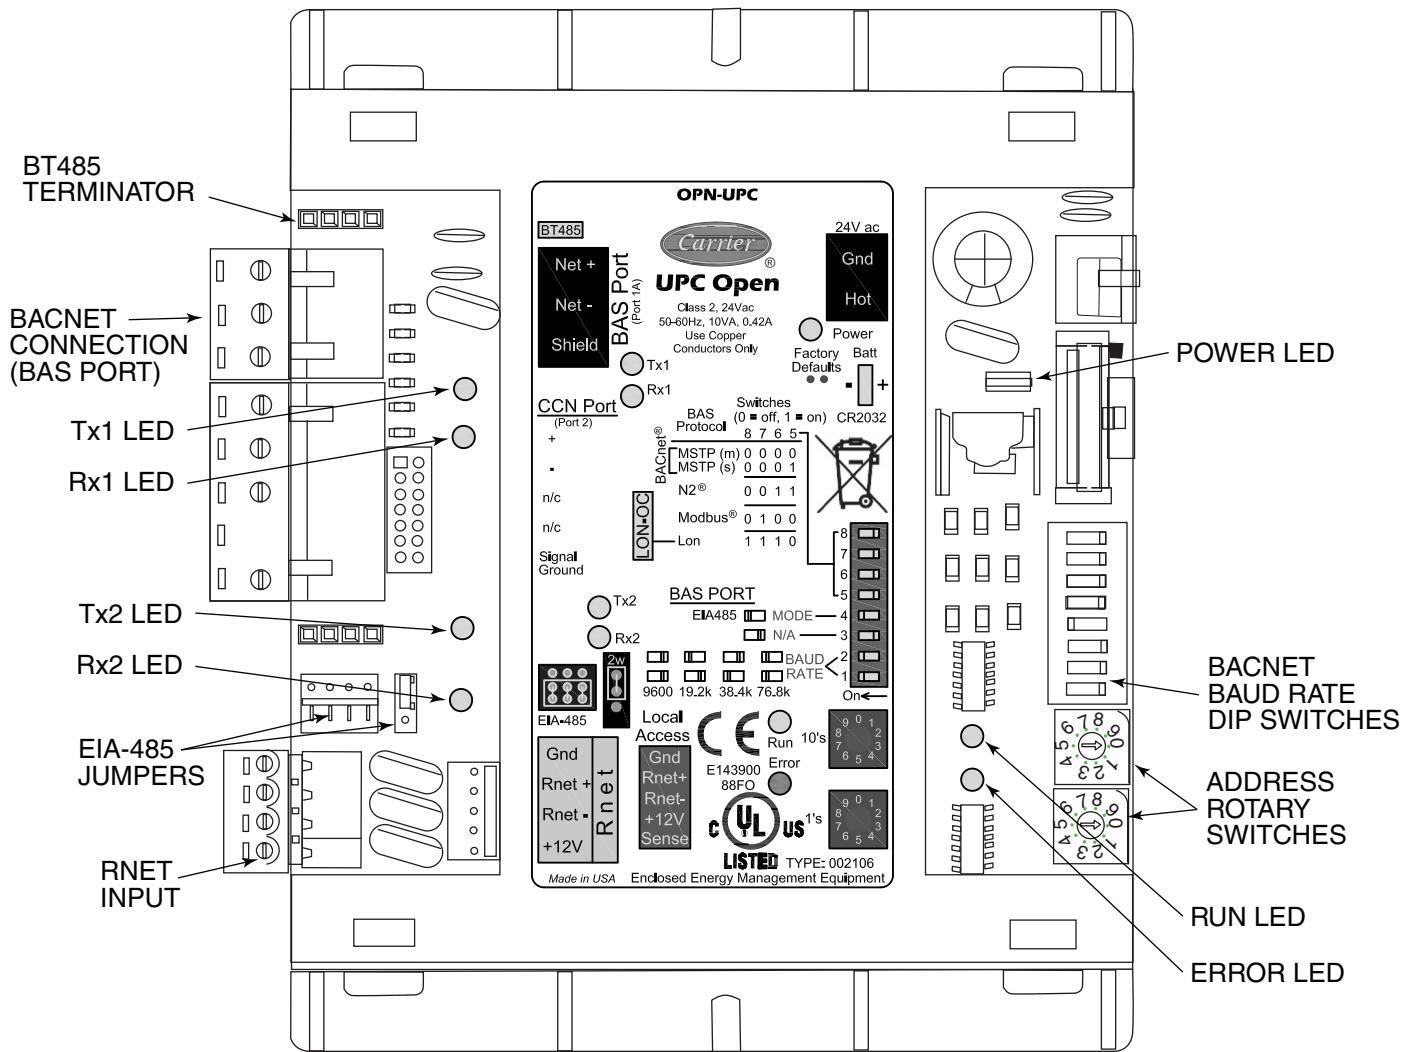


Fig. 61 — UPC Open Controller

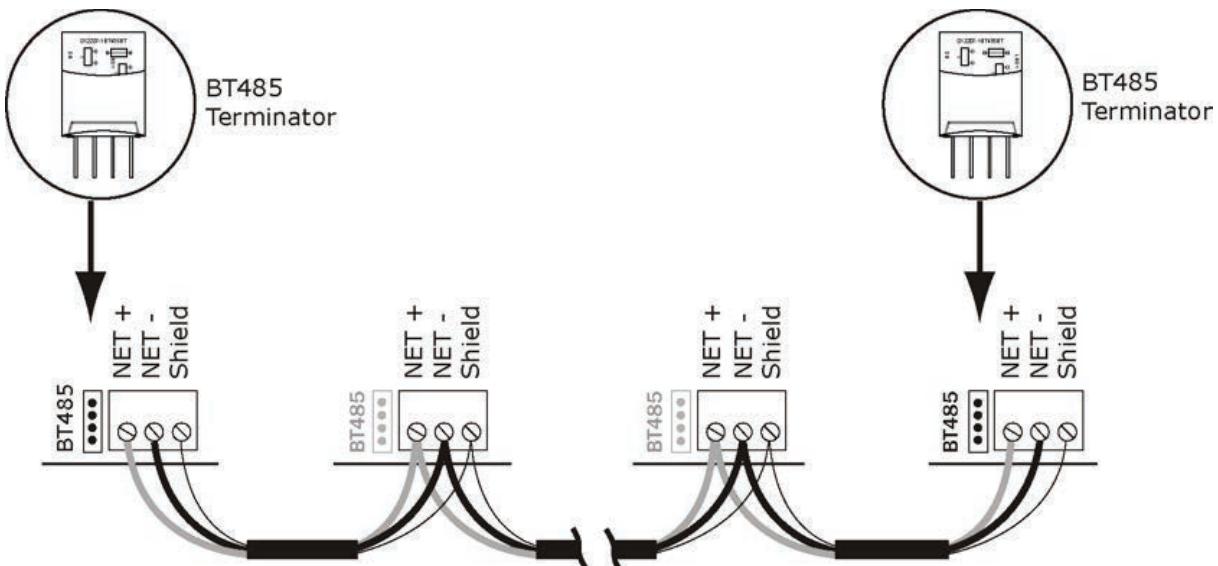


Fig. 62 — Open System Network Wiring

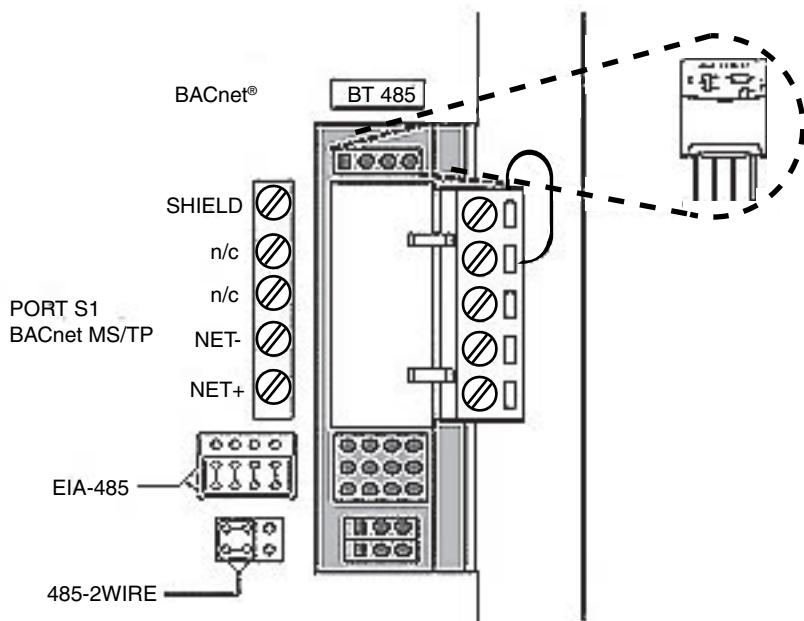


Fig. 63 — BT485 Installation

Table 14 — MS/TP Wiring Recommendations

SPECIFICATION	RECOMMENDATION
Cable	Single twisted pair, low capacitance, CL2P, 22 AWG (7x30), TC foam FEP, plenum rated cable
Conductor	22 or 24 AWG stranded copper (tin plated)
Insulation	Foamed FEP 0.015 in. (0.381 mm) wall 0.060 in. (1.524 mm) O.D.
Color Code	Black/White
Twist Lay	2 in. (50.8 mm) lay on pair 6 twists/foot (20 twists/meter) nominal
Shielding	Aluminum/Mylar shield with 24 AWG TC drain wire
Jacket	SmokeGard Jacket (SmokeGard PVC) 0.021 in. (0.5334 mm) wall 0.175 in. (4.445 mm) O.D. Halar Jacket (E-CTFE) 0.010 in. (0.254 mm) wall 0.144 in. (3.6576 mm) O.D.
DC Resistance	15.2 Ohms/1000 feet (50 Ohms/km) nominal
Capacitance	12.5 pF/ft (41 pF/meter) nominal conductor to conductor
Characteristic Impedance	100 Ohms nominal
Weight	12 lb/1000 feet (17.9 kg/km)
UL Temperature Rating	SmokeGard 167°F (75°C) Halar -40 to 302°F (-40 to 150°C)
Voltage	300 Vac, power limited
Listing	UL: NEC CL2P, or better

LEGEND

AWG	— American Wire Gauge
CL2P	— Class 2 Plenum Cable
DC	— Direct Current
FEP	— Fluorinated Ethylene Polymer
NEC	— National Electrical Code
O.D.	— Outside Diameter
TC	— Tinned Copper
UL	— Underwriters Laboratories

Table 15 — Open System Wiring Specifications and Recommended Vendors

Wire Type	WIRING SPECIFICATIONS	RECOMMENDED VENDORS AND PART NUMBERS			
		Connect Air International	Belden	RMCORP	Contractors Wire and Cable
MS/TP Network (RS-485)	22 AWG, single twisted shielded pair, low capacitance, CL2P, TC foam FEP, plenum rated. See MS/TP Installation Guide for specifications.	W221P-22227	—	25160PV	CLP0520LC
	24 AWG, single twisted shielded pair, low capacitance, CL2P, TC foam FEP, plenum rated. See MS/TP Installation Guide for specifications.	W241P-2000F	82841	25120-OR	—
Rnet	4 conductor, unshielded, CMP, 18 AWG, plenum rated.	W184C-2099BLB	6302UE	21450	CLP0442

LEGEND

AWG	— American Wire Gauge
CL2P	— Class 2 Plenum Cable
CMP	— Communications Plenum Rated
FEP	— Fluorinated Ethylene Polymer
TC	— Tinned Copper

Smoke Control Modes

Rooftop units can be used for aid in building smoke control in the event of a building fire. The available functions include: Fire Shutdown, Pressurization, Evacuation, and Smoke Purge. These functions are enhanced when multiple rooftop units are used to zone a building. See Table 16 and Fig. 58 and 59.

FIRE SHUTDOWN

Fire Shutdown mode terminates all unit operation (cooling, heating, supply fan, and power exhaust). This mode prevents recirculation of contaminated air back into the space. The mode will not allow admission into the space of unsuitable outside air. See Fig. 58 for wiring.

PRESSURIZATION

Pressurization mode is intended to keep smoke out of a zone. The factory-installed optional economizer is required for this function. Pressurization is accomplished by the following:

- opening the economizer (option)
- running the supply fan (optional inlet guide vanes open or optional VFD at normal duct static pressure set point)
- closing the power exhaust dampers (if installed as option or accessory)
- shutting off the power exhaust fans (if installed as option or accessory)

This allows the space to be over-pressurized relative to adjacent zones and prevents or slows entry of smoke into this space from adjacent zones. See Fig. 59 for wiring.

EVACUATION

Evacuation mode removes smoke or undesirable air from interior spaces without reintroducing unsuitable air. The factory-installed optional economizer with option/accessory power exhaust is required for this function. Evacuation is accomplished by:

- turning the supply fan off
- opening the economizer (option required)
- running the exhaust fans (option or accessory required)
- opening the exhaust dampers.

See Fig. 59 for wiring.

SMOKE PURGE

Smoke Purge mode removes smoke from the interior spaces and replaces it with fresh outside air. The factory-installed optional economizer with option/accessory power exhaust are required for this function. Smoke purge is accomplished by the following:

- turning supply fan on
- opening the economizer (option required)
- running the exhaust fans (option or accessory required)
- opening the exhaust dampers

See Fig. 59 for wiring.

SMOKE CONTROL INSTALLATION

Implementation of the various smoke control modes on these units requires the installer to modify the unit wiring to add contacts (via either manual switches or relays) that will selectively interrupt and override standard factory control sequences. See Table 16 and Fig. 57 and 58 and the Controls, Start-Up, Operation, Service and Troubleshooting manual for more information.

Table 16 — Smoke Control Modes

FUNCTION	MODE			
	Fire Shutdown	Pressurization	Evacuation*	Smoke Purge*
Supply Fan	Off	On	Off	On
VFD†	—	Open/On	—	Open/On
Economizer	Closed	Open	Open	Open
Return Air Damper	Open	Closed	Closed	Closed
Exhaust Fans	Off	Off	On	On
Exhaust Damper	Closed	Closed	Open	Open

LEGEND

VAV — Variable Air Volume

VFD — Variable Frequency Drive

*Power exhaust option required for this mode.

†Applicable to VAV units with appropriate options.

