



## Product Data

# WeatherMaster® Single Packaged Rooftop

3-Stage — 15 to 25 Nominal Tons

ecoblue™  technology



**Puron**  
ADVANCE™

48/50GE\*\*17, 20, 24, 28  
48GE: Single-Package Gas Heating/Electric Cooling  
Rooftop Units  
50GE: Electric Cooling Rooftop Units with Optional  
Electric Heat  
with Puron Advance™ Refrigerant (R-454B) and  
EcoBlue Technology

## Introducing Carrier's WeatherMaster® rooftop units (RTUs) with Puron Advance™ and EcoBlue™ Fan Technology.

The WeatherMaster line has always stood for high efficiency cooling solutions that are innovative, high quality, and easy to use. Carrier's new 48/50GE rooftops continues that legacy with Puron Advance, our low global warming potential refrigerant. With high efficiency offerings, additional factory installed options, EcoBlue fan technology, locally available stock, and direct fit footprints, new installations and replacements are easier than ever.

New major design features include:

- Puron Advance (R-454B) refrigerant, which delivers a 75% reduction in global warming potential (GWP) compared to the original Puron (R-410A). Puron Advance's GWP of 466 easily exceeds the EPA (Environmental Protection Agency) requirement of <700 GWP.
- A patented, industry-first vane axial indoor fan system with an electronically commutated motor for simplicity and efficiency. When compared to traditional belt-driven forward curve fans, our reliable system has:
  - 75% fewer moving parts
  - Up to 40% greater efficiency
  - No fan belts, pulleys, shaft, or shaft bearings
  - Better sound and comfort due to slow ramp-up capability

- Internal protection from phase reversal and phase loss situations
- High external static capability
- Slide-out blower assembly design
- Reliable 3 stage cooling with tandem scroll compressors technology, fully active evaporator coil, and mixed air temperature protection on all models
- Reliable copper tube/aluminum fin condenser coil with 5/16 in. tubing to help reduce refrigerant charge and weight versus prior designs

WeatherMaster® 48/50GE units up to 25 tons are specifically designed for dedicated factory-supplied vertical air flow or horizontal air flow. No special field kits are required. Designed to fit on pre-installed curbs by other manufacturer, these units can also fit on some of Carrier's past installed roof curbs.

Staged air volume (SAV) indoor fan speed control helps deliver IEERs up to 19.2.

With "no-strip" screw collars, handled access panels, and more, the unit is easy to install, easy to maintain, and easy to use. Your new 15 to 25 ton Carrier WeatherMaster rooftop unit (RTU) provides optimum comfort and control from a packaged rooftop.

Value-added features include:

- Optional Humidi-MiZer® adaptive dehumidification system for improved part load humidity performance

- SystemVu™ intuitive intelligent controls that provide:
  - Large, full text, multi-line display
  - USB flash port for data transfer
  - Built-in i-Vu®, CCN, and BACnet®<sup>1</sup>
  - Easy to read refrigerant pressures shown via the display — no checking gauges
  - Quick LED Status for Run, Alert, and Fault
  - Conventional thermostat or sensor capabilities
  - Historical component runtime and starts
  - Supply air tempering
  - Network Service Tool compatible
- Single point gas and electrical connections
- TXV refrigerant metering devices on 15 to 25 ton models
- Scroll compressors with internal line-break overload protection
- Easy-to-access tool-less filter door, filter tracks that tilt out for filter removal and replacement, and filter size consistency across units

## Installation ease

Lighter units make for easy replacement and aid in the structural approval process. All units have SystemVu controls standard for easy, tool free commissioning. Clearly labeled connection points reduce installation time, and a large control box provides room to work and mount Carrier accessories.

## Table of contents

	Page
Features/Benefits . . . . .	2
Model number nomenclature . . . . .	5
Capacity ratings . . . . .	7
Physical data . . . . .	10
Options and accessories . . . . .	13
Base unit dimensions . . . . .	18
Accessory dimensions . . . . .	48
Performance data . . . . .	51
Fan data . . . . .	69
Electrical data . . . . .	94
Typical wiring diagrams . . . . .	120
Sequence of operation . . . . .	126
Application data . . . . .	128
Guide specifications — 48GE . . . . .	130
Guide specifications — 50GE . . . . .	141

1. Third-party trademarks and logos are the property of their respective owners.

## Easy to maintain

With the EcoBlue vane axial fan system and a direct drive ECM motor, belts and pulleys are a thing of the past. This frees up maintenance, installation and commissioning time. Should an adjustment be necessary, it can easily be made via the SystemVu controller in the control box. For regular service activities, our easy-access handles provide a quick solution to all commonly accessed service panels, and our sloped, corrosion-resistant composite drain pan sheds water and will not rust. Service gauge connections are included on compressor suction/discharge lines and before and after the filter drier to monitor system operation during maintenance.

## Puron Advance™ Features

In 2018, Carrier announced Puron Advance (R-454B) as our next generation refrigerant for light commercial rooftops. With a GWP of 466 and similar working pressure and performance to R-410A, Puron Advance easily exceeds the EPA's new, stringent <700 GWP refrigerant requirement while minimizing unit redesign. Like other next generation refrigerants (R-32, etc.), R-454B is classified as an "A2L" refrigerant by ASHRAE<sup>®1</sup> (American Society of Heating, Refrigerating, and Air-Conditioning Engineers). This designation means that

R-454B is "mildly flammable" under certain conditions. While this is a change from legacy "A1 — No Flame Propagation" refrigerants like Puron (R-410A), A2Ls are still very low on the flammability scale and quite safe for use. A2L refrigerants are difficult to ignite and have an extremely low flame speed — much less so than natural gas, propane, or even rubbing alcohol. At Carrier, we are committed to safety. As such, all of our Puron Advance rooftop units include a factory-installed dissipation control board and leak sensor designed to last the lifetime of the unit. This system is certified to UL 60335-2-40 and designed to work right away, without any field configuration or wiring. In the event of a leak, these systems are designed to automatically identify and resolve the issue by dissipating the refrigerant to minimize risk to equipment, buildings, or occupants.

## EcoBlue™ Technology

Our direct drive EcoBlue indoor fan system uses vane axial fan and electronically commutated motor. The benefit is clear: when compared to legacy belt drive systems, this vane axial design has 75% fewer moving parts, uses up to 40% less energy, and has no belts, blower bearings, or shaft. The full

fan and motor assembly also slides out for easier maintenance and service.

## Streamlined control and integration

The 48/50GE 3-Stage units standard SystemVu controls make connecting into existing building automation systems easy.

## Operating efficiency and flexibility

The 48/50GE 3-Stage rooftops exceed the DOE 2023 efficiency standard, as well as ASHRAE (American Society of Heating, Refrigerating, and Air-Conditioning Engineers) 90.1 and IECC<sup>®1</sup> (International Energy Conservation Code) requirements.

## Comfort control


Carrier's patented Humidi-MiZer<sup>®</sup> adaptive dehumidification system is an all-inclusive factory-installed option on gas heating/electric cooling and electric cooling/electric heat models. This system provides reliable, flexible operation to meet indoor part load sensible and latent requirements as well as multiple gas heat and electric heat sized to fit an array of applications.

---

1. Third-party trademarks and logos are the property of their respective owners.



**WeatherMaster®**  
with **ecoblue™** technology  
48/50GE 3-Stage 15 – 25 Ton Models

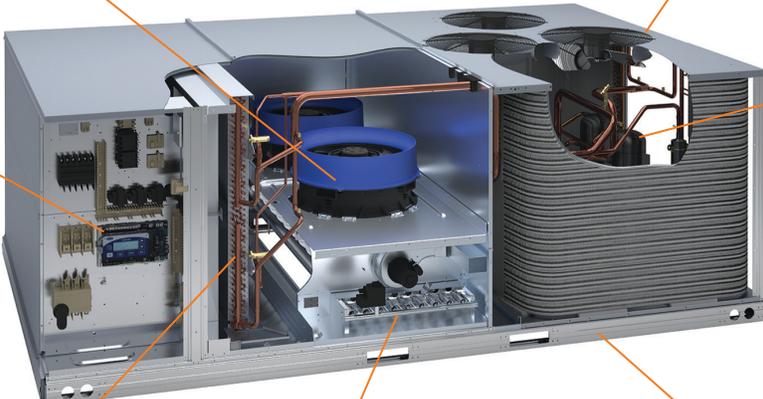

**Vane Axial Indoor Fan**

- Direct drive ECM
- Slow ramp up
- Phase loss protection
- No belts or pulleys
- Slide out design

**High Efficiency Outdoor Fan**

- Quiet operation
- Balanced blades
- Efficient airflow collar

**Unit Control**

- SystemVu™ controller

**Compression**

- Fully hermetic scroll
- Internally protected
- Multi stage design
- Safety switch protected

**Air Management**

- Factory - Field economizers
- Upgraded MERV-13 filters
- Tool-less Filter Access door

**Efficient Coils**

- Round tube/plate fin
- Copper/Aluminum
- Special coating available
- New 5/16 in. condenser tube
- Humidi-MiZer® system available
- TXV metering device

**Heating**

- Gas Heating
  - Induced draft heat exchanger
  - Multiple sizes available
  - Efficient dimpled gas design
- Electric Heating
  - Multiple sizes available
  - Single point power

**Cabinet Design**

- Heavy gauge base rails
- Large handled access panels
- Embossed strengthened base pan

## 48GE Model Number Nomenclature

Position:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
Example:	4	8	G	E	E	T	2	0	A	2	A	6	-	3	A	0	A	0

### Unit Heat Type

48 — Gas Heat Packaged Rooftop

### Model Series - WeatherMaster®

GE — High Efficiency Puron Advance™

### Heat Options

D = Low Heat  
 E = Medium Heat  
 F = High Heat  
 S = Low Heat w/ Stainless Steel Heat Exchanger  
 R = Medium Heat w/ Stainless Steel Heat Exchanger  
 T = High Heat w/ Stainless Steel Heat Exchanger

### Refrig. Systems Options

R = Three Stage Cooling/Single Circuit with Chicago Code Relief Valve  
 S = Three Stage Cooling/Single Circuit with Humidi-MiZer® System and Chicago Code Relief Valve  
 T = Three Stage Cooling/Single Circuit  
 U = Three Stage Cooling with Humidi-MiZer System

### Cooling Tons

17 = 15.0 tons  
 20 = 17.5 tons  
 24 = 20.0 tons  
 28 = 25.0 tons

### Sensor Options

A = None  
 B = Return Air Smoke Detector (RA)  
 C = Supply Air Smoke Detector (SA)  
 D = RA + SA Smoke Detector  
 J = Condensate Overflow Switch  
 K = Condensate Overflow Switch + RA Smoke Detectors  
 L = Condensate Overflow Switch + RA and SA Smoke Detectors  
 M = Condensate Overflow Switch + SA Smoke Detector

### Indoor Fan Options - Vane Axial EcoBlue Fan System

2 = Standard/Medium Static Motor - Vertical Supply  
 3 = High Static Motor - Vertical Supply  
 5 = Standard/Medium Static Motor - Vertical Supply and Filter Status Switch  
 6 = High Static Motor - Vertical Supply and Filter Status Switch  
 J = High Static Motor - Horizontal Supply  
 L = High Static Motor - Horizontal Supply and Filter Status Switch

### Coil Options – RTPF (Outdoor – Indoor – Hail Guard)

A = Al/Cu – Al/Cu  
 B = Precoat Al/Cu – Al/Cu  
 C = E-coat Al/Cu – Al/Cu  
 D = E-coat Al/Cu – E-coat Al/Cu  
 M = Al/Cu – Al/Cu – Louvered Hail Guard  
 N = Precoat Al/Cu – Al/Cu – Louvered Hail Guard  
 P = E-coat Al/Cu – Al/Cu – Louvered Hail Guard  
 Q = E-coat Al/Cu – E-coat Al/Cu – Louvered Hail Guard  
 R = Cu/Cu – Al/Cu – Louvered Hail Guard  
 S = Cu/Cu – Cu/Cu – Louvered Hail Guard

### Voltage

1 = 575-3-60  
 5 = 208/230-3-60  
 6 = 460-3-60

### Packaging Compliance

0 = Standard

### Electrical Options

A = None  
 B = HACR Breaker  
 C = Non-Fused Disconnect (NFDC)  
 N = Phase Monitor/Protection (PMR)  
 P = PMR + HACR  
 Q = PMR + NFDC  
 1 = HSCCR® (High Short Circuit Current Rating) Protection

### Service Options

0 = None  
 1 = Unpowered Convenience Outlet (NPCO)  
 2 = Powered Convenience Outlet (PCO)  
 3 = Hinged Panels (HP)  
 4 = Hinged Panels + NPCO  
 5 = Hinged Access Panels + PCO  
 6 = MERV-13 Filters (M13)  
 7 = NPCO + MERV-13 Filters  
 8 = PCO + MERV-13 Filters  
 9 = Hinged Panels + MERV-13 Filters  
 A = HP + NPCO + MERV-13 Filters  
 B = HP + PCO + MERV-13 Filters  
 C = Foil Faced Insulation (FF)  
 D = FF + NPCO  
 E = FF + PCO  
 F = FF + HP  
 G = FF + HP + NPCO  
 H = FF + HP + PCO  
 J = FF + MERV-13 Filters  
 K = FF + NPCO + MERV-13 Filters  
 L = FF + PCO + MERV-13 Filters  
 M = FF + HP + MERV-13 Filters  
 N = FF + HP + NPCO + MERV-13 Filters  
 P = FF + HP + PCO + MERV-13 Filters

### Intake / Exhaust Options

A = None  
 B = Temperature Economizer with Barometric Relief  
 F = Enthalpy Economizer with Barometric Relief  
 L = ULL (Ultra Low Leak) Temperature Economizer with Barometric Relief and CO<sub>2</sub> Sensor  
 M = ULL Enthalpy Economizer with Barometric Relief and CO<sub>2</sub> Sensor  
 N = ULL Temperature Economizer with Power Exhaust and CO<sub>2</sub> Sensor, Vertical Only  
 P = ULL Enthalpy Economizer with Power Exhaust and CO<sub>2</sub> Sensor, Vertical Only  
 U = ULL Temperature Economizer with Barometric Relief  
 V = ULL Temperature Economizer with Power Exhaust, Vertical Only  
 W = ULL Enthalpy Economizer with Barometric Relief  
 X = ULL Enthalpy Economizer with Power Exhaust, Vertical Only

### Base Unit Controls

3 = SystemVu™ Controller

### Design Revision

- = Factory Design Revision

### NOTE(S):

a. Not available on the following models/options: 575V, Phase Loss Monitor, Non-Fused Disconnect, HACR Breaker, Powered Convenience Outlet.

# Model number nomenclature (cont)



## 50GE Model Number Nomenclature

Position:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
Example:	5	0	G	E	-	T	2	0	A	2	A	6	-	3	A	0	A	0

### Unit Type

50 — Cooling with Optional Electric Heat

### Model Series - WeatherMaster®

GE — High Efficiency Puron Advance™

### Electric Heat Size

- = No Heat  
 A = Low Electric Heat  
 B = Medium Electric Heat  
 C = High Electric Heat

### Refrig. Systems Options

R = Three Stage Cooling/Single Circuit with Chicago Code Relief Valve  
 S = Three Stage Cooling/Single Circuit with Humidi-MiZer® System and Chicago Code Relief Valve  
 T = Three Stage Cooling/Single Circuit  
 U = Three Stage Cooling with Humidi-MiZer System

### Tonnage

17 = 15.0 tons  
 20 = 17.5 tons  
 24 = 20.0 tons  
 28 = 25.0 tons

### Sensor Options

A = None  
 B = RA Smoke Detector  
 C = SA Smoke Detector  
 D = RA + SA Smoke Detector  
 J = Condensate Overflow Switch  
 K = Condensate Overflow Switch + RA Smoke Detectors  
 L = Condensate Overflow Switch + RA and SA Smoke Detectors  
 M = Condensate Overflow Switch + SA Smoke Detector

### Indoor Fan Options - Vane Axial EcoBlue Fan System

2 = Standard/Medium Static Motor - Vertical Supply  
 3 = High Static Motor - Vertical Supply  
 5 = Standard/Medium Static Motor - Vertical Supply and Filter Status Switch  
 6 = High Static Motor - Vertical Supply and Filter Status Switch  
 J = High Static Motor - Horizontal Supply  
 L = High Static Motor - Horizontal Supply and Filter Status Switch

### RTPF Coil Options – (Outdoor – Indoor – Hail Guard)

A = Al/Cu – Al/Cu  
 B = Precoat Al/Cu – Al/Cu  
 C = E-coat Al/Cu – Al/Cu  
 D = E-coat Al/Cu – E-coat Al/Cu  
 M = Al/Cu – Al/Cu – Louvered Hail Guard  
 N = Precoat Al/Cu – Al/Cu – Louvered Hail Guard  
 P = E-coat Al/Cu – Al/Cu – Louvered Hail Guard  
 Q = E-coat Al/Cu – E-coat Al/Cu – Louvered Hail Guard  
 R = Cu/Cu – Al/Cu – Louvered Hail Guard  
 S = Cu/Cu – Cu/Cu – Louvered Hail Guard

### Voltage

1 = 575-3-60  
 5 = 208/230-3-60  
 6 = 460-3-60

### Packaging Compliance

0 = Standard

### Electrical Options

A = None  
 B = HACR Breaker  
 C = Non-Fused Disconnect (NFDC)  
 N = Phase Monitor/Protection (PMR)  
 P = PMR + HACR  
 Q = PMR + NFDC  
 1 = HSCCR® (High Short Circuit Current Rating) Protection

### Service Options

0 = None  
 1 = Unpowered Convenience Outlet (NPCO)  
 2 = Powered Convenience Outlet (PCO)  
 3 = Hinged Panels (HP)  
 4 = Hinged Panels + NPCO  
 5 = Hinged Access Panels + PCO  
 6 = MERV-13 Filters (M13)  
 7 = NPCO + MERV-13 Filters  
 8 = PCO + MERV-13 Filters  
 9 = Hinged Panels + MERV-13 Filters  
 A = HP + NPCO + MERV-13 Filters  
 B = HP + PCO + MERV-13 Filters  
 C = Foil Faced Insulation (FF)  
 D = Foil Faced Insulation + NPCO  
 E = Foil Faced Insulation + PCO  
 F = Foil Faced Insulation + Hinged Panels  
 G = FF + HP + NPCO  
 H = FF + HP + PCO  
 J = Foil Faced Insulation + MERV-13 Filters  
 K = FF + NPCO + MERV-13 Filters  
 L = FF + PCO + MERV-13 Filters  
 M = FF + HP + MERV-13 Filters  
 N = FF + HP + NPCO + MERV-13 Filters  
 P = FF + HP + PCO + MERV-13 Filters

### Intake / Exhaust Options

A = None  
 B = Temperature Economizer with Barometric Relief  
 F = Enthalpy Economizer with Barometric Relief  
 L = ULL (Ultra Low Leak) Temperature Economizer with Barometric Relief and CO<sub>2</sub> Sensor  
 M = ULL Enthalpy Economizer with Barometric Relief and CO<sub>2</sub> Sensor  
 N = ULL Temperature Economizer with Power Exhaust and CO<sub>2</sub> Sensor, Vertical Only  
 P = ULL Enthalpy Economizer with Power Exhaust and CO<sub>2</sub> Sensor, Vertical Only  
 U = ULL Temperature Economizer with Barometric Relief  
 V = ULL Temperature Economizer with Power Exhaust, Vertical Only  
 W = ULL Enthalpy Economizer with Barometric Relief  
 X = ULL Enthalpy Economizer with Power Exhaust, Vertical Only

### Unit Controls

3 = SystemVu™ Controller

### Design Revision

- = Factory Design Revision

### NOTE(S):

a. Not available on the following models/options: 575V, Phase Loss Monitor, Non-Fused Disconnect, HACR Breaker, Powered Convenience Outlet.

## 48GE AHRI Ratings<sup>a,b,c,d</sup>

VERTICAL AIR FLOW UNITS <sup>e</sup>									
48GE UNIT	COOLING STAGES	NOMINAL CAPACITY (TONS)	NET COOLING CAPACITY (MBH)	TOTAL POWER (kW)	EER	IEER WITH 3-SPEED INDOOR FAN MOTOR	AHRI RATING CFM	AHRI MEDIUM PART LOAD CFM	AHRI LOW PART LOAD CFM
48GE**17	3	15.0	170.0	14.2	12.0	19.0	6,000	3,600	2,400
48GE**20	3	17.5	206.0	17.2	12.0	19.0	6,250	3,750	2,500
48GE**24	3	20.0	244.0	22.4	10.9	17.3	8,000	4,800	3,200
48GE**28	3	25.0	292.0	27.0	10.8	18.1	10,000	6,000	4,000
HORIZONTAL AIR FLOW UNITS <sup>e</sup>									
48GE**17	3	15.0	170.0	14.2	12.0	18.9	6,000	3,600	2,400
48GE**20	3	17.5	204.0	17.0	12.0	18.8	6,250	3,750	2,500
48GE**24	3	20.0	242.0	22.6	10.7	16.8	8,000	4,800	3,200
48GE**28	3	25.0	290.0	27.6	10.3	17.5	10,000	6,000	4,000

NOTE(S):

- Rated in accordance with AHRI Standards 340/360.
- Rating are based on:  
**Cooling Standard:** 80°F (27°C) db, 67°F (19°C) wb indoor air temperature and 95°F (35°C) db outdoor air temperature.  
**IEER Standard:** A measure that expresses cooling part-load EER efficiency for commercial unitary air-conditioning and heat pump equipment on the basis of weighted operation at various load capacities.
- All 48GE units comply with ASHRAE 90.1-2019 (American Society of Heating, Refrigerating, and Air-Conditioning Engineers) and DOE-2023 (Department of Energy) Energy Standard for minimum IEER requirements.
- 48GE units comply with US Energy Policy Act (2005). To evaluate code compliance requirements, refer to state and local codes.
- See position 10 in the 48GE 17-28 model number nomenclature to determine if the unit is a Vertical or Horizontal air flow unit.

LEGEND

- AHRI — Air-Conditioning, Heating and Refrigeration Institute
- EER — Energy Efficiency Ratio
- IEER — Integrated Energy Efficiency Ratio



## 50GE AHRI Ratings<sup>a,b,c,d</sup>

VERTICAL AIR FLOW UNITS <sup>e</sup>									
50GE UNIT	COOLING STAGES	NOMINAL CAPACITY (TONS)	NET COOLING CAPACITY (MBH)	TOTAL POWER (kW)	EER	IEER WITH 3-SPEED INDOOR FAN MOTOR	AHRI RATING CFM	AHRI MEDIUM PART LOAD CFM	AHRI LOW PART LOAD CFM
50GE-*17	3	15.0	170.0	13.9	12.2	19.2	6,000	3,600	2,400
50GE-*20	3	17.5	206.0	16.9	12.2	19.2	6,250	3,750	2,500
50GE-*24	3	20.0	244.0	22.0	11.1	17.5	8,000	4,800	3,200
50GE-*28	3	25.0	292.0	26.5	11.0	18.3	10,000	6,000	4,000
HORIZONTAL AIR FLOW UNITS <sup>e</sup>									
50GE-*17	3	15.0	170.0	13.9	12.2	19.1	6,000	3,600	2,400
50GE-*20	3	17.5	204.0	16.7	12.2	19.0	6,250	3,750	2,500
50GE-*24	3	20.0	242.0	22.2	10.9	17.0	8,000	4,800	3,200
50GE-*28	3	25.0	290.0	27.1	10.5	17.7	10,000	6,000	4,000

NOTE(S):

- Rated in accordance with AHRI Standards 340/360.
- Rating are based on:  
**Cooling Standard:** 80°F (27°C) db, 67°F (19°C) wb indoor air temperature and 95°F (35°C) db outdoor air temperature.  
**IEER Standard:** A measure that expresses cooling part-load EER efficiency for commercial unitary air-conditioning and heat pump equipment on the basis of weighted operation at various load capacities.
- All 50GE units comply with ASHRAE 90.1-2019 (American Society of Heating, Refrigerating, and Air-Conditioning Engineers) and DOE-2023 (Department of Energy) Energy Standard for minimum IEER requirements.
- 50GE units comply with US Energy Policy Act (2005). To evaluate code compliance requirements, refer to state and local codes.
- See position 10 in the 50GE 17-28 model number nomenclature to determine if the unit is a Vertical or Horizontal air flow unit.

LEGEND

- AHRI — Air-Conditioning, Heating and Refrigeration Institute
- EER — Energy Efficiency Ratio
- IEER — Integrated Energy Efficiency Ratio



### Sound Ratings Table<sup>a,b,c</sup>

48/50GE UNIT	COOLING STAGES	OUTDOOR SOUND (dB) at 60 Hz								
		A-WEIGHTED	63	125	250	500	1000	2000	4000	8000
17	3	84.1	92.2	83.9	80.4	81.8	78.7	76.5	72.2	65.4
20	3	84.1	92.2	83.9	80.4	81.8	78.7	76.5	72.2	65.4
24	3	86.5	95.6	87.5	84.2	84.2	81.7	77.9	73.2	66.3
28	3	85.9	97.1	88.3	84.4	83.3	80.7	77.4	73.4	67.3

NOTE(S):

- Outdoor sound data is measured in accordance with AHRI.
- Measurements are expressed in terms of sound power. Do not compare these values to sound pressure values because sound pressure depends on specific environmental factors which normally do not match individual applications. Sound power values are independent of the environment and therefore more accurate.
- A-weighted sound ratings filter out very high and very low frequencies, to better approximate the response of "average" human ear. A-weighted measurements for Carrier units are taken in accordance with AHRI.

LEGEND

dB — Decibel

### Minimum - Maximum Airflow Ratings (cfm) — Natural Gas and Propane

UNIT	HEAT LEVEL	COOLING				HEATING <sup>a</sup>	
		MINIMUM 3-SPEED AIRFLOW (LOW SPEED)	MINIMUM 3-SPEED AIRFLOW (MEDIUM SPEED)	MINIMUM 3-SPEED AIRFLOW (HIGH SPEED)	MAXIMUM AIRFLOW CFM	MINIMUM AIRFLOW CFM	MAXIMUM AIRFLOW CFM
48GE**17	LOW	1,800	2,700	4,500	8,750	3,000	11,000
	MED					3,880	9,300
	HIGH					4,620	10,000
48GE**20	LOW	2,100	3,150	5,250	8,750	3,000	11,000
	MED					3,880	11,630
	HIGH					4,620	10,000
48GE**24	LOW	2,400	3,600	6,000	10,000	3,000	16,500
	MED					3,880	15,500
	HIGH					4,620	15,000
48GE**28	LOW	3,000	4,500	7,500	12,500	3,000	16,500
	MED					3,880	15,500
	HIGH					4,620	15,000

NOTE(S):

- Heating rating values are identical for aluminum heat exchangers and stainless steel heat exchangers.

### Minimum - Maximum Airflow Ratings (cfm) — Cooling Units and Accessory Electric Heat

UNIT	COOLING				ELECTRIC HEAT <sup>a</sup>	
	MINIMUM 3-SPEED AIRFLOW (LOW SPEED)	MINIMUM 3-SPEED AIRFLOW (MEDIUM SPEED)	MINIMUM 3-SPEED AIRFLOW (HIGH SPEED)	MAXIMUM AIRFLOW CFM	MINIMUM AIRFLOW CFM	MAXIMUM AIRFLOW CFM
50GE**17	1,800	2,700	4,500	7,500	4,500	7,500
50GE**20	2,100	3,150	5,250	8,750	5,250	8,750
50GE**24	2,400	3,600	6,000	10,000	6,000	10,000
50GE**28	3,000	4,500	7,500	12,500	7,500	12,500

NOTE(S):

- Electric heat modules are available as factory-installed options or field-installed accessories. For factory-installed electric heat modules single point kits, if required, are also included.

## Heat Rating Table — Natural Gas and Propane

UNIT	GAS HEAT	AL/SS HEAT EXCHANGER		TEMPERATURE RISE (°F)	THERMAL EFFICIENCY (%)
		INPUT/OUTPUT STAGE 1 (MBH)	INPUT/OUTPUT STAGE 2 (MBH)		
48GE**17	LOW	176 / 142	220 / 178	20-45	81
	MED	248 / 200	310 / 251	30-55	81
	HIGH	320 / 260	400 / 324	35-60	81
48GE**20	LOW	176 / 142	220 / 178	15-45	81
	MED	248 / 200	310 / 251	25-55	81
	HIGH	320 / 260	400 / 324	30-60	81
48GE**24	LOW	176 / 142	220 / 178	15-45	81
	MED	248 / 200	310 / 251	20-55	81
	HIGH	320 / 260	400 / 324	30-60	81
48GE**28	LOW	176 / 142	220 / 178	10-45	81
	MED	248 / 200	310 / 251	15-55	81
	HIGH	320 / 260	400 / 324	20-60	81

LEGEND

**MBH** — Btuh in thousands

## 48/50GE 17 to 20 Physical Data

48/50GE UNIT	48/50GE*T/R17	48/50GE*U/S17	48/50GE*T/R20	48/50GE*U/S20
<b>NOMINAL TONS</b>	15.0	15.0	17.5	17.5
<b>BASE UNIT OPERATING WT (lb) 48GE/50GE<sup>a</sup></b>	1732/1640	1732/1640	2010/1918	2010/1918
<b>REFRIGERATION SYSTEM</b>				
<b>No. Circuits/No. Compressors/Type</b>	1/2/Scroll	1/2/Scroll	1/2/Scroll	1/2/Scroll
<b>Puron Advance™ (R-454B) Charge (lb-oz)</b>	24-14	—	32-1	—
<b>Humidi-MiZer® Puron Advance (R-454B) Charge (lb-oz)</b>	—	34-2	—	39-8
<b>Metering Device</b>	TXV	—	TXV	—
<b>Humidi-MiZer Metering Device</b>	—	TXV	—	TXV
<b>High-Pressure Trip/Reset (psig)</b>	630/505	630/505	630/505	630/505
<b>Low-Pressure Trip/Reset (psig)</b>	54/117	54/117	54/117	54/117
<b>EVAPORATOR COIL</b>				
<b>Material (Tube/Fin)</b>	Cu/Al	Cu/Al	Cu/Al	Cu/Al
<b>Coil Type</b>	3/8 in. RTPF	3/8 in. RTPF	3/8 in. RTPF	3/8 in. RTPF
<b>Rows/FPI</b>	4/15	4/15	4/15	4/15
<b>Total Face Area (ft<sup>2</sup>)</b>	22	22	22	22
<b>Condensate Drain Connection Size</b>	3/4 in.	3/4 in.	3/4 in.	3/4 in.
<b>CONDENSER COIL</b>				
<b>Material (Tube/Fin)</b>	Cu/Al	Cu/Al	Cu/Al	Cu/Al
<b>Coil Type</b>	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF
<b>Rows/FPI</b>	2/18	2/18	2/18	2/18
<b>Total Face Area (ft<sup>2</sup>)</b>	19.6	19.6	25.1	25.1
<b>HUMIDI-MIZER COIL</b>				
<b>Material</b>	—	Cu/Al	—	Cu/Al
<b>Coil Type</b>	—	5/16 in. RTPF	—	5/16 in. RTPF
<b>Rows/FPI</b>	—	1/18	—	1/18
<b>Total Face Area (ft<sup>2</sup>)</b>	—	21.4	—	21.4
<b>EVAPORATOR FAN AND MOTOR</b>				
<b>Vertical Standard Static 3 Phase</b>				
<b>Motor Qty / Drive Type</b>	2 / Direct	2 / Direct	2 / Direct	2 / Direct
<b>Maximum Cont bhp (per motor)</b>	2.4	2.4	2.4	2.4
<b>Range (rpm)</b>	250-2000	250-2000	250-2000	250-2000
<b>Fan Qty / Type</b>	2 / Vane Axial			
<b>Fan Diameter (in.)</b>	22	22	22	22
<b>Vertical High Static 3 Phase</b>				
<b>Motor Qty / Drive Type</b>	2 / Direct	2 / Direct	2 / Direct	2 / Direct
<b>Maximum Cont bhp (per motor)</b>	3	3	3	3
<b>Range (rpm)</b>	250-2200	250-2200	250-2200	250-2200
<b>Fan Qty / Type</b>	2 / Vane Axial			
<b>Fan Diameter (in.)</b>	22	22	22	22
<b>Horizontal High Static 3 Phase</b>				
<b>Motor Qty / Drive Type</b>	2 / Direct	2 / Direct	2 / Direct	2 / Direct
<b>Maximum Cont bhp (per motor)</b>	5	5	5	5
<b>Range (rpm)</b>	250-2200	250-2200	250-2200	250-2200
<b>Fan Qty / Type</b>	2 / Vane Axial			
<b>Fan Diameter (in.)</b>	22	22	22	22
<b>CONDENSER FAN AND MOTOR</b>				
<b>Qty / Motor Drive Type</b>	3 / Direct	3 / Direct	4 / Direct	4 / Direct
<b>Motor hp / rpm</b>	1/3 / Multiple Speeds <sup>b</sup>			
<b>Fan Diameter (in.)</b>	22	22	22	22
<b>FILTERS</b>				
<b>RA Filter Qty / Size (in.)</b>	6 / 20x25x2	6 / 20x25x2	6 / 20x25x2	6 / 20x25x2
<b>OA Inlet Screen Qty / Size (in.)</b>	4 / 16x25x1	4 / 16x25x1	4 / 16x25x1	4 / 16x25x1

**NOTE(S):**

- a. Base unit operating weight does not include weight of options.
- b. 1050/770/450/350/265 rpm

**LEGEND**

- bhp** — Brake Horsepower
- FPI** — Fins Per Inch
- OA** — Outdoor Air
- RA** — Return Air

## 48/50GE 24 to 28 Physical Data

48/50GE UNIT	48/50GE*T/R24	48/50GE*U/S24	48/50GE*T/R28	48/50GE*U/S28
<b>NOMINAL TONS</b>	20.0	20.0	25.0	25.0
<b>BASE UNIT OPERATING WT (lb) 48GE/50GE<sup>a</sup></b>	2290/2198	2290/2198	2383/2291	2383/2291
<b>REFRIGERATION SYSTEM</b>				
<b>No. Circuits/No. Compressors/Type</b>	1/2/Scroll	1/2/Scroll	1/2/Scroll	1/2/Scroll
<b>Puron Advance™ (R-454B) Charge (lb-oz)</b>	31-13	—	36-10	—
<b>Humidi-MiZer® Puron Advance (R-454B) Charge (lb-oz)</b>	—	42-13	—	52-11
<b>Metering Device</b>	TXV	—	TXV	—
<b>Humidi-MiZer Metering Device</b>	—	TXV	—	TXV
<b>High-Pressure Trip/Reset (psig)</b>	630/505	630/505	630/505	630/505
<b>Low-Pressure Trip/Reset (psig)</b>	54/117	54/117	54/117	54/117
<b>EVAPORATOR COIL</b>				
<b>Material (Tube/Fin)</b>	Cu/Al	Cu/Al	Cu/Al	Cu/Al
<b>Coil Type</b>	3/8 in. RTPF	3/8 in. RTPF	3/8 in. RTPF	3/8 in. RTPF
<b>Rows/FPI</b>	4/15	4/15	4/15	4/15
<b>Total Face Area (ft<sup>2</sup>)</b>	26	26	26	26
<b>Condensate Drain Connection Size</b>	3/4 in.	3/4 in.	3/4 in.	3/4 in.
<b>CONDENSER COIL</b>				
<b>Material (Tube/Fin)</b>	Cu/Al	Cu/Al	Cu/Al	Cu/Al
<b>Coil Type</b>	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF	5/16 in. RTPF
<b>Rows/FPI</b>	2/18	2/18	3/18	3/18
<b>Total Face Area (ft<sup>2</sup>)</b>	29.6	29.6	35.4	35.4
<b>HUMIDI-MIZER COIL</b>				
<b>Material</b>	—	Cu/Al	—	Cu/Al
<b>Coil Type</b>	—	5/16 in. RTPF	—	5/16 in. RTPF
<b>Rows/FPI</b>	—	1/18	—	1/18
<b>Total Face Area (ft<sup>2</sup>)</b>	—	25.3	—	25.3
<b>EVAPORATOR FAN AND MOTOR</b>				
<b>Vertical Standard Static 3 Phase</b>				
<b>Motor Qty / Drive Type</b>	2 / Direct	2 / Direct	2 / Direct	2 / Direct
<b>Maximum Cont bhp (per motor)</b>	2.4	2.4	3	3
<b>Range (rpm)</b>	250-2000	250-2000	250-2200	250-2200
<b>Fan Qty / Type</b>	2 / Vane Axial			
<b>Fan Diameter (in.)</b>	22	22	22	22
<b>Vertical High Static 3 Phase</b>				
<b>Motor Qty / Drive Type</b>	2 / Direct	2 / Direct	2 / Direct	2 / Direct
<b>Maximum Cont bhp (per motor)</b>	5	5	5	5
<b>Range (rpm)</b>	250-2200	250-2200	250-2200	250-2200
<b>Fan Qty / Type</b>	2 / Vane Axial			
<b>Fan Diameter (in.)</b>	22	22	22	22
<b>Horizontal High Static 3 Phase</b>				
<b>Motor Qty / Drive Type</b>	2 / Direct	2 / Direct	2 / Direct	2 / Direct
<b>Maximum Cont bhp (per motor)</b>	5	5	5	5
<b>Range (rpm)</b>	250-2200	250-2200	250-2200	250-2200
<b>Fan Qty / Type</b>	2 / Vane Axial			
<b>Fan Diameter (in.)</b>	22	22	22	22
<b>CONDENSER FAN AND MOTOR</b>				
<b>Qty / Motor Drive Type</b>	4 / Direct	4 / Direct	6 / Direct	6 / Direct
<b>Motor hp / rpm</b>	1/3 / Multiple Speeds <sup>b</sup>			
<b>Fan Diameter (in.)</b>	22	22	22	22
<b>FILTERS</b>				
<b>RA Filter Qty / Size (in.)</b>	9 / 20x25x2	9 / 20x25x2	9 / 20x25x2	9 / 20x25x2
<b>OA Inlet Screen Qty / Size (in.)</b>	4 / 16x25x1	4 / 16x25x1	4 / 16x25x1	4 / 16x25x1

**NOTE(S):**

- a. Base unit operating weight does not include weight of options.
- b. 1050/770/450/350/265 rpm

**LEGEND**

- bhp** — Brake Horsepower
- FPI** — Fins Per Inch
- OA** — Outdoor Air
- RA** — Return Air

## 48GE 17 to 28 Gas Heat Data

48GE UNIT	48GE**17	48GE**20	48GE**24	48GE**28
<b>NOMINAL TONS</b>	15.0	17.5	20.0	25.0
<b>GAS CONNECTION</b>				
<b>No. of Gas Valves</b>	1	1	1	1
<b>Natural Gas Supply Line Pressure (in. wg)/(psig)</b>	5-13 / 0.18-0.47	5-13 / 0.18-0.47	5-13 / 0.18-0.47	5-13 / 0.18-0.47
<b>Liquid Propane Supply Line Pressure (in. wg)/(psig)</b>	11-13 / 0.40-0.47	11-13 / 0.40-0.47	11-13 / 0.40-0.47	11-13 / 0.40-0.47
<b>HEAT ANTICIPATOR SETTING (AMPS)</b>				
<b>First Stage</b>	0.14	0.14	0.14	0.14
<b>Second Stage</b>	0.14	0.14	0.14	0.14
<b>NATURAL GAS HEAT</b>				
<b>LOW</b>				
<b>No. of Stages / No. of Burners (total)</b>	2 / 5	2 / 5	2 / 5	2 / 5
<b>Connection Size</b>	3/4 in. NPT	3/4 in. NPT	3/4 in. NPT	3/4 in. NPT
<b>Rollout Switch Opens / Closes (°F)</b>	195 / 115	195 / 115	195 / 115	195 / 115
<b>Temperature Rise (°F)</b>	20-45	15-45	15-45	10-45
<b>MEDIUM</b>				
<b>No. of Stages / No. of Burners (total)</b>	2 / 7	2 / 7	2 / 7	2 / 7
<b>Connection Size</b>	3/4 in. NPT	3/4 in. NPT	3/4 in. NPT	3/4 in. NPT
<b>Rollout Switch Opens / Closes (°F)</b>	195 / 115	195 / 115	195 / 115	195 / 115
<b>Temperature Rise (°F)</b>	30-55	25-55	20-55	15-55
<b>HIGH</b>				
<b>No. of Stages / No. of Burners (total)</b>	2 / 9	2 / 9	2 / 9	2 / 9
<b>Connection Size</b>	3/4 in. NPT	3/4 in. NPT	3/4 in. NPT	3/4 in. NPT
<b>Rollout Switch Opens / Closes (°F)</b>	195 / 115	195 / 115	195 / 115	195 / 115
<b>Temperature Rise (°F)</b>	35-60	30-60	30-60	20-60
<b>LIQUID PROPANE HEAT</b>				
<b>LOW</b>				
<b>No. of Stages / No. of Burners (total)</b>	2 / 5	2 / 5	2 / 5	2 / 5
<b>Connection Size</b>	3/4 in. NPT	3/4 in. NPT	3/4 in. NPT	3/4 in. NPT
<b>Rollout Switch Opens / Closes (°F)</b>	195 / 115	195 / 115	195 / 115	195 / 115
<b>Temperature Rise (°F)</b>	20-45	15-45	15-45	10-45
<b>MEDIUM</b>				
<b>No. of Stages / No. of Burners (total)</b>	2 / 7	2 / 7	2 / 7	2 / 7
<b>Connection Size</b>	3/4 in. NPT	3/4 in. NPT	3/4 in. NPT	3/4 in. NPT
<b>Rollout Switch Opens / Closes (°F)</b>	195 / 115	195 / 115	195 / 115	195 / 115
<b>Temperature Rise (°F)</b>	30-55	25-55	20-55	15-55
<b>HIGH</b>				
<b>No. of Stages / No. of Burners (total)</b>	2 / 9	2 / 9	2 / 9	2 / 9
<b>Connection Size</b>	3/4 in. NPT	3/4 in. NPT	3/4 in. NPT	3/4 in. NPT
<b>Rollout Switch Opens / Closes (°F)</b>	195 / 115	195 / 115	195 / 115	195 / 115
<b>Temperature Rise (°F)</b>	35-60	30-60	30-60	20-60

# Options and accessories



ITEM	FACTORY-INSTALLED OPTION	FIELD-INSTALLED ACCESSORY
<b>GAS HEAT (48GE units only)</b>		
Low, Medium or High Gas Heat — Aluminized Heat Exchanger	X	
Low, Medium or High Gas Heat — Stainless Steel Heat Exchanger	X	
Propane Conversion Kit		X
High Altitude Conversion Kit		X
Flue Discharge Deflector		X
<b>ELECTRIC HEAT (50GE units only)</b>		
Electric Resistance Heaters	X	X
Single Point Kits		X
<b>CABINET</b>		
Hinged Access Panels	X	
MERV-13, 4 in. Filters	X	
MERV-13, 2 in. Filters		X
MERV-8, 2 in. Filters		X
4 in. Filter Rack (filters not included)		X
<b>COIL OPTIONS</b>		
Cu/Cu Indoor and/or Outdoor Coils <sup>a</sup>	X	
Pre-Coated Outdoor Coils	X	
Premium, E-Coated Outdoor Coils	X	
<b>HUMIDITY CONTROL</b>		
Humidi-MiZer <sup>®</sup> Adaptive Dehumidification System	X	
<b>CONDENSER PROTECTION</b>		
Condenser Coil Hail Guard (louvered design)	X	X
<b>PRESSURE RELIEF</b>		
Pressure Relief Valve <sup>b</sup>	X	
<b>CONTROLS</b>		
Thermostats, Temperature Sensors, and Subbases		X
Smoke Detector (supply and/or return air)	X	X
Horn Strobe Annunciator <sup>c</sup>		X
Phase Monitor	X	X
<b>ECONOMIZERS AND OUTDOOR AIR DAMPERS</b>		
EconoMiZer <sup>®</sup> 2 for DDC Controls (Low and Ultra Low Leak air damper models) <sup>d</sup>	X	X
Motorized Two-Position Outdoor-Air Damper		X
Manual Outdoor-Air Damper (25% and 50%)		X
Barometric Relief <sup>e</sup>	X	X
Power Exhaust — centrifugal design	X	X
Condensate Overflow Switch	X	X

ITEM	FACTORY-INSTALLED OPTION	FIELD-INSTALLED ACCESSORY
<b>ECONOMIZER SENSORS AND IAQ DEVICES</b>		
Single Dry Bulb Temperature Sensors <sup>f</sup>	X	X
Differential Dry Bulb Temperature Sensors <sup>f</sup>		X
Differential Enthalpy Sensors <sup>f</sup>		X
CO <sub>2</sub> Sensor (wall, duct, or unit mounted) <sup>f</sup>	X	X
<b>INDOOR MOTOR AND DRIVE</b>		
Multiple Motor and Drive Packages	X	
Fan Filter Status Switch	X	X
<b>POWER OPTIONS</b>		
Convenience Outlet (powered)	X	
Convenience Outlet (unpowered)	X	
Convenience Outlet, 20 amp (unpowered)		X
HACR Circuit Breakers <sup>g</sup>	X	
Non-Fused Disconnect <sup>h</sup>	X	
High SCCR Protection <sup>i</sup>	X	
<b>ROOF CURBS</b>		
Roof Curb 14 in. (356 mm)		X
Roof Curb 24 in. (610 mm)		X

NOTE(S):

- Cu/Cu coils are only available with louvered hail guards.
- The Pressure Relief Valve is single use and must be replaced after refrigerant discharge.
- Requires a field-supplied 24V transformer for each application. See price pages for details.
- Models with SystemVu controls comply with California Title 24 Fault Detection and Diagnostic (FDD).
- Included with economizer.
- Sensors used to optimize economizer performance.
- HACR circuit breaker cannot be used when unit MOCP electrical rating exceeds:
  - 17-24 sizes -
    - 208V/230V = 150 amps
    - 460V = 70 amps
    - 575V = 50 amps
  - 28 size -
    - 208V/230V = 200 amps
    - 460V = 90 amps
    - 575V = 70 amps
 HACR circuit breaker on 575 volt can only be used on Wye power supply. Delta power supply is prohibited. Carrier RTUBuilder automatically selects the amps limitations.
- Non-fused disconnect switch cannot be used when unit FLA electrical rating exceeds:
  - 208V/230V = 200 amps
  - 460V/575V = 100 amps
- High SCCR (Short Circuit Current Rating) is not available on the following: units with Humidi-MiZer system, Phase loss monitor, Non-fused disconnect, Powered convenience outlet, and 575V models

## Factory-installed options

### Economizer (dry-bulb or enthalpy)

Economizers save money. They bring in fresh, outside air for ventilation; and provide cool, outside air to cool your building. This is the preferred method of low-ambient cooling. When coupled to CO<sub>2</sub> sensors, economizers can provide even more savings by coupling the ventilation air to only that amount required.

Economizers are available, installed and tested by the factory, with either enthalpy or dry-bulb temperature inputs. Additional sensors are available as accessories to optimize the economizers. Economizers include barometric relief system to help equalize building pressures.

Economizers can be factory-installed or easily field-installed.

### Unit mounted CO<sub>2</sub> sensor

The CO<sub>2</sub> sensor works with the economizer to intake only the correct amount of outside air for ventilation. As occupants fill your building, the CO<sub>2</sub> sensor detects their presence through increasing CO<sub>2</sub> levels, and opens the economizer appropriately. When the occupants leave, the CO<sub>2</sub> levels decrease, and the sensor appropriately closes the economizer. This intelligent control of the ventilation air, called demand controlled ventilation (DCV), reduces the overall load on the rooftop, saving money. It is also available as a field-installed accessory.

### Smoke detector (supply and/or return air)

Our smoke detectors make your application safer and your job easier. Carrier smoke detectors immediately shut down the rooftop unit when smoke is detected. They are available, installed by the factory, for supply air, return air, or both.

### Optional Humidi-MiZer<sup>®</sup> adaptive dehumidification system

Carrier's Humidi-MiZer adaptive dehumidification system is an all-inclusive factory-installed option that can be ordered with any WeatherMaster<sup>®</sup> 48/50GE 17-28 rooftop unit.

This system expands the envelope of operation of Carrier's WeatherMaster rooftop products to provide unprecedented flexibility to meet year round comfort conditions.

The Humidi-MiZer adaptive dehumidification system has a unique dual operational mode setting. The Humidi-MiZer system provides greater dehumidification of the occupied space by 2 modes of dehumidification operations in addition to its normal design cooling mode.

The WeatherMaster 48/50GE 17-28 rooftop coupled with the Humidi-MiZer system is capable of operating in normal design cooling mode, sub-cooling mode, and hot gas reheat mode. Normal design cooling mode is when the unit will operate under its normal sequence of operation by cycling compressors to maintain comfort conditions.

Sub-cooling mode will operate to satisfy part load type conditions when the space requires combined sensible and a higher proportion of latent load control. Hot Gas Reheat mode will operate when outdoor temperatures diminish and the need for latent capacity is required for sole humidity control. Hot Gas Reheat mode will provide neutral air for maximum dehumidification operation.

### Hinged access panels

Allows access to unit's major components with specifically designed hinged access panels. Panels are filter, control box access indoor fan motor access.

### Cu/Cu (indoor) coils

Copper fins and copper tubes are mechanically bonded to copper tubes and copper tube sheets. A polymer strip prevents coil assembly from contacting the sheet metal coil pan to minimize the potential for galvanic corrosion between coil and pan. Only available with louvered hail guards.

### E-coated (outdoor and indoor) coils

These coils feature a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins. The coating process ensures complete coil encapsulation of tubes, fins, and headers.

### Pre-coated outdoor coils

These coils feature a durable epoxy-phenolic coating that provides protection in mildly corrosive coastal environments. The coating minimizes galvanic action between dissimilar metals. The coating is applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.

### Condenser coil hail guard

These sleek, louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact. This can be purchased as a factory-installed option or as a field-installed accessory.

### Stainless steel heat exchanger (48GE units only)

For this option, the tubular heat exchanger is made out of a minimum 20 gauge type 409 stainless steel for applications where the mixed air going to the heat exchanger is expected to drop below 45°F (7°C). Stainless steel may be specified on applications where the presence of airborne contaminants require its use (applications such as paper mills) or in areas with very high outdoor humidity that may result in severe condensation in the heat exchanger during cooling operation.

### Convenience outlet (powered or un-powered)

Reduce service and/or installation costs by including a convenience outlet in your specification. Carrier will install this service feature at our factory. Provides a convenient, 15 amp, 115v GFCI receptacle with "Wet in Use" cover. The "powered" option allows the installer to power the outlet from the line side of the disconnect or load side as required by code. The "unpowered" option is to be powered from a separate 115/120v power source.

The unpowered convenience outlet is available as a 15 amp factory-installed option or a 20 amp field-installed accessory.

### Non-fused disconnect

This OSHA-compliant, factory-installed, safety switch allows a service technician to locally secure power to the rooftop. When selecting a factory-installed non-fused disconnect, note they are sized for the unit as ordered from the factory. The sizing of these do not accommodate field-installed items such as power exhaust devices, etc. If field installing electric heat with factory-installed non-fused disconnect switch, a single point kit may or may not be required.

## **HACR Breaker**

These manual reset devices provide overload and short circuit protection for the unit. Breakers are factory wired and mounted on the units, with an access cover to provide protection from the environment.

## **Condensate overflow switch**

This sensor and related controller monitors the condensate level in the drain pan and shuts down compression operation when overflow conditions occur. It includes:

- Indicator light — solid red (more than 10 seconds on water contact — compressors disabled), blinking red (sensor disconnected)
- 10-second delay to break — eliminates nuisance trips from splashing or waves in pan (sensor needs 10 seconds of constant water contact before tripping)
- Disables the compressors operation when condensate plug is detected, but still allows fans to run for economizer.

## **Power exhaust with barometric relief**

Superior internal building pressure control. This field-installed accessory may eliminate the need for costly, external pressure control fans.

## **MERV-13 4 in. return air filters**

This factory option upgrades the return air filters from standard unit filters to high efficiency MERV-13 filters. Non-woven MERV-13 filter media with high strength, moisture-resistant frame. Filter media is securely fastened inside the filter frame on all 4 sides.

## **High Short Circuit Current Rating (SCCR) protection**

This factory-installed option provides high short circuit current protection to each compressor, plus all indoor and outdoor fan motors of 60 kA (for 208/230-3-60 units) and 65 kA (for 460-3-60 units) against high potential fault current situations.

Standard unit comes with 5 kA rating.

This option is not available with factory installed Non-Fused Disconnect, Humidi-MiZer system, Phase loss monitor/protection, Powered convenience outlet, and 575 Volt models.

## **Pressure Relief Valve**

Units with the factory-installed pressure relief option contain a pressure relief valve in the unit liquid line for compliance with Chicago Municipal Code 18-28-1102.3. The pressure relief valve is set to open above 650 PSI and is intended to vent refrigerant in the event the refrigerant pressure exceeds the equipment design pressure. The pressure relief valve is single use and must be replaced after refrigerant discharge.

## Field-installed accessories

### Filter maintenance indicator

When the optional factory-installed filter maintenance indicator is used, a factory-installed differential pressure switch measures pressure drop across the outside air filter and activates a field-supplied dry contact indicator when the pressure differential exceeds the adjustable switch setpoint.

### Condenser coil hail guard

Sleek, louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact. This can be purchased as a factory-installed option or as a field-installed accessory.

### Differential enthalpy sensor

The differential enthalpy sensor is comprised of an outdoor and return air enthalpy sensors to provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.

### Wall or duct mounted CO<sub>2</sub> sensor

The IAQ sensor shall be available in duct or wall mount. The sensor provides demand ventilation indoor air quality (IAQ) control.

### Propane conversion kit (48GE units only)

Convert your gas heat rooftop from standard natural gas operation to Propane using this field-installed kit.

### High altitude conversion kit (48GE units only)

High altitudes have less oxygen, which affects the fuel/air mixture in heat exchangers. In order to maintain a proper fuel/air mixture, heat exchangers operating in altitudes above 2000 ft (610 m) require different orifices. To select the correct burner orifices or determine the heat capacity for a high altitude application, use either the selection software, or the unit's service manual. High altitudes have less oxygen, which means heat exchangers need less fuel. The new gas orifices in this field-installed kit make the necessary adjustment for high altitude applications. They restore the optimal fuel to air mixture and maintain healthy combustion on altitudes above 2000 ft (610 m).

NOTE: Typical natural gas heating value ranges from 975 to 1050 Btu/ft<sup>3</sup> at sea level nationally. The heating value goes down approximately 1.7% per every thousand feet elevation. Standard factory orifices can typically be used up to 2000 ft (610 m) elevation without any operational issues.

### Flue discharge deflector (48GE units only)

The flue discharge deflector is a useful accessory when flue gas recirculation is a concern. By venting the flue discharge

upwards, the deflector minimizes the chance for a neighboring unit to intake the flue exhaust.

### 4 in. filter rack kit

The 4 in. filter rack accessory kit is designed to hold 4 in. MERV-8 or MERV-13 filters. Filters not included in kit.

### MERV-13 2 in. return air filters

This kit includes MERV-13 2 in. filters (qty 4) to accommodate unit filter rack size.

### MERV-8 2 in. return air filters

This kit includes MERV-8 2 in. filters (qty 4) to accommodate unit filter rack size.

### Phase monitor protection

The Phase Monitor Control will monitor the sequence of 3-phase electrical system to provide a phase reversal protection; and monitor the 3-phase voltage inputs to provide a phase loss protection for the 3-phase device. It will work on either a Delta or Wye power connection.

### Roof curb (14 in./356 mm or 24 in./610 mm)

Full perimeter roof curb with exhaust capability provides separate air streams for energy recovery from the exhaust air without supply air contamination.

### Filter status indicator accessory

Monitors static pressure across supply and exhaust filters and provides indication when filters become clogged.

### Power exhaust

Superior internal building pressure control. This field-installed accessory may eliminate the need for costly, external pressure control fans.

### Manual OA damper

Manual outdoor air dampers are an economical way to bring in ventilation air. The dampers are available in 25% and 50% versions.

### Motorized Two-Position damper

The Carrier two-position, motorized outdoor air damper admits up to 100% outside air. Using reliable, gear-driven technology, the two-position damper opens to allow ventilation air and closes when the rooftop stops, stopping unwanted infiltration.

### Electric heaters (50GE units only)

Carrier offers a full-line of field-installed accessory heaters. The heaters are very easy to use, install and are all pre-engineered and certified.

## Options and Accessory Weights<sup>a</sup>





OPTION / ACCESSORY NAME	48/50GE UNIT WEIGHT							
	17		20		24		28	
	lb	kg	lb	kg	lb	kg	lb	kg
<b>Humidi-MiZer® System</b>	82	37	82	37	82	37	90	41
<b>Power Exhaust</b>	198	90	198	90	198	90	198	90
<b>EconoMi\$er® 2</b>	245	111	245	111	245	111	245	111
<b>High Gas Heat (48GE units only)</b>	132	60	132	60	132	60	132	60
<b>High Electric Heat (50GE units only)</b>	85	39	85	39	85	39	85	39
<b>Largest Single Point Box (50GE units only)</b>	20	9	20	9	20	9	20	9
<b>Hail Guard (louvered)</b>	90	41	90	41	100	46	100	46
<b>Cu/Cu Condenser Coil</b>	166	76	203	92	244	111	278	126
<b>Cu/Cu Evaporator Coil</b>	128	58	128	58	163	74	163	74
<b>Roof Curb (14 in. curb)</b>	240	109	255	116	255	116	255	116
<b>Roof Curb (24 in. curb)</b>	340	154	355	161	355	161	355	161
<b>CO<sub>2</sub> Sensor</b>	5	3	5	3	5	3	5	3
<b>Flue Discharge Deflector</b>	7	3	7	3	7	3	7	3
<b>Optional Indoor Motor<sup>b</sup></b>	30	14	30	14	30	14	0	0
<b>Return Air Smoke Detector</b>	7	3	7	3	7	3	7	3
<b>Supply Air Smoke Detector</b>	7	3	7	3	7	3	7	3
<b>Fan Filter Switch</b>	2	1	2	1	2	1	2	1
<b>Non-Fused Disconnect</b>	15	7	15	7	15	7	15	7
<b>Powered Convenience Outlet<sup>c</sup></b>	36	16	36	16	36	16	36	16
<b>Unpowered Convenience Outlet</b>	5	2	5	2	5	2	5	2
<b>Enthalpy Sensor</b>	2	1	2	1	2	1	2	1
<b>Differential Enthalpy Sensor</b>	3	1	3	1	3	1	3	1

NOTE(S):

- Where multiple variations are available, the heaviest combination is listed.
- Add the Optional Indoor Motor weight to the weight of the base unit.
- Weight includes convenience outlet and convenience outlet transformer.



### 48GE\*\*17 Base Unit Dimensions

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

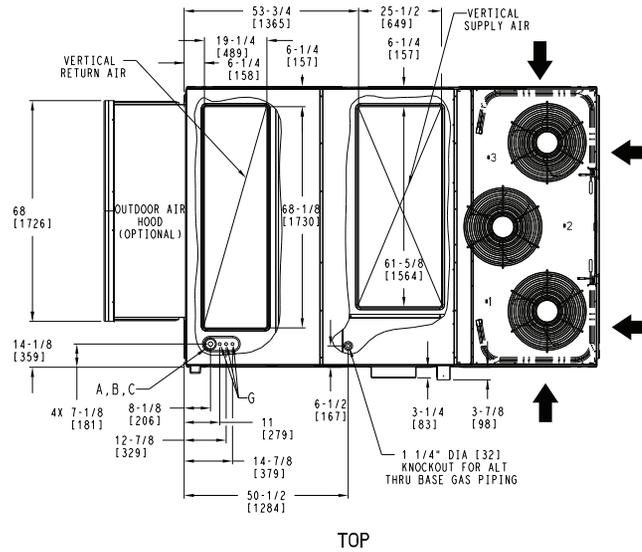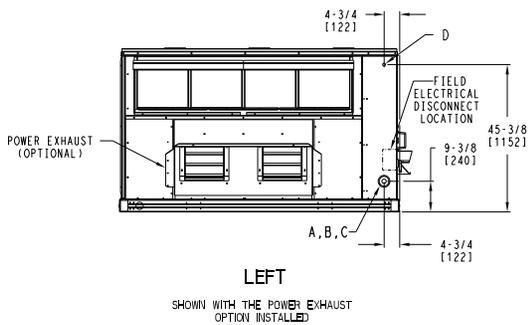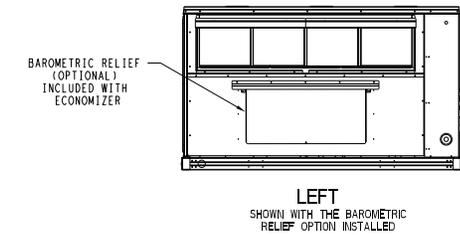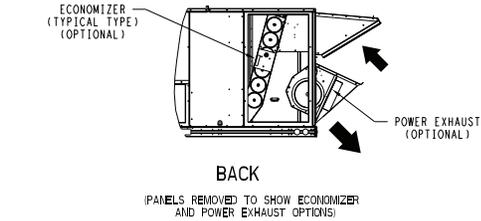

CONNECTION SIZES	
A	1 3/8" DIA [35] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
F	3/4"-14 NPT GAS CONNECTION (NOT SHOWN)
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT

- NOTES:
1. DIMENSIONS ARE IN INCHES, DIMENSIONS IN [ ] ARE IN MILLIMETERS.
  2. CENTER OF GRAVITY
  3. DIRECTION OF AIR FLOW
  4. ALL VIEW DRAWN USING 3RD ANGLE

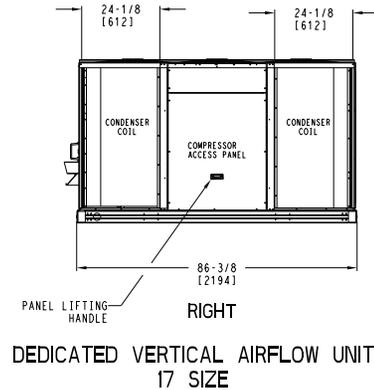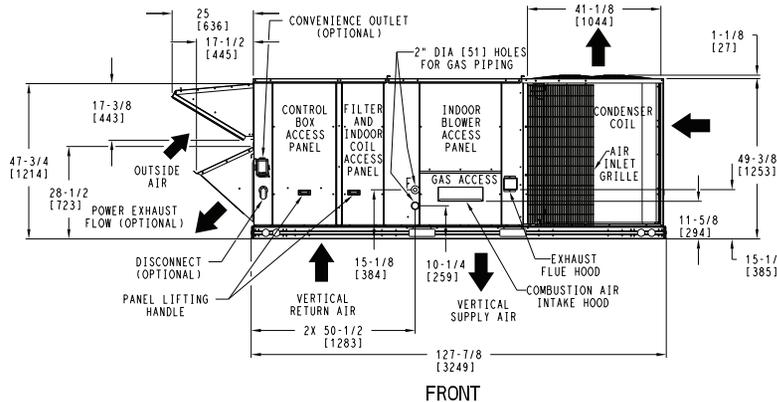

DEDICATED VERTICAL AIRFLOW UNIT  
17 SIZE

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	48GE 17 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008136	REV
U.S. ECCN:NSR	1 OF 5	09/08/25	08/20/24			A









48GE\*\*17 Base Unit Dimensions (cont)



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
A	1 3/8" DIA [35] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
F	3/4"-14 NPT GAS CONNECTION (NOT SHOWN)
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT

- NOTES:
1. DIMENSIONS ARE IN INCHES. DIMENSIONS IN [ ] ARE IN MILLIMETERS.
  2. CENTER OF GRAVITY
  3. DIRECTION OF AIR FLOW
  4. ALL VIEW DRAWN USING 3RD ANGLE

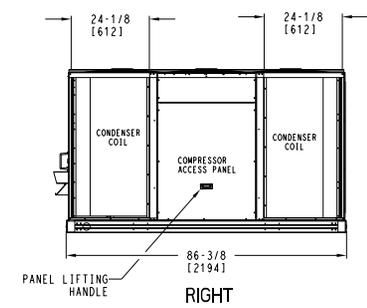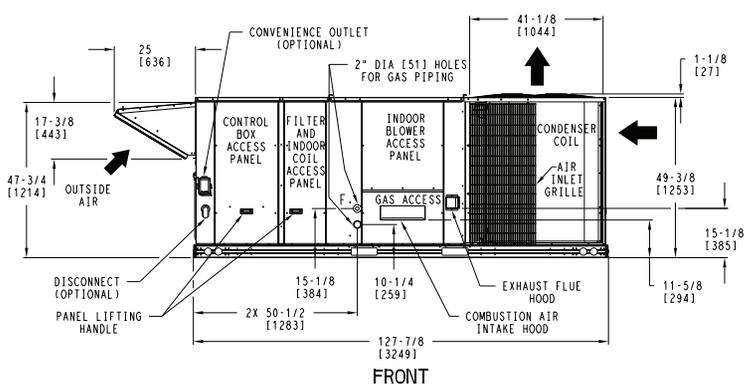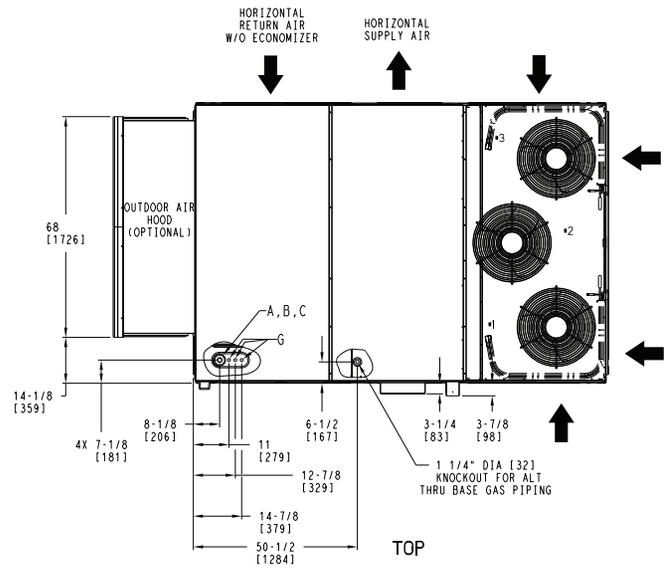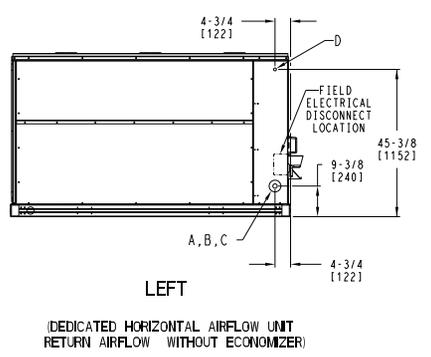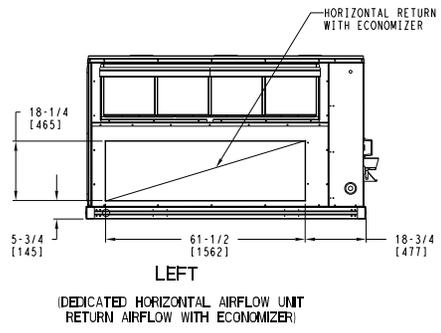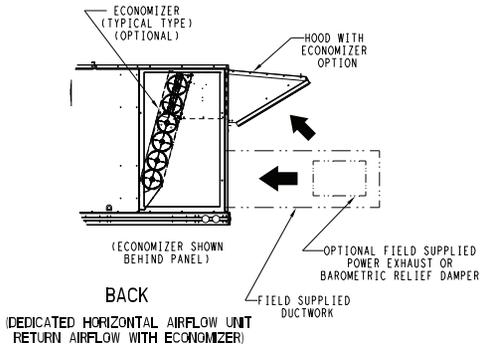

DEDICATED HORIZONTAL AIRFLOW UNIT 17 SIZE

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	48GE 17 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008136	REV
U.S. ECCN:NSR	2 OF 5	09/08/25	08/20/24			A






### 48GE\*\*17 Base Unit Dimensions (cont)



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
E	3/4"-14 NPT CONDENSATE DRAIN

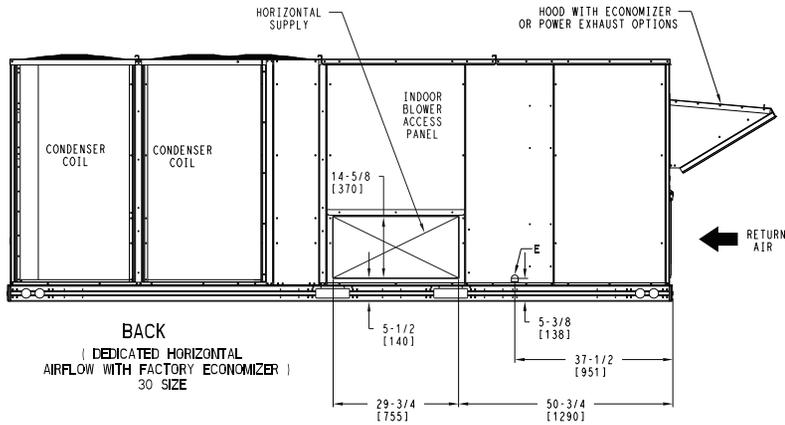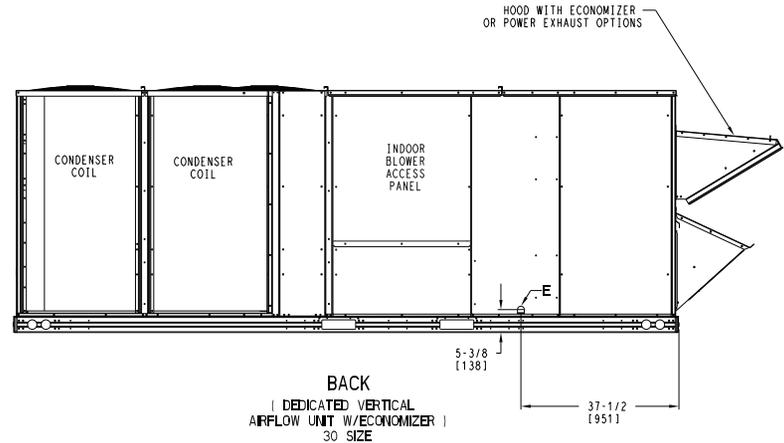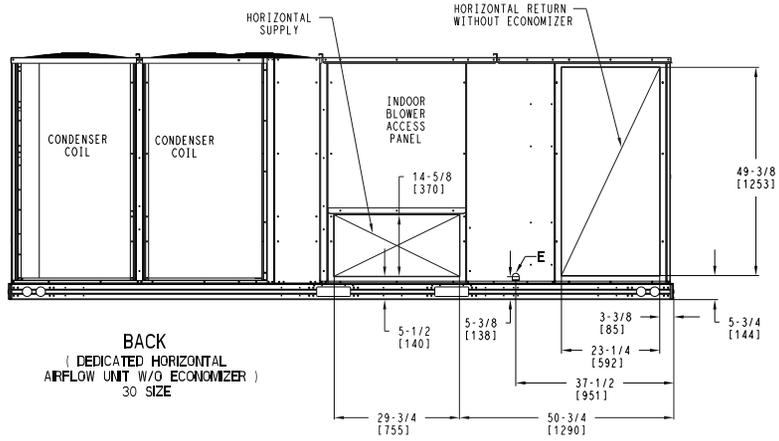

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	48GE 17 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008136	REV
U.S. ECCN:NSR	3 OF 5	09/08/25	08/20/24			A






### 48GE\*\*17 Base Unit Dimensions (cont)

UNIT	STD UNIT WEIGHT *		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		C.G.		
	LBS.	KG.	X	Y	Z								
48GE17	1732	786	369	167	461	209	501	227	401	182	71 [1803]	45 [1143]	16 1/2 [419]

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

\* STANDARD UNIT WEIGHT IS WITH LOW GAS HEAT AND WITHOUT PACKAGING. FOR OTHER OPTIONS AND ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.

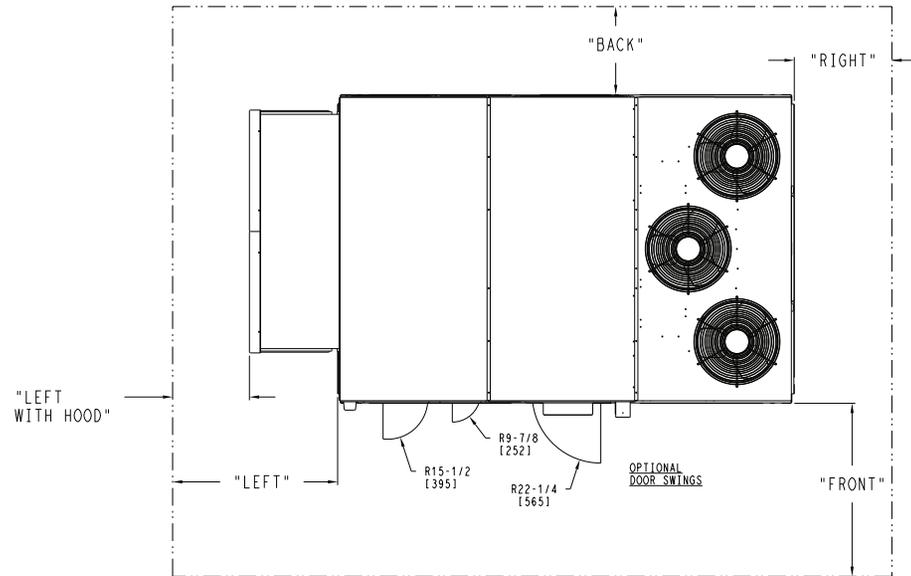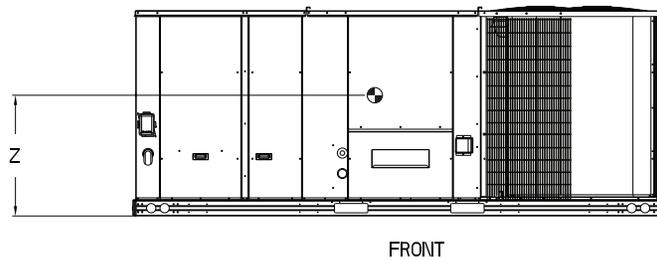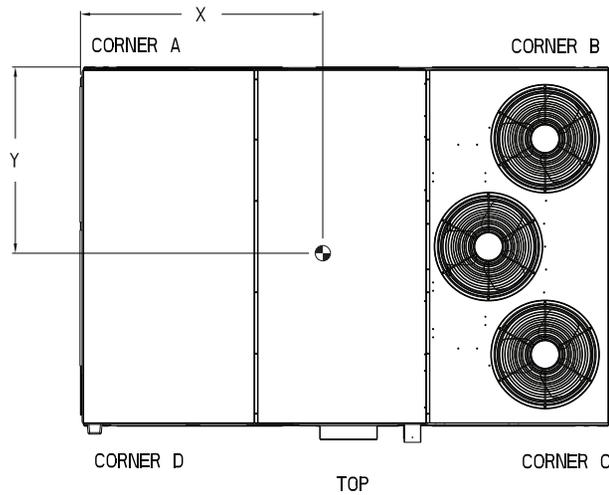

- NOTES:
- CLEARANCE ABOVE THE UNIT TO BE 72"
  - FOR ALL MINIMUM CLEARANCES LOCAL CODES OR JURISDICTIONS MAY PREVAIL.



SURFACE	SERVICE WITH:		OPERATING CLEARANCE
	CONDUCTIVE BARRIER	NONCONDUCTIVE BARRIER	
FRONT	48 [1219mm]	36 [914mm]	18 [457mm]
LEFT	48 [1219mm]	42 [1067mm]	18 [457mm]
BACK	42 [1067mm]	36 [914mm]	18 [457mm]
LEFT WITH HOOD	36 [914mm]	36 [914mm]	18 [457mm]
RIGHT	36 [914mm]	36 [914mm]	18 [457mm]
TOP	72 [1829mm]	72 [1829mm]	72 [1829mm]

ITC CLASSIFICATION U.S. ECCN: NSR	SHEET 4 OF 5	DATE 09/08/25	SUPERCEDES 08/20/24	48GE 17 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008136	REV A
--------------------------------------	-----------------	------------------	------------------------	--	------------	----------





### 48GE\*\*17 Base Unit Dimensions (cont)

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

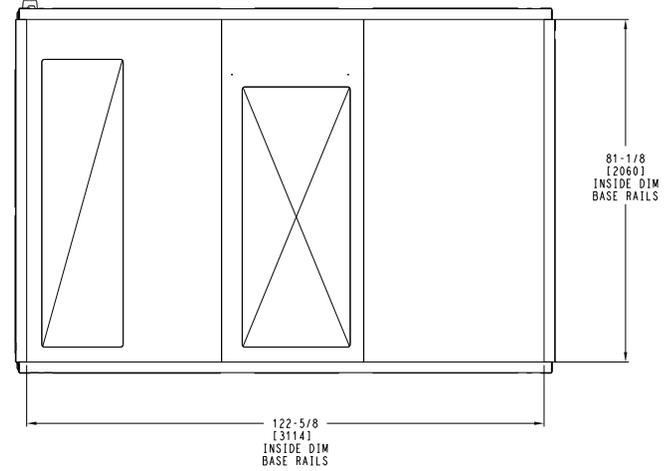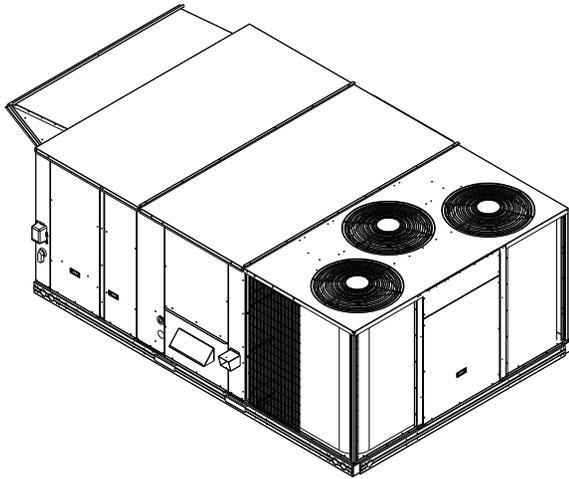

**BOTTOM**  
INSIDE BASERAIL DIMENSIONS

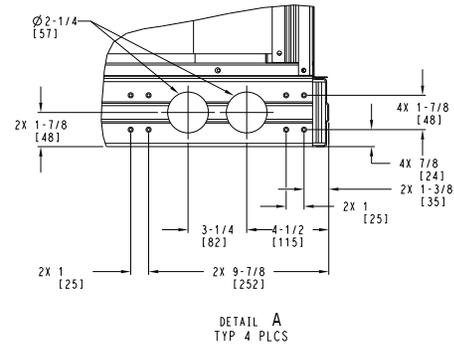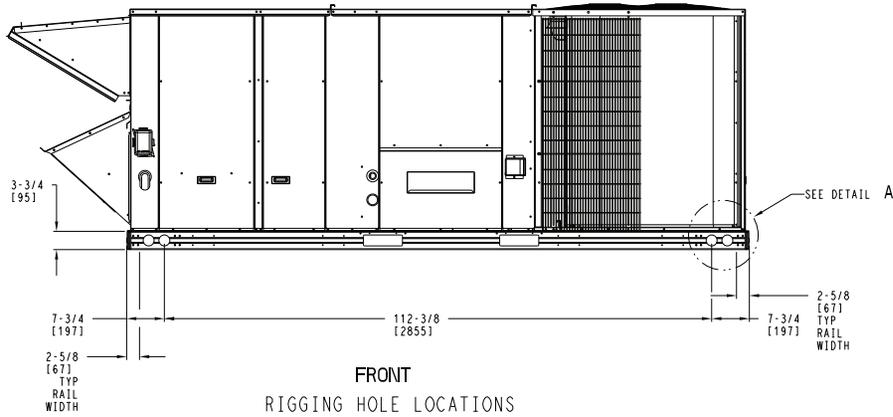





ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	48GE 17 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008136	REV
U.S. ECCN: NSR	5 OF 5	09/08/25	08/20/24			A



### 48GE\*\*20-24 Base Unit Dimensions





THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

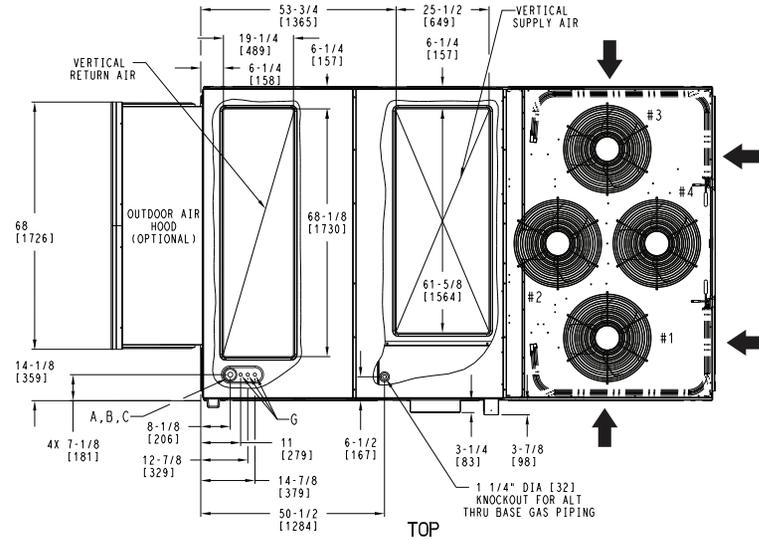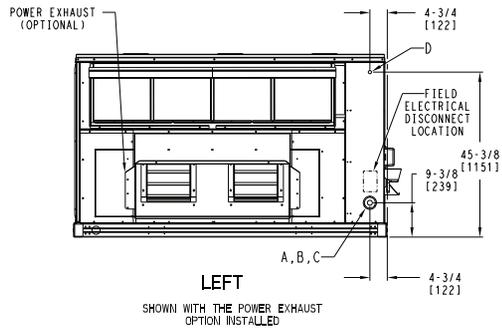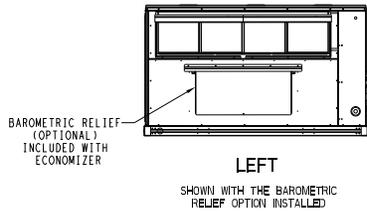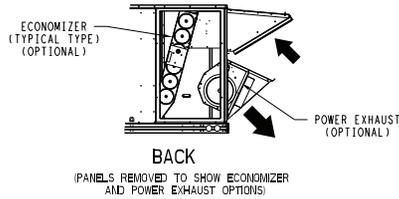

CONNECTION SIZES	
A	1 3/8" DIA [35] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
F	3/4"-14 NPT GAS CONNECTION (NOT SHOWN)
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT

UNIT	H
20 SIZE	49-3/8 [1253]
24 SIZE	57-3/8 [1456]

- NOTES:
1. DIMENSIONS ARE IN INCHES, DIMENSIONS IN [ ] ARE IN MILLIMETERS.
  2. CENTER OF GRAVITY
  3. DIRECTION OF AIR FLOW
  4. ALL VIEW DRAWN USING 3RD ANGLE

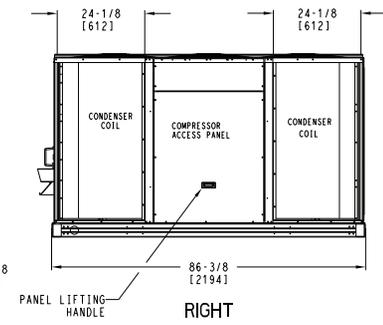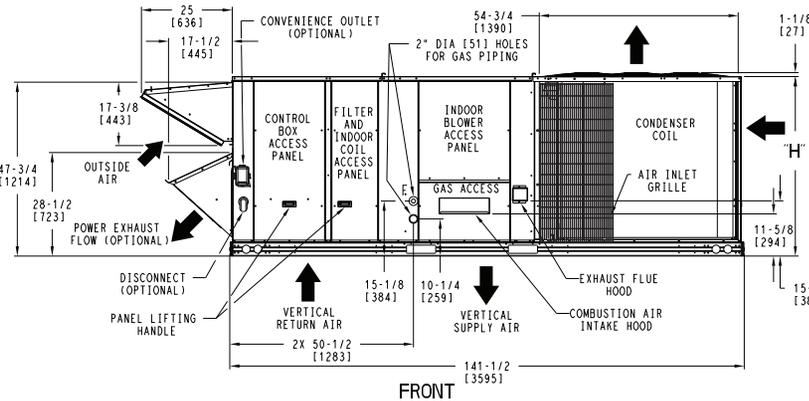

DEDICATED VERTICAL AIRFLOW UNIT  
20,24 SIZE

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	48GE 20,24 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008137	REV
U.S. ECCN:NSR	1 OF 5	09/08/25	08/21/24			A









### 48GE\*\*20-24 Base Unit Dimensions (cont)

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
A	1 3/8" DIA [35] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
F	3/4"-14 NPT GAS CONNECTION (NOT SHOWN)
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT

- NOTES:
1. DIMENSIONS ARE IN INCHES. DIMENSIONS IN [ ] ARE IN MILLIMETERS.
  2. CENTER OF GRAVITY
  3. DIRECTION OF AIR FLOW
  4. ALL VIEW DRAWN USING 3RD ANGLE

UNIT	H
20 SIZE	49-3/8 [1253]
24 SIZE	57-3/8 [1456]

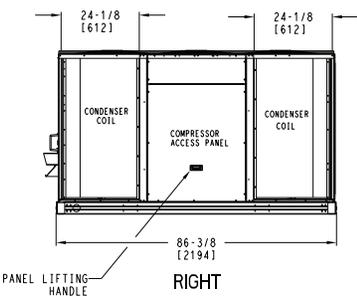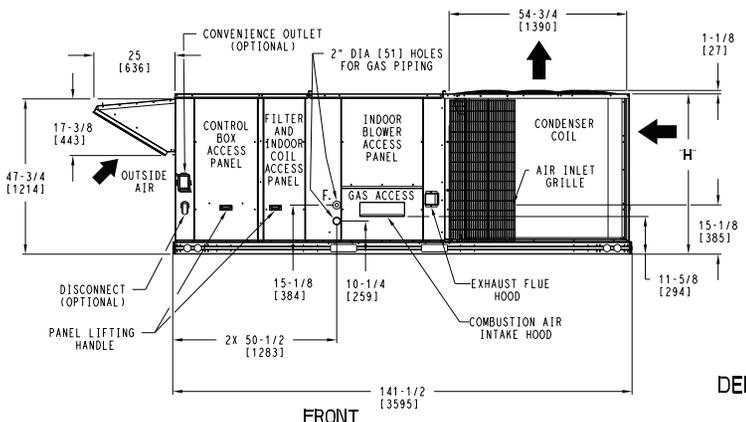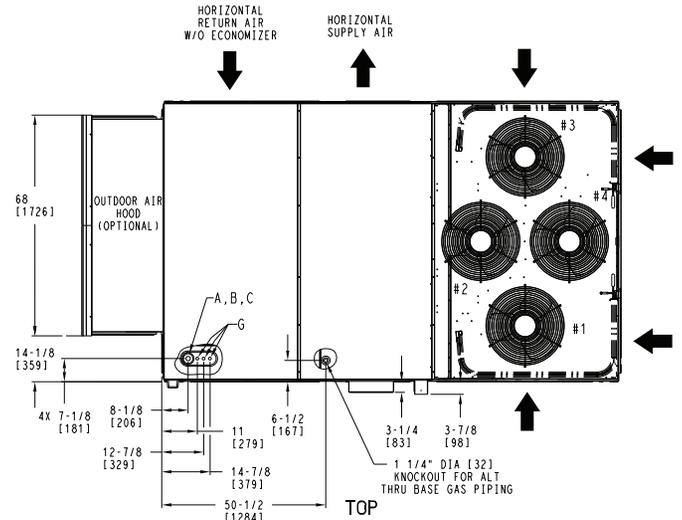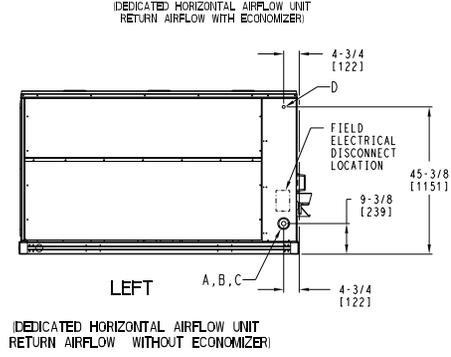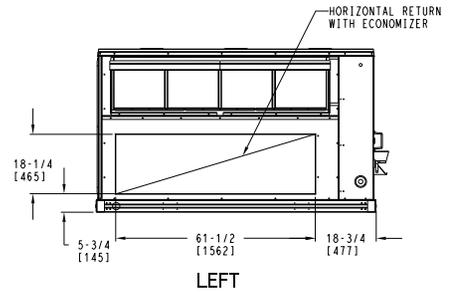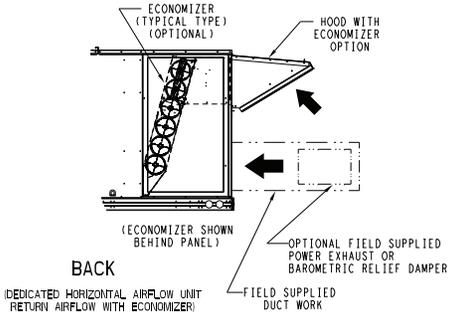

DEDICATED HORIZONTAL AIRFLOW UNIT 20,24 SIZE

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	48GE 20,24 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008137	REV
U.S. ECCN:NSR	2 OF 5	09/08/25	08/21/24			A








### 48GE\*\*20-24 Base Unit Dimensions (cont)

CONNECTION SIZES	
E	3/4"-14 NPT CONDENSATE DRAIN

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

UNIT	G
20 SIZE	41-3/8 [1049]
24 SIZE	49-1/4 [1251]

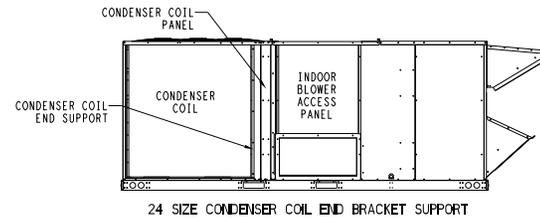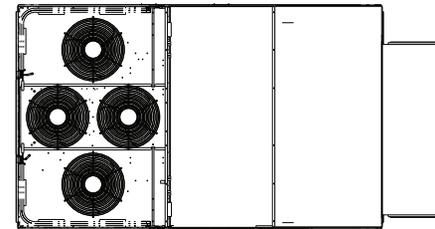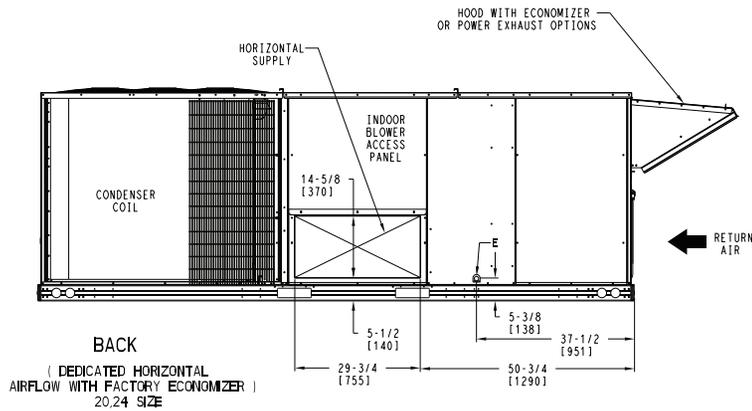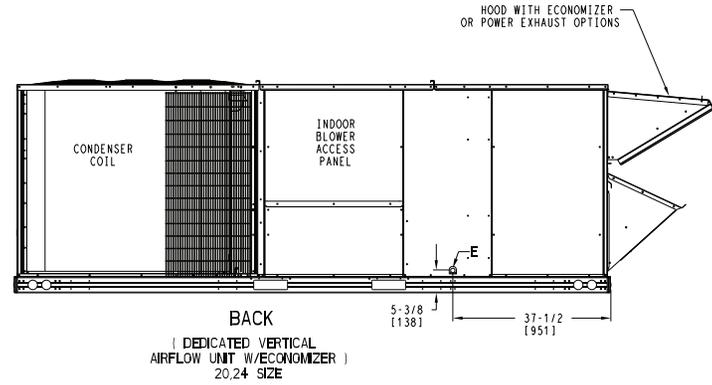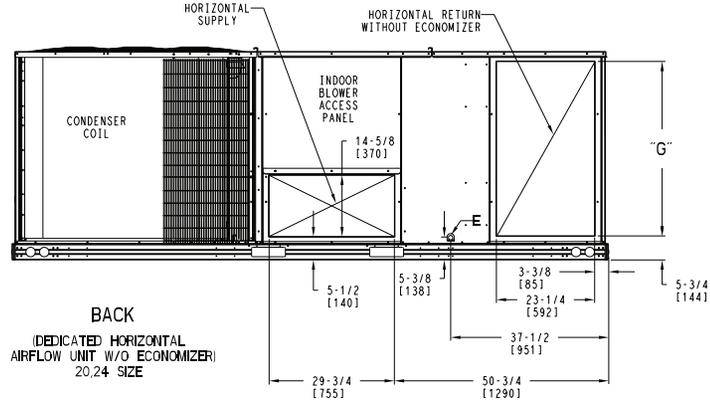

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	48GE 20.24 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008137	REV
U.S. ECCN:NSR	3 OF 5	09/08/25	08/21/24			A






### 48GE\*\*20-24 Base Unit Dimensions (cont)

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

UNIT	STD UNIT WEIGHT *		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		C.G.		
	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	X	Y	Z
48GE 20	2010	912	449	204	537	243	557	253	467	212	77 [1956]	44 [1118]	16 1/2 [419]
48GE 24	2290	1039	542	246	542	246	603	274	603	274	70 3/4 [1797]	45 1/2 [1156]	16 1/2 [419]

\* STANDARD UNIT WEIGHT IS WITH LOW GAS HEAT AND WITHOUT PACKAGING. FOR OTHER OPTIONS AND ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.

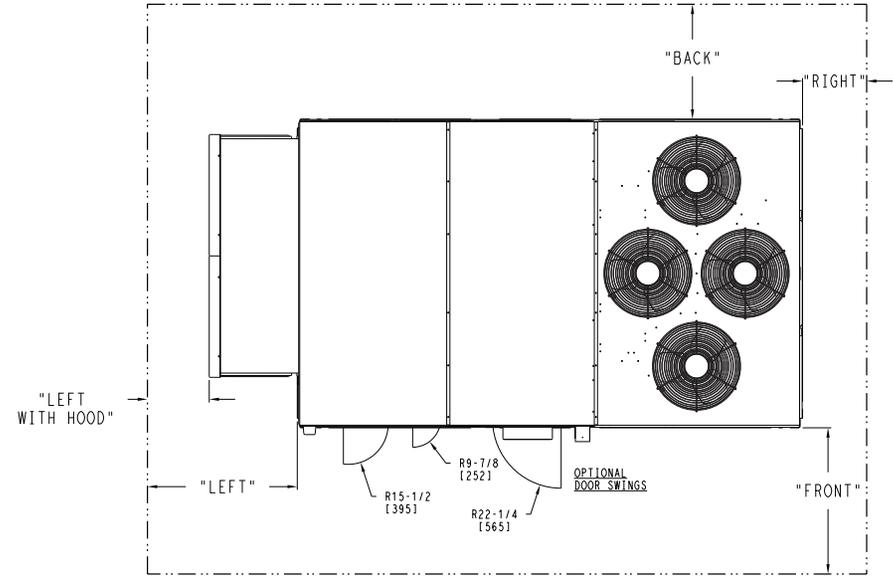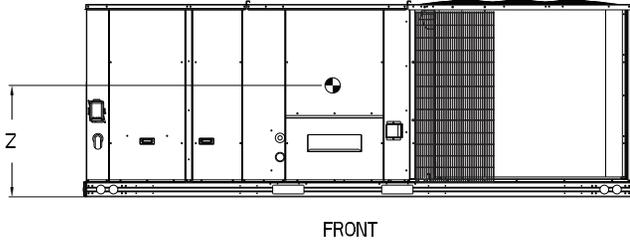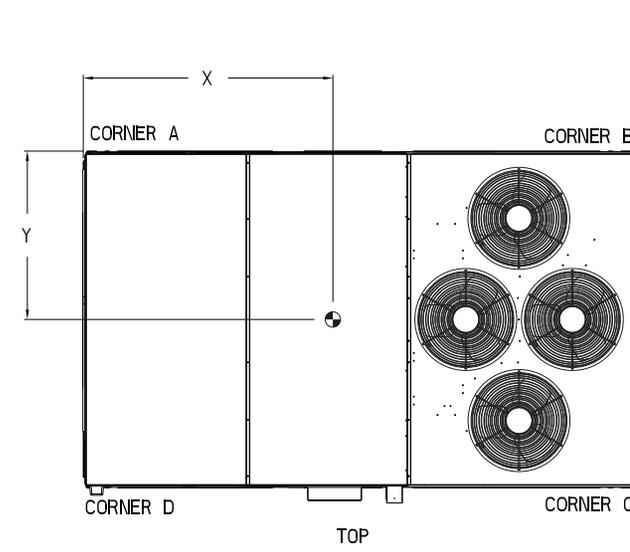

- NOTES:
1. CLEARANCE ABOVE THE UNIT TO BE 72"
  2. FOR ALL MINIMUM CLEARANCES LOCAL CODES OR JURISDICTIONS MAY PREVAIL.



SURFACE	CLEARANCE		OPERATING CLEARANCE
	SERVICE WITH CONDUCTIVE BARRIER	SERVICE WITH NONCONDUCTIVE BARRIER	
FRONT	48 [1219mm]	36 [914mm]	18 [457mm]
LEFT	48 [1219mm]	42 [1067mm]	18 [457mm]
BACK	42 [1067mm]	36 [914mm]	18 [457mm]
LEFT WITH HOOD	36 [914mm]	36 [914mm]	18 [457mm]
RIGHT	36 [914mm]	36 [914mm]	18 [457mm]
TOP	72 [1829mm]	72 [1829mm]	72 [1829mm]

ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 4 OF 5	DATE 09/08/25	SUPERCEDES 08/21/24	48GE 20,24 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008137	REV A
-------------------------------------	-----------------	------------------	------------------------	---	------------	----------





48GE\*\*20-24 Base Unit Dimensions (cont)

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

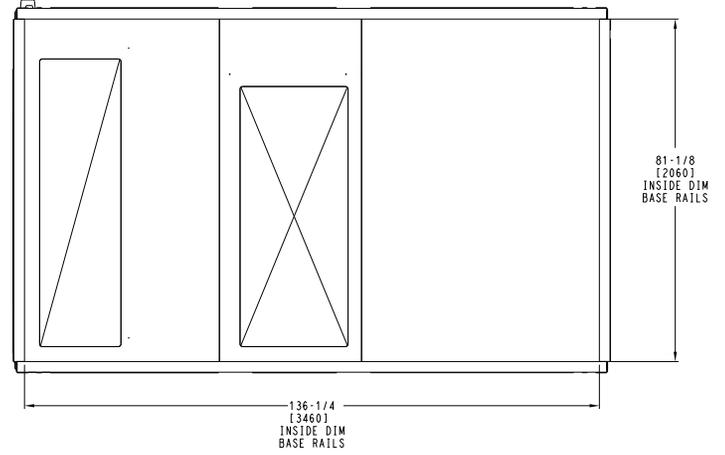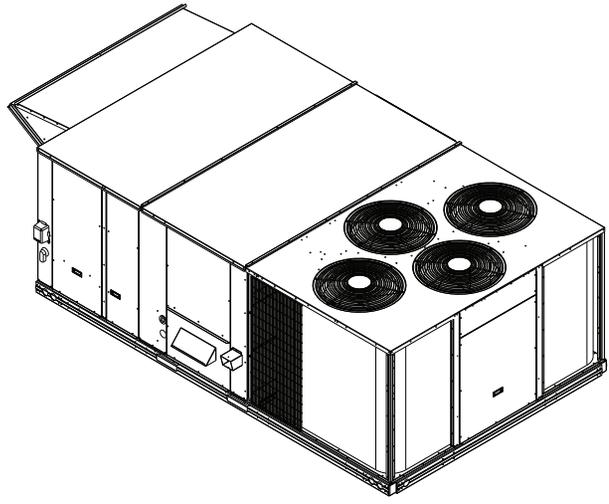

**BOTTOM**  
INSIDE BASERAIL DIMENSIONS

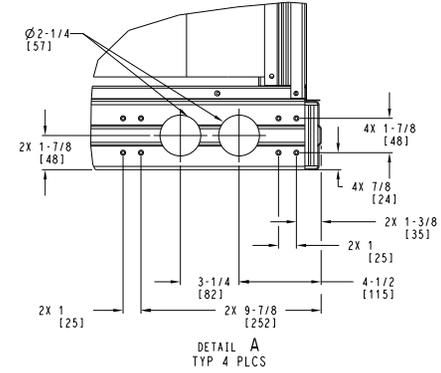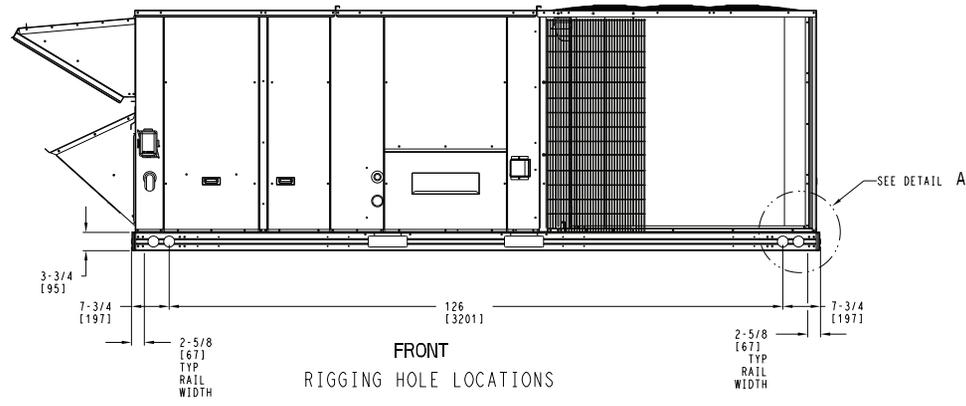





ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 5 OF 5	DATE 09/08/25	SUPERCEDES 08/21/24	48GE 20,24 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008137	REV A
-------------------------------------	-----------------	------------------	------------------------	--	------------	----------





### 48GE\*\*28 Base Unit Dimensions

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
A	1 3/8" DIA [35] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
F	3/4"-14 NPT GAS CONNECTION (NOT SHOWN)
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT

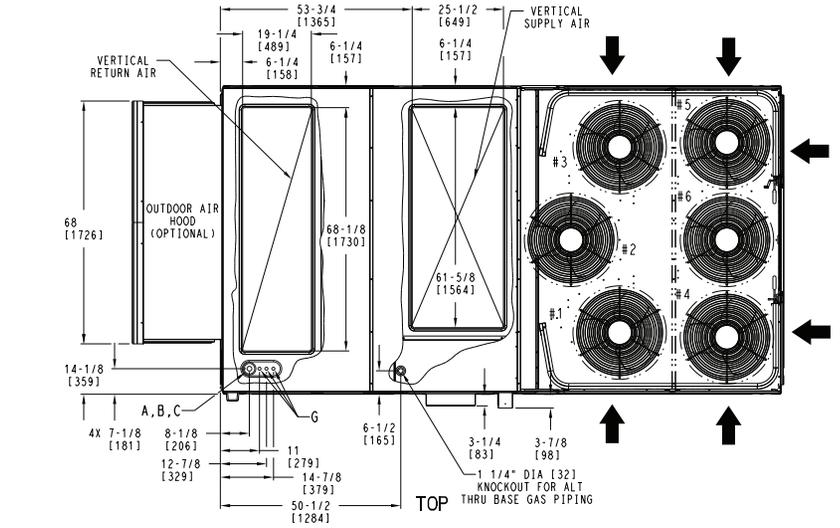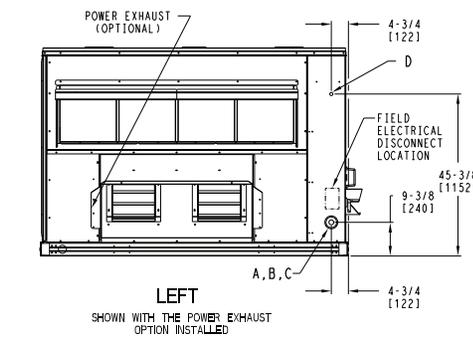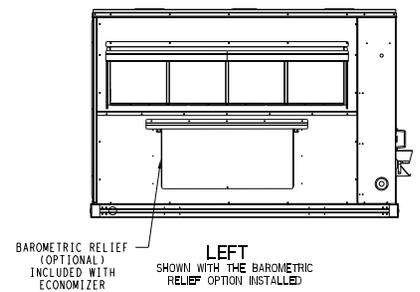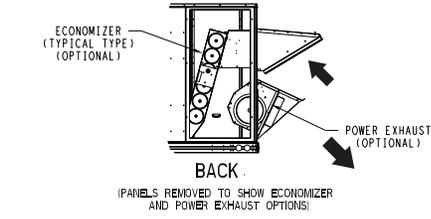

- NOTES:
1. DIMENSIONS ARE IN INCHES, DIMENSIONS IN [ ] ARE IN MILLIMETERS.
  2. CENTER OF GRAVITY
  3. DIRECTION OF AIR FLOW
  4. ALL VIEW DRAWN USING 3RD ANGLE

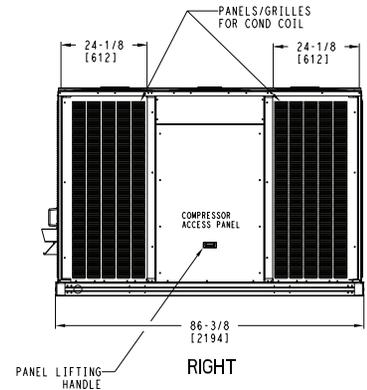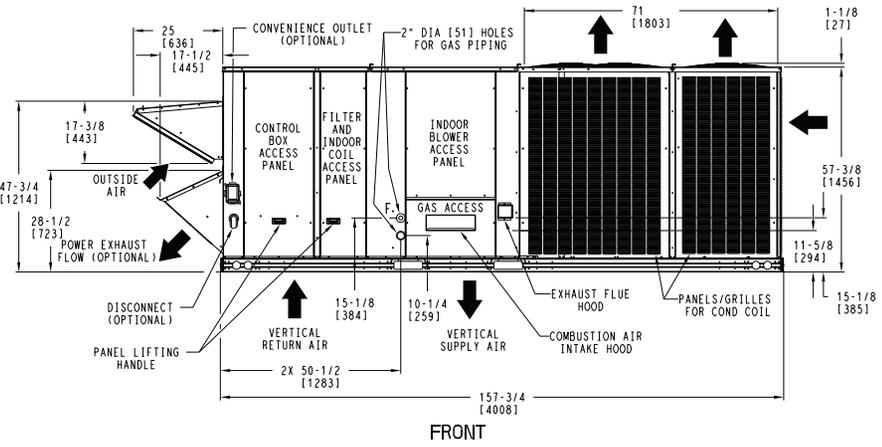

DEDICATED VERTICAL AIRFLOW UNIT 28 SIZE

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	48GE 28 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	REV
U.S. ECCN:NSR	1 OF 5	09/08/25	08/21/24	50HE008138	A









### 48GE\*\*28 Base Unit Dimensions (cont)

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
A	1 3/8" DIA [35] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
F	3/4"-14 NPT GAS CONNECTION (NOT SHOWN)
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT

- NOTES:
1. DIMENSIONS ARE IN INCHES, DIMENSIONS IN [ ] ARE IN MILLIMETERS.
  2. CENTER OF GRAVITY
  3. DIRECTION OF AIR FLOW
  4. ALL VIEW DRAWN USING 3RD ANGLE

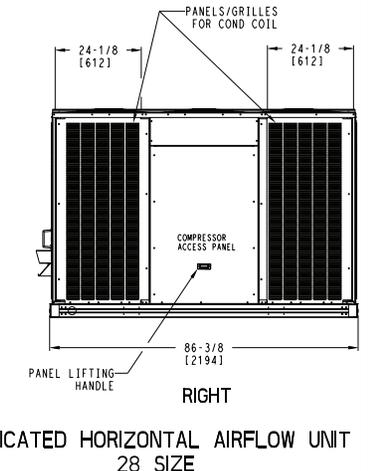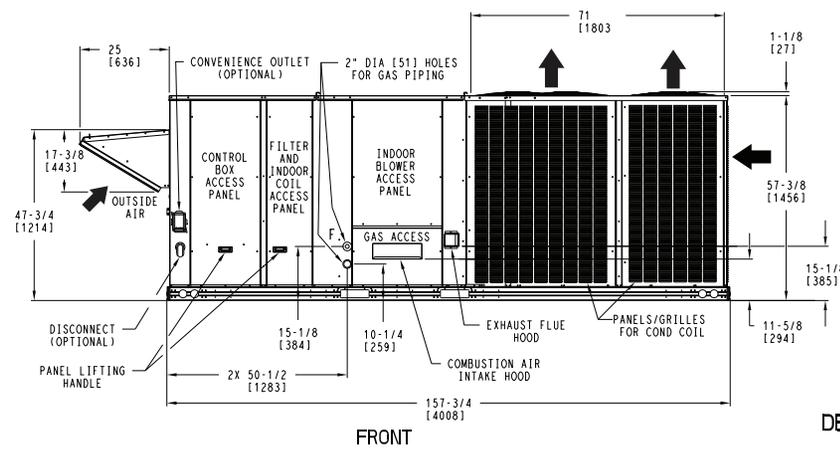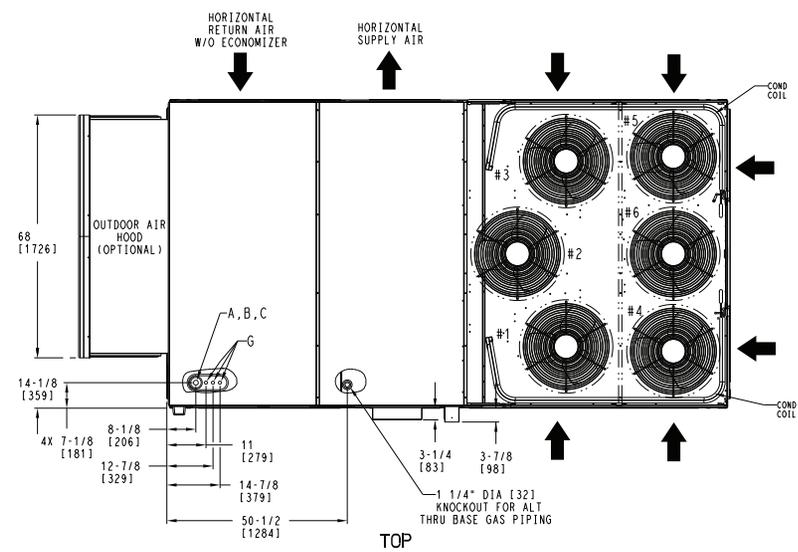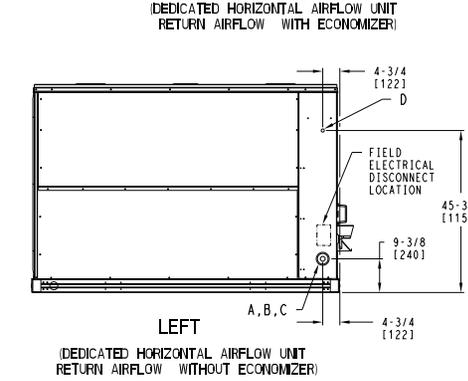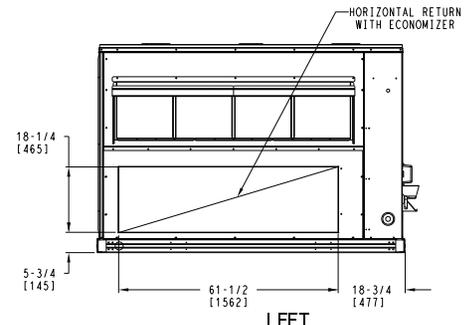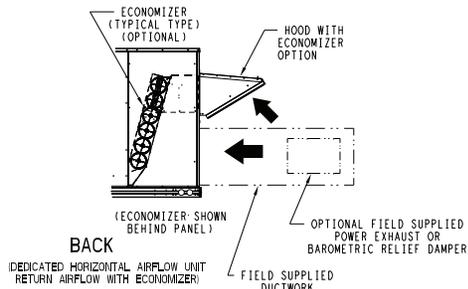




ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	48GE 28 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008138	REV
U.S. ECCN:NSR	2 OF 5	09/08/25	08/21/24			A



### 48GE\*\*28 Base Unit Dimensions (cont)

	THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.	SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.
--	---	---

CONNECTION SIZES	
E	3/4"-14 NPT CONDENSATE DRAIN

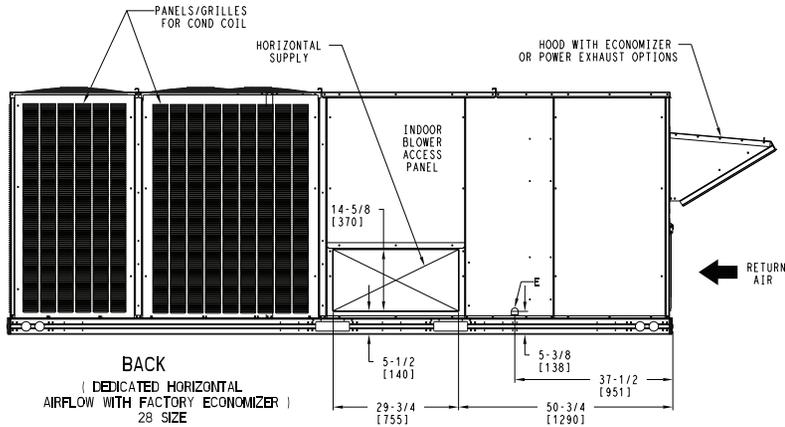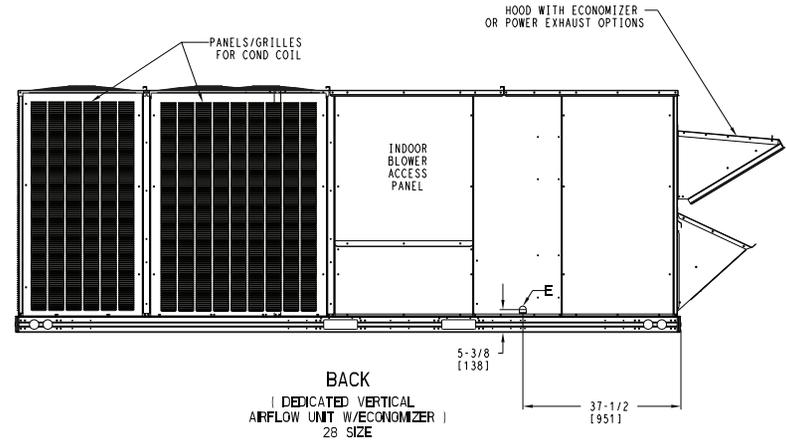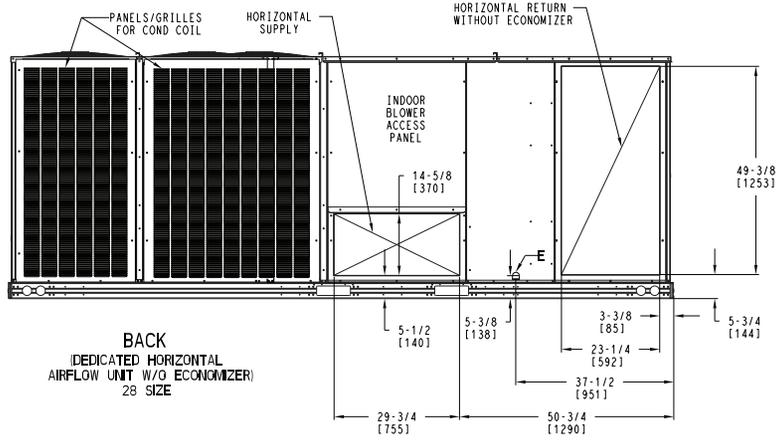

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	48GE 28 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008138	REV
U.S. ECCN:NSR	3 OF 5	09/08/25	08/21/24			A



### 48GE\*\*28 Base Unit Dimensions (cont)




UNIT	STD UNIT WEIGHT *		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		C.G.		
	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	X	Y	Z
48GE28	2383	1081	495	225	605	274	705	320	578	262	86 3/4 [2203]	46 1/2 [1181]	19 [483]



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

\* STANDARD UNIT WEIGHT IS WITH LOW GAS HEAT AND WITHOUT PACKAGING. FOR OTHER OPTIONS AND ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.

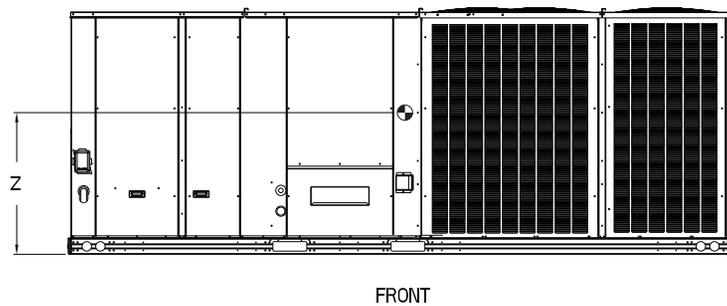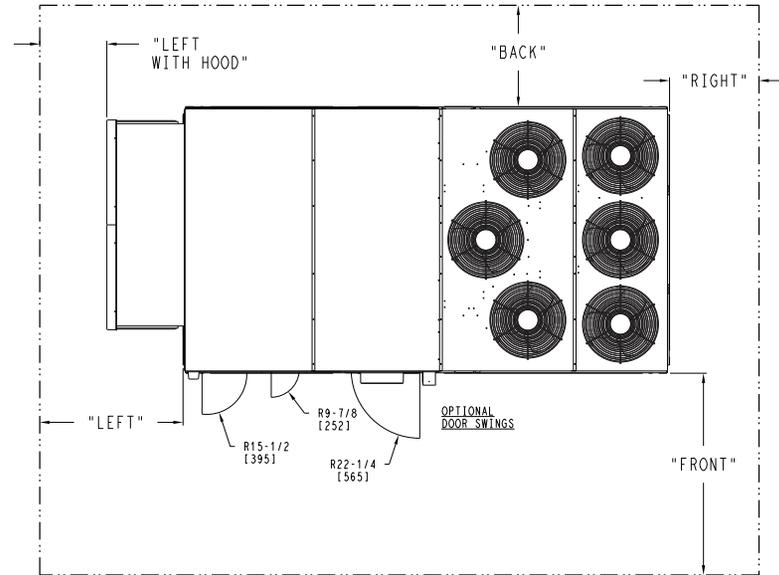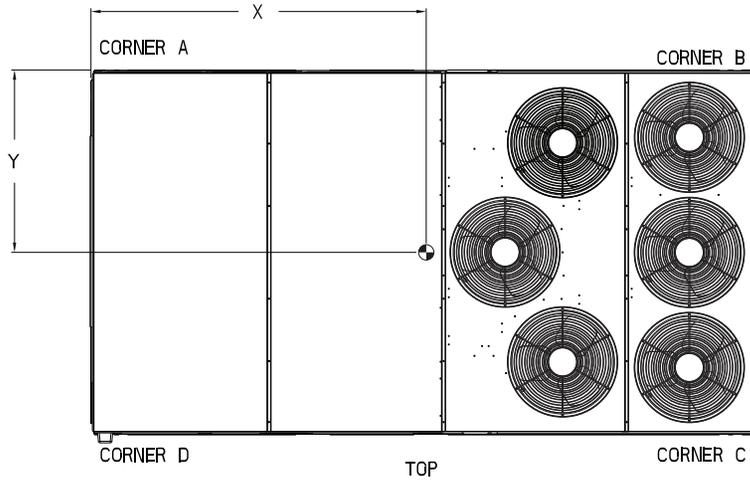

**NOTES:**

1. CLEARANCE ABOVE THE UNIT TO BE 72"
2. FOR ALL MINIMUM CLEARANCES LOCAL CODES OR JURISDICTIONS MAY PREVAIL.



SURFACE	CLEARANCE		OPERATING CLEARANCE
	SERVICE WITH CONDUCTIVE BARRIER	SERVICE WITH NONCONDUCTIVE BARRIER	
FRONT	48 [1219mm]	36 [914mm]	18 [457mm]
LEFT	48 [1219mm]	42 [1067mm]	18 [457mm]
BACK	42 [1067mm]	36 [914mm]	18 [457mm]
LEFT WITH HOOD	36 [914mm]	36 [914mm]	18 [457mm]
RIGHT	36 [914mm]	36 [914mm]	18 [457mm]
TOP	72 [1829mm]	72 [1829mm]	72 [1829mm]

ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 4 OF 5	DATE 09/08/25	SUPERCEDES 08/21/24	48GE 28 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008138	REV A
-------------------------------------	-----------------	------------------	------------------------	--	------------	----------




### 48GE\*\*28 Base Unit Dimensions (cont)

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

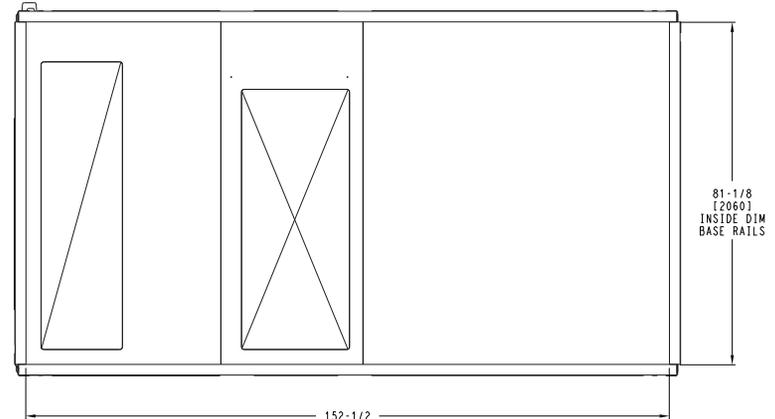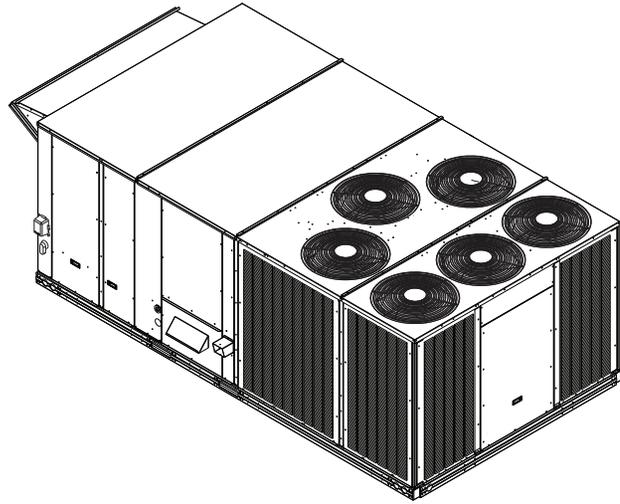


**BOTTOM**

INSIDE BASERAIL DIMENSIONS

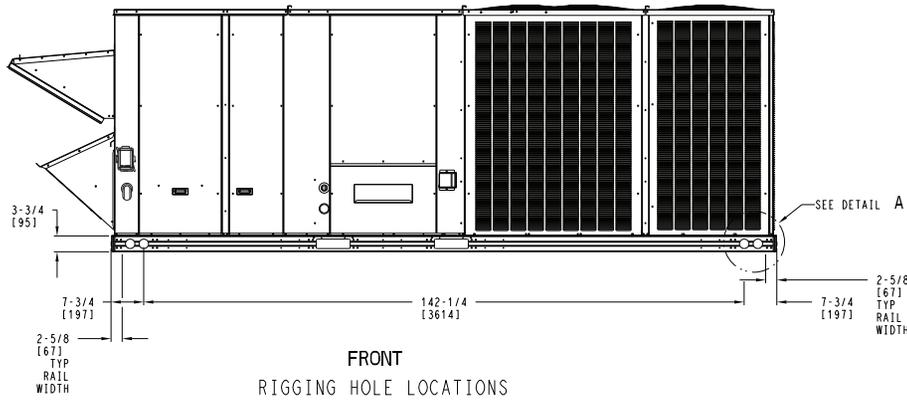

**FRONT**

RIGGING HOLE LOCATIONS

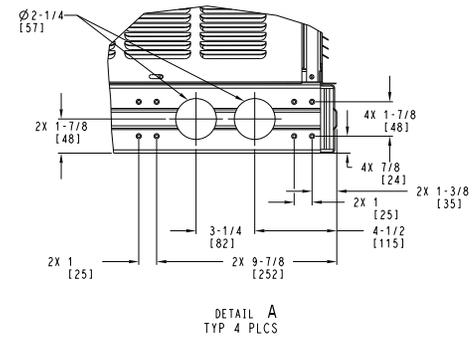

**DETAIL A**  
TYP 4 PLCS

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	48GE 28 SINGLE ZONE ELECTRICAL COOLING WITH GAS HEAT	50HE008138	REV
U.S. ECCN:NSR	5 OF 5	09/08/25	08/21/24			A









### 50GE-\*17 Base Unit Dimensions

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
A	1 3/8" DIA [35] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT

- NOTES:
1. DIMENSIONS ARE IN INCHES. DIMENSIONS IN [ ] ARE IN MILLIMETERS.
  2. CENTER OF GRAVITY
  3. DIRECTION OF AIR FLOW
  4. ALL VIEW DRAWN USING 3RD ANGLE

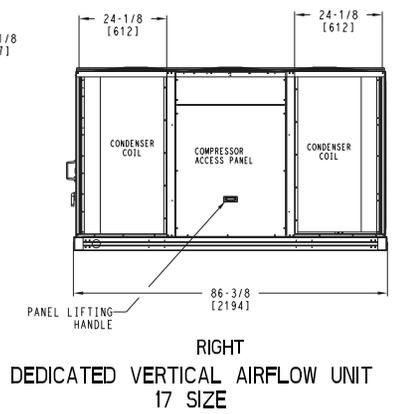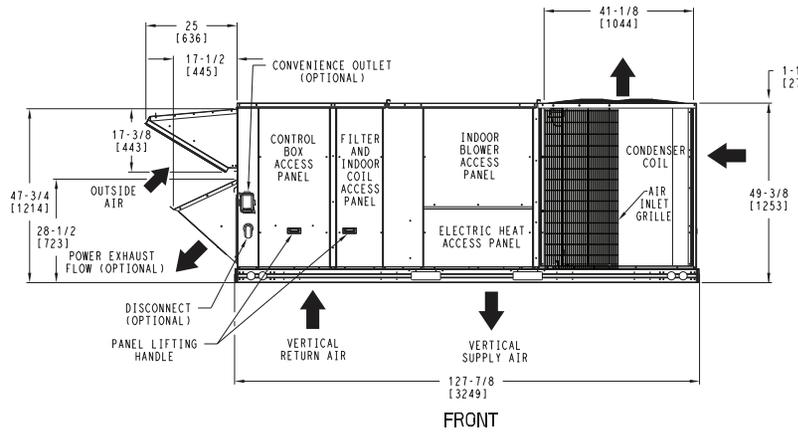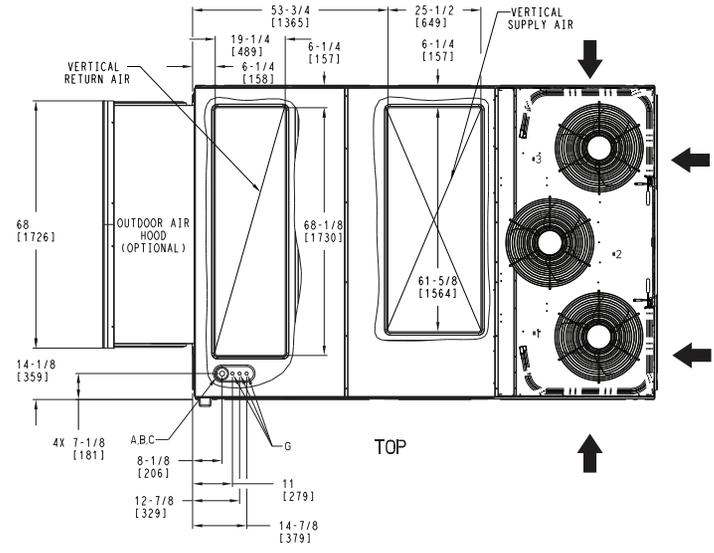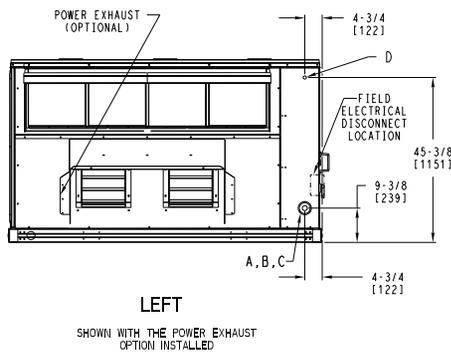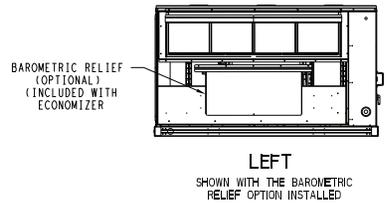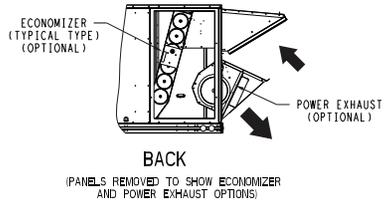

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	50GE 17 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	50HE008145	REV
U.S. ECCN:NSR	1 OF 5	09/08/25	08/21/24			A








### 50GE-\*17 Base Unit Dimensions (cont)

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
A	1 3/8" DIA [35] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT

- NOTES:
1. DIMENSIONS ARE IN INCHES. DIMENSIONS IN [ ] ARE IN MILLIMETERS.
  2. CENTER OF GRAVITY
  3. DIRECTION OF AIR FLOW
  4. ALL VIEW DRAWN USING 3RD ANGLE

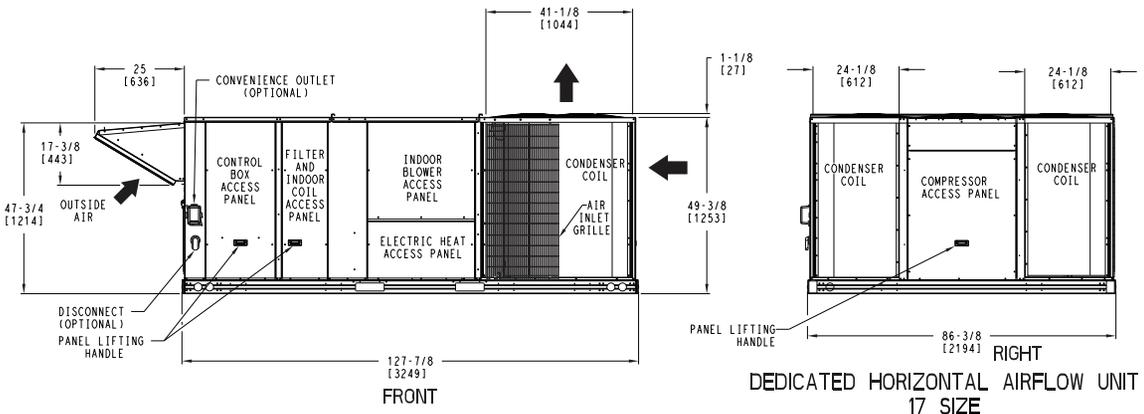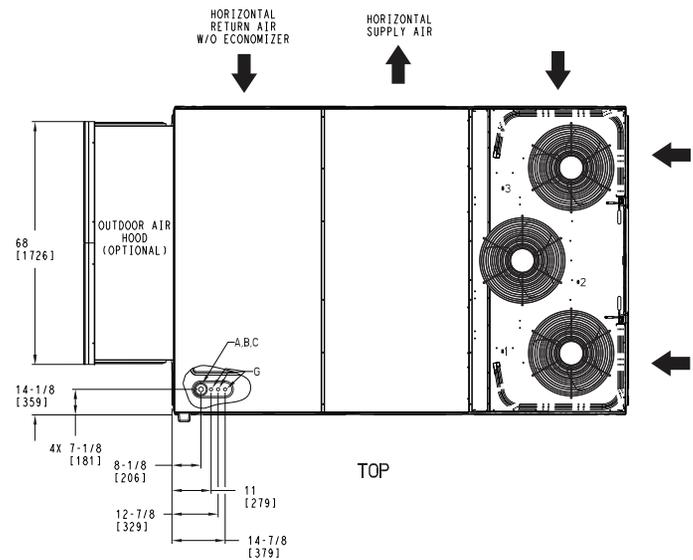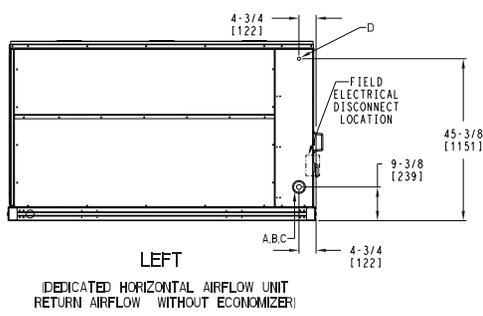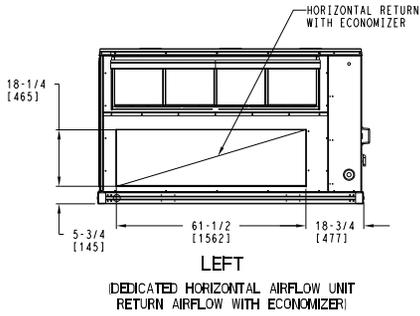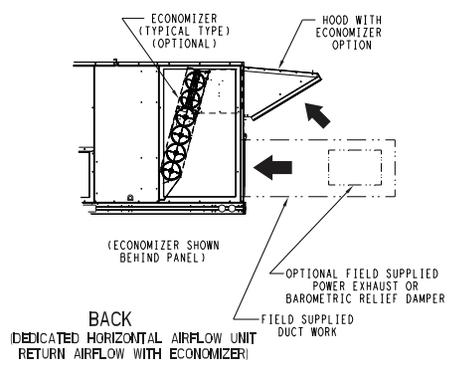




ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	50GE 17 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	REV
U.S. ECCN:NSR	2 OF 5	09/08/25	08/21/24	50HE008145	A



### 50GE-\*17 Base Unit Dimensions (cont)

CONNECTION SIZES	
E	3/4" - 14 NPT CONDENSATE DRAIN

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

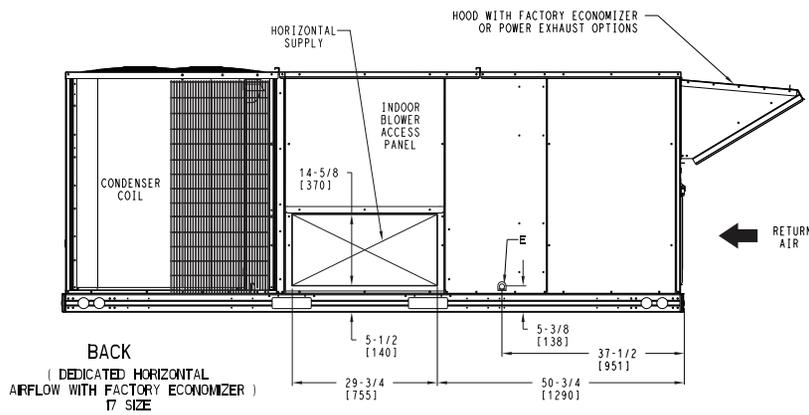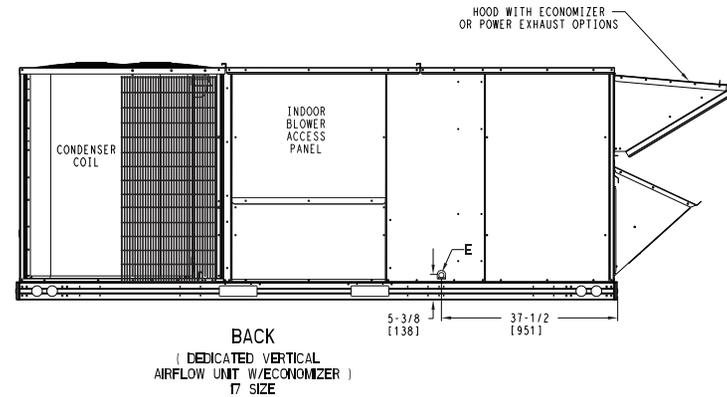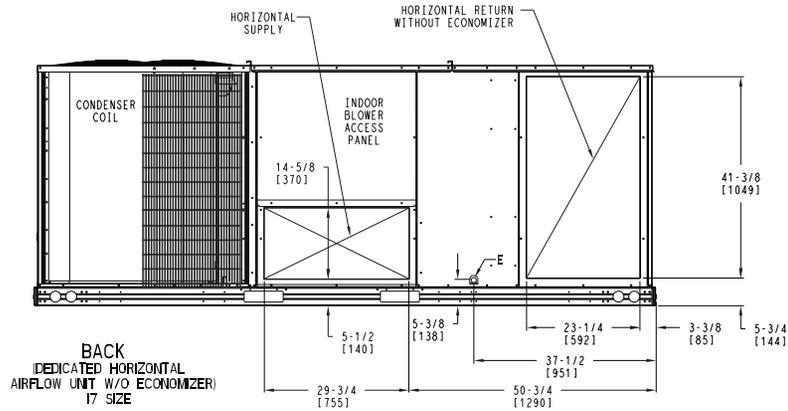

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	50GE 17 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	50HE008145	REV
U.S. ECCN:NSR	3 OF 5	09/08/25	08/21/24			A






### 50GE-\*17 Base Unit Dimensions (cont)

UNIT	STD UNIT WEIGHT #		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		C.G.		
	LBS.	KG.	X	Y	Z								
50GE17	1640	744	349	158	436	198	475	215	380	172	71 [1803]	45 [1143]	16 1/2 [419]

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

\* STANDARD UNIT WEIGHT IS WITHOUT ELECTRIC HEAT AND WITHOUT PACKAGING. FOR OTHER OPTIONS AND ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.

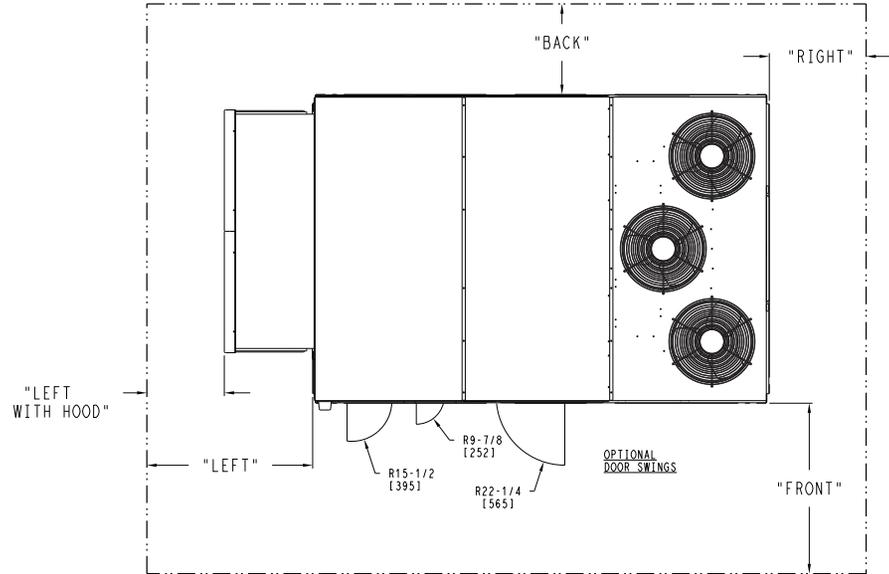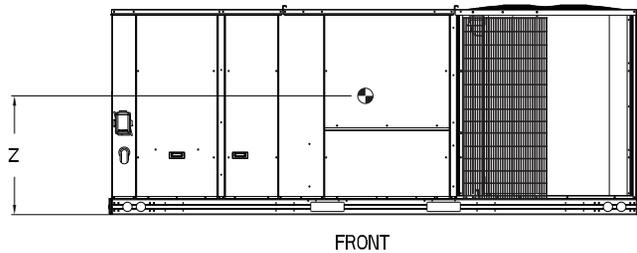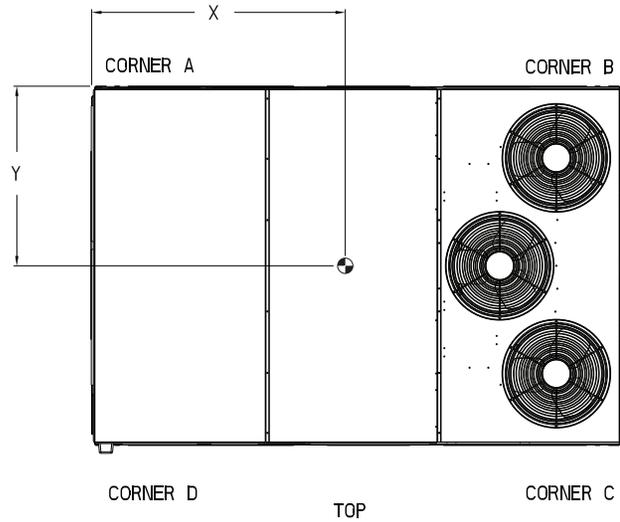

**NOTES:**

1. CLEARANCE ABOVE THE UNIT TO BE 72"
2. FOR ALL MINIMUM CLEARANCES LOCAL CODES OR JURISDICTIONS MAY PREVAIL.





SURFACE	CLEARANCE		OPERATING CLEARANCE
	SERVICE WITH CONDUCTIVE BARRIER	SERVICE WITH NONCONDUCTIVE BARRIER	
FRONT	48 [1219mm]	36 [914mm]	18 [457mm]
LEFT	48 [1219mm]	42 [1067mm]	18 [457mm]
BACK	42 [1067mm]	36 [914mm]	18 [457mm]
LEFT WITH HOOD	36 [914mm]	36 [914mm]	18 [457mm]
RIGHT	36 [914mm]	36 [914mm]	18 [457mm]
TOP	72 [1829mm]	72 [1829mm]	72 [1829mm]

ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 4 OF 5	DATE 09/08/25	SUPERCEDES 08/21/24	50GE 17 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	50HE008145	REV A
-------------------------------------	-----------------	------------------	------------------------	---	------------	----------



### 50GE-\*17 Base Unit Dimensions (cont)

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

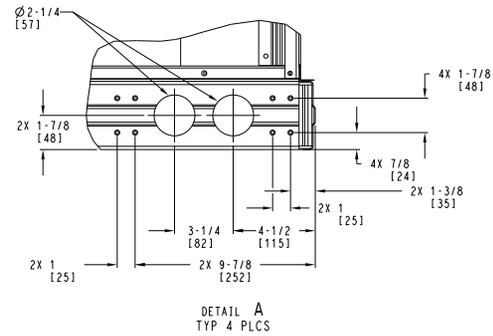
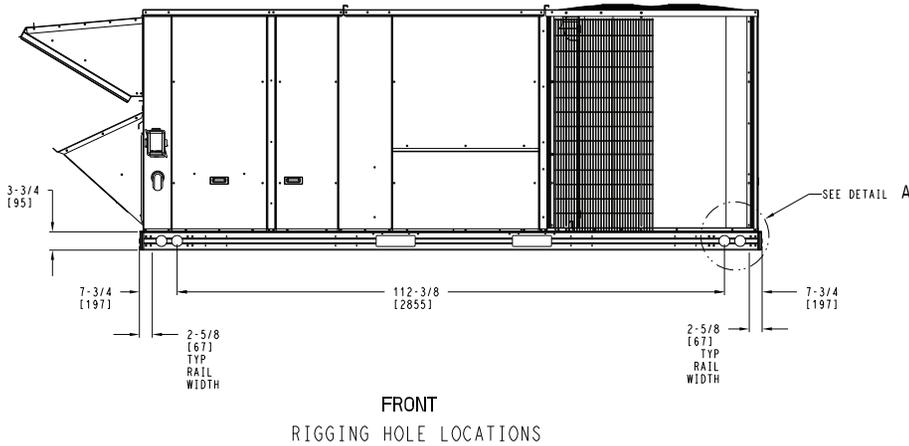
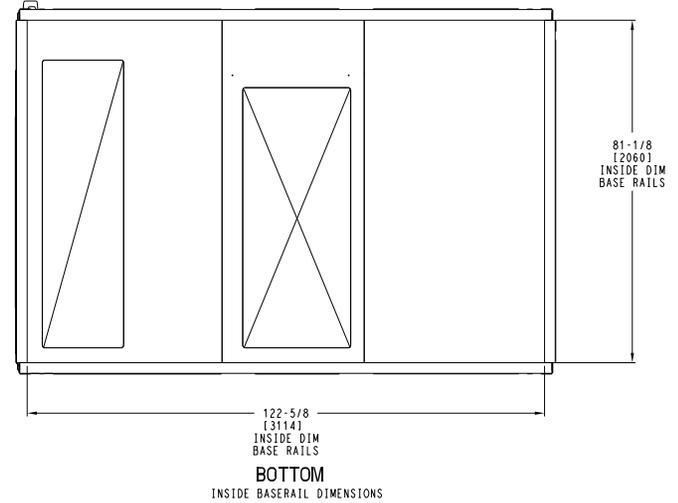
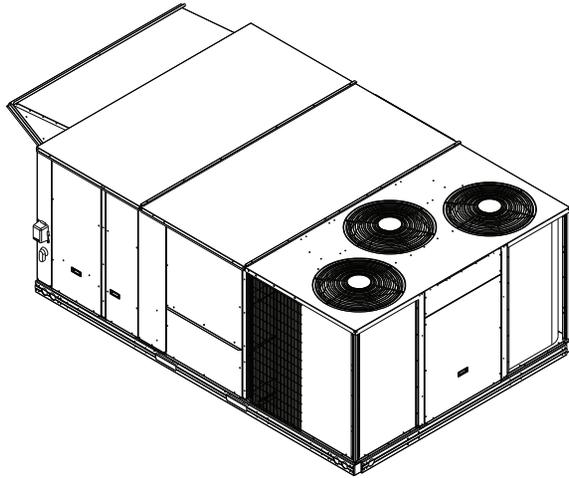


ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	50GE 17 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	REV
U.S. ECCN:NSR	5 OF 5	09/08/25	08/21/24	50HE008145	A



### 50GE-\*20-24 Base Unit Dimensions



**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

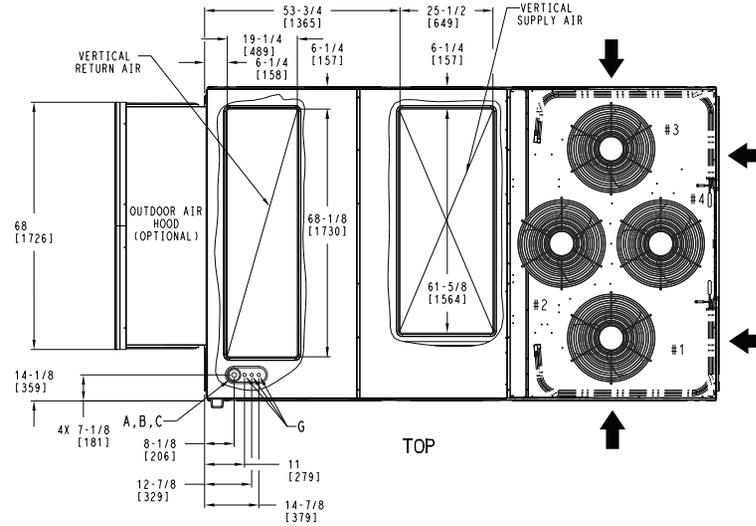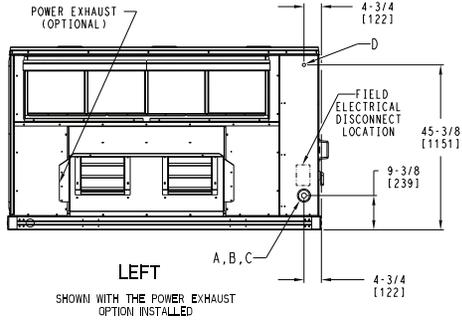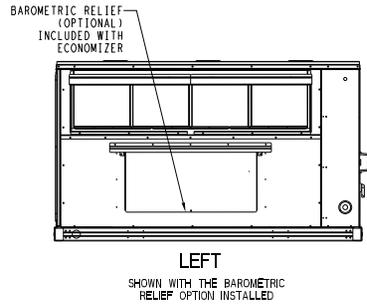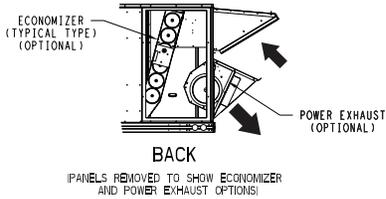

CONNECTION SIZES	
A	1 3/8" DIA [35] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT

UNIT	H
20 SIZE	49-3/8 [1253]
24 SIZE	57-3/8 [1456]

- NOTES:
1. DIMENSIONS ARE IN INCHES. DIMENSIONS IN [ ] ARE IN MILLIMETERS.
  2. CENTER OF GRAVITY
  3. DIRECTION OF AIR FLOW
  4. ALL VIEW DRAWN USING 3RD ANGLE

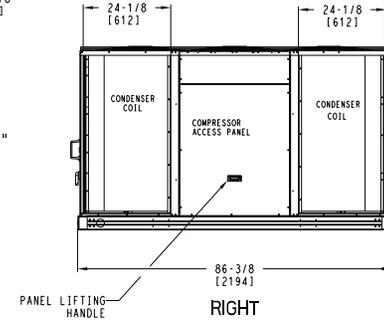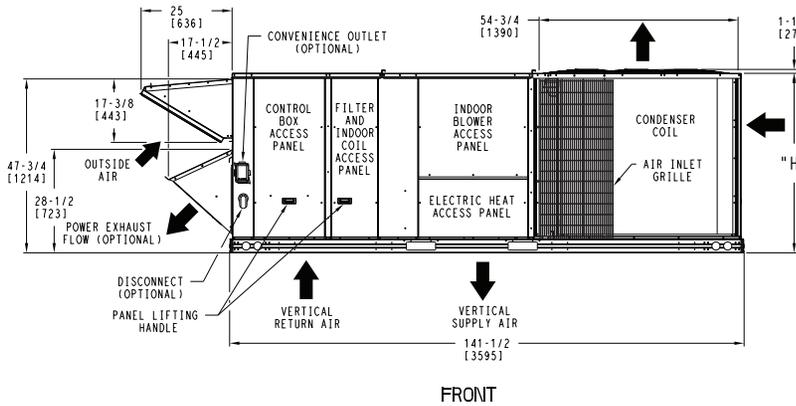


DEDICATED VERTICAL AIRFLOW UNIT  
20,24 SIZE

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	50GE 20,24 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	50HE008146	REV
U.S. ECCN:NSR	1 OF 5	09/08/25	08/21/24			A



### 50GE-\*20-24 Base Unit Dimensions (cont)

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

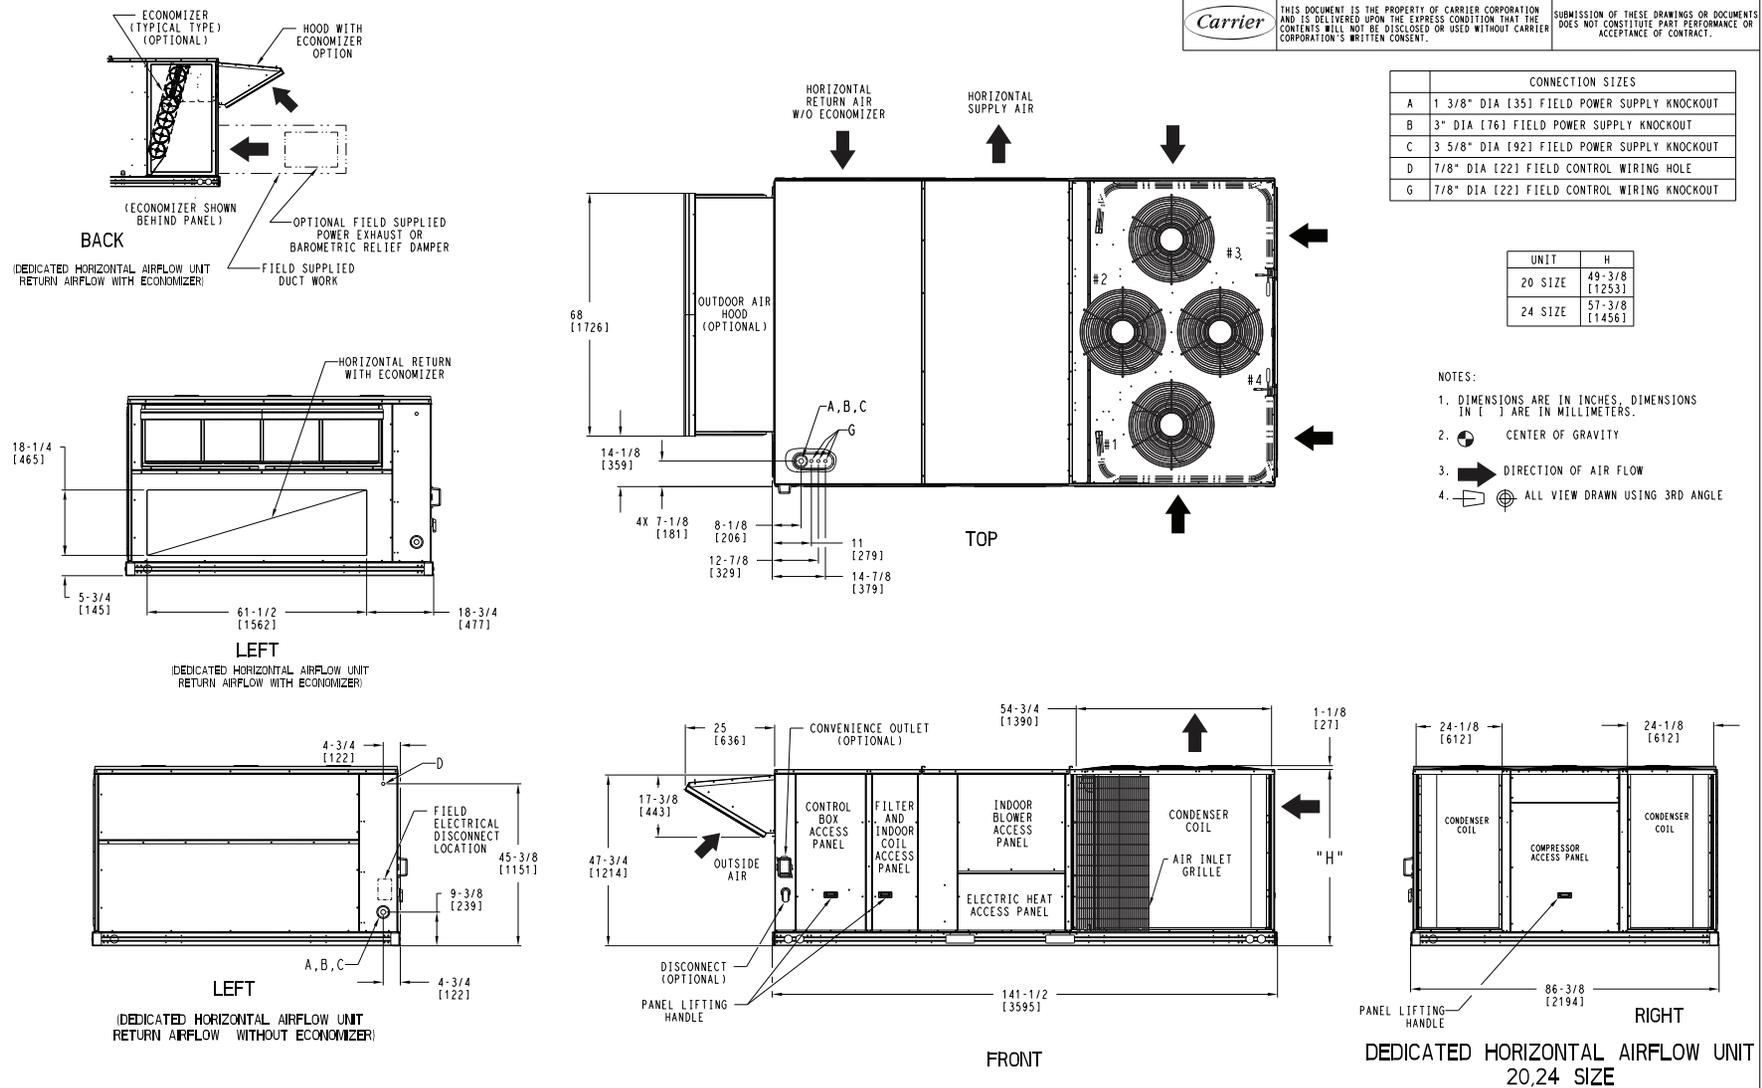

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	50GE 20, 24 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	REV
U.S. ECCN:NSR	2 OF 5	09/08/25	08/21/24	50HE008146	A








### 50GE-\*20-24 Base Unit Dimensions (cont)

CONNECTION SIZES	
E	3/4"-14 NPT CONDENSATE DRAIN

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

UNIT	G
20 SIZE	41-3/8 [1049]
24 SIZE	49-1/4 [1251]

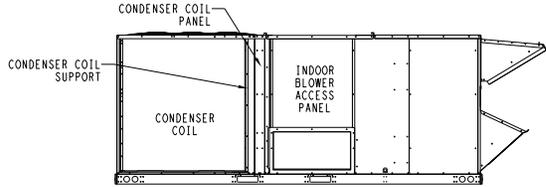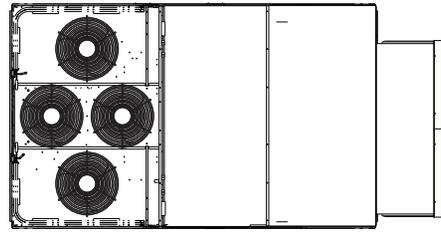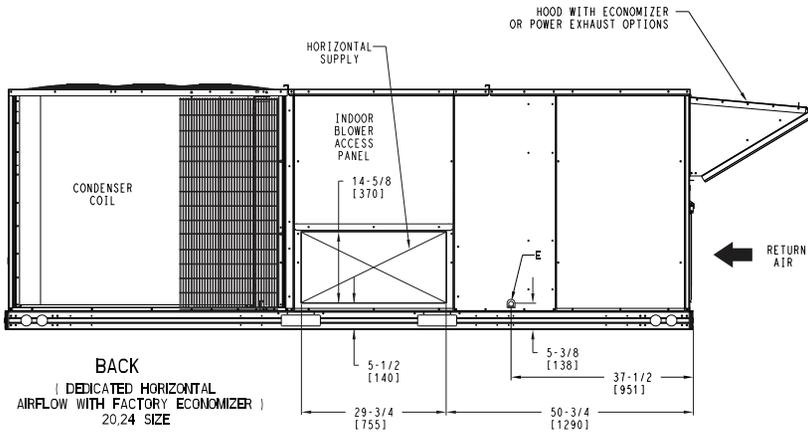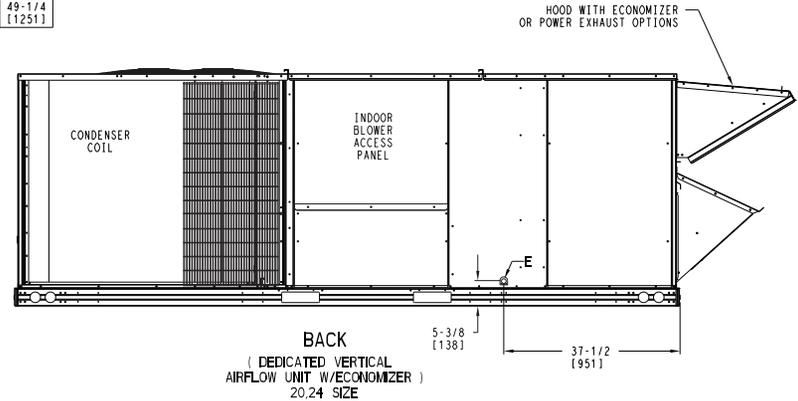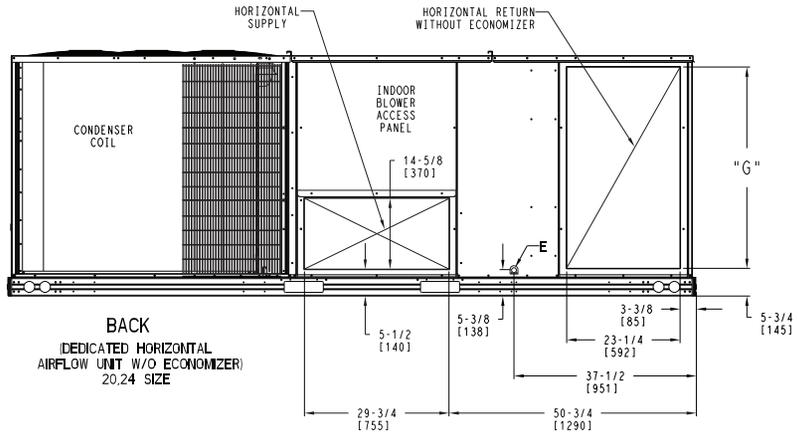

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	50GE 20,24 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	50HE008146	REV
U.S. ECCN:NSR	3 OF 5	09/08/25	08/21/24			A



### 50GE-\*20-24 Base Unit Dimensions (cont)




UNIT	STD. UNIT WEIGHT *		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		C.G.		
	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	X	Y	Z
50GE20	1918	870	429	195	512	232	532	241	445	202	77 [1956]	44 [1118]	16 1/2 [419]
50GE24	2198	997	520	236	520	236	579	263	579	263	70 3/4 [1797]	45 1/2 [1156]	16 1/2 [419]



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

\* STANDARD UNIT WEIGHT IS WITHOUT ELECTRIC HEAT AND WITHOUT PACKAGING. FOR OTHER OPTIONS AND ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.

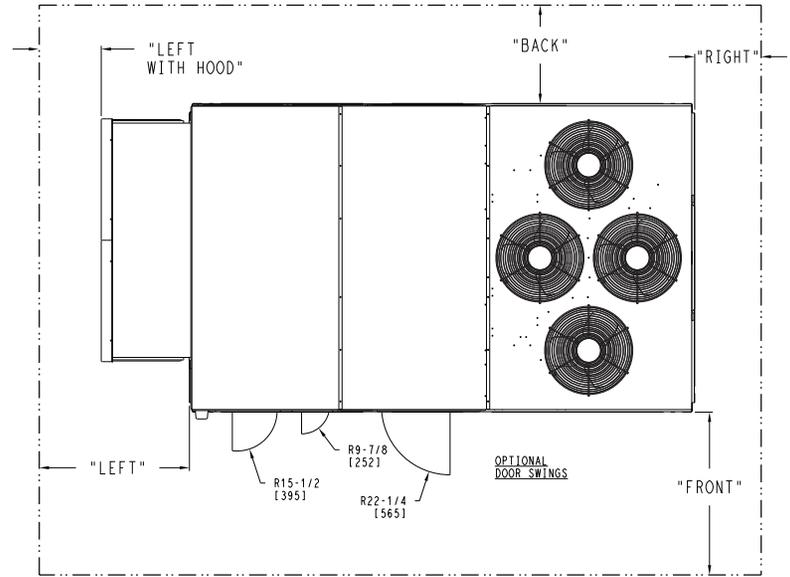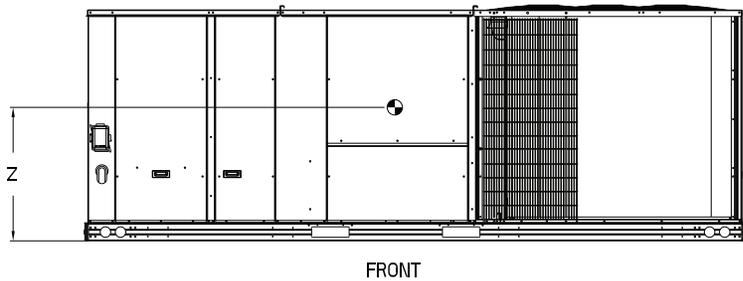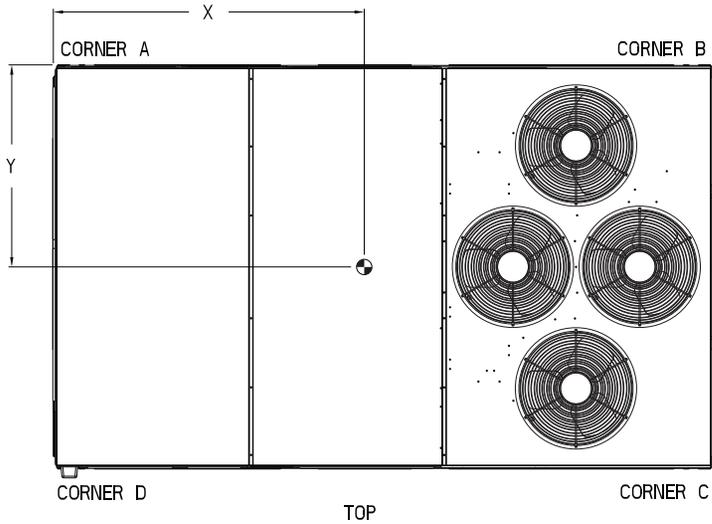

**NOTES:**

- CLEARANCE ABOVE THE UNIT TO BE 72"
- FOR ALL MINIMUM CLEARANCES LOCAL CODES OR JURISDICTIONS MAY PREVAIL.



SURFACE	SERVICE WITH:		OPERATING CLEARANCE
	CONDUCTIVE BARRIER	NONCONDUCTIVE BARRIER	
FRONT	48 [1219mm]	36 [914mm]	18 [457mm]
LEFT	48 [1219mm]	42 [1067mm]	18 [457mm]
BACK	42 [1067mm]	36 [914mm]	18 [457mm]
LEFT WITH HOOD	36 [914mm]	36 [914mm]	18 [457mm]
RIGHT	36 [914mm]	36 [914mm]	18 [457mm]
TOP	72 [1829mm]	72 [1829mm]	72 [1829mm]

ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 4 OF 5	DATE 09/08/25	SUPERCEDES 08/21/24	50GE 20, 24 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	50HE008146	REV A
-------------------------------------	-----------------	------------------	------------------------	---	------------	----------




### 50GE-\*20-24 Base Unit Dimensions (cont)


**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

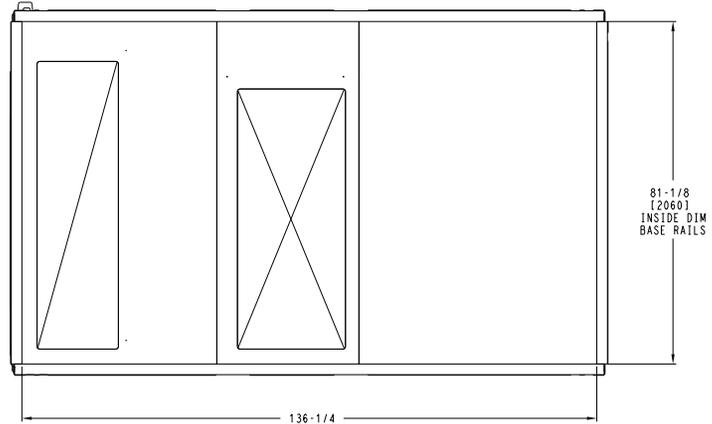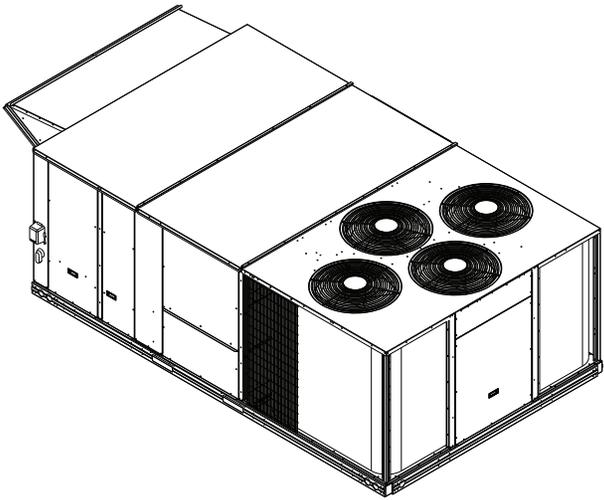

**BOTTOM**  
INSIDE BASERAIL DIMENSIONS

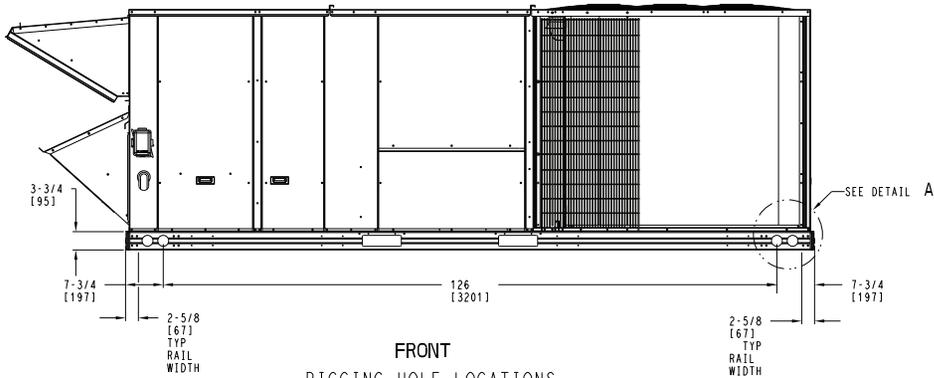

**FRONT**  
RIGGING HOLE LOCATIONS

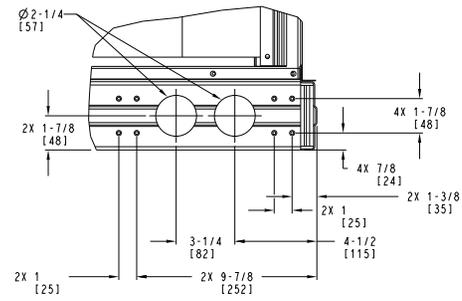

**DETAIL A**  
TYP 4 PLCS

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	50GE 20,24 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	50HE008146	REV
U.S. ECCN:NSR	5 OF 5	09/08/25	08/20/24			A




### 50GE-\*28 Base Unit Dimensions


**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
A	1 3/8" DIA [35] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT





- NOTES:
1. DIMENSIONS ARE IN INCHES, DIMENSIONS IN [ ] ARE IN MILLIMETERS.
  2. CENTER OF GRAVITY
  3. DIRECTION OF AIR FLOW
  4. ALL VIEW DRAWN USING 3RD ANGLE

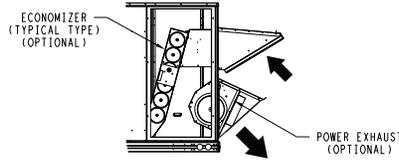

**BACK**  
 (PANELS REMOVED TO SHOW ECONOMIZER AND POWER EXHAUST OPTIONS)

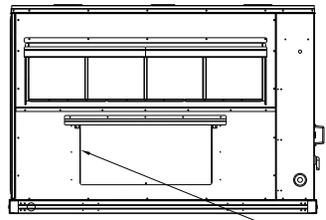

**BAROMETRIC RELIEF (OPTIONAL) INCLUDED WITH ECONOMIZER**

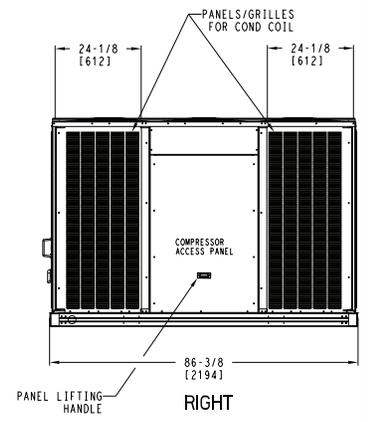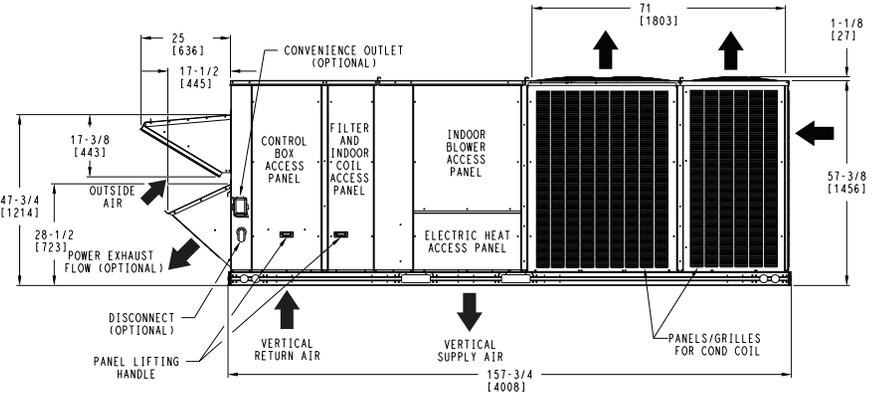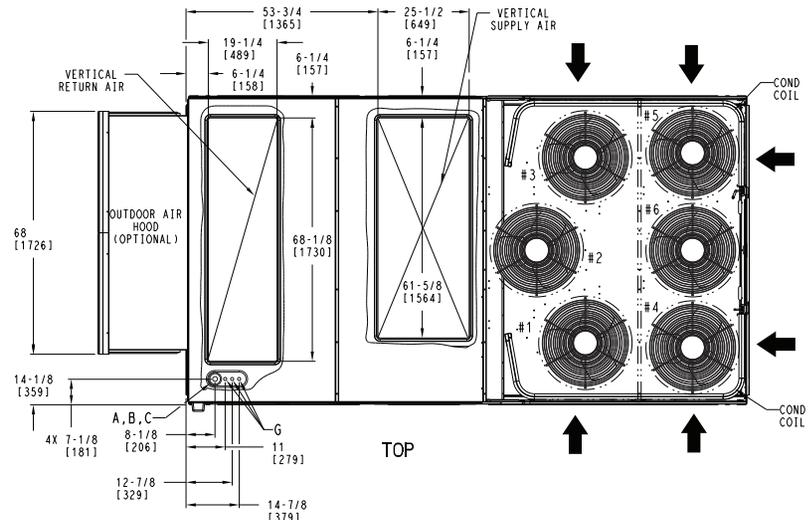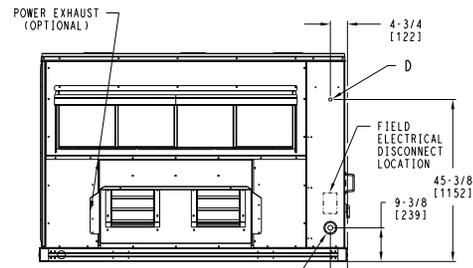


**DEDICATED VERTICAL AIRFLOW UNIT 28 SIZE**

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	50GE 28 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	REV
U.S. ECCN:NSR	1 OF 5	09/08/25	08/21/24	50HE008147	A



### 50GE-\*28 Base Unit Dimensions (cont)

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

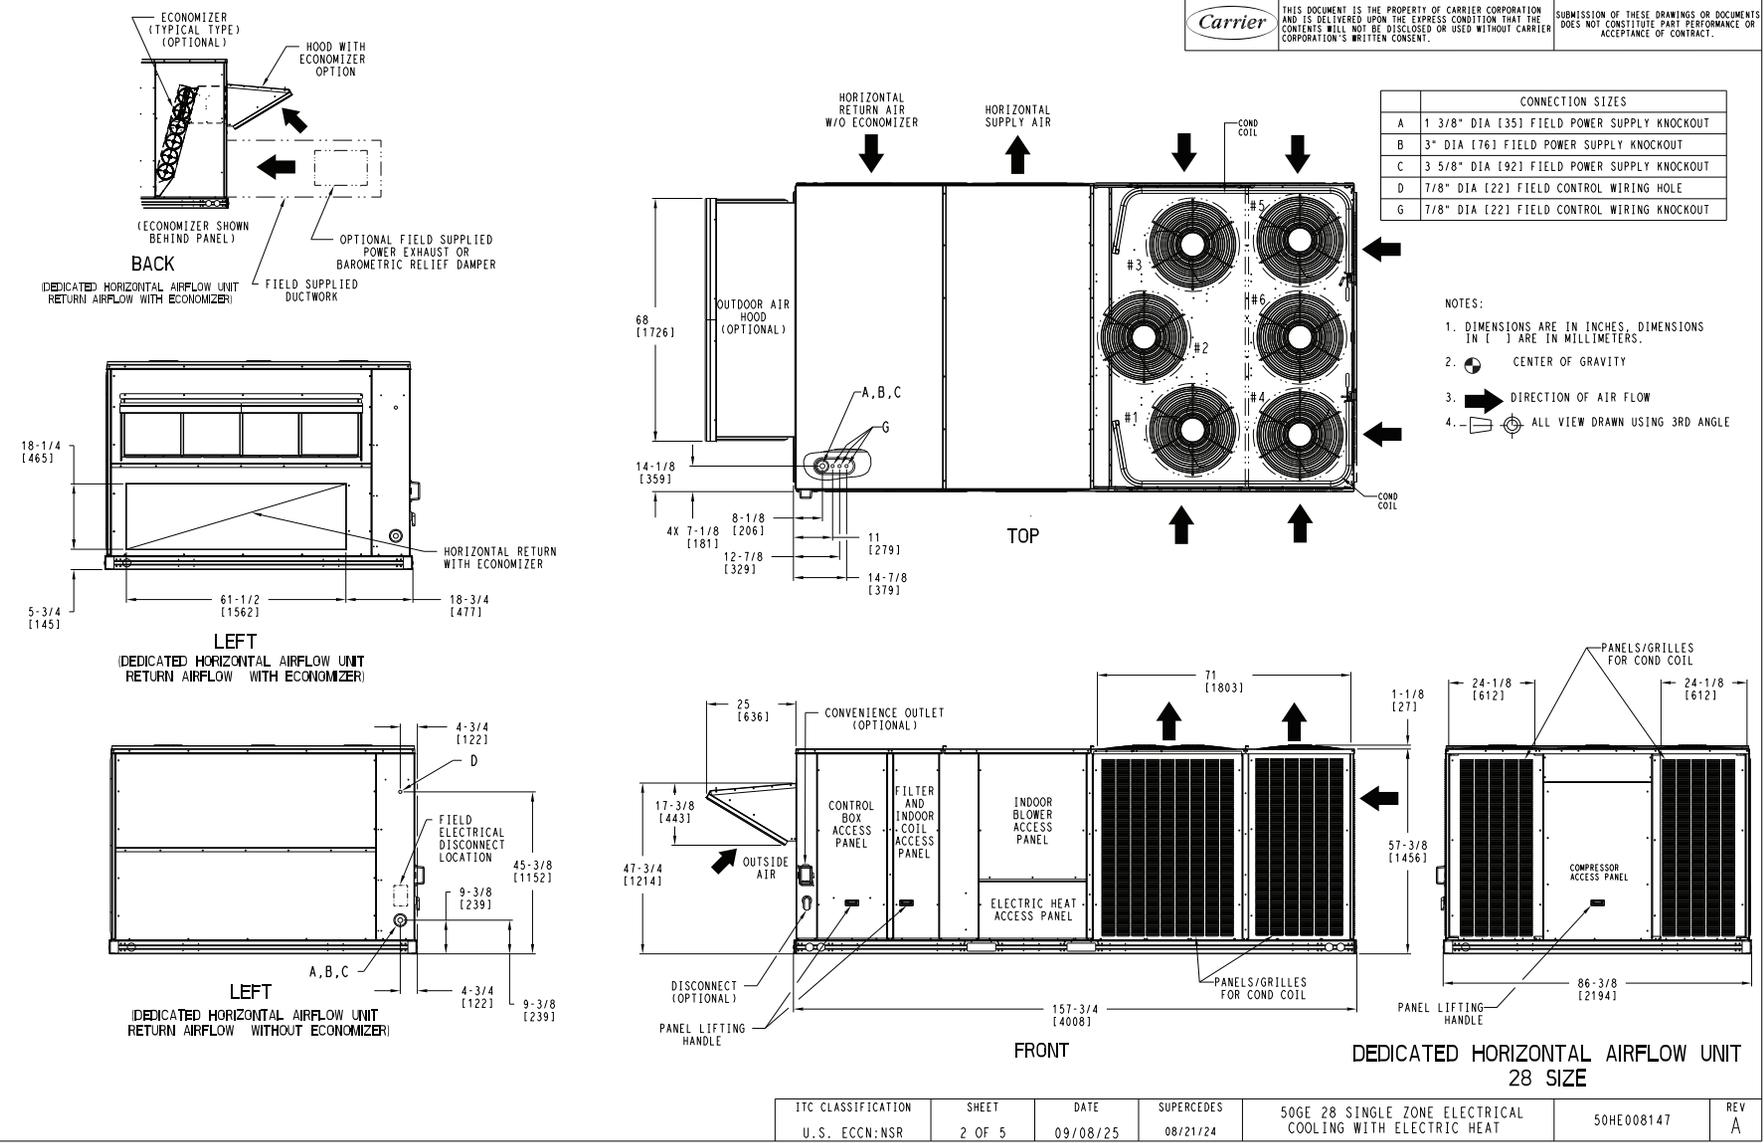




ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	50GE 28 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	50HE008147	REV
U.S. ECCN:NSR	2 OF 5	09/08/25	08/21/24			A



### 50GE-\*28 Base Unit Dimensions (cont)

CONNECTION SIZES	
E	3/4"-14 NPT CONDENSATE DRAIN

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

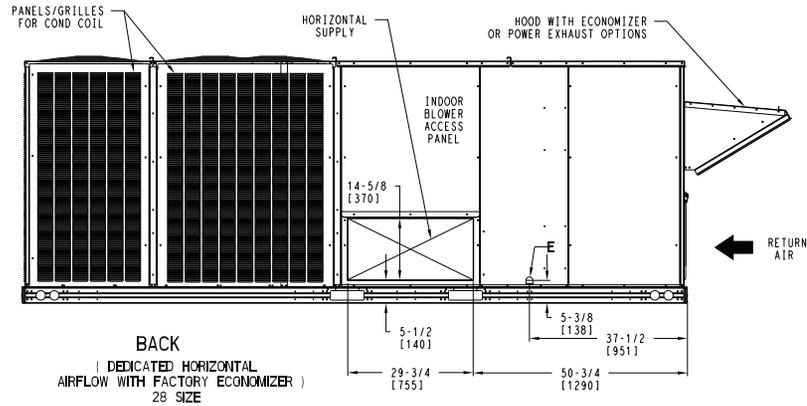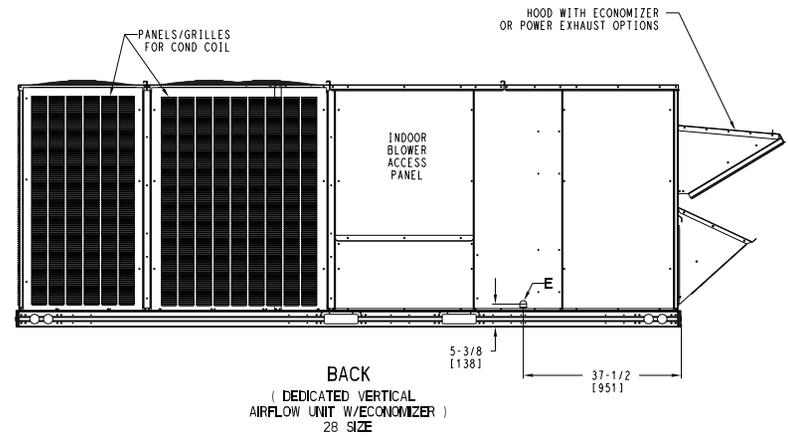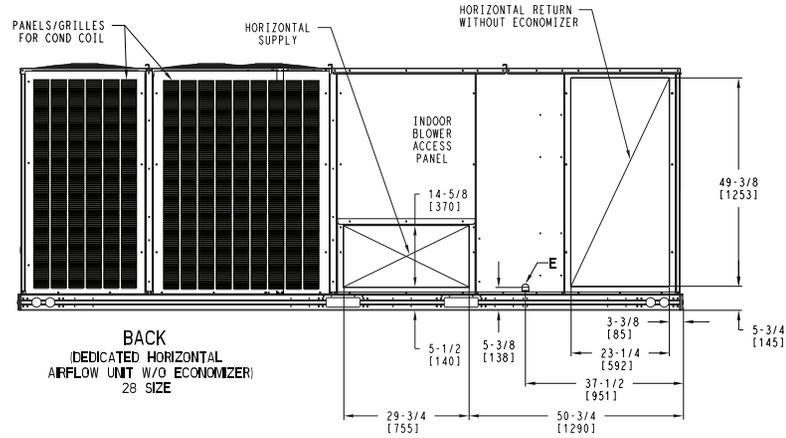

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	50GE 28 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	50HE008147	REV
U.S. ECCN:NSR	3 OF 5	09/08/25	08/21/24			A






### 50GE-\*28 Base Unit Dimensions (cont)

UNIT	STD UNIT WEIGHT *		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		C.G.					
	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	X	Y	Z			
50GE28	2291	1039	476	216	581	264	678	308	555	252	86 3/4	[2203]	46 1/2	[1181]	19	[483]

**Carrier** THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT. SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

\* STANDARD UNIT WEIGHT IS WITHOUT ELECTRIC HEAT AND WITHOUT PACKAGING. FOR OTHER OPTIONS AND ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.

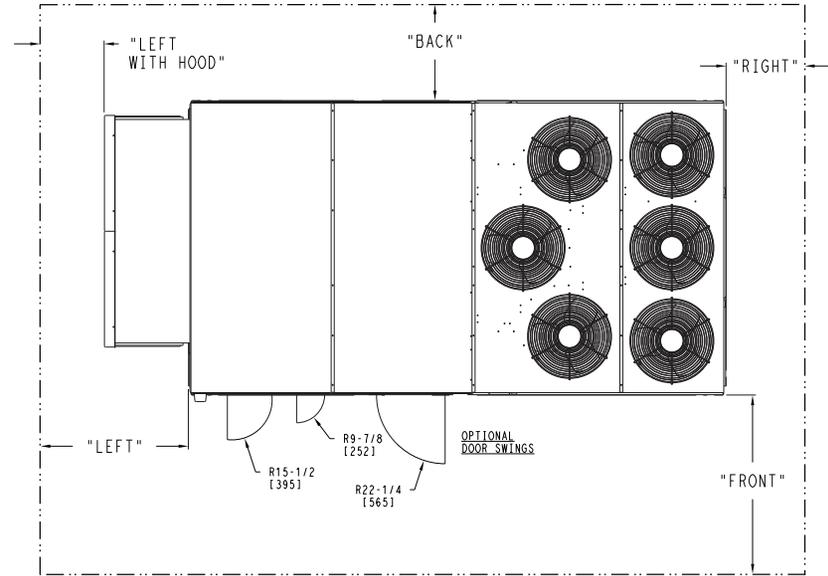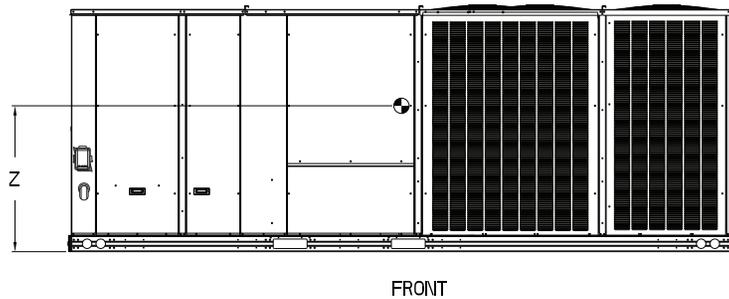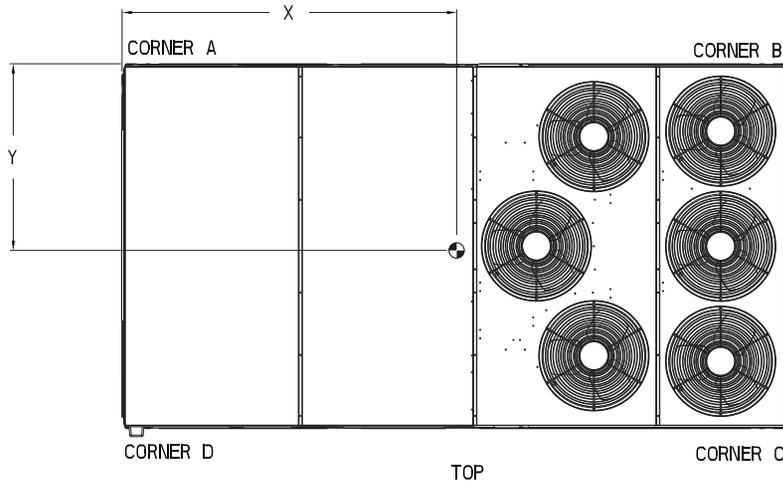

- NOTES:
- CLEARANCE ABOVE THE UNIT TO BE 72"
  - FOR ALL MINIMUM CLEARANCES LOCAL CODES OR JURISDICTIONS MAY PREVAIL.



SURFACE	CLEARANCE		OPERATING CLEARANCE
	SERVICE WITH CONDUCTIVE BARRIER	SERVICE WITH NONCONDUCTIVE BARRIER	
FRONT	48 [1219mm]	36 [914mm]	18 [457mm]
LEFT	48 [1219mm]	42 [1067mm]	18 [457mm]
BACK	42 [1067mm]	36 [914mm]	18 [457mm]
LEFT WITH HOOD	36 [914mm]	36 [914mm]	18 [457mm]
RIGHT	36 [914mm]	36 [914mm]	18 [457mm]
TOP	72 [1829mm]	72 [1829mm]	72 [1829mm]

ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 4 OF 5	DATE 09/08/25	SUPERCEDES 08/21/24	50GE 28 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	50HE008147	REV A
-------------------------------------	-----------------	------------------	------------------------	---	------------	----------




### 50GE-\*28 Base Unit Dimensions (cont)


	THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.	SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.
--	---	---

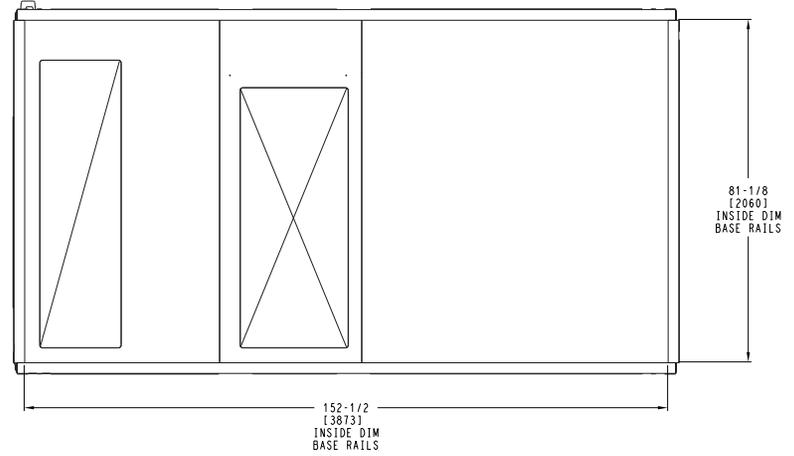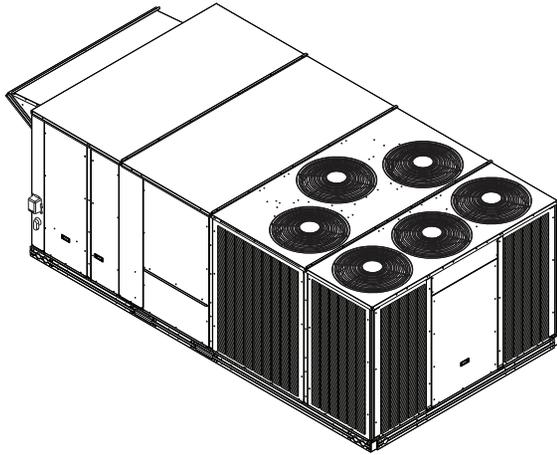

**BOTTOM**  
INSIDE BASERAIL DIMENSIONS

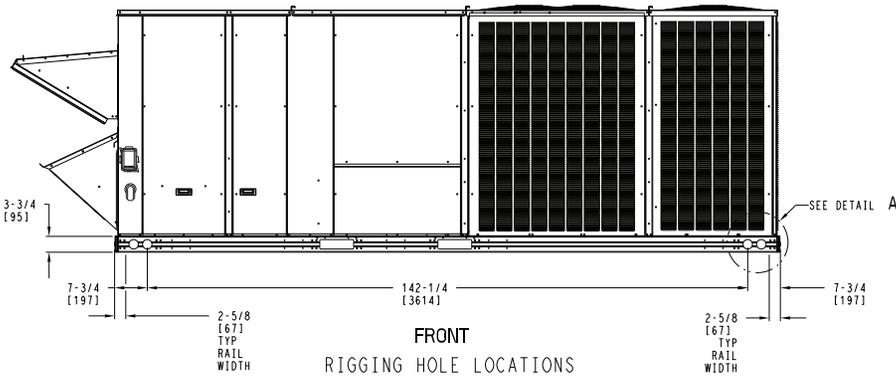

**FRONT**  
RIGGING HOLE LOCATIONS

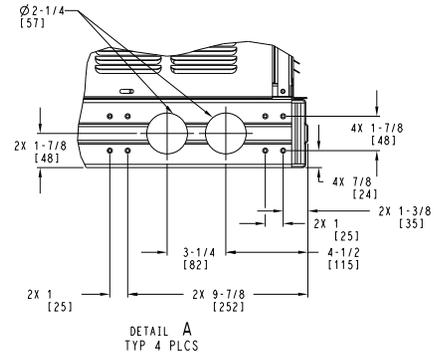


**DETAIL A**  
TYP 4 PLCS

ITC CLASSIFICATION U.S. ECCN: NSR	SHEET 5 OF 5	DATE 09/08/25	SUPERCEDES 08/21/24	50GE 28 SINGLE ZONE ELECTRICAL COOLING WITH ELECTRIC HEAT	50HE008147	REV A
--------------------------------------	-----------------	------------------	------------------------	--	------------	----------



## Roof Curb Dimensions — 48/50GE 17


"A"	ROOF CURB ACCESSORY
1'-2" [356.0]	CRRFCURB045A00
2'-0" [610.0]	CRRFCURB046A00

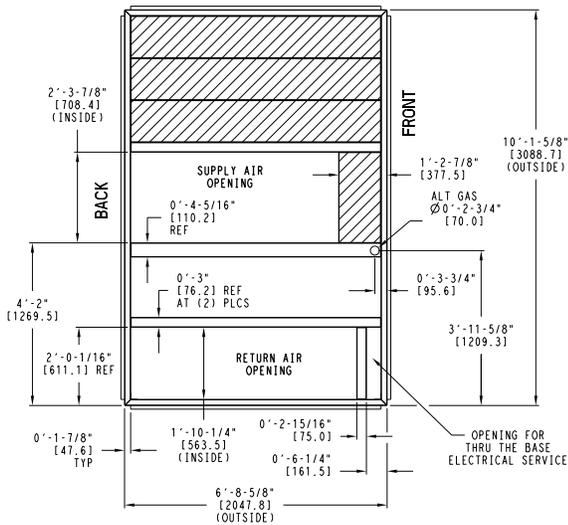







NOTES:

- 1 ROOF CURB ACCESSORY IS SHIPPED UNASSEMBLED.
- 2 DIMENSIONS IN [ ] ARE IN MILLIMETERS.
- 3 ROOF CURB GALVANIZED STEEL.
- 4 ATTACH DUCTWORK TO CURB (FLANGES ON DUCT REST ON CURB)
- 5 SERVICE CLEARANCE 4 FT ON EACH SIDE

➔ DIRECTION OF AIR FLOW




MAX CURB LEVELING TOLERANCES

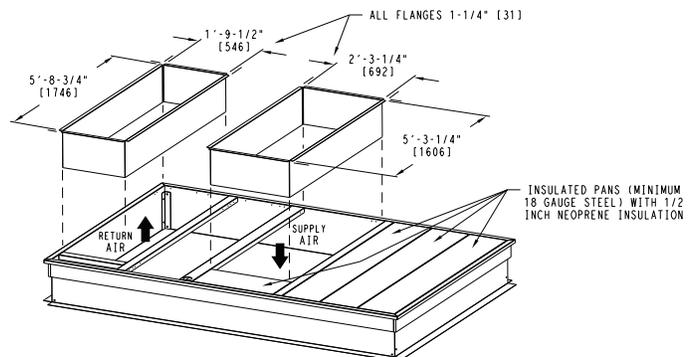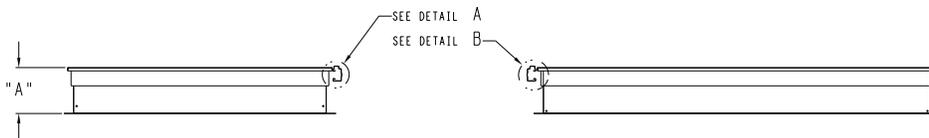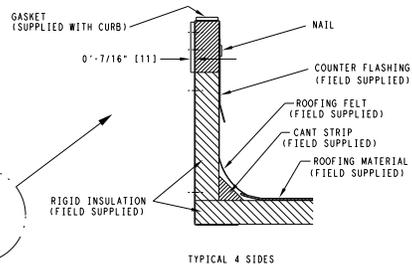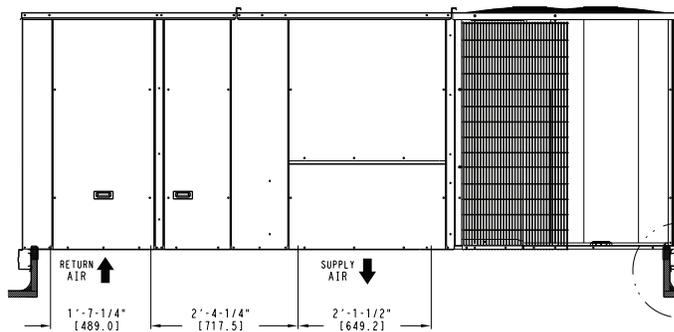

## Roof Curb Dimensions — 48/50GE 20-24

"A"	ROOF CURB ACCESSORY
1'-2" [356.0]	CRRFCURB047A00
2'-0" [610.0]	CRRFCURB048A00

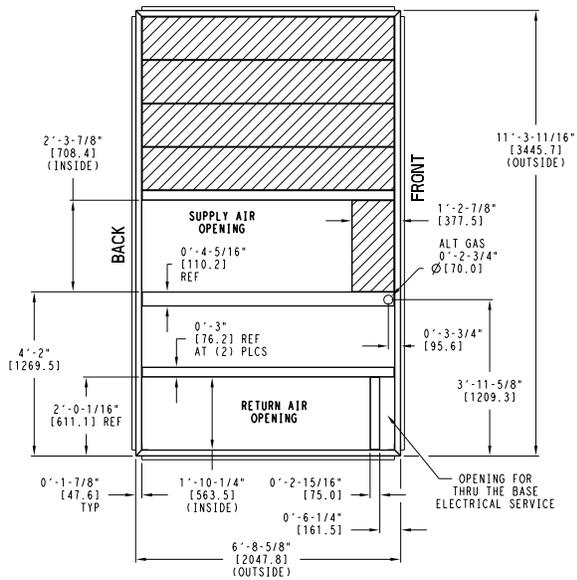






NOTES:

- 1 ROOF CURB ACCESSORY IS SHIPPED UNASSEMBLED.
- 2 DIMENSIONS IN [ ] ARE IN MILLIMETERS.
- 3 ROOF CURB GALVANIZED STEEL.
- 4 ATTACH DUCTWORK TO CURB (FLANGES ON DUCT REST ON CURB)
- 5 SERVICE CLEARANCE 4 ft ON EACH SIDE

➔ DIRECTION OF AIR FLOW




MAX CURB LEVELING TOLERANCES

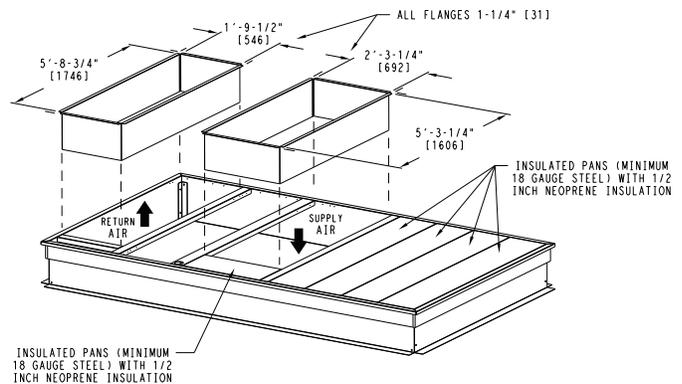
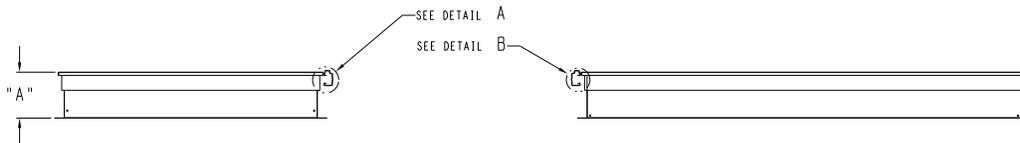
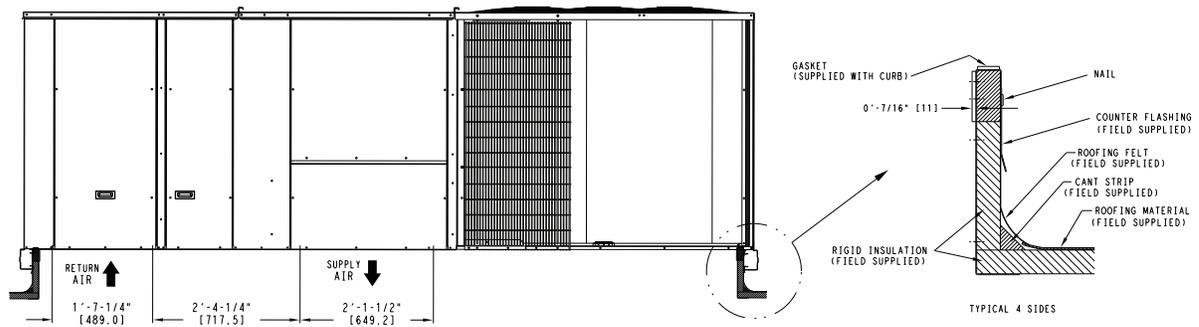


## Roof Curb Dimensions — 48/50GE 28

"A"	ROOF CURB ACCESSORY
1'-2" [356.0]	CRRFCURB049A00
2'-0" [610.0]	CRRFCURB050A00

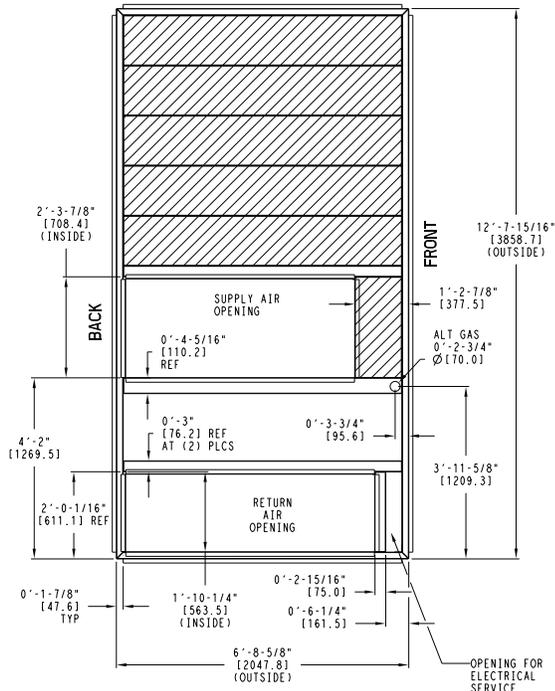

- NOTES:
- 1 ROOF CURB ACCESSORY IS SHIPPED UNASSEMBLED.
  - 2 BOLT HEADS TO BE ON INSIDE OF FLANGE. CLEARANCE IS [11] 0-0-7/16" TYP ALL CORNERS.
  - 3 DIMENSIONS IN [ ] ARE IN MILLIMETERS.
  - 4 ROOF CURB GALVANIZED STEEL.
  - 5 ATTACH DUCTWORK TO CURB (FLANGES ON DUCT REST ON CURB)
  - 6 SERVICE CLEARANCE 4 FT ON EACH SIDE
- ➔ DIRECTION OF AIR FLOW

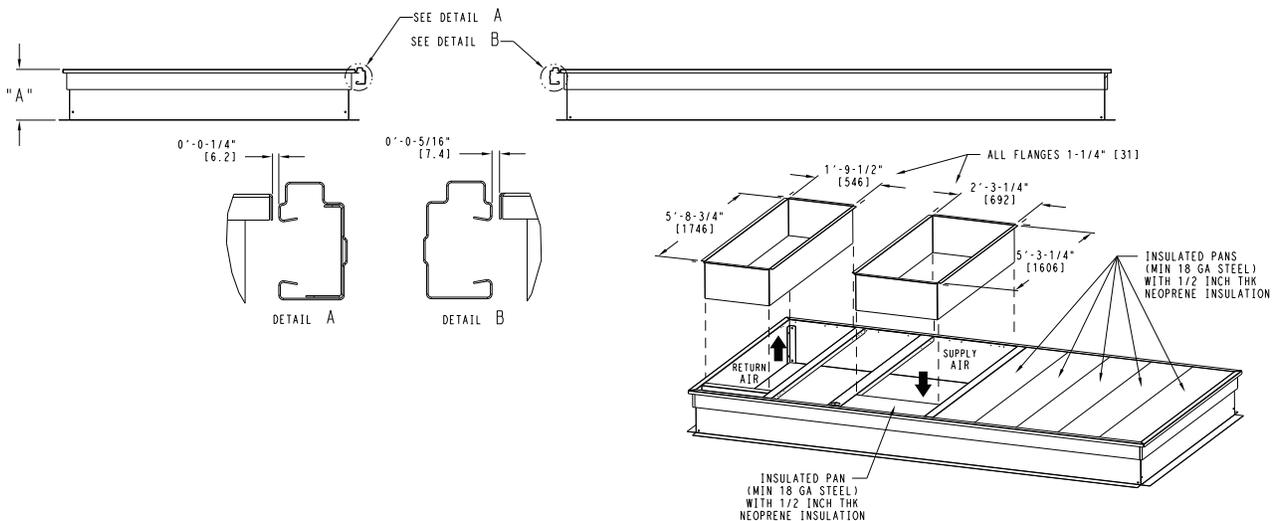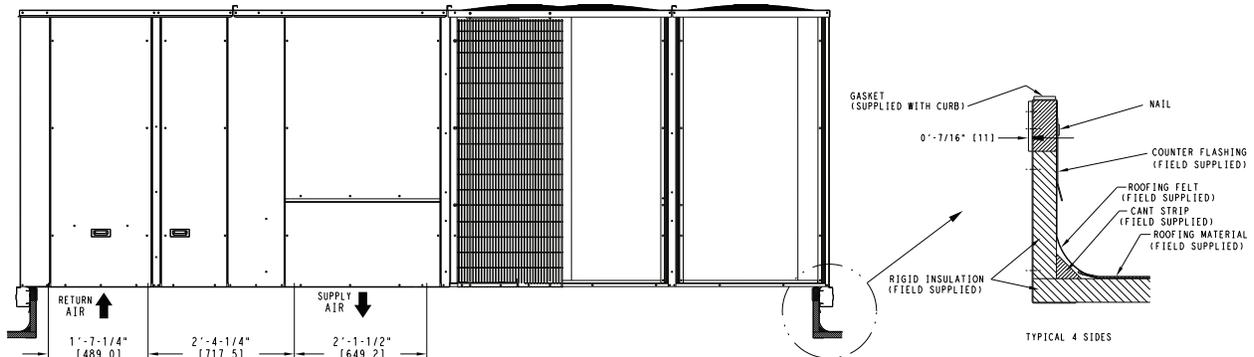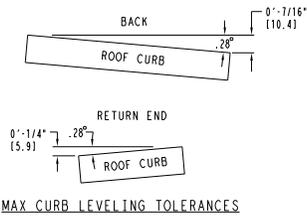

## 48/50GE\*\*17 Three Stage Cooling Capacities

48/50GE**17			AMBIENT TEMPERATURE (°F)																
			85			95			105			115			125				
			EA (db)			EA (db)			EA (db)			EA (db)			EA (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
4500 cfm	EA (wb)	58	TC	155.5	155.5	176.9	146.8	146.8	167.5	137.7	137.7	157.6	127.7	127.7	146.7	117.3	117.3	135.3	
			SHC	134.1	155.5	176.9	126.1	146.8	167.5	117.8	137.7	157.6	108.7	127.7	146.7	99.2	117.3	135.3	
		62	TC	163.0	163.0	169.1	152.6	152.6	162.5	141.5	141.5	155.7	129.9	129.9	148.5	119.1	119.1	137.1	
			SHC	120.8	144.9	169.1	114.2	138.4	162.5	107.5	131.6	155.7	100.4	124.5	148.5	91.4	114.2	137.1	
		67	TC	180.2	180.2	180.2	169.1	169.1	169.1	157.3	157.3	157.3	144.8	144.8	144.8	131.8	131.8	131.8	
			SHC	97.5	121.8	146.0	91.0	115.2	139.4	84.3	108.5	132.7	77.3	101.5	125.7	70.2	94.4	118.5	
	72	TC	199.1	199.1	199.1	187.0	187.0	187.0	174.9	174.9	174.9	161.4	161.4	161.4	147.6	147.6	147.6		
		SHC	74.0	98.2	122.4	67.4	91.6	115.8	60.9	85.0	109.2	53.8	78.0	102.2	46.8	70.9	95.1		
	76	TC	—	215.7	215.7	—	203.2	203.2	—	190.0	190.0	—	176.0	176.0	—	161.6	161.6		
		SHC	—	79.2	102.8	—	72.6	96.3	—	65.9	89.6	—	59.0	82.7	—	51.9	75.6		
	5250 cfm	EA (wb)	58	TC	165.2	165.2	187.7	155.9	155.9	177.5	146.3	146.3	167.2	135.6	135.6	155.5	124.6	124.6	143.4
				SHC	142.7	165.2	187.7	134.2	155.9	177.5	125.5	146.3	167.2	115.8	135.6	155.5	105.8	124.6	143.4
62			TC	168.1	168.1	187.6	157.9	157.9	180.8	149.6	149.6	164.1	135.8	135.8	162.4	124.8	124.8	150.0	
			SHC	131.8	159.7	187.6	125.2	153.0	180.8	113.9	139.0	164.1	109.3	135.8	162.4	99.6	124.8	150.0	
67			TC	185.5	185.5	185.5	174.1	174.1	174.1	162.0	162.0	162.0	149.2	149.2	149.2	135.5	135.5	135.5	
			SHC	104.6	132.7	160.8	98.1	126.1	154.2	91.3	119.3	147.4	84.3	112.3	140.3	77.0	105.0	133.0	
72		TC	204.8	204.8	204.8	192.6	192.6	192.6	179.5	179.5	179.5	165.6	165.6	165.6	151.3	151.3	151.3		
		SHC	77.0	105.0	133.1	70.4	98.4	126.5	63.6	91.6	119.6	56.5	84.5	112.6	49.3	77.3	105.3		
76		TC	—	221.7	221.7	—	208.6	208.6	—	194.9	194.9	—	180.3	180.3	—	165.4	165.4		
		SHC	—	82.6	110.0	—	76.0	103.4	—	69.1	96.6	—	62.1	89.5	—	54.9	82.4		
6000 cfm		EA (wb)	58	TC	173.2	173.2	196.6	163.4	163.4	185.9	153.2	153.2	174.8	142.2	142.2	162.8	130.7	130.7	150.2
				SHC	149.8	173.2	196.6	140.9	163.4	185.9	131.6	153.2	174.8	121.6	142.2	162.8	111.2	130.7	150.2
	62		TC	175.0	175.0	199.3	165.6	165.6	186.9	153.3	153.3	182.2	142.4	142.4	169.9	130.8	130.8	156.9	
			SHC	139.6	169.5	199.3	130.3	158.6	186.9	124.5	153.3	182.2	114.9	142.4	169.9	104.8	130.8	156.9	
	67		TC	189.9	189.9	189.9	177.9	177.9	177.9	165.5	165.5	165.5	152.1	152.1	154.4	138.3	138.3	147.0	
			SHC	111.4	143.3	175.1	104.7	136.6	168.4	97.9	129.8	161.6	90.8	122.6	154.4	83.6	115.3	147.0	
	72	TC	209.2	209.2	209.2	196.5	196.5	196.5	183.0	183.0	183.0	168.7	168.7	168.7	154.1	154.1	154.1		
		SHC	79.5	111.4	143.2	72.9	104.7	136.5	66.0	97.8	129.6	58.8	90.6	122.4	51.6	83.4	115.2		
	76	TC	—	226.1	226.1	—	212.6	212.6	—	198.6	198.6	—	183.7	183.7	—	168.4	168.4		
		SHC	—	85.5	116.7	—	78.8	109.9	—	71.9	103.0	—	64.7	95.9	—	57.5	88.6		
	6750 cfm	EA (wb)	58	TC	179.9	179.9	204.0	169.7	169.7	193.0	159.0	159.0	181.3	147.7	147.7	168.9	135.8	135.8	155.8
				SHC	155.7	179.9	204.0	146.5	169.7	193.0	136.8	159.0	181.3	126.5	147.7	168.9	115.7	135.8	155.8
62			TC	179.8	179.8	212.0	169.9	169.9	200.9	159.3	159.3	189.1	147.9	147.9	176.2	135.9	135.9	162.7	
			SHC	147.7	179.8	212.0	138.9	169.9	200.9	129.6	159.3	189.1	119.5	147.9	176.2	109.1	135.9	162.7	
67			TC	193.3	193.3	193.3	181.1	181.1	182.3	168.3	168.3	175.2	154.6	154.6	168.0	140.6	140.6	160.5	
			SHC	117.9	153.5	189.1	111.3	146.8	182.3	104.3	139.8	175.2	97.2	132.6	168.0	90.0	125.2	160.5	
72		TC	212.6	212.6	212.6	199.5	199.5	199.5	185.7	185.7	185.7	171.2	171.2	171.2	156.3	156.3	156.3		
		SHC	81.8	117.3	152.9	75.0	110.6	146.1	68.1	103.6	139.2	60.9	96.4	131.9	53.7	89.2	124.6		
76		TC	—	229.6	229.6	—	215.8	215.8	—	201.4	201.4	—	186.2	186.2	—	170.6	170.6		
		SHC	—	87.9	122.8	—	81.1	115.9	—	74.2	108.9	—	67.0	101.7	—	59.7	94.3		
7500 cfm		EA (wb)	58	TC	185.7	185.7	210.5	175.2	175.2	199.0	164.2	164.2	187.0	152.4	152.4	174.1	140.1	140.1	160.6
				SHC	161.0	185.7	210.5	151.3	175.2	199.0	141.4	164.2	187.0	130.7	152.4	174.1	119.6	140.1	160.6
	62		TC	186.0	186.0	219.1	175.4	175.4	207.2	164.4	164.4	194.9	152.6	152.6	181.6	140.2	140.2	167.7	
			SHC	152.9	186.0	219.1	143.6	175.4	207.2	133.9	164.4	194.9	123.6	152.6	181.6	112.8	140.2	167.7	
	67		TC	196.1	196.1	202.6	183.6	183.6	195.7	170.5	170.5	188.7	156.7	156.7	181.3	142.5	142.5	173.4	
			SHC	124.3	163.4	202.6	117.5	156.6	195.7	110.6	149.7	188.7	103.5	142.4	181.3	96.1	134.8	173.4	
	72	TC	215.3	215.3	215.3	201.8	201.8	201.8	187.9	187.9	187.9	173.2	173.2	173.2	158.1	158.1	158.1		
		SHC	83.7	123.0	162.2	76.9	116.1	155.4	70.0	109.2	148.3	62.8	102.0	141.1	55.6	94.7	133.7		
	76	TC	—	232.4	232.4	—	218.4	218.4	—	203.7	203.7	—	188.3	188.3	—	172.4	172.4		
		SHC	—	90.1	128.5	—	83.2	121.5	—	76.2	114.5	—	68.9	107.1	—	61.5	99.5		

### LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 8.

## 48/50GE\*\*17 Two Stage Cooling Capacities

48/50GE**17			AMBIENT TEMPERATURE (°F)																
			85			95			105			115			125				
			EA (db)			EA (db)			EA (db)			EA (db)			EA (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
2700 cfm	EA (wb)	58	TC	88.8	88.8	102.0	82.2	82.2	94.9	75.6	75.6	87.8	68.5	68.5	80.3	61.2	61.2	72.4	
			SHC	75.7	88.8	102.0	69.5	82.2	94.9	63.3	75.6	87.8	56.8	68.5	80.3	49.9	61.2	72.4	
		62	TC	107.4	107.4	107.4	87.4	87.4	91.1	79.5	79.5	85.5	71.3	71.3	79.8	61.7	61.7	73.1	
			SHC	71.1	85.9	100.8	62.3	76.7	91.1	56.8	71.1	85.5	51.1	65.5	79.8	44.7	58.9	73.1	
		67	TC	107.2	107.2	107.2	99.2	99.2	99.2	91.0	91.0	91.0	82.2	82.2	82.2	72.8	72.8	72.8	
			SHC	55.3	69.7	84.1	49.9	64.3	78.7	44.4	58.8	73.1	38.8	53.2	67.5	32.9	47.2	61.6	
	72	TC	120.4	120.4	120.4	111.9	111.9	111.9	103.0	103.0	103.0	93.6	93.6	93.6	83.9	83.9	83.9		
		SHC	42.7	57.0	71.4	37.3	51.6	65.9	31.7	46.0	60.3	26.0	40.3	54.5	20.3	34.4	48.6		
	76	TC	—	130.7	130.7	—	122.0	122.0	—	112.3	112.3	—	101.9	101.9	—	90.6	90.6		
		SHC	—	46.3	60.1	—	40.9	54.6	—	35.2	48.8	—	29.3	42.8	—	23.1	36.4		
	3150 cfm	EA (wb)	58	TC	95.5	95.5	109.3	88.7	88.7	102.1	81.6	81.6	94.5	74.2	74.2	86.6	66.5	66.5	78.3
				SHC	81.7	95.5	109.3	75.3	88.7	102.1	68.7	81.6	94.5	61.8	74.2	86.6	54.7	66.5	78.3
62			TC	99.0	99.0	107.9	91.2	91.2	102.3	83.1	83.1	96.5	75.2	75.2	89.2	66.6	66.6	82.3	
			SHC	74.7	91.3	107.9	69.2	85.7	102.3	63.5	80.0	96.5	57.1	73.2	89.2	50.8	66.6	82.3	
67			TC	111.4	111.4	111.4	103.0	103.0	103.0	94.3	94.3	94.3	85.2	85.2	85.2	75.7	75.7	75.7	
			SHC	60.0	76.7	93.3	54.5	71.2	87.8	48.9	65.5	82.1	43.1	59.7	76.3	37.2	53.7	70.3	
72		TC	124.6	124.6	124.6	115.6	115.6	115.6	106.5	106.5	106.5	96.7	96.7	96.7	86.2	86.2	86.2		
		SHC	45.0	61.5	78.0	39.4	55.9	72.3	33.8	50.2	66.6	28.0	44.3	60.7	22.0	38.2	54.4		
76		TC	—	134.6	134.6	—	124.9	124.9	—	114.5	114.5	—	103.5	103.5	—	92.6	92.6		
		SHC	—	48.7	64.3	—	43.0	58.5	—	37.0	52.4	—	30.9	46.0	—	24.6	39.4		
3600 cfm		EA (wb)	58	TC	101.1	101.1	115.5	94.1	94.1	108.1	86.7	86.7	100.2	79.0	79.0	91.8	70.8	70.8	83.0
				SHC	86.7	101.1	115.5	80.1	94.1	108.1	73.3	86.7	100.2	66.1	79.0	91.8	58.5	70.8	83.0
	62		TC	106.1	106.1	108.6	94.9	94.9	111.5	86.9	86.9	104.8	79.1	79.1	96.3	70.9	70.9	87.3	
			SHC	77.0	92.8	108.6	75.0	93.3	111.5	68.9	86.9	104.8	61.9	79.1	96.3	54.5	70.9	87.3	
	67		TC	114.6	114.6	114.6	106.0	106.0	106.0	97.0	97.0	97.0	87.6	87.6	87.6	77.7	77.7	78.6	
			SHC	64.4	83.3	102.1	58.8	77.6	96.4	53.1	71.9	90.7	47.2	65.9	84.7	41.1	59.9	78.6	
	72	TC	127.8	127.8	127.8	118.5	118.5	118.5	108.9	108.9	108.9	98.7	98.7	98.7	88.0	88.0	88.0		
		SHC	47.0	65.6	84.2	41.3	59.9	78.4	35.6	54.0	72.4	29.6	47.9	66.1	23.5	41.5	59.6		
	76	TC	—	137.0	137.0	—	126.6	126.6	—	116.0	116.0	—	104.9	104.9	—	93.2	93.2		
		SHC	—	50.6	67.9	—	44.6	61.7	—	38.5	55.4	—	32.2	48.8	—	25.8	42.0		
	4050 cfm	EA (wb)	58	TC	105.9	105.9	120.9	97.8	97.8	112.1	91.0	91.0	104.9	83.0	83.0	96.3	74.5	74.5	87.1
				SHC	91.0	105.9	120.9	83.5	97.8	112.1	77.1	91.0	104.9	69.7	83.0	96.3	61.8	74.5	87.1
62			TC	106.2	106.2	126.2	98.9	98.9	118.2	91.2	91.2	109.8	83.1	83.1	100.8	74.6	74.6	91.5	
			SHC	86.3	106.2	126.2	79.6	98.9	118.2	72.6	91.2	109.8	65.3	83.1	100.8	57.7	74.6	91.5	
67			TC	117.2	117.2	117.2	108.0	108.0	108.0	99.6	99.6	99.6	89.5	89.5	92.8	79.5	79.5	86.5	
			SHC	68.5	89.5	110.5	62.8	83.8	104.8	56.7	77.3	97.9	51.1	71.9	92.8	44.9	65.7	86.5	
72		TC	130.3	130.3	130.3	120.7	120.7	120.7	110.9	110.9	110.9	100.2	100.2	100.2	89.2	89.2	89.2		
		SHC	48.8	69.4	90.0	43.0	63.5	84.0	37.1	57.5	77.8	31.0	51.0	71.1	24.7	44.4	64.2		
76		TC	—	138.1	138.1	—	127.9	127.9	—	116.9	116.9	—	105.5	105.5	—	93.7	93.7		
		SHC	—	51.8	70.7	—	45.8	64.3	—	39.6	57.9	—	33.2	51.0	—	26.6	43.9		
4500 cfm		EA (wb)	58	TC	110.1	110.1	125.5	102.4	102.4	117.3	94.7	94.7	109.0	86.4	86.4	100.0	77.6	77.6	90.5
				SHC	94.7	110.1	125.5	87.6	102.4	117.3	80.4	94.7	109.0	72.7	86.4	100.0	64.6	77.6	90.5
	62		TC	110.5	110.5	131.0	102.7	102.7	122.5	94.8	94.8	113.9	86.5	86.5	104.7	77.7	77.7	95.0	
			SHC	89.9	110.5	131.0	82.8	102.7	122.5	75.7	94.8	113.9	68.2	86.5	104.7	60.3	77.7	95.0	
	67		TC	119.3	119.3	119.3	110.3	110.3	112.8	100.9	100.9	106.8	91.1	91.1	100.5	80.9	80.9	94.0	
			SHC	72.4	95.6	118.7	66.7	89.7	112.8	60.8	83.8	106.8	54.7	77.6	100.5	48.5	71.3	94.0	
	72	TC	132.0	132.0	132.0	122.4	122.4	122.4	112.3	112.3	112.3	101.7	101.7	101.7	90.0	90.0	90.0		
		SHC	50.2	72.7	95.2	44.4	66.8	89.1	38.5	60.6	82.7	32.3	54.1	76.0	25.7	46.9	68.1		
	76	TC	—	139.3	139.3	—	128.6	128.6	—	117.4	117.4	—	105.9	105.9	—	95.8	95.8		
		SHC	—	53.1	73.3	—	46.9	66.8	—	40.5	59.9	—	34	52.9	—	28.3	47.2		

### LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 8.

## 48/50GE\*\*17 One Stage Cooling Capacities

48/50GE**17			AMBIENT TEMPERATURE (°F)																
			85			95			105			115			125				
			EA (db)			EA (db)			EA (db)			EA (db)			EA (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
1800 cfm	EA (wb)	58	TC	56.5	56.5	65.5	51.2	51.2	60.0	45.6	45.6	54.0	40.0	40.0	48.1	34	34	41.7	
			SHC	47.5	56.5	65.5	42.5	51.2	60.0	37.2	45.6	54.0	31.9	40.0	48.1	26.2	34	41.7	
		62	TC	61.6	61.6	61.6	55.5	55.5	57.0	48.6	48.6	52.0	42.4	42.4	47.4	35.4	35.4	42.4	
			SHC	42.3	52.0	61.6	37.6	47.3	57.0	32.6	42.3	52.0	28.0	37.7	47.4	23.1	32.8	42.4	
		67	TC	70.6	70.6	70.6	64.2	64.2	64.2	57.6	57.6	57.6	50.6	50.6	50.6	43.1	43.1	43.1	
			SHC	34.5	44.3	54.0	29.9	39.6	49.4	25.1	34.8	44.5	20.3	30.0	39.6	15.3	25.0	34.7	
	72	TC	80.0	80.0	80.0	73.6	73.6	73.6	66.5	66.5	66.5	58.8	58.8	58.8	51.4	51.4	51.4		
		SHC	26.5	36.2	46.0	21.9	31.6	41.3	17.2	26.9	36.5	12.2	21.9	31.5	7.4	17.0	26.6		
	76	TC	—	88.9	88.9	—	80.4	80.4	—	74.7	74.7	—	65.4	65.4	—	56.9	56.9		
		SHC	—	29.9	39.0	—	24.7	34.1	—	20.3	28.0	—	15.0	24.1	—	9.9	18.9		
	2100 cfm	EA (wb)	58	TC	61.4	61.4	70.9	55.8	55.8	65.0	50.2	50.2	59.2	43.8	43.8	52.3	38.0	38.0	46.1
				SHC	51.9	61.4	70.9	46.6	55.8	65.0	41.3	50.2	59.2	35.4	43.8	52.3	29.8	38.0	46.1
62			TC	64.2	64.2	69.4	57.6	57.6	64.5	51.2	51.2	59.3	44.9	44.9	54.8	38.0	38.0	48.9	
			SHC	47.0	58.2	69.4	42.1	53.3	64.5	37.2	48.2	59.3	32.6	43.7	54.8	27.2	38.0	48.9	
67			TC	73.5	73.5	73.5	67.1	67.1	67.1	60.1	60.1	60.1	52.6	52.6	52.6	44.3	44.3	44.3	
			SHC	37.9	49.1	60.4	33.2	44.5	55.7	28.3	39.6	50.9	23.3	34.5	45.8	17.8	29.0	40.1	
72		TC	83.7	83.7	83.7	75.8	75.8	75.8	69.1	69.1	69.1	61.1	61.1	61.1	52.2	52.2	52.2		
		SHC	28.5	39.7	50.9	23.4	34.6	45.8	18.8	29.9	41.0	13.7	24.7	35.7	8.3.0	19.2	30.0		
76		TC	—	91.5	91.5	—	83.1	83.1	—	75.0	75.0	—	65.6	65.6	—	57.1	57.1		
		SHC	—	31.6	42.2	—	26.5	36.9	—	21.4	31.7	—	15.8	25.9	—	10.7	20.6		
2400 cfm		EA (wb)	58	TC	66.0	66.0	76.0	59.9	59.9	69.5	54.0	54.0	63.3	47.8	47.8	56.7	41.2	41.2	49.7
				SHC	56.0	66.0	76.0	50.3	59.9	69.5	44.7	54.0	63.3	38.9	47.8	56.7	32.8	41.2	49.7
	62		TC	67.1	67.1	77.3	60.9	60.9	72.1	54.2	54.2	66.6	47.8	47.8	59.7	41.3	41.3	52.6	
			SHC	51.9	64.6	77.3	47.0	59.5	72.1	41.8	54.2	66.6	35.9	47.8	59.7	30.0	41.3	52.6	
	67		TC	76.3	76.3	76.3	69.3	69.3	69.3	62.1	62.1	62.1	54.7	54.7	54.7	46.7	46.7	46.7	
			SHC	41.2	54.0	66.8	36.3	49.1	61.8	31.3	44.1	56.8	26.3	39.0	51.7	21.0	33.7	46.5	
	72	TC	85.9	85.9	85.9	78.8	78.8	78.8	70.9	70.9	70.9	62.4	62.4	62.4	54.2	54.2	54.2		
		SHC	30.0	42.7	55.3	25.2	37.8	50.4	20.1	32.6	45.0	14.8	27.0	39.2	9.6	21.8	34.0		
	76	TC	—	93.6	93.6	—	84.3	84.3	—	75.4	75.4	—	66.1	66.1	—	57.9	57.9		
		SHC	—	33.2	45.0	—	27.6	39.1	—	22.3	33.6	—	16.7	27.6	—	11.6	22.5		
	2700 cfm	EA (wb)	58	TC	69.4	69.4	79.7	63.6	63.6	73.6	57.4	57.4	67.0	50.9	50.9	60.1	44.0	44.0	52.8
				SHC	59.1	69.4	79.7	53.6	63.6	73.6	47.7	57.4	67.0	41.6	50.9	60.1	35.3	44.0	52.8
62			TC	67.4	67.4	80.8	63.6	63.6	76.9	57.5	57.5	70.4	51.0	51.0	63.3	44.1	44.1	55.8	
			SHC	54.1	67.4	80.8	50.2	63.6	76.9	44.6	57.5	70.4	38.7	51.0	63.3	32.4	44.1	55.8	
67			TC	77.6	77.6	77.6	70.2	70.2	70.2	63.1	63.1	63.1	56.4	56.4	56.9	48.3	48.3	51.9	
			SHC	43.9	58.2	72.6	38.8	53.1	67.3	33.7	47.9	62.0	28.9	42.9	56.9	23.7	37.8	51.9	
72		TC	86.5	86.5	86.5	80.4	80.4	80.4	72.0	72.0	72.0	63.9	63.9	63.9	55.9	55.9	55.9		
		SHC	30.9	44.7	58.4	26.4	40.3	54.2	21.1	34.9	48.6	16.0	29.5	43.0	10.9	24.4	38.0		
76		TC	—	94.3	94.3	—	84.6	84.6	—	76.7	76.7	—	66.8	66.8	—	58.6	58.6		
		SHC	—	34.2	46.9	—	28.5	40.8	—	23.4	35.6	—	17.5	29.1	—	12.3	23.9		
3000 cfm		EA (wb)	58	TC	72.6	72.6	83.3	66.5	66.5	76.8	60.2	60.2	70.1	53.4	53.4	62.9	46.4	46.4	55.4
				SHC	62.0	72.6	83.3	56.2	66.5	76.8	50.3	60.2	70.1	43.9	53.4	62.9	37.4	46.4	55.4
	62		TC	72.9	72.9	87.2	66.7	66.7	80.4	60.2	60.2	73.4	53.5	53.5	66.1	46.3	46.3	58.3	
			SHC	58.7	72.9	87.2	52.9	66.7	80.4	47	60.2	73.4	40.8	53.5	66.1	34.3	46.3	58.3	
	67		TC	79.8	79.8	79.8	72.8	72.8	73.0	65.1	65.1	68.2	57.4	57.4	63.0	49.4	49.4	57.2	
			SHC	46.9	62.7	78.4	41.8	57.4	73.0	36.8	52.5	68.2	31.7	47.3	63.0	26.2	41.7	57.2	
	72	TC	89.4	89.4	89.4	82.1	82.1	82.1	74.8	74.8	74.8	66.1	66.1	66.1	57.6	57.6	57.6		
		SHC	32.6	47.9	63.3	27.7	43.0	58.3	23.1	37.6	52.1	17.5	32.1	46.6	12.3	27.7	43.2		
	76	TC	—	94.6	94.6	—	87.2	87.2	—	77.4	77.4	—	67.1	67.1	—	59.3	59.3		
		SHC	—	34.9	48.5	—	30.3	42.1	—	24.0	36.6	—	18.3	31.0	—	12.9	25.1		

### LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 8.



## 48/50GE\*U17 — Unit with Humidi-MiZer® System in Subcooling Mode — Cooling Capacities

TEMP (°F) AIR ENTERING CONDENSER (Edb)		AIR ENTERING EVAPORATOR — SCFM/BF (80°F db)								
		4500/0.10			6000 /0.13			7500/0.16		
		Air Entering Evaporator — Ewb (°F)								
		72	67	62	72	67	62	72	67	62
75	TC	200.6	174.3	162.7	216.6	184.2	173.6	217.4	182.8	182.6
	SHC	84.2	100.5	129.2	93.1	119.2	156.0	106.2	129.3	172.3
	kW	11.1	10.4	10.4	11.3	10.6	10.5	11.2	10.2	10.7
85	TC	175.3	167.5	152.0	197.6	177.2	162.2	198.8	180.9	168.6
	SHC	60.5	94.5	118.7	74.9	113.1	145.2	89.1	127.8	168.6
	kW	12.0	12.0	11.8	12.6	12.2	12.0	12.6	12.3	12.2
95	TC	173.0	156.7	141.2	187.5	165.4	150.1	191.1	172.0	156.6
	SHC	58.8	84.3	109.0	65.5	102.1	134.1	82.1	119.9	156.6
	kW	14.0	13.8	13.4	14.4	13.9	13.6	14.6	14.1	13.8
105	TC	162.6	144.8	130.0	171.7	153.4	138.4	177.0	158.7	144.4
	SHC	49.3	73.4	98.5	60.1	91.1	123.3	69.3	107.6	144.4
	kW	16.0	15.4	15.2	16.2	15.7	15.3	16.3	15.7	15.5
115	TC	149.7	132.3	118.5	158.7	140.5	126.1	131.4	144.3	130.8
	SHC	37.7	62.1	88.2	48.3	79.7	112.4	126.3	94.9	130.8
	kW	30.5	17.3	16.9	18.2	17.5	17.1	17.5	17.6	17.3
125	TC	135.7	120.0	105.8	143.1	127.2	112.7	147.9	131.2	118.7
	SHC	25.5	51.5	77.1	34.7	68.2	100.6	43.4	83.3	118.7
	kW	19.9	19.4	19.0	20.0	19.6	19.1	20.2	19.7	19.3

## 48/50GE\*U17 — Unit with Humidi-MiZer System in Hot Gas Reheat Mode — Cooling Capacities

TEMP (°F) AIR ENTERING CONDENSER (Edb)		AIR ENTERING EVAPORATOR — Ewb (°F)								
		75 Dry Bulb 62.5 Wet Bulb (50% Relative)			75 Dry Bulb 64 Wet Bulb (56% Relative)			75 Dry Bulb 65.3 Wet Bulb (60% Relative)		
		Air Entering Evaporator — cfm								
		4500	6000	7500	4500	6000	7500	4500	6000	7500
80	TC	72.0	105.3	109.7	75.7	75.2	75.9	78.4	80.6	81.7
	SHC	10.6	32.1	52.5	2.7	11.7	22.2	-3.9	3.0	12.0
	kW	11.0	10.9	11.0	11.2	11.1	11.0	11.1	11.4	11.5
75	TC	80.6	81.9	84.5	81.0	83.7	83.7	88.4	87.7	89.2
	SHC	19.5	31.5	45.5	11.0	20.8	31.1	4.9	12.3	21.2
	kW	10.4	10.4	10.5	10.5	10.6	10.5	10.6	10.6	10.6
70	TC	88.8	90.6	97.4	89.2	92.5	94.4	93.1	96.8	98.7
	SHC	28.0	40.5	57.2	19.5	29.7	41.1	13.2	21.5	31.1
	kW	10.0	10.0	10.2	10.1	10.1	10.1	10.2	10.2	10.2
60	TC	96.0	99.4	100.9	96.1	99.6	101.2	99.8	103.7	105.3
	SHC	36.0	49.1	62.5	26.9	37.2	48.4	20.5	28.9	38.2
	kW	9.7	9.8	9.9	9.8	9.9	9.9	10.0	10.1	10.0
50	TC	112.0	116.5	118.9	113.7	116.0	118.7	115.5	122.9	122.5
	SHC	52.5	66.7	81.0	44.1	54.5	66.4	36.8	47.4	56.3
	kW	8.9	9.0	9.1	9.1	9.1	9.1	9.1	9.4	9.2
40	TC	127.3	134.9	138.5	136.3	133.8	135.0	130.5	138.5	139.3
	SHC	69.5	85.1	100.5	63.5	72.2	85.1	53.7	64.3	75.6
	kW	8.0	8.2	8.4	8.3	8.4	8.3	8.2	8.5	8.4

### LEGEND

- Edb — Entering Dry Bulb
- Ewb — Entering Wet Bulb
- kW — Compressor Power Input
- SCFM/BF — Standard Cubic Feet per Minute/Bypass Factor
- SHC — Sensible Heat Capacity (1000 Btuh) Gross
- TC — Total Capacity (1000 Btuh) Gross

## 48/50GE\*\*20 Three Stage Cooling Capacities

48/50GE**20			AMBIENT TEMPERATURE (°F)																
			85			95			105			115			125				
			EA (db)			EA (db)			EA (db)			EA (db)			EA (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
5250 cfm	EA (wb)	58	TC	179.2	179.2	203.9	169.3	169.3	193.2	158.9	158.9	182.0	148.0	148.0	170.2	136.5	136.5	157.7	
			SHC	154.4	179.2	203.9	145.3	169.3	193.2	135.8	158.9	182.0	125.9	148.0	170.2	115.3	136.5	157.7	
		62	TC	191.3	191.3	191.3	179.5	179.5	183.0	167.2	167.2	175.0	154.2	154.2	166.6	140.5	140.5	157.8	
			SHC	137.8	164.3	190.9	130.1	156.5	183.0	122.2	148.6	175.0	114.0	140.3	166.6	105.5	131.7	157.8	
		67	TC	211.9	211.9	211.9	199.4	199.4	199.4	186.2	186.2	186.2	172.3	172.3	172.3	157.6	157.6	157.6	
			SHC	112.8	139.4	166.0	105.1	131.6	158.2	97.2	123.7	150.2	89.1	115.6	142.1	80.8	107.2	133.6	
	72	TC	234.3	234.3	234.3	220.8	220.8	220.8	206.7	206.7	206.7	191.8	191.8	191.8	176.1	176.1	176.1		
		SHC	87.2	113.7	140.1	79.5	105.9	132.3	71.6	98.0	124.3	63.5	89.8	116.1	55.2	81.4	107.6		
	76	TC	—	252.4	252.4	—	238.2	238.2	—	222.9	222.9	—	206.9	206.9	—	190.0	190.0		
		SHC	—	92.5	118.4	—	84.8	110.5	—	76.8	102.5	—	68.5	94.2	—	60.1	85.6		
	6150 cfm	EA (wb)	58	TC	190.7	190.7	216.8	180.3	180.3	205.4	169.3	169.3	193.6	157.9	157.9	181.2	145.7	145.7	167.9
				SHC	164.7	190.7	216.8	155.1	180.3	205.4	145.1	169.3	193.6	134.6	157.9	181.2	123.5	145.7	167.9
62			TC	198.7	198.7	211.0	193.2	193.2	193.2	173.5	173.5	194.2	160.1	160.1	185.0	147.0	147.0	172.9	
			SHC	150.1	180.5	211.0	131.4	154.7	178.0	133.9	164.1	194.2	125.2	155.1	185.0	115.1	144.0	172.9	
67			TC	219.2	219.2	219.2	206.1	206.1	206.1	192.3	192.3	192.3	177.9	177.9	177.9	162.7	162.7	162.7	
			SHC	120.8	151.4	182.0	112.9	143.5	174.1	104.9	135.4	165.9	96.7	127.1	157.5	88.1	118.5	148.9	
72		TC	241.6	241.6	241.6	227.5	227.5	227.5	212.8	212.8	212.8	197.2	197.2	197.2	181.0	181.0	181.0		
		SHC	90.7	121.1	151.5	82.9	113.3	143.6	74.9	105.2	135.4	66.6	96.8	126.9	58.2	88.2	118.2		
76		TC	—	259.4	259.4	—	244.3	244.3	—	228.3	228.3	—	211.6	211.6	—	194.0	194.0		
		SHC	—	96.3	125.8	—	88.3	117.8	—	80.1	109.5	—	71.7	100.9	—	63.0	91.9		
7000 cfm		EA (wb)	58	TC	200.0	200.0	227.0	189.0	189.0	215.1	177.6	177.6	202.8	165.5	165.5	189.6	152.7	152.7	175.7
				SHC	172.9	200.0	227.0	162.8	189.0	215.1	152.4	177.6	202.8	141.3	165.5	189.6	129.8	152.7	175.7
	62		TC	204.1	204.1	228.1	191.6	191.6	219.4	178.2	178.2	211.2	165.7	165.7	197.9	152.9	152.9	183.6	
			SHC	160.5	194.3	228.1	152.2	185.8	219.4	144.1	177.7	211.2	133.5	165.7	197.9	122.2	152.9	183.6	
	67		TC	224.6	224.6	224.6	211.0	211.0	211.0	196.9	196.9	196.9	182.0	182.0	182.0	166.5	166.5	166.5	
			SHC	127.7	162.0	196.3	119.8	154.0	188.2	111.6	145.8	179.9	103.2	137.3	171.3	94.6	128.5	162.3	
	72	TC	246.9	246.9	246.9	232.2	232.2	232.2	217.1	217.1	217.1	201.0	201.0	201.0	184.3	184.3	184.3		
		SHC	93.6	127.6	161.6	85.7	119.6	153.5	77.5	111.3	145.1	69.2	102.8	136.4	60.6	94.0	127.4		
	76	TC	—	264.2	264.2	—	248.4	248.4	—	232.0	232.0	—	214.7	214.7	—	196.5	196.5		
		SHC	—	99.2	132.1	—	91.2	123.9	—	82.8	115.3	—	74.2	106.5	—	65.3	97.2		
	7900 cfm	EA (wb)	58	TC	208.2	208.2	236.2	196.8	196.8	223.8	184.9	184.9	210.9	172.3	172.3	197.2	159.1	159.1	182.8
				SHC	180.2	208.2	236.2	169.8	196.8	223.8	158.9	184.9	210.9	147.4	172.3	197.2	135.4	159.1	182.8
62			TC	208.8	208.8	246.3	197.2	197.2	233.4	185.1	185.1	219.8	172.5	172.5	205.8	159.2	159.2	190.9	
			SHC	171.3	208.8	246.3	161.1	197.2	233.4	150.3	185.1	219.8	139.3	172.5	205.8	127.6	159.2	190.9	
67			TC	229.1	229.1	229.1	215.2	215.2	215.2	200.7	200.7	200.7	185.6	185.6	185.6	169.6	169.6	175.8	
			SHC	134.6	172.6	210.6	126.6	164.5	202.4	118.3	156.1	193.9	109.8	147.4	185.0	101.0	138.4	175.8	
72		TC	251.2	251.2	251.2	236.3	236.3	236.3	220.6	220.6	220.6	204.3	204.3	204.3	187.1	187.1	187.1		
		SHC	96.3	133.9	171.5	88.3	125.7	163.2	80.0	117.3	154.6	71.6	108.7	145.8	62.8	99.7	136.5		
76		TC	—	268.0	268.0	—	251.8	251.8	—	235.3	235.3	—	217.1	217.1	—	198.6	198.6		
		SHC	—	102.0	138.2	—	93.7	129.7	—	85.4	121.1	—	76.4	111.7	—	67.3	102.2		
8750 cfm		EA (wb)	58	TC	214.8	214.8	243.5	203.1	203.1	230.8	190.7	190.7	217.4	177.7	177.7	203.2	164.1	164.1	188.3
				SHC	186.0	214.8	243.5	175.3	203.1	230.8	164.1	190.7	217.4	152.2	177.7	203.2	139.8	164.1	188.3
	62		TC	215.0	215.0	253.4	203.3	203.3	240.4	190.9	190.9	226.5	177.9	177.9	211.9	164.2	164.2	196.5	
			SHC	176.6	215.0	253.4	166.2	203.3	240.4	155.3	190.9	226.5	143.9	177.9	211.9	131.8	164.2	196.5	
	67		TC	232.6	232.6	232.6	218.5	218.5	218.5	203.7	203.7	206.4	188.3	188.3	197.4	172.1	172.1	187.9	
			SHC	140.7	182.1	223.5	132.6	173.8	215.0	124.3	165.3	206.4	115.7	156.5	197.4	106.8	147.4	187.9	
	72	TC	254.6	254.6	254.6	239.3	239.3	239.3	223.4	223.4	223.4	206.6	206.6	206.6	189.2	189.2	189.2		
		SHC	98.5	139.5	180.4	90.4	131.2	172.0	82.1	122.7	163.2	73.5	113.8	154.1	64.8	104.7	144.6		
	76	TC	—	270.7	270.7	—	254.2	254.2	—	236.9	236.9	—	218.9	218.9	—	200.0	200.0		
		SHC	—	104.2	143.4	—	95.8	134.7	—	87.1	125.7	—	78.2	116.2	—	68.9	106.4		

### LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 8.

## 48/50GE\*\*20 Two Stage Cooling Capacities

48/50GE**20			AMBIENT TEMPERATURE (°F)																
			85			95			105			115			125				
			EA (db)			EA (db)			EA (db)			EA (db)			EA (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
3150 cfm	EA (wb)	58	TC	108.8	108.8	122.0	102.0	102.0	114.8	94.9	94.9	107.2	87.4	87.4	99.3	79.7	79.7	91.0	
			SHC	95.5	108.8	122.0	89.1	102.0	114.8	82.5	94.9	107.2	75.6	87.4	99.3	68.4	79.7	91.0	
		62	TC	116.0	116.0	116.0	107.8	107.8	109.6	99.3	99.3	104.0	90.5	90.5	98.2	81.2	81.2	92.2	
			SHC	86.1	100.6	115.1	80.7	95.2	109.6	75.1	89.6	104.0	69.4	83.8	98.2	63.4	77.8	92.2	
		67	TC	130.0	130.0	130.0	121.4	121.4	121.4	112.3	112.3	112.3	102.9	102.9	102.9	93.0	93.0	93.0	
			SHC	71.1	85.6	100.1	65.7	80.2	94.7	60.1	74.6	89.1	54.4	68.9	83.4	48.6	63.1	77.5	
	72	TC	145.1	145.1	145.1	135.9	135.9	135.9	126.3	126.3	126.3	116.3	116.3	116.3	105.9	105.9	105.9		
		SHC	55.7	70.2	84.7	50.3	64.8	79.2	44.7	59.2	73.7	39.0	53.5	68.0	33.2	47.7	62.1		
	76	TC	—	157.8	157.8	—	148.1	148.1	—	138.0	138.0	—	127.4	127.4	—	116.3	116.3		
		SHC	—	57.5	71.5	—	52.1	66.1	—	46.5	60.6	—	40.8	54.9	—	35.0	49.0		
	3700 cfm	EA (wb)	58	TC	117.0	117.0	130.9	109.7	109.7	123.2	102.2	102.2	115.1	94.3	94.3	106.7	86.0	86.0	97.9
				SHC	103.0	117.0	130.9	96.3	109.7	123.2	89.2	102.2	115.1	81.9	94.3	106.7	74.2	86.0	97.9
62			TC	120.9	120.9	128.7	112.4	112.4	123.0	103.7	103.7	117.1	94.6	94.6	110.9	86.2	86.2	102.0	
			SHC	95.2	111.9	128.7	89.6	106.3	123.0	83.8	100.4	117.1	77.8	94.3	110.9	70.4	86.2	102.0	
67			TC	135.0	135.0	135.0	125.9	125.9	125.9	116.5	116.5	116.5	106.7	106.7	106.7	96.4	96.4	96.4	
			SHC	77.3	94.1	110.9	71.8	88.6	105.4	66.1	82.9	99.7	60.3	77.0	93.8	54.3	71.1	87.8	
72		TC	150.0	150.0	150.0	140.5	140.5	140.5	130.5	130.5	130.5	120.1	120.1	120.1	109.2	109.2	109.2		
		SHC	58.9	75.7	92.5	53.4	70.2	86.9	47.7	64.5	81.3	42.0	58.7	75.4	36.1	52.8	69.5		
76		TC	—	162.7	162.7	—	152.6	152.6	—	142.0	142.0	—	130.9	130.9	—	119.3	119.3		
		SHC	—	60.5	76.8	—	55.0	71.2	—	49.3	65.5	—	43.4	59.6	—	37.4	53.5		
4200 cfm		EA (wb)	58	TC	123.2	123.2	137.8	115.7	115.7	129.8	107.8	107.8	121.3	99.5	99.5	112.5	90.9	90.9	103.2
				SHC	108.6	123.2	137.8	101.5	115.7	129.8	94.2	107.8	121.3	86.5	99.5	112.5	78.5	90.9	103.2
	62		TC	124.6	124.6	140.4	116.2	116.2	134.1	107.9	107.9	126.0	99.7	99.7	117.0	91.0	91.0	107.5	
			SHC	102.7	121.5	140.4	96.7	115.4	134.1	89.8	107.9	126.0	82.3	99.7	117.0	74.5	91.0	107.5	
	67		TC	138.4	138.4	138.4	129.1	129.1	129.1	119.4	119.4	119.4	109.3	109.3	109.3	98.7	98.7	98.7	
			SHC	82.4	101.5	120.6	76.7	95.8	114.9	71.0	90.0	109.1	65.1	84.1	103.2	59.1	78.1	97.1	
	72	TC	153.6	153.6	153.6	143.7	143.7	143.7	133.4	133.4	133.4	122.7	122.7	122.7	111.5	111.5	111.5		
		SHC	61.3	80.4	99.4	55.7	74.7	93.8	50.0	69.0	88.0	44.2	63.1	82.1	38.2	57.1	76.0		
	76	TC	—	166.0	166.0	—	155.6	155.6	—	144.6	144.6	—	133.1	133.1	—	121.0	121.0		
		SHC	—	62.9	81.4	—	57.3	75.7	—	51.5	69.8	—	45.5	63.7	—	39.3	57.4		
	4750 cfm	EA (wb)	58	TC	129.1	129.1	144.2	121.2	121.2	135.7	112.9	112.9	126.9	104.4	104.4	117.7	95.4	95.4	108.1
				SHC	114.0	129.1	144.2	106.6	121.2	135.7	99.0	112.9	126.9	91.0	104.4	117.7	82.6	95.4	108.1
62			TC	129.2	129.2	149.4	119.9	119.9	139.7	113.1	113.1	131.8	104.5	104.5	122.4	95.5	95.5	112.4	
			SHC	109.1	129.2	149.4	100.2	119.9	139.7	94.4	113.1	131.8	86.6	104.5	122.4	78.5	95.5	112.4	
67			TC	141.4	141.4	141.4	131.9	131.9	131.9	122.0	122.0	122.0	111.6	111.6	112.9	100.8	100.8	106.6	
			SHC	87.9	109.2	130.5	82.2	103.5	124.8	76.4	97.6	118.9	70.4	91.6	112.9	64.3	85.5	106.6	
72		TC	156.6	156.6	156.6	146.5	146.5	146.5	135.9	135.9	135.9	125.0	125.0	125.0	113.5	113.5	113.5		
		SHC	63.9	85.2	106.4	58.3	79.5	100.7	52.5	73.7	94.9	46.6	67.7	88.8	40.5	61.6	82.6		
76		TC	—	168.7	168.7	—	157.9	157.9	—	146.6	146.6	—	134.7	134.7	—	122.2	122.2		
		SHC	—	65.2	85.7	—	59.5	79.9	—	53.5	73.8	—	47.4	67.5	—	41.1	60.9		
5250 cfm		EA (wb)	58	TC	133.6	133.6	149.2	125.5	125.5	140.5	117.0	117.0	131.5	108.1	108.1	121.9	98.8	98.8	111.9
				SHC	118.0	133.6	149.2	110.4	125.5	140.5	102.6	117.0	131.5	94.3	108.1	121.9	85.7	98.8	111.9
	62		TC	133.8	133.8	154.6	125.6	125.6	145.7	117.1	117.1	136.4	108.3	108.3	126.7	98.9	98.9	116.4	
			SHC	112.9	133.8	154.6	105.5	125.6	145.7	97.9	117.1	136.4	89.8	108.3	126.7	81.4	98.9	116.4	
	67		TC	143.7	143.7	143.7	134.0	134.0	134.0	123.9	123.9	127.7	113.4	113.4	121.5	102.4	102.4	115.2	
			SHC	92.5	116.0	139.5	86.7	110.2	133.7	80.8	104.3	127.7	74.8	98.2	121.5	68.6	91.9	115.2	
	72	TC	158.8	158.8	158.8	148.5	148.5	148.5	137.7	137.7	137.7	126.6	126.6	126.6	114.9	114.9	114.9		
		SHC	66.0	89.4	112.8	60.2	83.6	107.0	54.4	77.7	101.0	48.4	71.7	94.9	42.3	65.5	88.7		
	76	TC	—	170.6	170.6	—	159.5	159.5	—	147.9	147.9	—	135.7	135.7	—	123.1	123.1		
		SHC	—	67.1	89.6	—	61.2	83.6	—	55.2	77.3	—	48.9	70.8	—	42.4	64.0		

### LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 8.

## 48/50GE\*\*20 One Stage Cooling Capacities

48/50GE**20			AMBIENT TEMPERATURE (°F)																
			85			95			105			115			125				
			EA (db)			EA (db)			EA (db)			EA (db)			EA (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
2100 cfm	EA (wb)	58	TC	73.5	73.5	87.7	68.0	68.0	81.7	62.3	62.3	75.5	56.3	56.3	69.1	50.2	50.2	62.3	
			SHC	59.3	73.5	87.7	54.2	68.0	81.7	49.0	62.3	75.5	43.6	56.3	69.1	38.0	50.2	62.3	
		62	TC	80.6	80.6	81.5	74.0	74.0	76.8	67.2	67.2	72.0	60.1	60.1	67.1	52.7	52.7	62.1	
			SHC	52.2	66.8	81.5	47.5	62.1	76.8	42.7	57.4	72.0	37.8	52.5	67.1	32.9	47.5	62.1	
		67	TC	91.5	91.5	91.5	84.6	84.6	84.6	77.4	77.4	77.4	69.9	69.9	69.9	62.0	62.0	62.0	
			SHC	42.7	57.4	72.1	38.0	52.7	67.4	33.3	47.9	62.6	28.4	43.0	57.7	23.4	38.0	52.7	
	72	TC	103.5	103.5	103.5	96.1	96.1	96.1	88.5	88.5	88.5	80.5	80.5	80.5	72.1	72.1	72.1		
		SHC	33.1	47.8	62.4	28.4	43.1	57.7	23.6	38.3	52.9	18.7	33.4	48.0	13.7	28.4	43.0		
	76	TC	—	113.7	113.7	—	105.9	105.9	—	97.8	97.8	—	89.4	89.4	—	80.5	80.5		
		SHC	—	39.8	53.9	—	35.1	49.3	—	30.3	44.5	—	25.4	39.6	—	20.3	34.6		
	2450 cfm	EA (wb)	58	TC	79.7	79.7	94.8	73.9	73.9	88.5	67.9	67.9	81.9	61.6	61.6	75.0	55.0	55.0	67.9
				SHC	64.7	79.7	94.8	59.3	73.9	88.5	53.8	67.9	81.9	48.1	61.6	75.0	42.2	55.0	67.9
62			TC	84.5	84.5	91.6	77.6	77.6	86.8	70.5	70.5	81.9	63.1	63.1	76.8	55.5	55.5	71.5	
			SHC	57.6	74.6	91.6	52.8	69.8	86.8	47.9	64.9	81.9	42.9	59.8	76.8	37.7	54.6	71.5	
67			TC	95.7	95.7	95.7	88.4	88.4	88.4	80.8	80.8	80.8	72.9	72.9	72.9	64.7	64.7	64.7	
			SHC	46.3	63.3	80.4	41.5	58.5	75.5	36.6	53.6	70.6	31.6	48.6	65.6	26.5	43.5	60.5	
72		TC	107.7	107.7	107.7	100.0	100.0	100.0	92.0	92.0	92.0	83.6	83.6	83.6	74.9	74.9	74.9		
		SHC	34.8	51.8	68.8	29.9	47.0	64.0	25.0	42.1	59.1	20.0	37.0	54.0	14.9	31.9	48.9		
76		TC	—	118.0	118.0	—	109.9	109.9	—	101.3	101.3	—	92.3	92.3	—	82.9	82.9		
		SHC	—	42.3	58.8	—	37.4	54.0	—	32.5	49.0	—	27.4	43.9	—	22.2	38.6		
2800 cfm		EA (wb)	58	TC	85.1	85.1	100.9	78.9	78.9	94.2	72.6	72.6	87.3	66.0	66.0	80.1	59.1	59.1	72.5
				SHC	69.3	85.1	100.9	63.7	78.9	94.2	57.9	72.6	87.3	51.9	66.0	80.1	45.7	59.1	72.5
	62		TC	87.7	87.7	101.3	80.6	80.6	96.3	73.3	73.3	91.1	66.1	66.1	84.9	59.2	59.2	77.1	
			SHC	62.7	82.0	101.3	57.8	77.0	96.3	52.7	71.9	91.1	47.3	66.1	84.9	41.3	59.2	77.1	
	67		TC	98.9	98.9	98.9	91.3	91.3	91.3	83.5	83.5	83.5	75.3	75.3	75.3	66.8	66.8	68.0	
			SHC	49.5	68.9	88.3	44.6	64.0	83.4	39.6	59.0	78.4	34.6	53.9	73.3	29.4	48.7	68.0	
	72	TC	111.1	111.1	111.1	103.1	103.1	103.1	94.7	94.7	94.7	86.1	86.1	86.1	77.0	77.0	77.0		
		SHC	36.1	55.5	74.9	31.2	50.6	69.9	26.2	45.6	64.9	21.2	40.5	59.8	16.0	35.2	54.5		
	76	TC	—	121.3	121.3	—	112.7	112.7	—	103.7	103.7	—	94.3	94.3	—	84.3	84.3		
		SHC	—	44.4	63.2	—	39.4	58.1	—	34.3	53.0	—	29.1	47.6	—	23.6	42.0		
	3150 cfm	EA (wb)	58	TC	89.7	89.7	106.1	83.3	83.3	99.1	76.7	76.7	91.9	69.8	69.8	84.4	62.6	62.6	76.5
				SHC	73.2	89.7	106.1	67.4	83.3	99.1	61.4	76.7	91.9	55.2	69.8	84.4	48.7	62.6	76.5
62			TC	90.4	90.4	110.4	83.4	83.4	104.6	76.8	76.8	97.2	69.9	69.9	89.4	62.7	62.7	81.3	
			SHC	67.4	88.9	110.4	62.2	83.4	104.6	56.4	76.8	97.2	50.4	69.9	89.4	44.2	62.7	81.3	
67			TC	101.5	101.5	101.5	93.7	93.7	93.7	85.6	85.6	85.9	77.2	77.2	80.7	68.5	68.5	75.4	
			SHC	52.6	74.3	96.0	47.6	69.3	91.0	42.5	64.2	85.9	37.4	59.0	80.7	32.1	53.7	75.4	
72		TC	113.8	113.8	113.8	105.5	105.5	105.5	96.9	96.9	96.9	87.9	87.9	87.9	78.6	78.6	78.6		
		SHC	37.3	59.0	80.6	32.3	54.0	75.6	27.3	48.9	70.5	22.1	43.7	65.3	16.8	38.4	59.9		
76		TC	—	123.6	123.6	—	114.6	114.6	—	105.3	105.3	—	95.5	95.5	—	85.2	85.2		
		SHC	—	46.1	67.0	—	41.0	61.8	—	35.8	56.5	—	30.4	50.8	—	24.8	44.9		
3500 cfm		EA (wb)	58	TC	93.6	93.6	110.6	87.0	87.0	103.4	80.2	80.2	96.0	73.1	73.1	88.1	65.6	65.6	79.9
				SHC	76.6	93.6	110.6	70.6	87.0	103.4	64.5	80.2	96.0	58.0	73.1	88.1	51.3	65.6	79.9
	62		TC	93.8	93.8	116.5	87.2	87.2	109.1	80.3	80.3	101.4	73.2	73.2	93.3	65.7	65.7	84.9	
			SHC	71.1	93.8	116.5	65.3	87.2	109.1	59.3	80.3	101.4	53.1	73.2	93.3	46.6	65.7	84.9	
	67		TC	103.6	103.6	103.6	95.6	95.6	98.4	87.3	87.3	93.2	78.8	78.8	87.9	69.9	69.9	82.5	
			SHC	55.4	79.5	103.5	50.4	74.4	98.4	45.3	69.2	93.2	40.1	64.0	87.9	34.7	58.6	82.5	
	72	TC	115.9	115.9	115.9	107.4	107.4	107.4	98.6	98.6	98.6	89.4	89.4	89.4	79.9	79.9	79.9		
		SHC	38.3	62.3	86.2	33.3	57.2	81.1	28.2	52.0	75.9	23.0	46.8	70.6	17.6	41.3	65.1		
	76	TC	—	125.3	125.3	—	116.0	116.0	—	106.3	106.3	—	96.3	96.3	—	85.9	85.9		
		SHC	—	47.7	70.5	—	42.5	65.1	—	37.1	59.5	—	31.5	53.6	—	25.9	47.6		

### LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 8.

## 48/50GE\*U20 — Unit with Humidi-MiZer® System in Subcooling Mode — Cooling Capacities

TEMP (°F) AIR ENTERING CONDENSER (Edb)		AIR ENTERING EVAPORATOR — SCFM/BF (80°F db)								
		5250/0.04			7000 /0.06			8750/0.09		
		Air Entering Evaporator — Ewb (°F)								
		72	67	62	72	67	62	72	67	62
75	TC	242.3	218.9	195.5	256.3	233.2	208.6	263.4	232.2	217.9
	SHC	103.9	131.1	156.3	120.3	155.9	188.8	130.3	168.7	217.9
	kW	12.8	12.5	12.1	13.0	12.8	12.3	13.1	12.4	12.4
85	TC	225.6	202.5	181.8	237.8	213.9	194.3	240.9	223.3	203.0
	SHC	88.5	115.8	143.2	101.8	137.8	175.4	109.1	160.6	203.0
	kW	14.3	13.9	13.6	14.5	14.1	13.8	14.4	14.3	13.9
95	TC	209.5	188.0	168.0	221.0	199.7	179.5	230.9	207.0	188.3
	SHC	73.8	102.4	130.4	86.4	124.7	161.7	100.4	145.6	188.3
	kW	16.0	15.6	15.2	16.2	15.8	15.4	16.5	16.0	15.6
105	TC	195.3	172.8	153.9	206.3	183.6	164.5	213.2	190.2	172.9
	SHC	61.2	88.6	117.3	73.4	109.9	147.8	84.2	130.2	172.9
	kW	17.9	17.4	17.0	18.2	17.6	17.2	18.4	17.8	17.4
115	TC	178.7	157.1	139.2	188.7	166.8	148.7	194.9	172.8	156.6
	SHC	46.4	74.3	103.9	57.6	94.9	133.5	67.7	114.5	156.6
	kW	20.0	19.3	18.9	20.2	19.6	19.2	20.4	19.7	19.4
125	TC	161.8	142.3	124.0	170.7	151.0	132.5	176.3	155.1	140.2
	SHC	31.5	61.2	90.2	41.5	80.8	118.9	50.9	98.5	140.2
	kW	22.1	21.6	21.1	22.3	21.8	21.3	22.5	21.8	21.5

## 48/50GE\*U20 — Unit with Humidi-MiZer System in Hot Gas Reheat Mode — Cooling Capacities

TEMP (°F) AIR ENTERING CONDENSER (Edb)		AIR ENTERING EVAPORATOR — Ewb (°F)								
		75 Dry Bulb 62.5 Wet Bulb (50% Relative)			75 Dry Bulb 64 Wet Bulb (56% Relative)			75 Dry Bulb 65.3 Wet Bulb (60% Relative)		
		Air Entering Evaporator — cfm								
		5250	7000	8750	5250	7000	8750	5250	7000	8750
80	TC	77.8	79.9	81.1	82.8	85.1	86.1	87.3	89.3	90.6
	SHC	11.5	24.4	38.8	3.0	13.3	25.2	-4.3	3.3	13.3
	kW	12.8	12.8	12.8	12.9	13.0	13.0	13.0	13.1	13.1
75	TC	87.4	90.4	91.6	92.5	95.5	96.9	97.2	100.2	101.6
	SHC	21.1	34.8	49.3	12.6	23.7	36.0	5.4	14.0	24.2
	kW	12.2	12.3	12.3	12.4	12.4	12.4	12.5	12.5	12.6
70	TC	97.0	100.6	102.8	102.2	105.8	107.9	106.8	110.8	112.8
	SHC	30.6	45.0	60.4	22.3	34.0	47.0	15.1	24.6	35.5
	kW	11.7	11.7	11.8	11.8	11.9	11.9	11.9	12.0	12.0
60	TC	106.6	110.4	112.4	111.3	115.1	117.1	115.7	119.7	121.7
	SHC	40.0	54.5	69.7	31.2	43.0	56.0	23.7	33.3	44.1
	kW	11.4	11.5	11.5	11.5	11.6	11.7	11.7	11.8	11.9
50	TC	125.0	130.2	133.2	132.7	135.3	138.3	134.8	143.1	142.6
	SHC	58.6	74.6	90.8	51.4	63.5	77.4	42.9	55.2	65.5
	kW	10.4	10.5	10.6	10.7	10.7	10.8	10.7	11.0	10.9
40	TC	143.0	151.9	155.9	151.0	157.4	158.7	153.3	162.5	163.5
	SHC	78.1	95.8	113.1	70.3	84.9	100.1	63.1	75.4	88.7
	kW	9.4	9.7	9.8	9.7	9.8	9.8	9.7	10.0	9.9

### LEGEND

- Edb — Entering Dry Bulb
- Ewb — Entering Wet Bulb
- kW — Compressor Power Input
- SCFM/BF — Standard Cubic Feet per Minute/Bypass Factor
- SHC — Sensible Heat Capacity (1000 Btu/h) Gross
- TC — Total Capacity (1000 Btu/h) Gross

## 48/50GE\*\*24 Three Stage Cooling Capacities

48/50GE**24			AMBIENT TEMPERATURE (°F)																
			85			95			105			115			125				
			EA (db)			EA (db)			EA (db)			EA (db)			EA (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
6000 cfm	EA (wb)	58	TC	218.8	218.8	247.9	207.8	207.8	235.8	196.5	196.5	223.6	184.5	184.5	210.5	171.9	171.9	196.7	
			SHC	189.8	218.8	247.9	179.7	207.8	235.8	169.4	196.5	223.6	158.6	184.5	210.5	147.1	171.9	196.7	
		62	TC	235.6	235.6	235.6	222.5	222.5	222.5	208.8	208.8	211.3	194.3	194.3	202.4	179.1	179.1	193.3	
			SHC	168.6	198.4	228.2	160.3	190.1	219.8	151.9	181.6	211.3	143.1	172.7	202.4	134.1	163.7	193.3	
		67	TC	260.4	260.4	260.4	246.4	246.4	246.4	231.7	231.7	231.7	216.1	216.1	216.1	199.7	199.7	199.7	
			SHC	140.1	170.1	200.0	131.9	161.8	191.7	123.4	153.3	183.2	114.7	144.6	174.4	105.7	135.5	165.3	
	72	TC	288.0	288.0	288.0	273.1	273.1	273.1	257.3	257.3	257.3	240.5	240.5	240.5	—	—	—		
		SHC	111.2	141.0	170.8	103.0	132.7	162.5	94.5	124.3	154.0	85.7	115.5	145.2	—	—	—		
	76	TC	—	311.7	311.7	—	295.9	295.9	—	279.1	279.1	—	261.4	261.4	—	—	—		
		SHC	—	117.2	150.2	—	108.9	136.6	—	100.5	128.7	—	91.7	120.2	—	—	—		
	7000 cfm	EA (wb)	58	TC	234.7	234.7	265.2	223.3	223.3	252.8	211.3	211.3	239.8	198.8	198.8	226.0	185.5	185.5	211.5
				SHC	204.2	234.7	265.2	193.8	223.3	252.8	182.9	211.3	239.8	171.5	198.8	226.0	159.5	185.5	211.5
62			TC	247.3	247.3	253.0	233.7	233.7	244.3	219.4	219.4	235.6	204.2	204.2	226.3	188.4	188.4	216.0	
			SHC	184.8	218.9	253.0	176.4	210.3	244.3	167.8	201.7	235.6	158.8	192.6	226.3	149.1	182.5	216.0	
67			TC	272.4	272.4	272.4	257.8	257.8	257.8	242.4	242.4	242.4	226.1	226.1	226.1	209.0	209.0	209.0	
			SHC	151.5	185.8	220.2	143.2	177.5	211.8	134.5	168.8	203.1	125.7	159.9	194.1	116.5	150.7	184.9	
72		TC	300.4	300.4	300.4	284.7	284.7	284.7	268.2	268.2	268.2	250.7	250.7	250.7	—	—	—		
		SHC	117.4	151.7	185.9	109.1	143.3	177.5	100.4	134.6	168.8	91.6	125.7	159.9	—	—	—		
76		TC	—	324.5	324.5	—	307.8	307.8	—	290.4	290.4	—	271.9	271.9	—	—	—		
		SHC	—	123.7	156.1	—	115.3	148.0	—	106.7	139.5	—	97.8	130.8	—	—	—		
8000 cfm		EA (wb)	58	TC	249.7	249.7	281.5	237.9	237.9	268.6	225.3	225.3	254.9	212.2	212.2	240.5	198.2	198.2	225.2
				SHC	218.0	249.7	281.5	207.2	237.9	268.6	195.7	225.3	254.9	183.8	212.2	240.5	171.2	198.2	225.2
	62		TC	258.1	258.1	277.4	244.0	244.0	268.5	229.3	229.3	259.0	216.5	216.5	238.4	198.5	198.5	234.6	
			SHC	201.1	239.3	277.4	192.5	230.5	268.5	183.5	221.2	259.0	168.9	203.7	238.4	162.4	198.5	234.6	
	67		TC	283.4	283.4	283.4	268.2	268.2	268.2	252.3	252.3	252.3	235.5	235.5	235.5	217.8	217.8	217.8	
			SHC	162.9	201.5	240.1	154.6	193.1	231.6	145.9	184.3	222.8	136.9	175.3	213.7	127.7	166.1	204.4	
	72	TC	311.6	311.6	311.6	295.4	295.4	295.4	278.3	278.3	278.3	260.2	260.2	260.2	—	—	—		
		SHC	123.8	162.2	200.7	115.3	153.8	192.2	106.6	145.0	183.5	97.6	136.0	174.4	—	—	—		
	76	TC	—	336.0	336.0	—	318.8	318.8	—	300.7	300.7	—	281.7	281.7	—	—	—		
		SHC	—	130.1	166.9	—	121.6	158.6	—	112.9	150.0	—	103.8	141.1	—	—	—		
	9000 cfm	EA (wb)	58	TC	264.3	264.3	297.2	252.0	252.0	283.8	239.0	239.0	269.6	225.2	225.2	254.5	210.7	210.7	238.5
				SHC	231.4	264.3	297.2	220.2	252.0	283.8	208.4	239.0	269.6	195.9	225.2	254.5	182.8	210.7	238.5
62			TC	268.9	268.9	301.2	257.6	257.6	278.8	239.7	239.7	280.7	228.8	228.8	252.0	211.0	211.0	248.2	
			SHC	217.5	259.3	301.2	202.2	240.5	278.8	198.8	239.7	280.7	180.1	216.0	252.0	173.8	211.0	248.2	
67			TC	294.1	294.1	294.1	278.5	278.5	278.5	262.2	262.2	262.2	244.9	244.9	244.9	—	—	—	
			SHC	174.9	217.6	260.3	166.4	209.1	251.7	157.8	200.3	242.9	148.8	191.2	233.7	—	—	—	
72		TC	322.5	322.5	322.5	305.8	305.8	305.8	288.3	288.3	288.3	269.8	269.8	269.8	—	—	—		
		SHC	130.4	173.0	215.6	121.9	164.5	207.1	113.1	155.7	198.2	104.1	146.6	189.1	—	—	—		
76		TC	—	347.1	347.1	—	329.5	329.5	—	311.0	311.0	—	291.4	291.4	—	—	—		
		SHC	—	136.6	177.7	—	128.1	169.3	—	119.3	160.6	—	110.1	151.5	—	—	—		
10000 cfm		EA (wb)	58	TC	278.8	278.8	312.6	266.0	266.0	298.7	252.5	252.5	283.9	238.2	238.2	268.3	223.2	223.2	251.8
				SHC	244.9	278.8	312.6	233.3	266.0	298.7	221.1	252.5	283.9	208.2	238.2	268.3	194.6	223.2	251.8
	62		TC	279.9	279.9	325.2	266.5	266.5	310.1	252.9	252.9	294.9	238.6	238.6	278.8	223.6	223.6	261.8	
			SHC	234.6	279.9	325.2	222.8	266.5	310.1	210.9	252.9	294.9	198.4	238.6	278.8	185.4	223.6	261.8	
	67		TC	305.0	305.0	305.0	289.1	289.1	289.1	272.4	272.4	272.4	254.7	254.7	254.7	—	—	—	
			SHC	187.6	234.3	280.9	179.2	225.8	272.4	170.5	217.0	263.4	161.5	207.8	254.1	—	—	—	
	72	TC	333.6	333.6	333.6	316.6	316.6	316.6	298.7	298.7	298.7	279.8	279.8	279.8	—	—	—		
		SHC	137.7	184.3	230.9	129.1	175.7	222.3	120.3	166.9	213.5	111.3	157.8	204.4	—	—	—		
	76	TC	—	358.5	358.5	—	340.5	340.5	—	321.6	321.6	—	301.6	301.6	—	—	—		
		SHC	—	143.5	188.7	—	134.9	180.1	—	126.0	171.3	—	116.8	162.2	—	—	—		

### LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 8.

## 48/50GE\*\*24 Two Stage Cooling Capacities

48/50GE**24			AMBIENT TEMPERATURE (°F)																
			85			95			105			115			125				
			EA (db)			EA (db)			EA (db)			EA (db)			EA (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
3600 cfm	EA (wb)	58	TC	126.2	126.2	139.0	120.2	120.2	132.6	113.8	113.8	125.8	107.1	107.1	118.6	100.0	100.0	110.9	
			SHC	113.5	126.2	139.0	107.8	120.2	132.6	101.9	113.8	125.8	95.6	107.1	118.6	89.0	100.0	110.9	
		62	TC	135.0	135.0	135.0	127.6	127.6	127.6	119.8	119.8	120.2	111.5	111.5	115.2	102.8	102.8	109.9	
			SHC	102.4	116.0	129.7	97.8	111.4	125.0	93.0	106.6	120.2	88.1	101.7	115.2	82.9	96.4	109.9	
		67	TC	149.8	149.8	149.8	141.8	141.8	141.8	133.4	133.4	133.4	124.5	124.5	124.5	115.1	115.1	115.1	
			SHC	85.4	99.1	112.7	80.8	94.5	108.2	76.1	89.7	103.4	71.2	84.8	98.5	66.1	79.7	93.4	
	72	TC	166.1	166.1	166.1	157.5	157.5	157.5	148.4	148.4	148.4	138.7	138.7	138.7	128.5	128.5	128.5		
		SHC	68.0	81.7	95.3	63.4	77.1	90.7	58.7	72.3	85.9	53.8	67.4	81.0	48.7	62.3	75.9		
	76	TC	—	179.8	179.8	—	170.7	170.7	—	161.1	161.1	—	151.0	151.0	—	140.1	140.1		
		SHC	—	67.2	79.9	—	62.7	75.6	—	58.0	71.0	—	53.1	66.2	—	48.1	61.2		
	4200 cfm	EA (wb)	58	TC	134.3	134.3	147.7	127.8	127.8	140.9	121.1	121.1	133.6	113.9	113.9	126.0	106.2	106.2	117.7
				SHC	120.8	134.3	147.7	114.8	127.8	140.9	108.5	121.1	133.6	101.8	113.9	126.0	94.7	106.2	117.7
62			TC	140.1	140.1	142.5	132.3	132.3	137.7	124.2	124.2	132.6	115.7	115.7	127.1	106.6	106.6	121.9	
			SHC	111.2	126.9	142.5	106.5	122.1	137.7	101.5	117.1	132.6	96.3	111.7	127.1	91.1	106.5	121.9	
67			TC	155.1	155.1	155.1	146.7	146.7	146.7	137.8	137.8	137.8	128.5	128.5	128.5	118.6	118.6	118.6	
			SHC	91.5	107.2	122.9	86.8	102.5	118.2	82.0	97.7	113.4	77.0	92.7	108.3	71.8	87.5	103.1	
72		TC	171.1	171.1	171.1	162.1	162.1	162.1	152.7	152.7	152.7	142.7	142.7	142.7	132.1	132.1	132.1		
		SHC	71.1	86.8	102.5	66.4	82.1	97.8	61.6	77.3	93.0	56.7	72.3	88.0	51.5	67.2	82.8		
76		TC	—	185.1	185.1	—	175.6	175.6	—	165.6	165.6	—	155.0	155.0	—	143.8	143.8		
		SHC	—	69.9	84.6	—	65.4	80.5	—	60.6	75.7	—	55.7	70.8	—	50.6	65.7		
4800 cfm		EA (wb)	58	TC	141.0	141.0	155.1	134.2	134.2	147.8	127.1	127.1	140.2	119.5	119.5	132.1	111.4	111.4	123.4
				SHC	127.0	141.0	155.1	120.6	134.2	147.8	114.0	127.1	140.2	107.0	119.5	132.1	99.5	111.4	123.4
	62		TC	144.2	144.2	154.3	136.3	136.3	149.2	128.1	128.1	143.4	119.7	119.7	136.5	111.6	111.6	127.5	
			SHC	119.4	136.9	154.3	114.4	131.8	149.2	109.0	126.2	143.4	102.9	119.7	136.5	95.6	111.6	127.5	
	67		TC	159.1	159.1	159.1	150.4	150.4	150.4	141.2	141.2	141.2	131.6	131.6	131.6	121.3	121.3	121.3	
			SHC	97.2	114.9	132.7	92.4	110.1	127.8	87.5	105.2	122.9	82.4	100.1	117.7	77.1	94.7	112.4	
	72	TC	175.1	175.1	175.1	165.9	165.9	165.9	156.1	156.1	156.1	145.8	145.8	145.8	134.8	134.8	134.8		
		SHC	73.9	91.5	109.2	69.1	86.8	104.5	64.3	82.0	99.6	59.3	76.9	94.5	54.1	71.7	89.3		
	76	TC	—	189.2	189.2	—	179.4	179.4	—	169.1	169.1	—	158.1	158.1	—	146.5	146.5		
		SHC	—	72.4	89.4	—	67.8	84.8	—	62.9	80.0	—	57.9	75.1	—	52.7	69.9		
	5400 cfm	EA (wb)	58	TC	146.8	146.8	161.4	139.7	139.7	153.8	132.2	132.2	145.8	124.3	124.3	137.3	115.9	115.9	128.2
				SHC	132.2	146.8	161.4	125.6	139.7	153.8	118.7	132.2	145.8	111.4	124.3	137.3	103.5	115.9	128.2
62			TC	147.9	147.9	165.1	140.0	140.0	158.8	132.4	132.4	150.5	124.5	124.5	141.8	116.0	116.0	132.5	
			SHC	126.8	145.9	165.1	121.1	140.0	158.8	114.3	132.4	150.5	107.1	124.5	141.8	99.5	116.0	132.5	
67			TC	162.2	162.2	162.2	153.3	153.3	153.3	143.9	143.9	143.9	134.0	134.0	134.0	123.5	123.5	123.5	
			SHC	102.5	122.2	141.9	97.7	117.3	137.0	92.7	112.3	131.9	87.6	107.1	126.7	82.2	101.7	121.2	
72		TC	178.4	178.4	178.4	168.9	168.9	168.9	158.8	158.8	158.8	148.2	148.2	148.2	137.0	137.0	137.0		
		SHC	76.4	96.0	115.6	71.6	91.2	110.8	66.7	86.3	105.9	61.6	81.2	100.7	56.4	75.9	95.4		
76		TC	—	192.5	192.5	—	182.4	182.4	—	171.8	171.8	—	160.6	160.6	—	148.7	148.7		
		SHC	—	74.6	93.6	—	69.8	88.9	—	65.0	84.0	—	59.9	79.0	—	54.7	73.8		
6000 cfm		EA (wb)	58	TC	151.8	151.8	166.8	144.4	144.4	158.9	136.7	136.7	150.6	128.5	128.5	141.8	119.7	119.7	132.3
				SHC	136.8	151.8	166.8	129.9	144.4	158.9	122.7	136.7	150.6	115.1	128.5	141.8	107.0	119.7	132.3
	62		TC	152.0	152.0	172.0	144.6	144.6	164.0	136.8	136.8	155.4	128.6	128.6	146.4	119.8	119.8	136.7	
			SHC	131.9	152.0	172.0	125.2	144.6	164.0	118.2	136.8	155.4	110.8	128.6	146.4	102.8	119.8	136.7	
	67		TC	164.8	164.8	164.8	155.7	155.7	155.7	146.1	146.1	146.1	136.0	136.0	136.0	125.4	125.4	129.7	
			SHC	107.6	129.2	150.8	102.7	124.2	145.7	97.7	119.1	140.6	92.4	113.8	135.2	87.1	108.4	129.7	
	72	TC	181.0	181.0	181.0	171.2	171.2	171.2	161.0	161.0	161.0	150.2	150.2	150.2	138.7	138.7	138.7		
		SHC	78.6	100.1	121.7	73.8	95.4	116.9	68.9	90.4	111.9	63.8	85.3	106.7	58.5	79.9	101.3		
	76	TC	—	195.1	195.1	—	184.9	184.9	—	174.0	174.0	—	162.6	162.6	—	150.4	150.4		
		SHC	—	76.5	97.3	—	71.7	92.6	—	66.8	87.7	—	61.7	82.7	—	56.4	77.4		

### LEGEND

- Do Not Operate
- cfm — Cubic Feet Per Minute (Supply Air)
- EA (db) — Entering Air Temperature (dry bulb)
- EA (wb) — Entering Air Temperature (wet bulb)
- SHC — Sensible Heat Capacity (1000 Btuh) Gross
- TC — Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 8.

## 48/50GE\*\*24 One Stage Cooling Capacities

48/50GE**24			AMBIENT TEMPERATURE (°F)																
			85			95			105			115			125				
			EA (db)			EA (db)			EA (db)			EA (db)			EA (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
2400 cfm	EA (wb)	58	TC	98.0	98.0	106.0	92.4	92.4	102.2	86.5	86.5	97.8	80.5	80.5	92.5	74.7	74.7	86.2	
			SHC	81.2	93.6	106.0	77.4	89.8	102.2	73.1	85.5	97.8	68.4	80.5	92.5	63.1	74.7	86.2	
		62	TC	107.1	107.1	107.1	101.0	101.0	101.0	94.5	94.5	94.5	87.7	87.7	87.7	80.5	80.5	80.7	
			SHC	72.8	85.3	97.8	68.7	81.2	93.7	64.6	77.1	89.6	60.3	72.7	85.2	55.8	68.3	80.7	
		67	TC	119.5	119.5	119.5	112.9	112.9	112.9	106.0	106.0	106.0	98.8	98.8	98.8	91.0	91.0	91.0	
			SHC	61.6	74.1	86.7	57.6	70.1	82.6	53.4	65.9	78.4	49.1	61.6	74.1	44.7	57.2	69.7	
	72	TC	133.3	133.3	133.3	126.3	126.3	126.3	118.9	118.9	118.9	111.1	111.1	111.1	102.8	102.8	102.8		
		SHC	50.3	62.8	75.3	46.2	58.7	71.2	42.1	54.6	67.0	37.8	50.3	62.7	33.4	45.8	58.3		
	76	TC	—	145.3	145.3	—	137.9	137.9	—	130.1	130.1	—	121.8	121.8	—	113.1	113.1		
		SHC	—	53.4	66.6	—	49.4	62.6	—	45.2	58.4	—	41.0	54.2	—	36.5	48.3		
	2800 cfm	EA (wb)	58	TC	103.3	103.3	117.5	98.0	98.0	111.7	91.8	91.8	105.3	86.6	86.6	99.3	80.4	80.4	92.6
				SHC	89.1	103.3	117.5	84.2	98.0	111.7	78.3	91.8	105.3	73.8	86.6	99.3	68.2	80.4	92.6
62			TC	112.1	112.1	112.1	105.6	105.6	105.6	98.8	98.8	99.5	91.7	91.7	95.0	84.0	84.0	90.3	
			SHC	79.1	93.5	107.9	74.9	89.4	103.8	70.7	85.1	99.5	66.3	80.6	95.0	61.6	76.0	90.3	
67			TC	124.8	124.8	124.8	117.9	117.9	117.9	110.6	110.6	110.6	102.9	102.9	102.9	94.7	94.7	94.7	
			SHC	66.0	80.4	94.9	61.8	76.3	90.7	57.5	72.0	86.4	53.1	67.6	82.0	48.6	63.0	77.4	
72		TC	138.9	138.9	138.9	131.5	131.5	131.5	123.7	123.7	123.7	115.4	115.4	115.4	106.6	106.6	106.6		
		SHC	52.6	67.0	81.4	48.5	62.9	77.3	44.2	58.6	73.0	39.8	54.2	68.6	35.3	49.7	64.0		
76		TC	—	151.2	151.2	—	143.3	143.3	—	135.1	135.1	—	126.3	126.3	—	117.1	117.1		
		SHC	—	56.0	71.4	—	51.9	64.9	—	47.6	61.3	—	43.3	57.0	—	38.8	52.6		
3200 cfm		EA (wb)	58	TC	109.4	109.4	124.3	103.8	103.8	118.2	98.0	98.0	111.9	91.8	91.8	105.1	85.2	85.2	98.0
				SHC	94.5	109.4	124.3	89.4	103.8	118.2	84.1	98.0	111.9	78.5	91.8	105.1	72.5	85.2	98.0
	62		TC	116.1	116.1	117.6	109.4	109.4	113.3	102.3	102.3	108.8	94.9	94.9	104.2	87.0	87.0	99.2	
			SHC	85.0	101.3	117.6	80.8	97.0	113.3	76.4	92.6	108.8	71.8	88.0	104.2	67.0	83.1	99.2	
	67		TC	129.0	129.0	129.0	121.7	121.7	121.7	114.1	114.1	114.1	106.1	106.1	106.1	97.6	97.6	97.6	
			SHC	69.9	86.3	102.6	65.7	82.0	98.3	61.3	77.6	94.0	56.8	73.1	89.4	52.2	68.5	84.7	
	72	TC	143.3	143.3	143.3	135.4	135.4	135.4	127.3	127.3	127.3	118.7	118.7	118.7	109.6	109.6	109.6		
		SHC	54.6	70.9	87.2	50.3	66.6	82.9	46.0	62.3	78.6	41.6	57.8	74.1	36.9	53.2	69.5		
	76	TC	—	155.7	155.7	—	147.5	147.5	—	138.9	138.9	—	129.7	129.7	—	120.1	120.1		
		SHC	—	58.3	73.6	—	54.1	69.6	—	49.7	65.3	—	45.3	61.0	—	40.7	56.5		
	3600 cfm	EA (wb)	58	TC	114.7	114.7	130.2	108.9	108.9	123.9	102.7	102.7	117.2	96.3	96.3	110.1	89.4	89.4	102.6
				SHC	99.2	114.7	130.2	93.9	108.9	123.9	88.3	102.7	117.2	82.4	96.3	110.1	76.2	89.4	102.6
62			TC	119.4	119.4	126.7	112.4	112.4	122.3	105.2	105.2	117.6	97.6	97.6	112.6	89.6	89.6	107.3	
			SHC	90.5	108.6	126.7	86.2	104.2	122.3	81.6	99.6	117.6	76.9	94.7	112.6	71.9	89.6	107.3	
67			TC	132.4	132.4	132.4	124.9	124.9	124.9	117.0	117.0	117.0	108.7	108.7	108.7	99.9	99.9	99.9	
			SHC	73.6	91.8	110.0	69.3	87.5	105.6	64.9	83.0	101.2	60.3	78.5	96.6	55.6	73.7	91.8	
72		TC	146.7	146.7	146.7	138.7	138.7	138.7	130.3	130.3	130.3	121.4	121.4	121.4	112.1	112.1	112.1		
		SHC	56.3	74.4	92.6	52.0	70.2	88.3	47.6	65.8	83.9	43.1	61.2	79.3	38.5	56.5	74.6		
76		TC	—	159.3	159.3	—	150.7	150.7	—	141.8	141.8	—	132.4	132.4	—	122.5	122.5		
		SHC	—	60.2	77.6	—	56.0	73.4	—	51.6	69.1	—	47.1	64.6	—	42.4	60.0		
4000 cfm		EA (wb)	58	TC	119.3	119.3	135.4	113.3	113.3	128.8	106.9	106.9	121.8	100.2	100.2	114.5	93.0	93.0	106.6
				SHC	103.3	119.3	135.4	97.8	113.3	128.8	92.0	106.9	121.8	85.9	100.2	114.5	79.4	93.0	106.6
	62		TC	122.3	122.3	135.3	115.2	115.2	130.6	107.7	107.7	125.6	100.3	100.3	119.5	93.1	93.1	111.3	
			SHC	95.7	115.5	135.3	91.2	110.9	130.6	86.5	106.1	125.6	81.2	100.3	119.5	74.9	93.1	111.3	
	67		TC	135.2	135.2	135.2	127.4	127.4	127.4	119.4	119.4	119.4	110.8	110.8	110.8	101.9	101.9	101.9	
			SHC	77.1	97.1	117.1	72.7	92.7	112.7	68.3	88.2	108.2	63.6	83.5	103.5	58.9	78.7	98.6	
	72	TC	149.6	149.6	149.6	141.3	141.3	141.3	132.7	132.7	132.7	123.6	123.6	123.6	114.0	114.0	114.0		
		SHC	57.8	77.8	97.8	53.5	73.5	93.4	49.1	69.0	89.0	44.5	64.4	84.4	39.8	59.7	79.6		
	76	TC	—	162.1	162.1	—	153.4	153.4	—	144.2	144.2	—	134.6	134.6	—	124.4	124.4		
		SHC	—	62.0	81.2	—	57.7	77.0	—	53.3	72.6	—	48.7	68.0	—	44.0	63.4		

### LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 8.



## 48/50GE\*U24 — Unit with Humidi-MiZer® System in Subcooling Mode — Cooling Capacities

TEMP (°F) AIR ENTERING CONDENSER (Edb)		AIR ENTERING EVAPORATOR — SCFM/BF (80°F db)								
		6000/0.08			8000 /0.10			10000/0.13		
		Air Entering Evaporator — Ewb (°F)								
		72	67	62	72	67	62	72	67	62
75	TC	303.3	274.2	245.5	335.9	300.5	269.8	350.3	310.5	290.6
	SHC	127.6	157.9	187.4	142.4	193.4	232.8	170.8	217.6	282.8
	kW	17.5	16.9	16.3	17.9	17.3	16.6	17.9	17.1	16.9
85	TC	282.4	254.4	229.0	312.4	276.7	252.4	321.5	300.2	267.3
	SHC	106.9	139.8	171.5	118.5	170.1	215.4	142.9	204.8	281.5
	kW	19.5	18.8	18.4	19.8	19.1	18.6	19.7	19.4	18.8
95	TC	262.8	237.0	212.8	292.4	259.6	234.5	310.0	280.2	248.5
	SHC	89.5	123.8	157.0	99.3	153.5	200.5	129.0	186.6	264.8
	kW	21.5	20.9	20.4	22.0	21.3	20.8	22.4	21.5	21.0
105	TC	246.3	218.6	195.9	267.7	239.9	214.3	288.1	259.6	229.9
	SHC	73.2	106.0	140.6	89.6	135.2	188.0	108.0	166.1	242.8
	kW	24.2	23.4	22.7	24.6	23.8	23.0	25.0	23.9	23.2
115	TC	225.5	199.3	177.9	246.8	219.1	198.5	265.3	238.5	213.9
	SHC	53.3	87.7	124.4	69.6	117.0	160.4	86.4	146.8	208.3
	kW	45.9	25.9	25.2	27.3	26.3	25.6	27.5	26.6	25.9
125	TC	204.5	181.0	159.2	223.3	199.3	171.1	242.4	216.1	192.9
	SHC	34.5	71.3	107.5	47.6	98.5	157.5	63.1	125.4	189.0
	kW	29.5	28.8	28.1	29.8	29.2	28.4	30.1	29.3	28.8

## 48/50GE\*U24 — Unit with Humidi-MiZer System in Hot Gas Reheat Mode — Cooling Capacities

TEMP (°F) AIR ENTERING CONDENSER (Edb)		AIR ENTERING EVAPORATOR — Ewb (°F)								
		75 Dry Bulb 62.5 Wet Bulb (50% Relative)			75 Dry Bulb 64 Wet Bulb (56% Relative)			75 Dry Bulb 65.3 Wet Bulb (60% Relative)		
		Air Entering Evaporator — cfm								
		6000	8000	10000	6000	8000	10000	6000	8000	10000
80	TC	117.6	121.7	124.4	125.6	130.4	132.6	131.8	137.1	140.1
	SHC	17.4	37.2	59.5	4.5	20.4	38.8	-6.5	5.1	20.6
	kW	14.9	15.0	15.1	15.0	15.2	15.1	14.8	15.2	15.4
75	TC	130.3	135.6	138.2	138.6	144.2	144.9	145.7	151.4	154.8
	SHC	31.5	52.2	74.4	18.9	35.8	53.8	8.1	21.2	36.9
	kW	14.2	14.4	14.4	14.4	14.6	14.5	14.6	14.6	14.7
70	TC	142.4	148.9	152.9	150.9	157.4	161.4	157.9	165.3	169.3
	SHC	44.9	66.6	89.8	32.9	50.6	70.3	22.3	36.7	53.3
	kW	13.6	13.8	13.8	13.7	13.9	13.8	14.0	14.1	14.1
60	TC	151.8	158.5	161.9	159.3	166.1	169.5	166.3	173.6	177.2
	SHC	57.0	78.2	100.4	44.7	62.0	81.1	34.1	48.3	64.2
	kW	13.2	13.5	13.5	13.4	13.6	13.6	13.7	13.8	13.9
50	TC	173.8	181.9	186.4	185.3	190.1	194.9	189.2	202.3	202.5
	SHC	81.5	104.2	127.1	71.8	89.2	109.1	60.2	78.0	93.0
	kW	12.1	12.3	12.4	12.4	12.5	12.5	12.5	12.9	12.7
40	TC	194.2	207.2	213.0	206.5	216.3	218.8	210.8	224.7	227.0
	SHC	106.1	130.7	154.6	96.1	116.7	138.0	86.8	104.2	123.1
	kW	10.9	11.3	11.4	11.3	11.5	11.3	11.3	11.7	11.6

### LEGEND

- Edb — Entering Dry Bulb
- Ewb — Entering Wet Bulb
- kW — Compressor Power Input
- SCFM/BF — Standard Cubic Feet per Minute/Bypass Factor
- SHC — Sensible Heat Capacity (1000 Btu/h) Gross
- TC — Total Capacity (1000 Btu/h) Gross

## 48/50GE\*\*28 Three Stage Cooling Capacities

48/50GE**28			AMBIENT TEMPERATURE (°F)																
			85			95			105			115			125				
			EA (db)			EA (db)			EA (db)			EA (db)			EA (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
7500 cfm	EA (wb)	58	TC	254.9	254.9	289.7	241.6	241.6	275.2	227.8	227.8	260.2	212.9	212.9	243.9	196.7	196.7	226.2	
			SHC	220.2	254.9	289.7	208.0	241.6	275.2	195.4	227.8	260.2	181.9	212.9	243.9	167.2	196.7	226.2	
		62	TC	274.6	274.6	274.6	258.9	258.9	258.9	242.0	242.0	248.2	223.8	223.8	236.8	204.1	204.1	224.6	
			SHC	196.2	232.6	269.0	186.2	222.5	258.9	175.7	211.9	248.2	164.5	200.6	236.8	152.7	188.6	224.6	
		67	TC	305.1	305.1	305.1	288.4	288.4	288.4	270.5	270.5	270.5	251.1	251.1	251.1	230.1	230.1	230.1	
			SHC	161.8	198.3	234.9	151.8	188.4	224.9	141.4	177.9	214.4	130.5	167.0	203.4	119.1	155.5	191.9	
	72	TC	337.9	337.9	337.9	320.1	320.1	320.1	301.0	301.0	301.0	280.5	280.5	280.5	258.3	258.3	258.3		
		SHC	126.4	163.6	200.9	116.5	153.7	190.8	106.2	143.2	180.3	95.4	132.4	169.3	84.1	120.9	157.8		
	76	TC	—	365.7	365.7	—	346.9	346.9	—	326.7	326.7	—	305.0	305.0	—	281.6	281.6		
		SHC	—	135.4	176.7	—	125.5	166.2	—	115.2	155.4	—	104.3	143.9	—	93.0	132.1		
	8750 cfm	EA (wb)	58	TC	270.7	270.7	307.2	256.9	256.9	292.3	242.4	242.4	276.5	226.6	226.6	259.2	209.6	209.6	240.6
				SHC	234.2	270.7	307.2	221.6	256.9	292.3	208.4	242.4	276.5	194.0	226.6	259.2	178.6	209.6	240.6
62			TC	284.8	284.8	295.1	268.5	268.5	284.4	251.1	251.1	273.0	232.4	232.4	260.8	212.5	212.5	247.1	
			SHC	212.1	253.6	295.1	201.8	243.1	284.4	190.9	232.0	273.0	179.3	220.1	260.8	166.8	206.9	247.1	
67			TC	315.8	315.8	315.8	298.3	298.3	298.3	279.6	279.6	279.6	259.3	259.3	259.3	237.5	237.5	237.5	
			SHC	172.1	213.9	255.7	162.0	203.7	245.4	151.4	193.0	234.7	140.3	182.0	223.6	128.8	170.4	212.0	
72		TC	349.1	349.1	349.1	330.5	330.5	330.5	310.5	310.5	310.5	289.0	289.0	289.0	266.0	266.0	266.0		
		SHC	130.9	173.3	215.6	120.8	163.1	205.4	110.3	152.5	194.7	99.3	141.4	183.5	87.8	129.8	171.8		
76		TC	—	377.0	377.0	—	357.4	357.4	—	336.4	336.4	—	313.7	313.7	—	289.4	289.4		
		SHC	—	140.5	186.2	—	130.4	175.6	—	119.8	164.5	—	108.7	153.0	—	97.2	141.3		
10000 cfm		EA (wb)	58	TC	284.1	284.1	322.1	269.8	269.8	306.6	254.5	254.5	289.9	238.0	238.0	271.9	220.2	220.2	252.3
				SHC	246.0	284.1	322.1	233.0	269.8	306.6	219.1	254.5	289.9	204.2	238.0	271.9	188.0	220.2	252.3
	62		TC	293.3	293.3	318.8	276.6	276.6	307.5	258.9	258.9	295.2	244.1	244.1	264.2	220.4	220.4	263.4	
			SHC	226.6	272.7	318.8	215.9	261.7	307.5	204.5	249.8	295.2	183.8	224.0	264.2	177.4	220.4	263.4	
	67		TC	324.1	324.1	324.1	306.0	306.0	306.0	286.7	286.7	286.7	265.8	265.8	265.8	243.2	243.2	243.2	
			SHC	181.5	228.4	275.3	171.2	218.0	264.8	160.6	207.3	254.0	149.4	196.1	242.8	137.8	184.4	231.0	
	72	TC	357.8	357.8	357.8	338.5	338.5	338.5	317.9	317.9	317.9	295.7	295.7	295.7	271.9	271.9	271.9		
		SHC	134.4	181.8	229.2	124.2	171.5	218.8	113.6	160.8	208.0	102.4	149.5	196.6	90.8	137.7	184.7		
	76	TC	—	386.0	386.0	—	365.7	365.7	—	343.9	343.9	—	320.5	320.5	—	295.5	295.5		
		SHC	—	144.4	194.5	—	134.1	183.9	—	123.3	172.8	—	112.1	161.2	—	100.4	149.2		
	11250 cfm	EA (wb)	58	TC	295.4	295.4	334.8	280.6	280.6	318.7	264.7	264.7	301.3	247.5	247.5	282.5	229.0	229.0	262.2
				SHC	256.1	295.4	334.8	242.6	280.6	318.7	228.1	264.7	301.3	212.6	247.5	282.5	195.8	229.0	262.2
62			TC	300.6	300.6	339.8	288.6	288.6	305.1	270.0	270.0	294.7	247.8	247.8	294.6	229.3	229.3	273.6	
			SHC	239.6	289.7	339.8	217.4	261.3	305.1	206.8	250.8	294.7	201.1	247.8	294.6	185.0	229.3	273.6	
67			TC	330.8	330.8	330.8	312.1	312.1	312.1	292.3	292.3	292.3	270.9	270.9	270.9	247.8	247.8	249.2	
			SHC	190.3	242.1	294.0	179.9	231.7	283.5	169.2	220.8	272.5	158.0	209.6	261.1	146.3	197.7	249.2	
72		TC	364.8	364.8	364.8	345.0	345.0	345.0	323.8	323.8	323.8	301.0	301.0	301.0	276.7	276.7	276.7		
		SHC	137.2	189.5	241.8	126.9	179.0	231.2	116.1	168.2	220.3	104.8	156.8	208.7	93.1	144.9	196.7		
76		TC	—	393.2	393.2	—	372.2	372.2	—	349.9	349.9	—	325.9	325.9	—	300.3	300.3		
		SHC	—	147.3	202.1	—	136.9	191.4	—	126.0	180.2	—	114.6	168.4	—	102.6	156.2		
12500 cfm		EA (wb)	58	TC	305.3	305.3	345.8	290.0	290.0	329.1	273.5	273.5	311.1	255.7	255.7	291.6	236.7	236.7	270.7
				SHC	264.9	305.3	345.8	250.9	290.0	329.1	235.9	273.5	311.1	219.8	255.7	291.6	202.6	236.7	270.7
	62		TC	312.9	312.9	330.6	291.2	291.2	343.5	273.8	273.8	324.0	256.1	256.1	304.0	236.9	236.9	282.4	
			SHC	237.3	283.9	330.6	238.8	291.1	343.5	223.6	273.8	324.0	208.1	256.1	304.0	191.5	236.9	282.4	
	67		TC	336.4	336.4	336.4	317.3	317.3	317.3	297.0	297.0	297.0	275.1	275.1	278.6	251.6	251.6	266.3	
			SHC	198.5	255.0	311.6	188.1	244.6	301.1	177.4	233.8	290.3	166.1	222.3	278.6	154.3	210.3	266.3	
	72	TC	370.7	370.7	370.7	350.4	350.4	350.4	328.7	328.7	328.7	305.4	305.4	305.4	280.6	280.6	280.6		
		SHC	139.3	196.3	253.3	128.8	185.7	242.6	118.0	174.8	231.7	106.7	163.3	220.0	94.9	151.4	207.9		
	76	TC	—	399.1	399.1	—	377.7	377.7	—	354.9	354.9	—	330.5	330.5	—	304.3	304.3		
		SHC	—	149.3	208.6	—	138.7	197.8	—	127.7	186.5	—	116.1	174.6	—	104.1	162.1		

### LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 8.



## 48/50GE\*\*28 Two Stage Cooling Capacities

48/50GE**28			AMBIENT TEMPERATURE (°F)																
			85			95			105			115			125				
			EA (db)			EA (db)			EA (db)			EA (db)			EA (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
4500 cfm	EA (wb)	58	TC	154.0	154.0	175.0	145.6	145.6	165.8	137.4	137.4	156.9	129.2	129.2	148.0	119.1	119.1	136.9	
			SHC	133.1	154.0	175.0	125.3	145.6	165.8	117.9	137.4	156.9	110.4	129.2	148.0	101.3	119.1	136.9	
		62	TC	164.2	164.2	164.7	155.0	155.0	158.6	144.9	144.9	152.5	134.0	134.0	145.6	122.0	122.0	138.2	
			SHC	119.4	142.1	164.7	113.4	136.0	158.6	107.3	129.9	152.5	100.6	123.1	145.6	93.4	115.8	138.2	
		67	TC	182.4	182.4	182.4	172.4	172.4	172.4	161.8	161.8	161.8	150.1	150.1	150.1	137.4	137.4	137.4	
			SHC	98.3	121.0	143.7	92.4	115.1	137.9	86.3	109.0	131.7	79.8	102.5	125.2	73.0	95.6	118.3	
	72	TC	201.7	201.7	201.7	191.1	191.1	191.1	179.8	179.8	179.8	167.6	167.6	167.6	154.2	154.2	154.2		
		SHC	76.6	99.7	122.7	70.7	93.7	116.8	64.7	87.6	110.6	58.3	81.2	104.1	51.6	74.4	97.3		
	76	TC	—	218.3	218.3	—	207.1	207.1	—	194.9	194.9	—	182.2	182.2	—	168.1	168.1		
		SHC	—	82.2	107.0	—	76.4	101.0	—	70.2	94.5	—	63.9	87.8	—	57.2	80.8		
	5250 cfm	EA (wb)	58	TC	163.7	163.7	185.8	155.6	155.6	177.0	146.8	146.8	167.4	137.2	137.2	157.0	126.7	126.7	145.4
				SHC	141.6	163.7	185.8	134.2	155.6	177.0	126.2	146.8	167.4	117.5	137.2	157.0	108.0	126.7	145.4
62			TC	170.4	170.4	180.9	160.7	160.7	174.9	150.4	150.4	168.1	139.2	139.2	160.7	127.1	127.1	152.0	
			SHC	129.3	155.1	180.9	123.3	149.1	174.9	116.8	142.5	168.1	109.9	135.3	160.7	102.0	127.0	152.0	
67			TC	188.4	188.4	188.4	178.0	178.0	178.0	166.9	166.9	166.9	154.8	154.8	154.8	141.6	141.6	141.6	
			SHC	104.9	131.1	157.2	99.0	125.1	151.2	92.8	118.9	145.0	86.2	112.3	138.4	79.2	105.3	131.4	
72		TC	208.1	208.1	208.1	196.9	196.9	196.9	185.1	185.1	185.1	172.4	172.4	172.4	158.6	158.6	158.6		
		SHC	79.7	106.2	132.6	73.7	100.1	126.5	67.5	93.9	120.2	61.1	87.4	113.6	54.3	80.5	106.7		
76		TC	—	224.8	224.8	—	213.1	213.1	—	200.3	200.3	—	187.0	187.0	—	172.6	172.6		
		SHC	—	85.9	113.6	—	79.9	107.5	—	73.6	101.0	—	67.2	94.4	—	60.4	87.4		
6000 cfm		EA (wb)	58	TC	171.8	171.8	194.7	163.2	163.2	185.5	154.1	154.1	175.5	144.1	144.1	164.6	133.1	133.1	152.5
				SHC	148.8	171.7	194.7	141.0	163.2	185.5	132.6	154.1	175.5	123.6	144.1	164.6	113.7	133.1	152.5
	62		TC	175.2	175.2	196.2	166.2	166.2	183.6	154.4	154.4	183.1	147.0	147.0	158.6	133.2	133.2	159.1	
			SHC	138.5	167.3	196.2	129.2	156.4	183.6	125.8	154.4	183.1	110.6	134.6	158.6	107.2	133.2	159.1	
	67		TC	193.2	193.2	193.2	182.4	182.4	182.4	170.9	170.9	170.9	158.4	158.4	158.4	145.1	145.1	145.1	
			SHC	111.2	140.7	170.2	105.1	134.6	164.0	98.8	128.2	157.7	92.2	121.6	151.0	85.2	114.6	143.9	
	72	TC	213.1	213.1	213.1	201.3	201.3	201.3	189.2	189.2	189.2	176.1	176.1	176.1	161.8	161.8	161.8		
		SHC	82.4	112.2	142.0	76.3	106.0	135.7	70.0	99.7	129.3	63.5	93.1	122.6	56.6	86.1	115.6		
	76	TC	—	229.9	229.9	—	217.7	217.7	—	204.5	204.5	—	190.8	190.8	—	176.1	176.1		
		SHC	—	89.0	119.9	—	83.0	113.7	—	76.6	107.1	—	70.1	100.5	—	63.2	93.3		
	6750 cfm	EA (wb)	58	TC	178.6	178.6	202.4	169.7	169.7	192.7	160.2	160.2	182.4	149.9	149.9	171.0	138.5	138.5	158.5
				SHC	154.8	178.6	202.4	146.7	169.7	192.7	138.1	160.2	182.4	128.7	149.9	171.0	118.4	138.5	158.5
62			TC	179.5	179.5	210.4	170.1	170.1	200.8	160.4	160.4	190.0	150.0	150.0	178.3	138.6	138.6	165.4	
			SHC	147.1	178.7	210.4	139.3	170.1	200.8	130.8	160.4	190.0	121.7	150.0	178.3	111.8	138.6	165.4	
67			TC	196.8	196.8	196.8	185.9	185.9	185.9	174.0	174.0	174.0	161.3	161.3	163.0	147.3	147.3	155.6	
			SHC	117.0	149.8	182.6	110.9	143.6	176.3	104.5	137.2	169.8	97.8	130.4	163.0	90.6	123.1	155.6	
72		TC	217.1	217.1	217.1	205.3	205.3	205.3	192.4	192.4	192.4	179.1	179.1	179.1	164.5	164.5	164.5		
		SHC	84.7	117.7	150.6	78.6	111.6	144.5	72.2	105.1	137.9	65.7	98.4	131.2	58.7	91.4	124.0		
76		TC	—	233.8	233.8	—	221.1	221.1	—	208.1	208.1	—	193.9	193.9	—	178.6	178.6		
		SHC	—	91.8	125.8	—	85.6	119.5	—	79.2	112.8	—	72.6	106.0	—	65.6	98.8		
7500 cfm		EA (wb)	58	TC	184.5	184.5	209.0	175.3	175.3	199.0	165.5	165.5	188.2	154.8	154.8	176.5	143.2	143.2	163.8
				SHC	160.0	184.5	209.0	151.7	175.3	199.0	142.7	165.5	188.2	133.1	154.8	176.5	122.6	143.2	163.8
	62		TC	184.7	184.7	217.4	175.5	175.5	207.1	165.7	165.7	196.1	155.0	155.0	184.0	143.2	143.2	170.7	
			SHC	152.0	184.7	217.4	143.9	175.5	207.1	135.3	165.7	196.1	126.0	155.0	184.0	115.8	143.2	170.7	
	67		TC	199.9	199.9	199.9	188.6	188.6	188.6	176.5	176.5	181.3	163.6	163.6	174.3	149.6	149.6	166.6	
			SHC	122.5	158.4	194.3	116.3	152.1	187.9	109.9	145.6	181.3	103.1	138.7	174.3	95.8	131.2	166.6	
	72	TC	220.2	220.2	220.2	208.2	208.2	208.2	195.0	195.0	195.0	181.4	181.4	181.4	166.8	166.8	166.8		
		SHC	86.8	122.8	158.9	80.6	116.6	152.6	74.1	110.1	146.0	67.5	103.4	139.3	60.6	96.4	132.2		
	76	TC	—	236.9	236.9	—	224.2	224.2	—	210.8	210.8	—	196.3	196.3	—	180.6	180.6		
		SHC	—	94.1	131.0	—	87.9	124.6	—	81.5	118.1	—	74.7	111.2	—	67.7	103.9		

### LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 8.

## 48/50GE\*\*28 One Stage Cooling Capacities

48/50GE**28			AMBIENT TEMPERATURE (°F)																
			85			95			105			115			125				
			EA (db)			EA (db)			EA (db)			EA (db)			EA (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
3000 cfm	EA (wb)	58	TC	105.2	105.2	118.7	95.6	95.6	110.2	86.4	86.4	101.6	77.1	77.1	91.8	67.5	67.5	81.6	
			SHC	87.1	102.9	118.7	79.1	94.6	110.2	71.1	86.4	101.6	62.4	77.1	91.8	53.4	67.5	81.6	
		62	TC	117.5	117.5	117.5	107.1	107.1	107.1	96.6	96.6	96.6	85.6	85.6	85.7	74.1	74.1	77.5	
			SHC	77.4	93.3	109.2	69.7	85.6	101.5	61.9	77.8	93.7	53.9	69.8	85.7	45.8	61.7	77.5	
		67	TC	134.5	134.5	134.5	123.7	123.7	123.7	112.1	112.1	112.1	100.9	100.9	100.9	88.7	88.7	88.7	
			SHC	64.8	80.8	96.7	57.1	73.0	89.0	49.1	64.9	80.8	41.3	57.3	73.2	33.2	49.1	65.1	
	72	TC	152.8	152.8	152.8	141.5	141.5	141.5	129.7	129.7	129.7	117.6	117.6	117.6	104.8	104.8	104.8		
		SHC	51.8	67.9	84.1	44.1	60.2	76.3	36.3	52.4	68.5	28.4	44.5	60.6	20.3	36.3	52.4		
	76	TC	—	168.5	168.5	—	156.7	156.7	—	144.4	144.4	—	131.8	131.8	—	118.3	118.3		
		SHC	—	57.2	73.3	—	49.6	66.1	—	41.8	58.2	—	33.9	50.4	—	25.9	42.4		
	3500 cfm	EA (wb)	58	TC	113.7	113.7	131.0	104.5	104.5	121.2	94.8	94.8	111.0	84.9	84.9	100.4	75.1	75.1	90.0
				SHC	96.4	113.7	131.0	87.7	104.5	121.2	78.7	94.8	111.0	69.4	84.9	100.4	60.2	75.1	90.0
62			TC	123.9	123.9	123.9	113.2	113.2	114.8	102.1	102.1	106.8	90.5	90.5	98.5	78.5	78.5	89.9	
			SHC	85.9	104.3	122.7	78.0	96.4	114.8	70.0	88.4	106.8	61.8	80.1	98.5	53.4	71.7	89.9	
67			TC	141.4	141.4	141.4	130.0	130.0	130.0	118.3	118.3	118.3	106.1	106.1	106.1	93.3	93.3	93.3	
			SHC	70.8	89.3	107.7	62.9	81.4	99.8	54.9	73.3	91.8	46.7	65.2	83.6	38.4	56.8	75.2	
72		TC	160.1	160.1	160.1	148.1	148.1	148.1	135.8	135.8	135.8	122.9	122.9	122.9	109.5	109.5	109.5		
		SHC	55.3	73.9	92.5	47.4	66.0	84.6	39.4	58.0	76.5	31.2	49.8	68.3	22.9	41.4	60.0		
76		TC	—	175.7	175.7	—	163.5	163.5	—	150.8	150.8	—	137.4	137.4	—	123.3	123.3		
		SHC	—	61.2	80.4	—	53.4	72.6	—	45.3	64.1	—	37.3	56.4	—	28.9	47.9		
4000 cfm		EA (wb)	58	TC	122.0	122.0	140.2	112.3	112.3	129.9	102.4	102.4	119.4	92.2	92.2	108.5	81.5	81.5	97.0
				SHC	103.8	122.0	140.2	94.7	112.3	129.9	85.4	102.4	119.4	75.9	92.2	108.5	65.9	81.5	97.0
	62		TC	129.2	129.2	135.4	118.0	118.0	127.3	106.5	106.5	118.9	94.7	94.7	110.3	82.3	82.3	101.0	
			SHC	93.9	114.7	135.4	85.8	106.5	127.3	77.5	98.2	118.9	69.1	89.7	110.3	60.2	80.6	101.0	
	67		TC	146.8	146.8	146.8	134.9	134.9	134.9	122.7	122.7	122.7	110.1	110.1	110.1	96.8	96.8	96.8	
			SHC	76.3	97.2	118.2	68.2	89.1	110.1	60.0	80.9	101.8	51.7	72.6	93.5	43.2	64.1	84.9	
	72	TC	165.7	165.7	165.7	153.3	153.3	153.3	140.4	140.4	140.4	127.2	127.2	127.2	113.2	113.2	113.2		
		SHC	58.2	79.3	100.4	50.2	71.2	92.3	41.9	63.0	84.0	33.6	54.7	75.7	25.1	46.1	67.1		
	76	TC	—	181.8	181.8	—	168.9	168.9	—	155.6	155.6	—	141.4	141.4	—	127.2	127.2		
		SHC	—	64.7	86.5	—	56.6	78.4	—	48.5	70.2	—	40.1	61.8	—	31.6	53.0		
	4500 cfm	EA (wb)	58	TC	129.1	129.1	148.0	119.0	119.0	137.3	108.8	108.8	126.5	98.1	98.1	115.1	87.0	87.0	103.1
				SHC	110.2	129.1	148.0	100.7	119.0	137.3	91.2	108.8	126.5	81.2	98.1	115.1	70.9	87.0	103.1
62			TC	133.6	133.6	147.5	122.0	122.0	138.9	110.3	110.3	130.1	98.5	98.5	121.0	87.2	87.2	108.7	
			SHC	101.3	124.4	147.5	92.9	115.9	138.9	84.4	107.2	130.1	75.8	98.4	121.0	65.6	87.2	108.7	
67			TC	150.9	150.9	150.9	138.7	138.7	138.7	126.3	126.3	126.3	113.3	113.3	113.3	99.6	99.6	99.6	
			SHC	81.3	104.7	128.0	73.1	96.5	119.8	64.8	88.2	111.5	56.4	79.7	103.0	47.7	71.0	94.3	
72		TC	170.2	170.2	170.2	157.6	157.6	157.6	144.3	144.3	144.3	130.6	130.6	130.6	116.2	116.2	116.2		
		SHC	60.7	84.3	107.8	52.6	76.1	99.6	44.3	67.8	91.2	35.8	59.3	82.7	27.2	50.6	74.0		
76		TC	—	186.4	186.4	—	173.1	173.1	—	159.4	159.4	—	145.0	145.0	—	129.9	129.9		
		SHC	—	67.6	91.7	—	59.5	83.7	—	51.1	75.0	—	42.7	66.7	—	34.0	58.0		
5000 cfm		EA (wb)	58	TC	135.1	135.1	154.7	125.1	125.1	144.0	114.4	114.4	132.6	103.4	103.4	120.8	91.9	91.9	108.5
				SHC	115.6	135.1	154.7	106.1	125.1	144.0	96.2	114.4	132.6	85.9	103.4	120.8	75.2	91.9	108.5
	62		TC	137.4	137.4	158.6	125.4	125.4	148.7	114.6	114.6	138.9	103.6	103.6	126.9	92.0	92.0	114.3	
			SHC	108.2	133.4	158.6	99.0	123.8	148.7	90.2	114.6	138.9	80.2	103.6	126.9	69.8	92.0	114.3	
	67		TC	154.6	154.6	154.6	141.9	141.9	141.9	129.1	129.1	129.1	116.0	116.0	116.0	102.0	102.0	103.4	
			SHC	86.1	111.9	137.6	77.8	103.5	129.3	69.4	95.1	120.8	60.9	86.6	112.3	52.1	77.8	103.4	
	72	TC	173.7	173.7	173.7	160.8	160.8	160.8	147.3	147.3	147.3	133.3	133.3	133.3	118.7	118.7	118.7		
		SHC	63.0	88.9	114.9	54.7	80.6	106.5	46.3	72.2	98.0	37.8	63.6	89.4	29.0	54.8	80.6		
	76	TC	—	190.2	190.2	—	176.6	176.6	—	162.7	162.7	—	148.1	148.1	—	132.7	132.7		
		SHC	—	70.2	96.7	—	62.0	88.6	—	53.6	80.1	—	45.1	71.4	—	36.3	62.5		

### LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EA (db)	Entering Air Temperature (dry bulb)
EA (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 8.

## 48/50GE\*U28 — Unit with Humidi-MiZer® System in Subcooling Mode — Cooling Capacities

TEMP (°F) AIR ENTERING CONDENSER (Edb)		AIR ENTERING EVAPORATOR — SCFM/BF (80°F db)								
		7500/0.11			10000 /0.15			12500/0.18		
		Air Entering Evaporator — Ewb (°F)								
		72	67	62	72	67	62	72	67	62
75	TC	344.1	308.3	273.3	367.1	330.8	294.3	378.0	331.4	309.1
	SHC	141.4	176.7	209.7	149.3	210.1	253.9	176.7	227.2	293.3
	kW	20.6	20.0	19.2	20.7	20.4	19.6	21.0	19.9	19.9
85	TC	316.6	281.8	250.8	342.2	300.1	270.7	341.9	315.0	283.9
	SHC	115.6	151.5	187.7	124.8	181.0	231.1	143.0	211.0	269.0
	kW	22.8	22.1	21.4	23.1	22.4	21.8	23.1	22.8	22.2
95	TC	290.2	257.8	227.9	315.8	276.4	246.0	323.7	288.3	259.0
	SHC	91.2	128.7	165.8	100.7	158.3	207.7	125.4	185.7	245.0
	kW	25.2	24.6	23.9	25.9	25.1	24.4	26.4	25.2	24.8
105	TC	266.2	232.7	204.4	283.3	249.6	220.9	294.3	260.4	232.8
	SHC	69.0	105.4	143.6	84.6	133.3	184.1	97.9	159.4	220.1
	kW	28.3	27.4	26.6	28.7	27.8	27.1	29.1	28.0	27.3
115	TC	240.4	206.6	179.7	255.1	221.7	194.6	263.7	231.9	205.1
	SHC	45.4	81.2	120.7	58.6	107.9	159.9	69.8	133.4	193.9
	kW	53.8	30.3	29.5	31.9	30.8	30.0	32.1	31.1	30.5
125	TC	212.1	181.1	153.9	223.7	194.4	167.1	232.7	201.9	177.0
	SHC	20.0	57.9	97.3	30.2	82.7	134.8	41.2	105.6	167.6
	kW	34.6	33.7	32.9	34.9	34.1	33.2	35.2	34.2	33.7

## 48/50GE\*U28 — Unit with Humidi-MiZer System in Hot Gas Reheat Mode — Cooling Capacities


TEMP (°F) AIR ENTERING CONDENSER (Edb)		AIR ENTERING EVAPORATOR — Ewb (°F)								
		75 Dry Bulb 62.5 Wet Bulb (50% Relative)			75 Dry Bulb 64 Wet Bulb (56% Relative)			75 Dry Bulb 65.3 Wet Bulb (60% Relative)		
		Air Entering Evaporator — cfm								
		7500	10000	12500	7500	10000	12500	7500	10000	12500
80	TC	133.4	136.1	137.9	142.8	146.1	146.3	147.8	154.5	154.7
	SHC	19.7	41.6	66.0	5.2	22.8	42.8	-7.3	5.7	22.7
	kW	19.7	19.9	20.0	20.0	20.2	20.2	19.8	20.4	20.4
75	TC	149.4	154.3	154.5	158.4	163.7	161.7	166.8	171.9	173.5
	SHC	36.1	59.4	83.1	21.6	40.6	60.1	9.3	24.0	41.3
	kW	18.8	19.0	19.2	19.2	19.4	19.4	19.4	19.5	19.6
70	TC	164.9	171.2	172.8	174.7	180.8	182.8	182.7	190.1	192.3
	SHC	52.0	76.6	101.6	38.1	58.1	79.6	25.8	42.2	60.5
	kW	18.0	18.2	18.4	18.3	18.5	18.5	18.5	18.7	18.7
60	TC	180.2	186.3	187.8	188.8	195.2	196.9	196.5	204.1	205.8
	SHC	67.6	92.0	116.4	52.9	72.9	94.2	40.2	56.8	74.6
	kW	17.5	17.8	18.0	17.9	18.2	18.2	18.1	18.4	18.4
50	TC	210.2	219.0	221.7	223.9	228.4	231.8	228.2	242.3	240.1
	SHC	98.6	125.5	151.1	86.7	107.2	129.7	72.6	93.5	110.3
	kW	16.0	16.3	16.5	16.6	16.6	16.7	16.6	17.2	16.9
40	TC	239.8	254.2	258.7	253.9	264.3	264.9	258.4	274.0	273.7
	SHC	131.0	160.3	187.7	118.2	142.6	167.1	106.4	127.1	148.5
	kW	14.5	15.0	15.2	15.0	15.3	15.2	15.0	15.6	15.4

### LEGEND


- Edb — Entering Dry Bulb
- Ewb — Entering Wet Bulb
- kW — Compressor Power Input
- SCFM/BF — Standard Cubic Feet per Minute/Bypass Factor
- SHC — Sensible Heat Capacity (1000 Btu/h) Gross
- TC — Total Capacity (1000 Btu/h) Gross

## Pressure Drop — Heating


### 15 to 25 Ton Electric Heat Units

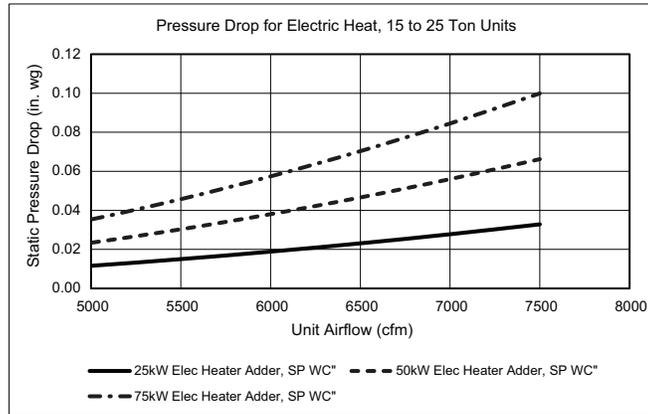

### 15 to 25 Ton Gas Heat Units

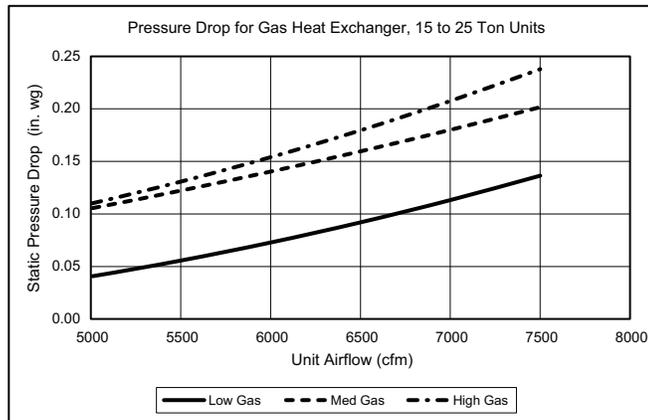


### Static Pressure 15 to 25 Ton Units

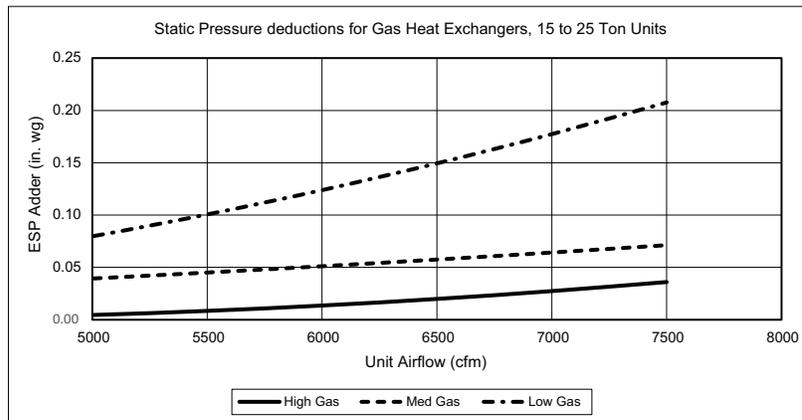


## Pressure Drops for Options and Accessories


### Economizer Pressure Drop, 15 to 25 Ton Units

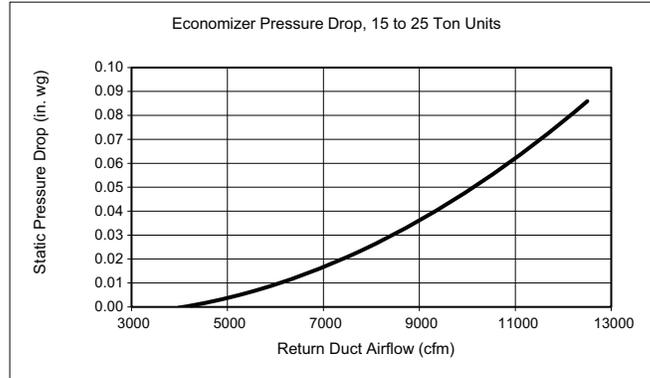

### Outside Air Damper Pressure Drop, 15 to 25 Ton Units

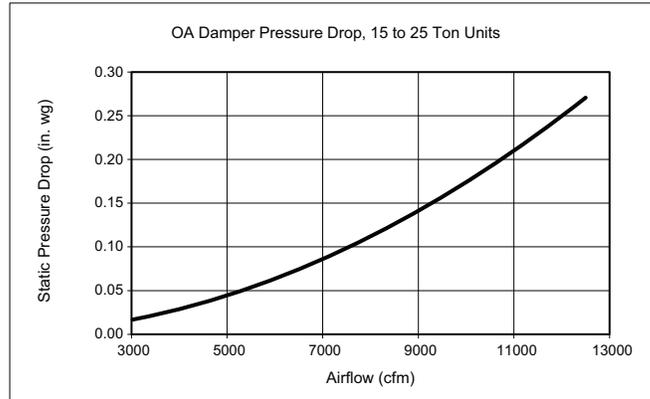

### Humidi-Mizer Coil Pressure Drop, 15 to 25 Ton Units

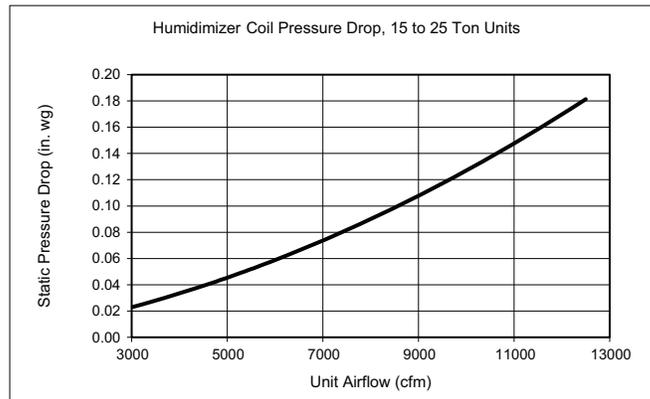

## General Fan Performance Notes

1. Interpolation is permissible. Do not extrapolate.
2. External static pressure is the static pressure difference between the return duct and the supply duct plus the static pressure caused by any FIOPs or accessories.
3. Tabular data accounts for pressure loss due to clean filters, unit casing, wet coils, and highest gas heat exchanger (when gas heat unit).
4. Factory options and accessories may effect static pressure losses. Gas heat unit fan tables assume highest gas heat models; for fan selections with low or medium heat models, the user must deduct low and medium heat static pressures. Selection software is available, through your salesperson, to help you select the best motor/drive combination for your application.
5. The fan performance tables offer motor recommendations. In cases when 2 motors would work, the lower horsepower option is recommended.
6. For information on the electrical properties of the fan motors, please see the Electrical information section of this book.
7. For more information on the performance limits of the fan motors, see the application data section of this book.
8. The EPACT (Energy Policy Act of 1992) regulates energy requirements for specific types of indoor fan motors. Motors regulated by EPACT include any general purpose, T-frame (3-digit, 143 and larger), single-speed, foot mounted, polyphase, squirrel cage induction motors of NEMA (National Electrical Manufacturers Association) design A and B, manufactured for use in the United States. Ranging from 1 to 200 Hp, these continuous-duty motors operate on 230 and 460 volt, 60 Hz power. If a motor does not fit into these specifications, the motor does not have to be replaced by an EPACT compliant energy-efficient motor. Variable-speed motors are exempt from EPACT compliance requirements.

## 48GEFT17 — 15 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	977	0.70	1102	1.00	1213	1.34	1314	1.70	1408	2.09
4875	1037	0.84	1155	1.15	1263	1.51	1360	1.88	1451	2.29
5250	1099	1.00	1210	1.33	1313	1.70	1408	2.10	1496	2.51
5625	1162	1.18	1267	1.53	1366	1.92	1457	2.33	1543	2.76
6000	1225	1.38	1325	1.75	1419	2.15	1508	2.58	1591	3.03
6375	1290	1.61	1384	1.99	1474	2.41	1560	2.85	1641	3.32
6750	1355	1.86	1443	2.25	1530	2.68	1613	3.14	1692	3.62
7125	1421	2.13	1504	2.52	1588	2.97	1668	3.44	1744	3.94
7500	1488	2.42	1567	2.82	1646	3.27	1723	3.75	1797	4.26

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	1496	2.51	1579	2.95	1658	3.41	1732	3.89	1803	4.39
4875	1537	2.72	1618	3.17	1695	3.65	1768	4.14	1838	4.65
5250	1579	2.96	1658	3.42	1733	3.91	1805	4.42	1875	4.95
5625	1623	3.22	1700	3.70	1774	4.20	1844	4.72	1912	5.26
6000	1670	3.51	1745	4.00	1816	4.51	1885	5.04	1952	5.60
6375	1717	3.80	1790	4.31	1860	4.83	1928	5.38	1993	5.95
6750	1766	4.12	1837	4.64	1906	5.18	1972	5.74	2035	6.30
7125	1817	4.45	1886	4.98	1953	5.53	2017	6.09	—	—
7500	1868	4.78	1936	5.33	2001	5.88	—	—	—	—

Std/Med Static 977-2000 rpm, 4.8 maximum bhp (2.4 maximum bhp per fan motor)

High Static 977-2200 rpm, 6.0 maximum bhp (3.0 maximum bhp per fan motor)

## 48GEFT17 — Standard/Medium Static — 15 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
4500	977	4.7	1102	5.4	1213	6.0	1314	6.5	1408	7.0
4875	1037	5.0	1155	5.7	1263	6.2	1360	6.7	1451	7.2
5250	1099	5.4	1210	5.9	1313	6.5	1408	7.0	1496	7.4
5625	1162	5.7	1267	6.2	1366	6.7	1457	7.2	1543	7.6
6000	1225	6.0	1325	6.5	1419	7.0	1508	7.5	1591	7.9
6375	1290	6.3	1384	6.8	1474	7.3	1560	7.7	1641	8.2
6750	1355	6.7	1443	7.1	1530	7.6	1613	8.0	1692	8.4
7125	1421	7.0	1504	7.4	1588	7.9	1668	8.3	1744	8.7
7500	1488	7.4	1567	7.8	1646	8.2	1723	8.6	1797	9.0

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
4500	1496	7.4	1579	7.8	1658	8.2	1732	8.6	1803	9.0
4875	1537	7.6	1618	8.0	1695	8.4	1768	8.8	1838	9.2
5250	1579	7.8	1658	8.2	1733	8.6	1805	9.0	1875	9.4
5625	1623	8.1	1700	8.5	1774	8.8	1844	9.2	—	—
6000	1670	8.3	1745	8.7	1816	9.1	1885	9.4	—	—
6375	1717	8.5	1790	8.9	1860	9.3	—	—	—	—
6750	1766	8.8	1837	9.2	—	—	—	—	—	—
7125	1817	9.1	1886	9.4	—	—	—	—	—	—
7500	1868	9.3	—	—	—	—	—	—	—	—

Std/Med Static 977-2000 rpm

## 48GEFT17 — High Static — 15 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
4500	977	4.4	1102	4.9	1213	5.4	1314	5.9	1408	6.3
4875	1037	4.6	1155	5.2	1263	5.7	1360	6.1	1451	6.5
5250	1099	4.9	1210	5.4	1313	5.9	1408	6.3	1496	6.8
5625	1162	5.2	1267	5.7	1366	6.2	1457	6.6	1543	7.0
6000	1225	5.5	1325	6.0	1419	6.4	1508	6.8	1591	7.2
6375	1290	5.8	1384	6.2	1474	6.6	1560	7.0	1641	7.4
6750	1355	6.1	1443	6.5	1530	6.9	1613	7.3	1692	7.7
7125	1421	6.4	1504	6.8	1588	7.2	1668	7.5	1744	7.9
7500	1488	6.7	1567	7.1	1646	7.4	1723	7.8	1797	8.1

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
4500	1496	6.8	1579	7.1	1658	7.5	1732	7.8	1803	8.2
4875	1537	6.9	1618	7.3	1695	7.7	1768	8.0	1838	8.3
5250	1579	7.1	1658	7.5	1733	7.8	1805	8.2	1875	8.5
5625	1623	7.3	1700	7.7	1774	8.0	1844	8.4	1912	8.7
6000	1670	7.6	1745	7.9	1816	8.2	1885	8.5	1952	8.9
6375	1717	7.8	1790	8.1	1860	8.4	1928	8.7	1993	9.0
6750	1766	8.0	1837	8.3	1906	8.6	1972	8.9	2035	9.2
7125	1817	8.2	1886	8.6	1953	8.9	2017	9.2	—	—
7500	1868	8.5	1936	8.8	2001	9.1	—	—	—	—

High Static 977-2200 rpm

## 48GEFT20 — 17.5 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
5250	1099	1.00	1210	1.33	1313	1.70	1408	2.10	1496	2.51
5690	1173	1.21	1277	1.57	1375	1.96	1466	2.37	1551	2.81
6125	1247	1.46	1344	1.83	1438	2.24	1525	2.67	1607	3.12
6565	1323	1.74	1414	2.12	1503	2.55	1587	3.00	1666	3.47
7000	1399	2.04	1484	2.43	1568	2.87	1649	3.34	1726	3.83
7440	1477	2.37	1557	2.78	1637	3.23	1714	3.70	1789	4.21
7875	1555	2.72	1629	3.13	1705	3.59	1779	4.07	1851	4.59
8315	1634	3.09	1704	3.50	1776	3.97	1847	4.46	1916	4.98
8750	1712	3.46	1778	3.88	1847	4.35	1915	4.84	1981	5.36

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
5250	1579	2.96	1658	3.42	1733	3.91	1805	4.42	1875	4.95
5690	1631	3.26	1708	3.75	1781	4.25	1851	4.77	1919	5.32
6125	1685	3.60	1759	4.09	1830	4.61	1899	5.15	1965	5.71
6565	1742	3.96	1814	4.48	1883	5.01	1949	5.55	2014	6.13
7000	1800	4.34	1870	4.87	1937	5.41	2002	5.97	—	—
7440	1860	4.73	1928	5.27	1993	5.82	2056	6.39	—	—
7875	1920	5.12	1986	5.67	2050	6.23	—	—	—	—
8315	1983	5.52	2047	6.07	—	—	—	—	—	—
8750	2046	5.91	—	—	—	—	—	—	—	—

Std/Med Static 1099-2000 rpm, 4.8 maximum bhp (2.4 maximum bhp per fan motor)

High Static 1099-2200 rpm, 6.0 maximum bhp (3.0 maximum bhp per fan motor)

## 48GEFT20 — Standard/Medium Static — 17.5 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
5250	1099	5.4	1210	5.9	1313	6.5	1408	7.0	1496	7.4
5690	1173	5.7	1277	6.3	1375	6.8	1466	7.3	1551	7.7
6125	1247	6.1	1344	6.6	1438	7.1	1525	7.6	1607	8.0
6565	1323	6.5	1414	7.0	1503	7.4	1587	7.9	1666	8.3
7000	1399	6.9	1484	7.3	1568	7.8	1649	8.2	1726	8.6
7440	1477	7.3	1557	7.7	1637	8.1	1714	8.5	1789	8.9
7875	1555	7.7	1629	8.1	1705	8.5	1779	8.9	1851	9.2
8315	1634	8.1	1704	8.5	1776	8.8	1847	9.2	1916	9.6
8750	1712	8.5	1778	8.9	1847	9.2	1915	9.6	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
5250	1579	7.8	1658	8.2	1733	8.6	1805	9.0	1875	9.4
5690	1631	8.1	1708	8.5	1781	8.9	1851	9.2	—	—
6125	1685	8.4	1759	8.8	1830	9.1	—	—	—	—
6565	1742	8.7	1814	9.0	1883	9.4	—	—	—	—
7000	1800	9.0	1870	9.3	—	—	—	—	—	—
7440	1860	9.3	—	—	—	—	—	—	—	—
7875	—	—	—	—	—	—	—	—	—	—
8315	—	—	—	—	—	—	—	—	—	—
8750	—	—	—	—	—	—	—	—	—	—

Std/Med Static 1099-2000 rpm

## 48GEFT20 — High Static — 17.5 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
5250	1099	4.9	1210	5.4	1313	5.9	1408	6.3	1496	6.8
5690	1173	5.3	1277	5.7	1375	6.2	1466	6.6	1551	7.0
6125	1247	5.6	1344	6.0	1438	6.5	1525	6.9	1607	7.3
6565	1323	6.0	1414	6.4	1503	6.8	1587	7.2	1666	7.5
7000	1399	6.3	1484	6.7	1568	7.1	1649	7.5	1726	7.8
7440	1477	6.7	1557	7.0	1637	7.4	1714	7.8	1789	8.1
7875	1555	7.0	1629	7.4	1705	7.7	1779	8.1	1851	8.4
8315	1634	7.4	1704	7.7	1776	8.0	1847	8.4	1916	8.7
8750	1712	7.7	1778	8.1	1847	8.4	1915	8.7	1981	9.0

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
5250	1579	7.1	1658	7.5	1733	7.8	1805	8.2	1875	8.5
5690	1631	7.4	1708	7.7	1781	8.1	1851	8.4	1919	8.7
6125	1685	7.6	1759	8.0	1830	8.3	1899	8.6	1965	8.9
6565	1742	7.9	1814	8.2	1883	8.5	1949	8.8	2014	9.1
7000	1800	8.2	1870	8.5	1937	8.8	2002	9.1	—	—
7440	1860	8.4	1928	8.7	1993	9.0	2056	9.3	—	—
7875	1920	8.7	1986	9.0	2050	9.3	—	—	—	—
8315	1983	9.0	2047	9.3	—	—	—	—	—	—
8750	2046	9.3	—	—	—	—	—	—	—	—

High Static 1099-2200 rpm

## 48GEFT24 — 20 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,000	1107	1.02	1212	1.34	1313	1.70	1411	2.11	1504	2.56
6,500	1182	1.24	1280	1.57	1374	1.95	1467	2.37	1556	2.83
7,000	1258	1.48	1350	1.83	1438	2.21	1525	2.64	1610	3.11
7,500	1335	1.75	1421	2.11	1504	2.50	1586	2.93	1667	3.40
8,000	1412	2.03	1494	2.40	1573	2.80	1650	3.23	1726	3.70
8,500	1490	2.32	1568	2.70	1643	3.11	1716	3.54	1788	4.00
9,000	1569	2.62	1643	3.01	1714	3.41	1783	3.84	1852	4.31
9,500	1647	2.92	1719	3.32	1786	3.72	1852	4.15	1918	4.61
10,000	1726	3.23	1795	3.64	1860	4.05	1923	4.47	1985	4.92

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,000	1592	3.04	1674	3.53	1750	4.03	1821	4.54	1888	5.06
6,500	1641	3.32	1721	3.83	1797	4.35	1869	4.90	1936	5.45
7,000	1692	3.61	1770	4.13	1845	4.68	1916	5.24	1984	5.81
7,500	1745	3.90	1821	4.43	1894	4.99	1964	5.56	2032	6.16
8,000	1801	4.20	1874	4.73	1945	5.29	2014	5.88	2080	6.47
8,500	1859	4.50	1929	5.03	1998	5.59	2065	6.17	2129	6.76
9,000	1920	4.80	1987	5.32	2053	5.87	2117	6.43	2180	7.03
9,500	1982	5.09	2046	5.60	2110	6.14	2172	6.70	—	—
10,000	2047	5.40	2108	5.89	2169	6.42	—	—	—	—

Std/Med Static 1107-2000 rpm, 4.8 maximum bhp (2.4 maximum bhp per fan motor)

High Static 1107-2200 rpm, 10.0 maximum bhp (5.0 maximum bhp per fan motor)

## 48GEFT24 — Standard/Medium Static — 20 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
6,000	1107	5.4	1212	5.9	1313	6.5	1411	7.0	1504	7.4
6,500	1182	5.8	1280	6.3	1374	6.8	1467	7.3	1556	7.7
7,000	1258	6.2	1350	6.7	1438	7.1	1525	7.6	1610	8.0
7,500	1335	6.6	1421	7.0	1504	7.4	1586	7.9	1667	8.3
8,000	1412	7.0	1494	7.4	1573	7.8	1650	8.2	1726	8.6
8,500	1490	7.4	1568	7.8	1643	8.2	1716	8.5	1788	8.9
9,000	1569	7.8	1643	8.2	1714	8.5	1783	8.9	1852	9.2
9,500	1647	8.2	1719	8.6	1786	8.9	1852	9.2	1918	9.6
10,000	1726	8.6	1795	8.9	1860	9.3	1923	9.6	1985	9.9

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
6,000	1592	7.9	1674	8.3	1750	8.7	1821	9.1	1888	9.4
6,500	1641	8.2	1721	8.6	1797	9.0	1869	9.3	—	—
7,000	1692	8.4	1770	8.8	1845	9.2	—	—	—	—
7,500	1745	8.7	1821	9.1	1894	9.5	—	—	—	—
8,000	1801	9.0	1874	9.4	—	—	—	—	—	—
8,500	1859	9.3	1929	9.6	—	—	—	—	—	—
9,000	1920	9.6	—	—	—	—	—	—	—	—
9,500	1982	9.9	—	—	—	—	—	—	—	—
10,000	—	—	—	—	—	—	—	—	—	—

Std/Med Static 1107-2000 rpm

## 48GEFT24 — High Static — 20 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
6,000	1107	5.0	1212	5.4	1313	5.9	1411	6.4	1504	6.8
6,500	1182	5.3	1280	5.8	1374	6.2	1467	6.6	1556	7.0
7,000	1258	5.7	1350	6.1	1438	6.5	1525	6.9	1610	7.3
7,500	1335	6.0	1421	6.4	1504	6.8	1586	7.2	1667	7.5
8,000	1412	6.4	1494	6.7	1573	7.1	1650	7.5	1726	7.8
8,500	1490	6.7	1568	7.1	1643	7.4	1716	7.8	1788	8.1
9,000	1569	7.1	1643	7.4	1714	7.8	1783	8.1	1852	8.4
9,500	1647	7.4	1719	7.8	1786	8.1	1852	8.4	1918	8.7
10,000	1726	7.8	1795	8.1	1860	8.4	1923	8.7	1985	9.0

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
6,000	1592	7.2	1674	7.6	1750	7.9	1821	8.3	1888	8.6
6,500	1641	7.4	1721	7.8	1797	8.1	1869	8.5	1936	8.8
7,000	1692	7.7	1770	8.0	1845	8.4	1916	8.7	1984	9.0
7,500	1745	7.9	1821	8.3	1894	8.6	1964	8.9	2032	9.2
8,000	1801	8.2	1874	8.5	1945	8.8	2014	9.1	2080	9.4
8,500	1859	8.4	1929	8.7	1998	9.1	2065	9.4	2129	9.7
9,000	1920	8.7	1987	9.0	2053	9.3	2117	9.6	2180	9.9
9,500	1982	9.0	2046	9.3	2110	9.6	2172	9.9	—	—
10,000	2047	9.3	2108	9.6	2169	9.9	—	—	—	—

High Static 1107-2200 rpm

## 48GEFT28 — 25 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
7,500	1177	1.57	1260	1.92	1347	2.35	1437	2.85	1524	3.40
8,125	1263	1.95	1337	2.31	1417	2.75	1499	3.26	1581	3.82
8,750	1349	2.38	1418	2.77	1490	3.21	1565	3.72	1642	4.30
9,375	1437	2.88	1500	3.27	1566	3.72	1635	4.24	1706	4.82
10,000	1525	3.41	1583	3.81	1644	4.27	1708	4.79	1774	5.37
11,700	1613	3.97	1668	4.39	1724	4.85	1784	5.37	1845	5.94
11,250	1702	4.57	1753	4.99	1806	5.46	1861	5.97	1918	6.54
11,875	1791	5.22	1839	5.66	1889	6.13	1941	6.65	1994	7.21
12,500	1880	6.00	1926	6.46	1973	6.94	2021	7.46	2071	8.03

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
7,500	1607	3.98	1686	4.60	1760	5.23	1830	5.88	1897	6.55
8,125	1661	4.43	1738	5.07	1811	5.74	1880	6.42	1947	7.13
8,750	1718	4.92	1792	5.59	1863	6.28	1932	7.00	1997	7.73
9,375	1778	5.45	1849	6.13	1918	6.84	1984	7.57	2049	8.34
10,000	1841	6.00	1908	6.68	1974	7.40	2039	8.15	2102	8.93
11,700	1907	6.56	1970	7.23	2033	7.95	2096	8.71	2157	9.50
11,250	1976	7.15	2036	7.82	2095	8.52	2155	9.28	—	—
11,875	2048	7.81	2104	8.47	2160	9.17	—	—	—	—
12,500	2122	8.63	2175	9.30	—	—	—	—	—	—

Std/Med Static 1177-2200 rpm, 6.0 maximum bhp (3.0 maximum bhp per fan motor)

High Static 1177-2200 rpm, 10.0 maximum bhp (5 maximum bhp per fan motor)

## 48GEFT28 — Standard/Medium Static — 25 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
7,500	1177	5.3	1260	5.7	1347	6.1	1437	6.5	1524	6.9
8,125	1263	5.7	1337	6.0	1417	6.4	1499	6.8	1581	7.1
8,750	1349	6.1	1418	6.4	1490	6.7	1565	7.1	1642	7.4
9,375	1437	6.5	1500	6.8	1566	7.1	1635	7.4	1706	7.7
10,000	1525	6.9	1583	7.2	1644	7.4	1708	7.7	1774	8.0
11,700	1613	7.3	1668	7.5	1724	7.8	1784	8.1	1845	8.4
11,250	1702	7.7	1753	7.9	1806	8.2	1861	8.4	—	—
11,875	1791	8.1	1839	8.3	1889	8.6	—	—	—	—
12,500	1880	8.5	—	—	—	—	—	—	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
7,500	1607	7.3	1686	7.6	1760	8.0	1830	8.3	—	—
8,125	1661	7.5	1738	7.9	1811	8.2	—	—	—	—
8,750	1718	7.8	1792	8.1	1863	8.4	—	—	—	—
9,375	1778	8.1	1849	8.4	—	—	—	—	—	—
10,000	1841	8.3	—	—	—	—	—	—	—	—
11,700	—	—	—	—	—	—	—	—	—	—
11,250	—	—	—	—	—	—	—	—	—	—
11,875	—	—	—	—	—	—	—	—	—	—
12,500	—	—	—	—	—	—	—	—	—	—

Std/Med Static 1177-2200 rpm

## 48GEFT28 — High Static — 25 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
7,500	1177	5.3	1260	5.7	1347	6.1	1437	6.5	1524	6.9
8,125	1263	5.7	1337	6.0	1417	6.4	1499	6.8	1581	7.1
8,750	1349	6.1	1418	6.4	1490	6.7	1565	7.1	1642	7.4
9,375	1437	6.5	1500	6.8	1566	7.1	1635	7.4	1706	7.7
10,000	1525	6.9	1583	7.2	1644	7.4	1708	7.7	1774	8.0
11,700	1613	7.3	1668	7.5	1724	7.8	1784	8.1	1845	8.4
11,250	1702	7.7	1753	7.9	1806	8.2	1861	8.4	1918	8.7
11,875	1791	8.1	1839	8.3	1889	8.6	1941	8.8	1994	9.0
12,500	1880	8.5	1926	8.7	1973	9.0	2021	9.2	2071	9.4

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
7,500	1607	7.3	1686	7.6	1760	8.0	1830	8.3	1897	8.6
8,125	1661	7.5	1738	7.9	1811	8.2	1880	8.5	1947	8.8
8,750	1718	7.8	1792	8.1	1863	8.4	1932	8.8	1997	9.1
9,375	1778	8.1	1849	8.4	1918	8.7	1984	9.0	2049	9.3
10,000	1841	8.3	1908	8.7	1974	9.0	2039	9.3	2102	9.5
11,700	1907	8.6	1970	8.9	2033	9.2	2096	9.5	2157	9.8
11,250	1976	9.0	2036	9.2	2095	9.5	2155	9.8	—	—
11,875	2048	9.3	2104	9.6	2160	9.8	—	—	—	—
12,500	2122	9.6	2175	9.9	—	—	—	—	—	—

High Static 1177-2200 rpm

## 48GEFT17 — 15 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	1092	0.79	1205	1.06	1311	1.36	1409	1.69	1500	2.04
4875	1164	0.95	1270	1.23	1370	1.55	1464	1.89	1552	2.25
5250	1237	1.14	1337	1.43	1432	1.76	1522	2.11	1607	2.49
5625	1311	1.34	1405	1.65	1496	2.00	1582	2.36	1664	2.75
6000	1386	1.58	1475	1.90	1561	2.25	1643	2.62	1722	3.02
6375	1461	1.83	1546	2.16	1627	2.52	1706	2.91	1782	3.31
6750	1538	2.10	1618	2.45	1696	2.82	1771	3.21	1844	3.62
7125	1614	2.39	1691	2.75	1765	3.13	1837	3.53	1907	3.94
7500	1691	2.71	1764	3.07	1835	3.46	1904	3.86	1972	4.29

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	1585	2.40	1667	2.79	1744	3.20	1819	3.88	1892	4.37
4875	1635	2.63	1714	3.03	1790	3.45	1862	3.88	1932	4.65
5250	1688	2.88	1764	3.29	1837	3.72	1908	4.17	1976	4.98
5625	1742	3.15	1816	3.57	1888	4.01	1956	4.46	2023	5.34
6000	1798	3.44	1870	3.87	1940	4.32	2007	4.78	2072	5.74
6375	1855	3.74	1926	4.18	1994	4.64	2059	5.11	2122	6.16
6750	1915	4.06	1983	4.50	2049	4.97	2113	5.45	2175	6.64
7125	1976	4.39	2042	4.84	2106	5.31	2168	5.80	—	—
7500	2038	4.74	2102	5.20	2164	5.67	—	—	—	—

High Static 1092-2200 rpm, 10.0 maximum bhp (5.0 maximum bhp per fan motor)

## 48GEFT17 — High Static — 15 ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
4500	1092	4.9	1205	5.4	1311	5.9	1409	6.3	1500	6.8
4875	1164	5.2	1270	5.7	1370	6.2	1464	6.6	1552	7.0
5250	1237	5.6	1337	6.0	1432	6.5	1522	6.9	1607	7.3
5625	1311	5.9	1405	6.3	1496	6.8	1582	7.1	1664	7.5
6000	1386	6.2	1475	6.7	1561	7.1	1643	7.4	1722	7.8
6375	1461	6.6	1546	7.0	1627	7.4	1706	7.7	1782	8.1
6750	1538	6.9	1618	7.3	1696	7.7	1771	8.0	1844	8.4
7125	1614	7.3	1691	7.7	1765	8.0	1837	8.3	1907	8.6
7500	1691	7.7	1764	8.0	1835	8.3	1904	8.6	1972	8.9

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
4500	1585	7.2	1667	7.5	1744	7.9	1819	8.2	1892	8.6
4875	1635	7.4	1714	7.8	1790	8.1	1862	8.4	1932	8.8
5250	1688	7.6	1764	8.0	1837	8.3	1908	8.7	1976	9.0
5625	1742	7.9	1816	8.2	1888	8.6	1956	8.9	2023	9.2
6000	1798	8.1	1870	8.5	1940	8.8	2007	9.1	2072	9.4
6375	1855	8.4	1926	8.7	1994	9.0	2059	9.3	2122	9.6
6750	1915	8.7	1983	9.0	2049	9.3	2113	9.6	2175	9.9
7125	1976	9.0	2042	9.3	2106	9.6	2168	9.9	—	—
7500	2038	9.3	2102	9.5	2164	9.8	—	—	—	—

High Static 1092-2200 rpm

## 48GEFT20 — 17.5 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
5250	1237	1.14	1337	1.43	1432	1.76	1522	2.11	1607	2.49
5690	1324	1.38	1417	1.69	1507	2.04	1592	2.40	1674	2.79
6125	1411	1.66	1499	1.99	1583	2.34	1664	2.72	1742	3.12
6565	1500	1.96	1582	2.30	1662	2.67	1739	3.06	1813	3.47
7000	1589	2.29	1666	2.64	1742	3.02	1815	3.42	1886	3.84
7440	1679	2.66	1752	3.02	1824	3.41	1893	3.81	1961	4.23
7875	1768	3.04	1838	3.42	1906	3.81	1973	4.23	2038	4.66
8135	1859	3.46	1926	3.85	1991	4.25	2054	4.67	2116	5.11
8750	1950	3.91	2013	4.30	2075	4.71	2136	5.14	2196	5.59

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
5250	1688	2.88	1764	3.29	1837	3.72	1908	4.17	1976	4.63
5690	1751	3.20	1826	3.63	1897	4.07	1965	4.52	2031	4.99
6125	1817	3.54	1889	3.97	1958	4.43	2024	4.89	2088	5.37
6565	1885	3.89	1955	4.34	2022	4.81	2086	5.28	2149	5.77
7000	1955	4.27	2022	4.73	2087	5.20	2150	5.68	—	—
7440	2028	4.68	2092	5.14	2155	5.62	—	—	—	—
7875	2101	5.10	2163	5.57	—	—	—	—	—	—
8135	2177	5.56	—	—	—	—	—	—	—	—
8750	—	—	—	—	—	—	—	—	—	—

High Static 1237-2200 rpm, 10.0 maximum bhp (5.0 maximum bhp per fan motor)

## 48GEFT20 — High Static — 17.5 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
5250	1237	5.6	1337	6.0	1432	6.5	1522	6.9	1607	7.3
5690	1324	6.0	1417	6.4	1507	6.8	1592	7.2	1674	7.6
6125	1411	6.4	1499	6.8	1583	7.2	1664	7.5	1742	7.9
6565	1500	6.8	1582	7.1	1662	7.5	1739	7.9	1813	8.2
7000	1589	7.2	1666	7.5	1742	7.9	1815	8.2	1886	8.6
7440	1679	7.6	1752	7.9	1824	8.3	1893	8.6	1961	8.9
7875	1768	8.0	1838	8.3	1906	8.6	1973	9.0	2038	9.3
8135	1859	8.4	1926	8.7	1991	9.0	2054	9.3	2116	9.6
8750	1950	8.8	2013	9.1	2075	9.4	2136	9.7	2196	10.0

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
5250	1688	7.6	1764	8.0	1837	8.3	1908	8.7	1976	9.0
5690	1751	7.9	1826	8.3	1897	8.6	1965	8.9	2031	9.2
6125	1817	8.2	1889	8.6	1958	8.9	2024	9.2	2088	9.5
6565	1885	8.5	1955	8.9	2022	9.2	2086	9.5	2149	9.8
7000	1955	8.9	2022	9.2	2087	9.5	2150	9.8	—	—
7440	2028	9.2	2092	9.5	2155	9.8	—	—	—	—
7875	2101	9.5	2163	9.8	—	—	—	—	—	—
8135	2177	9.9	—	—	—	—	—	—	—	—
8750	—	—	—	—	—	—	—	—	—	—

High Static 1237-2200 rpm

## 48GEFT24 — 20 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,000	1326	1.38	1417	1.68	1505	2.01	1589	2.37	1670	2.75
6,500	1421	1.67	1506	1.99	1589	2.34	1668	2.70	1745	3.09
7,000	1518	2.00	1597	2.33	1674	2.68	1750	3.06	1823	3.46
7,500	1615	2.36	1689	2.70	1762	3.06	1833	3.45	1903	3.86
8,000	1713	2.75	1783	3.10	1852	3.48	1919	3.87	1985	4.28
8,500	1811	3.17	1877	3.53	1943	3.92	2007	4.32	2069	4.73
9,000	1910	3.63	1973	4.00	2035	4.39	2095	4.79	2155	5.21
9,500	2010	4.12	2069	4.50	2128	4.89	2186	5.30	—	—
10,000	2109	4.64	2166	5.03	—	—	—	—	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,000	1748	3.16	1823	3.58	1894	4.02	1963	4.47	2030	4.94
6,500	1819	3.50	1891	3.94	1960	4.38	2027	4.85	2092	5.33
7,000	1893	3.88	1962	4.32	2029	4.78	2093	5.24	2156	5.73
7,500	1970	4.28	2036	4.73	2100	5.19	2162	5.66	—	—
8,000	2049	4.71	2112	5.16	2174	5.62	—	—	—	—
8,500	2131	5.17	2191	5.62	—	—	—	—	—	—
9,000	—	—	—	—	—	—	—	—	—	—
9,500	—	—	—	—	—	—	—	—	—	—
10,000	—	—	—	—	—	—	—	—	—	—

High Static 1326-2200 rpm, 10.0 maximum bhp (5.0 maximum bhp per fan motor)

## 48GEFT24 — High Static — 20 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
6,000	1326	6.0	1417	6.4	1505	6.8	1589	7.2	1670	7.6
6,500	1421	6.4	1506	6.8	1589	7.2	1668	7.5	1745	7.9
7,000	1518	6.9	1597	7.2	1674	7.6	1750	7.9	1823	8.3
7,500	1615	7.3	1689	7.6	1762	8.0	1833	8.3	1903	8.6
8,000	1713	7.8	1783	8.1	1852	8.4	1919	8.7	1985	9.0
8,500	1811	8.2	1877	8.5	1943	8.8	2007	9.1	2069	9.4
9,000	1910	8.7	1973	9.0	2035	9.2	2095	9.5	2155	9.8
9,500	2010	9.1	2069	9.4	2128	9.7	2186	9.9	—	—
10,000	2109	9.6	2166	9.8	—	—	—	—	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
6,000	1748	7.9	1823	8.3	1894	8.6	1963	8.9	2030	9.2
6,500	1819	8.2	1891	8.6	1960	8.9	2027	9.2	2092	9.5
7,000	1893	8.6	1962	8.9	2029	9.2	2093	9.5	2156	9.8
7,500	1970	8.9	2036	9.2	2100	9.5	2162	9.8	—	—
8,000	2049	9.3	2112	9.6	2174	9.9	—	—	—	—
8,500	2131	9.7	2191	10.0	—	—	—	—	—	—
9,000	—	—	—	—	—	—	—	—	—	—
9,500	—	—	—	—	—	—	—	—	—	—
10,000	—	—	—	—	—	—	—	—	—	—

High Static 1326-2200 rpm

## 48GEFT28 — 25 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
7,500	1486	2.49	1562	2.89	1639	3.34	1714	3.82	1786	4.32
8,125	1597	3.08	1668	3.51	1739	3.98	1809	4.48	1877	5.00
8,750	1709	3.75	1775	4.20	1841	4.69	1907	5.21	1971	5.75
9,375	1822	4.50	1884	4.97	1945	5.47	2007	6.01	2067	6.56
10,000	1936	5.31	1994	5.81	2051	6.32	2109	6.87	2166	7.44
10,625	2050	6.19	2104	6.69	2159	7.23	—	—	—	—
11,250	2164	7.09	—	—	—	—	—	—	—	—
11,875	—	—	—	—	—	—	—	—	—	—
12,500	—	—	—	—	—	—	—	—	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
7,500	1856	4.85	1923	5.39	1988	5.96	2050	6.53	2110	7.12
8,125	1944	5.55	2008	6.12	2071	6.71	2131	7.32	2189	7.93
8,750	2034	6.32	2096	6.92	2156	7.53	—	—	—	—
9,375	2127	7.15	2186	7.76	—	—	—	—	—	—
10,000	—	—	—	—	—	—	—	—	—	—
10,625	—	—	—	—	—	—	—	—	—	—
11,250	—	—	—	—	—	—	—	—	—	—
11,875	—	—	—	—	—	—	—	—	—	—
12,500	—	—	—	—	—	—	—	—	—	—

High Static 1486-2200 rpm, 10.0 maximum bhp (maximum bhp 5.0 per fan motor)

## 48GEFT28 — High Static — 25 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
7,500	1486	6.7	1562	7.1	1639	7.4	1714	7.8	1786	8.1
8,125	1597	7.2	1668	7.5	1739	7.9	1809	8.2	1877	8.5
8,750	1709	7.7	1775	8.0	1841	8.3	1907	8.6	1971	8.9
9,375	1822	8.3	1884	8.5	1945	8.8	2007	9.1	2067	9.4
10,000	1936	8.8	1994	9.0	2051	9.3	2109	9.6	2166	9.8
10,625	2050	9.3	2104	9.6	2159	9.8	—	—	—	—
11,250	2164	9.8	—	—	—	—	—	—	—	—
11,875	—	—	—	—	—	—	—	—	—	—
12,500	—	—	—	—	—	—	—	—	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
7,500	1856	8.4	1923	8.7	1988	9.0	2050	9.3	2110	9.6
8,125	1944	8.8	2008	9.1	2071	9.4	2131	9.7	2189	9.9
8,750	2034	9.2	2096	9.5	2156	9.8	—	—	—	—
9,375	2127	9.7	2186	9.9	—	—	—	—	—	—
10,000	—	—	—	—	—	—	—	—	—	—
10,625	—	—	—	—	—	—	—	—	—	—
11,250	—	—	—	—	—	—	—	—	—	—
11,875	—	—	—	—	—	—	—	—	—	—
12,500	—	—	—	—	—	—	—	—	—	—

High Static 1486-2200 rpm

## 50GE-T17 — 15 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	936	0.61	1065	0.90	1180	1.23	1285	1.59	1380	1.97
4875	991	0.73	1112	1.03	1224	1.37	1325	1.74	1418	2.14
5250	1048	0.86	1161	1.18	1268	1.53	1366	1.91	1457	2.32
5625	1106	1.02	1211	1.34	1314	1.71	1410	2.11	1498	2.53
6000	1166	1.19	1263	1.52	1362	1.90	1454	2.31	1540	2.75
6375	1226	1.38	1317	1.72	1410	2.11	1499	2.53	1584	2.99
6750	1287	1.59	1371	1.93	1460	2.33	1546	2.76	1628	3.23
7125	1349	1.82	1428	2.16	1511	2.56	1594	3.01	1674	3.48
7500	1412	2.07	1485	2.40	1563	2.80	1643	3.26	1721	3.74

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	1470	2.38	1554	2.81	1634	3.27	1710	3.74	1782	4.24
4875	1505	2.55	1588	3.00	1666	3.46	1741	3.95	1812	4.46
5250	1542	2.75	1623	3.21	1700	3.69	1773	4.18	1844	4.71
5625	1581	2.97	1660	3.44	1735	3.93	1807	4.44	1876	4.97
6000	1622	3.21	1699	3.69	1772	4.19	1843	4.71	1911	5.25
6375	1663	3.46	1739	3.95	1811	4.46	1880	4.99	1946	5.54
6750	1706	3.71	1780	4.22	1850	4.74	1918	5.28	1983	5.83
7125	1750	3.98	1822	4.49	1891	5.02	1958	5.57	2022	6.14
7500	1794	4.24	1866	4.77	1933	5.30	1999	5.86	—	—

Std/Med Static 936-2000 rpm, 4.8 maximum bhp (2.4 maximum bhp per fan motor)

High Static 936-2200 rpm, 6.0 maximum bhp (3.0 maximum bhp per fan motor)

## 50GE-T17 — Standard/Medium Static — 15 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
4500	936	4.5	1065	5.2	1180	5.8	1285	6.3	1380	6.8
4875	991	4.8	1112	5.4	1224	6.0	1325	6.5	1418	7.0
5250	1048	5.1	1161	5.7	1268	6.2	1366	6.7	1457	7.2
5625	1106	5.4	1211	5.9	1314	6.5	1410	7.0	1498	7.4
6000	1166	5.7	1263	6.2	1362	6.7	1454	7.2	1540	7.6
6375	1226	6.0	1317	6.5	1410	7.0	1499	7.4	1584	7.9
6750	1287	6.3	1371	6.8	1460	7.2	1546	7.7	1628	8.1
7125	1349	6.7	1428	7.1	1511	7.5	1594	7.9	1674	8.3
7500	1412	7.0	1485	7.4	1563	7.8	1643	8.2	1721	8.6

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
4500	1470	7.3	1554	7.7	1634	8.1	1710	8.5	1782	8.9
4875	1505	7.5	1588	7.9	1666	8.3	1741	8.7	1812	9.0
5250	1542	7.6	1623	8.1	1700	8.5	1773	8.8	1844	9.2
5625	1581	7.8	1660	8.3	1735	8.6	1807	9.0	1876	9.4
6000	1622	8.1	1699	8.5	1772	8.8	1843	9.2	—	—
6375	1663	8.3	1739	8.7	1811	9.0	1880	9.4	—	—
6750	1706	8.5	1780	8.9	1850	9.2	—	—	—	—
7125	1750	8.7	1822	9.1	1891	9.4	—	—	—	—
7500	1794	8.9	1866	9.3	—	—	—	—	—	—

Std/Med Static 936-2000 rpm

## 50GE-T17 — High Static — 15 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
4500	936	4.2	1065	4.8	1180	5.3	1285	5.8	1380	6.2
4875	991	4.4	1112	5.0	1224	5.5	1325	6.0	1418	6.4
5250	1048	4.7	1161	5.2	1268	5.7	1366	6.2	1457	6.6
5625	1106	5.0	1211	5.4	1314	5.9	1410	6.4	1498	6.8
6000	1166	5.2	1263	5.7	1362	6.1	1454	6.6	1540	7.0
6375	1226	5.5	1317	5.9	1410	6.4	1499	6.8	1584	7.2
6750	1287	5.8	1371	6.2	1460	6.6	1546	7.0	1628	7.4
7125	1349	6.1	1428	6.4	1511	6.8	1594	7.2	1674	7.6
7500	1412	6.4	1485	6.7	1563	7.1	1643	7.4	1721	7.8

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
4500	1470	6.6	1554	7.0	1634	7.4	1710	7.7	1782	8.1
4875	1505	6.8	1588	7.2	1666	7.5	1741	7.9	1812	8.2
5250	1542	7.0	1623	7.3	1700	7.7	1773	8.0	1844	8.4
5625	1581	7.1	1660	7.5	1735	7.9	1807	8.2	1876	8.5
6000	1622	7.3	1699	7.7	1772	8.0	1843	8.4	1911	8.7
6375	1663	7.5	1739	7.9	1811	8.2	1880	8.5	1946	8.8
6750	1706	7.7	1780	8.1	1850	8.4	1918	8.7	1983	9.0
7125	1750	7.9	1822	8.3	1891	8.6	1958	8.9	2022	9.2
7500	1794	8.1	1866	8.5	1933	8.8	1999	9.1	—	—

High Static 936-2200 rpm

## 50GE-T20 — 17.5 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
5250	1048	0.86	1162	1.18	1268	1.53	1366	1.91	1457	2.32
5690	1116	1.05	1220	1.37	1322	1.74	1417	2.14	1505	2.56
6125	1185	1.25	1281	1.58	1377	1.96	1469	2.39	1555	2.83
6565	1257	1.49	1344	1.82	1435	2.22	1523	2.65	1606	3.11
7000	1329	1.75	1409	2.08	1494	2.48	1578	2.92	1658	3.39
7440	1402	2.03	1476	2.36	1555	2.77	1635	3.21	1713	3.70
7875	1475	2.32	1543	2.66	1617	3.06	1693	3.51	1768	4.00
8315	1549	2.63	1613	2.97	1682	3.37	1753	3.81	1825	4.30
8750	1623	2.95	1682	3.28	1747	3.68	1815	4.12	1883	4.61

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
5250	1543	2.76	1623	3.21	1700	3.69	1773	4.18	1844	4.71
5690	1588	3.01	1667	3.49	1741	3.97	1813	4.48	1882	5.02
6125	1635	3.29	1712	3.78	1785	4.28	1855	4.80	1922	5.34
6565	1685	3.59	1759	4.08	1830	4.60	1899	5.14	1965	5.69
7000	1735	3.89	1808	4.40	1877	4.92	1944	5.47	2009	6.04
7440	1787	4.20	1858	4.72	1926	5.25	1992	5.81	2055	6.38
7875	1840	4.51	1909	5.03	1976	5.58	2040	6.14	—	—
8315	1895	4.82	1962	5.35	2028	5.90	—	—	—	—
8750	1951	5.12	2016	5.65	2080	6.21	—	—	—	—

Std/Med Static 1048-2000 rpm, 4.8 maximum bhp (2.4 maximum bhp per fan motor)

High Static 1048-2200 rpm, 6.0 maximum bhp (3.0 maximum bhp per fan motor)

## 50GE-T20 — Standard/Medium Static — 17.5 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
5250	1048	5.1	1162	5.7	1268	6.2	1366	6.7	1457	7.2
5690	1116	5.5	1220	6.0	1322	6.5	1417	7.0	1505	7.5
6125	1185	5.8	1281	6.3	1377	6.8	1469	7.3	1555	7.7
6565	1257	6.2	1344	6.6	1435	7.1	1523	7.5	1606	8.0
7000	1329	6.5	1409	7.0	1494	7.4	1578	7.8	1658	8.2
7440	1402	6.9	1476	7.3	1555	7.7	1635	8.1	1713	8.5
7875	1475	7.3	1543	7.6	1617	8.0	1693	8.4	1768	8.8
8315	1549	7.7	1613	8.0	1682	8.4	1753	8.7	1825	9.1
8750	1623	8.1	1682	8.4	1747	8.7	1815	9.0	1883	9.4

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
5250	1543	7.6	1623	8.1	1700	8.5	1773	8.8	1844	9.2
5690	1588	7.9	1667	8.3	1741	8.7	1813	9.0	1882	9.4
6125	1635	8.1	1712	8.5	1785	8.9	1855	9.3	—	—
6565	1685	8.4	1759	8.8	1830	9.1	—	—	—	—
7000	1735	8.6	1808	9.0	1877	9.4	—	—	—	—
7440	1787	8.9	1858	9.3	—	—	—	—	—	—
7875	1840	9.2	1909	9.5	—	—	—	—	—	—
8315	1895	9.5	—	—	—	—	—	—	—	—
8750	—	—	—	—	—	—	—	—	—	—

Std/Med Static 1048-2000 rpm

## 50GE-T20 — High Static — 17.5 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
5250	1048	4.7	1162	5.2	1268	5.7	1366	6.2	1457	6.6
5690	1116	5.0	1220	5.5	1322	5.9	1417	6.4	1505	6.8
6125	1185	5.3	1281	5.8	1377	6.2	1469	6.6	1555	7.0
6565	1257	5.6	1344	6.0	1435	6.5	1523	6.9	1606	7.3
7000	1329	6.0	1409	6.3	1494	6.7	1578	7.1	1658	7.5
7440	1402	6.3	1476	6.7	1555	7.0	1635	7.4	1713	7.8
7875	1475	6.7	1543	7.0	1617	7.3	1693	7.7	1768	8.0
8315	1549	7.0	1613	7.3	1682	7.6	1753	7.9	1825	8.3
8750	1623	7.3	1682	7.6	1747	7.9	1815	8.2	1883	8.5

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
5250	1543	7.0	1623	7.3	1700	7.7	1773	8.0	1844	8.4
5690	1588	7.2	1667	7.5	1741	7.9	1813	8.2	1882	8.5
6125	1635	7.4	1712	7.7	1785	8.1	1855	8.4	1922	8.7
6565	1685	7.6	1759	8.0	1830	8.3	1899	8.6	1965	8.9
7000	1735	7.9	1808	8.2	1877	8.5	1944	8.8	2009	9.1
7440	1787	8.1	1858	8.4	1926	8.7	1992	9.0	2055	9.3
7875	1840	8.3	1909	8.7	1976	9.0	2040	9.3	—	—
8315	1895	8.6	1962	8.9	2028	9.2	—	—	—	—
8750	1951	8.9	2016	9.2	2080	9.4	—	—	—	—

High Static 1048-2200 rpm

## 50GE-T24 — 20 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,000	1038	0.84	1148	1.14	1251	1.47	1351	1.86	1448	2.28
6,500	1103	1.01	1207	1.32	1304	1.66	1398	2.05	1490	2.48
7,000	1169	1.19	1269	1.52	1360	1.87	1448	2.26	1535	2.69
7,500	1234	1.38	1332	1.74	1418	2.09	1501	2.48	1583	2.91
8,000	1299	1.58	1395	1.95	1478	2.32	1557	2.72	1634	3.14
8,500	1364	1.78	1459	2.18	1540	2.56	1615	2.95	1689	3.37
9,000	1427	1.97	1524	2.40	1602	2.79	1674	3.18	1745	3.60
9,500	1491	2.17	1589	2.62	1665	3.02	1735	3.41	1802	3.83
10,000	1553	2.36	1653	2.84	1729	3.25	1797	3.65	1862	4.06

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,000	1539	2.74	1624	3.22	1703	3.72	1777	4.22	1847	4.74
6,500	1578	2.95	1662	3.44	1741	3.96	1816	4.49	1887	5.04
7,000	1619	3.16	1701	3.66	1779	4.19	1854	4.74	1924	5.30
7,500	1663	3.38	1742	3.88	1818	4.41	1892	4.97	1962	5.55
8,000	1711	3.60	1786	4.10	1859	4.62	1931	5.18	2000	5.76
8,500	1761	3.83	1832	4.31	1903	4.83	1972	5.37	2039	5.94
9,000	1813	4.04	1882	4.52	1949	5.02	2015	5.55	2081	6.11
9,500	1868	4.26	1933	4.72	1998	5.21	2061	5.72	2124	6.27
10,000	1925	4.49	1987	4.94	2049	5.41	2110	5.91	2170	6.43

Std/Med Static 1038-2200 rpm, 4.8 maximum bhp (2.4 maximum bhp per fan motor)

High Static 1038-2200 rpm, 10.0 maximum bhp (5.0 maximum bhp per fan motor)

## 50GE-T24 — Standard/Medium Static — 20 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
6,000	1038	5.1	1148	5.6	1251	6.1	1351	6.7	1448	7.2
6,500	1103	5.4	1207	5.9	1304	6.4	1398	6.9	1490	7.4
7,000	1169	5.7	1269	6.2	1360	6.7	1448	7.2	1535	7.6
7,500	1234	6.1	1332	6.6	1418	7.0	1501	7.4	1583	7.9
8,000	1299	6.4	1395	6.9	1478	7.3	1557	7.7	1634	8.1
8,500	1364	6.7	1459	7.2	1540	7.6	1615	8.0	1689	8.4
9,000	1427	7.1	1524	7.6	1602	8.0	1674	8.3	1745	8.7
9,500	1491	7.4	1589	7.9	1665	8.3	1735	8.6	1802	9.0
10,000	1553	7.7	1653	8.2	1729	8.6	1797	9.0	1862	9.3

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
7,500	1539	7.6	1624	8.1	1703	8.5	1777	8.9	1847	9.2
6,000	1578	7.8	1662	8.3	1741	8.7	1816	9.1	1887	9.4
6,500	1619	8.0	1701	8.5	1779	8.9	1854	9.2	—	—
7,000	1663	8.3	1742	8.7	1818	9.1	1892	9.4	—	—
7,500	1711	8.5	1786	8.9	1859	9.3	—	—	—	—
8,000	1761	8.8	1832	9.1	1903	9.5	—	—	—	—
8,500	1813	9.0	1882	9.4	1949	9.7	—	—	—	—
9,000	1868	9.3	1933	9.7	—	—	—	—	—	—
9,500	1925	9.6	1987	9.9	—	—	—	—	—	—

Std/Med Static 1038-2000 rpm

## 50GE-T24 — High Static — 20 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
6,000	1038	4.6	1148	5.1	1251	5.6	1351	6.1	1448	6.5
6,500	1103	4.9	1207	5.4	1304	5.9	1398	6.3	1490	6.7
7,000	1169	5.2	1269	5.7	1360	6.1	1448	6.5	1535	6.9
7,500	1234	5.5	1332	6.0	1418	6.4	1501	6.8	1583	7.2
8,000	1299	5.8	1395	6.3	1478	6.7	1557	7.0	1634	7.4
8,500	1364	6.1	1459	6.6	1540	7.0	1615	7.3	1689	7.6
9,000	1427	6.4	1524	6.9	1602	7.2	1674	7.6	1745	7.9
9,500	1491	6.7	1589	7.2	1665	7.5	1735	7.9	1802	8.2
10,000	1553	7.0	1653	7.5	1729	7.8	1797	8.1	1862	8.4

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
6,000	1539	6.9	1624	7.3	1703	7.7	1777	8.0	1847	8.4
6,500	1578	7.1	1662	7.5	1741	7.9	1816	8.2	1887	8.6
7,000	1619	7.3	1701	7.7	1779	8.1	1854	8.4	1924	8.7
7,500	1663	7.5	1742	7.9	1818	8.2	1892	8.6	1962	8.9
8,000	1711	7.7	1786	8.1	1859	8.4	1931	8.8	2000	9.1
8,500	1761	8.0	1832	8.3	1903	8.6	1972	8.9	2039	9.3
9,000	1813	8.2	1882	8.5	1949	8.8	2015	9.1	2081	9.5
9,500	1868	8.5	1933	8.8	1998	9.1	2061	9.4	2124	9.6
10,000	1925	8.7	1987	9.0	2049	9.3	2110	9.6	2170	9.9

High Static 1038-2200 rpm

## 50GE-T28 — 25 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
7,500	1099	1.27	1174	1.55	1256	1.90	1343	2.32	1433	2.82
8,125	1177	1.58	1246	1.87	1319	2.22	1397	2.64	1479	3.13
8,750	1256	1.92	1319	2.23	1385	2.58	1456	3.00	1530	3.48
9,375	1337	2.32	1394	2.63	1455	2.99	1519	3.40	1586	3.87
10,000	1417	2.74	1471	3.06	1526	3.42	1585	3.83	1646	4.29
10,625	1498	3.18	1548	3.51	1600	3.88	1654	4.28	1710	4.73
11,250	1579	3.65	1626	3.98	1675	4.36	1725	4.76	1777	5.20
11,875	1661	4.17	1705	4.51	1751	4.88	1798	5.29	1846	5.72
12,500	1743	4.78	1785	5.14	1828	5.52	1872	5.93	1917	6.37

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
7,500	1521	3.38	1604	3.96	1683	4.58	1757	5.21	1828	5.86
8,125	1561	3.68	1642	4.28	1720	4.92	1794	5.58	1864	6.26
8,750	1606	4.02	1683	4.63	1758	5.28	1830	5.95	1900	6.66
9,375	1655	4.40	1727	5.00	1798	5.64	1869	6.33	1937	7.05
10,000	1710	4.81	1776	5.39	1843	6.02	1910	6.70	1976	7.42
10,625	1769	5.24	1829	5.79	1891	6.40	1954	7.06	2018	7.78
11,250	1831	5.69	1887	6.23	1944	6.81	2003	7.45	2063	8.14
11,875	1896	6.20	1948	6.72	2001	7.29	2056	7.90	2111	8.56
12,500	1964	6.85	2012	7.36	2061	7.91	2112	8.51	2164	9.16

Std/Med Static 1099-2200 rpm, 6.0 maximum bhp (3.0 maximum bhp per fan motor)

High Static 1099-2200 rpm, 10.0 maximum bhp (5.0 maximum bhp per fan motor)

## 50GE-T28 — Standard/Medium Static — 25 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
7,500	1099	4.9	1174	5.3	1256	5.6	1343	6.0	1433	6.5
8,125	1177	5.3	1246	5.6	1319	5.9	1397	6.3	1479	6.7
8,750	1256	5.6	1319	5.9	1385	6.2	1456	6.6	1530	6.9
9,375	1337	6.0	1394	6.3	1455	6.6	1519	6.9	1586	7.2
10,000	1417	6.4	1471	6.6	1526	6.9	1585	7.2	1646	7.4
10,625	1498	6.8	1548	7.0	1600	7.2	1654	7.5	1710	7.7
11,250	1579	7.1	1626	7.4	1675	7.6	1725	7.8	1777	8.0
11,875	1661	7.5	1705	7.7	1751	7.9	1798	8.1	1846	8.4
12,500	1743	7.9	1785	8.1	1828	8.3	1872	8.5	1917	8.7

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
7,500	1521	6.9	1604	7.2	1683	7.6	1757	8.0	1828	8.3
8,125	1561	7.1	1642	7.4	1720	7.8	1794	8.1	1864	8.4
8,750	1606	7.3	1683	7.6	1758	8.0	1830	8.3	—	—
9,375	1655	7.5	1727	7.8	1798	8.1	1869	8.5	—	—
10,000	1710	7.7	1776	8.0	1843	8.4	—	—	—	—
10,625	1769	8.0	1829	8.3	1891	8.6	—	—	—	—
11,250	1831	8.3	1887	8.6	—	—	—	—	—	—
11,875	1896	8.6	—	—	—	—	—	—	—	—
12,500	—	—	—	—	—	—	—	—	—	—

Std/Med Static 1099-2200 rpm

## 50GE-T28 — High Static — 25 Ton Vertical Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
7,500	1099	4.9	1174	5.3	1256	5.6	1343	6.0	1433	6.5
8,125	1177	5.3	1246	5.6	1319	5.9	1397	6.3	1479	6.7
8,750	1256	5.6	1319	5.9	1385	6.2	1456	6.6	1530	6.9
9,375	1337	6.0	1394	6.3	1455	6.6	1519	6.9	1586	7.2
10,000	1417	6.4	1471	6.6	1526	6.9	1585	7.2	1646	7.4
10,625	1498	6.8	1548	7.0	1600	7.2	1654	7.5	1710	7.7
11,250	1579	7.1	1626	7.4	1675	7.6	1725	7.8	1777	8.0
11,875	1661	7.5	1705	7.7	1751	7.9	1798	8.1	1846	8.4
12,500	1743	7.9	1785	8.1	1828	8.3	1872	8.5	1917	8.7

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
7,500	1521	6.9	1604	7.2	1683	7.6	1757	8.0	1828	8.3
8,125	1561	7.1	1642	7.4	1720	7.8	1794	8.1	1864	8.4
8,750	1606	7.3	1683	7.6	1758	8.0	1830	8.3	1900	8.6
9,375	1655	7.5	1727	7.8	1798	8.1	1869	8.5	1937	8.8
10,000	1710	7.7	1776	8.0	1843	8.4	1910	8.7	1976	9.0
10,625	1769	8.0	1829	8.3	1891	8.6	1954	8.9	2018	9.2
11,250	1831	8.3	1887	8.6	1944	8.8	2003	9.1	2063	9.4
11,875	1896	8.6	1948	8.8	2001	9.1	2056	9.3	2111	9.6
12,500	1964	8.9	2012	9.1	2061	9.4	2112	9.6	2164	9.8

High Static 1099-2200 rpm

## 50GE-T17 — 15 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	1055	0.71	1171	0.97	1279	1.26	1379	1.58	1472	1.92
4875	1122	0.85	1231	1.12	1334	1.43	1430	1.76	1520	2.11
5250	1190	1.01	1293	1.30	1390	1.61	1482	1.95	1569	2.32
5625	1259	1.19	1356	1.49	1448	1.81	1536	2.16	1621	2.54
6000	1329	1.39	1420	1.69	1508	2.03	1592	2.39	1674	2.78
6375	1399	1.60	1486	1.92	1570	2.26	1650	2.63	1728	3.02
6750	1470	1.83	1553	2.16	1632	2.51	1710	2.89	1785	3.28
7125	1541	2.08	1620	2.42	1696	2.77	1770	3.15	1842	3.56
7500	1612	2.34	1688	2.69	1761	3.06	1832	3.44	1902	3.85

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	1560	2.29	1642	2.67	1721	3.29	1796	3.74	1870	4.22
4875	1605	2.49	1685	2.88	1762	3.29	1835	3.99	1906	4.47
5250	1652	2.70	1730	3.10	1805	3.53	1877	4.27	1946	4.75
5625	1701	2.94	1777	3.35	1850	3.78	1920	4.57	1988	5.07
6000	1751	3.18	1826	3.60	1897	4.04	1966	4.90	2032	5.41
6375	1803	3.43	1876	3.86	1945	4.31	2013	5.26	2078	5.79
6750	1857	3.70	1927	4.13	1995	4.59	2061	5.65	2125	6.19
7125	1913	3.98	1981	4.42	2047	4.88	2111	6.07	2173	6.62
7500	1969	4.27	2035	4.72	2099	5.18	2162	6.52	—	—

High Static 1055-2200 rpm, 10.0 maximum bhp (5.0 maximum bhp per fan motor)

## 50GE-T17 — High Static — 15 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
4500	1055	4.7	1171	5.3	1279	5.7	1379	6.2	1472	6.6
4875	1122	5.0	1231	5.5	1334	6.0	1430	6.4	1520	6.9
5250	1190	5.3	1293	5.8	1390	6.3	1482	6.7	1569	7.1
5625	1259	5.7	1356	6.1	1448	6.5	1536	6.9	1621	7.3
6000	1329	6.0	1420	6.4	1508	6.8	1592	7.2	1674	7.6
6375	1399	6.3	1486	6.7	1570	7.1	1650	7.5	1728	7.8
6750	1470	6.6	1553	7.0	1632	7.4	1710	7.7	1785	8.1
7125	1541	7.0	1620	7.3	1696	7.7	1770	8.0	1842	8.3
7500	1612	7.3	1688	7.6	1761	8.0	1832	8.3	1902	8.6

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
4500	1560	7.0	1642	7.4	1721	7.8	1796	8.1	1870	8.5
4875	1605	7.3	1685	7.6	1762	8.0	1835	8.3	1906	8.6
5250	1652	7.5	1730	7.8	1805	8.2	1877	8.5	1946	8.8
5625	1701	7.7	1777	8.0	1850	8.4	1920	8.7	1988	9.0
6000	1751	7.9	1826	8.3	1897	8.6	1966	8.9	2032	9.2
6375	1803	8.2	1876	8.5	1945	8.8	2013	9.1	2078	9.4
6750	1857	8.4	1927	8.7	1995	9.1	2061	9.4	2125	9.7
7125	1913	8.7	1981	9.0	2047	9.3	2111	9.6	2173	9.9
7500	1969	8.9	2035	9.2	2099	9.5	2162	9.8	—	—

High Static 1055-2200 rpm

## 50GE-T20 — 17.5 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
5250	1190	1.01	1293	1.30	1390	1.61	1482	1.95	1569	2.32
5690	1271	1.22	1367	1.52	1458	1.85	1546	2.20	1630	2.58
6125	1352	1.46	1442	1.77	1528	2.10	1612	2.47	1692	2.86
6565	1435	1.72	1520	2.04	1601	2.39	1680	2.76	1757	3.15
7000	1517	2.00	1597	2.33	1675	2.69	1750	3.06	1823	3.46
7440	1601	2.30	1677	2.65	1751	3.01	1822	3.39	1892	3.80
7875	1684	2.63	1757	2.98	1827	3.36	1895	3.74	1962	4.16
8315	1769	2.98	1838	3.35	1905	3.73	1971	4.13	2035	4.54
8750	1853	3.36	1920	3.73	1984	4.12	2046	4.52	2108	4.94

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
5250	1652	2.70	1730	3.10	1805	3.53	1876	3.96	1946	4.42
5690	1709	2.97	1785	3.39	1858	3.82	1928	4.27	1995	4.73
6125	1769	3.26	1842	3.69	1913	4.13	1981	4.58	2047	5.06
6565	1831	3.57	1902	4.00	1971	4.45	2037	4.91	2101	5.39
7000	1894	3.88	1963	4.33	2029	4.78	2094	5.25	2157	5.74
7440	1960	4.22	2026	4.67	2091	5.13	2154	5.61	—	—
7875	2027	4.58	2091	5.03	2154	5.50	—	—	—	—
8315	2097	4.97	2159	5.42	—	—	—	—	—	—
8750	2168	5.38	—	—	—	—	—	—	—	—

High Static 1190-2200 rpm, 10.0 maximum bhp (5.0 maximum bhp per fan motor)

## 50GE-T20 — High Static — 17.5 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
5250	1190	5.3	1293	5.8	1390	6.3	1482	6.7	1569	7.1
5690	1271	5.7	1367	6.2	1458	6.6	1546	7.0	1630	7.4
6125	1352	6.1	1442	6.5	1528	6.9	1612	7.3	1692	7.7
6565	1435	6.5	1520	6.9	1601	7.2	1680	7.6	1757	8.0
7000	1517	6.8	1597	7.2	1675	7.6	1750	7.9	1823	8.3
7440	1601	7.2	1677	7.6	1751	7.9	1822	8.3	1892	8.6
7875	1684	7.6	1757	8.0	1827	8.3	1895	8.6	1962	8.9
8315	1769	8.0	1838	8.3	1905	8.6	1971	8.9	2035	9.2
8750	1853	8.4	1920	8.7	1984	9.0	2046	9.3	2108	9.6

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
5250	1652	7.5	1730	7.8	1805	8.2	1876	8.5	1946	8.8
5690	1709	7.7	1785	8.1	1858	8.4	1928	8.7	1995	9.1
6125	1769	8.0	1842	8.3	1913	8.7	1981	9.0	2047	9.3
6565	1831	8.3	1902	8.6	1971	8.9	2037	9.2	2101	9.5
7000	1894	8.6	1963	8.9	2029	9.2	2094	9.5	2157	9.8
7440	1960	8.9	2026	9.2	2091	9.5	2154	9.8	—	—
7875	2027	9.2	2091	9.5	2154	9.8	—	—	—	—
8315	2097	9.5	2159	9.8	—	—	—	—	—	—
8750	2168	9.9	—	—	—	—	—	—	—	—

High Static 1190-2200 rpm

## 50GE-T24 — 20 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,000	1267	1.20	1361	1.49	1451	1.81	1538	2.15	1621	2.52
6,500	1356	1.45	1443	1.75	1527	2.07	1609	2.43	1688	2.80
7,000	1446	1.73	1527	2.04	1606	2.37	1683	2.73	1758	3.11
7,500	1537	2.03	1612	2.35	1687	2.69	1760	3.05	1831	3.44
8,000	1628	2.36	1699	2.68	1769	3.03	1838	3.40	1906	3.79
8,500	1719	2.71	1786	3.04	1853	3.40	1918	3.77	1983	4.16
9,000	1811	3.09	1875	3.43	1938	3.79	2000	4.17	2061	4.56
9,500	1904	3.50	1964	3.85	2024	4.21	2083	4.59	2142	4.99
10,000	1997	3.94	2054	4.29	2111	4.66	2167	5.04	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6,000	1700	2.90	1777	3.32	1850	3.74	1921	4.19	1989	4.65
6,500	1764	3.20	1838	3.62	1909	4.05	1977	4.50	2043	4.97
7,000	1831	3.51	1901	3.93	1970	4.37	2036	4.83	2100	5.30
7,500	1900	3.84	1968	4.27	2033	4.71	2098	5.17	2160	5.64
8,000	1972	4.20	2037	4.63	2100	5.07	2162	5.53	—	—
8,500	2046	4.57	2108	5.00	2169	5.45	—	—	—	—
9,000	2122	4.97	2181	5.40	—	—	—	—	—	—
9,500	2199	5.40	—	—	—	—	—	—	—	—
10,000	—	—	—	—	—	—	—	—	—	—

High Static 1267-2200 rpm, 10.0 maximum bhp (5.0 maximum bhp per fan motor)

## 50GE-T24 — High Static — 20 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
6,000	1267	5.7	1361	6.1	1451	6.5	1538	6.9	1621	7.3
6,500	1356	6.1	1443	6.5	1527	6.9	1609	7.3	1688	7.6
7,000	1446	6.5	1527	6.9	1606	7.3	1683	7.6	1758	8.0
7,500	1537	6.9	1612	7.3	1687	7.6	1760	8.0	1831	8.3
8,000	1628	7.4	1699	7.7	1769	8.0	1838	8.3	1906	8.6
8,500	1719	7.8	1786	8.1	1853	8.4	1918	8.7	1983	9.0
9,000	1811	8.2	1875	8.5	1938	8.8	2000	9.1	2061	9.4
9,500	1904	8.6	1964	8.9	2024	9.2	2083	9.5	2142	9.7
10,000	1997	9.1	2054	9.3	2111	9.6	2167	9.8	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
6,000	1700	7.7	1777	8.0	1850	8.4	1921	8.7	1989	9.0
6,500	1764	8.0	1838	8.3	1909	8.7	1977	9.0	2043	9.3
7,000	1831	8.3	1901	8.6	1970	8.9	2036	9.2	2100	9.5
7,500	1900	8.6	1968	8.9	2033	9.2	2098	9.5	2160	9.8
8,000	1972	8.9	2037	9.2	2100	9.5	2162	9.8	—	—
8,500	2046	9.3	2108	9.6	2169	9.9	—	—	—	—
9,000	2122	9.6	2181	9.9	—	—	—	—	—	—
9,500	2199	10.0	—	—	—	—	—	—	—	—
10,000	—	—	—	—	—	—	—	—	—	—

High Static 1267-2200 rpm

## 50GE-T28 — 25 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
7,500	1406	2.11	1483	2.47	1559	2.87	1636	3.32	1711	3.80
8,125	1509	2.60	1580	2.98	1651	3.40	1722	3.86	1792	4.35
8,750	1614	3.16	1679	3.56	1744	3.98	1810	4.45	1876	4.96
9,375	1719	3.78	1779	4.19	1840	4.63	1902	5.11	1963	5.62
10,000	1824	4.44	1880	4.87	1938	5.33	1995	5.81	2053	6.34
10,625	1930	5.16	1983	5.60	2036	6.06	2091	6.56	2145	7.09
11,250	2036	5.91	2086	6.35	2137	6.83	2187	7.32	—	—
11,875	2143	6.67	2190	7.12	—	—	—	—	—	—
12,500	—	—	—	—	—	—	—	—	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
7,500	1783	4.30	1853	4.82	1921	5.37	1986	5.94	2048	6.51
8,125	1861	4.87	1928	5.42	1993	5.98	2055	6.56	2116	7.16
8,750	1941	5.49	2005	6.05	2067	6.63	2128	7.24	2187	7.86
9,375	2024	6.16	2085	6.74	2144	7.33	—	—	—	—
10,000	2111	6.89	2168	7.46	—	—	—	—	—	—
10,625	2199	7.63	—	—	—	—	—	—	—	—
11,250	—	—	—	—	—	—	—	—	—	—
11,875	—	—	—	—	—	—	—	—	—	—
12,500	—	—	—	—	—	—	—	—	—	—

High Static 1406-2200 rpm, 10.0 maximum bhp (5.0 maximum bhp per fan motor)

## 50GE-T28 — High Static — 25 Ton Horizontal Supply (rpm - vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
7,500	1406	6.3	1483	6.7	1559	7.0	1636	7.4	1711	7.7
8,125	1509	6.8	1580	7.1	1651	7.5	1722	7.8	1792	8.1
8,750	1614	7.3	1679	7.6	1744	7.9	1810	8.2	1876	8.5
9,375	1719	7.8	1779	8.1	1840	8.3	1902	8.6	1963	8.9
10,000	1824	8.3	1880	8.5	1938	8.8	1995	9.1	2053	9.3
10,625	1930	8.8	1983	9.0	2036	9.2	2091	9.5	2145	9.7
11,250	2036	9.2	2086	9.5	2137	9.7	2187	9.9	—	—
11,875	2143	9.7	2190	10.0	—	—	—	—	—	—
12,500	—	—	—	—	—	—	—	—	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc	rpm	vdc
7,500	1783	8.1	1853	8.4	1921	8.7	1986	9.0	2048	9.3
8,125	1861	8.4	1928	8.7	1993	9.0	2055	9.3	2116	9.6
8,750	1941	8.8	2005	9.1	2067	9.4	2128	9.7	2187	9.9
9,375	2024	9.2	2085	9.5	2144	9.7	—	—	—	—
10,000	2111	9.6	2168	9.9	—	—	—	—	—	—
10,625	2199	10.0	—	—	—	—	—	—	—	—
11,250	—	—	—	—	—	—	—	—	—	—
11,875	—	—	—	—	—	—	—	—	—	—
12,500	—	—	—	—	—	—	—	—	—	—

High Static 1406-2200 rpm

## Legend and Notes

Applicable for Electrical Data Tables on pages 95 to 119

### LEGEND


<b>BRKR</b>	—	Circuit Breaker
<b>C.O.</b>	—	Convenience Outlet
<b>FLA</b>	—	Full Load Amps
<b>IFM</b>	—	Indoor Fan Motor
<b>LRA</b>	—	Locked Rotor Amps
<b>MCA</b>	—	Minimum Circuit Amps
<b>P.E.</b>	—	Power Exhaust
<b>PWRD C.O.</b>	—	Powered Convenience Outlet
<b>RLA</b>	—	Rated Load Amps
<b>SCCR</b>	—	Short Circuit Current Rating
<b>UNPWR C.O.</b>	—	Unpowered Convenience Outlet

### NOTES:

1. In compliance with NEC requirements for multi-motor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be fuse or HACR breaker. Canadian units may be fuse or circuit breaker.
2. For 208/230 v units, where one value is show it is the same for either 208 or 230 volts.
3. **Unbalanced 3-Phase Supply Voltage:** Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percentage of voltage imbalance.

$$\% \text{ Voltage Imbalance} = 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

Example: Supply voltage is 230-3-60



AB = 224-v  
BC = 231-v  
AC = 226-v

$$\text{Average Voltage} = \frac{(224 + 231 + 226)}{3} = \frac{681}{3} = 227$$

Determine maximum deviation from average voltage.

(AB) 227-224 = 3-v

(BC) 231-227 = 4-v

(AC) 227-226 = 1-v

Maximum deviation is 4-v.

Determine percent of voltage imbalance.

$$\% \text{ Voltage Imbalance} = 100 \times \frac{4}{227} = 1.78\%$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

**IMPORTANT:** If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

## 48/50GE\*\*17-28 Cooling Electrical Data

48/50GE UNIT SIZE	V-Ph-Hz	UNIT VOLTAGE		STD SCCR kA	HIGH SCCR kA <sup>a</sup>	COMP 1		COMP 2		OFM (EA)		IFM			COMBUSTION FAN MOTOR (48 SERIES ONLY)	POWER EXHAUST	
		Range				RLA	LRA	RLA	LRA	WATTS	FLA	Type	Effcy at Full Load	FLA	FLA	Motor Qty	FLA (Each motor)
		Min	Max														
17 Vertical	208-3-60	187	253	5	60	31.9	208	23.6	157	360	2.6	STD/MED HIGH	90.0% 90.0%	6.4 7.5	0.52	2	5.9
	230-3-60	187	253	5	60	31.9	208	23.6	157	360	2.6	STD/MED HIGH	90.0% 90.0%	6.4 7.5	0.52	2	5.9
	460-3-60	414	506	5	65	13.9	100	10.1	75	360	1.4	STD/MED HIGH	90.0% 90.0%	3.0 3.5	0.3	2	3.1
	575-3-60	518	633	5	—	10.0	78	8.6	48	360	2.6	STD/MED HIGH	90.0% 90.0%	2.5 3.0	0.24	2	2.4
20 Vertical	208-3-60	187	253	5	60	31.8	255	27.2	200	360	2.6	STD/MED HIGH	90.0% 90.0%	6.4 7.5	0.52	2	5.9
	230-3-60	187	253	5	60	31.8	255	27.2	200	360	2.6	STD/MED HIGH	90.0% 90.0%	6.4 7.5	0.52	2	5.9
	460-3-60	414	506	5	65	15.0	123	13.2	103	360	1.4	STD/MED HIGH	90.0% 90.0%	3.0 3.5	0.3	2	3.1
	575-3-60	518	633	5	—	11.9	94	10.4	78	360	2.6	STD/MED HIGH	90.0% 90.0%	2.5 3.0	0.24	2	2.4
24 Vertical	208-3-60	187	253	5	60	37.1	255	31.8	255	360	2.6	STD/MED HIGH	90.0% 90.0%	6.4 12.6	0.52	2	5.9
	230-3-60	187	253	5	60	37.1	255	31.8	255	360	2.6	STD/MED HIGH	90.0% 90.0%	6.4 12.6	0.52	2	5.9
	460-3-60	414	506	5	65	17.1	140	15	123	360	1.4	STD/MED HIGH	90.0% 90.0%	3.0 5.6	0.3	2	3.1
	575-3-60	518	633	5	—	14.4	108	11.9	94	360	2.6	STD/MED HIGH	90.0% 90.0%	2.5 4.6	0.24	2	2.4
28 Vertical	208-3-60	187	253	5	60	51.3	300	37.1	255	360	2.6	STD/MED HIGH	90.0% 90.0%	7.5 12.6	0.52	2	5.9
	230-3-60	187	253	5	60	51.3	300	37.1	255	360	2.6	STD/MED HIGH	90.0% 90.0%	7.5 12.6	0.52	2	5.9
	460-3-60	414	506	5	65	22.4	150	17.1	140	360	1.4	STD/MED HIGH	90.0% 90.0%	3.5 5.6	0.3	2	3.1
	575-3-60	518	633	5	—	19.9	109	14.4	108	360	2.6	STD/MED HIGH	90.0% 90.0%	3.0 4.6	0.24	2	2.4
17 Horizontal	208-3-60	187	253	5	60	31.9	208	23.6	157	360	2.6	HIGH	90.0%	12.6	0.52	2	5.9
	230-3-60	187	253	5	60	31.9	208	23.6	157	360	2.6	HIGH	90.0%	12.6	0.52	2	5.9
	460-3-60	414	506	5	65	13.9	100	10.1	75	360	1.4	HIGH	90.0%	5.6	0.3	2	3.1
	575-3-60	518	633	5	—	10	78	8.6	48	360	2.6	HIGH	90.0%	4.6	0.24	2	2.4
20 Horizontal	208-3-60	187	253	5	60	31.8	255	27.2	200	360	2.6	HIGH	90.0%	12.6	0.52	2	5.9
	230-3-60	187	253	5	60	31.8	255	27.2	200	360	2.6	HIGH	90.0%	12.6	0.52	2	5.9
	460-3-60	414	506	5	65	15	123	13.2	103	360	1.4	HIGH	90.0%	5.6	0.3	2	3.1
	575-3-60	518	633	5	—	11.9	94	10.4	78	360	2.6	HIGH	90.0%	4.6	0.24	2	2.4
24 Horizontal	208-3-60	187	253	5	60	37.1	255	31.8	255	360	2.6	HIGH	90.0%	12.6	0.52	2	5.9
	230-3-60	187	253	5	60	37.1	255	31.8	255	360	2.6	HIGH	90.0%	12.6	0.52	2	5.9
	460-3-60	414	506	5	65	17.1	140	15	123	360	1.4	HIGH	90.0%	5.6	0.3	2	3.1
	575-3-60	518	633	5	—	14.4	108	11.9	94	360	2.6	HIGH	90.0%	4.6	0.24	2	2.4
28 Horizontal	208-3-60	187	253	5	60	51.3	300	37.1	255	360	2.6	HIGH	90.0%	12.6	0.52	2	5.9
	230-3-60	187	253	5	60	51.3	300	37.1	255	360	2.6	HIGH	90.0%	12.6	0.52	2	5.9
	460-3-60	414	506	5	65	22.4	150	17.1	140	360	1.4	HIGH	90.0%	5.6	0.3	2	3.1
	575-3-60	518	633	5	—	19.9	109	14.4	108	360	2.6	HIGH	90.0%	4.6	0.24	2	2.4

NOTE(S):

- a. High SCCR (Short Circuit Current Rating) is not available on the following: units with Humidi-MiZer system, Phase loss monitor, Non-fused disconnect, Powered convenience outlet, and 575V models.

## 48GE\*\*17-28 Unit Wire/Fuse Sizing Electrical Data

48GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	HIGH SCCR kA <sup>a</sup>	NO CONVENIENCE OUTLET OR UNPOWERED CONVENIENCE OUTLET							
					No Power Exhaust				With Power Exhaust (powered from unit)			
					MCA	Fuse or HACR Breaker	Disconnect Size		MCA	Fuse or HACR Breaker	Disconnect Size	
							FLA	LRA			FLA	LRA
48GE**17 Vertical	208/230-3-60	STD/MED	5	60	84	100	88	392	96	125	101	412
		HIGH			86	100	90	396	98	125	104	416
	460-3-60	STD/MED	5	65	38	50	39	186	44	50	46	198
		HIGH			39	50	40	188	45	50	48	200
	575-3-60	STD/MED	5	—	34	40	36	143	39	45	42	151
		HIGH			35	40	37	143	40	45	43	151
48GE**20 Vertical	208/230-3-60	STD/MED	5	60	90	100	95	485	102	125	108	505
		HIGH			92	110	97	489	104	125	111	509
	460-3-60	STD/MED	5	65	44	50	46	238	50	60	53	250
		HIGH			45	50	47	240	51	60	54	252
	575-3-60	STD/MED	5	—	41	50	43	192	46	50	49	200
		HIGH			42	50	45	192	46	50	50	200
48GE**24 Vertical	208/230-3-60	STD/MED	5	60	101	125	106	540	113	150	119	560
		HIGH			114	150	120	558	126	150	134	578
	460-3-60	STD/MED	5	65	48	60	50	275	54	60	57	287
		HIGH			53	60	56	283	59	70	63	295
	575-3-60	STD/MED	5	—	45	50	48	222	50	60	53	230
		HIGH			50	60	53	226	54	60	58	234
48GE**28 Vertical	208/230-3-60	STD/MED	5	60	132	175	137	595	144	175	150	615
		HIGH			142	175	149	609	154	200	162	629
	460-3-60	STD/MED	5	65	60	80	63	306	67	80	70	318
		HIGH			65	80	68	312	71	90	75	324
	575-3-60	STD/MED	5	—	61	80	64	243	66	80	70	251
		HIGH			64	80	68	247	69	80	73	255
48GE**17 Horizontal	208/230-3-60	HIGH	5	60	96	125	102	410	108	125	115	430
	460-3-60	HIGH	5	65	43	50	45	194	49	60	52	206
	575-3-60	HIGH	5	—	38	45	41	147	43	50	46	155
48GE**20 Horizontal	208/230-3-60	HIGH	5	60	103	125	109	503	114	125	122	523
	460-3-60	HIGH	5	65	49	60	52	246	55	60	59	258
	575-3-60	HIGH	5	—	45	50	48	196	50	60	54	204
48GE**24 Horizontal	208/230-3-60	HIGH	5	60	114	150	120	558	126	150	134	578
	460-3-60	HIGH	5	65	53	60	56	283	59	70	63	295
	575-3-60	HIGH	5	—	50	60	53	226	54	60	58	234
48GE**28 Horizontal	208/230-3-60	HIGH	5	60	142	175	149	609	154	200	162	629
	460-3-60	HIGH	5	65	65	80	68	312	71	90	75	324
	575-3-60	HIGH	5	—	64	80	68	247	69	80	73	255

NOTE(S):

a. High SCCR (Short Circuit Current Rating) is not available on the following: units with Humidi-MiZer system, Phase loss monitor, Non-fused disconnect, and 575V models.

## 48GE\*\*17-28 Unit Wire/Fuse Sizing Electrical Data (cont)

48GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	WITH POWERED CONVENIENCE OUTLET							
				No Power Exhaust				With Power Exhaust (powered from unit)			
				MCA	Fuse or HACR Breaker	Disconnect Size		MCA	Fuse or HACR Breaker	Disconnect Size	
						FLA	LRA			FLA	LRA
48GE**17 Vertical	208/230-3-60	STD/MED	5	89	100	93	397	101	125	107	417
		HIGH		91	100	96	401	103	125	109	421
	460-3-60	STD/MED	5	40	50	42	188	46	50	49	200
		HIGH		41	50	43	190	47	60	50	202
	575-3-60	STD/MED	5	36	45	38	145	40	50	44	153
		HIGH		37	45	39	145	41	50	45	153
48GE**20 Vertical	208/230-3-60	STD/MED	5	95	125	100	490	107	125	114	510
		HIGH		97	125	103	494	109	125	116	514
	460-3-60	STD/MED	5	46	60	48	240	52	60	55	252
		HIGH		47	60	49	242	53	60	57	254
	575-3-60	STD/MED	5	42	50	45	194	47	60	51	202
		HIGH		43	50	46	194	48	60	52	202
48GE**24 Vertical	208/230-3-60	STD/MED	5	106	125	111	545	118	150	125	565
		HIGH		119	150	126	563	130	150	139	583
	460-3-60	STD/MED	5	50	60	53	277	56	70	60	289
		HIGH		55	60	59	285	62	70	66	297
	575-3-60	STD/MED	5	47	60	50	224	52	60	55	232
		HIGH		51	60	55	228	56	60	60	236
48GE**28 Vertical	208/230-3-60	STD/MED	5	137	175	142	600	148	175	156	620
		HIGH		147	175	154	614	159	200	168	634
	460-3-60	STD/MED	5	63	80	66	308	69	90	73	320
		HIGH		67	80	70	314	73	90	78	326
	575-3-60	STD/MED	5	63	80	66	245	67	80	72	253
		HIGH		66	80	70	249	71	90	75	257
48GE**17 Horizontal	208/230-3-60	HIGH	5	101	125	107	415	113	125	121	435
	460-3-60	HIGH	5	45	50	48	196	51	60	55	208
	575-3-60	HIGH	5	40	45	43	149	45	50	48	157
48GE**20 Horizontal	208/230-3-60	HIGH	5	107	125	114	508	119	150	128	528
	460-3-60	HIGH	5	51	60	54	248	57	70	61	260
	575-3-60	HIGH	5	47	50	50	198	51	60	56	206
48GE**24 Horizontal	208/230-3-60	HIGH	5	119	150	126	563	130	150	139	583
	460-3-60	HIGH	5	55	60	59	285	62	70	66	297
	575-3-60	HIGH	5	51	60	55	228	56	60	60	236
48GE**28 Horizontal	208/230-3-60	HIGH	5	147	175	154	614	159	200	168	634
	460-3-60	HIGH	5	67	80	70	314	73	90	78	326
	575-3-60	HIGH	5	66	80	70	249	71	90	75	257

## 48GE\*\*17-28 Unit HACR Sizing Electrical Data

48GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	NO CONVENIENCE OUTLET OR UNPOWERED CONVENIENCE OUTLET							
				No Power Exhaust				With Power Exhaust (powered from unit)			
				MCA	HACR Breaker	Disconnect Size		MCA	HACR Breaker	Disconnect Size	
FLA	LRA	FLA	LRA								
48GE**17 Vertical	208/230-3-60	STD/MED	5	84	100	88	392	96	125	101	412
		HIGH		86	100	90	396	98	125	104	416
	460-3-60	STD/MED	5	38	50	39	186	44	50	46	198
		HIGH		39	50	40	188	45	50	48	200
	575-3-60	STD/MED	5	34	40	36	143	39	45	42	151
		HIGH		35	40	37	143	40	45	43	151
48GE**20 Vertical	208/230-3-60	STD/MED	5	90	100	95	485	102	125	108	505
		HIGH		92	110	97	489	104	125	111	509
	460-3-60	STD/MED	5	44	50	46	238	50	60	53	250
		HIGH		45	50	47	240	51	60	54	252
	575-3-60	STD/MED	5	41	50	43	192	46	50	49	200
		HIGH		42	50	45	192	46	50	50	200
48GE**24 Vertical	208/230-3-60	STD/MED	5	101	125	106	540	113	150	119	560
		HIGH		114	150	120	558	126	150	134	578
	460-3-60	STD/MED	5	48	60	50	275	54	60	57	287
		HIGH		53	60	56	283	59	70	63	295
	575-3-60	STD/MED	5	45	50	48	222	50	60	53	230
		HIGH		50	60	53	226	54	60	58	234
48GE**28 Vertical	208/230-3-60	STD/MED	5	132	175	137	595	144	175	150	615
		HIGH		142	175	149	609	154	200	162	629
	460-3-60	STD/MED	5	60	80	63	306	67	80	70	318
		HIGH		65	80	68	312	71	90	75	324
	575-3-60	STD/MED	5	61	80	64	243	66	80	70	251
		HIGH		64	80	68	247	69	80	73	255
48GE**17 Horizontal	208/230-3-60	HIGH	5	96	125	102	410	108	125	115	430
	460-3-60	HIGH	5	43	50	45	194	49	60	52	206
	575-3-60	HIGH	5	38	45	41	147	43	50	46	155
48GE**20 Horizontal	208/230-3-60	HIGH	5	103	125	109	503	114	125	122	523
	460-3-60	HIGH	5	49	60	52	246	55	60	59	258
	575-3-60	HIGH	5	45	50	48	196	50	60	54	204
48GE**24 Horizontal	208/230-3-60	HIGH	5	114	150	120	558	126	150	134	578
	460-3-60	HIGH	5	53	60	56	283	59	70	63	295
	575-3-60	HIGH	5	50	60	53	226	54	60	58	234
48GE**28 Horizontal	208/230-3-60	HIGH	5	142	175	149	609	154	200	162	629
	460-3-60	HIGH	5	65	80	68	312	71	90	75	324
	575-3-60	HIGH	5	64	80	68	247	69	80	73	255

## 48GE\*\*17-28 Unit HACR Sizing Electrical Data (cont)

48GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	WITH POWERED CONVENIENCE OUTLET							
				No Power Exhaust				With Power Exhaust (powered from unit)			
				MCA	HACR Breaker	Disconnect Size		MCA	HACR Breaker	Disconnect Size	
						FLA	LRA			FLA	LRA
48GE**17 Vertical	208/230-3-60	STD/MED	5	89	100	93	397	101	125	107	417
		HIGH		91	100	96	401	103	125	109	421
	460-3-60	STD/MED	5	40	50	42	188	46	50	49	200
		HIGH		41	50	43	190	47	60	50	202
	575-3-60	STD/MED	5	36	45	38	145	40	50	44	153
		HIGH		37	45	39	145	41	50	45	153
48GE**20 Vertical	208/230-3-60	STD/MED	5	95	125	100	490	107	125	114	510
		HIGH		97	125	103	494	109	125	116	514
	460-3-60	STD/MED	5	46	60	48	240	52	60	55	252
		HIGH		47	60	49	242	53	60	57	254
	575-3-60	STD/MED	5	42	50	45	194	47	60	51	202
		HIGH		43	50	46	194	48	60	52	202
48GE**24 Vertical	208/230-3-60	STD/MED	5	106	125	111	545	118	150	125	565
		HIGH		119	150	126	563	130	150	139	583
	460-3-60	STD/MED	5	50	60	53	277	56	70	60	289
		HIGH		55	60	59	285	62	70	66	297
	575-3-60	STD/MED	5	47	60	50	224	52	60	55	232
		HIGH		51	60	55	228	56	60	60	236
48GE**28 Vertical	208/230-3-60	STD/MED	5	137	175	142	600	148	175	156	620
		HIGH		147	175	154	614	159	200	168	634
	460-3-60	STD/MED	5	63	80	66	308	69	90	73	320
		HIGH		67	80	70	314	73	90	78	326
	575-3-60	STD/MED	5	63	80	66	245	67	80	72	253
		HIGH		66	80	70	249	71	90	75	257
48GE**17 Horizontal	208/230-3-60	HIGH	5	101	125	107	415	113	125	121	435
	460-3-60	HIGH	5	45	50	48	196	51	60	55	208
	575-3-60	HIGH	5	40	45	43	149	45	50	48	157
48GE**20 Horizontal	208/230-3-60	HIGH	5	107	125	114	508	119	150	128	528
	460-3-60	HIGH	5	51	60	54	248	57	70	61	260
	575-3-60	HIGH	5	47	50	50	198	51	60	56	206
48GE**24 Horizontal	208/230-3-60	HIGH	5	119	150	126	563	130	150	139	583
	460-3-60	HIGH	5	55	60	59	285	62	70	66	297
	575-3-60	HIGH	5	51	60	55	228	56	60	60	236
48GE**28 Horizontal	208/230-3-60	HIGH	5	147	175	154	614	159	200	168	634
	460-3-60	HIGH	5	67	80	70	314	73	90	78	326
	575-3-60	HIGH	5	66	80	70	249	71	90	75	257

## 50GE\*\*17 Unit Wire/Fuse Sizing Electrical Data

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR KA	HIGH SCCR KA <sup>a</sup>	ELECTRIC HEATER				NO CONVENIENCE OUTLET or UNPOWERED CONVENIENCE OUTLET							
					STD SCCR CRHEATER ****00	HIGH SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)			
									MCA	Fuse or HACR Breaker	Disconnect Size		MCA	Fuse or HACR Breaker	Disconnect Size	
											FLA	LRA			FLA	LRA
50GE**17 Vertical	208/230-3-60	STD/MED	5	60	—	—	—	—	84	100	88	392	96	125	101	412
					454A	454A	18.8/25.0	52.1/60.1	84/91	100/100	88/88	392/392	96/106	125/125	101/101	412/412
					455A	455A	37.6/50.0	104.2/120.3	146/136	150/150	135/153	392/392	161/151	175/175	148/167	412/412
					456A	456A	56.3/75.0	156.4/180.4	172/196	200/225	195/222	392/392	187/211	200/225	208/236	412/412
		HIGH	5	60	—	—	—	—	86	100	90	396	98	125	104	416
					454A	454A	18.8/25.0	52.1/60.1	86/94	100/100	90/90	396/396	99/109	125/125	104/104	416/416
					455A	455A	37.6/50.0	104.2/120.3	149/139	150/150	137/156	396/396	164/154	175/175	151/169	416/416
					456A	456A	56.3/75.0	156.4/180.4	175/199	200/225	197/225	396/396	190/214	200/225	211/238	416/416
	460-3-60	STD/MED	5	65	—	—	—	—	38	50	39	186	44	50	46	198
					457A	457A	25.0	30.1	45	50	42	186	53	60	49	198
					458A	458A	50.0	60.1	68	70	76	186	75	80	83	198
					459A	459A	75.0	90.2	98	100	111	186	106	110	118	198
		HIGH	5	65	—	—	—	—	39	50	40	188	45	50	48	200
					457A	457A	25.0	30.1	46	50	43	188	54	60	50	200
					458A	458A	50.0	60.1	69	80	77	188	77	80	84	200
					459A	459A	75.0	90.2	99	100	112	188	107	110	119	200
	575-3-60	STD/MED	5	—	—	—	—	—	34	40	36	143	39	45	42	151
					460A	—	24.8	23.9	36	40	36	143	42	45	42	151
					461A	—	49.6	47.7	66	70	61	143	72	80	66	151
					462A	—	74.4	71.6	78	80	88	143	84	90	94	151
		HIGH	5	—	—	—	—	—	35	40	37	143	40	45	43	151
					460A	—	24.8	23.9	37	40	37	143	43	45	43	151
					461A	—	49.6	47.7	67	70	62	143	73	80	67	151
					462A	—	74.4	71.6	79	90	89	143	85	90	95	151
50GE**17 Horizontal	208/230-3-60	HIGH	5	60	—	—	—	—	96	125	102	410	108	125	115	430
					463A	463A	18.8/25.0	52.1/60.1	97/107	125/125	102/102	410/410	111/121	125/125	115/115	430/430
					464A	464A	37.6/50.0	104.2/120.3	162/152	175/175	149/167	410/410	176/167	200/175	162/181	430/430
					465A	465A	56.3/75.0	156.4/180.4	188/212	200/225	209/236	410/410	203/227	225/250	222/250	430/430
	460-3-60	HIGH	5	65	—	—	—	—	43	50	45	194	49	60	52	206
					466A	466A	25.0	30.1	52	60	47	194	59	60	55	206
					467A	467A	50.0	60.1	74	80	82	194	82	90	89	206
					468A	468A	75.0	90.2	104	110	117	194	112	125	124	206
	575-3-60	HIGH	5	—	—	—	—	—	38	45	41	147	43	50	46	155
					469A	—	24.8	23.9	41	45	41	147	47	50	46	155
					470A	—	49.6	47.7	71	80	65	147	77	80	71	155
					471A	—	74.4	71.6	83	90	93	147	89	90	98	155

NOTE(S):

- a. High SCCR (Short Circuit Current Rating) is not available on the following: units with Humidi-MiZer system, phase loss monitor, non-fused disconnect, and 575V models.

## 50GE\*\*17 Unit Wire/Fuse Sizing Electrical Data (cont)

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			WITH POWERED CONVENIENCE OUTLET							
				STD SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)			
							MCA	Fuse or HACR Breaker	Disconnect Size		MCA	Fuse or HACR Breaker	Disconnect Size	
									FLA	LRA			FLA	LRA
50GE**17 Vertical	208/230-3-60	STD/MED	5	—	—	—	89	100	93	397	101	125	107	417
				454A	18.8/25.0	52.1/60.1	89/97	100/100	93/93	397/397	102/112	125/125	107/107	417/417
				455A	37.6/50.0	104.2/120.3	152/142	175/150	140/159	397/397	167/157	175/175	154/172	417/417
				456A	56.3/75.0	156.4/180.4	178/202	200/225	200/228	397/397	193/217	200/225	214/241	417/417
		HIGH	5	—	—	—	91	100	96	401	103	125	109	421
				454A	18.8/25.0	52.1/60.1	91/100	100/100	96/96	401/401	105/115	125/125	109/109	421/421
	455A			37.6/50.0	104.2/120.3	155/145	175/150	143/161	401/401	170/160	175/175	156/175	421/421	
	456A			56.3/75.0	156.4/180.4	181/205	200/225	203/230	401/401	196/220	200/225	216/244	421/421	
	460-3-60	STD/MED	5	—	—	—	40	50	42	188	46	50	49	200
				457A	25.0	30.1	48	50	44	188	56	60	51	200
				458A	50.0	60.1	70	80	79	188	78	80	86	200
				459A	75.0	90.2	100	110	113	188	108	110	120	200
		HIGH	5	—	—	—	41	50	43	190	47	60	50	202
				457A	25.0	30.1	49	50	45	190	57	60	52	202
	458A			50.0	60.1	72	80	80	190	79	80	87	202	
	459A			75.0	90.2	102	110	114	190	110	110	121	202	
	575-3-60	STD/MED	5	—	—	—	36	45	38	145	40	50	44	153
				460A	24.8	23.9	38	45	38	145	44	50	44	153
				461A	49.6	47.7	68	70	63	145	74	80	68	153
				462A	74.4	71.6	80	90	90	145	86	90	96	153
		HIGH	5	—	—	—	37	45	39	145	41	50	45	153
				460A	24.8	23.9	40	45	39	145	46	50	45	153
	461A			49.6	47.7	69	70	64	145	75	80	69	153	
	462A			74.4	71.6	81	90	91	145	87	90	97	153	
50GE**17 Horizontal	208/230-3-60	HIGH	5	—	—	—	101	125	107	415	113	125	121	435
				463A	18.8/25.0	52.1/60.1	103/113	125/125	107/107	415/415	117/127	125/150	121/121	435/435
				464A	37.6/50.0	104.2/120.3	168/158	175/175	154/173	415/415	182/173	200/175	168/186	435/435
				465A	56.3/75.0	156.4/180.4	194/218	200/250	214/242	415/415	209/233	225/250	228/256	435/435
	460-3-60	HIGH	5	—	—	—	45	50	48	196	51	60	55	208
				466A	25.0	30.1	54	60	50	196	62	70	57	208
				467A	50.0	60.1	77	80	85	196	85	90	92	208
				468A	75.0	90.2	107	125	119	196	115	125	126	208
	575-3-60	HIGH	5	—	—	—	40	45	43	149	45	50	48	157
				469A	24.8	23.9	44	45	43	149	50	50	48	157
				470A	49.6	47.7	73	80	67	149	79	80	73	157
				471A	74.4	71.6	85	90	95	149	91	100	100	157

## 50GE\*\*17 Unit HACR Sizing Electrical Data

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR KA	ELECTRIC HEATER			NO CONVENIENCE OUTLET or UNPOWERED CONVENIENCE OUTLET								
				STD SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)				
							MCA	HACR Breaker	Disconnect Size		MCA	HACR Breaker	Disconnect Size		
									FLA	LRA			FLA	LRA	
50GE**17 Vertical	208/230-3-60	STD/MED	5	—	—	—	84	100	88	392	96	125	101	412	
				454A	18.8/25.0	52.1/60.1	91/91	100/100	88/88	392/392	106/106	125/125	101/101	412/412	
				455A	37.6/50.0	104.2/120.3	146/146	150/150	135/153	392/392	161/161	175/175	148/167	412/412	
		HIGH	5	456A	56.3/75.0	156.4/180.4	196/196	200/225	195/222	392/392	211/211	225/225	208/236	412/412	
				—	—	—	86	100	90	396	98	125	104	416	
				454A	18.8/25.0	52.1/60.1	94/94	100/100	90/90	396/396	109/109	125/125	104/104	416/416	
	460-3-60	STD/MED	5	455A	37.6/50.0	104.2/120.3	149/149	150/150	137/156	396/396	164/164	175/175	151/169	416/416	
				456A	56.3/75.0	156.4/180.4	199/199	200/225	197/225	396/396	214/214	225/225	211/238	416/416	
				—	—	—	38	50	39	186	44	50	46	198	
		HIGH	5	457A	25.0	30.1	45	50	42	186	53	60	49	198	
				458A	50.0	60.1	68	70	76	186	75	80	83	198	
				459A	75.0	90.2	98	100	111	186	106	110	118	198	
	575-3-60	STD/MED	5	—	—	—	39	50	40	188	45	50	48	200	
				457A	25.0	30.1	46	50	43	188	54	60	50	200	
				458A	50.0	60.1	69	80	77	188	77	80	84	200	
		HIGH	5	459A	75.0	90.2	99	100	112	188	107	110	119	200	
				—	—	—	34	40	36	143	39	45	42	151	
				460A	24.8	23.9	36	40	36	143	42	45	42	151	
	50GE**17 Horizontal	208/230-3-60	HIGH	5	461A	49.6	47.7	66	70	61	143	72	80	66	151
					462A	74.4	71.6	78	80	88	143	84	90	94	151
					—	—	—	35	40	37	143	40	45	43	151
		460-3-60	HIGH	5	460A	24.8	23.9	37	40	37	143	43	45	43	151
					461A	49.6	47.7	67	70	62	143	73	80	67	151
					462A	74.4	71.6	79	90	89	143	85	90	95	151
575-3-60	HIGH	5	—	—	—	96	125	102	410	108	125	115	430		
			463A	18.8/25.0	52.1/60.1	107/107	125/125	102/102	410/410	121/121	125/125	115/115	430/430		
			464A	37.6/50.0	104.2/120.3	162/162	175/175	149/167	410/410	176/176	200/200	162/181	430/430		
	HIGH	5	465A	56.3/75.0	156.4/180.4	212/212	225/225	209/236	410/410	227/227	250/250	222/250	430/430		
			—	—	—	43	50	45	194	49	60	52	206		
			466A	25.0	30.1	52	60	47	194	59	60	55	206		
HIGH	5	467A	50.0	60.1	74	80	82	194	82	90	89	206			
		468A	75.0	90.2	104	110	117	194	112	125	124	206			
		—	—	—	38	45	41	147	43	50	46	155			
HIGH	5	469A	24.8	23.9	41	45	41	147	47	50	46	155			
		470A	49.6	47.7	71	80	65	147	77	80	71	155			
		471A	74.4	71.6	83	90	93	147	89	90	98	155			

## 50GE\*\*17 Unit HACR Sizing Electrical Data (cont)

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			WITH POWERED CONVENIENCE OUTLET							
				STD SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)			
							MCA	HACR Breaker	Disconnect Size		MCA	HACR Breaker	Disconnect Size	
									FLA	LRA			FLA	LRA
50GE**17 Vertical	208/230-3-60	STD/MED	5	—	—	—	89	100	93	397	101	125	107	417
				454A	18.8/25.0	52.1/60.1	97/97	100/100	93/93	397/397	112/112	125/125	107/107	417/417
				455A	37.6/50.0	104.2/120.3	152/152	175/175	140/159	397/397	167/167	175/175	154/172	417/417
				456A	56.3/75.0	156.4/180.4	202/202	225/225	200/228	397/397	217/217	225/225	214/241	417/417
		HIGH	5	—	—	—	91	100	96	401	103	125	109	421
				454A	18.8/25.0	52.1/60.1	100/100	100/100	96/96	401/401	115/115	125/125	109/109	421/421
	455A			37.6/50.0	104.2/120.3	155/155	175/175	143/161	401/401	170/170	175/175	156/175	421/421	
	460-3-60	STD/MED	5	—	—	—	40	50	42	188	46	50	49	200
				457A	25.0	30.1	48	50	44	188	56	60	51	200
				458A	50.0	60.1	70	80	79	188	78	80	86	200
				459A	75.0	90.2	100	110	113	188	108	110	120	200
		HIGH	5	—	—	—	41	50	43	190	47	60	50	202
				457A	25.0	30.1	49	50	45	190	57	60	52	202
				458A	50.0	60.1	72	80	80	190	79	80	87	202
				459A	75.0	90.2	102	110	114	190	110	110	121	202
			5	—	—	—	36	45	38	145	40	50	44	153
				460A	24.8	23.9	38	45	38	145	44	50	44	153
				461A	49.6	47.7	68	70	63	145	74	80	68	153
				462A	74.4	71.6	80	90	90	145	86	90	96	153
	5	—	—	—	37	45	39	145	41	50	45	153		
		460A	24.8	23.9	40	45	39	145	46	50	45	153		
		461A	49.6	47.7	69	70	64	145	75	80	69	153		
		462A	74.4	71.6	81	90	91	145	87	90	97	153		
	50GE**17 Horizontal	208/230-3-60	HIGH	5	—	—	—	101	125	107	415	113	125	121
463A					18.8/25.0	52.1/60.1	113/113	125/125	107/107	415/415	127/127	150/150	121/121	435/435
464A					37.6/50.0	104.2/120.3	168/168	175/175	154/173	415/415	182/182	200/200	168/186	435/435
465A					56.3/75.0	156.4/180.4	218/218	225/250	214/242	415/415	233/233	250/250	228/256	435/435
460-3-60		HIGH	5	—	—	—	45	50	48	196	51	60	55	208
				466A	25.0	30.1	54	60	50	196	62	70	57	208
				467A	50.0	60.1	77	80	85	196	85	90	92	208
				468A	75.0	90.2	107	125	119	196	115	125	126	208
575-3-60		HIGH	5	—	—	—	40	45	43	149	45	50	48	157
				469A	24.8	23.9	44	45	43	149	50	50	48	157
				470A	49.6	47.7	73	80	67	149	79	80	73	157
				471A	74.4	71.6	85	90	95	149	91	100	100	157

## 50GE\*\*20 Unit Wire/Fuse Sizing Electrical Data

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	HIGH SCCR kA <sup>a</sup>	ELECTRIC HEATER				NO CONVENIENCE OUTLET or UNPOWERED CONVENIENCE OUTLET							
					STD SCCR CRHEATER ****00	HIGH SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)			
									MCA	Fuse or HACR Breaker	Disconnect Size		MCA	Fuse or HACR Breaker	Disconnect Size	
											FLA	LRA			FLA	LRA
50GE**20 Vertical	208/230-3-60	STD/MED	5	60	—	—	—	—	90	100	95	485	102	125	108	505
					454A	454A	18.8/25.0	52.1/60.1	90/91	100/100	95/95	485/485	102/106	125/125	108/108	505/505
					455A	455A	37.6/50.0	104.2/120.3	146/136	150/150	135/153	485/485	161/151	175/175	148/167	505/505
					456A	456A	56.3/75.0	156.4/180.4	172/196	200/225	195/222	485/485	187/211	200/225	208/236	505/505
		HIGH	5	60	—	—	—	—	92	110	97	489	104	125	111	509
					454A	454A	18.8/25.0	52.1/60.1	92/94	110/110	97/97	489/489	104/109	125/125	111/111	509/509
					455A	455A	37.6/50.0	104.2/120.3	149/139	150/150	137/156	489/489	164/154	175/175	151/169	509/509
					456A	456A	56.3/75.0	156.4/180.4	175/199	200/225	197/225	489/489	190/214	200/225	211/238	509/509
	460-3-60	STD/MED	5	65	—	—	—	—	44	50	46	238	50	60	53	250
					457A	457A	25.0	30.1	45	50	46	238	53	60	53	250
					458A	458A	50.0	60.1	68	70	76	238	75	80	83	250
					459A	459A	75.0	90.2	98	100	111	238	106	110	118	250
		HIGH	5	65	—	—	—	—	45	50	47	240	51	60	54	252
					457A	457A	25.0	30.1	46	50	47	240	54	60	54	252
					458A	458A	50.0	60.1	69	80	77	240	77	80	84	252
					459A	459A	75.0	90.2	99	100	112	240	107	110	119	252
	575-3-60	STD/MED	5	—	—	—	—	—	41	50	43	192	46	50	49	200
					460A	—	24.8	23.9	41	50	43	192	46	50	49	200
					461A	—	49.6	47.7	66	70	61	192	72	80	66	200
					462A	—	74.4	71.6	78	80	88	192	84	90	94	200
		HIGH	5	—	—	—	—	—	42	50	45	192	46	50	50	200
					460A	—	24.8	23.9	42	50	45	192	46	50	50	200
					461A	—	49.6	47.7	67	70	62	192	73	80	67	200
					462A	—	74.4	71.6	79	90	89	192	85	90	95	200
50GE**20 Horizontal	208/230-3-60	HIGH	5	60	—	—	—	—	103	125	109	503	114	125	122	523
					463A	463A	18.8/25.0	52.1/60.1	103/107	125/125	109/109	503/503	114/121	125/125	122/122	523/523
					464A	464A	37.6/50.0	104.2/120.3	162/152	175/175	149/167	503/503	176/167	200/175	162/181	523/523
					465A	465A	56.3/75.0	156.4/180.4	188/212	200/225	209/236	503/503	203/227	225/250	222/250	523/523
	460-3-60	HIGH	5	65	—	—	—	—	49	60	52	246	55	60	59	258
					466A	466A	25.0	30.1	52	60	52	246	59	60	59	258
					467A	467A	50.0	60.1	74	80	82	246	82	90	89	258
					468A	468A	75.0	90.2	104	110	117	246	112	125	124	258
	575-3-60	HIGH	5	—	—	—	—	—	45	50	48	196	50	60	54	204
					469A	—	24.8	23.9	45	50	48	196	50	60	54	204
					470A	—	49.6	47.7	71	80	65	196	77	80	71	204
					471A	—	74.4	71.6	83	90	93	196	89	90	98	204

NOTE(S):

- a. High SCCR (Short Circuit Current Rating) is not available on the following: units with Humidi-MiZer system, phase loss monitor, non-fused disconnect, and 575V models.

## 50GE\*\*20 Unit Wire/Fuse Sizing Electrical Data (cont)

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			WITH POWERED CONVENIENCE OUTLET								
				STD SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)				
							MCA	Fuse or HACR Breaker	Disconnect Size		MCA	Fuse or HACR Breaker	Disconnect Size		
									FLA	LRA			FLA	LRA	
50GE**20 Vertical	208/230-3-60	STD/MED	5	—	—	—	95	125	100	490	107	125	114	510	
				454A	18.8/25.0	52.1/60.1	95/97	125/125	100/100	490/490	107/112	125/125	114/114	510/510	
				455A	37.6/50.0	104.2/120.3	152/142	175/150	140/159	490/490	167/157	175/175	154/172	510/510	
		HIGH	5	456A	56.3/75.0	156.4/180.4	178/202	200/225	200/228	490/490	193/217	200/225	214/241	510/510	
				—	—	—	97	125	103	494	109	125	116	514	
				454A	18.8/25.0	52.1/60.1	97/100	125/125	103/103	494/494	109/115	125/125	116/116	514/514	
	460-3-60	STD/MED	5	455A	37.6/50.0	104.2/120.3	155/145	175/150	143/161	494/494	170/160	175/175	156/175	514/514	
				456A	56.3/75.0	156.4/180.4	181/205	200/225	203/230	494/494	196/220	200/225	216/244	514/514	
				—	—	—	46	60	48	240	52	60	55	252	
		HIGH	5	457A	25.0	30.1	48	60	48	240	56	60	55	252	
				458A	50.0	60.1	70	80	79	240	78	80	86	252	
				459A	75.0	90.2	100	110	113	240	108	110	120	252	
				—	—	—	47	60	49	242	53	60	57	254	
				457A	25.0	30.1	49	60	49	242	57	60	57	254	
				458A	50.0	60.1	72	80	80	242	79	80	87	254	
		575-3-60	STD/MED	5	459A	75.0	90.2	102	110	114	242	110	110	121	254
					—	—	—	42	50	45	194	47	60	51	202
					460A	24.8	23.9	42	50	45	194	47	60	51	202
	HIGH		5	461A	49.6	47.7	68	70	63	194	74	80	68	202	
				462A	74.4	71.6	80	90	90	194	86	90	96	202	
				—	—	—	43	50	46	194	48	60	52	202	
	575-3-60	HIGH	5	460A	24.8	23.9	43	50	46	194	48	60	52	202	
				461A	49.6	47.7	69	70	64	194	75	80	69	202	
				462A	74.4	71.6	81	90	91	194	87	90	97	202	
50GE**20 Horizontal		208/230-3-60	HIGH	5	—	—	—	107	125	114	508	119	150	128	528
					463A	18.8/25.0	52.1/60.1	107/113	125/125	114/114	508/508	119/127	150/150	128/128	528/528
					464A	37.6/50.0	104.2/120.3	168/158	175/175	154/173	508/508	182/173	200/175	168/186	528/528
	465A				56.3/75.0	156.4/180.4	194/218	200/250	214/242	508/508	209/233	225/250	228/256	528/528	
	460-3-60	HIGH	5	—	—	—	51	60	54	248	57	70	61	260	
				466A	25.0	30.1	54	60	54	248	62	70	61	260	
				467A	50.0	60.1	77	80	85	248	85	90	92	260	
				468A	75.0	90.2	107	125	119	248	115	125	126	260	
	575-3-60	HIGH	5	—	—	—	47	50	50	198	51	60	56	206	
				469A	24.8	23.9	47	50	50	198	51	60	56	206	
				470A	49.6	47.7	73	80	67	198	79	80	73	206	
				471A	74.4	71.6	85	90	95	198	91	100	100	206	

## 50GE\*\*20 Unit HRCR Sizing Electrical Data

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR KA	ELECTRIC HEATER			NO CONVENIENCE OUTLET or UNPOWERED CONVENIENCE OUTLET							
				STD SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)			
							MCA	HACR Breaker	Disconnect Size		MCA	HACR Breaker	Disconnect Size	
									FLA	LRA			FLA	LRA
50GE**20 Vertical	208/230-3-60	STD/MED	5	—	—	—	90	100	95	485	102	125	108	505
				454A	18.8/25.0	52.1/60.1	91/91	100/100	95/95	485/485	106/106	125/125	108/108	505/505
				455A	37.6/50.0	104.2/120.3	146/146	150/150	135/153	485/485	161/161	175/175	148/167	505/505
				456A	56.3/75.0	156.4/180.4	196/196	200/225	195/222	485/485	211/211	225/225	208/236	505/505
		HIGH	5	—	—	—	92	110	97	489	104	125	111	509
				454A	18.8/25.0	52.1/60.1	94/94	110/110	97/97	489/489	109/109	125/125	111/111	509/509
				455A	37.6/50.0	104.2/120.3	149/149	150/150	137/156	489/489	164/164	175/175	151/169	509/509
				456A	56.3/75.0	156.4/180.4	199/199	200/225	197/225	489/489	214/214	225/225	211/238	509/509
	460-3-60	STD/MED	5	—	—	—	44	50	46	238	50	60	53	250
				457A	25.0	30.1	45	50	46	238	53	60	53	250
				458A	50.0	60.1	68	70	76	238	75	80	83	250
				459A	75.0	90.2	98	100	111	238	106	110	118	250
		HIGH	5	—	—	—	45	50	47	240	51	60	54	252
				457A	25.0	30.1	46	50	47	240	54	60	54	252
				458A	50.0	60.1	69	80	77	240	77	80	84	252
				459A	75.0	90.2	99	100	112	240	107	110	119	252
	575-3-60	STD/MED	5	—	—	—	41	50	43	192	46	50	49	200
				460A	24.8	23.9	41	50	43	192	46	50	49	200
				461A	49.6	47.7	66	70	61	192	72	80	66	200
				462A	74.4	71.6	78	80	88	192	84	90	94	200
		HIGH	5	—	—	—	42	50	45	192	46	50	50	200
				460A	24.8	23.9	42	50	45	192	46	50	50	200
				461A	49.6	47.7	67	70	62	192	73	80	67	200
				462A	74.4	71.6	79	90	89	192	85	90	95	200
50GE**20 Horizontal	208/230-3-60	HIGH	5	—	—	—	103	125	109	503	114	125	122	523
				463A	18.8/25.0	52.1/60.1	107/107	125/125	109/109	503/503	121/121	125/125	122/122	523/523
				464A	37.6/50.0	104.2/120.3	162/162	175/175	149/167	503/503	176/176	200/200	162/181	523/523
				465A	56.3/75.0	156.4/180.4	212/212	225/225	209/236	503/503	227/227	250/250	222/250	523/523
	460-3-60	HIGH	5	—	—	—	49	60	52	246	55	60	59	258
				466A	25.0	30.1	52	60	52	246	59	60	59	258
				467A	50.0	60.1	74	80	82	246	82	90	89	258
				468A	75.0	90.2	104	110	117	246	112	125	124	258
	575-3-60	HIGH	5	—	—	—	45	50	48	196	50	60	54	204
				469A	24.8	23.9	45	50	48	196	50	60	54	204
				470A	49.6	47.7	71	80	65	196	77	80	71	204
				471A	74.4	71.6	83	90	93	196	89	90	98	204

## 50GE\*\*20 Unit HACR Sizing Electrical Data (cont)

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			WITH POWERED CONVENIENCE OUTLET								
				STD SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)				
							MCA	HACR Breaker	Disconnect Size		MCA	HACR Breaker	Disconnect Size		
									FLA	LRA			FLA	LRA	
50GE**20 Vertical	208/230-3-60	STD/MED	5	—	—	—	95	125	100	490	107	125	114	510	
				454A	18.8/25.0	52.1/60.1	97/97	125/125	100/100	490/490	112/112	125/125	114/114	510/510	
				455A	37.6/50.0	104.2/120.3	152/152	175/175	140/159	490/490	167/167	175/175	154/172	510/510	
		456A	56.3/75.0	156.4/180.4	202/202	225/225	200/228	490/490	217/217	225/225	214/241	510/510			
		HIGH	5	—	—	—	97	125	103	494	109	125	116	514	
				454A	18.8/25.0	52.1/60.1	100/100	125/125	103/103	494/494	115/115	125/125	116/116	514/514	
	455A			37.6/50.0	104.2/120.3	155/155	175/175	143/161	494/494	170/170	175/175	156/175	514/514		
	460-3-60	STD/MED	5	—	—	—	46	60	48	240	52	60	55	252	
				457A	25.0	30.1	48	60	48	240	56	60	55	252	
				458A	50.0	60.1	70	80	79	240	78	80	86	252	
		HIGH	5	459A	75.0	90.2	100	110	113	240	108	110	120	252	
				—	—	—	47	60	49	242	53	60	57	254	
				457A	25.0	30.1	49	60	49	242	57	60	57	254	
		575-3-60	STD/MED	5	458A	50.0	60.1	72	80	80	242	79	80	87	254
					459A	75.0	90.2	102	110	114	242	110	110	121	254
					—	—	—	42	50	45	194	47	60	51	202
			HIGH	5	460A	24.8	23.9	42	50	45	194	47	60	51	202
					461A	49.6	47.7	68	70	63	194	74	80	68	202
					462A	74.4	71.6	80	90	90	194	86	90	96	202
	50GE**20 Horizontal	208/230-3-60	HIGH	5	—	—	—	107	125	114	508	119	150	128	528
					463A	18.8/25.0	52.1/60.1	113/113	125/125	114/114	508/508	127/127	150/150	128/128	528/528
					464A	37.6/50.0	104.2/120.3	168/168	175/175	154/173	508/508	182/182	200/200	168/186	528/528
					465A	56.3/75.0	156.4/180.4	218/218	225/250	214/242	508/508	233/233	250/250	228/256	528/528
		460-3-60	HIGH	5	—	—	—	51	60	54	248	57	70	61	260
466A					25.0	30.1	54	60	54	248	62	70	61	260	
467A					50.0	60.1	77	80	85	248	85	90	92	260	
468A					75.0	90.2	107	125	119	248	115	125	126	260	
575-3-60		HIGH	5	—	—	—	47	50	50	198	51	60	56	206	
				469A	24.8	23.9	47	50	50	198	51	60	56	206	
				470A	49.6	47.7	73	80	67	198	79	80	73	206	
				471A	74.4	71.6	85	90	95	198	91	100	100	206	

## 50GE\*\*24 Unit Wire/Fuse Sizing Electrical Data

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR KA	HIGH SCCR KA <sup>a</sup>	ELECTRIC HEATER				NO CONVENIENCE OUTLET or UNPOWERED CONVENIENCE OUTLET								
					STD SCCR CRHEATER ****00	HIGH SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)				
									MCA	Fuse or HACR Breaker	Disconnect Size		MCA	Fuse or HACR Breaker	Disconnect Size		
											FLA	LRA			FLA	LRA	
50GE**24 Vertical	208/230-3-60	STD/MED	5	60	—	—	—	—	101	125	106	540	113	150	119	560	
					454A	454A	18.8/25.0	52.1/60.1	101/101	125/125	106/106	540/540	113/113	150/150	119/119	560/560	
					455A	455A	37.6/50.0	104.2/120.3	146/136	150/150	135/153	540/540	161/151	175/175	148/167	560/560	
					456A	456A	56.3/75.0	156.4/180.4	172/196	200/225	195/222	540/540	187/211	200/225	208/236	560/560	
		HIGH	5	60	—	—	—	—	114	150	120	558	126	150	134	578	
					454A	454A	18.8/25.0	52.1/60.1	114/114	150/150	120/120	558/558	126/126	150/150	134/134	578/578	
	455A				455A	37.6/50.0	104.2/120.3	162/152	175/175	149/167	558/558	176/167	200/175	162/181	578/578		
	460-3-60	STD/MED	5	65	—	—	—	—	48	60	50	275	54	60	57	287	
					457A	457A	25.0	30.1	48	60	50	275	54	60	57	287	
					458A	458A	50.0	60.1	68	70	76	275	75	80	83	287	
					459A	459A	75.0	90.2	98	100	111	275	106	110	118	287	
		HIGH	5	65	—	—	—	—	53	60	56	283	59	70	63	295	
					457A	457A	25.0	30.1	53	60	56	283	59	70	63	295	
					458A	458A	50.0	60.1	74	80	82	283	82	90	89	295	
					459A	459A	75.0	90.2	104	110	117	283	112	125	124	295	
		575-3-60	STD/MED	5	—	—	—	—	—	45	50	48	222	50	60	53	230
						460A	—	24.8	23.9	45	50	48	222	50	60	53	230
						461A	—	49.6	47.7	66	70	61	222	72	80	66	230
						462A	—	74.4	71.6	78	80	88	222	84	90	94	230
	HIGH	5	—	—	—	—	—	50	60	53	226	54	60	58	234		
				460A	—	24.8	23.9	50	60	53	226	54	60	58	234		
				461A	—	49.6	47.7	71	80	65	226	77	80	71	234		
				462A	—	74.4	71.6	83	90	93	226	89	90	98	234		
	50GE**24 Horizontal	208/230-3-60	HIGH	5	60	—	—	—	—	114	150	120	558	126	150	134	578
463A						463A	18.8/25.0	52.1/60.1	114/114	150/150	120/120	558/558	126/126	150/150	134/134	578/578	
464A						464A	37.6/50.0	104.2/120.3	162/152	175/175	149/167	558/558	176/167	200/175	162/181	578/578	
465A						465A	56.3/75.0	156.4/180.4	188/212	200/225	209/236	558/558	203/227	225/250	222/250	578/578	
460-3-60		HIGH	5	65	—	—	—	—	53	60	56	283	59	70	63	295	
					466A	466A	25.0	30.1	53	60	56	283	59	70	63	295	
					467A	467A	50.0	60.1	74	80	82	283	82	90	89	295	
					468A	468A	75.0	90.2	104	110	117	283	112	125	124	295	
575-3-60		HIGH	5	—	—	—	—	—	50	60	53	226	54	60	58	234	
					469A	—	24.8	23.9	50	60	53	226	54	60	58	234	
					470A	—	49.6	47.7	71	80	65	226	77	80	71	234	
					471A	—	74.4	71.6	83	90	93	226	89	90	98	234	

NOTE(S):

- a. High SCCR (Short Circuit Current Rating) is not available on the following: units with Humidi-MiZer system, phase loss monitor, non-fused disconnect, and 575V models.

## 50GE\*\*24 Unit Wire/Fuse Sizing Electrical Data (cont)

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			WITH POWERED CONVENIENCE OUTLET								
				STD SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)				
							MCA	Fuse or HACR Breaker	Disconnect Size		MCA	Fuse or HACR Breaker	Disconnect Size		
									FLA	LRA			FLA	LRA	
50GE**24 Vertical	208/230-3-60	STD/MED	5	—	—	—	106	125	111	545	118	150	125	565	
				454A	18.8/25.0	52.1/60.1	106/106	125/125	111/111	545/545	118/118	150/150	125/125	565/565	
				455A	37.6/50.0	104.2/120.3	152/142	175/150	140/159	545/545	167/157	175/175	154/172	565/565	
		456A	56.3/75.0	156.4/180.4	178/202	200/225	200/228	545/545	193/217	200/225	214/241	565/565			
		HIGH	5	—	—	—	119	150	126	563	130	150	139	583	
				454A	18.8/25.0	52.1/60.1	119/119	150/150	126/126	563/563	130/130	150/150	139/139	583/583	
	455A			37.6/50.0	104.2/120.3	168/158	175/175	154/173	563/563	182/173	200/175	168/186	583/583		
	460-3-60	STD/MED	5	—	—	—	50	60	53	277	56	70	60	289	
				457A	25.0	30.1	50	60	53	277	56	70	60	289	
				458A	50.0	60.1	70	80	79	277	78	80	86	289	
		459A	75.0	90.2	100	110	113	277	108	110	120	289			
		HIGH	5	—	—	—	55	60	59	285	62	70	66	297	
				457A	25.0	30.1	55	60	59	285	62	70	66	297	
	458A			50.0	60.1	77	80	85	285	85	90	92	297		
	575-3-60	STD/MED	5	—	—	—	47	60	50	224	52	60	55	232	
				460A	24.8	23.9	47	60	50	224	52	60	55	232	
				461A	49.6	47.7	68	70	63	224	74	80	68	232	
		462A	74.4	71.6	80	90	90	224	86	90	96	232			
		HIGH	5	—	—	—	51	60	55	228	56	60	60	236	
				460A	24.8	23.9	51	60	55	228	56	60	60	236	
	461A			49.6	47.7	73	80	67	228	79	80	73	236		
	50GE**24 Horizontal	208/230-3-60	HIGH	5	—	—	—	119	150	126	563	130	150	139	583
					463A	18.8/25.0	52.1/60.1	119/119	150/150	126/126	563/563	130/130	150/150	139/139	583/583
					464A	37.6/50.0	104.2/120.3	168/158	175/175	154/173	563/563	182/173	200/175	168/186	583/583
465A					56.3/75.0	156.4/180.4	194/218	200/250	214/242	563/563	209/233	225/250	228/256	583/583	
460-3-60		HIGH	5	—	—	—	55	60	59	285	62	70	66	297	
				466A	25.0	30.1	55	60	59	285	62	70	66	297	
				467A	50.0	60.1	77	80	85	285	85	90	92	297	
				468A	75.0	90.2	107	125	119	285	115	125	126	297	
575-3-60		HIGH	5	—	—	—	51	60	55	228	56	60	60	236	
				469A	24.8	23.9	51	60	55	228	56	60	60	236	
				470A	49.6	47.7	73	80	67	228	79	80	73	236	
				471A	74.4	71.6	85	90	95	228	91	100	100	236	

## 50GE\*\*24 Unit HACR Sizing Electrical Data

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR KA	ELECTRIC HEATER			NO CONVENIENCE OUTLET or UNPOWERED CONVENIENCE OUTLET								
				STD SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)				
							MCA	HACR Breaker	Disconnect Size		MCA	HACR Breaker	Disconnect Size		
									FLA	LRA			FLA	LRA	
50GE**24 Vertical	208/230-3-60	STD/MED	5	—	—	—	101	125	106	540	113	150	119	560	
				454A	18.8/25.0	52.1/60.1	101/101	125/125	106/106	540/540	113/113	150/150	119/119	560/560	
				455A	37.6/50.0	104.2/120.3	146/146	150/150	135/153	540/540	161/161	175/175	148/167	560/560	
				456A	56.3/75.0	156.4/180.4	196/196	200/225	195/222	540/540	211/211	225/225	208/236	560/560	
		HIGH	5	—	—	—	114	150	120	558	126	150	134	578	
				454A	18.8/25.0	52.1/60.1	114/114	150/150	120/120	558/558	126/126	150/150	134/134	578/578	
	455A			37.6/50.0	104.2/120.3	162/162	175/175	149/167	558/558	176/176	200/200	162/181	578/578		
	460-3-60	STD/MED	5	—	—	—	48	60	50	275	54	60	57	287	
				457A	25.0	30.1	48	60	50	275	54	60	57	287	
				458A	50.0	60.1	68	70	76	275	75	80	83	287	
				459A	75.0	90.2	98	100	111	275	106	110	118	287	
		HIGH	5	—	—	—	53	60	56	283	59	70	63	295	
				457A	25.0	30.1	53	60	56	283	59	70	63	295	
				458A	50.0	60.1	74	80	82	283	82	90	89	295	
				459A	75.0	90.2	104	110	117	283	112	125	124	295	
		575-3-60	STD/MED	5	—	—	—	45	50	48	222	50	60	53	230
					460A	24.8	23.9	45	50	48	222	50	60	53	230
					461A	49.6	47.7	66	70	61	222	72	80	66	230
					462A	74.4	71.6	78	80	88	222	84	90	94	230
	HIGH		5	—	—	—	50	60	53	226	54	60	58	234	
				460A	24.8	23.9	50	60	53	226	54	60	58	234	
				461A	49.6	47.7	71	80	65	226	77	80	71	234	
				462A	74.4	71.6	83	90	93	226	89	90	98	234	
	50GE**24 Horizontal	208/230-3-60	HIGH	5	—	—	—	114	150	120	558	126	150	134	578
463A					18.8/25.0	52.1/60.1	114/114	150/150	120/120	558/558	126/126	150/150	134/134	578/578	
464A					37.6/50.0	104.2/120.3	162/162	175/175	149/167	558/558	176/176	200/200	162/181	578/578	
465A					56.3/75.0	156.4/180.4	212/212	225/225	209/236	558/558	227/227	250/250	222/250	578/578	
460-3-60		HIGH	5	—	—	—	53	60	56	283	59	70	63	295	
				466A	25.0	30.1	53	60	56	283	59	70	63	295	
				467A	50.0	60.1	74	80	82	283	82	90	89	295	
				468A	75.0	90.2	104	110	117	283	112	125	124	295	
575-3-60		HIGH	5	—	—	—	50	60	53	226	54	60	58	234	
				469A	24.8	23.9	50	60	53	226	54	60	58	234	
				470A	49.6	47.7	71	80	65	226	77	80	71	234	
				471A	74.4	71.6	83	90	93	226	89	90	98	234	

## 50GE\*\*24 Unit HACR Sizing Electrical Data (cont)

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			WITH POWERED CONVENIENCE OUTLET								
				STD SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)				
							MCA	HACR Breaker	Disconnect Size		MCA	HACR Breaker	Disconnect Size		
									FLA	LRA			FLA	LRA	
50GE**24 Vertical	208/230-3-60	STD/MED	5	—	—	—	106	125	111	545	118	150	125	565	
				454A	18.8/25.0	52.1/60.1	106/106	125/125	111/111	545/545	118/118	150/150	125/125	565/565	
				455A	37.6/50.0	104.2/120.3	152/152	175/175	140/159	545/545	167/167	175/175	154/172	565/565	
		456A	56.3/75.0	156.4/180.4	202/202	225/225	200/228	545/545	217/217	225/225	214/241	565/565			
		HIGH	5	—	—	—	119	150	126	563	130	150	139	583	
				454A	18.8/25.0	52.1/60.1	119/119	150/150	126/126	563/563	130/130	150/150	139/139	583/583	
	455A			37.6/50.0	104.2/120.3	168/168	175/175	154/173	563/563	182/182	200/200	168/186	583/583		
	460-3-60	STD/MED	5	—	—	—	50	60	53	277	56	70	60	289	
				457A	25.0	30.1	50	60	53	277	56	70	60	289	
				458A	50.0	60.1	70	80	79	277	78	80	86	289	
		459A	75.0	90.2	100	110	113	277	108	110	120	289			
		HIGH	5	—	—	—	55	60	59	285	62	70	66	297	
				457A	25.0	30.1	55	60	59	285	62	70	66	297	
	458A			50.0	60.1	77	80	85	285	85	90	92	297		
	575-3-60	STD/MED	5	—	—	—	47	60	50	224	52	60	55	232	
				460A	24.8	23.9	47	60	50	224	52	60	55	232	
				461A	49.6	47.7	68	70	63	224	74	80	68	232	
		462A	74.4	71.6	80	90	90	224	86	90	96	232			
		HIGH	5	—	—	—	51	60	55	228	56	60	60	236	
				460A	24.8	23.9	51	60	55	228	56	60	60	236	
	461A			49.6	47.7	73	80	67	228	79	80	73	236		
	462A	74.4	71.6	85	90	95	228	91	100	100	236				
	50GE**24 Horizontal	208/230-3-60	HIGH	5	—	—	—	106	125	111	545	118	150	125	565
					463A	18.8/25.0	52.1/60.1	119/119	150/150	126/126	563/563	130/130	150/150	139/139	583/583
464A					37.6/50.0	104.2/120.3	168/168	175/175	154/173	563/563	182/182	200/200	168/186	583/583	
465A					56.3/75.0	156.4/180.4	218/218	225/250	214/242	563/563	233/233	250/250	228/256	583/583	
460-3-60		HIGH	5	—	—	—	55	60	59	285	62	70	66	297	
				466A	25.0	30.1	55	60	59	285	62	70	66	297	
				467A	50.0	60.1	77	80	85	285	85	90	92	297	
				468A	75.0	90.2	107	125	119	285	115	125	126	297	
575-3-60		HIGH	5	—	—	—	51	60	55	228	56	60	60	236	
				469A	24.8	23.9	51	60	55	228	56	60	60	236	
				470A	49.6	47.7	73	80	67	228	79	80	73	236	
				471A	74.4	71.6	85	90	95	228	91	100	100	236	

## 50GE\*\*28 Unit Wire/Fuse Sizing Electrical Data

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR KA	HIGH SCCR KA <sup>a</sup>	ELECTRIC HEATER				NO CONVENIENCE OUTLET or UNPOWERED CONVENIENCE OUTLET							
					STD SCCR CRHEATER ****00	HIGH SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)			
									MCA	Fuse or HACR Breaker	Disconnect Size		MCA	Fuse or HACR Breaker	Disconnect Size	
											FLA	LRA			FLA	LRA
50GE**28 Vertical	208/230-3-60	STD/MED	5	60	—	—	—	—	132	175	137	595	144	175	150	615
					454A	454A	18.8/25.0	52.1/60.1	132/132	175/175	137/137	595/595	144/144	175/175	150/150	615/615
					455A	455A	37.6/50.0	104.2/120.3	149/139	175/175	137/156	595/595	164/154	175/175	151/169	615/615
					456A	456A	56.3/75.0	156.4/180.4	175/199	200/225	197/225	595/595	190/214	200/225	211/238	615/615
		HIGH	5	60	—	—	—	—	142	175	149	609	154	200	162	629
					454A	454A	18.8/25.0	52.1/60.1	142/142	175/175	149/149	609/609	154/154	200/200	162/162	629/629
					455A	455A	37.6/50.0	104.2/120.3	162/152	175/175	149/167	609/609	176/167	200/200	162/181	629/629
					456A	456A	56.3/75.0	156.4/180.4	188/212	200/225	209/236	609/609	203/227	225/250	222/250	629/629
	460-3-60	STD/MED	5	65	—	—	—	—	60	80	63	306	67	80	70	318
					457A	457A	25.0	30.1	60	80	63	306	67	80	70	318
					458A	458A	50.0	60.1	69	80	77	306	77	80	84	318
					459A	459A	75.0	90.2	99	100	112	306	107	110	119	318
		HIGH	5	65	—	—	—	—	65	80	68	312	71	90	75	324
					457A	457A	25.0	30.1	65	80	68	312	71	90	75	324
					458A	458A	50.0	60.1	74	80	82	312	82	90	89	324
					459A	459A	75.0	90.2	104	110	117	312	112	125	124	324
	575-3-60	STD/MED	5	—	—	—	—	—	61	80	64	243	66	80	70	251
					460A	—	24.8	23.9	61	80	64	243	66	80	70	251
					461A	—	49.6	47.7	67	80	64	243	73	80	70	251
					462A	—	74.4	71.6	79	90	89	243	85	90	95	251
		HIGH	5	—	—	—	—	—	64	80	68	247	69	80	73	255
					460A	—	24.8	23.9	64	80	68	247	69	80	73	255
					461A	—	49.6	47.7	71	80	68	247	77	80	73	255
					462A	—	74.4	71.6	83	90	93	247	89	90	98	255
50GE**28 Horizontal	208/230-3-60	HIGH	5	60	—	—	—	—	142	175	149	609	154	200	162	629
					463A	463A	18.8/25.0	52.1/60.1	142/142	175/175	149/149	609/609	154/154	200/200	162/162	629/629
					464A	464A	37.6/50.0	104.2/120.3	162/152	175/175	149/167	609/609	176/167	200/200	162/181	629/629
					465A	465A	56.3/75.0	156.4/180.4	188/212	200/225	209/236	609/609	203/227	225/250	222/250	629/629
	460-3-60	HIGH	5	65	—	—	—	—	65	80	68	312	71	90	75	324
					466A	466A	25.0	30.1	65	80	68	312	71	90	75	324
					467A	467A	50.0	60.1	74	80	82	312	82	90	89	324
					468A	468A	75.0	90.2	104	110	117	312	112	125	124	324
	575-3-60	HIGH	5	—	—	—	—	—	64	80	68	247	69	80	73	255
					469A	—	24.8	23.9	64	80	68	247	69	80	73	255
					470A	—	49.6	47.7	71	80	68	247	77	80	73	255
					471A	—	74.4	71.6	83	90	93	247	89	90	98	255

NOTE(S):

- a. High SCCR (Short Circuit Current Rating) is not available on the following: units with Humidi-MiZer system, phase loss monitor, non-fused disconnect, and 575V models.

## 50GE\*\*28 Unit Wire/Fuse Sizing Electrical Data (cont)

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			WITH POWERED CONVENIENCE OUTLET								
				STD SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)				
							MCA	Fuse or HACR Breaker	Disconnect Size		MCA	Fuse or HACR Breaker	Disconnect Size		
									FLA	LRA			FLA	LRA	
50GE**28 Vertical	208/230-3-60	STD/MED	5	—	—	—	137	175	142	600	148	175	156	620	
				454A	18.8/25.0	52.1/60.1	137/137	175/175	142/142	600/600	148/148	175/175	156/156	620/620	
				455A	37.6/50.0	104.2/120.3	155/145	175/175	143/161	600/600	170/160	175/175	156/175	620/620	
		456A	56.3/75.0	156.4/180.4	181/205	200/225	203/230	600/600	196/220	200/225	216/244	620/620			
		HIGH	5	—	—	—	147	175	154	614	159	200	168	634	
				454A	18.8/25.0	52.1/60.1	147/147	175/175	154/154	614/614	159/159	200/200	168/168	634/634	
	455A			37.6/50.0	104.2/120.3	168/158	175/175	154/173	614/614	182/173	200/200	168/186	634/634		
	460-3-60	STD/MED	5	—	—	—	63	80	66	308	69	90	73	320	
				457A	25.0	30.1	63	80	66	308	69	90	73	320	
				458A	50.0	60.1	72	80	80	308	79	90	87	320	
		459A	75.0	90.2	102	110	114	308	110	110	121	320			
		HIGH	5	—	—	—	67	80	70	314	73	90	78	326	
				457A	25.0	30.1	67	80	70	314	73	90	78	326	
	458A			50.0	60.1	77	80	85	314	85	90	92	326		
	575-3-60	STD/MED	5	—	—	—	107	125	119	314	115	125	126	326	
				460A	24.8	23.9	63	80	66	245	67	80	72	253	
				461A	49.6	47.7	69	80	66	245	75	80	72	253	
		462A	74.4	71.6	81	90	91	245	87	90	97	253			
		HIGH	5	—	—	—	66	80	70	249	71	90	75	257	
				460A	24.8	23.9	66	80	70	249	71	90	75	257	
	461A			49.6	47.7	73	80	70	249	79	90	75	257		
	50GE**28 Horizontal	208/230-3-60	HIGH	5	—	—	—	147	175	154	614	159	200	168	634
					463A	18.8/25.0	52.1/60.1	147/147	175/175	154/154	614/614	159/159	200/200	168/168	634/634
					464A	37.6/50.0	104.2/120.3	168/158	175/175	154/173	614/614	182/173	200/200	168/186	634/634
465A					56.3/75.0	156.4/180.4	194/218	200/250	214/242	614/614	209/233	225/250	228/256	634/634	
460-3-60		HIGH	5	—	—	—	67	80	70	314	73	90	78	326	
				466A	25.0	30.1	67	80	70	314	73	90	78	326	
				467A	50.0	60.1	77	80	85	314	85	90	92	326	
				468A	75.0	90.2	107	125	119	314	115	125	126	326	
575-3-60		HIGH	5	—	—	—	66	80	70	249	71	90	75	257	
				469A	24.8	23.9	66	80	70	249	71	90	75	257	
				470A	49.6	47.7	73	80	70	249	79	90	75	257	
				471A	74.4	71.6	85	90	95	249	91	100	100	257	

## 50GE\*\*28 Unit HACR Sizing Electrical Data

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			NO CONVENIENCE OUTLET or UNPOWERED CONVENIENCE OUTLET								
				STD SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)				
							MCA	HACR Breaker	Disconnect Size		MCA	HACR Breaker	Disconnect Size		
									FLA	LRA			FLA	LRA	
50GE**28 Vertical	208/230-3-60	STD/MED	5	—	—	—	132	175	137	595	144	175	150	615	
				454A	18.8/25.0	52.1/60.1	132/132	175/175	137/137	595/595	144/144	175/175	150/150	615/615	
				455A	37.6/50.0	104.2/120.3	149/149	175/175	137/156	595/595	164/164	175/175	151/169	615/615	
				456A	56.3/75.0	156.4/180.4	199/199	200/225	197/225	595/595	214/214	225/225	211/238	615/615	
		HIGH	5	—	—	—	142	175	149	609	154	200	162	629	
				454A	18.8/25.0	52.1/60.1	142/142	175/175	149/149	609/609	154/154	200/200	162/162	629/629	
	455A			37.6/50.0	104.2/120.3	162/162	175/175	149/167	609/609	176/176	200/200	162/181	629/629		
	460-3-60	STD/MED	5	—	—	—	60	80	63	306	67	80	70	318	
				457A	25.0	30.1	60	80	63	306	67	80	70	318	
				458A	50.0	60.1	69	80	77	306	77	80	84	318	
				459A	75.0	90.2	99	100	112	306	107	110	119	318	
		HIGH	5	—	—	—	65	80	68	312	71	90	75	324	
				457A	25.0	30.1	65	80	68	312	71	90	75	324	
	50GE**28 Horizontal	575-3-60	STD/MED	5	—	—	—	61	80	64	243	66	80	70	251
					460A	24.8	23.9	61	80	64	243	66	80	70	251
					461A	49.6	47.7	67	80	64	243	73	80	70	251
					462A	74.4	71.6	79	90	89	243	85	90	95	251
			HIGH	5	—	—	—	64	80	68	247	69	80	73	255
					460A	24.8	23.9	64	80	68	247	69	80	73	255
		208/230-3-60	HIGH	5	—	—	—	142	175	149	609	154	200	162	629
					463A	18.8/25.0	52.1/60.1	142/142	175/175	149/149	609/609	154/154	200/200	162/162	629/629
					464A	37.6/50.0	104.2/120.3	162/162	175/175	149/167	609/609	176/176	200/200	162/181	629/629
					465A	56.3/75.0	156.4/180.4	212/212	225/225	209/236	609/609	227/227	250/250	222/250	629/629
			460-3-60	HIGH	5	—	—	—	65	80	68	312	71	90	75
466A						25.0	30.1	65	80	68	312	71	90	75	324
575-3-60	HIGH	5	—	—	—	64	80	68	247	69	80	73	255		
			469A	24.8	23.9	64	80	68	247	69	80	73	255		
			470A	49.6	47.7	71	80	68	247	77	80	73	255		
			471A	74.4	71.6	83	90	93	247	89	90	98	255		
			467A	50.0	60.1	74	80	82	312	82	90	89	324		
			468A	75.0	90.2	104	110	117	312	112	125	124	324		

## 50GE\*\*28 Unit HACR Sizing Electrical Data (cont)

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			WITH POWERED CONVENIENCE OUTLET								
				STD SCCR CRHEATER ****00	NOM (kW)	FLA	No Power Exhaust				With Power Exhaust (powered from unit)				
							MCA	HACR Breaker	Disconnect Size		MCA	HACR Breaker	Disconnect Size		
									FLA	LRA			FLA	LRA	
50GE**28 Vertical	208/230-3-60	STD/MED	5	—	—	—	137	175	142	600	148	175	156	620	
				454A	18.8/25.0	52.1/60.1	137/137	175/175	142/142	600/600	148/148	175/175	156/156	620/620	
				455A	37.6/50.0	104.2/120.3	155/155	175/175	143/161	600/600	170/170	175/175	156/175	620/620	
		456A	56.3/75.0	156.4/180.4	205/205	225/225	203/230	600/600	220/220	225/225	216/244	620/620			
		HIGH	5	—	—	—	147	175	154	614	159	200	168	634	
				454A	18.8/25.0	52.1/60.1	147/147	175/175	154/154	614/614	159/159	200/200	168/168	634/634	
	455A			37.6/50.0	104.2/120.3	168/168	175/175	154/173	614/614	182/182	200/200	168/186	634/634		
	460-3-60	STD/MED	5	—	—	—	63	80	66	308	69	90	73	320	
				457A	25.0	30.1	63	80	66	308	69	90	73	320	
				458A	50.0	60.1	72	80	80	308	79	90	87	320	
		459A	75.0	90.2	102	110	114	308	110	110	121	320			
		HIGH	5	—	—	—	67	80	70	314	73	90	78	326	
				457A	25.0	30.1	67	80	70	314	73	90	78	326	
	458A			50.0	60.1	77	80	85	314	85	90	92	326		
	575-3-60	STD/MED	5	—	—	—	107	125	119	314	115	125	126	326	
				459A	75.0	90.2	107	125	119	314	115	125	126	326	
				460A	24.8	23.9	63	80	66	245	67	80	72	253	
		HIGH	5	461A	49.6	47.7	69	80	66	245	75	80	72	253	
				462A	74.4	71.6	81	90	91	245	87	90	97	253	
				—	—	—	66	80	70	249	71	90	75	257	
	50GE**28 Horizontal	208/230-3-60	HIGH	5	460A	24.8	23.9	66	80	70	249	71	90	75	257
					461A	49.6	47.7	73	80	70	249	79	90	75	257
					462A	74.4	71.6	85	90	95	249	91	100	100	257
					—	—	—	147	175	154	614	159	200	168	634
460-3-60		HIGH	5	463A	18.8/25.0	52.1/60.1	147/147	175/175	154/154	614/614	159/159	200/200	168/168	634/634	
				464A	37.6/50.0	104.2/120.3	168/168	175/175	154/173	614/614	182/182	200/200	168/186	634/634	
	465A			56.3/75.0	156.4/180.4	218/218	225/250	214/242	614/614	233/233	250/250	228/256	634/634		
	—			—	—	67	80	70	314	73	90	78	326		
575-3-60	HIGH	5	466A	25.0	30.1	67	80	70	314	73	90	78	326		
			467A	50.0	60.1	77	80	85	314	85	90	92	326		
			468A	75.0	90.2	107	125	119	314	115	125	126	326		
			—	—	—	66	80	70	249	71	90	75	257		

## 50GE\*\*17 Electric Heat Data — Standard SCCR Unit

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	STD ELECTRIC HEATER PART NUMBER	NOMINAL (kW)	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	STD SCCR SINGLE POINT OR JUNCTION KIT PART NUMBER CRSINGLEXXXA00			
								No C.O. or Unpowered C.O.		With PWRD C.O.	
								No P.E.	With P.E. (pwrd fr/unit)	No P.E.	With P.E. (pwrd fr/unit)
50GE-M17 Vertical	208/230-3-60	STD/MED	5	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	—	—	—	—
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	5	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	—	—	—	—
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD/MED	5	CRHEATER457A00	25.0	23.0	78.3	—	—	—	—
				CRHEATER458A00	50.0	45.9	156.7	-	057	057	057
				CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
		HIGH	5	CRHEATER457A00	25.0	23.0	78.3	—	—	—	—
				CRHEATER458A00	50.0	45.9	156.7	057	057	057	057
				CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD/MED	5	CRHEATER460A00	24.8	22.8	77.7	—	—	—	—
				CRHEATER461A00	49.6	45.6	155.4	—	057	-	057
				CRHEATER462A00	74.4	68.3	233.1	057	057	057	057
		HIGH	5	CRHEATER460A00	24.8	22.8	77.7	—	—	—	—
				CRHEATER461A00	49.6	45.6	155.4	—	057	—	057
				CRHEATER462A00	74.4	68.3	233.1	057	057	057	057
50GE-M17 Horizontal	208/230-3-60	HIGH	5	CRHEATER463A00	25.0	18.8/23.0	64.1/78.3	—	—	—	056
				CRHEATER464A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER465A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	HIGH	5	CRHEATER466A00	25.0	23.0	78.3	—	—	—	—
				CRHEATER467A00	50.0	45.9	156.7	057	057	057	057
				CRHEATER468A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	HIGH	5	CRHEATER469A00	24.8	22.8	77.7	—	—	—	—
				CRHEATER470A00	49.6	45.6	155.4	057	057	057	057
				CRHEATER471A00	74.4	68.3	233.1	057	057	057	057

## 50GE\*\*17 Electric Heat Data — High SCCR Unit

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	HIGH SCCR kA	HIGH SCCR ELECTRIC HEATER PART NUMBER	NOMINAL (kW)	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	HIGH SCCR SINGLE POINT OR JUNCTION KIT PART NUMBER CRSINGLEXXXA00	
								No C.O. or Unpowered C.O.	
								No P.E.	With P.E. (pwrd fr/unit)
50GE-M17 Vertical	208/230-3-60	STD/MED	60	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	—	—
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	058	058
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	058	058
		HIGH	60	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	—	—
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	058	058
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	058	058
	460-3-60	STD/MED	65	CRHEATER457A00	25.0	23.0	78.3	—	—
				CRHEATER458A00	50.0	45.9	156.7	-	059
				CRHEATER459A00	75.0	68.9	235.0	059	059
		HIGH	65	CRHEATER457A00	25.0	23.0	78.3	—	—
				CRHEATER458A00	50.0	45.9	156.7	059	059
				CRHEATER459A00	75.0	68.9	235.0	059	059
50GE-M17 Horizontal	208/230-3-60	HIGH	60	CRHEATER463A00	25.0	18.8/23.0	64.1/78.3	—	—
				CRHEATER464A00	50.0	37.6/45.9	128.1/156.7	058	058
				CRHEATER465A00	75.0	56.3/68.9	192.2/235.0	058	058
	460-3-60	HIGH	65	CRHEATER466A00	25.0	23.0	78.3	—	—
				CRHEATER467A00	50.0	45.9	156.7	059	059
				CRHEATER468A00	75.0	68.9	235.0	059	059

## 50GE\*\*20 Electric Heat Data — Standard SCCR Unit

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	STD ELECTRIC HEATER PART NUMBER	NOMINAL (kW)	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	STD SCCR SINGLE POINT OR JUNCTION KIT PART NUMBER CRSINGLEXXXA00			
								No C.O. or Unpowered C.O.		With PWRD C.O.	
								No P.E.	With P.E. (pwrd fr/unit)	No P.E.	With P.E. (pwrd fr/unit)
50GE-M20 Vertical	208/230-3-60	STD/MED	5	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	—	—	—	—
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	5	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	—	—	—	—
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD/MED	5	CRHEATER457A00	25.0	23.0	78.3	—	—	—	—
				CRHEATER458A00	50.0	45.9	156.7	—	057	057	057
				CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
		HIGH	5	CRHEATER457A00	25.0	23.0	78.3	—	—	—	—
				CRHEATER458A00	50.0	45.9	156.7	057	057	057	057
				CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD/MED	5	CRHEATER460A00	24.8	22.8	77.7	—	—	—	—
				CRHEATER461A00	49.6	45.6	155.4	—	057	-	057
				CRHEATER462A00	74.4	68.3	233.1	057	057	057	057
		HIGH	5	CRHEATER460A00	24.8	22.8	77.7	—	—	—	—
				CRHEATER461A00	49.6	45.6	155.4	—	057	—	057
				CRHEATER462A00	74.4	68.3	233.1	057	057	057	057
50GE-M20 Horizontal	208/230-3-60	HIGH	5	CRHEATER463A00	25.0	18.8/23.0	64.1/78.3	—	—	—	056
				CRHEATER464A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER465A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	HIGH	5	CRHEATER466A00	25.0	23.0	78.3	—	—	—	—
				CRHEATER467A00	50.0	45.9	156.7	057	057	057	057
				CRHEATER468A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	HIGH	5	CRHEATER469A00	24.8	22.8	77.7	-	-	-	-
				CRHEATER470A00	49.6	45.6	155.4	057	057	057	057
				CRHEATER471A00	74.4	68.3	233.1	057	057	057	057

## 50GE\*\*20 Electric Heat Data — High SCCR Unit

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	HIGH SCCR kA	HIGH SCCR ELECTRIC HEATER PART NUMBER	NOMINAL (kW)	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	HIGH SCCR SINGLE POINT OR JUNCTION KIT PART NUMBER CRSINGLEXXXA00	
								No C.O. or Unpowered C.O.	
								No P.E.	With P.E. (pwrd fr/unit)
50GE-M20 Vertical	208/230-3-60	STD/MED	60	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	—	—
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	058	058
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	058	058
		HIGH	60	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	—	—
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	058	058
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	058	058
	460-3-60	STD/MED	65	CRHEATER457A00	25.0	23.0	78.3	—	—
				CRHEATER458A00	50.0	45.9	156.7	—	059
				CRHEATER459A00	75.0	68.9	235.0	059	059
		HIGH	65	CRHEATER457A00	25.0	23.0	78.3	—	—
				CRHEATER458A00	50.0	45.9	156.7	059	059
				CRHEATER459A00	75.0	68.9	235.0	059	059
50GE-M20 Horizontal	208/230-3-60	HIGH	60	CRHEATER463A00	25.0	18.8/23.0	64.1/78.3	—	—
				CRHEATER464A00	50.0	37.6/45.9	128.1/156.7	058	058
				CRHEATER465A00	75.0	56.3/68.9	192.2/235.0	058	058
	460-3-60	HIGH	65	CRHEATER466A00	25.0	23.0	78.3	—	—
				CRHEATER467A00	50.0	45.9	156.7	059	059
				CRHEATER468A00	75.0	68.9	235.0	059	059

## 50GE\*\*24 Electric Heat Data — Standard SCCR Unit

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	STD ELECTRIC HEATER PART NUMBER	NOMINAL (kW)	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	STD SCCR SINGLE POINT OR JUNCTION KIT PART NUMBER CRSINGLEXXXA00			
								No C.O. or Unpowered C.O.		With PWRD C.O.	
								No P.E.	With P.E. (pwrd fr/unit)	No P.E.	With P.E. (pwrd fr/unit)
50GE-M24 Vertical	208/230-3-60	STD/MED	5	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	—	056	—	056
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	5	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD/MED	5	CRHEATER457A00	25.0	23.0	78.3	—	—	—	—
				CRHEATER458A00	50.0	45.9	156.7	—	057	057	057
				CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
		HIGH	5	CRHEATER457A00	25.0	23.0	78.3	—	—	—	—
				CRHEATER458A00	50.0	45.9	156.7	057	057	057	057
				CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD/MED	5	CRHEATER460A00	24.8	22.8	77.7	—	—	—	—
				CRHEATER461A00	49.6	45.6	155.4	-	057	-	057
				CRHEATER462A00	74.4	68.3	233.1	057	057	057	057
		HIGH	5	CRHEATER460A00	24.8	22.8	77.7	—	—	—	—
				CRHEATER461A00	49.6	45.6	155.4	057	057	057	057
				CRHEATER462A00	74.4	68.3	233.1	057	057	057	057
50GE-M24 Horizontal	208/230-3-60	HIGH	5	CRHEATER463A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
				CRHEATER464A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER465A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	HIGH	5	CRHEATER466A00	25.0	23.0	78.3	—	—	—	—
				CRHEATER467A00	50.0	45.9	156.7	057	057	057	057
				CRHEATER468A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	HIGH	5	CRHEATER469A00	24.8	22.8	77.7	—	—	—	—
				CRHEATER470A00	49.6	45.6	155.4	057	057	057	057
				CRHEATER471A00	74.4	68.3	233.1	057	057	057	057

## 50GE\*\*24 Electric Heat Data — High SCCR Unit

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	HIGH SCCR kA	HIGH SCCR ELECTRIC HEATER PART NUMBER	NOMINAL (kW)	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	HIGH SCCR SINGLE POINT OR JUNCTION KIT PART NUMBER CRSINGLEXXXA00	
								No C.O. or Unpowered C.O.	
								No P.E.	With P.E. (pwrd fr/unit)
50GE-M24 Vertical	208/230-3-60	STD/MED	60	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	—	058
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	058	058
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	058	058
		HIGH	60	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	058	058
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	058	058
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	058	058
	460-3-60	STD/MED	65	CRHEATER457A00	25.0	23.0	78.3	—	—
				CRHEATER458A00	50.0	45.9	156.7	—	059
				CRHEATER459A00	75.0	68.9	235.0	059	059
		HIGH	65	CRHEATER457A00	25.0	23.0	78.3	—	—
				CRHEATER458A00	50.0	45.9	156.7	059	059
				CRHEATER459A00	75.0	68.9	235.0	059	059
50GE-M24 Horizontal	208/230-3-60	HIGH	60	CRHEATER463A00	25.0	18.8/23.0	64.1/78.3	058	058
				CRHEATER464A00	50.0	37.6/45.9	128.1/156.7	058	058
				CRHEATER465A00	75.0	56.3/68.9	192.2/235.0	058	058
	460-3-60	HIGH	65	CRHEATER466A00	25.0	23.0	78.3	—	—
				CRHEATER467A00	50.0	45.9	156.7	059	059
				CRHEATER468A00	75.0	68.9	235.0	059	059

## 50GE\*\*28 Electric Heat Data — Standard SCCR Unit


50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	STD ELECTRIC HEATER PART NUMBER	NOMINAL (kW)	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	STD SCCR SINGLE POINT OR JUNCTION KIT PART NUMBER CRSINGLEXXXA00			
								No C.O. or Unpowered C.O.		With PWRD C.O.	
								No P.E.	With P.E. (pwrd fr/unit)	No P.E.	With P.E. (pwrd fr/unit)
50GE-M28 Vertical	208/230-3-60	STD/MED	5	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	5	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD/MED	5	CRHEATER457A00	25.0	23.0	78.3	057	057	057	057
				CRHEATER458A00	50.0	45.9	156.7	057	057	057	057
				CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
		HIGH	5	CRHEATER457A00	25.0	23.0	78.3	057	057	057	057
				CRHEATER458A00	50.0	45.9	156.7	057	057	057	057
				CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
575-3-60	STD/MED	5	CRHEATER460A00	24.8	22.8	77.7	057	057	057	057	
			CRHEATER461A00	49.6	45.6	155.4	057	057	057	057	
			CRHEATER462A00	74.4	68.3	233.1	057	057	057	057	
	HIGH	5	CRHEATER460A00	24.8	22.8	77.7	057	057	057	057	
			CRHEATER461A00	49.6	45.6	155.4	057	057	057	057	
			CRHEATER462A00	74.4	68.3	233.1	057	057	057	057	
50GE-M28 Horizontal	208/230-3-60	HIGH	5	CRHEATER463A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
				CRHEATER464A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER465A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	HIGH	5	CRHEATER466A00	25.0	23.0	78.3	057	057	057	057
				CRHEATER467A00	50.0	45.9	156.7	057	057	057	057
				CRHEATER468A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	HIGH	5	CRHEATER469A00	24.8	22.8	77.7	057	057	057	057
				CRHEATER470A00	49.6	45.6	155.4	057	057	057	057
				CRHEATER471A00	74.4	68.3	233.1	057	057	057	057

## 50GE\*\*28 Electric Heat Data — High SCCR Unit

50GE UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	HIGH SCCR kA	HIGH SCCR ELECTRIC HEATER PART NUMBER	NOMINAL (kW)	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	HIGH SCCR SINGLE POINT OR JUNCTION KIT PART NUMBER CRSINGLEXXXA00	
								No C.O. or Unpowered C.O.	
								No P.E.	With P.E. (pwrd fr/unit)
50GE-M28 Vertical	208/230-3-60	STD/MED	60	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	058	058
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	058	058
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	058	058
		HIGH	60	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	058	058
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	058	058
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	058	058
	460-3-60	STD/MED	65	CRHEATER457A00	25.0	23.0	78.3	059	059
				CRHEATER458A00	50.0	45.9	156.7	059	059
				CRHEATER459A00	75.0	68.9	235.0	059	059
		HIGH	65	CRHEATER457A00	25.0	23.0	78.3	059	059
				CRHEATER458A00	50.0	45.9	156.7	059	059
				CRHEATER459A00	75.0	68.9	235.0	059	059
50GE-M28 Horizontal	208/230-3-60	HIGH	60	CRHEATER463A00	25.0	18.8/23.0	64.1/78.3	058	058
				CRHEATER464A00	50.0	37.6/45.9	128.1/156.7	058	058
				CRHEATER465A00	75.0	56.3/68.9	192.2/235.0	058	058
	460-3-60	HIGH	65	CRHEATER466A00	25.0	23.0	78.3	059	059
				CRHEATER467A00	50.0	45.9	156.7	059	059
				CRHEATER468A00	75.0	68.9	235.0	059	059




## 3-Stage 48GE\*\*17-24 Power Wiring Diagram, SystemVu™ Controller — 460-3-60 Units

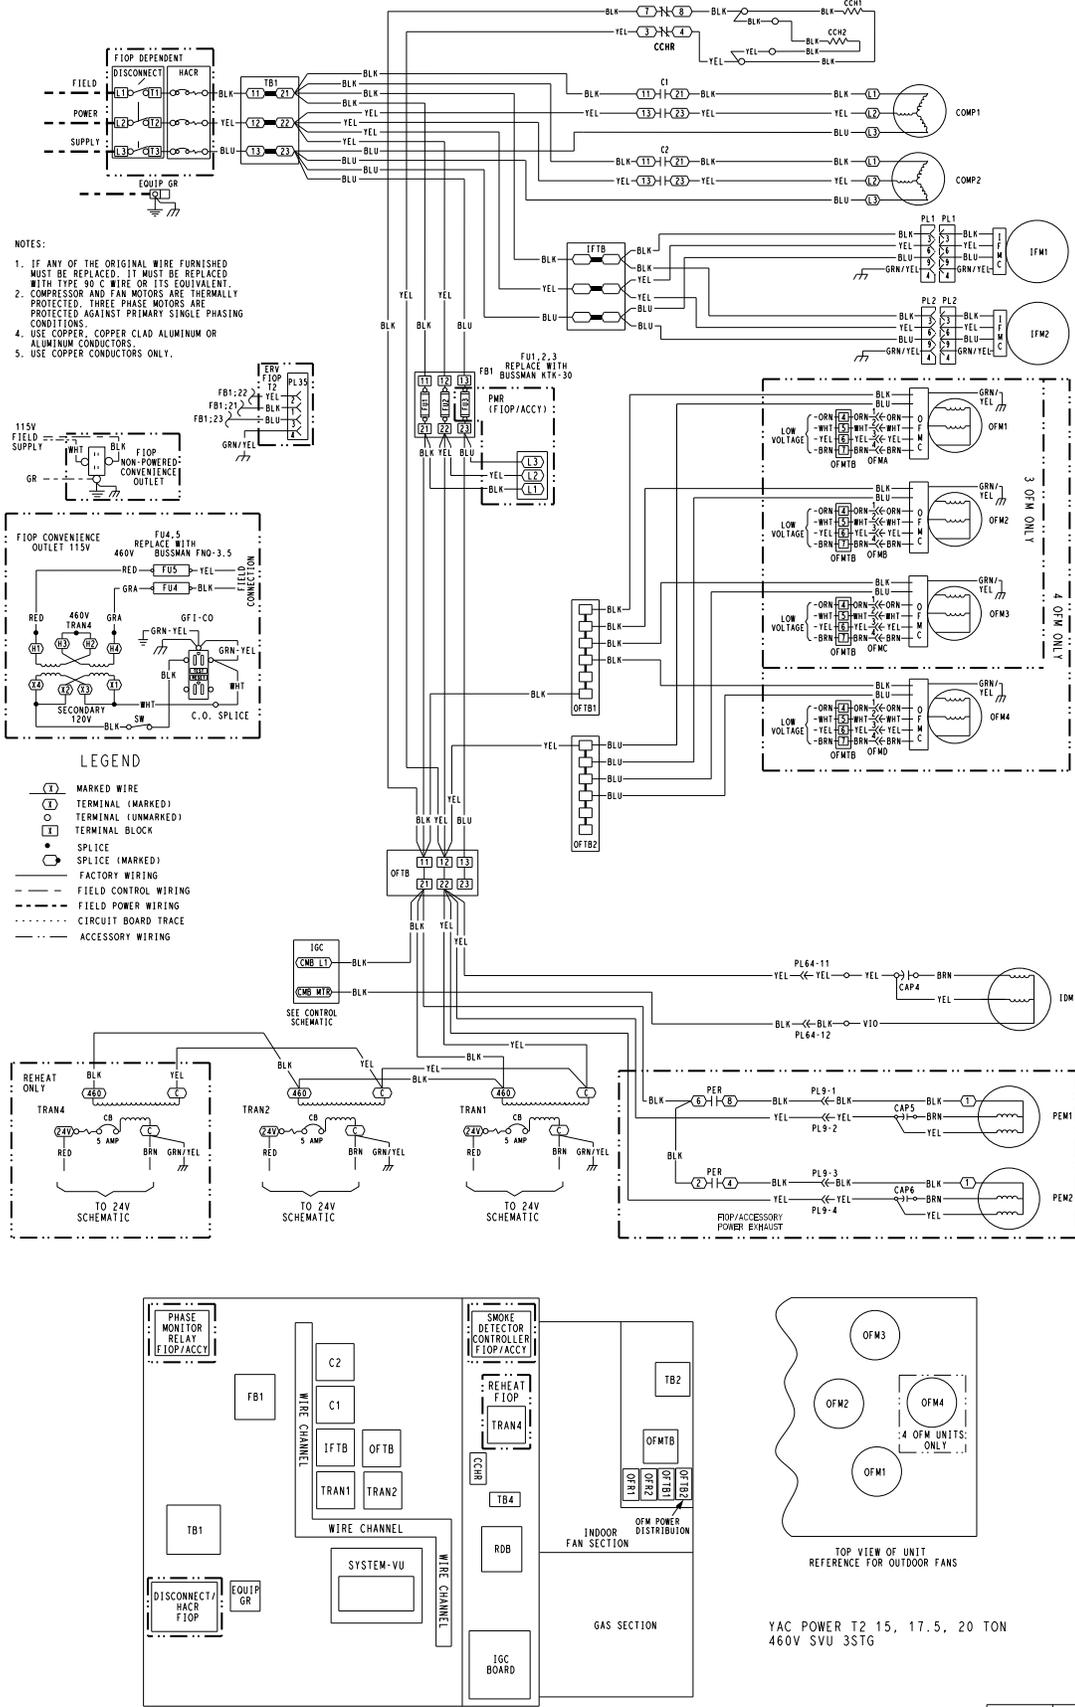


50HE008837 A


## 3-Stage 48GE\*\*28 Power Wiring Diagram, SystemVu™ Controller — 460-3-60 Unit

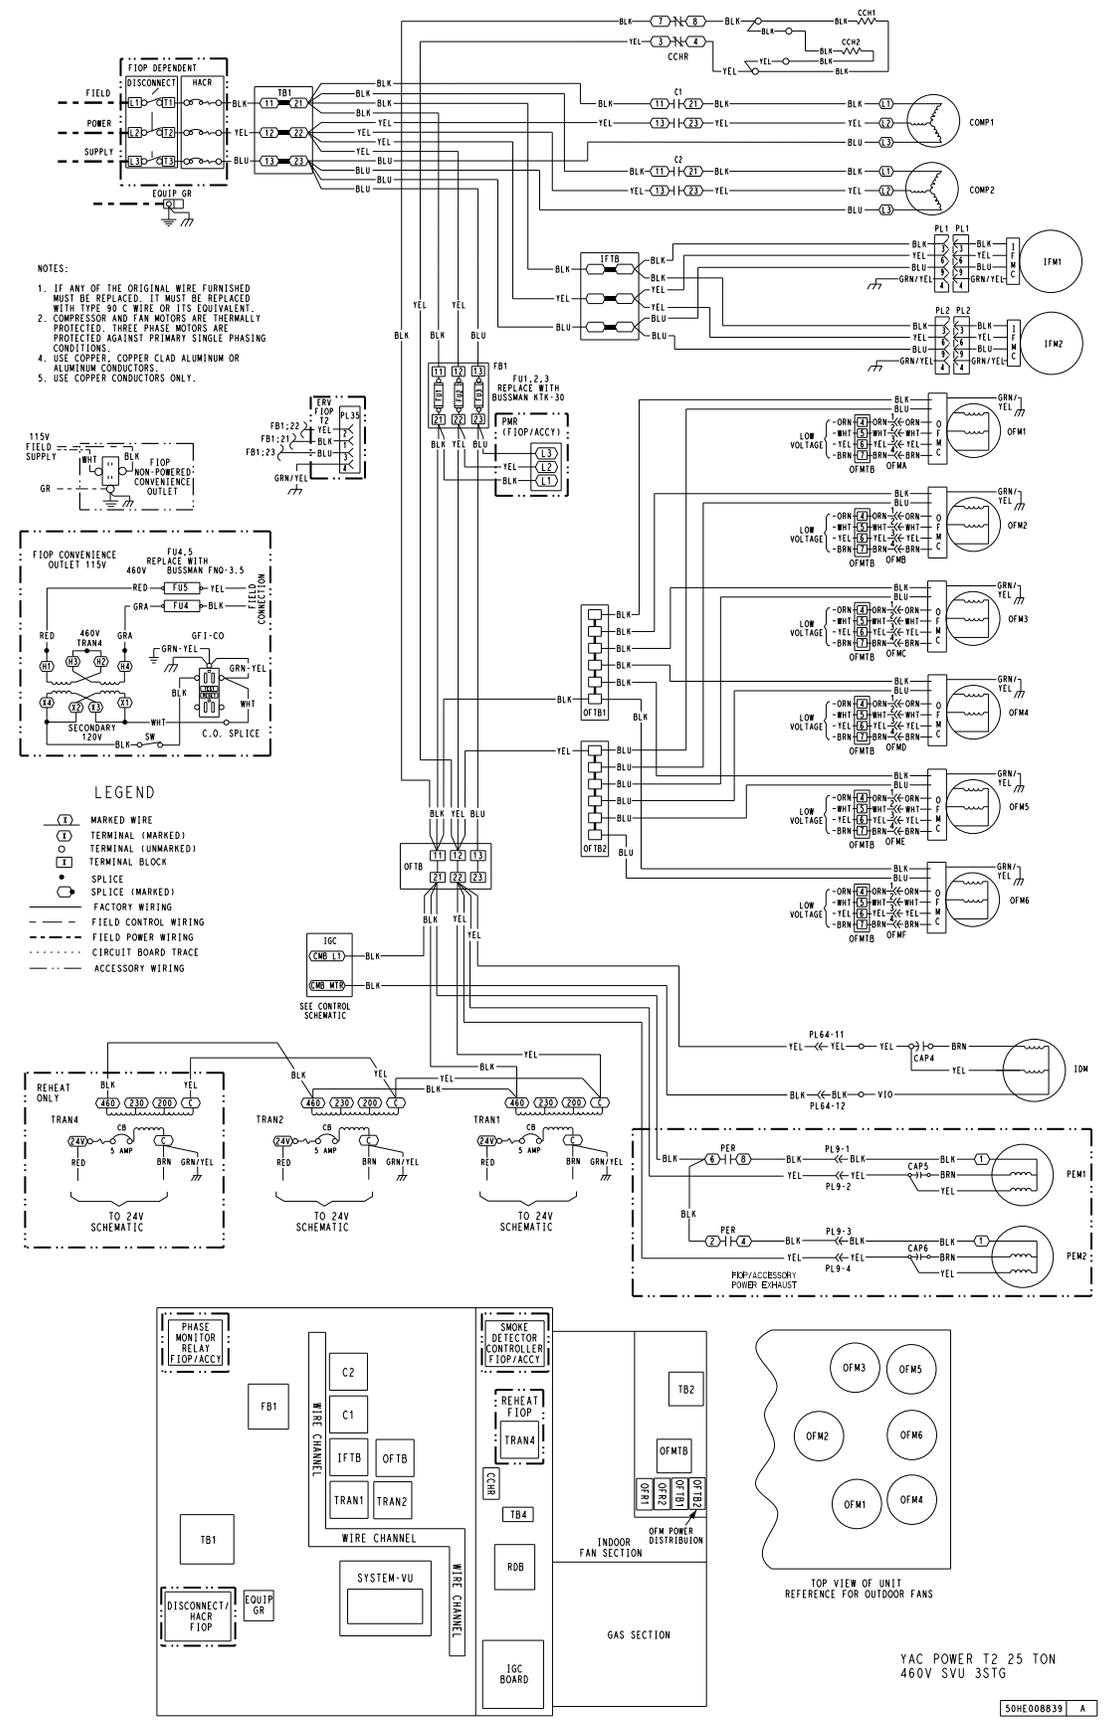

## 50GE\*-17-28 Control Wiring Diagram, SystemVu Controller — 460/575-3-60 Units

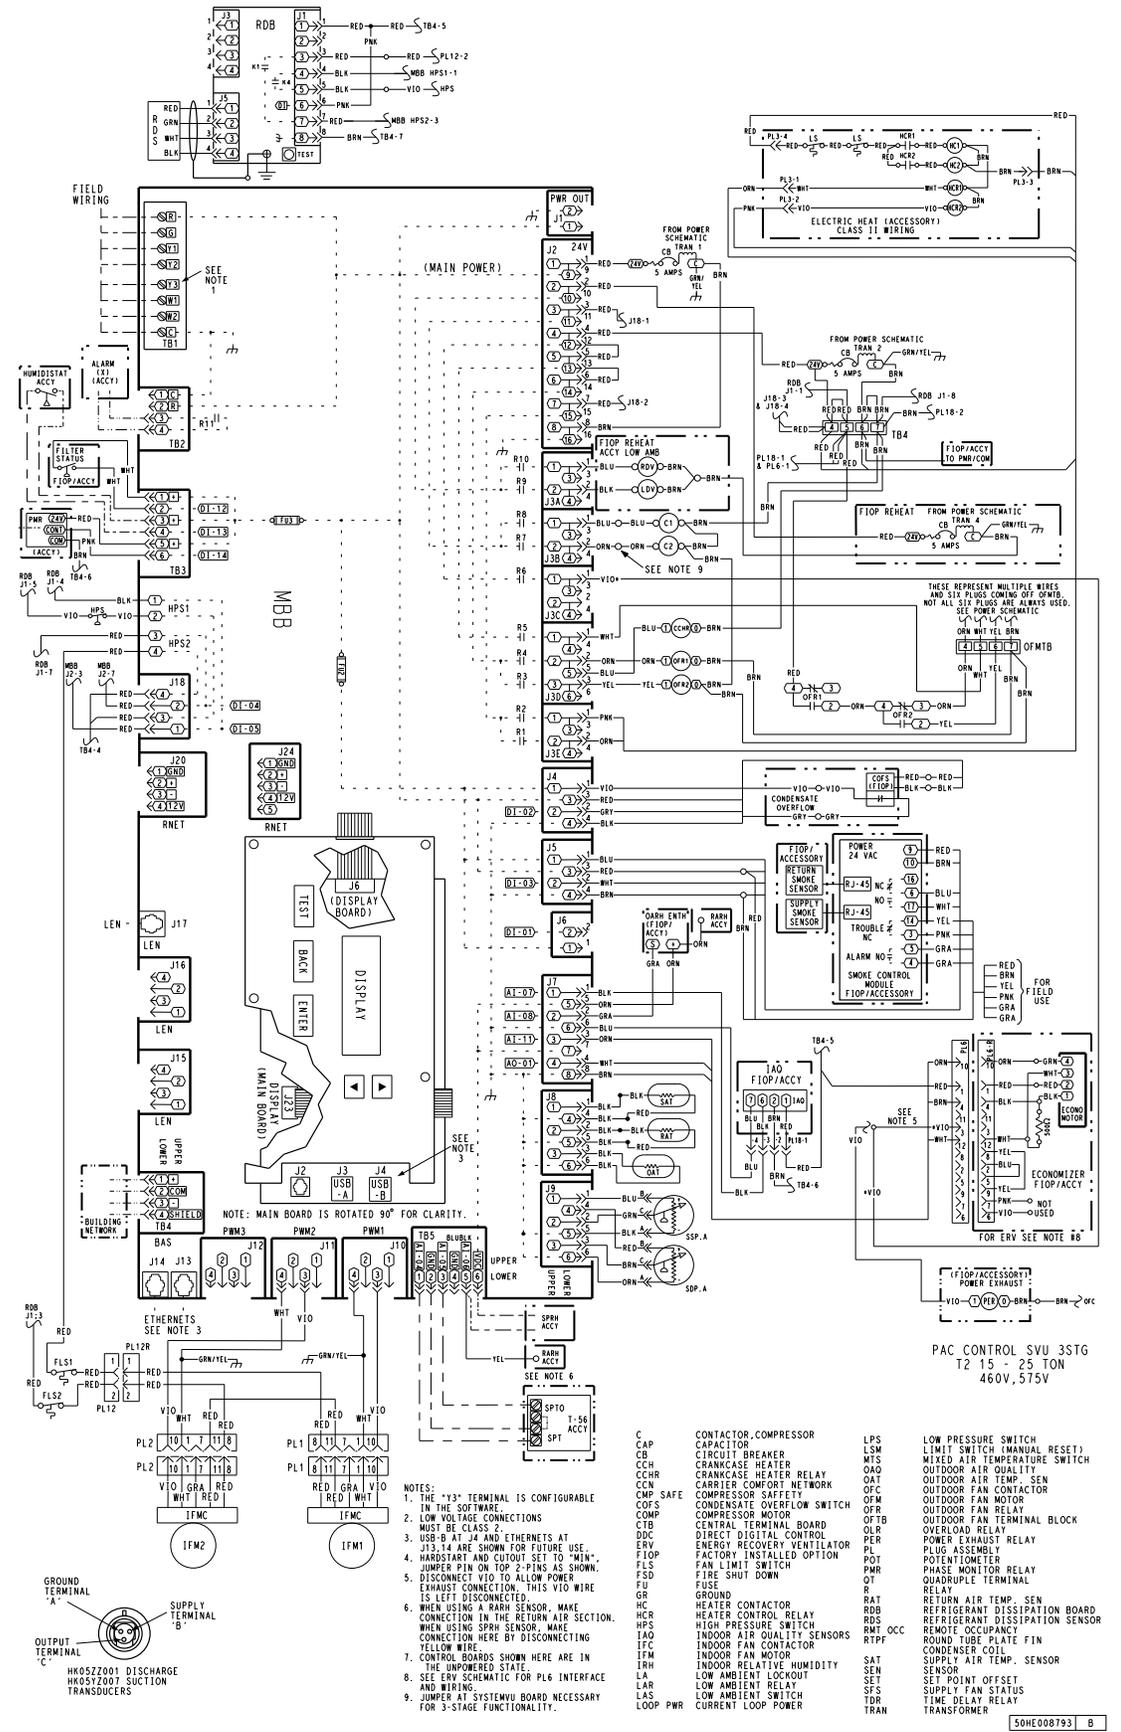


## 50GE-17-24 Power Wiring Diagram, SystemVu™ Controller — 460-3-60 Units

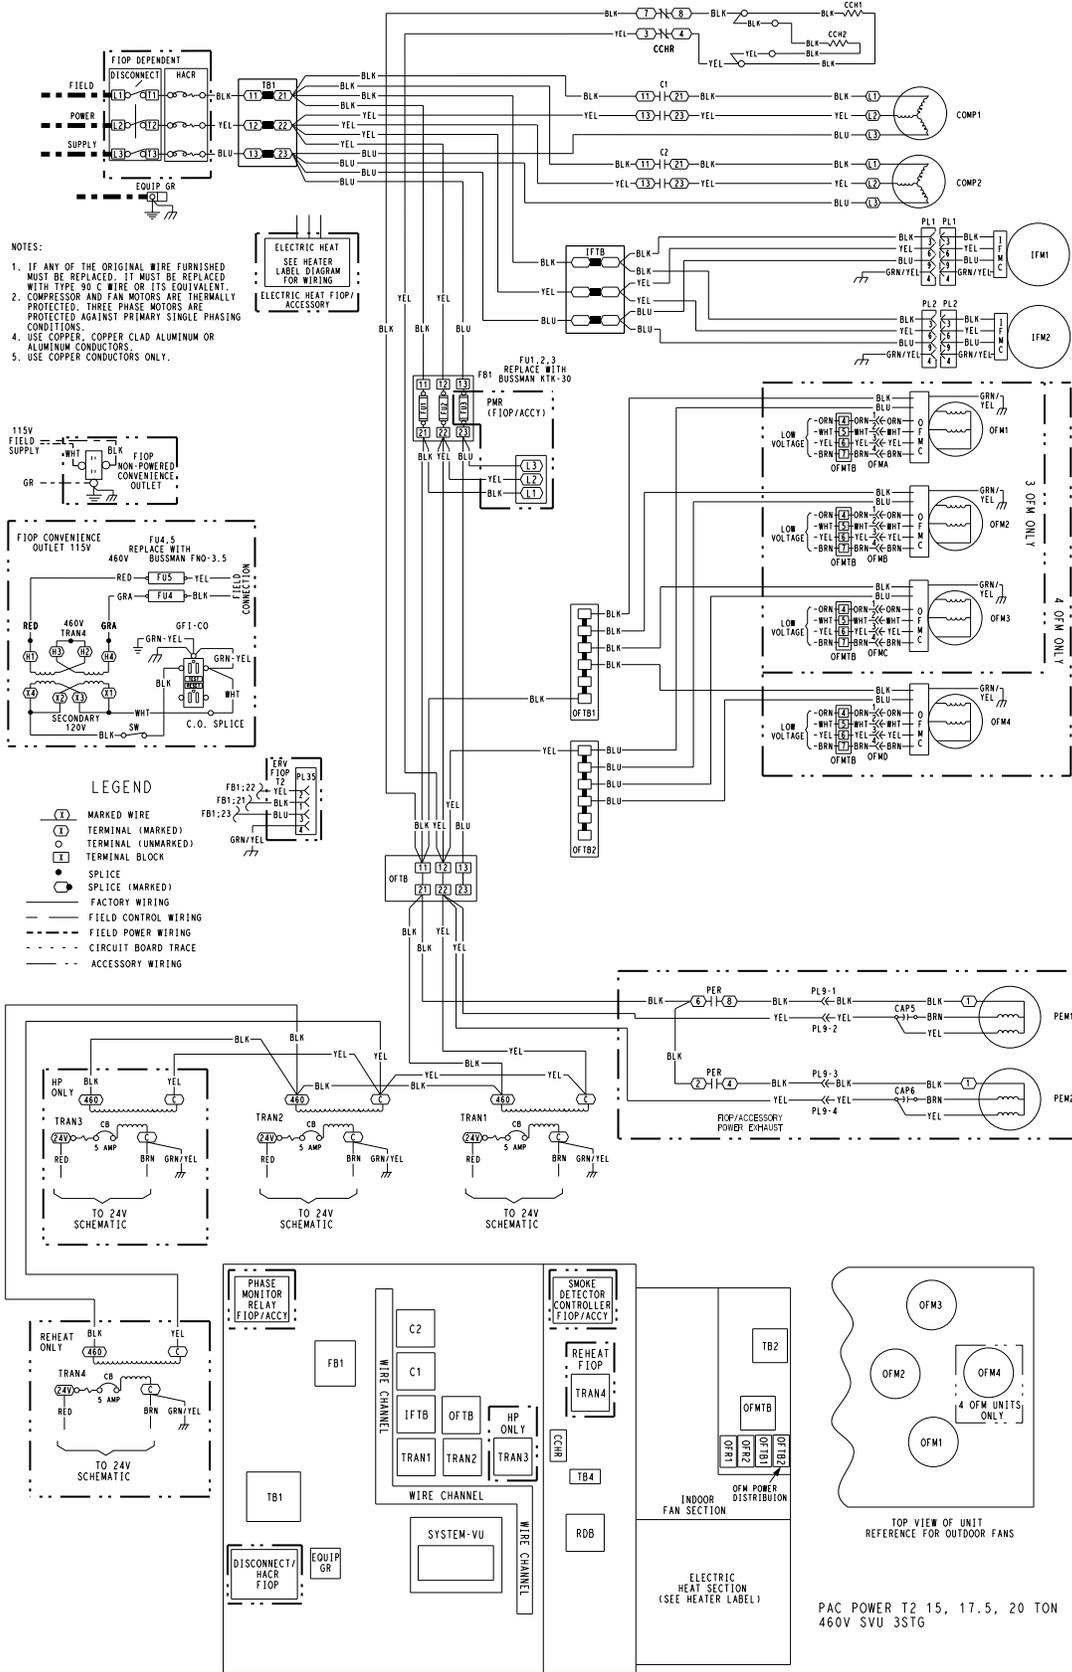

50HE008833 A

## 50GE-28 Power Wiring Diagram, SystemVu™ Controller — 460-3-60 Unit

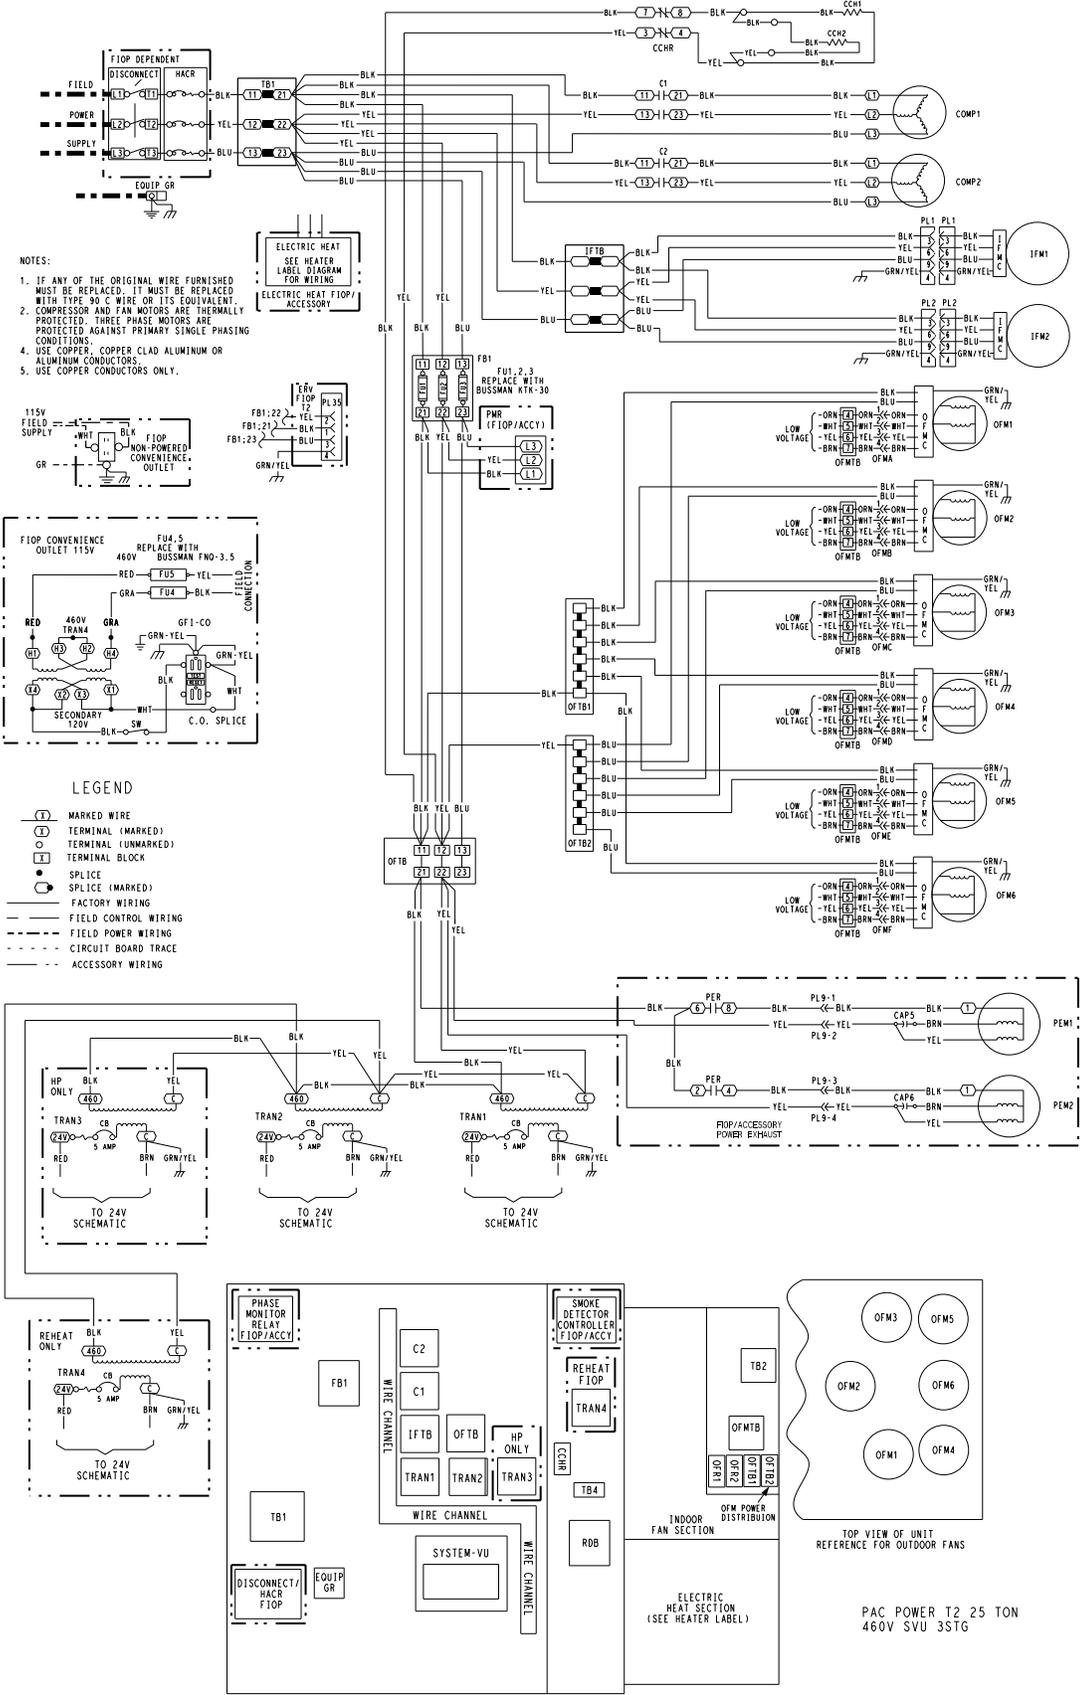

50HE008835 A

## General

The SystemVu controller is standard on all 48/50GE 3-stage units. The sequence below describes the sequence of operation for 48/50GE 3-stage units with and without a factory-installed economizer. For more information regarding the SystemVu controller, see the 48/50FE 04-30, 48/50GE 04-28 Single Package Rooftop Units with SystemVu Controls Version X.X, Start-Up, Operation and Troubleshooting manual.

## Dissipation

When the factory-installed dissipation system detects a level of refrigerant leak in the unit, a safety dissipation mode will be activated. During this dissipation mode, the thermostat will be disabled and the indoor fan will run at 66% of the maximum speed of the motor. When the refrigerant leak levels are normal for 5 minutes, the unit will return to normal operation.

## Cooling without economizer

When the thermostat calls for cooling, terminals G and Y1 are energized. The indoor fan will run at the low fan speed and the C2 compressor contactor (CC) is energized causing small compressor and outdoor fan to run. The low indoor fan speed is 40% of the user set fan speed, depending on unit size.

If additional cooling is needed, the thermostat will add the call for Y2. This will increase the indoor fan speed to 60% of the user set fan speed, energize the C1 contactor and the large compressor, and de-energize C2 and the small compressor. The outdoor fan may run at different speeds for Y1 and Y2 depending on unit size and outdoor ambient temperature.

If further cooling is needed, the thermostat will add the call for Y3. This will increase the indoor fan speed to the user set fan speed and re-energize the C2 contactor and small compressor for full compressor capacity. The outdoor fan runs at different speeds for Y1, Y2, and Y3 depending on unit size and outdoor ambient temperature.

When the thermostat removes the call for Y3 but leaves the Y2 and Y3, the indoor fan will slow to the reduced percentage of the user set fan speed, the C2 contactor will de-energize, the second compressor will turn off, and the outdoor fan will remain on. When the thermostat removes the call for Y2 but leaves the Y1, the indoor fan will further slow to the reduced percentage of the user set fan speed, the C1 contactor and large compressor will de-energize, the C2 contactor and small compressor will re-energize, and the outdoor fan will remain on. When the thermostat removes the call for Y1, the C2 contactor and small compressor will de-energize and the outdoor fan will shut down. When the thermostat removes the call for G, the indoor fan will turn off after the specific unit fan off delay.

NOTE: Per ASHRAE 90.1-2019 and IECC-2018 standards, during the first stage cooling operation the SystemVu controller will adjust the fan motor speed to provide 40% of the total cfm established for the unit. During the second stage cooling operation the SystemVu controller will adjust the fan motor speed to provide 60% of the total cfm established for the unit.

## Cooling with economizer

For detailed information on free cooling operation for 48/50GE 3-stage units with factory-installed economizer see the 48/50FE 04-30, 48/50GE 04-28 Single Package

Rooftop Units with SystemVu Controls Version X.X, Start-Up, Operation and Troubleshooting manual.

## Heating, unit with economizer

Upon a request for heating from the space thermostat terminal, W1 will be energized with 24V. The indoor fan will run at high speed, and outdoor fan C1 and C2 will be energized in heating. The indoor fan, outdoor fans, and compressor are energized. The reversing valve is de-energized and switch positions. The economizer is set to minimum position (ventilation position). If the space temperature continues to fall with W1 energized, W2 will bring on gas heat. As the space temperature rises the W2 will de-energize and the compressors will continue to operate, until the thermostat set point is achieved de-energizing W1. If the thermostat is set to Auto, the indoor fan will de-energize and the economizer will close. If the indoor fan is set to On, the indoor fan will continue to operate and the economizer will remain at minimum position (vent position). On units equipped for 2 stages of heat, when additional heat is needed, second stage of gas heat energized through W2. The economizer damper moves to the minimum position. When the thermostat is satisfied, the damper moves to the fully closed position.

## Heating, unit without economizer

Upon a request for heating from the space thermostat, terminal W1 will be energized with 24V. The indoor fan, outdoor fan C1 and C2 will be energized. The indoor fan, outdoor fans, and compressor 1, and compressor 2 are energized and reversing valves are deenergized and switch position. If the space temperature continues to fall while W1 is energized, W2 will be energized with 24V, and gas heat will be energized. When the space thermostat is satisfied, W2 will be de-energized first, and gas heating will be de-energized. Upon a further rise in space temperature, W1 will be de-energized.

## Gas heating (48GE units)

NOTE: WeatherMaster® units have 2 stages of gas heat.

When the thermostat calls for heating, power is sent to W on the Integrated Gas Controller (IGC) board. An LED (light-emitting diode) on the IGC board turns on and remains on during normal operation. A check is made to ensure that the roll-out switch and limit switch are closed. If the check is successful, then the induced-draft motor is energized, and when its speed is satisfactory, as proven by the flue gas pressure switch, the ignition activation period begins. The burners will ignite within 5 seconds. If the burners do not light, there is a 22 second delay before another 5 second attempt. This sequence is repeated for 15 minutes or until the burners light. If, after the 15 minutes, the burners still have not lit, heating is locked out. To reset the control, break 24-v power to the thermostat.

When ignition occurs, the IGC board will continue to monitor the condition of the roll-out switch, the limit switches, the flue gas pressure switch, and the flame sensor. Forty-five seconds after ignition occurs, assuming the unit is controlled through a room thermostat set for fan auto, the indoor-fan motor will energize (and the outdoor-air dampers will open to their minimum position). If, for some reason, the over-temperature limit opens prior to the start of the indoor fan blower, then the unit will shorten the 45 second delay to 5 seconds less than the time from initiation of heat to when the limit tripped. Gas will not be interrupted to the burners and heating will continue. Once the fan-on delay has been modified, it will not change back to 45 seconds until power is reset to the control. On units with

# Sequence of operation (cont)



2 stages of heat, when additional heat is required, W2 closes and initiates power to the second stage of the main gas valve. When the thermostat is satisfied, W1 and W2 open and the gas valve closes, interrupting the flow of gas to the main burners. If the unit is controlled through a room thermostat set for fan auto, then the indoor-fan motor will continue to operate for an additional 45 seconds and then stop. A LED indicator is provided on the IGC to monitor operation.

## Electric heating (50GE units)

Units have either 1 or 2 stages of electric heat. When the thermostat calls for heating, power is applied to G and the W1 terminals at the unit. The unit control will energize the indoor fan contactor and the first stage of electric heat. On units with 2-stage heating, when additional heating is required, the second stage of electric heat (if equipped) will be energized when power is applied at the W2 terminal on the unit.

**IMPORTANT:** The thermostat must be configured for Electric Heat so it will energize G with the W1 call.

### Heating

The sequence of operation for heating is the same as for an electromechanical unit without an economizer. The only difference is how the economizer acts. The economizer will stay at the Economizer Minimum Position while the evaporator fan is operating. The outdoor-air damper is closed when the indoor fan is not operating. Refer to the unit's service and maintenance manual for further details.

### Optional Humidi-MiZer® dehumidification system

Units with the factory-installed Humidi-MiZer system option are capable of providing multiple modes of improved dehumidification as a variation of the normal cooling cycle. The Humidi-MiZer system option includes additional valves in the liquid line and discharge line of each refrigerant circuit, a small reheat condenser coil downstream of the evaporator, and variable-speed control of some or all outdoor fans. Operation of the revised refrigerant circuit for each mode is described below.

The Humidi-MiZer system provides 3 sub-modes of operation: Cool, Reheat1, and Reheat2.




**Cool** — provides a normal ratio of sensible and latent cooling effect from the evaporator coil.

**Reheat1** — provides increased latent cooling while slightly reducing the sensible cooling effect.

**Reheat2** — provides normal latent cooling but with null or minimum sensible cooling effect delivered to the space.

The Reheat1 and Reheat2 modes are available when the unit is not in a heating mode and when the low ambient lockout switch is closed.

Refer to the following figures for piping flow diagrams.

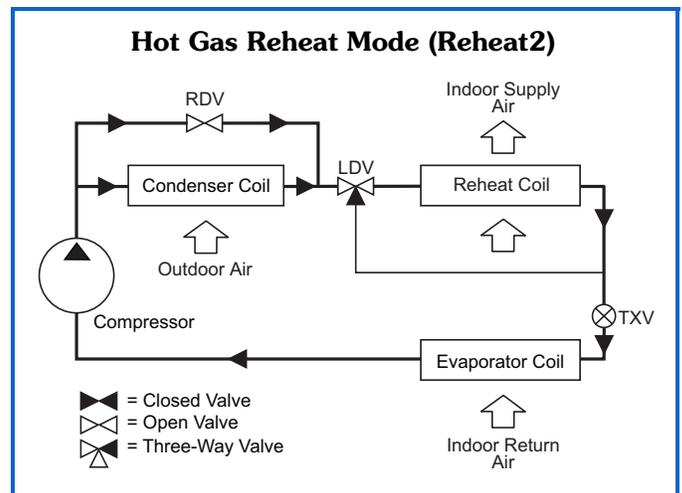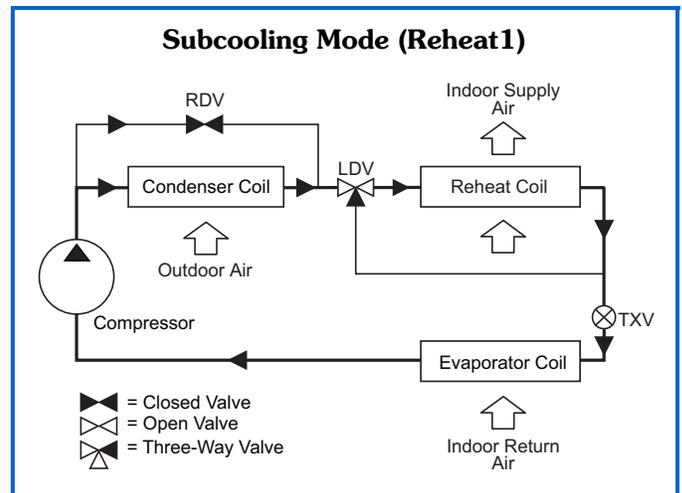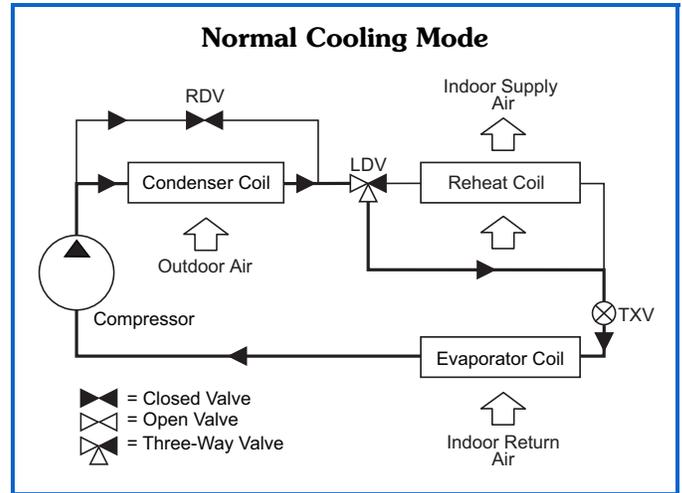

#### LEGEND

- LDV** — Liquid Diverter Valve
- RDV** — Reheat Discharge Valve
- TXV** — Thermostatic Expansion Valve

## Minimum operating ambient temperature (cooling)

In mechanical cooling mode, your Carrier rooftop unit can safely operate down to an outdoor ambient temperature of -10°F (-23°C). It is possible to provide cooling at lower outdoor ambient temperatures by using less outside air and/or economizers.

## Maximum operating ambient temperature (cooling)

The maximum operating ambient temperature for cooling mode is 125°F (52°C). While cooling operation above 125°F (52°C) may be possible, it could cause reduced performance, reduced reliability, or a protective action by the unit's internal safety devices.

## Multiple motor and drive packages

Some applications need larger horsepower motors, some need more airflow, and some need both. Regardless of the case, your Carrier expert has a factory installed combination to meet your application. A wide selection of motors are available, factory installed, to handle nearly any application.

## Stainless steel heat exchanger (48GE units only)

For this option, the tubular heat exchanger is made out of a minimum 20 gauge type 409 stainless steel for applications where the mixed air to the heat exchanger is expected to drop below 45°F (7°C). Stainless steel may be specified on applications where the presence of airborne contaminants require its use (applications such as paper mills) or in area with very high outdoor humidity that may result in severe condensation in the heat exchanger during cooling operation.

## Minimum mixed air temperature (heating) (48GE units only)

Using the factory settings, the minimum temperatures for mixed air (the combined temperature of the warm return air and the cold outdoor air) entering the dimpled gas heat exchangers are shown in the following table.

### Minimum Temperature for Mixed Air Temperature

ALUMINIZED	STAINLESS STEEL
50°F (10°C) Continuous	40°F (4°C) Continuous
45°F (7°C) Intermittent	35°F (2°C) Intermittent

Operating at lower mixed-air temperatures may be possible if a field-supplied, outdoor-air thermostat initiates both heat stages when the temperature is less than the minimum temperatures listed above. Please contact your local Carrier representative for assistance.

## Minimum and maximum airflow (heating and cooling)

To maintain safe and reliable operation of your rooftop, operate within the heating airflow limits during heating mode and cooling airflow limits during cooling mode. Operating above the maximum may cause blow-off, undesired airflow noise, or airflow-related problems with the rooftop unit. Operating below the minimum may cause problems with coil freeze-up and unsafe heating operation. Heating and cooling limitations differ when evaluating

operating cfm. The minimum value is the HIGHER of the cooling and heating minimum cfm values published on page 8 and the maximum value is the LOWER of the cooling and heating maximum values published on page 8.

## Heating-to-cooling changeover

Your unit will automatically change from heating to cooling mode when using a thermostat with an auto-changeover feature.

## Airflow

All units are draw-through in cooling mode and blow-through in heating mode.

## Outdoor air application strategies

Economizers reduce operating expenses and compressor run time by providing a free source of cooling and a means of ventilation to match changing needs. In fact, they should be considered for most applications. Also, consider the various economizer control methods and their benefits, as well as sensors required to accomplish your application goals. Please contact your local Carrier representative for assistance.

## Motor limits, brake horsepower (bhp)

Due to the internal design of Carrier units, the air path, and specially designed motors, the full horsepower (maximum continuous bhp) band, as listed in the Fan Performance tables, can be used with the utmost confidence. There is no need for extra safety factors, as Carrier motors are designed and rigorously tested to use the entire listed bhp range without either nuisance tripping or premature motor failure.

## Propane heating (48GE units only)

Propane has different physical qualities than natural gas. As a result, propane requires a different fuel to air mixture. To optimize the fuel/air mixture for propane, Carrier sells different burner orifices in an easy-to-install accessory kit. To select the correct burner orifices or determine the heat capacity for a propane application, use either the selection software or the unit's service manual.

## High altitude heating

High altitudes have less oxygen, which affects the fuel/air mixture in heat exchangers. In order to maintain a proper fuel/air mixture, heat exchangers operating in altitudes above 2000 ft (610 m) require different orifices. To select the correct burner orifices or determine the heat capacity for a high altitude application, use either the selection software or the unit's service manual.

High altitudes have less oxygen, which means heat exchangers need less fuel. The new gas orifices in Carrier's field-installed kit make the necessary adjustment for high altitude applications. They restore the optimal fuel to air mixture and maintain healthy combustion at altitudes above 2000 ft (610 m).

NOTE: Typical natural gas heating value ranges from 975 to 1050 Btu/ft<sup>3</sup> at sea level nationally. The heating value goes down approximately 1.7% per every thousand feet of elevation. Standard factory orifices can typically be used up to 2000 ft (610 m) elevation without any operational issues.

## Sizing a rooftop

Bigger is not necessarily better — while an air conditioner needs to have enough capacity to meet the design loads, it does not need excess capacity. In fact, excess capacity typically results in very poor part load performance and humidity control.

Using higher design temperatures than ASHRAE recommends for your location and adding “safety factors” to the calculated load are both signs of oversizing. Oversizing an air conditioner leads to poor humidity control, reduced

efficiency, higher utility bills, larger indoor temperature swings, excessive noise, and increased wear and tear on the air conditioner.

Rather than oversizing an air conditioner, engineers should “right-size” or even slightly “under-size” air conditioners. Correctly sizing an air conditioner controls humidity better, promotes efficiency, reduces utility bills, extends equipment life, and maintains even, comfortable temperatures. Please contact your local Carrier representative for assistance.

Note about this specification:

This specification is in the “Masterformat” as published by the Construction Specification Institute. Please feel free to copy this specification directly into your building spec.



## Gas Heat/Electric Cooling Packaged Rooftop

### HVAC Guide Specifications

Size Range: **15 to 25 Nominal Tons**

Carrier Model Number: **48GE\*17-28 — Three Stage**

### Part 1 — (23 06 80) Schedules for Decentralized HVAC Equipment

1.01 (23 06 80.13) Decentralized Unitary HVAC Equipment Schedule

- A. (23 06 80.13.A.) Rooftop Unit (RTU) Schedule:  
Schedule is per the project specification requirements.

### Part 2 — (23 07 16) HVAC Equipment Insulation

2.01 (23 07 16.13) Decentralized, Rooftop Units:

- A. (23 07 16.13.A.) Evaporator Fan Compartment:
1. Interior cabinet surfaces shall be insulated with a minimum 1/2 in. thick, minimum 1-1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, neoprene coated on the air side.
  2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
- B. (23 07 16.13.B.) Gas Heat Compartment:
1. Aluminum foil-faced fiberglass insulation shall be used.
  2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

### Part 3 — (23 09 13) Instrumentation and Control Devices for HVAC

3.01 (23 09 13.23) Sensors and Transmitters

- A. (23 09 13.23.A.) Thermostats:
1. Thermostat must:
    - a. energize both “W” and “G” when calling for heat.
    - b. have capability to energize 3 stages of cooling, and 2 different stages of heating.
    - c. include capability for occupancy scheduling.

### Part 4 — (23 09 23) Direct Digital Control system for HVAC

4.01 (23 09 23.13) Decentralized, Rooftop Units:

- A. (23 09 23.13.A.) SystemVu™ intelligent integrated Direct Digital Control (DDC) shall provide:
1. Integrated unit operation for comfort cooling, heating ventilation as well as all monitoring, recording and reporting capabilities. Controller shall also provide diagnostics and alarms of abnormal unit operation through the controller. Controller shall have an intuitive user display and be able to be used in a standalone operation or via building automation system (BAS).
  2. Quick Unit Status LEDs of: RUN — meaning all systems are go, ALERT — that indicates there is currently a non-critical issue with the unit, like filters need to be replaced and FAULT — that indicates the unit has a critical issue and will possibly shut down.
  3. Six large navigation keys for easy access. Navigation keys shall consist of: TEST, BACK, ENTER, and MENU along with UP and DOWN arrows.
  4. Full back lit user display with 4 line by 30 character text capabilities. Display menu shall be designed to provide guided major menus and sub menus main menus provided below:
    - a. Shutdown Unit
    - b. Run Status
    - c. Settings
    - d. Alerts/Faults
    - e. Service
    - f. Inputs
    - g. Outputs
    - h. USB
  5. The capability for standalone operation with conventional thermostat/sensor or use with building automation systems (BAS) of Carrier i-Vu®, BACnet®<sup>1</sup> and Carrier Comfort Network® (CCN) systems. No special modules or boards are required for these capabilities. Has the capability to work with Equipment Touch™ and System Touch™ devices and ZS Sensors.
  6. The ability to read refrigerant pressures at display or via BAS network of Discharge Pressure and Suction Pressure. The need for traditional refrigerant gauges is not required.
  7. USB Data Port for flash drive interaction. This will allow the transfer of data for uploads, downloads, perform software upgrades, back-up and restore data and file transfer data such as component number of starts and run hours.
  8. Reverse Rotation Protection of compressors if field 3-phase wiring is misapplied.

1. Third-party trademarks and logos are the property of their respective owners.

9. Provide Service Capabilities of:
  - a. Auto run test
  - b. Manual run test
  - c. Component run hours and starts
  - d. Commissioning reports
  - e. Data logging
  - f. Alarm history
10. Economizer control and diagnostics. Set up economizer operation, receive feedback from actuator. Also meets the most recent California Title 24, ASHRAE<sup>®1</sup> 90.1 and IECC<sup>®1</sup> Fault Detection and Diagnostic (FDD) requirements.
11. Unit cooling operation down to -10°F (-23°C).
12. Controller shall have easy access connections around the controller perimeter area and consist of Mate-N-Lok<sup>®1</sup>, terminal block and RJ style modular jack connections.
13. 365 day real time clock, 20 holiday schedules along with occupied and unoccupied scheduling.
14. Auto-Recognition for easy installation and commissioning of devices like economizers, space sensors etc.
15. A 5°F (3°C) temperature difference between cooling and heating setpoints to meet the latest ASHRAE 90.1 Energy Standard.
16. Return air sensor, supply air sensor and outdoor air sensor to help monitor and provide data for the unit comfort operation, diagnostic and alarms.
17. Use of Carrier's field accessory Equipment Touch and System Touch devices.
18. Units with the factory-installed Humidi-MiZer<sup>®</sup> system option are capable of providing multiple modes of improved dehumidification as a variation of the normal cooling cycle.
19. Supply Air Tempering control operates the gas or electric heat to maintain a minimum supply air temperature during conditions where very cold outdoor air causes the supply air temperature to fall below the configured Supply Air Tempering Setpoint. This occurs during periods where DCV is active and increasing the amount of outdoor air or in cases where the system is operating at very low airflow and the calculated economizer position has increased to maintain a constant ventilation rate.
20. Demand limiting in SystemVu is achieved through setpoint expansion. The systems heating and cooling setpoints are expanded in steps or levels. The degree to which the setpoints may be expanded is defined by the 6 demand level offsets and the 2 commanded demand limit levels
21. 3-year limited part warranty.

## Part 5 — (23 09 33) Electric and Electronic Control System for HVAC

### 5.01 (23 09 33.13) Decentralized, Rooftop Units:

#### A. (23 09 33.13.A.) General:

1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side. Transformer shall have 75VA capability.
2. Shall utilize color-coded wiring.
3. Shall include a SystemVu Controller to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, gas controller, economizer, thermostat, and low and high pressure switches.
4. The heat exchanger shall be controlled by an integrated gas controller (IGC) microprocessor. See heat exchanger section of this specification.
5. Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.

#### B. (23 09 33.13.B.) Safeties:

1. Compressor over-temperature, over-current. High internal pressure differential.
2. Low Pressure Switch:  
Low pressure switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
3. High Pressure Switch:  
High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
4. Mixed Air Auto Reset Temperature Switch:  
All cooling units contain a low return air (or mixed air - depending on unit configuration) temperature switch for compressor protection. The switch prevents compressor operation at mixed air temperatures below 60°F (15°C) to ensure long term reliability but allows continued fan and economizer operation (if in-stalled). The switch will automatically reset when the return/mixed air temperature warms above 65°F (18°C) and will allow compressor operation to continue.
5. Automatic reset, motor thermal overload protector.
6. Heating section shall be provided with the following minimum protections:
  - a. High temperature limit switches.
  - b. Induced draft motor pressure switch.
  - c. Flame rollout switch.
  - d. Flame proving controls.

1. Third-party trademarks and logos are the property of their respective owners.

7. A2L Refrigerant Leak Dissipation System (SystemVu):
  - a. Leak dissipation system shall consist of control board and A2L sensor certified to UL-60335-2-40, integrated with SystemVu controller.
  - b. System shall be designed for the life of the unit.
  - c. Dissipation system shall be automatic, ship pre-wired, and require no additional field connections to function.
  - d. Refrigerant leak sensor shall be installed in UL-certified location and orientation. Sensor shall be self-correcting and resettable. Single use refrigerant leak sensor shall not be permitted.
  - e. Factory-installed dissipation system shall use onboard microprocessor and include:
    - 1) Automatic leak detection and dissipation algorithm.
    - 2) Automatic reset after a dissipation event has occurred.
    - 3) Onboard LED with flash code to indicate current unit status and hardware failures.
    - 4) Depressible “Test” button to allow for a system test and recall/reset of leak detection history.
    - 5) 24-v dry contact alarm terminal on dissipation control board to allow for external notification of leak detection.
    - 6) Ability to notify BAS system of dissipation event via readable alarm point through SystemVu.
    - 7) Recallable dissipation alarm history on SystemVu controller.
  - f. Dissipation control board shall be accessible via normal maintenance locations and LED shall be visible.
  - g. Dissipation system shall “Fail Safe” per UL requirements.
  - h. Dissipation shall allow smoke and building fire systems to override in case of event.

## Part 6 — (23 09 93) Sequence of Operation for HVAC Controls

6.01 (23 09 93.13) Decentralized, Rooftop Units:

- A. (23 09 93.13.A.) INSERT SEQUENCE OF OPERATION

## Part 7 — (23 40 13) Panel Air Filters

7.01 (23 40 13.13) Decentralized, Rooftop Units:

- A. (23 40 13.13.A.) Standard Filter Section:
  1. Shall consist of factory installed, low velocity, disposable 2 in. thick fiberglass filters of commercially available sizes.
  2. Unit shall use only one filter size. Multiple sizes are not acceptable.

3. Filters shall be accessible through an access panel with “no-tool” removal as described in the unit cabinet section of this specification (23 81 19.13.G).

## Part 8 — (23 81 19) Self-Contained Air Conditioners

8.01 (23 81 19.13) Small-Capacity Self-Contained Air Conditioners:

- A. (23 81 19.13.A.) General:
  1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a fully hermetic scroll compressor(s) for cooling duty and gas combustion for heating duty.
  2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
  3. Unit shall use Puron Advance™ (R-454B) refrigerant.
  4. Unit shall be installed in accordance with the manufacturer’s instructions.
  5. Unit must be selected and installed in compliance with local, state, and federal codes.
- B. (23 81 19.13.B.) Quality Assurance:
  1. Unit meets DOE and ASHRAE 90.1 minimum efficiency requirements.
  2. Unit shall be rated in accordance with AHRI Standards 340/360.
  3. Unit shall be designed to conform to ASHRAE 15.
  4. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
  5. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
  6. Unit casing shall be capable of withstanding 500 hour salt spray exposure per ASTM B117 (scribed specimen).
  7. Unit shall be designed in accordance with ISO 9001, and shall be manufactured in a facility registered by ISO 9001:2015.
  8. Roof curb shall be designed to conform to NRCA Standards.
  9. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
  10. Unit shall be designed in accordance with UL Standard 600335-1 and 60335-2-40, to withstand rain. Unit shall be IPX4 rated.
  11. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.
  12. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.

- C. (23 81 19.13.C.) Delivery, Storage, and Handling:
  - 1. Unit shall be stored and handled per manufacturer's recommendations.
  - 2. Lifted by crane requires either shipping top panel or spreader bars.
  - 3. Unit shall only be stored or positioned in the upright position.
- D. (23 81 19.13.D.) Project Conditions:
  - 1. As specified in the contract.
- E. (23 81 19.13.E.) Operating Characteristics:
  - 1. Unit shall be capable of starting and running at 125°F (52°C) ambient outdoor temperature meeting maximum load criteria of AHRI Standard 340/360 at ±10% voltage.
  - 2. Compressor with standard controls shall be capable of operation down to -10°F (-23°C) ambient outdoor temperatures.
  - 3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
  - 4. Unit shall be factory configured for vertical supply and return configurations or horizontal supply and return configurations. Unit shall not require field conversion.
- F. (23 81 19.13.F.) Electrical Requirements:
  - 1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.
- G. (23 81 19.13.G.) Unit Cabinet:
  - 1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a prepainted baked enamel finish on all externally exposed surfaces.
  - 2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 inches minimum, gloss (per ASTM D523, 60°F/16°C): 60, Hardness: H-2H Pencil hardness.
  - 3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2 in. thick, 1 lb density, flexible fiberglass insulation, neoprene coated on the air side. Aluminum foil-faced fiberglass insulation shall be used in the heat compartment.
  - 4. Base of unit shall have a minimum of 4 locations for thru-the-base gas and electrical connections (factory-installed or field-installed), standard.
  - 5. Base Rail:
    - a. Unit shall have base rails on a minimum of 2 sides.
    - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
    - c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
  - d. Base rail shall be a minimum of 16 gauge thickness.
- 6. Condensate Pan and Connections:
  - a. Shall be a sloped condensate drain pan made of a corrosion resistant material.
  - b. Shall comply with ASHRAE Standard 62.
  - c. Shall use a 3/4 in. 14 NPT drain connection, possible either through the side of the drain pan. Connection shall be made per manufacturer's recommendations.
- 7. Top Panel:
  - a. Shall be a multi-top panel linked with water-tight flanges and locking systems.
- 8. Gas Connections:
  - a. All gas piping connecting to unit gas valve shall enter the unit cabinet at a single location on side of unit (horizontal plane).
  - b. Thru-the-base capability.
    - 1) Standard unit shall have thru-the-base gas-line location using a raised, embossed portion of the unit basepan standard.
    - 2) No basepan penetration, other than those authorized by the manufacturer, is permitted.
- 9. Electrical Connections:
  - a. All unit power wiring shall enter unit cabinet at a single, factory prepared, knockout location.
  - b. Thru-the-base capability.
    - 1) Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
    - 2) No basepan penetration, other than those authorized by the manufacturer, is permitted.
- 10. Component Access Panels (standard):
  - a. Cabinet panels shall be easily removable for servicing.
  - b. Unit shall have one factory installed, tool-less, filter access panel.
  - c. Panels covering control box, indoor fan, indoor fan motor, gas components (where applicable), and compressors shall have molded composite handles.
  - d. Handles shall be UV modified, composite. They shall be permanently attached, and recessed into the panel.
  - e. Screws on the vertical portion of all removable access panel shall engage into heat resistant, molded composite collars.
  - f. Collars shall be removable and easily replaceable using manufacturer recommended parts.

## H. (23 81 19.13.H.) Gas Heat:

### 1. General:

- a. Heat exchanger shall be an induced draft design. Positive pressure heat exchanger designs shall not be allowed.
- b. Shall incorporate a direct-spark ignition system and redundant main gas valve.
- c. Gas supply pressure at the inlet to the rooftop unit gas valve must match that required by the manufacturer.

### 2. The heat exchanger shall be controlled by an integrated gas controller (IGC) microprocessor:

- a. IGC board shall notify users of fault using an LED (light-emitting diode).
- b. The LED shall be visible without removing the control box access panel.
- c. IGC board shall contain algorithms that modify evaporator fan operation to prevent future cycling on high temperature limit switch.
- d. Unit shall be equipped with anti-cycle protection with one short cycle on unit flame rollout switch or 4 continuous short cycles on the high temperature limit switch. Fault indication shall be made using an LED.

### 3. Standard Heat Exchanger Construction:

- a. Heat exchanger shall be of the tubular-section type constructed of a minimum of 20 gauge steel coated with a nominal 1.2 mil aluminum-silicone alloy for corrosion resistance.
- b. Burners shall be of the in-shot type constructed of aluminum-coated steel.
- c. Burners shall incorporate orifices for rated heat output up to 2000 ft (610 m) elevation. Additional accessory kits may be required for applications above 2000 ft (610 m) elevation, depending on local gas supply conditions.
- d. Each heat exchanger tube shall contain multiple dimples for increased heating effectiveness.

### 4. Optional Stainless Steel Heat Exchanger Construction:

- a. Use energy saving, direct-spark ignition system.
- b. Use a redundant main gas valve.
- c. Burners shall be of the in-shot type constructed of aluminum-coated steel.
- d. All gas piping shall enter the unit cabinet at a single location on side of unit (horizontal plane).
- e. The optional stainless steel heat exchanger shall be of the tubular-section type, constructed of a minimum of 20 gauge type 409 stainless steel.
- f. Type 409 stainless steel shall be used in heat exchanger tubes and vestibule plate.

- g. Complete stainless steel heat exchanger allows for greater application flexibility.

### 5. Induced Draft Combustion Motor and Blower:

- a. Shall be a direct-drive, single inlet, forward-curved centrifugal type.
- b. Shall be made from steel with a corrosion resistant finish.
- c. Shall have permanently lubricated sealed bearings.
- d. Shall have inherent thermal overload protection.
- e. Shall have an automatic reset feature.

## I. (23 81 19.13.I.) Coils:

### 1. Standard Aluminum Fin-Copper Tube Coils:

- a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally helical grooved copper tubes with all joints brazed.
- b. Evaporator coils shall be leak tested to 150 psig, pressure tested to 450 psig, and qualified to UL 60335-2-40 burst test at 1775 psig.
- c. Condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to UL 60335-2-40 burst test at 1980 psig.

### 2. Optional Pre-coated Aluminum-Fin Condenser Coils:

- a. Shall have a durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments.
- b. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.
- c. Epoxy-phenolic barrier shall minimize galvanic action between dissimilar metals.
- d. Corrosion durability of fin stock shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117.
- e. Corrosion durability of fin stock shall be confirmed through testing to have no visible corrosion after 48 hour immersion in a room temperature solution of 5% salt, 1% acetic acid.
- f. Fin stock coating shall pass 2000 hours of the following: one week exposure in the prohesion chamber followed by one week of accelerated ultraviolet light testing. Prohesion chamber: the solution shall contain 3.5% sodium chloride and 0.35% ammonium sulfate. The exposure cycle is one hour of salt fog application at ambient followed by one hour drying at 95°F (35°C).

3. Optional Copper-fin Evaporator and Condenser Coils:
  - a. Shall be constructed of copper fins mechanically bonded to copper tubes and copper tube sheets.
  - b. Galvanized steel tube sheets shall not be acceptable.
  - c. A polymer strip shall prevent coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan.
4. Optional E-coated Aluminum-Fin Evaporator and Condenser Coils:
  - a. Shall have a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins.
  - b. Coating process shall ensure complete coil encapsulation of tubes, fins and headers.
  - c. Color shall be high gloss black with gloss per ASTM D523-89.
  - d. Uniform dry film thickness from 0.8 to 1.2 mil on all surface areas including fin edges.
  - e. Superior hardness characteristics of 2H per ASTM D3363- and cross-hatch adhesion of 4B-5B per ASTM D3359.
  - f. Impact resistance shall be up to 160 in. lb (ASTM D2794).
  - g. Humidity and water immersion resistance shall be up to minimum 1000 and 250 hours respectively (ASTM D2247 and ASTM D870).
  - h. Corrosion durability shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117.
- J. (23 81 19.13.J.) Refrigerant Components:
  1. Refrigerant circuit shall include the following control, safety, and maintenance features:
    - a. Thermostatic Expansion Valve (TXV) shall help provide optimum performance across the entire operating range. Shall contain removable power element to allow change out of power element and bulb without removing the valve body.
    - b. Refrigerant filter drier — Solid core design with pre and post filter service gauge connections for filter diagnostics and maintenance.
    - c. Service gauge connections on suction and discharge lines.
    - d. Pressure gauge access through a specially designed access port in the unit.
  2. There shall be gauge line access port in the skin of the rooftop, covered by a black, removable plug.
    - a. The plug shall be easy to remove and replace.
    - b. When the plug is removed, the gauge access port shall enable maintenance personnel to route their pressure gauge lines.
      - c. This gauge access port shall facilitate correct and accurate condenser pressure readings by enabling the reading with the compressor access panel on.
      - d. The plug shall be made of leak proof, UV-resistant, composite material.
3. Compressors:
  - a. Unit shall use tandem scroll compressor assembly on single independent refrigeration circuit with three stages of cooling for efficient comfort cooling operation.
  - b. Evaporator coils shall be a full active design to help better control latent removal and minimize unconditioned bypass air.
  - c. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
  - d. Compressors shall be internally protected from high discharge temperature conditions.
  - e. Compressors shall be protected from an over-temperature and over-ampereage conditions by an internal, motor overload device.
  - f. Compressor shall be factory-mounted on rubber grommets.
  - g. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
  - h. Crankcase heaters shall not be required for normal operating range, unless required by the manufacturer due to refrigerant charge limits.
- K. (23 81 19.13.K.) Filter Section:
  1. Filters access is specified in the unit cabinet section of this specification.
  2. Filters shall be held in place by a pivoting filter tray, facilitating easy removal and installation.
  3. Shall consist of factory installed, low velocity, throw-away 2 in. thick fiberglass filters.
  4. Filters shall be standard, commercially available sizes.
  5. Only one size filter per unit is allowed.
- L. (23 81 19.13.L.) Evaporator Fan and Motor with EcoBlue™ Technology:
  1. Direct Drive Evaporator Fan Motor:
    - a. Shall be a ECM motor design.
    - b. Shall be direct drive design for all static options.
    - c. Shall have permanently lubricated bearings.
    - d. Shall have inherent automatic-reset thermal overload protection.
    - e. Shall have slow ramp up to speed capabilities.
    - f. Shall require no fan/motor belts for operation, adjustments and or initial fan speed set up.
    - g. Fan DC voltage set up on the SystemVu controller shall eliminate the need of

removal of blower access door, required on conventional belt drive systems.

- h. Shall be internally protected from electrical phase reversal.

## 2. Evaporator Fan:

- a. Speed shall be easily set through SystemVu controller.
- b. Shall provide 3 stage cooling capacity control, the indoor fan speed is automatically controlled to meet the code-compliant 40% low fan speed, 60% medium fan speed, and 100% at full fan speed operation.
- c. Blower fans shall be a Vane Axial fan design with fan assembly secured directly to ECM motor. Additional shafts, belts, pulleys/sheaves, and bearing blocks to drive fan shall not be permitted or necessary.
- d. Additional variable frequency drive to control fan motor speed shall not be permitted or necessary. All speed control electronics must be onboard fan motor assembly.
- e. Shall be constructed of a high impact composite material on stator, rotor and air inlet casing.
- f. Shall be a patented / pending design with a corrosion resistant material.
- g. Fan assembly design shall be integrated to fan deck, dynamically balanced, and require no additional vibration isolation for normal operation.
- h. Shall have slow ramp up to speed capabilities to help reduce sound and comfort issues typically associated with single speed belt drive systems.
- i. Units shall contain 2 separate vane axial fan assemblies.
- j. Shall be a slide out design with removal of a few support brackets.

- 3. Shall include an easily accessible SystemVu Board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, gas controller, economizer, thermostat, DDC control options, and low and high pressure switches. Controller shall also provide an intuitive means to adjust the indoor fan speed.

## M. (23 81 19.13.M.) Condenser Fans and Motors:

- 1. Condenser Fan Motors:
  - a. Shall be a totally enclosed ECM motor.
  - b. Shall use permanently lubricated bearings.
  - c. Shall have inherent thermal overload protection with an automatic reset feature.
  - d. Shall use a shaft-down design on all sizes.
- 2. Condenser Fans:
  - a. Shall be a direct-driven propeller type fan.

- b. Shall have galvalum blades riveted to steel spider that have corrosion-resistant properties and shall be dynamically balanced.

## N. (23 81 19.13.N.) Special Features Options and Accessories:

- 1. Integrated EconoMi\$er® 2 Low Leak Rate Models.
  - a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
  - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory installed option.
  - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
  - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below set points.
  - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
  - f. Low leak rate shall be equipped with dampers not to exceed 2% leakage at 1 in. wg pressure differential.
  - g. Economizer controller on EconoMi\$er 2 models with SystemVu controllers shall be a 4 to 20 mA design controlled directly by the controller. SystemVu controllers meet California Title 24, ASHRAE 90.1, and IECC Fault Detection and Diagnostic (FDD) requirements.
  - h. Shall be capable of introducing up to 100% outdoor air.
  - i. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
  - j. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
  - k. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory-installed economizers only. Outdoor air sensor setpoint shall be adjustable and shall range from 40°F to 100°F (4°C to 38°C). Additional sensor options shall be available as accessories.
  - l. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
  - m. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.

- n. Dampers shall be completely closed when the unit is in the unoccupied mode.
  - o. Economizer controller shall accept a 0 to 10 vdc CO<sub>2</sub> sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
  - p. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
  - q. Contains LED indicators for free cooling, sensor, and damper operation.
2. Integrated EconoMi\$er 2 Ultra Low Leak Rate Models.
- a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
  - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory installed option.
  - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
  - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below set points.
  - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
  - f. Ultra Low Leak design meets California Title 24 section 140.4 and ASHRAE 90.1 requirements for 4 cfm per sq ft on the outside air dampers and 10 cfm per sq ft on the return dampers.
  - g. Economizer controller on EconoMi\$er<sup>®</sup> 2 models with SystemVu controllers shall be a 4 to 20 mA design controlled directly by the controller. SystemVu controllers meet California Title 24, ASHRAE 90.1, and IECC Fault Detection and Diagnostic (FDD) requirements.
  - h. Shall be capable of introducing up to 100% outdoor air.
  - i. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
  - j. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
  - k. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory-installed economizers only. Outdoor air sensor setpoint shall be adjustable and shall range from 40°F to 100°F (4°C to 38°C). Additional sensor options shall be available as accessories.
- l. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
  - m. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
  - n. Dampers shall be completely closed when the unit is in the unoccupied mode.
  - o. Economizer controller shall accept a 0 to 10 vdc CO<sub>2</sub> sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
  - p. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
  - q. Contains LED indicators for free cooling, sensor, and damper operation.
3. Two-Position Damper (Field-installed only):
- a. Damper shall be a Two-Position Damper. Damper travel shall be from the full closed position to the field adjustable %-open set-point.
  - b. Damper shall include adjustable damper travel from 25% to 100% (full open).
  - c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
  - d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.
  - e. Damper will admit up to 100% outdoor air for applicable rooftop units.
  - f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
  - g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
  - h. Outside air hood shall include aluminum water entrainment filter.
4. Manual Damper (Field-installed only):
- Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 25 or 50% outdoor air for year round ventilation.
5. Humidi-MiZer<sup>®</sup> Adaptive Dehumidification System:
- The Humidi-MiZer Adaptive Dehumidification System shall be factory installed and shall provide greater dehumidification of the occupied space by 2 modes of dehumidification operations in addition to its normal design cooling mode:
- a. Subcooling mode further sub cools the hot liquid refrigerant leaving the condenser coil

when both temperature and humidity in the space are not satisfied.

- b. Hot gas reheat mode shall mix a portion of the hot gas from the discharge of the compressor with the hot liquid refrigerant leaving the condenser coil to create a 2-phase heat transfer in the system, resulting in a neutral leaving air temperature when only humidity in the space is not satisfied.
6. Propane Conversion Kit:
    - a. Package shall contain all the necessary hardware and instructions to convert a standard natural gas unit for use with liquefied propane, up to 2000 ft (610 m) elevation.
    - b. Additional accessory kits may be required for applications above 2000 ft (610 m) elevation.
  7. Condenser Coil Hail Guard Assembly (Factory or field installed):
    - a. Shall protect against hail and additional coil damage.
    - b. Shall be louvered type.
  8. Unit-Mounted, Non-Fused Disconnect Switch:
    - a. Available on 15 to 25 ton units with FLA of 100 amps (460/575V) or 200 amps or less (208/230V).
    - b. Switch shall be factory installed, internally mounted.
    - c. National Electric Code (NEC) and UL approved non-fused switch shall provide unit power shutoff.
    - d. Shall be accessible from outside the unit.
    - e. Shall provide local shutdown and lockout capability.
    - f. Sized **only** for the unit as ordered from the factory. Does not accommodate field-installed devices.
  9. HACR Breaker:
    - a. These manual reset devices provide overload and short circuit protection for the unit. Factory wired and mounted with the units, with access cover to help provide environmental protection. On 575V applications, HACR breaker can only be used with WYE power distribution systems. Use on Delta power distribution systems is prohibited.
    - b. Sized **only** for the unit as ordered from the factory. Does not accommodate field-installed devices.
  10. Convenience Outlet:
    - a. Factory-Installed Powered Convenience Outlet.
      - 1) Outlet shall be powered from main line power to the rooftop unit.
      - 2) Outlet shall be powered from line side or load side of disconnect by installing contractor, as required by code. If outlet is powered from load side of disconnect, unit electrical ratings shall be UL certified and rated for additional outlet amperage.
      - 3) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
      - 4) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
      - 5) Voltage required to operate convenience outlet shall be provided by a factory installed step-down transformer.
      - 6) Outlet shall be accessible from outside the unit.
      - 7) Outlet shall include a field installed “Wet in Use” cover.
    - b. Factory-Installed Non-Powered Convenience Outlet.
      - 1) Outlet shall be powered from a separate 115/120v power source.
      - 2) A transformer shall not be included.
      - 3) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
      - 4) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
      - 5) Outlet shall be accessible from outside the unit.
      - 6) Outlet shall include a field installed “Wet in Use” cover.
    - c. Field-Installed Non-Powered Convenience Outlet.
      - 1) Outlet shall be powered from a separate 115/120v power source.
      - 2) A transformer shall not be included.
      - 3) Outlet shall be field-installed and internally mounted with easily accessible 115-v female receptacle.
      - 4) Outlet shall include 20 amp GFI receptacles. This kit provides a flexible installation method which allows code compliance for height requirements of the GFCI outlet from the finished roof surface as well as the capability to relocate the outlet to a more convenient location.
      - 5) Outlet shall be accessible from outside the unit.
      - 6) Outlet shall include a field installed “Wet in Use” cover.
  11. Flue Discharge Deflector:
    - a. Flue discharge deflector shall direct unit exhaust vertically instead of horizontally.

- b. Deflector shall be defined as a “natural draft” device by the National Fuel and Gas (NFG) code.
- 12. Thru-the-Base Connectors:
  - a. Shall provide connectors to permit gas and electrical connections to be brought to the unit through the unit basepan.
  - b. Minimum of 4 connection locations per unit.
- 13. Centrifugal Fan Power Exhaust:
  - a. Power exhaust shall be used in conjunction with an integrated economizer.
  - b. Horizontal power exhaust shall be mounted in return ductwork.
  - c. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0 to 100% adjustable setpoint on the economizer control.
- 14. Roof Curbs (Vertical):
  - a. Full perimeter roof curb with exhaust capability providing separate air streams for energy recovery from the exhaust air without supply air contamination.
  - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
  - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
- 15. High Altitude Gas Conversion Kit:

Package shall contain all the necessary hardware and instructions to convert a standard natural gas unit to operate from 2000 to 7000 ft (610 to 2134 m) elevation with natural gas or from 0 to 7000 ft (0 to 2134 m) elevation with liquefied propane.
- 16. Outdoor Air Enthalpy Sensor:

The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
- 17. Return Air Enthalpy Sensor:

The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
- 18. Indoor Air Quality (CO<sub>2</sub>) Sensor:
  - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
  - b. The IAQ sensor shall be available in duct mount, wall mount, or wall mount with LED display. The setpoint shall have adjustment capability.
- 19. Smoke Detectors:
  - a. Shall be a 4-Wire Controller and Detector.
  - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
  - c. Shall use magnet-activated test/reset sensor switches.
  - d. Shall have tool-less connection terminal access.
  - e. Shall have a recessed momentary switch for testing and resetting the detector.
  - f. Controller shall include:
    - 1) One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
    - 2) Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
    - 3) One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
    - 4) Capable of direct connection to 2 individual detector modules.
    - 5) Can be wired to up to 14 other duct smoke detectors for multiple fan shut-down applications.
- 20. Hinged Access Panels:
  - a. Shall provide easy access through integrated quarter turn latches.
  - b. Shall be on major panels of: filter, control box, fan motor, and compressor.
- 21. Condensate Overflow Switch:

The sensor and related controller monitors the condensate level in the drain pan and shuts down compression operation when overflow conditions occur. It includes:

  - a. Indicator light — solid red (more than 10 seconds on water contact — compressors disabled), blinking red (sensor disconnected).
  - b. 10 second delay to break — eliminates nuisance trips from splashing or eaves in pan (sensor needs 10 seconds of constant water contact before tripping).
  - c. Disables the compressor(s) operation when condensate plug is detected, but still allows fans to run for Economizer.
- 22. Foil Faced Insulation:
  - a. Throughout unit cabinet air stream, non-fibrous and cleanable foil faced insulation is used.
- 23. MERV-13 — 4 in. Return Air Filters (Factory Installed Only):
  - a. Factory option to upgrade standard unit filters to 4 in. MERV-13 filters.
  - b. Upgrade option shall include factory installed 4 in. Filter Rack kit.

24. 4 in. Return Air Rack (Field Installed Only);
  - a. Accessory kit is designed to hold 4 in. MERV-8 or MERV-13 filters. Filters not included in kit.
25. 2 in. MERV-13 Return Air Filters:
  - a. Accessory kit to field upgrade standard unit filters to 2 in. MERV-13 filters.
  - b. Correct size and quantity of filters shall ship in a single box.
26. 2 in. MERV-8 Return Air filters:
  - a. Accessory kit to field upgrade standard unit filters to 2 in. MERV-8 filters.
  - b. Correct size and quantity of filters shall ship in a single box.
27. Phase Monitor Control:
  - a. Shall monitor the sequence of 3-phase electrical system to provide a phase reversal protection.
  - b. Shall monitor the 3-phase voltage inputs to provide a phase loss protection for the 3-phase device.
  - c. Will work on either a Delta or Wye power connection.
28. Horn/Strobe Annunciator:
  - a. Provides an audible/visual signaling device for use with factory-installed option or field installed accessory smoke detectors.
  - b. Requires installation of a field-supplied 24-v transformer suitable for 4.2 VA (AC) or 3.0 VA (DC) per horn/strobe accessory.
- c. Requires field-supplied electrical box, North American 1-gang box, 2 in. x 4 in. (51 mm x 102 mm).
- d. Shall have a clear colored lens.
29. High Short Circuit Current Rating (SCCR) Protection:
  - a. Factory-installed option shall provide high short circuit current protection to compressor and all indoor and outdoor fan motors rated at is 208/230V = 60kA, 460V = 65kA against high potential fault current situations. (Standard unit comes with 5 kA rating.)
  - b. This option is not available with factory installed Humidi-MiZer system, Powered Convenience Outlet, Non-Fused Disconnect, Phase Loss monitor/protection and 575 Volt models.
30. Pressure Relief Valve:
  - a. Units with the factory-installed pressure relief option contain a pressure relief valve in the unit liquid line for compliance with Chicago Municipal Code 18-28-1102.3.
  - b. The pressure relief valve is set to open above 650 PSI and is intended to vent refrigerant in the event the refrigerant pressure exceeds the equipment design pressure.
  - c. The pressure relief valve is single use and must be replaced after refrigerant discharge.

Note about this specification:

This specification is in the “Masterformat” as published by the Construction Specification Institute. Please feel free to copy this specification directly into your building spec.



## Electric Cooling Packaged Rooftop

### HVAC Guide Specifications

Size Range: **15 to 25 Nominal Tons**

Carrier Model Number: **50GE\*17-28 — Three Stage**

#### Part 1 — (23 06 80) Schedules for Decentralized HVAC Equipment

1.01 (23 06 80.13) Decentralized Unitary HVAC Equipment Schedule:

- A. (23 06 80.13.A.) Rooftop Unit (RTU) Schedule:  
Schedule is per the project specification requirements.

#### Part 2 — (23 07 16) HVAC Equipment Insulation

2.01 (23 07 16.13) Decentralized, Rooftop Units:

- A. (23 07 16.13.A.) Evaporator Fan Compartment:
  1. Interior cabinet surfaces shall be insulated with a minimum 1/2 in. thick, minimum 1-1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, neoprene coated on the air side.
  2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
- B. (23 07 16.13.B.) Electric Heat Compartment:
  1. Aluminum foil-faced fiberglass insulation shall be used.
  2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

#### Part 3 — (23 09 13) Instrumentation and Control Devices for HVAC

3.01 (23 09 13.23) Sensors and Transmitters:

- A. (23 09 13.23.A.) Thermostats:
  1. Thermostat must:
    - a. energize both “W” and “G” when calling for heat.
    - b. have capability to energize 3 stages of cooling, and 2 different stages of heating.
    - c. include capability for occupancy scheduling.

#### Part 4 — (23 09 23) Direct Digital Control System for HVAC

4.01 (23 09 23.13) Decentralized, Rooftop Units:

- A. (23 09 23.13.A.) SystemVu™ intelligent integrated Direct Digital Control (DDC) shall provide:
  1. Integrated unit operation for comfort cooling, heating ventilation as well as all monitoring,

recording and reporting capabilities. Controller shall also provide diagnostics and alarms of abnormal unit operation through the controller. Controller shall have an intuitive user display and be able to be used in a standalone operation or via building automation system (BAS).

2. Quick Unit Status LEDs of: RUN — meaning all systems are go, ALERT — that indicates there is currently a non-critical issue with the unit, like filters need to be replaced and FAULT — that indicates the unit has a critical issue and will possibly shut down.
3. Six large navigation keys for easy access. Navigation keys shall consist of: TEST, BACK, ENTER, and MENU along with UP and DOWN arrows.
4. Full back lit user display with 4 line by 30 character text capabilities. Display menu shall be designed to provide guided major menus and sub menus main menus provided below:
  - a. Shutdown Unit
  - b. Run Status
  - c. Settings
  - d. Alerts/Faults
  - e. Service
  - f. Inputs
  - g. Outputs
  - h. USB
5. The capability for standalone operation with conventional thermostat/sensor or use with building automation systems (BAS) of Carrier i-Vu®, BACnet®<sup>1</sup> and Carrier Comfort Network® (CCN) systems. No special modules or boards are required for these capabilities. Has the capability to work with Equipment Touch™ and System Touch™ devices and ZS Sensors.
6. The ability to read refrigerant pressures at display or via BAS network of; Discharge Pressure and Suction Pressure. The need for traditional refrigerant gauges is not required.
7. USB Data Port for flash drive interaction. This will allow the transfer of data for uploads, downloads, perform software upgrades, backup and restore data and file transfer data such as component number of starts and run hours.
8. Reverse Rotation Protection of compressors if field 3-phase wiring is misapplied.
9. Provide service capabilities of:
  - a. Auto run test
  - b. Manual run test
  - c. Component run hours and starts
  - d. Commissioning reports
  - e. Data logging
  - f. Alarm history

---

1. Third-party trademarks and logos are the property of their respective owners.

10. Economizer control and diagnostics. Set up economizer operation, receive feedback from actuator. Also meets the most recent California Title 24, ASHRAE 90.1 and IECC<sup>®1</sup> Fault Detection and Diagnostic (FDD) requirements.
11. Unit cooling operation down to -10°F (-23°C).
12. Controller shall have easy access connections around the controller perimeter area and consist of Mate-N-Lok<sup>®1</sup>, terminal block and RJ style modular jack connections.
13. 365 day real time clock, 20 holiday schedules along with occupied and unoccupied scheduling.
14. Auto-Recognition for easy installation and commissioning of devices like economizers, space sensors, etc.
15. A 5°F (3°C) temperature difference between cooling and heating setpoints to meet the latest ASHRAE 90.1 Energy Standard.
16. Contains return air sensor, supply air sensor and outdoor air sensor to help monitor and provide data for the unit comfort operation, diagnostic and alarms.
17. Use of Carrier's field accessory Equipment Touch and System Touch devices.
18. Units with the factory-installed Humidi-MiZer<sup>®</sup> system option are capable of providing multiple modes of improved dehumidification as a variation of the normal cooling cycle.
19. Supply Air Tempering control operates the gas or electric heat to maintain a minimum supply air temperature during conditions where very cold outdoor air causes the supply air temperature to fall below the configured Supply Air Tempering Setpoint. This occurs during periods where DCV is active and increasing the amount of outdoor air or in cases where the system is operating at very low airflow and the calculated economizer position has increased to maintain a constant ventilation rate.
20. Demand limiting in SystemVu controller is achieved through set point expansion. The systems heating and cooling set points are expanded in steps or levels. The degree to which the set points may be expanded is defined by the 6 demand level offsets and the 2 commanded demand limit levels.
21. 3-year limited part warranty.

## Part 5 — (23 09 33) Electric and Electronic Control System for HVAC

### 5.01 (23 09 33.13) Decentralized, Rooftop Units:

#### A. (23 09 33.13.A.) General:

1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit

1. Third-party trademarks and logos are the property of their respective owners.

2. Shall utilize color-coded wiring.
  3. Shall include a SystemVu Controller to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, and low and high pressure switches.
  4. Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.
- B. (23 09 33.13.B.) Safeties:
1. Compressor over-temperature, over-current. High internal pressure differential.
  2. Low Pressure Switch.  
Low pressure switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
  3. High Pressure Switch.  
High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
  4. Mixed Air Auto Reset Temperature Switch.  
All cooling units contain a low return air (or mixed air - depending on unit configuration) temperature switch for compressor protection. The switch prevents compressor operation at mixed air temperatures below 60°F (16°C) to ensure long term reliability but allows continued fan and economizer operation (if installed). The switch will automatically reset when the return/mixed air temperature warms above 65°F (18°C) and will allow compressor operation to continue.
  5. Heating section shall be provided with the following minimum protections:  
High temperature limit switches.
  6. A2L Refrigerant Leak Dissipation System (SystemVu)
    - a. Leak dissipation system shall consist of control board and A2L sensor certified to UL 60335-2-40, integrated with SystemVu controller.
    - b. System shall be designed for the life of the unit.
    - c. Dissipation system shall be automatic, ship pre-wired, and require no additional field connections to function.
    - d. Refrigerant leak sensor shall be installed in UL certified location and orientation. Sensor shall be self-correcting and resettable. Single use refrigerant leak sensor shall not be permitted.

- e. Factory installed dissipation system shall use onboard microprocessor and include:
  - 1) Automatic leak detection and dissipation algorithm
  - 2) Automatic reset after a dissipation event has occurred
  - 3) Onboard LED with flash code to indicate current unit status and hardware failures
  - 4) Depressible “Test” button to allow for a system test and recall/reset of leak detection history
  - 5) 24V dry contact alarm terminal on dissipation control board to allow for external notification of leak detection
  - 6) Ability to notify BAS system of dissipation event via readable alarm point through SystemVu
  - 7) Recallable dissipation alarm history on SystemVu controller
- f. Dissipation control board shall be accessible via normal maintenance locations and LED shall be visible.
- g. Dissipation system shall “Fail Safe” per UL requirements.
- h. Dissipation shall allow smoke and building fire systems to override in case of event.
- 3. Unit shall use Puron Advance™ (R-454B) refrigerant.
- 4. Unit shall be installed in accordance with the manufacturer’s instructions.
- 5. Unit must be selected and installed in compliance with local, state, and federal codes.
- B. (23 81 19.13.B.) Quality Assurance:
  - 1. Unit meets DOE and ASHRAE 90.1 minimum efficiency requirements.
  - 2. Unit shall be rated in accordance with AHRI Standards 340/360.
  - 3. Unit shall be designed to conform to ASHRAE 15.
  - 4. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
  - 5. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
  - 6. Unit casing shall be capable of withstanding 500 hour salt spray exposure per ASTM B117 (scribed specimen).
  - 7. Unit shall be designed in accordance with ISO 9001, and shall be manufactured in a facility registered by ISO 9001:2015.
  - 8. Roof curb shall be designed to conform to NRCA Standards.
  - 9. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
  - 10. Unit shall be designed in accordance with UL Standard 60335-1 and 60335-2-40, including testing to with-stand rain. Unit shall be IPX4 rated.
  - 11. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.
  - 12. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.

## Part 6 — (23 09 93) Sequence of Operation for HVAC Controls

6.01 (23 09 93.13) Decentralized, Rooftop Units:

- A. (23 09 93.13.A.) INSERT SEQUENCE OF OPERATION

## Part 7 — (23 40 13) Panel Air Filters

7.01 (23 40 13.13) Decentralized, Rooftop Units:

- A. (23 40 13.13.A.) Standard Filter Section:
  - 1. Shall consist of factory installed, low velocity, disposable 2 in. thick fiberglass filters of commercially available sizes.
  - 2. Unit shall use only one filter size. Multiple sizes are not acceptable.
  - 3. Filters shall be accessible through an access panel with “no-tool” removal as described in the unit cabinet section of this specification (23 81 19.13.G).

## Part 8 — (23 81 19) Self-Contained Air Conditioners

8.01 (23 81 19.13) Small-Capacity Self-Contained Air Conditioners:

- A. (23 81 19.13.A.) General:
  - 1. Outdoor, rooftop mounted, electrically controlled, cooling unit utilizing fully hermetic scroll compressors for cooling duty.
  - 2. Factory assembled, single-piece cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
- C. (23 81 19.13.C.) Delivery, Storage, and Handling:
  - 1. Unit shall be stored and handled per manufacturer’s recommendations.
  - 2. Lifted by crane requires either shipping top panel or spreader bars.
  - 3. Unit shall only be stored or positioned in the upright position.
- D. (23 81 19.13.D.) Project Conditions:
  - 1. As specified in the contract.
- E. (23 81 19.13.E.) Operating Characteristics:
  - 1. Unit shall be capable of starting and running at 125°F (52°C) ambient outdoor temperature meeting maximum load criteria of AHRI Standard 340/360 at ±10% voltage.

2. Compressor with standard controls shall be capable of operation down to  $-10^{\circ}\text{F}$  ( $-23^{\circ}\text{C}$ ) ambient outdoor temperatures.
  3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
  4. Unit shall be factory configured for either vertical or horizontal supply and return configurations. Unit shall not require field conversion.
- F. (23 81 19.13.F.) Electrical Requirements:
1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.
- G. (23 81 19.13.G.) Unit Cabinet:
1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a prepainted baked enamel finish on all externally exposed surfaces.
  2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 in. minimum, gloss (per ASTM D523,  $60^{\circ}\text{F}/16^{\circ}\text{C}$ ): 60, Hardness: H-2H Pencil hardness.
  3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2 in. thick, 1 lb density, flexible fiberglass insulation, neoprene coated on the air side. Aluminum foil-faced fiberglass insulation shall be used in the heat compartment.
  4. Base of unit shall have a minimum of 4 locations for thru-the-base gas and electrical connections (factory-installed or field-installed), standard.
  5. Base Rail:
    - a. Unit shall have base rails on a minimum of 2 sides.
    - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
    - c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
    - d. Base rail shall be a minimum of 16 gauge thickness.
  6. Condensate Pan and Connections:
    - a. Shall be a sloped condensate drain pan made of a corrosion resistant material.
    - b. Shall comply with ASHRAE Standard 62.
    - c. Shall use a 3/4 in. 14 NPT drain connection, possible either through the bottom or side of the drain pan. Connection shall be made per manufacturer's recommendations.
  7. Top Panel:
    - a. Shall be a multi-top panel with watertight flanges and locking systems.
  8. Electrical Connections:
    - a. All unit power wiring shall enter unit cabinet at a single, factory prepared, knockout location.
    - b. Thru-the-base capability:
      - 1) Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
      - 2) No basepan penetration, other than those authorized by the manufacturer, is permitted.
  9. Component Access Panels (standard):
    - a. Cabinet panels shall be easily removable for servicing.
    - b. Unit shall have one factory installed, tool-less, removable, filter access panel.
    - c. Panels covering control box, indoor fan, indoor fan motor, gas components (where applicable), and compressors shall have molded composite handles.
    - d. Handles shall be UV modified, composite. They shall be permanently attached, and recessed into the panel.
    - e. Screws on the vertical portion of all removable access panel shall engage into heat resistant, molded composite collars.
    - f. Collars shall be removable and easily replaceable using manufacturer recommended parts.
- H. (23 81 19.13.H.) Coils:
1. Standard Aluminum Fin-Copper Tube Coils:
    - a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
    - b. Evaporator coils shall be leak tested to 150 psig, pressure tested to 450 psig, and qualified to UL 60335-2-40 burst test at 1775 psig.
    - c. Condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to UL 60335-2-40burst test at 1980 psig.
  2. Optional Pre-coated Aluminum-Fin Condenser Coils:
    - a. Shall have a durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments.
    - b. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.
    - c. Epoxy-phenolic barrier shall minimize galvanic action between dissimilar metals.

- d. Corrosion durability of fin stock shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117.
  - e. Corrosion durability of fin stock shall be confirmed through testing to have no visible corrosion after 48 hour immersion in a room temperature solution of 5% salt, 1% acetic acid.
  - f. Fin stock coating shall pass 2000 hours of the following: one week exposure in the prohesion chamber followed by one week of accelerated ultraviolet light testing. Prohesion chamber: the solution shall contain 3.5% sodium chloride and 0.35% ammonium sulfate. The exposure cycle is one hour of salt fog application at ambient followed by one hour drying at 95°F (35°C).
3. Optional Copper-Fin Evaporator and Condenser Coils:
- a. Shall be constructed of copper fins mechanically bonded to copper tubes and copper tube sheets.
  - b. Galvanized steel tube sheets shall not be acceptable.
  - c. A polymer strip shall prevent coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan.
4. Optional E-coated Aluminum-Fin Evaporator and Condenser Coils:
- a. Shall have a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins.
  - b. Coating process shall ensure complete coil encapsulation of tubes, fins and headers.
  - c. Color shall be high gloss black with gloss per ASTM D523.
  - d. Uniform dry film thickness from 0.8 to 1.2 mil on all surface areas including fin edges.
  - e. Superior hardness characteristics of 2H per ASTM D3363 and cross-hatch adhesion of 4B-5B per ASTM D3359.
  - f. Impact resistance shall be up to 160 in.-lb (ASTM D2794).
  - g. Humidity and water immersion resistance shall be up to minimum 1000 and 250 hours respectively (ASTM D2247 and ASTM D870).
  - h. Corrosion durability shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117.
- I. (23 81 19.13.1.) Refrigerant Components:
- 1. Refrigerant circuit shall include the following control, safety, and maintenance features:
    - a. Thermostatic Expansion Valve (TXV) shall help provide optimum performance across the entire operating range. Shall contain removable power element to allow change out of power element and bulb without removing the valve body.
    - b. Refrigerant filter drier — Solid core design with pre and post filter service gauge connections for filter diagnostics and maintenance.
    - c. Service gauge connections on suction and discharge lines.
    - d. Pressure gauge access through a specially designed access port in the unit.
2. There shall be gauge line access port in the skin of the rooftop, covered by a black, removable plug.
- a. The plug shall be easy to remove and replace.
  - b. When the plug is removed, the gauge access port shall enable maintenance personnel to route their pressure gauge lines.
  - c. This gauge access port shall facilitate correct and accurate condenser pressure readings by enabling the reading with the compressor access panel on.
  - d. The plug shall be made of a leak proof, UV-resistant, composite material.
3. Compressors:
- a. Unit shall use tandem scroll compressor assembly on a on single independent refrigeration circuit with three stages of cooling for efficient comfort cooling operation.
  - b. Evaporator coils shall be a full active design to help better control latent removal and minimize unconditioned bypass air.
  - c. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
  - d. Compressors shall be internally protected from high discharge temperature conditions.
  - e. Compressors shall be protected from an over-temperature and over-ampereage conditions by an internal, motor overload device.
  - f. Compressor shall be factory mounted on rubber grommets.
  - g. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
  - h. Crankcase heaters shall not be required for normal operating range, unless required by compressor manufacturer due to refrigerant charge limits.
- J. (23 81 19.13.J.) Filter Section:
- 1. Filters access is specified in the unit cabinet section of this specification.
  - 2. Filters shall be held in place by a pivoting filter tray, facilitating easy removal and installation.
  - 3. Shall consist of factory installed, low velocity, throw-away 2 in. thick fiberglass filters.

4. Filters shall be standard, commercially available sizes.
  5. Only one size filter per unit is allowed.
- K. (23 81 19.13.K.) Evaporator Fan and Motor with EcoBlue™ Technology:
1. Direct Drive Evaporator fan motor:
    - a. Shall be a ECM motor design.
    - b. Shall be direct drive design for all static options.
    - c. Shall have permanently lubricated bearings.
    - d. Shall have inherent automatic-reset thermal overload protection.
    - e. Shall have slow ramp up to speed capabilities.
    - f. Shall require no fan/motor belts for operation, adjustments and or initial fan speed set up.
    - g. Fan DC voltage set up on the SystemVu controller shall eliminate the need of removal of blower access door, required on conventional belt drive systems.
    - h. Shall be internally protected from electrical phase reversal and loss.
  2. Evaporator Fan:
    - a. Speed shall be easily set through SystemVu controller.
    - b. Shall provide 3 stage cooling capacity control, the indoor fan speed is automatically controlled to meet the code-compliant 40% low fan speed, 60% medium fan speed, and 100% at full fan speed operation.
    - c. Blower fan shall be a Vane Axial fan design with fan assembly secured directly to ECM motor. Additional shafts, belts, pulleys/sheaves, and bearing blocks to drive fan shall not be permitted or necessary.
    - d. Additional variable frequency drive to control fan motor speed shall not be permitted or necessary. All speed control electronics must be onboard fan motor assembly.
    - e. Shall be constructed of a high impact composite material on stator, rotor, and air inlet casing.
    - f. Shall be a patented / pending design with a corrosion resistant material.
    - g. Fan assembly design shall be integrated to fan deck, dynamically balanced, and require no additional vibration isolation for normal operation.
    - h. Shall have slow ramp up to speed capabilities to help reduce sound and comfort issues typically associated with single speed belt drive systems.
    - i. Units shall contain 2 separate vane axial fan assemblies.
    - j. Shall be a slide out design with removal of a few support brackets.
3. Shall include an easily accessible SystemVu Board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, gas controller, economizer, thermostat, DDC control options, and low and high pressure switches. Controller shall also provide an intuitive means to adjust the indoor fan speed.
- L. (23 81 19.13.L.) Condenser Fans and Motors:
1. Condenser Fan Motors:
    - a. Shall be a totally enclosed ECM motor.
    - b. Shall use permanently lubricated bearings.
    - c. Shall have inherent thermal overload protection with an automatic reset feature.
    - d. Shall use a shaft-down design on all sizes.
  2. Condenser Fans:
    - a. Shall be a direct-driven propeller type fan.
    - b. Shall have galvalum blades riveted to steel spider that have corrosion-resistant properties and shall be dynamically balanced.
- M. (23 81 19.13.M.) Special Features Options and Accessories:
1. Integrated EconoMi\$er® 2 Low Leak Rate Models.
    - a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
    - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory installed option.
    - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
    - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below set points.
    - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
    - f. Low leak rate shall be equipped with dampers not to exceed 2% leakage at 1 in. wg pressure differential.
    - g. Economizer controller on EconoMi\$er 2 models with SystemVu controllers shall be a 4-20mA design controlled directly by the controller. SystemVu controllers meet California Title 24, ASHRAE 90.1 and IECC Fault Detection and Diagnostic (FDD) requirements.
    - h. Shall be capable of introducing up to 100% outdoor air.
    - i. Shall be equipped with a barometric relief damper capable of relieving up to 100%

- return air and contain seals that meet ASHRAE 90.1 requirements.
- j. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
  - k. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory installed only. Outdoor air sensor set point shall be adjustable and shall range from 40°F to 100°F (4°C to 38°C). Additional sensor options shall be available as accessories.
  - l. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
  - m. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
  - n. Dampers shall be completely closed when the unit is in the unoccupied mode.
  - o. Economizer controller shall accept a 0 to 10 vdc CO<sub>2</sub> sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
  - p. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
  - q. Shall contain LED indication for free cooling, sensor, and damper operation.
2. Integrated EconoMi\$er® 2 Ultra Low Leak Rate Models.
    - a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
    - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory-installed option.
    - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
    - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below set points.
    - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
    - f. Ultra Low Leak design meets California Title 24 section 140.4 and ASHRAE 90.1 requirements for 4 cfm per sq ft on the outside air dampers and 10 cfm per sq ft on the return dampers.
    - g. Economizer controller on EconoMi\$er 2 models with SystemVu controls shall be a 4-20mA design controlled directly by the controller. SystemVu controller meets California Title 24, ASHRAE 90.1 and IECC Fault Detection and Diagnostic (FDD) requirements.
    - h. Shall be capable of introducing up to 100% outdoor air.
    - i. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
    - j. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
    - k. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory installed only. Outdoor air sensor setpoint shall be adjustable and shall range from 40°F to 100°F (4°C to 38°C). Additional sensor options shall be available as accessories.
    - l. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
    - m. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
    - n. Dampers shall be completely closed when the unit is in the unoccupied mode.
    - o. Economizer controller shall accept a 0 to 10 vdc CO<sub>2</sub> sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
    - p. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
    - q. Contains LED indication for free cooling, sensor, and damper operation.
  3. Two-Position Damper (Field-installed only):
    - a. Damper shall be a Two-Position Damper. Damper travel shall be from the full closed position to the field adjustable %-open set point.
    - b. Damper shall include adjustable damper travel from 25% to 100% (full open).
    - c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
    - d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.
    - e. Damper will admit up to 100% outdoor air for applicable rooftop units.
    - f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.

- g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
  - h. Outside air hood shall include aluminum water entrainment filter.
4. Manual Damper (Field-installed only):  
Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 25% or 50% outdoor air for year round ventilation.
5. Humidi-MiZer® Adaptive Dehumidification System:  
The Humidi-MiZer Adaptive Dehumidification System shall be factory installed and shall provide greater dehumidification of the occupied space by 2 modes of dehumidification operations in addition to its normal design cooling mode:
- a. Subcooling mode further sub cools the hot liquid refrigerant leaving the condenser coil when both temperature and humidity in the space are not satisfied.
  - b. Hot gas reheat mode shall mix a portion of the hot gas from the discharge of the compressor with the hot liquid refrigerant leaving the condenser coil to create a 2-phase heat transfer in the system, resulting in a neutral leaving air temperature when only humidity in the space is not satisfied.
6. Condenser Coil Hail Guard Assembly:
- a. Shall protect against hail and additional coil damage.
  - b. Shall be louvered type.
7. Unit-Mounted, Non-Fused Disconnect Switch:
- a. Available on 15 to 25 ton units with FLA of 100 amps or less (460/575V) or 200 amps or less (208/230V).
  - b. Switch shall be factory installed, internally mounted.
  - c. National Electric Code (NEC) and UL approved non-fused switch shall provide unit power shutoff.
  - d. Shall be accessible from outside the unit.
  - e. Shall provide local shutdown and lockout capability.
  - f. Sized **only** for the unit as ordered from the factory. Does not accommodate field-installed devices.
8. HACR Breaker:
- a. These manual reset devices provide overload and short circuit protection for the unit. Factory wired and mounted with the units, with access cover to help provide environmental protection. On 575V applications, HACR breaker can only be used with WYE power distribution systems. Use on Delta power distribution systems is prohibited.
- b. Sized **only** for the unit as ordered from the factory. Does not accommodate field-installed devices.
9. Convenience Outlet:
- a. Factory-Installed Powered Convenience Outlet.
    - 1) Outlet shall be powered from main line power to the rooftop unit.
    - 2) Outlet shall be powered from line side or load side of disconnect by installing contractor, as required by code. If outlet is powered from load side of disconnect, unit electrical ratings shall be UL certified and rated for additional outlet amperage.
    - 3) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
    - 4) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
    - 5) Voltage required to operate convenience outlet shall be provided by a factory installed step-down transformer.
    - 6) Outlet shall be accessible from outside the unit.
    - 7) Outlet shall include a field installed "Wet in Use" cover.
  - b. Factory-Installed Non-Powered Convenience Outlet.
    - 1) Outlet shall be powered from a separate 115/120v power source.
    - 2) A transformer shall not be included.
    - 3) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
    - 4) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
    - 5) Outlet shall be accessible from outside the unit.
    - 6) Outlet shall include a field installed "Wet in Use" cover.
  - c. Field-Installed Non-Powered Convenience Outlet.
    - 1) Outlet shall be powered from a separate 115/120v power source.
    - 2) A transformer shall not be included.
    - 3) Outlet shall be field-installed and internally mounted with easily accessible 115-v female receptacle.
    - 4) Outlet shall include 20 amp GFI receptacles. This kit provides a flexible installation method which allows code compliance for height requirements of the GFCI outlet from the finished roof surface as well as

- the capability to relocate the outlet to a more convenient location.
  - 5) Outlet shall be accessible from outside the unit.
  - 6) Outlet shall include a field installed “Wet in Use” cover.
10. Thru-the-Base Connectors:
- a. Shall provide connectors to permit gas and electrical connections to be brought to the unit through the unit basepan.
  - b. Minimum of 4 connection location per unit.
11. Centrifugal Fan Power Exhaust:
- a. Power exhaust shall be used in conjunction with an integrated economizer.
  - b. Horizontal power exhaust shall be mounted in return ductwork.
  - c. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0 to 100% adjustable setpoint on the economizer control.
12. Roof Curbs (Vertical):
- a. Full perimeter roof curb with exhaust capability providing separate air streams for energy recovery from the exhaust air without supply air contamination.
  - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
  - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
13. Outdoor Air Enthalpy Sensor:
- The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
14. Return Air Enthalpy Sensor:
- The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
15. Indoor Air Quality (CO<sub>2</sub>) Sensor:
- a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
  - b. The IAQ sensor shall be available in duct mount, wall mount, or wall mount with LED display. The setpoint shall have adjustment capability.
16. Smoke Detectors:
- a. Shall be a 4-wire controller and detector.
  - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
- c. Shall use magnet-activated test/reset sensor switches.
  - d. Shall have tool-less connection terminal access.
  - e. Shall have a recessed momentary switch for testing and resetting the detector.
  - f. Controller shall include:
    - 1) One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
    - 2) Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
    - 3) One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
    - 4) Capable of direct connection to 2 individual detector modules.
    - 5) Can be wired to up to 14 other duct smoke detectors for multiple fan shut-down applications.
17. Hinged Access Panels:
- a. Shall provide easy access through integrated quarter turn latches.
  - b. Shall be on major panels of: filter, control box, fan motor, and compressor.
18. Condensate Overflow Switch:
- This sensor and related controller monitors the condensate level in the drain pan and shuts down compression operation when overflow conditions occur. It includes:
- a. Indicator light — solid red (more than 10 seconds on water contact — compressors disabled), blinking red (sensor disconnected).
  - b. 10 second delay to break — eliminates nuisance trips from splashing or waves in pan (sensor needs 10 seconds of constant water contact before tripping).
  - c. Disables the compressor(s) operation when condensate plug is detected, but still allows fans to run for Economizer.
19. Foil Faced Insulation:
- Throughout unit cabinet air stream, non-fibrous and cleanable foil faced insulation is used.
20. MERV-13 — 4 in. Return Air Filters (Factory Installed Only):
- a. Factory option to upgrade standard unit filters to 4 in. MERV-13 filters.
  - b. Upgrade option shall include factory installed 4 in. Filter Rack kit.
21. 4 in. Return Air Rack (Field Installed Only);
- a. Accessory kit is designed to hold 4 in. MERV-8 or MERV-13 filters. Filters not included in kit.

22. 2 in. MERV-13 Return Air Filters:
  - a. Accessory kit to field upgrade standard unit filters to 2 in. MERV-13 filters.
  - b. Correct size and quantity of filters shall ship in a single box.
23. 2 in. MERV-8 Return Air filters:
  - a. Accessory kit to field upgrade standard unit filters to 2 in. MERV-8 filters.
  - b. Correct size and quantity of filters shall ship in a single box.
24. Phase Monitor Control:
  - a. Shall monitor the sequence of 3-phase electrical system to provide a phase reversal protection.
  - b. Shall monitor the 3-phase voltage inputs to provide a phase loss protection for the 3-phase device.
  - c. Will work on either a Delta or Wye power connection.
25. Horn/Strobe Annunciator:
  - a. Provides an audible/visual signaling device for use with factory-installed option or field installed accessory smoke detectors.
  - b. Requires installation of a field-supplied 24-v transformer suitable for 4.2 VA (AC) or 3.0 VA (DC) per horn/strobe accessory.
  - c. Requires field-supplied electrical box, North American 1-gang box, 2 in. x 4 in. (51 mm x 102 mm).
  - d. Shall have a clear colored lens.
26. Electric Heat:
  - a. Heating Section:
    - 1) Heater element open coil resistance wire, nickel-chrome alloy, 0.29 inches inside diameter, strung through ceramic insulators mounted on metal frame. Coil ends are staked and welded to terminal screw slots.
  - 2) Heater assemblies are provided with integral fusing for protection of internal heater circuits not exceeding 48 amps each. Auto reset thermo limit controls, magnetic heater contactors (24-v coil) and terminal block all mounted in electric heater control box (minimum 18 ga galvanized steel) attached to end of heater assembly.
27. High Short Circuit Current Rating (SCCR) Protection:
  - a. Factory-installed option shall provide high short circuit current protection to compressor and all indoor and outdoor fan motors rated at 208/230V = 60kA, 460V = 65kA against high potential fault current situations. (Standard unit comes with 5 kA rating.)
  - b. This option is not available with factory installed Humidi-MiZer system, Powered Convenience Outlet, Non-Fused Disconnect, Phase Loss monitor/protection and 575 Volt models.
28. Pressure Relief Valve:
  - a. Units with the factory-installed pressure relief option contain a pressure relief valve in the unit liquid line for compliance with Chicago Municipal Code 18-28-1102.3.
  - b. The pressure relief valve is set to open above 650 PSI and is intended to vent refrigerant in the event the refrigerant pressure exceeds the equipment design pressure.
  - c. The pressure relief valve is single use and must be replaced after refrigerant discharge.



