

40MB*D
Ducted Style Ductless System
Sizes 09 to 48



Product Data



NOTE: Images for illustration purposes only. Actual models may be slightly different.

INDUSTRY LEADING FEATURES / BENEFITS

A PERFECT BALANCE BETWEEN BUDGET LIMITS, ENERGY SAVINGS AND COMFORT.

The 40MB*D series ducted style ductless systems are a matched combination of an outdoor condensing unit and an indoor fan coil unit connected only by refrigerant tubing and wires.

The fan coil is mounted in the ceiling. This selection of fan coils permits creative solutions to design problems such as:

- Add-ons to current space (an office or family room addition)
- Special space requirements
- When changes in the load cannot be handled by the existing system.
- Historical renovations or any application where preserving the look of the original structure is essential.

These compact indoor fan coil units take up very little space above the ceiling. Advanced system components incorporate innovative technology to provide reliable cooling performance at low sound levels.

LOW SOUND LEVELS

When noise is a concern, the ductless split systems are the answer. The indoor units are whisper quiet. There are no compressors indoors, either in the conditioned space or directly over it, and there is none of the noise usually generated by air being forced through ductwork.

SECURE OPERATION

If security is an issue, outdoor and indoor units are connected only by refrigerant piping and wiring to prevent intruders from crawling through ductwork. In addition, since outdoor units can be installed close to an outside wall, coils are protected from vandals and severe weather.

FAST INSTALLATION

This compact ductless system is simple to install. A mounting bracket and duct work is needed for the indoor units, and only wire and piping need run between the indoor and outdoor units. These units are fast and easy to install ensuring minimal disruption to customers in the home or workplace. This makes the ducted style ductless systems the equipment of choice, especially in retrofit situations.

SIMPLE SERVICING AND MAINTENANCE

Removing the top panel on outdoor units provides immediate access to the control compartment, providing a service technician access to check unit operation. In addition, the draw-thru design of the outdoor section means that dirt accumulates on the outside surface of the coil. Coils can be cleaned quickly from the inside using a pressure hose and detergent.

On all indoor units, service and maintenance expense is reduced due to easy accessible service panels. In addition, these ducted systems have extensive self-diagnostics to assist in troubleshooting.

BUILT-IN RELIABILITY

Ducted style ductless system indoor and outdoor units are designed to provide years of trouble-free operation.

The ducted indoor units include protection against freeze-up and high evaporator temperatures on heat pumps.

The condensing units on heat pumps are protected by a three minute time delay before the compressor starts the over-current protection and the high temperature protection.

INDIVIDUAL ROOM COMFORT

Maximum comfort is provided because each space can be controlled individually based on usage pattern. The air sweep feature provided permits optimal room air mixing to eliminate hot and cold spots for occupant comfort. In addition, year-round comfort can be provided with heat pumps.

ECONOMICAL OPERATION

The ducted style ductless system design allows individual or multi-room heating or cooling when required. There is no need to run large supply-air fans or chilled water pumps to handle a few spaces with unique load patterns.

EASY-TO-USE CONTROLS

The ducted units have microprocessor-based controls to provide the ultimate in comfort and efficiency. The user friendly wired and wireless remote control provides the interface between user and the unit.

BUILT-IN CONDENSATE LIFT PUMP

Factory installed condensate lift pump on the ducted fan coil provides installation flexibility.

OPTIONAL WIRED CONTROLLER

Timer Function


STANDARD WIRED CONTROLLER

7 Day Programmable

AGENCY LISTINGS

All systems are listed with AHRI (Air Conditioning, Heating & Refrigeration Institute), and ETL.

MODEL NUMBER NOMENCLATURE

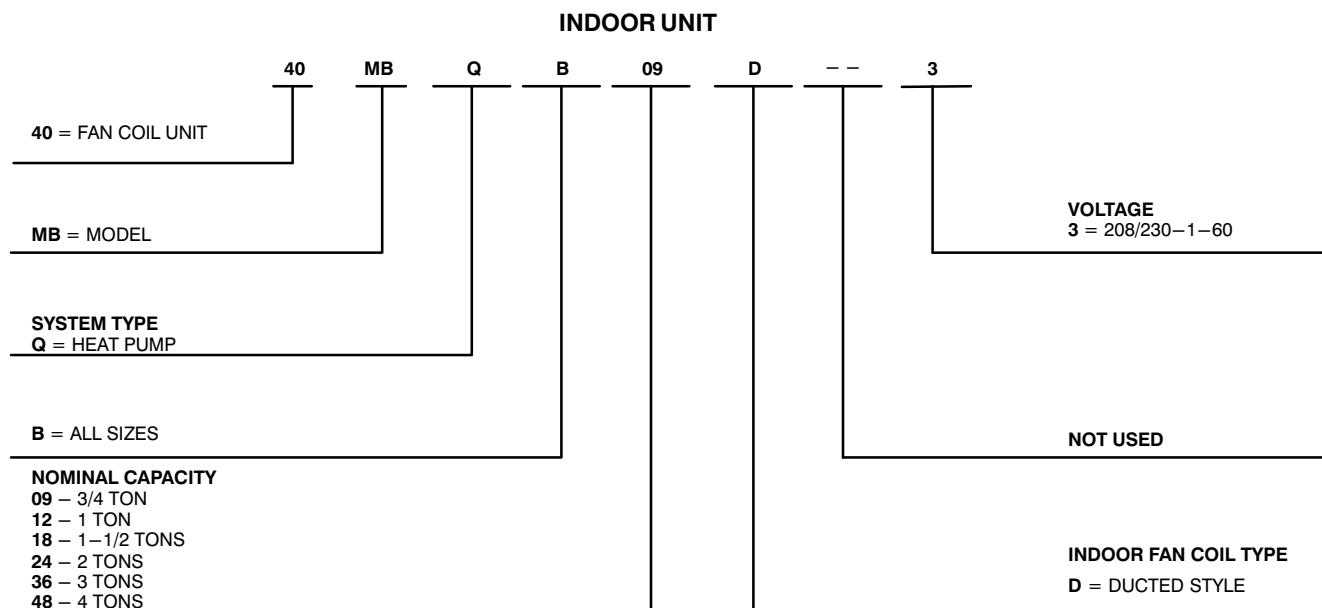

Use of the AHRI Certified
TM Mark indicates a
manufacturer's
participation in the
program. For verification
of certification for individual
products, go to
www.ahridirectory.org.



STANDARD FEATURES AND ACCESSORIES

Ease Of Installation	
Mounting Brackets	S
Low Voltage Controls	S
Comfort Features	
Rear or Bottom Return	S
Microprocessor Controls	S
Wired Remote Control (7 Day Programmable KSACN0501AAA Standard on units produced after serial number 4616V10001)	S
Wireless Remote Control	S
Auto Restart Function	S
Cold Blow Protection On Heat Pumps	S
Freeze Protection Mode On Heat Pumps	S
Turbo Mode	S
Auto Changeover On Heat Pumps	S
Follow Me (<i>Sense Temperature at remote</i>)	S
Energy Saving Features	
Outside Air Intake	S
Sleep Mode	S
Stop/Start Timer	S
46°F Heating Mode (Heating Setback)	S
Safety And Reliability	
Indoor Coil Freeze Protection	S
Indoor Coil High Temp Protection in Heating Mode	S
Aluminum Blue Hydrophilic pre-coated fins	S
Ease Of Service And Maintenance	
Cleanable Filters (Standard on units produced after serial number 2815V10001)	S
Diagnostics	S
Liquid Line Pressure Taps	S
Application Flexibility	
Built-in Condensate Lift Pump	S

Legend

S Standard
A Accessory

ACCESSORIES

ORDERING NO.	DESCRIPTION	FOR MODELS
53DS-900---089	Insulated 25' Line Set - 1/4" x 3/8"	SIZE 09
53DS-900---008	Insulated 25' Line Set - 1/4" x 1/2"	SIZES 12, 18

DIMENSIONS – INDOOR


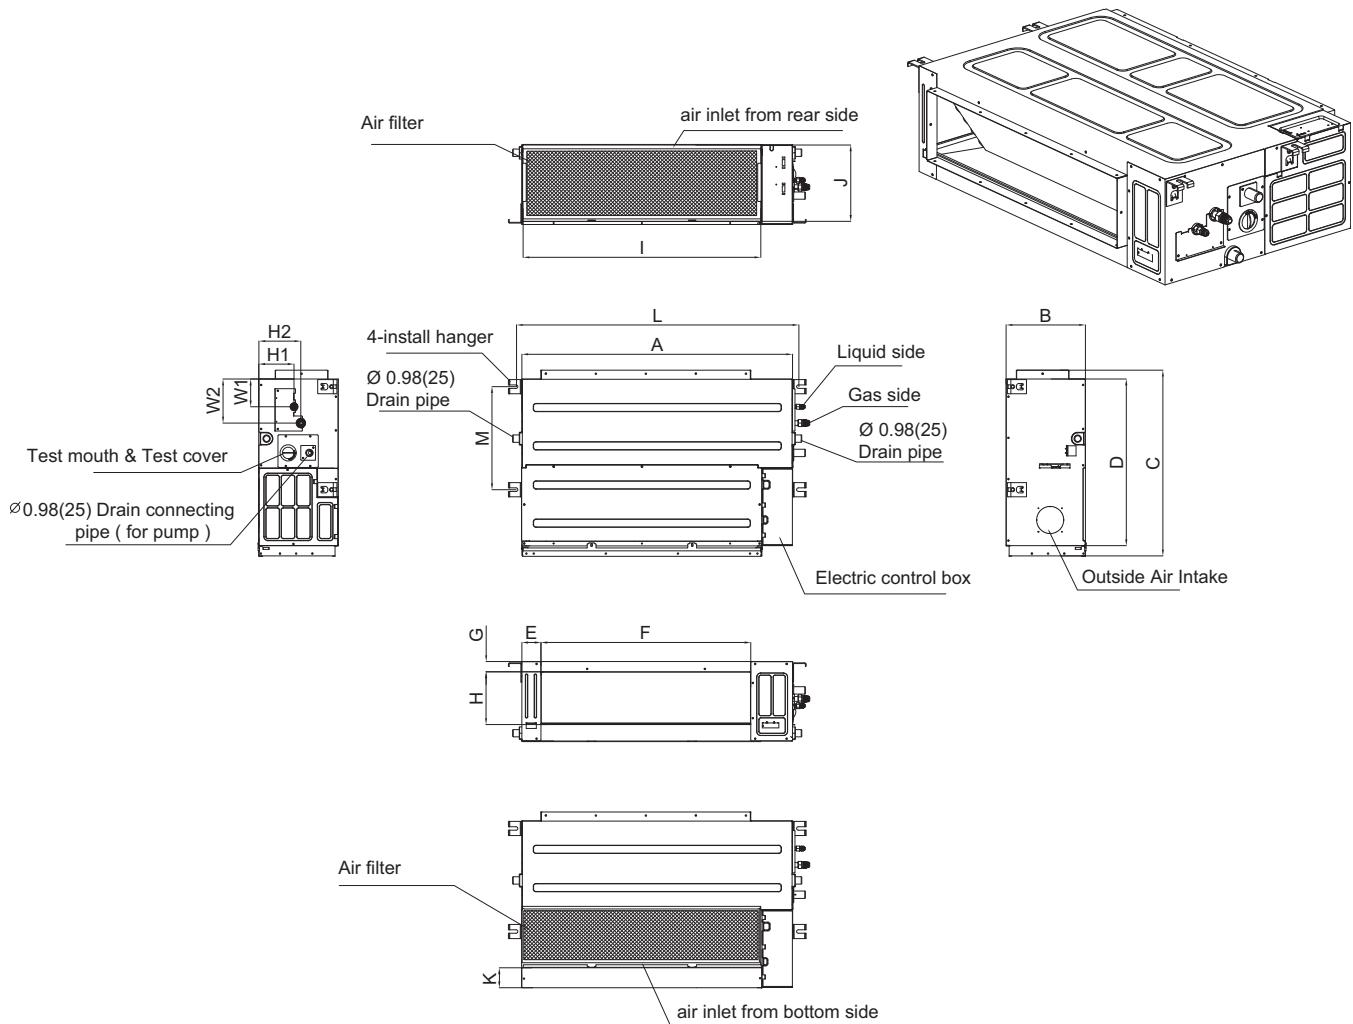


Fig. 1 – Indoor Unit

Size	OUTLINE DIMENSIONS					AIR OUTLET OPENING SIZE			AIR RETURN OPENING SIZE			HANGAR BRACKETS		REFRIGERANT PIPE LOCATIONS				OPERATING WEIGHT lb. (kg)
	A	B	C	D	E	F	G	H	I	J	K	L	M	H1	H2	W1	W2	
9	27.6 (700)	8.2 (210)	25 (635)	22.4 (570)	2.5 (65)	19.4 (493)	1.3 (35)	4.6 (119)	23.4 (595)	7.8 (200)	3.1 (80)	29.1 (740)	13.8 (350)	4.7 (120)	5.6 (143)	3.7 (95)	5.9 (150)	39.9 (18.1)
12	27.6 (700)	8.2 (210)	25 (635)	22.4 (570)	2.5 (65)	19.4 (493)	1.3 (35)	4.6 (119)	23.4 (595)	7.8 (200)	3.1 (80)	29.1 (740)	13.8 (350)	4.7 (120)	5.6 (143)	3.7 (95)	5.9 (150)	39.9 (18.1)
18	36.2 (920)	8.2 (210)	25 (635)	22.4 (570)	2.5 (65)	28.07 (713)	1.3 (35)	4.6 (119)	32.0 (815)	7.8 (200)	3.1 (80)	37.8 (960)	13.8 (350)	4.7 (120)	5.6 (143)	3.7 (95)	5.9 (150)	50.7 (23)
24	36.2 (920)	10.6 (270)	25 (635)	22.4 (570)	2.5 (65)	28.07 (713)	1.3 (35)	7.0 (179)	32.0 (815)	10.2 (260)	0.7 (20)	37.8 (960)	13.8 (350)	4.7 (120)	5.6 (143)	3.7 (95)	5.9 (150)	57.3 (26)
36	44.8 (1140)	10.6 (270)	30.5 (775)	27.9 (710)	2.5 (65)	36.7 (933)	1.3 (35)	7.0 (179)	40.7 (1035)	10.2 (260)	0.7 (20)	46.5 (1180)	19.3 (490)	4.7 (120)	5.6 (143)	3.7 (95)	5.9 (150)	77.1 (35)
48	47.2 (1200)	11.8 (300)	34.1 (865)	31.4 (800)	3.1 (80)	38.1 (968)	1.5 (40)	8.0 (204)	43.0 (1094)	11.3 (288)	1.7 (45)	48.8 (1240)	19.7 (500)	6.9 (175)	7.8 (198)	6.1 (155)	8.3 (210)	99.2 (45)

CLEARANCES – INDOOR

INSTALLATION PLACE

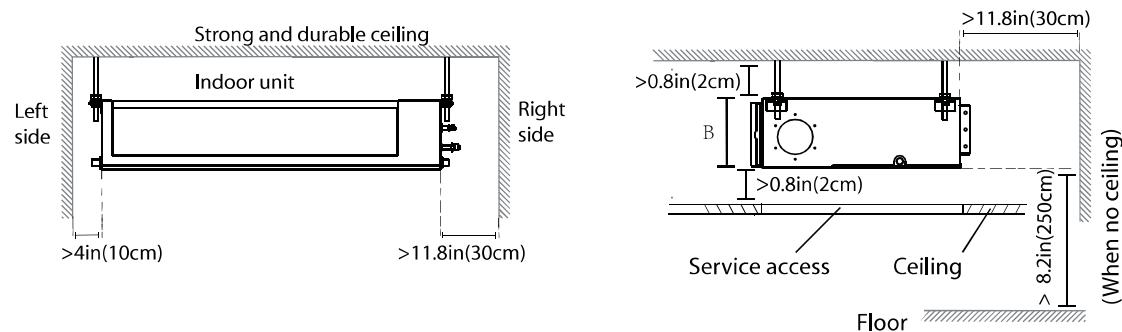

MAINTENANCE SPACE

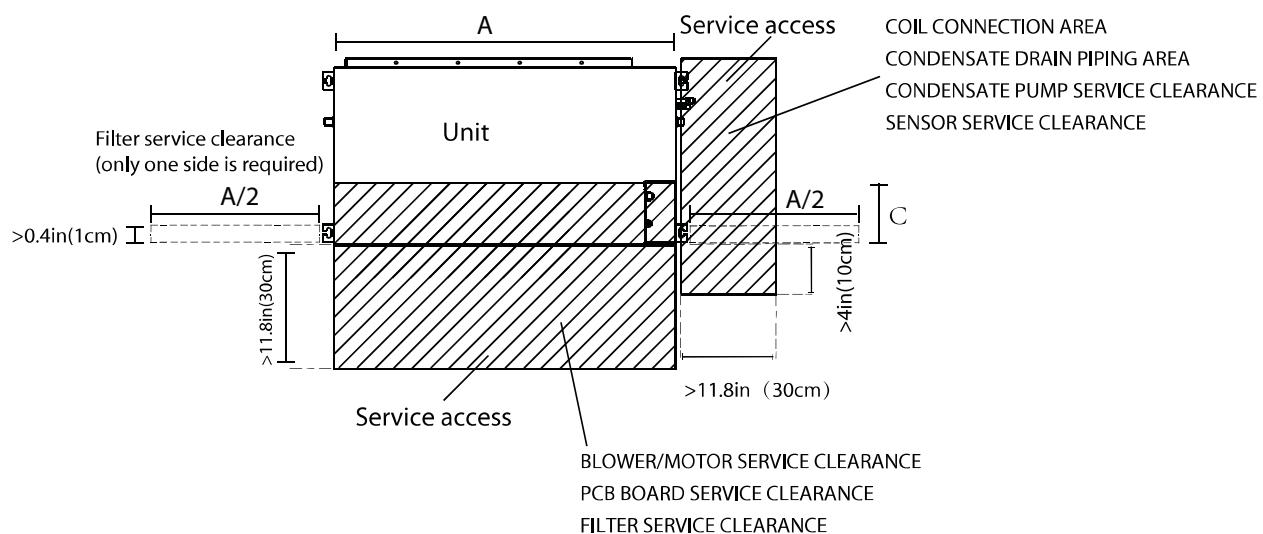


Fig. 2 – Indoor Unit Clearances

Capacity (Kbtu)	A	B	C
9K	27.56in(70cm)	8.27in(21cm)	11.81in(30cm)
12K	27.56in(70cm)	8.27in(21cm)	11.81in(30cm)
18K	36.22in(92cm)	8.27in(21cm)	11.81in(30cm)
24K	36.22in(92cm)	10.63in(27cm)	11.81in(30cm)
36K	44.88in(114cm)	10.63in(27cm)	11.81in(30cm)
48K	47.24in(120cm)	11.81in(30cm)	15.75in(40cm)

SPECIFICATIONS

System	SIZE		9	12	18	24	36	48
	Indoor Model		40MBQB09D-3	40MBQB12D-3	40MBQB18D-3	40MBQB24D-3	40MBQB36D-3	40MBQB48D-3
Electrical	Voltage, Phase, Cycle	V/Ph/Hz	208/230-1-60	208/230-1-60	208/230-1-60	208/230-1-60	208/230-1-60	208/230-1-60
	Power Supply				Indoor unit powered from outdoor unit			
Controls	MCA	A.	0.51	0.51	0.62	0.62	0.73	1.2
	Wireless Remote Controller (°F/°C Convertible)		Standard	Standard	Standard	Standard	Standard	Standard
Operating Range	Wired Remote Controller (°F/°C Convertible)		Standard	Standard	Standard	Standard	Standard	Standard
	Cooling Indoor DB Min - Max	°F(°C)	63~90 (17~32)	63~90 (17~32)	63~90 (17~32)	63~90 (17~32)	63~90 (17~32)	63~90 (17~32)
Piping	Heating Indoor DB Min - Max	°F(°C)	32~86 (0~30)	32~86 (0~30)	32~86 (0~30)	32~86 (0~30)	32~86 (0~30)	32~86 (0~30)
	Pipe Connection Size - Liquid	In. (mm)	1/4 (6.35)	1/4 (6.35)	1/4 (6.35)	3/8 (9.52)	3/8 (9.52)	3/8 (9.52)
Indoor Coil	Pipe Connection Size - Suction	In. (mm)	3/8 (9.52)	1/2 (12.7)	1/2 (12.7)	5/8 (16)	5/8 (16)	5/8 (16)
	Face Area	Sq. Ft.	1.4	1.4	1.4	2.0	3.5	4.2
Indoor	No. Rows		3	3	3	4	4	4
	Fins per inch		16	16	16	16	16	16
	Circuits		4	4	4	6	8	8
	Unit Width	In. (mm)	27.56 (700)	27.56 (700)	36.22 (920)	36.22 (920)	44.88 (1140)	47.24 (1200)
	Unit Height	In. (mm)	8.27 (210)	8.27 (210)	8.27 (210)	10.63 (270)	10.63 (270)	11.81 (300)
	Unit Depth	In. (mm)	25 (635)	25 (635)	25 (635)	25 (635)	30.51 (775)	34.06 (865)
	Net Weight	lbs (kg)	39.90 (18.1)	39.90 (18.1)	50.7 (23)	57.32 (26)	77.16 (35)	99.21 (45)
	No. Fan Speeds		3	3	3	3	3	3
	Airflow (lowest to highest)	CFM	290/340/380	290/340/380	400/440/480	590/650/810	680/940/1180	940/1180/1470
	Sound Pressure (lowest to highest)	dB(A)	30/33/36	30/34/38	34/37/38	43/45/48	46/50/52	41/44/46
	Max Static Pressure	In.WG.	0.18	0.18	0.28	0.40	0.40	0.40

Performance may vary based on the outdoor unit matched to. See the compatible outdoor units product data for Performance Data.

COMPATIBILITY TABLE

INDOOR UNIT	40MBQB09D-3	40MBQB12D-3	40MBQB18D-3	40MBQB24D-3	40MBQB36D-3	40MBQB48D-3
Single Zone Outdoor Unit	38MAQB09R-3	38MAQB12R-3	38MAQB18R-3	38MAQB24R-3		
					38MBRQ36A-3	38MBRQ48A-3
Multi-Zone Outdoor Unit	38MGRQ18B-3					
	38MGRQ24C-3					
	38MGRQ30D-3					
	38MGRQ36D-3					
	38MGRQ48E-3					

NOTE: Backward compatible with Single Zone Systems 38MAQ sizes 09–24, 38MBQ Sizes 36–48 and Multi–zone Systems 38MGQ.

APPLICATION DATA

UNIT SELECTION

Select equipment to either match or that can handle slightly less than the anticipated peak load. This provides better humidity control, fewer unit cycles, and less part-load operation.

For units used in spaces with high sensible loads, base equipment selection on unit sensible load, not on a total anticipated load. Adjust for anticipated room wet bulb temperature to avoid undersizing equipment.

UNIT MOUNTING (INDOOR)

Refer to unit Installation Instructions for further details.

Unit leveling – For reliable operation, units should be level in all planes.

Clearance – Provide adequate clearance for airflow as shown in Fig. 3.

Unit location – Select a location which provides the best air circulation for the room.

These units should be positioned as accessible as possible above the ceiling. The unit return and discharge should not be obstructed by furniture, curtains, or anything which may cause unit short cycling or air recirculation. Duct the unit in the middle of the selected wall (if possible). Duct towards an outside wall, if available, to make piping easier, and place the unit so it faces the normal location of room occupants.

UNIT MOUNTING (OUTDOOR)

Refer to unit Installation Instructions for further details.

Do not install the indoor or outdoor units in a location with special environmental conditions. For those applications, contact your ductless representative.

MOUNTING

Refer to unit's Installation Instructions for further details.

SUPPORT

Adequate support must be provided to support the weight of all fan coils. Refer to the *Physical Data* section for fan coil weights, and the base unit dimensional drawings for the location of mounting brackets.

SYSTEM OPERATING CONDITIONS

OPERATING RANGE Min / Max °F (°C)		
	Cooling	Heating
Indoor DB	63 / 90 (17 / 32)	32 / 86 (0 / 30)
Indoor WB	59 / 84 (15 / 29)	

NOTE: Reference the product Installation Instructions for more information.

DRAIN CONNECTIONS

Install drains to meet local sanitation codes. The standard ducted fan coil unit condensate lift pump has a maximum lift of 29.5 in. (750mm).

WIRING

All wires must be sized per NEC (National Electrical Code) or CEC (Canadian Electrical Code) and local codes. Use the Electrical Data table MCA (minimum circuit amps) and MOCP (maximum over current protection) to correctly size the wires and the disconnect fuse or breakers respectively. Per the caution note, only Stranded copper conductors with a 600 volt rating and double insulated copper wire must be used.

NOTE: The use of BX cable is not recommended.

Recommended Connection Method for Power and Communication Wiring – Power and Communication Wiring:

The main power is supplied to the outdoor unit. The field supplied 14/3 power/communication wiring from the outdoor unit to the indoor unit consists of four (4) wires and provides the power for the indoor unit. Two wires are high voltage AC power, one is communication wiring and the other is a ground wire.

Recommended Connection Method for Power and Communication Wiring (To minimize communication wiring interference)

PowerWiring:

The main power is supplied to the outdoor unit. The field supplied power wiring from the outdoor unit to the indoor unit consists of three (3) wires and provides the power for the indoor unit. Two wires are high voltage AC power and one is a ground wire. To minimize voltage drop, the factory recommended wire size is 14/2 stranded with a ground.

Communication Wiring:

A separate shielded stranded copper conductor only, with a minimum 600 volt rating and double insulated copper wire, must be used as the communication wire from the outdoor unit to the indoor unit. Please use a separate shielded 16GA stranded control wire.



CAUTION

EQUIPMENT DAMAGE HAZARD

Failure to follow this caution may result in equipment damage or improper operation.

- Wires should be sized based on NEC and local codes.
- Use copper conductors only with a 600 volt rating and double insulated copper wire.



CAUTION

EQUIPMENT DAMAGE HAZARD

Failure to follow this caution may result in equipment damage or improper operation.

- Be sure to comply with local codes while running wire from indoor unit to outdoor unit.
- Every wire must be connected firmly. Loose wiring may cause terminal to overheat or result in unit malfunction. A fire hazard may also exist. Therefore, be sure all wiring is tightly connected.
- No wire should be allowed to touch refrigerant tubing, compressor or any moving parts.
- Disconnecting means must be provided and shall be located within sight and readily accessible from the air conditioner.
- Connecting cable with conduit shall be routed through hole in the conduit panel.

CONTROL SYSTEM

The indoor unit is equipped with a microprocessor control to perform two functions:

1. Provide safety for the system
2. Control the system and provide optimum levels of comfort and efficiency

The main microprocessor is located on the control board of the fan coil unit (outdoor units have a microprocessor also) with thermistors located in the fan coil air inlet and on the indoor coil. Heat pump units have a thermistor on the outdoor coil. These thermistors monitor the system operation to maintain the unit within acceptable parameters and control the operating mode.

WIRELESS REMOTE CONTROL



Fig. 3 – Wireless Remote Control

1. A wireless remote control is supplied for system operation for system operation of all ducted units.
2. Each battery operated wireless (infrared) remote control may be used to control more than one unit.

AIR FLOW DATA

SYSTEM SIZE	9	12	18	24	36	48
Indoor (CFM)	High	380	380	480	810	1180
	Medium	340	340	440	650	940
	Low	290	290	400	590	680

SOUND PRESSURE

SYSTEM SIZE	9	12	18	24	36	48
Cooling operation Indoor Sound Pressure	30/33/36	30/34/38	34/37/38	43/45/48	46/50/52	41/44/46
Heating operation Indoor Sound Pressure	30/33/36	30/34/38	34/37/39	44/45/48	46/49/51	40/43/45

SOUND PRESSURE TESTING METHOD

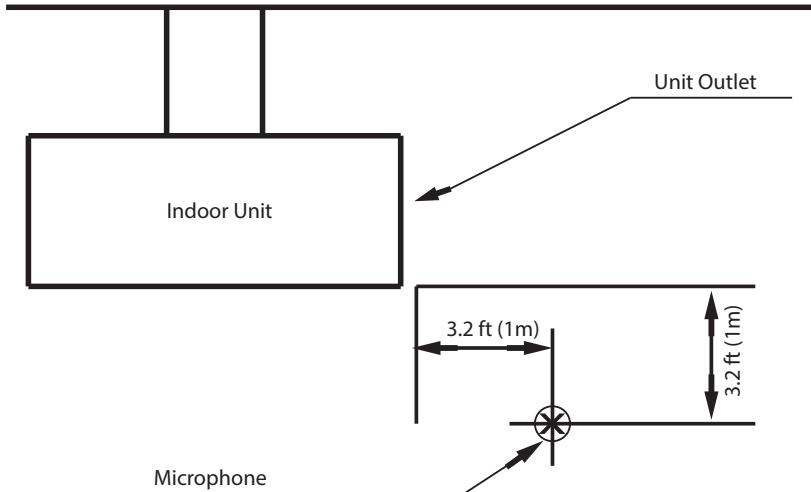


Fig. 6 – Sound Pressure Testing Method

SOUND POWER

SYSTEM SIZE	9	12	18	24	36	48
Cooling operation Indoor Sound Power	39/42/45	39/43/47	43/46/48	53/55/58	56/60/62	51/54/56
Heating operation Indoor Sound Power	39/42/45	39/43/47	43/46/48	54/55/58	56/59/61	50/53/55

WIRED REMOTE CONTROL

P/N KSACN0101AAA (optional available as an accessory)

P/N KSACN0501AAA (included with the Unit)

1. Wired remote controller used for system operation of all ducted units.
2. Kit includes a wired remote controller and a connecting cable.
3. Connect with wire terminal between remote controller and indoor unit.
4. Display in °F or °C and temperature increments every 1°F or every 1°C.



Fig. 4 – KSACN0101AAA (Timer Function)



Fig. 5 – KSACN0501AAA (7 Day Programmable)

ELECTRICAL DATA

UNIT SIZE		INDOOR FAN			MAX FUSE CB AMP	
		V-PH-HZ	FLA	HP	W	
9	208-230/1/60	208-230/1/60	1.03	0.07	55	Refer to outdoor unit installation instructions - Indoor unit powered by the outdoor unit
12			1.03	0.07	55	
18			0.83	0.12	90	
24			0.83	0.12	90	
36			1.263	0.2	150	
48			2.23	0.32	240	

LEGEND

FLA – Full Load Amps

FAN AND MOTOR SPECIFICATIONS

SYSTEM SIZE		9	12	18	24	36	48
Indoor Fan	Material	ABS	ABS	ABS	ABS	ABS	ABS
	Type	LX-140*150*12-41J	LX-140*150*12-41J	LX-142*180*12-42J	LX-188*190*12-40J	LX-188*190*12-40J	LX-188*190*12-40J
	Diameter inch	140	140	142	188	188	188
	Height inch	150	150	180	190	490	490
Indoor Fan Motor	Model	WZDK55-38GS-W	WZDK55-38GS-W	WZDK90-38GS-W	WZDK90-38GS-W	WZDK150-38GS-W	WZDK240-38GS-W
	Type	DC	DC	DC	DC	DC	DC
	Phase	3	3	3	3	3	3
	FLA	1.03	1.03	0.83	0.83	1.263	2.23
	Insulation class	E	E	E	E	E	E
	Safe Class	IPX0	IPX0	IPX0	IPX0	IPX0	IPX0
	Input W	118	118	143	143	167	276
	Output W	55	55	90	90	150	240
	Range of Current Amps	1.03±10%	1.03±10%	1.15±10%	1.15±10%	1.263±10%	2.23±10%
	Rated Current Amps	1.03	1.03	0.83	0.83	1.263	2.23
	Rated HP HP	0.073	0.073	0.12	0.12	0.2	0.32
	Speed rev/min	1100/950/800	1150/1000/900	1100/1050/880/820	1030/880/800	1120/1000/860	1040/950/830
	Rated RPM rev/min	1450	1450	1200	1200	1180	1200
	Max. Input W	118	118	143	143	167	276


FAN PERFORMANCES AT VARYING STATIC PRESSURES (DUCTED UNITS)

The static pressure of the indoor unit has been set in the factory according to the table below.


						Static Pressure Range In. WG (Pa)
Size	0	1	2	3	4	
9 and 12	0.02 (5)	0.04 (10)	0.08 (20)	0.12 (30)	0.16 (40)	0–0.18 (0–45)
18	0.04 (10)	0.10 (25)	0.14 (35)	0.18 (45)	0.22 (55)	0–0.28 (0–70)
24	0.04 (10)	0.10 (25)	0.16 (40)	0.22 (55)	0.28 (70)	0–0.40 (0–100)
36 and 48	0.08 (20)	0.14 (35)	0.20 (50)	0.26 (65)	0.32 (80)	0–0.40 (0–100)
Factory Setting	✓					

SYSTEM SIZE		9K	12K	18K	24K	36K	48K
High	CFM	335	370	520	820	1120	1470
	CMH	570	629	884	1394	1904	2499
Medium	CFM	290	320	430	620	940	1180
	CMH	493	544	731	1054	1598	2006
Low	CFM	240	260	360	520	680	940
	CMH	408	442	672	884	1156	1598

STATIC PRESSURE CURVES SIZE 09

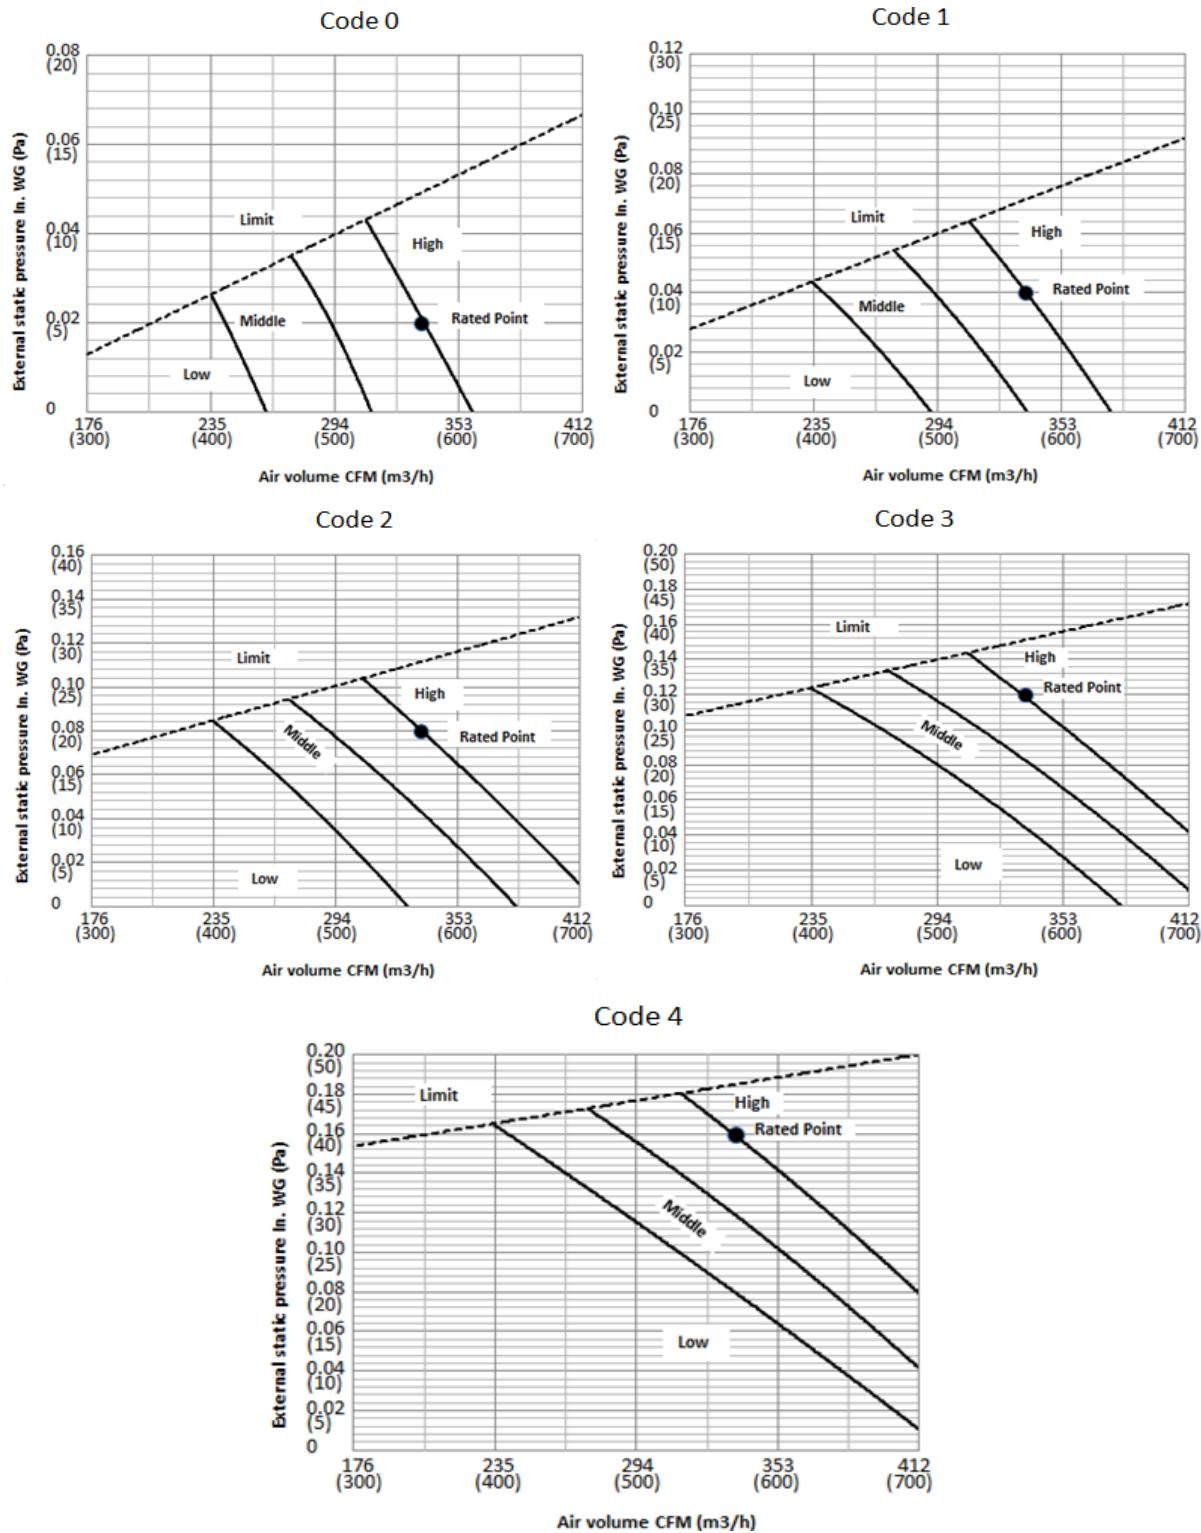


STATIC PRESSURE CURVES SIZE 12

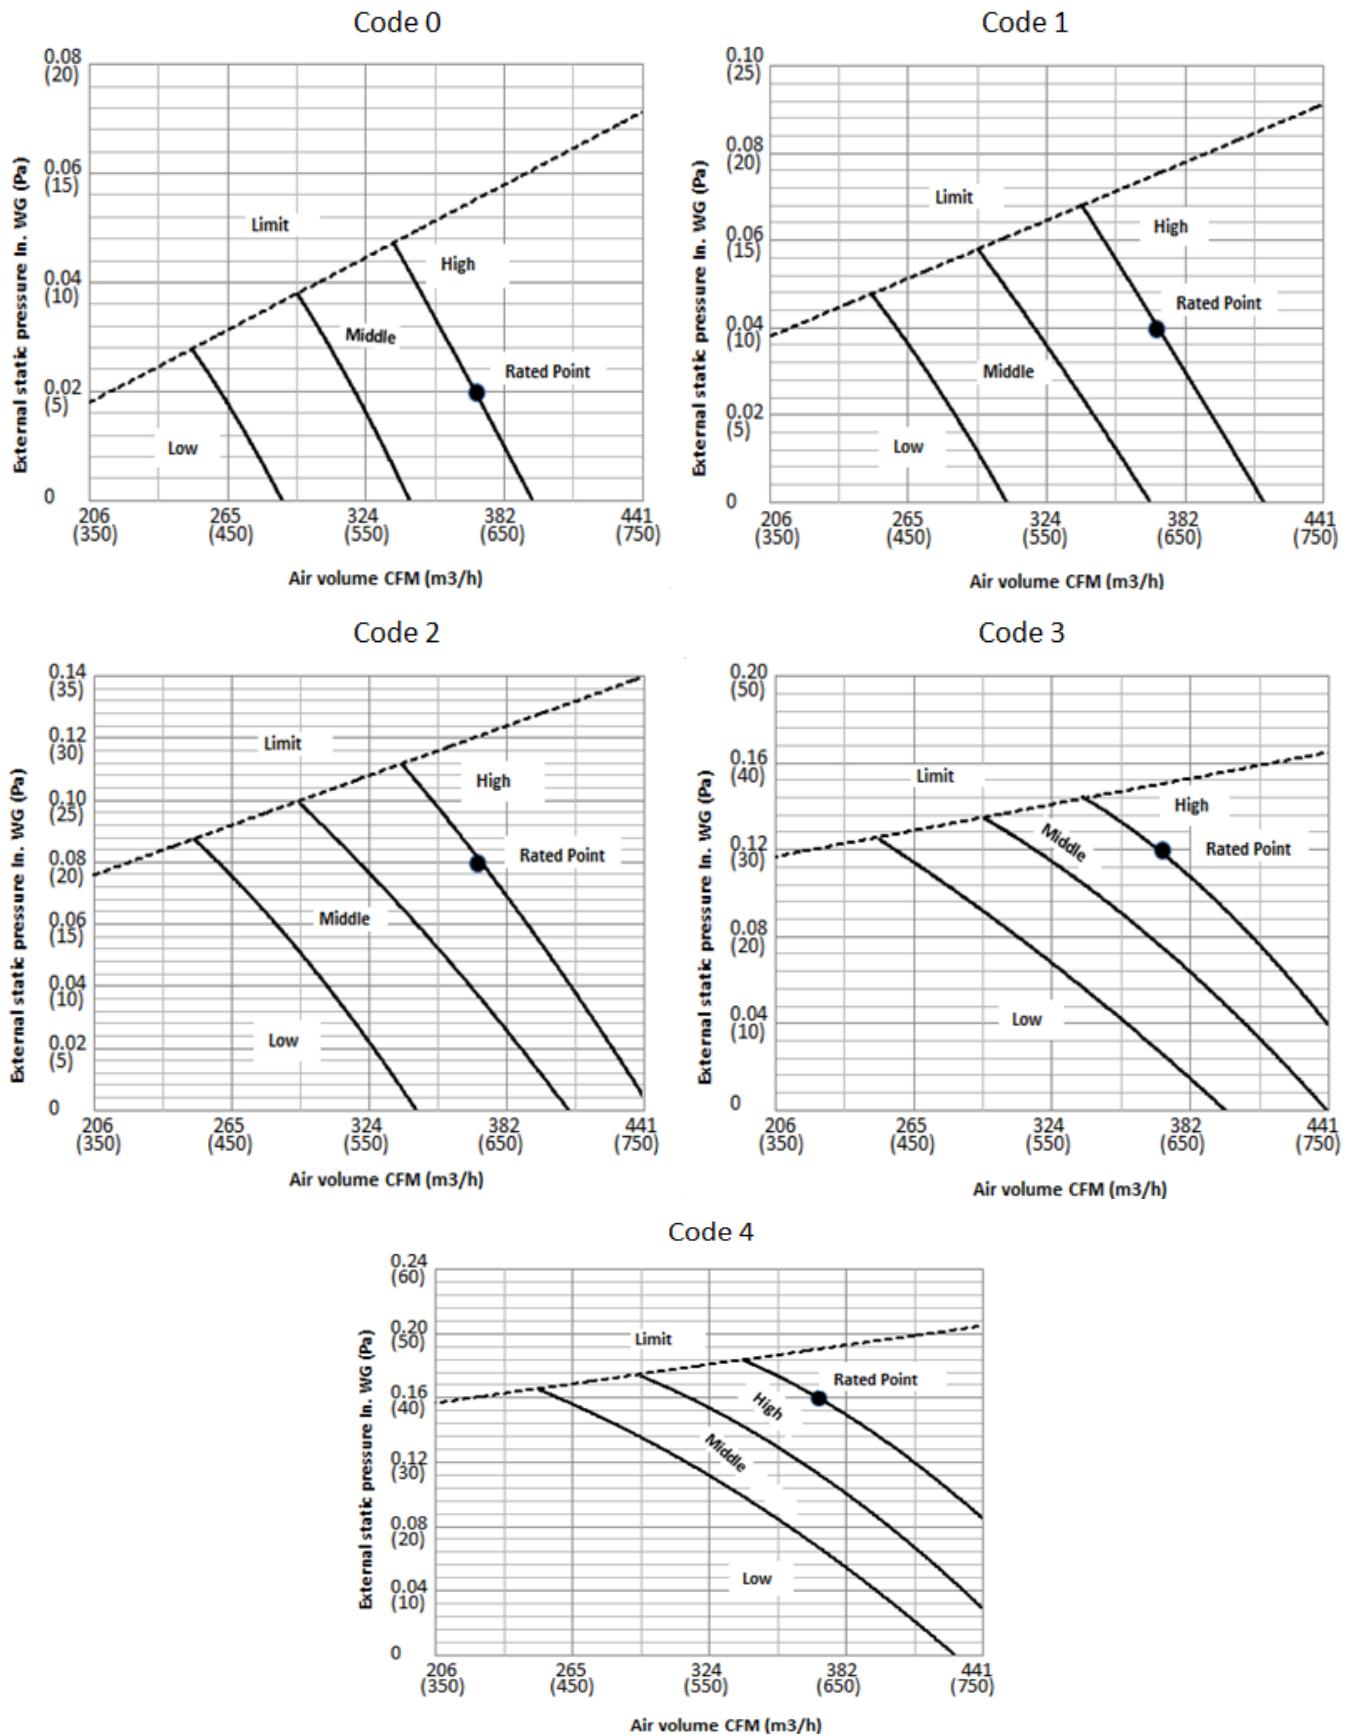


STATIC PRESSURE CURVES SIZE 18


Code 0

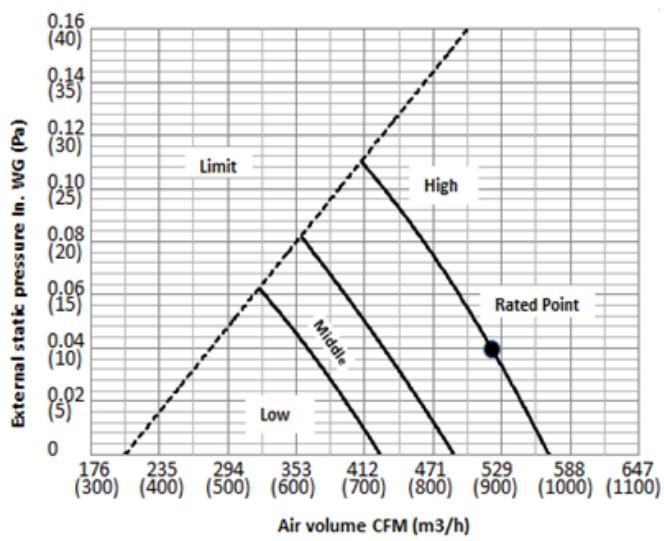


Code 1

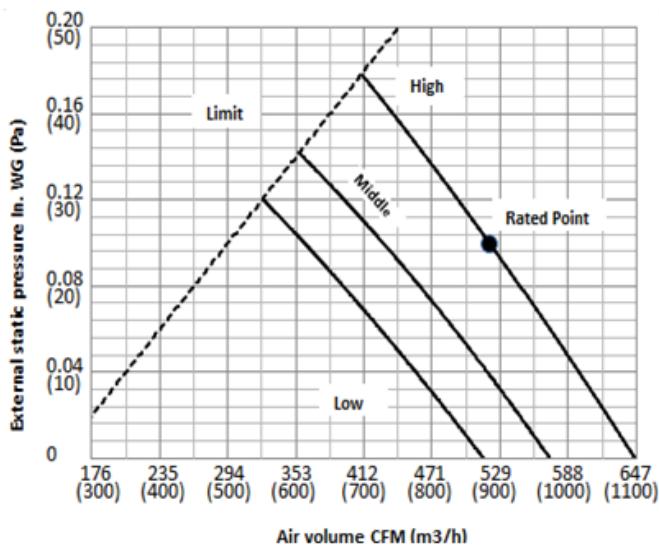


Code 2

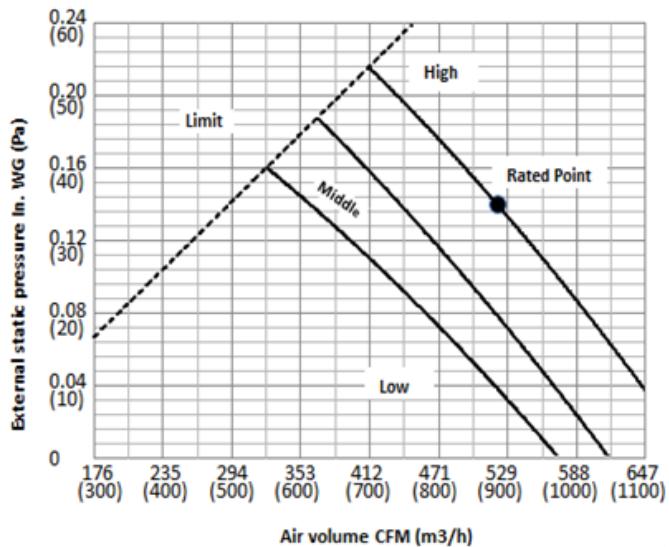


Code 3

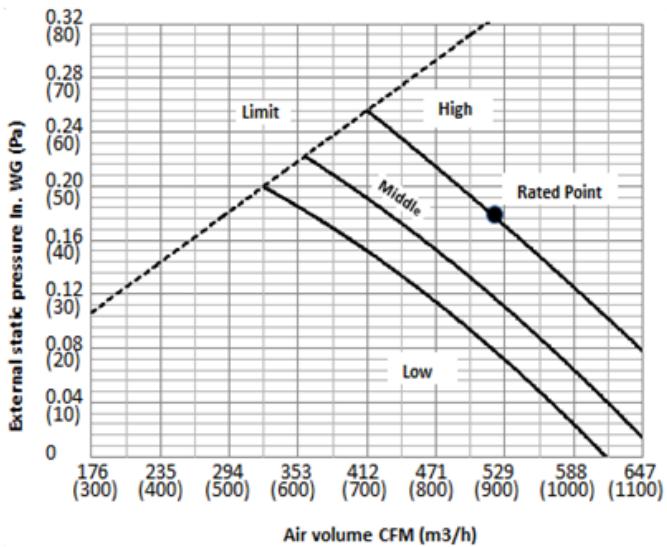

Code 4

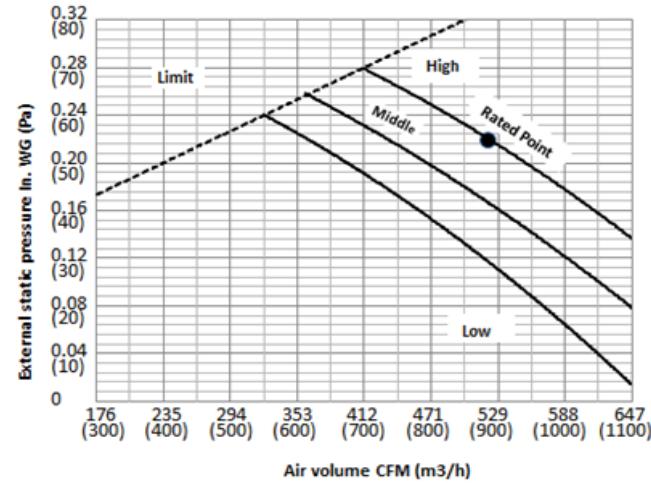


STATIC PRESSURE CURVES SIZE 24

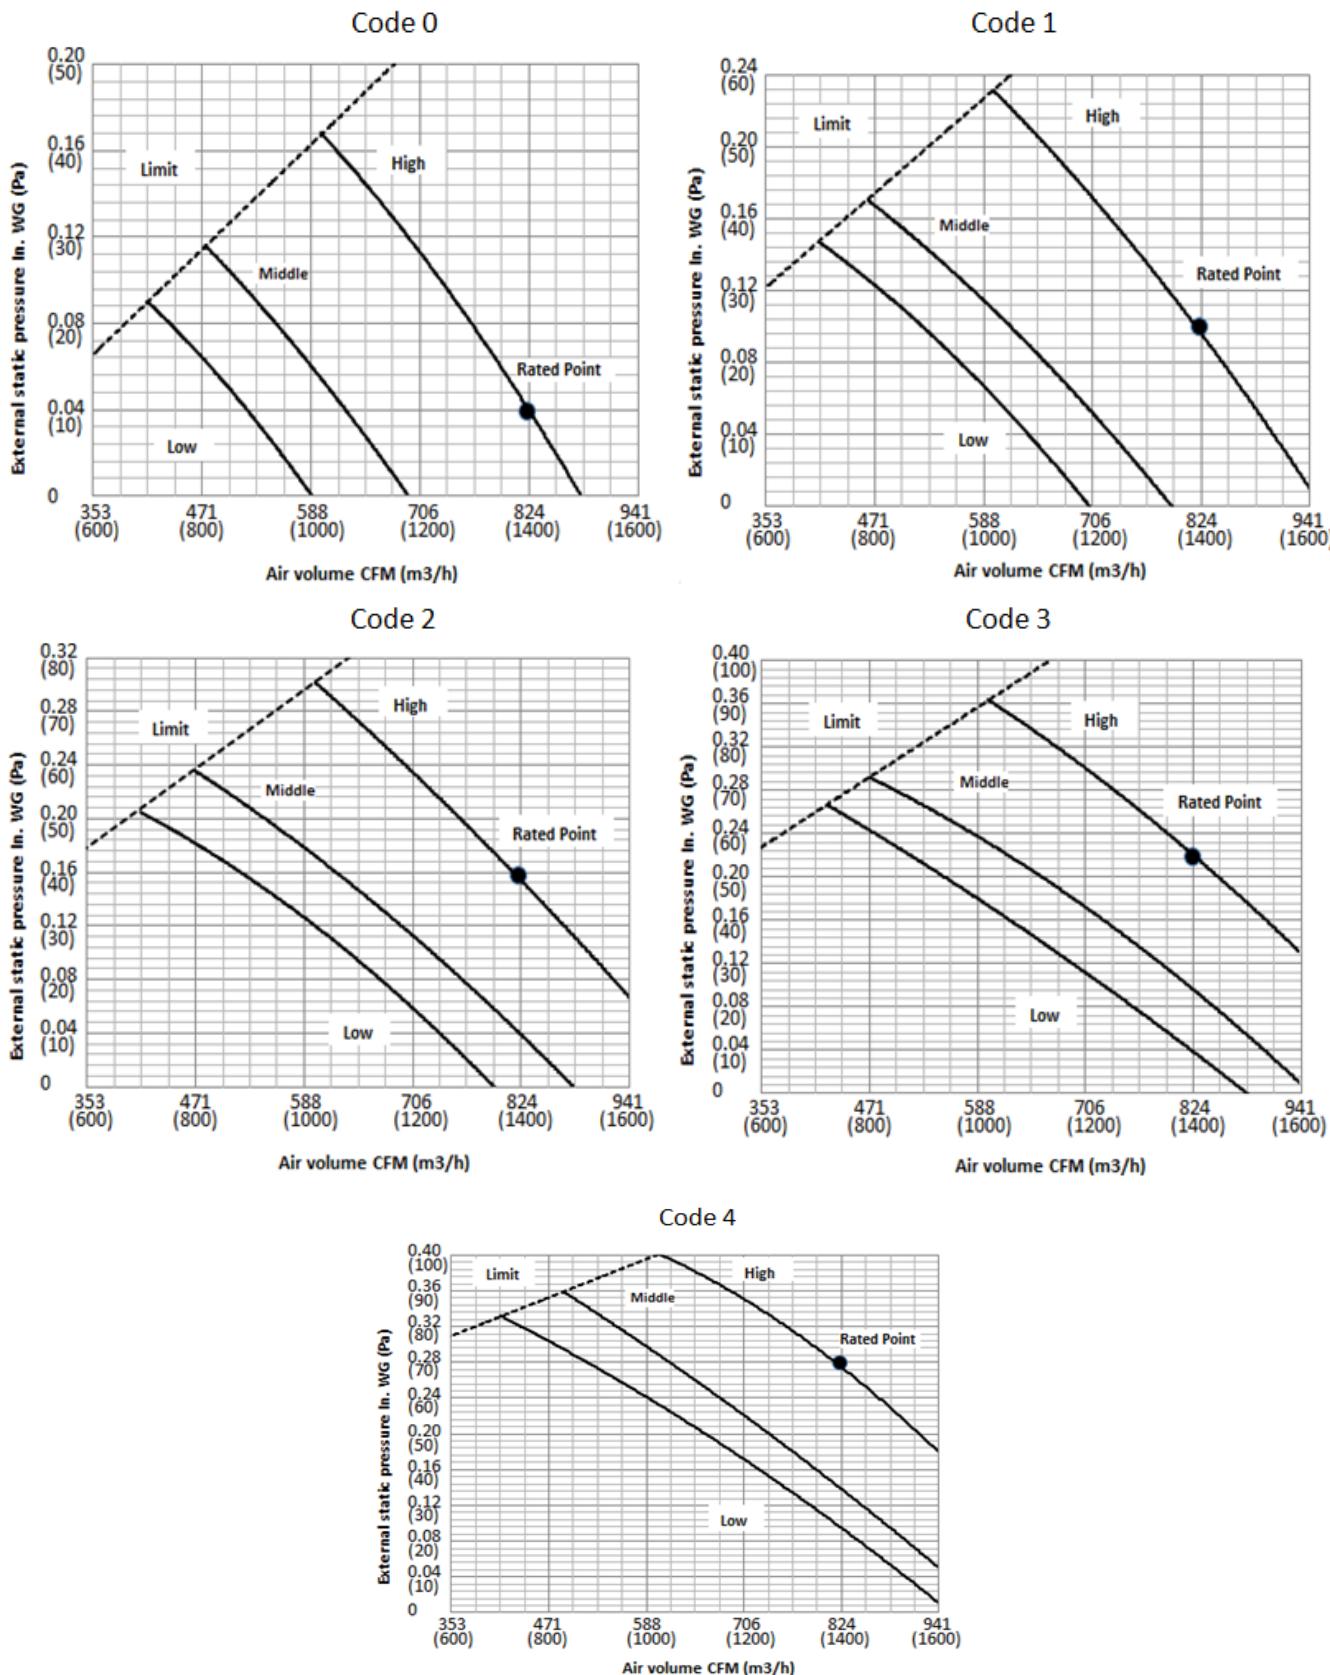


STATIC PRESSURE CURVES SIZE 36


Code 0

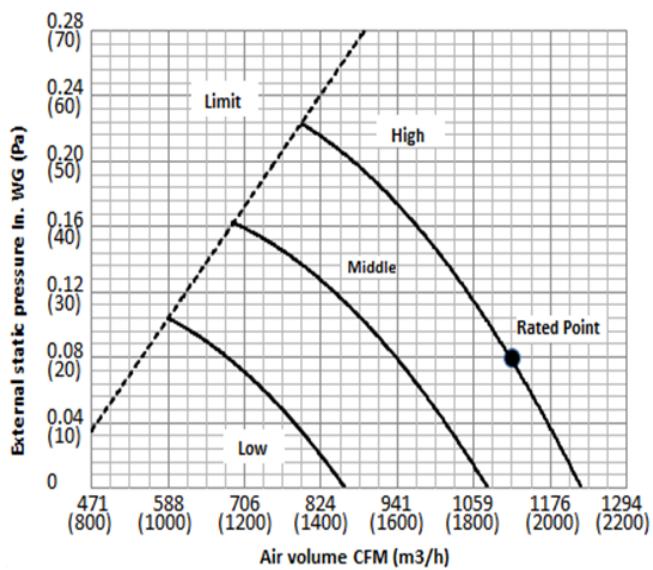


Code 1

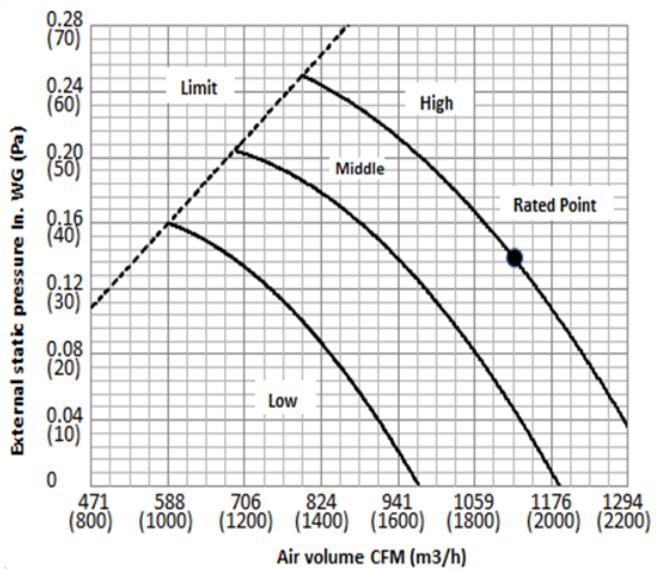


Code 2

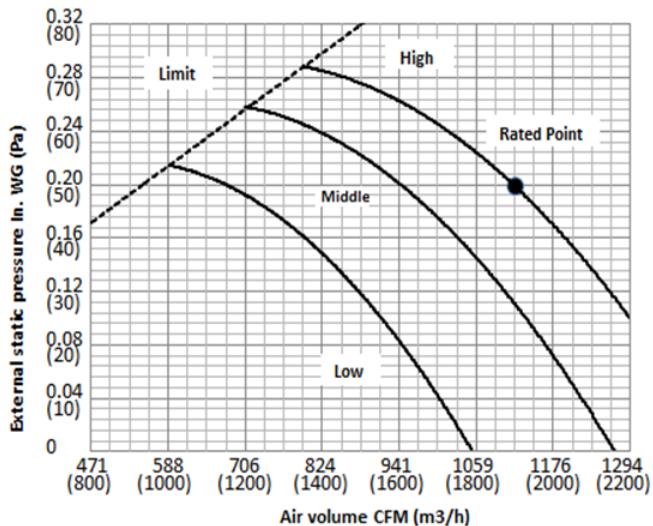

Code 3

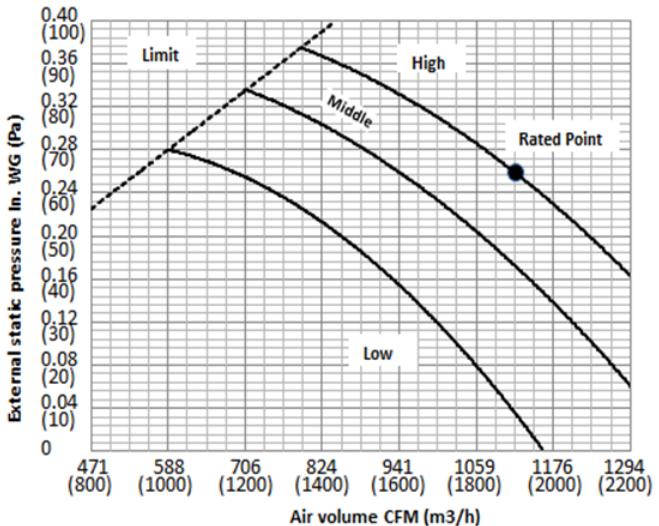


Code 4

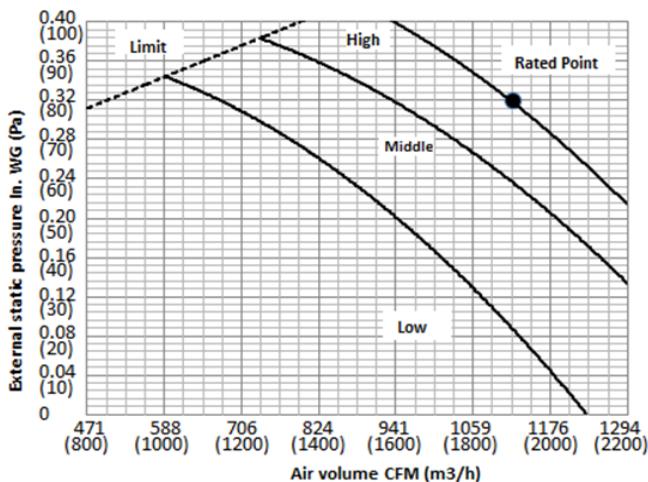


STATIC PRESSURE CURVES SIZE 48


Code 0

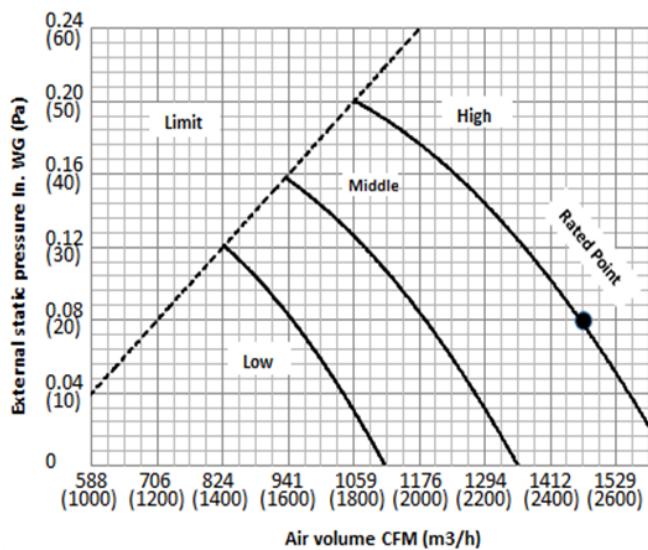


Code 1

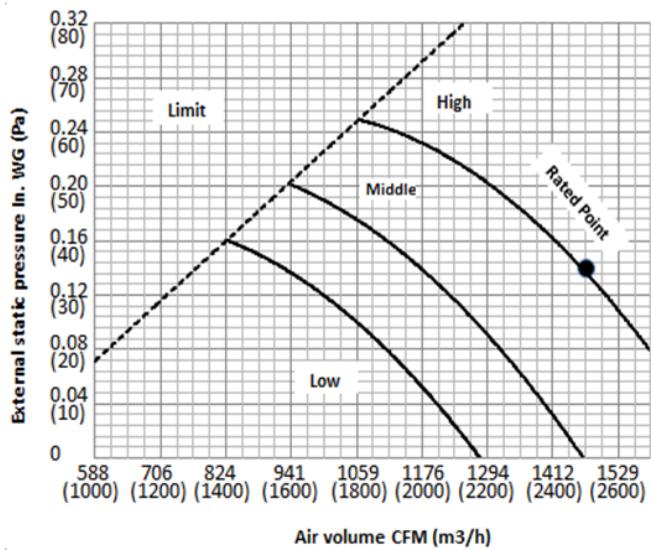


Code 2

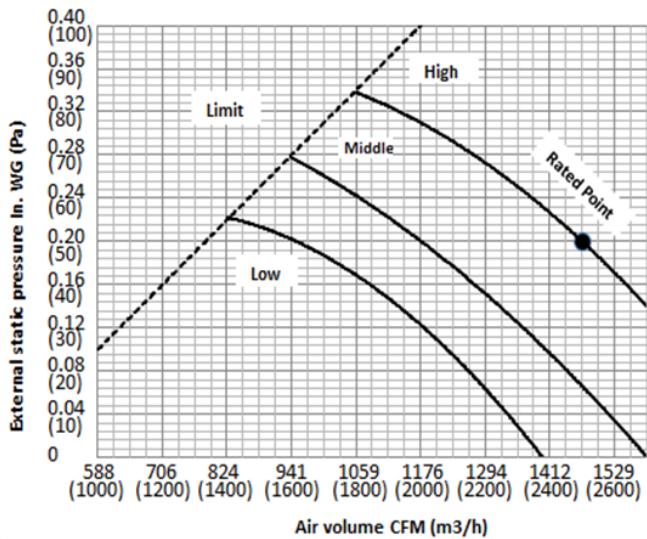

Code 3

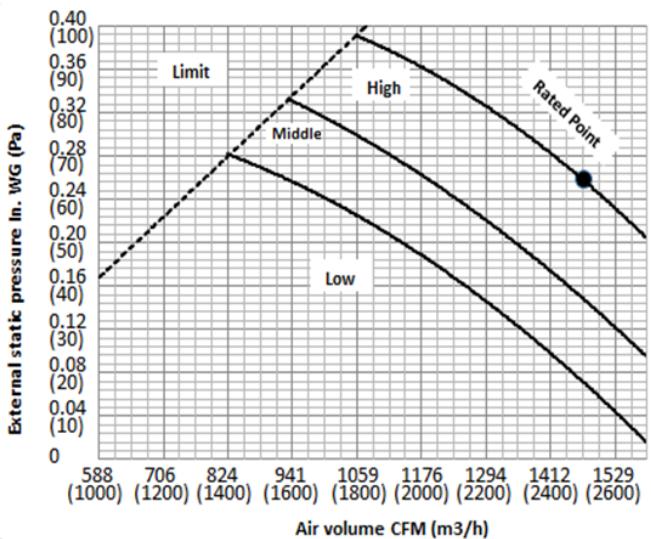

Code 4

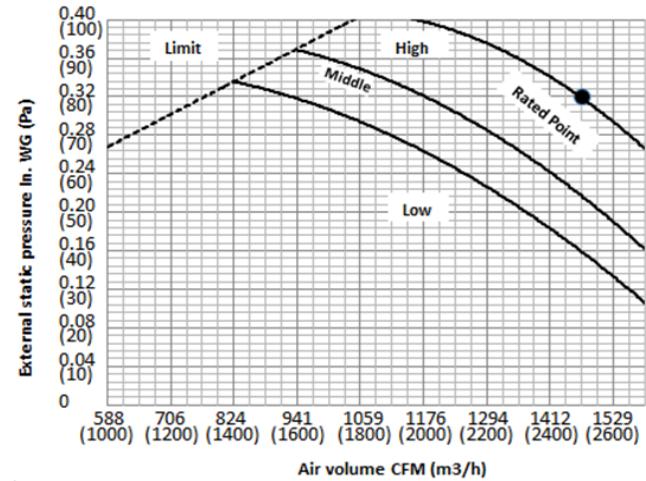

WIRING DIAGRAMS

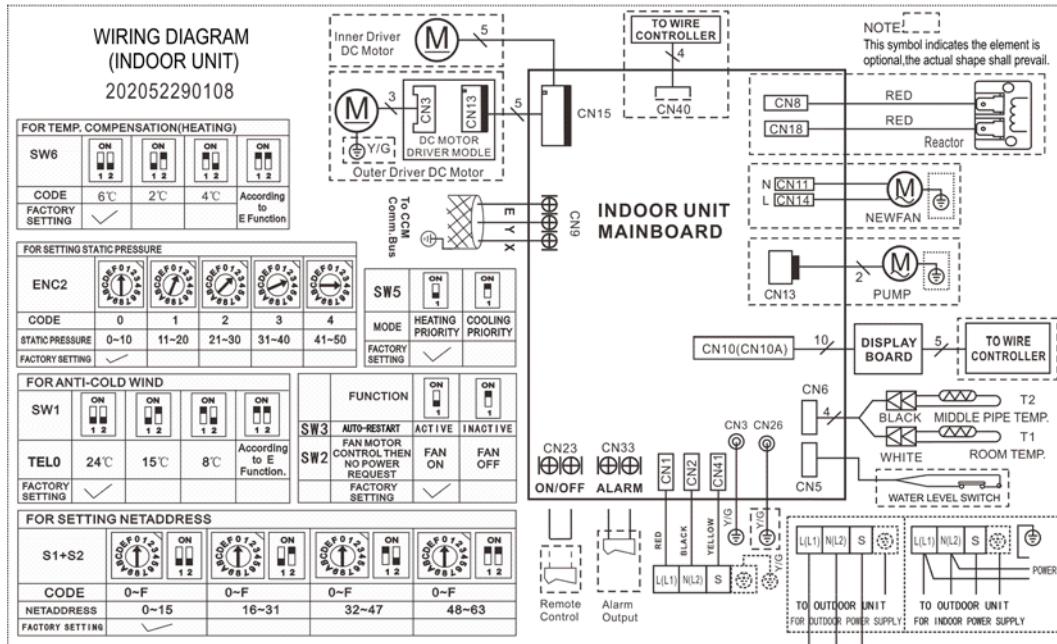


Fig. 7 – Wiring Diagram Sizes 09 – 12

INDOOR UNIT	
CODE	PART NAME
CN1	Input: 230VAC High voltage Connection of the terminal
CN2	Input: 230VAC High voltage Connection of the terminal
CN3/CN26	Output: 0V Connection of the earth
CN5	Output: 0–5VDC Connection of the Water level switch
CN6	Output: 5VDC Connection of the Room and Pipe temperature
CN8/CN18	Output: 320VDC High voltage Connection of the Reactor
CN9	Output: 5VDC Connection of the CCM
CN10(CN10A)	Output: 12VDC Connection of the Display board
CN11/CN14	Output: 220VAC High voltage Connection of the New Fan
CN13	Output: 220VAC High voltage Connection of the Pump
CN15	Output: 320VDC High voltage Connection of the Fan board
CN23	Output: 1–12VDC Connection of the Remote switch
CN33	Output: 0V Connection of the Alarm
CN40	Output: 12VDC Connection of the Wire controller
CN41	Output: 24VDC Between CN2 Connection of the S signal

WIRING DIAGRAMS (CONT)

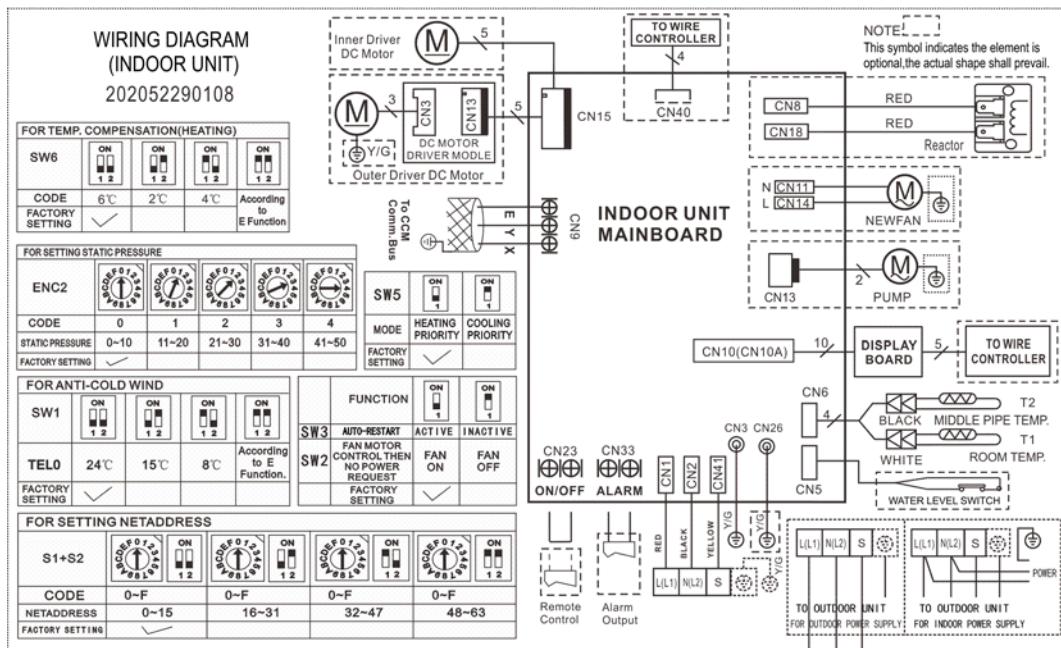


Fig. 8 – Wiring Diagram Size 18

INDOOR UNIT		PART NAME
CODE	CN1	Input: 230VAC High voltage Connection of the terminal
	CN2	Input: 230VAC High voltage Connection of the terminal
	CN3/CN26	Output: 0V Connection of the earth
	CN5	Output: 0~5VDC Connection of the Water level switch
	CN6	Output: 5VDC Connection of the Room and Pipe temperature
	CN8/CN18	Output: 320VDC High voltage Connection of the Reactor
	CN9	Output: 5VDC Connection of the CCM
	CN10(CN10A)	Output: 12VDC Connection of the Display board
	CN11/CN14	Output: 220VAC High voltage Connection of the New Fan
	CN13	Output: 220VAC High voltage Connection of the Pump
	CN15	Output: 320VDC High voltage Connection of the Fan board
	CN23	Output: 1~12VDC Connection of the Remote switch
	CN33	Output: 0V Connection of the Alarm
	CN40	Output: 12VDC Connection of the Wire controller
	CN41	Output: 24VDC Between CN2 Connection of the S signal

WIRING DIAGRAMS (CONT)

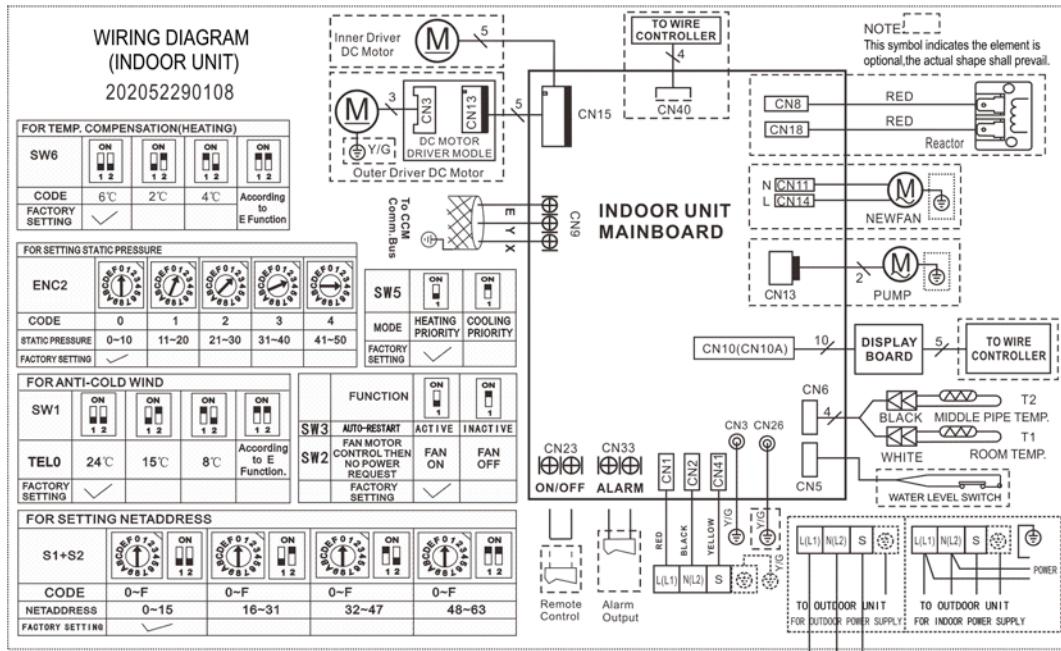


Fig. 9 – Wiring Diagram Size 24

INDOOR UNIT	
CODE	PART NAME
CN1	Input: 230VAC High voltage Connection of the terminal
CN2	Input: 230VAC High voltage Connection of the terminal
CN3/CN26	Output: 0V Connection of the earth
CN5	Output: 0-5VDC Connection of the Water level switch
CN6	Output: 5VDC Connection of the Room and Pipe temperature
CN8/CN18	Output: 320VDC High voltage Connection of the Reactor
CN9	Output: 5VDC Connection of the CCM
CN10(CN10A)	Output: 12VDC Connection of the Display board
CN11/CN14	Output: 220VAC High voltage Connection of the New Fan
CN13	Output: 220VAC High voltage Connection of the Pump
CN15	Output: 320VDC High voltage Connection of the Fan board
CN23	Output: 1-12VDC Connection of the Remote switch
CN33	Output: 0V Connection of the Alarm
CN40	Output: 12VDC Connection of the Wire controller
CN41	Output: 24VDC Between CN2 Connection of the S signal

WIRING DIAGRAMS (CONT)

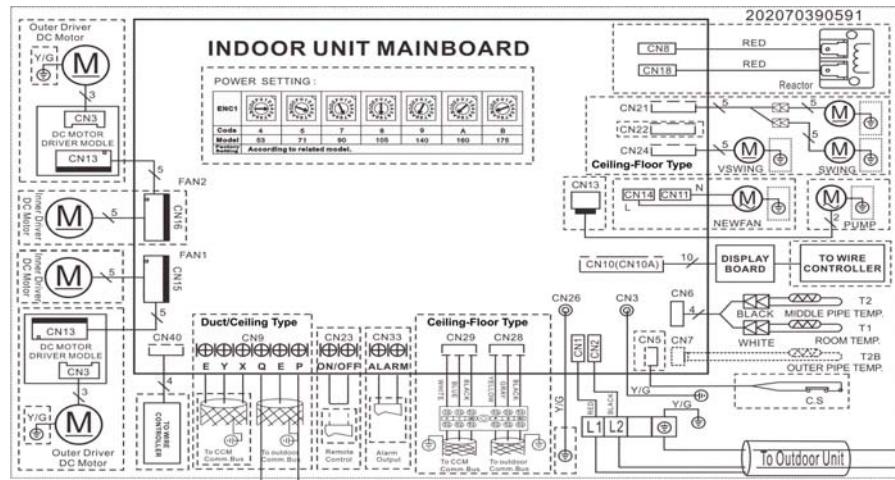


Fig. 10 – Wiring Diagram Size 36

INDOOR UNIT	
CODE	PART NAME
CN1	Input: 230VAC High voltage Connection of the terminal
CN2	Input: 230VAC High voltage Connection of the terminal
CN3	Output: 0V Connection of the earth
CN5	Output: 0–5VDC Connection of the Water level switch
CN6	Output: 5VDC Connection of the Room and Pipe temperature
CN7	Output: 5VDC Connection of the Outer Pipe temperature
CN9	Output: 5VDC Connection of the CCM and RS–485
CN10(CN10A)	Output: 12VDC Connection of the Display board
CN13	Output: 220VAC High voltage Connection of the Pump
CN15	Output: 320VDC High voltage Connection of the Fan board
CN23	Output: 1–12VDC Connection of the Remote switch
CN33	Output: 0V Connection of the Alarm
CN40	Output: 12VDC Connection of the Wire controller

WIRING DIAGRAMS (CONT)

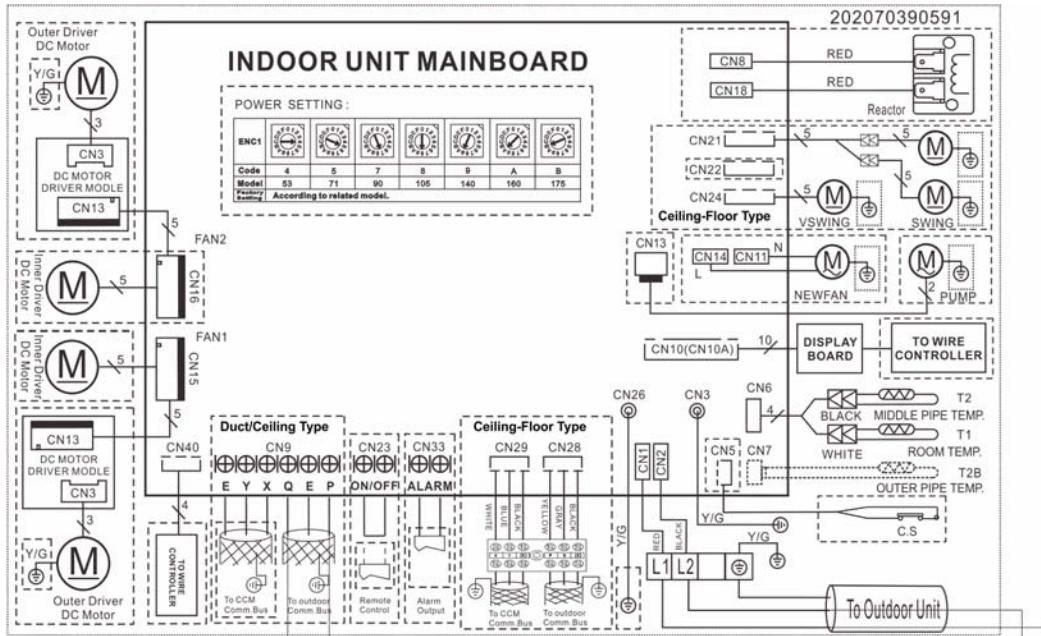


Fig. 11 – Wiring Diagram Size 48

CODE	PART NAME
Indoor Unit	
CN1	Input: 230VAC High voltage Connection of the terminal
CN2	Input: 230VAC High voltage Connection of the terminal
CN3	Output: 0V Connection of the earth
CN5	Output: 0–5VDC Connection of the Water level switch
CN6	Output: 5VDC Connection of the Room and Pipe temperature
CN7	Output: 5VDC Connection of the Outer Pipe temperature
CN9	Output: 5VDC Connection of the CCM and RS-485
CN10(CN10A)	Output: 12VDC Connection of the Display board
CN13	Output: 220VAC High voltage Connection of the Pump
CN15	Output: 320VDC High voltage Connection of the Fan board
CN23	Output: 1–12VDC Connection of the Remote switch
CN33	Output: 0V Connection of the Alarm
CN40	Output: 12VDC Connection of the Wire controller

GUIDE SPECIFICATIONS

INDOOR CEILING-MOUNTED DUCTED STYLE DUCTLESS UNITS

Size Range: 3/4 to 4 Ton Nominal Cooling and Heating Capacity

Model Number: 40MB*D

PART 1 – GENERAL

1.01 System Description

Indoor, ceiling-mounted, direct-expansion fan coils are matched with a heat pump outdoor unit.

1.02 Agency Listings

Unit is rated per AHRI Standards 210/240 and listed in the AHRI directory as a matched system.

1.03 Delivery, Storage, And Handling

Units are stored and handled per unit the manufacturer's recommendations.

1.04 Warranty (For Inclusion By Specifying Engineer)

PART 2 – PRODUCTS

2.01 Equipment

A. General:

Indoor, direct-expansion, ceiling-mounted fan coil. The unit is complete with cooling/heating coil, fan, fan motor, piping connectors, electrical controls, microprocessor control system, and integral temperature sensing.

B. Unit Cabinet:

Unit cabinet is constructed of galvanized steel. The cabinet is fully insulated for improved thermal and acoustic performance.

C. Fans:

The fan is tangential direct-drive blower type with air intake at the rear or bottom of the unit and discharge at the front.

D. Coil:

The coil is a copper tube with aluminum fins and galvanized steel tube sheets. The fins are bonded to the tubes by mechanical expansion and specially blue hydrophilic pre-coated for enhanced wet-ability. A drip pan under the coil has a factory installed condensate pump and drain connection for hose attachment to remove condensate.

E. Motors:

The motors has an open drip-proof, permanently lubricated ball bearing with inherent overload protection. Fan motors are 3-speed.

F. Controls:

The controls consist of a microprocessor-based control system which controls the space temperature, determines optimum fan speed, and runs self diagnostics. The temperature control range is 62°F to 86°F (17°C to 30°C) in increments of 1°F or 1°C, and has a 46°F Heating Mode (Heating Setback). The wireless remote controller can act as the temperature sensing location for room comfort.

The unit has the following functions as a minimum:

1. An automatic restart after power failure at the same operating conditions as at failure.
2. A timer function to provide a minimum 24-hour timer cycle for system Auto Start/Stop.
3. Temperature-sensing controls sense return air temperature.
4. Indoor coil freeze protection.
5. Wireless infrared remote control to enter set points and operating conditions.
6. Dehumidification mode provides increased latent removal capability by modulating system operation and set point temperature.
7. Fan-only operation to provide room air circulation when no cooling is required.
8. Diagnostics provide continuous checks of unit operation and warn of possible malfunctions. Error messages appear on the unit.
9. The fan speed control is user-selectable: high, medium, low, or microprocessor controlled automatic operation during all operating modes.
10. Automatic heating-to-cooling changeover in heat pump mode. The control includes deadband to prevent rapid mode cycling between heating and cooling.
11. Indoor coil high temperature protection is provided to detect an excessive indoor discharge temperature when unit is in the heat pump mode.

G. Electrical Requirements:

The indoor fan motor operates on 208–230V. Power is supplied from the outdoor unit.

H. Operating Characteristics:

The 40MB*D system has a minimum SEER (Seasonal Energy Efficiency Ratio) and HSPF at AHRI conditions, as listed on the specifications table.

I. Refrigerant Lines:

All units have refrigerant lines that can be oriented to connect from the side of the unit. Both refrigerant lines need to be insulated.

