

**180CNV
EVOLUTION® EXTREME
VARIABLE SPEED AIR CONDITIONER
WITH PURON® REFRIGERANT
(2 - 5 Ton)**



Product Data



Bryant's 180C Evolution® Extreme AC is a variable speed cooling product providing up to 20.5 SEER cooling efficiency. Lower speed operation, when needed in cooling, for enhanced comfort and dehumidification.

This product has been designed and manufactured to meet Energy Star® criteria for energy efficiency when matched with appropriate coil components. Refer to the combination ratings in the AHRI for system combinations that meet Energy Star® guidelines.

NOTE: Ratings contained in this document are subject to change at any time. Always refer to the AHRI directory (www.ahridirectory.org) for the most up-to-date ratings information.

INDUSTRY LEADING FEATURES / BENEFITS

Energy Efficiency

- Up to 20.5 SEER/15.5 EER
- Microtube Technology™ refrigeration system
- Indoor air quality accessories available

Sound

- Sound level as low as 58 dBA

Comfort

- Variable speed scroll compressor with capacity range from 40-100%
- Air cooled Inverter variable speed drive
 - System requires Evolution® Connex™ wall control (SYSTXBBITC01-A, SYSTXBBITC01-B or newer)
- Energy Tracking capability with the Evolution® Connex™ wall control
 - Wall Control w/software version 13 or later (Energy Tracking has the ability to monitor and estimate the energy consumption of your Evolution® system.)

Reliability

- Non-ozone depleting Puron® refrigerant
- Front-seating service valves
- High pressure switch
- Suction pressure transducer
- TXV for cooling
- Filter drier (field installed)
- Internal crankcase heater standard

Flexibility and installation:

- 2 control wires to outdoor unit
- Minimum and maximum airflow adjustments

Durability

DuraGuard™ Plus protection package:

- Solid, Durable sheet metal construction
- Steel louver coil guard
- Baked-on, complete outer coverage, powder paint

Applications

- Long-line - up to 250 feet (76.2 m) total equivalent length, up to 200 feet (60.96 m) condenser above evaporator, or up to 80 ft. (24.38 m) evaporator above condenser (See Longline Guide for more information.)

MODEL NUMBER NOMENCLATURE

1 N	2 N	3 N	4 A	5 A/N	6 N	7 N	8 N	9 N	10 A/N	11 A/N	12 N	14 A
1	8	0	C	N	V	0	3	6	0	0	0	A
Product Family 1=AC	Tier 8= Evolution Series	SEER 0 = 20 SEER	Major Series C=Puron	Voltage N= 208–230–1 or 208/230–1	Variations V = Variable Speed	Cooling Capacity 1,000 Btuh (nominal)		Open 0=Not Defined		Open 0=Not Defined	Open 0=Not Defined	Series A = Original Series



Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to www.ahridirectory.org.



ISO 9001
QMI-SAI Global



This product has been designed and manufactured to meet Energy Star® criteria for energy efficiency when matched with appropriate coil components. However, proper refrigerant charge and proper air flow are critical to achieve rated capacity and efficiency. Installation of this product should follow all manufacturing refrigerant charging and air flow instructions. **Failure to confirm proper charge and air flow may reduce energy efficiency and shorten equipment life.**



STANDARD FEATURES

FEATURES	Unit Size – Voltage, Series			
	24–A	36–A	48–A	60–A
Puron Refrigerant	X	X	X	X
Louvered Coil Guard	X	X	X	X
Field Installed Filter Drier	X	X	X	X
Front Seating Service Valves	X	X	X	X
Temperature Protection	X	X	X	X
Long Line capability	X	X	X	X
Suction Pressure Transducer	X	X	X	X
High Pressure Switch	X	X	X	X
Internal Crankcase Heater	X	X	X	X
Low ambient cooling down to 0°F capability with Evolution® Connex™ wall control	X	X	X	X
Utility Interface Connections	X	X	X	X
Enhanced Diagnostics with Evolution® Connex™ wall control	X	X	X	X
Energy Tracking Capability with the Evolution® Connex™ wall control (requires software version 13 or later)	X	X	X	X
Deluxe Sound Blanket	X	X	X	X
Outdoor Air Temperature Sensor	X	X	X	X

X = Standard

REFRIGERANT PIPING LENGTH LIMITATIONS

Maximum Line Lengths:

The maximum allowable total equivalent length for air conditioners can vary depending on the vertical separation. See the tables below for allowable lengths depending on whether the outdoor unit is on the same level, above or below the indoor unit.

Maximum Line Lengths for Air Conditioner Applications

	MAXIMUM ACTUAL LENGTH ft (m)	MAXIMUM EQUIVALENT LENGTH† ft (m)	MAXIMUM VERTICAL SEPARATION ft (m)
Units on equal level	200 (61)	250 (76.2)	N/A
Outdoor unit ABOVE indoor unit	200 (61)	250 (76.2)	200 (61)
Outdoor unit BELOW indoor unit	See Table 'Maximum Total Equivalent Length: Outdoor Unit BELOW Indoor Unit'		

† Total equivalent length accounts for losses due to elbows or fitting. See the Long Line Guideline for details.

Maximum Total Equivalent Length† - Outdoor Unit BELOW Indoor Unit

Size	Liquid Line Diameter w/ TXV	AC with Puron® Refrigerant – Maximum Total Equivalent Length† Vertical Separation ft (m) Outdoor unit BELOW indoor unit;						
		0–20 (0 – 6.1)	21–30 (6.4 – 9.1)	31–40 (9.4 – 12.2)	41–50 (12.5 – 15.2)	51–60 (15.5 – 18.3)	61–70 (18.6 – 21.3)	71–80 (21.6 – 24.4)
24	3/8	250*	250*	250*	250*	250*	250*	250*
36	3/8	250*	250*	250*	250*	250*	250*	250*
48	3/8	250*	250*	250*	250*	230	160	--
60	3/8	250*	225*	190	150*	110	--	--

* Maximum actual length not to exceed 200 ft (61 m)

† Total equivalent length accounts for losses due to elbows or fitting.

-- = outside acceptable range

LONG LINE APPLICATIONS

An application is considered Long Line when the refrigerant level in the system requires the use of accessories to maintain acceptable refrigerant management for systems reliability. Defining a system as long line depends on the liquid line diameter, actual length of the tubing, and vertical separation between the indoor and outdoor units.

For air conditioner systems, the chart below shows when an application is considered Long Line. Beyond these lengths, long line accessories are required:

AC with Puron Referant Long Line Description ft. (m) Beyond these lengths, long line accessories are required.

Liquid Line Size	Units On Same Level	Outdoor Below Indoor	Outdoor Above Indoor
3/8	80 (24.4)	20 (6.1) vertical or 80 (24.4) total	80 (24.4)

Note: See Long Line Guideline for details

COOLING CAPACITY LOSS TABLE

Nominal Size (Btuh)	Line OD (in.)	180CNV Cooling Capacity Loss (%)										
		Total Equivalent Line Length (ft)										
		25	50	75	80	100	125	150	175	200	225	250
24000	5/8	0.5	1.2	1.8	1.9	2.4	3.0	3.7	4.3	4.9	5.5	6.2
	3/4	0.1	0.4	0.6	0.7	0.8	1.1	1.3	1.5	1.8	2.0	2.3
	7/8	0.0	0.1	0.3	0.3	0.4	0.5	0.6	0.7	0.8	1.0	1.1
36000	5/8	1.1	2.4	3.7	4.0	5.0	6.3	7.7	9.0	10.3	11.6	12.9
	3/4	0.3	0.8	1.3	1.4	1.8	2.3	2.8	3.2	3.7	4.2	4.7
	7/8	0.0	0.3	0.5	0.6	0.8	1.0	1.3	1.5	1.8	2.0	2.3
48000	3/4	0.7	1.6	2.4	2.6	3.2	4.1	4.9	5.7	6.5	7.4	8.2
	7/8	0.3	0.7	1.1	1.2	1.6	2.0	2.4	2.8	3.2	3.6	4.1
	1 1/8	0.0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0
60000	3/4	1.0	2.3	3.5	3.8	4.8	6.0	7.3	8.5	9.8	11.0	12.3
	7/8	0.4	1.0	1.7	1.8	2.3	2.9	3.5	4.2	4.8	5.4	6.0
	1 1/8	0.0	0.1	0.3	0.4	0.5	0.7	0.8	1.0	1.2	1.4	1.5

Rating Line Size in **Bold**

MIN/MAX AIRFLOW TABLES

The indoor airflow delivered by this system varies significantly based on outdoor temperature, indoor unit combination, and system demand. The airflows on these tables are for duct design considerations. Duct systems capable of these ranges will ensure

the system will deliver full capacity at all outdoor temperatures. Minimum and maximum airflows can be adjusted from these numbers in the Evolution® Connex™ wall control air conditioner Setup screen.

Cooling – Comfort Mode			Minimum Cooling (Dehum or Zoning)
Size	Max Capacity	Min Capacity	
24	726	651	398
36	1168	651	398
48	1394	1186	693
60	1650	1186	693

Cooling – Efficiency Mode		
Size	Max Capacity	Min Capacity
24	949	830
36	1334	830
48	1593	1355
60	1885	1355

PHYSICAL DATA

UNIT SIZE SERIES	24–A	36–A	48–A	60–A
Operating Weight lb (kg)	315 (143)	315 (143)	324 (147)	324 (147)
Shipping Weight lb (kg)	351 (159)	351 (159)	362 (164)	362 (164)
Compressor Type	Variable Speed Scroll			
REFRIGERANT	Puron® (R-410A)			
Control	TXV (Puron® Hard Shutoff)			
Charge lb (kg)	12.7 (5.76)	12.7 (5.76)	14.0 (6.35)	14.0 (6.35)
COND FAN	Forward Swept Propeller Type, Direct Drive			
Air Discharge	Vertical			
Air Qty (CFM)	2700	4269	4350	5000
Motor HP	1/3	1/3	1/3	1/3
Motor RPM	500–900	500–900	500–900	500–900
COND COIL				
Face Area (Sq ft)	30.25	30.25	30.25	30.25
Fins per In.	20	20	20	20
Rows	2	2	2	2
Circuits	8	8	8	8
VALVE CONNECT. (In. ID)				
Vapor	7/8	7/8	7/8	7/8
Liquid	3/8			
REFRIGERANT TUBES (In. OD)				
Rated Vapor*	7/8	7/8	1–1/8	1–1/8
Max Liquid Line	3/8			

* Units are rated with 25 ft (7.6 m) of lineset length. See Vapor Line Sizing and Cooling Capacity Loss table when using other sizes and lengths of lineset.

Note: See unit Installation Instruction for proper installation.

ACCESSORIES

KIT NUMBER	KIT NAME	24-A	36-A	48-A	60-A
KHAEM0101EMI	Electro-Magnetic Interference (Emi) Kit	X	X	X	X
KHASS0606MPK*	Snow Stand	X	X	X	X
KSASF0201AAA	Support Feet	X	X	X	X
KSATX0301PUR	TXV	X	X		
KSATX0401PUR	TXV			X	X
STANDARD	Internal Crankcase Heater	S	S	S	S

x = Accessory S = Standard * Available from RCD

CONTROLS

SYSTXBBITC01-A & B	Evolution® Connex™ wall control (Wi-Fi)
SYSTXBB4ZC01	4-Zone Damper Control Module (Wall-mounted control for a four-zone system.)
SYSTXBBSMS01	Smart Sensor (Optional wall control used to monitor temperature and/or fan control in an individual zone.)
SYSTXBBRRS01	Remote Room Sensor (Monitors temperature in an individual zone.)
SYSTXBBNIM01	Evolution Network Interface Module (Connects Heat Recovery and Energy Recovery Ventilators on non-zoning applications.)

ACCESSORY USAGE GUIDELINE

ACCESSORY	REQUIRED FOR LOW-AMBIENT COOLING APPLICATIONS (Below 55°F/12.8°C)	REQUIRED FOR LONG LINE APPLICATIONS* (Over 80 ft/24.38 m)	REQUIRED FOR SEA COAST APPLICATIONS (Within 2 miles/3.22 km)	Installations with Radio Frequency Interference Concerns in the Range
Crankcase Heater	Standard	Standard	Standard	N/A
Electro-Magnetic Interference (EMI) Kit	No	No	No	Yes
Evaporator Freeze Protection	Standard with Evolution Control	No	No	N/A
Low-Ambient Control	Standard with Evolution Control	No	No	N/A
Puron Refrigerant Balance Port Hard-ShutOff TXV	Yes†	Yes†	Yes†	N/A
Winter Start Control	Standard with Evolution Control	No	No	N/A

* For tubing set lengths between 80 and 200 ft. (24.38 and 60.96 m) horizontal or 20 ft. (6.10 m) vertical differential (total equivalent length), refer to the Long Line Guideline—Air Conditioners and Heat Pumps using Puron® Refrigerant.

† Required on all indoor units.

Accessory Description and Usage (Listed Alphabetically)

1. Compressor Start Assist

The inverter drive gently starts the variable speed compressor at all times. No other start device is compatible with this unit.

2. Crankcase Heater

Compressor motor winding resistance heater which is internal to compressor to keep the lubricant warm during off cycles. Improves compressor lubrication on restart and minimizes the chance of liquid slugging.

Usage:

Used in low ambient cooling applications.

Used in long line applications.

3. Electro-Magnetic Interference (EMI) Kit

Usage Guideline:

May be required to address radio frequency interference for equipment, such as HAM radios, operating between 6 and 30 MHz.

4. Evaporator Freeze Thermostat

An SPST temperature-actuated switch that stops unit operation when evaporator reaches freeze-up conditions.

Usage Guideline:

Required when low ambient kit has been added.

5. Thermostatic Expansion Valve (TXV) Bi-Flow

A modulating flow-control valve which meters refrigerant liquid flow rate into the evaporator in response to the superheat of the refrigerant gas leaving the evaporator.

Usage Guideline:

Accessory required to meet AHRI rating and system reliability, where indoor not equipped.

Required in all Air conditioner applications designed with Puron refrigerant.

6. Winter Start Control

This control is designed to alleviate nuisance opening of the low-pressure switch by bypassing it for the first 3 minutes of operation.

ELECTRICAL DATA

UNIT SIZE – VOLTAGE, SERIES	V/PH	OPER VOLTS*		COMPR		FAN	MCA	MAX FUSE** or CKT BRK AMPS
		MAX	MIN	LRA	RLA	FLA		
24 – A	208–230–1	253	197	24	15.1	3.2	22.1	30
36 – A				24	15.1	3.2	22.1	30
48 – A				42	25.4	3.2	35	50
60 – A				42	25.4	3.2	35	50

* Permissible limits of the voltage range at which the unit will operate satisfactorily

† If wire is applied at ambient greater than 30°C, consult table 310–16 of the NEC (NFPA 70). The ampacity of non–metallic–sheathed cable (NM), trade name ROMEX, shall be that of 60°C conditions, per the NEC (NFPA 70) Article 336–26. If other than uncoated (no–plated), 60 or 75°C insulation, copper wire (solid wire for 10 AWG or smaller, stranded wire for larger than 10 AWG) is used, consult applicable tables of the NEC (NFPA 70).

‡ Length shown is as measured 1 way along wire path between unit and service panel for voltage drop not to exceed 2%.

** Time–Delay fuse.

FLA – Full Load Amps

LRA – Locked Rotor Amps

MCA – Minimum Circuit Amps

RLA – Rated Load Amps

NOTE: Control circuit is 24–V on all units and requires external power source. Copper wire must be used from service disconnect to unit.

All motors/compressors contain internal overload protection.

Complies with 2010 requirements of ASHRAE Standards 90.1

SOUND POWER LEVEL (dBA)

Unit Size – Voltage, Series	Typical Octave Band Spectrum (without tone adjustment)	Min Speed Cooling	Max Speed Cooling
24 – A	Freq (Hz)	1800 RPM	3200 RPM
	125	60	61
	250	58	60
	500	56	58
	1000	52	58
	2000	48	51
	4000	44	47
	8000	51	55
	Sound Rating (dBA)	58	62
36 – A	Freq (Hz)	1800 RPM	4500 RPM
	125	60	63
	250	58	62
	500	56	65
	1000	52	61
	2000	48	59
	4000	44	56
	8000	51	55
	Sound Rating (dBA)	58	67
48 – A	Freq (Hz)	1800 RPM	3450 RPM
	125	64	68
	250	59	67
	500	57	65
	1000	57	63
	2000	52	59
	4000	51	52
	8000	55	58
	Sound Rating (dBA)	62	68
60 – A	Freq (Hz)	1800 RPM	4250 RPM
	125	64	70
	250	59	71
	500	57	68
	1000	57	67
	2000	52	62
	4000	51	57
	8000	55	57
	Sound Rating (dBA)	62	71

NOTE: Tested in compliance with AHRI 270–2008 but not listed with AHRI.

* 024 & 036 tested at 44°F Outdoor Air Temperature. 048 & 060 tested at 40°F

**Testable RPM limited by outdoor temp. Max unit RPM is 6500 for the 4 ton and 7000 for the 3 and 5 ton.

CHARGING SUBCOOLING (TXV-TYPE EXPANSION DEVICE)

UNIT SIZE – VOLTAGE, SERIES	REQUIRED SUBCOOLING °F (°C) – See UI
24 – A	Subcooling recommendation displayed on wall control after the required stabilization period in Charging Mode must be followed
36 – A	
48 – A	
60 – A	


DIMENSIONS

UNIT	SERIES	ELECTRICAL CHARACTERISTICS				A				B				C				D				E				G				H				J				K				OPERATING				SHIPPING				SHIPPING LENGTH / WIDTH (Sq.)				SHIPPING HEIGHT																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																			
		INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM

NOTES:

- 1. ALLOW 24" (609.6) CLEARANCE TO SERVICE SIDE OF UNIT, 48" (1219.2) ABOVE UNIT, 6" (152.4) ON ONE SIDE, 12" (304.8) ON REMAINING SIDE, AND 24" (609.6) BETWEEN UNITS FOR PROPER AIRFLOW.
- 2. CENTER OF GRAVITY
- 3. SERIES DESIGNATION IS THE 14TH POSITION OF THE UNIT MODEL NUMBER.

Y=YES N=NO	575-3-60	460-3-60	208-230-3-60	208-230-1-60
---------------	----------	----------	--------------	--------------

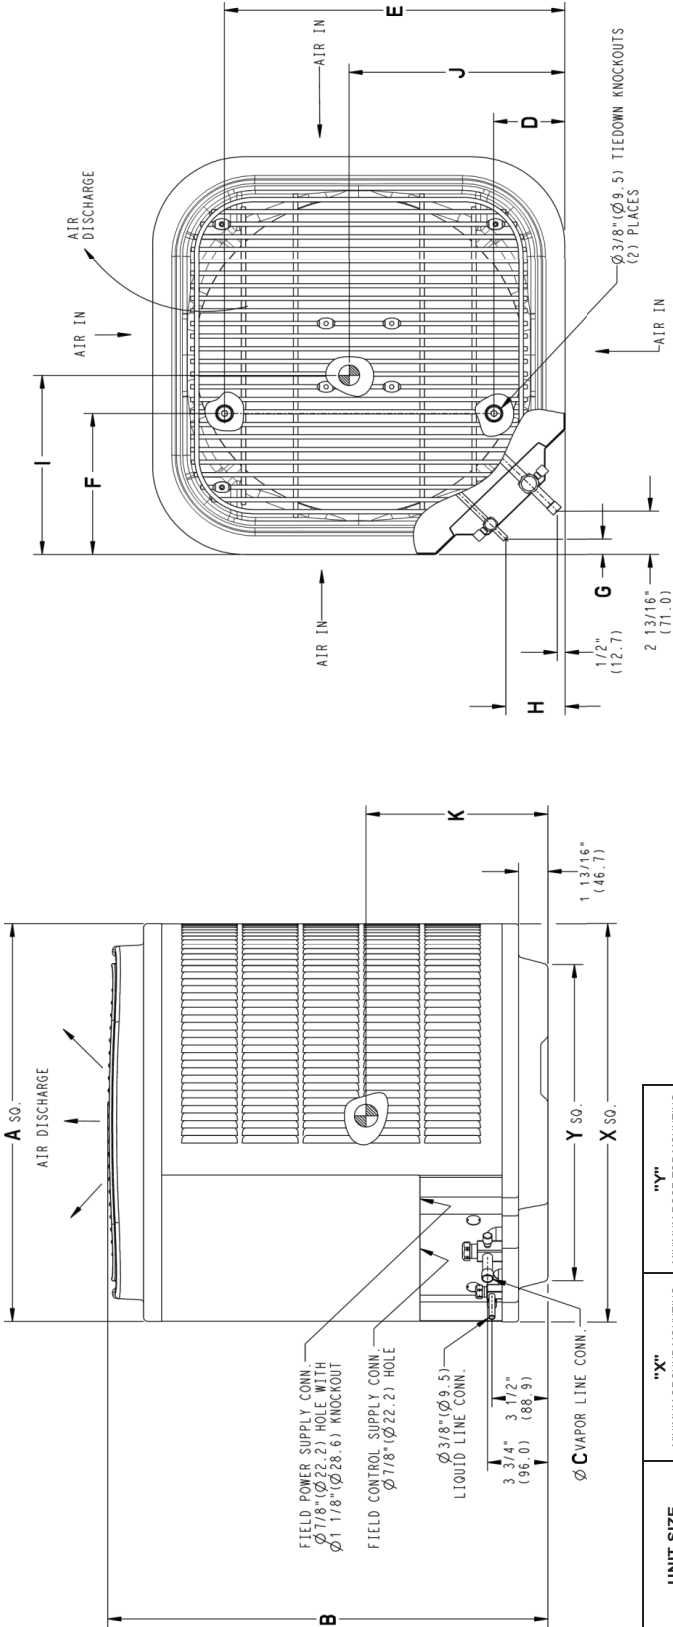


UNIT SIZE	"X"		"Y"	
	MINIMUM GROUND MOUNTING PAD APPLICATION DIMENSIONS		MINIMUM ROOF-TOP MOUNTING PAD APPLICATION DIMENSIONS	
-	23	1/8	587.3	17 7/8
-	25	3/4	654.0	20 7/16
-	31	3/16	792.5	22 15/16
24,36,48,60	35		889.0	26 3/4

NOTE: ALL DIMENSIONS IN INCH (MM)

U.S. ECCN: Not Subject to Regulation (N.S.R.)

CLEARANCES

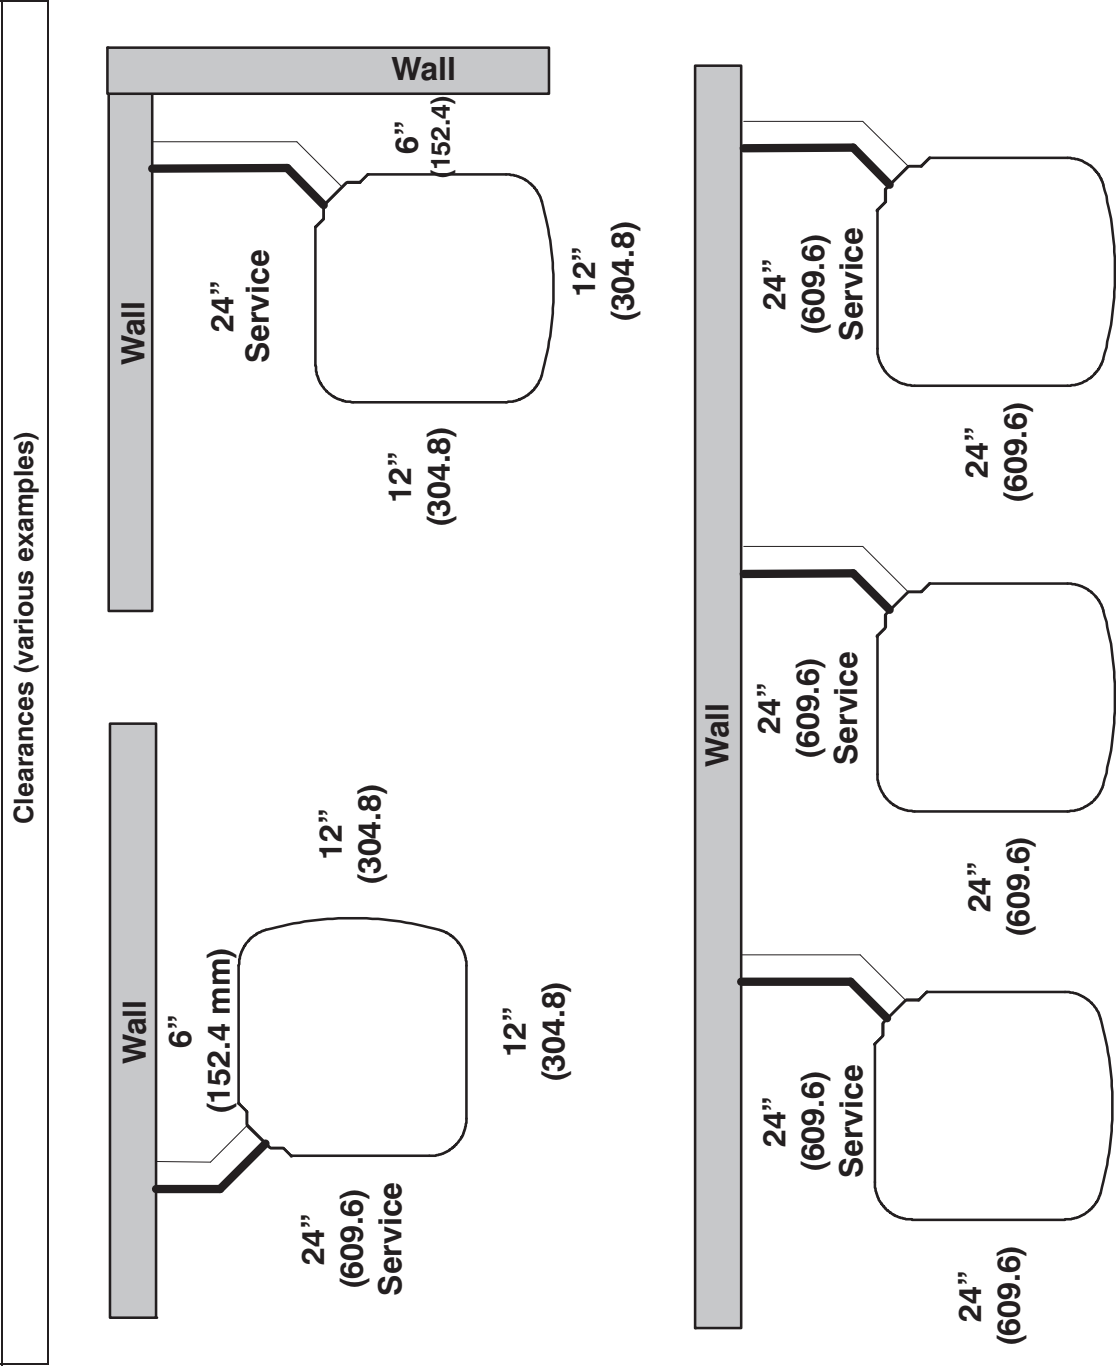

Note: Numbers in () = mm

IMPORTANT: When installing multiple units in an alcove, roof well, or partially enclosed area, ensure there is adequate ventilation to prevent re-circulation of discharge air.

TESTED AHRI TESTED COMBINATION RATINGS*

NOTE: Ratings contained in this document are subject to change at any time.

For AHRI ratings certificates, please refer to the AHRI directory www.ahridirectory.org

Additional ratings and system combinations can be accessed via the Bryant database at: http://cactaxcredits.info/bryant-ratings/hp_ratings_sreh.php

Equipment performance calculator can be accessed at: <http://rpmobbry.wrightsoft.com/>

Model Number	Coil Model Number	Furnace Model Number	Clg. Cap. High	Clg. Cap. Low	EER	SEER	ID CFM	
							High	Low
180CNV024****A	CAP**3617AL	315(A,J)AV036070	24,000	16,100	14.5	18.0	900	650
180CNV036****A	CAP**3617AL	315(A,J)AV036070	33,000	16,100	12.5	18.0	1200	875
180CNV048****A	CAP**6124AL	315(A,J)AV060110	47,500	30,400	13.0	18.0	1500	1100
180CNV060****A	CAP**6124AL	315(A,J)AV060110	55,500	30,400	13.0	18.0	1500	1100

* Ratings are net values reflecting the effects of circulating fan heat. Supplemental electric heat is not included. Ratings are based on:

Cooling Standard: 80°F (27°C) db 67°F (19°C) wb indoor entering air temperature and 95°F (35°C) db air entering outdoor unit.

EER — Energy Efficiency Ratio

SEER — Seasonal Energy Efficiency Ratio

UI — User Interface

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE

180CNU024/CAP**3617AL+315(A,J)AV036070 Comfort + Dehumidify Mode																
Condenser Entering Air Temperature °F (°C)																
EDB °F (°C)	EVAP. AIR EWB °F (°C)	125 (51.7)			115 (46.1)			105 (40.5)			95 (35)			Total Sys. KW**		
		ID SCFM	Capacity MBtu/h† Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtu/h† Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtu/h† Total	Sens†				
75 (23.9)	72 (22.2)	520	22.52	9.09	2.89	510	23.63	9.52	2.41	500	24.37	9.80	1.96	25.00	10.15	1.61
	67 (19.4)		20.21	11.61	2.95		21.22	12.04	2.46		21.92	12.28	2.01	22.57	12.52	1.66
	63 (17.2)		18.48	13.64	2.99		19.54	14.04	2.51		20.15	14.22	2.05	20.78	14.43	1.69
	57 (13.9)		16.80	15.94	3.03		17.33	16.93	2.56		17.95	17.13	2.11	19.68	13.39	1.70
80 (26.7)	72 (22.2)	520	22.47	11.94	2.89	510	23.57	12.14	2.41	500	24.33	12.37	1.96	25.03	12.60	1.61
	67 (19.4)		20.15	14.27	2.95		21.17	14.57	2.58		21.88	14.81	2.01	22.53	15.00	1.66
	63 (17.2)		18.48	16.23	2.98		19.48	16.57	2.51		20.15	16.74	2.05	20.78	16.90	1.69
	57 (13.9)		17.58	17.58	3.01		18.27	18.27	2.54		18.72	18.72	2.09	19.12	19.12	1.73
MAXIMUM DEMAND																
75 (23.9)	72 (22.2)	510	21.82	8.81	2.90	480	22.04	8.88	2.32	420	20.74	8.35	1.72	19.55	7.87	1.25
	67 (19.4)		19.62	11.30	2.96		19.78	11.21	2.38		18.64	10.39	1.77	17.59	9.80	1.29
	63 (17.2)		17.91	13.20	3.00		18.15	13.02	2.42		17.12	12.00	1.81	16.11	11.40	1.33
	57 (13.9)		16.00	16.00	3.05		16.09	15.73	2.47		15.21	14.40	1.86	14.39	13.59	1.38
80 (26.7)	72 (22.2)	510	21.78	11.39	2.90	480	21.99	11.30	2.32	420	20.70	10.47	1.71	19.51	9.87	1.25
	67 (19.4)		19.51	13.81	2.96		19.74	13.61	2.38		18.62	12.50	1.77	17.55	11.78	1.29
	63 (17.2)		20.71	10.41	2.92		18.11	13.80	2.33		17.11	14.09	1.81	16.17	13.29	1.33
	57 (13.9)		17.07	17.07	3.03		16.97	16.97	2.45		15.80	15.80	1.84	14.93	14.93	1.36
MINIMUM DEMAND																
75 (23.9)	72 (22.2)	505	21.35	8.62	3.17	445	20.59	8.30	2.44	360	17.52	7.06	1.61	14.19	5.72	0.99
	67 (19.4)		19.11	11.08	3.23		18.48	10.43	2.49		15.74	8.79	1.66	12.74	7.17	1.03
	63 (17.2)		17.52	12.93	3.28		16.95	12.12	2.55		14.44	10.15	1.70	11.70	8.30	1.06
	57 (13.9)		15.64	15.64	3.33		15.05	14.61	2.60		12.81	12.19	1.75	10.38	10.01	1.11
80 (26.7)	72 (22.2)	505	21.32	11.15	3.17	445	20.56	10.52	2.44	360	17.52	8.81	1.61	14.16	7.22	0.99
	67 (19.4)		19.09	13.53	3.23		18.45	12.65	2.50		15.70	10.58	1.66	12.71	8.66	1.03
	63 (17.2)		17.54	15.41	3.28		16.95	14.30	2.55		14.44	11.93	1.70	11.69	9.79	1.06
	57 (13.9)		16.70	16.70	3.31		15.79	15.79	2.58		13.34	13.34	1.73	10.87	10.87	1.09

See additional notes on page 26

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE (CONT.)

180CNV024/CAP**3617AL+315(A,J)AV036070 Comfort + Dehumidify Mode Condenser Entering Air Temperature ° F (° C)													
EDB ° F (° C)	EVAP. AIR EWB ° F (° C)	ID SCFM	85 (29.4)		Total Sys. KW**	ID SCFM	75 (23.9)		Total Sys. KW**	ID SCFM	65 (18.3)		Total Sys. KW**
			Capacity MBtuht Total	Sens†			Capacity MBtuht Total	Sens†			Capacity MBtuht Total	Sens†	
MAXIMUM DEMAND													
75 (23.9)	72 (22.2)	510	26.37	10.61	1.33	530	27.63	11.10	1.10	540	28.76	11.57	0.87
	67 (19.4)		23.77	13.21	1.38		24.95	13.76	1.15		25.96	14.35	0.92
	63 (17.2)		21.97	15.17	1.42		23.04	15.85	1.18		24.04	16.45	0.96
	57 (13.9)		19.60	18.16	1.48		20.60	18.98	1.24		21.50	19.61	1.01
80 (26.7)	72 (22.2)	510	26.34	13.23	1.33	530	27.60	13.83	1.09	540	28.72	14.36	0.87
	67 (19.4)		23.76	15.74	1.38		24.92	16.44	1.14		25.96	17.01	0.92
	63 (17.2)		21.96	17.74	1.42		23.04	18.53	1.18		24.03	19.15	0.96
	57 (13.9)		20.16	20.16	1.46		21.14	21.14	1.22		21.96	21.96	1.00
MEDIAN DEMAND													
75 (23.9)	72 (22.2)	415	20.66	8.32	1.02	435	21.73	8.75	0.83	450	22.70	9.14	0.65
	67 (19.4)		18.61	10.36	1.07		19.60	10.89	0.87		20.49	11.36	0.70
	63 (17.2)		17.14	11.96	1.11		18.06	12.57	0.91		18.91	13.11	0.73
	57 (13.9)		15.29	14.36	1.16		16.14	15.11	0.96		16.92	15.74	0.78
80 (26.7)	72 (22.2)	415	20.65	10.37	1.02	435	21.69	10.94	0.83	450	22.66	11.41	0.65
	67 (19.4)		18.58	12.43	1.07		19.56	13.06	0.87		20.45	13.61	0.70
	63 (17.2)		17.13	14.02	1.11		18.06	14.74	0.91		18.91	15.35	0.73
	57 (13.9)		15.81	15.81	1.14		16.67	16.67	0.94		17.42	17.42	0.77
MINIMUM DEMAND													
75 (23.9)	72 (22.2)	320	15.08	6.08	0.81	340	15.94	6.42	0.65	355	16.71	6.74	0.50
	67 (19.4)		13.57	7.63	0.85		14.36	8.08	0.69		15.07	8.47	0.55
	63 (17.2)		12.47	8.86	0.88		13.21	9.39	0.72		13.88	9.84	0.58
	57 (13.9)		11.10	10.69	0.93		11.79	11.35	0.76		13.10	10.65	0.60
80 (26.7)	72 (22.2)	320	15.05	7.68	0.81	340	15.90	8.12	0.65	355	16.68	8.51	0.50
	67 (19.4)		13.54	9.22	0.85		14.32	9.77	0.69		15.04	10.23	0.55
	63 (17.2)		12.46	10.44	0.88		13.21	11.08	0.72		13.88	11.60	0.58
	57 (13.9)		11.61	11.61	0.91		12.32	12.32	0.75		12.94	12.94	0.60

See additional notes on page 26

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE (CONT.)

180CNU036/CAP**3617AL+315(A,J)AV036070 Comfort + Dehumidify Mode																	
Condenser Entering Air Temperature ° F (° C)																	
EDB ° F (° C)	EVAP. AIR EWB ° F (° C)	125			115			105			95						
		ID SCFM	Capacity MBtu/h† Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtu/h† Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtu/h† Total	Sens†	Total Sys. KW**				
75 (23.9)	72 (22.2)	685	29.28	11.77	3.82	705	31.29	12.55	3.29	730	33.23	13.32	2.82	750	34.98	14.00	2.43
	67 (19.4)		26.25	15.09	3.88		28.00	15.91	3.35		29.90	16.88	2.87		31.53	17.67	2.48
	63 (17.2)		24.06	17.67	3.92		25.82	18.66	3.40		27.52	19.66	2.91		29.22	20.67	2.51
	57 (13.9)		21.49	21.49	3.97		23.06	22.60	3.45		24.64	23.84	2.97		26.06	24.89	2.57
80 (26.7)	72 (22.2)	685	29.24	15.24	3.82	705	31.25	16.10	3.29	730	33.18	17.00	2.82	750	34.95	17.79	2.43
	67 (19.4)		26.20	18.49	3.88		28.07	19.49	3.36		29.86	20.47	2.87		31.48	21.38	2.48
	63 (17.2)		24.11	21.07	3.92		25.86	22.17	3.39		27.54	23.28	2.91		29.09	24.26	2.51
	57 (13.9)		22.90	22.90	3.96		24.36	24.36	3.42		25.88	25.88	2.94		27.21	27.21	2.55
MEDIAN DEMAND																	
75 (23.9)	72 (22.2)	595	25.69	10.35	3.37	580	26.45	10.63	2.77	535	25.79	10.36	2.12	480	24.68	9.92	1.62
	67 (19.4)		23.07	13.28	3.44		23.76	13.49	2.82		23.20	13.01	2.18		22.22	12.31	1.67
	63 (17.2)		21.13	15.57	3.48		21.82	15.72	2.87		21.33	15.09	2.22		20.46	14.18	1.71
	57 (13.9)		18.88	18.88	3.53		19.46	19.06	2.93		19.02	18.21	2.28		18.23	16.99	1.76
80 (26.7)	72 (22.2)	595	25.68	13.40	3.37	580	26.40	13.60	2.76	535	25.75	13.11	2.12	480	24.64	12.38	1.62
	67 (19.4)		22.99	16.28	3.49		23.72	16.41	2.82		23.16	15.72	2.18		22.14	14.82	1.67
	63 (17.2)		21.16	18.55	3.48		23.96	11.06	2.78		21.33	17.79	2.22		20.47	16.59	1.71
	57 (13.9)		20.07	20.07	3.50		20.50	20.50	2.90		19.87	19.87	2.26		18.81	18.81	1.75
MINIMUM DEMAND																	
75 (23.9)	72 (22.2)	505	21.35	8.62	3.17	445	20.59	8.30	2.44	360	17.52	7.06	1.61	300	14.19	5.72	0.99
	67 (19.4)		19.11	11.08	3.23		18.48	10.43	2.49		15.74	8.79	1.66		12.74	7.17	1.03
	63 (17.2)		17.52	12.93	3.28		16.95	12.12	2.55		14.44	10.15	1.70		11.70	8.30	1.06
	57 (13.9)		15.64	15.64	3.33		15.05	14.61	2.60		12.81	12.19	1.75		10.38	10.01	1.11
80 (26.7)	72 (22.2)	505	21.32	11.15	3.17	445	20.56	10.52	2.44	360	17.52	8.81	1.61	300	14.16	7.22	0.99
	67 (19.4)		19.09	13.53	3.23		18.45	12.65	2.50		15.70	10.58	1.66		12.71	8.66	1.03
	63 (17.2)		17.54	15.41	3.28		16.95	14.30	2.55		14.44	11.93	1.70		11.69	9.79	1.06
	57 (13.9)		16.70	16.70	3.31		15.79	15.79	2.58		13.34	13.34	1.73		10.87	10.87	1.09

See additional notes on page 26

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE (CONT.)

180CNV036/CAP**3617AL+315(A,J)AV036070 Expanded Ratings Cooling Comfort + Dehumidify Mode															
Condenser Entering Air Temperature ° F (° C)															
EDB ° F (° C)	EVAP. AIR EWB ° F (° C)	85 (29.4)			75 (23.9)			65 (18.3)			Total Sys. KW**	ID SCFM	Capacity MBtuht		Total Sys. KW**
		ID SCFM	Capacity MBtuht Total	Sens†	ID SCFM	Capacity MBtuht Total	Sens†	ID SCFM	Capacity MBtuht Total	Sens†					
MAXIMUM DEMAND															
75 (23.9)	72 (22.2)	805	36.98	14.78	2.07	855	38.83	15.51	1.76	885	40.44	16.13	1.49		
	67 (19.4)		33.36	18.72	2.12		35.09	19.71	1.81		36.58	20.48	1.53		
	63 (17.2)		30.81	21.81	2.16		32.41	22.96	1.85		33.79	23.86	1.57		
	57 (13.9)		27.66	26.44	2.21		30.91	22.57	1.86		30.47	28.95	1.62		
80 (26.7)	72 (22.2)	805	36.93	18.81	2.07	855	38.80	19.79	1.76	885	40.39	20.52	1.49		
	67 (19.4)		33.31	22.67	2.12		35.02	23.85	1.81		36.52	24.77	1.53		
	63 (17.2)		30.84	25.78	2.16		32.45	27.16	1.85		33.89	28.25	1.57		
	57 (13.9)		28.91	28.91	2.19		30.48	30.48	1.88		31.83	31.83	1.60		
MEDIAN DEMAND															
75 (23.9)	72 (22.2)	500	26.01	10.45	1.35	520	27.27	10.96	1.10	535	28.43	11.42	0.88		
	67 (19.4)		23.44	12.95	1.40		24.61	13.57	1.15		25.67	14.11	0.93		
	63 (17.2)		21.62	14.92	1.43		22.72	15.62	1.19		23.73	16.23	0.97		
	57 (13.9)		19.30	17.86	1.49		20.31	18.69	1.24		21.23	19.40	1.02		
80 (26.7)	72 (22.2)	500	25.96	13.02	1.34	520	27.23	13.63	1.10	535	28.38	14.17	0.88		
	67 (19.4)		23.41	15.48	1.40		24.57	16.20	1.15		25.64	16.82	0.93		
	63 (17.2)		21.62	17.45	1.43		22.72	18.25	1.19		23.72	18.94	0.97		
	57 (13.9)		19.84	19.84	1.48		20.83	20.83	1.23		21.70	21.70	1.01		
MINIMUM DEMAND															
75 (23.9)	72 (22.2)	320	15.08	6.08	0.81	340	15.94	6.42	0.65	355	16.71	6.74	0.50		
	67 (19.4)		13.57	7.63	0.85		14.36	8.08	0.69		15.07	8.47	0.55		
	63 (17.2)		12.47	8.86	0.88		13.21	9.39	0.72		13.88	9.84	0.58		
	57 (13.9)		11.10	10.69	0.93		11.79	11.35	0.76		13.10	10.65	0.60		
80 (26.7)	72 (22.2)	320	15.05	7.68	0.81	340	15.90	8.12	0.65	355	16.68	8.51	0.50		
	67 (19.4)		13.54	9.22	0.85		14.32	9.77	0.69		15.04	10.23	0.55		
	63 (17.2)		12.46	10.44	0.88		13.21	11.08	0.72		13.88	11.60	0.58		
	57 (13.9)		11.61	11.61	0.91		12.32	12.32	0.75		12.94	12.94	0.60		

See additional notes on page 26

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE (CONT.)

180CNV048/CAP**6124AL+315(A,J)AV060110 Expanded Ratings Cooling Comfort with Dehumidify Mode																	
Condenser Entering Air Temperature ° F (° C)																	
EDB ° F (° C)	EVAP. AIR EWB ° F (° C)	125			115			105			95						
		ID SCFM	Capacity MBtu/h† Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtu/h† Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtu/h† Total	Sens†	Total Sys. KW**				
75 (23.9)	72 (22.2)	790	41.50	16.59	4.64	840	44.64	17.83	4.15	900	47.72	19.05	3.69	950	50.57	20.18	3.30
	67 (19.4)		37.50	20.69	4.64		40.29	22.34	4.14		43.17	23.74	3.68		45.76	25.03	3.28
	63 (17.2)		34.54	23.89	4.63		37.22	25.64	4.14		39.83	27.42	3.67		42.31	28.94	3.27
	57 (13.9)		30.62	28.62	4.63		33.07	30.69	4.13		35.47	32.87	3.67		39.45	28.03	3.27
80 (26.7)	72 (22.2)	790	41.43	20.75	4.64	840	44.55	22.25	4.15	900	47.62	23.78	3.69	950	50.28	25.44	3.30
	67 (19.4)		37.41	24.81	4.64		40.25	26.65	4.14		43.02	28.48	3.68		45.66	30.08	3.28
	63 (17.2)		34.47	28.05	4.64		37.07	30.12	4.14		39.73	32.08	3.67		42.18	33.98	3.27
	57 (13.9)		31.54	31.54	4.64		33.86	33.86	4.13		36.31	36.30	3.67		38.49	38.49	3.27
MAXIMUM DEMAND																	
75 (23.9)	72 (22.2)	775	40.90	16.35	4.46	795	42.20	16.87	3.80	780	40.83	16.32	3.03	755	39.44	15.77	2.40
	67 (19.4)		36.95	20.39	4.46		38.16	21.00	3.80		36.91	20.38	3.03		35.55	19.86	2.39
	63 (17.2)		33.95	23.71	4.46		35.13	24.31	3.80		34.02	23.59	3.03		32.87	22.82	2.39
	57 (13.9)		30.18	28.23	4.45		32.88	24.36	3.79		30.33	28.34	3.03		29.29	27.45	2.39
80 (26.7)	72 (22.2)	775	40.83	20.45	4.46	795	42.13	21.08	3.80	780	40.72	20.43	3.03	755	39.33	19.71	2.39
	67 (19.4)		36.88	24.45	4.46		38.05	25.18	3.80		36.80	24.49	3.03		35.56	23.67	2.39
	63 (17.2)		33.98	27.61	4.46		36.96	18.84	3.78		33.96	27.68	3.03		32.84	26.70	2.39
	57 (13.9)		31.07	31.07	4.47		32.05	32.05	3.80		31.12	31.12	3.03		30.09	30.09	2.39
MINIMUM DEMAND																	
75 (23.9)	72 (22.2)	760	40.67	16.26	4.60	750	40.09	16.03	3.72	635	33.63	13.46	2.54	535	27.58	11.05	1.68
	67 (19.4)		36.68	20.26	4.60		36.20	19.99	3.72		30.38	16.82	2.54		24.93	13.88	1.68
	63 (17.2)		33.92	23.29	4.61		33.35	23.10	3.72		28.00	19.46	2.55		22.95	16.14	1.69
	57 (13.9)		29.98	28.07	4.60		29.64	27.73	3.73		24.86	23.37	2.55		20.39	19.42	1.69
80 (26.7)	72 (22.2)	760	40.46	20.29	4.60	750	39.99	20.05	3.72	635	33.53	16.86	2.54	535	27.49	13.91	1.68
	67 (19.4)		36.65	24.33	4.60		36.12	23.99	3.72		30.32	20.21	2.54		24.84	16.72	1.68
	63 (17.2)		33.75	27.45	4.60		33.28	27.08	3.72		27.93	22.83	2.55		22.88	19.00	1.69
	57 (13.9)		30.84	30.84	4.60		30.44	30.44	3.73		25.61	25.61	2.55		21.11	21.11	1.69

See additional notes on page 26

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE (CONT.)

180CNV048/CAP**6124AL+315(A,J)AV060110 Expanded Ratings Cooling Comfort with Dehumidify Mode													
Condenser Entering Air Temperature ° F (° C)													
EDB ° F (° C)	EVAP. AIR EWB ° F (° C)	85 (29.4)			ID SCFM	75 (23.9)			ID SCFM	65 (18.3)			Total Sys. KW**
		Capacity MBtuHt Total	Sens†	Total Sys. KW**		Capacity MBtuHt Total	Sens†	Capacity MBtuHt Total		Sens†			
75 (23.9)	72 (22.2) 67 (19.4) 63 (17.2) 57 (13.9)	970	52.97	21.14	2.94	985	54.98	21.95	995	56.94	22.76	2.32	
			47.91	26.21	2.92		49.81	27.13		2.57	51.58	27.97	2.29
			44.18	30.49	2.91		46.09	31.23		2.56	47.81	32.10	2.27
			39.51	36.09	2.90		41.16	37.22		2.54	42.71	38.21	2.25
80 (26.7)	72 (22.2) 67 (19.4) 63 (17.2) 57 (13.9)	970	52.83	26.22	2.93	985	54.87	27.13	995	56.84	27.99	2.33	
			47.80	31.25	2.92		49.90	32.05		2.58	51.50	33.17	2.29
			44.21	35.22	2.91		46.02	36.32		2.56	47.65	37.40	2.27
			40.15	40.15	2.90		41.63	41.63		2.54	43.11	42.93	2.53
MAXIMUM DEMAND													
75 (23.9)	72 (22.2) 67 (19.4) 63 (17.2) 57 (13.9)	790	41.57	16.61	2.12	790	43.06	17.22	805	44.72	17.89	1.63	
			37.56	20.74	2.11		38.99	21.38		1.84	40.52	22.14	1.61
			34.67	24.00	2.10		35.94	24.82		1.84	37.47	25.48	1.61
			30.91	28.84	2.11		33.70	23.32		1.83	33.45	30.43	1.60
80 (26.7)	72 (22.2) 67 (19.4) 63 (17.2) 57 (13.9)	790	41.45	20.78	2.11	790	42.98	21.40	805	44.69	22.17	1.63	
			37.45	24.95	2.11		38.95	25.56		1.84	40.45	26.36	1.61
			34.56	28.20	2.10		35.90	28.87		1.84	37.45	29.63	1.60
			31.71	31.70	2.10		32.71	32.71		1.84	33.89	33.89	1.60
MINIMUM DEMAND													
75 (23.9)	72 (22.2) 67 (19.4) 63 (17.2) 57 (13.9)	555	29.04	11.63	1.47	580	30.47	12.20	600	31.85	12.75	1.10	
			26.24	14.57	1.47		27.57	15.28		1.27	28.81	15.94	1.10
			24.20	16.87	1.47		25.42	17.72		1.27	26.56	18.46	1.10
			21.54	20.34	1.47		22.67	21.33		1.28	23.71	22.20	1.10
80 (26.7)	72 (22.2) 67 (19.4) 63 (17.2) 57 (13.9)	555	28.95	14.60	1.47	580	30.43	15.32	600	31.76	15.96	1.10	
			26.17	17.51	1.47		27.57	18.23		1.27	28.80	19.05	1.10
			24.14	19.83	1.47		25.37	20.78		1.27	26.52	21.63	1.10
			22.21	22.21	1.47		23.33	23.33		1.28	24.35	24.35	1.10

See additional notes on page 26

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE (CONT.)

180CNV060/CAP**6124AL+315(A,J)AV060110 Expanded Ratings Cooling Comfort + Dehumidify Mode Condenser Entering Air Temperature °F (°C)														
EDB °F (°C)	EVAP. AIR EWB °F (°C)	125			115			105			95			Total Sys. KW**
		ID SCFM	Capacity MBtu/h† Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtu/h† Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtu/h† Total	Sens†		
MAXIMUM DEMAND														
75 (23.9)	72 (22.2)	945	48.54	19.36	5.48	1020	52.28	20.84	4.94	1095	55.87	22.22	4.47	1165
	67 (19.4)		43.80	24.19	5.46		47.35	25.95	4.92		50.51	27.88	4.44	
	63 (17.2)		40.39	28.00	5.44		43.64	30.26	4.90		46.65	32.32	4.42	
	57 (13.9)		35.89	33.64	5.42		38.88	36.36	4.88		41.61	38.90	4.40	
80 (26.7)	72 (22.2)	945	48.47	24.29	5.48	1020	52.18	26.15	4.94	1095	55.72	27.91	4.47	1165
	67 (19.4)		43.70	29.07	5.46		47.17	31.39	4.92		50.41	33.54	4.44	
	63 (17.2)		40.33	32.88	5.44		43.58	35.48	4.90		46.59	37.94	4.42	
	57 (13.9)		36.93	36.93	5.43		39.95	39.95	4.88		42.81	42.81	4.41	
MEDIAN DEMAND														
75 (23.9)	72 (22.2)	850	44.71	17.86	4.88	870	46.24	18.46	4.21	850	45.39	18.13	3.41	835
	67 (19.4)		40.36	22.34	4.87		41.80	23.05	4.20		41.04	22.58	3.40	
	63 (17.2)		37.29	25.70	4.87		38.52	26.60	4.19		37.87	26.08	3.39	
	57 (13.9)		33.05	30.92	4.86		34.24	31.85	4.19		33.72	31.30	3.39	
80 (26.7)	72 (22.2)	850	44.55	22.32	4.88	870	46.13	23.06	4.21	850	45.29	22.62	3.41	835
	67 (19.4)		40.32	26.75	4.87		41.71	27.59	4.20		40.95	27.04	3.40	
	63 (17.2)		36.97	30.12	4.86		38.48	31.14	4.19		37.80	30.53	3.39	
	57 (13.9)		33.96	33.96	4.86		35.15	35.15	4.19		34.50	34.50	3.39	
MINIMUM DEMAND														
75 (23.9)	72 (22.2)	760	40.67	16.26	4.60	750	40.09	16.03	3.72	635	33.63	13.46	2.54	535
	67 (19.4)		36.68	20.26	4.60		36.20	19.99	3.72		30.38	16.82	2.54	
	63 (17.2)		33.92	23.29	4.61		33.35	23.10	3.72		28.00	19.46	2.55	
	57 (13.9)		29.98	28.07	4.60		29.64	27.73	3.73		24.86	23.37	2.55	
80 (26.7)	72 (22.2)	760	40.46	20.29	4.60	750	39.99	20.05	3.72	635	33.53	16.86	2.54	535
	67 (19.4)		36.65	24.33	4.60		36.12	23.99	3.72		30.32	20.21	2.54	
	63 (17.2)		33.75	27.45	4.60		33.28	27.08	3.72		27.93	22.83	2.55	
	57 (13.9)		30.84	30.84	4.60		30.44	30.44	3.73		25.61	25.61	2.55	

See additional notes on page 26

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE (CONT.)

180CNV060/CAP**6124AL +315(A,J)AV060110 Expanded Ratings Cooling Comfort + Dehumidify Mode Condenser Entering Air Temperature ° F (° C)													
EDB ° F (° C)	EVAP AIR EWB ° F (° C)	85			75			65			Total Sys. KW**	Total Sys. KW**	
		ID SCFM	Capacity MBtuht		Total Sys. KW**	ID SCFM	Capacity MBtuht		Total Sys. KW**	Capacity MBtuht			
			Total	Sens†			Total	Sens†		Total			Sens†
MAXIMUM DEMAND													
75 (23.9)	72 (22.2)	1175	61.85	24.60	3.59	64.03	25.50	3.23	66.06	26.29	2.97		
	67 (19.4)		55.93	30.67	3.55	57.98	31.58	3.18	59.93	32.48	2.91		
	63 (17.2)		51.74	35.48	3.53	53.69	36.43	3.15	55.58	37.40	2.87	1185	
	57 (13.9)		46.25	42.58	3.50	48.02	43.54	3.11	49.72	44.59	2.81		
80 (26.7)	72 (22.2)	1175	61.74	30.72	3.59	63.93	31.62	3.22	65.98	32.48	2.96		
	67 (19.4)		55.86	36.73	3.55	57.91	37.68	3.17	59.86	38.63	2.90		
	63 (17.2)		51.70	41.51	3.53	53.65	42.46	3.14	55.53	43.49	2.86	1185	
	57 (13.9)		47.24	47.24	3.50	48.69	48.69	3.11	50.13	50.13	2.82		
MEDIAN DEMAND													
75 (23.9)	72 (22.2)	855	46.17	18.45	2.42	48.07	19.21	2.13	50.03	20.00	1.88		
	67 (19.4)		41.81	22.84	2.41	43.51	23.78	2.12	45.30	24.71	1.86		
	63 (17.2)		38.58	26.47	2.41	40.26	27.32	2.11	41.91	28.44	1.84	895	
	57 (13.9)		34.40	31.72	2.40	35.89	32.74	2.10	37.43	33.95	1.83		
80 (26.7)	72 (22.2)	855	46.06	22.97	2.42	47.96	23.81	2.13	49.92	24.73	1.88		
	67 (19.4)		41.67	27.42	2.41	43.42	28.35	2.12	45.21	29.41	1.86		
	63 (17.2)		38.51	30.94	2.41	40.03	32.14	2.11	41.85	33.10	1.84	895	
	57 (13.9)		35.10	35.10	2.40	36.43	36.43	2.10	37.87	37.87	1.83		
MINIMUM DEMAND													
75 (23.9)	72 (22.2)	555	29.04	11.63	1.47	30.47	12.20	1.28	31.85	12.75	1.10		
	67 (19.4)		26.24	14.57	1.47	27.57	15.28	1.27	28.81	15.94	1.10		
	63 (17.2)		24.20	16.87	1.47	25.42	17.72	1.27	26.56	18.46	1.10	600	
	57 (13.9)		21.54	20.34	1.47	22.67	21.33	1.28	23.71	22.20	1.10		
80 (26.7)	72 (22.2)	555	28.95	14.60	1.47	30.43	15.32	1.27	31.76	15.96	1.10		
	67 (19.4)		26.17	17.51	1.47	27.57	18.23	1.27	28.80	19.05	1.10		
	63 (17.2)		24.14	19.83	1.47	25.37	20.78	1.27	26.52	21.63	1.10	600	
	57 (13.9)		22.21	22.21	1.47	23.33	23.33	1.28	24.35	24.35	1.10		

See additional notes on page 26

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE

180CNV024/CAP**3617AL+315(A,J)AV036070 Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)																	
EDB ° F (° C)	EVAP. AIR EWB ° F (° C)	125			115			105			95			Total Sys. KW**			
		ID SCFM	Capacity MBtuht Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuht Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuht Total	Sens†	Total Sys. KW**				
MAXIMUM DEMAND																	
75 (23.9)	72 (22.2)	700	23.70	9.48	2.90	775	25.23	10.39	2.43	840	26.41	10.88	2.00	900	27.54	11.34	1.67
	67 (19.4)		21.17	13.11	2.96		22.85	14.15	2.49		23.76	14.97	2.05		24.81	15.72	1.72
	63 (17.2)		19.43	15.76	3.01		20.87	17.18	2.53		16.82	15.96	1.55		22.91	19.09	1.76
	57 (13.9)		18.17	18.17	3.04		19.63	19.63	2.56		20.74	20.74	2.12		21.76	21.76	1.78
80 (26.7)	72 (22.2)	700	23.50	13.20	2.90	775	25.17	14.26	2.43	840	26.35	15.06	2.00	900	27.48	15.80	1.67
	67 (19.4)		21.19	16.50	2.95		22.86	18.02	2.49		23.77	19.13	2.05		24.80	20.15	1.72
	63 (17.2)		20.36	15.36	2.89		21.10	20.91	2.53		22.77	20.69	2.07		23.76	21.80	1.74
	57 (13.9)		19.52	19.52	3.01		21.03	21.03	2.53		22.18	22.18	2.09		23.27	23.26	1.75
MEDIAN DEMAND																	
75 (23.9)	72 (22.2)	695	22.82	9.41	2.91	745	23.64	9.75	2.34	710	22.67	9.37	1.72	680	21.38	8.87	1.25
	67 (19.4)		20.56	12.78	2.97		21.25	13.31	2.40		20.42	12.76	1.78		19.33	12.16	1.30
	63 (17.2)		18.86	15.40	3.01		19.54	16.15	2.44		18.80	15.49	1.82		17.82	14.78	1.33
	57 (13.9)		17.67	17.67	3.04		18.43	18.43	2.47		17.72	17.72	1.84		16.84	16.84	1.36
80 (26.7)	72 (22.2)	695	22.86	12.82	2.90	745	23.59	13.43	2.34	710	22.63	12.88	1.72	680	21.42	12.21	1.25
	67 (19.4)		20.51	16.17	2.97		21.21	16.98	2.40		20.39	16.27	1.78		19.32	15.50	1.29
	63 (17.2)		19.04	18.69	3.01		19.79	19.65	2.43		19.02	18.85	1.81		18.05	17.97	1.32
	57 (13.9)		18.93	18.93	3.01		19.72	19.72	2.43		18.95	18.95	1.81		18.00	18.00	1.33
MINIMUM DEMAND																	
75 (23.9)	72 (22.2)	690	22.30	9.22	3.18	700	22.06	9.12	2.45	595	19.16	7.93	1.60	480	15.45	6.41	0.98
	67 (19.4)		20.11	12.54	3.25		19.94	12.52	2.51		17.23	10.80	1.65		13.88	8.73	1.02
	63 (17.2)		18.45	15.14	3.30		18.33	15.20	2.56		15.85	13.07	1.69		12.77	10.59	1.05
	57 (13.9)		17.24	17.24	3.32		17.29	17.29	2.59		14.92	14.92	1.72		12.04	12.04	1.07
80 (26.7)	72 (22.2)	690	22.41	12.59	3.17	700	22.17	12.57	2.44	595	19.11	10.89	1.60	480	15.39	8.79	0.98
	67 (19.4)		20.10	15.90	3.24		19.92	15.92	2.51		17.21	13.71	1.65		13.86	11.11	1.02
	63 (17.2)		19.80	14.96	3.25		19.44	15.72	2.52		16.02	15.89	1.68		12.91	12.88	1.05
	57 (13.9)		18.54	18.54	3.29		18.50	18.50	2.55		15.94	15.94	1.71		12.88	12.88	1.05

See additional notes on page 26

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE (CONT.)

180CNV024/CAP**3617AL +315(A,J)AV036070 Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)														
EDB ° F (° C)	EVAP. AIR EWB ° F (° C)	85 (29.4)				75 (23.9)				65 (18.3)				
		ID SCFM	Capacity MBtu/h†		Total Sys. KW**	ID SCFM	Capacity MBtu/h†		Total Sys. KW**	ID SCFM	Capacity MBtu/h†		Total Sys. KW**	
			Total	Sens†			Total	Sens†			Total	Sens†		
MAXIMUM DEMAND														
75 (23.9)	72 (22.2)	875	28.81	11.77	1.39	940	30.27	12.36	1.17	1000	31.64	12.90	0.98	
			25.99	16.05	1.44			27.29	16.91		1.22	28.52	17.70	1.03
			23.94	19.41	1.48			25.23	20.54		1.26	26.41	21.54	1.07
			22.54	22.54	1.51			23.79	23.79		1.28	24.95	24.95	1.09
80 (26.7)	72 (22.2)	875	28.75	16.12	1.39	940	30.16	16.97	1.17	1000	31.50	17.76	0.98	
			25.97	20.36	1.44			27.31	21.53		1.22	28.56	22.56	1.03
			26.13	17.86	1.43			27.63	18.28		1.21	28.97	18.81	1.02
			24.04	24.03	1.47			25.37	25.37		1.25	26.61	26.61	1.06
MEDIAN DEMAND														
75 (23.9)	72 (22.2)	750	22.72	9.43	1.05	750	23.75	9.79	0.85	785	24.84	10.23	0.69	
			20.48	13.07	1.10			21.43	13.44		0.90	22.42	14.04	0.73
			18.91	15.93	1.13			19.78	16.31		0.93	20.72	17.04	0.76
			18.01	18.01	1.15			18.71	18.71		0.96	19.59	19.59	0.79
80 (26.7)	72 (22.2)	750	22.67	13.12	1.05	750	23.69	13.49	0.85	785	24.78	14.08	0.69	
			20.48	16.72	1.09			21.41	17.10		0.90	22.41	17.85	0.73
			19.27	19.27	1.12			20.25	19.36		0.92	21.03	20.65	0.76
			19.24	19.24	1.12			19.96	19.96		0.93	20.89	20.89	0.76
MINIMUM DEMAND														
75 (23.9)	72 (22.2)	560	16.53	6.93	0.81	650	17.55	7.44	0.66	640	18.27	7.71	0.52	
			14.88	9.65	0.85			15.77	10.75		0.70	16.60	11.15	0.57
			13.73	11.81	0.88			14.65	13.08		0.73	15.39	13.77	0.60
			13.14	13.14	0.90			14.21	14.21		0.74	14.94	14.94	0.61
80 (26.7)	72 (22.2)	560	16.48	9.70	0.80	650	17.50	10.65	0.66	640	18.34	11.19	0.53	
			14.88	12.40	0.85			15.85	13.75		0.70	16.63	14.48	0.57
			14.09	14.09	0.87			15.23	15.23		0.71	16.02	16.02	0.58
			14.06	14.06	0.87			15.21	15.21		0.71	15.99	15.99	0.58

See additional notes on page 26

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE (CONT.)

180CNV036/CAP**3617AL+315(A,J)AV036070 Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)																
EDB ° F (° C)	EVAP AIR EWB ° F (° C)	125			115			105			95			Total Sys. KW**		
		ID SCFM	Capacity MBtuht Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuht Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuht Total	Sens†	Total Sys. KW**			
75 (23.9)	72 (22.2)	830	30.35	12.51	3.85	955	32.91	13.58	3.37	1080	35.16	14.53	2.97	37.12	15.40	2.71
	67 (19.4)		27.22	16.91	3.91		29.56	18.52	3.43		31.63	19.76	3.03	33.38	20.98	2.75
	63 (17.2)		24.97	20.38	3.96		27.16	22.45	3.47		29.03	23.91	3.06	30.75	25.51	2.79
	57 (13.9)		23.02	23.02	4.00		25.26	25.26	3.51		27.28	27.28	3.10	29.00	29.00	2.82
80 (26.7)	72 (22.2)	830	30.32	17.00	3.85	955	32.87	18.71	3.37	1080	35.11	19.98	2.97	37.05	21.12	2.70
	67 (19.4)		27.16	21.41	3.91		29.53	23.64	3.42		31.61	25.23	3.02	33.37	26.77	2.75
	63 (17.2)		25.11	24.65	3.95		27.39	27.21	3.46		32.78	32.48	3.00	34.01	33.85	2.74
	57 (13.9)		24.55	24.55	3.97		27.01	27.01	3.48		29.14	29.14	3.07	31.00	31.00	2.78
MAXIMUM DEMAND																
75 (23.9)	72 (22.2)	760	26.73	10.90	3.39	835	27.98	11.42	2.81	875	27.79	11.39	2.18	27.15	11.17	1.68
	67 (19.4)		23.99	14.60	3.46		25.14	15.47	2.87		25.01	15.65	2.23	24.61	15.55	1.74
	63 (17.2)		21.97	17.53	3.51		23.12	18.66	2.91		23.03	19.02	2.28	22.58	18.87	1.77
	57 (13.9)		20.41	20.41	3.54		21.62	21.62	2.95		21.76	21.76	2.31	21.42	21.42	1.80
80 (26.7)	72 (22.2)	760	26.70	14.71	3.39	835	27.80	15.54	2.80	875	27.74	15.72	2.17	27.10	15.52	1.68
	67 (19.4)		23.93	18.32	3.45		25.10	19.71	2.88		24.99	19.96	2.23	24.44	19.78	1.73
	63 (17.2)		22.17	21.22	3.50		23.35	22.69	2.90		24.17	20.74	2.25	24.09	19.28	1.74
	57 (13.9)		21.84	21.84	3.50		23.12	23.12	2.91		23.27	23.27	2.27	22.94	22.94	1.76
MINIMUM DEMAND																
75 (23.9)	72 (22.2)	690	22.30	9.22	3.18	700	22.06	9.12	2.45	595	19.16	7.93	1.60	15.45	6.41	0.98
	67 (19.4)		20.11	12.54	3.25		19.94	12.52	2.51		17.23	10.80	1.65	13.88	8.73	1.02
	63 (17.2)		18.45	15.14	3.30		18.33	15.20	2.56		15.85	13.07	1.69	12.77	10.59	1.05
	57 (13.9)		17.24	17.24	3.32		17.28	17.28	2.59		14.92	14.92	1.72	12.04	12.04	1.07
80 (26.7)	72 (22.2)	690	22.41	12.59	3.17	700	22.17	12.56	2.44	595	19.11	10.89	1.60	15.39	8.79	0.98
	67 (19.4)		20.10	15.90	3.24		19.92	15.92	2.51		17.21	13.71	1.65	13.86	11.11	1.02
	63 (17.2)		19.80	14.96	3.25		19.43	15.72	2.52		16.02	15.89	1.68	12.91	12.88	1.05
	57 (13.9)		18.54	18.54	3.29		18.49	18.49	2.55		15.94	15.94	1.71	12.87	12.87	1.05

See additional notes on page 26

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE (CONT.)

180CNV036/CAP**3617AL+315(A,J)AV036070 Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)													
EDB ° F (° C)	EVAP. AIR EWB ° F (° C)	ID SCFM	85 (29.4)		Total Sys. KW**	ID SCFM	75 (23.9)		Total Sys. KW**	ID SCFM	65 (18.3)		Total Sys. KW**
			Capacity MBtuht Total	Sens†			Capacity MBtuht Total	Sens†			Capacity MBtuht Total	Sens†	
MAXIMUM DEMAND													
75 (23.9)	72 (22.2)	1050	38.62	16.02	2.18	1225	40.79	16.82	1.96	1405	42.58	17.53	1.87
	67 (19.4)		34.81	22.20	2.23		36.80	23.08	2.01		38.38	24.03	1.92
	63 (17.2)		32.10	27.05	2.26		33.98	28.02	2.04		35.42	29.14	1.95
	57 (13.9)		30.48	30.48	2.29		31.71	31.71	2.08		33.44	33.44	1.98
80 (26.7)	72 (22.2)	1050	38.53	22.30	2.18	1225	40.66	23.16	1.96	1405	42.41	24.09	1.87
	67 (19.4)		34.78	28.39	2.22		36.76	29.35	2.01		38.37	30.57	1.92
	63 (17.2)		34.93	34.93	2.22		37.07	35.43	2.00		38.67	37.97	1.91
	57 (13.9)		31.42	31.42	2.27		33.75	33.75	2.05		35.66	35.66	1.95
MEDIAN DEMAND													
75 (23.9)	72 (22.2)	870	28.45	11.62	1.40	925	29.86	12.18	1.18	985	31.23	12.72	0.99
	67 (19.4)		25.62	15.87	1.46		26.96	16.69	1.23		28.20	17.49	1.04
	63 (17.2)		23.66	19.25	1.49		24.87	20.27	1.27		26.04	21.29	1.08
	57 (13.9)		22.35	22.35	1.52		23.46	23.46	1.29		24.61	24.61	1.10
80 (26.7)	72 (22.2)	870	28.40	15.97	1.40	925	29.80	16.75	1.18	985	31.16	17.55	0.99
	67 (19.4)		25.63	20.15	1.45		26.93	21.22	1.23		28.29	22.47	1.04
	63 (17.2)		23.95	23.36	1.48		25.20	24.61	1.26		26.60	25.78	1.07
	57 (13.9)		23.76	23.76	1.49		25.05	25.05	1.26		26.35	26.35	1.07
MINIMUM DEMAND													
75 (23.9)	72 (22.2)	560	16.52	6.93	0.81	650	17.55	7.44	0.66	640	18.27	7.71	0.52
	67 (19.4)		14.88	9.64	0.85		15.77	10.74	0.70		16.60	11.15	0.57
	63 (17.2)		13.73	11.81	0.88		14.64	13.08	0.73		15.39	13.77	0.60
	57 (13.9)		13.14	13.14	0.90		14.21	14.21	0.74		14.94	14.94	0.61
80 (26.7)	72 (22.2)	560	16.47	9.70	0.80	650	17.50	10.65	0.66	640	18.34	11.19	0.53
	67 (19.4)		14.88	12.40	0.85		15.85	13.75	0.70		16.63	14.48	0.57
	63 (17.2)		14.09	14.09	0.87		15.23	15.23	0.71		16.02	16.02	0.58
	57 (13.9)		14.06	14.06	0.87		15.21	15.21	0.71		15.99	15.99	0.58

See additional notes on page 26

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE (CONT.)

180CNV048/CAP**6124AL+315(A,J)AV060110 Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)														
EDB ° F (° C)	EVAP. AIR EWB ° F (° C)	125			115			105			95			Total Sys. KW**
		ID SCFM	Capacity MBtuht Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuht Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuht Total	Sens†		
75 (23.9)	72 (22.2)	1250	44.80	18.05	4.82	1335	48.29	19.48	4.31	1425	51.30	20.55	3.94	3.60
	67 (19.4)		40.50	24.61	4.81		43.71	26.49	4.30		46.44	28.04	3.92	3.58
	63 (17.2)		37.39	29.82	4.81		40.35	31.97	4.30		42.87	33.87	3.91	3.57
	57 (13.9)		34.65	34.65	4.80		37.39	37.39	4.29		39.77	39.77	3.90	3.56
80 (26.7)	72 (22.2)	1250	44.42	24.80	4.81	1335	48.10	26.47	4.31	1425	51.10	28.02	3.94	3.60
	67 (19.4)		40.39	31.08	4.81		43.58	33.40	4.30		46.33	35.44	3.92	3.58
	63 (17.2)		37.47	36.12	4.81		40.31	38.70	4.30		43.05	41.16	3.91	3.57
	57 (13.9)		36.92	36.92	4.81		39.80	39.80	4.30		42.33	42.33	3.91	3.57
MAXIMUM DEMAND														
75 (23.9)	72 (22.2)	1230	43.75	17.64	4.62	1265	45.55	18.36	3.97	1240	43.91	17.72	3.21	2.55
	67 (19.4)		39.95	24.25	4.63		41.34	24.75	3.96		39.81	24.30	3.20	2.54
	63 (17.2)		36.84	29.35	4.63		38.08	30.30	3.96		40.64	13.45	3.19	2.54
	57 (13.9)		34.16	34.16	4.62		35.30	35.30	3.96		34.18	34.18	3.20	2.54
80 (26.7)	72 (22.2)	1230	43.94	24.26	4.63	1265	45.35	25.01	3.97	1240	43.71	24.25	3.21	2.55
	67 (19.4)		39.81	30.69	4.63		41.11	31.60	3.96		39.56	30.88	3.20	2.55
	63 (17.2)		36.92	35.75	4.63		38.18	36.75	3.96		36.85	35.75	3.20	2.54
	57 (13.9)		36.40	36.40	4.63		37.60	37.60	3.96		36.40	36.40	3.20	2.54
MINIMUM DEMAND														
75 (23.9)	72 (22.2)	1205	43.93	17.73	4.76	1190	43.26	17.46	3.88	1005	36.36	14.77	2.64	1.75
	67 (19.4)		39.71	24.18	4.76		39.15	23.86	3.88		32.87	20.13	2.64	1.75
	63 (17.2)		36.68	29.26	4.76		36.13	28.85	3.88		30.35	24.47	2.64	1.75
	57 (13.9)		34.01	34.01	4.76		33.53	33.53	3.88		28.25	28.25	2.65	1.75
80 (26.7)	72 (22.2)	1205	43.76	24.18	4.76	1190	43.08	23.83	3.88	1005	36.17	20.19	2.64	1.75
	67 (19.4)		38.20	30.00	4.74		39.03	30.18	3.88		32.80	25.52	2.64	1.75
	63 (17.2)		36.74	35.53	4.76		36.20	35.04	3.88		30.44	29.65	2.64	1.75
	57 (13.9)		36.25	36.24	4.76		35.72	35.72	3.88		30.09	30.09	2.64	1.75

See additional notes on page 26

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE (CONT.)

180CNV048/CAP**6124AL+315(A,J)AV060110 Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)													
EDB ° F (° C)	EVAP AIR EWB ° F (° C)	85			75			65			Total Sys. KW**	Total Sys. KW**	
		ID SCFM	Capacity MBtuHt		Total Sys. KW**	ID SCFM	Capacity MBtuHt		Total Sys. KW**	ID SCFM			Capacity MBtuHt
			Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†
MAXIMUM DEMAND													
75 (23.9)	72 (22.2)	1500	56.79	22.56	3.23	1540	59.15	23.42	2.94	1575	61.40	24.30	2.67
	67 (19.4)		51.40	30.44	3.21		53.58	31.55	2.91		55.72	32.64	2.64
	63 (17.2)		47.47	36.60	3.20		49.52	37.89	2.88		51.56	39.15	2.60
	57 (13.9)		43.67	43.67	3.19		45.47	45.47	2.87		47.24	47.24	2.59
80 (26.7)	72 (22.2)	1500	56.61	30.43	3.23	1540	58.95	31.49	2.94	1575	61.20	32.57	2.67
	67 (19.4)		51.29	38.19	3.21		53.43	39.51	2.90		55.76	40.86	2.63
	63 (17.2)		47.61	44.27	3.20		49.67	45.75	2.89		51.72	47.21	2.61
	57 (13.9)		46.39	46.39	3.20		48.24	48.24	2.88		50.10	50.10	2.60
MEDIAN DEMAND													
75 (23.9)	72 (22.2)	1170	44.41	17.87	2.24	1260	46.64	18.75	2.03	1280	48.45	19.39	1.83
	67 (19.4)		40.23	24.06	2.23		42.22	25.41	2.03		43.90	26.13	1.82
	63 (17.2)		37.12	28.91	2.23		39.01	30.62	2.01		40.56	31.48	1.81
	57 (13.9)		34.17	34.17	2.22		36.09	36.09	2.01		37.36	37.36	1.80
80 (26.7)	72 (22.2)	1170	44.24	24.04	2.24	1260	46.42	25.23	2.04	1280	48.33	25.82	1.83
	67 (19.4)		40.09	30.18	2.23		42.13	32.00	2.02		43.72	32.82	1.82
	63 (17.2)		37.21	34.93	2.23		39.15	37.15	2.01		40.66	38.07	1.81
	57 (13.9)		36.32	36.32	2.23		38.36	38.36	2.01		39.71	39.71	1.81
MINIMUM DEMAND													
75 (23.9)	72 (22.2)	870	31.39	12.79	1.53	875	32.81	13.31	1.34	895	34.20	13.84	1.18
	67 (19.4)		28.42	17.43	1.54		29.70	18.00	1.34		30.98	18.65	1.17
	63 (17.2)		26.24	21.14	1.53		27.41	21.70	1.34		28.60	22.45	1.17
	57 (13.9)		24.42	24.42	1.54		25.35	25.35	1.34		26.37	26.37	1.17
80 (26.7)	72 (22.2)	870	31.24	17.43	1.54	875	32.66	17.99	1.34	895	34.06	18.63	1.18
	67 (19.4)		28.30	22.09	1.53		29.59	22.66	1.34		30.86	23.41	1.17
	63 (17.2)		26.78	24.33	1.53		28.43	23.77	1.34		29.79	24.02	1.17
	57 (13.9)		25.99	25.99	1.53		26.96	26.96	1.34		28.03	28.03	1.17

See additional notes on page 26

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE (CONT.)

180CNV060/CAP**6124AL+315(A,J)AV060110 Expanded Ratings Cooling EFFICIENCY Mode Condenser Entering Air Temperature °F (°C)																
EDB °F (°C)	EVAP. AIR EWB °F (°C)	125			115			105			95			Total Sys. KW**		
		ID SCFM	Capacity MBtuht Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuht Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuht Total	Sens†				
MAXIMUM DEMAND																
75 (23.9)	72 (22.2)	1200	50.55	20.14	5.59	1300	54.52	21.67	5.09	1400	58.22	23.07	4.64	61.68	24.37	4.26
	67 (19.4)		45.83	26.41	5.57		49.35	28.44	5.06		52.67	30.34	4.61	55.81	32.16	4.22
	63 (17.2)		42.22	31.27	5.56		45.53	33.70	5.04		48.60	36.01	4.59	51.49	38.23	4.20
	57 (13.9)		37.97	37.81	5.53		41.03	40.86	5.02		43.88	43.88	4.57	46.61	46.61	4.18
80 (26.7)	72 (22.2)	1200	50.19	26.29	5.59	1300	54.14	28.35	5.09	1400	57.83	30.26	4.64	61.32	32.10	4.26
	67 (19.4)		45.66	32.55	5.57		49.23	35.11	5.06		52.52	37.55	4.61	55.67	39.84	4.22
	63 (17.2)		42.19	37.38	5.55		45.52	40.34	5.04		48.62	43.16	4.59	51.55	45.87	4.20
	57 (13.9)		40.23	40.23	5.54		43.45	43.45	5.03		46.49	46.49	4.58	49.40	49.40	4.19
MEDIAN DEMAND																
75 (23.9)	72 (22.2)	1230	47.61	19.05	5.04	1330	49.56	19.83	4.42	1350	48.89	19.62	3.62	47.39	19.08	2.93
	67 (19.4)		43.00	25.53	5.03		44.83	26.86	4.40		44.25	26.77	3.61	42.91	26.07	2.92
	63 (17.2)		39.72	30.65	5.02		41.31	32.32	4.40		40.83	32.40	3.60	39.62	31.59	2.91
	57 (13.9)		36.42	36.42	5.02		38.06	38.06	4.39		37.89	37.89	3.60	36.83	36.83	2.90
80 (26.7)	72 (22.2)	1230	47.42	25.54	5.04	1330	49.24	27.01	4.42	1350	48.69	26.74	3.62	47.21	26.04	2.93
	67 (19.4)		42.94	31.99	5.03		44.72	33.81	4.40		44.12	33.80	3.61	42.78	33.00	2.91
	63 (17.2)		39.75	36.97	5.02		41.46	39.20	4.40		41.00	39.28	3.60	39.78	38.32	2.91
	57 (13.9)		38.68	38.68	5.03		40.60	40.60	4.40		40.32	40.32	3.60	39.19	39.19	2.91
MINIMUM DEMAND																
75 (23.9)	72 (22.2)	1205	43.93	17.73	4.76	1190	43.26	17.46	3.88	1005	36.36	14.77	2.64	29.84	12.07	1.75
	67 (19.4)		39.71	24.18	4.76		39.15	23.86	3.88		32.87	20.13	2.64	26.98	16.71	1.75
	63 (17.2)		36.68	29.26	4.76		36.13	28.85	3.88		30.35	24.47	2.64	24.90	20.29	1.75
	57 (13.9)		34.01	34.01	4.76		33.53	33.53	3.88		28.25	28.25	2.65	23.28	23.28	1.75
80 (26.7)	72 (22.2)	1205	43.76	24.18	4.76	1190	43.08	23.83	3.88	1005	36.17	20.19	2.64	29.65	16.69	1.75
	67 (19.4)		38.20	30.00	4.74		39.03	30.18	3.88		32.80	25.52	2.64	26.86	21.20	1.75
	63 (17.2)		36.74	35.53	4.76		36.20	35.04	3.88		30.44	29.65	2.64	24.95	24.68	1.75
	57 (13.9)		36.25	36.24	4.76		35.72	35.72	3.88		30.09	30.09	2.64	24.79	24.79	1.75

See additional notes on page 26

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE (CONT.)

180CNV060/CAP**6124AL+315(A..J)AV060110 Expanded Ratings Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)													
EDB ° F (° C)	EVAP AIR EWB ° F (° C)	ID SCFM	85 (29.4)		Total Sys. KW**	ID SCFM	75 (23.9)		Total Sys. KW**	ID SCFM	65 (18.3)		Total Sys. KW**
			Capacity MBtuht† Total	Sens†			Capacity MBtuht† Total	Sens†			Capacity MBtuht† Total	Sens†	
75 (23.9)	72 (22.2)	1500	64.31	25.37	3.82	1675	67.74	26.64	3.60	1880	70.82	26.76	3.57
			58.23	33.16	3.78		61.37	35.35	3.54		64.01	37.30	3.50
			53.80	39.28	3.75		56.69	42.14	3.50		59.21	44.95	3.46
			48.73	47.70	3.72		51.56	51.56	3.47		54.41	54.41	3.41
			64.07	33.21	3.83		67.51	35.32	3.59		70.29	37.20	3.56
80 (26.7)	67 (19.4)	1500	58.16	40.88	3.78	1675	61.22	43.90	3.54	1880	63.84	46.86	3.50
			53.87	46.94	3.75		56.82	50.67	3.51		59.40	54.40	3.46
			51.22	51.22	3.73		54.60	54.60	3.49		57.69	57.69	3.44
MAXIMUM DEMAND													
75 (23.9)	72 (22.2)	1300	49.53	19.83	2.61	1365	51.83	20.72	2.35	1420	53.98	21.54	2.12
			44.84	26.73	2.59		46.98	27.91	2.33		48.96	29.10	2.10
			41.41	32.09	2.59		43.40	33.62	2.32		45.27	34.99	2.09
			38.10	38.10	2.58		39.96	39.96	2.31		41.69	41.69	2.07
			49.36	26.69	2.61		51.63	27.92	2.35		53.77	29.03	2.12
80 (26.7)	67 (19.4)	1300	44.72	33.50	2.59	1365	46.84	35.08	2.33	1420	48.84	36.50	2.10
			41.50	38.81	2.59		43.51	40.67	2.32		45.40	42.32	2.09
			40.49	40.49	2.59		42.46	42.46	2.32		44.27	44.27	2.08
MINIMUM DEMAND													
75 (23.9)	72 (22.2)	870	31.39	12.79	1.53	875	32.81	13.31	1.34	895	34.20	13.84	1.18
			28.42	17.43	1.54		29.70	18.00	1.34		30.98	18.65	1.17
			26.24	21.14	1.53		27.41	21.70	1.34		28.60	22.45	1.17
			24.42	24.42	1.54		25.35	25.35	1.34		26.37	26.37	1.17
80 (26.7)	72 (22.2)	870	31.24	17.43	1.54	875	32.66	17.99	1.34	895	34.06	18.63	1.18
			28.30	22.09	1.53		29.59	22.66	1.34		30.86	23.41	1.17
			26.78	24.33	1.53		28.43	23.77	1.34		29.79	24.02	1.17
			25.99	25.99	1.53		26.96	26.96	1.34		28.03	28.03	1.17

NOTES:

- * Tested combination.
- † Total and sensible capacities are net capacities. Blower motor heat has been subtracted.
- ‡ Sensible capacities are shown for both 80°F (27°C) and 75°F (23.4°C) entering air at the indoor coil. For sensible capacities at other than these, deduct 835 Btu/h (245 kW) per 1000 CFM (480 L/S) of indoor coil air for each degree below reference temperature, or add 835 Btu/h (245 kW) per 1000 CFM (480 L/S) of indoor coil air for each degree above reference temperature.
- # Detailed cooling capacities are based on indoor and outdoor unit at the same elevation per AHRI standard 210/240-2008. If additional tubing length and/or indoor unit is located above outdoor unit, a slight variation in capacity may occur.
- ** System kw is total of indoor and outdoor unit kilowatts.
- NOTE: When the required data falls between the published data, interpolation may be performed. Extrapolation is not an acceptable practice.
- EWB — Entering Wet Bulb

GUIDE SPECIFICATIONS

GENERAL

System Description

Outdoor-mounted, air-cooled, split-system air conditioner unit suitable for ground or rooftop installation. Unit consists of a hermetic compressor, an air-cooled coil, forward-swept blade propeller-type condenser fan, and a control box. Unit will discharge supply air upward as shown on contract drawings. Unit will be used in a refrigeration circuit to match up to a packaged fan coil or coil unit.

Quality Assurance

- Unit will be rated in accordance with the latest edition of AHRI Standard 240.
- Unit will be certified for capacity and efficiency, and listed in the latest AHRI directory.
- Unit construction will comply with latest edition of ASHRAE and with NEC.
- Unit will be constructed in accordance with UL standards and will carry the UL label of approval. Unit will have C-UL approval.
- Unit cabinet will be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 500-hr salt spray test.
- Air-cooled condenser coils are pressure tested and the outdoor units are leak tested.
- Unit constructed in ISO9001 approved facility.

Delivery, Storage, and Handling

- Unit will be shipped as single package only and is stored and handled per unit manufacturer's recommendations.

Warranty (for inclusion by specifying engineer)

- U.S. and Canada only.

PRODUCTS

Equipment

- Factory-assembled, single-piece, air-cooled air conditioner. Contained within the unit enclosure is all factory wiring, piping, controls, compressor, refrigerant charge Puron® (R-410A) refrigerant, and special features required prior to field start-up.

Unit Cabinet

- Unit cabinet will be constructed of galvanized steel, bonderized, and coated with a powder coat paint.

Fans

- Condenser fan will be direct-drive propeller type, forward swept blade, discharging air upward.

AIR-COOLED, SPLIT-SYSTEM AIR CONDITIONER

180CNV

2 TO 5 NOMINAL TONS

- Condenser fan motors will be totally enclosed, 1-phase type with class B insulation and permanently lubricated.
- Shafts will be corrosion resistant.
- Fan blades will be statically and dynamically balanced.
- Condenser fan openings will be equipped with coated steel wire safety guards.

Compressor

- Compressor will be hermetically sealed.
- Compressor will be mounted on rubber vibration isolators.
- Compressor will be covered with a sound absorbing blanket.

Condenser Coil

- Condenser coil will be air cooled.
- Coil will be constructed of aluminum fins mechanically bonded to copper tubes which are then cleaned, dehydrated, and sealed.

Refrigeration Components

- Refrigeration circuit components will include liquid-line front-seating shutoff valve with sweat connections, vapor-line front-seating shutoff valve with sweat connections, system charge of Puron® (R-410A) refrigerant, POE compressor oil, accumulator.
- Unit will be equipped with high-pressure switch, suction pressure transducer, and filter drier for Puron® refrigerant.

Operating Characteristics

- The capacity of the unit will meet or exceed _____ Btuh at a suction temperature of _____ °F (°C). The power consumption at full load will not exceed _____ kW.
- Combination of the unit and the evaporator or fan coil unit will have a total net cooling capacity of _____ Btuh or greater at conditions of _____ CFM entering air temperature at the evaporator at _____ °F (°C) wet bulb and _____ °F (°C) dry bulb, and air entering the unit at _____ °F (°C).
- The system will have a SEER of _____ Btuh/watt or greater at DOE conditions.

Electrical Requirements

- Nominal unit electrical characteristics will be _____ v, single phase, 60 hz. The unit will be capable of satisfactory operation within voltage limits of _____ v to _____ v.
- Unit electrical power will be single point connection.
- Control circuit will be 24v.

Special Features

- Refer to section of this literature identifying accessories and descriptions for specific features and available enhancements.
- Evolution® wall control with appropriate software version is required for full featured operation.

SYSTEM DESIGN SUMMARY

1. Intended for outdoor installation with free air inlet and outlet. Outdoor fan external static pressure available is less than 0.01-in. wc.
2. This product is qualified for low ambient cooling operation (below 55°F / 12.8°C) with an Evolution wall control **ONLY**.
3. The maximum outdoor operating ambient in cooling mode is 125.6°F (51.67°C).
4. For reliable operation, unit should be level in all horizontal planes.
5. For interconnecting refrigerant tube lengths greater than 80 ft (23.4 m) and/or elevation differences between indoor and outdoor units greater than 20 ft (6.1 m), consult Residential Piping and Longline Guideline and Service Manual available from equipment distributor.
6. If any refrigerant tubing is buried, provide a 6 in. (152.4 mm) vertical rise to the valve connections at the unit. Refrigerant tubing lengths up to 36 in. (914.4 mm) may be buried without further consideration. Do not bury refrigerant lines longer than 36 in. (914.4 mm).
7. Use only copper wire for electric connection at unit. Aluminum and clad aluminum are not acceptable for the type of connector provided.
8. Do not apply capillary tube indoor coils to these units.
9. Factory-supplied filter drier must be installed.