




DELUXE 13 SEER AIR CONDITIONER WITH PURON® REFRIGERANT

550A (60 Hz)

Sizes 024 thru 060

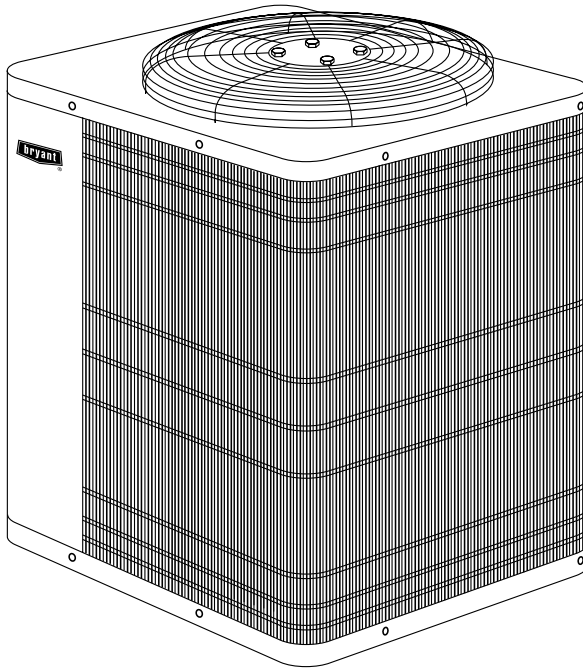

Bryant's Quantum Plus 550A with Puron® refrigerant provides a completely unique collection of features which cannot be matched by any other family of equipment. The 550A family has been designed as the first air conditioning system utilizing Bryant's unique Puron refrigerant. The environmentally sound refrigerant allows you to make a responsible decision in the protection of the earth's ozone layer. Bryant's Quantum Plus systems meet the Energy Star® guidelines for energy efficiency.

AVAILABLE OPTIONS

Puron Environmentally Sound Refrigerant—Is Bryant's unique refrigerant designed to help protect the environment. Puron is an HFC refrigerant which does not contain chlorine that can harm the ozone layer. The most important advantage of Puron refrigerant is that it has not been banned in future air conditioning systems as the traditional refrigerant R-22 has been. Puron refrigerant is in service in thousands of systems proving highly reliable, environmentally sound performance.

Heavy Duty Inlet Grille—The DuraGuard™ coil protector, made of a coated steel wire grid with vertical 3/8 in. spacing, is designed to help protect the coil from inclement weather, vandalism, and incidental damage. It provides protection while not restricting airflow and maintaining ease of coil inspection and cleaning.

High Efficiency Performance—Is delivered through a combination of features including Bryant's Puron refrigerant, unique scroll compressor, and advanced heat transfer surfaces. Efficiency ratings are 13 SEER (Seasonal Energy Efficiency Ratio) with enhanced ratings of up to 14 SEER. Sophisticated heat transfer surfaces utilized in Bryant's 550A design allow heat to easily be transferred to the outdoor air and require less energy. The unique scroll compressor found in the 550A design performs quietly and adds to the overall efficiency of the system. For improved serviceability, all models are equipped with a compressor terminal plug. Finally, Bryant's Puron refrigerant operates more efficiently than ordinary R-22 refrigerant found in other systems. The efficiency levels provided by the 550A provide end users with lower costs of operation than traditional air conditioning systems.

Assured Future Service—By utilizing the environmentally sound refrigerant, Puron, 550A models will remain serviceable well into the future. The Clean Air Act of 1990 has placed a cap on production of most other refrigerants which has scheduled reductions beginning in 2004. The resulting cap in production

ultimately results in a complete ban on many other refrigerants in new equipment by the year 2010. These changes required by federal law, mean the supply of other refrigerants may be limited in the near future making Puron refrigerant the correct choice when considering long term serviceability.

Highly Reliable Performance—Is delivered through the superior design of the system and componentry. The reliability of the 550A models has been proven to provide the lowest incidence of warranty service of any product in the Bryant family in the past three years of service. Long term reliability is assured through the use of both high and low pressure switches which will not allow the system to operate in the event of a significant change in operating pressure. In doing this, the system is protected from damage if an unusual condition arises. Finally, Bryant includes a special liquid line filter drier designed to trap moisture and contaminants which could otherwise shorten the life of the system.

Bryant's AeroQuiet System—Is one of the most sought after features of the 550A family. Extremely low operating sound is the result of special attention to the air moving through the outdoor unit, a specially designed sound enclosure surrounding the compressor, and an exclusive laminated plate beneath the compressor to eliminate sound transmission to the rest of the system.

Application Versatility—Bryant's systems utilizing Puron refrigerant have the same application guidelines as other systems. Applications which include long line sets (50 to 175 ft) or applications which require the system to operate at low outdoor temperatures (below 55°F) are approved under Bryant's standard guidelines.

Bryant Coils and Fan Coils to Complete the System—Bryant specially designs both the outdoor product and indoor coil products to operate with assured reliability and performance. A wide range of indoor coil options are listed in the ratings sections of this publication.

Special Protective Devices—High and low pressure switches and internal protection in the compressor including temperature and current sensing overloads prevent operation under potentially damaging circumstances. A special liquid line filter drier designed to trap nearly 4 times the volume of contaminants of standard driers provides superior protection from moisture trapped in the system.

Electrical Range—208/230v, single phase.

Wide Range of Sizes—Available in six sizes; 2, 2-1/2, 3, 3-1/2, 4, and 5 ton.

Reliant Cabinet—Galvanized steel is coated with powder paint to provide superior long-lasting protection and appearance.

Totally Enclosed Fan Motor—Protected from adverse weather conditions.

Unit Design—Enhanced copper and aluminum heat transfer surfaces with vertical air discharge to direct air up and away from the area.


External Service Valves—Both service valves are back seating type valves which are externally located. These unique valves allow service technicians to evacuate or charge the system in less time than standard service valves.

Easy Serviceability—Removal of one panel provides access to both electrical and refrigerant carrying components simplifying installation and service.

Agency Approvals—550A models are listed with UL (U.S. and Canada), ARI, and CEC. Special endorsements have also been awarded these products by Energy Star® which recognizes energy efficient products.

Limited Warranty—A standard five year warranty on parts with extended warranty coverage on the compressor for a total of 10 years. A five year warranty is offered on the outdoor coil. Optional warranties are available through your Bryant distributor.

DIMENSIONS

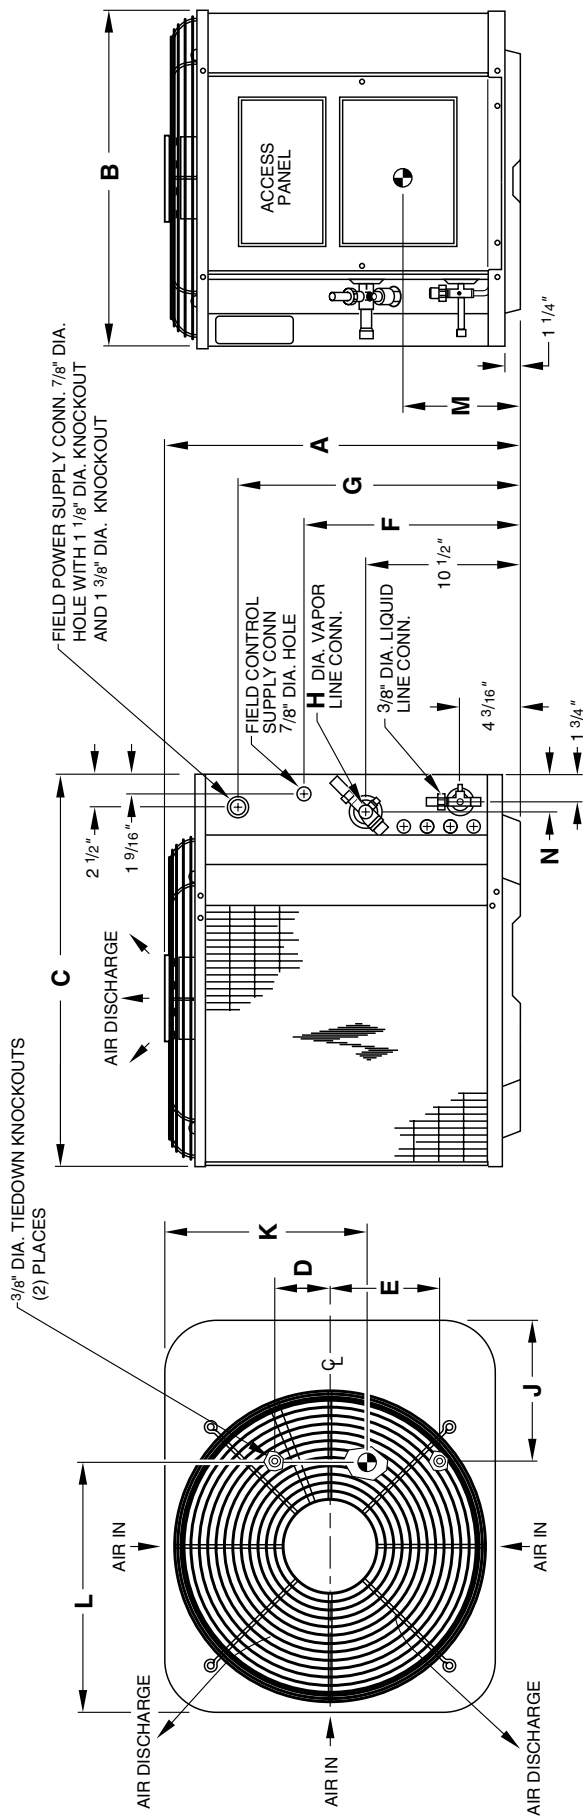

NOTES:

- 1. ALLOW 30" CLEARANCE TO SERVICE SIDE OF UNIT, 48" ABOVE UNIT, 6" ON ONE SIDE, 12" ON REMAINING SIDE, AND 24" BETWEEN UNITS FOR PROPER AIRFLOW.
- 2. MINIMUM OUTDOOR OPERATING AMBIENT IN COOLING MODE IS 55°F, (UNLESS LOW AMBIENT CONTROL IS USED) MAX. 125°F.
- 3. SERIES DESIGNATION IS THE 14TH POSITION OF THE UNIT MODEL NUMBER.
- 4. CENTER OF GRAVITY

A99067

DIMENSIONS (IN.)

UNIT SIZE	SERIES	UNIT DIMENSIONS													MINIMUM MOUNTING PAD DIMENSIONS
		A	B	C	D	E	F	G	H	J	K	L	M	N	
024	E, F	33-13/16	30	33	5-1/16	9-11/16	21-15/16	28-3/8	5/8	8-3/16	17	19-3/4	15-3/4	2-15/16	26 x 32
030	E, F	27-13/16	30	33	5-1/16	9-11/16	15-15/16	22-3/8	3/4	8-3/16	18-1/2	19-3/4	13	2-15/16	26 x 32
036	E, F	33-13/16	30	33	5-1/16	9-11/16	21-15/16	28-3/8	3/4	8-3/16	17	19-3/4	15-3/4	2-15/16	26 x 32
042	E, F	39-13/16	30	33	5-1/16	9-11/16	27-15/16	34-3/8	7/8	8-3/16	17-3/4	19	17-3/4	2-15/16	26 x 32
048	E, F	39-13/16	30	33	5-1/16	9-11/16	27-15/16	34-3/8	7/8	8-3/16	16-3/4	19-1/2	17-1/4	2-15/16	26 x 32
060	E, G	39-13/16	30	33	5-1/16	9-11/16	27-15/16	34-3/8	7/8	8-3/16	16-1/2	19	16-3/4	2-15/16	26 x 32

RECOMMENDED TUBE DIAMETERS

UNIT SIZE	Liquid Tube Diameter (In.)		Vapor Tube Diameter (In.)	
	0 to 50 Ft Tube Length	Long-Line Applications*	0 to 50 Ft Tube Length	Long-Line Applications* (Maximum Diameter)
024	3/8	3/8	5/8	7/8
030, 036			3/4	7/8
042, 048			7/8	1-1/8
060			1-1/8	1-1/8

* For tube sets greater than 50 ft, consult Residential Split System Application Guideline and Service Manual.

CHECK-FLO-RATER® PISTON

UNIT SIZE-SERIES	PISTON* IDENTIFICATION NO.
024-E, F	61
030-E, F	63
036-E, F	70
042-E, F	73
048-E, F	78
060-E, G	96

* Piston listed is for any approved non-capillary tube coil combination. Piston is shipped with outdoor unit and must be installed in an approved indoor coil.

CHARGING SUBCOOLING (TXV-TYPE EXPANSION DEVICE*)

UNIT SIZE-SERIES	REQUIRED SUBCOOLING (°F)
024-E, F	13
030-E, F	12
036-E, F	11
042-E, F	12
048-E, F	11
060-E, G	12

* Must be a Puron® approved hard shutoff TXV.



★ As an ENERGY STAR® partner, Bryant Heating & Cooling Systems has determined that this product meets the ENERGY STAR® guidelines for energy efficiency.



CERTIFICATION APPLIES ONLY WHEN THE COMPLETE SYSTEM IS LISTED WITH ARI.



CERTIFICATE NO. FM 28768

REGISTERED QUALITY SYSTEM

APPROVALS
ISO 9001
EN 29001
BS 5750 PART 1
ANSI/ASQC Q91

*Refer to the combination ratings in the Product Data Sheet for system combinations meeting ENERGY STAR® efficiency standards.

SPECIFICATIONS

UNIT SIZE-SERIES	024-E/F	030-E/F	036-E/F
Operating Weight (Lb)	214	202	237
ELECTRICAL			
Unit Volts—Hertz—Phase	208/230—60—1		
Operating Voltage Range*	187—253		
Compressor— Rated Load Amps	13.5	14.7	15.4
Locked Rotor Amps	61.0	72.5	83.0
Condenser Fan Motor—Full Load Amps	0.80	0.80	1.1
Min Unit Ampacity for Wire Sizing	17.6	19.2	20.2
Min Wire Size (60°C Copper) AWG†	14	14	12
Min Wire Size (75°C Copper) AWG†	14	14	12
Max Wire Length (Ft) (60°C Copper)‡	44	41	62
Max Wire Length (Ft) (75°C Copper)‡	42	39	59
Max Branch Circuit Fuse or Circuit Breaker Size (Amps)	25	30	30
COMPRESSOR & REFRIGERANT			
Compressor— Type	Scroll		
Manufacturer	Copeland		
Temperature & Current Protection	Internal Line Break		
Refrigerant— Type	Puron® (R-410A)		
Amount (Lb)	6.00	6.00	6.88
CONDENSER COIL & FAN			
Coil Face Area (Sq Ft)	15.2	12.2	15.2
Fins per In.—Rows—Circuits	25—1—2	25—1—2	25—1—2
Fan Motor—HP (PSC) & RPM	1/8 & 825	1/8 & 825	1/5 & 825
Volts—Hertz—Phase	208/230—60—1		
Condenser Airflow (CFM)	2400	2400	2800
OPTIONAL EQUIPMENT			
Support Feet	KSASF0101AAA		
Coastal Filter	KAACF0201MED		
Time Delay Relay	KAATD0101TDR		
Cycle Protector	KSACY0101AAA		
Crankcase Heater	KAACH1201AAA		
Start Assist—Capacitor/Relay Type	KSAHS1501AAA		
Start Assist—PTC Type	KAACS0201PTC		
TXV (Hard Shutoff)	KSATX0201PUR	KSATX0301PUR	
Piston Body	KSAPX0101PIS		
Filter Drier (Suction Line)	KH45LG140 (RCD)		
Evaporator Freeze Thermostat**	KAAFT0101AAA		
Liquid-Line Solenoid Valve	KAALS0201LLS		
Winter Start Control**	KAAWS0101AAA		
Low-Ambient Pressure Switch	KSALA0301410		
MotorMaster® Control††	32LT660004 (RCD)		
Ball Bearing Fan Motor	HC38GE230 (RCD)		
Thermostat—Auto Changeover, Non-Programmable, °F/°C, 1-Stage Heat, 1-Stage Cool	TSTATBBNAC01-B		
Thermostat—Auto Changeover, 7-Day Programmable, °F/°C, 1-Stage Heat, 1-Stage Cool	TSTATBBPAC01-B		
Thermidistat™ Control— Programmable/Non-Programmable Thermostat with Humidity Control	TSTATBBPRH01-B		
Builder's Thermostat—Manual Changeover, Non-Programmable, °F/°C, 1-Stage Heat, 1-Stage Cool	TSTATBBBAC01-B		
Outdoor Air Temperature Sensor	TSTATXXSEN01-B		
Backplate for Non-Programmable Thermostat	TSTATXXNBP01		
Backplate for Programmable Thermostat	TSTATXXBP01		
Backplate for Builder's Thermostat	TSTATXXBBP01		
Thermostat Conversion Kit (4 to 5 wire)—10 Pack	TSTATXXCNV10		

See notes on page 5.

SPECIFICATIONS Continued

UNIT SIZE-SERIES	042-E/F	048-E/F	060-E/G
Operating Weight (Lb)	247	295	331
ELECTRICAL			
Unit Volts—Hertz—Phase	208/230—60—1		
Operating Voltage Range*	187—253		
Compressor— Rated Load Amps	18.6	20.5	27.6
Locked Rotor Amps	105.0	109.0	158.0
Condenser Fan Motor—Full Load Amps	1.1	1.4	1.4
Min Unit Ampacity for Wire Sizing	24.4	27.0	35.9
Min Wire Size (60°C Copper) AWG†	10	10	8
Min Wire Size (75°C Copper) AWG†	10	10	8
Max Wire Length (Ft) (60°C Copper)‡	80	73	85
Max Wire Length (Ft) (75°C Copper)‡	76	70	80
Max Branch Circuit Fuse or Circuit Breaker Size (Amps)	40	40	60
COMPRESSOR & REFRIGERANT			
Compressor— Type	Scroll		
Manufacturer	Copeland		
Temperature & Current Protection	Internal Line Break		
Refrigerant— Type	Puron® (R-410A)		
Amount (Lb)	8.75	10.13	12.00
CONDENSER COIL & FAN			
Coil Face Area (Sq Ft)	18.2	18.2	18.2
Fins per In.—Rows—Circuits	25—1—3	20—2—5	20—2—5
Fan Motor—HP (PSC) & RPM	1/5 & 825	1/4 & 1100	1/4 & 1100
Volts—Hertz—Phase	208/230—60—1		
Condenser Airflow (CFM)	2800	3300	3300
OPTIONAL EQUIPMENT			
Support Feet	KSASF0101AAA		
Coastal Filter	KAACF0201MED		
Time Delay Relay	KAATD0101TDR		
Cycle Protector	KSACY0101AAA		
Crankcase Heater	KAACH1201AAA	Standard	
Start Assist—Capacitor/Relay Type	KSAHS1501AAA	KSAHS1601AAA	
Start Assist—PTC Type	KAACS0201PTC		
TXV (Hard Shutoff)	KSATX0301PUR	KSATX0401PUR	KSATX0501PUR
Piston Body	KSAPX0101PIS		
Filter Drier (Suction Line)	KH45LG141 (RCD)		
Evaporator Freeze Thermostat**	KAAFT0101AAA		
Liquid-Line Solenoid Valve	KAALS0201LLS		Standard
Winter Start Control**	KAAWS0101AAA		
Low-Ambient Pressure Switch	KSALA0301410		
MotorMaster® Control††	32LT660004 (RCD)		
Ball Bearing Fan Motor	HC38GE230 (RCD)	HC40GE230 (RCD)	
Thermostat—Auto Changeover, Non-Programmable, °F/°C, 1-Stage Heat, 1-Stage Cool	TSTATBBNAC01-B		
Thermostat—Auto Changeover, 7-Day Programmable, °F/°C, 1-Stage Heat, 1-Stage Cool	TSTATBBPAC01-B		
Thermidistat™ Control— Programmable/Non-Programmable Thermostat with Humidity Control	TSTATBBPRH01-B		
Builder's Thermostat—Manual Changeover, Non-Programmable, °F/°C, 1-Stage Heat, 1-Stage Cool	TSTATBBBAC01-B		
Outdoor Air Temperature Sensor	TSTATXXSEN01-B		
Backplate for Non-Programmable Thermostat	TSTATXXNBP01		
Backplate for Programmable Thermostat	TSTATXXBP01		
Backplate for Builder's Thermostat	TSTATXXBBP01		
Thermostat Conversion Kit (4 to 5 wire)—10 Pack	TSTATXXCNV10		

* Permissible limits of the voltage range at which the unit will operate satisfactorily. Operation outside these limits may result in unit failure.

† If wire is applied at ambient greater than 30°C (86°F), consult Table 310-16 of the NEC (ANSI/NFPA 70).

The ampacity of nonmetallic-sheathed cable (NM), trade name ROMEX, shall be that of 60°C (140°F) conductors, per the NEC (ANSI/NFPA 70) Article 336-26. If other than uncoated (non-plated), 60 or 75°C (140 or 167°F) insulation, copper wire (solid wire for 10 AWG and smaller, stranded wire for larger than 10 AWG) is used, consult applicable tables of the NEC (ANSI/NFPA 70).

‡ Length shown is as measured 1 way along wire path between unit and service panel for a voltage drop not to exceed 2%.

** See low-ambient controller Installation Instructions for application.

†† Fan motor with ball bearings required.

N/A — Not Applicable.

NOTE: Copper wire must be used from service disconnect to unit. All motors/compressors contain internal overload protection.

ACCESSORY USAGE GUIDELINE

ACCESSORY	REQUIRED FOR LOW-AMBIENT APPLICATIONS (Below 55°F)	REQUIRED FOR LONG-LINE APPLICATIONS* (Over 50 Ft)	REQUIRED FOR SEA COAST APPLICATIONS (Within 2 Miles)
Crankcase Heater	Yes	Yes	No
Evaporator Freeze Thermostat	Yes	No	No
Winter Start Control	Yes†	No	No
Accumulator	No	No	No
Compressor Start Assist Capacitor and Relay	Yes	Yes	No
MotorMaster® Control or Low-Ambient Pressure Switch	Yes	No	No
Wind Baffle	See Low-Ambient Instructions	No	No
Coastal Filter	No	No	Yes
Support Feet	Recommended	No	Recommended
Liquid-Line Solenoid Valve or Hard Shutoff TXV	No	See Long-Line Application Guideline	No
Ball Bearing Fan Motor	Yes‡	No	No

* For tubing line sets greater than 50 ft and/or 20 ft vertical differential, refer to Residential Split-System Long-Line Application Guideline and Service Manual.

† Only when low-pressure switch is used.

‡ Required for MotorMaster® Control only.

ACCESSORY DESCRIPTION AND USAGE (Listed Alphabetically)

1. Ball Bearing Fan Motor

A fan motor with ball bearings which permits speed reduction while maintaining bearing lubrication.

SUGGESTED USE: Required on all units where Low-Ambient Controller (full modulation feature) or MotorMaster® Control has been added.

2. Coastal Filter

A mesh screen inserted under the top cover and inside base pan to protect the condenser coil from corrosive atmosphere without restricting airflow.

SUGGESTED USE: In geographic areas where salt damage could occur.

In areas with high pollution levels.

3. Compressor Start Assist—Capacitor/Relay Type

Start capacitor and start relay which gives a “hard” boost to compressor motor at each start-up.

SUGGESTED USE: Installations where interconnecting tube length exceeds 50 ft.

Installations where outdoor design temperature exceeds 105°F (40.6°C).

Installations where Liquid-Line Solenoid Valve has been added.

4. Compressor Start Assist—PTC Type

Solid-state electrical device which gives a “soft” boost to compressor motor at each start-up.

SUGGESTED USE: Installations with marginal power supply.

Replacement installations with rapid pressure balance (RPB) expansion valve on indoor coil.

5. Crankcase Heater

An electric resistance heater which mounts to the base of the compressor to keep the lubricant warm during off cycles. Improves compressor lubrication on restart and minimizes chance of refrigerant slugging. May or may not include a thermostat control.

SUGGESTED USE: When interconnecting tube length exceeds 50 ft.

When unit will be operated below 55°F (12.8°C) outdoor air temperature. Use with Low-Ambient Controller.

All commercial installations.

6. Cycle Protector

Solid state timing device which prevents compressor rapid recycling. Control provides an approximate 5-minute delay after power to the compressor has been interrupted for any reason, including normal room thermostat cycling.

SUGGESTED USE: Installations in areas where power interruptions are frequent.

Where user is likely to “play” with the room thermostat.

All commercial installations.

Installations where interconnecting tube length exceeds 50 ft.

High-rise applications.

7. Evaporator Freeze Thermostat

An SPST temperature actuated switch which stops unit operation when evaporator reaches freeze-up conditions.

SUGGESTED USE: All units where Winter Start Control has been added.

8. Filter Drier (Suction Line)

A device for removing contaminants from refrigerant circulating in an air conditioner: 1-direction flow.

SUGGESTED USE: All split-system air conditioners.

9. Liquid-Line Solenoid Valve (LSV)

An electrically operated shutoff valve to be installed at the outdoor or indoor unit (depending on tubing configuration) and which stops and starts refrigerant liquid flow in response to compressor operation. Maintains a column of refrigerant liquid ready for action at next compressor operation cycle.

NOTE: Compressor Start Assist—Capacitor/Relay Type must also be used. Do not use with hard shutoff TXV.

SUGGESTED USE: For improved system performance in air conditioners for certain combinations of indoor and outdoor units. Refer to ARI Unitary Directory. In certain long-line applications. Refer to Residential Split System Long-Line Application Guideline and Service Manual.

ACCESSORY DESCRIPTION AND USAGE (Listed Alphabetically) Continued

10. Low-Ambient Pressure Switch

A long life pressure switch which is mounted to outdoor unit service valve. It is designed to cycle the outdoor fan motor in order to maintain head pressure within normal operating limits (approximately 200 psig to 365 psig). The control will maintain working head pressure at low-ambient temperatures down to 0°F when properly installed.

SUGGESTED USE: Cooling operation at outdoor temperatures below 55°F (12.8°C).

11. MotorMaster® Control

A fan speed control device activated by a temperature sensor. Designed to control condenser fan motor speed in response to the saturated, condensing temperature during operation in cooling mode only. For outdoor temperatures down to -20°F, it maintains condensing temperature at 100°F ± 10°F.

SUGGESTED USE: Cooling operation at outdoor temperatures below 55°F.

All commercial installations.

12. Outdoor Air Temperature Sensor

A device that allows the temperature at a remote location (outdoors) to be displayed at the thermostat.

SUGGESTED USE: All corporate programmable thermostats.

13. Piston Body

This piston body is to be used as a replacement for the FK4C Fan Coil R-22 thermostatic expansion valve when used with Puron® (R-410A) air conditioner units. Use piston and piston ring shipped with outdoor unit for installations under 50 ft.

SUGGESTED USE: All Puron® (R-410A) air conditioner installations matched with FK4C Fan Coils.

14. Support Feet

Four stick-on plastic feet which raise the unit 4 in. above the mounting pad. This allows sand, dirt, and other debris to be flushed from the unit base, minimizing corrosion.

SUGGESTED USE: For improved sound ratings.

Coastal installations.

Windy areas or where debris is normally circulating.

Rooftop installations.

15. Thermostatic Expansion Valve (TXV)

A modulating flow-control valve which meters refrigerant liquid flow rate into the evaporator in response to the superheat of the refrigerant gas leaving the evaporator. Kit includes valve, adapter tubes, and external equalizer tube. Hard shutoff valves are available. Do not use with Liquid-Line Solenoid Valve.

SUGGESTED USE: For improved system performance in cooling mode for certain combinations of indoor and outdoor units. Refer to ARI Unitary Directory.

Required for use on all zoning systems.

16. Time-Delay Relay

An SPST delay relay which briefly continues operation of the indoor blower motor to provide additional cooling after the compressor cycles off.

SUGGESTED USE: For improved efficiency ratings for certain combinations of indoor and outdoor units. Refer to ARI Unitary Directory.

Required for use on all zoning systems.

17. Winter Start Control

An SPST delay relay which bypasses the low-pressure switch for approximately 3 minutes to permit start-up for cooling operation under low-load conditions.

SUGGESTED USE: All air conditioners where Low-Ambient Controller has been added.

SOUND POWER (dBA)

UNIT SIZE	SOUND LEVEL (dBA)	OCTAVE BAND CENTER FREQUENCY (Hz)						
		125	250	500	1000	2000	4000	8000
024	69	55	59	64	66	63	59.5	53
030	70	57.5	60	64	66	62	58.5	53.5
036	72	57.5	60.5	65	65	62	59	52.5
042	72	55.5	62.5	66	65.5	63.5	62	55.5
048	76	62	67.5	70	69.5	67.5	66	60.5
060	78	66	68	71.5	72.5	70.5	65	59.5

COMBINATION RATINGS

UNIT SIZE-SERIES	INDOOR MODEL	TOT. CAP. BTUH	FACTORY- SUPPLIED ENHANCE- MENT	SEER			EER
				Standard Rating	Bryant Gas Furnace or Accessory TDR†	Accessory TXV‡	
024-E, F	CC5A/CD5AA030*	24,000	NONE	—	13.00	13.00	11.20
	CC5A/CD5AA024	24,000	NONE	—	12.50	12.50	11.10
	CC5A/CD5AW024	24,000	NONE	—	12.50	12.50	11.10
	CC5A/CD5AW030	24,000	NONE	—	13.00	13.00	11.20
	CE3AA024	24,000	NONE	—	12.50	12.50	11.25
	CE3AA030	24,000	NONE	—	13.00	13.00	11.35
	CF5AA024	24,000	NONE	—	12.50	12.50	11.20
	CK3BA024	24,000	NONE	—	12.50	12.50	11.20
	CK3BA030	24,000	NONE	—	13.00	13.00	11.35
	CK5A/CK5BA024	24,000	NONE	—	12.50	12.50	11.20
	CK5A/CK5BA030	24,000	NONE	—	13.00	13.00	11.35
	CK5A/CK5BW024	24,000	NONE	—	12.50	12.50	11.20
	CK5A/CK5BW030	24,000	NONE	—	13.00	13.00	11.35
	F(A,B)4(A,B)NF024	24,000	TDR	12.50	—	12.50	11.30
	F(A,B)4(A,B)NF030	24,000	TDR	13.00	—	13.00	11.40
	FF1DNA024	24,000	TDR	12.50	—	12.50	11.30
	FF1DNA030	24,000	TDR	13.00	—	13.00	11.50
	FG3AAA024	24,000	NONE	—	12.00	12.00	11.00
	FK4(C,D)NF002	26,000	TDR & TXV	14.00	—	—	12.40
	FK4(C,D)NF003	26,000	TDR & TXV	14.00	—	—	12.60
	FK4(C,D)NF003††	25,600	TDR & TXV	14.00	—	—	12.95
	FV4(A,B)NF002	26,000	TDR & TXV	14.00	—	—	12.40
	FV4(A,B)NF003	26,000	TDR & TXV	14.00	—	—	12.60
	FX4(A,B)NF030	24,000	TDR & TXV	12.50	—	—	11.00
	COILS +315(A,J)AV036070 VARIABLE SPEED FURNACE						
	CC5A/CD5AA024	24,000	TDR	13.5	—	13.5	11.95
	CC5A/CD5AA030	24,000	TDR	14	—	14	12.2
	CC5A/CD5AW024	24,000	TDR	13.5	—	13.5	11.95
	CC5A/CD5AW030	24,000	TDR	14	—	14	12.2
	CE3AA024	24,000	TDR	13.5	—	13.5	12.05
	CE3AA030	24,000	TDR	14	—	14	12.25
	CK3BA024	24,000	TDR	13.5	—	13.5	12.15
	CK3BA030	24,000	TDR	14	—	14	12.25
	CK5A/CK5BA024	24,000	TDR	13.5	—	13.5	12.15
	CK5A/CK5BA030	24,000	TDR	14	—	14	12.25
	CK5A/CK5BW024	24,000	TDR	13.5	—	13.5	12.15
	CK5A/CK5BW030	24,000	TDR	14	—	14	12.25
	CK5PA024	24,000	TDR&TXV	13.5	—	—	12.1
	CK5PA030	24,000	TDR&TXV	14	—	—	12.25
	CK5PW024	24,000	TDR&TXV	13.5	—	—	12.1
	CK5PW030	24,000	TDR&TXV	14	—	—	12.25
	COILS + 355MAV042040 VARIABLE SPEED FURNACE						
	CC5A/CD5AA024	24,000	TDR	13.50	—	13.50	11.95
	CC5A/CD5AA030	24,000	TDR	14.00	—	14.00	12.25
	CC5A/CD5AW024	24,000	TDR	13.50	—	13.50	11.95
	CC5A/CD5AW030	24,000	TDR	14.00	—	14.00	12.25
	CE3AA024	24,000	TDR	13.50	—	13.50	12.05
	CE3AA030	24,000	TDR	14.00	—	14.00	12.30
	CK3BA024	24,000	TDR	13.50	—	13.50	12.00
	CK3BA030	24,000	TDR	14.00	—	14.00	12.20
	CK5A/CK5BW030	24,000	TDR	14.00	—	14.00	12.20
	COILS + 355MAV042060 VARIABLE SPEED FURNACE						
	CC5A/CD5AA024	24,000	TDR	13.50	—	13.50	11.90
	CC5A/CD5AA030	24,000	TDR	14.00	—	14.00	12.15
	CC5A/CD5AW024	24,000	TDR	13.50	—	13.50	11.90
	CC5A/CD5AW030	24,000	TDR	14.00	—	14.00	12.15
	CE3AA024	24,000	TDR	13.50	—	13.50	12.00
	CE3AA030	24,000	TDR	14.00	—	14.00	12.25
	CK3BA024	24,000	TDR	13.50	—	13.50	12.00
	CK3BA030	24,000	TDR	14.00	—	14.00	12.20
	CK5A/CK5BW024	24,000	TDR	13.50	—	13.50	12.00
	CK5A/CK5BW030	24,000	TDR	14.00	—	14.00	12.20
	COILS + 355MAV042080 VARIABLE SPEED FURNACE						
	CC5A/CD5AA024	24,000	TDR	13.50	—	13.50	12.05
	CC5A/CD5AA030	24,000	TDR	14.00	—	14.00	12.30
	CC5A/CD5AW024	24,000	TDR	13.50	—	13.50	12.05
	CC5A/CD5AW030	24,000	TDR	14.00	—	14.00	12.30
	CE3AA024	24,000	TDR	13.50	—	13.50	12.15
	CE3AA030	24,000	TDR	14.00	—	14.00	12.40
	CK3BA024	24,000	TDR	13.50	—	13.50	12.25
	CK3BA030	24,000	TDR	14.00	—	14.00	12.45
	CK5A/CK5BW024	24,000	TDR	13.50	—	13.50	12.25
	CK5A/CK5BW030	24,000	TDR	14.00	—	14.00	12.45
030-E, F	CC5A/CD5AA030	28,000	NONE	—	12.50	12.50	11.20
	CC5A/CD5AA036*	29,000	NONE	—	13.00	13.00	10.85
	CC5A/CD5AW030	28,000	NONE	—	12.50	12.50	10.85
	CD5AW036	29,000	NONE	—	13.00	13.00	11.20
	CE3AA030	28,000	NONE	—	12.50	12.50	11.00
	CE3AA036	28,400	NONE	—	12.50	12.50	11.10
	CF5AA036	28,400	NONE	—	12.50	12.50	11.15
	CK3BA030	28,000	NONE	—	12.50	12.50	10.95
	CK3BA036	29,000	NONE	—	13.00	13.00	11.25

See notes on page 16.

COMBINATION RATINGS Continued

UNIT SIZE-SERIES	INDOOR MODEL	TOT. CAP. BTUH	FACTORY- SUPPLIED ENHANCE- MENT	SEER			EER
				Standard Rating	Bryant Gas Furnace or Accessory TDR†	Accessory TXV‡	
030-E, F	CK5A/CK5BA030	28,000	NONE	—	12.50	12.50	10.95
	CK5A/CK5BA036	29,000	NONE	—	13.00	13.00	11.25
	CK5A/CK5BN036	27,000	NONE	—	13.00	13.00	11.25
	CK5A/CK5BW030	28,000	NONE	—	12.50	12.50	10.95
	CK5A/CK5BW036	29,000	NONE	—	13.00	13.00	11.25
	F(A,B)4(A,B)NF030	28,600	TDR	12.50	—	12.50	11.10
	F(A,B)4(A,B)NF036	29,000	TDR	12.50	—	12.50	10.95
	FF1DNA030	28,600	TDR	12.50	—	12.50	11.05
	FG3AAA036	28,400	NONE	—	12.50	12.50	11.00
	FK4(C,D)NF001**	29,000	TDR & TXV	13.00	—	—	11.95
	FK4(C,D)NF001††	28,600	TDR & TXV	13.00	—	—	12.10
	FK4(C,D)NF002**	29,000	TDR & TXV	13.50	—	—	12.05
	FK4(C,D)NF003**	29,600	TDR & TXV	14.00	—	—	12.40
	FK4(C,D)NF003††	29,000	TDR & TXV	14.00	—	—	12.55
	FV4(A,B)NF002	29,000	TDR & TXV	13.50	—	—	12.05
	FV4(A,B)NF003	29,600	TDR & TXV	14.00	—	—	12.40
	FX4(A,B)NF030	28,600	TDR & TXV	12.50	—	—	11.00
	FX4(A,B)NF036	29,000	TDR & TXV	12.50	—	—	10.95
	COILS +315(A,J)AV036070 VARIABLE SPEED FURNACE						
	CC5A/CD5AA030	28,000	TDR	13.5	—	13.5	11.65
	CC5A/CD5AA036	29,000	TDR	14	—	14	12
	CC5A/CD5AW030	28,000	TDR	13.5	—	13.5	11.65
	CE3AA030	28,400	TDR	13.5	—	13.5	11.75
	CE3AA036	28,600	TDR	13.5	—	13.5	11.85
	CK3BA030	28,000	TDR	13.5	—	13.5	11.7
	CK3BA036	29,000	TDR	14	—	14	12.05
	CK5A/CK5BA030	28,000	TDR	13.5	—	13.5	11.7
	CK5A/CK5BA036	29,000	TDR	14	—	14	12.05
	CK5A/CK5BT036	29,000	TDR	14	—	14	12.05
	CK5A/CK5BW030	28,000	TDR	13.5	—	13.5	11.7
	CK5PA030	28,600	TDR&TXV	13.5	—	—	11.7
	CK5PA036	29,000	TDR&TXV	14	—	—	12.05
	CK5PT036	29,000	TDR&TXV	14	—	—	12.05
	CK5PW030	28,600	TDR&TXV	13.5	—	—	11.7
	COILS +315(A,J)AV048090 VARIABLE SPEED FURNACE						
	CC5A/CD5AA030	28,000	TDR	13.5	—	13.5	11.8
	CC5A/CD5AA036	29,000	TDR	14	—	14	12.15
	CC5A/CD5AW030	28,000	TDR	13.5	—	13.5	11.8
	CC5A/CD5AW036	29,000	TDR	14	—	14	12.15
	CE3AA030	28,600	TDR	13.5	—	13.5	11.9
	CE3AA036	28,800	TDR	13.5	—	13.5	12.05
	CK3BA030	28,000	TDR	13.5	—	13.5	11.85
	CK3BA036	29,000	TDR	14	—	14	12.2
	CK5A/CK5BA030	28,000	TDR	13.5	—	13.5	11.85
	CK5A/CK5BA036	29,000	TDR	14	—	14	12.2
	CK5A/CK5BW030	28,600	TDR	13.5	—	13.5	11.85
	CK5A/CK5BW036	29,000	TDR	14	—	14	12.2
	CK5PA030	28,600	TDR&TXV	13.5	—	—	11.8
	CK5PA036	29,000	TDR&TXV	14	—	—	12.2
	CK5PT036	29,000	TDR&TXV	14	—	—	12.2
	CK5PW030	28,600	TDR&TXV	13.5	—	—	11.8
	CK5PW036	29,000	TDR&TXV	14	—	—	12.2
	COILS + 355MAV042040 VARIABLE SPEED FURNACE						
	CC5A/CD5AA030	28,400	TDR	13.20	—	13.20	11.55
	CC5A/CD5AA036	29,600	TDR	13.50	—	13.50	11.90
	CC5A/CD5AW030	28,400	TDR	13.20	—	13.20	11.55
	CC5A/CD5AW036	29,600	TDR	13.50	—	13.50	11.90
	CE3AA030	29,000	TDR	13.50	—	13.50	11.70
	CE3AA036	29,200	TDR	13.50	—	13.50	11.75
	CK3BA030	28,400	TDR	13.00	—	13.00	11.45
	CK3BA036	29,600	TDR	13.50	—	13.50	11.95
	CK5A/CK5BW030	28,400	TDR	13.00	—	13.00	11.45
	CK5A/CK5BW036	29,600	TDR	13.50	—	13.50	11.95
	COILS + 355MAV042060 VARIABLE SPEED FURNACE						
	CC5A/CD5AA030	28,400	TDR	13.20	—	13.20	11.50
	CC5A/CD5AA036	29,600	TDR	13.50	—	13.50	11.90
	CC5A/CD5AW030	28,400	TDR	13.20	—	13.20	11.50
	CC5A/CD5AW036	29,600	TDR	13.50	—	13.50	11.90
	CE3AA030	29,000	TDR	13.20	—	13.20	11.65
	CE3AA036	29,200	TDR	13.50	—	13.50	11.75
	CK3BA030	28,400	TDR	13.20	—	13.20	11.45
	CK3BA036	29,600	TDR	13.50	—	13.50	11.95
	CK5A/CK5BA036	29,600	TDR	13.50	—	13.50	11.95
	CK5A/CK5BW030	28,400	TDR	13.20	—	13.20	11.45
	COILS + 355MAV042080 VARIABLE SPEED FURNACE						
	CC5A/CD5AA030	28,600	TDR	13.50	—	13.50	11.65
	CC5A/CD5AA036	29,600	TDR	14.00	—	14.00	12.10
	CC5A/CD5AW030	28,600	TDR	13.50	—	13.50	11.65
	CC5A/CD5AW036	29,600	TDR	14.00	—	14.00	12.10
	CE3AA030	29,000	TDR	13.50	—	13.50	11.80
	CE3AA036	29,200	TDR	13.50	—	13.50	11.90

See notes on page 16.

COMBINATION RATINGS Continued

UNIT SIZE-SERIES	INDOOR MODEL	TOT. CAP. BTUH	FACTORY- SUPPLIED ENHANCE- MENT	SEER			EER
				Standard Rating	Bryant Gas Furnace or Accessory TDR†	Accessory TXV‡	
030-E, F	CK3BA030	28,600	TDR	13.20	—	13.20	11.55
	CK3BA036	29,600	TDR	14.00	—	14.00	12.10
	CK5A/CK5BW030	28,600	TDR	13.20	—	13.20	11.55
	CK5A/CK5BW036	29,600	TDR	14.00	—	14.00	12.10
036-E, F	CC5A/CD5AA036	35,000	NONE	—	13.00	13.00	11.20
	CC5A/CD5AA042*	35,000	NONE	—	13.00	13.00	11.20
	CC5A/CD5AW042	35,000	NONE	—	12.50	12.50	11.10
	CD5AW036	35,000	NONE	—	13.00	13.00	11.20
	CE3AA036	35,000	NONE	—	12.50	12.50	11.05
	CE3AA042	35,000	NONE	—	13.00	13.00	11.30
	CF5AA036	35,000	NONE	—	13.00	13.00	11.15
	CK3BA036	35,000	NONE	—	13.00	13.00	11.20
	CK3BA042	35,000	NONE	—	13.00	13.00	11.20
	CK5A/CK5BA036	35,000	NONE	—	13.00	13.00	11.20
	CK5A/CK5BA042	35,000	NONE	—	13.00	13.00	11.20
	CK5A/CK5BN042	34,000	NONE	—	13.00	13.00	11.20
	CK5A/CK5BW036	35,000	NONE	—	13.00	13.00	11.20
	F(A,B)4(A,B)N(F,B)042	35,000	TDR	13.00	—	13.00	11.25
	F(A,B)4(A,B)NF036	35,000	TDR	12.50	—	12.50	11.15
	FG3AAA036	35,000	NONE	—	12.20	12.20	10.95
	FK4(C,D)NF002**	35,000	TDR & TXV	13.00	—	—	11.75
	FK4(C,D)NF003**	35,000	TDR & TXV	13.50	—	—	12.05
	FK4(C,D)NF005**	36,000	TDR & TXV	14.00	—	—	12.20
	FK4(C,D)NF005††	35,000	TDR & TXV	14.00	—	—	12.35
	FV4(A,B)NF002	35,000	TDR & TXV	13.00	—	—	11.75
	FV4(A,B)NF003	35,000	TDR & TXV	13.50	—	—	12.05
	FV4(A,B)NF005	36,000	TDR & TXV	14.00	—	—	12.20
	FX4(A,B)NF036	34,000	TDR & TXV	12.25	—	—	11.00
	FX4(A,B)NF042	35,000	TDR & TXV	13.00	—	—	11.25
	COILS +315(A,J)AV036070 VARIABLE SPEED FURNACE						
	CC5A/CD5AA036	35,000	TDR	13.5	—	13.5	11.8
	CE3AA036	35,000	TDR	13.2	—	13.2	11.7
	CE3AA042	35,000	TDR	13.5	—	13.5	11.95
	CK3BA036	35,000	TDR	13.5	—	13.5	11.9
	CK5A/CK5BA036	35,000	TDR	13.5	—	13.5	11.9
	CK5A/CK5BE042	35,000	TDR	13.5	—	13.5	12
	CK5A/CK5BT036	35,000	TDR	13.5	—	13.5	11.9
	CK5PA036	35,000	TDR&TXV	13.5	—	—	11.9
	CK5PE042	35,000	TDR&TXV	13.5	—	—	12
	CK5PT036	35,000	TDR&TXV	13.5	—	—	11.9
	COILS +315(A,J)AV048090 VARIABLE SPEED FURNACE						
	CC5A/CD5AA036	35,000	TDR	13.5	—	13.5	12
	CC5A/CD5AA042	35,000	TDR	14	—	14	12.15
	CC5A/CD5AW036	35,000	TDR	13.5	—	13.5	12
	CE3AA036	35,000	TDR	13.2	—	13.2	11.9
	CE3AA042	35,000	TDR	14	—	14	12.15
	CK3BA036	35,000	TDR	13.5	—	13.5	12.1
	CK3BA042	35,000	TDR	14	—	14	12.15
	CK5A/CK5BA036	35,000	TDR	13.5	—	13.5	12.1
	CK5A/CK5BA042	35,000	TDR	14	—	14	12.15
	CK5A/CK5BE042	35,000	TDR	14	—	14	12.2
	CK5A/CK5BT036	35,000	TDR	13.5	—	13.5	12.1
	CK5A/CK5BT042	35,000	TDR	14	—	14	12.15
	CK5A/CK5BW036	35,000	TDR	13.5	—	13.5	12.1
	CK5PA036	35,000	TDR&TXV	13.5	—	—	12.05
	CK5PA042	35,000	TDR&TXV	14	—	—	12.15
	CK5PE042	35,000	TDR&TXV	14	—	—	12.2
	CK5PT036	35,000	TDR&TXV	13.5	—	—	12.05
	CK5PT042	35,000	TDR&TXV	14	—	—	12.15
	CK5PW036	35,000	TDR&TXV	13.5	—	—	12.05
	COILS +315(A,J)AV066110 VARIABLE SPEED FURNACE						
	CC5A/CD5AA036	35,000	TDR	14	—	14	12.1
	CC5A/CD5AA042	35,000	TDR	14	—	14	12.25
	CC5A/CD5AW036	35,000	TDR	14	—	14	12.1
	CC5A/CD5AW042	35,000	TDR	14	—	14	12.2
	CE3AA036	35,000	TDR	13.5	—	13.5	12
	CE3AA042	35,000	TDR	14	—	14	12.25
	CK3BA036	35,000	TDR	14	—	14	12.15
	CK3BA042	35,000	TDR	14	—	14	12.25
	CK5A/CK5BA036	35,000	TDR	14	—	14	12.15
	CK5A/CK5BA042	35,000	TDR	14	—	14	12.25
	CK5A/CK5BT036	35,000	TDR	14	—	14	12.15
	CK5A/CK5BT042	35,000	TDR	14	—	14	12.25
	CK5A/CK5BW036	35,000	TDR	14	—	14	12.15
	CK5PA036	35,000	TDR&TXV	14	—	—	12.15
	CK5PA042	35,000	TDR&TXV	14	—	—	12.25
	CK5PT036	35,000	TDR&TXV	14	—	—	12.15
	CK5PT042	35,000	TDR&TXV	14	—	—	12.25
	CK5PW036	35,000	TDR&TXV	14	—	—	12.15
	COILS +315(A,J)AV066135 VARIABLE SPEED FURNACE						
	CC5A/CD5AA042	35,000	TDR	14	—	14	12.2

See notes on page 16.

COMBINATION RATINGS Continued

UNIT SIZE-SERIES	INDOOR MODEL	TOT. CAP. BTUH	FACTORY- SUPPLIED ENHANCE- MENT	SEER			EER
				Standard Rating	Bryant Gas Furnace or Accessory TDR†	Accessory TXV‡	
036-E, F	CC5A/CD5AW036	35,000	TDR	14	—	14	12.05
	CC5A/CD5AW042	35,000	TDR	14	—	14	12.15
	CE3AA036	35,000	TDR	13.5	—	13.5	11.95
	CE3AA042	35,000	TDR	14	—	14	12.2
	CK3BA042	35,000	TDR	14	—	14	12.2
	CK5A/CK5BA042	35,000	TDR	14	—	14	12.2
	CK5A/CK5BT042	35,000	TDR	14	—	14	12.2
	CK5A/CK5BW036	35,000	TDR	14	—	14	12.1
	CK5PA042	35,000	TDR&TXV	14	—	—	12.2
	CK5PT042	35,000	TDR&TXV	14	—	—	12.2
	CK5PW036	35,000	TDR&TXV	14	—	—	12.1
	COILS +315(A,J)AV066155 VARIABLE SPEED FURNACE						
	CC5A/CD5AA042	35,000	TDR	14	—	14	12.3
	CC5A/CD5AW036	35,000	TDR	14	—	14	12.1
	CC5A/CD5AW042	35,000	TDR	14	—	14	12.25
	CE3AA036	35,000	TDR	13.5	—	13.5	12
	CE3AA042	35,000	TDR	14	—	14	12.3
	CK3BA042	35,000	TDR	14	—	14	12.3
	CK5A/CK5BA042	35,000	TDR	14	—	14	12.3
	CK5A/CK5BT042	35,000	TDR	14	—	14	12.3
	CK5A/CK5BW036	35,000	TDR	14	—	14	12.15
	CK5PA042	35,000	TDR&TXV	14	—	—	12.25
	CK5PT042	35,000	TDR&TXV	14	—	—	12.25
	CK5PW036	35,000	TDR&TXV	14	—	—	12.15
	COILS + 355MAV042040 VARIABLE SPEED FURNACE						
	CC5A/CD5AW042	35,000	TDR	13.00	—	13.00	11.45
	CC5A/CD5AA036	35,000	TDR	13.20	—	13.20	11.60
	CC5A/CD5AA042	35,000	TDR	13.20	—	13.20	11.50
	CE3AA036	35,000	TDR	13.00	—	13.00	11.35
	CE3AA042	35,000	TDR	13.20	—	13.20	11.60
	CK3BA036	35,000	TDR	13.00	—	13.00	11.45
	CK3BA042	35,000	TDR	13.00	—	13.00	11.45
	CK5A/CK5BA042	35,000	TDR	13.00	—	13.00	11.45
	CK5A/CK5BW036	35,000	TDR	13.00	—	13.00	11.45
	COILS + 355MAV042060 VARIABLE SPEED FURNACE						
	CC5A/CD5AA036	35,000	TDR	13.20	—	13.20	11.45
	CC5A/CD5AA042	35,000	TDR	13.20	—	13.20	11.60
	CC5A/CD5AW042	35,000	TDR	13.00	—	13.00	11.50
	CD5AW036	35,000	TDR	13.20	—	13.20	11.45
	CE3AA036	35,000	TDR	13.00	—	13.00	11.35
	CE3AA042	35,000	TDR	13.20	—	13.20	11.60
	CK3BA036	35,000	TDR	13.00	—	13.00	11.50
	CK3BA042	35,000	TDR	13.20	—	13.20	11.60
	CK5A/CK5BA036	35,000	TDR	13.00	—	13.00	11.50
	CK5A/CK5BN042	34,000	TDR	13.00	—	13.00	11.50
	COILS + 355MAV042080 VARIABLE SPEED FURNACE						
	CC5A/CD5AA036	35,000	TDR	13.20	—	13.20	11.65
	CC5A/CD5AA042	35,000	TDR	13.50	—	13.50	11.85
	CC5A/CD5AW042	35,000	TDR	13.50	—	13.50	11.75
	CD5AW036	35,000	TDR	13.20	—	13.20	11.65
	CE3AA036	35,000	TDR	13.00	—	13.00	11.55
	CE3AA042	35,000	TDR	13.50	—	13.50	11.85
	CK3BA036	35,000	TDR	13.20	—	13.20	11.60
	CK3BA042	35,000	TDR	13.50	—	13.50	11.75
	CK5A/CK5BA042	35,000	TDR	13.50	—	13.50	11.75
	CK5A/CK5BW036	35,000	TDR	13.20	—	13.20	11.60
	COILS + 355MAV060080 VARIABLE SPEED FURNACE						
	CC5A/CD5AA036	35,000	TDR	13.50	—	13.50	11.75
	CC5A/CD5AA042	35,000	TDR	13.50	—	13.50	11.90
	CC5A/CD5AW042	35,000	TDR	13.50	—	13.50	11.85
	CD5AW036	35,000	TDR	13.50	—	13.50	11.75
	CE3AA036	35,000	TDR	13.00	—	13.00	11.60
	CE3AA042	35,000	TDR	13.50	—	13.50	11.90
	CK3BA036	35,000	TDR	13.00	—	13.00	11.45
	CK3BA042	35,000	TDR	13.00	—	13.00	11.60
	CK5A/CK5BA042	35,000	TDR	13.00	—	13.00	11.60
	CK5A/CK5BW036	35,000	TDR	13.00	—	13.00	11.45
	COILS + 355MAV060100 VARIABLE SPEED FURNACE						
	CC5A/CD5AA036	35,000	TDR	13.50	—	13.50	11.75
	CC5A/CD5AA042	35,000	TDR	13.50	—	13.50	11.90
	CC5A/CD5AW042	35,000	TDR	13.50	—	13.50	11.85
	CD5AW036	35,000	TDR	13.50	—	13.50	11.75
	CE3AA036	35,000	TDR	13.00	—	13.00	11.60
	CE3AA042	35,000	TDR	13.50	—	13.50	11.90
	CK3BA036	35,000	TDR	13.50	—	13.50	11.80
	CK3BA042	35,000	TDR	13.50	—	13.50	12.00
	CK5A/CK5BA042	35,000	TDR	13.50	—	13.50	12.00
	CK5A/CK5BW036	35,000	TDR	13.50	—	13.50	11.80

See notes on page 16.

COMBINATION RATINGS Continued

UNIT SIZE-SERIES	INDOOR MODEL	TOT. CAP. BTUH	FACTORY- SUPPLIED ENHANCE- MENT	SEER			EER
				Standard Rating	Bryant Gas Furnace or Accessory TDR†	Accessory TXV‡	
036-E, F	COILS + 355MAV060120 VARIABLE SPEED FURNACE						
	CC5A/CD5AA036	35,000	TDR	13.50	—	13.50	11.75
	CC5A/CD5AA042	35,000	TDR	13.50	—	13.50	11.90
	CC5A/CD5AW042	35,000	TDR	13.50	—	13.50	11.85
	CD5AW036	35,000	TDR	13.50	—	13.50	11.75
	CE3AA036	35,000	TDR	13.00	—	13.00	11.60
	CE3AA042	35,000	TDR	13.50	—	13.50	11.90
	CK3BA036	35,000	TDR	13.50	—	13.50	11.85
	CK3BA042	35,000	TDR	13.50	—	13.50	12.00
	CK5A/CK5BA042	35,000	TDR	13.50	—	13.50	12.00
	CK5A/CK5BW036	35,000	TDR	13.50	—	13.50	11.85
042-E, F	CD5AA048*	40,500	NONE	—	13.00	13.00	11.20
	CC5A/CD5AA042	40,500	NONE	—	13.00	13.00	11.15
	CC5A/CD5AC048	40,000	NONE	—	12.50	12.50	11.10
	CC5A/CD5AW042	40,000	NONE	—	12.50	12.50	11.00
	CC5A/CD5AW048	40,500	NONE	—	13.00	13.00	11.20
	CE3AA042	41,000	NONE	—	13.00	13.00	11.25
	CE3AA048	41,000	NONE	—	13.00	13.00	11.30
	CF5AA048	40,500	NONE	—	12.50	12.50	11.20
	CK3BA042	40,500	NONE	—	13.00	13.00	11.20
	CK3BA048	40,500	NONE	—	13.00	13.00	11.30
	CK5A/CK5BA042	40,500	NONE	—	13.00	13.00	11.20
	CK5A/CK5BA048	40,500	NONE	—	13.00	13.00	11.30
	CK5A/CK5BN042	39,500	NONE	—	12.50	12.50	11.20
	CK5A/CK5BN048	39,500	NONE	—	12.50	12.50	11.30
	CK5A/CK5BW048	40,500	NONE	—	13.00	13.00	11.30
	F(A,B)4(A,B)N(F,B)042	40,500	TDR	12.50	—	12.50	11.20
	F(A,B)4(A,B)N(F,B)048	41,000	TDR	13.00	—	13.00	11.40
	FG3AAA048	40,000	NONE	—	12.50	12.50	11.20
	FK4(C,D)NB006**	41,500	TDR & TXV	14.00	—	—	12.90
	FK4(C,D)NB006††	41,000	TDR & TXV	14.00	—	—	13.00
	FK4(C,D)NF003**	39,500	TDR & TXV	13.00	—	—	11.95
	FK4(C,D)NF005**	41,000	TDR & TXV	13.50	—	—	12.50
	FV4(A,B)NB006	41,500	TDR & TXV	14.00	—	—	12.90
	FV4(A,B)NF003	39,500	TDR & TXV	13.00	—	—	11.95
	FV4(A,B)NF005	41,000	TDR & TXV	13.50	—	—	12.50
	FX4(A,B)NF042	40,000	TDR & TXV	12.50	—	—	11.20
	FX4(A,B)NF048	40,500	TDR & TXV	12.50	—	—	11.20
	COILS +315(A,J)AV048090 VARIABLE SPEED FURNACE						
	CC5A/CD5AA042	40,000	TDR	13.5	—	13.5	11.85
	CC5A/CD5AC048	40,000	TDR	13.5	—	13.5	11.85
	CD5AA048	40,500	TDR	13.5	—	13.5	12
	CE3AA042	40,500	TDR	13.5	—	13.5	11.9
	CE3AA048	41,000	TDR	13.5	—	13.5	11.95
	CK3BA042	40,500	TDR	13.5	—	13.5	11.9
	CK3BA048	40,500	TDR	13.5	—	13.5	12
	CK5A/CK5BA042	40,000	TDR	13.5	—	13.5	11.9
	CK5A/CK5BA048	40,500	TDR	13.5	—	13.5	12
	CK5A/CK5BE042	40,500	TDR	13.5	—	13.5	11.95
	CK5A/CK5BT042	40,500	TDR	13.5	—	13.5	11.9
	CK5A/CK5BT048	40,500	TDR	13.5	—	13.5	12
	CK5PA042	40,500	TDR&TXV	13.5	—	—	11.9
	CK5PA048	40,500	TDR&TXV	13.5	—	—	12
	CK5PE042	40,500	TDR&TXV	13.5	—	—	11.95
	CK5PT042	40,500	TDR&TXV	13.5	—	—	11.9
	CK5PT048	40,500	TDR&TXV	13.5	—	—	12
	COILS +315(A,J)AV066110 VARIABLE SPEED FURNACE						
	CC5A/CD5AA042	40,500	TDR	13.5	—	13.5	11.95
	CC5A/CD5AC048	40,000	TDR	13.5	—	13.5	12
	CC5A/CD5AW042	40,000	TDR	13.5	—	13.5	11.85
	CC5A/CD5AW048	40,500	TDR	14	—	14	12.15
CD5AA048	40,500	TDR	14	—	14	12.1	
CE3AA042	40,500	TDR	13.5	—	13.5	12.05	
CE3AA048	41,000	TDR	13.5	—	13.5	12.1	
CK3BA042	40,500	TDR	13.5	—	13.5	12	
CK3BA048	40,500	TDR	14	—	14	12.15	
CK5A/CK5BA042	40,500	TDR	13.5	—	13.5	12	
CK5A/CK5BA048	40,500	TDR	14	—	—	12.15	
CK5A/CK5BT042	40,500	TDR	13.5	—	13.5	12	
CK5A/CK5BT048	40,500	TDR	14	—	14	12.15	
CK5A/CK5BW048	40,500	TDR	14	—	14	12.15	
CK5PA042	40,500	TDR&TXV	13.5	—	—	12	
CK5PA048	40,500	TDR&TXV	14	—	—	12.15	
CK5PT042	40,500	TDR&TXV	13.5	—	—	12	
CK5PT048	40,500	TDR&TXV	14	—	—	12.15	
CK5PW048	40,500	TDR&TXV	14	—	—	12.15	
COILS +315(A,J)AV066135 VARIABLE SPEED FURNACE							
CC5A/CD5AA042	40,500	TDR	13.5	—	13.5	11.95	
CC5A/CD5AC048	40,000	TDR	13.5	—	13.5	12	
CC5A/CD5AW042	40,000	TDR	13.5	—	13.5	11.85	
CC5A/CD5AW048	40,500	TDR	14	—	14	12.15	
CD5AA048	40,500	TDR	14	—	14	12.15	
CE3AA042	40,500	TDR	13.5	—	13.5	12.05	
CE3AA048	41,000	TDR	13.5	—	13.5	12.1	
CK3BA042	40,500	TDR	13.5	—	13.5	12	
CK3BA048	40,500	TDR	14	—	14	12.15	
CK5A/CK5BA042	40,500	TDR	13.5	—	13.5	12	
CK5A/CK5BA048	40,500	TDR	14	—	—	12.15	
CK5A/CK5BT042	40,500	TDR	13.5	—	13.5	12	
CK5A/CK5BT048	40,500	TDR	14	—	14	12.15	
CK5A/CK5BW048	40,500	TDR	14	—	14	12.15	
CK5PA042	40,500	TDR&TXV	13.5	—	—	12	
CK5PA048	40,500	TDR&TXV	14	—	—	12.15	
CK5PT042	40,500	TDR&TXV	13.5	—	—	12	
CK5PT048	40,500	TDR&TXV	14	—	—	12.15	
CK5PW048	40,500	TDR&TXV	14	—	—	12.15	

See notes on page 16.

COMBINATION RATINGS Continued

UNIT SIZE-SERIES	INDOOR MODEL	TOT. CAP. BTUH	FACTORY- SUPPLIED ENHANCE- MENT	SEER			EER
				Standard Rating	Bryant Gas Furnace or Accessory TDR†	Accessory TXV‡	
042-E, F	CE3AA048	41,000	TDR	13.5	—	13.5	12.1
	CK3BA042	40,500	TDR	13.5	—	13.5	12
	CK3BA048	40,500	TDR	14	—	14	12.15
	CK5A/CK5BA042	40,500	TDR	13.5	—	13.5	12
	CK5A/CK5BA048	40,500	TDR	14	—	14	12.15
	CK5A/CK5BT042	40,500	TDR	13.5	—	13.5	12
	CK5A/CK5BT048	40,500	TDR	14	—	14	12.15
	CK5A/CK5BW048	40,500	TDR	14	—	14	12.15
	CK5PA042	40,500	TDR&TXV	13.5	—	—	12
	CK5PA048	40,500	TDR&TXV	14	—	—	12.15
	CK5PT042	40,500	TDR&TXV	13.5	—	—	12
	CK5PT048	40,500	TDR&TXV	14	—	—	12.15
	CK5PW048	40,500	TDR&TXV	14	—	—	12.15
	COILS +315(A,J)AV066155 VARIABLE SPEED FURNACE						
	CC5A/CD5AA042	40,500	TDR	13.5	—	13.5	12
	CC5A/CD5AC048	40,000	TDR	13.5	—	13.5	12.05
	CC5A/CD5AW042	40,000	TDR	13.5	—	13.5	11.9
	CC5A/CD5AW048	40,500	TDR	14	—	14	12.2
	CD5AA048	40,500	TDR	14	—	14	12.2
	CE3AA042	40,500	TDR	13.5	—	13.5	12.05
	CE3AA048	41,000	TDR	13.5	—	13.5	12.1
	CK3BA042	40,500	TDR	13.5	—	13.5	12.05
	CK3BA048	40,500	TDR	14	—	14	12.2
	CK5A/CK5BA042	40,500	TDR	13.5	—	13.5	12.05
	CK5A/CK5BA048	40,500	TDR	14	—	14	12.2
	CK5A/CK5BT042	40,500	TDR	13.5	—	13.5	12.05
	CK5A/CK5BT048	40,500	TDR	14	—	14	12.2
	CK5A/CK5BW048	40,500	TDR	14	—	14	12.2
	CK5PA042	40,500	TDR&TXV	13.5	—	—	12.05
	CK5PA048	40,500	TDR&TXV	14	—	—	12.2
	CK5PT042	40,500	TDR&TXV	13.5	—	—	12.05
	CK5PT048	40,500	TDR&TXV	14	—	—	12.2
	CK5PW048	40,500	TDR&TXV	14	—	—	12.2
	COILS + 355MAV042040 VARIABLE SPEED FURNACE						
	CC5A/CD5AA042	40,500	TDR	12.80	—	12.80	11.05
	CC5A/CD5AC048	40,000	TDR	12.50	—	12.50	11.10
	CC5A/CD5AW042	40,000	TDR	12.50	—	12.50	11.00
	CC5A/CD5AW048	40,500	TDR	13.00	—	13.00	11.30
	CD5AA048	40,500	TDR	13.00	—	13.00	11.30
	CE3AA042	40,000	TDR	13.00	—	13.00	11.15
	CE3AA048	40,000	TDR	13.00	—	13.00	11.20
	COILS + 355MAV042060 VARIABLE SPEED FURNACE						
	CC5A/CD5AA042	40,500	TDR	12.80	—	12.80	11.10
	CC5A/CD5AC048	40,000	TDR	12.50	—	12.50	11.15
	CC5A/CD5AW042	40,000	TDR	12.50	—	12.50	11.05
	CC5A/CD5AW048	40,000	TDR	13.00	—	13.00	11.35
	CD5AA048	40,000	TDR	13.00	—	13.00	11.35
	CE3AA042	40,500	TDR	13.00	—	13.00	11.20
	CE3AA048	40,500	TDR	13.00	—	13.00	11.25
	COILS + 355MAV042080 VARIABLE SPEED FURNACE						
	CC5A/CD5AA042	40,500	TDR	13.00	—	13.00	11.40
	CC5A/CD5AC048	40,000	TDR	13.00	—	13.00	11.45
	CC5A/CD5AW042	40,000	TDR	13.00	—	13.00	11.30
	CC5A/CD5AW048	40,500	TDR	13.20	—	13.20	11.60
	CD5AA048	40,500	TDR	13.50	—	13.50	11.60
	CE3AA042	41,000	TDR	13.00	—	13.00	11.50
	CE3AA048	41,000	TDR	13.20	—	13.20	11.55
	CK3BA042	40,500	TDR	13.00	—	13.00	11.30
	CK3BA048	40,500	TDR	13.20	—	13.20	11.55
	CK5A/CK5BA042	40,500	TDR	13.00	—	13.00	11.30
	CK5A/CK5BA048	40,500	TDR	13.20	—	13.20	11.55
	COILS + 355MAV060080 VARIABLE SPEED FURNACE						
	CC5A/CD5AA042	40,500	TDR	13.20	—	13.20	11.50
	CC5A/CD5AC048	40,000	TDR	13.20	—	13.20	11.55
	CC5A/CD5AW042	40,000	TDR	13.00	—	13.00	11.40
	CC5A/CD5AW048	40,500	TDR	13.50	—	13.50	11.75
	CD5AA048	40,500	TDR	13.50	—	13.50	11.75
	CE3AA042	41,000	TDR	13.20	—	13.20	11.60
	CE3AA048	41,000	TDR	13.50	—	13.50	11.65
	COILS + 355MAV060100 VARIABLE SPEED FURNACE						
	CC5A/CD5AA042	40,500	TDR	13.20	—	13.20	11.50
	CC5A/CD5AC048	40,000	TDR	13.20	—	13.20	11.55
	CC5A/CD5AW042	40,000	TDR	13.00	—	13.00	11.40
	CC5A/CD5AW048	40,500	TDR	13.50	—	13.50	11.75
	CD5AA048	40,500	TDR	13.50	—	13.50	11.75
	CE3AA042	41,000	TDR	13.20	—	13.20	11.60
	CE3AA048	41,000	TDR	13.50	—	13.50	11.65
	CK3BA042	40,500	TDR	13.00	—	13.00	11.55
	CK3BA048	40,500	TDR	13.50	—	13.50	11.80
	CK5A/CK5BA042	40,500	TDR	13.00	—	13.00	11.55
	CK5A/CK5BW048	40,500	TDR	13.50	—	13.50	11.80

See notes on page 16.

COMBINATION RATINGS Continued

UNIT SIZE-SERIES	INDOOR MODEL	TOT. CAP. BTUH	FACTORY- SUPPLIED ENHANCE- MENT	SEER			EER
				Standard Rating	Bryant Gas Furnace or Accessory TDR†	Accessory TXV‡	
042-E, F	COILS + 355MAV060120 VARIABLE SPEED FURNACE						
	CC5A/CD5AA042	40,500	TDR	13.20	—	13.20	11.50
	CC5A/CD5AC048	40,000	TDR	13.20	—	13.20	11.55
	CC5A/CD5AW042	40,000	TDR	13.00	—	13.00	11.40
	CC5A/CD5AW048	40,500	TDR	13.50	—	13.50	11.75
	CD5AA048	40,500	TDR	13.50	—	13.50	11.75
	CE3AA042	41,000	TDR	13.20	—	13.20	11.60
	CE3AA048	41,000	TDR	13.50	—	13.50	11.65
	CK3BA042	40,500	TDR	13.00	—	13.00	11.65
	CK3BA048	40,500	TDR	13.50	—	13.50	11.85
	CK5A/CK5BA042	40,500	TDR	13.00	—	13.00	11.65
	CK5A/CK5BW048	40,500	TDR	13.50	—	13.50	11.85
	048-E, F	CC5A/CD5AA060*	46,500	NONE	—	13.00	13.00
CC5A/CD5AC048		45,000	NONE	—	12.50	12.50	11.35
CC5A/CD5AW048		46,000	NONE	—	13.00	13.00	11.50
CC5A/CD5AW060		47,000	NONE	—	13.00	13.00	11.80
CD5AA048		46,000	NONE	—	13.00	13.00	11.50
CE3AA048		46,500	NONE	—	13.00	13.00	11.65
CE3AA060		47,000	NONE	—	13.00	13.00	11.85
CF5AA048		46,000	NONE	—	12.50	12.50	11.55
CK3BA048		46,000	NONE	—	13.00	13.00	11.55
CK3BA060		46,500	NONE	—	13.00	13.00	11.65
CK5A/CK5BA048		46,000	NONE	—	13.00	13.00	11.55
CK5A/CK5BA060		46,500	NONE	—	13.00	13.00	11.65
CK5A/CK5BN048		44,000	NONE	—	12.50	12.50	11.30
CK5A/CK5BN060		45,500	NONE	—	13.00	13.00	11.90
CK5A/CK5BW048		46,000	NONE	—	13.00	13.00	11.55
CK5A/CK5BX060		47,000	NONE	—	13.00	13.00	11.90
F(A,B)4(A,B)N(F,B)048		46,000	TDR	12.20	—	12.20	11.50
F(A,B)4(A,B)N(F,B)060		47,000	TDR	12.50	—	12.50	11.55
FB4(A,B)NB070		47,500	TDR	13.00	—	13.00	12.00
FG3AAA048		46,000	NONE	—	12.20	12.20	11.50
FG3AAA060		46,500	NONE	—	12.50	12.50	11.65
FK4(C,D)NB006**		47,500	TDR & TXV	14.00	—	—	13.15
FK4(C,D)NB006††		47,000	TDR & TXV	14.00	—	—	13.15
FV4(A,B)NB006		47,500	TDR & TXV	14.00	—	—	13.15
FV4BNF005		47,000	TDR & TXV	13.80	—	—	12.70
FX4(A,B)NB060		47,000	TDR & TXV	12.50	—	—	11.50
FX4(A,B)NF048		46,000	TDR & TXV	12.20	—	—	11.50
COILS +315(A,J)AV048090 VARIABLE SPEED FURNACE							
CC5A/CD5AC048		45,000	TDR	13	—	13	11.8
CD5AA048		46,000	TDR	13.5	—	13.5	11.95
CE3AA048		46,500	TDR	13.5	—	13.5	11.95
CE3AA060		47,000	TDR	13.5	—	13.5	12.25
CK3BA048		46,000	TDR	13.5	—	13.5	11.95
CK5A/CK5BA048		46,000	TDR	13.5	—	13.5	11.95
CK5A/CK5BT048		46,000	TDR	13.5	—	13.5	11.95
CK5PA048		46,000	TDR&TXV	13.5	—	—	11.9
CK5PT048		46,000	TDR&TXV	13.5	—	—	11.9
COILS +315(A,J)AV066110 VARIABLE SPEED FURNACE							
CC5A/CD5AA060		46,000	TDR	13.5	—	13.5	12.2
CC5A/CD5AC048		45,000	TDR	13.5	—	13.5	12.05
CC5A/CD5AW048		46,000	TDR	13.5	—	13.5	12.15
CD5AA048		46,000	TDR	13.5	—	13.5	12.2
CD5PX060		47,500	TDR&TXV	14	—	—	12.6
CE3AA048		46,500	TDR	13.5	—	13.5	12.15
CE3AA060		47,000	TDR	14	—	14	12.5
CK3BA048		46,000	TDR	13.5	—	13.5	12.2
CK3BA060		46,500	TDR	13.5	—	13.5	12.5
CK5A/CK5BA048		46,000	TDR	13.5	—	13.5	12.2
CK5A/CK5BA060	46,500	TDR	13.5	—	13.5	12.5	
CK5A/CK5BT048	46,000	TDR	13.5	—	13.5	12.2	
CK5A/CK5BT060	46,500	TDR	13.5	—	13.5	12.5	
CK5A/CK5BW048	46,000	TDR	13.5	—	13.5	12.2	
CK5A/CK5BX060	47,500	TDR	14	—	14	12.7	
CK5PA048	46,000	TDR&TXV	13.5	—	—	12.15	
CK5PA060	46,500	TDR&TXV	13.5	—	—	12.5	
CK5PT048	46,000	TDR&TXV	13.5	—	—	12.15	
CK5PT060	46,500	TDR&TXV	13.5	—	—	12.5	
CK5PW048	46,000	TDR&TXV	13.5	—	—	12.15	
CK5PX060	47,500	TDR&TXV	14	—	—	12.75	
COILS +315(A,J)AV066135 VARIABLE SPEED FURNACE							
CC5A/CD5AA060	46,000	TDR	13.5	—	13.5	12.15	
CC5A/CD5AC048	45,000	TDR	13.5	—	13.5	12	
CC5A/CD5AW048	46,000	TDR	13.5	—	13.5	12.15	
CC5A/CD5AW060	47,000	TDR	14	—	14	12.45	
CD5AA048	46,000	TDR	13.5	—	13.5	12.15	
CD5PX060	47,500	TDR&TXV	14	—	—	12.55	
CE3AA048	46,500	TDR	13.5	—	13.5	12.1	
CE3AA060	47,000	TDR	14	—	14	12.45	
CK3BA048	46,000	TDR	13.5	—	13.5	12.15	
CK3BA060	46,500	TDR	13.5	—	13.5	12.45	
CK5A/CK5BA048	46,000	TDR	13.5	—	13.5	12.15	
CK5A/CK5BA060	46,500	TDR	13.5	—	13.5	12.45	

See notes on page 16.

COMBINATION RATINGS Continued

UNIT SIZE-SERIES	INDOOR MODEL	TOT. CAP. BTUH	FACTORY- SUPPLIED ENHANCE- MENT	SEER			EER
				Standard Rating	Bryant Gas Furnace or Accessory TDR†	Accessory TXV‡	
048-E, F	CK5A/CK5BT048	46,000	TDR	13.5	—	13.5	12.15
	CK5A/CK5BT060	46,500	TDR	13.5	—	—	12.45
	CK5A/CK5BW048	46,000	TDR	13.5	—	13.5	12.15
	CK5A/CK5BX060	47,500	TDR	14	—	14	12.65
	CK5PA048	46,000	TDR&TXV	13.5	—	—	12.1
	CK5PA060	46,500	TDR&TXV	13.5	—	—	12.45
	CK5PT048	46,000	TDR&TXV	13.5	—	—	12.1
	CK5PT060	46,500	TDR&TXV	13.5	—	—	12.45
	CK5PW048	46,000	TDR&TXV	13.5	—	—	12.1
	CK5PX060	47,500	TDR&TXV	14	—	—	12.7
	COILS +315(A,J)AV066155 VARIABLE SPEED FURNACE						
	CC5A/CD5AA060	46,000	TDR	13.5	—	13.5	12.25
	CC5A/CD5AC048	45,000	TDR	13.5	—	13.5	12.1
	CC5A/CD5AW048	46,000	TDR	13.5	—	13.5	12.25
	CC5A/CD5AW060	47,000	TDR	14	—	14	12.55
	CD5AA048	46,000	TDR	13.5	—	13.5	12.25
	CD5PX060	47,500	TDR&TXV	14	—	—	12.65
	CE3AA048	46,500	TDR	13.5	—	13.5	12.2
	CE3AA060	47,000	TDR	14	—	14	12.55
	CK3BA048	46,000	TDR	13.5	—	13.5	12.25
	CK3BA060	46,500	TDR	13.5	—	13.5	12.55
	CK5A/CK5BA048	46,000	TDR	13.5	—	13.5	12.25
	CK5A/CK5BA060	46,500	TDR	13.5	—	13.5	12.55
	CK5A/CK5BT048	46,000	TDR	13.5	—	13.5	12.25
	CK5A/CK5BT060	46,500	TDR	13.5	—	13.5	12.55
	CK5A/CK5BW048	46,000	TDR	13.5	—	13.5	12.25
	CK5A/CK5BX060	47,500	TDR	14	—	14	12.75
	CK5PA048	46,000	TDR&TXV	13.5	—	—	12.15
	CK5PA060	46,500	TDR&TXV	13.5	—	—	12.55
	CK5PT048	46,000	TDR&TXV	13.5	—	—	12.15
	CK5PT060	46,500	TDR&TXV	13.5	—	—	12.55
	CK5PW048	46,000	TDR&TXV	13.5	—	—	12.15
	CK5PX060	47,500	TDR&TXV	14	—	—	12.75
	CD5PX060	47,500	PURON-TXV	—	13.5	13.5	11.9
	COILS + 355MAV060080 VARIABLE SPEED FURNACE						
	CC5A/CD5AA060	46,500	TDR	13.00	—	13.00	11.55
	CC5A/CD5AC048	45,000	TDR	12.50	—	12.50	11.20
	CC5A/CD5AW048	46,000	TDR	13.00	—	13.00	11.50
	CC5A/CD5AW060	47,000	TDR	13.50	—	13.50	12.00
	CD5AA048	46,000	TDR	13.00	—	13.00	11.50
	CE3AA048	46,500	TDR	13.00	—	13.00	11.55
	CE3AA060	47,000	TDR	13.20	—	13.20	11.95
	COILS + 355MAV060100 VARIABLE SPEED FURNACE						
	CC5A/CD5AA060	46,500	TDR	13.00	—	13.00	11.55
	CC5A/CD5AC048	45,000	TDR	12.50	—	12.50	11.20
	CC5A/CD5AW048	46,000	TDR	13.00	—	13.00	11.50
	CC5A/CD5AW060	47,000	TDR	13.50	—	13.50	12.00
	CD5AA048	46,000	TDR	13.00	—	13.00	11.50
	CE3AA048	46,500	TDR	13.00	—	13.00	11.55
	CE3AA060	47,000	TDR	13.20	—	13.20	11.95
	CK3BA060	46,500	TDR	13.00	—	13.00	11.70
	CK5A/CK5BA060	46,500	TDR	13.00	—	13.00	11.70
	CK5A/CK5BN060	45,500	TDR	13.00	—	13.00	11.95
	CK5A/CK5BX060	47,500	TDR	13.50	—	13.50	12.05
	COILS + 355MAV060120 VARIABLE SPEED FURNACE						
	CC5A/CD5AA060	46,500	TDR	13.00	—	13.00	11.55
	CC5A/CD5AC048	45,000	TDR	12.50	—	12.50	11.20
	CC5A/CD5AW048	46,000	TDR	13.00	—	13.00	11.50
	CC5A/CD5AW060	47,000	TDR	13.50	—	13.50	12.00
	CD5AA048	46,000	TDR	13.00	—	13.00	11.50
	CE3AA048	46,500	TDR	13.00	—	13.00	11.55
	CE3AA060	47,000	TDR	13.20	—	13.20	11.95
	CK3BA048	46,000	TDR	13.00	—	13.00	11.60
	CK3BA060	46,500	TDR	13.00	—	13.00	11.80
	CK5A/CK5BA060	46,500	TDR	13.00	—	13.00	11.80
	CK5A/CK5BW048	46,000	TDR	13.00	—	13.00	11.60
	CK5A/CK5BX060	47,500	TDR	13.50	—	13.50	12.15
060-E, G	CK3BA060	58,000	LLS	—	12.50	—	10.95
	CJ5A/CK5A/CK5BX060*	59,000	LLS	—	13.00	—	11.10
	CJ5A/CK5A/CK5BA060	58,000	LLS	—	12.50	—	10.95
	F(A,B)4(A,B)N(FB,C)060	58,000	LLS & TDR	12.20	—	—	10.60
	FB4(A,B)NB070	59,000	LLS & TDR	13.00	—	—	11.10
	FK4(C,D)NB006**	59,000	LLS, TDR, & TXV	13.25	—	—	11.55
	FK4(C,D)NB006††	59,000	LLS, TDR, & TXV	13.25	—	—	11.55
	FV4(A,B)NB006	58,000	LLS, TDR, & TXV	13.25	—	—	11.55
	FX4(A,B)NB060	58,000	LLS, TDR, & TXV	12.50	—	—	10.95
	COILS +315(A,J)AV066110 VARIABLE SPEED FURNACE						
	CC5A/CD5AA060	57,000	TDR	—	12.5	—	10.9
	CD5PX060	58,000	TDR&TXV	—	13.25	—	11.35
	CE3AA060	57,500	TDR	—	12.75	—	11.35
	CK3BA060	57,500	TDR	—	13	—	11.2
	CK5A/CK5BA060	57,500	TDR	—	13	—	11.2

See notes on page 16.

COMBINATION RATINGS Continued

UNIT SIZE-SERIES	INDOOR MODEL	TOT. CAP. BTUH	FACTORY- SUPPLIED ENHANCE- MENT	SEER			EER
				Standard Rating	Bryant Gas Furnace or Accessory TDR†	Accessory TXV‡	
060-E, G	CK5A/CK5BT060	57,500	TDR	—	13	—	11.2
	CK5A/CK5BX060	58,500	TDR	—	13	—	11.5
	CK5PA060	57,500	TDR&TXV	—	13	—	11.25
	CK5PT060	57,500	TDR&TXV	—	13	—	11.25
	CK5PX060	58,500	TDR&TXV	—	13	—	11.5
	COILS +315(A,J)AV066135 VARIABLE SPEED FURNACE						
	CC5A/CD5AA060	56,500	TDR	—	12.5	—	10.9
	CC5A/CD5AW060	58,000	TDR	—	13	—	11.25
	CD5PX060	58,000	TDR&TXV	—	13	—	11.3
	CE3AA060	57,500	TDR	—	12.75	—	11.3
	CK3BA060	57,500	TDR	—	12.75	—	11.2
	CK5A/CK5BA060	57,500	TDR	—	12.75	—	11.2
	CK5A/CK5BT060	57,500	TDR	—	12.75	—	11.2
	CK5A/CK5BX060	58,500	TDR	—	13	—	11.5
	CK5PA060	57,500	TDR&TXV	—	13	—	11.2
	CK5PT060	57,500	TDR&TXV	—	12.75	—	11.2
	CK5PX060	58,500	TDR&TXV	—	13	—	11.5
	COILS +315(A,J)AV066155 VARIABLE SPEED FURNACE						
	CC5A/CD5AA060	56,000	TDR	—	12.5	—	11
	CC5A/CD5AW060	57,500	TDR	—	13	—	11.25
	CD5PX060	58,000	TDR&TXV	—	13	—	11.4
	CE3AA060	57,500	TDR	—	12.75	—	11.4
	CK3BA060	57,500	TDR	—	12.75	—	11.3
	CK5A/CK5BA060	57,500	TDR	—	12.75	—	11.3
	CK5A/CK5BT060	57,500	TDR	—	12.75	—	11.3
	CK5A/CK5BX060	58,500	TDR	—	13	—	11.55
	CK5PA060	57,500	TDR&TXV	—	13	—	11.3
	CK5PT060	57,500	TDR&TXV	—	13	—	11.3
	CK5PX060	58,500	TDR&TXV	—	13	—	11.55
	CD5PX060	58,000	PURON-TXV	13	—	—	11.05
	COILS + 355MAV060100 VARIABLE SPEED FURNACE						
	CK3BA060	57,000	LLS & TDR	12.50	—	—	11.00
	CK5A/CK5BA060	57,000	LLS & TDR	12.50	—	—	11.00
	CK5A/CK5BX060	58,000	LLS & TDR	13.00	—	—	11.25
	COILS + 355MAV060120 VARIABLE SPEED FURNACE						
	CK3BA060	57,000	LLS & TDR	12.75	—	—	11.05
	CK5A/CK5BA060	57,000	LLS & TDR	12.75	—	—	11.05
	CK5A/CK5BX060	58,000	LLS & TDR	13.00	—	—	11.30

* Tested combination.

† In most cases, only one method should be used to achieve TDR function. Using more than one method in a system may cause degradation in performance. Use either the accessory Time-Delay Relay KAATD0101TDR or a furnace equipped with TDR. Most Bryant furnaces are equipped with TDR.

‡ Based on computer simulation. TXV must be Puron® compatible and hard shutoff type.

** Ratings shown are with FK4C R-22 TXV replaced with Puron® TXV.

†† Ratings shown are with FK4C R-22 TXV replaced with Piston Body Kit and piston shipped with outdoor unit.

EER — Energy Efficiency Ratio

LLS — Liquid-Line Solenoid Valve

SEER — Seasonal Energy Efficiency Ratio

TDR — Time-Delay Relay

TXV — Thermostatic Expansion Valve

NOTES: 1. Ratings are net values reflecting the effects of circulating fan motor heat. Supplemental electric heat is not included.

2. Tested outdoor/indoor combinations have been tested in accordance with DOE test procedures for electric air conditioners. Ratings for other combinations are determined under DOE computer simulation procedures.

3. Determine actual CFM values obtainable for your system by referring to fan performance data in fan coil or furnace coil literature.

4. Do not apply with capillary tube coils as performance and reliability are significantly affected.

DETAILED COOLING CAPACITIES*

EVAP AIR		CONDENSER ENTERING AIR TEMPERATURES °F																	
		75			85			95			105			115			125		
CFM	EWB	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
550A024-E, F Outdoor Section With CC5A/CD5AA030 Indoor Section																			
650	72	27.3	12.9	1.47	26.5	12.6	1.64	25.5	12.3	1.83	24.4	11.8	2.03	23.1	11.4	2.26	21.6	10.8	2.50
	67	25.7	16.3	1.47	24.7	16.0	1.63	23.6	15.4	1.82	22.3	14.9	2.02	21.0	14.4	2.23	18.8	13.5	2.46
	63††	22.9	15.5	1.45	21.4	14.8	1.61	20.0	14.2	1.79	18.7	13.6	1.98	17.3	13.0	2.19	15.7	12.3	2.42
	62	22.2	18.8	1.45	20.7	18.0	1.61	19.2	17.3	1.78	17.7	16.6	1.97	16.3	15.9	2.18	15.0	15.0	2.41
	57	20.0	20.0	1.44	18.9	18.9	1.59	17.6	17.6	1.77	17.0	17.0	1.96	16.2	16.2	2.18	15.3	15.3	2.41
750	72	27.7	13.3	1.50	26.9	13.0	1.67	25.9	12.7	1.86	24.8	12.3	2.06	23.4	11.8	2.28	22.0	11.3	2.53
	67	26.1	17.0	1.49	25.2	16.8	1.66	24.0	16.2	1.85	22.8	15.8	2.05	21.5	15.3	2.27	19.1	14.4	2.50
	63††	24.5	16.9	1.49	23.0	16.2	1.65	21.6	15.6	1.83	20.2	15.0	2.03	18.8	14.3	2.24	17.2	13.7	2.47
	62	23.2	20.3	1.48	21.7	19.6	1.64	20.1	18.8	1.82	18.8	18.1	2.01	17.4	17.3	2.22	16.3	16.3	2.46
	57	21.1	21.1	1.47	20.0	20.0	1.63	19.4	19.4	1.81	18.6	18.6	2.01	17.8	17.8	2.23	16.8	16.8	2.46
850	72	27.8	13.5	1.53	27.1	13.3	1.70	26.3	13.1	1.89	25.2	12.8	2.09	23.7	12.3	2.32	22.2	11.8	2.56
	67	26.6	17.8	1.53	25.4	17.3	1.69	24.3	17.0	1.88	23.2	16.7	2.08	21.8	16.2	2.30	20.0	15.5	2.54
	63††	25.2	17.8	1.52	24.0	17.3	1.69	22.8	16.8	1.87	21.6	16.3	2.07	19.9	15.6	2.28	17.6	14.6	2.51
	62	24.3	21.9	1.52	22.5	21.0	1.68	21.1	20.2	1.85	19.7	19.5	2.05	18.4	18.4	2.27	17.5	17.5	2.51
	57	22.7	22.7	1.51	21.6	21.6	1.67	20.9	20.9	1.85	20.0	20.0	2.05	19.2	19.2	2.27	17.5	17.5	2.51
Multipliers for Determining the Performance With Other Indoor Sections																			
Indoor Section		Size	Cooling		Indoor Section	Size	Cooling												
			Capacity	Power			Capacity	Power											
CC5A/CD5AA		024	1.00 1.00		CK5PA		024	1.00 0.93											
		030	1.00 1.00				030	1.00 0.92											
CC5A/CD5AW		024	1.00 1.00		CK5PW		024	1.00 0.93											
		030	1.00 1.00				030	1.00 0.92											
CE3AA		024	1.00 1.00		COILS + 355MAV042040 VARIABLE SPEED FURNACE														
		030	1.00 1.00		CC5A/CD5AA		024	1.00 0.95											
CF5AA		024	1.00 1.00				030	1.00 0.94											
		CK3BA		024	1.00 1.00		CC5A/CD5AW		024	1.00 0.95									
030	1.00 1.00			030	1.00 0.94														
CK5A/CK5BA		024	1.00 1.00		CE3AA		024	1.00 0.96											
		030	1.00 1.00				030	1.00 0.95											
CK5A/CK5BW		024	1.00 1.00		CK3BA		024	1.00 0.95											
		030	1.00 1.00				030	1.00 0.95											
F(A,B)4(A,B)NF		024	1.00 1.00		CK5A/CK5BW		030	1.00 0.95											
		030	1.00 1.00				COILS + 355MAV042060 VARIABLE SPEED FURNACE												
FF1DNA		024	1.00 1.00		CC5A/CD5AA		024	1.00 0.96											
		030	1.00 1.00				030	1.00 0.95											
FG3AAA		024	1.00 1.00		CC5A/CD5AW		024	1.00 0.96											
		FK4(C,D)NF		002††			1.08 0.96		CE3AA		030	1.00 0.95							
003††	1.17 0.95			024	1.00 0.96														
003***	1.08 0.92			030	1.00 0.95														
FV4(A,B)NF		002	1.08 0.96		CK3BA		024	1.00 0.95											
		003	1.08 0.95				030	1.00 0.95											
FX4(A,B)NF		030	1.00 1.03		CK5A/CK5BW		024	1.00 0.95											
		COILS + 315(A,J)AV036070 VARIABLE SPEED FURNACE					030	1.00 0.95											
CC5A/CD5AA		024	1.00 0.94		COILS + 355MAV042080 VARIABLE SPEED FURNACE														
		030	1.00 0.92		CC5A/CD5AA		024	1.00 0.95											
CC5A/CD5AW		024	1.00 0.94				030	1.00 0.94											
		030	1.00 0.92		CC5A/CD5AW		024	1.00 0.95											
CE3AA		024	1.00 0.93				030	1.00 0.94											
		030	1.00 0.92		CE3AA		024	1.00 0.95											
CK3BA		024	1.00 0.92				030	1.00 0.94											
		030	1.00 0.91		CK3BA		024	1.00 0.94											
CK5A/CK5BA		024	1.00 0.92				030	1.00 0.94											
		030	1.00 0.91		CK5A/CK5BW		024	1.00 0.94											
CK5A/CK5BW		024	1.00 0.92				030	1.00 0.94											
		030	1.00 0.91		—		—												

See notes on page 26.

DETAILED COOLING CAPACITIES* Continued

EVAP AIR		CONDENSER ENTERING AIR TEMPERATURES °F																	
		75			85			95			105			115			125		
CFM	EWB	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
550A030-E, F Outdoor Section With CC5A/CD5AA036 Indoor Section																			
875	72	33.4	16.3	1.80	32.2	15.9	1.99	31.1	15.6	2.21	29.7	15.2	2.46	27.9	14.5	2.73	26.0	13.9	3.05
	67	31.4	21.2	1.79	30.0	20.7	1.97	28.6	20.1	2.19	27.0	19.6	2.43	24.5	18.6	2.69	21.7	17.5	2.97
	63††	29.4	20.9	1.77	27.8	20.2	1.96	25.1	19.0	2.15	22.3	17.8	2.37	20.4	17.0	2.63	18.2	16.1	2.91
	62	28.6	25.7	1.77	26.6	24.7	1.95	24.5	23.6	2.15	22.3	22.3	2.37	20.5	20.5	2.63	19.4	19.4	2.93
	57	26.6	26.6	1.75	25.1	25.1	1.93	23.6	23.6	2.14	21.9	21.9	2.37	20.8	20.8	2.63	19.6	19.6	2.93
1000	72	33.9	16.9	1.85	32.7	16.5	2.04	31.6	16.3	2.26	30.0	15.8	2.50	28.2	15.2	2.78	26.3	14.7	3.10
	67	31.9	22.3	1.83	30.5	21.8	2.02	29.0	21.3	2.23	27.4	20.8	2.47	25.2	20.0	2.74	22.3	18.9	3.02
	63††	30.0	22.1	1.82	28.5	21.5	2.00	25.8	20.3	2.20	23.1	19.2	2.42	21.1	18.3	2.68	18.9	17.4	2.96
	62	29.4	27.5	1.81	27.2	26.4	1.99	25.1	25.1	2.19	23.3	23.3	2.43	22.3	22.3	2.69	20.3	20.3	2.99
	57	27.9	27.9	1.80	26.4	26.4	1.99	24.7	24.7	2.19	23.7	23.7	2.43	22.6	22.6	2.70	20.4	20.4	2.99
1125	72	34.2	17.4	1.89	33.0	17.1	2.08	31.7	16.7	2.30	30.1	16.3	2.54	28.5	15.9	2.82	26.5	15.4	3.15
	67	32.2	23.3	1.87	30.8	22.9	2.06	29.3	22.4	2.27	27.7	22.0	2.51	25.7	21.3	2.78	22.7	20.2	3.07
	63††	30.3	23.1	1.86	29.0	22.7	2.05	26.3	21.6	2.25	24.1	20.6	2.47	21.8	19.6	2.73	19.6	18.7	3.01
	62	29.9	29.0	1.86	28.1	27.9	2.04	26.6	26.6	2.25	25.1	25.1	2.49	23.8	23.8	2.75	21.2	21.2	3.04
	57	29.5	29.5	1.85	28.2	28.2	2.04	26.6	26.6	2.25	25.3	25.3	2.49	23.5	23.5	2.75	21.1	21.1	3.04
Multipliers for Determining the Performance With Other Indoor Sections																			
Indoor Section		Size	Cooling		Indoor Section		Size	Cooling											
			Capacity	Power				Capacity	Power										
CC5A/CD5AA		030	0.97 0.99		CK5A/CK5BT		036	1.00 0.93											
		036	1.00 1.00				030	0.97 0.92											
CC5A/CD5AW		030	0.97 0.99		CK5PA		030	0.99 0.95											
CD5AW		036	1.00 1.00				036	1.00 0.93											
CE3AA		030	0.97 1.00		CK5PT		036	1.00 0.93											
		036	0.98 1.00				030	0.99 0.95											
CF5AA		036	0.98 1.00		COILS + 315(A,J)AV048090 VARIABLE SPEED FURNACE														
CK3BA		030	0.97 0.99		CC5A/CD5AA		030	0.97 0.92											
		036	1.00 0.99				036	1.00 0.92											
CK5A/CK5BA		030	0.97 0.99		CC5A/CD5AW		030	0.97 0.92											
		036	1.00 0.99				036	1.00 0.92											
CK5A/CK5BN		036	0.93 0.99		CE3AA		030	0.99 0.93											
CK5A/CK5BW		030	0.97 0.99				036	0.99 0.92											
		036	1.00 0.99		CK3BA		030	0.97 0.91											
F(A,B)4(A,B)NF		030	0.99 0.99				036	1.00 0.92											
		036	1.00 1.01		CK5A/CK5BA		030	0.97 0.91											
FF1DNA		030	0.99 1.00				036	1.00 0.92											
FG3AAA		036	0.98 1.00		CK5A/CK5BW		030	0.99 0.93											
FK4(C,D)NF		001‡‡	1.00 0.94				036	1.00 0.92											
		001***	0.99 0.92		CK5PA		030	0.99 0.94											
		002‡‡	1.00 0.94				036	1.00 0.92											
		003‡‡	1.02 0.92		CK5PT		036	1.00 0.92											
		003***	1.00 0.90				CK5PW		030	0.99 0.94									
FV4(A,B)NF		002	1.00 0.94		036	1.00 0.92													
		003	1.02 0.92		COILS + 355MAV042040 VARIABLE SPEED FURNACE														
FX4(A,B)NF		030	0.99 0.99		CC5A/CD5AA		030	0.98 0.95											
		036	1.00 1.02				036	1.02 0.95											
COILS + 315(A,J)AV036070 VARIABLE SPEED FURNACE					CC5A/CD5AW		030	0.98 0.95											
CC5A/CD5AA		030	0.97 0.93				036	1.02 0.95											
		036	1.00 0.93		CE3AA		030	1.00 0.95											
CC5A/CD5AW		030	0.97 0.93				036	1.01 0.95											
CE3AA		030	0.98 0.93		CK3BA		030	0.98 0.95											
		036	0.99 0.93				036	1.02 0.95											
CK3BA		030	0.97 0.92		CK5A/CK5BW		030	0.98 0.95											
		036	1.00 0.93				036	1.02 0.95											
CK5A/CK5BA		030	0.97 0.92																
		036	1.00 0.93																

DETAILED COOLING CAPACITIES* Continued

EVAP AIR		CONDENSER ENTERING AIR TEMPERATURES °F																	
		75			85			95			105			115			125		
CFM	EWB	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
550A030-E, F Outdoor Section With CC5A/CD5AA036 Indoor Section Continued																			
875	72	33.4	16.3	1.80	32.2	15.9	1.99	31.1	15.6	2.21	29.7	15.2	2.46	27.9	14.5	2.73	26.0	13.9	3.05
	67	31.4	21.2	1.79	30.0	20.7	1.97	28.6	20.1	2.19	27.0	19.6	2.43	24.5	18.6	2.69	21.7	17.5	2.97
	63††	29.4	20.9	1.77	27.8	20.2	1.96	25.1	19.0	2.15	22.3	17.8	2.37	20.4	17.0	2.63	18.2	16.1	2.91
	62	28.6	25.7	1.77	26.6	24.7	1.95	24.5	23.6	2.15	22.3	22.3	2.37	20.5	20.5	2.63	19.4	19.4	2.93
	57	26.6	26.6	1.75	25.1	25.1	1.93	23.6	23.6	2.14	21.9	21.9	2.37	20.8	20.8	2.63	19.6	19.6	2.93
1000	72	33.9	16.9	1.85	32.7	16.5	2.04	31.6	16.3	2.26	30.0	15.8	2.50	28.2	15.2	2.78	26.3	14.7	3.10
	67	31.9	22.3	1.83	30.5	21.8	2.02	29.0	21.3	2.23	27.4	20.8	2.47	25.2	20.0	2.74	22.3	18.9	3.02
	63††	30.0	22.1	1.82	28.5	21.5	2.00	25.8	20.3	2.20	23.1	19.2	2.42	21.1	18.3	2.68	18.9	17.4	2.96
	62	29.4	27.5	1.81	27.2	26.4	1.99	25.1	25.1	2.19	23.3	23.3	2.43	22.3	22.3	2.69	20.3	20.3	2.99
	57	27.9	27.9	1.80	26.4	26.4	1.99	24.7	24.7	2.19	23.7	23.7	2.43	22.6	22.6	2.70	20.4	20.4	2.99
1125	72	34.2	17.4	1.89	33.0	17.1	2.08	31.7	16.7	2.30	30.1	16.3	2.54	28.5	15.9	2.82	26.5	15.4	3.15
	67	32.2	23.3	1.87	30.8	22.9	2.06	29.3	22.4	2.27	27.7	22.0	2.51	25.7	21.3	2.78	22.7	20.2	3.07
	63††	30.3	23.1	1.86	29.0	22.7	2.05	26.3	21.6	2.25	24.1	20.6	2.47	21.8	19.6	2.73	19.6	18.7	3.01
	62	29.9	29.0	1.86	28.1	27.9	2.04	26.6	26.6	2.25	25.1	25.1	2.49	23.8	23.8	2.75	21.2	21.2	3.04
	57	29.5	29.5	1.85	28.2	28.2	2.04	26.6	26.6	2.25	25.3	25.3	2.49	23.5	23.5	2.75	21.1	21.1	3.04
Multipliers for Determining the Performance With Other Indoor Sections																			
Indoor Section		Size	Cooling		Indoor Section		Size	Cooling											
			Capacity	Power				Capacity	Power										
COILS + 355MAV042060 VARIABLE SPEED FURNACE					COILS + 355MAV042080 VARIABLE SPEED FURNACE														
CC5A/CD5AA		030	0.98		CC5A/CD5AA		030	0.99		0.94									
		036	1.02				036	1.02		0.94									
CC5A/CD5AW		030	0.98		CC5A/CD5AW		030	0.99		0.94									
		036	1.02				036	1.02		0.94									
CE3AA		030	1.00		CE3AA		030	1.00		0.94									
		036	1.01				036	1.01		0.94									
CK3BA		030	0.98		CK3BA		030	0.99		0.95									
		036	1.02				036	1.02		0.94									
CK5A/CK5BA		036	1.02		CK5A/CK5BW		030	0.99		0.95									
CK5A/CK5BW		030	0.98				036	1.02		0.94									

See notes on page 26.

DETAILED COOLING CAPACITIES* Continued

EVAP AIR		CONDENSER ENTERING AIR TEMPERATURES °F																							
		75				85				95				105				115				125			
CFM	EWB	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**			
		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†	
550A036-E, F Outdoor Section With CC5A/CD5AA042 Indoor Section																									
1050	72	40.4	19.6	2.15	39.0	19.2	2.40	37.4	18.6	2.66	35.6	18.0	2.96	33.4	17.3	3.28	30.9	16.4	3.64						
	67	38.0	25.3	2.14	36.4	24.8	2.38	34.6	24.1	2.65	32.5	23.3	2.94	30.4	22.4	3.24	26.5	20.9	3.57						
	63††	34.9	24.6	2.12	32.5	23.6	2.35	30.1	22.5	2.60	27.5	21.4	2.87	24.9	20.3	3.17	22.3	19.2	3.50						
	62	33.9	30.2	2.12	31.6	29.1	2.34	29.2	27.9	2.59	26.7	26.5	2.86	24.5	24.5	3.17	23.2	23.2	3.51						
	57	31.3	31.3	2.09	29.5	29.5	2.32	27.5	27.5	2.57	26.4	26.4	2.86	25.1	25.1	3.17	23.6	23.6	3.51						
1200	72	41.0	20.3	2.20	39.7	19.9	2.45	38.1	19.4	2.72	36.2	18.9	3.02	33.9	18.1	3.34	31.4	17.3	3.70						
	67	38.5	26.5	2.19	37.0	26.1	2.43	35.0	25.3	2.69	33.1	24.7	2.99	30.9	23.9	3.30	26.9	22.4	3.62						
	63††	36.1	26.3	2.18	33.6	25.2	2.41	31.1	24.1	2.66	28.3	23.0	2.93	26.0	22.0	3.24	23.3	20.9	3.56						
	62	34.8	32.4	2.17	32.4	31.2	2.39	30.0	29.7	2.65	27.9	27.9	2.93	26.8	26.8	3.25	24.6	24.6	3.58						
	57	32.7	32.7	2.15	31.0	31.0	2.38	29.9	29.9	2.64	28.7	28.7	2.94	27.3	27.3	3.25	24.8	24.8	3.58						
1350	72	41.4	20.9	2.25	40.2	20.6	2.50	38.2	19.9	2.76	36.4	19.4	3.06	34.2	18.8	3.38	31.7	18.2	3.75						
	67	39.0	27.8	2.24	37.4	27.3	2.48	35.5	26.7	2.74	33.5	26.1	3.03	31.2	25.4	3.35	27.2	23.8	3.68						
	63††	36.9	27.8	2.23	34.5	26.8	2.46	31.9	25.7	2.71	29.4	24.6	2.99	26.9	23.6	3.30	24.2	22.4	3.62						
	62	35.8	34.5	2.22	33.2	32.9	2.45	31.1	31.1	2.70	30.0	30.0	3.00	28.6	28.6	3.32	25.8	25.8	3.65						
	57	34.8	34.8	2.22	33.3	33.3	2.45	32.0	32.0	2.72	30.7	30.7	3.01	28.3	28.3	3.32	25.9	25.9	3.65						
Multipliers for Determining the Performance With Other Indoor Sections																									
Indoor Section		Size	Cooling		Indoor Section		Size	Cooling																	
			Capacity	Power				Capacity	Power																
CC5A/CD5AA		036	1.00		CE3AA		036	1.00																	
		042	1.00				042	1.00																	
CC5A/CD5AW		042	1.00		CK3BA		036	1.00																	
CD5AW		036	1.00				042	1.00																	
CE3AA		036	1.00		CK5A/CK5BA		036	1.00																	
		042	1.00				042	1.00																	
CF5AA		036	1.00		CK5A/CK5BE		042	1.00																	
CK3BA		036	1.00		CK5A/CK5BT		036	1.00																	
		042	1.00				042	1.00																	
CK5A/CK5BA		036	1.00		CK5A/CK5BW		036	1.00																	
		042	1.00				036	1.00																	
CK5A/CK5BN		042	0.97		CK5PA		036	1.00																	
CK5A/CK5BW		036	1.00				042	1.00																	
F(A,B)4(A,B)NF		036	1.00		CK5PE		042	1.00																	
F(A,B)4(A,B)N(F,B)		036	1.00				042	1.00																	
FG3AAA		036	1.00		CK5PT		036	1.00																	
FK4(C,D)NF		002††	1.00				036	1.00																	
FV4(A,B)NF		002††	1.00		COILS + 315(A,J)AV066110 VARIABLE SPEED FURNACE																				
		003††	1.00		CC5A/CD5AA		036	1.00																	
		005††	1.03				042	1.00																	
		005***	1.00		036	1.00																			
FX4(A,B)NF		002	1.00		CC5A/CD5AW		042	1.00																	
		003	1.00				036	1.00																	
		005	1.03				042	1.00																	
FX4(A,B)NF		036	0.97		CK3BA		036	1.00																	
		042	1.00				042	1.00																	
COILS + 315(A,J)AV036070 VARIABLE SPEED FURNACE					CK5A/CK5BA		036	1.00																	
CC5A/CD5AA		036	1.00				042	1.00																	
CE3AA		036	1.00		CK5A/CK5BT		036	1.00																	
		042	1.00				042	1.00																	
CK3BA		036	1.00		CK5A/CK5BW		036	1.00																	
CK5A/CK5BA		036	1.00		CK5PA		036	1.00																	
CK5A/CK5BE		042	1.00				042	1.00																	
CK5A/CK5BT		036	1.00		CK5PT		036	1.00																	
CK5PA		036	1.00				042	1.00																	
CK5PE		042	1.00		CK5PW		036	1.00																	
CK5PT		036	1.00		COILS + 315(A,J)AV066135 VARIABLE SPEED FURNACE																				
COILS + 315(A,J)AV048090 VARIABLE SPEED FURNACE					CC5A/CD5AA		042	1.00																	
CC5A/CD5AA		036	1.00		CC5A/CD5AW		036	1.00																	
		042	1.00				042	1.00																	
CC5A/CD5AW		036	1.00				—	—																	

See notes on page 26.

DETAILED COOLING CAPACITIES* Continued

EVAP AIR		CONDENSER ENTERING AIR TEMPERATURES °F																	
		75			85			95			105			115			125		
CFM	EWB	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
550A036-E, F Outdoor Section With CC5A/CD5AA042 Indoor Section continued																			
1050	72	40.4	19.6	2.15	39.0	19.2	2.40	37.4	18.6	2.66	35.6	18.0	2.96	33.4	17.3	3.28	30.9	16.4	3.64
	67	38.0	25.3	2.14	36.4	24.8	2.38	34.6	24.1	2.65	32.5	23.3	2.94	30.4	22.4	3.24	26.5	20.9	3.57
	63††	34.9	24.6	2.12	32.5	23.6	2.35	30.1	22.5	2.60	27.5	21.4	2.87	24.9	20.3	3.17	22.3	19.2	3.50
	62	33.9	30.2	2.12	31.6	29.1	2.34	29.2	27.9	2.59	26.7	26.5	2.86	24.5	24.5	3.17	23.2	23.2	3.51
	57	31.3	31.3	2.09	29.5	29.5	2.32	27.5	27.5	2.57	26.4	26.4	2.86	25.1	25.1	3.17	23.6	23.6	3.51
1200	72	41.0	20.3	2.20	39.7	19.9	2.45	38.1	19.4	2.72	36.2	18.9	3.02	33.9	18.1	3.34	31.4	17.3	3.70
	67	38.5	26.5	2.19	37.0	26.1	2.43	35.0	25.3	2.69	33.1	24.7	2.99	30.9	23.9	3.30	26.9	22.4	3.62
	63††	36.1	26.3	2.18	33.6	25.2	2.41	31.1	24.1	2.66	28.3	23.0	2.93	26.0	22.0	3.24	23.3	20.9	3.56
	62	34.8	32.4	2.17	32.4	31.2	2.39	30.0	29.7	2.65	27.9	27.9	2.93	26.8	26.8	3.25	24.6	24.6	3.58
	57	32.7	32.7	2.15	31.0	31.0	2.38	29.9	29.9	2.64	28.7	28.7	2.94	27.3	27.3	3.25	24.8	24.8	3.58
1350	72	41.4	20.9	2.25	40.2	20.6	2.50	38.2	19.9	2.76	36.4	19.4	3.06	34.2	18.8	3.38	31.7	18.2	3.75
	67	39.0	27.8	2.24	37.4	27.3	2.48	35.5	26.7	2.74	33.5	26.1	3.03	31.2	25.4	3.35	27.2	23.8	3.68
	63††	36.9	27.8	2.23	34.5	26.8	2.46	31.9	25.7	2.71	29.4	24.6	2.99	26.9	23.6	3.30	24.2	22.4	3.62
	62	35.8	34.5	2.22	33.2	32.9	2.45	31.1	31.1	2.70	30.0	30.0	3.00	28.6	28.6	3.32	25.8	25.8	3.65
	57	34.8	34.8	2.22	33.3	33.3	2.45	32.0	32.0	2.72	30.7	30.7	3.01	28.3	28.3	3.32	25.9	25.9	3.65
Multipliers for Determining the Performance With Other Indoor Sections																			
Indoor Section		Size	Cooling		Indoor Section		Size	Cooling											
			Capacity	Power				Capacity	Power										
CE3AA		036	1.00		0.94		COILS + 355MAV042080 VARIABLE SPEED FURNACE												
		042	1.00		0.92		CC5A/CD5AA		036	1.00		0.97							
CK3BA		042	1.00		0.92				042	1.00		0.96							
CK5A/CK5BA		042	1.00		0.92		CC5A/CD5AW		042	1.00		0.96							
CK5A/CK5BT		042	1.00		0.92		CD5AW		036	1.00		0.97							
CK5A/CK5BW		036	1.00		0.93		CE3AA		036	1.00		0.97							
CK5PA		042	1.00		0.92				042	1.00		0.96							
CK5PT		042	1.00		0.92		CK3BA		036	1.00		0.97							
CK5PW		036	1.00		0.93				042	1.00		0.96							
COILS + 315(A,J)AV066155 VARIABLE SPEED FURNACE							CK5A/CK5BA		042	1.00		0.96							
CC5A/CD5AA		042	1.00		0.91		CK5A/CK5BW		036	1.00		0.97							
CC5A/CD5AW		036	1.00		0.93		COILS + 355MAV060080 VARIABLE SPEED FURNACE												
		042	1.00		0.92		CC5A/CD5AA		036	1.00		0.96							
CE3AA		036	1.00		0.93				042	1.00		0.95							
		042	1.00		0.91		CC5A/CD5AW		042	1.00		0.95							
CK3BA		042	1.00		0.91		CD5AW		036	1.00		0.96							
CK5A/CK5BA		042	1.00		0.91		CE3AA		036	1.00		0.96							
CK5A/CK5BT		042	1.00		0.91				042	1.00		0.96							
CK5A/CK5BW		036	1.00		0.92		CK3BA		036	1.00		0.98							
CK5PA		042	1.00		0.91				042	1.00		0.97							
CK5PT		042	1.00		0.91		CK5A/CK5BA		042	1.00		0.97							
CK5PW		036	1.00		0.92		CK5A/CK5BW		036	1.00		0.98							
COILS + 355MAV042040 VARIABLE SPEED FURNACE							COILS + 355MAV060100 VARIABLE SPEED FURNACE												
CC5A/CD5AA		036	1.00		0.98		CC5A/CD5AA		036	1.00		0.96							
		042	1.00		0.97				042	1.00		0.95							
CC5A/CD5AW		042	1.00		0.97		CC5A/CD5AW		042	1.00		0.95							
CE3AA		036	1.00		0.98		CD5AW		036	1.00		0.96							
		042	1.00		0.98		CE3AA		036	1.00		0.96							
CK3BA		036	1.00		0.98				042	1.00		0.96							
		42	1.00		0.98		CK3BA		036	1.00		0.96							
CK5A/CK5BA		042	1.00		0.98				042	1.00		0.95							
CK5A/CK5BW		036	1.00		0.98		CK5A/CK5BA		042	1.00		0.95							
COILS + 355MAV042060 VARIABLE SPEED FURNACE							CK5A/CK5BW		036	1.00		0.96							
CC5A/CD5AA		036	1.00		0.98		COILS + 355MAV060120 VARIABLE SPEED FURNACE												
		042	1.00		0.97		CC5A/CD5AA		036	1.00		0.96							
CC5A/CD5AW		042	1.00		0.97				042	1.00		0.95							
CD5AW		036	1.00		0.98		CC5A/CD5AW		042	1.00		0.95							
CE3AA		036	1.00		0.98		CD5AW		036	1.00		0.96							
		042	1.00		0.98		CE3AA		036	1.00		0.96							
CK3BA		036	1.00		0.98				042	1.00		0.96							
		042	1.00		0.97		CK3BA		036	1.00		0.96							
CK5A/CK5BA		036	1.00		0.98				042	1.00		0.95							
CK5A/CK5BN		042	0.97		0.98		CK5A/CK5BA		042	1.00		0.95							
		—	—		—		CK5A/CK5BW		036	1.00		0.96							

See notes on page 26.

DETAILED COOLING CAPACITIES* Continued

EVAP AIR		CONDENSER ENTERING AIR TEMPERATURES °F																							
		75				85				95				105				115				125			
CFM	EWB	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**			
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡				
550A042-E, F Outdoor Section With CD5AA048 Indoor Section																									
1225	72	46.7	22.7	2.49	45.2	22.3	2.77	43.3	21.6	3.09	41.2	20.9	3.44	38.8	20.1	3.83	36.0	19.2	4.26						
	67	44.0	29.5	2.47	42.3	28.9	2.75	39.8	27.8	3.05	37.7	27.1	3.40	35.4	26.3	3.79	31.4	24.7	4.18						
	63††	40.5	28.7	2.44	37.8	27.5	2.70	35.0	26.3	3.00	32.0	25.0	3.32	30.2	24.3	3.70	27.8	23.3	4.11						
	62	39.3	35.4	2.43	36.7	34.1	2.69	33.9	32.7	2.98	31.1	30.9	3.31	29.5	29.5	3.69	27.9	27.9	4.11						
	57	36.4	36.4	2.40	34.3	34.3	2.67	32.1	32.1	2.96	30.8	30.8	3.30	29.4	29.4	3.69	27.7	27.7	4.11						
1400	72	47.1	23.3	2.55	45.8	23.0	2.83	43.9	22.5	3.15	41.8	21.8	3.51	39.3	21.1	3.90	36.5	20.2	4.33						
	67	44.3	30.5	2.52	42.7	30.2	2.81	40.5	29.4	3.12	38.4	28.8	3.47	35.9	27.9	3.85	31.7	26.4	4.25						
	63††	42.1	30.7	2.51	39.3	29.5	2.78	36.4	28.3	3.07	33.6	27.1	3.40	31.8	26.3	3.79	27.9	24.7	4.18						
	62	40.5	37.9	2.50	37.8	36.5	2.76	35.0	34.8	3.06	32.7	32.7	3.39	31.2	31.2	3.78	29.5	29.5	4.21						
	57	38.1	38.1	2.48	36.2	36.2	2.74	35.0	35.0	3.05	33.6	33.6	3.40	32.2	32.2	3.79	29.3	29.3	4.20						
1575	72	47.5	23.9	2.61	46.2	23.7	2.90	44.4	23.2	3.22	41.8	22.4	3.56	39.5	21.8	3.95	36.8	21.1	4.40						
	67	44.9	31.9	2.58	43.0	31.5	2.86	41.1	31.1	3.18	38.8	30.3	3.53	36.3	29.6	3.92	32.0	28.0	4.32						
	63††	42.5	32.0	2.57	40.5	31.4	2.85	37.6	30.1	3.15	35.0	29.1	3.48	33.1	28.3	3.87	27.9	26.0	4.24						
	62	41.6	40.2	2.57	38.9	38.5	2.83	36.5	36.5	3.13	35.4	35.4	3.49	32.7	32.7	3.86	30.7	30.7	4.29						
	57	40.7	40.7	2.56	39.0	39.0	2.83	37.6	37.6	3.15	35.8	35.8	3.49	33.5	33.5	3.87	30.7	30.7	4.29						
Multipliers for Determining the Performance With Other Indoor Sections																									
Indoor Section		Size	Cooling		Indoor Section	Size	Cooling																		
			Capacity	Power			Capacity	Power																	
CD5AA		048	1.00	1.00	CK5PT		042	1.00	0.94																
CC5A/CD5AA		042	1.00	1.00			048	1.00	0.93																
CC5A/CD5AC		048	0.99	1.00	COILS + 315(A,J)AV066110 VARIABLE SPEED FURNACE																				
CC5A/CD5AW		042	0.99	1.00	CC5A/CD5AA		042	1.00	0.94																
		048	1.00	1.00	CC5A/CD5AC		048	0.99	0.92																
CE3AA		042	1.01	1.00	CC5A/CD5AW		042	0.99	0.93																
		048	1.01	1.00			048	1.00	0.92																
CF5AA		048	1.00	1.00	CD5AA		048	1.00	0.92																
CK3BA		042	1.00	1.00	CE3AA		042	1.00	0.93																
		048	1.00	1.00			048	1.01	0.94																
CK5A/CK5BA		042	1.00	1.00	CK3BA		042	1.00	0.93																
		048	1.00	1.00			048	1.00	0.92																
CK5A/CK5BN		042	0.98	1.00	CK5A/CK5BA		042	1.00	0.93																
		048	0.98	1.00			048	1.00	0.92																
CK5A/CK5BW		048	1.00	1.00	CK5A/CK5BT		042	1.00	0.93																
F(A,B)4(A,B)N(F,B)		042	1.00	1.00			048	1.00	0.92																
		048	1.01	1.00	CK5A/CK5BW		048	1.00	0.92																
FG3AAA		048	0.99	1.00	CK5PA		042	1.00	0.93																
FK4(C,D)NB		006††	1.02	0.90			048	1.00	0.92																
		006***	1.01	0.92	CK5PT		042	1.00	0.93																
FK4(C,D)NF		003††	0.98	0.92			048	1.00	0.92																
		005††	1.01	0.91	CK5PW		048	1.00	0.92																
FV4(A,B)NB		006	1.02	0.90	COILS + 315(A,J)AV066135 VARIABLE SPEED FURNACE																				
FV4(A,B)NF		003	0.98	0.92	CC5A/CD5AA		042	1.00	0.94																
		005	1.01	0.91	CC5A/CD5AC		048	0.99	0.92																
FX4(A,B)NF		042	0.99	1.00	CC5A/CD5AW		042	0.99	0.93																
		048	1.00	1.01			048	1.00	0.92																
COILS + 315(A,J)AV048090 VARIABLE SPEED FURNACE					CD5AA		048	1.00	0.92																
CC5A/CD5AA		042	0.99	0.93	CE3AA		042	1.00	0.93																
CC5A/CD5AC		048	0.99	0.93			048	1.01	0.94																
CD5AA		048	1.00	0.93	CK3BA		042	1.00	0.93																
CE3AA		042	1.00	0.94			048	1.00	0.92																
		048	1.01	0.95	CK5A/CK5BA		042	1.00	0.93																
CK3BA		042	1.00	0.94			048	1.00	0.92																
		048	1.00	0.93	CK5A/CK5BT		042	1.00	0.93																
CK5A/CK5BA		042	0.99	0.93			048	1.00	0.92																
		048	1.00	0.93	CK5A/CK5BW		048	1.00	0.92																
CK5A/CK5BE		042	1.00	0.94	CK5PA		042	1.00	0.93																
CK5A/CK5BT		042	1.00	0.94			048	1.00	0.92																
		048	1.00	0.93	CK5PT		042	1.00	0.93																
CK5PA		042	1.00	0.94			048	1.00	0.92																
		048	1.00	0.93	CK5PW		048	1.00	0.92																
CK5PE		042	1.00	0.94			—	—	—																

See notes on page 26.

DETAILED COOLING CAPACITIES* Continued

EVAP AIR		CONDENSER ENTERING AIR TEMPERATURES °F																							
		75				85				95				105				115				125			
CFM	EWB	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**			
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
550A042-E, F Outdoor Section With CD5AA048 Indoor Section Continued																									
1225	72	46.7	22.7	2.49	45.2	22.3	2.77	43.3	21.6	3.09	41.2	20.9	3.44	38.8	20.1	3.83	36.0	19.2	4.26						
	67	44.0	29.5	2.47	42.3	28.9	2.75	39.8	27.8	3.05	37.7	27.1	3.40	35.4	26.3	3.79	31.4	24.7	4.18						
	63††	40.5	28.7	2.44	37.8	27.5	2.70	35.0	26.3	3.00	32.0	25.0	3.32	30.2	24.3	3.70	27.8	23.3	4.11						
	62	39.3	35.4	2.43	36.7	34.1	2.69	33.9	32.7	2.98	31.1	30.9	3.31	29.5	29.5	3.69	27.9	27.9	4.11						
	57	36.4	36.4	2.40	34.3	34.3	2.67	32.1	32.1	2.96	30.8	30.8	3.30	29.4	29.4	3.69	27.7	27.7	4.11						
1400	72	47.1	23.3	2.55	45.8	23.0	2.83	43.9	22.5	3.15	41.8	21.8	3.51	39.3	21.1	3.90	36.5	20.2	4.33						
	67	44.3	30.5	2.52	42.7	30.2	2.81	40.5	29.4	3.12	38.4	28.8	3.47	35.9	27.9	3.85	31.7	26.4	4.25						
	63††	42.1	30.7	2.51	39.3	29.5	2.78	36.4	28.3	3.07	33.6	27.1	3.40	31.8	26.3	3.79	27.9	24.7	4.18						
	62	40.5	37.9	2.50	37.8	36.5	2.76	35.0	34.8	3.06	32.7	32.7	3.39	31.2	31.2	3.78	29.5	29.5	4.21						
	57	38.1	38.1	2.48	36.2	36.2	2.74	35.0	35.0	3.05	33.6	33.6	3.40	32.2	32.2	3.79	29.3	29.3	4.20						
1575	72	47.5	23.9	2.61	46.2	23.7	2.90	44.4	23.2	3.22	41.8	22.4	3.56	39.5	21.8	3.95	36.8	21.1	4.40						
	67	44.9	31.9	2.58	43.0	31.5	2.86	41.1	31.1	3.18	38.8	30.3	3.53	36.3	29.6	3.92	32.0	28.0	4.32						
	63††	42.5	32.0	2.57	40.5	31.4	2.85	37.6	30.1	3.15	35.0	29.1	3.48	33.1	28.3	3.87	27.9	26.0	4.24						
	62	41.6	40.2	2.57	38.9	38.5	2.83	36.5	36.5	3.13	35.4	35.4	3.49	32.7	32.7	3.86	30.7	30.7	4.29						
	57	40.7	40.7	2.56	39.0	39.0	2.83	37.6	37.6	3.15	35.8	35.8	3.49	33.5	33.5	3.87	30.7	30.7	4.29						
Multipliers for Determining the Performance With Other Indoor Sections																									
Indoor Section		Size	Cooling		Indoor Section	Size	Cooling																		
			Capacity	Power			Capacity	Power																	
COILS + 315(A,J)AV066155 VARIABLE SPEED FURNACE																									
CC5A/CD5AA		042	1.00		0.93		CE3AA		042	1.01		0.98													
CC5A/CD5AC		048	0.99		0.92				048	1.01		0.99													
CC5A/CD5AW		042	0.99		0.93		CK3BA		042	1.00		0.99													
		048	1.00		0.92				048	1.00		0.98													
CD5AA		048	1.00		0.92		CK5A/CK5BA		042	1.00		0.99													
CE3AA		042	1.00		0.93				048	1.00		0.98													
		048	1.01		0.94		COILS + 355MAV060080 VARIABLE SPEED FURNACE																		
CK3BA		042	1.00		0.93		CC5A/CD5AA		042	1.00		0.98													
		048	1.00		0.92		CC5A/CD5AC		048	0.99		0.96													
CK5A/CK5BA		042	1.00		0.93		CC5A/CD5AW		042	0.99		0.98													
		048	1.00		0.92				048	1.00		0.96													
CK5A/CK5BT		042	1.00		0.93		CC5AA		048	1.00		0.96													
		048	1.00		0.92		CE3AA		042	1.01		0.98													
CK5A/CK5BW		048	1.00		0.92				048	1.01		0.98													
CK5PA		042	1.00		0.93		COILS + 355MAV060100 VARIABLE SPEED FURNACE																		
		048	1.00		0.92		CC5A/CD5AA		042	1.00		0.98													
CK5PT		042	1.00		0.93		CC5A/CD5AC		048	0.99		0.96													
		048	1.00		0.92		CC5A/CD5AW		042	0.99		0.98													
CK5PW		048	1.00		0.92				048	1.00		0.96													
COILS + 355MAV042040 VARIABLE SPEED FURNACE																									
CC5A/CD5AA		042	1.00		1.01		CE3AA		042	1.01		0.98													
CC5A/CD5AC		048	0.99		0.99				048	1.01		0.98													
CC5A/CD5AW		042	0.99		1.00		CK3BA		042	1.00		0.98													
		048	1.00		0.99				048	1.00		0.97													
CD5AA		048	1.00		0.99		CK5A/CK5BA		042	1.00		0.98													
CE3AA		042	0.99		1.01		CK5A/CK5BW		048	1.00		0.97													
		048	0.99		1.01		COILS + 355MAV060120 VARIABLE SPEED FURNACE																		
COILS + 355MAV042060 VARIABLE SPEED FURNACE																									
CC5A/CD5AA		042	1.00		1.00		CC5A/CD5AA		042	1.00		0.98													
CC5A/CD5AC		048	0.99		0.99		CC5A/CD5AC		048	0.99		0.98													
CC5A/CD5AW		042	0.99		1.00		CC5A/CD5AW		042	0.99		0.98													
		048	0.99		0.99				048	1.00		0.96													
CD5AA		048	0.99		0.99		CD5AA		048	1.00		0.96													
CE3AA		042	1.00		1.00		CE3AA		042	1.01		0.98													
		048	1.00		1.01				048	1.01		0.98													
COILS + 355MAV042080 VARIABLE SPEED FURNACE																									
CC5A/CD5AA		042	1.00		0.98		CK3BA		042	1.00		0.96													
CC5A/CD5AC		048	0.99		0.97		CK5A/CK5BA		042	1.00		0.97													
CC5A/CD5AW		042	0.99		0.98		CK5A/CK5BW		048	1.00		0.96													
		048	1.00		0.97				—	—		—													

See notes on page 26.

DETAILED COOLING CAPACITIES* Continued

EVAP AIR		CONDENSER ENTERING AIR TEMPERATURES °F																	
		75			85			95			105			115			125		
CFM	EWB	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
550A048-E, F Outdoor Section With CC5A/CD5AA060 Indoor Section																			
1400	72	53.0	25.6	2.87	51.3	25.0	3.18	49.4	24.3	3.53	47.2	23.6	3.93	44.8	22.8	4.36	42.1	21.9	4.83
	67	50.3	33.2	2.85	48.0	32.2	3.16	45.8	31.4	3.51	43.5	30.5	3.89	41.0	29.6	4.32	38.4	28.6	4.80
	63††	47.2	32.8	2.84	45.0	31.8	3.14	42.8	30.9	3.49	40.5	29.9	3.88	38.1	28.8	4.30	33.9	27.0	4.76
	62	46.2	40.4	2.83	44.0	39.3	3.14	41.5	38.1	3.48	38.9	36.8	3.86	36.1	35.3	4.28	33.2	33.2	4.75
	57	42.3	42.3	2.81	40.1	40.1	3.12	38.0	38.0	3.46	36.7	36.7	3.85	35.2	35.2	4.28	33.6	33.6	4.75
1600	72	53.9	26.4	2.94	52.2	25.9	3.26	50.2	25.2	3.61	48.0	24.5	4.00	45.5	23.8	4.44	42.4	22.6	4.90
	67	51.1	34.7	2.92	48.7	33.7	3.23	46.5	32.9	3.58	44.1	32.2	3.96	41.6	31.3	4.39	38.8	30.4	4.86
	63††	48.1	34.5	2.91	45.8	33.5	3.22	43.7	32.8	3.57	41.3	31.7	3.95	38.7	30.6	4.37	34.4	28.8	4.83
	62	47.2	43.0	2.91	45.1	42.0	3.22	42.4	40.6	3.56	39.7	39.0	3.94	37.0	37.0	4.36	34.5	34.5	4.83
	57	45.0	45.0	2.89	42.6	42.6	3.20	40.4	40.4	3.55	39.0	39.0	3.93	37.5	37.5	4.36	35.4	35.4	4.83
1800	72	53.7	26.7	3.00	52.9	26.7	3.33	50.9	26.1	3.68	47.9	25.0	4.06	45.6	24.3	4.50	42.3	23.1	4.96
	67	51.5	35.9	2.99	49.5	35.3	3.30	47.2	34.6	3.65	44.8	33.9	4.04	42.0	32.8	4.46	39.1	31.9	4.93
	63††	48.6	35.9	2.97	46.5	35.1	3.29	44.4	34.5	3.64	41.9	33.4	4.02	39.2	32.3	4.45	35.2	30.6	4.91
	62	47.8	45.0	2.97	45.7	44.1	3.29	43.1	42.6	3.63	40.5	40.5	4.02	39.0	39.0	4.45	36.7	36.7	4.92
	57	46.6	46.6	2.97	44.8	44.8	3.28	42.5	42.5	3.63	41.1	41.1	4.02	39.0	39.0	4.45	36.7	36.7	4.92
Multipliers for Determining the Performance With Other Indoor Sections																			
Indoor Section		Size	Cooling		Indoor Section	Size	Cooling												
			Capacity	Power			Capacity	Power											
CC5A/CD5AA		060	1.00		CE3AA	048	1.00												
CC5A/CD5AC		048	0.97			060	1.01												
CC5A/CD5AW		048	0.99		CK3BA	048	0.99												
		060	1.01			060	1.00												
CD5AA		048	0.99		CK5A/CK5BA	048	0.99												
CE3AA		048	1.00			060	1.00												
		060	1.01		CK5A/CK5BT	048	0.99												
CF5AA		048	0.99			060	1.00												
CK3BA		048	0.99		CK5A/CK5BW	048	0.99												
		060	1.00			060	1.02												
CK5A/CK5BA		048	0.99		CK5PA	048	0.99												
		060	1.00			060	1.00												
CK5A/CK5BN		048	0.95		CK5PT	048	0.99												
		060	0.98			060	1.00												
CK5A/CK5BW		048	0.99		CK5PW	048	0.99												
CK5A/CK5BX		060	1.01			060	1.02												
F(A,B)4(A,B)N(F,B)		048	0.99		COILS + 315(A,J)AV066135 VARIABLE SPEED FURNACE														
		060	0.98		CC5A/CD5AA	060	0.99												
FC4(B,C)N(F,B)		048	1.02		CC5A/CD5AC	048	0.97												
FG3AAA		048	0.99		CC5A/CD5AW	048	0.99												
		060	1.00			060	1.01												
FK4(C,D)NB		006††	1.02		CD5AA	048	0.99												
		006***	1.01		CD5PX	060	1.02												
FV4(A,B)NB		006	1.02		CE3AA	048	1.00												
FV4BNF		005	1.01			060	1.01												
FX4(A,B)NB		060	1.01		CK3BA	048	0.99												
FX4(A,B)NF		048	0.99			060	1.00												
COILS + 315(A,J)AV048090 VARIABLE SPEED FURNACE					CK5A/CK5BA	048	0.99												
CC5A/CD5AC		048	0.97			060	1.00												
CD5AA		048	0.99		CK5A/CK5BT	048	0.99												
CE3AA		048	1.00			060	1.00												
		060	1.01		CK5A/CK5BW	048	0.99												
CK3BA		048	0.99			060	1.02												
CK5A/CK5BA		048	0.99		CK5PA	048	0.99												
CK5A/CK5BT		048	0.99			060	1.00												
CK5PA		048	0.99		CK5PT	048	0.99												
CK5PT		048	0.99			060	1.00												
COILS + 315(A,J)AV066110 VARIABLE SPEED FURNACE					CK5PW	048	0.99												
CC5A/CD5AA		060	0.99		CK5PX	060	1.02												
CC5A/CD5AC		048	0.97		COILS + 315(A,J)AV066155 VARIABLE SPEED FURNACE														
CC5A/CD5AW		048	0.99		CC5A/CD5AA	060	0.99												
CD5AA		048	0.99		CC5A/CD5AC	048	0.97												
CD5PX		060	1.02			—	—												

See notes on page 26.

DETAILED COOLING CAPACITIES* Continued

EVAP AIR		CONDENSER ENTERING AIR TEMPERATURES °F																				
		75			85			95			105			115			125					
CFM	EWB	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**	Capacity MBtu/h†		Total Sys kW**			
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡				
550A048-E, F Outdoor Section With CC5A/CD5AA060 Indoor Section Continued																						
1400	72	53.0	25.6	2.87	51.3	25.0	3.18	49.4	24.3	3.53	47.2	23.6	3.93	44.8	22.8	4.36	42.1	21.9	4.83			
	67	50.3	33.2	2.85	48.0	32.2	3.16	45.8	31.4	3.51	43.5	30.5	3.89	41.0	29.6	4.32	38.4	28.6	4.80			
	63††	47.2	32.8	2.84	45.0	31.8	3.14	42.8	30.9	3.49	40.5	29.9	3.88	38.1	28.8	4.30	33.9	27.0	4.76			
	62	46.2	40.4	2.83	44.0	39.3	3.14	41.5	38.1	3.48	38.9	36.8	3.86	36.1	35.3	4.28	33.2	33.2	4.75			
	57	42.3	42.3	2.81	40.1	40.1	3.12	38.0	38.0	3.46	36.7	36.7	3.85	35.2	35.2	4.28	33.6	33.6	4.75			
1600	72	53.9	26.4	2.94	52.2	25.9	3.26	50.2	25.2	3.61	48.0	24.5	4.00	45.5	23.8	4.44	42.4	22.6	4.90			
	67	51.1	34.7	2.92	48.7	33.7	3.23	46.5	32.9	3.58	44.1	32.2	3.96	41.6	31.3	4.39	38.8	30.4	4.86			
	63††	48.1	34.5	2.91	45.8	33.5	3.22	43.7	32.8	3.57	41.3	31.7	3.95	38.7	30.6	4.37	34.4	28.8	4.83			
	62	47.2	43.0	2.91	45.1	42.0	3.22	42.4	40.6	3.56	39.7	39.0	3.94	37.0	37.0	4.36	34.5	34.5	4.83			
	57	45.0	45.0	2.89	42.6	42.6	3.20	40.4	40.4	3.55	39.0	39.0	3.93	37.5	37.5	4.36	35.4	35.4	4.83			
1800	72	53.7	26.7	3.00	52.9	26.7	3.33	50.9	26.1	3.68	47.9	25.0	4.06	45.6	24.3	4.50	42.3	23.1	4.96			
	67	51.5	35.9	2.99	49.5	35.3	3.30	47.2	34.6	3.65	44.8	33.9	4.04	42.0	32.8	4.46	39.1	31.9	4.93			
	63††	48.6	35.9	2.97	46.5	35.1	3.29	44.4	34.5	3.64	41.9	33.4	4.02	39.2	32.3	4.45	35.2	30.6	4.91			
	62	47.8	45.0	2.97	45.7	44.1	3.29	43.1	42.6	3.63	40.5	40.5	4.02	39.0	39.0	4.45	36.7	36.7	4.92			
	57	46.6	46.6	2.97	44.8	44.8	3.28	42.5	42.5	3.63	41.1	41.1	4.02	39.0	39.0	4.45	36.7	36.7	4.92			
Multipliers for Determining the Performance With Other Indoor Sections																						
Indoor Section		Size	Cooling			Indoor Section		Size	Cooling													
			Capacity	Power					Capacity	Power												
CC5A/CD5AW		048	0.99			CE3AA		048	1.00													
		060	1.01					060	1.01													
CD5AA		048	0.99			COILS + 355MAV060100 VARIABLE SPEED FURNACE																
CD5PX		060	1.02			CC5A/CD5AA		060	1.00													
CE3AA		048	1.00			CC5A/CD5AC		048	0.97													
		060	1.01					048	0.99													
CK3BA		048	0.99			CD5AA		060	1.01													
		060	1.00					048	0.99													
CK5A/CK5BA		048	0.99			CE3AA		048	1.00													
		060	1.00					060	1.01													
CK5A/CK5BT		048	0.99			CK3BA		060	1.00													
		060	1.00					060	1.00													
CK5A/CK5BW		048	0.99			CK5A/CK5BN		060	0.98													
CK5A/CK5BX		060	1.02			CK5A/CK5BX		060	1.02													
CK5PA		048	0.99			COILS + 355MAV060120 VARIABLE SPEED FURNACE																
		060	1.00			CC5A/CD5AA		060	1.00													
CK5PT		048	0.99			CC5A/CD5AC		048	0.97													
		060	1.00					048	0.99													
CK5PW		048	0.99			CD5AA		060	1.01													
CK5PX		060	1.02					048	0.99													
		060	1.02			CE3AA	048	1.00														
COILS + 355MAV060080 VARIABLE SPEED FURNACE							060	1.01														
CC5A/CD5AA		060	1.00			CK3BA		048	0.99													
CC5A/CD5AC		048	0.97					060	1.00													
CC5A/CD5AW		048	0.99			CK5A/CK5BA		060	1.00													
		060	1.01					CK5A/CK5BW	048	0.99												
CD5AA		048	0.99			CK5A/CK5BX		060	1.02													

See notes on page 26.

DETAILED COOLING CAPACITIES* Continued

EVAP AIR		CONDENSER ENTERING AIR TEMPERATURES °F																							
		75				85				95				105				115				125			
CFM	EWB	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**	Capacity MBtuh†		Total Sys kW**						
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡				
550A060-E, G Outdoor Section With CJ5A/CK5A/CK5BX060 Indoor Section																									
1600	72	67.9	32.7	3.87	64.9	31.5	4.30	62.9	30.8	4.80	58.4	29.1	5.31	54.9	27.9	5.90	50.7	26.6	6.53						
	67	64.0	41.3	3.82	61.6	40.6	4.27	58.5	39.5	4.75	54.7	38.2	5.27	50.4	36.6	5.84	45.8	34.9	6.46						
	63††	60.2	41.0	3.79	57.5	39.9	4.23	54.2	38.6	4.70	50.3	37.0	5.22	46.3	35.5	5.79	41.8	33.7	6.42						
	62	59.6	50.5	3.78	57.0	49.7	4.22	53.4	48.1	4.69	49.4	46.3	5.21	45.2	44.4	5.78	41.2	41.2	6.41						
	57	56.3	56.3	3.77	54.1	54.1	4.21	50.9	50.9	4.67	47.9	47.9	5.20	44.7	44.7	5.78	41.2	41.2	6.41						
1800	72	69.4	33.8	3.96	66.3	32.6	4.39	62.8	31.2	4.87	58.2	29.4	5.38	54.8	28.4	5.96	51.0	27.3	6.60						
	67	65.4	43.3	3.91	62.3	42.0	4.34	59.3	41.1	4.83	55.5	39.9	5.35	51.2	38.4	5.92	46.4	36.8	6.54						
	63††	60.8	42.2	3.87	58.3	41.4	4.30	55.0	40.2	4.78	51.1	38.7	5.30	47.1	37.4	5.87	42.3	35.6	6.49						
	62	60.6	52.8	3.86	58.0	52.3	4.31	54.3	50.7	4.78	50.2	48.8	5.29	46.3	46.3	5.87	42.6	42.6	6.49						
	57	58.2	58.2	3.86	55.3	55.3	4.28	52.6	52.6	4.76	49.5	49.5	5.28	46.1	46.1	5.86	42.6	42.6	6.49						
2000	72	68.9	33.9	4.02	65.8	32.6	4.45	62.1	31.2	4.93	59.7	30.7	5.48	54.6	28.7	6.02	50.9	27.9	6.66						
	67	65.6	44.2	3.98	62.6	42.9	4.41	59.7	42.4	4.90	56.0	41.4	5.43	51.7	40.1	6.00	46.9	38.7	6.61						
	63††	62.1	44.2	3.95	58.9	42.6	4.38	55.6	41.7	4.86	51.7	40.4	5.37	47.7	39.2	5.95	42.6	37.2	6.56						
	62	61.3	55.1	3.94	58.8	54.7	4.38	55.1	53.1	4.85	51.1	50.8	5.37	47.4	47.4	5.95	43.8	43.8	6.58						
	57	59.7	59.7	3.94	56.8	56.8	4.36	53.9	53.9	4.84	50.7	50.7	5.36	47.3	47.3	5.94	43.8	43.8	6.58						
Multipliers for Determining the Performance With Other Indoor Sections																									
Indoor Section		Size		Cooling		Indoor Section		Size		Cooling															
				Capacity	Power					Capacity	Power														
CK3BA		060		0.98		1.00		CK5A/CK5BT		060		0.97		0.97											
CK5A/CK5BA		060		0.98		1.00		CK5A/CK5BX		060		0.99		0.96											
CK5A/CK5BX		060		1.00		1.00		CK5PA		060		0.97		0.96											
F(A,B)4(A,B)N(F,B,C)		060		0.98		1.04		CK5PT		060		0.97		0.96											
FB4(A,B)NB		070		1.00		1.02		CK5PX		060		0.99		0.96											
FG3AAA		060		0.97		0.99		COILS + 315(A,J)AV066155 VARIABLE SPEED FURNACE																	
FK4(C,D)NB		006		1.00		0.97		CC5A/CD5AA		060		0.95		0.96											
FV4(A,B)NB		006		0.98		0.97		CC5A/CD5AW		060		0.97		0.96											
FX4(A,B)NB		060		0.98		1.01		CD5PX		060		0.98		0.96											
COILS + 315(A,J)AV066110 VARIABLE SPEED FURNACE								CE3AA		060		0.97		0.95											
CC5A/CD5AA		060		0.97		0.98		CK3BA		060		0.97		0.96											
CD5PX		060		0.98		0.96		CK5A/CK5BA		060		0.97		0.96											
CE3AA		060		0.97		0.95		CK5A/CK5BT		060		0.97		0.96											
CK3BA		060		0.97		0.97		CK5A/CK5BX		060		0.99		0.95											
CK5A/CK5BA		060		0.97		0.97		CK5PA		060		0.97		0.96											
CK5A/CK5BT		060		0.97		0.97		CK5PT		060		0.97		0.96											
CK5A/CK5BX		060		0.99		0.96		CK5PX		060		0.99		0.95											
CK5PA		060		0.97		0.96		CD5PX		060		0.98		0.99											
CK5PT		060		0.97		0.96		COILS + 355MAV060100 VARIABLE SPEED FURNACE																	
CK5PX		060		0.99		0.96		CK3BA		060		0.97		0.98											
COILS + 315(A,J)AV066135 VARIABLE SPEED FURNACE								CK5A/CK5BA		060		0.97		0.98											
CC5A/CD5AA		060		0.96		0.98		CK5A/CK5BX		060		0.98		0.98											
CC5A/CD5AW		060		0.98		0.97		COILS + 355MAV060120 VARIABLE SPEED FURNACE																	
CD5PX		060		0.98		0.96		CK3BA		060		0.97		0.97											
CE3AA		060		0.97		0.96		CK5A/CK5BA		060		0.97		0.97											
CK3BA		060		0.97		0.97		CK5A/CK5BX		060		0.98		0.97											
CK5A/CK5BA		060		0.97		0.97																			

NOTE: When the required data falls between the published data, interpolation may be performed. Extrapolation is not an acceptable practice.

* Detailed cooling capacities are based on indoor and outdoor unit at the same elevation per ARI standard 210/240-94. If additional tubing length and/or indoor unit is located above outdoor unit, a slight variation in capacity may occur.

† Total and sensible capacities are net capacities. Blower motor heat has been subtracted.

‡ Sensible capacities shown are based on 80°F (27°C) entering air at the indoor coil. For sensible capacities at other than 80°F (27°C), deduct 835 Btuh (245 kw) per 1000 CFM (480 L/S) of indoor coil air for each degree below 80°F (27°C), or add 835 Btuh (245 kw) per 1000 CFM (480 L/S) of indoor coil air per degree above 80°F (27°C). When the required data falls between the published data, interpolation may be performed.

** Unit kw is outdoor unit kilowatts only.

†† At TVA rating indoor condition (75°F edb/63°F ewb). All other indoor air temperatures are at 80°F edb.

CONDENSER ONLY RATINGS*

SST °F		CONDENSER ENTERING AIR TEMPERATURES °F							
		55	65	75	85	95	105	115	125
550A024-E/F									
30	TCG	25.9	24.5	23.1	21.7	20.3	18.9	17.5	16.0
	SDT	75.0	85.0	95.0	105.0	115.0	125.0	135.0	145.0
	KW	1.30	1.48	1.68	1.90	2.13	2.39	2.66	2.96
35	TCG	28.7	27.1	25.6	24.1	22.5	21.0	19.4	17.7
	SDT	75.0	85.0	95.0	105.0	115.0	125.0	135.0	145.0
	KW	1.28	1.46	1.66	1.88	2.12	2.38	2.66	2.96
40	TCG	31.6	29.9	28.2	26.6	24.9	23.2	21.5	19.6
	SDT	75.2	85.1	95.1	105.0	115.0	125.0	135.0	145.0
	KW	1.26	1.44	1.65	1.87	2.11	2.37	2.65	2.96
45	TCG	34.7	32.9	31.1	29.2	27.4	25.6	23.7	21.7
	SDT	75.8	85.6	95.5	105.0	115.0	125.0	135.0	145.0
	KW	1.24	1.43	1.63	1.85	2.10	2.36	2.65	2.96
50	TCG	37.9	36.0	34.0	32.1	30.1	28.1	26.0	23.9
	SDT	76.7	86.4	96.2	106.0	116.0	126.0	136.0	146.0
	KW	1.23	1.42	1.62	1.84	2.09	2.36	2.64	2.96
55	TCG	41.3	39.2	37.2	35.1	32.9	30.8	28.5	26.2
	SDT	77.9	87.5	97.1	107.0	117.0	126.0	136.0	146.0
	KW	1.22	1.41	1.61	1.84	2.09	2.35	2.64	2.96
550A030-E/F									
30	TCG	29.9	28.2	26.6	25.0	23.4	21.8	20.2	18.4
	SDT	75.3	85.3	95.3	105.0	115.0	125.0	135.0	145.0
	KW	1.42	1.61	1.82	2.07	2.34	2.64	2.98	3.36
35	TCG	32.9	31.1	29.4	27.7	25.9	24.1	22.3	20.4
	SDT	75.9	85.8	95.7	106.0	116.0	126.0	135.0	146.0
	KW	1.42	1.61	1.82	2.06	2.33	2.63	2.96	3.34
40	TCG	36.1	34.2	32.3	30.5	28.6	26.6	24.6	22.5
	SDT	76.7	86.5	96.3	106.0	116.0	126.0	136.0	146.0
	KW	1.42	1.61	1.82	2.06	2.32	2.62	2.96	3.33
45	TCG	39.5	37.5	35.4	33.4	31.3	29.2	27.1	24.7
	SDT	77.8	87.5	97.2	107.0	117.0	127.0	137.0	147.0
	KW	1.43	1.61	1.82	2.06	2.33	2.62	2.96	3.33
50	TCG	43.1	40.9	38.7	36.5	34.3	32.0	29.6	27.1
	SDT	79.2	88.8	98.4	108.0	118.0	128.0	138.0	147.0
	KW	1.44	1.63	1.83	2.07	2.33	2.63	2.96	3.33
55	TCG	46.9	44.5	42.2	39.8	37.4	34.9	32.3	29.6
	SDT	80.8	90.2	99.8	109.0	119.0	129.0	139.0	148.0
	KW	1.46	1.64	1.85	2.08	2.35	2.64	2.98	3.34
550A036-E/F									
30	TCG	36.3	34.4	32.4	30.4	28.2	26.0	23.7	21.1
	SDT	72.2	81.8	91.3	101.0	110.0	120.0	129.0	139.0
	KW	1.67	1.90	2.16	2.44	2.74	3.06	3.39	3.73
35	TCG	39.8	37.8	35.6	33.5	31.2	28.8	26.3	23.6
	SDT	73.5	83.1	92.7	102.0	112.0	121.0	130.0	140.0
	KW	1.68	1.91	2.17	2.45	2.75	3.08	3.43	3.78
40	TCG	43.5	41.3	39.0	36.7	34.3	31.8	29.1	26.2
	SDT	75.0	84.5	94.0	104.0	113.0	122.0	132.0	141.0
	KW	1.68	1.91	2.17	2.46	2.77	3.10	3.46	3.83
45	TCG	47.4	45.1	42.7	40.1	37.6	34.8	32.0	28.9
	SDT	76.6	86.0	95.4	105.0	114.0	124.0	133.0	142.0
	KW	1.68	1.92	2.18	2.47	2.79	3.13	3.49	3.87
50	TCG	51.5	49.1	46.5	43.8	41.0	38.1	35.0	31.7
	SDT	78.3	87.6	97.0	106.0	116.0	125.0	134.0	143.0
	KW	1.69	1.93	2.19	2.48	2.80	3.15	3.52	3.91
55	TCG	55.9	53.2	50.5	47.6	44.6	41.5	38.2	34.6
	SDT	80.1	89.3	98.6	108.0	117.0	126.0	135.0	144.0
	KW	1.70	1.93	2.20	2.50	2.82	3.17	3.54	3.94

See notes on page 28.

CONDENSER ONLY RATINGS* Continued

SST °F		CONDENSER ENTERING AIR TEMPERATURES °F							
		55	65	75	85	95	105	115	125
550A042-E/F									
30	TCG	41.4	39.2	37.0	34.8	32.5	30.2	27.8	25.3
	SDT	72.3	82.0	91.8	102.0	111.0	121.0	130.0	140.0
	KW	1.85	2.10	2.39	2.72	3.07	3.46	3.89	4.36
35	TCG	45.4	43.0	40.6	38.2	35.7	33.2	30.6	27.8
	SDT	73.7	83.4	93.1	103.0	112.0	122.0	131.0	141.0
	KW	1.86	2.12	2.41	2.74	3.09	3.49	3.92	4.39
40	TCG	49.6	47.0	44.5	41.8	39.1	36.4	33.5	30.5
	SDT	75.2	84.8	94.4	104.0	114.0	123.0	133.0	142.0
	KW	1.88	2.14	2.43	2.76	3.12	3.51	3.94	4.41
45	TCG	54.0	51.3	48.5	45.7	42.7	39.8	36.7	33.3
	SDT	76.7	86.3	95.9	106.0	115.0	125.0	134.0	143.0
	KW	1.89	2.16	2.45	2.78	3.14	3.54	3.97	4.44
50	TCG	58.8	55.8	52.8	49.7	46.6	43.3	39.9	36.3
	SDT	78.4	87.9	97.4	107.0	117.0	126.0	135.0	144.0
	KW	1.92	2.18	2.47	2.80	3.17	3.57	4.00	4.47
55	TCG	63.8	60.6	57.4	54.0	50.6	47.1	43.4	39.5
	SDT	80.2	89.6	99.1	109.0	118.0	127.0	137.0	145.0
	KW	1.94	2.20	2.50	2.83	3.20	3.60	4.03	4.50
550A048-E/F									
30	TCG	45.8	43.3	40.9	38.5	36.0	33.6	31.0	28.4
	SDT	72.0	82.0	92.0	102.0	112.0	122.0	132.0	142.0
	KW	2.11	2.40	2.73	3.09	3.52	3.98	4.51	5.09
35	TCG	50.6	47.9	45.2	42.6	39.9	37.2	34.4	31.5
	SDT	72.0	82.0	92.0	102.0	112.0	122.0	132.0	142.0
	KW	2.10	2.39	2.71	3.08	3.49	3.96	4.48	5.06
40	TCG	55.7	52.8	49.9	47.0	44.1	41.1	38.1	34.9
	SDT	72.3	82.1	92.0	102.0	112.0	122.0	132.0	142.0
	KW	2.10	2.38	2.70	3.06	3.47	3.93	4.45	5.02
45	TCG	60.9	57.8	54.7	51.7	48.6	45.4	42.1	38.5
	SDT	73.6	83.2	92.7	102.0	112.0	122.0	132.0	142.0
	KW	2.13	2.40	2.71	3.06	3.46	3.91	4.42	4.99
50	TCG	66.3	63.0	59.7	56.4	53.1	49.8	46.2	42.5
	SDT	75.1	84.6	94.1	104.0	113.0	123.0	132.0	142.0
	KW	2.17	2.44	2.75	3.09	3.48	3.92	4.41	4.96
55	TCG	72.1	68.5	65.0	61.4	57.8	54.2	50.5	46.5
	SDT	76.7	86.1	95.6	105.0	114.0	124.0	133.0	143.0
	KW	2.21	2.48	2.79	3.14	3.52	3.95	4.43	4.96
550A060-E/G									
30	TCG	57.0	54.0	51.1	48.1	45.1	42.1	39.0	35.6
	SDT	73.9	83.4	93.1	103.0	112.0	122.0	132.0	142.0
	KW	2.80	3.19	3.63	4.12	4.67	5.29	5.99	6.77
35	TCG	62.4	59.2	56.0	52.8	49.6	46.3	43.0	39.4
	SDT	75.4	84.9	94.5	104.0	114.0	123.0	133.0	142.0
	KW	2.85	3.24	3.67	4.16	4.71	5.32	6.00	6.76
40	TCG	68.2	64.7	61.2	57.7	54.3	50.7	47.1	43.3
	SDT	77.1	86.6	96.0	105.0	115.0	124.0	134.0	143.0
	KW	2.91	3.29	3.73	4.22	4.76	5.37	6.04	6.78
45	TCG	74.3	70.5	66.8	63.0	59.3	55.4	51.4	47.3
	SDT	79.0	88.3	97.7	107.0	117.0	126.0	135.0	144.0
	KW	2.97	3.36	3.79	4.28	4.83	5.43	6.10	6.84
50	TCG	80.7	76.7	72.7	68.6	64.5	60.3	56.0	51.5
	SDT	80.9	90.2	99.5	109.0	118.0	127.0	137.0	146.0
	KW	3.03	3.42	3.86	4.36	4.90	5.50	6.17	6.90
55	TCG	87.6	83.2	78.9	74.4	70.0	65.5	60.8	55.9
	SDT	83.0	92.2	101.0	111.0	120.0	129.0	138.0	147.0
	KW	3.11	3.50	3.94	4.44	4.98	5.59	6.25	6.98

* ARI listing applies only to systems shown in Ratings and Performance table.

KW — Total Power (Kw)

SDT — Saturated Temperature Leaving Compressor (°F)

SST — Saturated Temperature Entering Compressor (°F)

TCG — Gross Cooling Capacity (1000 Btuh).

SYSTEM DESIGN SUMMARY

1. Intended for outdoor installation with free air inlet and outlet. Outdoor fan external static pressure available is less than 0.01-in. wc.
2. Minimum outdoor operating air temperature without low-ambient operation accessory is 55°F (12.8°C).
3. Maximum outdoor operating air temperature is 125°F (51.7°C).
4. For reliable operation, unit should be level in all horizontal planes.
5. Maximum elevation of indoor coil above or below base of outdoor unit is: Indoor coil above = 50 ft, indoor coil below = 150 ft.
6. For interconnecting refrigerant tube lengths greater than 50 ft and/or 20 ft vertical differential, consult the Residential Split-System Application Guideline and Service Manual for Air Conditioners and Heat Pumps using Puron® (R-410A) Refrigerant available from equipment distributor.
7. If any refrigerant tubing is buried, provide a 6 in. vertical rise to the valve connections at the unit. Refrigerant tubing lengths up to 36 in. may be buried without further consideration. Do not bury refrigerant lines longer than 3 ft.
8. Use only copper wire for electric connection at unit. Aluminum and clad aluminum are not acceptable for the type of connector provided.
9. Mismatches of indoor coil capacity more than one size larger than outdoor unit capacity may result in inadequate indoor comfort.
10. Do not apply capillary tube indoor coils to these units.
11. Factory-supplied filter drier must be installed.

GENERAL

System Description

Outdoor-mounted, air-cooled, split-system air conditioner unit suitable for ground or rooftop installation. Unit consists of a hermetic compressor, an air-cooled coil, propeller-type condenser fan, and a control box. Unit will discharge supply air upward as shown on contract drawings. Unit will be used in a refrigeration circuit to match up to a packaged fan coil or coil unit.

Quality Assurance

Unit will be rated in accordance with the latest standard of ARI Standard 210.

Unit will be certified for capacity and efficiency, and listed in the latest ARI directory.

Unit construction will comply with latest edition of ANSI/ASHRAE and with NEC.

Unit will be constructed in accordance with UL standards and will carry the UL label of approval. Unit will have c-UL approval.

Unit cabinet will be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 500-hr salt spray test.

Air-cooled condenser coils will be leak tested at 250 psig and pressure tested at 450 psig.

Unit constructed in ISO9001 approved facility.

Delivery, Storage, and Handling

Unit will be shipped as single package only and is stored and handled per unit manufacturer's recommendations.

Warranty (for inclusion by specifying engineer)

U.S. and Canada only.

PRODUCTS

Equipment

Factory assembled, single piece, air-cooled air conditioner unit. Contained within the unit enclosure is all factory wiring, piping, controls, compressor, refrigerant charge Puron® (R-410A), and special features required prior to field start-up.

Unit Cabinet

Unit cabinet will be constructed of galvanized steel, bonderized, and coated with a powder coat paint.

Fans

Condenser fan will be direct-drive propeller type, discharging air upward.

Condenser fan motors will be totally enclosed, 1-phase type with class B insulation and permanently lubricated bearings.

Shafts will be corrosion resistant.

Fan blades will be statically and dynamically balanced.

Condenser fan openings will be equipped with PVC-coated steel wire safety guards.

Compressor

Compressor will be hermetically sealed.

Compressor will be mounted on rubber vibration isolators.

Condenser Coil

Condenser coil will be air cooled.

Coil will be constructed of aluminum fins mechanically bonded to copper tubes which are then cleaned, dehydrated, and sealed.

Refrigeration Components

Refrigeration circuit components will include liquid-line shutoff valve with sweat connections, vapor-line shutoff valve with sweat connections, system charge of refrigerant Puron® (R-410A), and compressor oil.

Operating Characteristics

The capacity of the unit will meet or exceed _____ Btuh at a suction temperature of _____ °F. The power consumption at full load will not exceed _____ kW.

Combination of the unit and the evaporator or fan coil unit will have a total net cooling capacity of _____ Btuh or greater at conditions of _____ CFM entering air temperature at the evaporator at _____ °F wet bulb and _____ °F dry bulb, and air entering the unit at _____ °F.

The system will have an SEER of _____ Btuh/watt or greater at DOE conditions.

Electrical Requirements


Nominal unit electrical characteristics will be _____ v, single phase, 60 hz. The unit will be capable of satisfactory operation within voltage limits of _____ v to _____ v.

Unit electrical power will be single point connection.

Control circuit will be 24v.

Special Features

Refer to section of this literature identifying accessories and descriptions for specific features and available enhancements.



SPECIFICATIONS SUBJECT TO CHANGE WITHOUT NOTICE

UNIT MUST BE INSTALLED IN ACCORDANCE
WITH INSTALLATION INSTRUCTIONS

Cancels: PDS 550A.24.5