

25HPA3
Performance™ Series Heat Pump with Puron®
Sizes 18 to 60
1 – 1/2 to 5 Nominal Tons



Turn to the Experts.™

Product Data



Performance
SERIES

Carrier's heat pumps with Puron® refrigerant provide a collection of features unmatched by any other family of equipment. The 25HPA has been designed utilizing Carrier's Puron® refrigerant. The environmentally sound refrigerant allows consumers to make a responsible decision in the protection of the earth's ozone layer.

As an Energy Star® Partner, Carrier Corporation has determined that this product meets the Energy Star® guidelines for energy efficiency. Refer to the combination ratings in the Product Data for system combinations that meet Energy Star® guidelines.

INDUSTRY LEADING FEATURES / BENEFITS

Energy Efficiency

- 13 SEER/11.5 EER/8 HSPF (Nominal)

New Aesthetic Design

- WeatherArmor Ultra™
- Baked on powder paint
- Steel louver coil guard
- Color matched cabinet screws

Extra Quiet Operation

- Silencer System II™ for sound as low as 69 dBA
- Quiet mount split post compressor grommets
- External silencer muffler
- Exclusive Silencer Top design
- 8 Pole PSC ball bearing condenser fan motor
- Forward-swept condenser fan blade
- Compressor blanket
- Quiet shift defrost

Reliability, Quality and Toughness

- Scroll compressor
- Field-installed 16 cu. in. filter drier
- Back-seating service valves
- High pressure switch
- Loss of charge switch
- Internal pressure relief valve
- Internal thermal overload
- Suction line accumulator
- Vapor fog eliminator

Controls and Diagnostics

- Infinity™ control compatible
- On-board Carrier diagnostics
- Up to 14 point diagnostic capability
- Long line accessory connections

Applications

- Long-line - up to 250 ft. total equivalent length, up to 200 ft. condenser above evaporator, or up to 20 ft. evaporator above condenser standard, (50 ft. w/liquid line solenoid)
- Low ambient (down to 0°F) with Infinity™ control or accessory kit

Limited Warranty

- Standard 10-year limited warranty on the compressor
- Standard 5-year limited warranty on all parts

MODEL NUMBER NOMENCLATURE

1 N	2 N	3 A	4 A	5 A/N	6 N	7 N	8 N	9 A/N	10 A/N	11 A/N	12 N	13 N
2	5	H	P	A	3	3	6	A	0	0	3	0
Product Series	Product Family	Tier	Major Series	SEER	Cooling Capacity	Variations	Open	Open	Voltage	Minor Series		
25 = HP	H = RES HP	P = Perfor- mance	A = Puron	3 = 13 SEER		A = Standard	0 = Not Defined	0 = Not Defined	3 = 208/230-1	0, 1, 2...		



As an Energy Star® Partner, Carrier Corporation has determined that this product meets the ENERGY STAR® guidelines for energy efficiency.

Refer to the combination ratings in Product Data for system combinations that meet Energy Star guidelines.

STANDARD FEATURES

Feature	18	24	30	36	42	48	60
Puron® Refrigerant	X	X	X	X	X	X	X
13 SEER	X	X	X	X	X	X	X
Scroll Compressor	X	X	X	X	X	X	X
Louvered Coil Guard	X	X	X	X	X	X	X
Field Installed Filter Drier	X	X	X	X	X	X	X
Back-Seating Service Valves	X	X	X	X	X	X	X
Internal Pressure Relief Valve	X	X	X	X	X	X	X
Internal Thermal Overload	X	X	X	X	X	X	X
Long Line capability	X	X	X	X	X	X	X
Low Ambient capability with Kit or Infinity™ Control	X	X	X	X	X	X	X
Suction Line Accumulator	X	X	X	X	X	X	X
High Pressure Switch	X	X	X	X	X	X	X
Loss of Charge Switch	X	X	X	X	X	X	X

PHYSICAL DATA

UNIT SIZE SERIES	18	24	30	36	42	48	60
Operating Weight (lb)	210	215	259	263	279	296	326
Shipping Weight (lb)	244	249	286	297	313	331	362
Compressor Type	Scroll						
REFRIGERANT	Puron® (R-410A)						
Control	TXV (Puron Hard Shutoff)						
Charge (lb)	6.13	6.13	8	7.69	8.38	11.19	12.5
COND FAN	Propeller Type, Direct Drive						
Air Discharge	Vertical						
Air Qty. (CFM)	2595	2595	3265	3265	3265	3673	3673
Motor HP	1/10	1/10	1/5	1/5	1/5	1/4	1/4
Motor RPM	800	800	800	800	800	800	800
COND COIL							
Face Area (Sq. ft.)	16.26	16.26	24.4	14.23	16.26	30.6	37.4
Fins per In.	20	20	20	20	20	20	20
Rows	1	1	1	2	2	2	2
Circuits	4	5	6	7	8	8	9
VALVE CONNECT. (In. ID)							
Vapor	5/8"	5/8"	3/4"	3/4"	7/8"	7/8"	7/8"
Liquid	3/8"						
REFRIGERANT TUBES* (In. OD)							
Vapor (0–80 ft. Tube Length)	5/8"	5/8"	3/4"	3/4"	7/8"	7/8"	1–1/8"
Liquid (0–80 ft. Tube Length)	3/8"						

* For tubing sets between 80 ft. and 200 ft. horizontal or 20 ft. vertical differential (250 ft. Total Equivalent Length), consult the Long–Line Guideline.

Note: See unit Installation Instruction for proper installation.

VAPOR LINE SIZING AND COOLING CAPACITY LOSS PURON 1-STAGE HEAT PUMP APPLICATIONS

LONG LINE APPLICATION: An application is considered "Long line" when the total equivalent tubing length exceeds 80 ft. or when there is more than 20 ft. vertical separation between indoor and outdoor units. These applications require additional accessories and system modifications for reliable system operation. The maximum allowable total equivalent length is 250 ft. The maximum vertical separation is 200 ft. when outdoor unit

is above indoor unit, and 80 ft. when the outdoor unit is below the indoor unit. Refer to Accessory Usage Guideline below for required accessories. See Long–Line Application Guideline for required piping and system modifications. Also, refer to the table below for the acceptable vapor tube diameters based on the total length to minimize the cooling capacity loss.

Unit Nominal Size (Btuh)	Acceptable Vapor Line Diameters (In. OD)	Cooling Capacity Loss (%) Total Equivalent Line Length (ft.)											
		Standard Application			Long Line Application Requires Accessories								
		25	50	80	80+	100	125	150	175	200	225	250	
18000 1–Stage Puron HP	1/2	1	2	3	3	4	6	7	8	9	10	12	
	5/8	0	0	1	1	1	1	2	2	3	3	3	
24000 1–Stage Puron HP	5/8	0	1	1	1	2	3	3	4	4	5	6	
	3/4	0	0	0	0	0	1	1	1	1	1	2	
30000 1–Stage Puron HP	5/8	1	2	3	3	3	4	5	6	7	8	9	
	3/4	0	0	1	1	1	1	2	2	2	3	3	
	7/8	0	0	0	0	0	1	1	1	1	1	1	
36000 1–Stage Puron HP	5/8	1	2	4	4	5	6	7	9	10	11	13	
	3/4	0	0	1	1	1	2	2	3	3	4	4	
	7/8	0	0	0	0	0	1	1	1	1	2	2	
42000 1–Stage Puron HP	3/4	0	1	2	2	2	3	4	4	5	6	6	
	7/8	0	0	1	1	1	1	2	2	2	3	3	
48000 1–Stage Puron HP	3/4	0	1	2	2	3	4	5	5	6	7	8	
	7/8	0	0	1	1	1	2	2	2	3	3	4	
60000 1–Stage Puron HP	3/4	1	2	4	4	5	6	7	9	10	11	12	
	7/8	0	1	2	2	2	3	4	4	5	5	6	
	1 1/8	0	0	0	0	1	1	1	1	1	1	2	

Standard Length = 80 ft. or less total equivalent length

Applications in this area are long line. Accessories are required as shown recommended on Long Line Application Guidelines

Applications in this area may have height restrictions that limit allowable total equivalent length, when outdoor unit is below indoor unit See Long Line Application Guidelines

ACCESSORIES

KIT NUMBER	KIT NAME	18–30	24–30	30–30	36–30	42–30	48–30	60–30
KAACH1201AAA	CRANKCASE HEATER				X	X	S	S
KAACH1401AAA	CRANKCASE HEATER	X	X	X				
KSACY0101AAA	CYCLE PROTECTOR	S	S	S	S	S	S	S
KAFT0101AAA	FREEZE THERMOSTAT	X	X	X	X	X	X	X
KSAS1701AAA	HARD START (CAP/RELAY)	X	X	X	X	X	X	X
KHAIR0101AAA	ISOLATION RELAY	X	X	X	X	X	X	X
KSALA0301410	LOW AMBIENT SWITCH	X	X	X	X	X	X	X
KHAOT0201SEC	OUTDOOR THERMOSTAT	X	X	X	X	X	X	X
KHAOT0301FST	OUTDOOR THERMOSTAT	X	X	X	X	X	X	X
KAACS0201PTC	PTC START ASSIST	X	X	X	X	X	X	X
KHALS0401LLS	SOLENOID VALVE	X	X	X	X	X	X	X
KSASF0101AAA	SUPPORT FEET	X	X	X	X	X	X	X
KAATD0101TDR	TIME DELAY RELAY	X	X	X	X	X	X	X
KSATX0201PUR	TXV (HSO)	X	X	X				
KSATX0301PUR	TXV (HSO)				X	X		
KSATX0401PUR	TXV (HSO)						X	
KSATX0501PUR	TXV (HSO)							X

x = Accessory S = Standard

ACCESSORY THERMOSTATS

THERMOSTAT / SUBBASE PKG.	DESCRIPTION
TSTATCCPRH01–B*	Thermidistat™ Control — Non–Programmable/Programmable Thermostat with Humidity Control (For use in Dual Fuel, AC, HP, and 2S applications. Includes Outdoor Air Temperature Sensor.)
TSTATCCPHH01–B*	Hybrid Heat™ (Dual Fuel) Thermostat — Auto Changeover, 7–Day Programmable, °F/°C, Includes Outdoor Sensor (TSTATXXSEN01–B)
TSTATCCPH01–B	Thermostat — Auto Changeover, 7–Day Programmable, °F/°C, 2–Stage Heat, 1–Stage Cool
TSTATCCNHP01–C	Thermostat — Auto Changeover, Non–Programmable, °F/°C, 2–Stage Heat, 1–Stage Cool
TSTATCCSHP01	Standard Programmable Thermostat—Manual Changeover, 5–2 Day Programmable, °F/°C, 1–Stage Heat/1–Stage Cool
TSTATCCBHP01–B*	Builder's Thermostat — Heat Pump, Non–Programmable, °F/°C, 2–Stage Heat, 1–Stage Cool, Manual Changeover
TSTATXXSEN01–B**	Outdoor Air Temperature Sensor
TSTATXXNBP01	Backplate for Non–Programmable Thermostat
TSTATXXBP01	Backplate for Programmable Thermostat and Thermidistat™ Control
TSTATXXSBP01	Backplate for Standard Programmable Thermostat
TSTATXXBBP01	Backplate for Builder's Thermostat
TSTATXXCNV10†	Thermostat Conversion Kit (4 to 5 Wire) — 10 Pack

* Do not use in zoning heat pump applications.

** Outdoor temperature sensor is an accessory for all Carrier electronic thermostats, except the non–programmable air conditioner version and builder's thermostats. It allows the temperature at a remote location (outdoors) to be displayed on the thermostat. The outdoor air temperature sensor must be used with the HybridHeat™ (dual fuel) thermostat.

† Thermostat conversion kit is a 24–vac accessory that can turn a 4–wire thermostat application into a 5–wire application. This kit can also be used to replace a broken thermostat wire, or add an extra wire when needed.

The outdoor air temperature sensor is included with the Thermidistat Control and HybridHeat™ (dual fuel) thermostat.

ACCESSORY USAGE GUIDELINE

ACCESSORY	REQUIRED FOR LOW-AMBIENT COOLING APPLICATIONS (Below 55° F)	REQUIRED FOR LONG LINE APPLICATIONS* (Over 80 Ft.)	REQUIRED FOR SEA COAST APPLICATIONS (Within 2 miles)
Crankcase Heater	Yes	Yes	No
Evaporator Freeze Thermostat	Yes	No	No
Accumulator	Standard	Standard	Standard
Compressor Start Assist Capacitor and Relay	Yes	Yes	No
Motor Master® Control or Low-ambient Pressure Switch	Standard	Standard	Standard
Support Feet	Recommended	No	Recommended
Liquid Line Solenoid Valve	No	See Long-Line Application Guideline	No
Ball Bearing Fan Motor	Standard	Standard	Standard

* For tubing line sets between 80 and 200 ft. and/or 20 ft. vertical differential (250 ft. Total Equivalent Length), refer to Long-Line Application Guideline.

Accessory Description and Usage (Listed Alphabetically)

1. Ball-Bearing Fan Motor

A fan motor with ball bearings which permits speed reduction while maintaining bearing lubrication.

Usage Guideline:

Required on all units when MotorMaster® is used.

2. Compressor Start Assist - Capacitor and Relay

Start capacitor and relay gives a "hard" boost to compressor motor at each start up.

Usage Guideline:

Required for reciprocating compressors in the following applications:

- Long line
- Low ambient cooling
- Hard shut off expansion valve on indoor coil
- Liquid line solenoid on indoor coil

Required for single-phase scroll compressors in the following applications:

- Long line
- Low ambient cooling

Suggested for all compressors in areas with a history of low voltage problems.

3. Compressor Start Assist — PTC Type

Solid state electrical device which gives a "soft" boost to the compressor at each start-up.

Usage Guideline:

Suggested in installations with marginal power supply.

4. Crankcase Heater

An electric resistance heater which mounts to the base of the compressor to keep the lubricant warm during off cycles. Improves compressor lubrication on restart and minimizes the chance of liquid slugging.

Usage Guideline:

- Required in low ambient cooling applications.
- Required in long line applications.
- Suggested in all commercial applications.

5. Evaporator Freeze Thermostat

An SPST temperature-actuated switch that stops unit operation when evaporator reaches freeze-up conditions.

Usage Guideline:

Required when low ambient kit has been added.

6. Isolation Relay

An SPDT relay which switches the low-ambient controller out of the outdoor fan motor circuit when the heat pump switches to heating mode.

Usage Guideline:

Required in all heat pumps where low ambient kit has been added.

7. Liquid-Line Solenoid Valve (LLS)

An electrically operated shutoff valve which stops and starts refrigerant liquid flow in response to compressor operation. It is to be installed at the outdoor unit to control refrigerant off cycle migration in the heating mode.

Usage Guideline:

An LLS is required in all long line heat pump applications to control refrigerant off cycle migration in the heating mode. See Long Line Guideline.

8. Low-Ambient Pressure Switch Kit

A long life pressure switch which is mounted to outdoor unit service valve. It is designed to cycle the outdoor fan motor in order to maintain head pressure within normal operating limits. The control will maintain working head pressure at low-ambient temperatures down to 0°F when properly installed.

Usage Guideline:

A Low-Ambient Pressure Switch or MotorMaster® Low-Ambient Controller must be used when cooling operation is used at outdoor temperatures below 55°F (12.8°C).

9. MotorMaster® Low-Ambient Controller

A fan-speed control device activated by a temperature sensor, designed to control condenser fan motor speed in response to the saturated, condensing temperature during operation in cooling mode only. For outdoor temperatures down to -20°F (-28.9°C), it maintains condensing temperature at 100°F ±10°F (37.8°C ± -12°C).

Usage Guideline:

A MotorMaster® Low Ambient Controller or Low-Ambient Pressure Switch must be used when cooling operation is used at outdoor temperatures below 55°F (12.8°C).

Suggested for all commercial applications.

Accessory Description and Usage (Listed Alphabetically) - CONTINUED

10. Outdoor Air Temperature Sensor

Designed for use with Carrier Thermostats listed in this publication. This device enables the thermostat to display the outdoor temperature. This device also is required to enable special thermostat features such as auxiliary heat lock out.

Usage Guideline:

Suggested for all Carrier thermostats listed in this publication.

11. Outdoor Thermostat

An SPDT temperature-actuated switch which turns on supplemental electric heaters when outdoor air temperature drops below a user-selected set point.

Usage Guideline:

Electric supplemental heat applications in non-variable speed indoor units when electric heat staging is desired.

12. Secondary Outdoor Thermostat

An SPDT temperature-actuated switch which turns on third-stage of supplemental electric heaters when outdoor air temperature drops below the second-stage set point.

Usage Guideline:

Outdoor thermostat applications where electric heater is capable of 3-stage operation.

13. Sound Hood

Wraparound sound reducing cover for the compressor. Reduces the sound level by about 2 dBA.

Usage Guideline:

Suggested when unit is installed closer than 15 ft. to quiet areas, bedrooms, etc.

Suggested when unit is installed between two houses less than 10 ft. apart.

14. Thermostatic Expansion Valve (TXV) Bi-Flow

A modulating flow-control valve which meters refrigerant liquid flow rate into the evaporator in response to the superheat of the refrigerant gas leaving the evaporator.

Usage Guideline:

Accessory required to meet ARI rating and system reliability, where indoor not equipped.

Required in all heat pump applications designed with Puron refrigerant.

15. Time-Delay Relay

An SPST delay relay which briefly continues operation of indoor blower motor to provide additional cooling after the compressor cycles off.

Note: Most indoor unit controls include this feature. For those that do not, use the guideline below.

Usage Guideline:

Accessory required to meet ARI rating, where indoor not equipped.

ELECTRICAL DATA

UNIT SIZE	V/PH	OPER VOLTS*		COMPR		FAN	MCA	MIN WIRE SIZE†	MIN WIRE SIZE†	MAX LENGTH (ft.)‡	MAX LENGTH (ft.)‡	MAX FUSE** or CKT BRK AMPS
		MAX	MIN	LRA	RLA	FLA		60° C	75° C	60° C	75° C	
18	208/230/1	253	197	48	9	0.7	11.92	14	14	66	63	20
24				58.3	12.8	0.7	16.73	14	14	47	45	25
30				73	16.4	1.1	21.6	12	12	58	55	30
36				112	18.2	1.1	23.81	12	12	52	50	35
42				109	19.9	1.1	25.94	10	10	77	73	40
48				117	21.8	1.3	28.64	10	10	70	66	40
60				134	26.6	1.3	34.65	8	10	90	55	50

* Permissible limits of the voltage range at which the unit will operate satisfactorily

† If wire is applied at ambient greater than 30° C (86° F), consult table 310–16 of the NEC (ANSI/NFPA 70). The ampacity of non-metallic-sheathed cable (NM), trade name ROMEX, shall be that of 60° C (140° F) conditions, per the NEC (ANSI/NFPA 70) Article 336–26. If other than uncoated (no-plated), 60 or 75° C (140 or 167° C) insulation, copper wire (solid wire for 10 AWG or smaller, stranded wire for larger than 10 AWG) is used, consult applicable tables of the NEC (ANSI/NFPA 70).

‡ Length shown is as measured 1 way along wire path between unit and service panel for voltage drop not to exceed 2%.

** Time–Delay fuse.

FLA – Full Load Amps

LRA – Locked Rotor Amps

MCA – Minimum Circuit Amps

RLA – Rated Load Amps

NOTE: Control circuit is 24–V on all units and requires external power source. Copper wire must be used from service disconnect to unit. All motors/compressors contain internal overload protection.

25HPA3

A-WEIGHTED SOUND LEVEL (dBA)

UNIT SIZE	STANDARD RATING	TYPICAL OCTAVE BAND SPECTRUM (without tone adjustment)						
		125	250	500	1000	2000	4000	8000
18	70	57	57	63	62.5	61	56.5	47.5
24	69	56.5	57.5	63.5	61.5	61.5	57	48.5
30	71	59.5	60	65	64.5	61.5	58	55.5
36	72	60	62	66	65	63	58	51.5
42	73	59.5	61.5	65	67.5	64	59.5	54
48	73	58.5	62.5	64.5	67	65	61	54.5
60	75	59	61	67	69.5	64	59	54.5

CHARGING SUBCOOLING (TXV-TYPE EXPANSION DEVICE)

UNIT SIZE – SERIES	REQUIRED SUBCOOLING (F)
18	12
24	13
30	12
36	12
42	11
48	13
60	11


DIMENSIONS

UNIT	SERIES	ELECTRICAL CHARACTERISTICS	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	OPERATING WEIGHT	SHIPPING WEIGHT	SHIPPING DIMENSIONS (L x W x H)
25HPA318	0	X 0 0 0	35 1/2"	33 11/16"	6 1/16"	5/8"	6 13/16"	28 3/4"	11 5/8"	1 3/4"	7"	4 3/16"	1 1/8"	19 1/2"	18"	16 3/4"	40"	210#	244#	41 1/8" X 36 5/8" X 37 7/16"
25HPA324	0	X 0 0 0	35 1/2"	33 11/16"	6 1/16"	5/8"	6 13/16"	28 3/4"	11 5/8"	1 3/4"	7"	4 3/16"	1 1/8"	19 1/2"	18"	16 1/2"	40"	215#	249#	41 1/8" X 36 5/8" X 37 7/16"
25HPA330	0	X 0 0 0	35 1/2"	47 5/16"	6 5/16"	3/4"	6 13/16"	28 3/4"	11 5/8"	1 3/4"	7"	4"	1 1/8"	18 1/2"	17 1/2"	20 1/2"	40"	259#	296#	41 1/8" X 36 5/8" X 51 1/16"
25HPA336	0	X 0 0 0	35 1/2"	30 5/16"	6 5/16"	3/4"	6 13/16"	28 3/4"	11 5/8"	1 3/4"	7"	4"	1 1/8"	19"	16 1/2"	13"	40"	263#	297#	41 1/8" X 36 5/8" X 34 1/16"
25HPA342	0	X 0 0 0	35 1/2"	33 11/16"	6 1/4"	7/8"	6 13/16"	28 3/4"	11 5/8"	1 3/4"	7"	4 1/16"	1 1/8"	19 1/2"	16 1/2"	13 1/2"	40"	279#	313#	41 1/8" X 36 5/8" X 37 7/16"
25HPA348	0	X 0 0 0	35 1/2"	37 1/8"	6 1/4"	7/8"	6 13/16"	28 3/4"	11 5/8"	1 3/4"	7"	4 1/16"	1 1/8"	20"	17"	16 1/2"	40"	296#	331#	41 1/8" X 36 5/8" X 40 7/8"
25HPA360	0	X 0 0 0	35 1/2"	43 7/8"	6 1/4"	7/8"	6 13/16"	28 3/4"	11 5/8"	1 3/4"	7"	4 1/16"	1 1/8"	19 1/2"	17"	18 1/2"	40"	326#	362#	41 1/8" X 36 5/8" X 47 11/16"

X = YES
0 = NO


NOTES:

1. ALLOW 30" CLEARANCE TO SERVICE SIDE OF UNIT, 48" ABOVE UNIT, 6" ON ONE SIDE, 12" ON REMAINING SIDE, AND 24" BETWEEN UNITS FOR PROPER AIRFLOW.
2. MINIMUM OUTDOOR OPERATING AMBIENT IN COOLING MODE IS 55 F., MAX. 125 F.
3. SERIES DESIGNATION IS THE 13TH POSITION OF THE UNIT MODEL NUMBER.
4. CENTER OF GRAVITY

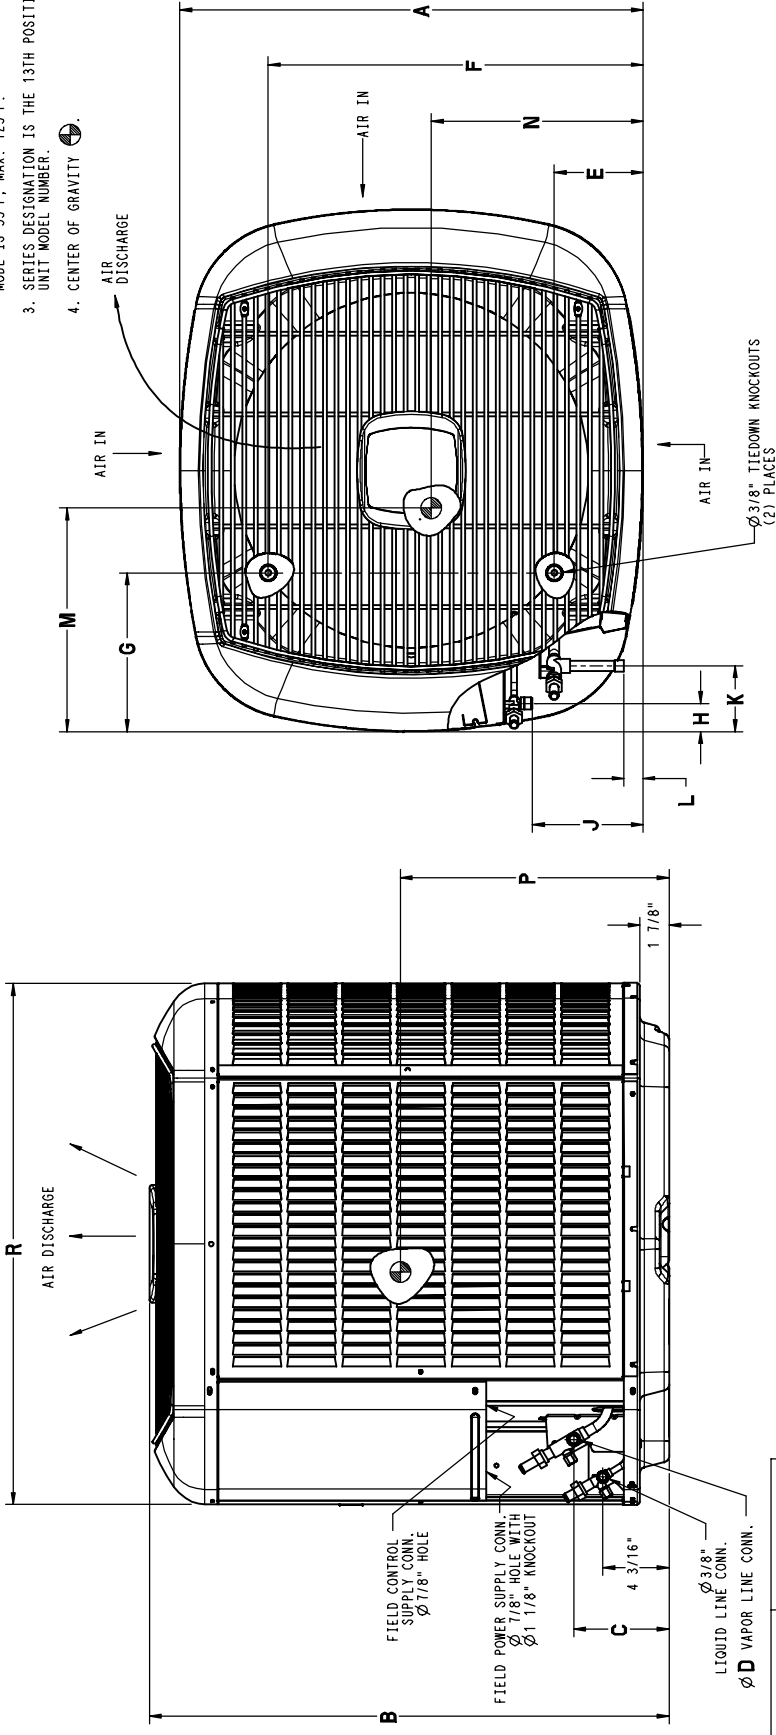

UNIT SIZE	MINIMUM MOUNTING PAD DIMENSIONS
-	29 1/2" X 33"
18 THRU 60	36 1/2" X 40"

25HPA3 BALANCE POINT WORKSHEET

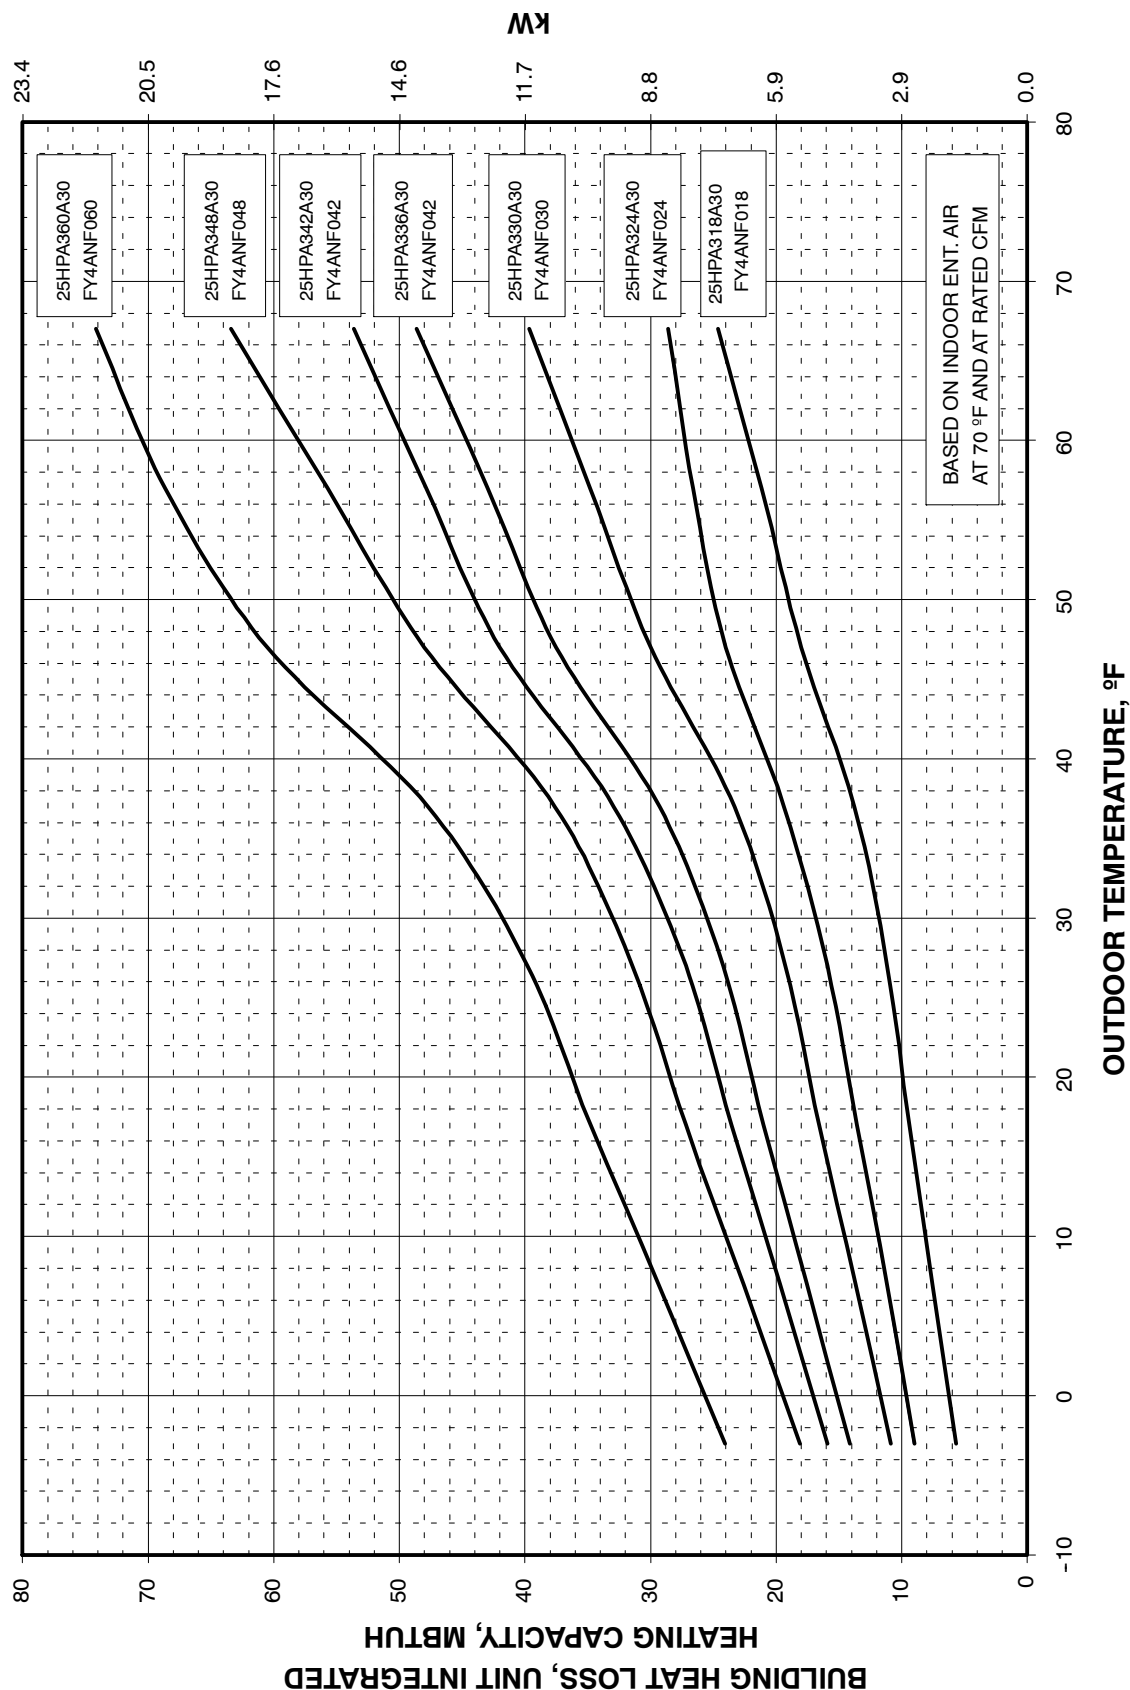

COMBINATION RATINGS

Unit Size – Series	Indoor Model	Cooling Capacity	ARI Standard Ratings									Furnace Model
			Cooling				Heating					
			Factory Enhance	Standard Rating	SEER TDR	EER	High Temp		Low Temp		HSPF	
E Capacity	E COP	H Capacity					H COP					
18–30	*FY4ANF018	17,400	TDR&TXV	13.00		10.8	18,000	3.42	10,800	2.22	8.0	
	FE4ANF002	18,000	TDR&TXV	15.50		12.50	17,800	3.70	10,300	2.40	8.3	
	FF1ENP018	17,400	TDR&TXV	13.20		11.00	18,000	3.42	10,800	2.24	7.9	
	FV4BNF002	18,000	TDR&TXV	15.50		12.50	17,800	3.70	10,300	2.40	8.3	
	FX4BNF018	17,400	TDR&TXV	13.20		10.80	18,000	3.42	10,800	2.22	7.8	
	FX4CNF018	17,800	TDR&TXV	14.00		12.00	18,000	3.64	10,400	2.36	8.2	
	FX4CNF024	18,000	TDR&TXV	15.00		12.00	18,000	3.70	10,400	2.40	8.3	
	FY4ANF024	17,600	TDR&TXV	13.20		11.00	18,000	3.42	10,900	2.24	8.0	
	CAP**1814A**	17,300	TDR&TXV	14.50		11.70	17,400	3.40	10,100	2.28	8.0	58CV(A,X)070–12
	CAP**1814A**	17,400	TXV		13.00	10.80	18,000	3.38	10,800	2.22	8.0	
	CAP**2414A**	17,600	TDR&TXV	15.00		12.00	17,600	3.54	10,200	2.34	8.0	58CV(A,X)070–12
	CAP**2414A**	17,700	TXV		13.50	10.80	18,000	3.52	10,900	2.28	8.0	
	CAP**2417A**	17,700	TDR&TXV	15.00		12.00	17,600	3.58	10,200	2.36	8.1	58CV(A,X)090–16
	CAP**2417A**	17,700	TDR&TXV	15.00		12.00	17,600	3.56	10,200	2.34	8.1	58MVB060–14
	CAP**2417A**	17,700	TXV		13.50	10.80	18,000	3.52	10,900	2.28	8.0	
	CNPF*2418A**	17,700	TXV		13.50	10.80	18,000	3.58	10,900	2.30	8.1	
	CNPH*2417A**	17,600	TDR&TXV	15.00		12.00	17,600	3.60	10,200	2.36	8.1	58CV(A,X)070–12
	CNPH*2417A**	17,700	TDR&TXV	15.00		12.00	17,600	3.62	10,300	2.36	8.2	58CV(A,X)090–16
	CNPH*2417A**	17,600	TDR&TXV	14.50		11.80	17,600	3.60	10,400	2.42	8.2	58MVB040–14
	CNPH*2417A**	17,600	TDR&TXV	15.00		12.00	17,600	3.60	10,300	2.36	8.2	58MVB060–14
	CNPH*2417A**	17,700	TDR&TXV	15.00		12.00	17,600	3.62	10,300	2.36	8.2	58MVB080–14
	CNPH*2417A**	17,700	TXV		13.50	10.80	18,000	3.58	10,900	2.30	8.1	
	CNPV*1814A**	17,300	TDR&TXV	15.00		11.70	17,400	3.52	10,200	2.32	8.0	58CV(A,X)070–12
	CNPV*1814A**	17,400	TXV		13.50	10.80	18,000	3.52	10,900	2.28	8.0	
	CNPV*2414A**	17,600	TDR&TXV	15.00		12.00	17,600	3.58	10,200	2.36	8.1	58CV(A,X)070–12
	CNPV*2414A**	17,700	TXV		13.50	10.80	18,000	3.58	10,900	2.28	8.1	
	CNPV*2417A**	17,700	TDR&TXV	15.00		12.00	17,600	3.62	10,300	2.36	8.2	58CV(A,X)090–16
CNPV*2417A**	17,700	TDR&TXV	15.00		12.00	17,600	3.60	10,300	2.36	8.2	58MVB060–14	
CNPV*2417A**	17,700	TXV		13.50	10.80	18,000	3.58	10,900	2.28	8.1		
CSPH*2412A**	17,600	TDR&TXV	15.00		12.00	17,600	3.58	10,300	2.36	8.1	58CV(A,X)070–12	
CSPH*2412A**	17,700	TDR&TXV	15.00		12.00	17,600	3.60	10,300	2.36	8.2	58CV(A,X)090–16	
CSPH*2412A**	17,600	TDR&TXV	14.50		11.90	17,600	3.58	10,400	2.40	8.2	58MVB040–14	
CSPH*2412A**	17,600	TDR&TXV	15.00		12.00	17,600	3.60	10,300	2.36	8.1	58MVB060–14	
CSPH*2412A**	17,700	TDR&TXV	15.00		12.00	17,600	3.60	10,300	2.36	8.2	58MVB080–14	
CSPH*2412A**	17,700	TXV		13.50	10.80	18,000	3.58	10,900	2.30	8.1		
24–30	*FY4ANF024	23,000	TDR&TXV	13.00		10.80	24,000	3.48	15,100	2.48	8.0	
	FE4ANF002	23,600	TDR&TXV	14.50		11.70	23,000	3.74	14,500	2.66	8.5	
	FE4ANF003	23,800	TDR&TXV	15.00		12.00	22,600	3.70	14,400	2.66	8.5	
	FF1ENP024	23,000	TDR&TXV	13.00		10.70	24,000	3.48	15,200	2.46	8.0	
	FF1ENP030	23,200	TDR&TXV	13.00		10.80	24,000	3.48	15,100	2.48	8.0	
	FV4BNF002	23,600	TDR&TXV	14.50		11.70	23,000	3.74	14,500	2.66	8.5	
	FV4BNF003	23,800	TDR&TXV	15.00		12.00	22,600	3.70	14,400	2.66	8.5	
	FX4CNF024	23,400	TDR&TXV	14.00		11.50	23,800	3.66	14,700	2.60	8.3	
	FX4CNF030	23,800	TDR&TXV	14.50		11.70	23,000	3.72	14,700	2.66	8.5	
	FY4ANF030	23,400	TDR&TXV	13.20		11.00	23,600	3.54	15,100	2.52	8.2	
	CAP**2414A**	23,000	TDR&TXV	14.00		11.50	24,000	3.66	14,400	2.58	8.2	58CV(A,X)070–12
	CAP**2414A**	23,200	TXV		13.00	10.80	24,000	3.54	15,200	2.50	8.0	
	CAP**2417A**	23,200	TDR&TXV	14.50		11.70	24,000	3.70	14,300	2.60	8.3	58CV(A,X)090–16
	CAP**2417A**	23,200	TDR&TXV	14.50		11.70	24,000	3.68	14,400	2.58	8.3	58MVB060–14
	CAP**2417A**	23,200	TXV		13.00	10.80	24,000	3.54	15,200	2.50	8.0	
	CAP**3014A**	23,400	TDR&TXV	14.50		11.70	22,600	3.58	14,400	2.60	8.2	58CV(A,X)070–12
	CAP**3014A**	23,400	TXV		13.00	10.80	22,000	3.38	15,200	2.50	8.0	
	CAP**3017A**	23,400	TDR&TXV	14.50		11.70	22,600	3.60	14,400	2.62	8.3	58CV(A,X)090–16
	CAP**3017A**	23,400	TDR&TXV	14.50		11.70	22,600	3.60	14,400	2.60	8.3	58MVB060–14
	CAP**3017A**	23,400	TXV		13.00	10.80	22,000	3.38	15,200	2.50	8.0	
	CNPF*2418A**	23,200	TXV		13.00	10.80	24,000	3.60	15,200	2.52	8.2	
	CNPH*2417A**	23,000	TDR&TXV	14.00		11.50	24,000	3.74	14,400	2.60	8.4	58CV(A,X)070–12
CNPH*2417A**	23,000	TDR&TXV	14.00		11.50	24,000	3.78	14,400	2.62	8.5	58CV(A,X)090–16	
CNPH*2417A**	23,200	TDR&TXV	14.00		11.50	24,000	3.76	14,500	2.60	8.4	58CV(A,X)110–20	
CNPH*2417A**	23,200	TDR&TXV	14.00		11.50	24,000	3.76	14,500	2.62	8.5	58CV(A,X)135–22	
CNPH*2417A**	23,000	TDR&TXV	14.00		11.50	24,000	3.86	14,600	2.68	8.6	58CV(A,X)155–22	
CNPH*2417A**	23,000	TDR&TXV	14.00		11.50	24,000	3.84	14,600	2.66	8.6	58MVB040–14	
CNPH*2417A**	23,000	TDR&TXV	14.00		11.50	24,000	3.74	14,400	2.60	8.4	58MVB060–14	

See note on pg. 17

COMBINATION RATINGS CONTINUED

Unit Size – Series	Indoor Model	Cooling Capacity	ARI Standard Ratings									Furnace Model
			Cooling				Heating					
			Factory Enhance	Standard Rating	SEER TDR	EER	High Temp		Low Temp		HSPF	
							E Capacity	E COP	H Capacity	H COP		
24–30	CNPH*2417A**	23,200	TDR&TXV	14.00		11.50	24,000	3.76	14,500	2.60	8.4	58MVB080–14
	CNPH*2417A**	23,200	TDR&TXV	14.00		11.50	24,000	3.76	14,500	2.60	8.4	58MVB080–20
	CNPH*2417A**	23,200	TDR&TXV	14.00		11.50	24,000	3.76	14,500	2.62	8.5	58MVB100–20
	CNPH*2417A**	23,000	TDR&TXV	14.00		11.50	24,000	3.74	14,500	2.60	8.4	58MVB120–20
	CNPH*2417A**	23,200	TXV		13.00	10.80	24,000	3.60	15,200	2.52	8.2	
	CNPH*3017A**	23,400	TDR&TXV	14.50		11.70	22,600	3.58	14,400	2.60	8.2	58CV(A,X)070–12
	CNPH*3017A**	23,400	TDR&TXV	14.50		11.70	22,400	3.60	14,400	2.62	8.2	58CV(A,X)090–16
	CNPH*3017A**	23,400	TDR&TXV	14.50		11.70	22,400	3.60	14,400	2.62	8.2	58CV(A,X)110–20
	CNPH*3017A**	23,400	TDR&TXV	14.50		11.70	22,400	3.60	14,400	2.62	8.2	58CV(A,X)135–22
	CNPH*3017A**	23,400	TDR&TXV	14.50		11.70	22,600	3.70	14,500	2.68	8.5	58CV(A,X)155–22
	CNPH*3017A**	23,400	TDR&TXV	14.50		11.70	22,600	3.68	14,600	2.66	8.5	58MVB040–14
	CNPH*3017A**	23,200	TDR&TXV	14.50		11.70	22,600	3.60	14,400	2.60	8.2	58MVB060–14
	CNPH*3017A**	23,200	TDR&TXV	14.50		11.70	22,600	3.60	14,400	2.62	8.2	58MVB080–14
	CNPH*3017A**	23,200	TDR&TXV	14.50		11.70	22,400	3.60	14,400	2.62	8.2	58MVB080–20
	CNPH*3017A**	23,400	TDR&TXV	14.50		11.70	22,400	3.60	14,400	2.62	8.2	58MVB100–20
	CNPH*3017A**	23,200	TDR&TXV	14.50		11.70	22,600	3.58	14,400	2.60	8.2	58MVB120–20
	CNPH*3017A**	23,400	TXV		13.20	10.80	22,000	3.38	15,200	2.52	8.0	
	CNPV*2414A**	23,000	TDR&TXV	14.00		11.50	24,000	3.74	14,400	2.60	8.4	58CV(A,X)070–12
	CNPV*2414A**	23,200	TXV		13.00	10.80	24,000	3.60	15,200	2.52	8.2	
	CNPV*2417A**	23,200	TDR&TXV	14.50		11.70	24,000	3.78	14,400	2.62	8.5	58CV(A,X)090–16
	CNPV*2417A**	23,000	TDR&TXV	14.00		11.50	24,000	3.76	14,400	2.60	8.4	58MVB060–14
	CNPV*2417A**	23,200	TXV		13.00	10.80	24,000	3.60	15,200	2.52	8.2	
	CNPV*3014A**	23,400	TDR&TXV	14.50		11.70	22,600	3.58	14,400	2.60	8.2	58CV(A,X)070–12
	CNPV*3014A**	23,400	TXV		13.20	11.00	22,000	3.38	15,200	2.52	8.0	
	CNPV*3017A**	23,400	TDR&TXV	14.50		11.70	22,400	3.60	14,400	2.62	8.3	58CV(A,X)090–16
	CNPV*3017A**	23,400	TDR&TXV	14.50		11.70	22,600	3.60	14,400	2.60	8.3	58MVB060–14
	CNPV*3017A**	23,400	TXV		13.20	10.80	22,000	3.36	15,200	2.52	8.0	
	CSPH*2412A**	23,000	TDR&TXV	14.50		11.70	23,600	3.70	14,500	2.60	8.4	58CV(A,X)070–12
	CSPH*2412A**	23,000	TDR&TXV	14.50		11.70	23,600	3.72	14,500	2.62	8.4	58CV(A,X)090–16
	CSPH*2412A**	23,200	TDR&TXV	14.00		11.50	23,600	3.70	14,500	2.60	8.4	58CV(A,X)110–20
	CSPH*2412A**	23,200	TDR&TXV	14.50		11.70	23,600	3.72	14,500	2.62	8.4	58CV(A,X)135–22
	CSPH*2412A**	23,400	TDR&TXV	14.50		11.70	23,800	3.80	14,600	2.68	8.6	58CV(A,X)155–22
	CSPH*2412A**	23,400	TDR&TXV	14.00		11.20	23,800	3.78	14,700	2.66	8.6	58MVB040–14
	CSPH*2412A**	23,200	TDR&TXV	14.50		11.70	23,600	3.70	14,500	2.60	8.4	58MVB060–14
	CSPH*2412A**	23,200	TDR&TXV	14.00		11.50	23,600	3.70	14,500	2.60	8.4	58MVB080–14
	CSPH*2412A**	23,200	TDR&TXV	14.50		11.70	23,600	3.70	14,500	2.60	8.4	58MVB080–20
	CSPH*2412A**	23,200	TDR&TXV	14.50		11.70	23,600	3.72	14,500	2.62	8.4	58MVB100–20
	CSPH*2412A**	23,000	TDR&TXV	14.00		11.50	23,800	3.68	14,500	2.60	8.4	58MVB120–20
	CSPH*2412A**	23,200	TXV		13.20	10.80	23,400	3.54	15,200	2.54	8.2	
	CSPH*3012A**	23,400	TDR&TXV	14.50		11.70	22,000	3.56	14,400	2.60	8.0	58CV(A,X)070–12
	CSPH*3012A**	23,400	TDR&TXV	14.50		11.70	22,000	3.60	14,400	2.62	8.0	58CV(A,X)090–16
	CSPH*3012A**	23,400	TDR&TXV	14.50		11.70	22,000	3.58	14,400	2.60	8.0	58CV(A,X)110–20
	CSPH*3012A**	23,400	TDR&TXV	14.50		11.70	22,000	3.58	14,400	2.62	8.0	58CV(A,X)135–22
	CSPH*3012A**	23,400	TDR&TXV	14.50		11.70	22,000	3.66	14,600	2.68	8.5	58CV(A,X)155–22
	CSPH*3012A**	23,400	TDR&TXV	14.50		11.70	22,000	3.66	14,600	2.66	8.5	58MVB040–14
	CSPH*3012A**	23,200	TDR&TXV	14.50		11.70	22,000	3.58	14,400	2.60	8.0	58MVB060–14
	CSPH*3012A**	23,200	TDR&TXV	14.50		11.70	22,000	3.58	14,500	2.60	8.0	58MVB080–14
	CSPH*3012A**	23,200	TDR&TXV	14.50		11.70	22,000	3.58	14,400	2.60	8.0	58MVB080–20
	CSPH*3012A**	23,400	TDR&TXV	14.50		11.70	22,000	3.58	14,400	2.62	8.0	58MVB100–20
	CSPH*3012A**	23,400	TDR&TXV	14.50		11.70	22,000	3.56	14,400	2.60	8.0	58MVB120–20
	CSPH*3012A**	23,200	TXV		13.20	11.00	21,400	3.34	15,200	2.52	7.8	
*FY4ANF030	30,000	TDR&TXV	13.00		10.60	30,000	3.46	21,000	2.48	8.3		
FE4ANF002	30,000	TDR&TXV	14.00		11.20	30,000	3.56	20,200	2.58	8.5		
FE4ANF003	30,000	TDR&TXV	14.50		11.50	30,000	3.56	20,000	2.58	8.5		
FE4ANF005	30,000	TDR&TXV	14.50		11.70	30,000	3.78	20,200	2.68	8.8		
FF1ENP030	29,800	TDR&TXV	13.00		10.50	30,000	3.42	21,000	2.46	8.2		
FF1ENP036	29,800	TDR&TXV	13.20		10.70	30,000	3.48	21,000	2.50	8.4		
FV4BNF002	30,000	TDR&TXV	14.00		11.20	30,000	3.56	20,200	2.58	8.5		
FV4BNF003	30,000	TDR&TXV	14.50		11.50	30,000	3.56	20,000	2.58	8.5		
FV4BNF005	30,000	TDR&TXV	14.50		11.70	30,000	3.78	20,200	2.68	8.8		
FX4CN(B,F)036	30,000	TDR&TXV	14.00		11.20	30,000	3.62	20,600	2.60	8.6		
FX4CNF030	30,000	TDR&TXV	14.00		11.20	30,000	3.58	20,600	2.56	8.5		
FY4ANF036	30,000	TDR&TXV	13.00		10.50	30,000	3.48	21,200	2.48	8.4		
CAP**3014A**	30,000	TDR&TXV	13.50		11.20	30,000	3.42	20,200	2.52	8.3	58CV(A,X)070–12	
CAP**3014A**	30,000	TXV		13.00	10.60	30,000	3.46	21,000	2.50	8.4		
CAP**3017A**	30,000	TDR&TXV	14.00		11.50	30,000	3.46	20,000	2.54	8.3	58CV(A,X)090–16	
CAP**3017A**	30,000	TDR&TXV	14.00		11.30	30,000	3.44	20,000	2.52	8.3	58MVB060–14	
CAP**3017A**	30,000	TXV		13.00	10.60	30,000	3.46	21,000	2.50	8.4		

See note on pg. 17

25HPA3

COMBINATION RATINGS CONTINUED

Unit Size — Series	Indoor Model	Cooling Capacity	ARI Standard Ratings									
			Cooling				Heating				Furnace Model	
			Factory Enhance	Standard Rating	SEER TDR	EER	High Temp		Low Temp			HSPF
E Capacity	E COP	H Capacity					H COP					
30–30												
	CAP**3614A**	29,000	TDR&TXV	13.50		11.20	29,000	3.46	20,200	2.52	8.3	58CV(A,X)070–12
	CAP**3614A**	29,000	TXV		13.00	10.60	29,000	3.50	21,000	2.50	8.4	
	CAP**3617A**	30,000	TDR&TXV	14.00		11.50	30,000	3.48	20,000	2.56	8.4	58CV(A,X)090–16
	CAP**3617A**	30,000	TDR&TXV	14.00		11.40	30,000	3.46	20,000	2.54	8.3	58MVB060–14
	CAP**3617A**	30,000	TXV		13.00	10.60	30,000	3.50	21,000	2.50	8.4	
	CAP**3621A**	30,000	TDR&TXV	14.00		11.60	30,000	3.52	20,000	2.56	8.4	58CV(A,X)110–20
	CAP**3621A**	30,000	TDR&TXV	14.00		11.50	30,000	3.48	20,000	2.56	8.4	58MVB080–14
	CAP**3621A**	30,000	TDR&TXV	14.00		11.40	30,000	3.48	20,000	2.54	8.4	58MVB080–20
	CAP**3621A**	30,000	TDR&TXV	14.00		11.50	30,000	3.48	20,000	2.56	8.4	58MVB100–20
	CAP**3621A**	30,000	TXV		13.00	10.60	30,000	3.50	21,000	2.50	8.4	
	CNPF*3618A**	30,000	TXV		13.00	10.60	30,000	3.48	21,200	2.50	8.4	
	CNPH*3017A**	30,000	TDR&TXV	13.50		11.20	30,000	3.44	20,200	2.52	8.3	58CV(A,X)070–12
	CNPH*3017A**	30,000	TDR&TXV	14.00		11.40	30,000	3.46	20,000	2.54	8.3	58CV(A,X)090–16
	CNPH*3017A**	30,000	TDR&TXV	14.00		11.40	30,000	3.48	20,200	2.54	8.4	58CV(A,X)110–20
	CNPH*3017A**	30,000	TDR&TXV	14.00		11.50	30,000	3.48	20,200	2.54	8.4	58CV(A,X)135–22
	CNPH*3017A**	30,000	TDR&TXV	14.00		11.50	30,000	3.50	20,000	2.56	8.4	58CV(A,X)155–22
	CNPH*3017A**	30,000	TDR&TXV	14.00		11.30	30,000	3.44	20,000	2.54	8.3	58MVB040–14
	CNPH*3017A**	30,000	TDR&TXV	13.50		11.30	30,000	3.44	20,000	2.52	8.3	58MVB060–14
	CNPH*3017A**	30,000	TDR&TXV	13.50		11.30	30,000	3.46	20,200	2.54	8.3	58MVB080–14
	CNPH*3017A**	30,000	TDR&TXV	13.50		11.30	30,000	3.46	20,000	2.54	8.3	58MVB080–20
	CNPH*3017A**	30,000	TDR&TXV	14.00		11.40	30,000	3.46	20,000	2.54	8.3	58MVB100–20
	CNPH*3017A**	30,000	TDR&TXV	14.00		11.40	30,000	3.44	81,000	4.92	8.6	58MVB120–20
	CNPH*3017A**	30,000	TXV		13.00	10.60	30,000	3.48	21,000	2.50	8.4	
	CNPH*3617A**	30,000	TDR&TXV	13.50		11.20	30,000	3.44	20,200	2.52	8.3	58CV(A,X)070–12
	CNPH*3617A**	30,000	TDR&TXV	14.00		11.40	30,000	3.46	20,000	2.54	8.3	58CV(A,X)090–16
	CNPH*3617A**	30,000	TDR&TXV	14.00		11.40	30,000	3.48	20,200	2.54	8.4	58CV(A,X)110–20
	CNPH*3617A**	30,000	TDR&TXV	14.00		11.50	30,000	3.48	20,200	2.54	8.4	58CV(A,X)135–22
	CNPH*3617A**	30,000	TDR&TXV	14.00		11.50	30,000	3.50	20,000	2.56	8.4	58CV(A,X)155–22
	CNPH*3617A**	30,000	TDR&TXV	14.00		11.30	30,000	3.44	20,000	2.54	8.3	58MVB040–14
	CNPH*3617A**	30,000	TDR&TXV	13.50		11.20	30,000	3.44	20,200	2.52	8.3	58MVB060–14
	CNPH*3617A**	30,000	TDR&TXV	13.50		11.20	30,000	3.46	20,200	2.52	8.3	58MVB080–14
	CNPH*3617A**	30,000	TDR&TXV	13.50		11.20	30,000	3.46	20,200	2.52	8.3	58MVB080–20
	CNPH*3617A**	30,000	TDR&TXV	14.00		11.40	30,000	3.46	20,200	2.54	8.3	58MVB100–20
	CNPH*3617A**	30,000	TDR&TXV	14.00		11.40	30,000	3.44	20,000	2.54	8.3	58MVB120–20
	CNPH*3617A**	30,000	TXV		13.00	10.60	30,000	3.48	21,200	2.50	8.4	
	CNPV*3014A**	30,000	TDR&TXV	13.50		11.20	30,000	3.44	20,200	2.52	8.3	58CV(A,X)070–12
	CNPV*3014A**	30,000	TXV		13.00	10.60	30,000	3.48	21,000	2.50	8.4	
	CNPV*3017A**	30,000	TDR&TXV	14.00		11.40	30,000	3.46	20,000	2.54	8.3	58CV(A,X)090–16
	CNPV*3017A**	30,000	TDR&TXV	13.50		11.20	30,000	3.44	20,000	2.52	8.3	58MVB060–14
	CNPV*3017A**	30,000	TXV		13.00	10.60	30,000	3.48	21,000	2.50	8.4	
	CNPV*3617A**	30,000	TDR&TXV	14.00		11.40	30,000	3.46	20,000	2.54	8.3	58CV(A,X)090–16
	CNPV*3617A**	30,000	TDR&TXV	13.50		11.20	30,000	3.44	20,000	2.52	8.3	58MVB060–14
	CNPV*3617A**	30,000	TXV		13.00	10.60	30,000	3.48	21,000	2.50	8.4	
	CNPV*3621A**	30,000	TDR&TXV	14.00		11.40	30,000	3.48	20,000	2.54	8.4	58CV(A,X)110–20
	CNPV*3621A**	30,000	TDR&TXV	13.50		11.20	30,000	3.46	20,200	2.54	8.3	58MVB080–14
	CNPV*3621A**	30,000	TDR&TXV	13.50		11.30	30,000	3.46	20,000	2.54	8.3	58MVB080–20
	CNPV*3621A**	30,000	TDR&TXV	14.00		11.40	30,000	3.46	20,000	2.54	8.3	58MVB100–20
	CNPV*3621A**	30,000	TXV		13.00	10.60	30,000	3.48	21,000	2.50	8.4	
	CSPH*3012A**	30,000	TDR&TXV	13.50		11.20	30,000	3.46	20,200	2.52	8.3	58CV(A,X)070–12
	CSPH*3012A**	30,000	TDR&TXV	14.00		11.40	30,000	3.48	20,200	2.54	8.4	58CV(A,X)090–16
	CSPH*3012A**	30,000	TDR&TXV	14.00		11.40	30,000	3.48	20,200	2.54	8.4	58CV(A,X)110–20
	CSPH*3012A**	30,000	TDR&TXV	14.00		11.50	30,000	3.48	20,200	2.56	8.4	58CV(A,X)135–22
	CSPH*3012A**	30,000	TDR&TXV	14.00		11.50	30,000	3.50	20,000	2.56	8.4	58CV(A,X)155–22
	CSPH*3012A**	30,000	TDR&TXV	13.50		11.30	30,000	3.46	20,200	2.54	8.3	58MVB040–14
	CSPH*3012A**	30,000	TDR&TXV	13.50		11.20	30,000	3.44	20,200	2.52	8.3	58MVB060–14
	CSPH*3012A**	30,000	TDR&TXV	13.50		11.20	30,000	3.46	20,200	2.54	8.3	58MVB080–14
	CSPH*3012A**	30,000	TDR&TXV	13.50		11.20	30,000	3.46	20,200	2.54	8.3	58MVB080–20
	CSPH*3012A**	30,000	TDR&TXV	14.00		11.40	30,000	3.48	20,200	2.54	8.4	58MVB100–20
	CSPH*3012A**	30,000	TDR&TXV	14.00		11.40	30,000	3.46	20,200	2.54	8.3	58MVB120–20
	CSPH*3012A**	30,000	TXV		13.00	10.60	30,000	3.50	21,200	2.50	8.4	
	CSPH*3612A**	30,000	TDR&TXV	14.00		11.50	30,000	3.58	20,400	2.58	8.5	58CV(A,X)070–12
	CSPH*3612A**	30,000	TDR&TXV	14.00		11.50	30,000	3.60	20,200	2.60	8.5	58CV(A,X)090–16
	CSPH*3612A**	30,000	TDR&TXV	14.00		11.50	30,000	3.62	20,200	2.60	8.5	58CV(A,X)110–20
	CSPH*3612A**	30,000	TDR&TXV	14.00		11.50	30,000	3.62	20,200	2.60	8.5	58CV(A,X)135–22
	CSPH*3612A**	30,000	TDR&TXV	14.50		11.50	30,000	3.62	20,200	2.62	8.6	58CV(A,X)155–22
	CSPH*3612A**	30,000	TDR&TXV	14.00		11.50	30,000	3.58	20,200	2.58	8.5	58MVB040–14

See note on pg. 17

COMBINATION RATINGS CONTINUED

Unit Size — Series	Indoor Model	Cooling Capacity	ARI Standard Ratings									Furnace Model
			Cooling				Heating					
			Factory Enhance	Standard Rating	SEER TDR	EER	High Temp		Low Temp		HSPF	
							E Capacity	E COP	H Capacity	H COP		
30—30	CSPH*3612A**	30,000	TDR&TXV	14.00		11.50	30,000	3.56	20,200	2.58	8.5	58MVB060—14
	CSPH*3612A**	30,000	TDR&TXV	14.00		11.50	30,000	3.58	20,400	2.58	8.5	58MVB080—14
	CSPH*3612A**	30,000	TDR&TXV	14.00		11.50	30,000	3.58	20,200	2.58	8.5	58MVB080—20
	CSPH*3612A**	30,000	TDR&TXV	14.00		11.50	30,000	3.60	20,200	2.60	8.5	58MVB100—20
	CSPH*3612A**	30,000	TDR&TXV	14.00		11.50	30,000	3.56	20,200	2.58	8.5	58MVB120—20
	CSPH*3612A**	30,000	TXV		13.20	10.80	30,000	3.62	21,200	2.56	8.5	
36—30	*FY4ANF042	36,400	TDR&TXV	13.00		10.80	37,600	3.44	24,400	2.44	8.0	
	FE4ANF002	35,600	TDR&TXV	13.50		11.20	36,200	3.36	23,400	2.46	7.7	
	FE4ANF003	35,800	TDR&TXV	14.00		11.50	35,800	3.38	23,200	2.48	7.7	
	FE4ANF005	37,500	TDR&TXV	14.50		11.70	36,000	3.62	23,400	2.58	8.2	
	FF1ENP036	35,600	TDR&TXV	13.00		10.80	36,600	3.26	23,800	2.40	7.7	
	FV4BNF002	35,600	TDR&TXV	13.50		11.20	36,200	3.36	23,400	2.46	7.7	
	FV4BNF003	35,800	TDR&TXV	14.00		11.50	35,800	3.38	23,200	2.48	7.7	
	FV4BNF005	37,500	TDR&TXV	14.50		11.70	36,000	3.62	23,400	2.58	8.2	
	FX4CN(B,F)036	36,400	TDR&TXV	13.50		11.20	36,600	3.46	23,600	2.50	7.9	
	FX4CN(B,F)042	37,000	TDR&TXV	14.00		11.50	37,000	3.60	23,800	2.56	8.2	
	FY4ANF036	35,200	TDR&TXV	13.00		10.50	36,600	3.24	23,800	2.38	7.7	
	CAP**3614A**	34,800	TDR&TXV	13.50		11.20	35,200	3.26	23,400	2.42	7.7	58CV(A,X)070—12
	CAP**3614A**	34,800	TXV		13.00	10.80	36,000	3.26	24,000	2.38	7.7	
	CAP**3617A**	35,600	TDR&TXV	13.50		11.20	35,800	3.30	23,200	2.44	7.7	58CV(A,X)090—16
	CAP**3617A**	35,400	TDR&TXV	13.50		11.20	35,800	3.28	23,200	2.44	7.7	58MVB060—14
	CAP**3617A**	35,800	TXV		13.00	10.80	37,000	3.32	24,200	2.40	7.7	
	CAP**3621A**	35,600	TDR&TXV	13.50		11.20	35,800	3.32	23,200	2.46	7.7	58CV(A,X)110—20
	CAP**3621A**	36,000	TDR&TXV	13.20		11.00	36,800	3.38	23,800	2.46	7.8	58MVB080—14
	CAP**3621A**	36,000	TDR&TXV	13.50		11.20	36,600	3.42	23,800	2.48	7.8	58MVB080—20
	CAP**3621A**	35,600	TDR&TXV	13.50		11.20	35,800	3.30	23,200	2.44	7.7	58MVB100—20
	CAP**3621A**	35,800	TXV		13.00	10.80	37,000	3.32	24,200	2.40	7.7	
	CAP**4221A**	35,800	TDR&TXV	14.00		11.50	37,600	3.36	24,200	2.42	7.8	58CV(A,X)110—20
	CAP**4221A**	36,200	TDR&TXV	13.50		11.20	36,800	3.48	23,800	2.50	7.8	58MVB080—14
	CAP**4221A**	36,400	TDR&TXV	13.50		11.20	36,000	3.36	23,200	2.46	8.0	58MVB080—20
	CAP**4221A**	35,800	TDR&TXV	13.50		11.20	36,000	3.38	23,200	2.48	7.8	58MVB100—20
	CAP**4221A**	36,000	TXV		13.00	10.80	37,600	3.40	24,200	2.42	7.8	
	CAP**4224A**	36,000	TDR&TXV	14.00		11.50	36,000	3.38	23,200	2.50	7.8	58CV(A,X)135—22
	CAP**4224A**	36,000	TDR&TXV	14.00		11.50	35,800	3.40	23,000	2.50	7.8	58CV(A,X)155—22
	CAP**4224A**	35,600	TDR&TXV	13.50		11.30	36,800	3.42	23,800	2.48	7.7	58MVB040—14
	CAP**4224A**	36,400	TDR&TXV	14.00		11.20	36,600	3.50	23,600	2.52	8.0	58MVB120—20
	CAP**4224A**	36,000	TXV		13.00	10.80	36,400	3.34	23,400	2.46	7.8	
	CNPF*3618A**	35,800	TXV		13.00	10.85	37,000	3.30	24,200	2.40	7.7	
	CNPH*3617A**	35,800	TDR&TXV	13.20		11.00	35,800	3.34	24,000	2.42	7.7	58CV(A,X)070—12
	CNPH*3617A**	35,600	TDR&TXV	13.50		11.20	35,800	3.40	23,600	2.46	7.8	58CV(A,X)090—16
	CNPH*3617A**	35,400	TDR&TXV	13.50		11.20	35,800	3.30	23,200	2.44	7.7	58CV(A,X)110—20
	CNPH*3617A**	35,400	TDR&TXV	13.50		11.20	35,800	3.28	23,200	2.44	7.7	58CV(A,X)135—22
	CNPH*3617A**	35,600	TDR&TXV	13.50		11.20	35,800	3.30	23,200	2.46	7.7	58CV(A,X)155—22
	CNPH*3617A**	35,200	TDR&TXV	13.20		11.00	36,400	3.26	23,600	2.42	7.5	58MVB040—14
	CNPH*3617A**	35,400	TDR&TXV	13.20		11.20	36,800	3.36	23,800	2.46	7.8	58MVB060—14
	CNPH*3617A**	35,800	TDR&TXV	13.00		11.00	36,800	3.32	24,000	2.42	7.7	58MVB080—14
	CNPH*3617A**	36,000	TDR&TXV	13.20		11.00	36,000	3.36	23,800	2.44	7.8	58MVB080—20
	CNPH*3617A**	35,400	TDR&TXV	13.50		11.20	36,000	3.28	23,200	2.42	7.7	58MVB100—20
	CNPH*3617A**	36,000	TDR&TXV	13.50		11.20	36,000	3.38	23,600	2.46	7.8	58MVB120—20
CNPH*3617A**	35,800	TXV		13.00	10.80	37,000	3.30	24,200	2.40	7.7		
CNPH*4221A**	36,000	TDR&TXV	13.50		11.20	36,000	3.50	23,800	2.50	8.0	58CV(A,X)070—12	
CNPH*4221A**	35,800	TDR&TXV	14.00		11.50	36,000	3.56	23,600	2.54	8.1	58CV(A,X)090—16	
CNPH*4221A**	35,800	TDR&TXV	14.00		11.50	36,000	3.42	23,200	2.52	7.8	58CV(A,X)110—20	
CNPH*4221A**	36,000	TDR&TXV	14.00		11.50	35,800	3.42	23,000	2.52	7.8	58CV(A,X)135—22	
CNPH*4221A**	36,000	TDR&TXV	14.50		11.70	35,800	3.44	23,000	2.52	7.9	58CV(A,X)155—22	
CNPH*4221A**	35,600	TDR&TXV	13.50		11.50	36,400	3.38	23,400	2.48	7.8	58MVB040—14	
CNPH*4221A**	36,200	TDR&TXV	13.50		11.20	36,800	3.52	23,600	2.54	8.0	58MVB060—14	
CNPH*4221A**	36,200	TDR&TXV	13.50		11.20	36,800	3.50	23,800	2.50	8.0	58MVB080—14	
CNPH*4221A**	36,400	TDR&TXV	13.50		11.20	36,000	3.50	23,600	2.52	8.0	58MVB080—20	
CNPH*4221A**	35,800	TDR&TXV	14.00		11.50	36,000	3.38	23,200	2.50	7.8	58MVB100—20	
CNPH*4221A**	36,400	TDR&TXV	14.00		11.50	36,000	3.54	23,400	2.54	8.1	58MVB120—20	
CNPH*4221A**	36,000	TXV		13.00	10.80	37,600	3.40	24,200	2.44	7.8		
CNPV*3617A**	35,600	TDR&TXV	13.50		11.20	35,800	3.38	23,600	2.46	7.8	58CV(A,X)090—16	
CNPV*3617A**	35,400	TDR&TXV	13.20		11.00	35,800	3.36	23,800	2.46	7.8	58MVB060—14	
CNPV*3617A**	35,800	TXV		13.00	10.80	37,000	3.30	24,200	2.40	7.7		
CNPV*3621A**	35,600	TDR&TXV	13.50		11.20	35,800	3.30	23,200	2.44	7.7	58CV(A,X)110—20	
CNPV*3621A**	35,800	TDR&TXV	13.00		11.00	36,800	3.32	23,800	2.42	7.7	58MVB080—14	

See note on pg. 17

COMBINATION RATINGS CONTINUED

Unit Size — Series	Indoor Model	Cooling Capacity	ARI Standard Ratings									Furnace Model	
			Cooling				Heating						
			Factory Enhance	Standard Rating	SEER TDR	EER	High Temp		Low Temp		HSPF		
E Capacity	E COP	H Capacity					H COP						
36—30	CNPV*3621A**	36,000	TDR&TXV	13.20		11.00	36,600	3.36	23,800	2.46	7.8	58MVB080—20	
	CNPV*3621A**	35,400	TDR&TXV	13.50		11.20	35,800	3.28	23,200	2.44	7.7	58MVB100—20	
	CNPV*3621A**	35,800	TXV		13.00	10.80	37,000	3.30	24,200	2.40	7.7		
	CNPV*4221A**	35,800	TDR&TXV	14.00		11.50	36,000	3.42	23,200	2.52	7.8	58CV(A,X)110—20	
	CNPV*4221A**	36,200	TDR&TXV	13.50		11.20	36,800	3.50	23,800	2.50	8.0	58MVB080—14	
	CNPV*4221A**	36,400	TDR&TXV	13.50		11.20	36,000	3.52	23,600	2.52	8.0	58MVB080—20	
	CNPV*4221A**	35,800	TDR&TXV	14.00		11.50	36,000	3.38	23,200	2.50	7.8	58MVB100—20	
	CNPV*4221A**	36,000	TXV		13.00	10.80	37,600	3.40	24,200	2.44	7.8		
	CSPH*3612A**	35,800	TDR&TXV	13.50		11.20	35,800	3.54	24,000	2.50	8.0	58CV(A,X)070—12	
	CSPH*3612A**	35,600	TDR&TXV	14.00		11.50	35,800	3.60	23,800	2.56	8.1	58CV(A,X)090—16	
	CSPH*3612A**	35,400	TDR&TXV	14.00		11.50	35,800	3.44	23,400	2.52	7.9	58CV(A,X)110—20	
	CSPH*3612A**	35,400	TDR&TXV	14.00		11.50	35,800	3.44	23,400	2.52	7.9	58CV(A,X)135—22	
	CSPH*3612A**	35,400	TDR&TXV	14.00		11.50	35,800	3.46	23,200	2.54	7.9	58CV(A,X)155—22	
	CSPH*3612A**	35,200	TDR&TXV	13.50		11.50	36,400	3.44	23,600	2.48	7.8	58MVB040—14	
	CSPH*3612A**	35,400	TDR&TXV	13.50		11.20	36,800	3.56	23,800	2.52	8.1	58MVB060—14	
	CSPH*3612A**	35,800	TDR&TXV	13.50		11.20	36,800	3.52	24,000	2.50	8.0	58MVB080—14	
	CSPH*3612A**	36,000	TDR&TXV			11.20	37,000	3.54	24,000	2.52	8.1	58MVB080—20	
	CSPH*3612A**	35,400	TDR&TXV	14.00		11.50	36,000	3.42	23,400	2.50	7.8	58MVB100—20	
	CSPH*3612A**	36,000	TDR&TXV	13.50		11.20	36,000	3.58	23,800	2.54	8.1	58MVB120—20	
	CSPH*3612A**	35,800	TXV		13.00	10.80	37,600	3.48	24,400	2.46	7.9		
	CSPH*4212A**	36,000	TDR&TXV	13.50		11.20	36,000	3.60	24,000	2.52	8.2	58CV(A,X)070—12	
	CSPH*4212A**	35,800	TDR&TXV	14.00		11.50	36,000	3.66	23,800	2.58	8.3	58CV(A,X)090—16	
	CSPH*4212A**	35,800	TDR&TXV	14.00		11.50	36,000	3.50	23,400	2.54	8.0	58CV(A,X)110—20	
	CSPH*4212A**	36,000	TDR&TXV	14.00		11.50	35,800	3.50	23,400	2.54	8.0	58CV(A,X)135—22	
	CSPH*4212A**	36,000	TDR&TXV	14.00		11.50	35,800	3.52	23,200	2.56	8.0	58CV(A,X)155—22	
	CSPH*4212A**	35,600	TDR&TXV	13.50		11.50	36,400	3.50	23,600	2.50	8.0	58MVB040—14	
	CSPH*4212A**	36,200	TDR&TXV	13.50		11.20	36,800	3.64	24,000	2.56	8.2	58MVB060—14	
	CSPH*4212A**	36,200	TDR&TXV	13.50		11.20	37,600	3.58	24,000	2.52	8.1	58MVB080—14	
	CSPH*4212A**	36,400	TDR&TXV	13.50		11.20	36,000	3.62	24,000	2.54	8.2	58MVB080—20	
	CSPH*4212A**	35,800	TDR&TXV	14.00		11.50	36,000	3.46	23,400	2.52	7.9	58MVB100—20	
	CSPH*4212A**	36,400	TDR&TXV	14.00		11.50	36,000	3.64	23,800	2.56	8.2	58MVB120—20	
	CSPH*4212A**	36,000	TXV		13.20	11.00	37,600	3.54	24,400	2.48	8.0		
		*FY4ANF042	41,500	TDR&TXV	13.00		10.8	42,000	3.48	28,600	2.56	8.1	
		FE4ANB006	42,000	TDR&TXV	14.50		11.70	42,000	3.70	27,400	2.80	8.7	
		FE4ANF003	41,000	TDR&TXV	14.00		11.50	42,000	3.40	27,200	2.60	8.0	
		FE4ANF005	42,000	TDR&TXV	14.50		11.70	42,000	3.66	27,400	2.74	8.5	
		FV4BNB006	42,000	TDR&TXV	14.50		11.70	42,000	3.70	27,400	2.80	8.7	
		FV4BNF003	41,000	TDR&TXV	14.00		11.50	42,000	3.40	27,200	2.60	8.0	
	FV4BNF005	42,000	TDR&TXV	14.50		11.70	42,000	3.66	27,400	2.74	8.5		
	FX4CN(B,F)042	42,000	TDR&TXV	13.50		11.20	42,000	3.62	28,000	2.68	8.4		
	FX4CN(B,F)048	42,000	TDR&TXV	14.50		11.50	42,000	3.70	27,800	2.76	8.7		
	FY4ANF048	42,000	TDR&TXV	13.20		11.20	42,000	3.50	28,600	2.62	8.2		
	CAP**4221A**	41,000	TDR&TXV	13.50		11.20	42,000	3.42	27,400	2.62	8.1	58CV(A,X)110—20	
	CAP**4221A**	40,500	TDR&TXV	13.50		11.20	42,000	3.34	27,400	2.56	7.8	58MVB080—14	
	CAP**4221A**	41,000	TDR&TXV	13.50		11.20	42,000	3.38	27,400	2.58	8.0	58MVB080—20	
	CAP**4221A**	41,000	TDR&TXV	13.50		11.20	42,000	3.40	27,400	2.60	8.0	58MVB100—20	
	CAP**4221A**	41,000	TXV		13.00	10.80	42,000	3.44	28,400	2.56	8.1		
	CAP**4224A**	41,000	TDR&TXV	14.00		11.50	42,000	3.44	27,200	2.64	8.1	58CV(A,X)135—22	
	CAP**4224A**	41,000	TDR&TXV	14.00		11.50	42,000	3.44	27,200	2.64	8.1	58CV(A,X)155—22	
	CAP**4224A**	40,500	TDR&TXV	13.50		11.20	42,000	3.36	27,400	2.56	7.9	58MVB040—14	
	CAP**4224A**	41,000	TDR&TXV	13.50		11.20	42,000	3.38	27,200	2.60	8.0	58MVB120—20	
	CAP**4224A**	41,000	TXV		13.00	10.80	42,000	3.44	28,400	2.56	8.0		
	CAP**4817A**	40,500	TDR&TXV	14.00		11.50	41,000	3.62	27,600	2.68	8.4	58CV(A,X)090—16	
	CAP**4817A**	40,500	TDR&TXV	14.00		11.50	41,000	3.58	27,600	2.66	8.4	58MVB060—14	
	CAP**4817A**	41,000	TXV		13.20	11.00	41,000	3.60	28,600	2.64	8.2		
	CAP**4821A**	41,500	TDR&TXV	14.00		11.50	42,000	3.60	27,400	2.68	8.4	58CV(A,X)110—20	
	CAP**4821A**	41,500	TDR&TXV	13.50		11.20	42,000	3.50	27,600	2.62	8.2	58MVB080—14	
	CAP**4821A**	41,500	TDR&TXV	13.50		11.20	42,000	3.54	27,600	2.64	8.3	58MVB080—20	
	CAP**4821A**	41,500	TDR&TXV	14.00		11.50	42,000	3.56	27,600	2.66	8.3	58MVB100—20	
	CAP**4821A**	42,000	TXV		13.20	11.00	42,000	3.56	28,600	2.62	8.2		
	CAP**4824A**	42,000	TDR&TXV	14.50		11.70	42,000	3.62	27,400	2.70	8.4	58CV(A,X)135—22	
	CAP**4824A**	42,000	TDR&TXV	14.50		11.70	42,000	3.62	27,400	2.70	8.4	58CV(A,X)155—22	
	CAP**4824A**	41,500	TDR&TXV	13.50		11.20	42,000	3.52	27,600	2.62	8.2	58MVB040—14	
	CAP**4824A**	41,500	TDR&TXV	14.00		11.50	42,000	3.56	27,400	2.66	8.3	58MVB120—20	
	CAP**4824A**	42,000	TXV		13.20	11.00	42,000	3.56	28,600	2.62	8.2		
	CNPF*4818A**	41,000	TXV		13.20	11.00	42,000	3.52	28,600	2.60	8.2		
	CNPH*4221A**	41,000	TDR&TXV	13.50		11.20	42,000	3.38	27,400	2.60	8.0	58CV(A,X)070—12	
	CNPH*4221A**	41,000	TDR&TXV	14.00		11.50	42,000	3.44	27,200	2.62	8.1	58CV(A,X)090—16	
	CNPH*4221A**	41,000	TDR&TXV	14.00		11.50	42,000	3.46	27,200	2.66	8.2	58CV(A,X)110—20	

See note on pg. 17

COMBINATION RATINGS CONTINUED

Unit Size – Series	Indoor Model	Cooling Capacity	ARI Standard Ratings									Furnace Model
			Cooling				Heating					
			Factory Enhance	Standard Rating	SEER TDR	EER	High Temp		Low Temp		HSPF	
E Capacity	E COP	H Capacity					H COP					
42–30	CNPH*4221A**	41,000	TDR&TXV	14.50		11.70	42,000	3.48	27,000	2.66	8.2	58CV(A,X)135–22
	CNPH*4221A**	41,000	TDR&TXV	14.50		11.70	42,000	3.48	27,000	2.66	8.2	58CV(A,X)155–22
	CNPH*4221A**	40,500	TDR&TXV	13.50		11.20	42,000	3.38	27,400	2.60	8.0	58MVB040–14
	CNPH*4221A**	41,000	TDR&TXV	14.00		11.50	42,000	3.40	27,200	2.62	8.0	58MVB060–14
	CNPH*4221A**	40,500	TDR&TXV	13.50		11.20	42,000	3.38	27,400	2.60	8.0	58MVB080–14
	CNPH*4221A**	41,000	TDR&TXV	14.00		11.50	42,000	3.40	27,400	2.60	8.0	58MVB080–20
	CNPH*4221A**	41,000	TDR&TXV	14.00		11.50	42,000	3.44	27,200	2.64	8.1	58MVB100–20
	CNPH*4221A**	41,000	TDR&TXV	14.00		11.50	42,000	3.42	27,200	2.62	8.1	58MVB120–20
	CNPH*4221A**	41,000	TXV		13.00	10.80	42,000	3.46	28,400	2.56	8.0	
	CNPH*4821A**	41,500	TDR&TXV	13.50		11.20	42,000	3.54	27,800	2.64	8.3	58CV(A,X)070–12
	CNPH*4821A**	41,500	TDR&TXV	14.00		11.50	42,000	3.60	27,400	2.68	8.3	58CV(A,X)090–16
	CNPH*4821A**	41,500	TDR&TXV	14.00		11.50	42,000	3.62	27,400	2.68	8.4	58CV(A,X)110–20
	CNPH*4821A**	42,000	TDR&TXV	14.50		11.70	42,000	3.64	27,400	2.70	8.4	58CV(A,X)135–22
	CNPH*4821A**	42,000	TDR&TXV	14.50		11.70	42,000	3.62	27,400	2.70	8.4	58CV(A,X)155–22
	CNPH*4821A**	41,500	TDR&TXV	13.50		11.20	42,000	3.54	27,600	2.64	8.3	58MVB040–14
	CNPH*4821A**	41,500	TDR&TXV	14.00		11.50	42,000	3.56	27,600	2.66	8.3	58MVB060–14
	CNPH*4821A**	41,500	TDR&TXV	13.50		11.20	42,000	3.52	27,600	2.62	8.2	58MVB080–14
	CNPH*4821A**	41,500	TDR&TXV	14.00		11.50	42,000	3.56	27,600	2.66	8.3	58MVB080–20
	CNPH*4821A**	41,500	TDR&TXV	14.00		11.50	42,000	3.58	27,600	2.66	8.3	58MVB100–20
	CNPH*4821A**	41,500	TDR&TXV	14.00		11.50	42,000	3.58	27,400	2.66	8.3	58MVB120–20
	CNPH*4821A**	42,000	TXV		13.20	11.00	42,000	3.58	28,600	2.62	8.2	
	CNPV*4221A**	41,000	TDR&TXV	14.00		11.50	42,000	3.46	27,200	2.66	8.2	58CV(A,X)110–20
	CNPV*4221A**	40,500	TDR&TXV	13.50		11.20	42,000	3.38	27,400	2.60	8.0	58MVB080–14
	CNPV*4221A**	41,000	TDR&TXV	13.50		11.20	42,000	3.40	27,400	2.60	8.0	58MVB080–20
	CNPV*4221A**	41,000	TDR&TXV	14.00		11.50	42,000	3.44	27,200	2.64	8.1	58MVB100–20
	CNPV*4221A**	41,000	TXV		13.00	10.80	42,000	3.46	28,400	2.56	8.0	
	CNPV*4821A**	41,500	TDR&TXV	14.00		11.50	42,000	3.62	27,400	2.68	8.4	58CV(A,X)110–20
	CNPV*4821A**	41,500	TDR&TXV	13.50		11.20	42,000	3.52	27,600	2.62	8.2	58MVB080–14
	CNPV*4821A**	41,500	TDR&TXV	14.00		11.50	42,000	3.56	27,600	2.66	8.3	58MVB080–20
	CNPV*4821A**	41,500	TDR&TXV	14.00		11.50	42,000	3.58	27,600	2.66	8.3	58MVB100–20
	CNPV*4821A**	42,000	TXV		13.20	11.00	42,000	3.58	28,600	2.62	8.2	
	CNPV*4824A**	42,000	TDR&TXV	14.00		11.50	42,000	3.64	27,400	2.70	8.4	58CV(A,X)135–22
	CNPV*4824A**	42,000	TDR&TXV	14.00		11.50	42,000	3.62	27,400	2.70	8.4	58CV(A,X)155–22
	CNPV*4824A**	41,500	TDR&TXV	13.50		11.20	42,000	3.54	27,600	2.64	8.3	58MVB040–14
	CNPV*4824A**	41,500	TDR&TXV	14.00		11.50	42,000	3.58	27,400	2.66	8.3	58MVB120–20
	CNPV*4824A**	42,000	TXV		13.20	11.00	42,000	3.58	28,600	2.62	8.2	
	CSPH*4212A**	41,000	TDR&TXV	13.50		11.20	42,000	3.54	27,800	2.62	8.3	58CV(A,X)070–12
	CSPH*4212A**	41,000	TDR&TXV	14.00		11.50	42,000	3.58	27,600	2.68	8.3	58CV(A,X)090–16
	CSPH*4212A**	41,000	TDR&TXV	14.00		11.50	42,000	3.60	27,600	2.68	8.3	58CV(A,X)110–20
	CSPH*4212A**	41,000	TDR&TXV	14.50		11.70	42,000	3.62	27,400	2.70	8.4	58CV(A,X)135–22
	CSPH*4212A**	41,000	TDR&TXV	14.50		11.70	42,000	3.62	27,400	2.70	8.4	58CV(A,X)155–22
	CSPH*4212A**	40,500	TDR&TXV	13.50		11.20	42,000	3.52	27,800	2.62	8.2	58MVB040–14
	CSPH*4212A**	41,000	TDR&TXV	14.00		11.50	42,000	3.56	27,600	2.66	8.3	58MVB060–14
	CSPH*4212A**	41,000	TDR&TXV	13.50		11.20	42,000	3.52	27,800	2.62	8.2	58MVB080–14
	CSPH*4212A**	41,000	TDR&TXV	14.00		11.50	42,000	3.56	27,600	2.64	8.3	58MVB080–20
	CSPH*4212A**	41,000	TDR&TXV	14.00		11.50	42,000	3.58	27,600	2.66	8.3	58MVB100–20
	CSPH*4212A**	41,000	TDR&TXV	14.00		11.50	42,000	3.56	27,600	2.66	8.3	58MVB120–20
	CSPH*4212A**	41,000	TXV		13.20	11.00	42,000	3.58	28,600	2.62	8.2	
	CSPH*4812A**	41,500	TDR&TXV	13.50		11.20	42,000	3.56	27,800	2.64	8.3	58CV(A,X)070–12
	CSPH*4812A**	41,500	TDR&TXV	14.00		11.50	42,000	3.62	27,600	2.68	8.4	58CV(A,X)090–16
	CSPH*4812A**	41,500	TDR&TXV	14.00		11.50	42,000	3.64	27,600	2.68	8.4	58CV(A,X)110–20
	CSPH*4812A**	42,000	TDR&TXV	14.00		11.50	42,000	3.66	27,400	2.70	8.5	58CV(A,X)135–22
	CSPH*4812A**	42,000	TDR&TXV	14.00		11.50	42,000	3.66	27,400	2.70	8.5	58CV(A,X)155–22
	CSPH*4812A**	41,500	TDR&TXV	13.50		11.20	42,000	3.56	27,800	2.64	8.3	58MVB040–14
	CSPH*4812A**	41,500	TDR&TXV	14.00		11.50	42,000	3.60	27,600	2.66	8.4	58MVB060–14
	CSPH*4812A**	41,500	TDR&TXV	13.50		11.20	42,000	3.54	27,800	2.64	8.3	58MVB080–14
	CSPH*4812A**	41,500	TDR&TXV	14.00		11.50	42,000	3.60	27,800	2.66	8.3	58MVB080–20
	CSPH*4812A**	41,500	TDR&TXV	14.00		11.50	42,000	3.60	27,600	2.68	8.4	58MVB100–20
	CSPH*4812A**	41,500	TDR&TXV	14.00		11.50	42,000	3.60	27,600	2.68	8.4	58MVB120–20
	CSPH*4812A**	42,000	TXV		13.20	11.00	42,000	3.62	28,600	2.64	8.2	
*FY4ANF048	47,000	TDR&TXV	13.00		10.80	48,000	3.58	31,000	2.54	8.1		
FE4ANB006	47,500	TDR&TXV	15.00		12.00	47,000	3.80	29,600	2.70	8.4		
FE4ANF005	47,000	TDR&TXV	14.50		11.70	47,000	3.68	29,600	2.64	8.2		
FV4BNB006	47,500	TDR&TXV	15.00		12.00	47,000	3.80	29,600	2.70	8.4		
FV4BNF005	47,000	TDR&TXV	14.50		11.70	47,000	3.68	29,600	2.64	8.2		
FX4CN(B,F)048	47,500	TDR&TXV	14.00		11.50	48,000	3.76	30,200	2.66	8.3		
FX4CN(B,F)060	48,500	TDR&TXV	14.50		11.70	48,000	3.94	30,200	2.72	8.6		
FY4ANB060	47,500	TDR&TXV	13.50		11.00	49,000	3.72	31,200	2.58	8.2		
CAP**4817A**	45,000	TDR&TXV	13.50		11.20	47,000	3.58	30,000	2.58	8.0	58CV(A,X)090–16	
CAP**4817A**	45,000	TXV		13.00	10.80	47,500	3.56	30,400	2.54	8.0		

See note on pg. 17

25HPA3

See note on pg. 17

COMBINATION RATINGS CONTINUED

Unit Size — Series	Indoor Model	Cooling Capacity	ARI Standard Ratings									Furnace Model
			Cooling				Heating					
			Factory Enhance	Standard Rating	SEER TDR	EER	High Temp		Low Temp		HSPF	
							E Capacity	E COP	H Capacity	H COP		
60–30	*FY4ANB060	59,500	TDR&TXV	13.00		10.60	60,500	3.56	37,800	2.52	8.0	
	FE4ANB006	59,500	TDR&TXV	14.00		11.50	59,000	3.70	36,000	2.62	8.3	
	FV4BNB006	59,500	TDR&TXV	14.00		11.50	59,000	3.70	36,000	2.62	8.3	
	CAP**6021A**	58,500	TXV		13.00	10.80	59,000	3.52	36,600	2.52	8.0	
	CAP**6021A**	58,000	TDR&TXV	13.50		11.30	58,500	3.54	36,400	2.54	8.0	58CV(A,X)110–20
	CAP**6024A**	59,500	TXV		13.00	10.80	60,000	3.60	37,200	2.56	8.2	
	CAP**6024A**	58,500	TDR&TXV	13.50		11.20	59,000	3.56	36,200	2.56	8.0	58CV(A,X)135–22
	CAP**6024A**	59,000	TDR&TXV	13.50		11.20	58,500	3.58	36,000	2.58	8.1	58CV(A,X)155–22
	CNPV*6024A**	59,500	TXV		13.00	10.80	60,000	3.60	37,000	2.54	8.1	
	CNPV*6024A**	58,500	TDR&TXV	13.50		11.20	59,000	3.52	36,000	2.54	7.9	58CV(A,X)135–22
	CNPV*6024A**	58,500	TDR&TXV	13.50		11.20	59,000	3.56	36,000	2.56	8.0	58CV(A,X)155–22
	CNPH*6024A**	59,000	TXV		13.00	10.80	60,000	3.60	37,000	2.54	8.1	
	CNPH*6024A**	58,500	TDR&TXV	13.50		11.10	59,000	3.50	36,200	2.52	8.1	58CV(A,X)110–20
	CNPH*6024A**	58,500	TDR&TXV	13.50		11.20	59,000	3.52	36,000	2.54	8.0	58CV(A,X)135–22
	CNPH*6024A**	58,500	TDR&TXV	13.50		11.20	58,500	3.56	36,000	2.56	8.0	58CV(A,X)155–22
CSPH*6012A**	59,000	TXV		13.00	10.80	60,000	3.66	37,200	2.56	8.2		
CSPH*6012A**	58,500	TDR&TXV	13.50		11.20	59,500	3.58	36,400	2.56	8.1	58CV(A,X)110–20	
CSPH*6012A**	58,500	TDR&TXV	13.50		11.20	59,000	3.62	36,200	2.58	8.2	58CV(A,X)135–22	
CSPH*6012A**	58,500	TDR&TXV	13.50		11.20	58,500	3.64	36,000	2.60	8.2	58CV(A,X)155–22	

* Ratings are net values reflecting the effects of circulating fan heat. Supplemental electric heat is not included. Ratings are based on:

Cooling Standard: 80°F (27°C) db 67°F (19°C) wb indoor entering air temperature and 95°F (35°C) db air entering outdoor unit.

High–Temp Heating Standard: 70°F (21°C) db indoor entering air temperature and 47°F (8°C) db 43°F (6°C) wb air entering outdoor unit.

Low–Temp Heating Standard: 70°F (21°C) db indoor entering air temperature and 17°F (±9°C) db 15°F (±10°C) wb air entering outdoor unit.

SEER — Seasonal Energy Efficiency Ratio

COP — Coefficient of Performance

TDR — Time–Delay Relay

HSPF — Heating Seasonal Performance Factor

EER — Energy Efficiency Ratio

25HPA3

DETAILED COOLING CAPACITIES

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																					
		75				85				95				105				115				125	
CFM	EWB	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**				
		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		
25HPA318A30 Outdoor Section With FY4ANF018 Indoor Section																							
525	72	24.30	12.55	1.08	23.10	12.08	1.23	21.88	11.61	1.39	20.61	11.13	1.58	19.27	10.62	1.78	17.85	10.10	2.02				
	67	22.00	15.34	1.10	20.89	14.87	1.24	19.76	14.38	1.41	18.58	13.88	1.59	17.35	13.37	1.80	16.04	12.83	2.04				
	63	20.35	14.80	1.11	19.32	14.32	1.26	18.25	13.83	1.42	17.15	13.33	1.61	15.99	12.82	1.82	14.77	12.27	2.05				
	62	19.94	18.13	1.11	18.93	17.63	1.26	17.90	17.11	1.42	16.85	16.56	1.61	15.82	15.82	1.82	14.85	14.85	2.05				
	57	19.21	19.21	1.12	18.42	18.42	1.26	17.60	17.60	1.43	16.74	16.74	1.61	15.83	15.83	1.82	14.85	14.85	2.05				
600	72	24.85	13.18	1.09	23.61	12.70	1.23	22.33	12.22	1.40	21.00	11.73	1.58	19.61	11.22	1.79	18.14	10.68	2.02				
	67	22.50	16.33	1.10	21.35	15.84	1.25	20.17	15.35	1.42	18.94	14.84	1.60	17.66	14.31	1.81	16.31	13.76	2.04				
	63	20.83	15.73	1.12	19.74	15.24	1.26	18.63	14.74	1.43	17.48	14.23	1.61	16.28	13.70	1.82	15.02	13.14	2.06				
	62	20.44	19.44	1.12	19.41	18.90	1.27	18.35	18.35	1.43	17.42	17.42	1.61	16.46	16.46	1.82	15.42	15.42	2.05				
	57	20.06	20.06	1.12	19.21	19.21	1.27	18.34	18.34	1.43	17.42	17.42	1.61	16.46	16.46	1.82	15.42	15.42	2.05				
675	72	25.29	13.77	1.09	24.00	13.28	1.24	22.68	12.80	1.41	21.31	12.30	1.59	19.88	11.78	1.80	18.37	11.24	2.03				
	67	22.90	17.27	1.11	21.70	16.78	1.26	20.48	16.27	1.42	19.22	15.75	1.61	17.90	15.21	1.82	16.52	14.64	2.05				
	63	21.20	16.61	1.12	20.08	16.11	1.27	18.93	15.60	1.44	17.75	15.08	1.62	16.51	14.53	1.83	15.22	13.95	2.07				
	62	20.89	20.60	1.13	19.88	19.88	1.27	18.96	18.96	1.44	18.00	18.00	1.62	16.99	16.99	1.83	15.90	15.90	2.06				
	57	20.78	20.78	1.13	19.89	19.89	1.27	18.97	18.97	1.44	18.00	18.00	1.62	16.99	16.99	1.83	15.91	15.91	2.06				

25HPA3

Cooling Indoor Model	Capacity	Power	Furnace Model
*FY4ANF018	1.00	1.00	
FE4ANF002	1.03	0.89	
FF1ENP018	1.00	0.98	
FF1ENP024	1.02	0.98	
FX4CNF018	1.02	0.92	
FX4CNF024	1.03	0.93	
FY4ANF024	1.01	0.99	
CAP**1814A**	1.00	1.00	
CAP**2414A**	1.02	1.02	
CAP**2417A**	1.02	1.02	
CNPF*2418A**	1.02	1.02	
CNPH*2417A**	1.02	1.02	
CNPV*1814A**	1.00	1.00	
CNPV*2414A**	1.02	1.02	
CNPV*2417A**	1.02	1.02	
CSPH*2412A**	1.02	1.02	

Cooling Indoor Model	Capacity	Power	Furnace Model
CAP**1814A**	0.99	0.92	58CV(A,X)070-12
CAP**2414A**	1.01	0.91	58CV(A,X)070-12
CNPH*2417A**	1.01	0.91	58CV(A,X)070-12
CNPV*1814A**	0.99	0.92	58CV(A,X)070-12
CNPV*2414A**	1.01	0.91	58CV(A,X)070-12
CSPH*2412A**	1.01	0.91	58CV(A,X)070-12
CAP**2417A**	1.02	0.92	58CV(A,X)090-16
CNPH*2417A**	1.02	0.92	58CV(A,X)090-16
CNPV*2417A**	1.02	0.92	58CV(A,X)090-16
CSPH*2412A**	1.02	0.92	58CV(A,X)090-16
CNPH*2417A**	1.01	0.93	58MVB040-14
CSPH*2412A**	1.01	0.92	58MVB040-14
CAP**2417A**	1.02	0.92	58MVB060-14
CNPH*2417A**	1.01	0.91	58MVB060-14
CNPV*2417A**	1.02	0.92	58MVB060-14
CSPH*2412A**	1.01	0.91	58MVB060-14

See notes on pg. 24

DETAILED COOLING CAPACITIES CONTINUED

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																	
		75			85			95			105			115			125		
		Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**	Capacity MBtu/h†		Total System KW**
Total	Sens†	Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†		Total	Sens†	
25HPA324A30 Outdoor Section With FY4ANF024 Indoor Section																			
700	72	27.51	14.02	1.68	26.23	13.52	1.88	24.90	13.01	2.11	23.50	12.47	2.36	22.00	11.91	2.64	20.37	11.30	2.94
	67	25.06	17.33	1.68	23.88	16.82	1.88	22.63	16.29	2.11	21.33	15.73	2.36	19.94	15.15	2.64	18.45	14.53	2.94
	63	23.27	16.76	1.68	22.15	16.24	1.88	20.98	15.70	2.11	19.75	15.14	2.36	18.44	14.55	2.64	17.04	13.93	2.94
	62	22.81	20.62	1.68	21.72	20.07	1.88	20.59	19.50	2.11	19.41	18.88	2.36	18.18	18.18	2.64	17.04	17.04	2.94
	57	21.95	21.95	1.68	21.09	21.09	1.88	20.17	20.17	2.11	19.21	19.21	2.36	18.17	18.17	2.64	17.05	17.05	2.94
800	72	28.00	14.63	1.71	26.68	14.13	1.92	25.29	13.60	2.14	23.84	13.06	2.39	22.29	12.49	2.67	20.60	11.87	2.97
	67	25.52	18.36	1.71	24.29	17.84	1.92	23.00	17.30	2.14	21.65	16.73	2.40	20.21	16.14	2.67	18.66	15.50	2.97
	63	23.71	17.72	1.71	22.55	17.19	1.92	21.33	16.64	2.14	20.05	16.07	2.40	18.70	15.47	2.68	17.25	14.83	2.98
	62	23.28	22.00	1.71	22.17	21.41	1.92	21.02	20.76	2.14	19.89	19.89	2.40	18.80	18.80	2.67	17.61	17.61	2.98
	57	22.80	22.80	1.71	21.88	21.88	1.92	20.92	20.92	2.14	19.90	19.90	2.40	18.80	18.80	2.67	17.61	17.61	2.98
900	72	28.36	15.21	1.75	27.00	14.70	1.95	25.58	14.17	2.18	24.08	13.62	2.43	22.49	13.04	2.71	20.76	12.42	3.01
	67	25.87	19.33	1.75	24.59	18.80	1.95	23.26	18.25	2.18	21.87	17.68	2.43	20.40	17.07	2.71	18.82	16.41	3.01
	63	24.04	18.63	1.75	22.84	18.09	1.95	21.59	17.53	2.18	20.27	16.95	2.43	18.89	16.34	2.71	17.41	15.67	3.01
	62	23.69	23.22	1.75	22.56	22.56	1.95	21.53	21.53	2.18	20.46	20.46	2.43	19.31	19.31	2.71	18.06	18.06	3.01
	57	23.51	23.51	1.75	22.55	22.55	1.95	21.53	21.53	2.18	20.46	20.46	2.43	19.31	19.31	2.71	18.06	18.06	3.01

Cooling Indoor Model	Capacity	Power	Furnace Model
*FY4ANF024	1.00	1.00	
FE4ANF002	1.03	0.95	
FE4ANF003	1.03	0.93	
FF1ENP024	1.00	1.01	
FF1ENP030	1.01	1.01	
FV4BNF002	1.03	0.95	
FV4BNF003	1.03	0.93	
FX4CNF024	1.02	0.96	
FX4CNF030	1.03	0.96	
FY4ANF030	1.02	1.00	
CAP**2414A**	1.01	1.01	
CAP**2417A**	1.01	1.01	
CAP**3014A**	1.02	1.02	
CAP**3017A**	1.02	1.02	
CNPF*2418A**	1.01	1.01	
CNPH*2417A**	1.01	1.01	
CNPH*3017A**	1.02	1.02	
CNPV*2414A**	1.01	1.01	
CNPV*2417A**	1.01	1.01	
CNPV*3014A**	1.02	1.00	
CNPV*3017A**	1.02	1.02	
CSPH*2412A**	1.01	1.01	
CSPH*3012A**	1.01	0.99	
CAP**2414A**	1.00	0.94	58CV(A,X)070-12
CAP**3014A**	1.02	0.94	58CV(A,X)070-12
CNPH*2417A**	1.00	0.94	58CV(A,X)070-12
CNPH*3017A**	1.02	0.94	58CV(A,X)070-12
CNPV*2414A**	1.00	0.94	58CV(A,X)070-12
CNPV*3014A**	1.02	0.94	58CV(A,X)070-12
CSPH*2412A**	1.00	0.92	58CV(A,X)070-12
CSPH*3012A**	1.02	0.94	58CV(A,X)070-12
CAP**2417A**	1.01	0.93	58CV(A,X)090-16
CAP**3017A**	1.02	0.94	58CV(A,X)090-16
CNPH*2417A**	1.00	0.94	58CV(A,X)090-16
CNPH*3017A**	1.02	0.94	58CV(A,X)090-16
CNPV*2417A**	1.01	0.93	58CV(A,X)090-16
CNPV*3017A**	1.02	0.94	58CV(A,X)090-16
CSPH*2412A**	1.00	0.92	58CV(A,X)090-16
CSPH*3012A**	1.02	0.94	58CV(A,X)090-16
CNPH*2417A**	1.01	0.95	58CV(A,X)110-20
CNPH*3017A**	1.02	0.94	58CV(A,X)110-20
CSPH*2412A**	1.01	0.95	58CV(A,X)110-20
CSPH*3012A**	1.02	0.94	58CV(A,X)110-20
CNPH*2417A**	1.01	0.95	58CV(A,X)135-22
CNPH*3017A**	1.02	0.94	58CV(A,X)135-22
CSPH*2412A**	1.01	0.93	58CV(A,X)135-22
CSPH*3012A**	1.02	0.94	58CV(A,X)135-22
CNPH*2417A**	1.00	0.92	58CV(A,X)155-22
CNPH*3017A**	1.02	0.92	58CV(A,X)155-22
CSPH*2412A**	1.02	0.92	58CV(A,X)155-22
CSPH*3012A**	1.02	0.92	58CV(A,X)155-22

Cooling Indoor Model	Capacity	Power	Furnace Model
CNPH*2417A**	1.00	0.92	58MVB040-14
CNPH*3017A**	1.02	0.92	58MVB040-14
CSPH*2412A**	1.02	0.96	58MVB040-14
CSPH*3012A**	1.02	0.92	58MVB040-14
CAP**2417A**	1.01	0.93	58MVB060-14
CAP**3017A**	1.02	0.94	58MVB060-14
CNPH*2417A**	1.00	0.94	58MVB060-14
CNPH*3017A**	1.01	0.93	58MVB060-14
CNPV*2417A**	1.00	0.94	58MVB060-14
CNPV*3017A**	1.02	0.94	58MVB060-14
CSPH*2412A**	1.01	0.93	58MVB060-14
CSPH*3012A**	1.01	0.93	58MVB060-14
CNPH*2417A**	1.01	0.95	58MVB080-14
CNPH*3017A**	1.01	0.93	58MVB080-14
CSPH*2412A**	1.01	0.95	58MVB080-14
CSPH*3012A**	1.01	0.93	58MVB080-14
CNPH*2417A**	1.01	0.95	58MVB080-20
CNPH*3017A**	1.01	0.93	58MVB080-20
CSPH*2412A**	1.01	0.93	58MVB080-20
CSPH*3012A**	1.01	0.93	58MVB080-20
CNPH*2417A**	1.01	0.95	58MVB100-20
CNPH*3017A**	1.02	0.94	58MVB100-20
CSPH*2412A**	1.01	0.93	58MVB100-20
CSPH*3012A**	1.02	0.94	58MVB100-20
CNPH*2417A**	1.00	0.94	58MVB120-20
CNPH*3017A**	1.01	0.93	58MVB120-20
CSPH*2412A**	1.00	0.94	58MVB120-20
CSPH*3012A**	1.02	0.94	58MVB120-20

See notes on pg. 24

25HPA3

DETAILED COOLING CAPACITIES CONTINUED

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																	
		75			85			95			105			115			125		
CFM	EWB	Capacity MBtu/h†		Total System KW* *	Capacity MBtu/h†		Total System KW* *	Capacity MBtu/h†		Total System KW* *	Capacity MBtu/h†		Total System KW* *	Capacity MBtu/h†		Total System KW* *	Capacity MBtu/h†		Total System KW* *
		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡	
25HPA330A30 Outdoor Section With FY4ANF030 Indoor Section																			
875	72	35.69	17.98	2.26	34.07	17.33	2.52	32.36	16.66	2.81	30.55	15.96	3.12	28.58	15.21	3.46	26.42	14.40	3.84
	67	32.56	22.06	2.26	31.07	21.40	2.52	29.49	20.72	2.81	27.82	20.00	3.12	26.02	19.24	3.46	24.03	18.41	3.84
	63	30.27	21.37	2.26	28.87	20.71	2.52	27.39	20.02	2.81	25.82	19.30	3.12	24.13	18.53	3.46	22.29	17.70	3.84
	62	29.68	26.13	2.26	28.31	25.44	2.52	26.87	24.72	2.80	25.35	23.95	3.12	23.74	23.10	3.46	22.04	22.04	3.84
	57	28.28	28.28	2.26	27.20	27.20	2.52	26.05	26.05	2.80	24.83	24.83	3.12	23.50	23.50	3.46	22.03	22.03	3.84
1000	72	36.38	18.74	2.31	34.68	18.08	2.57	32.90	17.41	2.85	31.01	16.69	3.17	28.97	15.93	3.51	26.72	15.11	3.88
	67	33.21	23.34	2.31	31.64	22.66	2.56	30.00	21.97	2.85	28.26	21.24	3.16	26.38	20.46	3.51	24.33	19.61	3.88
	63	30.89	22.57	2.31	29.43	21.89	2.56	27.88	21.19	2.85	26.25	20.45	3.16	24.49	19.67	3.51	22.58	18.82	3.88
	62	30.32	27.86	2.31	28.90	27.14	2.56	27.42	26.36	2.85	25.88	25.50	3.16	24.32	24.32	3.51	22.76	22.76	3.88
	57	29.40	29.40	2.31	28.25	28.25	2.56	27.04	27.04	2.85	25.73	25.73	3.16	24.33	24.33	3.51	22.76	22.76	3.88
1125	72	36.91	19.47	2.35	35.15	18.80	2.61	33.31	18.11	2.90	31.36	17.39	3.21	29.26	16.62	3.55	26.94	15.79	3.92
	67	33.71	24.57	2.35	32.09	23.88	2.61	30.38	23.17	2.89	28.58	22.43	3.21	26.65	21.63	3.55	24.54	20.76	3.92
	63	31.38	23.72	2.35	29.86	23.04	2.61	28.26	22.32	2.89	26.57	21.57	3.21	24.76	20.77	3.55	22.80	19.89	3.92
	62	30.85	29.47	2.35	29.41	28.67	2.61	27.88	27.88	2.89	26.48	26.48	3.21	24.99	24.99	3.55	23.35	23.35	3.92
	57	30.34	30.34	2.35	29.13	29.13	2.61	27.85	27.85	2.89	26.48	26.48	3.21	25.00	25.00	3.55	23.35	23.35	3.92

25HPA3

Cooling Indoor Model	Capacity	Power	Furnace Model
*FY4ANF030	1.00	1.00	
F(A,B)4BN(F,C)030	0.99	1.01	
F(A,B)4BN(F,C)036	0.99	1.02	
FE4ANF002	1.00	0.95	
FE4ANF003	1.00	0.92	
FE4ANF005	1.00	0.91	
FF1DNA030	0.99	1.02	
FF1ENP030	0.99	1.00	
FF1ENP036	0.99	0.98	
FV4BNF002	1.00	0.95	
FV4BNF003	1.00	0.92	
FV4BNF005	1.00	0.91	
FX4BNF030	1.00	1.00	
FX4BNF036	1.00	1.01	
FX4CN(B,F)036	1.00	0.95	
FX4CNF030	1.00	0.95	
FY4ANF036	1.00	1.01	
CAP**3014A**	1.00	1.00	
CAP**3017A**	1.00	1.00	
CAP**3614A**	0.97	0.97	
CAP**3617A**	1.00	1.00	
CAP**3621A**	1.00	1.00	
CNPF*3618A**	1.00	1.00	
CNPH*3017A**	1.00	1.00	
CNPH*3617A**	1.00	1.00	
CNPV*3014A**	1.00	1.00	
CNPV*3017A**	1.00	1.00	
CNPV*3617A**	1.00	1.00	
CNPV*3621A**	1.00	1.00	
CSPH*3012A**	1.00	1.00	
CSPH*3612A**	1.00	0.98	
CAP**3014A**	1.00	0.95	58CV(A,X)070-12
CAP**3614A**	0.97	0.91	58CV(A,X)070-12
CNPH*3017A**	1.00	0.95	58CV(A,X)070-12
CNPH*3617A**	1.00	0.95	58CV(A,X)070-12
CNPV*3014A**	1.00	0.95	58CV(A,X)070-12
CSPH*3012A**	1.00	0.95	58CV(A,X)070-12
CSPH*3612A**	1.00	0.92	58CV(A,X)070-12
CAP**3017A**	1.00	0.92	58CV(A,X)090-16
CAP**3617A**	1.00	0.92	58CV(A,X)090-16
CNPH*3017A**	1.00	0.93	58CV(A,X)090-16
CNPH*3617A**	1.00	0.93	58CV(A,X)090-16
CNPV*3017A**	1.00	0.93	58CV(A,X)090-16
CNPV*3617A**	1.00	0.93	58CV(A,X)090-16
CSPH*3012A**	1.00	0.93	58CV(A,X)090-16
CSPH*3612A**	1.00	0.92	58CV(A,X)090-16
CAP**3621A**	1.00	0.91	58CV(A,X)110-20
CNPH*3017A**	1.00	0.93	58CV(A,X)110-20
CNPH*3617A**	1.00	0.93	58CV(A,X)110-20
CNPV*3621A**	1.00	0.93	58CV(A,X)110-20
CSPH*3012A**	1.00	0.93	58CV(A,X)110-20
CSPH*3612A**	1.00	0.92	58CV(A,X)110-20
CNPH*3017A**	1.00	0.92	58CV(A,X)135-22
CNPH*3617A**	1.00	0.92	58CV(A,X)135-22
CSPH*3012A**	1.00	0.92	58CV(A,X)135-22
CSPH*3612A**	1.00	0.92	58CV(A,X)135-22

Cooling Indoor Model	Capacity	Power	Furnace Model
CNPH*3017A**	1.00	0.92	58CV(A,X)155-22
CNPH*3617A**	1.00	0.92	58CV(A,X)155-22
CSPH*3012A**	1.00	0.92	58CV(A,X)155-22
CSPH*3612A**	1.00	0.92	58CV(A,X)155-22
CNPH*3017A**	1.00	0.94	58MVB040-14
CNPH*3617A**	1.00	0.94	58MVB040-14
CSPH*3012A**	1.00	0.94	58MVB040-14
CSPH*3612A**	1.00	0.92	58MVB040-14
CAP**3017A**	1.00	0.94	58MVB060-14
CAP**3617A**	1.00	0.93	58MVB060-14
CNPH*3017A**	1.00	0.94	58MVB060-14
CNPH*3617A**	1.00	0.95	58MVB060-14
CNPV*3017A**	1.00	0.95	58MVB060-14
CNPV*3617A**	1.00	0.95	58MVB060-14
CSPH*3012A**	1.00	0.95	58MVB060-14
CSPH*3612A**	1.00	0.92	58MVB060-14
CAP**3621A**	1.00	0.92	58MVB080-14
CNPH*3017A**	1.00	0.94	58MVB080-14
CNPH*3617A**	1.00	0.95	58MVB080-14
CNPV*3621A**	1.00	0.95	58MVB080-14
CSPH*3012A**	1.00	0.95	58MVB080-14
CSPH*3612A**	1.00	0.92	58MVB080-14
CAP**3621A**	1.00	0.93	58MVB080-20
CNPH*3017A**	1.00	0.94	58MVB080-20
CNPH*3617A**	1.00	0.95	58MVB080-20
CNPV*3621A**	1.00	0.94	58MVB080-20
CSPH*3012A**	1.00	0.95	58MVB080-20
CSPH*3612A**	1.00	0.92	58MVB080-20
CAP**3621A**	1.00	0.92	58MVB100-20
CNPH*3017A**	1.00	0.93	58MVB100-20
CNPH*3617A**	1.00	0.93	58MVB100-20
CNPV*3621A**	1.00	0.93	58MVB100-20
CSPH*3012A**	1.00	0.92	58MVB100-20
CNPH*3017A**	1.00	0.93	58MVB120-20
CNPH*3617A**	1.00	0.93	58MVB120-20
CSPH*3012A**	1.00	0.93	58MVB120-20
CSPH*3612A**	1.00	0.92	58MVB120-20

See notes on pg. 24

DETAILED COOLING CAPACITIES CONTINUED

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																	
		75			85			95			105			115			125		
CFM	EWB	Capacity MBtu/h†		Total System KW **	Capacity MBtu/h†		Total System KW **	Capacity MBtu/h†		Total System KW **	Capacity MBtu/h†		Total System KW **	Capacity MBtu/h†		Total System KW **	Capacity MBtu/h†		Total System KW **
		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡	
25HPA336A30 Outdoor Section With FY4ANF042 Indoor Section																			
1050	72	43.15	21.78	2.78	41.23	21.01	3.07	39.18	20.22	3.40	37.03	19.39	3.76	34.70	18.51	4.16	32.11	17.54	4.59
	67	39.51	26.92	2.76	37.72	26.13	3.06	35.83	25.31	3.39	33.83	24.46	3.75	31.68	23.55	4.15	29.31	22.57	4.58
	63	36.80	26.10	2.75	35.12	25.31	3.04	33.35	24.48	3.37	31.47	23.62	3.73	29.46	22.71	4.13	27.24	21.72	4.56
	62	36.08	32.01	2.75	34.44	31.19	3.04	32.71	30.33	3.37	30.90	29.42	3.73	28.97	28.41	4.13	26.99	26.99	4.56
	57	34.51	34.51	2.74	33.22	33.22	3.04	31.84	31.84	3.37	30.36	30.36	3.73	28.77	28.77	4.13	26.99	26.99	4.56
1200	72	43.91	22.71	2.84	41.90	21.94	3.14	39.76	21.13	3.46	37.54	20.30	3.82	35.12	19.40	4.22	32.45	18.43	4.65
	67	40.24	28.51	2.82	38.38	27.71	3.12	36.40	26.87	3.45	34.33	26.01	3.81	32.09	25.08	4.21	29.64	24.08	4.64
	63	37.52	27.60	2.81	35.77	26.79	3.11	33.92	25.95	3.44	31.96	25.08	3.80	29.88	24.15	4.19	27.58	23.13	4.63
	62	36.83	34.20	2.81	35.14	33.34	3.11	33.36	32.41	3.43	31.53	31.35	3.80	29.76	29.76	4.19	27.87	27.87	4.63
	57	35.88	35.88	2.81	34.50	34.50	3.10	33.02	33.02	3.43	31.46	31.46	3.80	29.76	29.76	4.19	27.87	27.87	4.63
1350	72	44.45	23.59	2.90	42.38	22.81	3.20	40.17	21.99	3.53	37.89	21.15	3.89	35.41	20.25	4.28	32.67	19.27	4.71
	67	40.78	30.02	2.89	38.85	29.20	3.18	36.81	28.37	3.51	34.68	27.49	3.87	32.38	26.54	4.27	29.87	25.51	4.70
	63	38.05	29.02	2.87	36.24	28.20	3.17	34.32	27.34	3.50	32.32	26.46	3.86	30.16	25.51	4.26	27.81	24.46	4.69
	62	37.44	36.20	2.87	35.72	35.24	3.17	34.00	34.00	3.50	32.35	32.35	3.86	30.56	30.56	4.26	28.57	28.57	4.69
	57	37.01	37.01	2.87	35.55	35.55	3.17	34.00	34.00	3.50	32.35	32.35	3.86	30.56	30.56	4.26	28.57	28.57	4.69

Cooling Indoor Model	Capacity	Power	Furnace Model
*FY4ANF042	1.00	1.00	
F(A,B)4BN(F,B,C)042	0.98	0.99	
F(A,B)4BN(F,C)036	0.97	1.00	
FE4ANF002	0.98	0.94	
FE4ANF003	0.98	0.92	
FE4ANF005	1.03	0.95	
FF1ENP036	0.98	0.98	
FV4BNF002	0.98	0.94	
FV4BNF003	0.98	0.92	
FV4BNF005	1.03	0.95	
FX4BNF036	0.98	0.99	
FX4BNF042	1.00	1.00	
FX4CN(B,F)036	1.00	0.96	
FX4CN(B,F)042	1.02	0.95	
FY4ANF036	0.97	0.99	
CAP**3614A**	0.96	0.96	
CAP**3617A**	0.98	0.98	
CAP**3621A**	0.98	0.98	
CAP**4221A**	0.99	0.99	
CAP**4224A**	0.99	0.99	
CNPF*3618A**	0.98	0.98	
CNPH*3617A**	0.98	0.98	
CNPH*4221A**	0.99	0.99	
CNPV*3617A**	0.98	0.98	
CNPV*3621A**	0.98	0.98	
CNPV*4221A**	0.99	0.99	
CSPH*3612A**	0.98	0.98	
CSPH*4212A**	0.99	0.97	
CAP**3614A**	0.96	0.92	58CV(A,X)070-12
CNPH*3617A**	0.98	0.97	58CV(A,X)070-12
CNPH*4221A**	0.99	0.95	58CV(A,X)070-12
CSPH*3612A**	0.98	0.95	58CV(A,X)070-12
CSPH*4212A**	0.99	0.95	58CV(A,X)070-12
CAP**3617A**	0.98	0.94	58CV(A,X)090-16
CNPH*3617A**	0.98	0.94	58CV(A,X)090-16
CNPH*4221A**	0.98	0.92	58CV(A,X)090-16
CNPV*3617A**	0.98	0.94	58CV(A,X)090-16
CSPH*3612A**	0.98	0.92	58CV(A,X)090-16
CSPH*4212A**	0.98	0.92	58CV(A,X)090-16
CAP**3621A**	0.98	0.94	58CV(A,X)110-20
CAP**4221A**	0.98	0.92	58CV(A,X)110-20
CNPH*3617A**	0.97	0.94	58CV(A,X)110-20
CNPH*4221A**	0.98	0.92	58CV(A,X)110-20
CNPV*3621A**	0.98	0.94	58CV(A,X)110-20
CNPV*4221A**	0.98	0.92	58CV(A,X)110-20
CSPH*3612A**	0.97	0.91	58CV(A,X)110-20
CSPH*4212A**	0.98	0.91	58CV(A,X)110-20

Cooling Indoor Model	Capacity	Power	Furnace Model
CSPH*4212A**	0.98	0.92	58CV(A,X)110-20
CAP**4224A**	0.99	0.93	58CV(A,X)135-22
CNPH*3617A**	0.97	0.94	58CV(A,X)135-22
CNPH*4221A**	0.99	0.93	58CV(A,X)135-22
CSPH*3612A**	0.97	0.91	58CV(A,X)135-22
CSPH*4212A**	0.99	0.93	58CV(A,X)135-22
CAP**4224A**	0.99	0.93	58CV(A,X)155-22
CNPH*3617A**	0.98	0.94	58CV(A,X)155-22
CNPH*4221A**	0.99	0.91	58CV(A,X)155-22
CSPH*3612A**	0.97	0.91	58CV(A,X)155-22
CSPH*4212A**	0.99	0.93	58CV(A,X)155-22
CAP**4224A**	0.98	0.93	58MVB040-14
CNPH*3617A**	0.97	0.95	58MVB040-14
CNPH*4221A**	0.98	0.92	58MVB040-14
CSPH*3612A**	0.97	0.91	58MVB040-14
CSPH*4212A**	0.98	0.92	58MVB040-14
CAP**3617A**	0.97	0.94	58MVB060-14
CNPH*3617A**	0.97	0.94	58MVB060-14
CNPH*4221A**	0.99	0.96	58MVB060-14
CNPV*3617A**	0.97	0.95	58MVB060-14
CSPH*3612A**	0.97	0.94	58MVB060-14
CSPH*4212A**	0.99	0.96	58MVB060-14
CAP**3621A**	0.99	0.97	58MVB080-14
CAP**4221A**	0.99	0.96	58MVB080-14
CNPH*3617A**	0.98	0.97	58MVB080-14
CNPH*4221A**	0.99	0.96	58MVB080-14
CNPV*3621A**	0.98	0.97	58MVB080-14
CNPV*4221A**	0.99	0.96	58MVB080-14
CSPH*3612A**	0.98	0.95	58MVB080-14
CSPH*4212A**	1.00	0.96	58MVB080-20
CAP**3621A**	0.98	0.94	58MVB100-20
CAP**4221A**	0.98	0.95	58MVB100-20
CNPH*3617A**	0.97	0.94	58MVB100-20
CNPH*4221A**	0.98	0.92	58MVB100-20
CNPV*3621A**	0.97	0.94	58MVB100-20
CNPV*4221A**	0.98	0.92	58MVB100-20
CSPH*3612A**	0.97	0.91	58MVB100-20
CSPH*4212A**	0.98	0.92	58MVB100-20
CAP**4224A**	1.00	0.96	58MVB120-20
CNPH*3617A**	0.99	0.95	58MVB120-20
CNPH*4221A**	1.00	0.94	58MVB120-20
CSPH*3612A**	0.99	0.95	58MVB120-20
CSPH*4212A**	1.00	0.94	58MVB120-20

See notes on pg. 24

25HPA3

DETAILED COOLING CAPACITIES CONTINUED

25HPA3

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																	
		75			85			95			105			115			125		
CFM	E W B	Capacity MBtu/h†		Total System KW* ‡	Capacity MBtu/h†		Total System KW* ‡	Capacity MBtu/h†		Total System KW* ‡	Capacity MBtu/h†		Total System KW* ‡	Capacity MBtu/h†		Total System KW* ‡	Capacity MBtu/h†		Total System KW* ‡
		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡	
25HPA342A30 Outdoor Section With FY4ANF042 Indoor Section																			
1225	72	49.40	25.77	3.09	47.13	24.90	3.42	44.73	23.99	3.78	42.23	23.06	4.18	39.53	22.06	4.62	36.53	20.97	5.10
	67	45.29	32.36	3.07	43.20	31.46	3.40	40.98	30.53	3.76	38.65	29.56	4.16	36.14	28.52	4.61	33.39	27.39	5.08
	63	42.25	31.32	3.06	40.28	30.42	3.39	38.20	29.48	3.75	36.01	28.50	4.15	33.65	27.46	4.59	31.09	26.32	5.07
	62	41.49	38.82	3.05	39.59	37.85	3.38	37.60	36.79	3.75	35.56	35.56	4.15	33.63	33.63	4.59	31.50	31.50	5.07
	57	40.53	40.53	3.05	38.97	38.97	3.38	37.31	37.31	3.75	35.55	35.55	4.15	33.63	33.63	4.59	31.50	31.50	5.07
1400	72	50.08	26.93	3.16	47.74	26.05	3.49	45.26	25.14	3.85	42.69	24.20	4.25	39.90	23.19	4.69	36.81	22.08	5.17
	67	45.97	34.34	3.14	43.80	33.43	3.47	41.50	32.48	3.83	39.10	31.50	4.23	36.52	30.43	4.68	33.69	29.27	5.15
	63	42.93	33.19	3.13	40.88	32.27	3.45	38.73	31.31	3.82	36.46	30.31	4.22	34.04	29.24	4.66	31.40	28.06	5.14
	62	42.30	41.37	3.12	40.35	40.35	3.45	38.55	38.55	3.82	36.68	36.68	4.22	34.65	34.65	4.67	32.40	32.40	5.15
	57	41.97	41.97	3.12	40.32	40.32	3.45	38.56	38.56	3.82	36.69	36.69	4.22	34.66	34.66	4.67	32.40	32.40	5.15
1575	72	50.58	28.03	3.23	48.17	27.14	3.55	45.62	26.22	3.92	42.99	25.27	4.32	40.13	24.26	4.76	36.98	23.15	5.23
	67	46.46	36.22	3.21	44.22	35.29	3.54	41.86	34.33	3.90	39.41	33.32	4.30	36.77	32.22	4.74	33.90	31.00	5.22
	63	43.42	34.96	3.20	41.32	34.02	3.52	39.10	33.03	3.89	36.79	32.01	4.29	34.31	30.90	4.73	31.63	29.66	5.21
	62	43.15	43.15	3.19	41.41	41.41	3.52	39.56	39.56	3.89	37.59	37.59	4.29	35.47	35.47	4.74	33.10	33.10	5.22
	57	43.15	43.15	3.19	41.41	41.41	3.52	39.56	39.56	3.89	37.60	37.60	4.29	35.47	35.47	4.74	33.11	33.11	5.22

Cooling Indoor Model	Capacity	Power	Furnace Model
*FY4ANF042	1.00	1.00	
F(A,B)4BN(F,B,C)042	0.99	0.99	
F(A,B)4BN(F,B,C)048	1.00	1.00	
FE4ANB006	1.01	0.93	
FE4ANF003	0.99	0.93	
FE4ANF005	1.01	0.93	
FV4BNB006	1.01	0.93	
FV4BNF003	0.99	0.93	
FV4BNF005	1.01	0.93	
FX4BNF042	1.00	1.00	
FX4BNF048	1.01	0.99	
FX4CN(B,F)042	1.01	0.98	
FX4CN(B,F)048	1.01	0.95	
FY4ANF048	1.01	0.98	
CAP**4221A**	0.99	0.99	
CAP**4224A**	0.99	0.99	
CAP**4817A**	0.99	0.97	
CAP**4821A**	1.01	0.99	
CAP**4824A**	1.01	0.99	
CNPF*4818A**	0.99	0.97	
CNPH*4221A**	0.99	0.99	
CNPH*4821A**	1.01	0.99	
CNPV*4221A**	0.99	0.99	
CNPV*4821A**	1.01	0.99	
CNPV*4824A**	1.01	0.99	
CSPH*4212A**	0.99	0.97	
CSPH*4812A**	1.01	0.99	
CNPH*4221A**	0.99	0.95	58CV(A,X)070-12
CNPH*4821A**	1.00	0.96	58CV(A,X)070-12
CSPH*4212A**	0.99	0.95	58CV(A,X)070-12
CSPH*4812A**	1.00	0.96	58CV(A,X)070-12
CAP**4817A**	0.98	0.92	58CV(A,X)090-16
CNPH*4221A**	0.99	0.93	58CV(A,X)090-16
CNPH*4821A**	1.00	0.94	58CV(A,X)090-16
CSPH*4212A**	0.99	0.93	58CV(A,X)090-16
CSPH*4812A**	1.00	0.94	58CV(A,X)090-16
CAP**4221A**	0.99	0.95	58CV(A,X)110-20
CAP**4821A**	1.00	0.94	58CV(A,X)110-20
CNPH*4221A**	0.99	0.93	58CV(A,X)110-20
CNPH*4821A**	1.00	0.94	58CV(A,X)110-20
CNPV*4221A**	0.99	0.93	58CV(A,X)110-20
CNPV*4821A**	1.00	0.94	58CV(A,X)110-20
CSPH*4212A**	0.99	0.93	58CV(A,X)110-20
CSPH*4812A**	1.00	0.94	58CV(A,X)110-20
CAP**4224A**	0.99	0.93	58CV(A,X)135-22
CAP**4824A**	1.01	0.93	58CV(A,X)135-22
CNPH*4221A**	0.99	0.91	58CV(A,X)135-22
CNPH*4821A**	1.01	0.93	58CV(A,X)135-22
CNPV*4824A**	1.01	0.95	58CV(A,X)135-22
CSPH*4212A**	0.99	0.91	58CV(A,X)135-22

Cooling Indoor Model	Capacity	Power	Furnace Model
CSPH*4812A**	1.01	0.95	58CV(A,X)135-22
CAP**4224A**	0.99	0.93	58CV(A,X)155-22
CAP**4824A**	1.01	0.93	58CV(A,X)155-22
CNPH*4221A**	0.99	0.91	58CV(A,X)155-22
CNPH*4821A**	1.01	0.93	58CV(A,X)155-22
CNPV*4824A**	1.01	0.95	58CV(A,X)155-22
CSPH*4212A**	0.99	0.91	58CV(A,X)155-22
CSPH*4812A**	1.01	0.95	58CV(A,X)155-22
CAP**4224A**	0.98	0.94	58MVB040-14
CAP**4824A**	1.00	0.96	58MVB040-14
CNPH*4221A**	0.98	0.94	58MVB040-14
CNPH*4821A**	1.00	0.96	58MVB040-14
CNPV*4824A**	1.00	0.96	58MVB040-14
CSPH*4212A**	0.98	0.94	58MVB040-14
CSPH*4812A**	1.00	0.96	58MVB040-14
CAP**4817A**	0.98	0.92	58MVB060-14
CNPH*4221A**	0.99	0.93	58MVB060-14
CNPH*4821A**	1.00	0.94	58MVB060-14
CSPH*4212A**	0.99	0.93	58MVB060-14
CSPH*4812A**	1.00	0.94	58MVB060-14
CAP**4221A**	0.98	0.94	58MVB080-14
CAP**4821A**	1.00	0.96	58MVB080-14
CNPH*4221A**	0.98	0.94	58MVB080-14
CNPH*4821A**	1.00	0.96	58MVB080-14
CNPV*4221A**	0.98	0.94	58MVB080-14
CNPV*4821A**	1.00	0.96	58MVB080-14
CSPH*4212A**	0.99	0.95	58MVB080-14
CSPH*4812A**	1.00	0.96	58MVB080-14
CAP**4221A**	0.99	0.95	58MVB080-20
CAP**4821A**	1.00	0.96	58MVB080-20
CNPH*4221A**	0.99	0.93	58MVB080-20
CNPH*4821A**	1.00	0.94	58MVB080-20
CNPV*4221A**	0.99	0.95	58MVB080-20
CNPV*4821A**	1.00	0.94	58MVB080-20
CSPH*4212A**	0.99	0.93	58MVB080-20
CSPH*4812A**	1.00	0.94	58MVB080-20
CAP**4221A**	0.99	0.95	58MVB100-20
CAP**4821A**	1.00	0.94	58MVB100-20
CNPH*4221A**	0.99	0.93	58MVB100-20
CNPH*4821A**	1.00	0.94	58MVB100-20
CNPV*4221A**	0.99	0.93	58MVB100-20
CNPV*4821A**	1.00	0.94	58MVB100-20
CSPH*4212A**	0.99	0.93	58MVB100-20
CSPH*4812A**	1.00	0.94	58MVB100-20
CAP**4224A**	0.99	0.95	58MVB120-20
CAP**4824A**	1.00	0.94	58MVB120-20
CNPH*4221A**	0.99	0.93	58MVB120-20
CNPH*4821A**	1.00	0.94	58MVB120-20
CNPV*4824A**	1.00	0.94	58MVB120-20
CSPH*4212A**	0.99	0.93	58MVB120-20
CSPH*4812A**	1.00	0.94	58MVB120-20

See notes on pg. 24

DETAILED COOLING CAPACITIES CONTINUED

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																	
CFM	EWB	75			85			95			105			115			125		
		Capacity MBtu/h†		Total System KW* *	Capacity MBtu/h†		Total System KW* *	Capacity MBtu/h†		Total System KW* *	Capacity MBtu/h†		Total System KW* *	Capacity MBtu/h†		Total System KW* *	Capacity MBtu/h†		Total System KW* *
		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡	
25HPA348A30 Outdoor Section With FY4ANF048 Indoor Section																			
1400	72	56.59	28.89	3.44	54.05	27.91	3.82	51.34	26.86	4.23	48.48	25.78	4.68	45.40	24.63	5.17	42.00	23.38	5.71
	67	51.67	35.98	3.43	49.31	34.96	3.81	46.81	33.89	4.22	44.17	32.78	4.67	41.33	31.60	5.16	38.21	30.31	5.70
	63	48.05	34.81	3.43	45.83	33.78	3.80	43.49	32.70	4.21	41.00	31.58	4.66	38.33	30.39	5.15	35.43	29.10	5.69
	62	47.12	43.00	3.42	44.96	41.92	3.79	42.69	40.78	4.20	40.31	39.53	4.66	37.89	37.89	5.15	35.54	35.54	5.69
	57	45.58	45.58	3.42	43.84	43.84	3.79	42.00	42.00	4.20	40.03	40.03	4.66	37.89	37.89	5.15	35.54	35.54	5.69
1600	72	57.48	30.16	3.53	54.87	29.17	3.90	52.05	28.12	4.31	49.10	27.03	4.77	45.91	25.86	5.26	42.39	24.59	5.79
	67	52.55	38.17	3.52	50.10	37.14	3.89	47.50	36.05	4.30	44.76	34.91	4.75	41.82	33.70	5.25	38.60	32.38	5.78
	63	48.91	36.86	3.51	46.59	35.82	3.88	44.15	34.72	4.29	41.57	33.57	4.74	38.82	32.35	5.24	35.82	31.03	5.77
	62	48.06	45.95	3.51	45.85	44.78	3.88	43.53	43.53	4.29	41.41	41.41	4.74	39.15	39.15	5.24	36.65	36.65	5.78
	57	47.31	47.31	3.51	45.46	45.46	3.88	43.51	43.51	4.29	41.42	41.42	4.74	39.16	39.16	5.24	36.65	36.65	5.78
1800	72	58.15	31.38	3.62	55.45	30.37	3.99	52.55	29.31	4.40	49.51	28.21	4.85	46.24	27.03	5.34	42.62	25.74	5.88
	67	53.19	40.25	3.61	50.66	39.20	3.98	47.98	38.09	4.39	45.16	36.94	4.84	42.15	35.70	5.33	38.86	34.34	5.87
	63	49.53	38.81	3.60	47.14	37.74	3.97	44.63	36.63	4.38	41.98	35.46	4.83	39.15	34.21	5.32	36.09	32.84	5.86
	62	48.88	48.51	3.60	46.80	46.80	3.97	44.74	44.74	4.38	42.54	42.54	4.83	40.17	40.17	5.33	37.53	37.53	5.86
	57	48.74	48.74	3.60	46.80	46.80	3.97	44.74	44.74	4.38	42.55	42.55	4.83	40.17	40.17	5.33	37.54	37.54	5.86

Cooling Indoor Model	Capacity	Power	Furnace Model
*FY4ANF048	1.00	1.00	
F(A,B)4BN(F,B,C)048	0.97	1.00	
F(A,B)4BN(F,B,C)060	0.99	1.02	
FB4BNB070	1.01	0.99	
FE4ANB006	1.01	0.91	
FE4ANF005	1.00	0.92	
FV4BNB006	1.01	0.91	
FV4BNF005	1.00	0.92	
FX4BNB060	1.01	0.99	
FX4BNF048	1.00	1.00	
FX4CN(B,F)048	1.01	0.95	
FX4CN(B,F)060	1.03	0.95	
FY4ANB060	1.01	0.99	
CAP**4817A**	0.96	0.96	
CAP**4821A**	0.98	0.98	
CAP**4824A**	0.98	0.98	
CAP**6021A**	1.01	1.01	
CAP**6024A**	1.01	1.01	
CNPF*4818A**	0.96	0.96	
CNPH*4821A**	0.98	0.98	
CNPH*6024A**	1.00	0.98	
CNPV*4821A**	0.98	0.98	
CNPV*4824A**	0.98	0.98	
CNPV*6024A**	1.00	0.98	
CSPH*4812A**	0.98	0.98	
CSPH*6012A**	1.01	0.99	
CAP**4817A**	0.96	0.92	58CV(A,X)090-16
CNPH*4821A**	0.97	0.93	58CV(A,X)090-16
CNPH*6024A**	0.99	0.93	58CV(A,X)090-16
CSPH*4812A**	0.97	0.93	58CV(A,X)090-16
CSPH*6012A**	0.99	0.93	58CV(A,X)090-16
CAP**4821A**	0.97	0.93	58CV(A,X)110-20
CAP**6021A**	1.00	0.92	58CV(A,X)110-20
CNPH*4821A**	0.97	0.93	58CV(A,X)110-20
CNPH*6024A**	0.99	0.93	58CV(A,X)110-20
CNPV*4821A**	0.98	0.92	58CV(A,X)110-20
CSPH*4812A**	0.97	0.93	58CV(A,X)110-20
CSPH*6012A**	0.99	0.91	58CV(A,X)110-20
CAP**4824A**	0.98	0.94	58CV(A,X)135-22
CAP**6024A**	1.00	0.92	58CV(A,X)135-22
CNPH*4821A**	0.98	0.92	58CV(A,X)135-22
CNPH*6024A**	1.00	0.94	58CV(A,X)135-22
CNPV*4824A**	0.98	0.92	58CV(A,X)135-22
CNPV*6024A**	1.00	0.92	58CV(A,X)135-22
CSPH*4812A**	0.98	0.92	58CV(A,X)135-22
CSPH*6012A**	1.00	0.92	58CV(A,X)135-22
CAP**4824A**	0.98	0.92	58CV(A,X)155-22
CAP**6024A**	1.00	0.92	58CV(A,X)155-22
CNPH*4821A**	0.98	0.90	58CV(A,X)155-22
CNPH*6024A**	1.00	0.94	58CV(A,X)155-22
CNPV*4824A**	0.98	0.90	58CV(A,X)155-22
CNPV*6024A**	1.00	0.92	58CV(A,X)155-22
CSPH*4812A**	0.98	0.92	58CV(A,X)155-22
CSPH*6012A**	1.00	0.92	58CV(A,X)155-22

Cooling Indoor Model	Capacity	Power	Furnace Model
CAP**4821A**	0.97	0.93	58MVB080-20
CAP**6021A**	0.99	0.93	58MVB080-20
CNPH*4821A**	0.97	0.93	58MVB080-20
CNPH*6024A**	0.99	0.93	58MVB080-20
CNPV*4821A**	0.97	0.93	58MVB080-20
CSPH*4812A**	0.97	0.93	58MVB080-20
CSPH*6012A**	0.99	0.93	58MVB080-20
CAP**4821A**	0.97	0.93	58MVB100-20
CAP**6021A**	0.99	0.93	58MVB100-20
CNPH*4821A**	0.97	0.93	58MVB100-20
CNPH*6024A**	0.99	0.93	58MVB100-20
CNPV*4821A**	0.97	0.93	58MVB100-20
CSPH*4812A**	0.97	0.93	58MVB100-20
CSPH*6012A**	0.99	0.93	58MVB100-20
CAP**4824A**	0.97	0.93	58MVB120-20
CAP**6024A**	0.99	0.93	58MVB120-20
CNPH*4821A**	0.97	0.93	58MVB120-20
CNPH*6024A**	0.99	0.93	58MVB120-20
CNPV*4824A**	0.97	0.93	58MVB120-20
CNPV*6024A**	0.99	0.93	58MVB120-20
CSPH*4812A**	0.97	0.93	58MVB120-20
CSPH*6012A**	0.99	0.93	58MVB120-20

See notes on pg. 24

25HPA3

DETAILED COOLING CAPACITIES CONTINUED

CFM	EWB	Capacity MBtu/h†		Total Sys-tem KW* *	Capacity MBtu/h†		Total Sys-tem KW* *	Capacity MBtu/h†		Total Sys-tem KW* *	Capacity MBtu/h†		Total Sys-tem KW* *	Capacity MBtu/h†		Total Sys-tem KW* *	Capacity MBtu/h†	Total Sys-tem KW* *	
		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡		Total	Sens ‡				
25HPA360A30 Outdoor Section With FY4ANF060 Indoor Section																			
1750	72	70.99	36.16	4.48	67.58	34.84	4.94	63.91	33.43	5.44	60.11	32.00	6.00	56.01	30.47	6.60	51.47	28.80	7.25
	67	65.30	45.31	4.42	62.16	43.96	4.88	58.80	42.52	5.39	55.31	41.05	5.94	51.56	39.49	6.55	47.43	37.80	7.20
	63	61.06	44.00	4.38	58.11	42.63	4.84	54.98	41.20	5.34	51.73	39.73	5.90	48.25	38.17	6.51	44.43	36.48	7.17
	62	59.91	54.37	4.37	57.03	52.94	4.83	54.00	51.42	5.33	50.88	49.80	5.89	47.68	47.68	6.50	46.12	46.12	6.54
	57	57.89	57.89	4.35	55.58	55.58	4.81	53.12	53.12	5.32	50.51	50.51	5.89	47.68	47.68	6.50	44.52	44.52	7.17
2000	72	71.96	37.68	4.60	68.42	36.35	5.06	64.61	34.93	5.56	60.68	33.47	6.12	56.43	31.93	6.72	51.76	30.24	7.36
	67	66.28	47.99	4.55	63.00	46.61	5.00	59.50	45.16	5.51	55.88	43.66	6.07	52.00	42.07	6.67	47.74	40.33	7.32
	63	62.04	46.52	4.50	58.96	45.12	4.96	55.71	43.67	5.47	52.33	42.17	6.02	48.72	40.57	6.63	44.78	38.84	7.29
	62	60.98	58.04	4.49	58.02	56.50	4.95	54.90	54.90	5.46	52.08	52.08	6.02	49.06	49.06	6.64	45.68	45.68	7.30
	57	59.98	59.98	4.48	57.50	57.50	4.95	54.86	54.86	5.46	52.08	52.08	6.02	49.06	49.06	6.64	45.69	45.69	7.30
2250	72	72.63	39.13	4.72	68.98	37.78	5.18	65.07	36.35	5.69	61.02	34.88	6.24	56.67	33.32	6.84	51.88	31.62	7.48
	67	66.94	50.54	4.67	63.57	49.15	5.13	59.96	47.67	5.63	56.24	46.14	6.19	52.26	44.51	6.79	47.90	42.71	7.44
	63	62.73	48.91	4.62	59.56	47.50	5.08	56.20	46.01	5.59	52.73	44.48	6.14	49.02	42.84	6.75	44.99	41.04	7.41
	62	61.89	61.25	4.62	59.04	59.04	5.08	56.24	56.24	5.59	53.31	53.31	6.15	50.13	50.13	6.77	46.57	46.57	7.43
	57	61.66	61.66	4.62	59.04	59.04	5.08	56.25	56.25	5.59	53.32	53.32	6.15	50.13	50.13	6.77	46.57	46.57	7.43

Cooling Indoor Model	Capacity	Power	Furnace Model
*FY4ANB060	1.00	1.00	
FE4ANB006	1.00	0.92	
FV4BNB006	1.00	0.92	
FX4CN(B,F)060	1.01	0.93	
CAP**6021A**	0.98	0.96	
CAP**6024A**	1.00	0.98	
CNPH*6024A**	0.99	0.97	
CNPV*6024A**	1.00	0.98	
CSPH*6012A**	0.99	0.97	

Cooling Indoor Model	Capacity	Power	Furnace Model
CAP**6021A**	0.97	0.91	58CV(A,X)110-20
CNPH*6024A**	0.98	0.94	58CV(A,X)110-20
CSPH*6012A**	0.98	0.93	58CV(A,X)110-20
CAP**6024A**	0.98	0.93	58CV(A,X)135-22
CNPH*6024A**	0.98	0.93	58CV(A,X)135-22
CNPV*6024A**	0.98	0.93	58CV(A,X)135-22
CSPH*6012A**	0.98	0.93	58CV(A,X)135-22
CAP**6024A**	0.99	0.94	58CV(A,X)155-22
CNPH*6024A**	0.98	0.93	58CV(A,X)155-22
CNPV*6024A**	0.98	0.93	58CV(A,X)155-22
CSPH*6012A**	0.98	0.93	58CV(A,X)155-22

NOTE: When the required data falls between the published data, interpolation may be performed. Extrapolation is not an acceptable practice.

* Detailed cooling capacities are based on indoor and outdoor unit at the same elevation per ARI standard 210/240-94. If additional tubing length and/or indoor unit is located above outdoor unit, a slight variation in capacity may occur.

† Total and sensible capacities are net capacities. Blower motor heat has been subtracted.

‡ Sensible capacities shown are based on 80°F (27°C) entering air at the indoor coil. For sensible capacities at other than 80°F (27°C), deduct 835 Btu/h (245 kW) per 1000 CFM (480 L/S) of indoor coil air for each degree below 80°F (27°C), or add 835 Btu/h (245 kW) per 1000 CFM (480 L/S) of indoor coil air per degree above 80°F (27°C).

** System kw is total of indoor and outdoor unit kilowatts.

†† At TVA rating indoor condition (75°F edb/63°F ewb). All other indoor air temperatures are at 80°F edb.

EWB — Entering Wet Bulb

HEAT PUMP HEATING PERFORMANCE

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES deg F																										
		-3		7		17		27		37		47		57		67												
EDB	CFM	Capacity MBtuh		Total System KW†		Capacity MBtuh		Total System KW†		Capacity MBtuh		Total System KW†		Capacity MBtuh		Total System KW†		Capacity MBtuh		Total System KW†		Capacity MBtuh		Total System KW†				
		Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*			
65	525	6.36	5.86	1.25	7.64	8.31	7.64	1.30	9.47	10.39	9.47	1.34	12.63	11.22	1.40	15.18	13.81	1.46	18.01	16.60	1.55	21.15	21.15	24.62	24.62	1.77	28.50	27.09
	600	6.52	6.00	1.26	8.49	8.49	7.80	1.31	10.59	9.66	9.66	1.35	12.88	11.44	1.39	15.50	14.11	1.45	18.37	16.96	1.53	21.58	21.58	24.99	24.99	1.71	28.87	27.46
	675	6.67	6.13	1.28	8.62	8.62	7.92	1.32	10.77	9.82	9.82	1.36	13.09	11.63	1.40	15.75	14.33	1.45	18.66	17.25	1.52	21.93	21.93	25.01	25.01	1.67	29.15	27.74
	525	6.03	5.55	1.29	8.02	8.02	7.37	1.35	10.11	9.22	9.22	1.40	12.34	10.96	1.46	14.84	13.51	1.53	17.66	16.25	1.62	20.74	20.74	24.19	24.19	1.86	28.07	26.66
	600	6.19	5.70	1.31	8.20	8.20	7.54	1.36	10.31	9.40	9.40	1.41	12.56	11.15	1.46	15.13	13.77	1.52	18.00	16.84	1.60	21.16	21.16	24.63	24.63	1.80	28.51	27.19
70	525	6.33	5.83	1.33	8.36	8.36	7.68	1.38	9.54	10.47	9.54	1.42	12.77	11.34	1.46	15.40	14.01	1.52	18.29	16.99	1.59	21.52	21.52	24.84	24.84	1.76	28.72	27.31
	600	6.58	6.06	1.34	8.49	8.49	7.81	1.39	10.69	9.76	9.76	1.43	12.92	11.49	1.47	15.55	14.16	1.53	18.44	17.14	1.60	21.64	21.64	24.94	24.94	1.74	28.83	27.42
	675	6.73	6.19	1.36	8.62	8.62	7.94	1.40	10.87	9.92	9.92	1.44	13.16	11.73	1.48	15.73	14.35	1.54	18.63	17.34	1.61	21.82	21.82	25.04	25.04	1.69	29.04	27.63
	525	6.03	5.55	1.29	8.02	8.02	7.37	1.35	10.11	9.22	9.22	1.40	12.34	10.96	1.46	14.84	13.51	1.53	17.66	16.35	1.62	20.74	20.74	24.19	24.19	1.86	28.07	26.66
	600	6.19	5.70	1.31	8.20	8.20	7.54	1.36	10.31	9.40	9.40	1.41	12.56	11.15	1.46	15.13	13.77	1.52	18.00	16.88	1.60	21.16	21.16	24.63	24.63	1.80	28.51	27.19
75	525	6.33	5.83	1.33	8.36	8.36	7.68	1.38	9.54	10.47	9.54	1.42	12.77	11.34	1.46	15.40	14.01	1.52	18.29	17.01	1.59	21.52	21.52	24.84	24.84	1.76	28.72	27.31
	600	6.58	6.06	1.34	8.49	8.49	7.81	1.39	10.69	9.76	9.76	1.43	12.92	11.49	1.47	15.55	14.16	1.53	18.44	17.16	1.60	21.64	21.64	24.94	24.94	1.74	28.83	27.42
	675	6.73	6.19	1.36	8.62	8.62	7.94	1.40	10.87	9.92	9.92	1.44	13.16	11.73	1.48	15.73	14.35	1.54	18.63	17.36	1.61	21.82	21.82	25.04	25.04	1.69	29.04	27.63
	525	6.03	5.55	1.29	8.02	8.02	7.37	1.35	10.11	9.22	9.22	1.40	12.34	10.96	1.46	14.84	13.51	1.53	17.66	16.47	1.62	20.74	20.74	24.19	24.19	1.86	28.07	26.66
	600	6.19	5.70	1.31	8.20	8.20	7.54	1.36	10.31	9.40	9.40	1.41	12.56	11.15	1.46	15.13	13.77	1.52	18.00	16.92	1.60	21.16	21.16	24.63	24.63	1.80	28.51	27.19

25HPA31BA30 Outdoor Section With FY4ANF018 Indoor Section

Heating Indoor Model	Capacity	Power	Furnace Model
*FY4ANF018	1.00	1.00	
FE4ANF002	0.99	0.91	
FF1ENP018	1.00	1.00	
FF1ENP024	1.00	0.98	
FV4BNF002	0.99	0.91	
FX4CNF018	1.00	0.94	
FX4CNF024	1.00	0.93	
FY4ANF024	1.00	1.00	
CAP**1814A**	1.00	1.01	
CAP**2414A**	1.00	0.97	
CAP**2417A**	1.00	0.97	
CNPF*2418A**	1.00	0.95	
CNPH*2417A**	1.00	0.95	
CNPV*1814A**	1.00	0.97	
CNPV*2414A**	1.00	0.95	
CNPV*2417A**	1.00	0.95	
CSPH*2412A**	1.00	0.95	
CAP**1814A**	0.97	0.97	58CV(A.X)070-12
CAP**2414A**	0.98	0.94	58CV(A.X)070-12
CNPH*2417A**	0.98	0.93	58CV(A.X)070-12
CNPV*1814A**	0.97	0.94	58CV(A.X)070-12
CNPV*2414A**	0.98	0.93	58CV(A.X)070-12
CSPH*2412A**	0.98	0.93	58CV(A.X)070-12
CAP**2417A**	0.98	0.93	58CV(A.X)090-16
CNPV*2417A**	0.98	0.92	58CV(A.X)090-16
CNPV*2417A**	0.98	0.92	58CV(A.X)090-16
CSPH*2412A**	0.98	0.93	58CV(A.X)090-16
CNPV*2417A**	0.98	0.93	58MB040-14
CSPH*2412A**	0.98	0.93	58MB040-14
CAP**2417A**	0.98	0.94	58MB060-14
CNPH*2417A**	0.98	0.93	58MB060-14
CNPV*2417A**	0.98	0.93	58MB060-14
CSPH*2412A**	0.98	0.93	58MB060-14
CNPV*2417A**	0.98	0.92	58MB080-14
CSPH*2412A**	0.98	0.92	58MB080-14

See notes on pg. 31

HEAT PUMP HEATING PERFORMANCE CONTINUED

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES deg F																							
		-3			7			17			27			37			47			57			67		
EDB	CFM	Capacity MBtuh		Total System KWT	Capacity MBtuh		Total System KWT	Capacity MBtuh		Total System KWT	Capacity MBtuh		Total System KWT	Capacity MBtuh		Total System KWT	Capacity MBtuh		Total System KWT	Capacity MBtuh		Total System KWT	Capacity MBtuh		Total System KWT
		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*	
25HPA324A30 Outdoor Section With FY4ANF024 Indoor Section																									
65	700	9.87	9.08	1.51	12.23	11.24	1.57	14.94	13.63	1.66	17.99	15.98	1.77	21.37	19.45	1.90	24.27	24.27	2.00	27.08	27.08	2.12	29.76	29.76	2.24
	800	10.04	9.24	1.52	12.43	11.43	1.58	15.20	13.86	1.66	18.25	16.21	1.76	21.50	19.56	1.86	24.01	24.01	1.96	26.53	26.53	2.06	27.89	27.89	2.11
	900	10.20	9.39	1.54	12.62	11.59	1.59	15.40	14.04	1.67	18.47	16.41	1.76	21.42	19.49	1.85	23.71	23.71	1.94	25.56	25.56	2.01	26.28	26.28	2.03
70	700	9.63	8.86	1.58	11.99	11.02	1.65	14.66	13.36	1.74	17.67	15.70	1.85	21.03	19.14	1.99	24.17	24.17	2.10	27.04	27.04	2.23	29.84	29.84	2.36
	800	9.80	9.02	1.59	12.18	11.19	1.66	14.88	13.57	1.74	17.94	15.93	1.84	21.29	19.38	1.96	24.00	24.00	2.06	26.63	26.63	2.17	28.61	28.61	2.25
	900	9.96	9.16	1.61	12.35	11.35	1.67	15.09	13.75	1.74	18.16	16.13	1.84	21.36	19.44	1.95	23.77	23.77	2.04	26.15	26.15	2.14	27.09	27.09	2.16
75	700	9.37	8.62	1.65	11.75	10.79	1.73	14.37	13.10	1.82	17.37	15.43	1.94	20.68	18.82	2.08	24.09	24.09	2.21	26.94	26.94	2.34	29.83	29.83	2.48
	800	9.54	8.78	1.67	11.94	10.97	1.74	14.60	13.31	1.82	17.63	15.66	1.93	20.98	19.09	2.06	23.94	23.94	2.16	26.65	26.65	2.28	29.21	29.21	2.39
	900	9.70	8.93	1.69	12.11	11.12	1.75	14.80	13.49	1.83	17.86	15.86	1.93	21.18	19.28	2.05	23.77	23.77	2.14	26.27	26.27	2.25	27.80	27.80	2.30

Heating Indoor Model	Capacity	Power	Furnace Model
*FY4ANF024	1.00	1.00	
FE4ANF002	0.96	0.89	
FE4ANF003	0.94	0.89	
FF1ENP024	1.00	1.00	
FF1ENP030	1.00	1.00	
FV4BNF002	0.96	0.89	
FV4BNF003	0.94	0.89	
FX4CNF024	0.99	0.95	
FX4CNF030	0.98	0.90	
FY4ANF030	0.98	0.97	
CAP**2414A**	1.00	0.99	
CAP**2417A**	1.00	0.99	
CAP**3014A**	0.92	0.94	
CAP**3017A**	0.92	0.95	
CNPF*2418A**	1.00	0.97	
CNPH*2417A**	1.00	0.97	
CNPH*3017A**	0.92	0.95	
CNPV*2414A**	1.00	0.97	
CNPV*2417A**	1.00	0.97	
CNPV*3014A**	0.92	0.95	
CNPV*3017A**	0.92	0.95	
CSPH*2412A**	0.98	0.96	
CSPH*3012A**	0.89	0.93	
CAP**2414A**	1.00	0.95	58CV(A.X)070-12
CAP**2417A**	1.00	0.92	58CV(A.X)070-12
CNPH*2417A**	1.00	0.93	58CV(A.X)070-12
CNPH*3017A**	0.94	0.92	58CV(A.X)070-12
CNPV*2414A**	1.00	0.93	58CV(A.X)070-12
CNPV*3014A**	0.94	0.92	58CV(A.X)070-12
CSPH*2412A**	0.98	0.93	58CV(A.X)070-12
CSPH*3012A**	0.88	0.90	58CV(A.X)070-12
CAP**2414A**	1.00	0.94	58CV(A.X)090-16
CAP**3017A**	0.94	0.91	58CV(A.X)090-16
CNPH*2417A**	1.00	0.92	58CV(A.X)090-16
CNPH*3017A**	0.93	0.90	58CV(A.X)090-16
CNPV*2412A**	1.00	0.92	58CV(A.X)090-16
CNPV*3012A**	0.93	0.90	58CV(A.X)090-16
CSPH*2412A**	0.98	0.92	58CV(A.X)090-16
CSPH*3012A**	0.92	0.89	58CV(A.X)090-16
CNPV*2417A**	1.00	0.93	58CV(A.X)110-20

Heating Indoor Model	Capacity	Power	Furnace Model
CNPH*3017A**	0.93	0.90	58CV(A.X)110-20
CSPH*2412A**	0.98	0.93	58CV(A.X)110-20
CSPH*3012A**	0.92	0.89	58CV(A.X)110-20
CNPH*2417A**	1.00	0.93	58CV(A.X)135-22
CNPH*3017A**	0.93	0.90	58CV(A.X)135-22
CSPH*2412A**	0.98	0.92	58CV(A.X)135-22
CSPH*3012A**	0.92	0.89	58CV(A.X)135-22
CNPH*2417A**	1.00	0.92	58CV(A.X)155-22
CNPH*3017A**	0.94	0.91	58CV(A.X)155-22
CSPH*2412A**	0.99	0.93	58CV(A.X)155-22
CSPH*3012A**	0.92	0.89	58CV(A.X)155-22
CNPH*2417A**	1.00	0.93	58MB040-14
CNPH*3017A**	0.94	0.91	58MB040-14
CSPH*2412A**	0.99	0.93	58MB040-14
CSPH*3012A**	0.92	0.89	58MB040-14
CAP**2417A**	1.00	0.95	58MB060-14
CAP**3017A**	0.94	0.91	58MB060-14
CNPH*2417A**	1.00	0.93	58MB060-14
CNPH*3017A**	0.94	0.91	58MB060-14
CNPV*2417A**	1.00	0.93	58MB060-14
CNPV*3017A**	0.94	0.91	58MB060-14
CSPH*2412A**	0.98	0.93	58MB060-14
CSPH*3012A**	0.92	0.89	58MB060-14
CNPH*2417A**	1.00	0.93	58MB080-14
CNPH*3017A**	0.94	0.91	58MB080-14
CSPH*2412A**	0.98	0.93	58MB080-14
CSPH*3012A**	0.92	0.89	58MB080-14
CNPH*2417A**	1.00	0.93	58MB080-20
CNPH*3017A**	0.93	0.91	58MB080-20
CSPH*2412A**	0.98	0.93	58MB080-20
CSPH*3012A**	0.92	0.89	58MB080-20
CNPH*2417A**	1.00	0.92	58MB100-20
CNPH*3017A**	0.93	0.90	58MB100-20
CSPH*2412A**	0.98	0.92	58MB100-20
CSPH*3012A**	0.92	0.89	58MB100-20
CNPH*2417A**	1.00	0.93	58MB120-20
CNPH*3017A**	0.94	0.92	58MB120-20
CSPH*2412A**	0.99	0.94	58MB120-20
CSPH*3012A**	0.92	0.90	58MB120-20

See notes on pg. 31

HEAT PUMP HEATING PERFORMANCE CONTINUED

INDOOR AIR		-3				7				17				27				37				47				57				67			
		Capacity MBtuh		Total System KWh†		Capacity MBtuh		Total System KWh†		Capacity MBtuh		Total System KWh†		Capacity MBtuh		Total System KWh†		Capacity MBtuh		Total System KWh†		Capacity MBtuh		Total System KWh†		Capacity MBtuh		Total System KWh†		Capacity MBtuh		Total System KWh†	
EDB	CFM	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*
65	875	11.98	11.02	2.14	15.01	13.80	2.24	18.26	16.65	2.35	21.73	19.30	2.48	25.69	23.38	2.64	29.99	29.99	2.82	34.75	34.75	3.04	39.91	39.91	3.24	45.17	45.17	3.44	50.41	50.41	3.64	55.65	55.65
		12.23	11.25	2.15	15.28	14.04	2.25	18.55	16.92	2.35	22.07	19.60	2.46	26.10	23.75	2.60	30.50	30.50	2.77	35.37	35.37	2.95	40.35	40.35	3.13	45.60	45.60	3.31	50.84	50.84	3.51	56.08	56.08
		12.47	11.47	2.18	15.52	14.26	2.26	18.81	17.15	2.35	22.37	19.87	2.45	26.44	24.06	2.58	30.91	30.91	2.74	35.76	35.76	2.89	40.58	40.58	3.06	45.83	45.83	3.24	51.09	51.09	3.44	56.57	56.57
		11.55	10.63	2.22	14.62	13.43	2.34	17.88	16.30	2.46	21.36	19.97	2.59	25.17	22.91	2.75	29.51	29.51	2.95	34.21	34.21	3.18	39.34	39.34	3.39	44.59	44.59	3.39	49.97	49.97	3.64	55.41	55.41
		11.79	10.85	2.24	14.89	13.68	2.35	18.18	16.58	2.45	21.69	19.26	2.57	25.61	23.31	2.72	30.00	30.00	2.89	34.82	34.82	3.09	39.86	39.86	3.28	45.11	45.11	3.28	50.54	50.54	3.53	55.96	55.96
75	875	12.02	11.06	2.27	15.13	13.90	2.36	18.44	16.81	2.46	21.97	19.51	2.57	26.01	23.67	2.70	30.42	30.42	2.86	35.27	35.27	3.03	40.16	40.16	3.21	45.41	45.41	3.21	50.83	50.83	3.46	56.25	56.25
		11.08	10.20	2.31	14.19	13.04	2.44	17.48	15.94	2.57	20.97	18.62	2.71	24.72	22.49	2.88	29.03	29.03	3.08	33.70	33.70	3.32	38.76	38.76	3.55	43.82	43.82	3.32	49.24	49.24	3.58	54.72	54.72
		11.34	10.43	2.33	14.47	13.30	2.45	17.79	16.22	2.56	21.31	18.93	2.69	25.14	22.87	2.84	29.51	29.51	3.03	34.32	34.32	3.24	39.33	39.33	3.43	44.44	44.44	3.24	49.86	49.86	3.43	55.28	55.28
1125	1125	11.56	10.63	2.36	14.71	13.52	2.46	18.05	16.46	2.57	21.60	19.18	2.69	25.49	23.19	2.82	29.92	29.92	2.99	34.75	34.75	3.18	39.69	39.69	3.35	44.90	44.90	3.18	50.32	50.32	3.43	55.75	55.75

25HPA330A30 Outdoor Section With FY4ANF030 Indoor Section

Heating Indoor Model	Capacity	Power	Furnace Model
*FY4ANF030	1.00	1.00	
F(A,B)4BN(FC)030	1.00	1.03	
F(A,B)4BN(FC)036	1.00	1.03	
FE4ANF002	1.00	0.97	
FE4ANF003	1.00	0.97	
FE4ANF005	1.00	0.92	
FF1DNA030	1.00	1.02	
FF1ENP030	1.00	1.01	
FF1ENP036	1.00	0.99	
FV4BNF002	1.00	0.97	
FV4BNF003	1.00	0.97	
FV4BNF005	1.00	0.92	
FX4BNF030	1.00	1.00	
FX4BNF036	1.00	1.00	
FX4CN(B,F)036	1.00	0.95	
FX4CNF030	1.00	0.97	
FY4ANF036	1.00	1.00	
CAP**3014A**	1.00	1.00	
CAP**3017A**	1.00	1.00	
CAP**3614A**	0.97	0.96	
CAP**3617A**	1.00	0.99	
CAP**3621A**	1.00	0.99	
CNPV*3618A**	1.00	0.99	
CNPV*3017A**	1.00	0.99	
CNPV*3617A**	1.00	0.99	
CNPV*3014A**	1.00	0.99	
CNPV*3017A**	1.00	0.99	
CNPV*3617A**	1.00	0.99	
CNPV*3621A**	1.00	0.99	
CSPH*3012A**	1.00	0.99	
CSPH*3612A**	1.00	0.95	
CAP**3014A**	1.00	1.01	58CV(A.X)070-12
CAP**3614A**	0.97	0.97	58CV(A.X)070-12
CNPV*3017A**	1.00	1.00	58CV(A.X)070-12
CNPV*3621A**	1.00	0.99	58CV(A.X)070-12
CSPH*3012A**	1.00	1.00	58CV(A.X)070-12
CSPH*3612A**	1.00	1.01	58CV(A.X)070-12
CAP**3014A**	1.00	1.00	58CV(A.X)070-12
CAP**3614A**	0.97	0.97	58CV(A.X)070-12
CNPV*3017A**	1.00	1.00	58CV(A.X)070-12
CNPV*3621A**	1.00	0.99	58CV(A.X)070-12
CSPH*3012A**	1.00	1.00	58CV(A.X)070-12
CSPH*3612A**	1.00	0.97	58CV(A.X)070-12
CAP**3017A**	1.00	1.00	58CV(A.X)090-16
CAP**3617A**	1.00	0.99	58CV(A.X)090-16

Heating Indoor Model	Capacity	Power	Furnace Model
CNPV*3017A**	1.00	1.00	58CV(A.X)090-16
CNPV*3617A**	1.00	1.00	58CV(A.X)090-16
CNPV*3017A**	1.00	1.00	58CV(A.X)090-16
CNPV*3617A**	1.00	1.00	58CV(A.X)090-16
CSPH*3012A**	1.00	1.00	58CV(A.X)090-16
CSPH*3612A**	1.00	0.96	58CV(A.X)090-16
CAP**3621A**	1.00	0.99	58CV(A.X)110-20
CNPV*3017A**	1.00	0.99	58CV(A.X)110-20
CNPV*3617A**	1.00	0.99	58CV(A.X)110-20
CNPV*3017A**	1.00	0.99	58CV(A.X)110-20
CNPV*3617A**	1.00	0.99	58CV(A.X)110-20
CSPH*3012A**	1.00	0.99	58CV(A.X)110-20
CSPH*3612A**	1.00	0.96	58CV(A.X)110-20
CNPV*3017A**	1.00	0.99	58CV(A.X)135-22
CNPV*3617A**	1.00	0.99	58CV(A.X)135-22
CNPV*3012A**	1.00	0.99	58CV(A.X)135-22
CNPV*3612A**	1.00	0.96	58CV(A.X)135-22
CSPH*3012A**	1.00	0.99	58CV(A.X)155-22
CSPH*3612A**	1.00	0.99	58CV(A.X)155-22
CAP**3612A**	1.00	0.95	58CV(A.X)155-22
CNPV*3017A**	1.00	1.00	58MB040-14
CNPV*3617A**	1.00	1.00	58MB040-14
CNPV*3012A**	1.00	1.00	58MB040-14
CNPV*3612A**	1.00	0.97	58MB040-14
CSPH*3012A**	1.00	1.01	58MB060-14
CSPH*3612A**	1.00	1.01	58MB060-14
CAP**3617A**	1.00	1.01	58MB060-14
CNPV*3017A**	1.00	1.01	58MB060-14
CNPV*3617A**	1.00	1.01	58MB060-14
CNPV*3017A**	1.00	1.01	58MB060-14
CNPV*3617A**	1.00	0.97	58MB060-14
CSPH*3012A**	1.00	0.99	58MB060-14
CSPH*3612A**	1.00	0.99	58MB060-14
CAP**3621A**	1.00	1.00	58MB080-14
CNPV*3017A**	1.00	1.00	58MB080-14
CNPV*3617A**	1.00	1.00	58MB080-14
CNPV*3017A**	1.00	1.00	58MB080-14
CNPV*3617A**	1.00	1.00	58MB080-14
CSPH*3012A**	1.00	0.96	58MB080-14
CSPH*3612A**	1.00	0.99	58MB080-20
CAP**3621A**	1.00	1.00	58MB080-20
CNPV*3017A**	1.00	1.00	58MB080-20

Heating Indoor Model	Capacity	Power	Furnace Model
CNPV*3617A**	1.00	1.00	58MB080-20
CNPV*3621A**	1.00	1.00	58MB080-20
CSPH*3012A**	1.00	1.00	58MB080-20
CSPH*3612A**	1.00	0.97	58MB080-20
CAP**3621A**	1.00	0.99	58MB100-20
CNPV*3017A**	1.00	1.00	58MB100-20
CNPV*3621A**	1.00	1.00	58MB100-20
CNPV*3012A**	1.00	1.00	58MB100-20
CNPV*3612A**	1.00	0.96	58MB100-20
CSPH*3017A**	1.00	1.00	58MB120-20
CSPH*3617A**	1.00	1.00	58MB120-20
CSPH*3012A**	1.00	0.97	58MB120-20

See notes on pg. 31

HEAT PUMP HEATING PERFORMANCE CONTINUED

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES deg F																															
EDB	CFM	-3				7				17				27				37				47				57				67			
		Capacity MBtuh		Total Sys-tem KWT	Capacity MBtuh		Total Sys-tem KWT	Capacity MBtuh		Total Sys-tem KWT	Capacity MBtuh		Total Sys-tem KWT	Capacity MBtuh		Total Sys-tem KWT	Capacity MBtuh		Total Sys-tem KWT	Capacity MBtuh		Total Sys-tem KWT	Capacity MBtuh		Total Sys-tem KWT	Capacity MBtuh		Total Sys-tem KWT					
		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*	Total	Integ*	Total
28HPA336A30 Outdoor Section With FY4ANF042 Indoor Section																																	
65	1050	15.56	14.32	2.56	19.18	17.62	2.67	23.08	21.05	27.9	27.31	24.26	2.92	32.16	29.27	3.09	37.48	37.48	3.27	43.11	43.11	3.46	48.93	48.93	3.70								
	1200	15.87	14.60	2.59	19.51	17.93	2.68	23.44	21.37	27.9	27.74	24.64	2.91	32.68	29.74	3.06	38.02	38.02	3.20	43.44	43.44	3.38	49.08	49.08	3.58								
	1350	16.14	14.85	2.62	19.80	18.20	2.71	23.75	21.66	28.0	28.11	24.97	2.91	33.10	30.12	3.05	38.32	38.32	3.17	43.57	43.57	3.33	48.47	48.47	3.49								
	1050	15.08	13.88	2.67	18.77	17.25	2.79	22.68	20.68	2.92	26.89	23.88	3.06	31.68	28.83	3.23	36.91	36.91	3.43	42.60	42.60	3.62	48.38	48.38	3.86								
70	1200	15.39	14.16	2.70	19.08	17.54	2.80	23.04	21.01	2.92	27.28	24.23	3.04	32.18	29.28	3.20	37.50	37.50	3.35	42.96	42.96	3.53	48.63	48.63	3.74								
	1350	15.67	14.42	2.73	19.38	17.81	2.83	23.36	21.30	2.93	27.65	24.56	3.04	32.61	29.68	3.19	37.89	37.89	3.32	43.17	43.17	3.48	48.62	48.62	3.67								
	1050	14.59	13.42	2.78	18.32	16.84	2.91	22.26	20.29	3.05	26.48	23.52	3.20	31.08	28.28	3.37	36.41	36.41	3.60	42.06	42.06	3.78	47.80	47.80	4.04								
	1200	14.90	13.71	2.81	18.66	17.15	2.92	22.62	20.63	3.05	26.88	23.87	3.18	31.60	28.76	3.34	36.95	36.95	3.52	42.48	42.48	3.70	48.14	48.14	3.92								
75	1350	15.18	13.97	2.84	18.93	17.40	2.95	22.95	20.92	3.06	27.23	24.18	3.18	32.12	29.23	3.34	37.41	37.41	3.48	42.77	42.77	3.65	48.22	48.22	3.84								

Heating Indoor Model	Capacity	Power	Furnace Model	Heating Indoor Model	Capacity	Power	Furnace Model
*FY4ANF042	1.00	1.00		CNPH*4221A**	0.96	0.96	58CV(A)X110-20
F(A)B4BN(F)CJ042	0.98	1.03		CSPH*3612A**	0.95	0.95	58CV(A)X110-20
F(A)B4BN(F)CJ036	0.98	1.06		CSPH*4212A**	0.96	0.94	58CV(A)X110-20
FE4ANF003	0.95	0.97		CAP**4224A**	0.96	0.97	58CV(A)X135-22
FE4ANF005	0.96	0.91		CNPH*3617A**	0.95	0.99	58CV(A)X135-22
FF1ENP036	0.97	1.03		CNPH*4221A**	0.95	0.96	58CV(A)X135-22
FV4BNF002	0.96	0.99		CSPH*3612A**	0.95	0.95	58CV(A)X135-22
FV4BNF003	0.95	0.97		CSPH*4212A**	0.95	0.94	58CV(A)X135-22
FV4BNF005	0.96	0.91		CAP**4224A**	0.96	0.96	58CV(A)X155-22
FX4BNF036	1.00	1.04		CNPH*3617A**	0.95	0.99	58CV(A)X155-22
FX4BNF042	1.00	1.00		CNPH*4221A**	0.95	0.95	58CV(A)X155-22
FX4CNB(F)J036	0.97	0.97		CSPH*3612A**	0.95	0.94	58CV(A)X155-22
FX4CNB(F)J042	0.98	0.94		CSPH*4212A**	0.95	0.93	58CV(A)X155-22
FY4ANF036	0.97	1.03		CAP**4224A**	0.98	0.98	58WB040-14
CAP**3614A**	0.96	1.01		CNPH*3617A**	0.97	1.02	58WB040-14
CAP**3617A**	0.98	1.02		CNPH*4221A**	0.97	0.98	58WB040-14
CAP**3621A**	0.98	1.02		CSPH*3612A**	0.97	0.97	58WB040-14
CAP**4221A**	1.00	1.01		CSPH*4212A**	0.97	0.95	58WB040-14
CAP**4224A**	0.97	0.99		CAP**3617A**	0.95	1.00	58WB060-14
CNPF*3618A**	0.98	1.02		CNPH*3617A**	0.98	1.00	58WB060-14
CNPH*3617A**	0.98	1.02		CNPH*4221A**	0.98	0.95	58WB060-14
CNPH*4221A**	1.00	1.01		CNPH*3617A**	0.95	0.97	58WB060-14
CNPH*3617A**	0.98	1.02		CSPH*3612A**	0.98	0.94	58WB060-14
CNPH*3621A**	1.00	1.01		CSPH*4212A**	0.98	0.93	58WB060-14
CNPH*3612A**	1.00	1.01		CAP**3621A**	1.00	1.00	58WB060-14
CSPH*3612A**	1.00	0.99		CAP**4221A**	0.98	0.96	58WB060-14
CSPH*4212A**	1.00	0.97		CNPH*3617A**	0.98	1.01	58WB060-14
CAP**3614A**	0.94	0.96	58CV(A)X070-12	CNPH*4221A**	0.98	0.96	58WB060-14
CNPH*3617A**	0.95	0.98	58CV(A)X070-12	CNPH*3612A**	0.98	1.01	58WB060-14
CNPH*4221A**	0.96	0.94	58CV(A)X070-12	CNPH*4212A**	0.98	0.96	58WB060-14
CSPH*3612A**	0.95	0.93	58CV(A)X070-12	CSPH*3612A**	0.98	0.96	58WB060-14
CSPH*4212A**	0.96	0.91	58CV(A)X070-12	CSPH*4212A**	1.00	0.96	58WB060-14
CAP**3617A**	0.95	0.99	58CV(A)X090-16	CAP**3621A**	0.97	0.98	58WB060-14
CNPH*3617A**	0.95	0.96	58CV(A)X090-16	CAP**4221A**	0.96	0.98	58WB060-20
CNPH*4221A**	0.96	0.93	58CV(A)X090-16	CNPH*3617A**	0.96	0.98	58WB060-20
CNPH*3617A**	0.95	0.96	58CV(A)X090-16	CNPH*4221A**	0.96	0.94	58WB060-20
CNPH*3612A**	0.95	0.91	58CV(A)X090-16	CNPH*3612A**	0.97	0.99	58WB060-20
CSPH*3612A**	0.96	0.90	58CV(A)X090-16	CNPH*4221A**	0.96	0.93	58WB060-20
CAP**3621A**	0.95	0.98	58CV(A)X110-20	CSPH*3612A**	0.98	0.95	58WB060-20
CAP**4221A**	1.00	1.02	58CV(A)X110-20	CSPH*4212A**	0.96	0.91	58WB060-20
CNPH*3617A**	0.95	0.99	58CV(A)X110-20	CAP**3621A**	0.95	0.99	58WB100-20
CNPH*4221A**	0.96	0.96	58CV(A)X110-20	CAP**4221A**	0.96	0.97	58WB100-20
CNPH*3617A**	0.95	0.99	58CV(A)X110-20	CNPH*3617A**	0.96	1.01	58WB100-20
CNPH*4221A**	0.95	0.96	58CV(A)X110-20	CNPH*4221A**	0.96	0.97	58WB100-20

See notes on pg. 31

INDOOR AIR			OUTDOOR COIL ENTERING AIR TEMPERATURES deg F																						
EDB	CFM	-3		7			17			27			37			47			57			67			
		Capacity MBtuh		Total Sys-tem KWh	Capacity MBtuh		Total Sys-tem KWh	Capacity MBtuh		Total Sys-tem KWh	Capacity MBtuh		Total Sys-tem KWh	Capacity MBtuh		Total Sys-tem KWh	Capacity MBtuh		Total Sys-tem KWh	Capacity MBtuh		Total Sys-tem KWh			
		Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*				
25HPA342A30 Outdoor Section With FV4ANF042 Indoor Section																									
65	1225	17.48	16.09	2.92	21.54	19.80	3.03	25.92	23.63	3.15	30.72	27.28	3.28	36.22	32.96	3.46	42.15	42.15	3.62	48.15	48.15	3.82	54.40	54.40	4.05
	1400	17.80	16.38	2.96	21.88	20.11	3.05	26.28	23.96	3.16	31.15	27.67	3.30	36.70	33.40	3.45	42.45	42.45	3.58	48.22	48.22	3.75	52.89	52.89	3.90
	1575	18.08	16.64	3.00	22.20	20.40	3.09	26.61	24.26	3.18	31.53	28.00	3.30	37.11	33.77	3.44	42.58	42.58	3.56	48.05	48.05	3.72	50.32	50.32	3.78
70	1225	16.96	15.60	3.05	21.09	19.38	3.17	25.50	23.25	3.30	30.21	26.83	3.44	35.67	32.46	3.62	41.60	41.60	3.79	47.63	47.63	4.00	53.91	53.91	4.24
	1400	17.30	15.92	3.08	21.42	19.68	3.19	25.85	23.57	3.31	30.64	27.21	3.43	36.17	32.92	3.61	42.00	42.00	3.74	47.86	47.86	3.93	53.65	53.65	4.13
	1575	17.59	16.19	3.13	21.73	19.97	3.23	26.18	23.87	3.33	31.02	27.55	3.45	36.59	33.29	3.61	42.21	42.21	3.73	47.78	47.78	3.90	51.27	51.27	4.00
75	1225	16.41	15.09	3.17	20.60	18.93	3.31	25.01	22.81	3.45	29.75	26.42	3.60	35.04	31.89	3.78	40.99	40.99	3.98	47.10	47.10	4.19	53.37	53.37	4.44
	1400	16.73	15.40	3.21	20.92	19.22	3.34	25.39	23.15	3.46	30.16	26.79	3.59	35.63	32.42	3.77	41.50	41.50	3.92	47.40	47.40	4.12	53.39	53.39	4.33
	1575	17.03	15.67	3.26	21.23	19.51	3.37	25.73	23.46	3.48	30.51	27.10	3.60	36.05	32.80	3.77	41.78	41.78	3.90	47.44	47.44	4.08	52.00	52.00	4.23

Heating Indoor Model	Capacity	Power	Furnace Model
CNPH*4821A**	1.00	0.96	58CV(A,X)110-20
CNPV*4212A**	1.00	1.00	58CV(A,X)110-20
CNPV*4821A**	1.00	0.96	58CV(A,X)110-20
CSPH*4212A**	1.00	0.96	58CV(A,X)110-20
CSPH*4812A**	1.00	0.96	58CV(A,X)110-20
CAP*4224A**	1.00	1.01	58CV(A,X)135-22
CAP*4824A**	1.00	0.96	58CV(A,X)135-22
CNPH*4221A**	1.00	1.00	58CV(A,X)135-22
CNPH*4821A**	1.00	0.96	58CV(A,X)135-22
CSPH*4821A**	1.00	0.96	58CV(A,X)135-22
CNPV*4824A**	1.00	0.96	58CV(A,X)135-22
CNPV*4221A**	1.00	1.01	58CV(A,X)155-22
CAP*4824A**	1.00	0.96	58CV(A,X)155-22
CNPH*4221A**	1.00	1.00	58CV(A,X)155-22
CNPH*4821A**	1.00	0.96	58CV(A,X)155-22
CNPV*4824A**	1.00	0.96	58CV(A,X)155-22
CSPH*4212A**	1.00	0.96	58CV(A,X)155-22
CSPH*4812A**	1.00	0.95	58CV(A,X)155-22
CAP*4224A**	1.00	1.04	58WB040-14
CAP*4824A**	1.00	0.99	58WB040-14
CNPH*4221A**	1.00	1.03	58WB040-14
CNPH*4821A**	1.00	0.98	58WB040-14
CNPV*4824A**	1.00	0.98	58WB040-14
CSPH*4212A**	1.00	0.98	58WB040-14
CSPH*4812A**	1.00	0.98	58WB040-14
CAP*4817A**	0.98	0.95	58WB060-14
CNPH*4221A**	1.00	1.02	58WB060-14
CNPH*4821A**	1.00	0.97	58WB060-14
CSPH*4212A**	1.00	0.98	58WB060-14
CSPH*4812A**	1.00	0.97	58WB060-14
CAP*4221A**	1.00	1.04	58WB080-14
CAP*4821A**	1.00	0.99	58WB080-14
CNPH*4221A**	1.00	1.03	58WB080-14
CNPH*4821A**	1.00	0.98	58WB080-14
CNPV*4221A**	1.00	1.03	58WB080-14
CNPV*4821A**	1.00	0.98	58WB080-14
CSPH*4212A**	1.00	0.99	58WB080-14
CSPH*4812A**	1.00	0.98	58WB080-14

See notes on pg. 31

INDOOR AIR			OUTDOOR COIL ENTERING AIR TEMPERATURES deg F																						
EDB	CFM	-3		7			17			27			37			47			57			67			
		Capacity MBtuH Total	Total Sys-tem KWh Integ*	Capacity MBtuH Total	Total Sys-tem KWh Integ*	Capacity MBtuH Total	Total Sys-tem KWh Integ*	Capacity MBtuH Total	Total Sys-tem KWh Integ*	Capacity MBtuH Total	Total Sys-tem KWh Integ*	Capacity MBtuH Total	Total Sys-tem KWh Integ*	Capacity MBtuH Total	Total Sys-tem KWh Integ*	Capacity MBtuH Total	Total Sys-tem KWh Integ*	Capacity MBtuH Total	Total Sys-tem KWh Integ*	Capacity MBtuH Total	Total Sys-tem KWh Integ*				
65	1400	19.93	18.34	3.20	24.80	22.79	3.32	29.95	27.31	3.43	35.44	31.48	3.56	41.44	37.71	3.71	47.96	47.96	3.88	55.70	55.70	4.06	63.62	63.62	4.28
	1600	20.38	18.75	3.25	25.27	23.22	3.35	30.46	27.77	3.45	35.98	31.96	3.57	41.85	38.09	3.69	48.72	48.72	3.85	56.46	56.46	3.99	64.17	64.17	4.18
	1800	20.78	19.12	3.31	25.69	23.61	3.40	30.91	28.18	3.49	36.45	32.37	3.59	42.40	38.58	3.70	49.38	49.38	3.84	56.91	56.91	3.96	64.52	64.52	4.13
70	1400	19.20	17.67	3.33	24.16	22.20	3.46	29.32	26.74	3.59	34.87	30.97	3.73	40.71	37.05	3.88	47.09	47.09	4.06	54.84	54.84	4.26	62.83	62.83	4.48
	1600	19.68	18.10	3.39	24.61	22.61	3.50	29.85	27.21	3.61	35.42	31.46	3.73	41.30	37.59	3.86	48.00	48.00	4.03	55.73	55.73	4.18	63.38	63.38	4.37
	1800	20.08	18.47	3.44	25.04	23.01	3.55	30.31	27.63	3.64	35.90	31.89	3.75	41.92	38.15	3.87	48.64	48.64	4.02	56.26	56.26	4.14	63.81	63.81	4.32
75	1400	18.42	16.94	3.46	23.44	21.54	3.60	28.67	26.14	3.75	34.26	30.43	3.90	40.12	36.51	4.06	46.35	46.35	4.24	53.98	53.98	4.47	61.98	61.98	4.69
	1600	18.86	17.36	3.51	23.93	21.99	3.64	29.20	26.62	3.77	34.82	30.93	3.90	40.73	37.06	4.04	47.10	47.10	4.20	54.94	54.94	4.38	62.64	62.64	4.58
	1800	19.27	17.33	3.57	24.35	22.37	3.69	29.66	27.04	3.80	35.32	31.37	3.92	41.25	37.54	4.05	47.76	47.76	4.19	55.56	55.56	4.34	63.07	63.07	4.52

Heating Indoor Model	Capacity	Power	Furnace Model
*F4ANF048	1.00	1.00	
F(A,B)4BN(F,B,C)048	1.01	1.04	
F(A,B)4BN(F,B,C)060	1.02	1.03	
F44BNB070	1.02	0.99	
FE4ANB006	0.98	0.92	
FE4ANF005	0.98	0.96	
F44BNB006	0.98	0.92	
F44BNF005	0.98	0.96	
F44BNB060	1.02	0.99	
F44BNF048	1.01	1.01	
FX4CN(B,F)048	1.00	0.95	
FX4CN(B,F)060	1.00	0.91	
FY4ANB060	1.02	0.99	
CAP**4817A**	0.99	1.00	
CAP**4821A**	1.01	1.00	
CAP**4824A**	1.01	1.00	
CAP**6021A**	1.01	0.98	
CAP**6024A**	1.01	0.98	
CNPF*4818A**	0.99	1.03	
CNPH*4821A**	1.01	1.00	
CNPH*6024A**	1.01	0.99	
CNPV*4821A**	1.00	1.00	
CNPV*4824A**	1.01	1.00	
CNPV*6024A**	1.01	1.00	
CSPH*4812A**	1.01	0.99	
CSPH*4812A**	0.98	0.98	58CV(A,X)090-16
CAP**4817A**	0.98	0.98	58CV(A,X)090-16
CNPH*4821A**	0.98	0.99	58CV(A,X)090-16
CNPH*6024A**	0.98	0.97	58CV(A,X)090-16
CSPH*4812A**	0.98	0.98	58CV(A,X)090-16
CSPH*4812A**	0.98	0.96	58CV(A,X)090-16
CAP**4821A**	0.98	0.99	58CV(A,X)110-20
CNPH*4821A**	0.98	0.98	58CV(A,X)110-20
CNPH*6024A**	0.98	0.97	58CV(A,X)110-20
CNPV*4821A**	0.98	0.97	58CV(A,X)110-20
CNPV*4824A**	0.98	0.98	58CV(A,X)110-20

Heating Indoor Model	Capacity	Power	Furnace Model
CNPH*4821A**	0.97	0.97	58CV(A,X)135-22
CNPH*6024A**	0.98	0.96	58CV(A,X)135-22
CNPV*4824A**	0.97	0.97	58CV(A,X)135-22
CNPV*6024A**	0.98	0.96	58CV(A,X)135-22
CSPH*4812A**	0.98	0.97	58CV(A,X)135-22
CSPH*6012A**	0.98	0.95	58CV(A,X)135-22
CAP**4824A**	0.97	0.96	58CV(A,X)155-22
CAP**6024A**	0.98	0.95	58CV(A,X)155-22
CNPH*4821A**	0.97	0.96	58CV(A,X)155-22
CNPH*6024A**	0.98	0.95	58CV(A,X)155-22
CNPV*4824A**	0.97	0.96	58CV(A,X)155-22
CNPV*6024A**	0.98	0.95	58CV(A,X)155-22
CSPH*4812A**	0.98	0.98	58CV(A,X)155-22
CSPH*6012A**	0.98	0.94	58CV(A,X)155-22
CAP**4821A**	0.98	1.00	58MV/B080-20
CAP**6021A**	0.98	0.98	58MV/B080-20
CNPH*4821A**	0.98	1.00	58MV/B080-20
CNPH*6024A**	0.98	0.98	58MV/B080-20
CNPV*4821A**	0.98	1.00	58MV/B080-20
CNPV*6024A**	0.98	0.99	58MV/B080-20
CSPH*4812A**	0.98	0.99	58MV/B080-20
CSPH*6012A**	0.98	0.97	58MV/B100-20
CAP**4821A**	0.98	0.97	58MV/B100-20
CAP**6021A**	0.98	0.97	58MV/B100-20
CNPH*4821A**	0.98	0.98	58MV/B100-20
CNPH*6024A**	0.98	0.99	58MV/B100-20
CNPV*4821A**	0.98	0.98	58MV/B100-20
CNPV*6024A**	0.98	0.98	58MV/B100-20
CSPH*4812A**	0.98	0.98	58MV/B100-20
CSPH*6012A**	0.98	0.97	58MV/B100-20
CAP**4824A**	0.98	0.99	58MV/B120-20
CAP**6024A**	0.98	0.98	58MV/B120-20
CNPH*4821A**	0.98	0.99	58MV/B120-20
CNPH*6024A**	0.98	0.99	58MV/B120-20
CNPV*4824A**	0.98	0.98	58MV/B120-20
CNPV*6024A**	0.98	0.99	58MV/B120-20
CSPH*4812A**	0.98	0.99	58MV/B120-20
CSPH*6012A**	0.98	0.97	58MV/B120-20

30

HEAT PUMP HEATING PERFORMANCE CONTINUED

INDOOR AIR			OUTDOOR COIL ENTERING AIR TEMPERATURES deg F																					
EDB	CFM	-3		7		17		27		37		47		57		67								
		Capacity MBtuh		Total Sys-tem KWh	Capacity MBtuh		Total Sys-tem KWh	Capacity MBtuh		Total Sys-tem KWh	Capacity MBtuh		Total Sys-tem KWh	Capacity MBtuh		Total Sys-tem KWh	Capacity MBtuh		Total Sys-tem KWh					
		Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*					
25HPA360A30 Outdoor Section With FY4ANF060 Indoor Section																								
65	1750	26.24	24.14	3.94	31.95	29.36	4.08	38.09	34.73	4.24	44.72	39.72	4.42	52.43	47.72	4.64	60.68	60.68	69.10	69.10	5.09	77.85	77.85	5.39
	2000	26.76	24.62	4.00	32.50	29.86	4.13	38.66	35.25	4.27	45.36	40.28	4.43	53.28	48.49	4.61	61.13	61.13	69.26	69.26	5.01	73.56	73.56	5.12
	2250	27.24	25.06	4.08	33.00	30.33	4.20	39.18	35.73	4.33	45.94	40.80	4.47	53.94	49.08	4.62	61.31	61.31	67.91	67.91	4.95	69.91	69.91	4.97
70	1750	25.64	23.59	4.12	31.38	28.84	4.27	37.56	34.25	4.45	44.16	39.22	4.64	51.57	46.93	4.86	60.00	60.00	68.39	68.39	5.34	77.27	77.27	5.65
	2000	26.16	24.07	4.19	31.94	29.35	4.33	38.14	34.78	4.48	44.80	39.79	4.65	52.44	47.72	4.84	60.50	60.50	68.64	68.64	5.25	74.17	74.17	5.41
	2250	26.65	24.51	4.27	32.45	29.82	4.39	38.67	35.26	4.53	45.37	40.30	4.68	53.16	48.37	4.84	60.81	60.81	68.60	68.60	5.22	71.01	71.01	5.26
75	1750	25.00	23.00	4.31	30.79	28.30	4.48	37.00	33.74	4.66	43.60	38.72	4.86	50.81	46.23	5.09	59.33	59.33	67.64	67.64	5.59	76.51	76.51	5.92
	2000	25.53	23.49	4.38	31.35	28.81	4.53	37.59	34.28	4.69	44.23	39.28	4.87	51.61	46.96	5.08	59.86	59.86	68.03	68.03	5.51	74.47	74.47	5.70
	2250	26.02	23.93	4.46	31.86	29.27	4.59	38.13	34.77	4.74	44.80	39.79	4.90	52.35	47.63	5.08	60.23	60.23	68.15	68.15	5.47	71.67	71.67	5.55

Heating Indoor Model	Capacity	Power	Furnace Model
*FY4ANB060	1.00	1.00	
FE4ANB060	0.98	0.94	
FV4ANB060	0.98	0.94	
FX4CN(B)060	0.98	0.94	
CAP**6021A**	0.98	0.99	
CAP**6024A**	0.99	0.98	
CNPH*6024A**	0.99	0.98	
CNPV*6024A**	0.99	0.99	
CSPH*6012A**	0.99	0.97	

Heating Indoor Model	Capacity	Power	Furnace Model
CAP**6021A**	0.97	0.98	58CV(A,X)110-20
CNPH*6024A**	0.98	0.99	58CV(A,X)110-20
CSPH*6012A**	0.98	0.98	58CV(A,X)110-20
CAP**6024A**	0.98	0.98	58CV(A,X)135-22
CNPH*6024A**	0.98	0.99	58CV(A,X)135-22
CNPV*6024A**	0.98	0.99	58CV(A,X)135-22
CSPH*6012A**	0.98	0.96	58CV(A,X)135-22
CAP**6024A**	0.97	0.96	58CV(A,X)155-22
CNPH*6024A**	0.97	0.97	58CV(A,X)155-22
CNPV*6024A**	0.98	0.98	58CV(A,X)155-22
CSPH*6012A**	0.97	0.95	58CV(A,X)155-22

NOTE: When the required data falls between the published data, interpolation may be performed. Extrapolation is not an acceptable practice.

* The Btuh heating capacity values shown are net integrated values from which the defrost effect has been subtracted. The Btuh heating from supplement heaters should be added to those values to obtain total system capacity.

† The kW values include the compressor, outdoor fan motor, and indoor blower motor. The kW from supplement heaters should be added to these values to obtain total system kilowatts.

EDB — Entering Dry Bulb

GUIDE SPECIFICATIONS

GENERAL

System Description

Outdoor-mounted, air-cooled, split-system heat pump unit suitable for ground or rooftop installation. Unit consists of a hermetic compressor, an air-cooled coil, propeller-type condenser fan, and a control box. Unit will discharge supply air upward as shown on contract drawings. Unit will be used in a refrigeration circuit to match up to a packaged fan coil or coil unit.

Quality Assurance

- Unit will be rated in accordance with the latest edition of ARI Standard 240.
- Unit will be certified for capacity and efficiency, and listed in the latest ARI directory.
- Unit construction will comply with latest edition of ANSI/ASHRAE and with NEC.
- Unit will be constructed in accordance with UL standards and will carry the UL label of approval. Unit will have C-UL approval.
- Unit cabinet will be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 500-hr salt spray test.
- Air-cooled condenser coils are pressure tested and the outdoor units are leak tested.
- Unit constructed in ISO9001 approved facility.

Delivery, Storage, and Handling

- Unit will be shipped as single package only and is stored and handled per unit manufacturer's recommendations.

Warranty (for inclusion by specifying engineer)

- U.S. and Canada only.

PRODUCTS

Equipment

- Factory assembled, single piece, air-cooled heat pump unit. Contained within the unit enclosure is all factory wiring, piping, controls, compressor, refrigerant charge Puron® (R-410A), and special features required prior to field start-up.

Unit Cabinet

- Unit cabinet will be constructed of galvanized steel, bonderized, and coated with a powder coat paint.

Fans

- Condenser fan will be direct-drive propeller type, discharging air upward.

AIR-COOLED, SPLIT-SYSTEM HEAT PUMP

25HPA3

1-1/2 TO 5 NOMINAL TONS

- Condenser fan motors will be totally enclosed, 1-phase type with class B insulation and permanently lubricated bearings.
- Shafts will be corrosion resistant.
- Fan blades will be statically and dynamically balanced.
- Condenser fan openings will be equipped with steel wire safety guards.

Compressor

- Compressor will be hermetically sealed.
- Compressor will be mounted on rubber vibration isolators.

Condenser Coil

- Condenser coil will be air cooled.
- Coil will be constructed of aluminum fins mechanically bonded to copper tubes which are then cleaned, dehydrated, and sealed.

Refrigeration Components

- Refrigeration circuit components will include liquid-line shutoff valve with sweat connections, vapor-line shutoff valve with sweat connections, system charge of Puron® (R-410A) refrigerant, POE compressor oil, accumulator, and reversing valve.

Operating Characteristics

- The capacity of the unit will meet or exceed _____ Btuh at a suction temperature of _____ °F. The power consumption at full load will not exceed _____ kW.
- Combination of the unit and the evaporator or fan coil unit will have a total net cooling capacity of _____ Btuh or greater at conditions of _____ CFM entering air temperature at the evaporator at _____ °F wet bulb and _____ °F dry bulb, and air entering the unit at _____ °F.
- The system will have a SEER of _____ Btuh/watt or greater at DOE conditions.

Electrical Requirements

- Nominal unit electrical characteristics will be _____ v, single phase, 60 hz. The unit will be capable of satisfactory operation within voltage limits of _____ v to _____ v.
- Unit electrical power will be single point connection.
- Control circuit will be 24v.

Special Features

- Refer to section of this literature identifying accessories and descriptions for specific features and available enhancements.