




Product Data

58MCA 4-Way Multipoise Fixed-Capacity Condensing Gas Furnace

Series 131
Input Capacities: 40,000 thru 120,000 Btuh

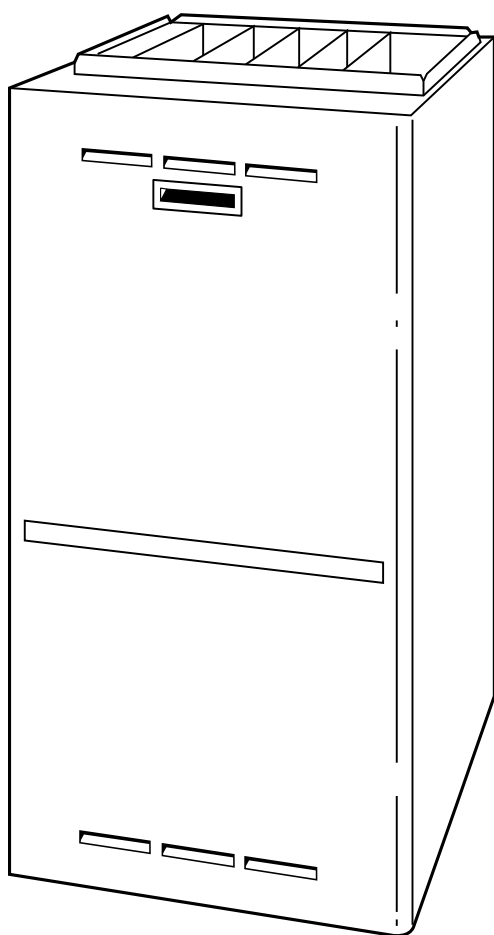

High Efficiency and Flexibility Designed to Meet the Needs of New Homes

The model 58MCA combines high efficiency with flexibility to meet the changing needs of new home construction. The unique 4-way, multipoise design of the 58MCA allows for installation in upflow, downflow, horizontal left, and horizontal right orientations, meaning it is perfect for a variety of installation applications. The 58MCA can be installed in a manufactured (mobile) home when the optional kit is used. The furnace is factory configured for upflow application but can easily be made ready for downflow or horizontal installation.

Horizontal applications offer the advantage of reduced space requirements by locating the furnace in an attic or crawlspace, freeing space formerly dedicated to a furnace or utility room.

The 58MCA is specifically designed to meet the needs of home builders and new home owners. Home builders benefit from the 58MCA's unmatched flexibility and by building a reputation of using quality appliances in homes. Home owners benefit by energy savings from 1 of the most important home appliances.

The components of the 58MCA represent the finest in the industry. Hot surface ignition (HSI) and an integrated control center provide reliable and efficient ignition. The inducer and inducer motor are unique in that efficient operation is achieved

in any type of installation. Standard 2-in. PVC pipe connects the combustion-air and vent pipes to the furnace. The primary and secondary heat exchangers are backed by a 25-year Limited Warranty.

The 58MCA is a standard part of a quality-built new home. This high-efficiency furnace will provide years of quality service to home builders and home owners alike.

As with other Carrier furnaces, this model is designed to work as a part of the total home comfort system which includes elements for cooling, air cleaning, humidification, ventilation, and zoning.

58MCA FEATURES/ BENEFITS

Casing—One piece, seamless wrap-around construction of heavy, galvanized steel resists corrosion.

Certifications—The 58MCA units are A.G.A. and C.G.A. design certified for use with natural and propane gases. The efficiency is GAMA efficiency rating certified. The 58MCA meets California Air Quality Management District

emission requirements. The 58MCA can be installed in a manufactured (mobile) home when the optional kit is used.

Warranties—25-year Limited Warranty on the heat exchangers. One-year Warranty on integrated control center, HSI, and inducer motor. Contact your dealer for details.

Combustion Products Venting—The combustion-air and vent pipes can terminate through a side wall or through the roof when used with a factory-authorized vent termination kit.

Blower Access Panel Switch—Shuts off all 115-v power through furnace components whenever blower access panel is opened.

Hot Surface Ignitor—No pilot flame to waste gas or cause ignition problems.

Slow Opening Redundant Gas Valve—The slow opening feature reduces start-up noise from rapid ignition.

Insulation—Foil-faced insulation in heat exchanger section of the casing minimizes heat loss.

Integrated Control Center—



Controls sequencing and furnace operation. Equipped with a component test feature and status indicator light to assist in troubleshooting. Control times blower start after main burners ignite to eliminate cold air blowing into rooms.

Adjustable Blower Speed—For precise airflow selection of heating or cooling operation.

Direct Vent Sealed Combustion System—Model 58MCA uses 100% outdoor air, which results in especially quiet operation. Direct venting also minimizes the possibility of chloride contamination which can result in heat exchanger corrosion; also reduces air infiltration into the home increasing comfort.


Monoport Burners—The burners are finely tuned for smooth, quiet combustion plus economical gas usage.

Serpentuff™—Exclusive Serpentuff coating, a patented Polypropylene laminate is used on the secondary heat exchanger.




A92505

HEAT EXCHANGERS

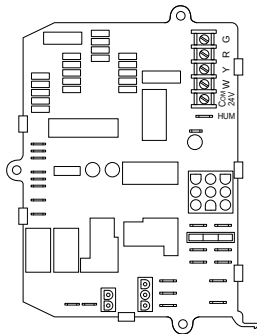

A95246

CONTROL CENTER

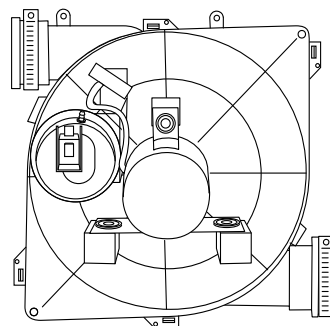

A94152

INDUCER ASSEMBLY

Model number nomenclature

58MCA	040	131	08
4-Way Multipoise Fixed-Capacity Condensing Gas Furnace			
Input Capacity 040 — 40,000 Btuh 100 — 100,000 Btuh 060 — 60,000 Btuh 120 — 120,000 Btuh 080 — 80,000 Btuh		Cooling Airflow (Nominal 400 CFM per 12,000 Btuh Cooling) 08 — 800 CFM 12 — 1200 CFM 16 — 1600 CFM 20 — 2000 CFM	
		Series	


Carrier accessories*

UNIT SIZE	040-08 040-12	060-08 060-12 060-16	080-12 080-16 080-20	100-16 100-20	120-20
ELECTRONIC AIR CLEANER (EAC)	Model 31KAX				
HUMIDIFIER	Models 49BF, 49BG, 49FH, 49FP, and 49WS				
TWINNING KIT (Upflow Only)	N/A	KGATW0401HSI†			
MANUFACTURED (Mobile) HOME KIT	KGAMH0101KIT				
RETURN-AIR PLENUM (With Washable Filters) Upflow Only	KGARP0201ALL				
SIDE FILTER RACK (Without Filter) Upflow Only	KGAFR0206ALL				
CONDENSATE FREEZE PROTECTION KIT	KGAHT0101CFP				
GAS CONVERSION KIT—NATURAL-TO-PROPANE	KGANP2001ALL				
GAS CONVERSION KIT—PROPANE-TO-NATURAL	KGAPN1601ALL				
DOWNFLOW BASE (For Combustible Floors, with or without A/C Coil)	KGASB0201ALL				
VENT TERMINATION KIT (Bracket Only for 2 Pipes)	2-in.—KGAVT0101BRA		3-in.—KGAVT0201BRA		
CONCENTRIC TERMINATION KIT (Single Exit)	2-in.—KGAVT0501CVT		3-in.—KGAVT0601CVT		
SIDEWALL VENT TERMINAL COVER	2-in.—KGAVT0301COV		3-in.—KGAVT0401COV		

* Factory-authorized and field-installed. Gas conversion kits are A.G.A. recognized.

† For 16 and 20 sizes only and in upflow application ONLY. See kit Installation Instructions for details.

N/A — Not Applicable




A93067

RETURN-AIR PLENUM

Custom-made return-air plenum can be mounted on either side of the furnace. Two framed washable filters included.

A	25 in.
B	16 in.
C	39-7/8 in.



A93068

SIDE FILTER RACK

Custom-made filter rack for easy connection when a return plenum already exists. Provides easy access for cleaning filter. Accepts one 16 x 25 x 1 in. filter.

A	23-1/8 in.
B	2-3/8 in.
C	14-1/2 in.




A93086

CONCENTRIC VENT

A concentric vent kit allows vent and combustion-air pipes to terminate through a single exit in a roof or sidewall.

One pipe runs inside the other allowing venting through the inner pipe and combustion air to be drawn through the outer pipe.




A91465

INDOOR AIR QUALITY

EAC (shown) cleans the air of smoke, dirt, and many pollens.

A Carrier humidifier will add moisture to winter-dry air to improve comfort and help keep household items in better condition. Moisturizing household air also helps to retain body heat and provide comfort at lower temperature.

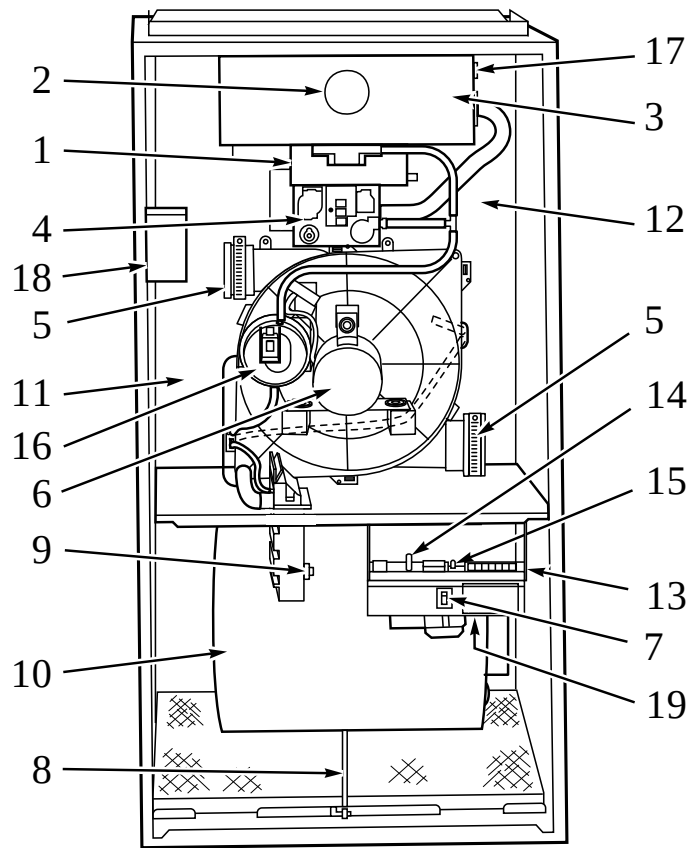

A96000

NOTES:

1. The 58MCA Furnaces are for use with natural gas, but can be field-converted for propane gas with a factory-authorized and listed accessory conversion kit.
2. Component location and configuration may be different than shown above.

- | | |
|---|--|
| <p>1 Combustion-air intake connection to ensure contaminant-free air (right or left side).</p> <p>2 Burner sight glass for viewing burner flame.</p> <p>3 Burner assembly (inside). Operates with energy-saving, inshot burners and hot surface ignitor for safe, dependable heating.</p> <p>4 Redundant gas valve. Safe, efficient. Features 1 gas control with 2 internal shutoff valves.</p> <p>5 Vent outlet. Uses PVC pipe to carry vent gases from the furnace's combustion system (right or left side).</p> <p>6 Inducer motor. Pulls hot flue gases through the heat exchangers, maintaining negative pressure for added safety.</p> <p>7 Blower access panel safety interlock switch.</p> <p>8 Air filter and retainer. May be used for side return application.</p> <p>9 Condensate drain connection. Collects moisture condensed during the combustion process.</p> <p>10 Heavy-duty blower. Circulates air across the heat exchangers to transfer heat into the home.</p> | <p>11 Secondary condensing heat exchanger (inside). Wrings out more heat through condensation. Constructed with Polypropylene-laminated steel to ensure durability.</p> <p>12 Primary serpentine heat exchanger (inside). Stretches fuel dollars with the S-shaped heat-flow design. Solid construction of corrosion-resistant aluminized steel means reliability.</p> <p>13 Control center.</p> <p>14 3-amp fuse provides electrical and component protection.</p> <p>15 Light emitting diode (LED) on control center. Code lights are for diagnosing furnace operation and service requirements.</p> <p>16 Pressure switch ensures adequate flow of flue products through furnace and out vent system.</p> <p>17 Rollout switch (manual reset) to prevent overtemperature.</p> <p>18 Junction box for 115-v electrical power supply.</p> <p>19 Transformer (24v) behind control center provides low-voltage power to furnace control center and thermostat.</p> |
|---|--|

Physical data

UNIT SIZE	040-08	040-12	060-08	060-12	060-16	080-12	080-16	080-20	100-16	100-20	120-20
OUTPUT CAPACITY BTUH* (Nonweatherized ICS)	37,200	37,200	55,800	55,800	55,800	74,400	74,400	74,400	93,000	93,000	111,600
INPUT BTUH†	40,000	40,000	60,000	60,000	60,000	80,000	80,000	80,000	100,000	100,000	120,000
SHIPPING WEIGHT (Lb)	149	152	156	163	166	172	175	197	193	196	228
CERTIFIED TEMP RISE RANGE (°F)	30—60	15—45	45—75	30—60	20—50	40—70	30—60	20—50	45—75	30—60	40—70
CERTIFIED EXT STATIC PRESSURE (In. wc)	Heating	0.10	0.10	0.12	0.12	0.12	0.15	0.15	0.15	0.20	0.20
	Cooling	0.50	0.50	0.50	0.50	0.50	0.50	0.50	0.50	0.50	0.50
AIRFLOW CFM‡	Heating	740	1035	740	1260	1320	1155	1285	1785	1315	1690
	Cooling	895	1230	900	1250	1545	1255	1525	1925/ 2035	1570	1930/ 2130
LIMIT CONTROL	SPST										
HEATING BLOWER CONTROL (Off Delay)	Factory-set at 135 sec										
BURNERS (Monoport)	2	2	3	3	3	4	4	4	5	5	6
GAS CONNECTION SIZE	1/2-in. NPT										
GAS VALVE (Redundant) Manufacturer	White-Rodgers										
Minimum Inlet Pressure (In. wc)	4.5 (Natural Gas)										
Maximum Inlet Pressure (In. wc)	13.6 (Natural Gas)										
IGNITION DEVICE	Hot Surface										

* Capacity in accordance with U.S. Government DOE test procedures.

† Gas input ratings are certified for elevations to 2000 ft. For elevations above 2000 ft, reduce ratings 4% for each 1000 ft above sea level. In Canada, derate the unit 10% for elevations 2000 to 4500 ft above sea level.

‡ Air delivery above 1800 CFM requires that both sides, or a combination of 1 side and bottom, or bottom only of the furnace be used for return air. Where 2 sets of data are listed, the first set is for bottom only return-air supply. The second set is for both sides, or 1 side and bottom return-air supply. A filter is required for each return-air supply.

ICS—Isolated Combustion System

Dimensions

CONCENTRIC VENT


DIMENSIONS (In.)

PART NO.	A*	B	C	D†
KGAVT0501CVT	41-1/8	2	3-1/2	27-1/4
KGAVT0601CVT	46-3/4	3	4-1/2	31-7/8

* Dimension A will change accordingly as dimension D is lengthened or shortened.

† Dimension D may be lengthened to 60 in. maximum. Dimension D may also be shortened by cutting the pipes provided in the kit to 12 in. minimum.

CONDENSATE TRAP

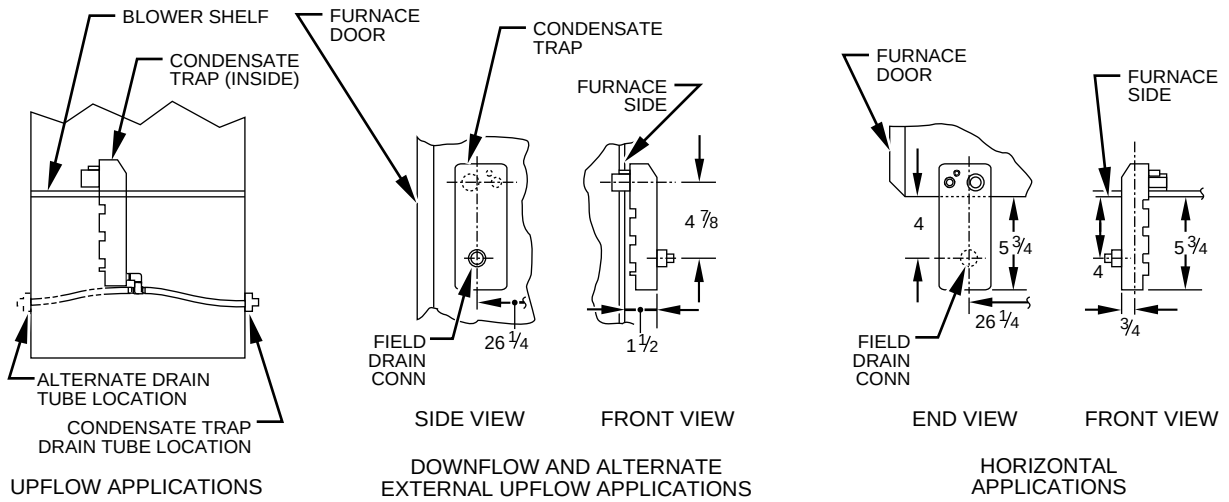

A93026

MEETS DOE RESIDENTIAL CONSERVATION SERVICES PROGRAM STANDARDS.

Before purchasing this appliance, read important energy cost and efficiency information available from your retailer.

As an ENERGY STAR Partner, Carrier Corporation has determined that this product meets the ENERGY STAR guidelines for energy efficiency.



Performance data

UNIT SIZE	040-08	040-12	060-08	060-12	060-16	080-12	080-16	080-20	100-16	100-20	120-20
DIRECT-DRIVE MOTOR Hp (PSC)	1/5	1/3	1/5	1/3	1/2	1/3	1/2	3/4	1/2	3/4	3/4
MOTOR FULL LOAD AMPS	4.9	5.8	4.9	5.8	7.9	5.8	7.9	11.1	7.9	11.1	11.1
RPM (Nominal) —SPEEDS	1075—3	1075—4	1075—3	1075—4							
BLOWER WHEEL DIAMETER X WIDTH (In.)	10 x 6	10 x 7	10 x 6	10 x 7	11 x 8	10 x 7	11 x 8	11 x 10	11 x 8	11 x 10	11 x 10
FILTER SIZE (In.)—(Washable)	(1) 16 x 25 x 1							(1) 20 x 25 x 1		(2) 16x25x1	

PSC—Permanent Split Capacitor

EFFICIENCY

UNIT SIZE	040-08	040-12	060-08	060-12	060-16	080-12	080-16	080-20	100-16	100-20	120-20
CAPACITY* Nonweatherized ICS	37,200	37,200	55,800	55,800	55,800	74,400	74,400	74,400	93,000	93,000	111,600
AFUE%* Nonweatherized ICS	90.5	90.5	90.5	90.5	90.5	90.5	90.5	90.5	90.5	90.5	90.5

* Capacity and AFUE in accordance with U.S. Government DOE test procedures.

ICS—Isolated Combustion System

AIR DELIVERY—CFM (With Filter)*

UNIT SIZE	RETURN-AIR SUPPLY	SPEED	EXTERNAL STATIC PRESSURE (In. wc)							
			0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
040-08	1 side or bottom	High	1075	1040	995	945	895	840	760	670
		Med-Low	850	825	780	740	685	635	560	480
		Low	740	700	650	620	565	515	455	385
040-12	1 side or bottom	High	1500	1445	1370	1300	1230	1145	1030	910
		Med-High	1370	1310	1255	1195	1130	1040	950	840
		Med-Low	1205	1160	1125	1070	1020	940	855	760
		Low	1035	1005	970	930	885	825	745	675
060-08	1 side or bottom	High	1100	1065	1005	945	900	805	730	610
		Med-Low	890	865	810	765	705	620	540	475
		Low	745	710	670	625	565	505	425	360
060-12	1 side or bottom	High	1505	1445	1385	1320	1250	1170	1090	1005
		Med-High	1415	1360	1295	1235	1170	1100	1010	920
		Med-Low	1270	1230	1170	1120	1050	985	905	810
		Low	1080	1045	1005	965	915	855	785	705
060-16	1 side or bottom	High	1700	1695	1640	1580	1545	1450	1380	1310
		Med-High	1500	1465	1435	1385	1355	1300	1250	1185
		Med-Low	1325	1295	1265	1230	1190	1150	1105	1050
		Low	1205	1170	1145	1110	1080	1035	990	950
080-12	1 side or bottom	High	1525	1465	1400	1335	1255	1175	1070	960
		Med-High	1385	1330	1280	1220	1155	1075	985	880
		Med-Low	1165	1150	1115	1060	1005	940	865	780
		Low	1000	985	950	905	860	790	725	655
080-16	1 side or bottom	High	1750	1685	1635	1575	1525	1445	1380	1310
		Med-High	1495	1455	1405	1355	1305	1250	1185	1120
		Med-Low	1310	1260	1225	1170	1125	1095	1040	980
		Low	1135	1105	1075	1040	995	995	910	860
080-20	bottom only	High	2200	2175	2085	2025	1925	1820	1735	1635
		Med-High	2100	2025	1945	1865	1785	1700	1620	1540
		Med-Low	1815	1760	1720	1670	1620	1550	1480	1405
		Low	1560	1555	1515	1460	1435	1390	1340	1270
	both sides or 1 side and bottom	High	2360	2280	2210	2130	2035	1960	1875	1790
		Med-High	1965	1925	1870	1830	1760	1710	1670	1575
100-16	1 side or bottom	High	1740	1705	1660	1615	1570	1500	1425	1355
		Med-High	1500	1470	1445	1410	1375	1330	1280	1210
		Med-Low	1340	1315	1300	1270	1235	1200	1140	1095
		Low	1195	1175	1165	1130	1100	1070	1030	975
100-20	bottom only	High	2250	2175	2090	2020	1930	1855	1760	1670
		Med-High	2020	1950	1900	1840	1790	1710	1640	1545
		Med-Low	1725	1690	1660	1630	1575	1520	1460	1370
		Low	1490	1480	1460	1440	1380	1340	1295	1230
	both sides or 1 side and bottom	High	2360	2315	2265	2200	2130	2055	1965	1890
		Med-High	1960	1940	1930	1900	1850	1800	1740	1660
120-20	bottom only	High	2350	2250	2160	2070	2000	1885	1790	1635
		Med-High	2100	2015	1955	1875	1810	1710	1650	1540
		Med-Low	1770	1720	1675	1620	1575	1515	1450	1365
		Low	1545	1520	1465	1415	1365	1325	1265	1185
	both sides or 1 side and bottom	High	2435	2360	2285	2220	2130	2050	1965	1875
		Med-High	2040	2000	1950	1905	1835	1790	1725	1650

*Air delivery above 1800 CFM requires that both sides, a combination of 1 side and bottom, or bottom only of the furnace be used for return air. A filter is required for each return-air supply.

Electrical data

UNIT SIZE		040-08	040-12	060-08	060-12	060-16	080-12	080-16	080-20	100-16	100-20	120-20
UNIT VOLTS—HERTZ—PHASE		115—60—1										
OPERATING VOLTAGE RANGE (Min—Max)*		104—127										
MAXIMUM UNIT AMPS		6.1	7.3	6.1	7.1	9.5	7.6	10.0	14.1	10.2	14.8	14.6
UNIT AMPACITY†		8.4	10.0	8.4	9.8	12.8	10.4	13.4	18.4	13.5	19.3	19.1
MINIMUM WIRE SIZE		14	14	14	14	14	14	14	12	14	12	12
MAXIMUM WIRE LENGTH (Ft)‡		44	37	44	38	29	36	28	31	27	30	30
MAXIMUM FUSE SIZE OR CKT BKR (Amps)**		15	15	15	15	15	15	15	20	15	20	20
TRANSFORMER (24v)		40va										
EXTERNAL CONTROL POWER AVAILABLE	Heating	12va										
	Cooling	21va										
AIR CONDITIONING BLOWER RELAY		Standard										


* Permissible limits of the voltage range at which the unit will operate satisfactorily.

† Unit ampacity = 125% of largest operating component's full load amps plus 100% of all other potential operating components' (EAC, humidifier, etc.) full load amps.

‡ Length is as measured 1 way along wire path between unit and service panel for maximum 2% voltage drop.

** Time-delay fuse is recommended.

Typical wiring schematic

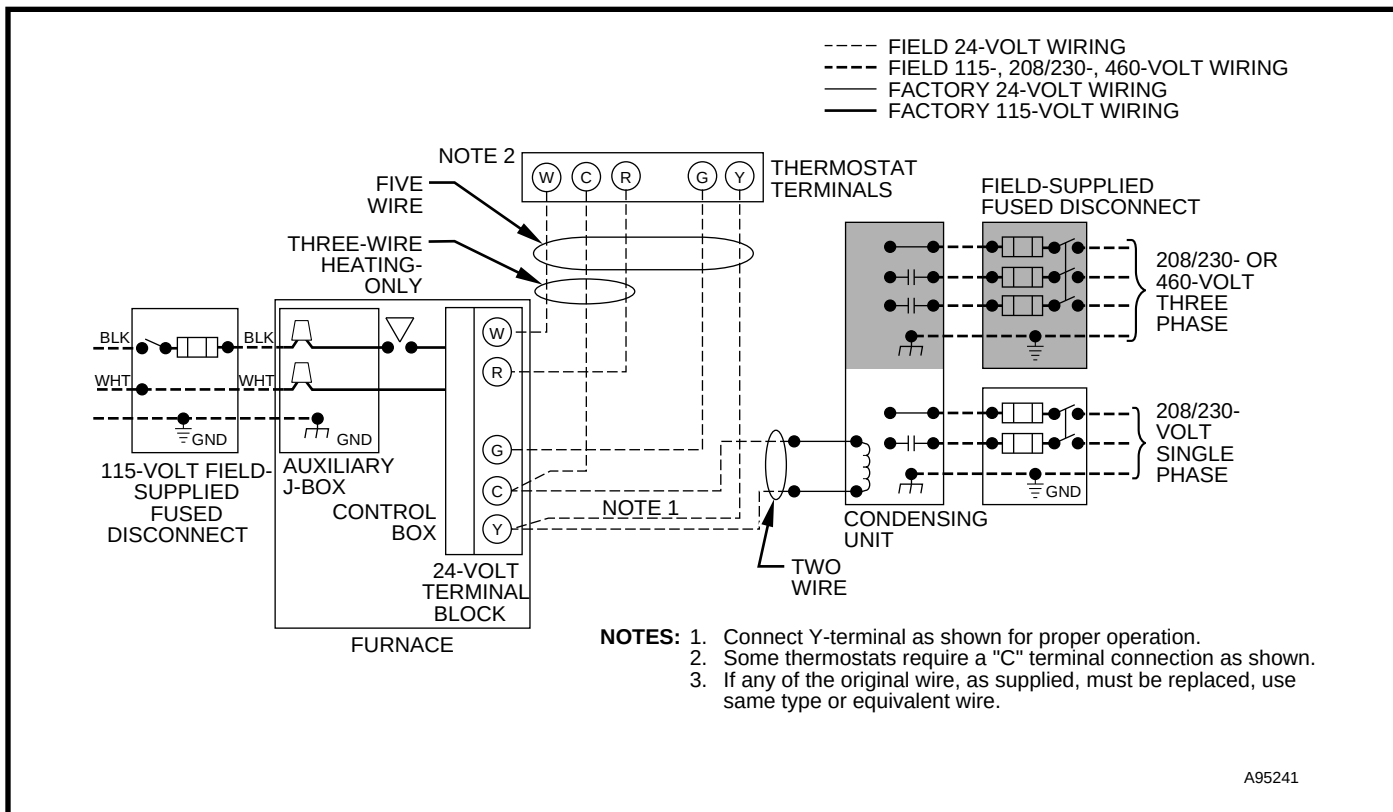

Combustion-air and vent piping

MAXIMUM ALLOWABLE PIPE LENGTH (FT)

ALTITUDE ABOVE SEA LEVEL (FT)	UNIT SIZE	TERMINATION TYPE	PIPE DIA (IN.)*	NUMBER OF 90° ELBOWS					
				1	2	3	4	5	6
0 to 2000	040-08 040-12	2 Pipe or 2-In. Concentric	1	5	NA	NA	NA	NA	NA
			1-1/2	70	70	65	60	60	55
			2	70	70	70	70	70	70
	060-08 060-12 060-16	2 Pipe or 2-In. Concentric	1-1/2	20	15	10	5	NA	NA
			2	70	70	70	70	70	70
			1-1/2	10	NA	NA	NA	NA	NA
	080-12 080-16 080-20	2 Pipe or 2-In. Concentric	2	55	50	35	30	30	20
			2-1/2	70	70	70	70	70	70
			2	5	NA	NA	NA	NA	NA
	100-16 100-20	2 Pipe or 3-In. Concentric	2-1/2	40	30	20	20	10	NA
			3	70	70	70	70	70	70
			2-1/2 one disk	10	NA	NA	NA	NA	NA
	120-20	2 Pipe or 3-In. Concentric	3 one disk	35	30	15	NA	NA	NA
			3† one disk	35	35	35	30	30	30
			3† no disk	70	70	70	70	70	70
2001 to 3000	040-08 040-12	2 Pipe or 2-In. Concentric	1-1/2	67	62	57	52	52	47
			2	70	70	70	70	70	70
	060-08 060-12 060-16	2 Pipe or 2-In. Concentric	1-1/2	17	12	7	NA	NA	NA
			2	70	67	66	61	61	61
	080-12 080-16 080-20	2 Pipe or 2-In. Concentric	2	49	44	30	25	25	15
			2-1/2	70	70	70	70	70	70
	100-16 100-20	2 Pipe or 3-In. Concentric	2-1/2	35	26	16	16	6	NA
			3	70	70	70	70	66	61
	120-20	2 Pipe or 3-In. Concentric	3 one disk	31	26	12	NA	NA	NA
			3† one disk	31	30	30	25	25	24
			3† no disk	63	62	62	61	61	61
3001 to 4000	040-08 040-12	2 Pipe or 2-In. Concentric	1-1/2	64	59	54	49	48	43
			2	70	70	70	70	70	70
	060-08 060-12 060-16	2 Pipe or 2-In. Concentric	1-1/2	16	11	6	NA	NA	NA
			2	68	63	62	57	57	56
	080-12 080-16 080-20	2 Pipe or 2-In. Concentric	2	46	41	28	23	22	13
			2-1/2	70	70	70	70	70	70
	100-16 100-20	2 Pipe or 3-In. Concentric	2-1/2	33	24	15	14	5	NA
			3	70	70	70	66	61	56
	120-20	2 Pipe or 3-In. Concentric	3 one disk	29	24	10	NA	NA	NA
			3†one disk	29	28	28	23	22	21
			3†no disk	59	59	58	57	57	56
4001 to 5000†	040-08 040-12	2 Pipe 2-In. Concentric	1-1/2	60	55	50	45	44	39
			2	70	70	70	70	70	70
	060-08 060-12 060-16	2 Pipe or 2-In. Concentric	1-1/2	15	10	5	NA	NA	NA
			2	64	59	58	53	52	52
	080-12 080-16 080-20	2 Pipe or 2-in Concentric	2	44	39	26	21	20	11
			2-1/2	70	70	70	70	70	70
	100-16 100-20	2 Pipe or 3-In. Concentric	2-1/2	31	22	13	12	NA	NA
			3	70	70	67	62	57	52
	120-20	2 Pipe or 3-In. Concentric	3†one disk	27	26	26	21	20	19
			3†no disk	56	55	54	53	52	52
5001 to 6000†	040-08 040-12	2 Pipe 2-In. Concentric	1-1/2	57	52	47	42	40	35
			2	70	70	70	70	70	70
	060-08 060-12 060-16	2 Pipe or 2-In. Concentric	1-1/2	14	9	NA	NA	NA	NA
			2	60	55	54	49	48	47
	080-12 080-16 080-20	2 Pipe or 2-In. Concentric	2	41	36	23	18	17	8
			2-1/2	70	70	70	70	70	70
	100-16 100-20	2 Pipe or 3-in Concentric	2-1/2	29	21	12	11	NA	NA
			3	70	67	62	57	52	47
	120-20	2 Pipe or 3-In. Concentric	3†one disk	26	24	23	18	17	16
			3† no disk	53	52	50	49	48	47

See notes on pg. 11.

MAXIMUM ALLOWABLE PIPE LENGTH (FT) Continued

ALTITUDE ABOVE SEA LEVEL (FT)	UNIT SIZE	TERMINATION TYPE	PIPE DIA (IN.)*	NUMBER OF 90° ELBOWS					
				1	2	3	4	5	6
6001 to 7000‡	040-08 040-12	2 Pipe or 2-In. Concentric	1-1/2	53	48	43	38	37	32
			2	70	70	68	67	66	64
	060-08 060-12 060-16	2 Pipe or 2-In. Concentric	1-1/2	13	8	NA	NA	NA	NA
			2	57	52	50	45	44	43
	080-12 080-16 080-20	2 Pipe or 2-In. Concentric	2	38	33	21	16	15	6
			2-1/2	70	70	68	67	66	64
	100-16 100-20	2 Pipe or 3-In. Concentric	2-1/2	27	19	10	9	NA	NA
			3	68	63	58	53	48	43
	120-20	2 Pipe or 3-In. Concentric	3† one disk	24	22	21	16	15	13
			3† no disk	49	48	47	45	44	43
7001 to 8000‡	040-08 040-12	2 Pipe or 2-In. Concentric	1-1/2	49	44	39	34	33	28
			2	66	65	63	62	60	59
	060-08 060-12 060-16	2 Pipe or 2-In. Concentric	1-1/2	12	7	NA	NA	NA	NA
			2	53	48	46	41	40	38
	080-12 080-16 080-20	2 Pipe or 2-In. Concentric	2	36	31	19	14	12	NA
			2-1/2	66	65	63	62	60	59
	100-16 100-20	2 Pipe or 3-In. Concentric	2-1/2	25	17	8	7	NA	NA
			3	63	58	53	48	43	38
	120-20	2 Pipe or 3-In. Concentric	3† one disk	22	20	19	14	12	11
			3† no disk	46	44	43	41	40	38
8001 to 9000‡	040-08 040-12	2 Pipe or 2-In. Concentric	1-1/2	46	41	36	31	29	24
			2	62	60	58	56	55	53
	060-08 060-12 060-16	2 Pipe or 2-In. Concentric	1-1/2	11	6	NA	NA	NA	NA
			2	49	44	42	37	35	34
	080-12 080-16 080-20	2 Pipe or 2-In. Concentric	2	33	28	17	12	10	NA
			2-1/2	62	60	58	56	55	53
	100-16 100-20	2 Pipe or 3-In. Concentric	2-1/2	23	15	7	5	NA	NA
			3	59	54	49	44	39	34
	120-20	2 Pipe or 3-In. Concentric	3† one disk	20	18	17	12	10	8
			3† no disk	43	41	39	37	35	34
9001 to 10,000‡	040-08 040-12	2 Pipe or 2-In. Concentric	1-1/2	42	37	32	27	25	20
			2	57	55	53	51	49	47
	060-08 060-12 060-16	2 Pipe or 2-In. Concentric	2	45	40	38	33	31	29
			2	30	25	14	9	7	NA
	080-12 080-16 080-20	2 Pipe or 2-In. Concentric	2-1/2	57	55	53	51	49	47
			2-1/2	21	13	5	NA	NA	NA
	100-16 100-20	2 Pipe or 3-In. Concentric	3	54	49	44	39	34	29
			3† one disk	18	16	14	9	7	5
	120-20	2 Pipe or 3-In. Concentric	3† no disk	39	37	35	33	31	29

* Disk usage—Unless otherwise specified, use perforated disk assembly (factory-supplied in loose parts bag). If stated, unsnap 1/2 perforated disk assembly and use shouldered disk half or no disk assembly.

† Wide radius elbow.

‡ Vent sizing for Canadian installations above 4500 ft (1370m) above sea level are subject to acceptance by the local authorities having jurisdiction.
NA — Not allowed; pressure switch will not make.

NOTES:

1. Do not use pipe size greater than those specified in table or incomplete combustion, flame disturbance, or flame sense lockout may occur.
2. Size both the combustion-air and vent pipe independently, then use the larger diameter for both pipes.
3. Assume two 45° elbows equal one 90° elbow. Long radius elbows are desirable and may be required in some cases.
4. Elbows and pipe sections within the furnace casing and at the vent termination should not be included in vent length or elbow count.
5. The minimum pipe length is 5 ft for all applications.

**MAXIMUM ALLOWABLE EXPOSED VENT PIPE LENGTH (FT) WITH INSULATION
IN WINTER DESIGN TEMPERATURE AMBIENT***

UNIT SIZE	WINTER DESIGN TEMP °F	MAXIMUM PIPE DIA	INSULATION THICKNESS (IN.)†				
			0	3/8	1/2	3/4	1
060-08 060-12 060-16	20	1-1/2	31	56	63	70	70
	0	1-1/2	16	34	39	47	54
	-20	1-1/2	9	23	27	34	39
060-08 060-12 060-16	20	2	45	70	70	70	70
	0	2	25	51	58	70	70
	-20	2	16	36	42	51	60
080-12 080-16 080-20	20	2-1/2	55	70	70	70	70
	0	2-1/2	31	61	69	70	70
	-20	2-1/2	20	43	49	61	70
100-16 100-20	20	3	61	70	70	70	70
	0	3	33	65	70	70	70
	-20	3	20	45	52	65	70
120-20	20	3	70	70	70	70	70
	0	3	40	70	70	70	70
	-20	3	26	55	64	70	70

* Pipe length (ft) specified for maximum vent pipe lengths located in unconditioned spaces. Vent pipes located in unconditioned space cannot exceed the total allowable pipe length as specified in Maximum Allowable Pipe Length table.

† Insulation thickness based on R value of 3.5 per in.

Clearance to combustibles

This appliance is equipped only for altitudes 0 - 2,000 ft (0-610 m) for use with natural gas and propane. A conversion kit, supplied by the manufacturer, shall be used to convert to the alternate fuel or elevation.

This direct-vent, forced-air furnace is for indoor installation in a building constructed on site or in a manufactured (mobile) home when using factory authorized kit, see rating plate. For installation in alcove or closet at minimum clearances from combustible material as shown below.

This appliance requires a special venting system. Refer to the installation instructions for parts list and method of installation. This furnace is for use with schedule-40 PVC, PVC-DWV, or ABS-DWV pipe, and must not be vented in common with other gas-fired appliances. Construction through which vent/air intake pipes may be installed is maximum 24 inches (600 mm), minimum 3/4 inches (19 mm) thickness (including roofing materials).

MINIMUM CLEARANCE TO COMBUSTIBLE MATERIAL

TOP	BOTTOM	SIDES	BACK	FRONT	VENT	INCHES
1	0	0	0	3 Ø	0	UPFLOW
1	#	0	0	3 Ø	0	DOWNFLOW
1	0 †	1 *	0	3 Ø	0	HORIZONTAL

For Installation on combustible floors only when installed on special base No. KGASB0201ALL.

* Clearance shown is for air inlet and air outlet end.

Horizontal position: Line contact is permissible only between lines formed by intersections of top and two sides of furnace jacket, and building joists, studs, or framing.


† 120,000 BTU Input Furnaces require 1 inch bottom clearance to combustible materials.

Ø Minimum front clearance for service is 30 inches. (762mm).

320611-101 REV. G


A93060

Typical installations

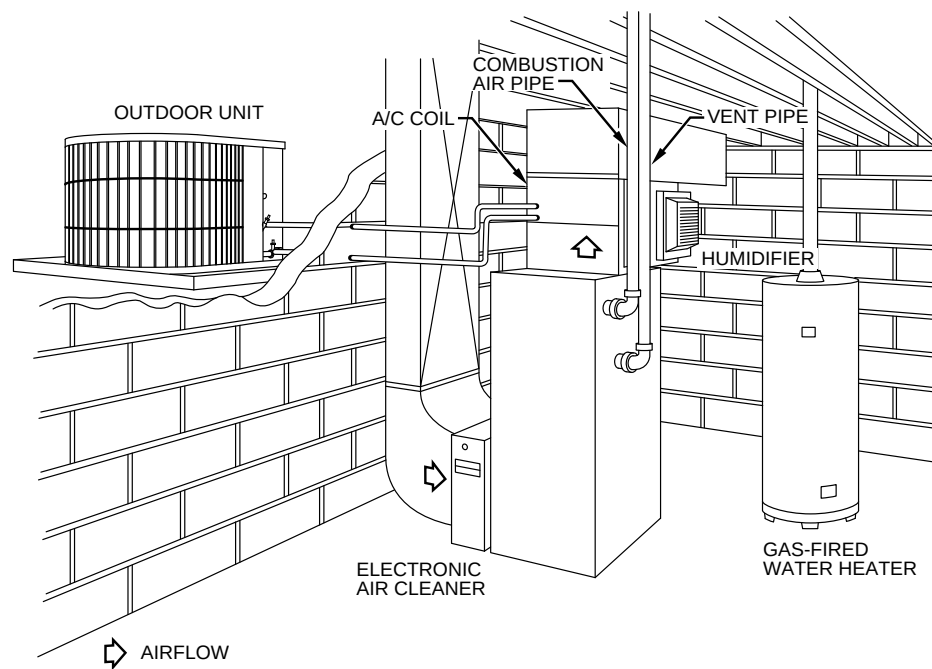


Basement — Upflow Application

A93063

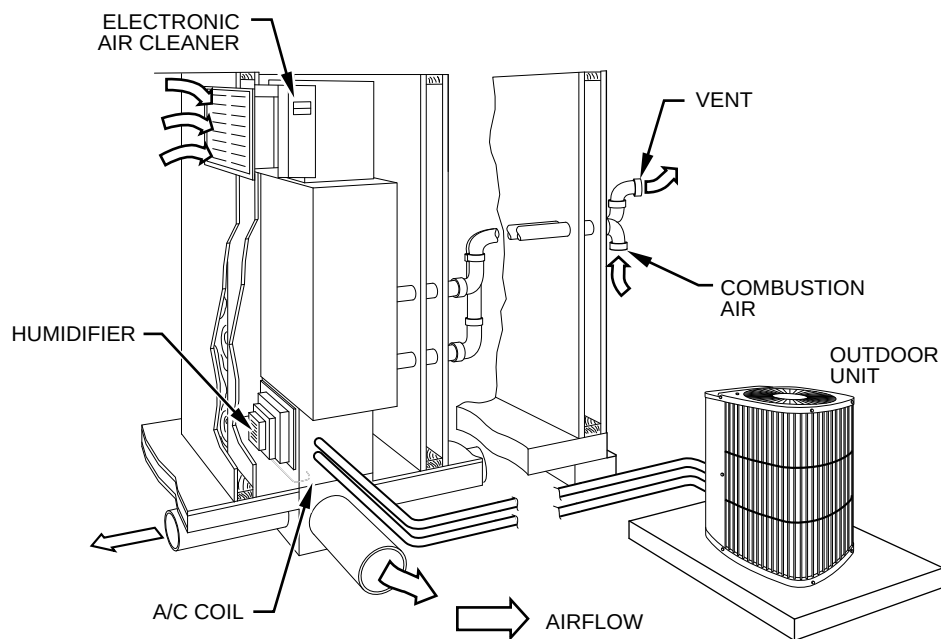


Closet — Downflow Application

A93064

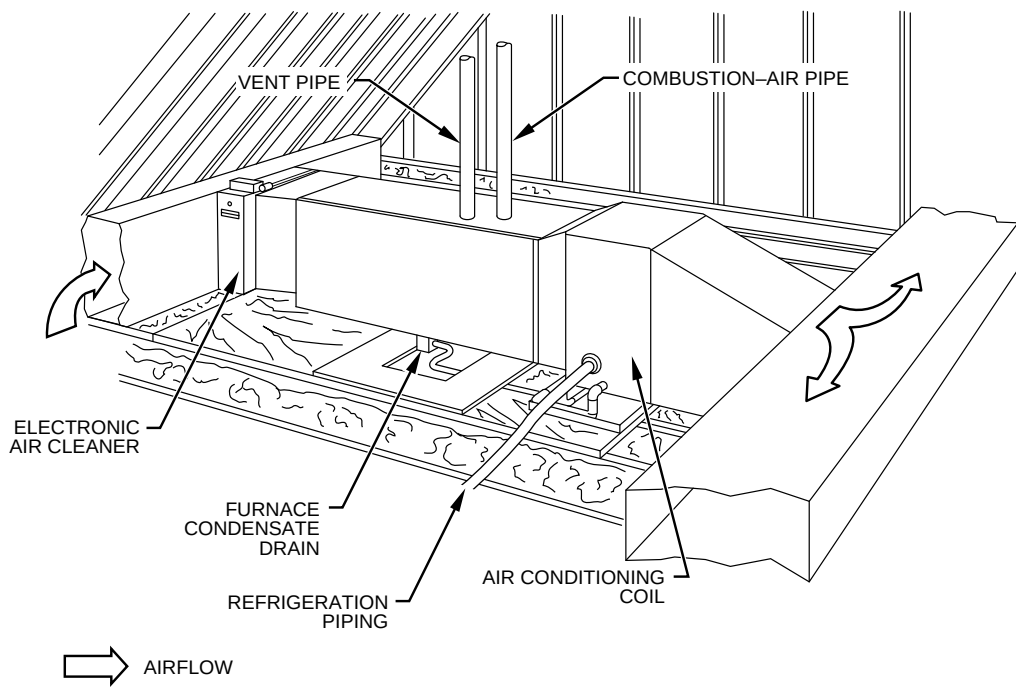

A93065

Attic — Horizontal Application

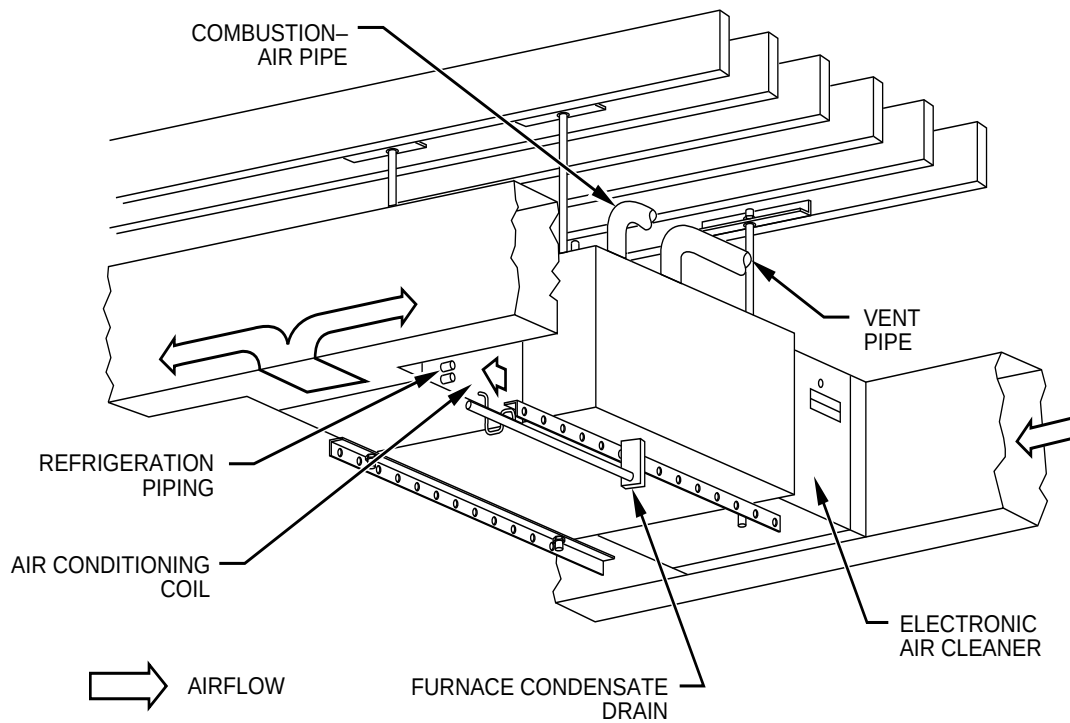

A93066

Crawlspace — Horizontal Application

SERVICE TRAINING

Packaged Service Training programs are an excellent way to increase your knowledge of the equipment discussed in this manual, including:

- Unit Familiarization
- Maintenance
- Installation Overview
- Operating Sequence

A large selection of product, theory, and skills programs is available, using popular video-based formats and materials. All include video and/or slides, plus companion book.

Classroom Service Training plus "hands-on" the products in our labs can mean increased confidence that really pays dividends in faster troubleshooting, fewer callbacks. Course descriptions and schedules are in our catalog.

CALL FOR FREE CATALOG 1-800-962-9212

☐ Packaged Service Training

☐ Classroom Service Training

A94328