


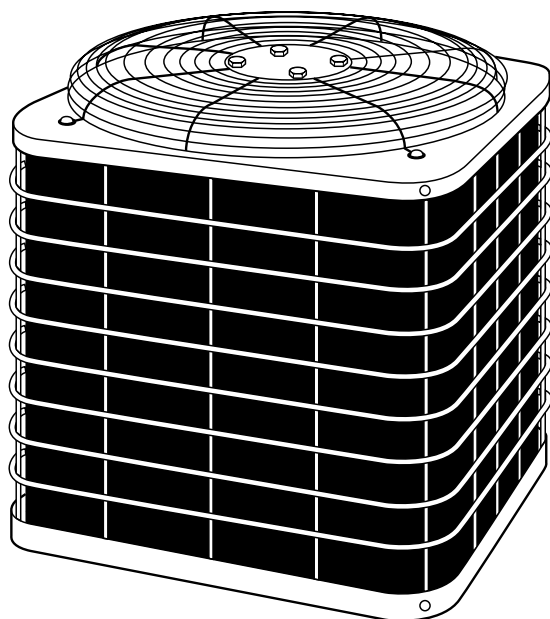

The 663C Outdoor Sections of Split-System Heat Pumps are designed for quiet, reliable heating during the winter and cooling during the summer. With a SEER of up to 14.0 and HSPF of up to 8.3, these heat pump systems provide economy of operation through energy conservation. They recover heat for indoor comfort from outdoor air during the heating season and, by automatically reversing the refrigerant system, remove indoor heat and excess humidity during the cooling season. All models are listed with UL, (U.S. and Canada), CEC, and ARI.

FEATURES/BENEFITS

ELECTRICAL RANGE—All units are offered in single phase 208-230v.

WIDE RANGE OF SIZES—Available in 7 nominal sizes from 018 through 060 to meet the needs of residential and light commercial applications.

COMPRESSOR—This unit features a scroll compressor which is significantly more efficient than conventional compressors. Its simple design offers improved reliability, and each compressor is mounted on rubber isolators for additional sound reduction. For improved serviceability, all models are equipped with a

compressor terminal plug. Continuous operation is approved down to -30°F (-34.4°C) in the heating mode and down to 55°F (12.8°C) in the cooling mode. (See heating and cooling performance tables.)

BUILT-IN-RELIABLE COMPONENTS—Includes a suction-tube accumulator that reduces the amount of liquid refrigerant that reaches the compressor, a loss of charge switch, and an internal pressure relief valve for high-pressure protection.

DEFROST CONTROL BOARD—Incorporates a defrost relay, defrost timer, and low-voltage terminations. The defrost control is a time/temperature, initiation/termination control which includes 3 field-selectable time periods of 30, 50, and 90 minutes.

THERMOSTATIC EXPANSION VALVE (TXV)—This unit must be installed with a TXV on the indoor coil. The FC4 and FK4 indoor fan coils come factory equipped with a bi-flow TXV. When installed in this application, no further change is required. If any other indoor fan coil or furnace coil is used, an accessory bi-flow TXV must be installed. See optional equipment list in this publication for correct part number.

DISCHARGE MUFFLER—Incorporated to minimize low frequency sound and pressure pulsation generated by compressor discharge gas.

WEATHER-PROTECTIVE CABINET—Steel is protected with a galvanized coating and treated with a layer of zinc phosphate. A coat of modified polyester powder paint is then applied and baked on, providing each unit with a hard, smooth finish that will last for many years.


All screws on cabinet exterior are coated for a long-lasting, rust-resistant, quality appearance.

UNIT DESIGN—All units are equipped with totally enclosed fan motors for greater reliability under rain and snow conditions. The large, wraparound coil uses copper tube and enhanced aluminum fin and is designed for optimum heat transfer during heating and cooling. The vertical air discharge carries the sound and air up and away from adjacent patio areas and foliage. The condenser coil can be cleaned with a common garden hose.

EXTERNAL SERVICE VALVES—Both service valves are brass, front seating type with sweat field connections. Valves are externally located so refrigerant tube connections can be made quickly and easily. Each valve has a service port for ease of checking operating refrigerant pressures.

LIMITED WARRANTY—Standard 5-year limited warranty on all parts and 5-year limited warranty on compressor.

DIMENSIONS

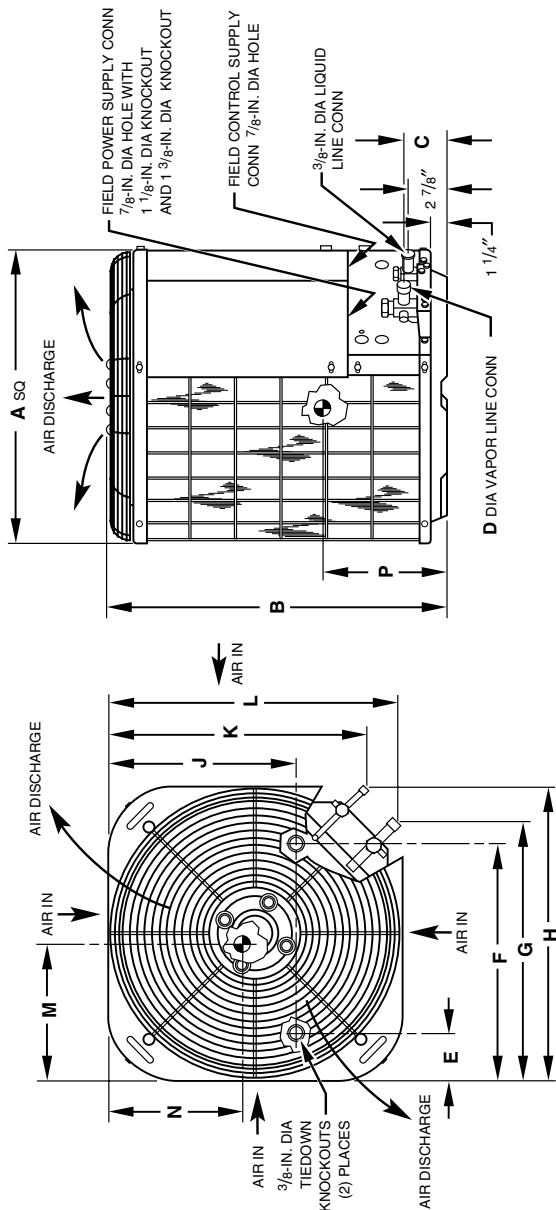

NOTES:

1. Allow 30 in. clearance to service side of unit, 48 in. above unit, 6 in. on one side, 12 in. on remaining side, and 24 in. between units for proper airflow.
2. Minimum outdoor operating ambient in cooling mode is 55°F, max. 125°F.
3. Maximum outdoor operating ambient in heating mode is 66°F.
4. Series designation is the 14th position of the unit model number.
5. Center of gravity ●.

A97071

DIMENSIONS (IN.)

UNIT SIZE	SERIES	A	B	C	D	E	F	G	H	J	K	L	M	N	P	MINIMUM MOUNTING PAD DIMENSIONS
018	D, E	22-1/2	33-15/16	3-3/16	5/8	3-11/16	18-1/8	19-3/4	21-5/8	14-3/8	18-7/8	22-1/16	10-3/4	11	14-1/4	22-1/2 x 22-1/2
024	F, G	30	27-15/16	3-3/16	3/4	6-1/2	23-1/2	27-1/4	29-1/8	20	26-3/8	29-9/16	15-1/2	15	11-3/4	30 x 30
030	E, F	30	33-15/16	3-3/16	3/4	6-1/2	23-1/2	27-1/4	29-1/8	20	26-3/8	29-9/16	15-1/2	15	14-1/2	22-1/2 x 22-1/2
036	E, F	30	33-15/16	3-3/16	3/4	6-1/2	23-1/2	27-1/4	29-1/8	20	26-3/8	29-9/16	15-1/2	15	14-1/2	30 x 30
042	D, E	30	29-15/16	3-1/4	7/8	6-1/2	23-1/2	27-1/4	29-1/8	20	26-3/8	29-9/16	15-1/2	14-3/4	14-1/4	30 x 30
048	D, E	30	33-15/16	3-1/4	7/8	6-1/2	23-1/2	27-1/4	29-1/8	20	26-3/8	29-9/16	15-1/2	14-1/4	14-1/2	30 x 30
060	D, E	30	39-15/16	3-1/4	7/8	6-1/2	23-1/2	27-1/4	29-1/8	20	26-3/8	29-9/16	14-3/4	13-1/2	15-1/2	30 x 30

RECOMMENDED TUBE DIAMETERS

UNIT SIZE	TUBE LENGTH (Ft)*	LIQUID TUBE DIAMETER (In.)	VAPOR TUBE DIAMETER (In.)
018	0 to 50	3/8	5/8
024, 030, 036			3/4
042			7/8
048, 060			1-1/8

* For tube set over 50 ft horizontal or 20 ft vertical differential, consult Long-Line section of Application Guideline and Service Manual—Air Conditioners and Heat Pumps Using R-22 Refrigerant.

CHECK-FLO-RATER® PISTON CHART


UNIT SIZE	SERIES	OUTDOOR PISTON	INDOOR TXV*
018	D, E	42	KSATX0601HSO
024	F, G	52	KSATX0601HSO
030	E, F	55	KSATX0601HSO
036	E, F	61	KSATX0601HSO
042	D, E	65	KSATX0601HSO
048	D, E	73	KSATX0701HSO
060	D, E	78	KSATX1001HSO

A-WTD. SOUND POWER (dBA)

UNIT SIZE-SERIES	STANDARD RATING	TYPICAL OCTAVE BAND SPECTRUM (without tone adjustment)						
		125	250	500	1000	2000	4000	8000
018-D, E	78	53.0	59.0	64.5	69.5	62.0	59.0	56.5
024-F, G	78	56.0	62.0	66.0	70.5	66.5	59.0	55.0
030-E, F	78	56.0	63.5	67.5	72.0	66.0	63.0	58.5
036-E, F	78	53.5	61.0	66.0	71.0	67.0	62.5	60.0
042-D, E	78	53.0	64.5	68.0	73.0	69.5	67.5	62.0
048-D, E	78	61.5	60.0	67.0	72.0	69.5	65.5	60.0
060-D, E	80	58.5	65.0	71.5	74.0	73.5	70.0	64.5

NOTE: Tested in accordance with ARI Standard 270-95. (Not listed with ARI).

MODEL NUMBER NOMENCLATURE

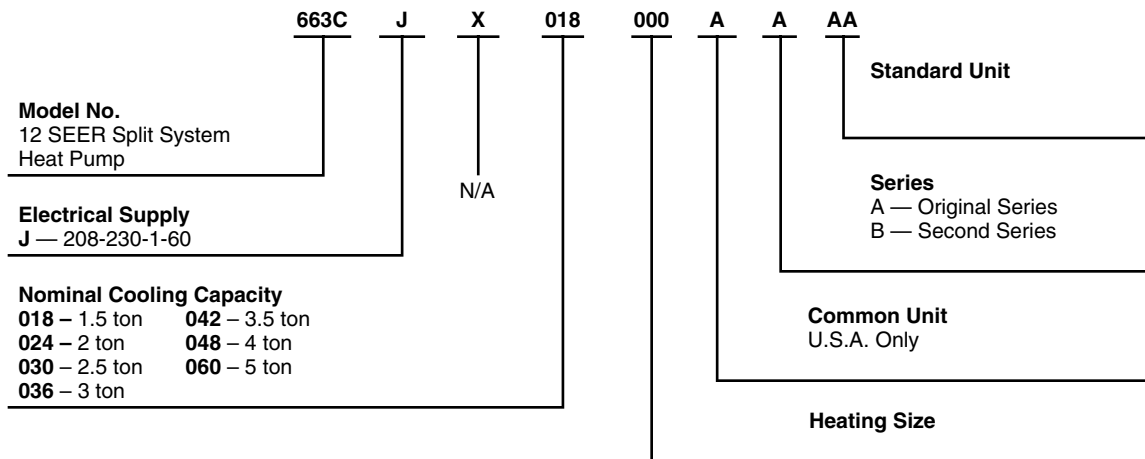

CERTIFICATION APPLIES ONLY
WHEN THE COMPLETE SYSTEM
IS LISTED WITH ARI.



REGISTERED QUALITY SYSTEM



APPROVALS
 ISO 9001
 EN 29001
 BS 5750 PART 1
 ANSI/ASQC Q91



* As an ENERGY STAR® Partner, Bryant Heating & Cooling Systems has determined that this product meets the ENERGY STAR® guidelines for energy

*Only those system combinations that meet Energy Star® efficiency requirements. Refer to the combination ratings in the product data sheet.

SPECIFICATIONS

UNIT SIZE-SERIES	018-D, E	024-F, G	030-E, F	036-E, F
Operating Weight (Lb)	115	166	182	182
ELECTRICAL				
Unit Volts—Hertz—Phase	208-230—60—1			
Operating Voltage Range*	197—253			
Unit Ampacity for Wire Sizing	13.8	16.1	22.0	23.4
Min Wire Size (60°C/75°C Copper) (AWG)†	14/14		12/12	
Maximum Length (60°C/75°C) (Ft)‡	56/54	49/47	57/54	55/52
Max Branch Circuit Fuse** or Circuit Breaker Size (Amps)	20	25	30	35
Compressor Rated Load Amps	10.6	12.0	16.7	17.8
Locked Rotor Amps	45.0	54.0	72.5	88.0
Fan Motor HP & RPM	1/12 & 1100	1/5 & 825		
Full Load Amps	0.5	1.1		
COMPRESSOR AND REFRIGERANT				
Type	Scroll			
Refrigerant Charge (Lb) @ 15 Ft	5.5	6.25	6.88	8.0
Refrigerant Tubes (In. OD) Vapor & Liquid (Up to 50 Ft)	5/8 & 3/8		3/4 & 3/8	
OUTDOOR COIL & FAN				
Coil Face Area (Sq Ft)	12.4	14.93	18.5	18.5
Rated Airflow (CFM)	1800	2800		
OPTIONAL EQUIPMENT				
Time-Delay Relay	KAATD0101TDR			
Outdoor Thermostat	KHAOT0301FST			
Secondary Outdoor Thermostat	KHAOT0201SEC			
Crankcase Heater	KAACH1401AAA	KAACH1201AAA		
Compressor Start Assist-Capacitor/Relay	KSAHS1501AAA			
Compressor Start Assist-PTC	KAACS0201PTC			
Sound Hood	KSASH1801COP			KSASH0601COP
Bi-flow TXV Kits (Hard Shutoff)	KSATX0601HSO			
Low-Pressure Switch	Standard			
High-Pressure Switch	KHAHI0101HPS			
Filter Drier—Bi-flow	P504-8083S (RCD)			
Isolation Relay	KHAIR0101AAA‡‡			
Evaporator Freeze Thermostat	KAAFT0101AAA‡‡			
Liquid Solenoid Valve (LSV)	KHALS0401LLS			
Coastal Filter Kit	KAACF1001MED	KAACF1101LRG		
Inlet Grille Kit (4 Pack)	KSABG1204CSM	KSABG1704CMD	KSABG2004CMD	
MotorMaster®—Low-Ambient Controller	KSALA0401AAA†††			
Ball Bearing Fan Motor	HC34GE232 (RCD)	HC38GE231 (RCD)		
Low-Ambient Pressure Switch Kit	KSALA0201R22			
Thermidistat Control™—Non-Programmable/ Programmable Thermostat with Humidity Control	TSTATBBPRH01-B			
Thermostat—Auto Changeover, 2-Day Programmable, °F/°C, Dual Fuel Includes Outdoor Sensor (TSTATXXSEN01-B)	TSTATBBPDF01-B***			
Standard Programmable Thermostat—Manual Changeover, 5-2 Day Programmable °F/°C, 2-Stage Heat/1-Stage Cool	TSTATBBSHP01			
Thermostat—Auto Changeover, 7-Day Programmable, °F/°C, 2-Stage Heat, 1-Stage Cool	TSTATBBPHP01-B			
Thermostat—Auto Changeover, Non-Programmable, °F/°C, 2-Stage Heat, 1-Stage Cool	TSTATBBNHP01-B			
Builder's Thermostat, Manual Changeover Non- Programmable °F/°C, 2-Stage Heat/1-Stage Cool	TSTATBBBHP01-B			
Outdoor Air Temperature Sensor	TSTATBBSEN01-B			
Backplate for Non-Programmable Thermostat	TSTATXXNBP01			
Backplate for Programmable Thermostat	TSTATXXBP01			
Backplate for Builder's Thermostat	TSTATXXBBP01			
Backplate for Standard Programmable Thermostat	TSTATXXSBP01			
Thermostat Conversion Kit (4 to 5 Wire)—10 Pack	TSTATXXCNV10			

See notes on page 6.

SPECIFICATIONS Continued

UNIT SIZE-SERIES	042-D, E	048-D, E	060-D, E
Operating Weight (Lb)	209	250	278
ELECTRICAL			
Unit Volts—Hertz—Phase	208-230—60—1		
Operating Voltage Range*	197—253		
Unit Ampacity for Wire Sizing	30.1	31.0	41.5
Min Wire Size (60°C/75°C Copper) (AWG)†	8/10		6/8
Maximum Length (60°C/75°C) (Ft)‡	104/63	97/59	126/71
Max Branch Circuit Fuse** Circuit Breaker Size (Amps)	50	45	60
Compressor Rated Load Amps	23.2	23.9	32.1
Locked Rotor Amps	104.0	137.0	148.0
Fan Motor HP & RPM	1/5 & 825		1/4 & 1125
Full Load Amps	1.1		1.4
COMPRESSOR AND REFRIGERANT			
Type	Scroll		
Refrigerant Charge (Lb) @ 15 Ft	10.38	11.13	14.00
Refrigerant Tubes (In. OD) Vapor & Liquid (Up to 50 Ft)	7/8 & 3/8	1-1/8 & 3/8	
OUTDOOR COIL & FAN			
Coil Face Area (Sq Ft)	16.18	18.67	22.40
Rated Airflow (CFM)	2800		3400
OPTIONAL EQUIPMENT			
Time-Delay Relay	KAATD0101TDR		
Outdoor Thermostat	KHAOT0301FST		
Secondary Outdoor Thermostat	KHAOT0201SEC		
Crankcase Heater	KAACH1201AAA		Standard
Compressor Start Assist-Capacitor/Relay	KSAHS1501AAA	KSAHS1701AAA	KSAHS1601AAA
Compressor Start Assist-PTC	KAACS0201PTC		
Sound Hood	KSASH0601COP	KSASH2101COP	
Bi-flow TXV Kits (Hard Shutoff)	KSATX0601HSO	KSATX0701HSO	KSATX1001HSO
Low-Pressure Switch	Standard		
High-Pressure Switch	KHAHI0101HPS		
Filter Drier—Bi-flow	P504-8163S (RCD)		
Isolation Relay	KHAIR0101AAA‡‡		
Evaporator Freeze Thermostat	KAAFT0101AAA‡‡		
Liquid Solenoid Valve (LSV)	KHALS0401LLS		
Coastal Filter	KAACF1101LRG		
Inlet Grille Kit (4 Pack)	KSABG1804CMD	KSABG2004CMD	KSABG2304CMD
MotorMaster®—Low-Ambient Controller	KSALA0401AAA†††		
Ball Bearing Fan Motor	HC38GE231 (RCD)		HC40GE232 (RCD)
Low-Ambient Pressure Switch Kit	KSALA0201R22		
Thermidistat Control™—Non-Programmable/ Programmable Thermostat with Humidity Control	TSTATBBPRH01-B		
Thermostat—Auto Changeover, 2-Day Programmable, °F/°C, Dual Fuel Includes Outdoor Sensor (TSTATXXSEN01-B)	TSTATBBPDF01-B***		
Standard Programmable Thermostat—Manual Changeover, 5-2 Day Programmable, °F/°C, 2-Stage Heat/1-Stage Cool	TSTATBBSHP01		
Thermostat—Auto Changeover, 7-Day Programmable, °F/°C, 2-Stage Heat, 1-Stage Cool	TSTATBBPHP01-B		
Thermostat—Auto Changeover, Non-Programmable, °F/°C, 2-Stage Heat, 1-Stage Cool	TSTATBBNHP01-B		
Builder's Thermostat, Manual Changeover, Non- Programmable °F/°C, 2-Stage Heat/1-Stage Cool	TSTATBBBHP01-B		
Outdoor Air Temperature Sensor	TSTATBBSEN01-B		
Backplate for Non-Programmable Thermostat	TSTATXXNBP01		
Backplate for Programmable Thermostat	TSTATXXPBP01		
Backplate for Builder's Thermostat	TSTATXXBBP01		
Backplate for Standard Programmable Thermostat	TSTATXXSBP01		
Thermostat Conversion Kit (4 to 5 Wire)—10 Pack	TSTATXXCNV10		

See notes on page 6.

* Permissible limits of the voltage range at which the unit will operate satisfactorily. Operation outside these limits may result in unit failure.

† If wire is applied at ambient greater than 30°C (86°F), consult Table 310-16 of the NEC (ANSI/NFPA 70). The ampacity of nonmetallic-sheathed cable (NM), trade name ROMEX, shall be that of 60°C (140°F) conductors, per the NEC (ANSI/NFPA 70) Article 336-26.

If other than uncoated (non-plated), 60°C or 75°C (140° or 167°F) insulation, copper wire (solid wire for 10 AWG and smaller, stranded wire for larger than 10 AWG) is used, consult applicable tables of the NEC (ANSI/NFPA 70).

‡ Length shown is as measured 1 way along wire path between unit and service panel for a voltage drop not to exceed 2%.

‡‡ Time-delay fuse.

‡‡‡ Use with low-ambient controller.

*** High pressure switch must be added if not supplied with the system.

††† Fan motor with ball bearings required.

N/A—Not Applicable

NOTE: Control circuit is 24v on all units and requires external power source. Copper wire must be used from service disconnect to unit. All motors/compressors contain internal overload protection.

ACCESSORY USAGE GUIDELINE

ACCESSORY	REQUIRED FOR LOW-AMBIENT APPLICATIONS (Below 55°F)	REQUIRED FOR LONG-LINE APPLICATIONS* (Over 50 Ft)
Crankcase Heater	Yes	Yes
Evaporator Freeze Thermostat	Yes	No
Winter Start Control	No	No
Accumulator	No	No
Compressor Start Assist Capacitor and Relay	Yes	Yes
MotorMaster®—Low-Ambient Controller	Yes	No
Wind Baffle	See Low-Ambient Instructions	No
Coastal Filter	No	No
Liquid-Line Solenoid Valve or Hard Shutoff TXV	No	See Long-Line Application Guideline
Ball Bearing Fan Motor	Yes	No

* For tubing line sets between 50 and 175 ft horizontal or 20 ft vertical differential, refer to Long-Line section of Application Guideline and Service Manual—Air Conditioners and Heat Pumps Using R-22 Refrigerant .

ACCESSORY DESCRIPTION AND USAGE (Listed Alphabetically)

1. Ball-Bearing Fan Motor

A fan motor with ball bearings which permits speed reduction while maintaining bearing lubrication.

Usage Guideline:

Required on all units when MotorMaster®—Low-Ambient Controller is installed.

2. Coastal Filter

A mesh screen inserted under the top cover and inside the base pan to protect the condenser coil from salt damage without restricting airflow.

3. Compressor Start Assist – Capacitor and Relay

Start capacitor and relay gives a "hard" boost to compressor motor at each start up.

Usage Guideline:

Required for single-phase reciprocating compressors in the following applications:

Long line
Low ambient cooling
Hard shut off expansion valve on indoor coil
Liquid line solenoid on indoor coil

Required for single-phase scroll compressors in the following applications:

Long line
Low ambient cooling

Suggested for all compressors in areas with a history of low voltage problems

4. Compressor Start Assist – PTC Type

Solid-state electrical device which gives a "soft" boost to the compressor motor at each start up.

Usage Guideline:

Suggested when compressor power supply is marginal.

Suggested in reciprocating compressor applications with rapid pressure balance (RPB) expansion valve on indoor coil.

5. Crankcase Heater

An electric resistance heater which mounts to the base of the compressor to keep the lubricant warm during off cycles. Improves compressor lubrication on restart and minimizes the chance of liquid slugging.

Note: Some heat pumps are factory supplied with a crankcase heater. See accessory list for units that come standard with a crankcase heater. For units that do not, use the guideline below.

Usage Guideline:

Required in low ambient cooling applications.

Required in long line applications.

Suggested in all commercial applications.

6. Cycle Protector

Solid-state timing device which prevents compressor rapid recycling. This control provides an approximate 5-minute delay after power to the compressor has been interrupted for any reason, including normal room thermostat cycling.

Usage Guideline:

Suggested in the following applications:

Installations in areas where power interruptions are frequent.
Where user is likely to "play" with the room thermostat.
All commercial installations.
Long line applications.
High-rise applications.

ACCESSORY DESCRIPTION AND USAGE (continued)

7. Evaporator Freeze Thermostat

An SPST temperature-actuated switch that stops unit operation when evaporator reaches freeze-up conditions.

Usage Guideline:

Required when low-ambient kit has been added.

8. Filter Drier

A device for removing contaminants from refrigerant circulating in a heat pump system: two-direction flow.

Usage Guideline:

Suggested in all field-connected split-system heat pumps.

9. High-Pressure Switch

Auto reset SPST switch activated by refrigerant pressure on high side of refrigerant circuit. Cycles compressor off if refrigerant pressure rises to 426 ± 10 psig and resets at 320 ± 20 psig. Provides protection against compressor damage due to loss of outdoor airflow.

Usage Guideline:

Suggested in installations exposed to "very dirty" outdoor air.

Suggested in installations where condenser inlet air temperature exceeds 125°F (51.7°C).

10. Isolation Relay

An SPDT relay which switches the low-ambient controller out of the outdoor fan motor circuit when the heat pump switches to heating mode.

Usage Guideline:

Required in all heat pumps where low-ambient kit has been added.

11. Liquid-Line Solenoid Valve (LLS)

An electrically operated shutoff valve which stops and starts refrigerant liquid flow in response to compressor operation. It maintains a column of refrigerant liquid ready for action at next compressor operation cycle. It also provides system protection against off-cycle refrigerant migration.

Note: When LLS is used with reciprocating compressors, Compressor Start Assist — Capacitor and Relay is required.

Usage Guideline:

Required in all heat pump long line applications to control refrigerant off cycle migration in the heating mode. A second LLS or hard shut off TXV is required in heat pump long line applications for refrigerant off cycle migration in the cooling mode. See Long Line Application Guideline.

12. Low-Ambient Pressure Switch Kit

A long life pressure switch which is mounted to outdoor unit service valve. It is designed to cycle the outdoor fan motor in order to maintain head pressure within normal operating limits (approximately 100 psig to 225 psig). The control will maintain working head pressure at low-ambient temperatures down to 0°F (−17.8°C) when properly installed.

Usage Guideline:

A Low-Ambient Pressure Switch or MotorMaster®—Low-Ambient Controller must be used when cooling operation is used at outdoor temperatures below 55°F (12.8°C).

13. MotorMaster®—Low-Ambient Controller

A fan speed control device activated by a temperature sensor. Designed to control condenser fan motor speed in response to the saturated, condensing temperature during operation in cooling mode only. For outdoor temperatures down to −20°F (−28.9°C), it maintains condensing temperature at $100^\circ\text{F} \pm 10^\circ\text{F}$ ($37.8^\circ\text{C} \pm 12^\circ\text{C}$).

Usage Guideline:

A MotorMaster®—Low-Ambient Controller or Low-Ambient Pressure Switch must be used when cooling operation is used at outdoor temperatures below 55°F (12.8°C).

Suggested for all commercial applications.

14. Outdoor Air Temperature Sensor

Designed for use with Bryant Thermostats listed in this publication. This device enables the thermostat to display the outdoor temperature. This device also is required to enable special thermostat features such as auxiliary heat lock out.

Usage Guideline:

Suggested for all Bryant thermostats listed in this publication.

15. Outdoor Thermostat

An SPDT temperature-actuated switch which turns on supplemental electric heaters when outdoor air temperature drops below a user-selected set point.

Usage Guideline:

Electric supplemental heat applications in non-variable speed indoor units when electric heat staging is desired.

16. Secondary Outdoor Thermostat

An SPDT temperature-actuated switch which turns on third-stage of supplemental electric heaters when outdoor air temperature drops below the second-stage set point.

Usage Guideline:

Outdoor Thermostat applications where electric heater is capable of 3-stage operation.

17. Sound Hood

Wraparound sound reducing cover for the compressor. Reduces the sound level by about 2 dBA.

Usage Guideline:

Suggested when unit is installed closer than 15 ft to quiet areas—bedrooms, etc.

Suggested when unit is installed between two houses less than 10 ft apart.

18. Thermostatic Expansion Valve (TXV) Bi-Flow

A modulating flow-control valve which meters refrigerant liquid flow rate into the evaporator in response to the superheat of the refrigerant gas leaving the evaporator. Kit includes valve, adapter tubes, and external equalizer tube. Both hard shutoff and RPB valves are available.

Note: When using a hard shut off TXV with single phase reciprocating compressors, a Compressor Start Assist — Capacitor and Relay is required

Usage Guideline:

Required to achieve ARI ratings in certain equipment combinations. Refer to combination ratings.

Required for use on all zoning systems.

See long line guideline.

19. Time-Delay Relay

An SPST delay relay which briefly continues operation of indoor blower motor to provide additional cooling after the compressor cycles off.

Note: Most indoor unit controls include this feature. For those that do not, use the guideline below.

Usage Guideline:

For improved efficiency ratings for certain combinations of indoor and outdoor units. Refer to ARI Unitary Directory.

Combination ratings continued

UNIT SIZE- SERIES	INDOOR UNIT	ARI STANDARD RATINGS*											
		Cooling						Heating					
		TC	Seasonal Efficiency SEER			EER	High-Temp		Low-Temp		Seasonal Efficiency HSPF		
			Factory- Supplied Enhance- ment	Standard Rating	Field-Supplied Accessory								
TXV‡	TXV & TDR**				TC		COP	TC	COP				
018-D, E	*F(A,B)4BN(F,C)024	18,700	TDR	—	12.00	—	10.80	17,800	3.30	11,200	2.28	7.5	
	CC5A/CD5AA018	17,800	NONE	—	—	11.50	10.25	17,500	2.98	11,100	2.14	7.0	
	CC5A/CD5AA024	18,500	NONE	—	—	11.50	10.60	17,700	3.16	11,200	2.22	7.2	
	CC5A/CD5AW024	18,500	NONE	—	—	11.50	10.60	17,700	3.16	11,200	2.22	7.2	
	CE3AA024	18,500	NONE	—	—	12.00	10.65	17,700	3.20	11,200	2.24	7.2	
	CF5AA024	18,500	NONE	—	—	12.00	10.65	17,800	3.20	11,200	2.24	7.2	
	CK3BA024	18,500	NONE	—	—	11.50	10.75	17,900	3.34	11,300	2.30	7.2	
	CK5A/CK5BA018	17,800	NONE	—	—	11.50	10.40	17,700	3.18	11,200	2.24	7.0	
	CK5A/CK5BA024	18,500	NONE	—	—	11.50	10.75	17,900	3.34	11,300	2.30	7.2	
	CK5A/CK5BW024	18,500	NONE	—	—	11.50	10.75	17,900	3.34	11,300	2.30	7.2	
	F(A,B)4BN(F,C)018	17,400	TDR	—	11.30	—	10.30	17,500	3.10	11,100	2.20	7.0	
	FC4CNF024	18,800	TDR&TXV	12.00	—	—	10.80	17,800	3.30	11,200	2.28	7.5	
	FF1DNA018	17,600	TDR	—	11.50	—	10.70	17,400	3.16	10,900	2.24	7.0	
	FF1DNA024	18,800	TDR	—	12.00	—	10.75	17,800	3.30	11,200	2.28	7.5	
	FF1DNE018	17,600	TDR&TXV	11.50	—	—	10.70	17,400	3.16	10,900	2.24	7.0	
	FG3AAA024	18,400	NONE	—	—	11.50	10.45	17,700	3.12	11,200	2.22	7.4	
	FK4DNF001	18,800	TDR&TXV	13.20	—	—	12.20	17,200	3.46	10,600	2.42	8.0	
	FK4DNF002	19,000	TDR&TXV	13.50	—	—	12.30	17,300	3.58	10,700	2.46	8.0	
	COILS + 315(A,J)AV036070 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA024	18,500	TDR	—	13.00	—	11.70	17,000	3.18	10,500	2.30	7.5	
	CC5A/CD5AW024	18,500	TDR	—	13.00	—	11.70	17,000	3.18	10,500	2.30	7.5	
	CE3AA024	18,500	TDR	—	13.00	—	11.75	17,000	3.20	10,500	2.34	7.5	
	CK3BA024	18,500	TDR	—	13.00	—	12.00	17,000	3.42	10,600	2.40	7.5	
	CK5A/CK5BA024	18,500	TDR	—	13.00	—	12.00	17,000	3.42	10,600	2.40	7.5	
	CK5A/CK5BW024	18,500	TDR	—	13.00	—	12.00	17,000	3.42	10,600	2.40	7.5	
024-F, G	*F(A,B)4BN(F,C)030	23,000	TDR	—	12.00	—	11.00	23,600	3.38	14,100	2.26	7.5	
	CC5A/CD5AA024	22,400	NONE	—	—	11.70	10.60	23,600	3.18	14,100	2.18	7.3	
	CC5A/CD5AA030	22,600	NONE	—	—	12.00	10.60	23,600	3.16	14,100	2.18	7.3	
	CC5A/CD5AW024	22,400	NONE	—	—	11.70	10.60	23,600	3.18	14,100	2.18	7.3	
	CC5A/CD5AW030	22,600	NONE	—	—	12.00	10.60	23,600	3.16	14,100	2.18	7.3	
	CE3AA024	22,600	NONE	—	—	11.80	10.65	23,600	3.24	14,100	2.20	7.3	
	CE3AA030	23,000	NONE	—	—	12.00	10.80	23,600	3.32	14,200	2.24	7.5	
	CF5AA024	22,600	NONE	—	—	11.80	10.60	23,600	3.18	14,100	2.18	7.3	
	CK3BA024	22,400	NONE	—	—	11.70	10.75	23,600	3.40	14,200	2.26	7.3	
	CK3BA030	22,600	NONE	—	—	12.00	10.65	23,600	3.28	14,200	2.24	7.3	
	CK5A/CK5BA024	22,400	NONE	—	—	11.70	10.75	23,600	3.40	14,200	2.26	7.3	
	CK5A/CK5BA030	22,600	NONE	—	—	12.00	10.65	23,600	3.30	14,200	2.24	7.3	
	CK5A/CK5BW024	22,400	NONE	—	—	11.70	10.75	23,600	3.40	14,200	2.26	7.3	
	CK5A/CK5BW030	22,600	NONE	—	—	12.00	10.65	23,600	3.30	14,200	2.24	7.3	
	F(A,B)4BN(F,C)024	22,600	TDR	—	11.70	—	10.85	23,600	3.36	14,100	2.24	7.5	
	FC4CNF024	22,600	TDR&TXV	11.70	—	—	10.85	23,600	3.36	14,100	2.24	7.5	
	FC4CNF030	23,000	TDR&TXV	12.00	—	—	11.00	23,600	3.38	14,100	2.26	7.5	
	FF1DNA024	22,600	TDR	—	11.70	—	10.65	23,600	3.32	14,200	2.22	7.5	
	FF1DNA030	23,200	TDR	—	12.00	—	10.80	23,600	3.36	14,200	2.24	7.5	
	FF1DNE024	22,600	TDR&TXV	11.70	—	—	10.65	23,600	3.32	14,200	2.22	7.5	
	FF1DNE030	23,200	TDR&TXV	12.00	—	—	10.80	23,600	3.36	14,200	2.24	7.5	
	FG3AAA024	22,200	NONE	—	—	11.60	10.40	23,600	3.20	14,100	2.18	7.4	
	FK4DNF001	23,200	TDR&TXV	13.00	—	—	12.15	23,200	3.50	13,500	2.38	7.8	
	FK4DNF002	23,600	TDR&TXV	13.20	—	—	12.35	23,200	3.62	13,500	2.40	8.0	
	FK4DNF003	23,800	TDR&TXV	14.00	—	—	12.50	23,000	3.58	13,400	2.42	8.0	
	COILS + 315(A,J)AV036070 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA030	22,600	TDR	—	13.00	—	11.70	22,800	3.20	13,300	2.26	7.4	
	CC5A/CD5AW030	22,600	TDR	—	13.00	—	11.70	22,800	3.20	13,300	2.26	7.4	
	CE3AA030	22,600	TDR	—	13.30	—	11.90	23,000	3.36	13,400	2.32	7.5	
	CK3BA030	22,600	TDR	—	13.00	—	11.85	23,000	3.36	13,400	2.34	7.4	
	CK5A/CK5BA030	22,600	TDR	—	13.00	—	11.75	23,000	3.36	13,400	2.32	7.4	
	CK5A/CK5BW030	22,600	TDR	—	13.00	—	11.80	23,000	3.36	13,400	2.34	7.4	
	COILS + 355MAV042040 VARIABLE-SPEED FURNACE												
	CE3AA030	23,000	TDR	—	13.30	—	11.80	23,400	3.48	13,700	2.34	7.5	
	COILS + 355MAV042060 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA030	22,600	TDR	—	13.00	—	11.55	23,200	3.30	13,600	2.30	7.4	
	CC5A/CD5AW030	22,600	TDR	—	13.00	—	11.55	23,200	3.30	13,600	2.30	7.4	
	CE3AA030	23,000	TDR	—	13.30	—	11.80	23,400	3.48	13,700	2.34	7.5	
	CK3BA030	22,600	TDR	—	13.00	—	11.70	23,200	3.46	13,700	2.36	7.4	
	CK5A/CK5BA030	22,600	TDR	—	13.00	—	11.55	23,400	3.44	13,700	2.34	7.4	
	CK5A/CK5BW030	22,600	TDR	—	13.00	—	11.65	23,400	3.44	13,700	2.36	7.4	
030-E, F	*F(A,B)4BN(F,C)036	28,400	TDR	—	12.10	—	10.45	29,600	3.28	18,500	2.28	7.6	
	CC5A/CD5AA030	27,800	NONE	—	—	12.00	10.35	29,000	3.08	18,200	2.24	7.3	
	CC5A/CD5AA036	28,800	NONE	—	—	12.50	10.70	29,400	3.32	18,300	2.30	7.5	
	CC5A/CD5AW030	27,800	NONE	—	—	12.00	10.35	29,000	3.08	18,200	2.24	7.3	
	CC5A/CD5AW036	28,800	NONE	—	—	12.50	10.70	29,400	3.32	18,300	2.30	7.5	

See notes on page 13.

COMBINATION RATINGS Continued

UNIT SIZE- SERIES	INDOOR UNIT	ARI STANDARD RATINGS*											
		Cooling						Heating					
		TC	Seasonal Efficiency SEER			EER	High-Temp		Low-Temp		Seasonal Efficiency HSPF		
			Factory- Supplied Enhance- ment	Standard Rating	Field-Supplied Accessory								
TXV‡	TXV & TDR**												
030-E, F	CE3AA030	28,000	NONE	—	—	12.10	10.50	29,400	3.28	18,300	2.28	7.5	
	CE3AA036	28,400	NONE	—	—	12.30	10.55	29,400	3.22	18,300	2.30	7.5	
	CF5AA036	28,400	NONE	—	—	12.40	10.65	29,400	3.28	18,200	2.28	7.5	
	CK3BA030	27,800	NONE	—	—	12.10	10.40	29,000	3.20	18,300	2.30	7.3	
	CK3BA036	28,800	NONE	—	—	12.50	10.75	29,400	3.36	18,400	2.34	7.5	
	CK5A/CK5BA036	28,800	NONE	—	—	12.50	10.75	29,400	3.34	18,400	2.34	7.5	
	CK5A/CK5BT036	28,800	NONE	—	—	12.50	10.75	29,400	3.36	18,400	2.34	7.5	
	CK5A/CK5BW030	27,800	NONE	—	—	12.10	10.40	29,000	3.20	18,300	2.30	7.3	
	CK5A/CK5BW036	28,800	NONE	—	—	12.50	10.75	29,400	3.36	18,400	2.34	7.5	
	F(A,B)4BN(F,C)030	28,000	TDR	—	—	12.20	—	10.60	29,200	3.30	18,300	2.30	7.5
	FC4CNF030	28,000	TDR&TXV	12.20	—	—	—	10.60	29,200	3.30	18,300	2.30	7.5
	FC4CNF036	28,400	TDR&TXV	12.10	—	—	—	10.45	29,600	3.26	18,500	2.28	7.6
	FF1DNA030	28,200	TDR	—	—	12.20	—	10.50	29,400	3.32	18,400	2.30	7.5
	FF1DNE030	28,200	TDR&TXV	12.20	—	—	—	10.50	29,400	3.32	18,400	2.30	7.5
	FG3AAA036	28,400	NONE	—	—	12.20	—	10.50	29,400	3.26	18,300	2.30	7.5
	FK4DNF001	28,600	TDR&TXV	13.50	—	—	—	11.50	29,000	3.38	17,600	2.38	7.9
	FK4DNF002	28,600	TDR&TXV	13.50	—	—	—	11.55	29,000	3.50	17,700	2.42	8.0
	FK4DNF003	29,200	TDR&TXV	14.00	—	—	—	11.90	28,800	3.46	17,500	2.44	8.1
	COILS + 315(A,J)AV036070 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA036	28,800	TDR	—	13.50	—	11.60	29,000	3.36	17,600	2.38	7.8	
	CE3AA036	28,400	TDR	—	13.20	—	11.35	29,000	3.28	17,600	2.36	7.8	
	CK3BA036	28,800	TDR	—	13.50	—	11.60	29,000	3.44	17,600	2.42	7.8	
	CK5A/CK5BA036	28,800	TDR	—	13.50	—	11.60	29,000	3.44	17,600	2.42	7.8	
	CK5A/CK5BT036	28,800	TDR	—	13.50	—	11.60	29,000	3.44	17,600	2.42	7.8	
	COILS + 315(A,J)AV048090 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA036	28,800	TDR	—	13.50	—	11.75	29,000	3.38	17,500	2.40	7.8	
	CC5A/CD5AW036	28,800	TDR	—	13.50	—	11.75	29,000	3.38	17,500	2.40	7.8	
	CE3AA036	28,800	TDR	—	13.50	—	11.60	29,000	3.32	17,400	2.38	7.8	
	CK3BA036	28,800	TDR	—	13.50	—	11.80	29,000	3.46	17,500	2.44	7.8	
	CK5A/CK5BA036	28,800	TDR	—	13.50	—	11.80	29,000	3.46	17,600	2.44	7.8	
	CK5A/CK5BW036	28,800	TDR	—	13.50	—	11.80	29,000	3.46	17,500	2.44	7.8	
	COILS + 355MAV042060 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA036	28,800	TDR	—	13.00	—	11.40	29,000	3.42	17,900	2.40	7.8	
	CE3AA036	28,400	TDR	—	13.00	—	11.15	29,000	3.32	17,900	2.38	7.8	
	CK3BA036	28,800	TDR	—	13.00	—	11.35	29,000	3.46	18,000	2.42	7.8	
	CK5A/CK5BA036	28,800	TDR	—	13.00	—	11.35	29,000	3.46	18,000	2.42	7.8	
	CK5A/CK5BT036	28,800	TDR	—	13.00	—	11.35	29,000	3.46	18,000	2.42	7.8	
	COILS + 355MAV042080 VARIABLE-SPEED FURNACE												
	CC5A/CD5AW036	28,800	TDR	—	13.00	—	11.55	29,000	3.46	17,800	2.42	7.8	
	CE3AA036	28,400	TDR	—	13.00	—	11.30	29,000	3.34	17,800	2.38	7.8	
	CK3BA036	28,800	TDR	—	13.00	—	11.50	29,000	3.48	17,900	2.44	7.8	
	CK5A/CK5BW036	28,800	TDR	—	13.00	—	11.50	29,000	3.48	17,900	2.44	7.8	
	COILS + 355MAV060100 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA036	28,800	TDR	—	13.00	—	11.55	29,000	3.46	17,800	2.42	7.8	
	CC5A/CD5AW036	28,800	TDR	—	13.00	—	11.55	29,000	3.46	17,800	2.42	7.8	
	CE3AA036	28,400	TDR	—	13.00	—	11.35	29,000	3.36	17,800	2.40	7.8	
	CK3BA036	28,800	TDR	—	13.00	—	11.70	29,000	3.52	17,800	2.48	7.8	
	CK5A/CK5BA036	28,800	TDR	—	13.00	—	11.70	29,000	3.52	17,800	2.48	7.8	
	CK5A/CK5BT036	28,800	TDR	—	13.00	—	11.70	29,000	3.52	17,800	2.48	7.8	
	CK5A/CK5BW036	28,800	TDR	—	13.00	—	11.70	29,000	3.52	17,800	2.48	7.8	
	COILS + 355MAV060120 VARIABLE-SPEED FURNACE												
	CC5A/CD5AW036	28,800	TDR	—	13.00	—	11.55	29,000	3.46	17,800	2.42	7.8	
	CE3AA036	28,400	TDR	—	13.00	—	11.35	29,000	3.36	17,800	2.40	7.8	
	CK5A/CK5BW036	28,800	TDR	—	13.00	—	11.65	29,000	3.52	17,800	2.46	7.8	
036-E, F	*F(A,B)4BN(F,B,C)042	33,800	TDR	—	12.10	—	10.45	35,800	3.46	23,000	2.44	8.0	
	CC5A/CD5AA036	33,600	NONE	—	—	12.10	10.50	35,800	3.42	22,800	2.42	7.7	
	CC5A/CD5AA042	33,600	NONE	—	—	12.10	10.50	35,800	3.42	22,800	2.42	7.7	
	CC5A/CD5AW036	33,600	NONE	—	—	12.10	11.25	35,400	3.46	22,000	2.48	7.7	
	CC5A/CD5AW042	33,400	NONE	—	—	12.10	10.45	35,800	3.38	22,800	2.40	7.6	
	CE3AA036	33,200	NONE	—	—	12.00	10.40	35,600	3.38	22,800	2.40	7.6	
	CE3AA042	33,800	NONE	—	—	12.10	10.60	36,000	3.48	22,800	2.44	7.7	
	CF5AA036	33,400	NONE	—	—	12.10	10.50	35,800	3.40	22,800	2.42	7.7	
	CK3BA036	33,600	NONE	—	—	12.10	10.50	35,800	3.50	22,800	2.46	7.7	
	CK3BA042	33,600	NONE	—	—	12.10	10.50	35,800	3.50	22,800	2.46	7.7	
	CK5A/CK5BA036	33,600	NONE	—	—	12.10	10.55	35,800	3.50	22,800	2.46	7.7	
	CK5A/CK5BA042	33,600	NONE	—	—	12.10	10.50	35,800	3.50	22,800	2.46	7.7	
	CK5A/CK5BE042	33,600	NONE	—	—	12.10	10.60	35,800	3.54	23,000	2.48	7.7	
	CK5A/CK5BT036	33,600	NONE	—	—	12.10	10.50	35,800	3.50	22,800	2.46	7.7	
	CK5A/CK5BT042	33,600	NONE	—	—	12.10	10.50	35,800	3.50	22,800	2.46	7.7	
	CK5A/CK5BW036	33,600	NONE	—	—	12.10	10.50	35,800	3.50	22,800	2.46	7.7	

See notes on page 13.

COMBINATION RATINGS Continued

UNIT SIZE- SERIES	INDOOR UNIT	ARI STANDARD RATINGS*											
		Cooling						Heating					
		TC	Seasonal Efficiency SEER				EER	High-Temp		Low-Temp		Seasonal Efficiency HSPF	
			Factory- Supplied Enhance- ment	Standard Rating	Field-Supplied Accessory								
TXV‡	TXV & TDR**				TC	COP		TC	COP				
036-E, F	F(A,B)4BN(F,C)036	33,000	TDR	—	11.70	—	10.20	36,000	3.38	23,000	2.38	7.6	
	FC4CN(F,B)042	33,800	TDR&TXV	12.10	—	—	10.45	35,800	3.46	23,000	2.44	8.0	
	FC4CNF036	33,000	TDR&TXV	11.70	—	—	10.20	36,000	3.38	23,000	2.38	7.6	
	FG3AAA036	33,000	NONE	—	—	12.00	10.30	35,800	3.38	22,800	2.40	7.7	
	FK4DNF001	33,200	TDR&TXV	12.20	—	—	11.00	35,000	3.46	22,200	2.46	7.8	
	FK4DNF002	33,400	TDR&TXV	12.30	—	—	11.00	35,000	3.58	22,200	2.50	8.0	
	FK4DNF003	33,600	TDR&TXV	13.00	—	—	11.55	35,000	3.58	21,800	2.56	8.0	
	FK4DNF005	35,000	TDR&TXV	14.00	—	—	12.00	33,400	3.72	22,000	2.64	8.0	
	COILS + 315(A,J)AV036070 VARIABLE-SPEED FURNACE												
	CE3AA042	33,800	TDR	—	13.00	—	11.30	35,200	3.52	22,000	2.50	8.0	
	CK5A/CK5BE042	33,800	TDR	—	13.00	—	11.35	35,200	3.60	22,200	2.54	8.0	
	COILS + 315(A,J)AV048090 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA042	33,800	TDR	—	13.00	—	11.50	35,200	3.50	21,800	2.52	8.0	
	CE3AA042	33,800	TDR	—	13.00	—	11.50	35,200	3.56	22,000	2.54	8.0	
	CK3BA042	33,800	TDR	—	13.00	—	11.45	35,200	3.58	22,000	2.56	8.0	
	CK5A/CK5BA042	33,800	TDR	—	13.00	—	11.45	35,200	3.58	22,000	2.56	8.0	
	CK5A/CK5BE042	33,800	TDR	—	13.00	—	11.50	35,200	3.64	22,000	2.56	8.0	
	CK5A/CK5BT042	33,800	TDR	—	13.00	—	11.45	35,200	3.58	22,000	2.56	8.0	
	COILS + 315(A,J)AV066110 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA042	33,800	TDR	—	13.50	—	11.60	35,200	3.52	21,800	2.52	8.0	
	CC5A/CD5AW042	33,800	TDR	—	13.50	—	11.55	35,200	3.48	21,600	2.50	8.0	
	CE3AA042	33,800	TDR	—	13.50	—	11.60	35,200	3.58	21,800	2.56	8.0	
	CK3BA042	33,800	TDR	—	13.50	—	11.55	35,200	3.60	21,800	2.56	8.0	
	CK5A/CK5BA042	33,800	TDR	—	13.50	—	11.55	35,200	3.60	21,800	2.56	8.0	
	CK5A/CK5BT042	33,800	TDR	—	13.50	—	11.55	35,200	3.60	21,800	2.56	8.0	
	COILS + 315(A,J)AV066135 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA042	33,800	TDR	—	13.50	—	11.55	35,200	3.52	21,800	2.52	8.0	
	CC5A/CD5AW042	33,800	TDR	—	13.50	—	11.50	35,200	3.46	21,800	2.50	8.0	
	CE3AA042	33,800	TDR	—	13.50	—	11.55	35,200	3.58	21,800	2.54	8.0	
	CK3BA042	33,800	TDR	—	13.50	—	11.50	35,200	3.60	22,000	2.56	8.0	
	CK5A/CK5BA042	33,800	TDR	—	13.50	—	11.50	35,200	3.60	22,000	2.56	8.0	
	CK5A/CK5BT042	33,800	TDR	—	13.50	—	11.50	35,200	3.60	22,000	2.56	8.0	
	COILS + 315(A,J)AV066155 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA042	33,800	TDR	—	13.50	—	11.65	35,200	3.54	21,600	2.54	8.0	
	CC5A/CD5AW042	33,800	TDR	—	13.50	—	11.60	35,200	3.48	21,600	2.52	8.0	
	CE3AA042	33,800	TDR	—	13.50	—	11.65	35,200	3.58	21,800	2.56	8.0	
	CK3BA042	33,800	TDR	—	13.50	—	11.60	35,200	3.62	21,800	2.58	8.0	
	CK5A/CK5BA042	33,800	TDR	—	13.50	—	11.60	35,200	3.62	21,800	2.58	8.0	
	CK5A/CK5BT042	33,800	TDR	—	13.50	—	11.60	35,200	3.62	21,800	2.58	8.0	
	COILS + 355MAV042060 VARIABLE-SPEED FURNACE												
	CE3AA042	33,600	TDR	—	13.00	—	10.90	35,200	3.54	22,600	2.50	8.0	
	COILS + 355MAV042080 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA042	33,600	TDR	—	13.00	—	11.15	35,200	3.54	22,400	2.50	8.0	
	CC5A/CD5AW042	33,600	TDR	—	13.00	—	11.05	35,200	3.50	22,200	2.48	8.0	
	CE3AA042	33,600	TDR	—	13.00	—	11.10	35,200	3.58	22,400	2.52	8.0	
	CK5A/CK5BA042	33,600	TDR	—	13.00	—	11.05	35,200	3.60	22,400	2.54	8.0	
	CK5A/CK5BT042	33,600	TDR	—	13.00	—	11.05	35,200	3.60	22,400	2.54	8.0	
	COILS + 355MAV060080 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA042	33,600	TDR	—	13.00	—	11.20	35,200	3.56	22,200	2.52	8.0	
	CC5A/CD5AW042	33,600	TDR	—	13.00	—	11.15	35,200	3.50	22,200	2.50	8.0	
	CE3AA042	33,600	TDR	—	13.00	—	11.20	35,200	3.60	22,400	2.54	8.0	
	CK3BA042	33,600	TDR	—	13.00	—	10.90	35,200	3.58	22,600	2.52	8.0	
	CK5A/CK5BA042	33,600	TDR	—	13.00	—	10.90	35,200	3.58	22,600	2.52	8.0	
	CK5A/CK5BT042	33,600	TDR	—	13.00	—	10.90	35,200	3.58	22,600	2.52	8.0	
	COILS + 355MAV060100 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA042	33,600	TDR	—	13.00	—	11.20	35,200	3.56	22,200	2.52	8.0	
	CC5A/CD5AW042	33,600	TDR	—	13.00	—	11.15	35,200	3.50	22,200	2.50	8.0	
	CE3AA042	33,600	TDR	—	13.00	—	11.20	35,200	3.60	22,400	2.54	8.0	
	CK3BA042	33,600	TDR	—	13.00	—	11.30	35,200	3.64	22,400	2.56	8.0	
	CK5A/CK5BA042	33,600	TDR	—	13.00	—	11.30	35,200	3.64	22,400	2.56	8.0	
	CK5A/CK5BT042	33,600	TDR	—	13.00	—	11.30	35,200	3.64	22,400	2.56	8.0	
	COILS + 355MAV060120 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA042	33,600	TDR	—	13.00	—	11.20	35,200	3.56	22,200	2.52	8.0	
	CC5A/CD5AW042	33,600	TDR	—	13.00	—	11.15	35,200	3.50	22,200	2.50	8.0	
	CE3AA042	33,600	TDR	—	13.00	—	11.20	35,200	3.60	22,400	2.54	8.0	
	CK5A/CK5BA042	33,600	TDR	—	13.00	—	11.30	35,200	3.64	22,400	2.56	8.0	
	CK5A/CK5BT042	33,600	TDR	—	13.00	—	11.30	35,200	3.64	22,400	2.56	8.0	

See notes on page 13.

COMBINATION RATINGS Continued

UNIT SIZE- SERIES	INDOOR UNIT	ARI STANDARD RATINGS*										
		Cooling						Heating				
		TC	Seasonal Efficiency SEER			EER	High-Temp		Low-Temp		Seasonal Efficiency HSPF	
			Factory- Supplied Enhance- ment	Standard Rating	Field-Supplied Accessory							
TXV‡	TXV & TDR**	TC				COP	TC	COP				
042-D, E	*F(A,B)4BN(F,B,C)048	40,000	TDR	—	12.00	—	10.65	43,000	3.46	27,800	2.54	8.0
	CC5A/CD5AA042	39,000	NONE	—	—	12.00	10.70	42,000	3.32	27,200	2.50	7.5
	CC5A/CD5AC048	39,000	NONE	—	—	11.80	10.55	42,000	3.24	27,200	2.46	7.5
	CC5A/CD5AW048	40,000	NONE	—	—	12.00	10.70	42,500	3.38	27,400	2.52	7.6
	CD5AA048	40,000	NONE	—	—	12.00	10.75	42,500	3.38	27,400	2.52	7.6
	CE3AA042	39,500	NONE	—	—	12.00	10.70	42,500	3.38	27,400	2.52	7.6
	CE3AA048	40,000	NONE	—	—	12.00	10.75	42,500	3.42	27,400	2.54	7.7
	CF5AA048	40,000	NONE	—	—	12.00	10.75	42,000	3.36	27,400	2.52	7.6
	CK3BA042	39,000	NONE	—	—	12.00	10.70	42,000	3.38	27,200	2.52	7.5
	CK3BA048	40,000	NONE	—	—	12.00	10.85	42,500	3.42	27,200	2.54	7.6
	CK5A/CK5BA042	39,000	NONE	—	—	12.00	10.70	42,000	3.38	27,200	2.52	7.5
	CK5A/CK5BA048	40,000	NONE	—	—	12.00	10.85	42,500	3.46	27,400	2.56	7.6
	CK5A/CK5BE042	39,000	NONE	—	—	12.00	10.85	41,000	3.42	27,200	2.54	7.5
	CK5A/CK5BT042	39,000	NONE	—	—	12.00	10.70	42,000	3.38	27,200	2.52	7.5
	CK5A/CK5BT048	40,000	NONE	—	—	12.00	10.85	42,500	3.46	27,400	2.56	7.6
	CK5A/CK5BW048	40,000	NONE	—	—	12.00	10.85	42,500	3.42	27,200	2.54	7.6
	F(A,B)4BN(F,B,C)042	39,500	TDR	—	11.70	—	10.45	42,500	3.32	27,600	2.48	7.6
	FC4CN(F,B)042	39,500	TDR&TXV	11.70	—	—	10.45	42,500	3.32	27,600	2.48	7.6
	FC4CN(F,B)048	40,000	TDR&TXV	12.00	—	—	10.65	43,000	3.46	27,800	2.54	8.0
	FG3AAA048	39,500	NONE	—	—	11.70	10.70	42,500	3.46	27,400	2.56	7.7
	FK4DNB006	42,000	TDR&TXV	14.00	—	—	12.50	42,000	3.86	26,600	2.82	8.3
	FK4DNF003	39,500	TDR&TXV	13.00	—	—	11.55	41,500	3.40	26,400	2.60	7.8
	FK4DNF005	41,500	TDR&TXV	13.50	—	—	12.10	42,000	3.70	26,600	2.74	8.0
	COILS + 315(A,J)AV048090 VARIABLE-SPEED FURNACE											
	CC5A/CD5AC048	39,000	TDR	—	13.00	—	11.35	42,000	3.26	26,200	2.56	7.8
	CD5AA048	39,000	TDR	—	13.00	—	11.55	42,000	3.44	26,400	2.60	8.0
	CE3AA048	39,000	TDR	—	13.00	—	11.50	42,000	3.48	26,600	2.62	8.0
	CK3BA048	39,000	TDR	—	13.00	—	11.50	42,000	3.52	26,600	2.64	8.0
	CK5A/CK5BA048	39,000	TDR	—	13.00	—	11.50	42,000	3.52	26,600	2.64	8.0
	CK5A/CK5BT048	39,000	TDR	—	13.00	—	11.50	42,000	3.52	26,600	2.64	8.0
	COILS + 315(A,J)AV066110 VARIABLE-SPEED FURNACE											
	CC5A/CD5AC048	39,000	TDR	—	13.00	—	11.50	42,000	3.28	26,200	2.56	7.8
	CC5A/CD5AW048	39,000	TDR	—	13.00	—	11.65	42,000	3.44	26,200	2.62	8.0
	CD5AA048	39,000	TDR	—	13.00	—	11.65	42,000	3.46	26,200	2.62	8.0
	CE3AA048	39,000	TDR	—	13.00	—	11.60	42,000	3.50	26,400	2.64	8.0
	CK3BA048	39,000	TDR	—	13.00	—	11.65	42,000	3.54	26,400	2.66	8.0
	CK5A/CK5BA048	39,000	TDR	—	13.00	—	11.65	42,000	3.54	26,400	2.66	8.0
	CK5A/CK5BT048	39,000	TDR	—	13.00	—	11.65	42,000	3.54	26,400	2.66	8.0
	CK5A/CK5BW048	39,000	TDR	—	13.00	—	11.65	42,000	3.54	26,400	2.66	8.0
	COILS + 315(A,J)AV066135 VARIABLE-SPEED FURNACE											
	CC5A/CD5AC048	39,000	TDR	—	13.00	—	11.50	42,000	3.28	26,000	2.58	7.8
	CC5A/CD5AW048	39,000	TDR	—	13.00	—	11.70	42,000	3.46	26,200	2.62	8.0
	CD5AA048	39,000	TDR	—	13.00	—	11.70	42,000	3.46	26,200	2.62	8.0
	CE3AA048	39,000	TDR	—	13.00	—	11.60	42,000	3.50	26,400	2.64	8.0
	CK3BA048	39,000	TDR	—	13.00	—	11.65	42,000	3.54	26,400	2.66	8.0
	CK5A/CK5BA048	39,000	TDR	—	13.00	—	11.65	42,000	3.54	26,400	2.66	8.0
	CK5A/CK5BT048	39,000	TDR	—	13.00	—	11.65	42,000	3.54	26,400	2.66	8.0
	CK5A/CK5BW048	39,000	TDR	—	13.00	—	11.65	42,000	3.54	26,400	2.66	8.0
	COILS + 315(A,J)AV066155 VARIABLE-SPEED FURNACE											
	CC5A/CD5AC048	39,000	TDR	—	13.00	—	11.55	42,000	3.28	26,000	2.58	7.8
	CC5A/CD5AW048	39,000	TDR	—	13.00	—	11.75	42,000	3.46	26,200	2.64	8.0
	CD5AA048	39,000	TDR	—	13.00	—	11.75	42,000	3.46	26,200	2.64	8.0
	CE3AA048	39,000	TDR	—	13.00	—	11.65	42,000	3.50	26,400	2.64	8.0
	CK3BA048	39,000	TDR	—	13.00	—	11.70	42,000	3.56	26,400	2.68	8.0
	CK5A/CK5BA048	39,000	TDR	—	13.00	—	11.70	42,000	3.56	26,400	2.68	8.0
	CK5A/CK5BT048	39,000	TDR	—	13.00	—	11.70	42,000	3.56	26,400	2.68	8.0
	CK5A/CK5BW048	39,000	TDR	—	13.00	—	11.70	42,000	3.56	26,400	2.68	8.0
	COILS + 355MAV042080 VARIABLE-SPEED FURNACE											
	CD5AA048	40,000	TDR	—	12.50	—	11.10	42,000	3.44	27,000	2.56	8.0
	CE3AA048	40,000	TDR	—	12.50	—	11.00	42,000	3.46	27,200	2.58	8.0
	CK5A/CK5BA048	40,000	TDR	—	12.50	—	10.95	42,000	3.48	27,200	2.60	8.0
	CK5A/CK5BT048	40,000	TDR	—	12.50	—	10.95	42,000	3.48	27,200	2.60	8.0
	COILS + 355MAV060080 VARIABLE-SPEED FURNACE											
	CD5AA048	40,000	TDR	—	13.00	—	11.20	42,000	3.46	26,800	2.58	8.0
	CE3AA048	40,000	TDR	—	12.50	—	11.10	42,000	3.48	27,200	2.60	8.0
	CK5A/CK5BA048	40,000	TDR	—	12.50	—	10.85	42,000	3.46	27,400	2.58	8.0
	CK5A/CK5BT048	40,000	TDR	—	12.50	—	10.85	42,000	3.46	27,400	2.58	8.0
	COILS + 355MAV060100 VARIABLE-SPEED FURNACE											
	CD5AA048	40,000	TDR	—	13.00	—	11.20	42,000	3.46	26,800	2.58	8.0

See notes on page 13.

COMBINATION RATINGS Continued

UNIT SIZE- SERIES	INDOOR UNIT	ARI STANDARD RATINGS*											
		Cooling						Heating					
		TC	Seasonal Efficiency SEER			EER	High-Temp		Low-Temp		Seasonal Efficiency HSPF		
			Factory- Supplied Enhance- ment	Standard Rating	Field-Supplied Accessory								
					TXV‡	TXV & TDR**		TC	COP	TC	COP		
042-D, E	CE3AA048	40,000	TDR	—	12.50	—	11.10	42,000	3.48	27,200	2.60	8.0	
	CK3BA048	40,000	TDR	—	13.00	—	11.20	42,000	3.54	27,000	2.64	8.0	
	CK5A/CK5BA048	40,000	TDR	—	13.00	—	11.20	42,000	3.54	27,000	2.64	8.0	
	CK5A/CK5BT048	40,000	TDR	—	13.00	—	11.20	42,000	3.54	27,000	2.64	8.0	
	COILS + 355MAV060120 VARIABLE-SPEED FURNACE												
	CC5A/CD5AW048	40,000	TDR	—	13.00	—	11.20	42,000	3.46	26,800	2.58	8.0	
	CE3AA048	40,000	TDR	—	12.50	—	11.10	42,000	3.48	27,200	2.60	8.0	
	CK3BA048	40,000	TDR	—	13.00	—	11.25	42,000	3.54	27,000	2.64	8.0	
	CK5A/CK5BA048	40,000	TDR	—	13.00	—	11.25	42,000	3.54	27,000	2.64	8.0	
	CK5A/CK5BT048	40,000	TDR	—	13.00	—	11.25	42,000	3.54	27,000	2.64	8.0	
	CK5A/CK5BW048	40,000	TDR	—	13.00	—	11.25	42,000	3.54	27,000	2.64	8.0	
048-D, E	*FK4DNF005	48,000	TDR&TXV	13.00	—	—	10.95	48,000	3.58	31,600	2.64	8.0	
	CC5A/CD5AA060	46,000	NONE	—	—	11.50	9.95	48,000	3.24	32,200	2.44	7.4	
	CC5A/CD5AC048	44,500	NONE	—	—	11.50	9.80	48,000	3.10	31,800	2.38	7.0	
	CC5A/CD5AW048	45,500	NONE	—	—	11.50	9.90	48,000	3.28	32,200	2.46	7.5	
	CC5A/CD5AW060	47,000	NONE	—	—	12.00	10.20	48,000	3.42	32,400	2.52	7.8	
	CD5AA048	45,500	NONE	—	—	11.50	9.90	48,000	3.28	32,200	2.46	7.5	
	CE3AA048	46,000	NONE	—	—	11.50	10.00	48,000	3.36	32,200	2.50	7.6	
	CE3AA060	47,500	NONE	—	—	12.00	10.25	48,000	3.44	32,400	2.54	7.8	
	CF5AA048	45,000	NONE	—	—	11.50	10.00	48,000	3.22	32,000	2.44	7.3	
	CK3BA048	45,500	NONE	—	—	11.50	9.90	48,000	3.36	32,200	2.50	7.5	
	CK3BA060	46,000	NONE	—	—	11.50	10.20	48,000	3.52	32,400	2.56	7.4	
	CK5A/CK5BA048	45,500	NONE	—	—	11.50	9.90	48,000	3.36	32,200	2.50	7.5	
	CK5A/CK5BA060	46,000	NONE	—	—	11.50	10.20	48,000	3.52	32,400	2.56	7.4	
	CK5A/CK5BT048	45,500	NONE	—	—	11.50	9.90	48,000	3.36	32,200	2.50	7.5	
	CK5A/CK5BT060	46,000	NONE	—	—	11.50	10.20	48,000	3.52	32,400	2.56	7.4	
	CK5A/CK5BW048	45,500	NONE	—	—	11.50	9.90	48,000	3.36	32,200	2.50	7.5	
	CK5A/CK5BX060	47,000	NONE	—	—	12.00	10.35	48,000	3.56	32,400	2.58	7.8	
	F(A,B)4BN(F,B,C)048	46,000	TDR	—	11.50	—	9.90	48,000	3.40	32,600	2.50	7.6	
	F(A,B)4BN(F,B,C)060	47,500	TDR	—	11.70	—	10.00	48,000	3.48	33,000	2.52	7.8	
	FB4BNB070	48,000	TDR	—	12.00	—	10.40	48,000	3.62	32,800	2.60	8.0	
	FC4CN(F,B)048	46,000	TDR&TXV	11.50	—	—	9.90	48,000	3.40	32,600	2.50	7.6	
	FC4CN(F,B)060	47,500	TDR&TXV	11.70	—	—	10.00	48,000	3.48	33,000	2.52	7.8	
	FC4CNB054	48,000	TDR&TXV	12.10	—	—	10.45	48,000	3.64	32,600	2.60	8.0	
	FC4CNB070	48,000	TDR&TXV	12.00	—	—	10.40	48,000	3.62	32,800	2.60	8.0	
	FG3AAA048	45,000	NONE	—	—	11.40	9.90	48,000	3.34	32,200	2.48	7.5	
	FG3AAA060	46,000	NONE	—	—	11.80	10.10	48,000	3.38	32,400	2.50	7.6	
	FK4DNB006	48,000	TDR&TXV	13.50	—	—	11.35	48,000	3.74	31,400	2.72	8.2	
	COILS + 315(A,J)AV048090 VARIABLE-SPEED FURNACE												
	CE3AA060	45,500	TDR	—	12.50	—	10.70	48,000	3.42	31,600	2.58	7.8	
	COILS + 315(A,J)AV066110 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA060	45,000	TDR	—	12.00	—	10.60	48,000	3.24	31,000	2.50	7.8	
	CE3AA060	45,500	TDR	—	12.50	—	10.90	48,000	3.46	31,400	2.60	7.8	
	CK3BA060	45,500	TDR	—	12.50	—	10.85	48,000	3.58	31,400	2.64	7.8	
	CK5A/CK5BA060	45,500	TDR	—	12.50	—	10.85	48,000	3.58	31,400	2.64	7.8	
	CK5A/CK5BT060	45,500	TDR	—	12.50	—	10.85	48,000	3.58	31,400	2.64	7.8	
	CK5A/CK5BX060	47,000	TDR	—	13.00	—	11.15	48,000	3.62	31,400	2.66	7.8	
	COILS + 315(A,J)AV066135 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA060	45,000	TDR	—	12.00	—	10.55	48,000	3.24	31,200	2.50	7.8	
	CC5A/CD5AW060	47,000	TDR	—	13.00	—	10.85	48,000	3.44	31,200	2.58	7.8	
	CE3AA060	45,500	TDR	—	12.50	—	10.85	48,000	3.44	31,400	2.60	7.8	
	CK3BA060	45,500	TDR	—	12.50	—	10.85	48,000	3.58	31,400	2.64	7.8	
	CK5A/CK5BA060	45,500	TDR	—	12.50	—	10.85	48,000	3.58	31,400	2.64	7.8	
	CK5A/CK5BT060	45,500	TDR	—	12.50	—	10.85	48,000	3.58	31,400	2.64	7.8	
	CK5A/CK5BX060	47,000	TDR	—	13.00	—	11.05	48,000	3.60	31,400	2.66	7.8	
	COILS + 315(A,J)AV066155 VARIABLE-SPEED FURNACE												
	CC5A/CD5AA060	45,000	TDR	—	12.00	—	10.65	48,000	3.26	30,200	2.46	7.8	
CC5A/CD5AW060	47,000	TDR	—	13.00	—	10.95	48,000	3.46	31,200	2.60	7.8		
CE3AA060	45,500	TDR	—	12.50	—	10.95	48,000	3.46	31,200	2.60	7.8		
CK3BA060	45,500	TDR	—	12.50	—	10.95	48,000	3.60	31,400	2.64	7.8		
CK5A/CK5BA060	45,500	TDR	—	12.50	—	10.95	48,000	3.60	31,400	2.64	7.8		
CK5A/CK5BT060	45,500	TDR	—	12.50	—	10.95	48,000	3.60	31,400	2.66	7.8		
CK5A/CK5BX060	47,000	TDR	—	13.00	—	11.15	48,000	3.62	31,400	2.68	7.8		
COILS + 355MAV060080 VARIABLE-SPEED FURNACE													
CC5A/CD5AA060	46,000	TDR	—	11.50	—	10.05	48,000	3.58	31,600	2.64	8.0		
CC5A/CD5AW060	47,000	TDR	—	12.00	—	10.40	48,000	3.26	32,200	2.46	8.0		
CE3AA060	47,000	TDR	—	12.00	—	10.40	48,000	3.60	32,400	2.62	8.0		
COILS + 355MAV060100 VARIABLE-SPEED FURNACE													
CC5A/CD5AA060	46,000	TDR	—	11.50	—	10.05	48,000	3.46	32,200	2.54	8.0		
CC5A/CD5AW060	47,000	TDR	—	12.00	—	10.40	48,000	3.26	32,200	2.46	8.0		

See notes on page 13.

UNIT SIZE- SERIES	INDOOR UNIT	ARI STANDARD RATINGS*										
		Cooling						Heating				
		TC	Seasonal Efficiency SEER			EER	High-Temp		Low-Temp		Seasonal Efficiency HSPF	
			Factory- Supplied Enhance- ment	Standard Rating	Field-Supplied Accessory							
					TXV‡	TXV & TDR**		TC	COP	TC	COP	
048-D, E	CE3AA060	47,000	TDR	—	12.00	—	10.40	48,000	3.44	32,200	2.56	8.0
	CK3BA060	47,000	TDR	—	12.50	—	10.80	48,000	3.68	31,800	2.66	8.0
	CK5A/CK5BA060	47,000	TDR	—	12.50	—	10.80	48,000	3.46	32,200	2.54	8.0
	CK5A/CK5BT060	47,000	TDR	—	12.50	—	10.80	48,000	3.68	31,800	2.66	8.0
	CK5A/CK5BX060	47,000	TDR	—	12.00	—	10.55	48,000	3.68	31,800	2.66	8.0
	COILS + 355MAV060120 VARIABLE-SPEED FURNACE											
	CC5A/CD5AA060	46,000	TDR	—	11.50	—	10.05	48,000	3.46	32,200	2.54	8
	CC5A/CD5AW060	47,000	TDR	—	12.00	—	10.40	48,000	3.26	32,200	2.46	8.0
	CE3AA060	47,000	TDR	—	12.00	—	10.40	48,000	3.44	32,200	2.56	8.0
	CK3BA060	47,000	TDR	—	12.00	—	10.35	48,000	3.58	32,400	2.60	8.0
	CK5A/CK5BA060	47,000	TDR	—	12.00	—	10.35	48,000	3.58	32,400	2.60	8.0
	CK5A/CK5BT060	47,000	TDR	—	12.00	—	10.35	48,000	3.58	32,400	2.60	8.0
	CK5A/CK5BX060	47,000	TDR	—	12.00	—	10.60	48,000	3.58	32,400	2.60	8.0
	060-D, E	*FK4DNB006	59,000	TDR&TXV	12.00	—	—	10.30	60,000	3.40	39,000	2.46
CC5A/CD5AA060		55,000	NONE	—	—	11.00	9.45	60,000	2.94	39,000	2.24	7.0
CC5A/CD5AW060		57,000	NONE	—	—	11.40	9.75	60,000	3.08	38,500	2.30	7.4
CE3AA060		57,000	NONE	—	—	11.50	9.75	60,000	3.12	39,000	2.32	7.4
CK3BA060		55,000	NONE	—	—	11.00	9.65	60,000	3.06	39,000	2.30	7.0
CK5A/CK5BA060		55,000	NONE	—	—	11.00	9.65	60,000	3.06	39,000	2.30	7.0
CK5A/CK5BT060		55,000	NONE	—	—	11.00	9.65	60,000	3.06	39,000	2.30	7.0
CK5A/CK5BX060		57,000	NONE	—	—	11.50	9.85	60,000	3.18	39,000	2.36	7.4
F(A,B)4BN(F,B,C)060		56,500	TDR	—	11.20	—	9.50	60,000	3.16	40,000	2.32	7.5
FB4BNB070		58,000	TDR	—	11.50	—	9.80	60,000	3.30	39,500	2.38	7.7
FC4CN(F,B)060		56,500	TDR&TXV	11.20	—	—	9.50	60,000	3.16	40,000	2.32	7.5
FC4CNB070		58,000	TDR&TXV	11.50	—	—	9.80	60,000	3.30	39,500	2.38	7.7
FG3AAA060		55,500	NONE	—	—	11.30	9.60	60,000	3.04	39,000	2.30	7.3
COILS + 315(A,J)AV066110 VARIABLE-SPEED FURNACE												
CC5A/CD5AA060		54,500	TDR	—	11.30	—	9.75	60,000	2.96	38,500	2.28	7.2
CE3AA060		56,500	TDR	—	11.50	—	10.05	60,000	3.16	38,500	2.38	7.5
CK3BA060		54,500	TDR	—	11.50	—	9.90	60,000	3.28	39,000	2.40	7.5
CK5A/CK5BA060		54,500	TDR	—	11.50	—	9.90	60,000	3.28	39,000	2.40	7.5
CK5A/CK5BT060		54,500	TDR	—	11.50	—	9.90	60,000	3.28	39,000	2.40	7.5
CK5A/CK5BX060		56,500	TDR	—	12.00	—	10.20	60,000	3.30	38,500	2.44	7.5
COILS + 315(A,J)AV066135 VARIABLE-SPEED FURNACE												
CC5A/CD5AA060		54,500	TDR	—	11.30	—	9.70	60,000	2.96	38,500	2.28	7.2
CC5A/CD5AW060		54,500	TDR	—	11.50	—	10.00	60,000	3.14	38,500	2.36	7.5
CE3AA060		56,500	TDR	—	11.50	—	10.05	60,000	3.16	38,500	2.38	7.5
CK3BA060	54,500	TDR	—	11.50	—	9.85	60,000	3.28	39,000	2.40	7.5	
CK5A/CK5BA060	54,500	TDR	—	11.50	—	9.85	60,000	3.28	39,000	2.40	7.5	
CK5A/CK5BT060	54,500	TDR	—	11.50	—	9.85	60,000	3.28	39,000	2.40	7.5	
CK5A/CK5BX060	56,500	TDR	—	12.00	—	10.20	60,000	3.30	38,500	2.44	7.5	
COILS + 315(A,J)AV066155 VARIABLE-SPEED FURNACE												
CC5A/CD5AA060	54,500	TDR	—	11.50	—	9.80	60,000	2.98	38,500	2.28	7.2	
CC5A/CD5AW060	54,500	TDR	—	11.50	—	10.10	60,000	3.16	38,500	2.36	7.5	
CE3AA060	56,500	TDR	—	11.50	—	10.10	60,000	3.18	38,500	2.38	7.5	
CK3BA060	54,500	TDR	—	11.50	—	9.95	60,000	3.28	38,500	2.42	7.5	
CK5A/CK5BA060	54,500	TDR	—	11.50	—	9.95	60,000	3.28	38,500	2.42	7.5	
CK5A/CK5BT060	54,500	TDR	—	11.50	—	9.95	60,000	3.28	38,500	2.42	7.5	
CK5A/CK5BX060	56,500	TDR	—	12.00	—	10.25	60,000	3.30	38,500	2.44	7.5	

*Ratings are net values reflecting the effects of circulating fan heat. Supplemental electric heat is not included. Ratings are based on:

Cooling Standard: 80°F (27°C) db 67°F (19°C) wb indoor entering air temperature and 95°F (35°C) db air entering outdoor unit.

High-Temperature Heating Standard: 70°F (21°C) db indoor entering air temperature and 47°F (8°C) db 43°F (6°C) wb air entering outdoor unit.

Low-Temperature Heating Standard: 70°F (21°C) db indoor entering air temperature and 17°F (–8°C) db 15°F (–10°C) wb air entering outdoor unit.

† Outdoor section/indoor section combination tested in accordance with DOE test procedures for heat pumps. Ratings for other combinations are determined under DOE computer simulation procedures.

‡ TDR is provided on most Bryant furnaces.

** Requires hard shutoff TXV; based on computer simulation.

COP — Coefficient of Performance

HSPF — Heating Seasonal Performance Factor

SEER — Seasonal Energy Efficiency Ratio


TC — Total Capacity (Btuh)

TDR — Time-Delay Relay

TXV — Thermostatic Expansion Valve

663C BALANCE POINT WORKSHEET

BUILDING HEAT LOSS, 1000 BTU/HR
UNIT INTEGRATED HEATING CAPACITY, 1000 BTU/HR

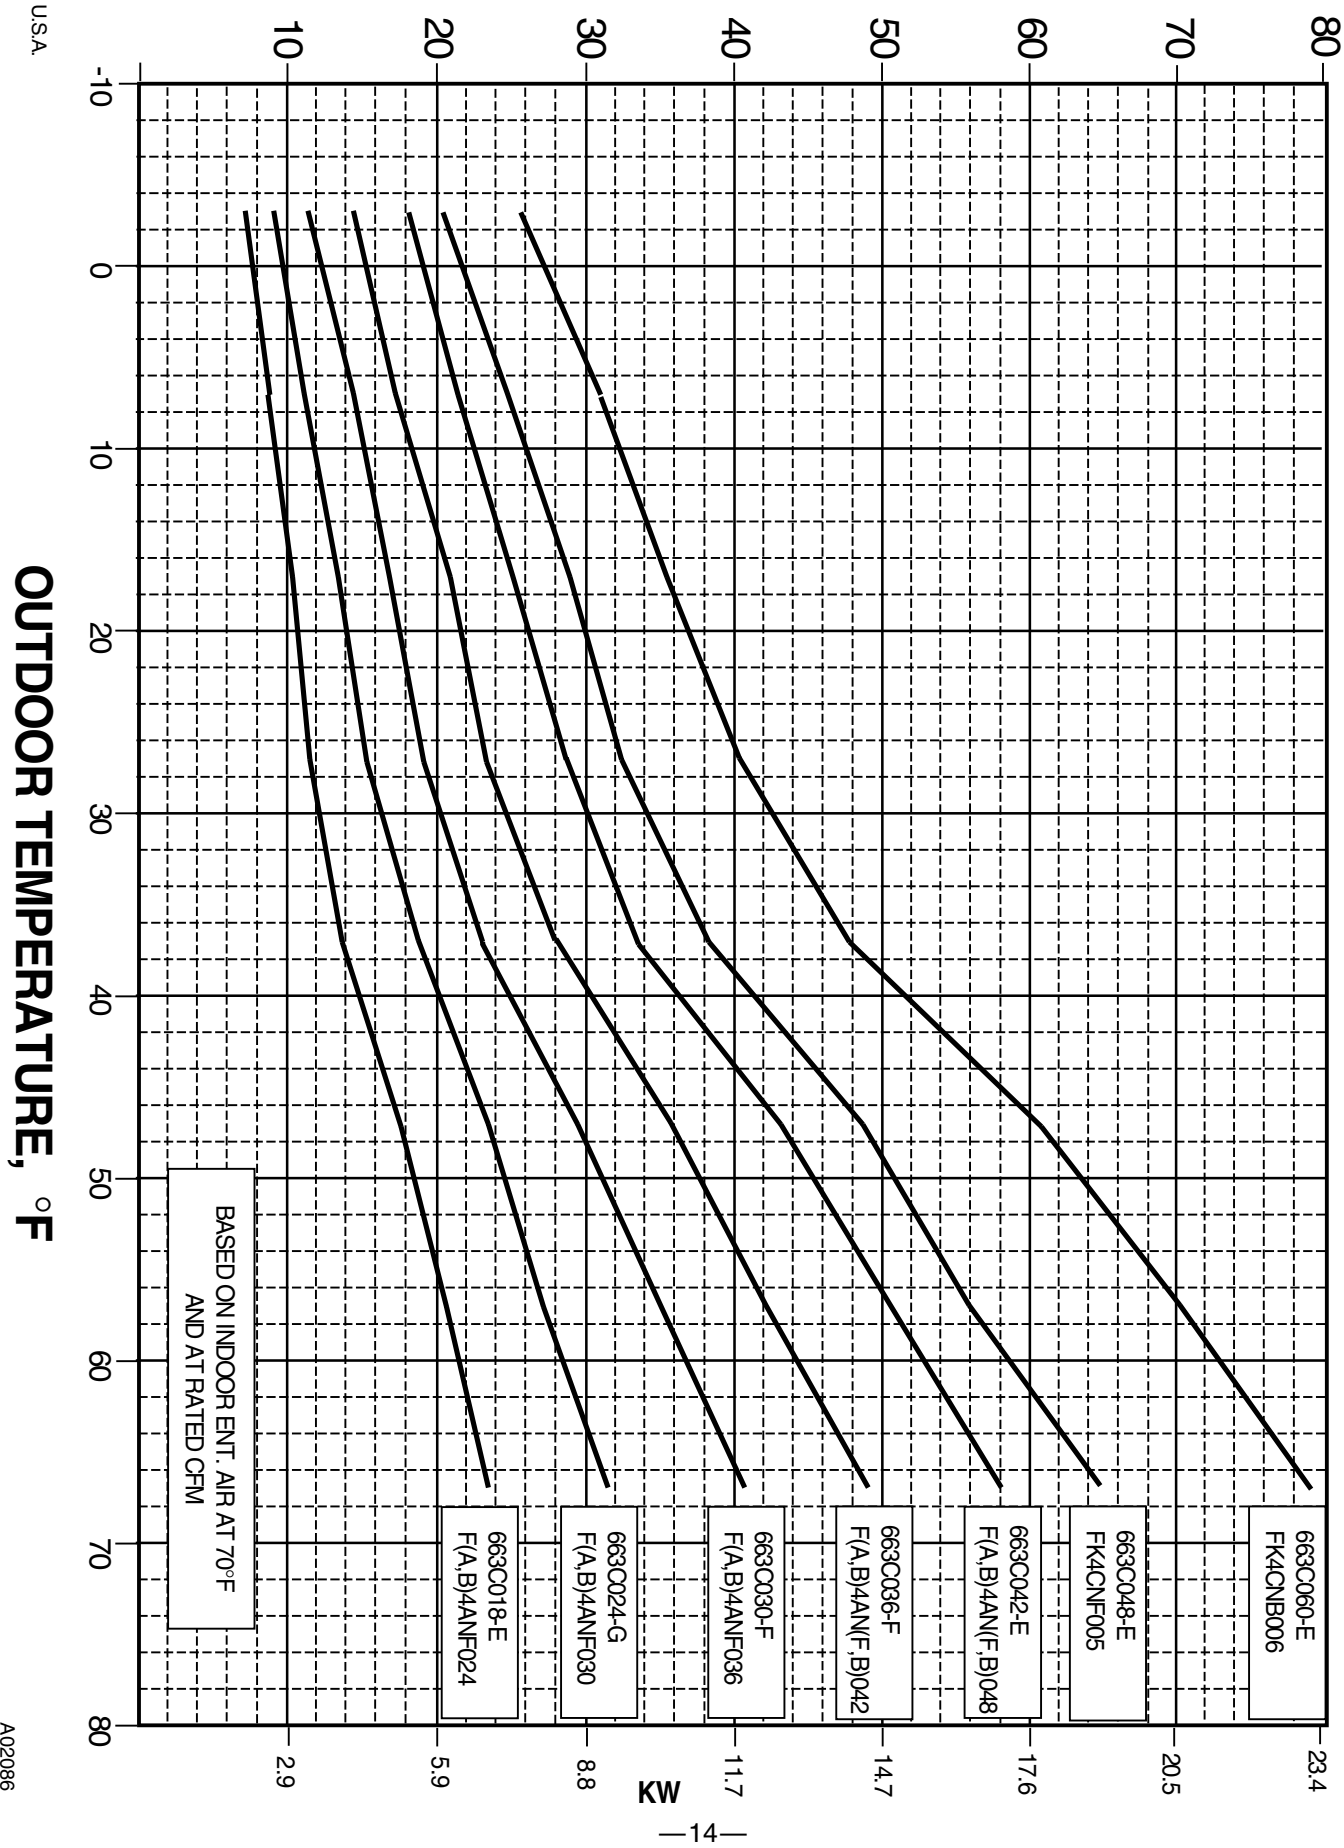

DETAILED COOLING CAPACITIES*

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
CFM	EWB	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
663C018-D, E Outdoor Section with F(A,B)4BN(F,C)024 Indoor Section																
550	72	21.0	10.5	1.51	20.1	10.2	1.69	19.2	9.86	1.91	18.2	9.52	2.12	17.2	9.17	2.36
	67	19.1	13.4	1.51	18.3	13.0	1.68	17.5	12.7	1.88	16.6	12.3	2.11	15.6	12.0	2.34
	63††	17.8	13.0	1.49	17.0	12.6	1.68	16.2	12.3	1.88	15.3	11.9	2.10	14.4	11.5	2.34
	62	17.5	16.1	1.49	16.7	15.8	1.68	16.0	15.4	1.88	15.2	15.0	2.10	14.4	14.4	2.33
	57	17.0	17.0	1.50	16.4	16.4	1.68	15.8	15.8	1.87	15.1	15.1	2.08	14.4	14.4	2.34
650	72	21.4	11.1	1.56	20.5	10.8	1.74	19.5	10.5	1.93	18.5	10.1	2.15	17.5	9.80	2.41
	67	19.5	14.4	1.53	18.7	14.1	1.73	17.8	13.8	1.93	16.8	13.4	2.14	15.9	13.1	2.39
	63††	18.2	14.0	1.53	17.4	13.7	1.72	16.5	13.3	1.93	15.6	12.9	2.13	14.7	12.5	2.38
	62	18.0	17.5	1.53	17.2	17.1	1.71	16.5	16.5	1.92	15.8	15.8	2.14	15.0	15.0	2.37
	57	17.8	17.8	1.53	17.2	17.2	1.72	16.5	16.5	1.91	15.8	15.8	2.12	15.0	15.0	2.38
750	72	21.6	11.7	1.58	20.7	11.4	1.78	19.7	11.1	1.98	18.7	10.7	2.19	17.7	10.4	2.45
	67	19.8	15.5	1.58	18.9	15.1	1.75	18.0	14.8	1.97	17.1	14.4	2.18	16.1	14.1	2.41
	63††	18.4	15.0	1.58	17.6	14.6	1.75	16.7	14.2	1.95	15.8	13.9	2.17	14.9	13.5	2.41
	62	18.5	18.5	1.57	17.8	17.8	1.75	17.1	17.1	1.96	16.3	16.3	2.18	15.5	15.5	2.41
	57	18.5	18.5	1.57	17.8	17.8	1.75	17.1	17.1	1.95	16.3	16.3	2.19	15.5	15.5	2.42
Multipliers for Determining the Performance With Other Indoor Sections																
Indoor Section		Size	Cooling		Indoor Section		Size	Cooling								
			Capacity	Power				Capacity	Power							
CC5A/CD5AA		018	0.95	1.00	FF1DNA		018	0.94	0.95							
		024	0.99	1.01			024	1.01	1.01							
CC5A/CD5AW		024	0.99	1.01	FF1DNE		018	0.94	0.95							
CE3AA		024	0.99	1.00	FG3AAA		024	0.98	1.02							
CF5AA		024	0.99	1.00	FK4DNF		001	1.01	0.89							
CK3BA		024	0.99	0.99			002	1.02	0.89							
CK5A/CK5BA		018	0.95	0.99	COILS + 315(A,J)AV036070 FURNACE											
		024	0.99	0.99	CC5A/CD5AA		024	0.99	0.91							
CK5A/CK5BW		024	0.99	0.99	CC5A/CD5AW		024	0.99	0.91							
F(A,B)4BN(F,C)		018	0.93	0.98	CE3AA		024	0.99	0.91							
		024	1.00	1.00	CK3BA		024	0.99	0.89							
FC4CNF		024	1.01	1.01	CK5A/CK5BA		024	0.99	0.89							
		—	—	—	CK5A/CK5BW		024	0.99	0.89							

See notes on page 23.

DETAILED COOLING CAPACITIES* Continued

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
CFM	EWB	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
663C024-F, G Outdoor Section With F(A,B)4BN(F,C)030 Indoor Section																
725	72	25.7	13.0	1.95	24.7	12.6	2.15	23.7	12.2	2.38	22.7	11.9	2.63	21.6	11.5	2.92
	67	23.6	16.6	1.95	22.7	16.3	2.14	21.7	15.9	2.37	20.7	15.5	2.63	19.8	15.1	2.91
	63††	21.9	16.1	1.95	21.1	15.8	2.14	20.1	15.4	2.37	19.2	15.0	2.62	18.3	14.6	2.90
	62	21.7	20.1	1.94	20.8	19.7	2.14	19.9	19.3	2.37	19.1	18.8	2.62	18.3	18.2	2.90
	57	21.1	21.1	1.94	20.4	20.4	2.14	19.7	19.7	2.37	19.0	19.0	2.62	18.2	18.2	2.90
825	72	26.0	13.5	1.98	25.0	13.1	2.18	24.0	12.8	2.41	22.9	12.4	2.67	21.9	12.1	2.96
	67	24.0	17.6	1.98	23.0	17.2	2.18	22.0	16.9	2.41	21.0	16.5	2.66	20.0	16.1	2.95
	63††	22.3	17.0	1.98	21.4	16.7	2.18	20.4	16.3	2.40	19.5	15.9	2.66	18.5	15.5	2.94
	62	22.1	21.4	1.98	21.2	20.9	2.18	20.4	20.3	2.40	19.6	19.6	2.66	18.8	18.8	2.94
	57	21.9	21.9	1.98	21.1	21.1	2.18	20.4	20.4	2.40	19.6	19.6	2.66	18.8	18.8	2.94
925	72	26.3	14.0	2.01	25.2	13.6	2.22	24.2	13.3	2.44	23.1	12.9	2.70	22.0	12.6	3.00
	67	24.2	18.5	2.01	23.2	18.2	2.21	22.2	17.8	2.44	21.2	17.4	2.70	20.2	17.0	2.99
	63††	22.5	17.9	2.01	21.6	17.5	2.21	20.6	17.1	2.44	19.7	16.7	2.69	18.7	16.4	2.98
	62	22.5	22.4	2.01	21.7	21.7	2.21	20.9	20.9	2.44	20.1	20.1	2.69	19.3	19.3	2.98
	57	22.5	22.5	2.01	21.7	21.7	2.21	20.9	20.9	2.44	20.1	20.1	2.69	19.3	19.3	2.98
Multipliers for Determining the Performance With Other Indoor Sections																
Indoor Section		Size	Cooling		Indoor Section		Size	Cooling								
			Capacity	Power				Capacity	Power							
CC5A/CD5AA		024	0.97	1.01	FG3AAA		024	0.97	1.02							
		030	0.98	1.02			FK4DNF		001	1.01	0.91					
CC5A/CD5AW		024	0.97	1.01	002				1.03	0.91						
		030	0.98	1.02			003		1.03	0.91						
CE3AA		024	0.98	1.01	COILS + 315(A,J)AV036070 FURNACE											
		030	1.00	1.02	CC5A/CD5AA		030	0.98	0.92							
CF5AA		024	0.98	1.02	CC5A/CD5AW		030	0.98	0.92							
CK3BA		024	0.97	1.00	CE3AA		030	0.98	0.91							
		030	0.98	1.01	CK3BA		030	0.98	0.91							
CK5A/CK5BA		024	0.97	1.00	CK5A/CK5BA		030	0.98	0.92							
		030	0.98	1.01	CK5A/CK5BW		030	0.98	0.92							
CK5A/CK5BW		024	0.97	1.00	COILS + 355MAV042040 FURNACE											
		030	0.98	1.01	CE3AA		030	1.00	0.93							
F(A,B)4BN(F,C)		024	0.98	1.00	COILS + 355MAV042060 FURNACE											
		030	1.00	1.00	CC5A/CD5AA		030	0.98	0.94							
FC4CNF		024	0.98	1.00	CC5A/CD5AW		030	0.98	0.94							
		030	1.00	1.00	CE3AA		030	1.00	0.93							
FF1DNA		024	0.98	1.01	CK3BA		030	0.98	0.92							
		030	1.01	1.03	CK5A/CK5BA		030	0.98	0.94							
FF1DNE		024	0.98	1.01	CK5A/CK5BW		030	0.98	0.93							
		030	1.01	1.03			—	—	—							

See notes on page 23.

DETAILED COOLING CAPACITIES* Continued

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
CFM	EWB	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
663C030-E, F Outdoor Section With F(A,B)4BN(F,C)036 Indoor Section																
875	72	32.1	16.6	2.38	30.8	16.1	2.67	29.3	15.6	2.99	27.9	15.0	3.32	26.3	14.5	3.68
	67	29.2	20.7	2.39	28.0	20.2	2.67	26.7	19.6	2.98	25.3	19.1	3.31	23.8	18.5	3.67
	63††	27.1	20.0	2.39	25.9	19.5	2.67	24.7	18.9	2.98	23.4	18.3	3.30	22.0	17.7	3.65
	62	26.7	24.8	2.39	25.5	24.2	2.67	24.4	23.6	2.97	23.2	22.9	3.30	21.9	21.9	3.65
	57	26.0	26.0	2.39	25.1	25.1	2.67	24.1	24.1	2.97	23.1	23.1	3.30	21.9	21.9	3.65
1000	72	32.6	17.3	2.43	31.2	16.8	2.72	29.8	16.3	3.03	28.3	15.7	3.37	26.6	15.1	3.73
	67	29.7	22.0	2.43	28.4	21.4	2.72	27.1	20.9	3.03	25.6	20.3	3.36	24.1	19.7	3.72
	63††	27.6	21.2	2.44	26.3	20.6	2.72	25.0	20.1	3.02	23.7	19.5	3.35	22.3	18.8	3.70
	62	27.2	26.4	2.44	26.1	25.7	2.72	24.9	24.9	3.02	23.8	23.8	3.35	22.7	22.7	3.71
	57	26.9	26.9	2.44	26.0	26.0	2.72	24.9	24.9	3.02	23.8	23.8	3.35	22.7	22.7	3.71
1125	72	33.0	18.0	2.47	31.6	17.5	2.76	30.1	17.0	3.08	28.5	16.4	3.41	26.8	15.8	3.78
	67	30.1	23.2	2.48	28.8	22.6	2.77	27.3	22.1	3.08	25.9	21.5	3.40	24.3	20.8	3.77
	63††	27.9	22.3	2.48	26.6	21.7	2.77	25.3	21.2	3.07	23.9	20.6	3.40	22.5	19.9	3.75
	62	27.8	27.8	2.48	26.7	26.7	2.77	25.6	25.6	3.07	24.5	24.5	3.40	23.2	23.2	3.76
	57	27.7	27.7	2.48	26.7	26.7	2.77	25.6	25.6	3.07	24.5	24.5	3.40	23.3	23.3	3.76
Multipliers for Determining the Performance With Other Indoor Sections																
Indoor Section	Size	Cooling		Indoor Section	Size	Cooling										
		Capacity	Power			Capacity	Power									
CC5A/CD5AA	030	0.98	0.99	COILS + 315(A,J)AV048090 FURNACE												
	036	1.01	0.99	CC5A/CD5AA	036	1.01	0.90									
CC5A/CD5AW	030	0.98	0.99	CC5A/CD5AW	036	1.01	0.90									
	036	1.01	0.99	CE3AA	036	1.01	0.91									
CE3AA	030	0.99	0.98	CK3BA	036	1.01	0.90									
	036	1.00	0.99	CK5A/CK5BA	036	1.01	0.90									
CF5AA	036	1.00	0.98	CK5A/CK5BW	036	1.01	0.90									
CK3BA	030	0.98	0.98	COILS + 355MAV042060 FURNACE												
	036	1.01	0.99	CC5A/CD5AA	036	1.01	0.93									
CK5A/CK5BA	036	1.01	0.99	CE3AA	036	1.00	0.94									
CK5A/CK5BT	036	1.01	0.99	CK3BA	036	1.01	0.93									
CK5A/CK5BW	030	0.98	0.98	CK5A/CK5BA	036	1.01	0.93									
	036	1.01	0.99	CK5A/CK5BT	036	1.01	0.93									
F(A,B)4BN(F,C)	030	0.99	0.97	COILS + 355MAV042080 FURNACE												
	036	1.00	1.00	CC5A/CD5AW	036	1.01	0.92									
FC4CNF	030	0.99	0.97	CE3AA	036	1.00	0.92									
	036	1.00	1.00	CK3BA	036	1.01	0.92									
FF1DNA	030	0.99	0.99	CK5A/CK5BW	036	1.01	0.92									
FF1DNE	030	0.99	0.99	COILS + 355MAV060100 FURNACE												
FG3AAA	036	1.00	1.00	CC5A/CD5AA	036	1.01	0.92									
FK4DNF	001	1.01	0.92	CC5A/CD5AW	036	1.01	0.92									
	002	1.01	0.91	CE3AA	036	1.00	0.92									
	003	1.03	0.90	CK3BA	036	1.01	0.91									
COILS + 315(A,J)AV036070 FURNACE				CK5A/CK5BA	036	1.01	0.91									
CC5A/CD5AA	036	1.01	0.91	CK5A/CK5BT	036	1.01	0.91									
CE3AA	036	1.00	0.92	CK5A/CK5BW	036	1.01	0.91									
CK3BA	036	1.01	0.91	COILS + 355MAV060120 FURNACE												
CK5A/CK5BA	036	1.01	0.91	CC5A/CD5AW	036	1.01	0.92									
CK5A/CK5BT	036	1.01	0.91	CE3AA	036	1.00	0.92									
	—	—	—	CK5A/CK5BW	036	1.01	0.91									

See notes on page 23.

DETAILED COOLING CAPACITIES* Continued

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
CFM	EWB	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
663C036-E, F Outdoor Section With F(A,B)4BN(F,B,C)042 Indoor Section																
1050	72	38.2	19.8	2.90	36.6	19.2	3.20	35.0	18.6	3.51	33.2	17.9	3.86	31.4	17.3	4.25
	67	34.8	24.8	2.88	33.3	24.2	3.17	31.8	23.6	3.48	30.2	22.9	3.83	28.5	22.2	4.21
	63††	32.3	24.0	2.86	30.9	23.3	3.15	29.5	22.7	3.46	27.9	22.0	3.81	26.3	21.3	4.18
	62	31.8	29.8	2.86	30.5	29.1	3.15	29.1	28.3	3.46	27.7	27.5	3.80	26.3	26.3	4.18
	57	31.1	31.1	2.85	30.0	30.0	3.14	28.8	28.8	3.46	27.6	27.6	3.80	26.3	26.3	4.18
1200	72	38.8	20.7	2.97	37.1	20.1	3.26	35.4	19.4	3.58	33.7	18.8	3.93	31.7	18.1	4.31
	67	35.3	26.3	2.94	33.8	25.7	3.23	32.2	25.0	3.55	30.6	24.4	3.90	28.8	23.6	4.27
	63††	32.8	25.4	2.92	31.4	24.7	3.22	29.9	24.1	3.53	28.3	23.4	3.87	26.6	22.6	4.24
	62	32.5	31.6	2.92	31.2	30.8	3.21	29.8	29.8	3.53	28.5	28.5	3.87	27.1	27.1	4.25
	57	32.2	32.2	2.92	31.0	31.0	3.21	29.8	29.8	3.53	28.5	28.5	3.87	27.1	27.1	4.25
1350	72	39.2	21.5	3.03	37.5	20.9	3.33	35.8	20.3	3.65	33.9	19.6	3.99	32.0	18.9	4.37
	67	35.7	27.8	3.01	34.2	27.1	3.30	32.5	26.5	3.62	30.8	25.7	3.96	29.0	25.0	4.34
	63††	33.2	26.7	2.99	31.7	26.1	3.28	30.2	25.4	3.59	28.5	24.6	3.93	26.9	23.9	4.31
	62	33.1	33.1	2.99	31.8	31.8	3.28	30.5	30.5	3.60	29.2	29.2	3.94	27.8	27.8	4.32
	57	33.1	33.1	2.99	31.8	31.8	3.28	30.6	30.6	3.60	29.2	29.2	3.94	27.8	27.8	4.32
Multipliers for Determining the Performance With Other Indoor Sections																
Indoor Section	Size	Cooling			Indoor Section	Size	Cooling									
		Capacity	Power				Capacity	Power								
CC5A/CD5AA	036	0.99	0.99		CK3BA	042	1.00	0.91								
	042	0.99	0.99		CK5A/CK5BA	042	1.00	0.91								
CC5A/CD5AW	036	0.99	0.92		CK5A/CK5BE	042	1.00	0.91								
	042	0.99	0.99		CK5A/CK5BT	042	1.00	0.91								
CE3AA	036	0.98	0.99		COILS + 315(A,J)AV066110 FURNACE											
	042	1.00	0.99		CC5A/CD5AA	042	1.00	0.90								
CF5AA	036	0.99	0.98		CC5A/CD5AW	042	1.00	0.90								
CK3BA	036	0.99	0.99		CE3AA	042	1.00	0.90								
	042	0.99	0.99		CK3BA	042	1.00	0.90								
CK5A/CK5BA	036	0.99	0.98		CK5A/CK5BA	042	1.00	0.90								
	042	0.99	0.99		CK5A/CK5BT	042	1.00	0.90								
CK5A/CK5BE	042	0.99	0.98		COILS + 315(A,J)AV066135 FURNACE											
CK5A/CK5BT	036	0.99	0.99		CC5A/CD5AA	042	1.00	0.90								
	042	0.99	0.99		CC5A/CD5AW	042	1.00	0.91								
CK5A/CK5BW	036	0.99	0.99		CE3AA	042	1.00	0.90								
F(A,B)4BN(F,B,C)	042	1.00	1.00		CK3BA	042	1.00	0.91								
F(A,B)4BN(F,C)	036	0.98	1.00		CK5A/CK5BA	042	1.00	0.91								
FC4CN(F,B)	042	1.00	1.00		CK5A/CK5BT	042	1.00	0.91								
FC4CNF	036	0.98	1.00		COILS + 315(A,J)AV066155 FURNACE											
FG3AAA	036	0.98	0.99		CC5A/CD5AA	042	1.00	0.90								
FK4DNF	001	0.98	0.93		CC5A/CD5AW	042	1.00	0.90								
	002	0.99	0.94		CE3AA	042	1.00	0.90								
	003	0.99	0.90		CK3BA	042	1.00	0.90								
	005	1.04	0.90		CK5A/CK5BA	042	1.00	0.90								
COILS + 315(A,J)AV036070 FURNACE					CK5A/CK5BT	042	1.00	0.90								
CE3AA	042	1.00	0.92		COILS + 355MAV042060 FURNACE											
CK5A/CK5BE	042	1.00	0.92		CE3AA	042	0.99	0.95								
COILS + 315(A,J)AV048090 FURNACE					COILS + 355MAV042080 FURNACE											
CC5A/CD5AA	042	1.00	0.91		CC5A/CD5AA	042	0.99	0.93								
CE3AA	042	1.00	0.91		CC5A/CD5AW	042	0.99	0.94								

See notes on page 23.

DETAILED COOLING CAPACITIES* Continued

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
CFM	EWB	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
663C036-E, F Outdoor Section With F(A,B)4BN(F,B,C)042 Indoor Section continued																
1050	72	38.2	19.8	2.90	36.6	19.2	3.20	35.0	18.6	3.51	33.2	17.9	3.86	31.4	17.3	4.25
	67	34.8	24.8	2.88	33.3	24.2	3.17	31.8	23.6	3.48	30.2	22.9	3.83	28.5	22.2	4.21
	63††	32.3	24.0	2.86	30.9	23.3	3.15	29.5	22.7	3.46	27.9	22.0	3.81	26.3	21.3	4.18
	62	31.8	29.8	2.86	30.5	29.1	3.15	29.1	28.3	3.46	27.7	27.5	3.80	26.3	26.3	4.18
	57	31.1	31.1	2.85	30.0	30.0	3.14	28.8	28.8	3.46	27.6	27.6	3.80	26.3	26.3	4.18
1200	72	38.8	20.7	2.97	37.1	20.1	3.26	35.4	19.4	3.58	33.7	18.8	3.93	31.7	18.1	4.31
	67	35.3	26.3	2.94	33.8	25.7	3.23	32.2	25.0	3.55	30.6	24.4	3.90	28.8	23.6	4.27
	63††	32.8	25.4	2.92	31.4	24.7	3.22	29.9	24.1	3.53	28.3	23.4	3.87	26.6	22.6	4.24
	62	32.5	31.6	2.92	31.2	30.8	3.21	29.8	29.8	3.53	28.5	28.5	3.87	27.1	27.1	4.25
	57	32.2	32.2	2.92	31.0	31.0	3.21	29.8	29.8	3.53	28.5	28.5	3.87	27.1	27.1	4.25
1350	72	39.2	21.5	3.03	37.5	20.9	3.33	35.8	20.3	3.65	33.9	19.6	3.99	32.0	18.9	4.37
	67	35.7	27.8	3.01	34.2	27.1	3.30	32.5	26.5	3.62	30.8	25.7	3.96	29.0	25.0	4.34
	63††	33.2	26.7	2.99	31.7	26.1	3.28	30.2	25.4	3.59	28.5	24.6	3.93	26.9	23.9	4.31
	62	33.1	33.1	2.99	31.8	31.8	3.28	30.5	30.5	3.60	29.2	29.2	3.94	27.8	27.8	4.32
	57	33.1	33.1	2.99	31.8	31.8	3.28	30.6	30.6	3.60	29.2	29.2	3.94	27.8	27.8	4.32
Multipliers for Determining the Performance With Other Indoor Sections																
Indoor Section		Size	Cooling		Indoor Section		Size	Cooling								
			Capacity	Power				Capacity	Power							
CE3AA		042	0.99		0.94		CC5A/CD5AW		042	0.99		0.93				
CK5A/CK5BA		042	0.99		0.94		CE3AA		042	0.99		0.93				
CK5A/CK5BT		042	0.99		0.94		CK3BA		042	0.99		0.92				
COILS + 355MAV060080 FURNACE							CK5A/CK5BA		042	0.99		0.92				
CC5A/CD5AA		042	0.99		0.93		CK5A/CK5BT		042	0.99		0.92				
CC5A/CD5AW		042	0.99		0.93		COILS + 355MAV060120 FURNACE									
CE3AA		042	0.99		0.93		CC5A/CD5AA		042	0.99		0.93				
CK3BA		042	0.99		0.95		CC5A/CD5AW		042	0.99		0.93				
CK5A/CK5BA		042	0.99		0.95		CE3AA		042	0.99		0.93				
CK5A/CK5BT		042	0.99		0.95		CK5A/CK5BA		042	0.99		0.92				
COILS + 355MAV060100 FURNACE							CK5A/CK5BT		042	0.99		0.92				
CC5A/CD5AA		042	0.99		0.93		—		—	—		—				

See notes on page 23.

DETAILED COOLING CAPACITIES* Continued

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
CFM	EWB	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
663C042-D, E Outdoor Section With F(A,B)4BN(F,B,C)048 Indoor Section																
1275	72	44.7	22.9	3.39	42.9	22.3	3.72	41.0	21.6	4.08	39.0	20.9	4.47	36.9	20.2	4.89
	67	41.2	29.7	3.34	39.5	29.1	3.67	37.7	28.4	4.03	35.8	27.6	4.41	33.9	26.9	4.83
	63††	38.4	28.9	3.31	36.8	28.2	3.63	35.2	27.5	3.99	33.4	26.7	4.37	31.5	25.9	4.78
	62	38.0	36.2	3.30	36.5	35.4	3.63	34.9	34.5	3.98	33.3	33.3	4.37	31.8	31.8	4.78
	57	37.5	37.5	3.30	36.2	36.2	3.62	34.8	34.8	3.98	33.3	33.3	4.37	31.8	31.8	4.78
1475	72	45.3	24.1	3.47	43.4	23.4	3.80	41.6	22.8	4.17	39.4	22.1	4.56	37.3	21.3	4.98
	67	41.8	31.8	3.43	40.0	31.1	3.76	38.2	30.4	4.11	36.2	29.6	4.50	34.2	28.9	4.92
	63††	39.0	30.8	3.40	37.4	30.1	3.72	35.6	29.4	4.07	33.7	28.6	4.45	31.9	27.8	4.87
	62	38.9	38.6	3.39	37.4	37.4	3.72	36.0	36.0	4.08	34.4	34.4	4.47	32.8	32.8	4.89
	57	38.8	38.8	3.39	37.4	37.4	3.72	35.9	35.9	4.08	34.4	34.4	4.47	32.8	32.8	4.89
1675	72	45.8	25.2	3.56	43.7	24.5	3.89	41.8	23.9	4.25	39.6	23.2	4.64	37.4	22.5	5.07
	67	42.1	33.8	3.52	40.3	33.1	3.84	38.5	32.3	4.20	36.5	31.6	4.59	34.5	30.8	5.01
	63††	39.4	32.6	3.48	37.7	31.9	3.81	35.9	31.1	4.16	34.0	30.4	4.54	32.1	29.5	4.96
	62	39.8	39.8	3.49	38.4	38.4	3.82	36.9	36.9	4.18	35.2	35.2	4.57	33.6	33.6	4.99
	57	39.8	39.8	3.49	38.4	38.4	3.82	36.9	36.9	4.18	35.2	35.2	4.57	33.6	33.6	4.99
Multipliers for Determining the Performance With Other Indoor Sections																
Indoor Section		Size	Cooling		Indoor Section		Size	Cooling								
			Capacity	Power				Capacity	Power							
CC5A/CD5AA		042	0.98		0.97		CK5A/CK5BA		048	0.98		0.90				
CC5A/CD5AC		048	0.98		0.98		CK5A/CK5BT		048	0.98		0.90				
CC5A/CD5AW		048	1.00		1.00		COILS + 315(A,J)AV066110 FURNACE									
CD5AA		048	1.00		0.99		CC5A/CD5AC		048	0.98		0.90				
CE3AA		042	0.99		0.98		CC5A/CD5AW		048	0.98		0.89				
		048	1.00		0.99		CD5AA		048	0.98		0.89				
CF5AA		048	1.00		0.99		CE3AA		048	0.98		0.90				
CK3BA		042	0.98		0.97		CK3BA		048	0.98		0.89				
		048	1.00		0.98		CK5A/CK5BA		048	0.98		0.89				
CK5A/CK5BA		042	0.98		0.97		CK5A/CK5BT		048	0.98		0.89				
		048	1.00		0.98		CK5A/CK5BW		048	0.98		0.89				
CK5A/CK5BE		042	0.98		0.96		COILS + 315(A,J)AV066135 FURNACE									
CK5A/CK5BT		042	0.98		0.97		CC5A/CD5AC		048	0.98		0.90				
		048	1.00		0.98		CC5A/CD5AW		048	0.98		0.89				
CK5A/CK5BW		048	1.00		0.98		CD5AA		048	0.98		0.89				
F(A,B)4BN(F,B,C)		042	0.99		1.01		CE3AA		048	0.98		0.90				
		042	0.99		1.01		CK3BA		048	0.98		0.89				
		048	1.00		1.00		CK5A/CK5BA		048	0.98		0.89				
FC4CN(F,B)		042	0.99		1.01		CK5A/CK5BT		048	0.98		0.89				
		048	1.00		1.00		CK5A/CK5BW		048	0.98		0.89				
FG3AAA		048	0.99		0.98		COILS + 315(A,J)AV066155 FURNACE									
FK4DNB		006	1.05		0.89		CC5A/CD5AC		048	0.98		0.90				
FK4DNF		003	0.99		0.91		CC5A/CD5AW		048	0.98		0.88				
		005	1.04		0.91		CD5AA		048	0.98		0.88				
COILS + 315(A,J)AV048090 FURNACE							CE3AA		048	0.98		0.89				
CC5A/CD5AC		048	0.98		0.91		CK3BA		048	0.98		0.89				
CD5AA		048	0.98		0.90		CK5A/CK5BA		048	0.98		0.89				
CE3AA		048	0.98		0.90		CK5A/CK5BT		048	0.98		0.89				
CK3BA		048	0.98		0.90		CK5A/CK5BW		048	0.98		0.89				

See notes on page 23.

DETAILED COOLING CAPACITIES* Continued

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
CFM	EWB	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
663C042-D, E Outdoor Section With F(A,B)4BN(F,B,C)048 Indoor Section continued																
1275	72	44.7	22.9	3.39	42.9	22.3	3.72	41.0	21.6	4.08	39.0	20.9	4.47	36.9	20.2	4.89
	67	41.2	29.7	3.34	39.5	29.1	3.67	37.7	28.4	4.03	35.8	27.6	4.41	33.9	26.9	4.83
	63††	38.4	28.9	3.31	36.8	28.2	3.63	35.2	27.5	3.99	33.4	26.7	4.37	31.5	25.9	4.78
	62	38.0	36.2	3.30	36.5	35.4	3.63	34.9	34.5	3.98	33.3	33.3	4.37	31.8	31.8	4.78
	57	37.5	37.5	3.30	36.2	36.2	3.62	34.8	34.8	3.98	33.3	33.3	4.37	31.8	31.8	4.78
1475	72	45.3	24.1	3.47	43.4	23.4	3.80	41.6	22.8	4.17	39.4	22.1	4.56	37.3	21.3	4.98
	67	41.8	31.8	3.43	40.0	31.1	3.76	38.2	30.4	4.11	36.2	29.6	4.50	34.2	28.9	4.92
	63††	39.0	30.8	3.40	37.4	30.1	3.72	35.6	29.4	4.07	33.7	28.6	4.45	31.9	27.8	4.87
	62	38.9	38.6	3.39	37.4	37.4	3.72	36.0	36.0	4.08	34.4	34.4	4.47	32.8	32.8	4.89
	57	38.8	38.8	3.39	37.4	37.4	3.72	35.9	35.9	4.08	34.4	34.4	4.47	32.8	32.8	4.89
1675	72	45.8	25.2	3.56	43.7	24.5	3.89	41.8	23.9	4.25	39.6	23.2	4.64	37.4	22.5	5.07
	67	42.1	33.8	3.52	40.3	33.1	3.84	38.5	32.3	4.20	36.5	31.6	4.59	34.5	30.8	5.01
	63††	39.4	32.6	3.48	37.7	31.9	3.81	35.9	31.1	4.16	34.0	30.4	4.54	32.1	29.5	4.96
	62	39.8	39.8	3.49	38.4	38.4	3.82	36.9	36.9	4.18	35.2	35.2	4.57	33.6	33.6	4.99
	57	39.8	39.8	3.49	38.4	38.4	3.82	36.9	36.9	4.18	35.2	35.2	4.57	33.6	33.6	4.99
Multipliers for Determining the Performance With Other Indoor Sections																
Indoor Section	Size	Cooling			Indoor Section	Size	Cooling									
		Capacity	Power				Capacity	Power								
COILS + 355MAV042080 FURNACE					CE3AA	048	1.00	0.96								
CD5AA	048	1.00	0.96		CK3BA	048	1.00	0.95								
CE3AA	048	1.00	0.97		CK5A/CK5BA	048	1.00	0.95								
CK5A/CK5BA	048	1.00	0.97		CK5A/CK5BT	048	1.00	0.95								
CK5A/CK5BT	048	1.00	0.97		COILS + 355MAV060120 FURNACE											
COILS + 355MAV060080 FURNACE					CC5A/CD5AW	048	1.00	0.95								
CD5AA	048	1.00	0.95		CE3AA	048	1.00	0.96								
CE3AA	048	1.00	0.96		CK3BA	048	1.00	0.95								
CK5A/CK5BA	048	1.00	0.98		CK5A/CK5BA	048	1.00	0.95								
CK5A/CK5BT	048	1.00	0.98		CK5A/CK5BT	048	1.00	0.95								
COILS + 355MAV060100 FURNACE					CK5A/CK5BW	048	1.00	0.95								
CD5AA	048	1.00	0.95			—	—	—								

See notes on page 23.

DETAILED COOLING CAPACITIES* Continued

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
CFM	EWB	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
663C048-D, E Outdoor Section With FK4DNF005 Indoor Section																
1400	72	54.2	27.2	3.94	52.0	26.4	4.42	49.7	25.6	4.95	47.3	24.7	5.52	44.7	23.8	6.12
	67	50.1	34.7	3.91	48.0	33.8	4.39	45.8	33.0	4.90	43.5	32.0	5.46	41.2	31.1	6.05
	63††	46.7	33.8	3.88	44.8	32.9	4.35	42.7	32.0	4.86	40.6	31.1	5.41	38.3	30.1	6.00
	62	46.1	41.9	3.88	44.2	41.0	4.35	42.3	40.0	4.86	40.2	38.9	5.41	38.0	37.8	5.99
	57	44.7	44.7	3.87	43.2	43.2	4.34	41.5	41.5	4.85	39.6	39.6	5.39	37.9	37.9	5.99
1600	72	55.1	28.5	4.00	52.8	27.7	4.49	50.4	26.9	5.01	47.9	26.0	5.58	45.3	25.1	6.19
	67	51.0	36.9	3.97	48.8	36.0	4.45	46.6	35.1	4.97	44.2	34.2	5.53	41.7	33.3	6.12
	63††	47.6	35.8	3.94	45.6	35.0	4.41	43.4	34.1	4.93	41.2	33.1	5.48	38.9	32.1	6.07
	62	47.1	44.8	3.94	45.2	43.8	4.41	43.2	42.7	4.92	41.2	41.2	5.48	39.3	39.3	6.07
	57	46.4	46.4	3.93	44.7	44.7	4.41	43.0	43.0	4.92	41.1	41.1	5.47	39.2	39.2	6.07
1800	72	55.7	29.7	4.06	53.4	28.9	4.55	51.0	28.0	5.07	48.4	27.1	5.64	45.7	26.2	6.25
	67	51.6	39.0	4.03	49.4	38.1	4.51	47.1	37.2	5.03	44.7	36.3	5.59	42.2	35.3	6.19
	63††	48.3	37.8	4.00	46.2	36.9	4.48	44.0	36.0	4.99	41.7	35.0	5.54	39.3	34.0	6.13
	62	48.1	47.4	4.00	46.2	46.1	4.47	44.3	44.3	4.99	42.4	42.4	5.55	40.4	40.4	6.15
	57	47.8	47.8	4.00	46.0	46.0	4.47	44.3	44.3	4.99	42.2	42.2	5.54	40.3	40.3	6.15
Multipliers for Determining the Performance With Other Indoor Sections																
Indoor Section		Size	Cooling		Indoor Section	Size	Cooling									
			Capacity	Power			Capacity	Power								
CC5A/CD5AA		060	0.96 1.05		COILS + 315(A,J)AV066135 FURNACE											
CC5A/CD5AC		048	0.93 1.04		CC5A/CD5AA		060	0.94 0.97								
CC5A/CD5AW		048	0.95 1.05		CC5A/CD5AW		060	0.98 0.99								
		060	0.98 1.05		CE3AA		060	0.95 0.96								
CD5AA		048	0.95 1.05		CK3BA		060	0.95 0.96								
CE3AA		048	0.96 1.05		CK5A/CK5BA		060	0.95 0.96								
		060	0.99 1.06		CK5A/CK5BT		060	0.95 0.96								
CF5AA		048	0.94 1.03		CK5A/CK5BX		060	0.98 0.97								
CK3BA		048	0.95 1.05		COILS + 315(A,J)AV066155 FURNACE											
		060	0.96 1.03		CC5A/CD5AA		060	0.94 0.96								
CK5A/CK5BA		048	0.95 1.05		CC5A/CD5AW		060	0.98 0.98								
		060	0.96 1.03		CE3AA		060	0.95 0.95								
CK5A/CK5BT		048	0.95 1.05		CK3BA		060	0.95 0.95								
		060	0.96 1.03		CK5A/CK5BA		060	0.95 0.95								
CK5A/CK5BW		048	0.95 1.05		CK5A/CK5BT		060	0.95 0.95								
CK5A/CK5BX		060	0.98 1.04		CK5A/CK5BX		060	0.98 0.96								
F(A,B)4BN(F,B,C)		048	0.96 1.06		COILS + 355MAV060080 FURNACE											
		060	0.99 1.08		CC5A/CD5AA		060	0.96 1.04								
FB4BNB		070	1.00 1.05		CC5A/CD5AW		060	0.98 1.03								
FC4CN(F,B)		048	0.96 1.06		CE3AA		060	0.98 1.03								
		060	0.99 1.08		COILS + 355MAV060100 FURNACE											
FC4CNB		054	1.00 1.05		CC5A/CD5AA		060	0.96 1.04								
		070	1.00 1.05		CC5A/CD5AW		060	0.98 1.03								
FG3AAA		048	0.94 1.04		CE3AA		060	0.98 1.03								
		060	0.96 1.04		CK3BA		060	0.98 0.99								
FK4DNB		006	1.00 0.96		CK5A/CK5BA		060	0.98 0.99								
FK4DNF		005	1.00 1.00		CK5A/CK5BT		060	0.98 0.99								
COILS + 315(A,J)AV048090 FURNACE					CK5A/CK5BX		060	0.98 1.02								
CE3AA		060	0.95 0.97		COILS + 355MAV060120 FURNACE											
COILS + 315(A,J)AV066110 FURNACE					CC5A/CD5AA		060	0.96 1.04								
CC5A/CD5AA		060	0.94 0.97		CC5A/CD5AW		060	0.98 1.03								
CE3AA		060	0.95 0.95		CE3AA		060	0.98 1.03								
CK3BA		060	0.95 0.96		CK3BA		060	0.98 1.04								
CK5A/CK5BA		060	0.95 0.96		CK5A/CK5BA		060	0.98 1.04								
CK5A/CK5BT		060	0.95 0.96		CK5A/CK5BT		060	0.98 1.04								
CK5A/CK5BX		060	0.98 0.96		CK5A/CK5BX		060	0.98 1.01								

See notes on page 23.

DETAILED COOLING CAPACITIES* Continued

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
CFM	EWB	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**
		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡		Total	Sens‡	
663C060-D, E Outdoor Section With FK4DNB006 Indoor Section																
1750	72	66.7	33.9	5.29	63.7	32.8	5.86	60.5	31.7	6.48	57.2	30.5	7.16	53.6	29.3	7.88
	67	61.8	43.6	5.22	59.0	42.4	5.78	56.0	41.3	6.40	52.9	40.1	7.07	49.7	38.8	7.78
	63††	57.9	42.5	5.16	55.3	41.4	5.72	52.5	40.1	6.33	49.5	38.9	6.99	46.5	37.6	7.69
	62	57.2	53.0	5.15	54.6	51.7	5.71	52.0	50.4	6.32	49.2	48.8	6.98	46.5	46.5	7.70
	57	55.9	55.9	5.13	53.8	53.8	5.70	51.6	51.6	6.32	49.2	49.2	6.98	46.6	46.6	7.70
2000	72	67.8	35.6	5.39	64.7	34.5	5.96	61.5	33.4	6.59	58.1	32.2	7.26	54.4	31.0	7.99
	67	62.6	46.3	5.31	59.7	45.2	5.87	56.6	44.0	6.49	53.4	42.7	7.15	50.0	41.4	7.87
	63††	59.0	45.2	5.26	56.3	44.1	5.82	53.4	42.8	6.44	50.4	41.6	7.09	47.3	40.2	7.80
	62	58.2	56.6	5.24	55.7	55.1	5.80	53.1	53.1	6.42	50.5	50.5	7.09	47.9	47.9	7.81
	57	57.8	57.8	5.24	55.5	55.5	5.80	53.2	53.2	6.42	50.6	50.6	7.10	47.9	47.9	7.82
2250	72	68.3	37.0	5.47	65.5	36.1	6.06	62.2	35.0	6.68	58.7	33.8	7.36	54.6	32.4	8.06
	67	63.5	49.1	5.40	60.6	48.0	5.97	57.4	46.7	6.59	53.8	45.3	7.24	50.4	44.0	7.95
	63††	59.6	47.6	5.34	57.1	46.6	5.92	54.2	45.4	6.53	51.1	44.1	7.19	47.5	42.5	7.88
	62	59.6	59.5	5.34	57.2	57.2	5.91	54.7	54.7	6.53	51.7	51.7	7.20	48.9	48.9	7.92
	57	59.3	59.3	5.34	57.0	57.0	5.90	54.5	54.5	6.53	51.8	51.8	7.20	49.0	49.0	7.92
Multipliers for Determining the Performance With Other Indoor Sections																
Indoor Section		Size	Cooling		Indoor Section		Size	Cooling								
			Capacity	Power				Capacity	Power							
CC5A/CD5AA		060	0.93		CK5A/CK5BT		060	0.92								
CC5A/CD5AW		060	0.97		CK5A/CK5BX		060	0.96								
CE3AA		060	0.97		COILS + 315(A,J)AV066135 FURNACE											
CK3BA		060	0.93		CC5A/CD5AA		060	0.92								
CK5A/CK5BA		060	0.93		CC5A/CD5AW		060	0.92								
CK5A/CK5BT		060	0.93		CE3AA		060	0.96								
CK5A/CK5BX		060	0.97		CK3BA		060	0.92								
F(A,B)4BN(F,B,C)		060	0.96		CK5A/CK5BA		060	0.92								
		060	0.96		CK5A/CK5BT		060	0.92								
FB4BNB		070	0.98		CK5A/CK5BX		060	0.96								
FC4CN(F,B)		060	0.96		COILS + 315(A,J)AV066155 FURNACE											
FC4CNB		070	0.98		CC5A/CD5AA		060	0.92								
FG3AAA		060	0.94		CC5A/CD5AW		060	0.92								
FK4DNB		006	1.00		CE3AA		060	0.96								
COILS + 315(A,J)AV066110 FURNACE					CK3BA		060	0.92								
CC5A/CD5AA		060	0.92		CK5A/CK5BA		060	0.92								
CE3AA		060	0.96		CK5A/CK5BT		060	0.92								
CK3BA		060	0.92		CK5A/CK5BX		060	0.96								
CK5A/CK5BA		060	0.92				—	—								

NOTE: When the required data falls between the published data, interpolation may be performed. Extrapolation is not an acceptable practice.

*Detailed cooling capacities are based on indoor and outdoor unit at the same elevation per ARI standard 210/240-94. If additional tubing length and/or indoor unit is located above outdoor unit, a slight variation in capacity may occur.

† Total and sensible capacities are net capacities. Blower motor heat has been subtracted.

‡ Sensible capacities shown are based on 80°F (27°C) entering air at the indoor coil. For sensible capacities at other than 80°F (27°C), deduct 835 Btuh (245 kW) per 1000 CFM (480 L/S) of indoor coil air for each degree below 80°F (27°C), or add 835 Btuh (245 kW) per 1000 CFM (480 L/S) of indoor coil air per degree above 80°F (27°C).

** System kW is total of indoor and outdoor unit kilowatts.

†† At TVA rating indoor condition (75°F edb/63°F ewb). All other indoor air temperatures are at 80°F edb.

EWB—Entering Wet Bulb

HEAT PUMP HEATING PERFORMANCE

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F																															
		-3				7				17				27				37				47				57				67			
		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power					
EDB	CFM	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†					
663C018-D, E Outdoor Section With F(A,B)4BN(F,C)024 Indoor Section																																	
65	550	7.82	7.20	1.19	9.40	8.63	1.24	11.2	10.2	1.29	13.1	11.6	1.34	15.3	13.9	1.42	17.8	17.8	1.52	20.5	20.5	1.64	23.6	23.6	1.82								
	650	7.97	7.33	1.21	9.55	8.78	1.25	11.3	10.3	1.29	13.2	11.8	1.34	15.5	14.1	1.41	18.0	18.0	1.51	20.8	20.8	1.63	23.9	23.9	1.80								
	750	8.10	7.45	1.23	9.69	8.91	1.27	11.5	10.5	1.31	13.4	11.9	1.35	15.7	14.3	1.42	18.2	18.2	1.52	20.9	20.9	1.64	24.1	24.1	1.82								
70	550	7.73	7.11	1.25	9.29	8.54	1.30	11.0	10.1	1.36	12.9	11.5	1.42	15.1	13.7	1.49	17.6	17.6	1.59	20.3	20.3	1.72	23.3	23.3	1.90								
	650	7.87	7.24	1.27	9.44	8.68	1.31	11.2	10.2	1.36	13.1	11.6	1.41	15.3	13.9	1.49	17.8	17.8	1.58	20.5	20.5	1.71	23.6	23.6	1.88								
	750	8.01	7.37	1.29	9.58	8.81	1.33	11.4	10.4	1.37	13.3	11.8	1.42	15.5	14.1	1.49	18.0	18.0	1.59	20.7	20.7	1.71	23.9	23.9	1.89								
75	550	7.61	7.00	1.31	9.19	8.45	1.37	10.9	9.95	1.42	12.8	11.3	1.49	14.9	13.6	1.57	17.4	17.4	1.67	20.0	20.0	1.81	23.1	23.1	1.98								
	650	7.76	7.14	1.33	9.34	8.59	1.38	11.1	10.1	1.43	13.0	11.5	1.49	15.2	13.8	1.56	17.6	17.6	1.66	20.3	20.3	1.79	23.4	23.4	1.96								
	750	7.90	7.27	1.35	9.48	8.71	1.39	11.2	10.2	1.44	13.1	11.6	1.49	15.3	13.9	1.56	17.8	17.8	1.66	20.5	20.5	1.79	23.6	23.6	1.96								
Multipliers for Determining the Performance With Other Indoor Sections																																	
Indoor Section		Size	Heating				Indoor Section		Size	Heating																							
			Capacity		Power					Capacity		Power																					
CC5A/CD5AA		018	0.98				FF1DNA		018	0.98				1.02																			
		024	0.99						024	1.00				1.00																			
CC5A/CD5AW		024	0.99				FF1DNE		018	0.98				1.02																			
CE3AA		024	0.99				FG3AAA		024	0.99				1.05																			
CF5AA		024	1.00				FK4DNF		001	0.97				0.92																			
CK3BA		024	1.01				COILS + 315(A,J)AV036070 FURNACE		002	0.97				0.90																			
CK5A/CK5BA		018	0.99						1.03		CC5A/CD5AA		024	0.96		0.99																	
		024	1.01				0.99		CC5A/CD5AW		024	0.96		0.99																			
CK5A/CK5BW		024	1.01				0.99		CC5A/CD5AW		024	0.96		0.99																			
F(A,B)4BN(F,C)		018	0.98				1.05		CE3AA		024	0.96		0.98																			
		024	1.00				1.00		CK3BA		024	0.96		0.92																			
FC4CNF		024	1.00				1.00		CK5A/CK5BA		024	0.96		0.92																			
		—	—				—		CK5A/CK5BW		024	0.96		0.92																			
663C024-F, G Outdoor Section With F(A,B)4BN(F,C)030 Indoor Section																																	
65	725	9.88	9.09	1.75	12.4	11.4	1.80	14.8	13.5	1.84	17.5	15.5	1.88	20.4	18.5	1.93	23.6	23.6	1.99	27.4	27.4	2.07	31.5	31.5	2.19								
	825	10.1	9.26	1.77	12.5	11.5	1.81	15.0	13.7	1.84	17.6	15.7	1.88	20.6	18.8	1.92	23.8	23.8	1.97	27.7	27.7	2.05	31.9	31.9	2.16								
	925	10.2	9.41	1.79	12.7	11.7	1.83	15.2	13.8	1.86	17.8	15.8	1.89	20.8	18.9	1.92	24.1	24.1	1.96	27.9	27.9	2.04	32.2	32.2	2.14								
70	725	9.56	8.80	1.80	12.1	11.1	1.86	14.6	13.3	1.91	17.3	15.3	1.96	20.2	18.3	2.01	23.4	23.4	2.08	27.0	27.0	2.17	31.1	31.1	2.30								
	825	9.76	8.98	1.82	12.3	11.3	1.88	14.8	13.5	1.92	17.4	15.5	1.96	20.4	18.5	2.00	23.6	23.6	2.06	27.3	27.3	2.14	31.5	31.5	2.25								
	925	9.93	9.14	1.85	12.5	11.5	1.90	15.0	13.6	1.93	17.6	15.6	1.97	20.6	18.7	2.00	23.8	23.8	2.05	27.6	27.6	2.13	31.8	31.8	2.23								
75	725	9.25	8.51	1.86	11.9	10.9	1.93	14.4	13.2	1.99	17.1	15.2	2.04	19.9	18.1	2.10	23.1	23.1	2.18	26.7	26.7	2.27	30.8	30.8	2.41								
	825	9.44	8.68	1.88	12.1	11.1	1.94	14.6	13.3	2.00	17.2	15.3	2.04	20.1	18.3	2.09	23.3	23.4	2.15	27.0	27.0	2.24	31.1	31.1	2.36								
	925	9.61	8.84	1.91	12.2	11.2	1.96	14.8	13.5	2.01	17.4	15.5	2.05	20.3	18.5	2.09	23.6	23.6	2.14	27.3	27.3	2.22	31.4	31.4	2.33								
Multipliers for Determining the Performance With Other Indoor Sections																																	
Indoor Section		Size	Heating				Indoor Section		Size	Heating																							
			Capacity		Power					Capacity		Power																					
CC5A/CD5AA		024	1.00				FG3AAA		024	1.00				1.06																			
		030	1.00						1.07		FK4DNF		001	0.98		0.95																	
CC5A/CD5AW		024	1.00				FK4DNF		002	0.98				0.92																			
		030	1.00						1.07		003		0.97				0.92																
CE3AA		024	1.00				COILS + 315(A,J)AV036070 FURNACE																										
		030	1.00						1.02		CC5A/CD5AA		030	0.97		1.02																	
CF5AA		024	1.00				1.06		CC5A/CD5AW		030	0.97		1.02																			
CK3BA		024	1.00				0.99		CE3AA		030	0.97		0.98																			
		030	1.00				1.03		CK3BA		030	0.97		0.98																			
CK5A/CK5BA		024	1.00				0.99		CK5A/CK5BA		030	0.97		0.98																			
		030	1.00				1.02		CK5A/CK5BW		030	0.97		0.98																			
CK5A/CK5BW		024	1.00				0.99		COILS + 355MAV042040 FURNACE																								
		030	1.00				1.02		CE3AA		030	0.99		0.96																			
F(A,B)4BN(F,C)		024	1.00				1.01		COILS + 355MAV042060 FURNACE																								
		030	1.00				1.00		CC5A/CD5AA		030	0.98		1.01																			
FC4CNF		024	1.00				1.01		CC5A/CD5AW		030	0.98		1.01																			
		030	1.00				1.00		CE3AA		030	0.99		0.96																			
FF1DNA		024	1.00				1.02		CK3BA		030	0.98		0.96																			
		030	1.00				1.01		CK5A/CK5BA		030	0.99		0.97																			
FF1DNE		024	1.00				1.02		CK5A/CK5BW		030	0.99		0.97																			
		030	1.00				1.01		—		—		—																				

HEAT PUMP HEATING PERFORMANCE Continued

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F																															
		-3				7				17				27				37				47				57				67			
		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power					
EDB	CFM	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†					
663C030-E, F Outdoor Section With F(A,B)4BN(F,C)036 Indoor Section																																	
65	875	12.2	11.2	2.00	15.0	13.8	2.07	18.1	16.5	2.15	21.6	19.2	2.26	25.4	23.1	2.39	29.6	29.6	2.55	34.5	34.5	2.77	39.0	39.0	2.91								
	1000	12.4	11.4	2.02	15.2	14.0	2.09	18.4	16.8	2.16	21.9	19.4	2.26	25.7	23.4	2.38	30.0	30.0	2.54	34.6	34.6	2.69	38.4	38.4	2.83								
	1125	12.6	11.6	2.05	15.4	14.2	2.11	18.6	17.0	2.18	22.1	19.7	2.27	26.0	23.6	2.38	30.2	30.2	2.53	34.6	34.4	2.65	37.8	37.8	2.78								
70	875	11.9	10.9	2.08	14.7	13.5	2.16	17.8	16.3	2.25	21.3	18.9	2.36	25.1	22.9	2.50	29.3	29.3	2.67	34.1	34.1	2.89	38.9	38.9	3.07								
	1000	12.1	11.1	2.11	15.0	13.8	2.18	18.1	16.5	2.25	21.6	19.2	2.36	25.4	23.1	2.48	29.6	29.6	2.65	34.4	34.4	2.83	38.6	38.6	2.97								
	1125	12.3	11.3	2.14	15.2	13.9	2.20	18.3	16.7	2.27	21.9	19.4	2.37	25.7	23.4	2.49	29.9	29.9	2.64	34.4	34.4	2.78	38.1	38.1	2.92								
75	875	11.6	10.7	2.16	14.5	13.3	2.26	17.6	16.0	2.35	21.0	18.7	2.47	24.8	22.6	2.61	28.9	28.9	2.79	33.7	33.7	3.02	38.7	38.7	3.23								
	1000	11.8	10.9	2.19	14.7	13.5	2.27	17.8	16.2	2.35	21.3	18.9	2.46	25.1	22.9	2.59	29.3	29.3	2.76	34.1	34.1	2.98	38.6	38.6	3.12								
	1125	12.0	11.0	2.22	14.9	13.7	2.30	18.0	16.5	2.37	21.5	19.1	2.47	25.4	23.1	2.60	29.5	29.5	2.76	34.3	34.3	2.93	38.2	38.2	3.07								
Multipliers for Determining the Performance With Other Indoor Sections																																	
Indoor Section		Size		Heating				Indoor Section		Size		Heating																					
				Capacity		Power						Capacity		Power																			
CC5A/CD5AA		030		0.98				1.04		CC5A/CD5AA		036		0.98				0.95															
		036		0.99				0.98				036		0.98				0.95															
CC5A/CD5AW		030		0.98				1.04		CC5A/CD5AW		036		0.98				0.95															
		036		0.99				0.98				036		0.98				0.97															
CE3AA		030		0.99				0.99		CK3BA		036		0.98				0.93															
		036		0.99				1.01				CK5A/CK5BA		036		0.98				0.93													
CF5AA		036		0.99				0.99		CK5A/CK5BW		036		0.98				0.93															
CK3BA		030		0.98				1.00		CC5A/CD5AA		036		0.98				0.94															
		036		0.99				0.97				036		0.98				0.94															
CK5A/CK5BA		036		0.99				0.98		CE3AA		036		0.98				0.97															
CK5A/CK5BT		036		0.99				0.97		CK3BA		036		0.98				0.93															
CK5A/CK5BW		030		0.98				1.00		CK5A/CK5BA		036		0.98				0.93															
		036		0.99				0.97		CK5A/CK5BT		036		0.98				0.93															
F(A,B)4BN(F,C)		030		0.99				0.98		CC5A/CD5AW		036		0.98				0.93															
		036		1.00				1.00				036		0.98				0.93															
FC4CNF		030		0.99				0.98		CE3AA		036		0.98				0.96															
		036		1.00				1.01		CK3BA		036		0.98				0.92															
FF1DNA		030		0.99				0.98		CK5A/CK5BW		036		0.98				0.92															
FF1DNE		030		0.99				0.98		CC5A/CD5AA		036		0.98				0.93															
FG3AAA		036		0.99				1.00				036		0.98				0.93															
FK4DNF		001		0.98				0.95				CC5A/CD5AW		036		0.98				0.93													
		002		0.98				0.92		CE3AA		036		0.98				0.96															
		003		0.97				0.92		CK3BA		036		0.98				0.91															
COILS + 315(A,J)AV036070 FURNACE										CK5A/CK5BA		036		0.98				0.91															
CC5A/CD5AA		036		0.98				0.96		CK5A/CK5BT		036		0.98				0.91															
CE3AA		036		0.98				0.98		CK5A/CK5BW		036		0.98				0.91															
CK3BA		036		0.98				0.93		CC5A/CD5AW		036		0.98				0.93															
CK5A/CK5BA		036		0.98				0.93				036		0.98				0.96															
CK5A/CK5BT		036		0.98				0.93				CK5A/CK5BW		036		0.98				0.91													

See notes on page 29.

HEAT PUMP HEATING PERFORMANCE Continued

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F																							
		-3			7			17			27			37			47			57			67		
		Capacity MBtuh	Total Power		Capacity MBtuh	Total Power		Capacity MBtuh	Total Power		Capacity MBtuh	Total Power		Capacity MBtuh	Total Power		Capacity MBtuh	Total Power		Capacity MBtuh	Total Power		Capacity MBtuh	Total Power	
EDB	CFM	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†
663C036-E, F Outdoor Section With F(A,B)4BN(F,B,C)042 Indoor Section																									
65	1050	15.0	13.8	2.27	18.4	16.9	2.36	22.1	20.2	2.46	26.2	23.2	2.58	30.7	27.9	2.73	35.8	35.8	2.92	41.2	41.2	3.09	45.6	45.6	3.26
	1200	15.3	14.0	2.30	18.7	17.2	2.38	22.4	20.5	2.47	26.5	23.5	2.59	31.1	28.3	2.73	36.2	36.2	2.91	40.8	40.8	3.03	43.0	43.0	3.09
	1350	15.5	14.3	2.34	18.9	17.4	2.42	22.7	20.7	2.50	26.8	23.8	2.61	31.4	28.6	2.75	36.5	36.5	2.91	40.8	40.8	3.03	43.0	43.0	2.96
70	1050	14.7	13.5	2.35	18.1	16.6	2.45	21.8	19.9	2.56	25.9	23.0	2.69	30.3	27.6	2.85	35.4	35.4	3.05	41.0	41.0	3.25	45.6	45.6	3.41
	1200	14.9	13.7	2.39	18.4	16.9	2.48	22.1	20.2	2.57	26.2	23.3	2.70	30.7	27.9	2.84	35.8	35.8	3.03	40.9	40.9	3.17	44.8	44.8	3.32
	1350	15.2	14.0	2.43	18.7	17.1	2.51	22.4	20.4	2.60	26.5	23.5	2.72	31.0	28.2	2.86	36.1	36.1	3.03	40.5	40.5	3.14	41.6	41.6	3.16
75	1050	14.3	13.2	2.44	17.8	16.3	2.55	21.5	19.6	2.67	25.6	22.7	2.81	30.0	27.3	2.97	34.9	34.9	3.18	40.6	40.6	3.42	45.6	45.6	3.58
	1200	14.6	13.4	2.48	18.1	16.6	2.58	21.8	19.9	2.68	25.9	23.0	2.81	30.4	27.6	2.97	35.4	35.4	3.16	40.8	40.8	3.32	45.1	45.1	3.48
	1350	14.8	13.7	2.52	18.4	16.9	2.61	22.1	20.2	2.71	26.2	23.3	2.83	30.7	27.9	2.97	35.7	35.7	3.16	40.6	40.6	3.28	43.6	43.6	3.39
Multipliers for Determining the Performance With Other Indoor Sections																									
Indoor Section		Size	Heating		Indoor Section		Size	Heating																	
			Capacity	Power				Capacity	Power																
CC5A/CD5AA		036	1.00		CC5A/CD5AA		042	0.98																	
		042	1.01				0.97																		
CC5A/CD5AW		036	0.99		CC5A/CD5AW		042	0.98																	
		042	1.00				0.95																		
CE3AA		036	0.99		CK3BA		042	0.98																	
		042	1.01				0.95																		
CF5AA		036	1.00		CK5A/CK5BA		042	0.98																	
CK3BA		036	1.00		CK5A/CK5BT		042	0.98																	
CK5A/CK5BA		036	1.00		CK5A/CK5BA		042	0.98																	
		042	1.00				0.94																		
CK5A/CK5BE		042	1.00		CK5A/CK5BT		042	0.98																	
CK5A/CK5BT		036	1.00		CK5A/CK5BT		042	0.98																	
CK5A/CK5BW		042	1.00		CK5A/CK5BT		042	0.98																	
F(A,B)4BN(F,B,C)		036	1.00		CK5A/CK5BT		042	0.98																	
F(A,B)4BN(F,C)		042	1.00		CE3AA		042	0.98																	
FC4CN(F,B)		036	1.01		CE3AA		042	0.98																	
FC4CNF		042	1.00		CC5A/CD5AA		042	0.98																	
FG3AAA		036	1.01		CC5A/CD5AW		42	0.98																	
FK4DNF		036	1.00		CE3AA		042	0.98																	
FK4DNF		001	0.98		CK3BA		042	0.98																	
		002	0.98		CK5A/CK5BA		042	0.98																	
		003	0.98		CK5A/CK5BT		042	0.98																	
		005	0.93		COILS + 355MAV060080 FURNACE																				
COILS + 315(A,J)AV036070 FURNACE		001	0.98		CC5A/CD5AA		042	0.98																	
CE3AA		002	0.98		CC5A/CD5AA		042	0.98																	
CK5A/CK5BE		003	0.98		CC5A/CD5AW		042	0.98																	
COILS + 315(A,J)AV048090 FURNACE		005	0.93		CK3BA		042	0.98																	
CC5A/CD5AA		001	0.98		CK5A/CK5BA		042	0.98																	
CE3AA		002	0.98		CK5A/CK5BT		042	0.98																	
CK3BA		003	0.98		COILS + 355MAV060100 FURNACE																				
CK5A/CK5BA		005	0.93		CC5A/CD5AA		042	0.98																	
CK5A/CK5BE		001	0.98		CC5A/CD5AW		042	0.98																	
CK5A/CK5BT		002	0.98		CE3AA		042	0.98																	
COILS + 315(A,J)AV066110 FURNACE		003	0.98		CK3BA		042	0.98																	
CC5A/CD5AA		005	0.93		CK5A/CK5BA		042	0.98																	
CC5A/CD5AW		001	0.98		CK5A/CK5BT		042	0.98																	
CE3AA		002	0.98		COILS + 355MAV060120 FURNACE																				
CK3BA		003	0.98		CC5A/CD5AA		042	0.98																	
CK5A/CK5BA		005	0.93		CC5A/CD5AW		042	0.98																	
CK5A/CK5BT		001	0.98		CE3AA		042	0.98																	
		002	0.98		CK5A/CK5BA		042	0.98																	
		003	0.98		CK5A/CK5BT		042	0.98																	
		005	0.93		CK5A/CK5BT		042	0.98																	

See notes on page 29.

HEAT PUMP HEATING PERFORMANCE Continued

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F																															
		-3				7				17				27				37				47				57				67			
		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power		Capacity MBtuh		Total Power					
EDB	CFM	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†					
663C042-D, E Outdoor Section With F(A,B)4BN(F,B,C)048 Indoor Section																																	
65	1275 1475 1675	19.7 20.0 20.4	18.1 18.4 18.7	2.77 2.82 2.88	23.5 23.8 24.1	21.6 21.9 22.2	2.88 2.92 2.98	27.5 27.9 28.3	25.1 25.4 25.8	3.00 3.03 3.07	31.9 32.4 32.7	28.4 28.7 29.1	3.13 3.15 3.18	36.9 37.4 37.8	33.6 34.0 34.4	3.28 3.29 3.31	43.0 43.5 44.0	43.0 43.5 44.0	3.48 3.47 3.49	50.4 51.1 51.6	50.4 51.1 51.6	3.75 3.73 3.75	58.0 58.8 59.2	58.0 58.8 59.2	4.08 4.05 4.01								
70	1275 1475 1675	19.2 19.6 20.0	17.7 18.1 18.4	2.87 2.92 2.98	23.2 23.5 23.9	21.3 21.6 21.9	3.00 3.04 3.10	27.2 27.6 28.0	24.8 25.2 25.5	3.13 3.16 3.20	31.6 32.0 32.4	28.1 28.4 28.8	3.27 3.28 3.32	36.5 37.0 37.4	33.2 33.7 34.0	3.42 3.43 3.45	42.4 43.0 43.5	42.4 43.0 43.5	3.63 3.62 3.64	49.7 50.4 51.0	49.7 50.4 51.0	3.91 3.89 3.89	57.3 58.1 58.7	57.3 58.1 58.7	4.25 4.21 4.22								
75	1275 1475 1675	18.7 19.1 19.5	17.2 17.6 18.0	2.97 3.03 3.09	22.9 23.2 23.6	21.0 21.4 21.7	3.12 3.17 3.22	26.9 27.3 27.6	24.5 24.9 25.2	3.26 3.29 3.33	31.3 31.7 32.1	27.8 28.1 28.5	3.41 3.42 3.46	36.1 36.6 37.0	32.9 33.3 33.7	3.58 3.58 3.60	41.9 42.5 43.0	41.9 42.5 43.0	3.79 3.78 3.79	49.0 49.7 50.3	49.0 49.7 50.3	4.08 4.05 4.05	56.5 57.3 57.9	56.5 57.3 57.9	4.42 4.38 4.38								
Multipliers for Determining the Performance With Other Indoor Sections																																	
Indoor Section		Size		Heating				Indoor Section		Size		Heating																					
				Capacity		Power						Capacity		Power																			
CC5A/CD5AA		042		0.98				1.02		CC5A/CD5AC		048		0.98				1.03															
		048		0.98				1.04				0.98		0.98																			
CC5A/CD5AW		048		0.99				1.01		CC5A/CD5AW		048		0.98				0.98															
CD5AA		048		0.99				1.01		CD5AA		048		0.98				0.98															
CE3AA		042		0.99				1.01		CE3AA		048		0.98				0.97															
		048		0.99				1.00		CK3BA		048		0.98				0.95															
CF5AA		048		0.98				1.01		CK5A/CK5BA		048		0.98				0.95															
CK3BA		042		0.98				1.00		CK5A/CK5BT		048		0.98				0.95															
		048		0.99				1.00		CK5A/CK5BW		048		0.98				0.95															
CK5A/CK5BA		042		0.98				1.00		CC5A/CD5AC		048		0.98				1.03															
		048		0.99				0.99				0.98		0.98																			
CK5A/CK5BE		042		0.95				0.96		CC5A/CD5AW		048		0.98				0.98															
CK5A/CK5BT		042		0.98				1.00		CD5AA		048		0.98				0.98															
		048		0.99				0.99		CE3AA		048		0.98				0.97															
CK5A/CK5BW		048		0.99				1.00		CK3BA		048		0.98				0.95															
F(A,B)4BN(F,B,C)		042		0.99				0.99		CK5A/CK5BA		048		0.98				0.95															
		042		0.99				1.03		CK5A/CK5BT		048		0.98				0.95															
		048		1.00				1.00		CK5A/CK5BW		048		0.98				0.95															
FC4CN(F,B)		042		0.99				1.03		CD5AA		048		0.98				0.98															
		048		1.00				1.00				0.98		0.98																			
FG3AAA		048		0.99				0.99		CE3AA		048		0.98				0.98															
FK4DNB		006		0.98				0.88		CK5A/CK5BA		048		0.98				0.97															
FK4DNF		003		0.97				0.98		CK5A/CK5BT		048		0.98				0.97															
		005		0.98				0.91		CD5AA		048		0.98				0.98															
COILS + 315(A,J)AV048090 FURNACE		048		0.98				1.04				CE3AA		048		0.98				0.97													
COILS + 315(A,J)AV066110 FURNACE		048		0.98				1.03		CK5A/CK5BA		048		0.98				0.95															
COILS + 315(A,J)AV066110 FURNACE		048		0.98				0.98		CK5A/CK5BT		048		0.98				0.95															
COILS + 355MAV060120 FURNACE		048		0.98				0.97		CC5A/CD5AW		048		0.98				0.98															
COILS + 355MAV060120 FURNACE		048		0.98				0.95		CE3AA		048		0.98				0.97															
COILS + 355MAV060120 FURNACE		048		0.98				0.95		CK3BA		48		0.98				0.95															
COILS + 355MAV060120 FURNACE		048		0.98				0.95		CK5A/CK5BA		048		0.98				0.95															
COILS + 355MAV060120 FURNACE		048		0.98				0.95		CK5A/CK5BT		048		0.98				0.95															
COILS + 355MAV060120 FURNACE		—		—				—		CK5A/CK5BW		048		0.98				0.95															

See notes on page 29.

HEAT PUMP HEATING PERFORMANCE Continued

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F																								
		-3			7			17			27			37			47			57			67			
		Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	
EDB	CFM	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	
663C048-D, E Outdoor Section With FK4DNF005 Indoor Section																										
65	1400	22.2	20.4	2.99	26.7	24.6	3.13	31.4	28.6	3.25	36.3	32.2	3.38	42.1	38.3	3.54	48.5	48.5	3.73	56.1	56.1	3.97	64.6	64.6	4.29	
	1600	22.5	20.7	3.00	27.0	24.8	3.13	31.7	28.9	3.23	36.6	32.5	3.35	42.5	38.6	3.48	49.1	49.1	3.66	56.7	56.7	3.88	65.4	65.4	4.18	
	1800	22.7	20.9	3.02	27.2	25.0	3.13	32.0	29.1	3.23	36.9	32.8	3.33	42.8	39.0	3.46	49.5	49.5	3.62	57.2	57.2	3.83	66.0	66.0	4.12	
70	1400	21.7	19.9	3.13	26.4	24.3	3.28	31.1	28.4	3.42	35.9	31.9	3.56	41.6	37.9	3.73	48.0	48.0	3.93	55.4	55.4	4.19	63.7	63.7	4.51	
	1600	22.0	20.2	3.14	26.7	24.5	3.28	31.4	28.6	3.40	36.3	32.2	3.53	42.0	38.2	3.67	48.5	48.5	3.85	56.0	56.0	4.09	64.5	64.5	4.40	
	1800	22.3	20.5	3.16	27.0	24.8	3.29	31.7	28.9	3.40	36.6	32.5	3.51	42.4	38.6	3.65	48.9	48.9	3.81	56.5	56.5	4.03	65.1	65.1	4.33	
75	1400	21.1	19.4	3.26	26.0	23.9	3.43	30.8	28.1	3.60	35.6	31.6	3.75	41.2	37.5	3.93	47.5	47.5	4.14	54.7	54.7	4.41	62.9	62.9	4.75	
	1600	21.4	19.7	3.28	26.3	24.2	3.43	31.1	28.4	3.58	35.9	31.9	3.71	41.6	37.8	3.87	48.0	48.0	4.06	55.3	55.3	4.31	63.7	63.7	4.62	
	1800	21.7	20.0	3.30	26.6	24.4	3.44	31.4	28.6	3.57	36.2	32.1	3.69	41.9	38.1	3.84	48.4	48.4	4.01	55.8	55.8	4.24	64.3	64.3	4.55	
Multipliers for Determining the Performance With Other Indoor Sections																										
Indoor Section		Size	Heating				Indoor Section		Size	Heating																
			Capacity		Power					Capacity		Power														
CC5A/CD5AA		060	1.00						1.10		COILS + 315(A,J)AV066135 FURNACE															
CC5A/CD5AC		048	1.00						1.15		CC5A/CD5AA		060	1.00				1.10								
CC5A/CD5AW		048	1.00						1.09		CC5A/CD5AW		060	1.00				1.04								
		060	1.00						1.05		CE3AA		060	1.00				1.04								
CD5AA		048	1.00						1.09		CK3BA		060	1.00				1.00								
CE3AA		048	1.00						1.07		CK5A/CK5BA		060	1.00				1.00								
		060	1.00						1.04		CK5A/CK5BT		060	1.00				1.00								
CF5AA		048	1.00						1.11		CK5A/CK5BX		060	1.00				0.99								
CK3BA		048	1.00						1.07		COILS + 315(A,J)AV066155 FURNACE															
		060	1.00						1.02		CC5A/CD5AA		060	1.00				1.10								
CK5A/CK5BA		048	1.00						1.07		CC5A/CD5AW		060	1.00				1.03								
		060	1.00						1.02		CE3AA		060	1.00				1.03								
CK5A/CK5BT		048	1.00						1.07		CK3BA		060	1.00				0.99								
		060	1.00						1.02		CK5A/CK5BA		060	1.00				0.99								
CK5A/CK5BW		048	1.00						1.07		CK5A/CK5BT		060	1.00				0.99								
CK5A/CK5BX		060	1.00						1.01		CK5A/CK5BX		060	1.00				0.99								
F(A,B)4BN(F,B,C)		048	1.00						1.05		COILS + 355MAV060080 FURNACE															
		060	1.00						1.03		CC5A/CD5AA		060	1.00				1.00								
FB4BNB		070	1.00						0.99		CC5A/CD5AW		060	1.00				1.10								
FC4CN(F,B)		048	1.00						1.05		CE3AA		060	1.00				0.99								
		060	1.00						1.03		COILS + 355MAV060100 FURNACE															
FC4CNB		054	1.00						0.98		CC5A/CD5AA		060	1.00				1.03								
		070	1.00						0.99		CC5A/CD5AW		060	1.00				1.10								
FG3AAA		048	1.00						1.07		CE3AA		060	1.00				1.04								
		060	1.00						1.06		CK3BA		060	1.00				0.97								
FK4DNB		006	1.00						0.96		CK5A/CK5BA		060	1.00				1.03								
FK4DNF		005	1.00						1.00		CK5A/CK5BT		060	1.00				0.97								
											CK5A/CK5BX		060	1.00				0.97								
COILS + 315(A,J)AV048090 FURNACE										COILS + 355MAV060120 FURNACE																
CE3AA		060	1.00						1.05		COILS + 355MAV060110 FURNACE															
COILS + 315(A,J)AV066110 FURNACE										CC5A/CD5AA		060	1.00				1.03									
CC5A/CD5AA		060	1.00						1.10		CC5A/CD5AW		060	1.00				1.10								
CE3AA		060	1.00						1.03		CE3AA		060	1.00				1.04								
CK3BA		060	1.00						1.00		CK3BA		060	1.00				1.00								
CK5A/CK5BA		060	1.00						1.00		CK5A/CK5BA		060	1.00				1.00								
CK5A/CK5BT		060	1.00						1.00		CK5A/CK5BT		060	1.00				1.00								
CK5A/CK5BX		060	1.00						0.99		CK5A/CK5BX		060	1.00				1.00								

See notes on page 29.

HEAT PUMP HEATING PERFORMANCE Continued

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F																															
		-3				7				17				27				37				47				57				67			
		Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	Capacity MBtuh		Total Power	Capacity MBtuh		Total Power					
EDB	CFM	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†					
663C060-D, E Outdoor Section With FK4DNB006 Indoor Section																																	
65	1750	28.2	26.0	4.20	33.5	30.8	4.37	39.1	35.7	4.55	45.3	40.2	4.75	52.5	47.8	5.00	60.7	60.7	5.30	70.1	70.1	5.69	79.6	79.6	6.03								
	2000	28.6	26.3	4.22	33.8	31.1	4.38	39.5	36.0	4.54	45.7	40.6	4.72	53.0	48.3	4.95	61.3	61.3	5.23	70.7	70.7	5.56	79.4	79.4	5.87								
	2250	28.9	26.6	4.26	34.1	31.3	4.40	39.9	36.3	4.55	46.1	41.0	4.72	53.5	48.7	4.93	61.8	61.8	5.20	70.8	70.8	5.48	78.5	78.5	5.75								
70	1750	27.8	25.5	4.38	33.2	30.5	4.59	38.8	35.4	4.78	44.9	39.8	4.99	52.0	47.3	5.25	60.0	60.0	5.57	69.3	69.3	5.97	79.7	79.7	6.41								
	2000	28.1	25.9	4.41	33.5	30.8	4.59	39.2	35.7	4.77	45.3	40.2	4.96	52.5	47.8	5.20	60.6	60.6	5.49	70.1	70.1	5.87	79.2	79.2	6.18								
	2250	28.5	26.2	4.45	33.8	31.1	4.61	39.5	36.0	4.78	45.7	40.6	4.95	52.9	48.2	5.18	61.1	61.1	5.45	70.4	70.4	5.77	78.5	78.5	6.05								
75	1750	27.2	25.0	4.57	32.9	30.2	4.80	38.5	35.1	5.02	44.4	39.5	5.24	51.4	46.8	5.52	59.3	59.3	5.84	68.5	68.5	6.26	79.0	79.0	6.80								
	2000	27.6	25.4	4.59	33.2	30.5	4.81	38.8	35.4	5.00	44.9	39.8	5.21	52.0	47.3	5.45	60.0	60.0	5.76	69.3	69.3	6.15	79.4	79.4	6.55								
	2250	28.0	25.7	4.63	33.5	30.8	4.83	39.2	35.7	5.01	45.2	40.2	5.20	52.4	47.7	5.43	60.4	60.4	5.71	69.9	69.9	6.09	78.8	78.8	6.39								
Multipliers for Determining the Performance With Other Indoor Sections																																	
Indoor Section		Size		Heating				Indoor Section		Size		Heating																					
				Capacity		Power						Capacity		Power																			
CC5A/CD5AA		060		1.00		1.16		CK5A/CK5BT		060		1.00		1.04																			
CC5A/CD5AW		060		1.00		1.10		CK5A/CK5BX		060		1.00		1.03																			
CE3AA		060		1.00		1.09		COILS + 315(A,J)AV066135 FURNACE																									
CK3BA		060		1.00		1.11		CC5A/CD5AA		060		1.00		1.15																			
CK5A/CK5BA		060		1.00		1.11		CC5A/CD5AW		060		1.00		1.08																			
CK5A/CK5BT		060		1.00		1.11		CE3AA		060		1.00		1.08																			
CK5A/CK5BX		060		1.00		1.07		CK3BA		060		1.00		1.04																			
F(A,B)4BN(F,B,C)		060		1.00		1.06		CK5A/CK5BA		060		1.00		1.04																			
		060		1.00		1.08		CK5A/CK5BT		060		1.00		1.04																			
FB4BNB		070		1.00		1.03		CK5A/CK5BX		060		1.00		1.03																			
FC4CN(F,B)		060		1.00		1.08		COILS + 315(A,J)AV066155 FURNACE																									
FC4CNB		070		1.00		1.03		CC5A/CD5AA		060		1.00		1.14																			
FG3AAA		060		1.00		1.12		CC5A/CD5AW		060		1.00		1.08																			
FK4DNB		006		1.00		1.00		CE3AA		060		1.00		1.07																			
COILS + 315(A,J)AV066110 FURNACE								CK3BA		060		1.00		1.04																			
CC5A/CD5AA		060		1.00		1.15		CK5A/CK5BA		060		1.00		1.04																			
CE3AA		060		1.00		1.08		CK5A/CK5BT		060		1.00		1.04																			
CK3BA		060		1.00		1.04		CK5A/CK5BX		060		1.00		1.03																			
CK5A/CK5BA		060		1.00		1.04				—		—		—																			

NOTE: When the required data falls between the published data, interpolation may be performed. Extrapolation is not an acceptable practice.

* The Btuh heating capacity values shown are net integrated values from which the defrost effect has been subtracted. The Btuh heating from supplement heaters should be added to those values to obtain total system capacity.

† The kW values include the compressor, outdoor fan motor, and indoor blower motor. The kW from supplement heaters should be added to these values to obtain total system kilowatts.

EDB—Entering Dry Bulb

SYSTEM DESIGN

1. Intended for outdoor installation with free air inlet and outlet. Outdoor fan external static pressure available is less than 0.01-in. wc.
2. Minimum outdoor operating air temperature for cooling mode without low-ambient operation accessory is 55°F (12.8°C).
3. Maximum outdoor operating air temperature for cooling mode is 125°F (51.7°C).
4. Minimum outdoor operating air temperature for heating mode is -30°F (-34.4°C).
5. Maximum outdoor operating air temperature for heating mode is 66°F (18.9°C).
6. For reliable operation, unit should be level in all horizontal planes.
7. Maximum elevation of indoor coil above or below base of outdoor unit is: indoor coil above—50 ft, indoor coil below—150 ft. (See items 8 and 9 following.)
8. For interconnecting refrigerant tube lengths greater than 50 ft, consult Application Guideline and Service Manual—Air Conditioners and Heat Pumps Using R-22 Refrigerant.
9. If any refrigerant tubing is buried, provide a minimum 6-in. vertical rise to the valve connections at the unit. Refrigerant tubing lengths up to 36 in. may be buried without further consideration. For buried refrigerant tubing lengths greater than 36 in., consult your local distributor.
10. Use only copper wire for electric connection at unit. Aluminum and clad aluminum are not acceptable for the type of connector provided.
11. Mismatches of indoor coil capacity more than 1 size larger than outdoor unit capacity may result in inadequate indoor comfort.

GENERAL

System Description

Outdoor-mounted, air-cooled, split-system air conditioner unit suitable for ground or rooftop installation. Unit consists of a hermetic compressor, an air-cooled coil, propeller-type condenser fan, and a control box. Unit will discharge supply air upward as shown on contract drawings. Unit will be used in a refrigeration circuit to match up to a packaged fan coil or coil unit.

Quality Assurance

Unit will be rated in accordance with the latest edition of ARI Standard 210.

Unit will be certified for capacity, efficiency, and listed in the latest ARI directory.

Unit construction will comply with latest edition of ANSI/ASHRAE and with NEC.

Unit will be constructed in accordance with UL standards and will carry the UL label of approval. Unit will have c-UL approval.

Unit cabinet will be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 500-hr salt spray test.

Air-cooled condenser coils will be leak tested at 150 psig and pressure tested at 300 psig.

Unit constructed in ISO 9001 approved facility.

Delivery, Storage, and Handling

Unit will be shipped as single package only and is stored and handled per unit manufacturer's recommendations.

Warranty (for inclusion by specifying engineer)

U.S. and Canada only.

PRODUCTS

Equipment

Factory assembled, single piece, air-cooled air conditioner unit. Contained within the unit enclosure will be all factory wiring, piping, controls, compressor, refrigerant charge (R22), and special features required prior to field start-up.

Unit Cabinet

Unit cabinet will be constructed of galvanized steel, bonderized, and coated with a powder coat paint.

Fans

Condenser fan will be direct-drive propeller type, discharging air upward.

Condenser fan motors will be totally enclosed, 1-phase type with class B insulation and permanently lubricated bearings.

Shafts will be corrosion resistant.

Fan blades will be statically and dynamically balanced.

Condenser fan openings will be equipped with steel wire safety guards.

Compressor

Compressor will be hermetically sealed.

Compressor will be mounted on rubber vibration isolators.

Condenser Coil

Condenser coil will be air cooled.

Coil will be constructed of aluminum fins mechanically bonded to copper tubes which are then cleaned, dehydrated, and sealed.

Refrigeration Components

Refrigeration circuit components will include liquid line shutoff valve with sweat connections, suction tube shutoff valves with sweat connections, system charge of refrigerant R22, and compressor oil.

Operating Characteristics

The capacity of the unit will meet or exceed ____ Btuh at a suction temperature of ____ °F. The power consumption at full load will not exceed ____ kW.

Combination of the unit and the evaporator or fan coil unit will have a total net cooling capacity of ____ Btuh or greater at conditions of ____ CFM entering air temperature at the evaporator at ____ °F wet bulb and ____ °F dry bulb, and air entering the unit at ____ °F.

The system will have a SEER of ____ Btuh/watt or greater at DOE conditions.

Electrical Requirements


Nominal unit electrical characteristics will be ____ v, ____ phase, 60 hz. The unit will be capable of satisfactory operation within voltage limits of ____ v to ____ v.

Unit electrical power will be single point connection.

Control circuit will be 24v.

Special Features

Refer to section of this literature identifying accessories and descriptions for specific features and available enhancements.



SPECIFICATIONS SUBJECT TO CHANGE WITHOUT NOTICE

UNIT MUST BE INSTALLED IN ACCORDANCE
WITH INSTALLATION INSTRUCTIONS

Cancels: PDS 663C.18.7