

HIGH EFFICIENCY PACKAGE HEAT PUMPS R-410A SINGLE PACKAGE ROOFTOP 3 - 10 TONS (1 & 3-Phase)

BUILT TO LAST, EASY TO INSTALL AND SERVICE

- One-piece, high efficiency electric heating and electric cooling units, prewired, tested, and charged at the factory
- Filed convertible from vertical to horizontal airflow on all models. No special kits required on 036-102 models. Supply duct kit required for 120 size model only.
- Full perimeter base rail with built-in rigging adapters and fork truck slots
- Pre-painted exterior panels and primer-coated interior panels tested to 500 hours salt spray protection
- Fully insulated cabinet
- Single stage cooling on 036-072 models, 2 stage on 090-120
- Single scroll compressor on 036-072 models, dual scroll compressors on 090 -120 models with internal line-break overload protection
- All units have high and low pressure switches
- Two inch disposable fiberglass type return air filters in dedicated rack with tool-less filter access door
- Refrigerant circuits contain a liquid line filter drier to trap dirt and moisture
- Precision sized suction line accumulator to provide high reliability
- 4-way reversing valve rapidly changes the flow of refrigerant to quickly changeover from cooling to heating and heating to cooling
- Dependable time/temperature defrost logic provides a defrost cycle, if needed, every 30, 60, 90, or 120 minutes and is adjustable
- Direct drive high efficiency ECM blower motor on 036-060 models
- Belt drive evaporator-fan motor and pulley combinations available on all 3 phase models
- Crankcase heaters on all models except 036 size
- Standard coils are copper round tube, aluminum plate fin with optional coil coatings and copper fin design.
- Newly-designed indoor refrigerant header for easier maintenance and replacement
- Exclusive non-corrosive composite condensate pan in accordance with ASHRAE 62 Standard, sloping design; side or center drain
- Access panels with easy grip handles provide quick and easy access to the blower and blower motor, control box, and compressor.
- "No-strip" screw system has superior holding power and guides screws into position while preventing the screw from stripping the unit's metal.
- Newly designed terminal board facilitates simple safety circuit troubleshooting and simplified control box arrangement
- Outdoor temperature cooling operation range up to 125°F (52°C) and down to 30°F (-1°C)
- TXV refrigerant metering device on each circuit to precisely control refrigerant flow
- Large, laminated control wiring and power wiring drawings are affixed to unit to make troubleshooting easy
- Standard, medium and high static fan motor options available
- Provisions for thru-the-bottom power entry capability
- Single point electrical connections



RHH036-060



RHH072-102



Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to www.ahridirectory.org.



WARRANTY

- 5 Year compressor limited warranty
- 1 Year parts limited warranty

UNIT PERFORMANCE DATA

BASE MODEL	Nom. Tons	COOLING			HEATING			Unit Dimensions H x W x L	Unit Weight lbs (kg)
		Net Cap. (Btuh)	SEER	EER	High Cap. (Btuh)	HSPF	COP		
RHH036*0XA0AAA	3	36,400	15.6	12.7	34,000	8.0	N/A	33 ³ / ₈ x 46 ³ / ₄ x 74 ³ / ₈ (847x1187x1888)	495 (225)
RHH048*0XA0AAA	4	47,000	15.8	12.8	46,000	8.1	N/A	41 ³ / ₈ x 46 ³ / ₄ x 74 ³ / ₈ (1051x1187x1888)	580 (263)
RHH060*0XA0AAA	5	58,500	15.0	12.5	55,000	8.2	N/A	41 ³ / ₈ x 46 ³ / ₄ x 74 ³ / ₈ (1051x1187x1888)	610 (277)
RHH072*0AA0AAA	6	72,000	N/A	12.0	70,000	N/A	3.4	41 ³ / ₈ x 59 ¹ / ₂ x 88 ¹ / ₈ (1051x1510x2238)	710 (322)
RHH090*0AA0AAA	7 ¹ / ₂	90,000	N/A	12.1	84,000	N/A	3.5	49 ³ / ₈ x 59 ¹ / ₂ x 88 ¹ / ₈ (1253x1510x2238)	875 (397)
RHH102*0AA0AAA	8 ¹ / ₂	100,000	N/A	12.0	100,000	N/A	3.4	49 ³ / ₈ x 59 ¹ / ₂ x 88 ¹ / ₈ (1253x1510x2238)	1020 (463)
RHH120*0AA0AAA	10	119,000	N/A	12.3	116,000	N/A	3.5	57 ³ / ₈ x 63 ³ / ₈ x 115 ⁷ / ₈ (1456x1609x2942)	1390 (632)

* Indicates Unit voltage: K = 208/230-1-60, H = 208/230-3-60, L = 460-3-60, S = 575-3-60

TABLE OF CONTENTS

	PAGE		PAGE
MODEL NUMBER NOMENCLATURE	3	HEATING TABLES	41
FACTORY OPTIONS AND/OR ACCESSORIES	4	STATIC PRESSURE ADDERS	48
AHRI CAPACITY RATINGS	10	FAN PERFORMANCE	49
SOUND PERFORMANCE TABLE	11	OUTDOOR AIR INTAKE & EXHAUST PERF	60
PHYSICAL DATA	12	ELECTRICAL INFO	62
ELECTRIC HEAT DATA	14	MCA / MOCP	65
WEIGHTS & DIMENSIONS	21	TYPICAL WIRING DIAGRAMS	73
APPLICATION DATA	27	SEQUENCE OF OPERATION	77
COOLING TABLES	34	GUIDE SPECIFICATIONS	79

MODEL NOMENCLATURE

MODEL SERIES	R	H	H	0	9	0	H	0	A	A	0	A	A	A
Position Number	1	2	3	4	5	6	7	8	9	10	11	12	13	14
R = Rooftop														
A = Air Conditioning (Cooling Only) H = Heat Pump G = Gas/Electric Type														
H = High Efficiency, Energy Star Efficiency														
036 = 36,000 = 3 Tons 048 = 48,000 = 4 Tons 060 = 60,000 = 5 Tons 072 = 72,000 = 6 Tons 090 = 90,000 = 7.5 Tons (Dual Compressor) 102 = 102,000 = 8.5 Tons (Dual Compressor) 120 = 120,000 = 10 Tons (Dual Compressor) Nominal. Cooling Capacity														
K = 208/230-1-60 H = 208/230-3-60 L = 460-3-60 S = 575-3-60 Voltage														
0 = No Heat Heating Capacity														
X = Direct drive ECM Motor (3-5 Ton) A = Standard Static Option - Belt Drive (6-10 Ton) C = Medium Static Option (Belt Drive) (3-10 Ton, 3 Phase Only) B = High Static Option (Belt Drive) (3-10 Ton, 3 Phase Only) E = High Static with High Efficiency Motor (10 Ton only) Motor Option														
A = None B = Economizer w/Bara-relief, OA Temp sensor E = Economizer w/Bara-relief + CO2 Sensor, OA Temp sensor H = Economizer w/Bara-relief, enthalpy sensor L = Economizer w/Bara-relief + CO2 Sensor, enthalpy sensor P = 2-Position damper w/Baro-relief Outdoor Air Options / Control														
0A = No Options 4B = Non-Fused Disconnect AT = Non-powered 115v C.O. BA = Supply Air Smoke Detector + Non-Powered 115v C.O. 7C = Non-Fused Disconnect + Non-Powered 115v C.O. 7K = Non-Fused Disconnect + Non-Powered 115v C.O.+ SA Smoke detector 8A = Non-Fused Disconnect + SA Smoke detector AA = Easy Access Hinged Panels 6C = Non-Fused Disconnect + Easy Access Hinged Panels 6D = Non-Fused Disconnect + Easy Access Hinged Panels + Non-powered 115V C.O. 6L = Non-Fused Disconnect + Easy Access Hinged Panels + Non-powered 115V C.O. + SA Smoke detector 7B = Non-Fused Disconnect + Easy Access Hinged Panels + SA Smoke detector AB = Easy Access Hinged Panels + Non-powered 115v C.O. AJ = Easy Access Hinged Panels + Non-powered 115v C.O. + SA Smoke detector CH = Easy Access Hinged Panels + SA Smoke detector Factory Installed Options														
A = Aluminum / Copper Cond & Alum/Copper Evap Coil B = Pre-coat Alum/Copper Cond & Alum / Copper Evap (3 phase only) C = E-Coated Alum/Copper Cond & Alum / Copper Evap (3 phase only) D = E-Coated Alum/Copper Cond & E-Coated Alum/Copper Evap (3 phase only) E = Copper/Copper Cond & Alum/Copper Evap (3 phase only) F = Copper/Copper Cond & Copper/Copper Evap (3 phase only) Condenser / Evaporator Coil Configuration														
A = Original Design Sales Digit														

Table 1 – FACTORY INSTALLED OPTIONS AND FIELD INSTALLED ACCESSORIES

CATEGORY	ITEM	FACTORY INSTALLED OPTION	FIELD INSTALLED ACCESSORY
Cabinet	Thru-the-base electrical connections		X
	Hinged Access Panels	X	
	Supply duct kit - Horizontal air applications only (10 Ton)		X
Coil Options	Copper/Copper indoor and/or outdoor coils	X (3 phase only)	
	Pre-coated outdoor coils	X (3 phase only)	
	Premium, E-coated outdoor coils	X (3 phase only)	
Condenser Protection	Condenser coil hail guard (louvered design)	X	X
Controls	Temperature sensors		X
	Smoke detector (supply air)	X	
	Time Guard II compressor delay control circuit		X
	Phase Monitor		X
Economizers & Outdoor Air Dampers	Economizer (for electro-mechanical controlled RTUs)	X (3 phase only)	X
	Motorized 2 position outdoor-air damper	X	X
	Manual outdoor-air damper		X
	Barometric relief ¹	X	X
	Power exhaust		X
Economizer Sensors & IAQ Devices	Single dry bulb temperature sensors ²	X	X
	Differential dry bulb temperature sensors ²		X
	Single enthalpy sensors ²	X	X
	Differential enthalpy sensors ²		X
	CO ₂ sensor (wall, duct, or unit mounted) ²		X
Electric Heat	Electric Heaters		X
	Single Point Kit		X
Indoor Motor & Drive	Multiple motor and drive packages	X	
Low Ambient Control	Motormaster head pressure controller ³		X
Power Options	Convenience outlet (unpowered)	X	
	Non-fused disconnect	X	
Roof Curbs	Roof curb 14" (356mm)		X
	Roof curb 24" (610mm)		X

NOTES:

1. Included with economizer.
2. Sensors used to optimize economizer performance.
3. See application data for assistance.

FACTORY OPTIONS AND/OR ACCESSORIES

Economizer (dry-bulb or enthalpy)

Economizers bring in fresh, outside air for ventilation; and provide cool, outside air to cool your building. This is the preferred method of low-ambient cooling. When coupled to CO₂ sensors, Economizers can provide even more savings by coupling the ventilation air to only that amount required based on occupancy.

Economizers are available, installed and tested by the factory (3 phase only), with either enthalpy or dry-bulb temperature inputs. There are also models for electromechanical as well as direct digital controllers. Additional sensors are available as accessories to optimize the economizers.

Economizers include gravity controlled, barometric relief which equalizes building pressure and ambient air pressures. This can be a cost effective solution to prevent building pressurization.

CO₂ Sensor

Improves productivity and saves money by working with the economizer to intake only the correct amount of outside air for ventilation. As occupants fill your building, the CO₂ sensor detects their presence through increasing CO₂ levels, and opens the economizer appropriately.

When the occupants leave, the CO₂ levels decrease, and the sensor appropriately closes the economizer. This intelligent control of the ventilation air, called Demand Control Ventilation (DCV) reduces the overall load on the rooftop, saving money. CO₂ sensors are available with the economizer, installed and tested by the factory.

Smoke Detectors (Optional)

Smoke detectors immediately shut down the rooftop unit when smoke is detected. They are available, installed by the factory for supply air.

Louvered Hail Guards

Sleek, accessory louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact.

Convenience Outlet (Unpowered)

Installed at the factory, unpowered. Provides a convenient, 15 amp, 115v GFCI receptacle.

Non-fused Disconnect

This OSHA-compliant, factory-installed, safety switch allows a service technician to locally secure power to the rooftop.

Power Exhaust

Superior internal building pressure control. This field-installed accessory may eliminate the need for costly, external pressure control fans.

Time Guard II Control Circuit

This accessory protects your compressor by preventing short-cycling in the event of some other failure, prevents the compressor from restarting for 30 seconds after stopping.

Motorized 2-Position Damper

A 2-position, motorized outdoor air damper is available factory installed and admits up to 100% outside air. Using reliable, gear-driven technology, the 2-position damper opens to allow ventilation air and closes when the rooftop stops, stopping unwanted infiltration.

Manual OA Damper

Accessory manual outdoor air dampers are an economical way to bring in ventilation air.

Hinged Access Panels

Allows access to unit's major components with specifically designed hinged access panels. Panels are: filter, control box, fan motor and compressor.

Head Pressure Controller

The motor controller is a low ambient, head pressure controller kit that is designed to maintain the unit's condenser head pressure during periods of low ambient cooling operation. This device should be used as an alternative to economizer free cooling not when economizer usage is either not appropriate or desired. The controller will either cycle the outdoor-fan motors or operate them at reduced speed to maintain the unit operation, depending on the model.

Alternate Motors and Drives

Some applications need larger horsepower motors, some need more airflow, and some need both. A wide selection of motors and pulleys (drives) are available, factory installed, to handle nearly any application.

Thru-the-Base Connections

Thru-the-base connections, available as an accessory are necessary to ensure proper connection and seal when routing wire through the rooftop's basepan and curb. These couplings eliminate roof penetration and should be considered for main power lines, as well as control power.

Electric Heaters

A full-line of field-installed accessory heaters are available. The heaters are very easy to use, install and are pre-engineered and certified.

ACCESSORIES - RHH036-120

FLAT ROOF CURBS		
Model Number	Description	Use With Model Size
CRRFCURB001A01	14" High Roof Curb. Ductwork attaches to the roof curb. Includes thru-the-bottom capability.	036 - 060
CRRFCURB003A01	14" High Roof Curb. Ductwork attaches to the roof curb. Includes thru-the-bottom capability.	072 - 102
CRRFCURB072A00	14" High Roof Curb. Ductwork attaches to the roof curb. Includes thru-the-bottom capability.	120
CRRFCURB002A01	24" High Roof Curb. Ductwork attaches to the roof curb. Includes thru-the-bottom capability.	036 - 060
CRRFCURB004A01	24" High Roof Curb. Ductwork attaches to the roof curb. Includes thru-the-bottom capability.	072 - 102
CRRFCURB073A00	24" High Roof Curb. Ductwork attaches to the roof curb. Includes thru-the-bottom capability.	120

ECONOMIZERS		
Model Number	Description	Use With Model Size
DNECOMZR020A02	Vertical EconoMi\$er IV with solid-state controller, gear-driven, 3-position modulating damper, spring return actuator, up to 100% barometric relief, supply and outdoor air sensors, and CO2 sensor compatible.	036 - 060
DNECOMZR021A03		072 - 102
DNECOMZR062A00	Vertical EconoMi\$er IV with solid-state controller, gear-driven, modulating damper, spring return actuator, up to 100% barometric relief, supply and outdoor air sensors, and CO2 sensor compatible.	120
DNECOMZR024A02	Horizontal EconoMi\$er IV with solid-state controller, gear-driven, 3-position modulating damper, spring return actuator, up to 100% barometric relief, supply and outdoor air sensors, and CO2 sensor compatible.	036 - 060
DNECOMZR025A02		090 - 102
DNECOMZR064A00	Horizontal EconoMi\$er IV with solid-state controller, gear-driven, modulating damper, spring return actuator, up to 100% barometric relief, supply and outdoor air sensors, and CO2 sensor compatible.	120

POWER EXHAUST		
Model Number	Description	Use With Model Size
DNPWREXH030A01	Vertical Power Exhaust 208/230 volt (1 or 3 Phase)	036 - 060
DNPWREXH021A01	Vertical Power Exhaust 460 volt	036 - 060
DNPWREXH022A01	Vertical Power Exhaust 208/230 volt	072 - 102
DNPWREXH023A01	Vertical Power Exhaust 460 volt	072 - 102
DNPWREXH080A00	Vertical Power Exhaust 208/230 volt	120
DNPWREXH081A00	Vertical Power Exhaust 460 volt	120
DNPWREXH028A01	Horizontal Power Exhaust 208/230 (1 or 3 Phase) & 575 volt	036 - 102
DNPWREXH029A01	Horizontal Power Exhaust 460 volt	036 - 102
DNPWREXH082A00	Horizontal Power Exhaust 208/230 & 575 volt	120
DNPWREXH083A00	Horizontal Power Exhaust 460 volt	120

NOTES:

Horizontal Power Exhaust should be duct-mounted in the return duct.

Horizontal Power Exhaust package includes exhaust hood, screens, and propeller fan system.

575V TRANSFORMER		
Model Number	Description	Use With Model Size
1171494 ²	Transformer for conversion from 575v to 208/230v power exhaust applications.	036 - 120

² Available from Fast parts.

ACCESSORIES - RHH036-120 (cont.)

MANUAL OUTDOOR AIR DAMPERS		
Model Number	Description	Use With Model Size
CRMANDPR001A03	25% Open Manual Fresh Air Damper	036 - 060
CRMANDPR001A02	50% Open Manual Fresh Air Damper	036 - 060
CRMANDPR002A03	25% Open Manual Fresh Air Damper	072 - 102
CRMANDPR002A02	50% Open Manual Fresh Air Damper	072 - 102
CRMANDPR011A02	50% Open Manual Fresh Air Damper	120
MOTORIZED OUTDOOR AIR DAMPERS		
Model Number	Description	Use With Model Size
CRTWOPOS010A00	Motorized 2 position outdoor air damper (25-100% Outdoor Air)	036 - 060
CRTWOPOS011A00	Motorized 2 position outdoor air damper	072 - 102
CRTWOPOS014A00	Motorized 2 position outdoor air damper	120
SPECIAL - 120 SIZE SPECIFIC ACCESSORIES		
Model Number	Description	Use With Model Size
CRDISBKT001A00	Disconnect Switch Bracket - Provides a pre engineered and sized mounting bracket for applications requiring a unit mounted fused disconnect of greater than 100 amps. Bracket assures that no damage will occur to coils when mounting with screws and other fasteners.	120
CRDUCTCV001A00	Supply Duct Cover - This supply duct cover is required when field converting the factory standard vertical duct supply to horizontal duct supply configuration. One required per unit.	120
THROUGH-THE-BOTTOM/CURB POWER CONNECTION		
Model Number	Description	Use With Model Size
CRBTMPWR001A01	Thru-the-bottom electrical connections and thru-the-curb gas connections. Includes a 3/4-inch diameter liquid tight conduit fitting for high voltage power wires	036 - 060
CRBTMPWR002A01	Thru-the-bottom electrical connections and thru-the-curb gas connections. Includes a 1-1/4-inch diameter liquid tight conduit fitting for high voltage power wires	072 - 102
CRBTMPWR003A01	Thru-the-bottom power, control, and gas connections. Includes a 3/4-inch diameter liquid tight conduit fitting for high voltage power wires	036 - 060
CRBTMPWR004A01	Thru-the-bottom power, control, and gas connections. Includes a 1-1/4-inch diameter liquid tight conduit fitting for high voltage power wires	072 - 102
CRBTMPWR005A00	Thru-the-bottom power, control, and gas connections. Includes a 1-1/4 inch diameter liquid tight conduit fitting for high voltage power wires	120
CRBTMPWR006A00	Thru-the-bottom power, control, and gas connections. Includes a 1-1/2 inch diameter liquid tight conduit fitting for high voltage power wires	
CRBTMPWR007A00	Thru-the-bottom power, control, and gas connections. Includes a 2 inch diameter liquid tight conduit fitting for high voltage power wires	

ACCESSORIES - RHH036-120

ECONOMIZER SENSORS		
Model Number	Description	Use With Model Size
DNTEMPSN002A00	Outdoor or Return Dry Bulb Temperature Sensor used with Electro-Mechanical control.	ALL Economizers
DNCBDIOX005A00	CO ₂ Sensor for use in return airstream. Also includes Aspirator Box required for Duct Mounting.	ALL Economizers
DNENTDIF004A00	Return Air Enthalpy Sensor used with Electro-Mechanical controls, use with AXB078ENT for differential enthalpy control.	ALL Economizers
AXB078ENT	Economizer Differential Enthalpy Control Upgrade	ALL Economizers
CONTROL UPGRADE KITS		
Model Number	Description	Use With Model Size
NRTIMEGD001A00	Time Guard II	036 - 120
CRPHASE3001A02	Phase Monitor Control	All 208/230v, 460v (3 Ph only)
CRPHASE3002A00	Phase Monitor Control	All 575v
1178184	Remote keyed attenuator / test / reset station for use with factory-installed smoke detectors. Includes power, alarm & trouble indicator lights.	036 - 120
LOW AMBIENT CONTROLS*		
Model Number	Description	Use With Model Size
32LT900301 ¹	Motormaster I -20°F (-29°C) Low Ambient Control 208/230-1-60, 208/203-3-60, 575-3-60	036 - 102
32LT900611 ¹	Motormaster I -20°F (-29°C) Low Ambient Control 460-3-60	036 - 102
1178185 ²	Motormaster I Compatible Condenser Fan Motor, 208/230-1-60, 208/230-3-60, 575-3-60	036
1178186 ²	Motormaster I Compatible Condenser Fan Motor, 460-3-60	036
1171974 ²	Motormaster I Compatible Condenser Fan Motor, 208/230-3-60, 575-3-60	048 - 090
1171975 ²	Motormaster I Compatible Condenser Fan Motor, 460-3-60	048 - 090
CRLOWAMB030A00 ³	Motormaster® V Low Ambient Control Mechanical cooling operation down to -20°F (-29°C)	102, 208/230-3-60
CRLOWAMB031A00 ³		102, 460-3-60
CRLOWAMB032A00 ³		102, 575-3-60
CRLOWAMB039A00	Motormaster I Low Ambient Kit. Mechanical cooling operation down to -20° F (- 29° C). Kit includes 3 motors, MotorMaster controller, wiring label, and required wire ties and connectors, DNWINSTR001A00 also required (one per refrigerant circuit), 208/230-3-60.	120
CRLOWAMB040A00	Motormaster I Low Ambient Kit. Mechanical cooling operation down to -20° F (- 29° C). Kit includes 3 motors, MotorMaster controller, wiring label, and required wire ties and connectors) 575 Volt models also require CRTRXKIT002A00 plus DNWINSTR001A00 also required (one per refrigerant circuit), 460-3-60 and 575-3-60.	120
CRWHPKT001A00	Low Ambient Heat Pump Relay Kit - This kit provides the necessary relay and hardware required for heat pump duty MotorMaster I operation. Typically a separate field installed relay and relay base, now all combined into one. All voltages.	120
CRTRXKIT001A00	Motormaster I Low Ambient Control - Transformer Kit. Must be used in conjunction with Low Ambient Controller if used on 575-3-60 volt models, 575-3-60.	120

*See usage tables in kit instructions.

¹ Requires motor change out.

² Available from FAST Parts.

Note: Sizes 036-072 requires (1) low ambient controller and (1) compatible condenser fan motor for change out

Sizes 090 requires (1) low ambient controller and (2) compatible condenser fan motors for change out

³ No motor change is required on these specific models.

ACCESSORIES - RHH036-120 (cont.)

ACCESSORY KITS FOR UNITS WITH HINGED ACCESS PANELS		
Model Number	Description	Use With Model Size
DNHNGPNL001A00	Horizontal accessory kit. Required when field installing a two position damper or vertical economizer. Includes angle and seal strip.	036 - 060
DNHNGPNL002A00		072 - 102
DNPECONV003A00	Vertical accessory kit. Required when field installing a two position damper or vertical economizer. Includes door panel, angle and seal strip	036 - 060
DNPECONV004A00		072 - 102
LOUVERED HAIL GUARDS – CONDENSER COIL		
Model Number	Description	Use With Model Size
CRLVHLGD012A00	Louvered Condenser Coil Hail Guard – Includes louvered panel(s) to protect condenser coil from damage and vandalism.	036
CRLVHLGD013A00		048 - 060
CRLVHLGD014A00		072
CRLVHLGD016A00		090 - 102
CRLVHLGD032A00		120

See pages 14 to 20 for Electric heater and single point wiring kit models and usage.

Table 2 – AHRI COOLING RATING TABLE

UNIT RHH	NOM. CAPACITY (TONS)	NET COOLING CAPACITY (BTUH)	TOTAL POWER (KW)	SEER	EER	IEER
036	3	36,400	2.8	15.6	12.7	N/A
048	4	47,000	3.6	15.8	12.8	N/A
060	5	58,500	4.6	15.0	12.5	N/A
072	6	72,000	6.0	N/A	12.0	12.8
090	7.5	90,000	7.4	N/A	12.1	12.8
102	8.5	100,000	8.3	N/A	12.0	12.5
120	10	119,000	9.8	N/A	12.3	13.0

NOTE:

All AHRI ratings are based on 230, 460 and 575 volt.

* Electric Drive (direct drive) ECM 5 speed/torque motor. SEER rating is 13.0 for belt drive.

NA Not applicable

Table 2 - AHRI HEATING TABLE

UNIT RHH	HSPF	HEATING LOW		HEATING HIGH	
		CAPACITY (BTUH)	COP	CAPACITY (BTUH)	COP
036	8.0	18,400	N/A	34,000	N/A
048	8.1	23,800	N/A	46,000	N/A
060	8.2	28,600	N/A	55,000	N/A
072	N/A	39,000	2.40	70,000	3.40
090	N/A	47,000	2.40	84,000	3.50
102	N/A	56,000	2.26	100,000	3.40
120	N/A	65,000	2.26	116,000	3.50

LEGEND

- AHRI - Air-Conditioning, Heating & Refrigeration Institute
- ASHRAE - American Society of Heating, Refrigerating and Air Conditioning, Inc.
- EER - Energy Efficiency Ratio
- IEER - Integrated Energy Efficiency Ratio
- SEER - Seasonal Energy Efficiency Ratio
- COP - Coefficient of Performance

NOTES:

1. Rated and certified under AHRI Standard 210/240-06 or 340/360-04, as appropriate.
2. Ratings are based on:
 - Cooling Standard:** 80°F (27°C) db, 67°F (19°C) wb indoor air temp and 95°F (35°C) db outdoor air temp.
 - IEER Standard:** A measure that expresses cooling part-load EER efficiency for commercial unitary air conditioning and heat pump equipment on the basis of weighted operation at variable load capacities.
3. All RHH units comply with ASHRAE 90.1 2001, 2004 Energy Standard for minimum SEER and EER requirements.



Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to www.ahridirectory.org.



Table 3 – MINIMUM - MAXIMUM AIRFLOWS ELECTRIC HEAT

UNIT RHH	COOLING		ELECTRIC HEATERS	
	Minimum	Maximum	Minimum	Maximum
036	900	1500	900	1500
048	1200	2000	1200	2000
060	1500	2500	1500	2500
072	1800	3000	1800	3000
090	2250	3750	2250*	3750
102	2550	4250	2552*	4250
120	3000	5000	3000*	5000

***Minimum electric heat CFM exceptions:**

UNIT RHH	UNIT VOLTAGE	HEATER kW	UNIT CONFIGURATION	REQUIRED MINIMUM CFM
090 - 102	575	17.0	Horizontal or Vertical	2800
		34.0		2350
120	230	50.0	Vertical	3550
			Horizontal	3420
		43.5	Horizontal or Vertical	3040
	575	50.0	Vertical	3150
		33.5		3520
		26.5	Horizontal	3420
		Vertical	3610	

Table 4 – SOUND PERFORMANCE TABLE

UNIT RHH	OUTDOOR SOUND (dB)								
	A-Weighted	63	125	250	500	1000	2000	4000	8000
036	76	51.8	69.0	64.6	67.8	70.7	63.8	60.9	59.0
048	79	56.1	69.6	68.7	72.5	72.8	68.9	65.0	61.2
060	79	57.7	66.6	68.7	72.9	74.5	71.1	67.6	62.6
072	81	86.7	82.7	79.1	78.4	75.4	71.2	67.8	62.9
090	83	87.3	81.6	79.7	80.6	79.0	73.5	69.2	66.1
102	87	61.7	74.7	77.4	82.6	84.9	81.9	78.8	75.9
120	83	61.0	67.3	75.1	77.7	78.1	75.5	71.2	66.7

LEGEND

dB - Decibel

NOTES:

1. Outdoor sound data is measure in accordance with AHRI standard 270-95.
2. Measurements are expressed in terms of sound power. Do not compare these values to sound pressure values because sound pressure depends on specific environmental factors which normally do not match individual applications. Sound power values are independent of the environment and therefore more accurate.
3. A-weighted sound ratings filter out very high and very low frequencies, to better approximate the response of "average" human ear. A-weighted measurements are taken in accordance with AHRI standard 270-95.

Table 5 – PHYSICAL DATA (COOLING) 3 - 6 TONS

	RHH	036	048	060	072
Refrigeration System					
# Circuits / # Comp. / Type		1 / 1 / Scroll	1 / 1 / Scroll	1 / 1 / Scroll	1 / 1 / Scroll
Refrig. charge per circuit A/B(lbs-oz)		12 - 8 / -	15 - 8 / -	17 - 8 / -	15 - 8 / -
Metering Device		TXV	TXV	TXV	TXV
High pressure Trip / Reset (psig)		630 / 505	630 / 505	630 / 505	630 / 505
Loss of Charge Press. Trip / Reset (psig)		27 / 44	27 / 44	27 / 44	27 / 44
Compressor Capacity Staging (%)		100	100	100	100
Evap. Coil					
Material - Tube / Fin		Cu / Al	Cu / Al	Cu / Al	Cu / Al
Coil type		3/8" RTPF	3/8" RTPF	3/8" RTPF	3/8" RTPF
Rows / FPI		3 / 15	3 / 15	4 / 15	3 / 15
Total Face Area (ft ²)		5.5	7.3	7.3	8.9
Condensate Drain Conn. Size		3/4"	3/4"	3/4"	3/4"
Evap. Fan and Motor					
Standard Static 1 phase	Motor Qty / Drive Type	1 / Direct	1 / Direct	1 / Direct	N/A
	Max BHP	1.0	1.0	1.0	N/A
	RPM Range	600-1200	600-1200	600-1200	N/A
	Motor Frame Size	48	48	48	N/A
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	N/A
	Fan Diameter x Length (in)	10 x 10	10 x 10	11 x 10	N/A
Standard Static 3 phase	Motor Qty / Drive Type	1 / Direct	1 / Direct	1 / Direct	1 / Belt
	Max BHP	1.0	1.0	1.0	1.2
	RPM Range	600-1200	600-1200	600-1200	489-747
	Motor Frame Size	48	48	48	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter x Length (in)	10 x 10	10 x 10	11 x 10	15 x 15
Medium Static 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	1.5	1.5	2.0	2.9
	RPM Range	819-1251	920-1303	1066-1380	733-949
	Motor Frame Size	56	56	56	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter x Length (in)	10 x 10	10 x 10	10 x 10	15 x 15
High Static 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	2.0	2.0	2.9	4.0
	RPM Range	1035-1466	1035-1466	1208-1639	909-1102
	Motor Frame Size	56	56	56	145
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter x Length (in)	10 x 10	10 x 10	10 x 10	15 x 15
Cond. Coil					
Material - Tube / Fin		Cu / Al	Cu / Al	Cu / Al	Cu / Al
Coil type		3/8" RTPF	3/8" RTPF	3/8" RTPF	3/8" RTPF
Rows / FPI		2 / 17	2 / 17	2 / 17	2 / 17
Total Face Area (ft ²)		16.5	21.3	21.3	20.5
Cond. fan / motor					
Qty / Motor Drive Type		1 / direct	1 / direct	1 / direct	2 / direct
Motor HP / RPM		1/8 / 825	1/4 / 1100	1/4 / 1100	1/4 / 1100
Fan diameter (in)		22	22	22	22
Filters					
RA Filter # / Size (in)		2 / 16 x 25 x 2	4 / 16 x 16 x 2	4 / 16 x 16 x 2	4 / 16 x 20 x 2
OA inlet screen # / Size (in)		1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 20 x 36 x 1

Table 6 – PHYSICAL DATA (COOLING) 7.5 - 10 TONS

	RHH	090	102	120
Refrigeration System				
# Circuits / # Comp. / Type		2 / 2 / Scroll	2 / 2 / Scroll	2 / 2 / Scroll
Refrig. charge per circuit A/B (lbs-oz)		11 - 12 / 11 - 12	14-1/14-4	16-3/17-3
Metering Device		TXV	TXV	TXV
High pressure Trip / Reset (psig)		630 / 505	630 / 505	630 / 505
Loss of Charge Press. Trip / Reset (psig)		27 / 44	27 / 44	27 / 44
Compressor Capacity Staging (%)		50 / 100	50 / 100	50 / 100
Evap. Coil				
Material - Tube / Fin		Cu / Al	Cu / Al	Cu / Al
Coil type		3/8" RTPF	3/8" RTPF	3/8" RTPF
Rows / FPI		4 / 15	4 / 15	3 / 15
Total Face Area (ft ²)		11.1	11.1	17.3
Condensate Drain Conn. Size		3/4"	3/4"	3/4"
Evap. Fan and Motor				
Standard Static 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	1 / Belt
	Max BHP	1.2	1.2	2.4
	RPM Range	518-733	460-652	440-609
	Motor Frame Size	56	56	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter x Length (in)	15 x 15	15 x 15	18 x 18
Medium Static 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	1 / Belt
	Max BHP	1.7	2.9	2.9
	RPM Range	690-936	591-838	547-757
	Motor Frame Size	56	56	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter x Length (in)	15 x 15	15 x 15	18 x 18
High Static 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	N/A
	Max BHP	2.8	2.9	N/A
	RPM Range	838-1084	838-1084	N/A
	Motor Frame Size	56	56	N/A
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	N/A
	Fan Diameter x Length (in)	15 x 15	15 x 15	N/A
High Static High Efficiency 3 phase*	Motor Qty / Drive Type	N/A	N/A	1 / Belt
	Max BHP	N/A	N/A	6.1
	RPM Range	N/A	N/A	762-963
	Motor Frame Size	N/A	N/A	S184T
	Fan Qty / Type	N/A	N/A	1 / Centrifugal
	Fan Diameter x Length (in)	N/A	N/A	18 x 18
Cond. Coil				
Material - Tube / Fin		Cu / Al	Cu / Al	Cu / Al
Coil type		3/8" RTPF	3/8" RTPF	3/8" RTPF
Rows / FPI		2 / 17	3 / 17	2 / 17
Total Face Area (ft ²)		25.1	25.1	46.2
Cond. fan / motor				
Qty / Motor Drive Type		2 / direct	1 / direct	3 / direct
Motor HP / RPM		1/4 / 1100	1 / 1175	1 / 1100
Fan diameter (in)		22	30	22
Filters				
RA Filter # / Size (in)		4 / 20 x 20 x 2	4 / 20 x 20 x 2	6 / 18 x 24 x 2 2 / 24 x 27 x 1 (Vert) 1 / 30 x 39 x 1 (Horiz)
OA inlet screen # / Size (in)		1 / 20 x 24 x 1	1 / 20 x 24 x 1	

* Section 313 of the Energy Independence and Security Act of 2007 (EISA 2007) mandates that the efficiency of general purpose motors used in Light Commercial Rooftops rated at 5.0 HP and larger be increased on or after December 19, 2010.

Table 7 – ELECTRIC HEAT - ELECTRICAL DATA, 3 TONS

UNIT RHH	NOM. V-PH-HZ	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXA00	
						WITHOUT C.O. or UNPWRD C.O.	
						WITHOUT P.E.	WITH P.E.
036	208/230-1-60	STD DD	101A00	4.4	3.3/4.0	037	037
			102A00	6.5	4.9/6.0	040	040
			103B00	8.7	6.5/8.0	040	040
			104B00	10.5	7.9/9.6	040	040
			102A00,102A00	13.0	9.8/11.9	041	041
	208/230-3-60	STD DD	101A00	4.4	3.3/4.0	-	-
			102A00	6.5	4.9/6.0	-	-
			103B00	8.7	6.5/8.0	-	-
			104B00	10.5	7.9/9.6	037	037
			105A00	16.0	12.0/14.7	038	038
		MED	101A00	4.4	3.3/4.0	-	-
			102A00	6.5	4.9/6.0	-	-
			103B00	8.7	6.5/8.0	-	-
			104B00	10.5	7.9/9.6	037	037
			105A00	16.0	12.0/14.7	038	038
		HIGH	101A00	4.4	3.3/4.0	-	-
			102A00	6.5	4.9/6.0	-	-
			103B00	8.7	6.5/8.0	-	-
			104B00	10.5	7.9/9.6	037	037
			105A00	16.0	12.0/14.7	038	038
	460-3-60	STD DD	106A00	6.0	5.5	-	-
			107A00	8.8	8.1	-	-
			108A00	11.5	10.6	-	-
			109A00	14.0	12.9	-	-
MED		106A00	6.0	5.5	-	-	
		107A00	8.8	8.1	-	-	
		108A00	11.5	10.6	-	-	
		109A00	14.0	12.9	-	-	
HIGH		106A00	6.0	5.5	-	-	
		107A00	8.8	8.1	-	-	
		108A00	11.5	10.6	-	-	
		109A00	14.0	12.9	-	-	

- No Single Point Kit required

LEGEND

- APP PWR - 208 / 230V / 460V / 575V
- BD - Belt drive motor
- C.O. - Convenience outlet
- DD - Electric Drive ECM 5 speed/torque motor
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- UNPWRD - Unpowered convenient outlet

Table 6 - (cont.) ELECTRIC HEAT - ELECTRIC DATA 4 TONS

UNIT RHH	NOM. V - PH - HZ	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXA00	
						WITHOUT C.O. or UNPWRD C.O.	
						WITHOUT P.E.	WITH P.E.
048	208/230-1-60	STD DD	101A00	4.4	3.3/4.0	037	037
			103B00	8.7	6.5/8.0	040	040
			102A00,102A00	13.0	9.8/11.9	041	041
			103B00,103B00	17.4	13.1/16.0	041	041
			104B00,104B00	21.0	15.8/19.3	041	041
	208/230-3-60	STD DD	102A00	6.5	4.9/6.0	-	-
			103B00	8.7	6.5/8.0	037	037
			105A00	16.0	12.0/14.7	038	038
			104B00,104B00	21.0	15.8/19.3	039	039
		MED	102A00	6.5	4.9/6.0	-	-
			103B00	8.7	6.5/8.0	-	037
			105A00	16.0	12.0/14.7	038	038
			104B00,104B00	21.0	15.8/19.3	039	039
		HIGH	102A00	6.5	4.9/6.0	-	-
			103B00	8.7	6.5/8.0	-	037
			105A00	16.0	12.0/14.7	038	038
			104B00,104B00	21.0	15.8/19.3	039	039
	460-3-60	STD DD	106A00	6.0	5.5	-	-
			108A00	11.5	10.6	-	-
			109A00	14.0	12.9	-	-
			108A00,108A00	23.0	21.1	037	037
		MED	106A00	6.0	5.5	-	-
			108A00	11.5	10.6	-	-
			109A00	14.0	12.9	-	-
108A00,108A00			23.0	21.1	037	037	
HIGH		106A00	6.0	5.5	-	-	
		108A00	11.5	10.6	-	-	
		109A00	14.0	12.9	-	-	
		108A00,108A00	23.0	21.1	037	037	

- No Single Point Kit required

LEGEND

- APP PWR - 208 / 230V / 460V / 575V
- BD - Belt drive motor
- C.O. - Convenience outlet
- DD - Electric Drive ECM 5 speed/torque motor
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- UNPWRD - Unpowered convenient outlet

Table 6 - (cont.) ELECTRIC HEAT - ELECTRIC DATA 5 TONS

UNIT RHH	NOM. V - PH - HZ	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXA00	
						WITHOUT C.O. or UNPWRD C.O.	
						WITHOUT P.E.	WITH P.E.
060	208/230-1-60	STD DD	102A00	6.5	4.9/6.0	040	040
			103B00	8.7	6.5/8.0	040	040
			102A00,102A00	13.0	9.8/11.9	041	041
			103B00,103B00	17.4	13.1/16.0	041	041
			104B00,104B00	21.0	15.8/19.3	041	041
	208/230-3-60	STD DD	102A00	6.5	4.9/6.0	-	-
			104B00	10.5	7.9/9.6	038	038
			105A00	16.0	12.0/14.7	038	038
			104B00,104B00	21.0	15.8/19.3	039	039
			104B00,105A00	26.5	19.9/24.3	039	039
		MED	102A00	6.5	4.9/6.0	-	-
			104B00	10.5	7.9/9.6	037	037
			105A00	16.0	12.0/14.7	038	038
			104B00,104B00	21.0	15.8/19.3	039	039
		HIGH	104B00,105A00	26.5	19.9/24.3	039	039
			102A00	6.5	4.9/6.0	-	-
			104B00	10.5	7.9/9.6	038	038
	105A00		16.0	12.0/14.7	038	038	
	460-3-60	STD DD	104B00,104B00	21.0	15.8/19.3	039	039
			104B00,105A00	26.5	19.9/24.3	039	039
			106A00	6.0	5.5	-	-
			108A00	11.5	10.6	-	-
			109A00	14.0	12.9	-	-
		MED	108A00,108A00	23.0	21.1	037	037
108A00,109A00			25.5	23.4	037	037	
106A00			6.0	5.5	-	-	
108A00			11.5	10.6	-	-	
109A00			14.0	12.9	-	-	
HIGH		108A00,108A00	23.0	21.1	037	037	
		108A00,109A00	25.5	23.4	037	037	
		106A00	6.0	5.5	-	-	
	108A00	11.5	10.6	-	-		
		109A00	14.0	12.9	-	-	
		108A00,108A00	23.0	21.1	037	037	
		108A00,109A00	25.5	23.4	037	037	

- No Single Point Kit required

LEGEND

- APP PWR - 208 / 230V / 460V / 575V
- C.O. - Convenience outlet
- FLA - Full load amps
- DD - Electric Drive ECM 5 speed/torque motor
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- UNPWRD - Unpowered convenient outlet

Table 6 - (cont.) ELECTRIC HEAT - ELECTRIC DATA 6 TONS

UNIT RHH	NOM. V - PH - HZ	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXA00	
						WITHOUT C.O. or UNPWRD C.O.	
						WITHOUT P.E.	WITH P.E.
072	208/230-3-60	STD	264A00	6.5	4.9/6.0	042	042
			117A00	10.4	7.8/9.6	043	043
			110A00	16.0	12.0/14.7	043	043
			117A00,117A00	21.0	15.8/19.3	045	045
			110A00,117A00	26.5	19.9/24.3	045	045
		MED	264A00	6.5	4.9/6.0	042	042
			117A00	10.4	7.8/9.6	043	043
			110A00	16.0	12.0/14.7	043	043
			117A00,117A00	21.0	15.8/19.3	045	045
	HIGH	110A00,117A00	26.5	19.9/24.3	045	045	
		264A00	6.5	4.9/6.0	045	045	
		117A00	10.4	7.8/9.6	043	043	
		110A00	16.0	12.0/14.7	043	043	
		117A00,117A00	21.0	15.8/19.3	045	045	
	460-3-60	STD	110A00,117A00	26.5	19.9/24.3	045	045
			265A00	6.0	5.5	042	042
			266A00	11.5	10.6	042	042
			267A00	14.0	12.9	042	042
268A00			23.0	21.1	042	042	
MED		269A00	25.5	23.4	042	042	
		265A00	6.0	5.5	042	042	
		266A00	11.5	10.6	042	042	
		267A00	14.0	12.9	042	042	
		268A00	23.0	21.1	042	042	
HIGH		269A00	25.5	23.4	042	042	
		265A00	6.0	5.5	042	042	
		266A00	11.5	10.6	042	042	
		267A00	14.0	12.9	042	042	
		268A00	23.0	21.1	042	042	
		269A00	25.5	23.4	042	048	

LEGEND

- APP PWR - 208 / 230V / 460V / 575V
- C.O. - Convenience outlet
- DD - Electric Drive ECM 5 speed/torque motor
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- UNPWRD - Unpowered convenient outlet

Table 6 - (cont.) ELECTRIC HEAT - ELECTRIC DATA 7.5 TONS

UNIT RHH	NOM. V - PH - HZ	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXXA00	
						WITHOUT C.O. or UNPWRD C.O.	
						WITHOUT P.E.	WITH P.E.
090 (2-Stage Cool)	208/230-3-60	STD	117A00	10.4	7.8/9.6	049	049
			110A00	16.0	12.0/14.7	049	049
			111A00	24.8	18.6/22.8	051	051
			112A00	32.0	24.0/29.4	051	051
			112A00,117A00	42.4	31.8/38.9	053	053
		MED	117A00	10.4	7.8/9.6	049	049
			110A00	16.0	12.0/14.7	049	049
			111A00	24.8	18.6/22.8	051	051
			112A00	32.0	24.0/29.4	051	051
			112A00,117A00	42.4	31.8/38.9	053	053
		HIGH	117A00	10.4	7.8/9.6	049	049
			110A00	16.0	12.0/14.7	049	049
	111A00		24.8	18.6/22.8	051	051	
	112A00		32.0	24.0/29.4	051	051	
	112A00,117A00		42.4	31.8/38.9	053	053	
	460-3-60	STD	116A00	13.9	12.8	047	047
			113A00	16.5	15.2	047	047
			114A00	27.8	25.5	047	050
			115A00	33.0	30.3	050	050
			114A00,116A00	41.7	38.3	052	052
		MED	116A00	13.9	12.8	047	047
			113A00	16.5	15.2	047	047
			114A00	27.8	25.5	047	050
			115A00	33.0	30.3	050	050
			114A00,116A00	41.7	38.3	052	052
		HIGH	116A00	13.9	12.8	047	047
			113A00	16.5	15.2	047	047
	114A00		27.8	25.5	050	050	
115A00	33.0		30.3	050	050		
114A00,116A00	41.7		38.3	052	052		
575-3-60	STD	118A00	17.0	17.0	047	047	
		119A00	34.0	34.0	050	050	
	MED	118A00	17.0	17.0	047	047	
		119A00	34.0	34.0	050	050	
	HIGH	118A00	17.0	17.0	047	047	
		119A00	34.0	34.0	050	050	

LEGEND

- APP PWR - 208 / 230V / 460V / 575V
- C.O. - Convenience outlet
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- UNPWRD - Unpowered convenient outlet

Table 6 - (cont.) ELECTRIC HEAT - ELECTRIC DATA 8.5 TONS

UNIT RHH	NOM. V-PH-HZ	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXA00	
						WITHOUT C.O. or UNPWRD C.O.	
						WITHOUT P.E.	WITH P.E.
102 (2 Stage Cool)	208/230-3-60	STD	117A00	10.4	7.8/9.6	049	049
			110A00	16.0	12.0/14.7	049	049
			111A00	24.8	18.6/22.8	051	051
			112A00	32.0	24.0/29.4	051	051
			112A00,117A00	42.4	31.8/38.9	053	053
		MED	117A00	10.4	7.8/9.6	049	049
			110A00	16.0	12.0/14.7	049	049
			111A00	24.8	18.6/22.8	051	051
			112A00	32.0	24.0/29.4	051	051
			112A00,117A00	42.4	31.8/38.9	053	053
		HIGH	117A00	10.4	7.8/9.6	049	049
			110A00	16.0	12.0/14.7	049	049
	111A00		24.8	18.6/22.8	051	051	
	112A00		32.0	24.0/29.4	051	051	
	460-3-60	STD	116A00	13.9	12.8	047	047
			113A00	16.5	15.2	047	047
			114A00	27.8	25.5	050	050
			115A00	33.0	30.3	050	050
			114A00,116A00	41.7	38.3	052	052
		MED	116A00	13.9	12.8	047	047
			113A00	16.5	15.2	047	047
			114A00	27.8	25.5	050	050
			115A00	33.0	30.3	050	050
			114A00,116A00	41.7	38.3	052	052
HIGH		116A00	13.9	12.8	047	047	
		113A00	16.5	15.2	047	047	
	114A00	27.8	25.5	050	050		
	115A00	33.0	30.3	050	050		
575-3-60	STD	118A00	17.0	17.0	047	047	
		119A00	34.0	34.0	050	050	
	MED	118A00	17.0	17.0	047	047	
		119A00	34.0	34.0	050	050	
	HIGH	118A00	17.0	17.0	047	047	
		119A00	34.0	34.0	050	050	

LEGEND

- APP PWR - 208 / 230V / 460V / 575V
- C.O. - Convenience outlet
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- UNPWRD - Unpowered convenient outlet

Table 6 - (cont.) ELECTRIC HEAT - ELECTRIC DATA 10 TONS

Unit RHH	Nominal Volt-Ph-Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATERXXXXXX	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLEXXXA00	
						WITHOUT C.O. or UNPWRD C.O.	
						WITHOUT P.E.	WITH P.E.
120 2-Stage	208/230-3-60	STD	288A00	10.0	7.5/9.2	049	049
			291A00	16.5	12.4/15.2	049	049
			294A00	33.5	25.2/30.8	051	051
			288A00,294A00	43.5	32.7/40.0	053	053
			291A00,294A00	50.0	37.6/45.9	053	053
		MED	288A00	10.0	7.5/9.2	049	049
			291A00	16.5	12.4/15.2	049	049
			294A00	33.5	25.2/30.8	051	051
			288A00,294A00	43.5	32.7/40.0	053	053
			291A00,294A00	50.0	37.6/45.9	053	053
		HIGH - High Eff.	288A00	10.0	7.5/9.2	051	051
			291A00	16.5	12.4/15.2	051	051
	294A00		33.5	25.2/30.8	053	053	
	288A00,294A00		43.5	32.7/40.0	054	054	
	460-3-60	STD	289A00	10.0	9.2	047	047
			292A00	16.5	15.2	047	047
			295A00	33.5	30.8	050	050
			289A00,295A00	43.5	40.0	052	052
			292A00,295A00	50.0	45.9	052	052
		MED	289A00	10.0	9.2	047	047
			292A00	16.5	15.2	047	047
			295A00	33.5	30.8	050	050
			289A00,295A00	43.5	40.0	052	052
			292A00,295A00	50.0	45.9	052	052
HIGH - High Eff.		289A00	10.0	9.2	047	047	
		292A00	16.5	15.2	047	047	
	295A00	33.5	30.8	050	050		
	289A00,295A00	43.5	40.0	052	052		
575-3-60	STD	290A00	10.0	9.2	047	047	
		293A00	16.5	15.2	047	047	
		296A00	33.5	30.8	047	050	
		290A00,296A00	43.5	40.0	052	052	
		293A00,296A00	50.0	45.9	052	052	
	MED	290A00	10.0	9.2	047	047	
		293A00	16.5	15.2	047	047	
		296A00	33.5	30.8	047	050	
		290A00,296A00	43.5	40.0	052	052	
		293A00,296A00	50.0	45.9	052	052	
	HIGH - High Eff.	290A00	10.0	9.2	047	047	
		293A00	16.5	15.2	047	047	
296A00		33.5	30.8	050	050		
290A00,296A00		43.5	40.0	052	052		
293A00,296A00	50.0	45.9	052	052			








LEGEND

- APP PWR - 208 / 230V / 460V / 575V
- C.O. - Convenience outlet
- FLA - Full load amps
- IFM - Indoor fan motor
- NOM PWR - 240V / 480V / 600V
- P.E. - Power exhaust
- UNPWRD - Unpowered convenient outlet

BASE UNIT DIMENSIONS - RHH036-060

NOTES:


1. DIMENSIONS ARE IN INCHES, DIMENSIONS IN [] ARE IN MILLIMETERS.
2. CENTER OF GRAVITY
3. DIRECTION OF AIR FLOW

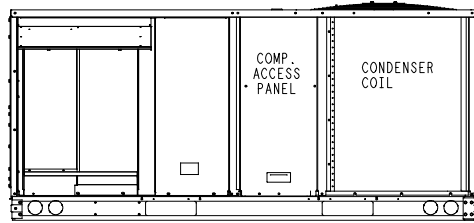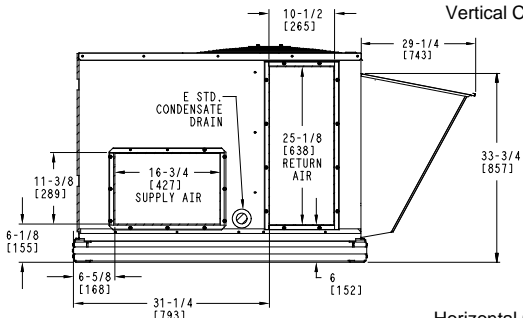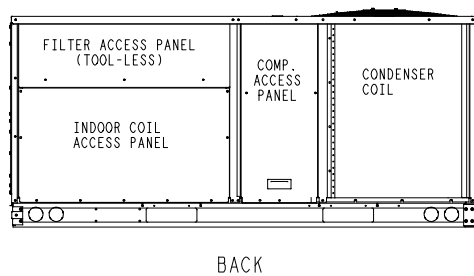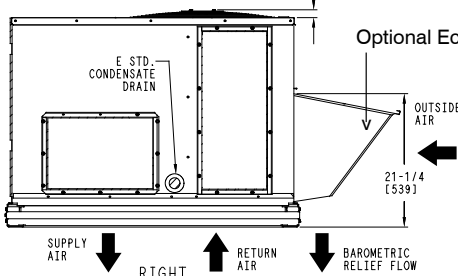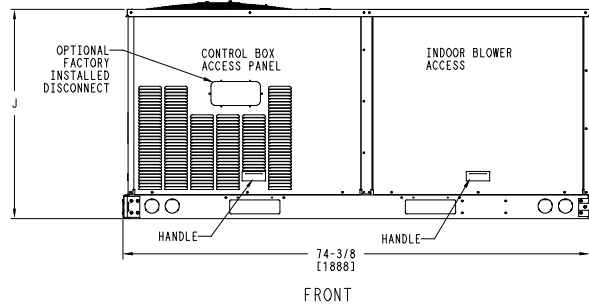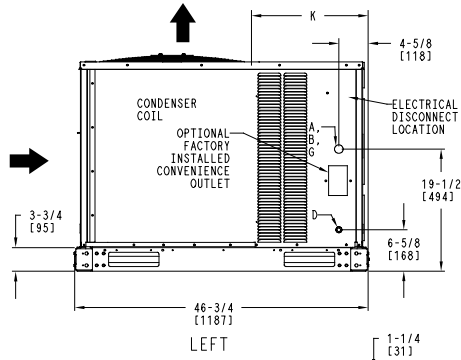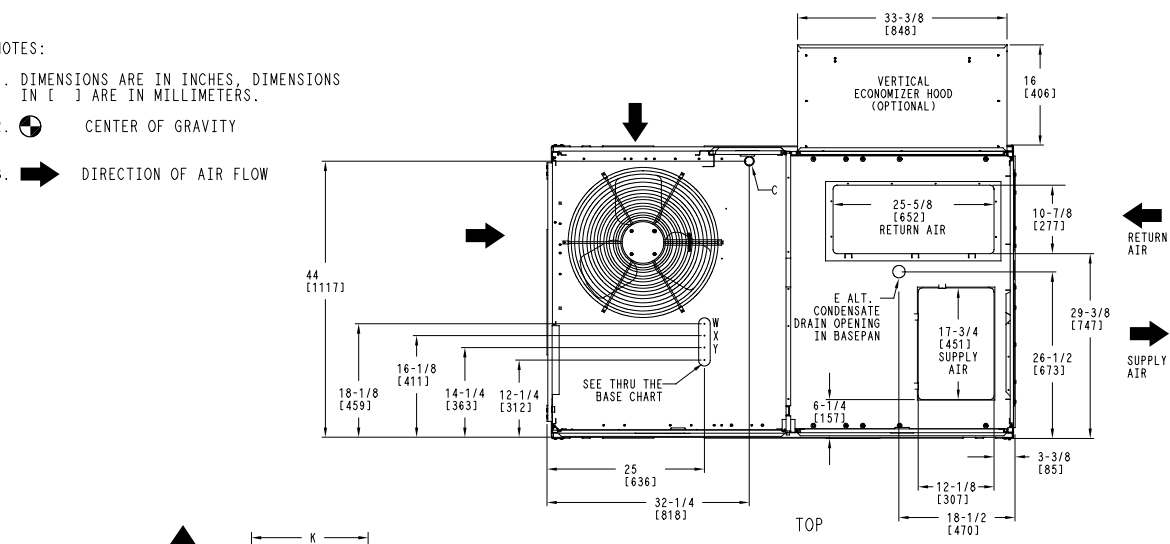

		Thru the Base Chart These Holes Req'd For Use CRBTMPWR001A01						
Connection Sizes		Threaded Conduit Size	Wire Use	Req'd Hole Sizes (Max.)	Unit	J	K	
A	1-3/8" [35] DIA Field Power Supply Hole	W	1/2"	Acc.	7/8" [22.2]	036	33-3/8 [847]	18-5/8 [472]
B	2" [51] DIA Power Supply Knockout	X	1/2"	24V	7/8" [22.2]	048	41-3/8 [1051]	14-7/8 [377]
C	1-3/4" [44] DIA Gauge Access Plug	Y*	3/4" (001)	Power*	1-1/8" [28.4]	060	41-3/8 [1051]	14-7/8 [377]
D	7/8" [22] DIA Field Control Wiring Hole	* Select either 3/4" or 1-1/4" for power, depending on wire size.						
E	3/4" 14 NPT Condensate Drain							
G	2" [51] DIA Power Supply Knockout							


WEIGHTS & DIMENSIONS - RHH036-060 (cont.)

UNIT	BASE UNIT WEIGHT		Corner Weight A		Corner Weight B		Corner Weight C		Corner Weight D		Center of Gravity In [mm]		
	LBS	KG	LBS	KG	LBS	KG	LBS	KG	LBS	KG	X	Y	Z
RHH036	495	225	130	59	118	54	118	54	130	59	35-3/8 [899]	23-3/8 [594]	18-3/8 [416]
RHH048	580	263	161	73	147	67	130	59	142	64	35-1/2 [902]	21-7/8 [556]	20-1/2 [419]
RHH060	610	277	165	75	152	69	141	64	152	69	35-3/4 [908]	22-1/2 [572]	20-3/4 [511]

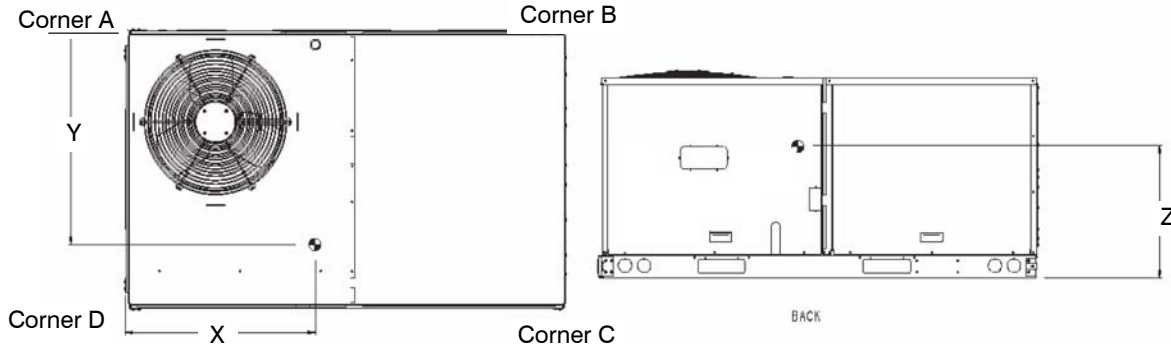

UNIT CLEARANCES

LOC	DIMENSION	CONDITION
A	48" (1219 mm)	Unit disconnect is mounted on panel
	18" (457 mm)	No disconnect, convenience outlet option
	18" (457 mm)	Recommended service clearance
	12" (305 mm)	Minimum clearance
B	42" (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall)
	36" (914 mm) Special	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass) Check for sources of flue products within 10-ft of unit fresh air intake hood
C	36" (914 mm)	Side condensate drain is used
	18" (457 mm)	Minimum clearance
D	42" (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall, another unit)
	36" (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)

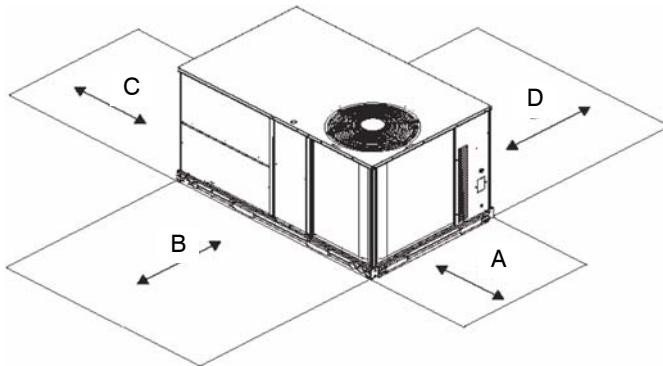


ROOF CURB DETAILS - RHH036-060

RoofCurb Accessory	A	Unit Size
CRRFCURB001A01	1' 2" [356]	RHH036-060
CRRFCURB002A01	2' 0" [610]	

NOTES:



1. Roofcurb accessory is shipped disassembled.
2. Insulated panels, 1" thick polyurethane foam, 1-3/4# density.
3. Dimensions in. [] in millimeters.
4. Roofcurb 18 ga steel on 14" curb, 16 ga steel on 24" curb.
5. Attach ductwork to curb (Flanges of duct rest on curb)
6. Service clearance 4" on each side.
7. Direction of airflow.
8. Connector pkg. CRBTMPWR001A01 and 2A01 are for thru-the-curb connections. Pkg. CRBTMPWR003A01 and 4A01 are for thru-the-bottom connections.


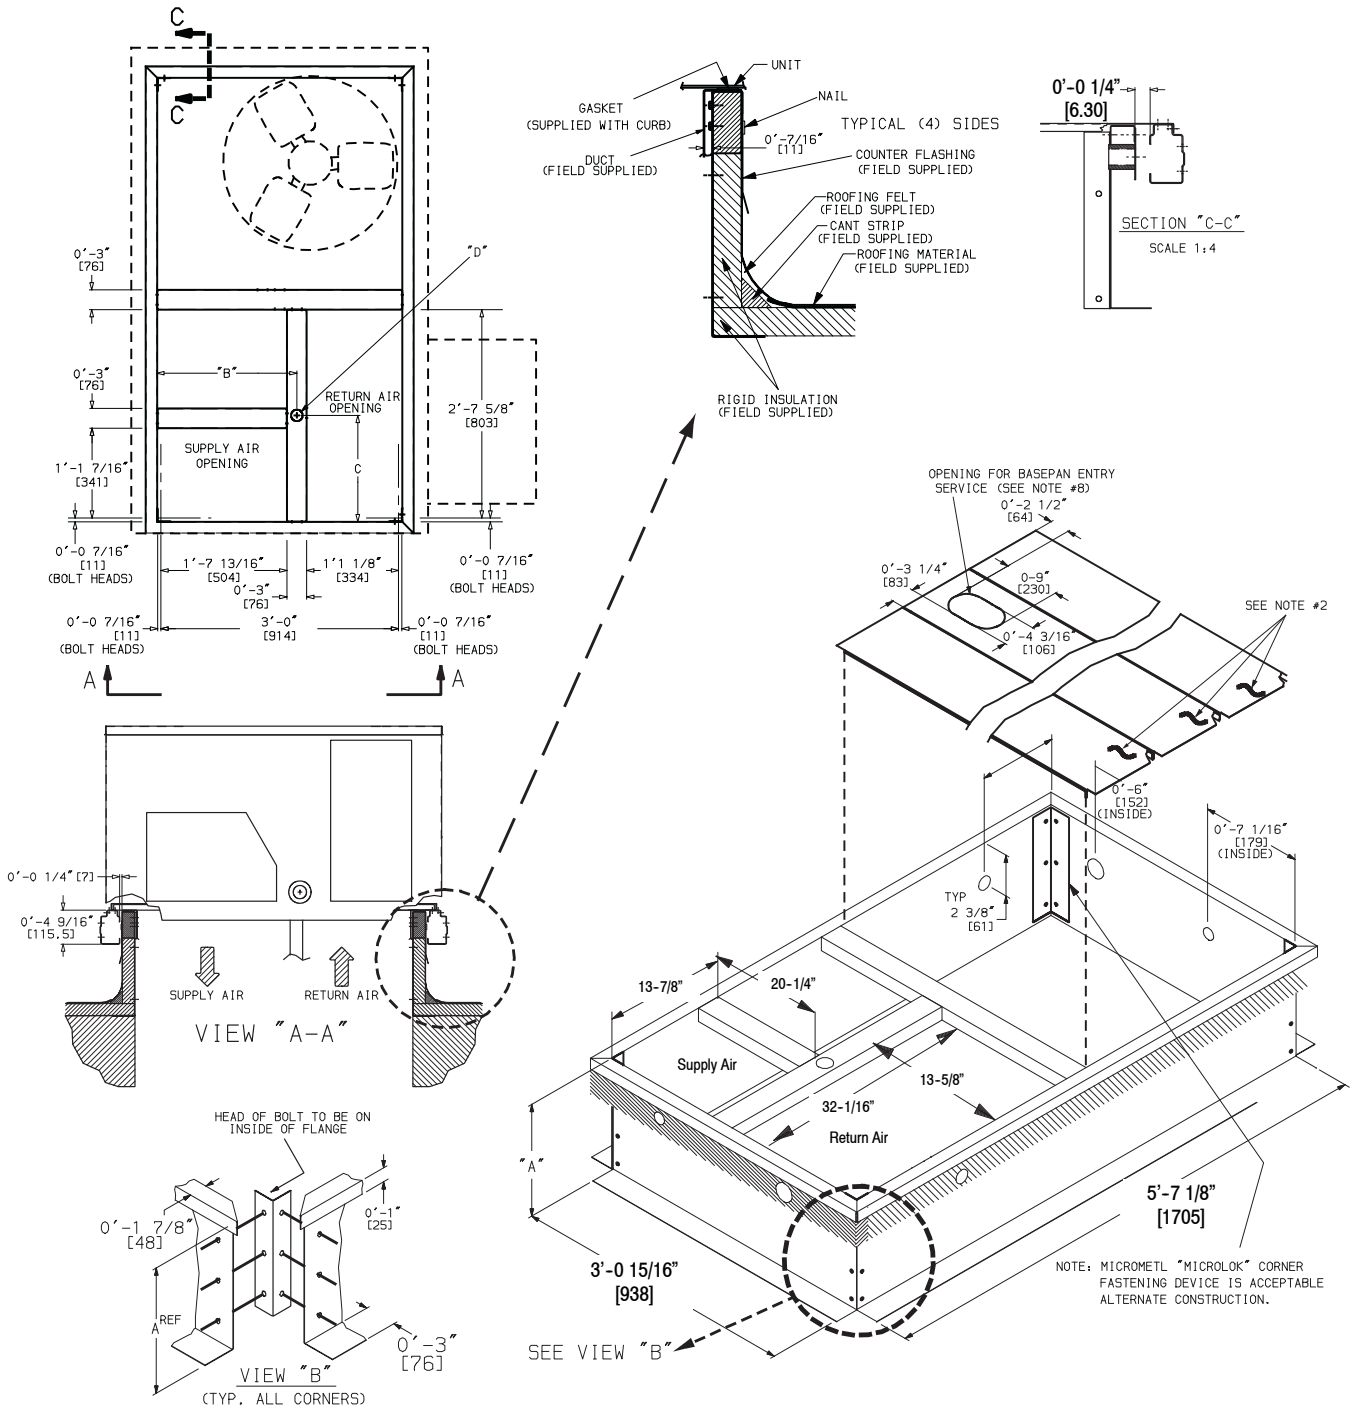
Connector Pkg. Acc.	B	C	D Alt. Drain Hole	Power	Control	Accessory Power
CRBTMPWR001A01	2'-8 ⁷ / ₁₆ " [827]	1'-10 ¹⁵ / ₁₆ " [583]	1-3/4" [44.5]	3/4" [19] NPT	1/2" [12.7] NPT	1/2" [12.7] NPT
CRBTMPWR002A01				3/4" [19] NPT		
CRBTMPWR003A01				1 1/4" [19] NPT		
CRBTMPWR004A01						



BASE UNIT DIMENSIONS - RHH072-090

NOTES:

1. DIMENSIONS ARE IN INCHES. DIMENSIONS IN [] ARE IN MILLIMETERS.
2.  CENTER OF GRAVITY
3.  DIRECTION OF AIR FLOW

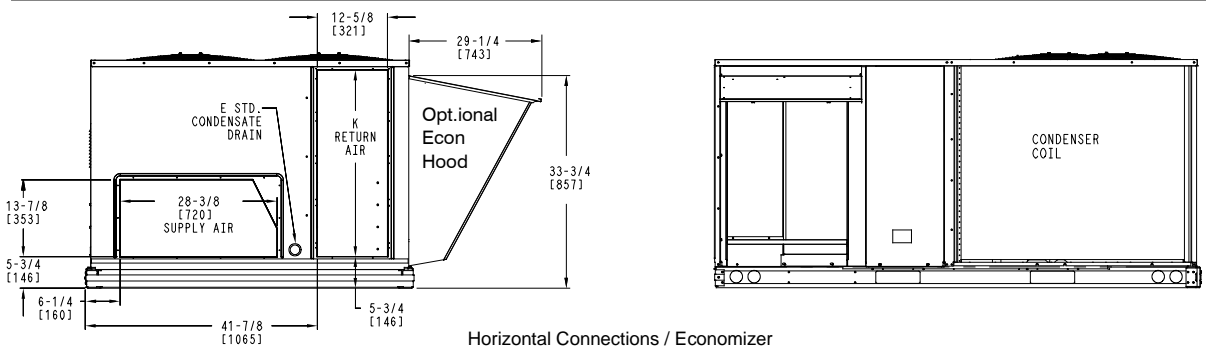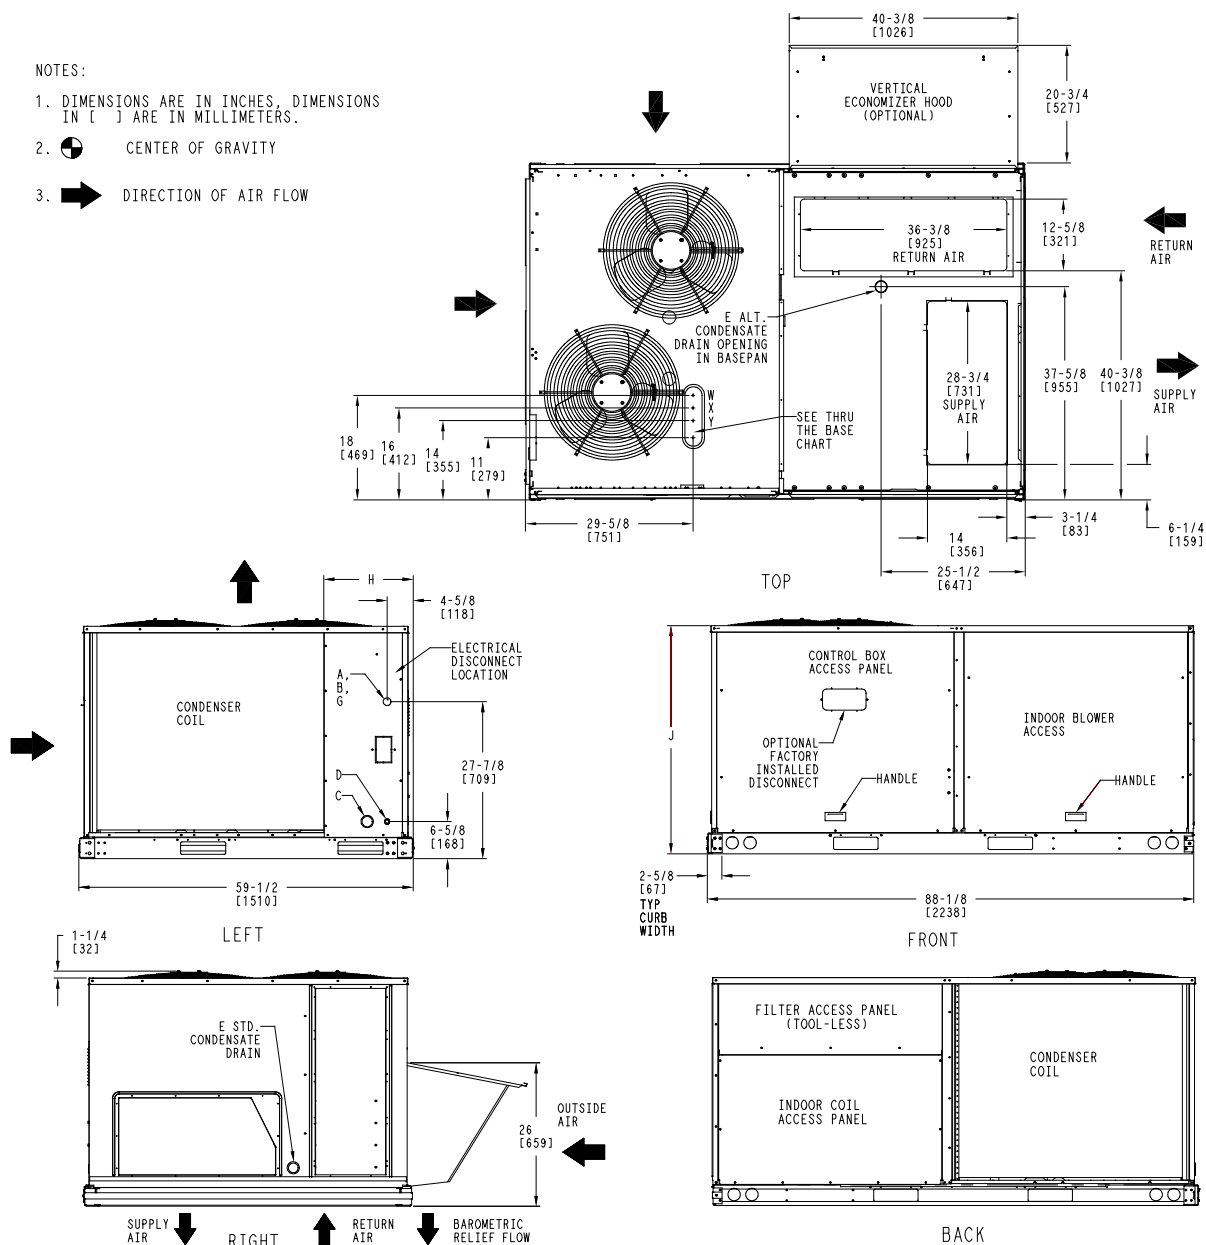


CONNECTION SIZES	
A	1 3/8" [35] DIA FIELD POWER SUPPLY HOLE
B	2 1/2" [64] DIA POWER SUPPLY KNOCKOUT
C	1 3/4" [51] DIA GAUGE ACCESS PLUG
D	7/8" [22] DIA FIELD CONTROL WIRING HOLE
E	3/4"-14 NPT CONDENSATE DRAIN
G	2" [51] DIA POWER SUPPLY KNOCK-OUT

THRU-THE-BASE CHART (FIELD INST)			
THESE HOLES REQUIRED FOR USE WITH ACCY KITS: CRBTMPWR001A01: 072 CRBTMPWR002A01: 090			
	THREADED CONDUIT SIZE	WIRE USE	REQ'D HOLE SIZES (MAX.)
W	1/2"	ACC.	7/8" [22.2]
X	1/2"	24V	7/8" [22.2]
Y	3/4" (001) 1 1/4" (002)	POWER	1 1/8" [28.6] 1 3/4" [44.4]

THRU-THE-BASE CHART (FIOP)			
FOR "THRU-THE-BASEPAN" FACTORY OPTION, FITTINGS FOR ONLY X & Y ARE PROVIDED: (1) 1/2" & (1) 1 1/4" ELECTRICAL FITTINGS.			
UNIT	J	K	H
RHH072	41 1/4 [1048]	33 [658]	15 7/8 [403]
RHH090	49 3/8 [1253]	36 3/8 [925]	15 7/8 [403]


WEIGHT & CLEARANCE DIMENSIONS - RHH072-090 (cont.)

UNIT	BASE UNIT WEIGHT		Corner Weight A		Corner Weight B		Corner Weight C		Corner Weight D		Center of Gravity In [mm]		
	LBS	KG	LBS	KG	LBS	KG	LBS	KG	LBS	KG	X	Y	Z
RHH072	710	322	162	73.5	129	58.5	186	84.4	234	106	38-5/8 [481]	34-1/8 [867]	21-1/4 [540]
RHH090	875	397	190	86.2	160	72.6	253	114.8	284	128.8	40 [1016]	34-5/8 [879]	24-3/8 [619]

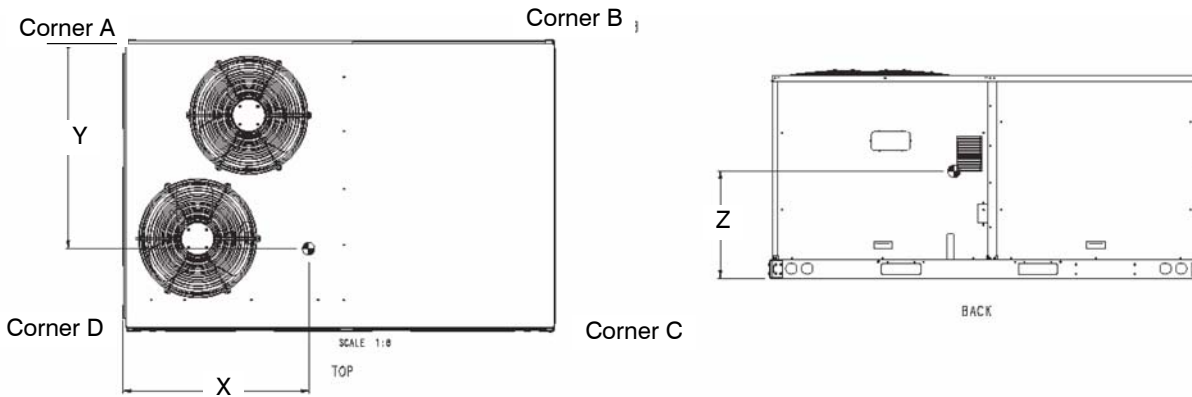



UNIT CLEARANCES

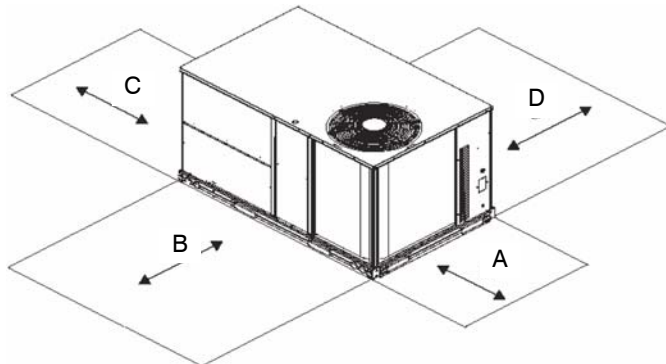
LOC	DIMENSION	CONDITION
A	48" (1219 mm)	Unit disconnect is mounted on panel
	36" (914 mm)	If dimension-B is 12"
	18" (457 mm)	No disconnect, convenience outlet option
	18" (457 mm)	Recommended service clearance (use electric screwdriver)
	12" (305 mm)	Minimum clearance (use manual ratchet screwdriver)
B	36" (914 mm)	Unit has economizer
	12" (305 mm)	If dimension-A is 36"
	Special	Check for sources of flue products within 10-ft of unit fresh air intake hood
C	36" (914 mm)	Side condensate drain is used
	18" (457 mm)	Minimum clearance
D	42" (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall, another unit)
	36" (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)




BASE UNIT DIMENSIONS - RHH102

NOTES:

1. DIMENSIONS ARE IN INCHES. DIMENSIONS IN [] ARE IN MILLIMETERS.
2.  CENTER OF GRAVITY
3.  DIRECTION OF AIR FLOW

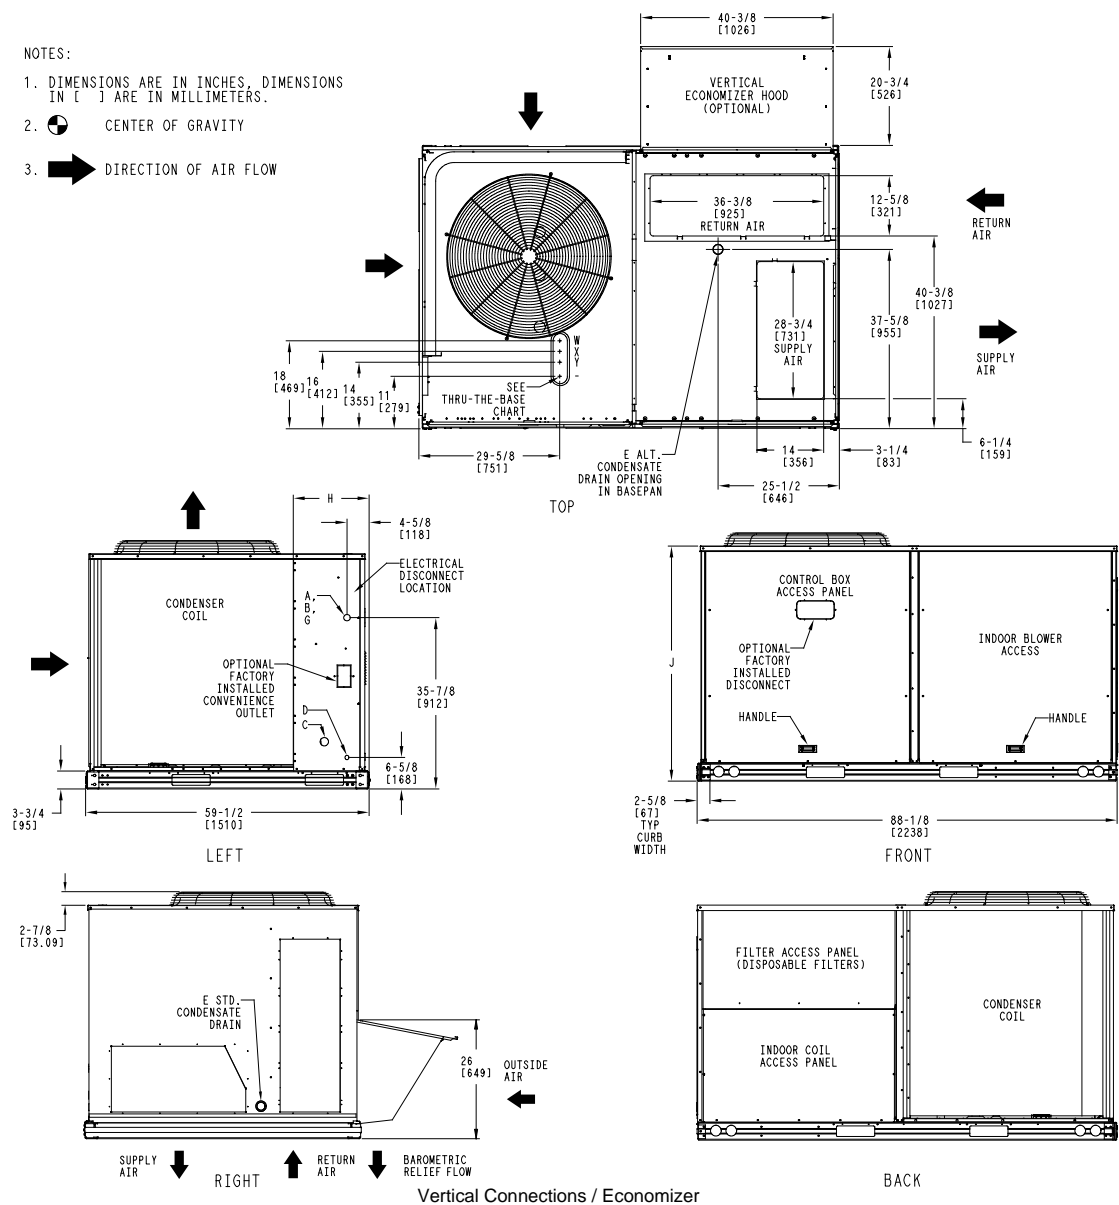

Vertical Connections / Economizer

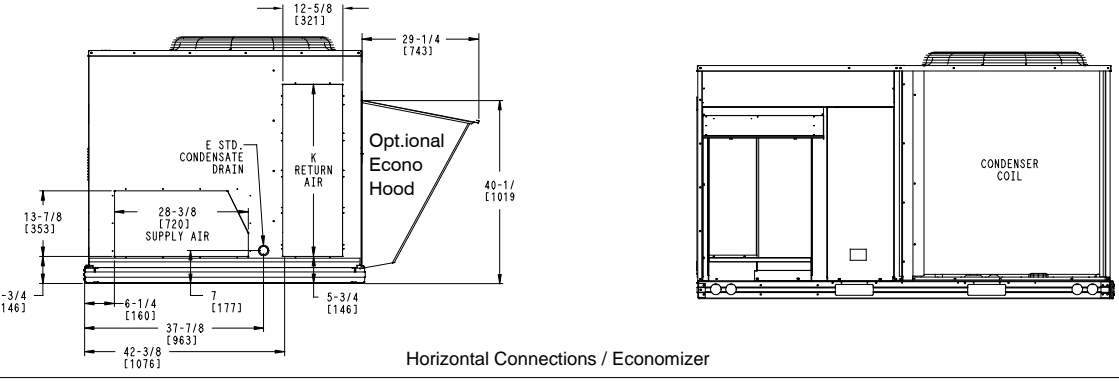

Horizontal Connections / Economizer

CONNECTION SIZES	
A	1 3/8" [35] DIA FIELD POWER SUPPLY HOLE
B	2 1/2" [64] DIA POWER SUPPLY KNOCKOUT
C	1 3/4" [51] DIA GAUGE ACCESS PLUG
D	7/8" [22] DIA FIELD CONTROL WIRING HOLE
E	3/4"-14 NPT CONDENSATE DRAIN
G	2" [51] DIA POWER SUPPLY KNOCK-OUT


THRU-THE-BASE CHART THESE HOLES REQUIRED FOR USE CRBTMPW002A01			
	THREADED CONDUIT SIZE	WIRE USE	REQ'D HOLE SIZES (MAX.)
W	1/2"	ACC.	7/8" [22.2]
X	1/2"	24V	7/8" [22.2]
Y	1 1/4"	POWER	1 3/4" [44.4]

FOR "THRU-THE-BASEPAN" FACTORY OPTION, FITTINGS FOR ONLY X & Y ARE PROVIDED

UNIT	H	J	K
RHH102	15 7/8 [403]	49 3/8 [1253]	36 3/8 [925]


WEIGHT & CLEARANCE DIMENSIONS - RHH102 (cont.)

UNIT	BASE UNIT WEIGHT		Corner Weight A		Corner Weight B		Corner Weight C		Corner Weight D		Center of Gravity In [mm]		
	LBS	KG	LBS	KG	LBS	KG	LBS	KG	LBS	KG	X	Y	Z
RHH102	1020	463	255	115.7	199	90.3	248	112.5	318	144.2	38-1/4 [972]	32 [813]	24 [610]

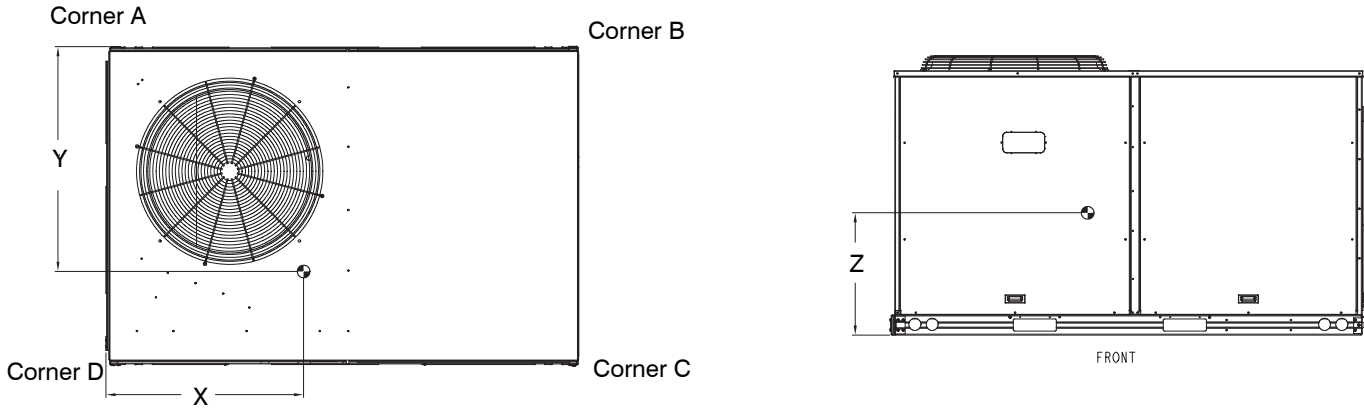

UNIT CLEARANCES

LOC	DIMENSION	CONDITION
A	48" (1219 mm)	Unit disconnect is mounted on panel
	36" (914 mm)	If dimension-B is 12"
	18" (457 mm)	No disconnect, convenience outlet option
	18" (457 mm)	Recommended service clearance (use electric screwdriver)
	12" (305 mm)	Minimum clearance (use manual ratchet screwdriver)
B	36" (914 mm)	Unit has economizer
	12" (305 mm)	If dimension-A is 36"
	Special	Check for sources of flue products within 10-ft of unit fresh air intake hood
C	36" (914 mm)	Side condensate drain is used
	18" (457 mm)	Minimum clearance
D	42" (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall, another unit)
	36" (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)

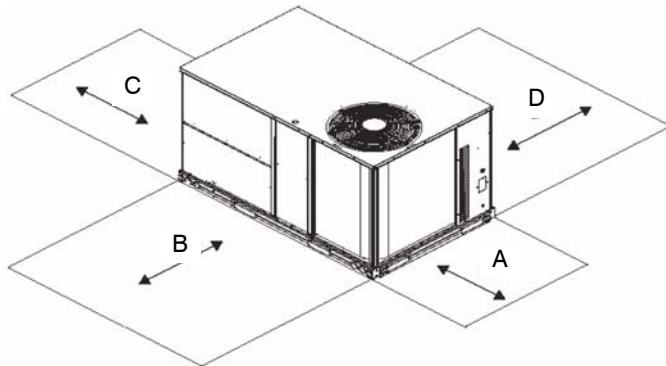


ROOF CURB DETAILS - RHH072-102

RoofCurb Accessory	A	Unit Size
CRRFCURB003A01	1' 2" [356]	RHH072-102
CRRFCURB004A01	2' 0" [610]	

NOTES:

1. Roofcurb accessory is shipped disassembled.
2. Insulated panels, 1" thick polyurethane foam, 1-3/4# density.
3. Dimensions in. [] in millimeters.
4. Roofcurb 18 ga steel on 14" curb, 16 ga steel on 24" curb.
5. Attach ductwork to curb (Flanges of duct rest on curb)
6. Service clearance 4' on each side.
7. Direction of airflow.
8. Connector pkg. CRBTMPWR001A01 and 2A01 are for thru-the-curb connections. Pkg. CRBTMPWR003A01 and 4A01 are for thru-the-bottom connections.


Connector Pkg. Acc.	B	C	D Alt. Drain Hole	Power	Control	Accessory Power
CRBTMPWR001A01	2' 8-7/16" [827]	1' 10-15/16" [583]	1-3/4" [44.5]	3/4" [19] NPT	1/2" [12.7] NPT	1/2" [12.7] NPT
CRBTMPWR002A01				1-1/4 [31.7]		
CRBTMPWR003A01				3/4" [19] NPT		
CRBTMPWR004A01				1-1/4" [31.7] NPT		

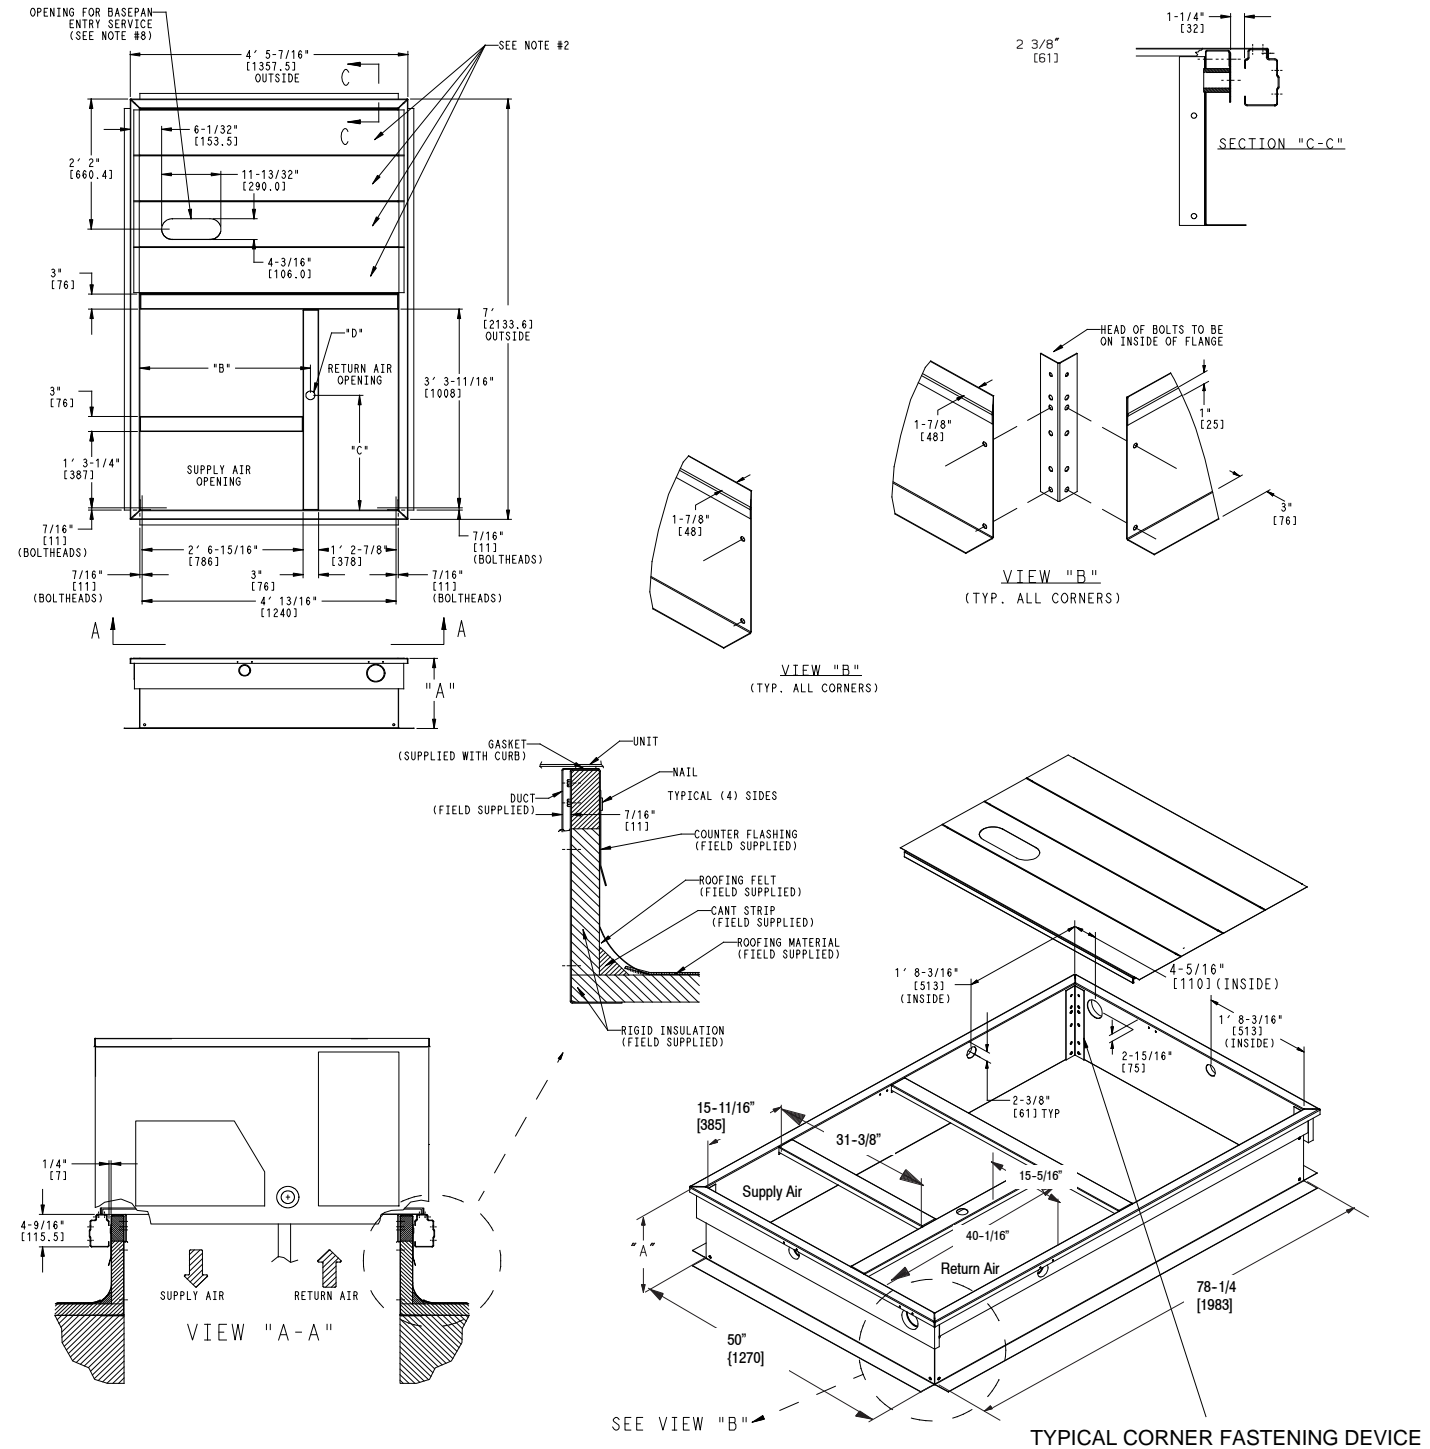

WEIGHT & CLEARANCE DIMENSIONS - RHH120 (cont.)

UNIT	BASE UNIT WEIGHT		Corner Weight A		Corner Weight B		Corner Weight C		Corner Weight D		Center of Gravity In [mm]		
	LBS	KG	LBS	KG	LBS	KG	LBS	KG	LBS	KG	X	Y	Z
RHH120	1390	632	356	162	344	156	339	154	351	160	57 [1448]	31-1/2 [800]	21-1/8 [537]

STANDARD UNIT WEIGHT IS WITHOUT ELECTRIC HEAT & WITHOUT PACKAGING.

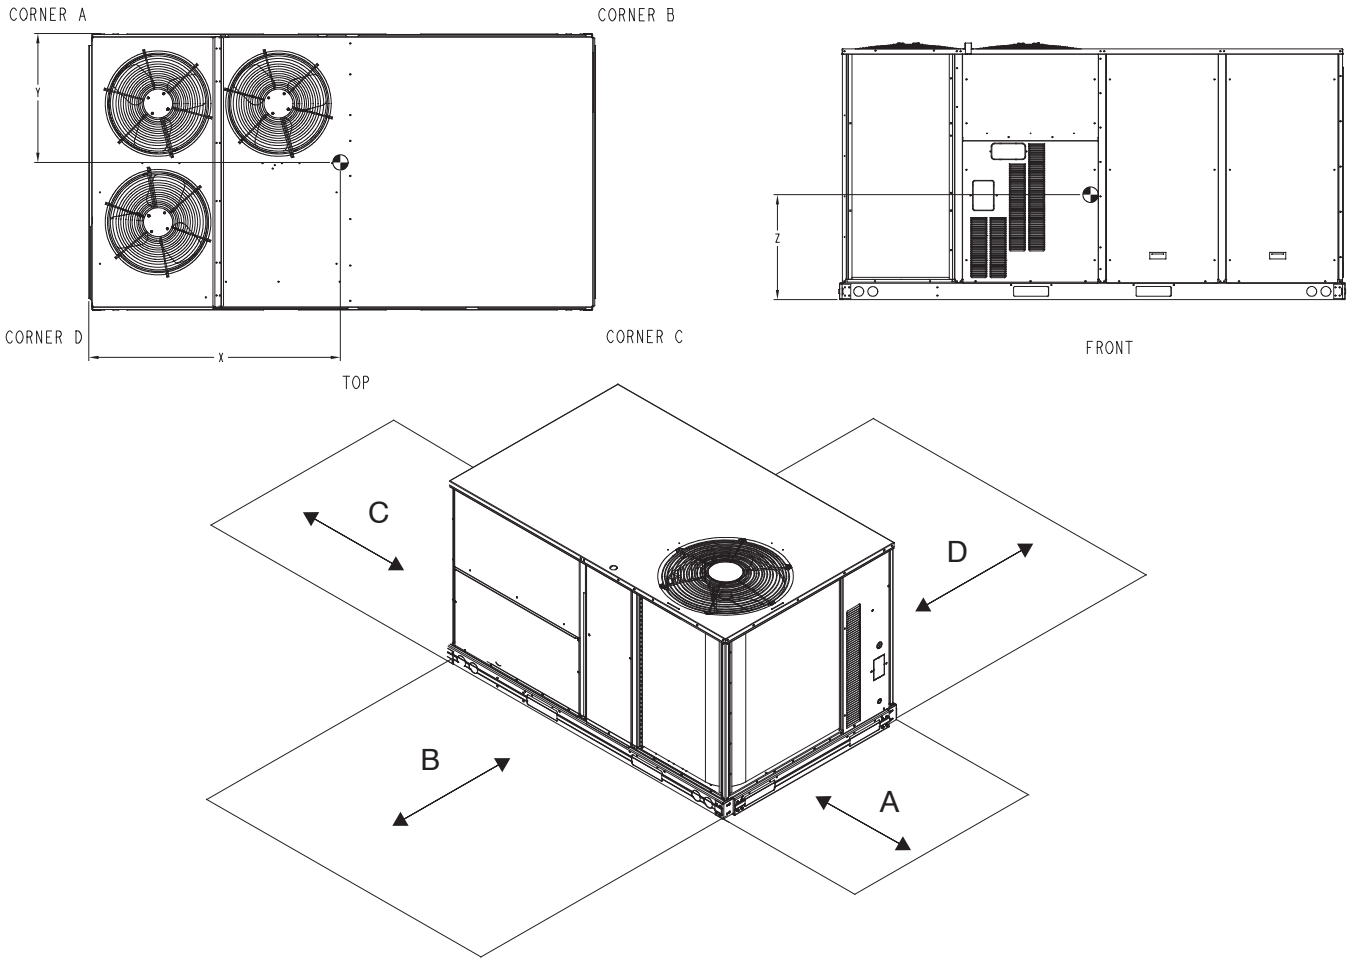

UNIT CLEARANCES


LOC	DIMENSION	CONDITION
A	48" (1219 mm)	Unit disconnect is mounted on panel
	36" (914 mm)	If dimension-B is 12"
	18" (457 mm)	No disconnect, convenience outlet option
	18" (457 mm)	Recommended service clearance (use electric screwdriver)
	12" (305 mm)	Minimum clearance (use manual ratchet screwdriver)
B	36" (914 mm)	Unit has economizer
	12" (305 mm)	If dimension-A is 36"
	Special	Check for sources of flue products within 10-ft of unit fresh air intake hood
C	36" (914 mm)	Side condensate drain is used
	18" (457 mm)	Minimum clearance
D	42" (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall, another unit)
	36" (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)

ROOF CURB DETAILS - RHH120

NOTES:

1. ROOFCURB ACCESSORY IS SHIPPED DISASSEMBLED.
2. INSULATED PANELS: 1/2" THK. NEOPRENE FOAM, 1.0# DENSITY.
3. DIMENSIONS IN [] ARE IN MILLIMETERS.
4. ROOFCURB SIDEWALLS: 16 GAGE STEEL.
5. ATTACH DUCTWORK TO CURB. (FLANGES OF DUCT REST ON CURB).
6. SERVICE CLEARANCE 4 FT ON EACH SIDE.
7. DIRECTION OF AIR FLOW.
8. "L" & "S" DESIGNATIONS DENOTE LOCATION OF COMMON CROSS RAIL. (POSITION "S" FOR SMALL DUCT OPENING CURB).

ROOF CURB ACCESSORY #	A
CRRFCURB072A00	14" [356]
CRRFCURB073A00	24" [610]

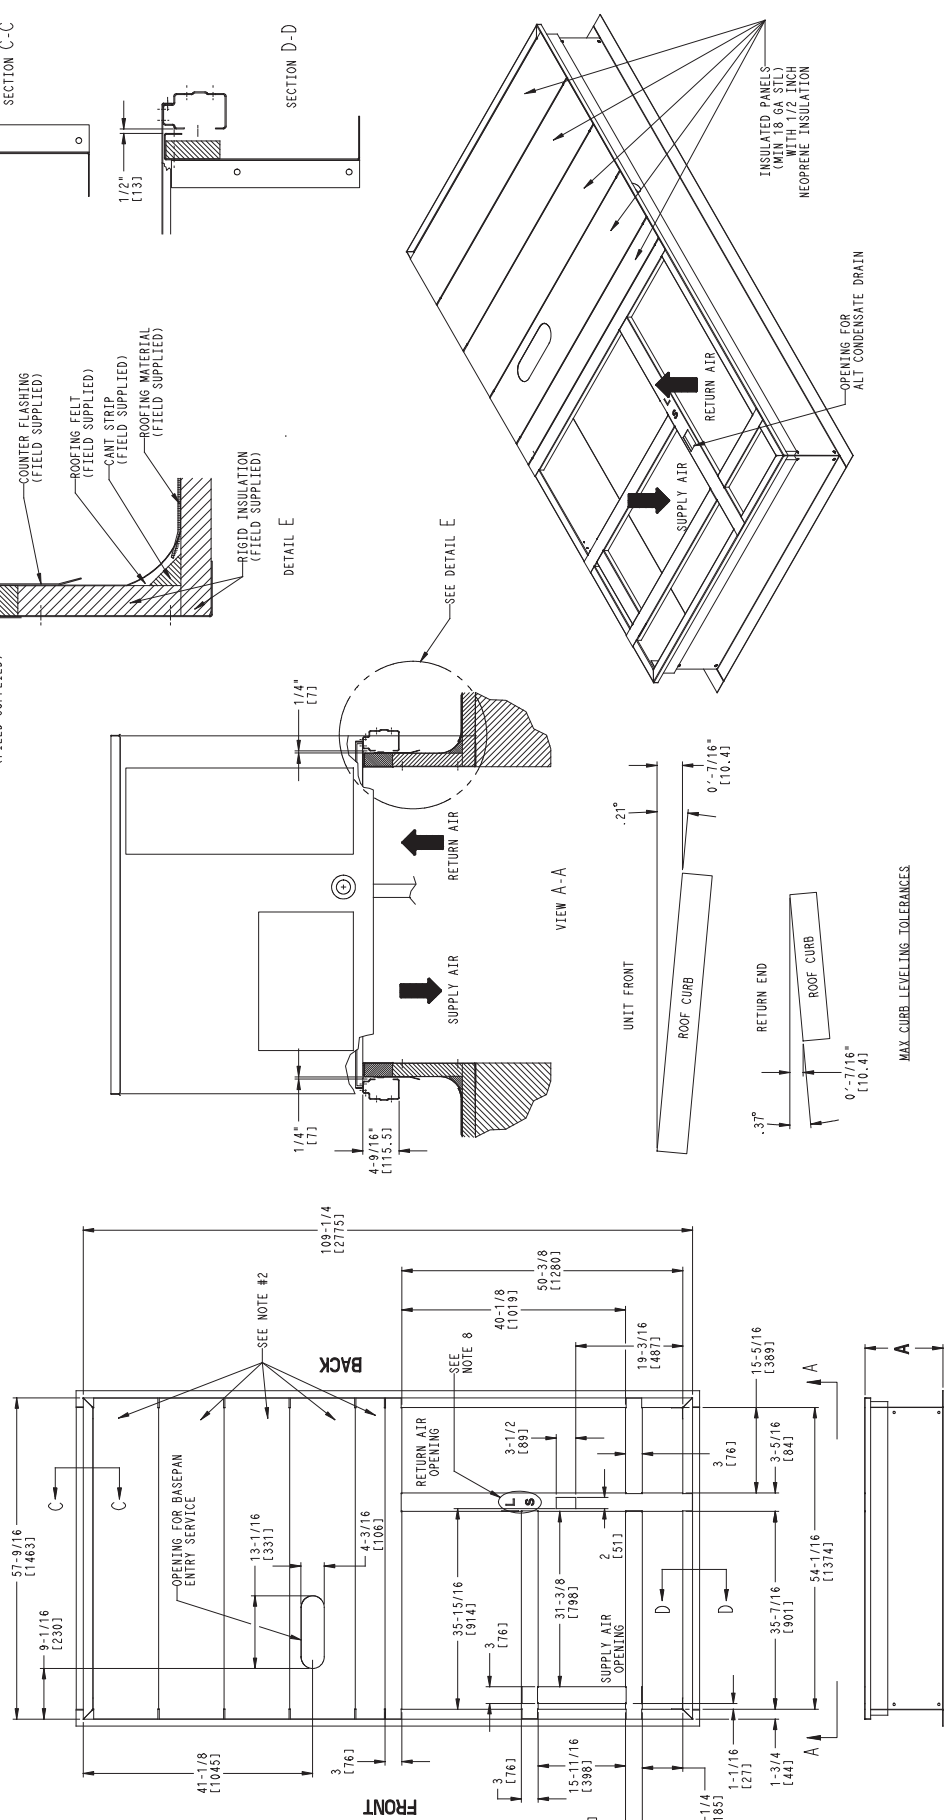

OPTION / ACCESSORY WEIGHTS

OPTION / ACCESSORY	OPTION / ACCESSORY WEIGHTS – RHH													
	036		048		060		072		090		102		120	
	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg
Power Exhaust – vertical	50	23	50	23	50	23	50	23	75	34	75	34	85	39
Power Exhaust – horizontal	30	14	30	14	30	14	30	14	30	14	30	14	75	34
EconoMi\$er	50	23	50	23	50	23	50	23	75	34	75	34	115	52
Two Position damper	39	18	39	18	39	18	39	18	58	26	58	26	65	29
Manual Dampers	12	5	12	5	12	5	12	5	18	8	18	8	25	11
Hail Guard (louvered)	16	7	16	7	16	7	16	7	34	15	34	15	45	20
Cu/Cu Condenser Coil	35	16	35	16	35	16	95	43	95	43	95	43	160	73
Cu/Cu Cond. & Evaporator Coils	60	27	60	27	90	41	165	75	140	64	195	88	280	127
Roof Curb (14–in. curb)	115	52	115	52	115	52	115	52	143	65	143	65	180	82
Roof Curb (24–in. curb)	197	89	197	89	197	89	197	89	245	111	245	111	255	116
CO ₂ sensor	5	2	5	2	5	2	5	2	5	2	5	2	5	2
Electric Heater	30	14	30	14	30	14	30	14	45	20	45	20	25	11
Single Point Kit	10	5	10	5	10	5	10	5	12	5	12	5	25	11
Optional Indoor Motor / Drive	10	5	10	5	10	5	10	5	15	7	15	7	45	20
Motormaster Controller	35	16	35	16	35	16	35	16	35	16	35	16	35	16
Supply Smoke Detector	5	2	5	2	5	2	5	2	5	2	5	2	5	2
Non–Fused Disconnect	15	7	15	7	15	7	15	7	15	7	15	7	15	7
Non–Powered Convenience outlet	5	2	5	2	5	2	5	2	5	2	5	2	5	2
Enthalpy Sensor	2	1	2	1	2	1	2	1	2	1	2	1	2	1
Differential Enthalpy Sensor	3	1	3	1	3	1	3	1	3	1	3	1	3	1

NOTE: Where multiple variations are available, the heaviest combination is listed.

APPLICATION DATA

Min operating ambient temp (cooling):

In mechanical cooling mode, your rooftop can safely operate down to an outdoor ambient temperature of 25°F (-4°C), with an accessory winter start kit; 40°F (4°C) standard minimum operating temperature. It is possible to provide cooling at lower outdoor ambient temperatures by using less outside air, economizers, and/or accessory low ambient kits.

Max operating ambient temp (cooling):

The maximum operating ambient temperature for cooling mode is 115°F (46°C). While cooling operation above 115°F (46°C) may be possible, it could cause either a reduction in performance, reliability, or a protective action by the unit's internal safety devices.

Min and max airflow (cooling):

To maintain safe and reliable operation of your rooftop, operate within the cooling airflow limits. Operating above the max may cause blow-off, undesired airflow noise, or airflow related problems with the rooftop unit. Operating below the min may cause problems with coil freeze-up.

Airflow:

All units are draw-through in cooling mode and blow-through in heating mode.

Outdoor air application strategies:

Economizers reduce operating expenses and compressor run time by providing a free source of cooling and a means of ventilation to match application changing needs. In fact, they should be considered for most applications. Also, consider the various economizer control methods and their benefits, as well as sensors required to accomplish your application goals. Please contact your local sales representative for assistance.

Motor limits, break horsepower (BHP):

Due to the internal unit design, air path, and specially designed motors, the full horsepower (maximum continuous BHP) band, as listed in Table 5, can be used with the utmost confidence. There is no need for extra safety factors, these motors are designed and rigorously tested to use the entire, listed BHP range without either nuisance tripping or premature motor failure.

Sizing a rooftop

Bigger isn't necessarily better. While an air conditioner needs to have enough capacity to meet the design loads, it doesn't need excess capacity. In fact, excess capacity typically results in very poor partload performance and humidity control.

Using higher design temperatures than ASHRAE recommends for your location, adding "safety factors" to the calculated load, are all signs of oversizing air conditioners. Oversizing the air conditioner leads to short cycling (quick on-off cycles) which results in: poor humidity control, reduced efficiency, higher utility bills, larger indoor temperature swings, excessive noise, and increased wear and tear on the air conditioner.

Rather than oversizing an air conditioner, engineers should "right-size" or even slightly undersize air conditioners. Correctly sizing an air conditioner controls humidity better; promotes efficiency; reduces utility bills; extends equipment life, and maintains even, comfortable temperatures.

Low ambient applications

The optional economizer can adequately cool your space by bringing in fresh, cool outside air. In fact, when so equipped, accessory low-ambient kit may not be necessary. In low ambient conditions, unless the outdoor air is excessively humid or contaminated, economizer-based "free cooling" is the preferred less costly and energy conscious method.

In low ambient applications where outside air might not be desired (such as contaminated or excessively humid outdoor environments), your rooftop can operate to ambient temperatures down to -20°F (-29°C) using the recommended accessory Motormaster low ambient controller.

Table 8 – COOLING CAPACITIES 1-Stage Cooling 3 TONS

RHH036			AMBIENT TEMPERATURE															
			85			95			105			115			125			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	
900 Cfm	EAT (wb)	58	THC	31.8	31.8	36.0	30.5	30.5	34.5	29.0	29.0	32.9	27.5	27.5	31.1	25.7	25.7	29.2
		SHC	27.5	31.8	36.0	26.4	30.5	34.5	25.2	29.0	32.9	23.8	27.5	31.1	22.3	25.7	29.2	
		62	THC	33.5	33.5	34.2	31.8	31.8	33.4	30.0	30.0	32.5	28.0	28.0	31.4	25.9	25.9	30.2
		SHC	24.9	29.5	34.2	24.0	28.7	33.4	23.2	27.8	32.5	22.2	26.8	31.4	21.1	25.7	30.2	
		67	THC	36.8	36.8	36.8	34.9	34.9	34.9	32.9	32.9	32.9	30.8	30.8	30.8	28.4	28.4	28.4
	SHC	20.6	25.2	29.9	19.8	24.4	29.1	18.9	23.6	28.3	18.0	22.7	27.4	17.0	21.7	26.4		
	72	THC	40.4	40.4	40.4	38.4	38.4	38.4	36.2	36.2	36.2	33.8	33.8	33.8	31.3	31.3	31.3	
	SHC	16.1	20.9	25.6	15.4	20.1	24.8	14.5	19.2	24.0	13.6	18.3	23.0	12.7	17.4	22.1		
	76	THC	-	43.4	43.4	-	41.2	41.2	-	38.9	38.9	-	36.4	36.4	-	33.7	33.7	
	SHC	-	17.3	22.2	-	16.5	21.5	-	15.7	20.6	-	14.8	19.6	-	13.9	18.7		
1050 Cfm	EAT (wb)	58	THC	33.5	33.5	38.0	32.1	32.1	36.4	30.6	30.6	34.7	28.9	28.9	32.7	27.0	27.0	30.6
		SHC	29.0	33.5	38.0	27.8	32.1	36.4	26.5	30.6	34.7	25.0	28.9	32.7	23.4	27.0	30.6	
		62	THC	34.6	34.6	37.4	32.8	32.8	36.5	30.9	30.9	35.5	28.9	28.9	34.1	27.0	27.0	31.9
		SHC	26.7	32.1	37.4	25.9	31.2	36.5	24.9	30.2	35.5	23.8	28.9	34.1	22.2	27.0	31.9	
		67	THC	37.9	37.9	37.9	35.9	35.9	35.9	33.8	33.8	33.8	31.5	31.5	31.5	29.0	29.0	29.0
	SHC	21.8	27.2	32.6	21.0	26.4	31.8	20.1	25.5	30.9	19.2	24.6	29.9	18.2	23.6	28.9		
	72	THC	41.5	41.5	41.5	39.4	39.4	39.4	37.1	37.1	37.1	34.6	34.6	34.6	31.9	31.9	31.9	
	SHC	16.7	22.1	27.6	15.9	21.3	26.7	15.0	20.4	25.9	14.1	19.5	24.9	13.1	18.6	24.0		
	76	THC	-	44.6	44.6	-	42.3	42.3	-	39.8	39.8	-	37.2	37.2	-	34.4	34.4	
	SHC	-	18.0	23.6	-	17.2	22.8	-	16.3	21.9	-	15.4	21.0	-	14.5	20.0		
1200 Cfm	EAT (wb)	58	THC	35.0	35.0	39.7	33.5	33.5	38.0	31.8	31.8	36.1	30.0	30.0	34.0	28.1	28.1	31.8
		SHC	30.3	35.0	39.7	29.0	33.5	38.0	27.6	31.8	36.1	26.0	30.0	34.0	24.3	28.1	31.8	
		62	THC	35.5	35.5	40.4	33.7	33.7	39.3	31.9	31.9	37.6	30.1	30.1	35.4	28.1	28.1	33.1
		SHC	28.4	34.4	40.4	27.4	33.3	39.3	26.2	31.9	37.6	24.7	30.1	35.4	23.1	28.1	33.1	
		67	THC	38.7	38.7	38.7	36.7	36.7	36.7	34.5	34.5	34.5	32.1	32.1	32.4	29.5	29.5	31.4
	SHC	22.9	29.0	35.1	22.1	28.2	34.3	21.2	27.3	33.4	20.3	26.3	32.4	19.2	25.3	31.4		
	72	THC	42.4	42.4	42.4	40.2	40.2	40.2	37.8	37.8	37.8	35.2	35.2	35.2	32.5	32.5	32.5	
	SHC	17.1	23.3	29.4	16.3	22.5	28.6	15.5	21.6	27.7	14.5	20.7	26.8	13.6	19.7	25.8		
	76	THC	-	45.5	45.5	-	43.1	43.1	-	40.6	40.6	-	37.8	37.8	-	34.9	34.9	
	SHC	-	18.6	25.0	-	17.8	24.1	-	17.0	23.2	-	16.0	22.3	-	15.1	21.3		
1350 Cfm	EAT (wb)	58	THC	36.2	36.2	41.1	34.6	34.6	39.3	32.9	32.9	37.3	31.0	31.0	35.1	28.9	28.9	32.8
		SHC	31.4	36.2	41.1	30.0	34.6	39.3	28.5	32.9	37.3	26.9	31.0	35.1	25.1	28.9	32.8	
		62	THC	36.3	36.3	42.8	34.7	34.7	40.9	32.9	32.9	38.8	31.0	31.0	36.6	29.0	29.0	34.1
		SHC	29.8	36.3	42.8	28.5	34.7	40.9	27.1	32.9	38.8	25.5	31.0	36.6	23.8	29.0	34.1	
		67	THC	39.4	39.4	39.4	37.3	37.3	37.3	35.0	35.0	35.8	32.5	32.5	34.8	29.9	29.9	33.7
	SHC	24.0	30.8	37.6	23.2	30.0	36.8	22.3	29.1	35.8	21.3	28.1	34.8	20.3	27.0	33.7		
	72	THC	43.1	43.1	43.1	40.8	40.8	40.8	38.3	38.3	38.3	35.7	35.7	35.7	32.9	32.9	32.9	
	SHC	17.6	24.4	31.3	16.8	23.6	30.4	15.9	22.7	29.5	14.9	21.8	28.6	14.0	20.8	27.6		
	76	THC	-	46.2	46.2	-	43.8	43.8	-	41.1	41.1	-	38.3	38.3	-	35.3	35.3	
	SHC	-	19.2	26.2	-	18.4	25.4	-	17.5	24.5	-	16.6	23.5	-	15.6	22.5		
1500 Cfm	EAT (wb)	58	THC	37.3	37.3	42.3	35.6	35.6	40.4	33.8	33.8	38.3	31.8	31.8	36.1	29.7	29.7	33.6
		SHC	32.3	37.3	42.3	30.9	35.6	40.4	29.3	33.8	38.3	27.6	31.8	36.1	25.7	29.7	33.6	
		62	THC	37.3	37.3	44.0	35.7	35.7	42.0	33.9	33.9	39.9	31.9	31.9	37.5	29.7	29.7	35.0
		SHC	30.7	37.3	44.0	29.3	35.7	42.0	27.8	33.9	39.9	26.2	31.9	37.5	24.4	29.7	35.0	
		67	THC	39.9	39.9	40.0	37.8	37.8	39.1	35.4	35.4	38.1	32.9	32.9	37.1	30.3	30.3	35.9
	SHC	25.1	32.5	40.0	24.2	31.7	39.1	23.3	30.7	38.1	22.3	29.7	37.1	21.2	28.5	35.9		
	72	THC	43.7	43.7	43.7	41.3	41.3	41.3	38.8	38.8	38.8	36.1	36.1	36.1	33.2	33.2	33.2	
	SHC	18.0	25.5	33.0	17.2	24.7	32.1	16.3	23.8	31.2	15.3	22.8	30.3	14.3	21.8	29.3		
	76	THC	-	46.8	46.8	-	44.3	44.3	-	41.6	41.6	-	38.7	38.7	-	35.6	35.6	
	SHC	-	19.8	27.4	-	19.0	26.6	-	18.1	25.7	-	17.1	24.7	-	16.1	23.7		

LEGEND

- Do not operate in this region (Points are outside SST and SDT permissible operating range)
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- THC – Total capacity

Table 9 – COOLING CAPACITIES 1-Stage Cooling 4 TONS

RHH048			AMBIENT TEMPERATURE															
			85			95			105			115			125			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	
1200 Cfm	EAT (wb)	58	THC	41.1	41.1	46.6	39.5	39.5	44.8	37.7	37.7	42.7	35.8	35.8	40.6	33.7	33.7	38.2
		SHC	35.6	41.1	46.6	34.2	39.5	44.8	32.7	37.7	42.7	31.0	35.8	40.6	29.2	33.7	38.2	
		62	THC	43.1	43.1	44.7	41.0	41.0	43.6	38.7	38.7	42.5	36.3	36.3	41.2	33.8	33.8	39.8
		SHC	32.3	38.5	44.7	31.3	37.5	43.6	30.2	36.3	42.5	29.0	35.1	41.2	27.8	33.8	39.8	
		67	THC	47.4	47.4	47.4	45.1	45.1	45.1	42.6	42.6	42.6	39.9	39.9	39.9	37.1	37.1	37.1
	SHC	26.7	32.9	39.1	25.7	31.9	38.0	24.6	30.8	37.0	23.5	29.7	35.9	22.4	28.5	34.7		
	72	THC	52.1	52.1	52.1	49.6	49.6	49.6	46.8	46.8	46.8	43.9	43.9	43.9	40.8	40.8	40.8	
	SHC	20.8	27.1	33.4	19.9	26.1	32.3	18.8	25.1	31.3	17.7	24.0	30.2	16.6	22.8	29.0		
	76	THC	-	56.1	56.1	-	53.3	53.3	-	50.4	50.4	-	47.3	47.3	-	44.0	44.0	
	SHC	-	22.4	29.0	-	21.4	28.0	-	20.4	26.9	-	19.3	25.7	-	18.2	24.6		
1400 Cfm	EAT (wb)	58	THC	43.3	43.3	49.1	41.6	41.6	47.1	39.6	39.6	44.9	37.6	37.6	42.6	35.4	35.4	40.1
		SHC	37.5	43.3	49.1	36.0	41.6	47.1	34.4	39.6	44.9	32.6	37.6	42.6	30.6	35.4	40.1	
		62	THC	44.5	44.5	48.9	42.3	42.3	47.7	39.9	39.9	46.3	37.7	37.7	44.4	35.4	35.4	41.7
		SHC	34.7	41.8	48.9	33.6	40.7	47.7	32.4	39.4	46.3	30.9	37.7	44.4	29.1	35.4	41.7	
		67	THC	48.8	48.8	48.8	46.3	46.3	46.3	43.7	43.7	43.7	40.9	40.9	40.9	37.9	37.9	38.1
	SHC	28.3	35.4	42.5	27.2	34.4	41.5	26.2	33.3	40.4	25.0	32.2	39.3	23.8	31.0	38.1		
	72	THC	53.6	53.6	53.6	50.9	50.9	50.9	48.0	48.0	48.0	45.0	45.0	45.0	41.7	41.7	41.7	
	SHC	21.6	28.7	35.9	20.5	27.7	34.9	19.5	26.6	33.8	18.4	25.5	32.7	17.2	24.3	31.5		
	76	THC	-	57.6	57.6	-	54.7	54.7	-	51.6	51.6	-	48.4	48.4	-	44.9	44.9	
	SHC	-	23.3	30.9	-	22.3	29.8	-	21.3	28.7	-	20.1	27.5	-	19.0	26.3		
1600 Cfm	EAT (wb)	58	THC	45.2	45.2	51.3	43.3	43.3	49.1	41.3	41.3	46.8	39.1	39.1	44.3	36.7	36.7	41.6
		SHC	39.2	45.2	51.3	37.5	43.3	49.1	35.8	41.3	46.8	33.9	39.1	44.3	31.8	36.7	41.6	
		62	THC	46.1	46.1	50.5	43.4	43.4	51.1	41.3	41.3	48.7	39.1	39.1	46.1	36.7	36.7	43.3
		SHC	36.0	43.3	50.5	35.7	43.4	51.1	33.9	41.3	48.7	32.1	39.1	46.1	30.2	36.7	43.3	
		67	THC	49.9	49.9	49.9	47.3	47.3	47.3	44.6	44.6	44.6	41.6	41.6	42.6	38.6	38.6	41.3
	SHC	29.8	37.8	45.9	28.7	36.8	44.8	27.6	35.7	43.7	26.5	34.5	42.6	25.2	33.3	41.3		
	72	THC	54.7	54.7	54.7	51.9	51.9	51.9	48.9	48.9	48.9	45.7	45.7	45.7	42.4	42.4	42.4	
	SHC	22.2	30.3	38.4	21.2	29.2	37.3	20.1	28.2	36.2	18.9	27.0	35.1	17.7	25.8	33.9		
	76	THC	-	58.8	58.8	-	55.8	55.8	-	52.6	52.6	-	49.2	49.2	-	45.6	45.6	
	SHC	-	24.2	32.6	-	23.1	31.5	-	22.1	30.3	-	20.9	29.1	-	19.7	27.9		
1800 Cfm	EAT (wb)	58	THC	46.8	46.8	53.1	44.8	44.8	50.8	42.7	42.7	48.3	40.3	40.3	45.7	37.8	37.8	42.9
		SHC	40.6	46.8	53.1	38.8	44.8	50.8	37.0	42.7	48.3	34.9	40.3	45.7	32.8	37.8	42.9	
		62	THC	46.9	46.9	55.2	44.8	44.8	52.8	42.7	42.7	50.3	40.4	40.4	47.6	37.9	37.9	44.6
		SHC	38.5	46.9	55.2	36.8	44.8	52.8	35.1	42.7	50.3	33.2	40.4	47.6	31.1	37.9	44.6	
		67	THC	50.8	50.8	50.8	48.1	48.1	48.1	45.2	45.2	46.9	42.2	42.2	45.7	39.1	39.1	44.3
	SHC	31.2	40.2	49.1	30.1	39.1	48.0	29.0	37.9	46.9	27.8	36.7	45.7	26.6	35.4	44.3		
	72	THC	55.7	55.7	55.7	52.7	52.7	52.7	49.6	49.6	49.6	46.4	46.4	46.4	42.9	42.9	42.9	
	SHC	22.8	31.8	40.8	21.7	30.7	39.7	20.6	29.6	38.6	19.5	28.4	37.4	18.3	27.2	36.2		
	76	THC	-	59.7	59.7	-	56.6	56.6	-	53.3	53.3	-	49.8	49.8	-	46.1	46.1	
	SHC	-	25.0	34.2	-	23.9	33.1	-	22.8	31.9	-	21.6	30.7	-	20.4	29.5		
2000 Cfm	EAT (wb)	58	THC	48.2	48.2	54.6	46.1	46.1	52.2	43.8	43.8	49.7	41.4	41.4	46.9	38.8	38.8	44.0
		SHC	41.8	48.2	54.6	39.9	46.1	52.2	38.0	43.8	49.7	35.9	41.4	46.9	33.6	38.8	44.0	
		62	THC	48.2	48.2	56.8	46.1	46.1	54.4	43.9	43.9	51.7	41.4	41.4	48.8	38.8	38.8	45.7
		SHC	39.6	48.2	56.8	37.9	46.1	54.4	36.0	43.9	51.7	34.0	41.4	48.8	31.9	38.8	45.7	
		67	THC	51.4	51.4	52.2	48.7	48.7	51.1	45.8	45.8	49.9	42.7	42.7	48.6	39.5	39.5	47.1
	SHC	32.6	42.4	52.2	31.5	41.3	51.1	30.3	40.1	49.9	29.1	38.8	48.6	27.8	37.4	47.1		
	72	THC	56.4	56.4	56.4	53.4	53.4	53.4	50.2	50.2	50.2	46.9	46.9	46.9	43.3	43.3	43.3	
	SHC	23.3	33.2	43.0	22.2	32.1	41.9	21.1	31.0	40.8	20.0	29.8	39.6	18.8	28.6	38.4		
	76	THC	-	60.4	60.4	-	57.2	57.2	-	53.9	53.9	-	50.3	50.3	-	46.5	46.5	
	SHC	-	25.7	35.7	-	24.6	34.6	-	23.5	33.5	-	22.3	32.2	-	21.1	31.0		

LEGEND

- Do not operate in this region (Points are outside SST and SDT permissible operating range)
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- THC – Total capacity

Table 10 – COOLING CAPACITIES 1-Stage Cooling 5 TONS

RHH060			AMBIENT TEMPERATURE															
			85			95			105			115			125			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	
1500 Cfm	EAT (wb)	58	THC	53.8	53.8	60.7	51.7	51.7	58.3	49.4	49.4	55.8	46.9	46.9	53.0	44.2	44.2	49.9
			SHC	46.9	53.8	60.7	45.0	51.7	58.3	43.0	49.4	55.8	40.9	46.9	53.0	38.5	44.2	49.9
		62	THC	56.2	56.2	58.3	53.5	53.5	57.0	50.6	50.6	55.5	47.5	47.5	53.9	44.2	44.2	51.8
			SHC	42.6	50.5	58.3	41.3	49.1	57.0	39.9	47.7	55.5	38.4	46.2	53.9	36.6	44.2	51.8
		67	THC	61.7	61.7	61.7	58.7	58.7	58.7	55.5	55.5	55.5	52.0	52.0	52.0	48.2	48.2	48.2
		SHC	35.1	43.0	50.9	33.8	41.7	49.6	32.5	40.4	48.3	31.1	38.9	46.8	29.5	37.4	45.3	
	72	THC	67.7	67.7	67.7	64.4	64.4	64.4	60.9	60.9	60.9	57.1	57.1	57.1	53.0	53.0	53.0	
		SHC	27.4	35.3	43.3	26.1	34.1	42.0	24.8	32.7	40.7	23.4	31.3	39.2	21.9	29.8	37.7	
		THC	–	72.7	72.7	–	69.2	69.2	–	65.4	65.4	–	61.3	61.3	–	56.9	56.9	
		SHC	–	29.0	37.3	–	27.8	36.1	–	26.5	34.7	–	25.1	33.2	–	23.5	31.6	
1750 Cfm	EAT (wb)	58	THC	56.7	56.7	64.0	54.4	54.4	61.4	51.9	51.9	58.6	49.2	49.2	55.6	46.2	46.2	52.2
			SHC	49.4	56.7	64.0	47.4	54.4	61.4	45.2	51.9	58.6	42.9	49.2	55.6	40.3	46.2	52.2
		62	THC	58.0	58.0	63.8	55.2	55.2	62.3	52.2	52.2	60.5	49.3	49.3	57.8	46.3	46.3	54.2
			SHC	45.9	54.8	63.8	44.5	53.4	62.3	42.9	51.7	60.5	40.8	49.3	57.8	38.3	46.3	54.2
		67	THC	63.4	63.4	63.4	60.3	60.3	60.3	56.9	56.9	56.9	53.2	53.2	53.2	49.3	49.3	49.7
		SHC	37.3	46.4	55.5	36.0	45.1	54.2	34.6	43.7	52.8	33.1	42.2	51.3	31.5	40.6	49.7	
	72	THC	69.5	69.5	69.5	66.0	66.0	66.0	62.4	62.4	62.4	58.3	58.3	58.3	54.0	54.0	54.0	
		SHC	28.3	37.5	46.7	27.0	36.2	45.4	25.7	34.8	44.0	24.2	33.4	42.5	22.7	31.8	41.0	
		THC	–	74.5	74.5	–	70.9	70.9	–	66.9	66.9	–	62.6	62.6	–	58.0	58.0	
		SHC	–	30.2	39.7	–	29.0	38.4	–	27.6	37.0	–	26.2	35.5	–	24.6	33.9	
2000 Cfm	EAT (wb)	58	THC	59.1	59.1	66.7	56.7	56.7	64.0	54.0	54.0	61.0	51.1	51.1	57.7	48.0	48.0	54.1
			SHC	51.5	59.1	66.7	49.4	56.7	64.0	47.1	54.0	61.0	44.5	51.1	57.7	41.8	48.0	54.1
		62	THC	59.5	59.5	68.7	56.7	56.7	66.5	54.1	54.1	63.4	51.2	51.2	60.0	48.0	48.0	56.2
			SHC	48.7	58.7	68.7	47.0	56.7	66.5	44.8	54.1	63.4	42.4	51.2	60.0	39.7	48.0	56.2
		67	THC	64.7	64.7	64.7	61.5	61.5	61.5	57.9	57.9	57.9	54.1	54.1	55.6	50.1	50.1	53.9
		SHC	39.3	49.6	59.9	38.0	48.3	58.6	36.6	46.9	57.2	35.0	45.3	55.6	33.4	43.7	53.9	
	72	THC	70.9	70.9	70.9	67.3	67.3	67.3	63.4	63.4	63.4	59.3	59.3	59.3	54.8	54.8	54.8	
		SHC	29.2	39.5	49.9	27.9	38.2	48.6	26.5	36.8	47.2	25.0	35.3	45.7	23.4	33.8	44.1	
		THC	–	75.9	75.9	–	72.1	72.1	–	68.0	68.0	–	63.6	63.6	–	58.8	58.8	
		SHC	–	31.3	41.9	–	30.0	40.6	–	28.7	39.2	–	27.2	37.6	–	25.6	36.0	
2250 Cfm	EAT (wb)	58	THC	61.2	61.2	69.1	58.6	58.6	66.1	55.8	55.8	63.0	52.7	52.7	59.5	49.4	49.4	55.7
			SHC	53.3	61.2	69.1	51.0	58.6	66.1	48.6	55.8	63.0	45.9	52.7	59.5	43.0	49.4	55.7
		62	THC	61.2	61.2	71.8	58.6	58.6	68.7	55.8	55.8	65.4	52.8	52.8	61.9	49.4	49.4	57.9
			SHC	50.7	61.2	71.8	48.6	58.6	68.7	46.2	55.8	65.4	43.7	52.8	61.9	40.9	49.4	57.9
		67	THC	65.8	65.8	65.8	62.4	62.4	62.8	58.8	58.8	61.3	54.9	54.9	59.7	50.7	50.7	57.9
		SHC	41.2	52.7	64.2	39.9	51.3	62.8	38.4	49.9	61.3	36.9	48.3	59.7	35.2	46.5	57.9	
	72	THC	72.0	72.0	72.0	68.3	68.3	68.3	64.3	64.3	64.3	60.0	60.0	60.0	55.4	55.4	55.4	
		SHC	30.0	41.5	53.0	28.6	40.1	51.6	27.2	38.7	50.2	25.8	37.2	48.7	24.2	35.6	47.1	
		THC	–	77.0	77.0	–	73.1	73.1	–	68.9	68.9	–	64.3	64.3	–	59.5	59.5	
		SHC	–	32.3	44.1	–	31.0	42.7	–	29.6	41.3	–	28.1	39.7	–	26.6	38.1	
2500 Cfm	EAT (wb)	58	THC	62.9	62.9	71.1	60.2	60.2	68.0	57.3	57.3	64.7	54.1	54.1	61.1	50.6	50.6	57.1
			SHC	54.8	62.9	71.1	52.5	60.2	68.0	49.9	57.3	64.7	47.1	54.1	61.1	44.1	50.6	57.1
		62	THC	63.0	63.0	73.8	60.3	60.3	70.6	57.3	57.3	67.2	54.1	54.1	63.4	50.6	50.6	59.3
			SHC	52.2	63.0	73.8	49.9	60.3	70.6	47.5	57.3	67.2	44.8	54.1	63.4	41.9	50.6	59.3
		67	THC	66.6	66.6	68.2	63.2	63.2	66.8	59.5	59.5	65.2	55.5	55.5	63.5	51.3	51.3	61.5
		SHC	43.1	55.6	68.2	41.7	54.2	66.8	40.2	52.7	65.2	38.6	51.0	63.5	36.8	49.1	61.5	
	72	THC	72.8	72.8	72.8	69.0	69.0	69.0	65.0	65.0	65.0	60.6	60.6	60.6	55.9	55.9	55.9	
		SHC	30.7	43.3	56.0	29.4	42.0	54.6	28.0	40.6	53.2	26.5	39.1	51.7	24.9	37.5	50.1	
		THC	–	77.9	77.9	–	73.9	73.9	–	69.5	69.5	–	64.9	64.9	–	59.9	59.9	
		SHC	–	33.3	46.1	–	32.0	44.7	–	30.6	43.3	–	29.1	41.7	–	27.5	40.1	

LEGEND

- Do not operate in this region (Points are outside SST and SDT permissible operating range)
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- THC – Total capacity

Table 11 – COOLING CAPACITIES 1-Stage Cooling 6 TONS

RHH072			AMBIENT TEMPERATURE															
			85			95			105			115			125			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	
1800 Cfm	EAT (wb)	58	THC	63.5	63.5	71.7	60.1	60.1	67.9	56.4	56.4	63.7	52.3	52.3	59.1	47.8	47.8	54
			SHC	55.2	63.5	71.7	52.3	60.1	67.9	49.1	56.4	63.7	45.5	52.3	59.1	41.6	47.8	54
		62	THC	66.5	66.5	68.9	62.1	62.1	66.9	57.4	57.4	64.6	52.4	52.4	61.4	47.9	47.9	56.2
			SHC	50.2	59.5	68.9	48.1	57.5	66.9	45.9	55.2	64.6	43.3	52.4	61.4	39.6	47.9	56.2
		67	THC	73.9	73.9	73.9	69.9	69.9	69.9	64.6	64.6	64.6	59	59	59	52.8	52.8	52.8
		SHC	40.7	50	59.4	39.2	48.7	58.1	37.2	46.6	56	35	44.5	53.9	32.7	42.1	51.6	
	72	THC	78.2	78.2	78.2	76.9	76.9	76.9	73.1	73.1	73.1	67.5	67.5	67.5	61	61	61	
		SHC	29.8	38.9	47.9	29.4	38.7	48	28	37.4	46.8	26.1	35.5	44.9	23.9	33.3	42.7	
		THC	–	79.5	79.5	–	79.9	79.9	–	78.1	78.1	–	74	74	–	68.1	68.1	
		SHC	–	29.8	39.7	–	29.9	39.8	–	29.3	39.1	–	27.9	37.5	–	26.1	35.5	
2100 Cfm	EAT (wb)	58	THC	67.7	67.7	76.4	64	64	72.3	60.1	60.1	67.9	55.8	55.8	63	51	51	57.7
			SHC	58.9	67.7	76.4	55.7	64	72.3	52.3	60.1	67.9	48.5	55.8	63	44.4	51	57.7
		62	THC	69.2	69.2	75.6	64.7	64.7	73.5	60.2	60.2	70.5	55.8	55.8	65.5	51.1	51.1	60
			SHC	54.2	64.9	75.6	52.2	62.8	73.5	49.7	60.1	70.5	46.2	55.8	65.5	42.2	51.1	60
		67	THC	75.6	75.6	75.6	72.1	72.1	72.1	66.9	66.9	66.9	60.9	60.9	60.9	54.5	54.5	56.9
		SHC	42.8	53.4	63.9	41.8	52.6	63.3	39.9	50.7	61.6	37.6	48.5	59.3	35.3	46.1	56.9	
	72	THC	78.9	78.9	78.9	78.2	78.2	78.2	75	75	75	69.6	69.6	69.6	63	63	63	
		SHC	30.2	40.2	50.2	30.1	40.6	51	29.1	39.8	50.5	27.3	38.1	48.9	25.1	35.9	46.7	
		THC	–	79.7	79.7	–	80.5	80.5	–	79.1	79.1	–	75.5	75.5	–	69.8	69.8	
		SHC	–	30.7	42.3	–	30.8	42.1	–	30.3	41.4	–	29.1	40.1	–	27.4	38.3	
2400 Cfm	EAT (wb)	58	THC	70.8	70.8	80	67.3	67.3	76.1	63.1	63.1	71.3	58.6	58.6	66.2	53.7	53.7	60.7
			SHC	61.6	70.8	80	58.6	67.3	76.1	54.9	63.1	71.3	51	58.6	66.2	46.7	53.7	60.7
		62	THC	71.3	71.3	81.4	67.4	67.4	79	63.1	63.1	74.1	58.7	58.7	68.9	53.7	53.7	63.1
			SHC	57.7	69.6	81.4	55.7	67.4	79	52.2	63.1	74.1	48.5	58.7	68.9	44.4	53.7	63.1
		67	THC	76.7	76.7	76.7	73.7	73.7	73.7	68.5	68.5	68.5	62.4	62.4	64.4	56	56	62
		SHC	44.7	56.2	67.8	44.1	56.1	68.1	42.3	54.5	66.7	40.1	52.2	64.4	37.8	49.9	62	
	72	THC	79.3	79.3	79.3	79	79	79	76.3	76.3	76.3	71.1	71.1	71.1	64.4	64.4	64.4	
		SHC	30.5	41.3	52.1	30.7	42.1	53.6	29.9	41.8	53.8	28.3	40.4	52.5	26.2	38.3	50.5	
		THC	–	80	80	–	80.8	80.8	–	79.8	79.8	–	76.5	76.5	–	71	71	
		SHC	–	31.2	43.5	–	31.4	43.6	–	31.1	43.3	–	30.2	42.4	–	28.6	40.8	
2700 Cfm	EAT (wb)	58	THC	73.3	73.3	82.8	70	70	79.1	65.8	65.8	74.3	61	61	68.9	55.9	55.9	63.2
			SHC	63.7	73.3	82.8	60.9	70	79.1	57.2	65.8	74.3	53.1	61	68.9	48.7	55.9	63.2
		62	THC	73.3	73.3	85.8	70.1	70.1	82.3	65.8	65.8	77.3	61.1	61.1	71.7	56	56	65.7
			SHC	60.5	73.2	85.8	58	70.1	82.3	54.4	65.8	77.3	50.5	61.1	71.7	46.3	56	65.7
		67	THC	77.5	77.5	77.5	74.9	74.9	74.9	70	70	71.5	63.7	63.7	69.2	57.2	57.2	66.6
		SHC	46.1	58.6	71.1	46.1	59.3	72.5	44.7	58.1	71.5	42.4	55.8	69.2	40	53.3	66.6	
	72	THC	79.6	79.6	79.6	79.5	79.5	79.5	77.2	77.2	77.2	72.3	72.3	72.3	65.6	65.6	65.6	
		SHC	30.8	42.3	53.7	31.1	43.4	55.8	30.7	43.7	56.7	29.2	42.5	55.9	27.2	40.6	54.1	
		THC	–	80.1	80.1	–	81.1	81.1	–	80.3	80.3	–	77.1	77.1	–	71.9	71.9	
		SHC	–	31.6	44.5	–	32	44.9	–	31.8	44.9	–	31	44.3	–	29.6	43	
3000 Cfm	EAT (wb)	58	THC	75	75	84.8	72.2	72.2	81.6	68.1	68.1	76.9	63.1	63.1	71.2	57.8	57.8	65.3
			SHC	65.3	75	84.8	62.9	72.2	81.6	59.2	68.1	76.9	54.9	63.1	71.2	50.3	57.8	65.3
		62	THC	75.1	75.1	88.1	72.3	72.3	84.8	68.1	68.1	79.9	63.1	63.1	74.1	57.9	57.9	67.9
			SHC	62.1	75.1	88.1	59.8	72.3	84.8	56.3	68.1	79.9	52.2	63.1	74.1	47.8	57.9	67.9
		67	THC	77.9	77.9	77.9	75.9	75.9	76.5	71.1	71.1	76	65	65	73.8	58.4	58.4	70.9
		SHC	47.3	60.6	73.8	48	62.2	76.5	46.8	61.4	76	44.6	59.2	73.8	42.1	56.5	70.9	
	72	THC	79.3	79.3	79.3	79.9	79.9	79.9	77.9	77.9	77.9	73.2	73.2	73.2	66.5	66.5	66.5	
		SHC	30.9	42.8	54.6	31.6	44.6	57.7	31.3	45.3	59.3	30	44.5	59	28.1	42.7	57.4	
		THC	–	80.1	80.1	–	81.2	81.2	–	80.6	80.6	–	77.6	77.6	–	72.5	72.5	
		SHC	–	32	45.4	–	32.4	46	–	32.5	46.4	–	31.8	46.1	–	30.6	45.1	

LEGEND

- Do not operate in this region (Points are outside SST and SDT permissible operating range)
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- THC – Total capacity

Table 12 – COOLING CAPACITIES 2-Stage Cooling 7.5 TONS

RHH090			AMBIENT TEMPERATURE															
			85			95			105			115			125			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	
2250 Cfm	EAT (wb)	58	THC	81.1	81.1	92.1	76.4	76.4	86.8	73.0	73.0	82.9	69.3	69.3	78.7	65.2	65.2	74.1
		SHC	70.1	81.1	92.1	66.0	76.4	86.8	63.1	73.0	82.9	59.8	69.3	78.7	56.4	65.2	74.1	
		62	THC	86.2	86.2	86.2	80.1	80.1	83.0	75.6	75.6	80.9	70.8	70.8	78.6	65.9	65.9	76.1
		SHC	62.5	74.2	85.9	59.7	71.3	83.0	57.6	69.3	80.9	55.4	67.0	78.6	53	64.5	76.1	
		67	THC	94.3	94.3	94.3	87.6	87.6	87.6	82.8	82.8	82.8	77.6	77.6	77.6	72.1	72.1	72.1
	SHC	51.3	63.0	74.6	48.5	60.1	71.8	46.5	58.1	69.8	44.4	56.0	67.7	42.2	53.8	65.5		
	72	THC	102.9	102.9	102.9	95.6	95.6	95.6	90.3	90.3	90.3	84.7	84.7	84.7	78.7	78.7	78.7	
	SHC	39.6	51.4	63.1	36.9	48.6	60.3	34.9	46.6	58.3	32.9	44.5	56.2	30.7	42.4	54.1		
	76	THC	–	109.9	109.9	–	102.1	102.1	–	96.4	96.4	–	90.5	90.5	–	84.1	84.1	
	SHC	–	41.8	54.2	–	39.1	51.4	–	37.2	49.4	–	35.2	47.2	–	33.1	45		
2625 Cfm	EAT (wb)	58	THC	85.7	85.7	97.3	80.6	80.6	91.5	76.9	76.9	87.3	72.8	72.8	82.7	68.5	68.5	77.8
		SHC	74.0	85.7	97.3	69.6	80.6	91.5	66.4	76.9	87.3	62.9	72.8	82.7	59.2	68.5	77.8	
		62	THC	89.0	89.0	94.2	82.6	82.6	91.1	78.0	78.0	88.7	73.3	73.3	85.3	68.5	68.5	81
		SHC	67.3	80.7	94.2	64.3	77.7	91.1	62.1	75.4	88.7	59.3	72.3	85.3	56.1	68.5	81	
		67	THC	97.2	97.2	97.2	90.1	90.1	90.1	85.0	85.0	85.0	79.6	79.6	79.6	73.8	73.8	73.8
	SHC	54.3	67.8	81.2	51.4	64.9	78.3	49.4	62.8	76.3	47.3	60.7	74.1	45	58.5	71.9		
	72	THC	105.8	105.8	105.8	98.1	98.1	98.1	92.6	92.6	92.6	86.7	86.7	86.7	80.5	80.5	80.5	
	SHC	40.9	54.4	67.9	38.1	51.5	65.0	36.1	49.5	63.0	34.0	47.4	60.9	31.8	45.3	58.7		
	76	THC	–	112.7	112.7	–	104.5	104.5	–	98.6	98.6	–	92.4	92.4	–	85.8	85.8	
	SHC	–	43.5	57.6	–	40.7	54.6	–	38.7	52.5	–	36.7	50.4	–	34.5	48.1		
3000 Cfm	EAT (wb)	58	THC	89.5	89.5	101.6	84.1	84.1	95.5	80.1	80.1	90.9	75.7	75.7	86.0	71.2	71.2	80.8
		SHC	77.3	89.5	101.6	72.6	84.1	95.5	69.2	80.1	90.9	65.5	75.7	86.0	61.5	71.2	80.8	
		62	THC	91.3	91.3	101.9	84.8	84.8	97.7	80.3	80.3	94.3	75.8	75.8	89.5	71.2	71.2	84.1
		SHC	71.7	86.8	101.9	68.2	83.0	97.7	65.5	79.9	94.3	62.1	75.8	89.5	58.3	71.2	84.1	
		67	THC	99.5	99.5	99.5	92.1	92.1	92.1	86.8	86.8	86.8	81.1	81.1	81.1	75.1	75.1	78.2
	SHC	57.2	72.4	87.5	54.2	69.4	84.6	52.2	67.4	82.6	50.0	65.2	80.4	47.8	63	78.2		
	72	THC	108.1	108.1	108.1	100.0	100.0	100.0	94.3	94.3	94.3	88.2	88.2	88.2	81.8	81.8	81.8	
	SHC	42.0	57.2	72.4	39.1	54.3	69.5	37.1	52.3	67.4	35.0	50.2	65.3	32.9	48	63.1		
	76	THC	–	114.8	114.8	–	106.3	106.3	–	100.3	100.3	–	93.8	93.8	–	87	87	
	SHC	–	44.9	60.6	–	42.0	57.6	–	40.1	55.5	–	38.0	53.3	–	35.8	51		
3375 Cfm	EAT (wb)	58	THC	92.8	92.8	105.4	87.0	87.0	98.8	82.8	82.8	94.0	78.2	78.2	88.9	73.4	73.4	83.4
		SHC	80.2	92.8	105.4	75.2	87.0	98.8	71.5	82.8	94.0	67.6	78.2	88.9	63.4	73.4	83.4	
		62	THC	93.6	93.6	108.0	87.1	87.1	102.8	82.8	82.8	97.8	78.3	78.3	92.5	73.5	73.5	86.8
		SHC	75.3	91.6	108.0	71.3	87.1	102.8	67.9	82.8	97.8	64.1	78.3	92.5	60.1	73.5	86.8	
		67	THC	101.3	101.3	101.3	93.6	93.6	93.6	88.1	88.1	88.6	82.3	82.3	86.4	76.2	76.2	84
	SHC	59.9	76.8	93.6	56.9	73.8	90.7	54.8	71.7	88.6	52.6	69.5	86.4	50.3	67.2	84		
	72	THC	109.8	109.8	109.8	101.5	101.5	101.5	95.6	95.6	95.6	89.3	89.3	89.3	82.8	82.8	82.8	
	SHC	43.0	59.9	76.7	40.1	56.9	73.8	38.1	54.9	71.7	36.0	52.8	69.6	33.8	50.6	67.4		
	76	THC	–	116.4	116.4	–	107.6	107.6	–	101.4	101.4	–	94.8	94.8	–	87.9	87.9	
	SHC	–	46.1	63.3	–	43.2	60.2	–	41.2	58.1	–	39.1	55.9	–	37	53.6		
3750 Cfm	EAT (wb)	58	THC	95.6	95.6	108.6	89.5	89.5	101.7	85.1	85.1	96.7	80.4	80.4	91.3	75.3	75.3	85.5
		SHC	82.6	95.6	108.6	77.4	89.5	101.7	73.6	85.1	96.7	69.4	80.4	91.3	65.1	75.3	85.5	
		62	THC	95.7	95.7	113.0	89.6	89.6	105.8	85.2	85.2	100.6	80.4	80.4	95.0	75.4	75.4	89
		SHC	78.3	95.7	113.0	73.4	89.6	105.8	69.7	85.2	100.6	65.8	80.4	95.0	61.7	75.4	89	
		67	THC	102.7	102.7	102.7	94.8	94.8	96.6	89.2	89.2	94.4	83.3	83.3	92.1	77.1	77.1	89.6
	SHC	62.5	81.0	99.6	59.5	78.0	96.6	57.4	75.9	94.4	55.1	73.6	92.1	52.8	71.2	89.6		
	72	THC	111.3	111.3	111.3	102.8	102.8	102.8	96.7	96.7	96.7	90.3	90.3	90.3	83.6	83.6	83.6	
	SHC	44.0	62.4	80.8	41.1	59.5	77.9	39.0	57.4	75.8	36.9	55.3	73.7	34.7	53.1	71.5		
	76	THC	–	117.5	117.5	–	108.6	108.6	–	102.3	102.3	–	95.6	95.6	–	88.6	88.6	
	SHC	–	47.2	65.7	–	44.3	62.6	–	42.3	60.5	–	40.2	58.2	–	38	55.9		

LEGEND

- Do not operate in this region (Points are outside SST and SDT permissible operating range)
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- THC – Total capacity

Table 13 – COOLING CAPACITIES 2-Stage Cooling 8.5 TONS

RHH102			AMBIENT TEMPERATURE															
			85			95			105			115			125			
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)			
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	
2550 Cfm	EAT (wb)	58	THC	85.8	85.8	97.8	80.9	80.9	91.8	75.7	75.7	85.9	70.2	70.2	79.7	64.4	64.4	73.1
		SHC	73.9	85.8	97.8	70	80.9	91.8	65.5	75.7	85.9	60.7	70.2	79.7	55.7	64.4	73.1	
		62	THC	90.4	90.4	94.5	83.8	83.8	91.4	76.8	76.8	88	70.5	70.5	82.7	64.5	64.5	76.1
		SHC	67.8	81.1	94.5	64.8	78.1	91.4	61.6	74.8	88	57.6	70.1	82.7	52.8	64.5	76.1	
		67	THC	101.6	101.6	101.6	95	95	95	87.4	87.4	87.4	79.3	79.3	79.3	71	71	71
	SHC	55.5	68.7	81.9	52.9	66.3	79.7	49.9	63.3	76.7	46.9	60.3	73.7	43.8	57.2	70.6		
	72	THC	109.3	109.3	109.3	106	106	106	99.6	99.6	99.6	91.4	91.4	91.4	82.7	82.7	82.7	
	SHC	41.1	54.1	67.2	39.9	53.3	66.6	37.7	51.1	64.6	34.9	48.3	61.7	32	45.4	58.8		
	76	THC	-	114.5	114.5	-	111.2	111.2	-	107.7	107.7	-	101	101	-	92.6	92.6	
	SHC	-	42.6	56.7	-	41.6	55.6	-	40.5	54.5	-	38.3	51.9	-	35.6	49.2		
2975 Cfm	EAT (wb)	58	THC	91.8	91.8	104.5	86.4	86.4	98	80.7	80.7	91.6	74.7	74.7	84.8	68.6	68.6	77.8
		SHC	79.1	91.8	104.5	74.7	86.4	98	69.8	80.7	91.6	64.6	74.7	84.8	59.3	68.6	77.8	
		62	THC	94.4	94.4	104.4	87.5	87.5	100.5	81	81	95.1	74.8	74.8	88.3	68.7	68.7	81
		SHC	73.8	89.1	104.4	70.3	85.4	100.5	66.1	80.6	95.1	61.3	74.8	88.3	56.3	68.7	81	
		67	THC	104.3	104.3	104.3	98.6	98.6	98.6	90.6	90.6	90.6	82.1	82.1	82.1	73.4	73.4	78.4
	SHC	58.7	73.7	88.6	56.8	72.3	87.8	53.8	69.3	84.8	50.7	66.1	81.6	47.5	62.9	78.4		
	72	THC	111.3	111.3	111.3	108	108	108	102.7	102.7	102.7	94.5	94.5	94.5	85.5	85.5	85.5	
	SHC	42.2	56.7	71.3	41	56.1	71.3	39.3	54.8	70.3	36.6	52.1	67.6	33.7	49.2	64.7		
	76	THC	-	116.3	116.3	-	112.7	112.7	-	109.2	109.2	-	103.5	103.5	-	95.4	95.4	
	SHC	-	44.3	60.6	-	43.1	59	-	41.9	57.7	-	40.2	56	-	37.7	53.4		
3400 Cfm	EAT (wb)	58	THC	96.6	96.6	109.9	91.1	91.1	103.4	85.1	85.1	96.6	78.7	78.7	89.3	72.1	72.1	81.8
		SHC	83.3	96.6	109.9	78.8	91.1	103.4	73.6	85.1	96.6	68.1	78.7	89.3	62.4	72.1	81.8	
		62	THC	97.7	97.7	112.8	91.7	91.7	106.8	85.3	85.3	100.7	78.8	78.8	93	72.2	72.2	85.2
		SHC	78.6	95.7	112.8	74.4	90.6	106.8	69.9	85.3	100.7	64.6	78.8	93	59.2	72.2	85.2	
		67	THC	106	106	106	101.2	101.2	101.2	93	93	93	84.4	84.4	89.2	75.5	75.5	85.8
	SHC	61.6	78.1	94.7	60.2	77.7	95.1	57.4	74.9	92.4	54.2	71.7	89.2	50.9	68.4	85.8		
	72	THC	112.7	112.7	112.7	109.3	109.3	109.3	104.8	104.8	104.8	96.8	96.8	96.8	87.7	87.7	87.7	
	SHC	43.1	59	75	41.9	58.5	75.2	40.7	58	75.4	38.1	55.7	73.2	35.2	52.8	70.4		
	76	THC	-	117.6	117.6	-	113.9	113.9	-	110.2	110.2	-	105.2	105.2	-	97.2	97.2	
	SHC	-	45.4	63	-	44.2	61.5	-	43.1	60.5	-	41.8	59.4	-	39.5	57.2		
3825 Cfm	EAT (wb)	58	THC	100.5	100.5	114.2	95.1	95.1	107.9	88.9	88.9	100.8	82.2	82.2	93.3	75.3	75.3	85.5
		SHC	86.7	100.5	114.2	82.3	95.1	107.9	76.9	88.9	100.8	71.1	82.2	93.3	65.2	75.3	85.5	
		62	THC	100.6	100.6	119	95.4	95.4	112.5	89	89	105	82.3	82.3	97.1	75.4	75.4	89
		SHC	82.3	100.6	119	78.2	95.4	112.5	72.9	89	105	67.5	82.3	97.1	61.8	75.4	89	
		67	THC	107.3	107.3	107.3	103.1	103.1	103.1	95.1	95.1	99.8	86.3	86.3	96.4	77.3	77.3	92.6
	SHC	64.1	82.2	100.2	63.4	82.7	102	60.8	80.3	99.8	57.6	77	96.4	54.2	73.4	92.6		
	72	THC	113.8	113.8	113.8	110.3	110.3	110.3	106.3	106.3	106.3	98.5	98.5	98.5	89.3	89.3	89.3	
	SHC	44	61.2	78.3	42.7	60.8	78.9	41.8	61	80.1	39.5	59	78.5	36.6	56.2	75.7		
	76	THC	-	118.6	118.6	-	114.8	114.8	-	110.9	110.9	-	106.3	106.3	-	98.5	98.5	
	SHC	-	46.4	65.1	-	45.2	63.9	-	44.2	63	-	43.2	62.5	-	41.1	60.7		
4250 Cfm	EAT (wb)	58	THC	103.2	103.2	117.2	98.5	98.5	111.8	92.2	92.2	104.6	85.3	85.3	96.8	78.1	78.1	88.7
		SHC	89.1	103.2	117.2	85.2	98.5	111.8	79.7	92.2	104.6	73.8	85.3	96.8	67.6	78.1	88.7	
		62	THC	103.2	103.2	121.8	98.6	98.6	116.3	92.3	92.3	108.9	85.4	85.4	100.7	78.2	78.2	92.3
		SHC	84.6	103.2	121.8	80.8	98.6	116.3	75.6	92.3	108.9	70	85.4	100.7	64.1	78.2	92.3	
		67	THC	108.3	108.3	108.3	104.5	104.5	108.3	96.8	96.8	106.7	88	88	103.2	79.3	79.3	97.6
	SHC	66.5	86	105.5	66.3	87.3	108.3	64	85.3	106.7	60.7	82	103.2	56.6	77.1	97.6		
	72	THC	114.7	114.7	114.7	111.1	111.1	111.1	107.3	107.3	107.3	99.9	99.9	99.9	90.6	90.6	90.6	
	SHC	44.8	63.1	81.5	43.5	62.9	82.3	42.8	63.5	84.2	40.7	62.1	83.5	37.9	59.4	81		
	76	THC	-	119.4	119.4	-	115.5	115.5	-	111.4	111.4	-	107.1	107.1	-	99.5	99.5	
	SHC	-	47.3	67	-	46.2	66	-	45.2	65.3	-	44.5	65.3	-	42.6	63.9		

LEGEND

- Do not operate in this region (Points are outside SST and SDT permissible operating range)
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- THC – Total capacity

Table 14 – COOLING CAPACITIES 2-Stage Cooling 10 TONS


50HCQD12			AMBIENT TEMPERATURE															
			85			95			105			115			125			
			EA (dB)			EA (dB)			EA (dB)			EA (dB)			EA (dB)			
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85	
3000 Cfm	EAT (wb)	58	THC	106.0	106.0	119.9	102.0	102.0	115.3	97.6	97.6	110.4	92.9	92.9	105.0	87.5	87.5	98.9
			SHC	92.2	106.0	119.9	88.6	102.0	115.3	84.9	97.6	110.4	80.7	92.9	105.0	76.1	87.5	98.9
		62	THC	112.3	112.3	113.3	107.1	107.1	110.7	101.5	101.5	107.9	95.4	95.4	104.7	88.9	88.9	100.5
			SHC	83.4	98.3	113.3	80.8	95.8	110.7	78.1	93.0	107.9	75.1	89.9	104.7	71.5	86.0	100.5
		67	THC	123.3	123.3	123.3	117.6	117.6	117.6	111.4	111.4	111.4	104.5	104.5	104.5	97.0	97.0	97.0
	SHC		69.2	84.3	99.3	66.7	81.7	96.8	64.1	79.1	94.1	61.2	76.2	91.2	58.0	73.0	88.0	
	72	THC	135.2	135.2	135.2	128.8	128.8	128.8	121.9	121.9	121.9	114.4	114.4	114.4	106.2	106.2	106.2	
		SHC	54.5	69.8	85.0	52.0	67.3	82.5	49.4	64.6	79.8	46.5	61.7	76.8	43.4	58.5	73.6	
	76	THC	-	145.1	145.1	-	138.2	138.2	-	130.7	130.7	-	122.6	122.6	-	113.7	113.7	
		SHC	-	57.9	74.3	-	55.4	71.8	-	52.8	69.1	-	50.0	66.1	-	46.9	62.8	
3500 Cfm	EAT (wb)	58	THC	111.6	111.6	126.2	107.3	107.3	121.4	102.6	102.6	116.0	97.4	97.4	110.2	91.6	91.6	103.6
			SHC	97.1	111.6	126.2	93.3	107.3	121.4	89.2	102.6	116.0	84.7	97.4	110.2	79.6	91.6	103.6
		62	THC	115.9	115.9	123.6	110.5	110.5	120.7	104.6	104.6	117.4	98.6	98.6	112.5	92.1	92.1	106.9
			SHC	89.4	106.5	123.6	86.7	103.7	120.7	83.7	100.5	117.4	79.8	96.1	112.5	75.4	91.2	106.9
		67	THC	127.0	127.0	127.0	120.9	120.9	120.9	114.3	114.3	114.3	107.1	107.1	107.1	99.2	99.2	99.2
	SHC		73.2	90.5	107.8	70.7	87.9	105.2	67.9	85.1	102.4	64.9	82.2	99.4	61.7	78.9	96.1	
	72	THC	139.1	139.1	139.1	132.3	132.3	132.3	125.0	125.0	125.0	117.0	117.0	117.0	108.4	108.4	108.4	
		SHC	56.4	73.8	91.3	53.8	71.2	88.6	51.1	68.4	85.8	48.1	65.4	82.8	44.9	62.2	79.5	
	76	THC	-	149.0	149.0	-	141.7	141.7	-	133.8	133.8	-	125.2	125.2	-	-	-	
		SHC	-	60.3	79.1	-	57.7	76.3	-	54.9	73.3	-	52.0	70.1	-	-	-	
4000 Cfm	EAT (wb)	58	THC	116.5	116.5	131.7	111.8	111.8	126.5	106.8	106.8	120.7	101.2	101.2	114.4	95.0	95.0	107.4
			SHC	101.2	116.5	131.7	97.2	111.8	126.5	92.8	106.8	120.7	88.0	101.2	114.4	82.5	95.0	107.4
		62	THC	118.9	118.9	133.1	113.5	113.5	128.6	107.8	107.8	123.8	101.7	101.7	118.4	95.1	95.1	111.7
			SHC	94.9	114.0	133.1	91.4	110.0	128.6	87.6	105.7	123.8	83.4	100.9	118.4	78.5	95.1	111.7
		67	THC	129.9	129.9	129.9	123.5	123.5	123.5	116.6	116.6	116.6	109.1	109.1	109.1	100.9	100.9	103.8
	SHC		77.0	96.4	115.9	74.4	93.8	113.2	71.5	90.9	110.3	68.5	87.8	107.2	65.2	84.5	103.8	
	72	THC	142.0	142.0	142.0	135.0	135.0	135.0	127.3	127.3	127.3	119.1	119.1	119.1	110.1	110.1	110.1	
		SHC	58.0	77.6	97.2	55.4	74.9	94.5	52.6	72.1	91.6	49.6	69.0	88.5	46.3	65.7	85.1	
	76	THC	-	152.0	152.0	-	144.4	144.4	-	136.2	136.2	-	-	-	-	-	-	
		SHC	-	62.4	83.1	-	59.7	80.2	-	56.9	77.2	-	-	-	-	-	-	
4500 Cfm	EAT (wb)	58	THC	120.6	120.6	136.3	115.7	115.7	130.8	110.3	110.3	124.7	104.4	104.4	118.0	97.8	97.8	110.5
			SHC	104.8	120.6	136.3	100.5	115.7	130.8	95.9	110.3	124.7	90.7	104.4	118.0	85.0	97.8	110.5
		62	THC	122.1	122.1	139.4	116.6	116.6	134.6	110.6	110.6	129.9	104.4	104.4	122.7	97.8	97.8	114.9
			SHC	98.8	119.1	139.4	95.1	114.9	134.6	91.3	110.6	129.9	86.2	104.4	122.7	80.7	97.8	114.9
		67	THC	132.2	132.2	132.2	125.5	125.5	125.5	118.4	118.4	118.4	110.6	110.6	114.6	102.2	102.2	111.0
	SHC		80.6	102.1	123.7	77.8	99.4	120.9	74.9	96.4	117.9	71.8	93.2	114.6	68.4	89.7	111.0	
	72	THC	144.4	144.4	144.4	137.1	137.1	137.1	129.2	129.2	129.2	120.7	120.7	120.7	111.4	111.4	111.4	
		SHC	59.5	81.2	102.8	56.8	78.4	100.1	54.0	75.5	97.1	50.9	72.4	93.9	47.6	69.1	90.5	
	76	THC	-	154.4	154.4	-	146.5	146.5	-	138.0	138.0	-	-	-	-	-	-	
		SHC	-	64.2	86.9	-	61.5	84.0	-	58.7	81.0	-	-	-	-	-	-	
5000 Cfm	EAT (wb)	58	THC	124.1	124.1	140.4	119.0	119.0	134.5	113.3	113.3	128.1	107.1	107.1	121.1	100.1	100.1	113.2
			SHC	107.9	124.1	140.4	103.4	119.0	134.5	98.5	113.3	128.1	93.1	107.1	121.1	87.0	100.1	113.2
		62	THC	124.9	124.9	144.9	119.2	119.2	140.0	113.4	113.4	133.2	107.1	107.1	125.8	100.2	100.2	117.7
			SHC	102.2	123.6	144.9	98.4	119.2	140.0	93.6	113.4	133.2	88.4	107.1	125.8	82.7	100.2	117.7
		67	THC	134.0	134.0	134.0	127.2	127.2	128.2	119.8	119.8	125.1	111.9	111.9	121.6	103.3	103.3	117.6
	SHC		83.9	107.5	131.1	81.1	104.7	128.2	78.2	101.6	125.1	74.9	98.3	121.6	71.3	94.5	117.6	
	72	THC	146.3	146.3	146.3	138.8	138.8	138.8	130.7	130.7	130.7	121.9	121.9	121.9	112.5	112.5	112.5	
		SHC	60.9	84.6	108.3	58.1	81.8	105.4	55.2	78.8	102.4	52.2	75.6	99.1	48.8	72.2	95.6	
	76	THC	-	156.4	156.4	-	148.2	148.2	-	-	-	-	-	-	-	-	-	
		SHC	-	66.0	90.6	-	63.3	87.6	-	-	-	-	-	-	-	-	-	

LEGEND

- Do not operate in this region
- Cfm - Cubic feet per minute (supply air)
- EAT(db) - Entering air temperature (dry bulb)
- EAT(wb) - Entering air temperature (wet bulb)
- SHC - Sensible heat capacity
- THC - Total capacity

Table 15 – HEATING CAPACITIES 3 TONS

RETURN AIR (°F db)		CFM (STANDARD AIR)		RHH036							TEMPERATURE AIR ENTERING OUTDOOR COIL (°F db AT 70% RH)	
				-10	0	10	17	30	40	47	50	60
55	900	Capacity	/	13.3	17.2	20.0	26.0	31.3	35.6	37.0	42.7	
		Int. Cap.		12.3	15.8	18.3	22.8	31.3	35.6	37.0	42.7	
		kW		1.9	2.0	2.1	2.2	2.4	2.6	2.7	2.9	
	1200	Capacity	/	13.8	17.8	20.8	27.0	32.8	36.9	38.3	44.1	
		Int. Cap.		12.7	16.3	18.9	23.6	32.8	36.9	38.3	44.1	
		kW		1.8	1.9	2.0	2.1	2.3	2.4	2.4	2.6	
	1500	Capacity	/	/	18.7	21.8	28.2	34.0	38.1	39.4	45.1	
		Int. Cap.			17.2	19.8	24.7	34.0	38.1	39.4	45.1	
		kW			2.0	2.1	2.2	2.4	2.4	2.5	2.6	
70	900	Capacity	7.5	11.0	14.9	17.8	23.6	28.5	32.7	34.2	40.4	
		Int. Cap.	6.9	10.2	13.7	16.2	20.7	28.5	32.7	34.2	40.4	
		kW	2.1	2.2	2.3	2.4	2.6	2.7	2.9	3.0	3.3	
	1200	Capacity	7.9	11.6	15.6	18.6	24.7	29.9	34.6	36.0	41.9	
		Int. Cap.	7.3	10.7	14.3	16.9	21.6	29.9	34.6	36.0	41.9	
		kW	2.0	2.1	2.2	2.3	2.4	2.6	2.8	2.8	3.0	
	1500	Capacity	8.7	12.4	16.5	19.6	25.8	31.3	35.9	37.3	43.1	
		Int. Cap.	8.0	11.4	15.1	17.8	22.6	31.3	35.9	37.3	43.1	
		kW	2.2	2.2	2.3	2.4	2.5	2.6	2.8	2.8	3.0	
80	900	Capacity	5.7	9.3	13.2	16.1	21.9	26.8	30.5	32.1	38.4	
		Int. Cap.	5.3	8.5	12.1	14.7	19.2	26.8	30.5	32.1	38.4	
		kW	2.3	2.4	2.5	2.6	2.8	3.0	3.2	3.2	3.6	
	1200	Capacity	6.1	9.8	13.9	16.9	22.9	28.1	32.3	33.9	40.3	
		Int. Cap.	5.6	9.0	12.7	15.4	20.1	28.1	32.3	33.9	40.3	
		kW	2.2	2.3	2.4	2.5	2.7	2.8	3.0	3.1	3.3	
	1500	Capacity	6.8	10.6	14.8	17.9	24.1	29.4	34.0	35.6	41.6	
		Int. Cap.	6.3	9.8	13.6	16.3	21.1	29.4	34.0	35.6	41.6	
		kW	2.4	2.5	2.5	2.6	2.7	2.9	3.0	3.1	3.3	

 – Indicates operation not permissible

LEGEND

- Capacity – Instantaneous Capacity (1000 Btuh) includes indoor fan motor heat @AHRI static conditions
- Int. Cap. – Integrated Capacity is Instantaneous Capacity minus the effects of frost on the outdoor coil and the heat required to defrost
- RH – Relative Humidity
- db – Dry Bulb

Table 16 – HEATING CAPACITIES 4 TONS







RETURN AIR (°F db)		CFM (STANDARD AIR)		RHH048							TEMPERATURE AIR ENTERING OUTDOOR COIL (°F db AT 70% RH)	
				-10	0	10	17	30	40	47	50	60
55	1200	Capacity		18.5	23.8	27.7	35.3	41.9	47.6	49.3	56.5	
		Int. Cap.		17.1	21.8	25.2	30.9	41.9	47.6	49.3	56.5	
		kW		2.6	2.7	2.8	3.1	3.3	3.6	3.6	3.9	
	1600	Capacity		18.8	24.3	28.4	36.1	43.6	48.7	50.4	57.4	
		Int. Cap.		17.3	22.3	25.9	31.6	43.6	48.7	50.4	57.4	
		kW		2.5	2.6	2.6	2.8	3.1	3.2	3.3	3.5	
	2000	Capacity		19.8	25.3	29.7	37.5	44.9	49.8	51.4	58.0	
		Int. Cap.		18.2	23.2	27.1	32.9	44.9	49.8	51.4	58.0	
		kW		2.6	2.7	2.8	2.9	3.2	3.3	3.3	3.5	
70	1200	Capacity	10.9	16.2	21.4	25.2	32.8	38.9	44.0	46.0	54.0	
		Int. Cap.	10.1	14.9	19.7	23.0	28.7	38.9	44.0	46.0	54.0	
		kW	2.8	2.9	3.1	3.2	3.5	3.7	4.0	4.1	4.5	
	1600	Capacity	11.2	16.6	22.0	25.9	34.0	40.0	46.1	48.0	55.2	
		Int. Cap.	10.3	15.3	20.2	23.6	29.8	40.0	46.1	48.0	55.2	
		kW	2.7	2.8	2.9	3.0	3.2	3.4	3.7	3.8	4.0	
	2000	Capacity	12.1	17.7	23.2	27.1	35.2	41.8	47.7	49.4	56.2	
		Int. Cap.	11.2	16.2	21.2	24.7	30.9	41.8	47.7	49.4	56.2	
		kW	2.9	2.9	3.0	3.1	3.3	3.5	3.7	3.8	4.0	
80	1200	Capacity	8.9	14.3	19.6	23.3	30.8	37.4	41.8	43.6	51.8	
		Int. Cap.	8.2	13.1	18.0	21.3	27.0	37.4	41.8	43.6	51.8	
		kW	3.0	3.2	3.3	3.5	3.8	4.1	4.3	4.4	4.8	
	1600	Capacity	9.2	14.7	20.2	24.1	31.9	38.4	43.4	45.5	53.5	
		Int. Cap.	8.5	13.6	18.6	22.0	28.0	38.4	43.4	45.5	53.5	
		kW	2.9	3.0	3.2	3.3	3.5	3.8	4.0	4.1	4.4	
	2000	Capacity	10.1	15.8	21.4	25.3	33.4	39.8	45.4	47.4	54.7	
		Int. Cap.	9.4	14.5	19.6	23.1	29.2	39.8	45.4	47.4	54.7	
		kW	3.1	3.2	3.3	3.4	3.6	3.8	4.0	4.1	4.4	

– Indicates operation not permissible

LEGEND

- Capacity – Instantaneous Capacity (1000 Btuh) includes indoor fan motor heat @AHRI static conditions
- Int. Cap. – Integrated Capacity is Instantaneous Capacity minus the effects of frost on the outdoor coil and the heat required to defrost
- RH – Relative Humidity
- db – Dry Bulb

Table 17 – HEATING CAPACITIES 5 TONS

RETURN AIR (°F db)		CFM (STANDARD AIR)		RHH060							
				TEMPERATURE AIR ENTERING OUTDOOR COIL (°F db AT 70% RH)							
				-10	0	10	17	30	40	47	50
55	1500	Capacity		22.0	28.5	33.3	43.5	51.4	58.0	60.1	68.6
		Int. Cap.		20.3	26.1	30.4	38.1	51.4	58.0	60.1	68.6
		kW		2.9	3.1	3.2	3.5	3.7	3.8	3.9	4.1
	2000	Capacity		23.9	30.5	35.5	45.7	54.1	60.4	62.3	69.9
		Int. Cap.		22.0	28.0	32.4	40.1	54.1	60.4	62.3	69.9
		kW		3.2	3.3	3.4	3.6	3.8	3.9	3.9	4.1
	2500	Capacity		25.0	31.7	36.9	47.1	55.2	60.7	62.3	68.8
		Int. Cap.		23.0	29.1	33.6	41.3	55.2	60.7	62.3	68.8
		kW		3.3	3.4	3.5	3.7	3.8	3.9	3.9	4.0
70	1500	Capacity		18.9	25.3	30.1	40.1	48.4	54.8	56.8	65.4
		Int. Cap.		17.4	23.3	27.5	35.2	48.4	54.8	56.8	65.4
		kW		3.4	3.5	3.6	3.9	4.2	4.4	4.5	4.7
	2000	Capacity		20.7	27.4	32.3	43.0	50.9	57.4	59.3	67.4
		Int. Cap.		19.1	25.1	29.4	37.7	50.9	57.4	59.3	67.4
		kW		3.6	3.7	3.8	4.1	4.3	4.4	4.4	4.6
	2500	Capacity		21.9	28.6	33.6	44.4	52.5	58.5	60.3	67.3
		Int. Cap.		20.1	26.3	30.7	38.9	52.5	58.5	60.3	67.3
		kW		3.7	3.8	3.9	4.1	4.3	4.4	4.4	4.6
80	1500	Capacity	10.3	16.5	23.1	27.8	37.4	46.2	52.4	54.7	63.2
		Int. Cap.	9.5	15.2	21.2	25.4	32.8	46.2	52.4	54.7	63.2
		kW	3.5	3.7	3.9	4.0	4.3	4.6	4.8	4.9	5.2
	2000	Capacity	12.0	18.4	25.1	30.0	40.1	48.9	55.2	57.4	65.4
		Int. Cap.	11.1	16.9	23.0	27.4	35.2	48.9	55.2	57.4	65.4
		kW	3.8	3.9	4.1	4.2	4.4	4.6	4.8	4.9	5.1
	2500	Capacity	13.0	19.5	26.3	31.4	41.9	50.5	56.6	58.4	65.7
		Int. Cap.	12.0	18.0	24.2	28.6	36.7	50.5	56.6	58.4	65.7
		kW	3.9	4.0	4.2	4.3	4.5	4.7	4.8	4.8	5.0

 – Indicates operation not permissible

LEGEND

- Capacity – Instantaneous Capacity (1000 Btuh) includes indoor fan motor heat @AHRI static conditions
- Int. Cap. – Integrated Capacity is Instantaneous Capacity minus the effects of frost on the outdoor coil and the heat required to defrost
- RH – Relative Humidity
- db – Dry Bulb

Table 18 – HEATING CAPACITIES 6 TONS

		RHH072									
RETURN AIR (°F db)	CFM (STANDARD AIR)		TEMPERATURE AIR ENTERING OUTDOOR COIL (°F db AT 70% RH)								
			-10	0	10	17	30	40	47	50	60
55	900	Capacity	20.5	28.2	36.0	41.6	52.8	62.7	71.0	73.5	83.8
		Int. Cap.	19.0	25.9	33.0	38.0	46.3	62.7	71.0	73.5	83.8
		kW	4.0	4.2	4.4	4.5	4.7	5.0	5.2	5.3	5.5
	1200	Capacity	/	29.0	37.0	42.8	54.4	65.4	73.0	75.4	86.1
		Int. Cap.	/	26.7	34.0	39.1	47.7	65.4	73.0	75.4	86.1
		kW	/	4.1	4.2	4.3	4.5	4.8	4.9	4.9	5.1
1500	Capacity	/	29.5	37.6	43.5	55.4	66.4	73.9	76.4	87.2	
	Int. Cap.	/	27.1	34.5	39.7	48.5	66.4	73.9	76.4	87.2	
	kW	/	4.0	4.1	4.2	4.4	4.6	4.7	4.7	4.9	
70	900	Capacity	15.8	23.6	31.6	37.3	48.5	57.7	65.5	68.5	79.7
		Int. Cap.	14.6	21.7	29.0	34.0	42.5	57.7	65.5	68.5	79.7
		kW	4.5	4.7	4.9	5.0	5.3	5.5	5.7	5.8	6.1
	1200	Capacity	16.4	24.6	32.8	38.7	50.2	60.1	68.9	71.7	82.3
		Int. Cap.	15.1	22.6	30.1	35.3	44.0	60.1	68.9	71.7	82.3
		kW	4.4	4.6	4.8	4.9	5.1	5.2	5.5	5.5	5.7
1500	Capacity	16.8	25.1	33.5	39.5	51.3	61.6	70.5	73.0	83.6	
	Int. Cap.	15.5	23.1	30.8	36.1	44.9	61.6	70.5	73.0	83.6	
	kW	4.4	4.6	4.7	4.8	4.9	5.1	5.3	5.3	5.5	
80	900	Capacity	11.9	20.0	28.1	33.9	45.2	54.3	61.5	64.5	76.1
		Int. Cap.	11.0	18.4	25.8	30.9	39.6	54.3	61.5	64.5	76.1
		kW	4.8	5.0	5.3	5.4	5.7	5.9	6.1	6.2	6.5
	1200	Capacity	12.5	20.9	29.3	35.4	47.0	56.7	64.6	67.7	79.4
		Int. Cap.	11.5	19.2	26.9	32.3	41.2	56.7	64.6	67.7	79.4
		kW	4.8	5.0	5.1	5.3	5.5	5.6	5.8	5.9	6.1
1500	Capacity	12.8	21.4	30.1	36.2	48.1	57.9	66.5	69.6	80.9	
	Int. Cap.	11.8	19.7	27.6	33.0	42.1	57.9	66.5	69.6	80.9	
	kW	4.8	4.9	5.1	5.2	5.3	5.5	5.6	5.7	5.9	

 – Indicates operation not permissible

 = Indicates standard rating point

LEGEND

- Capacity – Instantaneous Capacity (1000 Btuh) includes indoor fan motor heat @AHRI static conditions
- Int. Cap. – Integrated Capacity is Instantaneous Capacity minus the effects of frost on the outdoor coil and the heat required to defrost
- RH – Relative Humidity
- db – Dry Bulb

Table 19 – HEATING CAPACITIES 7.5 TONS

RHH090											
RETURN AIR (°F db)	CFM (STANDARD AIR)		TEMPERATURE AIR ENTERING OUTDOOR COIL (°F db AT 70% RH)								
			-10	0	10	17	30	40	47	50	60
55	2250	Capacity	24.3	33.6	43.4	50.6	66.3	78.0	87.4	90.4	102.6
		Int. Cap.	22.4	30.9	39.8	46.2	58.1	78.0	87.4	90.4	102.6
		kW	4.8	5.0	5.2	5.4	5.8	6.1	6.3	6.4	6.7
	3000	Capacity	24.7	34.2	44.3	51.8	67.8	80.2	89.6	92.5	104.6
		Int. Cap.	22.8	31.5	40.7	47.3	59.4	80.2	89.6	92.5	104.6
		kW	4.7	4.9	5.0	5.1	5.4	5.7	5.9	5.9	6.2
	3750	Capacity	24.9	34.6	44.9	52.6	68.7	81.3	90.4	93.1	104.3
		Int. Cap.	23.1	31.9	41.2	48.0	60.2	81.3	90.4	93.1	104.3
		kW	4.7	4.8	4.9	5.0	5.3	5.5	5.6	5.6	5.8
70	2250	Capacity	20.3	29.6	39.3	46.5	60.8	73.8	82.7	85.9	98.3
		Int. Cap.	18.7	27.2	36.1	42.4	53.3	73.8	82.7	85.9	98.3
		kW	5.5	5.7	5.9	6.1	6.5	6.9	7.2	7.3	7.7
	3000	Capacity	20.8	30.4	40.5	47.9	63.4	75.9	85.4	88.5	100.6
		Int. Cap.	19.3	28.0	37.2	43.6	55.6	75.9	85.4	88.5	100.6
		kW	5.4	5.6	5.8	5.9	6.2	6.5	6.7	6.7	7.0
	3750	Capacity	21.2	31.0	41.2	48.7	64.8	77.2	86.8	89.8	101.4
		Int. Cap.	19.6	28.5	37.8	44.4	56.7	77.2	86.8	89.8	101.4
		kW	5.4	5.5	5.6	5.7	6.0	6.2	6.4	6.4	6.6
80	2250	Capacity	16.8	26.2	36.0	43.2	57.2	70.2	79.5	82.8	95.2
		Int. Cap.	15.5	24.1	33.0	39.4	50.1	70.2	79.5	82.8	95.2
		kW	6.0	6.2	6.5	6.7	7.1	7.5	7.9	8.0	8.4
	3000	Capacity	17.4	27.1	37.2	44.6	59.3	73.0	82.1	85.4	97.7
		Int. Cap.	16.1	24.9	34.2	40.7	52.0	73.0	82.1	85.4	97.7
		kW	5.9	6.1	6.3	6.4	6.7	7.1	7.3	7.4	7.7
	3750	Capacity	17.7	27.6	38.0	45.5	60.6	74.3	83.7	87.0	98.8
		Int. Cap.	16.4	25.4	34.9	41.5	53.1	74.3	83.7	87.0	98.8
		kW	5.9	6.0	6.2	6.3	6.5	6.8	7.0	7.0	7.3

■ = Indicates standard rating point

LEGEND

- Capacity – Instantaneous Capacity (1000 Btuh) includes indoor fan motor heat @AHRI static conditions
- Int. Cap. – Integrated Capacity is Instantaneous Capacity minus the effects of frost on the outdoor coil and the heat required to defrost
- RH – Relative Humidity
- dD – Dry Bulb

Table 20 – HEATING CAPACITIES 8.5 TONS

RHH102											
RETURN AIR (°F db)	CFM (STANDARD AIR)		TEMPERATURE AIR ENTERING OUTDOOR COIL (°F db AT 70% RH)								
			-10	0	10	17	30	40	47	50	60
55	2250	Capacity	35.1	37.7	49.0	57.4	74.4	87.8	98.9	102.6	118.3
		Int. Cap.	32.5	34.7	45.0	52.3	65.2	87.8	98.9	102.6	118.3
		kW	5.4	5.3	5.5	5.7	6.1	6.4	6.7	6.7	7.1
	3400	Capacity	32.6	39.1	50.8	59.4	76.8	90.8	102.1	105.7	121.3
		Int. Cap.	30.1	36.0	46.6	54.1	67.3	90.8	102.1	105.7	121.3
		kW	5.4	5.3	5.5	5.7	6.0	6.2	6.4	6.4	6.7
	4250	Capacity	34.4	42.6	54.4	63.3	80.9	95.1	106.1	109.6	125.0
		Int. Cap.	31.8	39.2	50.0	57.7	70.9	95.1	106.1	109.6	125.0
		kW	6.2	6.2	6.3	6.4	6.7	6.9	7.0	7.1	7.3
70	2250	Capacity	35.2	33.3	44.5	52.8	69.3	83.1	93.6	97.3	112.9
		Int. Cap.	32.6	30.6	40.9	48.1	60.7	83.1	93.6	97.3	112.9
		kW	6.3	6.0	6.3	6.5	6.9	7.3	7.6	7.7	8.1
	3400	Capacity	35.6	34.9	46.5	55.0	72.5	86.1	97.1	100.8	116.2
		Int. Cap.	32.9	32.1	42.7	50.1	63.5	86.1	97.1	100.8	116.2
		kW	6.3	6.1	6.3	6.5	6.8	7.1	7.3	7.3	7.6
	4250	Capacity	38.2	38.6	50.3	59.0	76.7	90.5	101.6	105.2	120.2
		Int. Cap.	35.3	35.5	46.2	53.7	67.2	90.5	101.6	105.2	120.2
		kW	7.2	6.9	7.1	7.2	7.5	7.7	7.9	7.9	8.2
80	2250	Capacity	34.6	29.6	40.9	49.1	65.4	79.8	89.9	93.8	109.1
		Int. Cap.	32.0	27.2	37.5	44.8	57.3	79.8	89.9	93.8	109.1
		kW	7.1	6.6	6.9	7.1	7.5	8.0	8.3	8.4	8.8
	3400	Capacity	35.2	31.2	42.8	51.4	68.2	82.7	93.4	97.2	112.5
		Int. Cap.	32.5	28.7	39.3	46.8	59.8	82.7	93.4	97.2	112.5
		kW	7.1	6.7	6.9	7.1	7.4	7.7	8.0	8.1	8.4
	4250	Capacity	38.2	34.9	46.7	55.4	72.7	87.1	98.2	101.8	116.8
		Int. Cap.	35.3	32.1	42.9	50.5	63.7	87.1	98.2	101.8	116.8
		kW	7.9	7.5	7.7	7.8	8.1	8.4	8.6	8.6	8.9

■ = Indicates standard rating point

LEGEND

- Capacity – Instantaneous Capacity (1000 Btuh) includes indoor fan motor heat @AHRI static conditions
- Int. Cap. – Integrated Capacity is Instantaneous Capacity minus the effects of frost on the outdoor coil and the heat required to defrost
- RH – Relative Humidity
- db – Dry Bulb

Table 21 – HEATING CAPACITIES 10 TONS

RHH120											
RETURN AIR (°F db)	CFM (STANDARD AIR)		TEMPERATURE AIR ENTERING OUTDOOR COIL (°F db AT 70% RH)								
			-10	0	10	17	30	40	47	50	60
55	3000	Capacity	39.8	50.9	62.9	72.7	91.4	106.1	117.2	121.0	136.2
		Int. Cap.	36.8	46.8	57.8	66.3	80.1	106.1	117.2	121.0	136.2
		kW	6.23	6.55	6.87	7.15	7.71	8.20	8.62	8.76	9.39
	4000	Capacity	42.1	53.5	66.0	75.9	94.8	109.6	120.7	124.3	139.4
		Int. Cap.	39.0	49.2	60.6	69.2	83.0	109.6	120.7	124.3	139.4
		kW	6.50	6.75	7.01	7.22	7.65	8.03	8.36	8.47	8.96
	5000	Capacity	44.5	56.0	69.1	79.1	97.5	112.3	123.0	126.3	140.9
		Int. Cap.	41.2	51.5	63.4	72.1	85.4	112.3	123.0	126.3	140.9
		kW	6.93	7.15	7.38	7.56	7.91	8.25	8.51	8.60	9.01
70	3000	Capacity	34.6	45.8	57.9	66.9	86.4	101.6	112.2	116.3	131.2
		Int. Cap.	32.0	42.1	53.1	61.0	75.7	101.6	112.2	116.3	131.2
		kW	7.04	7.42	7.81	8.11	8.82	9.41	9.86	10.06	10.75
	4000	Capacity	37.0	48.5	60.9	70.4	90.4	105.1	116.1	120.0	134.8
		Int. Cap.	34.2	44.6	55.9	64.2	79.3	105.1	116.1	120.0	134.8
		kW	7.31	7.62	7.93	8.17	8.73	9.16	9.53	9.66	10.21
	5000	Capacity	39.4	51.1	63.7	73.6	93.5	108.0	118.9	122.5	137.0
		Int. Cap.	36.4	47.0	58.4	67.1	81.9	108.0	118.9	122.5	137.0
		kW	7.74	8.01	8.28	8.48	8.96	9.33	9.63	9.74	10.21
80	3000	Capacity	30.4	41.9	54.1	63.1	82.6	98.5	108.9	113.1	127.9
		Int. Cap.	28.1	38.6	49.6	57.6	72.3	98.5	108.9	113.1	127.9
		kW	7.65	8.09	8.53	8.86	9.64	10.34	10.83	11.05	11.80
	4000	Capacity	32.8	44.6	57.1	66.5	86.5	102.1	112.7	116.9	131.5
		Int. Cap.	30.4	41.1	52.4	60.6	75.8	102.1	112.7	116.9	131.5
		kW	7.92	8.28	8.64	8.90	9.51	10.03	10.43	10.58	11.17
	5000	Capacity	35.2	47.2	59.9	69.4	89.8	105.1	115.8	119.6	134.0
		Int. Cap.	32.6	43.5	55.0	63.3	78.7	105.1	115.8	119.6	134.0
		kW	8.36	8.68	8.98	9.19	9.72	10.15	10.49	10.61	11.12

LEGEND

- Capacity – Instantaneous Capacity (1000 Btuh) includes indoor fan motor heat @AHRI static conditions
- Int. Cap. – Integrated Capacity is Instantaneous Capacity minus the effects of frost on the outdoor coil and the heat required to defrost
- RH – Relative Humidity
- db – Dry Bulb

Table 22 – STATIC PRESSURE ADDERS (Factory Options and/or Accessories)

Economizer

3 - 5 TONS											
CFM (in. wg)	600	800	1000	1250	1500	1750	2000	2250	2500	2750	3000
Vertical Economizer	0.01	0.02	0.04	0.05	0.07	0.09	0.12	0.15	0.18	0.22	0.26
Horizontal Economizer	0.02	0.03	0.04	0.06	0.08	0.10	0.13	0.15	0.18	0.23	0.28

6 - 10 TONS																
CFM (in. wg)	2250	2500	2750	3000	3250	3500	3750	4000	4250	4500	4750	5000	5250	5500	5750	6000
Vertical Economizer	0.06	0.08	0.09	0.12	0.13	0.15	0.17	0.20	0.22	0.25	0.29	0.33	0.36	0.40	0.44	0.48
Horizontal Economizer	0.08	0.10	0.13	0.15	0.18	0.21	0.25	0.28	0.30	0.34	0.39	0.43	0.47	0.51	0.56	0.60

Electric Heaters

3 - 5 TONS											
CFM (in. wg)	600	900	1200	1400	1600	1800	2000	2200	2400	2600	
1 Electric Heater Module	0.03	0.05	0.07	0.09	0.09	0.10	0.11	0.11	0.12	0.13	
2 Electric Heater Modules	0.13	0.15	0.16	0.16	0.16	0.17	0.17	0.17	0.18	0.18	

6 - 10 TONS																
CFM (in. wg)	2250	2500	2750	3000	3250	3500	3750	4000	4250	4500	4750	5000	5250	5500	5750	6000
1 Electric Heater Module	0.03	0.04	0.04	0.05	0.06	0.07	0.08	0.09	0.10	0.11	0.12	0.13	0.14	0.15	0.16	0.18
2 Electric Heater Modules	0.04	0.05	0.05	0.06	0.07	0.08	0.09	0.10	0.11	0.12	0.13	0.15	0.16	0.17	0.19	0.20

General fan performance notes:

1. Interpolation is permissible. Do not extrapolate.
2. External static pressure is the static pressure difference between the return duct and the supply duct plus the static pressure caused by any FIOPs or accessories.
3. Tabular data accounts for pressure loss due to clean filters, unit casing, and wet coils. Factory options and accessories may add static pressure losses.
4. The Fan Performance tables offer motor/drive recommendations. In cases when two motor/drive combinations would work, recommend the lower horsepower option.
5. For information on the electrical properties of motors, please see the Electrical information section of this book.
6. For more information on the performance limits of motors, see the application data section of this book.

FAN PERFORMANCE

**Table 23 – 3 TON DIRECT DRIVE, ECM MOTOR,
HORIZONTAL SUPPLY**

SPEED (TORQUE) TAP	CFM	ESP	BHP
1	900	0.57	0.25
	975	0.47	0.24
	1050	0.37	0.22
	1125	0.27	0.21
	1200	0.18	0.20
	1275	0.09	0.20
	1350	–	–
	1425	–	–
	1500	–	–
2	900	0.73	0.30
	975	0.62	0.29
	1050	0.51	0.28
	1125	0.41	0.27
	1200	0.30	0.25
	1275	0.19	0.24
	1350	0.08	0.22
	1425	–	–
	1500	–	–
3	900	1.04	0.41
	975	0.93	0.40
	1050	0.82	0.39
	1125	0.70	0.38
	1200	0.58	0.36
	1275	0.46	0.35
	1350	0.34	0.33
	1425	0.23	0.31
	1500	0.12	0.30
4	900	1.26	0.49
	975	1.18	0.50
	1050	1.09	0.50
	1125	0.99	0.50
	1200	0.88	0.49
	1275	0.76	0.47
	1350	0.63	0.46
	1425	0.50	0.44
	1500	0.37	0.42
5	900	1.35	0.52
	975	1.30	0.54
	1050	1.26	0.57
	1125	1.21	0.59
	1200	1.16	0.62
	1275	1.12	0.64
	1350	1.07	0.67
	1425	1.02	0.70
	1500	0.97	0.73

**Table 24 – 3 TON DIRECT DRIVE, ECM MOTOR,
VERTICAL SUPPLY**

SPEED (TORQUE) TAP	CFM	ESP	BHP
1	900	0.44	0.19
	975	0.34	0.18
	1050	0.24	0.17
	1125	0.15	0.16
	1200	0.07	0.16
	1275	–	–
	1350	–	–
	1425	–	–
	1500	–	–
2	900	0.60	0.24
	975	0.49	0.23
	1050	0.38	0.22
	1125	0.28	0.21
	1200	0.18	0.20
	1275	0.09	0.19
	1350	–	–
	1425	–	–
	1500	–	–
3	900	0.93	0.36
	975	0.81	0.35
	1050	0.70	0.34
	1125	0.58	0.33
	1200	0.47	0.31
	1275	0.36	0.30
	1350	0.25	0.29
	1425	0.14	0.27
	1500	–	–
4	900	1.15	0.44
	975	1.07	0.45
	1050	0.97	0.46
	1125	0.86	0.46
	1200	0.74	0.43
	1275	0.61	0.41
	1350	0.48	0.40
	1425	0.35	0.39
	1500	0.23	0.37
5	900	1.24	0.51
	975	1.19	0.52
	1050	1.24	0.54
	1125	1.24	0.57
	1200	1.03	0.59
	1275	0.98	0.61
	1350	0.93	0.64
	1425	0.88	0.67
	1500	0.82	0.69

FAN PERFORMANCE

**Table 25 – 4 TON DIRECT DRIVE, ECM MOTOR,
HORIZONTAL SUPPLY**

SPEED (TORQUE) TAP	CFM	ESP	BHP
1	1200	0.93	0.48
	1300	0.80	0.46
	1400	0.66	0.44
	1500	0.51	0.41
	1600	0.36	0.39
	1700	0.22	0.36
	1800	0.08	0.33
	1900	–	–
	2000	–	–
2	1200	1.04	0.53
	1300	0.91	0.51
	1400	0.76	0.48
	1500	0.61	0.46
	1600	0.45	0.43
	1700	0.30	0.40
	1800	0.16	0.38
	1900	0.04	0.35
	2000	–	–
3	1200	1.18	0.58
	1300	1.09	0.59
	1400	0.98	0.60
	1500	0.86	0.60
	1600	0.72	0.57
	1700	0.57	0.54
	1800	0.42	0.51
	1900	0.28	0.48
	2000	0.15	0.45
4	1200	1.24	0.60
	1300	1.18	0.63
	1400	1.12	0.66
	1500	1.04	0.71
	1600	0.95	0.70
	1700	0.85	0.71
	1800	0.73	0.71
	1900	0.60	0.69
	2000	0.45	0.65
5	1200	1.25	0.61
	1300	1.20	0.65
	1400	1.12	0.68
	1500	1.04	0.68
	1600	1.05	0.76
	1700	1.01	0.76
	1800	0.96	0.84
	1900	0.91	0.89
	2000	0.87	0.93

**Table 26 – 4 TON DIRECT DRIVE, ECM MOTOR,
VERTICAL SUPPLY**

SPEED (TORQUE) TAP	CFM	ESP	BHP
1	1200	0.87	0.43
	1300	0.73	0.41
	1400	0.59	0.39
	1500	0.43	0.37
	1600	0.27	0.34
	1700	0.12	0.33
	1800	–	–
	1900	–	–
	2000	–	–
2	1200	0.96	0.48
	1300	0.84	0.46
	1400	0.69	0.44
	1500	0.53	0.41
	1600	0.37	0.39
	1700	0.21	0.36
	1800	0.06	0.34
	1900	–	–
	2000	–	–
3	1200	1.13	0.53
	1300	1.06	0.53
	1400	0.98	0.54
	1500	0.88	0.56
	1600	0.76	0.54
	1700	0.62	0.52
	1800	0.47	0.50
	1900	0.31	0.47
	2000	0.15	0.45
4	1200	1.16	0.57
	1300	1.12	0.59
	1400	1.07	0.62
	1500	1.00	0.67
	1600	0.91	0.66
	1700	0.80	0.67
	1800	0.67	0.67
	1900	0.52	0.63
	2000	0.35	0.61
5	1200	1.16	0.59
	1300	1.11	0.63
	1400	1.01	0.67
	1500	0.91	0.67
	1600	0.96	0.75
	1700	0.91	0.75
	1800	0.86	0.83
	1900	0.80	0.87
	2000	0.74	0.91

FAN PERFORMANCE

**Table 27 – 5 TON DIRECT DRIVE, ECM MOTOR,
HORIZONTAL SUPPLY**

SPEED (TORQUE) TAP	CFM	ESP	BHP
1	1500	0.37	0.35
	1625	0.22	0.33
	1750	0.08	0.31
	1875	–	–
	2000	–	–
	2125	–	–
	2250	–	–
	2375	–	–
	2500	–	–
2	1500	0.54	0.44
	1625	0.37	0.41
	1750	0.20	0.38
	1875	0.04	0.35
	2000	–	–
	2125	–	–
	2250	–	–
	2375	–	–
	2500	–	–
3	1500	1.28	0.83
	1625	1.10	0.81
	1750	0.90	0.78
	1875	0.68	0.74
	2000	0.47	0.70
	2125	0.27	0.66
	2250	0.10	0.62
	2375	–	–
	2500	–	–
4	1500	1.46	0.94
	1625	1.32	0.92
	1750	1.16	0.96
	1875	0.96	0.95
	2000	0.76	0.91
	2125	0.54	0.86
	2250	0.33	0.82
	2375	0.14	0.78
	2500	0.00	0.72
5	1500	1.52	0.97
	1625	1.42	1.01
	1750	1.16	1.05
	1875	0.96	1.09
	2000	1.00	1.09
	2125	0.82	1.06
	2250	0.62	1.02
	2375	0.40	0.98
	2500	0.16	0.93

**Table 28 – 5 TON DIRECT DRIVE, ECM MOTOR,
VERTICAL SUPPLY**

SPEED (TORQUE) TAP	CFM	ESP	BHP
1	1500	0.27	0.32
	1625	0.13	0.30
	1750	–	–
	1875	–	–
	2000	–	–
	2125	–	–
	2250	–	–
	2375	–	–
	2500	–	–
2	1500	0.42	0.40
	1625	0.25	0.37
	1750	0.08	0.34
	1875	–	–
	2000	–	–
	2125	–	–
	2250	–	–
	2375	–	–
	2500	–	–
3	1500	1.11	0.79
	1625	0.91	0.76
	1750	0.70	0.74
	1875	0.50	0.70
	2000	0.30	0.67
	2125	0.12	0.63
	2250	–	–
	2375	–	–
	2500	–	–
4	1500	1.29	0.90
	1625	1.13	0.88
	1750	0.95	0.91
	1875	0.74	0.88
	2000	0.52	0.84
	2125	0.30	0.80
	2250	0.11	0.77
	2375	–	–
	2500	–	–
5	1500	1.36	0.94
	1625	1.24	0.99
	1750	0.95	1.02
	1875	0.74	1.05
	2000	0.74	1.03
	2125	0.53	0.99
	2250	0.31	0.94
	2375	0.08	0.90
	2500	–0.14	0.86

FAN PERFORMANCE

Table 29 – RHH036, 3 TON HORIZONTAL SUPPLY, 3 PHASE BELT DRIVE

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	574	0.13	707	0.23	817	0.34	913	0.47	999	0.61
975	597	0.15	727	0.25	835	0.37	929	0.50	1015	0.64
1050	621	0.18	747	0.28	853	0.40	946	0.53	1030	0.68
1125	646	0.20	768	0.31	872	0.43	964	0.57	1047	0.72
1200	671	0.23	790	0.34	892	0.47	982	0.61	1064	0.76
1275	696	0.26	812	0.38	912	0.51	1001	0.65	1082	0.81
1350	723	0.30	835	0.42	933	0.55	1020	0.70	1100	0.86
1425	749	0.34	859	0.46	955	0.60	1040	0.75	1119	0.91
1500	776	0.38	883	0.51	977	0.65	1061	0.80	1138	0.97

Med static – 819–1251 RPM, 1.5 Max BHP

High static – 1035–1466 RPM, 2.0 max HP

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	1078	0.77	1151	0.93	1220	1.11	1284	1.30	1346	1.49
975	1093	0.80	1165	0.97	1233	1.15	1297	1.33	1358	1.53
1050	1108	0.84	1180	1.01	1247	1.19	1311	1.38	1371	1.58
1125	1123	0.88	1195	1.05	1261	1.23	1325	1.42	1385	1.62
1200	1140	0.92	1210	1.10	1276	1.28	1339	1.47	1399	1.68
1275	1157	0.97	1226	1.15	1292	1.33	1354	1.53	1414	1.73
1350	1174	1.02	1243	1.20	1308	1.39	1370	1.59	1429	1.80
1425	1192	1.08	1260	1.26	1325	1.45	1386	1.65	1444	1.86
1500	1210	1.14	1278	1.33	1342	1.52	1403	1.72	1461	1.93

Med static – 819–1251 RPM, 1.5 Max BHP

High static – 1035–1466 RPM, 2.0 max HP

Table 30 – RHH036, 3 TON VERTICAL SUPPLY, 3 PHASE BELT DRIVE

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	594	0.15	740	0.25	867	0.37	981	0.52	1084	0.68
975	618	0.17	758	0.28	881	0.40	991	0.55	1092	0.71
1050	642	0.19	777	0.30	896	0.43	1003	0.58	1102	0.75
1125	668	0.22	797	0.34	912	0.47	1017	0.62	1113	0.79
1200	695	0.25	818	0.37	930	0.51	1032	0.66	1126	0.83
1275	722	0.29	841	0.41	949	0.55	1048	0.71	1140	0.88
1350	750	0.33	864	0.46	968	0.60	1065	0.76	1155	0.93
1425	778	0.37	888	0.50	989	0.65	1083	0.81	1171	0.99
1500	807	0.42	913	0.56	1011	0.71	1103	0.87	1188	1.05

Med static – 819–1251 RPM, 1.5 Max BHP

High static – 1035–1466 RPM, 2.0 max HP

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	1180	0.86	1269	1.05	1354	1.25	1434	1.47	1511	1.70
975	1186	0.89	1275	1.08	1358	1.29	1437	1.51	1513	1.74
1050	1194	0.92	1281	1.12	1363	1.32	1441	1.54	1516	1.78
1125	1204	0.97	1289	1.16	1370	1.37	1447	1.59	1520	1.82
1200	1215	1.01	1298	1.21	1378	1.42	1454	1.64	1526	1.87
1275	1227	1.06	1309	1.26	1387	1.47	1462	1.69	1533	1.92
1350	1240	1.12	1321	1.32	1397	1.53	1471	1.75	1541	1.99
1425	1254	1.18	1333	1.38	1409	1.59	1481	1.82	–	–
1500	1270	1.24	1347	1.45	1421	1.66	1492	1.89	–	–

Med static – 819–1251 RPM, 1.5 Max BHP

High static – 1035–1466 RPM, 2.0 max HP

Bold Face indicates field-supplied drive

1.Recommend using field-supplied fan pulley (part no. 1178034), motor pulley (part no. 1178187) and belt (part no.1183370).

FAN PERFORMANCE (cont.)

Table 31 – RHH048, 4 TON HORIZONTAL SUPPLY, 3 PHASE BELT DRIVE

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	630	0.20	755	0.31	859	0.43	949	0.56	1030	0.70
1300	659	0.24	781	0.36	883	0.48	972	0.61	1052	0.76
1400	689	0.28	808	0.40	908	0.53	995	0.67	1075	0.82
1500	720	0.33	836	0.46	933	0.59	1020	0.74	1098	0.89
1600	752	0.38	864	0.52	960	0.66	1044	0.81	1121	0.97
1700	784	0.44	893	0.58	986	0.73	1070	0.89	1146	1.05
1800	816	0.50	922	0.65	1014	0.81	1096	0.97	1171	1.14
1900	849	0.58	952	0.73	1042	0.90	1122	1.07	1196	1.24
2000	882	0.66	982	0.82	1070	0.99	1149	1.17	1222	1.35

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	1104	0.84	1173	0.99	1237	1.15	1298	1.32	1356	1.49
1300	1125	0.91	1194	1.06	1258	1.23	1318	1.40	1375	1.58
1400	1147	0.98	1215	1.14	1278	1.31	1338	1.48	1395	1.67
1500	1170	1.05	1237	1.22	1299	1.39	1359	1.57	1416	1.76
1600	1193	1.13	1259	1.31	1321	1.49	1380	1.67	1437	1.86
1700	1216	1.22	1282	1.40	1344	1.59	1402	1.78	1458	1.97
1800	1240	1.32	1305	1.50	1366	1.69	1424	1.89	1480	2.09
1900	1265	1.43	1329	1.61	1390	1.81	1447	2.01	1502	2.22
2000	1290	1.54	1353	1.73	1413	1.93	1470	2.14	1525	2.35

Med static – 920–1303 RPM, 1.5 Max HP

High static – 1035–1466 RPM, 2.0 Max HP

Bold Face indicates field–supplied drive

Recommend using field–supplied motor (part no. 1175721–230v and 460v, 1178090–575 volt), fan pulley (part no. 1178034), motor pulley (part no. 1171562), and belt (1183370).

Table 32 – RHH048, 4 TON VERTICAL SUPPLY, 3 PHASE BELT DRIVE

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	682	0.25	800	0.36	897	0.48	982	0.61	1058	0.75
1300	717	0.29	832	0.42	928	0.55	1011	0.68	1086	0.82
1400	753	0.34	865	0.48	958	0.61	1041	0.76	1115	0.91
1500	789	0.40	898	0.54	990	0.69	1071	0.84	1144	1.00
1600	826	0.47	932	0.62	1022	0.77	1102	0.93	1174	1.09
1700	863	0.54	966	0.70	1055	0.86	1133	1.03	1205	1.20
1800	901	0.62	1001	0.79	1088	0.96	1165	1.13	1235	1.31
1900	939	0.71	1037	0.89	1121	1.07	1197	1.25	1267	1.44
2000	978	0.81	1073	0.99	1156	1.18	1230	1.37	1299	1.57

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	1128	0.89	1192	1.03	1252	1.18	1309	1.34	1363	1.50
1300	1155	0.97	1219	1.12	1279	1.28	1336	1.44	1389	1.61
1400	1183	1.06	1247	1.22	1306	1.38	1362	1.55	1416	1.72
1500	1212	1.16	1275	1.32	1334	1.49	1389	1.67	1443	1.85
1600	1241	1.26	1303	1.43	1362	1.61	1417	1.79	1470	1.98
1700	1271	1.37	1332	1.55	1390	1.74	1445	1.93	1498	2.12
1800	1301	1.50	1362	1.68	1419	1.87	1474	2.07	1526	2.27
1900	1331	1.63	1392	1.82	1449	2.02	1503	2.22	–	–
2000	1362	1.77	1422	1.97	1478	2.18	1532	2.38	–	–

Med static – 920–1303 RPM, 1.5 Max HP

High static – 1035–1466 RPM, 2.0 Max HP

Bold Face indicates field–supplied drive

Recommend using field–supplied motor (part no. 1175721–230v and 460v, 1178090–575 volt), fan pulley (part no. 1178034), motor pulley (part no. 1171562), and belt (1183370).

FAN PERFORMANCE (cont.)

Table 33 – RHH060, 5 TON HORIZONTAL SUPPLY, 3 PHASE BELT DRIVE

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	725	0.33	840	0.46	937	0.60	1023	0.75	1101	0.90
1625	765	0.40	876	0.54	970	0.68	1054	0.84	1131	1.00
1750	806	0.48	912	0.63	1004	0.78	1087	0.94	1162	1.11
1875	847	0.57	950	0.72	1039	0.88	1120	1.05	1194	1.23
2000	889	0.66	988	0.83	1075	1.00	1154	1.18	1226	1.36
2125	931	0.78	1027	0.95	1112	1.13	1189	1.31	1260	1.50
2250	974	0.90	1067	1.08	1149	1.27	1224	1.46	1294	1.66
2375	1018	1.03	1107	1.23	1187	1.43	1261	1.63	1329	1.84
2500	1061	1.19	1148	1.39	1226	1.59	1297	1.81	1364	2.02

Med static – 1066–1380 RPM, 2.0 Max HP

High static – 1208–1639 RPM, 2.9 Max HP

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	1172	1.06	1239	1.23	1302	1.40	1361	1.58	1418	1.77
1625	1201	1.16	1267	1.34	1329	1.52	1388	1.71	1444	1.90
1750	1231	1.28	1296	1.46	1358	1.65	1416	1.84	1472	2.04
1875	1262	1.41	1326	1.60	1387	1.79	1445	1.99	1499	2.20
2000	1294	1.55	1357	1.74	1417	1.95	1474	2.15	1528	2.36
2125	1326	1.70	1388	1.90	1447	2.11	1504	2.33	1557	2.55
2250	1359	1.87	1420	2.08	1479	2.29	1534	2.51	1587	2.74
2375	1393	2.05	1453	2.27	1511	2.49	1566	2.72	–	–
2500	1427	2.24	1487	2.47	1543	2.70	1597	2.94	–	–

Med static – 1066–1380 RPM, 2.0 Max HP

High static – 1208–1639 RPM, 2.9 Max HP

Table 34 – RHH060, 5 TON VERTICAL SUPPLY, 3 PHASE BELT DRIVE

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	794	0.41	902	0.55	993	0.69	1074	0.85	1147	1.00
1625	840	0.49	945	0.64	1034	0.80	1113	0.96	1185	1.13
1750	888	0.59	988	0.75	1075	0.92	1153	1.09	1223	1.26
1875	936	0.70	1033	0.87	1117	1.05	1193	1.23	1263	1.41
2000	984	0.82	1078	1.00	1160	1.19	1235	1.39	1303	1.58
2125	1033	0.96	1124	1.15	1204	1.35	1277	1.56	1343	1.76
2250	1083	1.11	1170	1.32	1248	1.53	1319	1.74	1385	1.96
2375	1133	1.28	1217	1.50	1293	1.72	1363	1.95	1427	2.17
2500	1183	1.47	1265	1.70	1339	1.93	1406	2.17	1470	2.41

Med static – 1066–1380 RPM, 2.0 Max HP

High static – 1208–1639 RPM, 2.9 Max HP

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	1214	1.16	1277	1.33	1336	1.50	1392	1.67	1445	1.85
1625	1251	1.30	1313	1.47	1371	1.65	1427	1.83	1479	2.02
1750	1289	1.44	1350	1.63	1407	1.81	1462	2.01	1514	2.20
1875	1327	1.60	1387	1.80	1444	1.99	1498	2.19	1550	2.40
2000	1366	1.78	1426	1.98	1482	2.19	1535	2.40	1586	2.61
2125	1406	1.97	1464	2.18	1520	2.40	1573	2.62	1623	2.84
2250	1446	2.18	1504	2.40	1559	2.62	1611	2.85	–	–
2375	1487	2.40	1544	2.63	1598	2.87	–	–	–	–
2500	1529	2.64	1585	2.89	–	–	–	–	–	–

Med static – 1066–1380 RPM, 2.0 Max HP

High static – 1208–1639 RPM, 2.9 Max HP

FAN PERFORMANCE (cont.)

Table 35 – RHH072, 6 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1800	415	0.28	510	0.46	588	0.65	655	0.85	715	1.08
1950	431	0.32	525	0.51	601	0.71	668	0.93	727	1.16
2100	448	0.38	540	0.57	615	0.78	681	1.01	740	1.25
2250	465	0.43	555	0.64	629	0.86	694	1.10	753	1.34
2400	483	0.49	571	0.71	644	0.94	708	1.19	766	1.45
2550	501	0.56	587	0.79	659	1.04	722	1.29	779	1.56
2700	519	0.64	603	0.88	674	1.14	737	1.40	793	1.68
2850	538	0.72	620	0.98	689	1.24	751	1.52	807	1.80
3000	557	0.82	637	1.08	705	1.36	766	1.64	822	1.94

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1800	770	1.31	821	1.56	868	1.82	913	2.09	955	2.36
1950	782	1.40	832	1.66	879	1.92	924	2.20	966	2.49
2100	794	1.50	844	1.76	891	2.03	935	2.32	977	2.61
2250	806	1.60	856	1.87	903	2.15	947	2.45	988	2.75
2400	819	1.71	868	1.99	915	2.28	958	2.58	1000	2.89
2550	832	1.83	881	2.12	927	2.42	971	2.73	1012	3.05
2700	845	1.96	894	2.26	940	2.57	983	2.88	1024	3.21
2850	859	2.10	907	2.41	953	2.72	995	3.05	1036	3.38
3000	873	2.24	921	2.56	966	2.89	1008	3.22	1049	3.56

Std static – 489–747 RPM, 1.2 Max BHP

Med static – 733–949 RPM, 2.9 Max BHP

High static – 909–1102 RPM, 4.0 Max BHP

Table 36 – RHH072, 6 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1800	446	0.33	534	0.50	609	0.70	676	0.91	736	1.14
1950	467	0.39	552	0.57	625	0.77	690	0.99	750	1.23
2100	489	0.45	571	0.64	642	0.86	706	1.08	764	1.33
2250	511	0.53	591	0.73	660	0.95	722	1.19	779	1.44
2400	534	0.61	611	0.82	678	1.05	739	1.30	795	1.56
2550	558	0.71	631	0.93	697	1.17	756	1.42	811	1.69
2700	581	0.81	652	1.04	716	1.29	774	1.55	828	1.83
2850	605	0.93	674	1.17	736	1.43	792	1.70	845	1.98
3000	630	1.06	696	1.31	756	1.58	811	1.86	863	2.15

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1800	791	1.39	843	1.65	892	1.93	938	2.22	981	2.53
1950	804	1.49	855	1.76	903	2.04	949	2.34	992	2.65
2100	818	1.59	868	1.87	915	2.16	961	2.46	1003	2.78
2250	832	1.71	882	1.99	928	2.29	973	2.59	1015	2.92
2400	847	1.83	896	2.12	942	2.43	986	2.74	1028	3.07
2550	862	1.97	910	2.27	956	2.58	999	2.90	1041	3.23
2700	878	2.12	926	2.42	971	2.74	1013	3.07	1055	3.41
2850	895	2.28	941	2.59	986	2.92	1028	3.25	1069	3.60
3000	912	2.46	958	2.78	1001	3.11	1043	3.45	1083	3.80

Std static – 489–747 RPM, 1.2 Max BHP

Med static – 733–949 RPM, 2.9 Max BHP

High static – 909–1102 RPM, 4.0 Max BHP

FAN PERFORMANCE (cont.)

Table 37 – RHH090, 7.5 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	433	0.29	518	0.41	596	0.54	667	0.67	733	0.81
2438	454	0.35	535	0.48	609	0.61	677	0.75	741	0.90
2625	477	0.42	553	0.55	624	0.69	689	0.84	751	1.00
2813	500	0.49	572	0.64	640	0.78	703	0.94	763	1.10
3000	523	0.58	592	0.73	657	0.88	718	1.05	775	1.22
3188	547	0.68	613	0.83	675	1.00	733	1.17	789	1.34
3375	571	0.78	634	0.95	694	1.12	750	1.30	804	1.48
3563	596	0.90	656	1.07	713	1.25	768	1.44	820	1.63
3750	621	1.03	679	1.21	734	1.40	786	1.59	837	1.79

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	795	0.96	854	1.11	910	1.27	963	1.43	1014	1.60
2438	802	1.05	859	1.21	913	1.38	966	1.55	1016	1.72
2625	810	1.16	865	1.32	919	1.49	970	1.67	1019	1.85
2813	819	1.27	874	1.44	925	1.62	975	1.80	1023	1.99
3000	830	1.39	883	1.57	934	1.76	982	1.95	1029	2.14
3188	843	1.53	894	1.71	943	1.90	990	2.10	1036	2.30
3375	856	1.67	905	1.86	953	2.06	1000	2.27	1045	2.48
3563	870	1.83	918	2.03	965	2.23	1010	2.44	1054	2.66
3750	885	1.99	932	2.20	978	2.42	1022	2.64	1065	2.86

Std static – 518–733 RPM, 1.2 Max BHP

Med static – 690–936 RPM, 1.7 Max BHP

High static – 838–1084 RPM, 2.8 Max BHP

Table 38 – RHH090, 3 PHASE, 7.5 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	457	0.32	536	0.44	604	0.55	664	0.67	719	0.79
2438	481	0.39	557	0.51	623	0.64	682	0.77	735	0.89
2625	505	0.47	578	0.60	642	0.73	700	0.87	753	1.00
2813	530	0.55	601	0.70	663	0.84	719	0.98	771	1.13
3000	556	0.65	623	0.80	684	0.95	738	1.11	789	1.26
3188	582	0.76	647	0.92	705	1.08	759	1.25	808	1.41
3375	608	0.88	671	1.05	727	1.22	779	1.40	828	1.57
3563	634	1.01	695	1.19	750	1.38	801	1.56	848	1.74
3750	661	1.16	719	1.35	773	1.54	822	1.73	869	1.93

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	770	0.91	817	1.03	861	1.15	903	1.28	943	1.40
2438	785	1.02	832	1.15	876	1.28	917	1.41	957	1.55
2625	802	1.14	847	1.28	891	1.42	932	1.56	971	1.70
2813	819	1.27	864	1.42	907	1.57	947	1.72	986	1.87
3000	836	1.42	881	1.57	923	1.73	963	1.89	1001	2.05
3188	855	1.57	898	1.74	940	1.90	979	2.07	1017	2.24
3375	873	1.74	916	1.91	957	2.09	996	2.26	1034	2.44
3563	893	1.92	935	2.11	975	2.29	1014	2.47	1051	2.66
3750	912	2.12	954	2.31	994	2.50	1031	2.70	1068	2.89

Std static – 518–733 RPM, 1.2 Max BHP

Med static – 690–936 RPM, 1.7 Max BHP

High static – 838–1084 RPM, 2.8 Max BHP

FAN PERFORMANCE (cont.)

Table 39 – RHH102, 8.5 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2550	468	0.39	546	0.52	618	0.66	684	0.80	747	0.96
2763	493	0.47	567	0.61	635	0.76	699	0.91	760	1.07
2975	520	0.57	589	0.72	654	0.87	716	1.03	774	1.20
3188	547	0.68	613	0.83	675	1.00	733	1.17	789	1.34
3400	575	0.80	637	0.96	696	1.14	752	1.31	806	1.50
3613	603	0.94	662	1.11	719	1.29	773	1.48	824	1.67
3825	631	1.09	688	1.27	742	1.46	794	1.66	843	1.86
4038	660	1.26	714	1.45	766	1.65	816	1.85	864	2.06
4250	689	1.45	741	1.65	790	1.86	838	2.07	885	2.29

Std static – 440–606 RPM, 2.4 Max BHP

Med static – 591–838 RPM, 2.9 Max BHP

High static – 838–1084, 2.9 Max BHP

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2550	806	1.11	863	1.28	916	1.45	968	1.62	1018	1.80
2763	817	1.24	871	1.41	924	1.59	974	1.77	1022	1.95
2975	829	1.37	882	1.55	932	1.74	981	1.93	1028	2.12
3188	843	1.53	894	1.71	943	1.90	990	2.10	1036	2.30
3400	858	1.69	907	1.88	955	2.09	1001	2.29	1046	2.50
3613	874	1.87	922	2.07	968	2.28	1013	2.49	1057	2.71
3825	891	2.07	938	2.28	983	2.49	1027	2.71	1069	2.94
4038	910	2.28	955	2.50	999	2.72	1041	2.95	1083	3.19
4250	930	2.51	973	2.74	1015	2.97	1057	3.21	1097	3.45

Std static – 440–606 RPM, 2.4 Max BHP

Med static – 591–838 RPM, 2.9 Max BHP

High static – 838–1084, 2.9 Max BHP

Table 40 – RHH102, 8.5 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2550	495	0.43	570	0.56	634	0.70	693	0.83	746	0.96
2763	524	0.53	595	0.67	657	0.81	714	0.95	766	1.09
2975	552	0.63	620	0.79	681	0.94	736	1.09	787	1.24
3188	582	0.76	647	0.92	705	1.08	759	1.25	808	1.41
3400	611	0.89	674	1.07	730	1.24	782	1.42	831	1.59
3613	641	1.05	701	1.23	756	1.42	806	1.60	854	1.79
3825	672	1.22	729	1.42	782	1.61	831	1.81	877	2.00
4038	702	1.41	758	1.62	809	1.83	857	2.03	901	2.24
4250	733	1.62	787	1.84	836	2.06	883	2.28	926	2.49

Std static – 440–606 RPM, 2.4 Max BHP

Med static – 591–838 RPM, 2.9 Max BHP

High static – 838–1084, 2.9 Max BHP

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2550	795	1.09	841	1.23	885	1.36	926	1.50	965	1.64
2763	814	1.24	859	1.38	902	1.53	943	1.68	982	1.82
2975	834	1.40	878	1.55	921	1.71	961	1.86	999	2.02
3188	855	1.57	898	1.74	940	1.90	979	2.07	1017	2.24
3400	876	1.76	919	1.94	960	2.12	998	2.29	1036	2.47
3613	898	1.97	940	2.16	980	2.34	1018	2.53	1055	2.72
3825	921	2.20	962	2.40	1001	2.59	1039	2.79	1075	2.99
4038	944	2.45	984	2.65	1023	2.86	1060	3.07	1096	3.27
4250	968	2.71	1007	2.93	1045	3.15	1081	3.36	1117	3.58

Std static – 440–606 RPM, 2.4 Max BHP

Med static – 591–838 RPM, 2.9 Max BHP

High static – 838–1084, 2.9 Max BHP

FAN PERFORMANCE (cont.)

Table 41 – RHH120, 10 TON HORIZONTAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	335	0.32	421	0.51	500	0.74	572	1.00	637	1.29
3250	350	0.38	430	0.58	505	0.81	575	1.08	640	1.37
3500	365	0.45	441	0.65	512	0.89	579	1.16	642	1.46
3750	381	0.53	452	0.74	520	0.98	584	1.26	645	1.56
4000	397	0.61	464	0.83	529	1.08	590	1.36	650	1.67
4250	413	0.70	477	0.93	538	1.19	598	1.47	655	1.78
4500	429	0.81	491	1.05	549	1.31	606	1.60	661	1.91
4750	445	0.92	505	1.17	561	1.44	615	1.73	667	2.05
5000	462	1.04	519	1.30	573	1.58	625	1.88	675	2.21

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	697	1.59	751	1.91	801	2.24	847	2.59	891	2.94
3250	699	1.68	753	2.01	803	2.35	850	2.71	895	3.08
3500	701	1.78	755	2.12	806	2.47	853	2.84	898	3.22
3750	703	1.88	757	2.23	808	2.59	855	2.97	900	3.36
4000	706	2.00	759	2.35	809	2.72	857	3.11	902	3.51
4250	709	2.12	761	2.48	811	2.86	858	3.25	903	3.66
4500	714	2.25	765	2.62	813	3.00	860	3.40	905	3.82
4750	719	2.40	768	2.77	816	3.15	862	3.56	906	3.99
5000	725	2.55	773	2.93	820	3.32	865	3.73	908	4.16

Std Static Motor and Drive – 440–609 RPM, Max BHP 2.4

Med Static Motor and Drive – 547–757 RPM, Max BHP 2.9

High Static Motor and Drive – 762–963 RPM, Max BHP 6.1

Boldface – Field-supplied Drive (motor pulley 1175849)

Italics – Field-supplied drive (motor pulley 1170699)

Table 42 – RHH120, 10 TON VERTICAL SUPPLY

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	383	0.39	470	0.60	549	0.85	620	1.13	684	1.42
3250	402	0.47	483	0.68	559	0.94	629	1.22	692	1.53
3500	421	0.55	498	0.78	570	1.04	637	1.33	699	1.65
3750	441	0.65	513	0.88	582	1.15	647	1.45	707	1.78
4000	461	0.75	529	0.99	594	1.27	657	1.58	716	1.91
4250	481	0.87	545	1.12	608	1.41	668	1.72	725	2.06
4500	502	1.01	563	1.26	622	1.55	680	1.88	735	2.22
4750	522	1.15	581	1.42	637	1.72	693	2.05	746	2.40
5000	543	1.31	599	1.59	653	1.90	706	2.23	758	2.59

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (IN. WG)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	742	1.73	795	2.05	845	2.38	891	2.73	935	3.08
3250	749	1.85	802	2.19	852	2.54	899	2.89	943	3.26
3500	756	1.98	809	2.33	859	2.69	906	3.06	950	3.45
3750	764	2.12	816	2.48	866	2.86	912	3.24	956	3.64
4000	771	2.27	824	2.64	873	3.03	919	3.42	963	3.83
4250	780	2.43	831	2.81	880	3.21	926	3.62	<u>970</u>	<u>4.04</u>
4500	788	2.60	839	2.99	887	3.40	933	3.82	<u>976</u>	<u>4.25</u>
4750	798	2.78	847	3.18	895	3.60	940	4.03	<u>983</u>	<u>4.47</u>
5000	808	2.98	856	3.38	903	3.81	947	4.25	<u>990</u>	<u>4.71</u>

Std Static Motor and Drive – 440–609 RPM, Max BHP 2.4

Med Static Motor and Drive – 547–757 RPM, Max BHP 2.9

High Static Motor and Drive – 762–963 RPM, Max BHP 6.1

Boldface – Field-supplied Drive (motor pulley 1175849)

Italics – Field-supplied drive (motor pulley 1170699)

Underline – Field-supplied (motor pulley 1178187)

FAN PERFORMANCE (cont.)

Table 43 – PULLEY ADJUSTMENT

UNIT RHH	PHASE	MOTOR/DRIVE COMBO	MOTOR PULLEY TURNS OPEN										
			0	0.5	1	1.5	2	2.5	3	3.5	4	4.5	5
036	3	Medium Static	1251	1208	1165	1121	1078	1035	992	949	905	862	819
		High Static	1466	1423	1380	1337	1294	1251	1207	1164	1121	1078	1035
048	3	Medium Static	1303	1265	1226	1188	1150	1112	1073	1035	997	958	920
		High Static	1466	1423	1380	1337	1294	1251	1207	1164	1121	1078	1035
060	3	Medium Static	1380	1349	1317	1286	1254	1223	1192	1160	1129	1097	1066
		High Static	1639	1596	1553	1510	1467	1424	1380	1337	1294	1251	1208
072	3	Standard Static	1192	1161	1129	1098	1066	1035	1004	972	941	909	878
		Medium Static	1380	1349	1317	1286	1254	1223	1192	1160	1129	1097	1066
		High Static	1639	1596	1553	1510	1467	1424	1380	1337	1294	1251	1208
090	3	Standard Static	652	633	614	594	575	556	537	518	498	479	460
		Medium Static	838	813	789	764	739	715	690	665	640	616	591
		High Static	1084	1059	1035	1010	986	961	936	912	887	863	838
102	3	Standard Static	652	633	614	594	575	556	537	518	498	479	460
		Medium Static	838	813	789	764	739	715	690	665	640	616	591
		High Static	1084	1059	1035	1010	986	961	936	912	887	863	838
120	3	Standard Static	609	592	575	558	541	525	508	491	474	457	440
		Medium Static	757	736	715	694	673	652	631	610	589	568	547
		High Static	963	943	923	903	883	863	842	822	802	782	762

NOTE: Do not adjust pulley further than 5 turns open.

■ – Factory settings

* Do not set motor pulley above 5 turns open for A or AX section belts

** Do not set motor pulley below 1 turn open for B or BX section belts

ECONOMIZER, BAROMETRIC RELIEF, AND PERFORMANCE, 3 - 8.5 TON

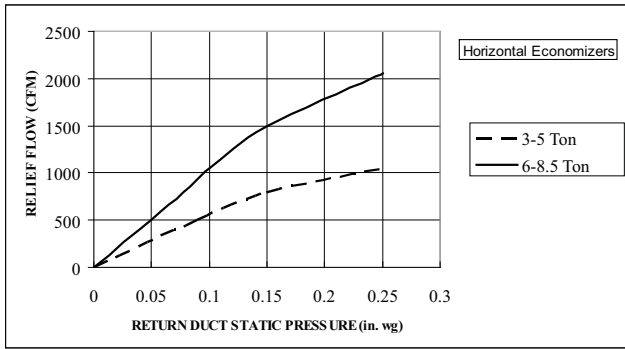


Fig 1 - Barometric Relief Flow Capacity

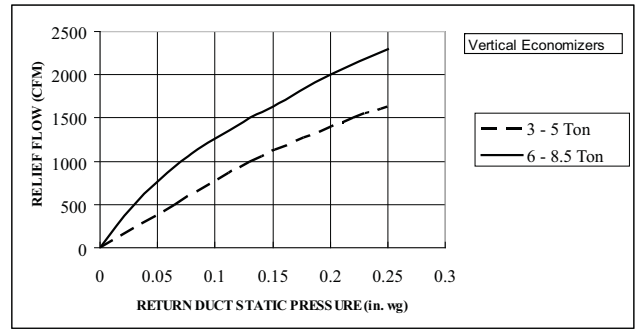


Fig 4 - Barometric Relief Flow Capacity

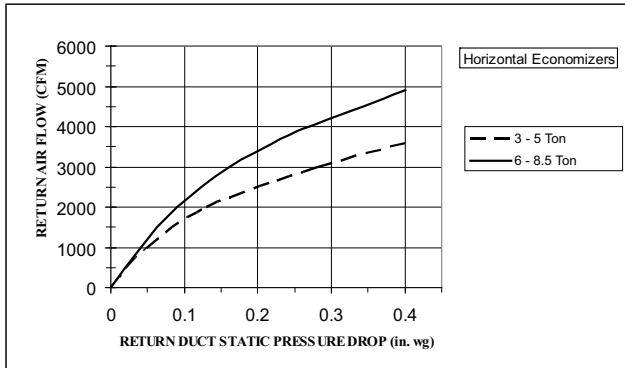


Fig 2 - Return Air Pressure Drop

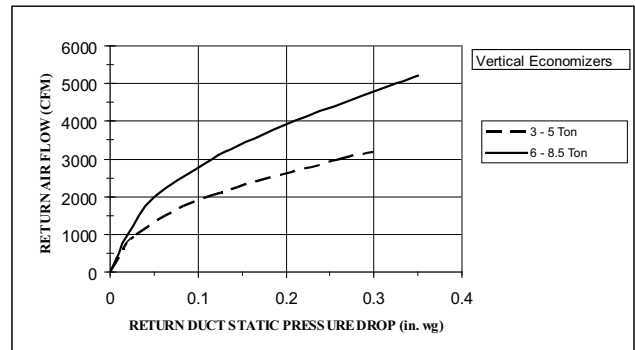


Fig 5 - Return Air Pressure Drop

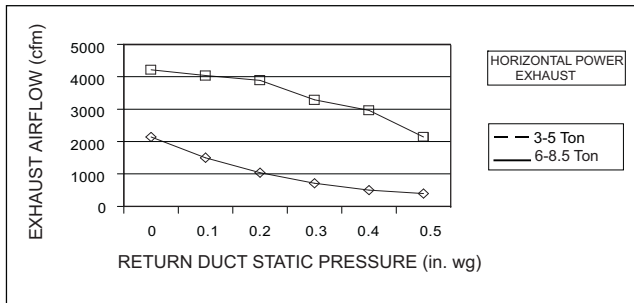


Fig 3 - Horizontal Power Exhaust Performance

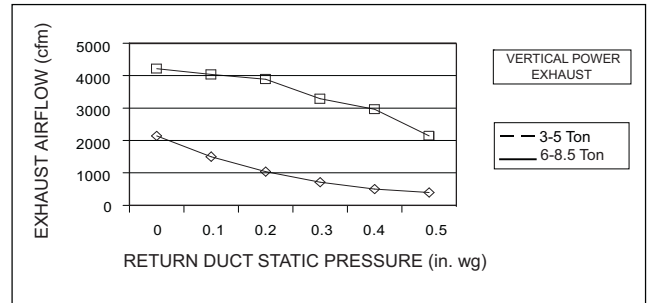


Fig 6 - Vertical Power Exhaust Performance

ECONOMIZER, BAROMETRIC RELIEF, AND PERFORMANCE, 10 TON

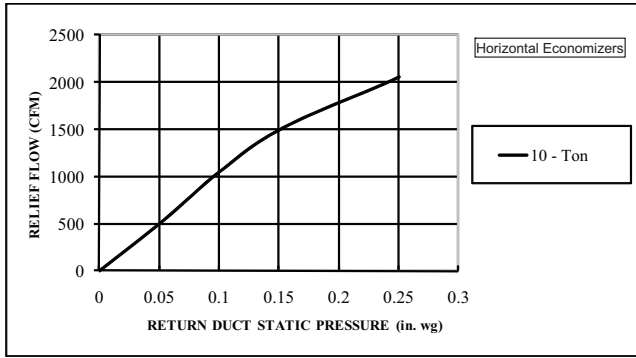


Fig7 - Barometric Relief Flow Capacity

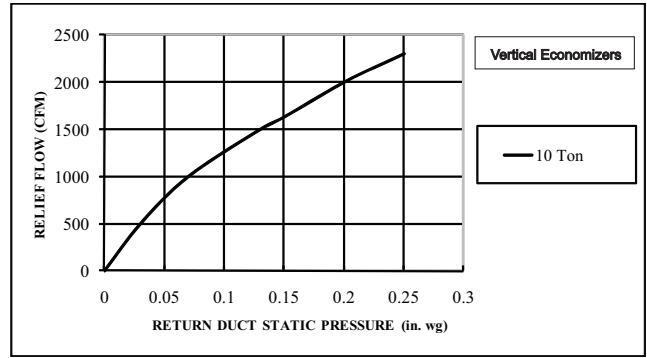


Fig10 - Barometric Relief Flow Capacity

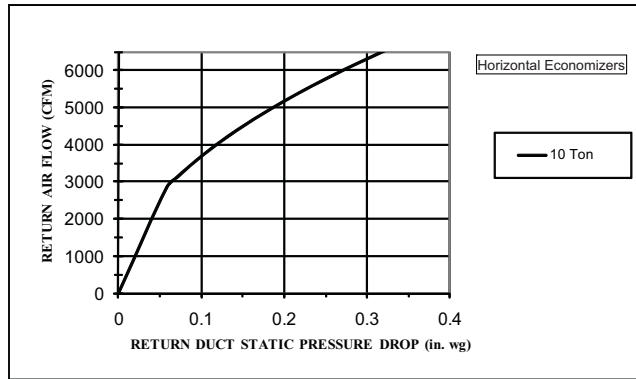


Fig8 - Return Air Pressure Drop

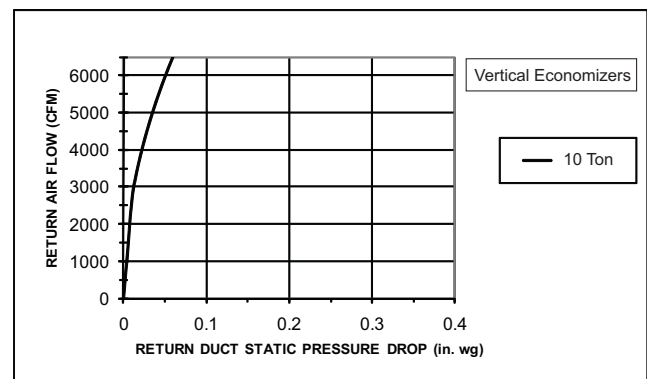


Fig11 - Return Air Pressure Drop

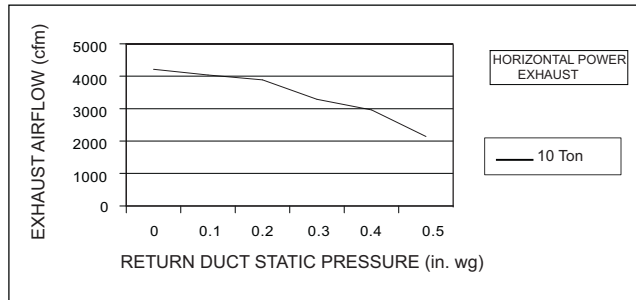


Fig9 - Horizontal Power Exhaust Performance

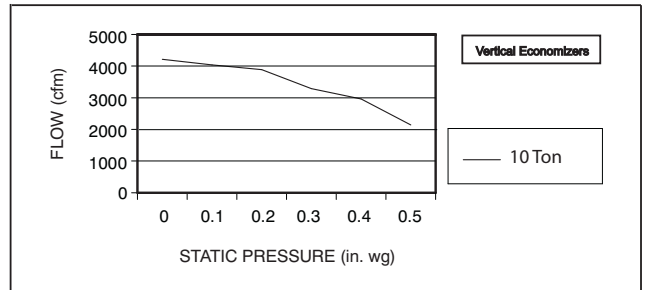


Fig12 - Vertical Power Exhaust Performance

ELECTRICAL INFORMATION

Table 44 – RHH036, 3 TONS.....1-Stage Cooling

V-Ph-Hz	VOLTAGE RANGE		COMP (ea)		OFM (ea)		IFM				
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	Max WATTS	Max AMP Draw	EFF at Full Load	FLA
208-1-60	187	253	16.6	79	190	1.0	DD-STD	980	7.8	84%	7.4
230-1-60	187	253	16.6	79	190	1.0	DD-STD	980	7.8	84%	7.4
208-3-60	187	253	10.4	73	190	1.0	DD-STD	980	7.8	84%	7.4
							MED	2000	5.5	80%	5.2
							HIGH	2000	5.5	80%	5.2
230-3-60	187	253	10.4	73	190	1.0	DD-STD	980	7.8	84%	7.4
							MED	2000	5.5	80%	5.2
							HIGH	2000	5.5	80%	5.2
460-3-60	414	506	5.8	38	190	0.5	DD-STD	980	4.2	84%	4.0
							MED	2000	2.7	80%	2.6
							HIGH	2000	2.7	80%	2.6
575-3-60	518	633	3.8	37	190	0.5	DD-STD	980	4.2	84%	4.0
							MED	2000	2.5	80%	2.4
							HIGH	2000	2.1	80%	2.0

Table 45 – RHH048, 4 TONS.....1-Stage Cooling

V-Ph-Hz	VOLTAGE RANGE		COMP (ea)		OFM (ea)		IFM				
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	Max WATTS	Max AMP Draw	EFF at Full Load	FLA
208-1-60	187	253	19.8	109	325	1.4	DD-STD	980	7.8	84%	7.4
230-1-60	187	253	19.8	109	325	1.4	DD-STD	980	7.8	84%	7.4
208-3-60	187	253	13.1	83	325	1.4	DD-STD	980	7.8	84%	7.4
							MED	2000	5.5	80%	5.2
							HIGH	2000	5.5	80%	5.2
230-3-60	187	253	13.1	83	325	1.4	DD-STD	980	7.8	84%	7.4
							MED	2000	5.5	80%	5.2
							HIGH	2000	5.5	80%	5.2
460-3-60	414	506	6.1	41	325	0.8	DD-STD	980	4.2	84%	4.0
							MED	2000	2.7	80%	2.6
							HIGH	2000	2.7	80%	2.6
575-3-60	518	633	4.4	33	325	0.8	DD-STD	980	4.2	84%	4.0
							MED	2000	2.5	80%	2.4
							HIGH	2000	2.1	80%	2.0

Table 46 – RHH060, 5 TONS.....1-Stage Cooling

V-Ph-Hz	VOLTAGE RANGE		COMP (ea)		OFM (ea)		IFM				
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	Max WATTS	Max AMP Draw	EFF at Full Load	FLA
208-1-60	187	253	25.0	134	325	1.4	DD-STD	980	7.8	84%	7.4
230-1-60	187	253	25.0	134	325	1.4	DD-STD	980	7.8	84%	7.4
208-3-60	187	253	15.9	110	325	1.4	DD-STD	980	7.8	84%	7.4
							MED	2000	5.5	80%	5.2
							HIGH	2770	7.9	81%	7.5
230-3-60	187	253	15.9	110	325	1.4	DD-STD	980	7.8	84%	7.4
							MED	2000	5.5	80%	5.2
							HIGH	2770	7.9	81%	7.5
460-3-60	414	506	7.0	52	325	0.8	DD-STD	980	4.2	84%	4.0
							MED	2000	2.7	80%	2.6
							HIGH	2770	3.6	81%	3.4
575-3-60	518	633	5.1	40	325	0.8	DD-STD	980	4.2	84%	4.0
							MED	2000	2.1	80%	2.0
							HIGH	2770	2.9	81%	2.8

ELECTRICAL INFORMATION (cont.)

Table 47 – RHH072, 6 TONS.....1-Stage Cooling

V-Ph-Hz	VOLTAGE RANGE		COMP (ea)		OFM (ea)		IFM				
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	Max WATTS	Max AMP Draw	EFF at Full Load	FLA
208-3-60	187	253	19.0	123	325	1.5	STD	1500	5.5	80%	5.2
							MED	3000	7.9	80%	7.5
							HIGH	4200	15.8	80%	15.0
230-3-60	187	253	19.0	123	325	1.5	STD	1600	5.5	80%	5.2
							MED	3100	7.9	80%	7.5
							HIGH	4500	15.8	80%	15.0
460-3-60	414	506	9.7	62	325	0.8	STD	1600	2.7	80%	2.6
							MED	3100	3.6	80%	3.4
							HIGH	4500	7.8	80%	7.4
575-3-60	518	633	7.4	50	325	0.6	STD	1600	2.5	80%	2.4
							MED	3100	2.9	80%	2.8
							HIGH	4500	5.9	80%	5.6

Table 48 – RHH090, 7.5 TONS.....2-Stage Cooling

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM				
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	Max WATTS	Max AMP Draw	EFF at Full Load	FLA
208-3-60	187	253	13.1	83	13.1	83	325	1.5	STD	1500	5.5	80%	5.2
									MED	1800	5.5	80%	5.2
									HIGH	2600	10.5	81%	10.0
230-3-60	187	253	13.1	83	13.1	83	325	1.5	STD	1600	5.5	80%	5.2
									MED	1900	5.5	80%	5.2
									HIGH	2800	10.5	81%	10.0
460-3-60	414	506	6.1	41	6.1	41	325	0.8	STD	1600	2.7	80%	2.6
									MED	1900	2.7	80%	2.6
									HIGH	2800	4.6	81%	4.4
575-3-60	518	633	4.4	33	4.4	33	325	0.6	STD	1600	2.5	80%	2.4
									MED	1900	2.1	80%	2.0
									HIGH	2800	2.9	81%	2.8

Table 49 – RHH102, 8.5 TONS.....2-Stage Cooling

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM				
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	Max WATTS	Max AMP Draw	EFF at Full Load	FLA
208-3-60	187	253	16.0	91	13.7	83	325	6.2	STD	1800	5.5	80%	5.2
									MED	3000	7.9	80%	7.5
									HIGH	2600	10.5	81%	10.0
230-3-60	187	253	16.0	91	13.7	83	325	6.2	STD	1900	5.5	80%	5.2
									MED	3100	7.9	80%	7.5
									HIGH	2800	10.5	81%	10.0
460-3-60	414	506	7.0	46	6.2	41	325	3.1	STD	1900	2.7	80%	2.6
									MED	3100	3.6	80%	3.4
									HIGH	2800	4.6	81%	4.4
575-3-60	518	633	5.6	37	4.8	33	325	2.5	STD	1900	2.1	80%	2.0
									MED	3100	2.9	80%	2.8
									HIGH	2800	2.9	81%	2.8

ELECTRICAL INFORMATION (cont.)

Table 50 – RHH120, 10 TONS.....2-Stage Cooling

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	15.6	110	15.9	110	280	1.5	STD MED HIGH High Eff.	80% 80% 89.5%	5.2 7.5 20.4
230-3-60	187	253	15.6	110	15.9	110	280	1.5	STD MED HIGH High Eff.	80% 80% 89.5%	5.2 7.5 20.4
460-3-60	414	506	7.7	52	7.7	52	280	0.8	STD MED HIGH High Eff.	80% 80% 89.5%	2.6 3.4 10.2
575-3-60	518	633	5.8	39	5.7	39	280	0.7	STD MED HIGH High Eff.	80% 80% 89.5%	2.0 2.8 9.0

Table 51 – MCA/MOCP DETERMINATION NO C.O. OR UNPWRD C.O.

Unit RHH	NOM. V-PH-HZ	IFM TYPE	ELEC HTR		WITHOUT C.O. or UNPWR C.O.							
			NOM (kW)	FLA	WITHOUT P.E.				WITH P.E. (pwrd fr/unit)			
					MCA	MOCP	DISC. SIZE		MCA	MOCP	DISC. SIZE	
						FLA	LRA	MCA	MOCP	FLA	LRA	
036	208/230-1-60	DD-STD	-	-	29.2	45	29	88	31.1	45	31	90
			3.3/4.4	15.9/18.3	49.0/52.0	60/60	47/50	104/106	50.9/53.9	60/60	49/52	106/108
			4.9/6.5	23.5/27.1	58.5/63.0	60/70	56/60	112/115	60.4/64.9	70/70	58/62	114/117
			6.5/8.7	31.4/36.3	68.4/74.5	70/80	65/70	119/124	70.3/76.4	80/80	67/73	121/126
			7.9/10.5	37.9/43.8	76.5/83.9	80/90	72/79	126/132	78.4/85.8	80/90	75/81	128/134
			9.8/13.0	46.9/54.2	87.8/96.9	90/100	83/91	182/196	89.7/98.8	90/100	85/93	184/198
	208/230-3-60	DD-STD	-	-	21.4	30	22	82	23.3	30	24	84
			3.3/4.4	9.2/10.6	32.9/34.7	40/40	32/34	91/93	34.8/36.6	40/40	34/36	93/95
			4.9/6.5	13.6/15.6	38.4/40.9	45/45	37/40	96/98	40.3/42.8	45/45	39/42	98/100
			6.5/8.7	18.1/20.9	44.0/47.5	45/50	42/46	100/103	45.9/49.4	50/50	45/48	102/105
			7.9/10.5	21.9/25.3	48.8/53.0	50/60	47/51	104/107	50.7/54.9	60/60	49/53	106/109
			12.0/16.0	33.4/38.5	63.2/69.5	70/70	60/66	115/121	65.1/71.4	70/80	62/68	117/123
		MED	-	-	19.2	25	19	94	21.1	30	21	96
			3.3/4.4	9.2/10.6	30.7/32.5	35/40	30/31	103/105	32.6/34.4	40/40	32/33	105/107
			4.9/6.5	13.6/15.6	36.2/38.7	40/45	35/37	108/110	38.1/40.6	45/45	37/39	110/112
			6.5/8.7	18.1/20.9	41.8/45.3	45/50	40/43	112/115	43.7/47.2	45/50	42/45	114/117
			7.9/10.5	21.9/25.3	46.6/50.8	50/60	44/48	116/119	48.5/52.7	50/60	46/50	118/121
			12.0/16.0	33.4/38.5	61.0/67.3	70/70	58/63	127/133	62.9/69.2	70/70	60/66	129/135
	HIGH	-	-	19.2	25	19	105	21.1	30	21	107	
		3.3/4.4	9.2/10.6	30.7/32.5	35/40	30/31	114/116	32.6/34.4	40/40	32/33	116/118	
		4.9/6.5	13.6/15.6	36.2/38.7	40/45	35/37	119/121	38.1/40.6	45/45	37/39	121/123	
		6.5/8.7	18.1/20.9	41.8/45.3	45/50	40/43	123/126	43.7/47.2	45/50	42/45	125/128	
		7.9/10.5	21.9/25.3	46.6/50.8	50/60	44/48	127/130	48.5/52.7	50/60	46/50	129/132	
		12.0/16.0	33.4/38.5	61.0/67.3	70/70	58/63	138/144	62.9/69.2	70/70	60/66	140/146	
460-3-60	DD-STD	-	-	11.8	15	12	43	12.8	15	13	44	
		6.0	7.2	20.8	25	20	50	21.8	25	21	51	
		8.8	10.6	25.0	25	24	54	26.0	30	25	55	
		11.5	13.8	29.0	30	28	57	30.0	30	29	58	
		14.0	16.8	32.8	35	31	60	33.8	35	32	61	
	MED	-	-	10.4	15	10	48	11.4	15	11	49	
		6.0	7.2	19.4	20	19	55	20.4	25	20	56	
		8.8	10.6	23.6	25	22	59	24.6	25	24	60	
		11.5	13.8	27.6	30	26	62	28.6	30	27	63	
		14.0	16.8	31.4	35	30	65	32.4	35	31	66	
	HIGH	-	-	10.4	15	10	54	11.4	15	11	55	
		6.0	7.2	19.4	20	19	61	20.4	25	20	62	
8.8		10.6	23.6	25	22	65	24.6	25	24	66		
11.5		13.8	27.6	30	26	68	28.6	30	27	69		
14.0		16.8	31.4	35	30	71	32.4	35	31	72		
575-3-60	DD-STD	-	-	9.3	15	10	42	11.2	15	12	44	
	MED	-	-	7.7	15	8	45	9.6	15	10	47	
	HIGH	-	-	7.3	15	7	49	9.2	15	9	51	

See Legend and calculations on page 72.

Table 51 (cont.) MCA/MOCP DETERMINATION NO C.O. OR UNPWRD C.O.

UNIT RHH	NOM. V-PH-HZ	IFM TYPE	ELEC HTR		WITHOUT C.O. or UNPWR C.O.							
			NOM (kW)	FLA	WITHOUT P.E.				WITH P.E. (pwrd fr/unit)			
					MCA	MOCP	DISC. SIZE		MCA	MOCP	DISC. SIZE	
						FLA	LRA			FLA	LRA	
048	208/230-1-60	DD-STD	-	-	33.6	50	33	119	35.5	50	35	121
			3.3/4.4	15.9/18.3	53.4/56.4	60/60	51/54	135/137	55.3/58.3	60/60	53/56	137/139
			6.5/8.7	31.4/36.3	72.8/78.9	80/80	69/75	150/155	74.7/80.8	80/90	71/77	152/157
			9.8/13.0	46.9/54.2	92.2/101.3	100/110	87/95	213/227	94.1/103.2	100/110	89/97	215/229
			13.1/17.4	62.8/72.5	112.1/124.2	125/125	105/116	245/264	114.0/126.1	125/150	107/118	247/266
			15.8/21.0	75.8/87.5	128.3/142.9	150/150	120/134	271/294	130.2/144.8	150/150	122/136	273/296
	208/230-3-60	DD-STD	-	-	25.2	30	25	93	27.1	40	27	95
			4.9/6.5	13.6/15.6	42.2/44.7	50/50	41/43	107/109	44.1/46.6	50/50	43/45	109/111
			6.5/8.7	18.1/20.9	47.8/51.3	50/60	46/49	111/114	49.7/53.2	50/60	48/51	113/116
			12.0/16.0	33.4/38.5	66.9/73.3	70/80	64/69	126/132	68.8/75.2	70/80	66/72	128/134
		MED	-	-	23.0	30	23	105	24.9	30	25	107
			4.9/6.5	13.6/15.6	40.0/42.5	45/50	38/41	119/121	41.9/44.4	50/50	40/43	121/123
			6.5/8.7	18.1/20.9	45.6/49.1	50/50	43/47	123/126	47.5/51.0	50/60	46/49	125/128
			12.0/16.0	33.4/38.5	64.7/71.1	70/80	61/67	138/144	66.6/73.0	70/80	63/69	140/146
		HIGH	-	-	23.0	30	23	116	24.9	30	25	118
			4.9/6.5	13.6/15.6	40.0/42.5	45/50	38/41	130/132	41.9/44.4	50/50	40/43	132/134
			6.5/8.7	18.1/20.9	45.6/49.1	50/50	43/47	134/137	47.5/51.0	50/60	46/49	136/139
			12.0/16.0	33.4/38.5	64.7/71.1	70/80	61/67	149/155	66.6/73.0	70/80	63/69	151/157
	460-3-60	DD-STD	-	-	12.4	15	13	47	13.4	15	14	48
			6.0	7.2	21.4	25	21	54	22.4	25	22	55
			11.5	13.8	29.7	30	28	61	30.7	35	30	62
			14.0	16.8	33.4	35	32	64	34.4	35	33	65
			23.0	27.7	47.1	50	44	102	48.1	50	46	103
		MED	-	-	11.0	15	11	52	12.0	15	12	53
6.0			7.2	20.0	25	19	59	21.0	25	20	60	
11.5			13.8	28.3	30	27	66	29.3	30	28	67	
14.0			16.8	32.0	35	30	69	33.0	35	31	70	
HIGH		-	-	11.0	15	11	58	12.0	15	12	59	
		6.0	7.2	20.0	25	19	65	21.0	25	20	66	
		11.5	13.8	28.3	30	27	72	29.3	30	28	73	
	14.0	16.8	32.0	35	30	75	33.0	35	31	76		
575-3-60	DD-STD	-	-	10.3	15	11	39	12.2	15	13	41	
		-	-	8.7	15	9	42	10.6	15	11	44	
		-	-	8.3	15	8	46	10.2	15	10	48	

See Legend and calculations on page 72.

Table 51 (cont.) MCA/MOCP DETERMINATION NO C.O. OR UNPWRD C.O.

UNIT RHH	NOM. V-PH-HZ	IFM TYPE	ELEC HTR		WITHOUT C.O. or UNPWR C.O.							
			NOM (kW)	FLA	WITHOUT P.E.				WITH P.E. (pwrd fr/unit)			
					MCA	MOCP	DISC. SIZE		MCA	MOCP	DISC. SIZE	
						FLA	LRA	MCA	MOCP	FLA	LRA	
060	208/230-1-60	DD-STD	-	-	40.1	60	39	144	42.0	60	41	146
			4.9/6.5	23.5/27.1	69.4/73.9	80/80	66/70	168/171	71.3/75.8	80/80	68/72	170/173
			6.5/8.7	31.4/36.3	79.3/85.4	80/100	75/81	175/180	81.2/87.3	90/100	77/83	177/182
			9.8/13.0	46.9/54.2	98.7/107.8	100/110	93/101	238/252	100.6/109.7	110/110	95/103	240/254
			13.1/17.4	62.8/72.5	118.6/130.7	125/150	111/122	270/289	120.5/132.6	125/150	113/124	272/291
			15.8/21.0	75.8/87.5	134.8/149.4	150/150	126/139	296/319	136.7/151.3	150/175	128/142	298/321
	208/230-3-60	DD-STD	-	-	28.7	40	28	120	30.6	45	31	122
			4.9/6.5	13.6/15.6	45.7/48.2	50/60	44/46	134/136	47.6/50.1	60/60	46/49	136/138
			7.9/10.5	21.9/25.3	56.1/60.3	60/70	54/58	142/145	58.0/62.2	60/70	56/60	144/147
			12.0/16.0	33.4/38.5	70.4/76.8	80/80	67/73	153/159	72.3/78.7	80/80	69/75	155/161
			15.8/21.0	43.8/50.5	83.4/91.8	90/100	79/86	208/221	85.3/93.7	90/100	81/89	210/223
			19.9/26.5	55.2/63.8	97.7/108.4	100/110	92/102	230/248	99.6/110.3	100/125	94/104	232/250
		MED	-	-	26.5	40	26	143	28.4	40	28	145
			4.9/6.5	13.6/15.6	43.5/46.0	50/50	42/44	157/159	45.4/47.9	50/50	44/46	159/161
			7.9/10.5	21.9/25.3	53.9/58.1	60/60	51/55	165/168	55.8/60.0	60/60	53/57	167/170
			12.0/16.0	33.4/38.5	68.2/74.6	70/80	64/70	176/182	70.1/76.5	80/80	66/72	178/184
			15.8/21.0	43.8/50.5	81.2/89.6	90/90	76/84	231/244	83.1/91.5	90/100	78/86	233/246
			19.9/26.5	55.2/63.8	95.5/106.2	100/110	89/99	253/271	97.4/108.1	100/110	92/101	255/273
	HIGH	-	-	28.8	40	29	169	30.7	45	31	171	
		4.9/6.5	13.6/15.6	45.8/48.3	50/60	44/46	183/185	47.7/50.2	60/60	46/49	185/187	
		7.9/10.5	21.9/25.3	56.2/60.4	60/70	54/58	191/194	58.1/62.3	60/70	56/60	193/196	
		12.0/16.0	33.4/38.5	70.5/76.9	80/80	67/73	202/208	72.4/78.8	80/80	69/75	204/210	
		15.8/21.0	43.8/50.5	83.5/91.9	90/100	79/87	257/270	85.4/93.8	90/100	81/89	259/272	
		19.9/26.5	55.2/63.8	97.8/108.5	100/110	92/102	279/297	99.7/110.4	100/125	94/104	281/299	
	460-3-60	DD-STD	-	-	13.6	20	14	58	14.6	20	15	59
			6.0	7.2	22.6	25	22	65	23.6	25	23	66
			11.5	13.8	30.8	35	29	72	31.8	35	31	73
			14.0	16.8	34.6	35	33	75	35.6	40	34	76
23.0			27.7	48.2	50	45	113	49.2	50	47	114	
25.5			30.7	51.9	60	49	119	52.9	60	50	120	
MED		-	-	12.2	15	12	69	13.2	20	13	70	
		6.0	7.2	21.2	25	20	76	22.2	25	21	77	
		11.5	13.8	29.4	30	28	83	30.4	35	29	84	
		14.0	16.8	33.2	35	31	86	34.2	35	32	87	
		23.0	27.7	46.8	50	44	124	47.8	50	45	125	
		25.5	30.7	50.5	60	47	130	51.5	60	48	131	
HIGH		-	-	13.0	15	13	82	14.0	20	14	83	
		6.0	7.2	22.0	25	21	89	23.0	25	22	90	
		11.5	13.8	30.2	35	29	96	31.2	35	30	97	
		14.0	16.8	34.0	35	32	99	35.0	35	33	100	
		23.0	27.7	47.6	50	45	137	48.6	50	46	138	
		25.5	30.7	51.3	60	48	143	52.3	60	49	144	
575-3-60	DD-STD	-	-	11.2	15	11	46	13.1	15	14	48	
	MED	-	-	9.2	15	9	53	11.1	15	11	55	
	HIGH	-	-	10.0	15	10	64	11.9	15	12	66	

See Legend and calculations on page 72.

Table 51 (cont.) MCA/MOCP DETERMINATION NO C.O. OR UNPWRD C.O.

UNIT RHH	NOM. V-PH-HZ	IFM TYPE	ELEC HTR		WITHOUT C.O. or UNPWR C.O.							
			Nom (kW)	FLA	WITHOUT P.E.				WITH P.E. (pwrd fr/unit)			
					MCA	MOCP	DISC. SIZE		MCA	MOCP	DISC. SIZE	
						FLA	LRA			FLA	LRA	
072	208/230-3-60	STD	-	-	32.0	50	31	148	35.8	50	36	152
			4.9/6.5	13.6/15.6	49.0/51.5	60/60	47/49	162/164	52.8/55.3	60/60	51/54	166/168
			7.8/10.4	21.7/25.0	59.1/63.2	60/70	56/60	170/173	62.9/67.0	70/70	61/64	174/177
			12.0/16.0	33.4/38.5	73.7/80.1	80/90	70/76	181/187	77.5/83.9	80/90	74/80	185/191
			15.8/21.0	43.8/50.5	86.7/95.1	90/100	82/89	236/249	90.5/98.9	100/100	86/94	240/253
		19.9/26.5	55.2/63.8	101.0/111.7	110/125	95/105	258/276	104.8/115.5	110/125	99/109	262/280	
		MED	-	-	34.3	50	34	185	38.1	50	38	189
			4.9/6.5	13.6/15.6	51.3/53.8	60/60	50/52	199/201	55.1/57.6	60/60	54/56	203/205
			7.8/10.4	21.7/25.0	61.4/65.5	70/70	59/63	207/210	65.2/69.3	70/80	63/67	211/214
	12.0/16.0		33.4/38.5	76.0/82.4	80/90	72/78	218/224	79.8/86.2	80/90	77/83	222/228	
	HIGH	-	-	41.8	60	43	211	45.6	60	47	215	
		4.9/6.5	13.6/15.6	58.8/61.3	70/70	58/60	225/227	62.6/65.1	70/80	63/65	229/231	
		7.8/10.4	21.7/25.0	68.9/73.0	80/80	68/71	233/236	72.7/76.8	80/80	72/76	237/240	
		12.0/16.0	33.4/38.5	83.5/89.9	90/90	81/87	244/250	87.3/93.7	90/100	85/91	248/254	
		15.8/21.0	43.8/50.5	96.5/104.9	100/110	93/101	299/312	100.3/108.7	110/110	97/105	303/316	
	19.9/26.5	55.2/63.8	110.8/121.5	125/125	106/116	321/339	114.6/125.3	125/150	110/120	325/343		
	460-3-60	STD	-	-	16.3	25	16	75	18.1	25	18	77
			6.0	7.2	25.3	30	24	82	27.1	30	26	84
			11.5	13.8	33.6	35	32	89	35.4	40	34	91
			14.0	16.8	37.3	40	35	92	39.1	40	37	94
			23.0	27.7	51.0	60	48	103	52.8	60	50	105
		25.5	30.7	54.7	60	51	106	56.5	60	53	108	
		MED	-	-	17.1	25	17	94	18.9	25	19	96
			6.0	7.2	26.1	30	25	101	27.9	30	27	103
11.5			13.8	34.4	40	33	108	36.2	40	35	110	
14.0			16.8	38.1	40	36	111	39.9	45	38	113	
23.0			27.7	51.8	60	49	122	53.6	60	51	124	
25.5		30.7	55.5	60	52	125	57.3	60	54	127		
HIGH		-	-	21.1	30	22	107	22.9	30	24	109	
		6.0	7.2	30.1	35	30	114	31.9	35	32	116	
		11.5	13.8	38.4	40	37	121	40.2	45	39	123	
	14.0	16.8	42.1	45	41	124	43.9	45	43	126		
	23.0	27.7	55.8	60	53	135	57.6	60	55	137		
25.5	30.7	59.5	60	57	138	61.3	70	59	140			
575-3-60	STD	-	-	12.9	20	13	61	16.7	20	17	65	
	MED	-	-	13.3	20	13	76	17.1	20	17	80	
	HIGH	-	-	16.1	20	16	90	19.9	25	21	94	

See Legend and calculations on page 72.

Table 51 (cont.) MCA/MOCP DETERMINATION NO C.O. OR UNPWRD C.O.

UNIT RHH	NOM. V-PH-HZ	IFM TYPE	ELEC HTR		WITHOUT C.O. or UNPWR C.O.							
			Nom (kW)	FLA	WITHOUT P.E.				WITH P.E. (pwrd fr/unit)			
					MCA	MOCP	DISC. SIZE		MCA	MOCP	DISC. SIZE	
						FLA	LRA			FLA	LRA	
090	208/230-3-60	STD	-	-	37.7	50	40	191	41.5	50	44	195
			7.8/10.4	21.7/25.0	64.8/68.9	70/70	65/68	213/216	68.6/72.7	70/80	69/73	217/220
			12.0/16.0	33.4/38.5	79.4/85.8	80/90	78/84	224/230	83.2/89.6	90/90	82/88	228/234
			18.6/24.8	51.7/59.7	102.3/112.3	110/125	99/108	243/251	106.1/116.1	110/125	103/113	247/255
			24.0/32.0	66.7/77.0	121.1/133.9	125/150	116/128	258/268	124.9/137.7	125/150	121/132	262/272
		31.8/42.4	88.4/102.0	148.2/165.2	150/175	141/157	368/395	152.0/169.0	175/175	146/161	372/399	
		MED	-	-	37.7	50	40	202	41.5	50	44	206
			7.8/10.4	21.7/25.0	64.8/68.9	70/70	65/68	224/227	68.6/72.7	70/80	69/73	228/231
			12.0/16.0	33.4/38.5	79.4/85.8	80/90	78/84	235/241	83.2/89.6	90/90	82/88	239/245
	18.6/24.8		51.7/59.7	102.3/112.3	110/125	99/108	254/262	106.1/116.1	110/125	103/113	258/266	
	24.0/32.0		66.7/77.0	121.1/133.9	125/150	116/128	269/279	124.9/137.7	125/150	121/132	273/283	
	31.8/42.4	88.4/102.0	148.2/165.2	150/175	141/157	379/406	152.0/169.0	175/175	146/161	383/410		
	HIGH	-	-	42.5	50	45	245	46.3	50	49	249	
		7.8/10.4	21.7/25.0	69.6/73.7	70/80	70/74	267/270	73.4/77.5	80/80	74/78	271/274	
		12.0/16.0	33.4/38.5	84.2/90.6	90/100	83/89	278/284	88.0/94.4	90/100	88/94	282/288	
		18.6/24.8	51.7/59.7	107.1/117.1	110/125	105/114	297/305	110.9/120.9	125/125	109/118	301/309	
		24.0/32.0	66.7/77.0	125.9/138.7	150/150	122/134	312/322	129.7/142.5	150/150	126/138	316/326	
	31.8/42.4	88.4/102.0	153.0/170.0	175/175	147/162	422/449	156.8/173.8	175/175	151/167	426/453		
	460-3-60	STD	-	-	17.9	20	19	95	19.7	25	21	97
			13.9	16.7	38.8	40	38	112	40.6	45	40	114
			16.5	19.8	42.7	45	42	115	44.5	45	44	117
			27.8	33.4	59.7	60	57	128	61.5	70	59	130
			33.0	39.7	67.6	70	65	135	69.4	70	67	137
		41.7	50.2	80.7	90	77	195	82.5	90	79	197	
MED		-	-	17.9	20	19	101	19.7	25	21	103	
		13.9	16.7	38.8	40	38	118	40.6	45	40	120	
		16.5	19.8	42.7	45	42	121	44.5	45	44	123	
		27.8	33.4	59.7	60	57	134	61.5	70	59	136	
		33.0	39.7	67.6	70	65	141	69.4	70	67	143	
41.7		50.2	80.7	90	77	201	82.5	90	79	203		
HIGH		-	-	19.7	25	21	123	21.5	25	23	125	
		13.9	16.7	40.6	45	40	140	42.4	45	42	142	
		16.5	19.8	44.5	45	44	143	46.3	50	46	145	
	27.8	33.4	61.5	70	59	156	63.3	70	61	158		
	33.0	39.7	69.4	70	67	163	71.2	80	69	165		
41.7	50.2	82.5	90	79	223	84.3	90	81	225			
575-3-60	STD	-	-	13.5	15	14	77	17.3	20	19	81	
		17.0	20.4	39.0	40	38	97	42.8	45	42	101	
	34.0	40.9	64.6	70	61	118	68.4	70	66	122		
	MED	-	-	13.1	15	14	81	16.9	20	18	85	
		17.0	20.4	38.6	40	37	101	42.4	45	42	105	
		34.0	40.9	64.2	70	61	122	68.0	70	65	126	
	HIGH	-	-	13.9	20	15	92	17.7	20	19	96	
		17.0	20.4	39.4	40	38	112	43.2	45	43	116	
		34.0	40.9	65.0	70	62	133	68.8	70	66	137	

See Legend and calculations on page 72.

Table 51 (cont.) MCA/MOCP DETERMINATION NO C.O. OR UNPWRD C.O.

Unit RHH	NOM. V-PH-HZ	IFM TYPE	ELEC HTR		WITHOUT C.O. or UNPWR C.O.							
			Nom (kW)	FLA	WITHOUT P.E.				WITH P.E. (pwrd fr/unit)			
					MCA	MOCP	DISC. SIZE		MCA	MOCP	DISC. SIZE	
						FLA	LRA			FLA	LRA	
102	208/230-3-60	STD	-	-	45.1	60	47	225	48.9	60	52	229
			7.8/10.4	21.7/25.0	72.2/76.4	80/80	72/76	247/250	76.0/80.2	80/90	77/80	251/254
			12.0/16.0	33.4/38.5	86.9/93.2	90/100	86/92	258/264	90.7/97.0	100/100	90/96	262/268
			18.6/24.8	51.7/59.7	109.7/119.7	110/125	107/116	277/285	113.5/123.5	125/125	111/120	281/289
			24.0/32.0	66.7/77.0	128.5/141.4	150/150	124/136	292/302	132.3/145.2	150/150	128/140	296/306
		31.8/42.4	88.4/102.0	155.6/172.6	175/175	149/165	402/429	159.4/176.4	175/200	153/169	406/433	
		MED	-	-	47.4	60	50	262	51.2	60	54	266
			7.8/10.4	21.7/25.0	74.5/78.7	80/80	75/79	284/287	78.3/82.5	80/90	79/83	288/291
			12.0/16.0	33.4/38.5	89.2/95.5	90/100	88/94	295/301	93.0/99.3	100/100	93/99	299/305
	18.6/24.8		51.7/59.7	112.0/122.0	125/125	109/119	314/322	115.8/125.8	125/150	114/123	318/326	
	24.0/32.0		66.7/77.0	130.8/143.7	150/150	127/138	329/339	134.6/147.5	150/150	131/143	333/343	
	31.8/42.4	88.4/102.0	157.9/174.9	175/175	152/167	439/466	161.7/178.7	175/200	156/172	443/470		
	HIGH	-	-	49.9	60	53	279	53.7	60	57	283	
		7.8/10.4	21.7/25.0	77.0/81.2	80/90	78/82	301/304	80.8/85.0	90/90	82/86	305/308	
		12.0/16.0	33.4/38.5	91.7/98.0	100/100	91/97	312/318	95.5/101.8	100/110	96/101	316/322	
		18.6/24.8	51.7/59.7	114.5/124.5	125/125	112/121	331/339	118.3/128.3	125/150	117/126	335/343	
		24.0/32.0	66.7/77.0	133.3/146.2	150/150	129/141	346/356	137.1/150.0	150/150	134/146	350/360	
	31.8/42.4	88.4/102.0	160.4/177.4	175/200	154/170	456/483	164.2/181.2	175/200	159/174	460/487		
	460-3-60	STD	-	-	20.7	25	22	112	22.5	25	24	114
			13.9	16.7	41.5	45	41	129	43.3	45	43	131
			16.5	19.8	45.4	50	45	132	47.2	50	47	134
			27.8	33.4	62.4	70	60	145	64.2	70	62	147
			33.0	39.7	70.3	80	67	152	72.1	80	69	154
		41.7	50.2	83.4	90	79	212	85.2	90	82	214	
MED		-	-	21.5	25	23	131	23.3	30	25	133	
		13.9	16.7	42.3	45	42	148	44.1	45	44	150	
		16.5	19.8	46.2	50	45	151	48.0	50	47	153	
		27.8	33.4	63.2	70	61	164	65.0	70	63	166	
		33.0	39.7	71.1	80	68	171	72.9	80	70	173	
41.7		50.2	84.2	90	80	231	86.0	90	82	233		
HIGH		-	-	22.5	25	24	140	24.3	30	26	142	
		13.9	16.7	43.3	45	43	157	45.1	50	45	159	
		16.5	19.8	47.2	50	47	160	49.0	50	49	162	
	27.8	33.4	64.2	70	62	173	66.0	70	64	175		
	33.0	39.7	72.1	80	69	180	73.9	80	72	182		
41.7	50.2	85.2	90	82	240	87.0	90	84	242			
575-3-60	STD	-	-	16.3	20	17	97	20.1	25	22	101	
		17.0	20.4	41.8	45	41	117	45.6	50	45	121	
		34.0	40.9	67.4	70	64	138	71.2	80	69	142	
	MED	-	-	17.1	20	18	108	20.9	25	22	112	
		17.0	20.4	42.6	45	42	128	46.4	50	46	132	
		34.0	40.9	68.2	70	65	149	72.0	80	69	153	
	HIGH	-	-	17.1	20	18	108	20.9	25	22	112	
		17.0	20.4	42.6	45	42	128	46.4	50	46	132	
		34.0	40.9	68.2	70	65	149	72.0	80	69	153	

See Legend and calculations on page 72.

Table 51 (cont.) MCA/MOCP DETERMINATION NO C.O. OR UNPWRD C.O.

Unit RHH	Nom V-Ph-H	IFM TYPE	ELEC HTR		WITHOUT C.O. or UNPWR C.O.							
			NOM (kW)	FLA	WITHOUT P.E.				WITH P.E. (pwrd fr/unit)			
					MCA	MOCP	DISC. SIZE		MCA	MOCP	DISC. SIZE	
							FLA	LRA			FLA	LRA
208/230-3 -60	STD	-	-	45.2	60	47	262	49.0	60	52	266	
		7.5/10.0	20.9/24.1	71.3/75.3	80/80	71/75	283/286	75.1/79.1	80/80	76/79	287/290	
		12.4/16.5	34.4/39.7	88.2/94.8	90/100	87/93	296/302	92.0/98.6	100/100	91/97	300/306	
		25.2/33.5	69.9/80.6	132.6/145.9	150/150	128/140	332/343	136.4/149.7	150/150	132/144	336/347	
		32.7/43.5	90.7/104.7	158.6/176.1	175/200	152/168	443/471	162.4/179.9	175/200	156/172	447/475	
	37.6/50.0	104.3/120.3	175.6/165.5	200/175	167/186	471/503	179.4/169.3	200/175	172/190	475/507		
	MED	-	-	47.5	60	50	288	51.3	60	54	292	
		7.5/10.0	20.9/24.1	73.6/77.6	80/80	74/78	309/312	77.4/81.4	80/90	78/82	313/316	
		12.4/16.5	34.4/39.7	90.5/97.1	100/100	90/96	322/328	94.3/100.9	100/110	94/100	326/332	
		25.2/33.5	69.9/80.6	134.9/148.2	150/150	130/143	358/369	138.7/152.0	150/175	135/147	362/373	
		32.7/43.5	90.7/104.7	160.9/178.4	175/200	154/170	469/497	164.7/182.2	175/200	159/175	473/501	
	37.6/50.0	104.3/120.3	177.9/167.8	200/175	170/188	497/529	181.7/171.6	200/200	174/193	501/533		
	HIGH	-	-	57.3/55.0	70/60	61/59	316	61.1/58.8	70/70	65/63	320	
		7.5/10.0	20.9/24.1	83.4/85.1	90/90	85/86	337/340	87.2/88.9	90/90	89/91	341/344	
		12.4/16.5	34.4/39.7	100.3/104.6	110/110	101/104	350/356	104.1/108.4	110/110	105/109	354/360	
		25.2/33.5	69.9/80.6	144.6/155.7	150/175	141/151	386/397	148.4/159.5	150/175	146/156	390/401	
		32.7/43.5	90.7/104.7	170.6/185.9	175/200	165/179	497/525	174.4/189.7	175/200	170/183	501/529	
	37.6/50.0	104.3/120.3	187.6/175.3	200/200	181/197	525/557	191.4/179.1	200/200	185/201	529/561		
	HIGH High Eff.	-	-	61.5	80	65	324	65.3	80	69	328	
		7.5/10.0	20.9/24.1	87.6/91.6	100/100	89/93	345/348	91.4/95.4	100/100	93/97	349/352	
12.4/16.5		34.4/39.7	104.5/111.1	110/125	104/111	358/364	108.3/114.9	110/125	109/115	362/368		
25.2/33.5		69.9/80.6	148.9/162.3	150/175	145/158	394/405	152.7/166.1	175/175	150/162	398/409		
32.7/43.5		90.7/104.7	174.9/192.4	175/200	169/185	505/533	178.7/196.2	200/200	174/190	509/537		
37.6/50.0	104.3/120.3	191.9/181.8	200/200	185/203	533/565	195.7/185.6	200/200	189/208	537/569			
120	STD	-	-	22.3	30	23	125	24.1	30	26	127	
		10.0	12.0	37.3	40	37	137	39.1	40	39	139	
		16.5	19.9	47.2	50	46	145	49.0	50	48	147	
		33.5	40.3	72.7	80	70	165	74.5	80	72	167	
		43.5	52.3	87.7	90	84	230	89.5	90	86	232	
	50.0	60.2	82.5	90	93	245	84.3	90	95	247		
	MED	-	-	23.1	30	24	138	24.9	30	26	140	
		10.0	12.0	38.1	40	38	150	39.9	40	40	152	
		16.5	19.9	48.0	50	47	158	49.8	50	49	160	
		33.5	40.3	73.5	80	71	178	75.3	80	73	180	
		43.5	52.3	88.5	90	85	243	90.3	100	87	245	
	50.0	60.2	83.3	90	94	258	85.1	90	96	260		
	HIGH	-	-	27.3	30	29	152	29.1	35	31	154	
		10.0	12.0	42.3	45	43	164	44.1	45	45	166	
		16.5	19.9	52.2	60	52	172	54.0	60	54	174	
		33.5	40.3	77.7	80	76	192	79.5	80	78	194	
		43.5	52.3	92.7	100	89	257	94.5	100	91	259	
	50.0	60.2	87.5	90	98	272	89.3	100	101	274		
	HIGH High Eff.	-	-	30.6	40	32	156	32.4	40	34	158	
		10.0	12.0	45.6	50	46	168	47.4	50	48	170	
16.5		19.9	55.4	60	55	176	57.2	60	57	178		
33.5		40.3	80.9	90	79	196	82.7	90	81	198		
43.5		52.3	95.9	100	92	261	97.7	100	94	263		
50.0	60.2	90.8	100	101	276	92.6	100	104	278			
575-3-60	STD	-	-	17.1	20	18	95	20.9	25	22	99	
		10.0	9.6	29.1	30	29	105	32.9	35	33	109	
		16.5	15.9	36.9	40	36	111	40.7	45	41	115	
		33.5	32.2	57.3	60	55	127	61.1	70	59	131	
		43.5	41.8	69.3	70	66	179	73.1	80	70	183	
	50.0	48.1	65.2	70	73	191	69.0	80	78	195		
	MED	-	-	17.9	20	19	106	21.7	25	23	110	
		10.0	9.6	29.9	30	30	116	33.7	35	34	120	
		16.5	15.9	37.7	40	37	122	41.5	45	42	126	
		33.5	32.2	58.1	60	56	138	61.9	70	60	142	
		43.5	41.8	70.1	80	67	190	73.9	80	71	194	
	50.0	48.1	66.0	70	74	202	69.8	80	79	206		
	HIGH	-	-	21.2	25	23	109	25.0	30	27	113	
		10.0	9.6	33.2	35	34	119	37.0	40	38	123	
		16.5	15.9	41.1	45	41	125	44.9	45	45	129	
		33.5	32.2	61.5	70	60	141	65.3	70	64	145	
		43.5	41.8	73.5	80	71	193	77.3	80	75	197	
	50.0	48.1	69.3	80	78	205	73.1	80	82	209		
	HIGH High Eff.	-	-	24.9	30	26	118	28.7	35	30	122	
		10.0	9.6	36.9	40	37	128	40.7	45	41	132	
16.5		15.9	44.7	45	44	134	48.5	50	49	138		
33.5		32.2	65.1	70	63	150	68.9	70	67	154		
43.5		41.8	77.1	80	74	202	80.9	90	78	206		
50.0	48.1	73.0	80	81	214	76.8	80	86	218			

See Legend and calculations on page 72.

LEGEND:

- CO - Convenient outlet
- DISC - Disconnect
- FLA - Full load amps
- IFM - Indoor fan motor
- LRA - Locked rotor amps
- MCA - Minimum circuit amps
- MOCP - Maximum over current protection
- PE - Power exhaust
- UNPWRD CO - Unpowered convenient outlet



NOTES:

1. In compliance with NEC requirements for multimotor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be fuse or HACR breaker. Canadian units may be fuse or circuit breaker.

2. Unbalanced 3-Phase Supply Voltage

Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percentage of voltage imbalance.

$$\% \text{ Voltage Imbalance} = 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

Example: Supply voltage is 230-3-60



AB = 224 v

BC = 231 v

AC = 226 v

$$\begin{aligned} \text{Average Voltage} &= \frac{(224 + 231 + 226)}{3} = \frac{681}{3} \\ &= 227 \end{aligned}$$

Determine maximum deviation from average voltage.

(AB) 227 - 224 = 3 v

(BC) 231 - 227 = 4 v

Maximum deviation is 4 v.

Determine percent of voltage imbalance.

$$\begin{aligned} \% \text{ Voltage Imbalance} &= 100 \times \frac{4}{227} \\ &= 1.76\% \end{aligned}$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

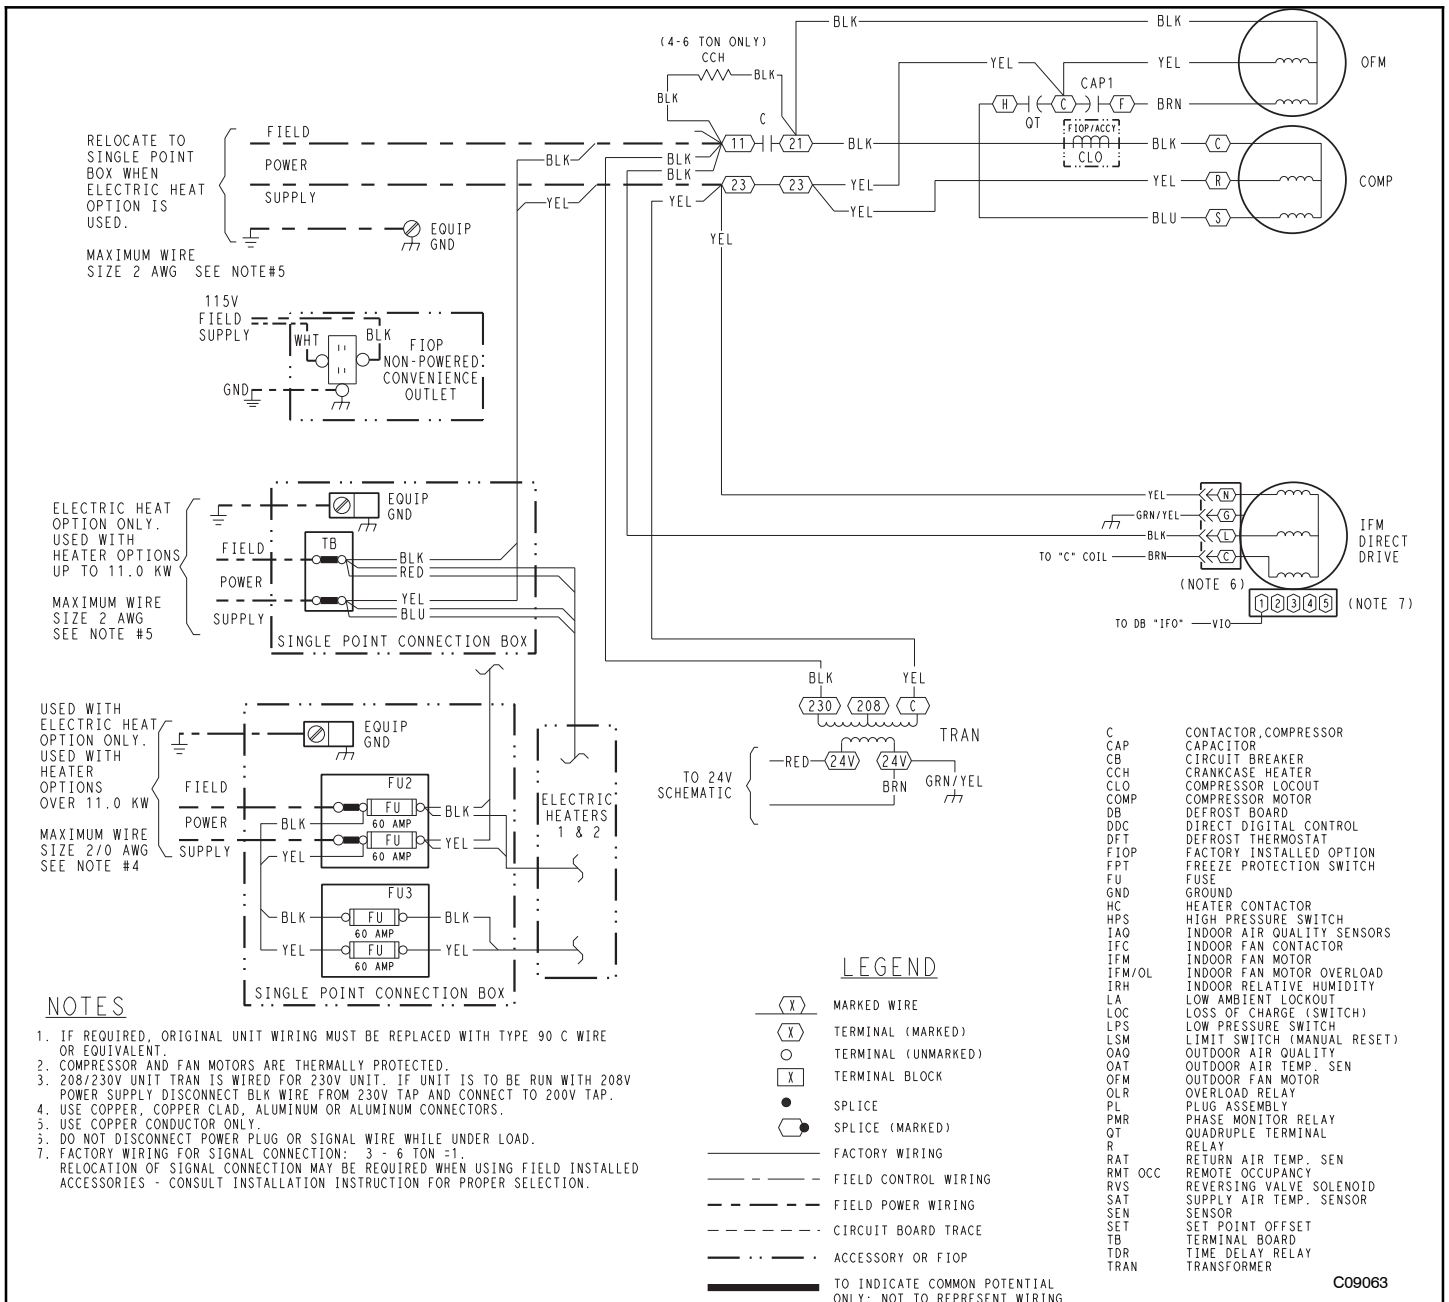


Fig. 13 - 1 Stage Typical Power Diagram

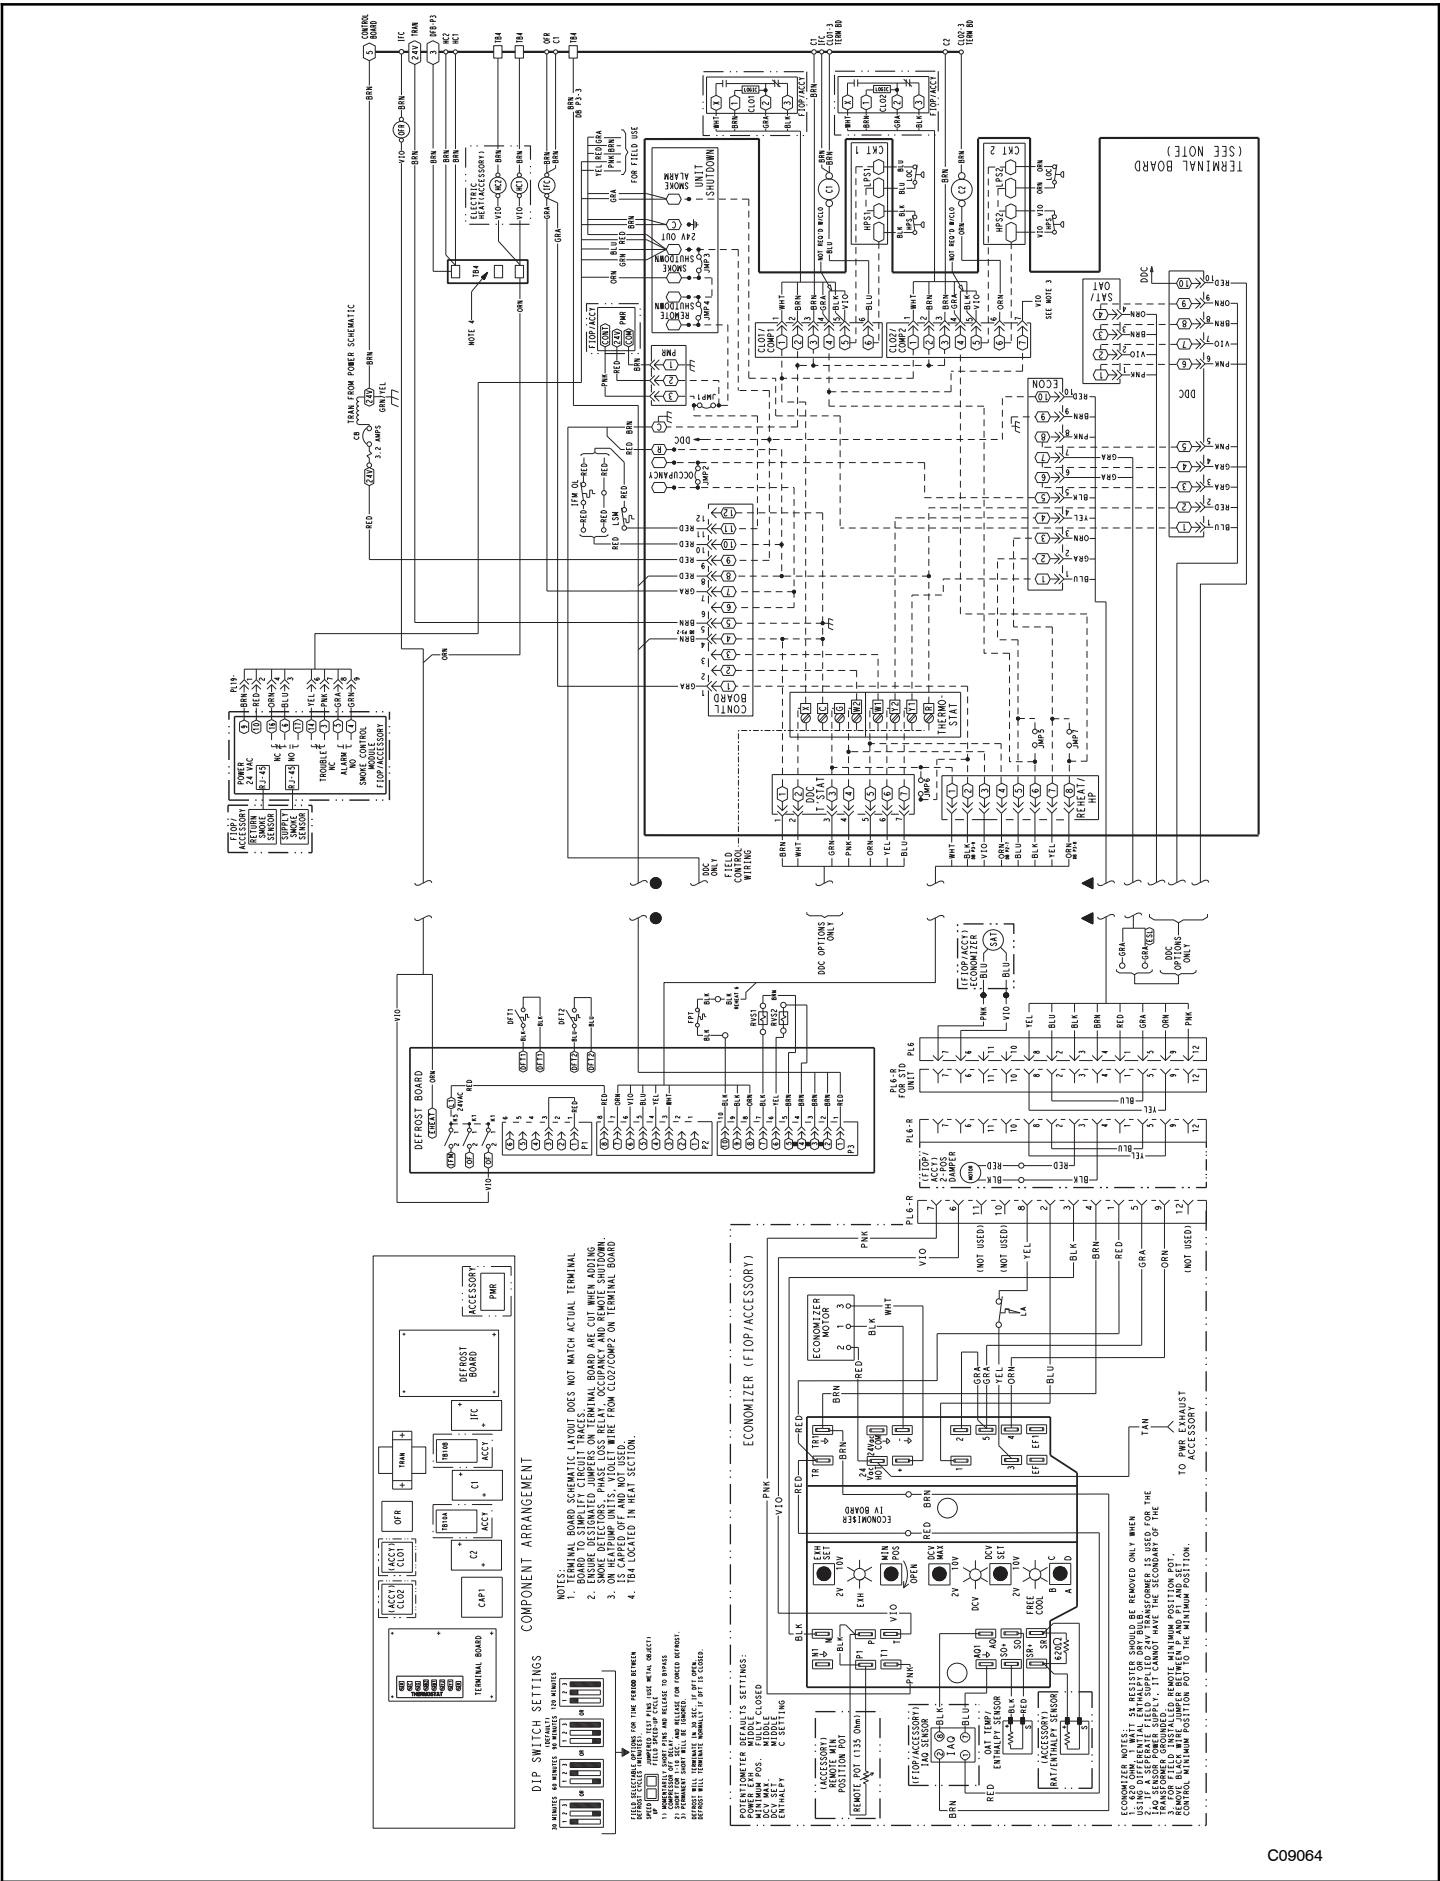


Fig. 12, 2 - Stage Typical Wiring Diagram

C09064

SEQUENCE OF OPERATION

Cooling, unit without economizer

When thermostat calls for cooling, terminals G and Y1 are energized. The indoor fan contactor (IFC), reversing valve solenoid (RVS) and compressor contactor are energized and indoor fan motor, compressor, and outdoor fan starts. The outdoor fan motor runs continuously while unit is cooling.

Two-stage models: If Stage 1 cooling does not satisfy the space load, the space temperature will rise until thermostat calls for Stage 2 cooling (Y2 closes). Defrost Board activates Stage 2 Compressor. Reversing valve 2 switches to Cooling position. Compressor 2 contactor is energized; Compressor 2 starts and Circuit 2 operates in Cooling mode.

When Cooling Stage 2 is satisfied, thermostat Y2 opens. Compressor 2 contactor is de-energized; Compressor 2 stops. Reversing Valve 2 remains energized.

When Cooling Stage 1 is satisfied, thermostat Y1 opens. Compressor 1 contactor is de-energized; Compressor 1 stops. Outdoor fan relay is de-energized; outdoor fans stop. After the Fan Delay period, the Indoor fan contactor is de-energized; indoor fan stops (unless Continuous Fan operation has been selected). Reversing Valve 1 remains energized.

Reversing valve solenoids are energized in Cooling modes. Each solenoid will remain energized until the next Heating mode is initiated for this circuit.

Heating, unit without economizer

Upon a request for heating from the space thermostat, terminal W1 will be energized with 24V. The IFC, outdoor fan contactor (OFC), C1, and C2 will be energized. The indoor fan, outdoor fans, and compressor no. 1, and compressor no. 2 are energized and reversing valves are de-energized and switch position.

If the space temperature continues to fall while W1 is energized, W2 will be energized with 24V, and the heater contactor(s) (HC) will be energized, which will energize the electric heater(s).

When the space thermostat is satisfied, W2 will be de-energized first, and the electric heater(s) will be de-energized.

Upon a further rise in space temperature, W1 will be de-energized.

Two compressor models: When the thermostat calls for heating, terminal W1 is energized. Defrost Board de-energizes both reversing valve solenoids and reversing valves move to Heating position. The indoor fan contactor is energized; indoor fan motor starts. Outdoor fan relay is energized; both outdoor fan motors run. Compressor contactors C1 and C2 are energized; both refrigeration circuits operate in Heating mode.

If Stage 1 heating does not satisfy the space load, the space temperature will fall until thermostat calls for Stage 2 heating (W2 closes). Terminal W2 is energized. Defrost Board issues an output at EHEAT. Heater contactor 1 and heater contactor 2 (if installed) are energized; all electric heaters are energized.

When space heating load is partially satisfied, thermostat terminal W2 is de-energized; heater contactors are de-energized and all electric heat is terminated. Stage 1 heating continues.

When the space heating load is fully satisfied, thermostat terminal W1 is also de-energized.

Reversing valve solenoids remain de-energized until the next call for Cooling mode is initiated.

Cooling, unit with EconoMi\$er IV

When free cooling is not available, the compressors will be controlled by the zone thermostat. When free cooling is available, the outdoor air damper is modulated by the EconoMi\$er IV control to provide a 50 to 55°F (10° to 13°C) mixed air temperature into the zone. As the mixed air temperature fluctuates above 55 or below 50°F (13° to 10°C), the dampers will be modulated (open or close) to bring the mixed air temperature back within control.

If mechanical cooling is utilized with free cooling, the outdoor air damper will maintain its current position at the time the compressor is started. If the increase in cooling capacity causes the mixed air temperature to drop below 45°F (7°C), then the outdoor air damper position will be decreased to the minimum position. If the mixed air temperature continues to fall, the outdoor air damper will close. Control returns to normal once the mixed air temperature rises above 48°F (9°C).

If optional power exhaust is installed, as the outdoor air damper opens and closes, the power exhaust fans will be energized and de-energized.

If field-installed accessory CO₂ sensors are connected to the EconoMi\$er IV control, a demand controlled ventilation strategy will begin to operate. As the CO₂ level in the zone increases above the CO₂ setpoint, the minimum position of the damper will be increased proportionally. As the CO₂ level decreases because of the increase in fresh air, the outdoor air damper will be proportionally closed.

For EconoMi\$er IV operation, there must be a thermostat call for the fan (G). If the unit is occupied and the fan is on, the damper will operate at minimum position. Otherwise, the damper will be closed.

When the EconoMi\$er IV control is in the occupied mode and a call for cooling exists (Y1 on the thermostat), the control will first check for indoor fan operation. If the fan is not on, then cooling will not be activated. If the fan is on, then the control will open the EconoMi\$er IV damper to the minimum position.

On the initial power to the EconoMi\$er IV control, it will take the damper up to 2¹/₂ minutes before it begins to position itself. Any change in damper position will take up to 30 seconds to initiate. Damper movement from full closed to full open (or vice versa) will take between 1¹/₂ and 2¹/₂ minutes.

If free cooling can be used as determined from the appropriate changeover command (switch, dry bulb, enthalpy curve, differential dry bulb, or differential enthalpy), then the control will modulate the dampers open to maintain the mixed air temperature setpoint at 50° to 55°F (10° to 13°C).

If there is a further demand for cooling (cooling second stage — Y2 is energized), then the control will bring on compressor stage 1 to maintain the mixed air temperature setpoint. The EconoMi\$er IV damper will be open at maximum position. EconoMi\$er IV operation is limited to a single compressor.

Defrost

When the temperature of the outdoor coil drops below 28°F (-2°C) as sensed by the defrost thermostat (DFT2) and the defrost timer is at the end of a timed period (adjustable at 30, 60, 90 or 120 minutes), reversing valve solenoids (RVS1 and RVS2) are energized and the OFC is de-energized. This switches the position of the reversing valves and shuts off the outdoor fan. The electric heaters (if installed) will be energized.

The unit continues to defrost until the coil temperature as measured by DFT2 reaches 65°F (18°C), or the duration of defrost cycle completes a 10-minute period.

During the Defrost mode, if circuit 1 defrosts first, RVS1 will oscillate between Heating and Cooling modes until the Defrost mode is complete.

At the end of the defrost cycle, the electric heaters (if installed) will be de-energized; the reversing valves switch and the outdoor fan motor will be energized. The unit will now operate in the Heating mode.

If the space thermostat is satisfied during a defrost cycle, the unit will continue in the Defrost mode until the time or temperature constraints are satisfied.

Automatic changeover

When the system selection switch is set at AUTO. position, unit automatically changes from heating operation to cooling operation when the temperature of the conditioned space rises to the cooling level setting. When the temperature of the conditioned space falls to the heating level setting, unit automatically changes from cooling to heating operation (with a 3°F deadband in between).

Continuous air circulation

Turn unit power on. Set system control at OFF position. Set fan switch at ON position. The indoor fan contactor is energized through the thermostat switch and the indoor fan runs continuously.

Emergency heat

When the switch is on (thermostat is set to the EM HT position), compressor circuit and outdoor thermostats are bypassed, and the second stage of thermostat energizes the indoor blower and the electric resistance heaters.

Rooftop Packaged Heat Pump

HVAC Guide Specifications

Size Range: 3 to 10 Nominal Tons

<u>Section</u>	<u>Description</u>
----------------	--------------------

23 06 80	Schedules for Decentralized HVAC Equipment
-----------------	---

23 06 80.13	Decentralized Unitary HVAC Equipment Schedule
-------------	---

23 06 80.13.A.	Rooftop unit schedule
----------------	-----------------------

1. Schedule is per the project specification requirements.

23 07 16	HVAC Equipment Insulation
-----------------	----------------------------------

23 07 16.13	Decentralized, Rooftop Units:
-------------	-------------------------------

23 07 16.13.A.	Evaporator fan compartment:
----------------	-----------------------------

1. Interior cabinet surfaces shall be insulated with a minimum 1/2-in. thick, minimum 1 1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, neoprene coated on the air side.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

23 07 16.13.B.	Electric heat compartment:
----------------	----------------------------

1. Aluminum foil-faced fiberglass insulation shall be used.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

23 09 13	Instrumentation and Control Devices for HVAC
-----------------	---

23 09 13.23	Sensors and Transmitters
-------------	--------------------------

23 09 13.23.A.	Thermostats
----------------	-------------

1. Thermostat must
 - a. have capability to energize 2 different stages of cooling, and 2 different stages of heating.
 - b. include capability for occupancy scheduling.

23 09 23	Direct-digital Control system for HVAC
-----------------	---

23 09 23.13	
-------------	--

23 09 23.13.A.	
----------------	--

23 09 23.13.B.	
----------------	--

23 09 33	Electric and Electronic Control System for HVAC
-----------------	--

23 09 33.13	Decentralized, Rooftop Units:
-------------	-------------------------------

23 09 33.13.A.	General:
----------------	----------

1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side. Transformer shall have 75VA capability.
2. Shall utilize color-coded wiring.
3. Shall include a central control terminal board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, loss of charge, freeze switch, high pressure switches.
4. Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.
5. Shall include integrated defrost system to prevent excessive frost accumulation during heating duty, and shall be controlled as follows:
 - a. Defrost shall be initiated on the basis of time and coil temperature.
 - b. A 30,60,90,120 minute timer shall activate the defrost cycle only if the coil temperature is low enough to indicate a heavy frost condition.
 - c. Defrost cycle shall terminate when defrost thermostat are satisfied and shall have a positive termination time of 10 minutes.
6. Defrost system shall also include:
 - a. Defrost Cycle Indicator LED.
 - b. Dip switch selectable defrost time between 30,60,90 and 120 minutes. Factory set at 30 minutes.
 - c. Molded plug connection to insure proper connection.

23 09 33.23.B.	Safeties:
----------------	-----------

1. Compressor over-temperature, over current.
2. Loss of charge switch.
 - a. Units with 2 compressors shall have different sized connectors for the circuit 1 and circuit 2 low and high pressure switches. They shall physically prevent the cross-wiring of the safety switches between circuits 1 and 2.
 - b. Loss of charge switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.

3. High-pressure switch.
 - a. Units with 2 compressors shall have different sized connectors for the circuit 1 and circuit 2 low and high pressure switches. They shall physically prevent the cross-wiring of the safety switches between circuits 1 and 2.
 - b. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
4. Freeze protection thermostat, evaporator coil (one per refrigerant circuit).
5. Automatic reset, motor thermal overload protector.

23 09 93 Sequence of Operations for HVAC Controls

- 23 09 93.13 Decentralized, Rooftop Units:
 23 09 93.13 INSERT SEQUENCE OF OPERATION

23 40 13 Panel Air Filters

- 23 40 13.13 Decentralized, Rooftop Units:
 23 40 13.13.A. Standard filter section
1. Shall consist of factory-installed, low velocity, throwaway 2-in. thick fiberglass filters of commercially available sizes.
 2. Unit shall use only one filter size. Multiple sizes are not acceptable.
 3. Filters shall be accessible through an access panel with "no-tool" removal as described in the unit cabinet section of this specification (23 81 19.13.H).

23 81 19 Self-Contained Air Conditioners

- 23 81 19.13 Small-Capacity Self-Contained Air Conditioners (RHH036-120)
 23 81 19.13.A. General
1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a(n) hermetic scroll compressor(s) for cooling duty and heat pump for heating duty.
 2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
 3. Unit shall use environmentally safe, R-410A refrigerant.
 4. Unit shall be installed in accordance with the manufacturer's instructions.
 5. Unit must be selected and installed in compliance with local, state, and federal codes.
- 23 81 19.13.B. Quality Assurance
1. Unit meets ASHRAE 90.1-2004 minimum efficiency requirements.
 2. Unit shall be rated in accordance with AHRI Standards 210/240 and 340/360.
 3. Unit shall be designed to conform to ASHRAE 15, 2001.
 4. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
 5. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
 6. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM B117 (scribed specimen).
 7. Unit casing shall be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 5000-hour salt spray.
 8. Unit shall be designed in accordance with ISO 9001:2000, and shall be manufactured in a facility registered by ISO 9001:2000.
 9. Roof curb shall be designed to conform to NRCA Standards.
 10. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
 11. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
 12. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.
 13. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.
- 23 81 19.13.C. Delivery, Storage, and Handling
1. Unit shall be stored and handled per manufacturer's recommendations.
 2. Lifted by crane requires either shipping top panel or spreader bars.
 3. Unit shall only be stored or positioned in the upright position.
- 23 81 19.13.D. Project Conditions
1. As specified in the contract.
- 23 81 19.13.E. Project Conditions
1. As specified in the contract.
- 23 81 19.13.F. Operating Characteristics
1. Unit shall be capable of starting and running at 125°F (52°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 210/240 or 340/360 at ± 10% voltage.
 2. Compressor with standard controls shall be capable of operation from 30°F (-1°C), ambient outdoor temperatures. Accessory winter start kit is necessary if mechanically cooling at ambient temperatures below 30°F (-1°C).
 3. Unit shall be capable of simultaneous heating duty and defrost cycle operation when using accessory electric heaters.
 4. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.

5. Unit shall be factory configured for vertical supply & return configurations.
 6. Unit shall be field convertible from vertical to horizontal configuration
 7. Unit shall be capable of mixed operation: vertical supply with horizontal return or horizontal supply with vertical return.
- 23 81 19.13.G. Electrical Requirements
1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.
- 23 81 19.13.H. Unit Cabinet
1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a pre-painted baked enamel finish on all externally exposed surfaces.
 2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 inches minimum, gloss (per ASTM D523, 60°F): 60, Hardness: H-2H Pencil hardness.
 3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 210/240 or 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2-in. thick, 1 lb density, flexible fiberglass insulation, neoprene coated on the air side. Aluminum foil-faced fiberglass insulation shall be used in the heat compartment.
 4. Base of unit shall have a minimum of three locations for thru-the-base electrical connections (field installed), standard.
5. Base Rail
- a. Unit shall have base rails on a minimum of 2 sides.
 - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
 - c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
 - d. Base rail shall be a minimum of 16 gauge thickness.
6. Condensate pan and connections:
- a. Shall be a sloped condensate drain pan made of a non-corrosive material.
 - b. Shall comply with ASHRAE Standard 62.
 - c. Shall use a 3/4" -14 NPT drain connection, possible either through the bottom or end of the drain pan. Connection shall be made per manufacturer's recommendations.
7. Top panel:
- a. Shall be a single piece on all models.
8. Electrical Connections
- a. All unit power wiring shall enter unit cabinet at a single, factory-prepared, knockout location.
 - b. Thru-the-base capability
 - (1.) Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
 - (2.) Optional, factory-approved, water-tight connection method must be used for thru-the-base electrical connections.
 - (3.) No basepan penetration, other than those authorized by the manufacturer, is permitted.
9. Component access panels (standard)
- a. Cabinet panels shall be easily removable for servicing.
 - b. Unit shall have one factory installed, tool-less, removable, filter access panel.
 - c. Panels covering control box, indoor fan, indoor fan motor, and compressors shall have molded composite handles.
 - d. Handles shall be UV modified, composite. permanently attached, and recessed into the panel.
 - e. Screws on the vertical portion of all removable access panel shall engage into heat resistant, molded composite collars.
 - f. Collars shall be removable and easily replaceable using manufacturer recommended parts.
- 23 81 19.13.I. N/A
- 23 81 19.13.J. Coils
1. Standard Aluminum/Copper Coils: on all models.
 - a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
 - b. Evaporator coils shall be leak tested to 150 psig, pressure tested to 450 psig, and qualified to UL 1995 burst test at 1775 psig.
 - c. Condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to UL 1995 burst test at 1980 psig.
 2. Optional Pre-coated aluminum-fin condenser coils: on all models.
 - a. Shall have a durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments.
 - b. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.
 - c. Epoxy-phenolic barrier shall minimize galvanic action between dissimilar metals.
 3. Optional Copper-fin evaporator and condenser coils: on all models.
 - a. Shall be constructed of copper fins mechanically bonded to copper tubes and copper tube sheets.
 - b. Galvanized steel tube sheets shall not be acceptable.
 - c. A polymer strip shall prevent coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan.
 4. Optional E-coated aluminum-fin evaporator and condenser coils: on all models.

- a. Shall have a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins.
- b. Coating process shall ensure complete coil encapsulation of tubes, fins and headers.
- c. Color shall be high gloss black with gloss per ASTM D523-89.
- d. Uniform dry film thickness from 0.8 to 1.2 mil on all surface areas including fin edges.
- e. Superior hardness characteristics of 2H per ASTM D3363-92A and cross-hatch adhesion of 4B-5B per ASTM D3359-93.
- f. Impact resistance shall be up to 160 in.-lb (ASTM D2794-93).
- g. Humidity and water immersion resistance shall be up to minimum 1000 and 250 hours respectively (ASTM D2247-92 and ASTM D870-92).
- h. Corrosion durability shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117-90.

23 81 19.13.K. Refrigerant Components

1. Refrigerant circuit shall include the following control, safety, and maintenance features:
 - a. Thermostatic Expansion Valve (TXV) shall help provide optimum performance across the entire operating range. Shall contain removable power element to allow change out of power element and bulb without removing the valve body.
 - b. Refrigerant filter drier on each refrigerant circuit.
 - c. Service gauge connections on suction and discharge lines.
 - d. Pressure gauge access through a specially designed access port in the top panel of the unit.
 - e. Suction line accumulator to provide protection in all operating modes from cooling, heating and reverse cycle switching.
2. There shall be gauge line access port in the top of the rooftop, covered by a black, removable plug.
 - a. The plug shall be easy to remove and replace.
 - b. When the plug is removed, the gauge access port shall enable maintenance personnel to route their pressure gauge lines.
 - c. This gauge access port shall facilitate correct and accurate condenser pressure readings by enabling the reading with the compressor access panel on.
 - d. The plug shall be made of a leak proof, UV-resistant, composite material.
3. Compressors
 - a. Unit shall use one fully hermetic, scroll compressor for each independent refrigeration circuit.
 - b. Models shall be available with single compressor designs on 036-072 models, plus additional 2 compressor (stage) models from 090-120 sizes.
 - c. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
 - d. Compressors shall be internally protected from high discharge temperature conditions.
 - e. Compressors shall be protected from an over-temperature and over-amperage conditions by an internal, motor overload device.
 - f. Compressor shall be factory mounted on rubber grommets.
 - g. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
 - h. Crankcase heaters shall be utilized on all models to protect compressor with specific refrigerant charge.

23 81 19.13.L. Filter Section

1. Filters access is specified in the unit cabinet section of this specification.
2. Filters shall be held in place by a pivoting filter tray, facilitating easy removal and installation.
3. Shall consist of factory-installed, low velocity, throw-away 2-in. thick fiberglass filters.
4. Filters shall be standard, commercially available sizes.
5. Only one size filter per unit is allowed.

23 81 19.13.M. Evaporator Fan and Motor

1. Evaporator fan motor:
 - a. Shall have permanently lubricated bearings.
 - b. Shall have inherent automatic-reset thermal overload protection or circuit breaker.
 - c. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.
2. Electric Drive (Direct Drive) ECM – 5 Speed/Torque Evaporator Fan:
 - a. Multi speed motor with easy quick adjustment settings.
 - b. Blower fan shall be double-inlet type with forward-curved blades.
 - c. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.
 - d. Standard on all 036-060 models
3. Belt-driven Evaporator Fan:
 - a. Belt drive shall include an adjustable-pitch motor pulley.
 - b. Shall use sealed, permanently lubricated ball-bearing type.
 - c. Blower fan shall be double-inlet type with forward-curved blades.
 - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.
 - e. Standard on all 072 - 120 size models. Optional on all 036-060 3-phase models.

23 81 19.13.N. Condenser Fans and Motors

1. Condenser fan motors:
 - a. Shall be a totally enclosed motor.
 - b. Shall use permanently lubricated bearings.
 - c. Shall have inherent thermal overload protection with an automatic reset feature.
 - d. Shall use a shaft-down design on 036 to 102 models.
2. Condenser Fans:
 - a. Shall be a direct-driven propeller type fan.
 - b. Shall have aluminum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.

23 81 19.13.O. Special Features, Options (factory installed) and Accessories (field installed)

1. Integrated Economizers:
 - a. Integrated, gear-driven parallel modulating blade design type capable of simultaneous economizer and compressor operation.
 - b. Independent modules for vertical or horizontal return configurations shall be available. Vertical return modules shall be available as a factory installed option.
 - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
 - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
 - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
 - f. Shall be equipped with low-leakage dampers, not to exceed 2% leakage at 1 in. wg pressure differential.
 - g. Shall be capable of introducing up to 100% outdoor air.
 - h. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air.
 - i. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
 - j. Dry bulb outdoor-air temperature sensor shall be provided as standard. Outdoor air sensor setpoint shall be adjustable and shall range from 40 to 100°F / 4 to 38°C. Additional sensor options shall be available as accessories.
 - k. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
 - l. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy. A remote potentiometer may be used to override the damper setpoint.
 - m. Dampers shall be completely closed when the unit is in the unoccupied mode.
 - n. Economizer controller shall accept a 2-10Vdc CO₂ sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor-air damper to provide ventilation based on the sensor input.
 - o. Compressor lockout sensor shall open at 35°F (2°C) and closes at 50°F (10°C).
 - p. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
 - q. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
 - r. Economizer equipped with a mixed air sensor field mounted on the indoor fan blower side plate to control return air and outdoor air dampers to maintain 55°F (13°C) temperature.

2. Two-Position Motorized Damper

- a. Damper shall be a Two-Position Motorized Damper. Damper travel shall be from the full closed position to the field adjustable %-open setpoint.
- b. Damper shall include adjustable damper travel from 25% to 100% (full open).
- c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
- d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.
- e. Damper will admit up to 100% outdoor air for applicable rooftop units.
- f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
- g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
- h. Outside air hood shall include aluminum water entrainment filter

3. Manual damper

- a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 50% outdoor air for year round ventilation.

4. Head Pressure (low ambient operation) Control Package

- a. Controller shall control head pressure by condenser-fan speed modulation or condenser-fan cycling and wind baffles.
- b. Shall consist of solid-state control and condenser-coil temperature sensor to maintain condensing temperature between 90°F (32°C) and 110°F (43°C) at outdoor ambient temperatures down to -20°F (-29°C).

5. Condenser Coil Hail Guard Assembly

- a. Shall protect against damage from hail.
- b. Shall be louvered design.

6. Unit-Mounted, Non-Fused Disconnect Switch (80 amp max.):
 - a. Switch shall be factory-installed, internally mounted.
 - b. National Electric Code (NEC) and UL approved non-fused switch shall provide unit power shutoff.
 - c. Shall be accessible from outside the unit
 - d. Shall provide local shutdown and lockout capability.
7. Convenience Outlet:
 - a. Non-Powered convenience outlet.
 - (1.) Outlet shall be powered from a separate 115-120v power source.
 - (2.) A transformer shall not be included.
 - (3.) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
 - (4.) Outlet shall include 15 amp GFI receptacles.
 - (5.) Outlet shall be accessible from outside the unit.
8. Thru-the-Base Connectors:
 - a. Kits shall provide connectors to permit electrical connections to be brought to the unit through the unit basepan.
 - b. Minimum of three connection locations per unit.
9. Propeller Power Exhaust:
 - a. Power exhaust shall be used in conjunction with an integrated economizer.
 - b. Independent modules for vertical or horizontal return configurations shall be available.
 - c. Horizontal power exhaust shall be mounted in return ductwork.
 - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0-100% adjustable setpoint on the economizer control.
10. Roof Curbs (Vertical):
 - a. Full perimeter roof curb with exhaust capability providing separate air streams for energy recovery from the exhaust air without supply air contamination.
 - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
 - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
11. Medium and high Static Indoor Fan Motor(s) and Drive(s) (036-120):
 - a. Medium and high static motor(s) and drive(s) shall be factory-installed to provide additional performance range.
12. Thru-the-Bottom Utility Connectors:
 - a. Kit shall provide connectors to permit electrical connections to be brought to the unit through the basepan.
13. Outdoor Air Enthalpy Sensor:
 - a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
14. Return Air Enthalpy Sensor:
 - a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
15. Indoor Air Quality (CO₂) Sensor:
 - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
 - b. The IAQ sensor shall be available in duct mount. The setpoint shall have adjustment capability.
16. Smoke detectors (where applicable):
 - a. Shall be a Four-Wire Controller and Detector.
 - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
 - c. Shall use magnet-activated test/reset sensor switches.
 - d. Shall have tool-less connection terminal access.
 - e. Shall have a recessed momentary switch for testing and resetting the detector.
 - f. Controller shall include:
 - (1.) One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
 - (2.) Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
 - (3.) One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
 - (4.) Capable of direct connection to two individual detector modules.
 - (5.) Can be wired to up to 14 other duct smoke detectors for multiple fan shutdown applications.
17. Time Guard
 - a. Shall prevent compressor short cycling by providing a 5-minute delay (±2 minutes) before restarting a compressor after shutdown for any reason.
 - b. One device shall be required per compressor.

18. Electric Heat:

a. Heating Section

- (1.) Heater element open coil resistance wire, nickel-chrome alloy, 0.29 inches inside diameter, strung through ceramic insulators mounted on metal frame. Coil ends are staked and welded to terminal screw slots.
- (2.) Heater assemblies are provided with integral fusing for protection of internal heater circuits not exceeding 48 amps each. Auto reset thermo limit controls, magnetic heater contactors (24V coil) and terminal block all mounted in electric heater control box (minimum 18 ga galvanized steel) attached to end of heater assembly.

19. Hinged Access panels

- a. Shall provide easy access through integrated quarter turn latches.
- b. Shall be on major panels of filter, control box, fan motor and compressor.