

HIGH EFFICIENCY PACKAGE ELECTRIC COOLING, R-410A SINGLE PACKAGE ROOFTOP 3 – 12.5 TONS (1 & 3-Phase)

BUILT TO LAST, EASY TO INSTALL AND SERVICE

- One-piece, high efficiency electric cooling with a low profile, prewired, tested, and charged at the factory
- Field Convertible from vertical to horizontal airflow on all models. No special kit required on 036-120 models. Field accessory supply duct kit required for 150 size model only.
- Full perimeter base rail with built-in rigging adapters and fork truck slots
- Pre-painted exterior panels & primer-coated interior panels tested to 500 hours salt spray protection
- Fully insulated cabinet
- Single-stage cooling capacity control on 036-072 models, two-stage on 090-150 models
- Single scroll compressor on 036-072 models, dual scroll compressors on 090-150 models with internal line-break overload protection
- All units have high and low pressure switches
- Two inch disposable fiberglass type return air filters in dedicated rack with tool-less filter access door
- Refrigerant circuits contain a liquid line filter drier to trap dirt and moisture
- Indoor and outdoor coils constructed of aluminum fins mechanically bonded to seamless copper tubes
- Newly-designed indoor refrigerant header for easier maintenance and replacement
- Exclusive non-corrosive composite condensate pan in accordance with ASHRAE 62 Standard, sloping design; side or center drain
- Direct drive high efficiency ECM blower motors on 036-060 single phase models
- Belt drive evaporator-fan motor and pulley combinations available on all 3 phase models
- Access panels with easy grip handles provide quick and easy access to the blower and blower motor, control box, and compressor.
- "No-strip" screw system has superior holding power and guides screws into position while preventing the screw from stripping the unit's metal.
- Newly designed terminal board facilitates simple safety circuit troubleshooting and simplified control box arrangement
- Outdoor temperature cooling operation range up to 125°F (52°C) and down to 35°F (-2°C) using winter start kit
- TXV refrigerant metering devices on all models to precisely control refrigerant flow
- Large, laminated control wiring and power wiring drawings are affixed to unit to make troubleshooting easy
- Standard, medium and high static fan motor options available
- Provisions for thru-the-bottom power entry capability
- Single point electrical connections

WARRANTY

- 5 Year compressor limited warranty
- 1 Year parts limited warranty



RAH036-060



RAH072-120



Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to www.ahridirectory.org.



UNIT PERFORMANCE DATA - ONE STAGE COOLING

UNIT	Nom. Tons	COOLING			Unit Dimensions H x W x L in [mm]	Unit Weight lb. [kg]
		Net Cap. (Btuh)	SEER	EER		
RAH036*0XA0AAA	3	36,000	15.0	12.5	33-3/8 x 46-3/4 x 74-3/8 (847 x 1187 x 1888)	458 (208)
RAH048*0XA0AAA	4	48,500	15.6	13.0	41-3/8 x 46-3/4 x 74-3/8 (1051 x 1187 x 1888)	545 (207)
RAH060*0XA0AAA	5	57,500	15.2	12.5	41-3/8 x 46-3/4 x 74-3/8 (1051 x 1187 x 1888)	550 (249)
RAH072*0AA0AAA	6	73,000	N/A	12.2	41-1/4 x 59-1/2 x 88-1/8 (1048 x 1510 x 2238)	715 (324)

UNIT PERFORMANCE DATA - TWO STAGE COOLING

UNIT	Nom. Tons	COOLING			Unit Dimensions H x W x L in [mm]	Unit Weight lb. [kg]
		Net Cap. (Btuh)	Total Pwr (kW)	EER		
RAH090*0AA0AAA	7 1/2	89,000	7.3	12.2	49-3/8 x 59-1/2 x 88-1/8 (1253 x 1510 x 2238)	860 (390)
RAH102*0AA0AAA	8 1/2	97,000	8.0	12.2	49-3/8 x 59-1/2 x 88-1/8 (1253 x 1510 x 2238)	860 (390)
RAH110*0AA0AAA	10	111,000	9.3	12.0	49-3/8 x 59-1/2 x 88-1/8 (1253 x 1510 x 2238)	1025 (465)
RAH120*0AA0AAA	10	115,000	9.8	11.7	49-3/8 x 59-1/2 x 88-1/8 (1253 x 1510 x 2238)	1025 (465)
RAH150*0AA0AAA	12.5	146,000	11.8	12.4	57-3/8 x 63-3/8 x 115-7/8 (1456 x 1609 x 2942)	1360 (617)

* Indicates Unit voltage: K = 208/230-1-60, H = 208/230-3-60, L = 460-3-60, S = 575-3-60

TABLE OF CONTENTS

	PAGE		PAGE
MODEL NUMBER NOMENCLATURE	3	ELECTRICAL DATA FOR UNITS PRODUCED ON OR AFTER TO JULY 30, 2012	66
FACTORY OPTIONS AND/OR ACCESSORIES	4	ELECTRICAL INFO	67
AHRI COOLING RATING TABLE	11	ELECTRICAL HEAT	73
SOUND PERFORMANCE TABLE	12	UNIT WIRE/FUSE OR HACR BREAKER SIZE DATA .	90
PHYSICAL DATA	13	ELECTRICAL DATA FOR UNITS PRODUCED PRIOR TO JULY 30, 2012	105
CURBS & WEIGHTS DIMENSIONS	15	ELECTRICAL INFO	106
ACCESSORY WEIGHTS	28	ELECTRICAL HEAT	112
APPLICATION DATA	29	UNIT WIRE/FUSE OR HACR BREAKER SIZE DATA	126
COOLING TABLES	31	SEQUENCE OF OPERATION	136
STATIC PRESSURE ADDERS	47	HOT GAS REHEAT MODES	137
OUTDOOR AIR INTAKE & EXHAUST PERF	48	GUIDE SPECIFICATIONS	138
FAN PERFORMANCE	49		

3 to 12.5 TON ROOFTOP UNIT FIOP CODES (Use with Model Nomenclature on next page)			
OPTION	DESCRIPTION	NOMENCLATURE	
		CODE	OPTIONS
2	Non-Fused Disconnect Switch	0A	None
4	Easy Access Hinged Panels	4B	2
5	Unpowered Convenience Outlet	AT	5
9	Supply Air Smoke Detector	BR	9
		7C	2, 5
		7K	2,5,9
		BA	5, 9
		8A	2, 9
		AA	4
		6C	2, 4
		6D	2, 4, 5
		6L	2, 4, 5, 9
		7B	2, 4, 9
		AB	4, 5
		AJ	4, 5, 9
		CH	4, 9

MODEL NOMENCLATURE

MODEL SERIES	R	A	H	0	9	0	H	0	A	A	0	A	A	A
Position Number	1	2	3	4	5	6	7	8	9	10	11	12	13	14
R = Rooftop														
A = Air Conditioning (Cooling Only)	Type													
H = High Efficiency	Efficiency													
036 = 3 Tons														
048 = 4 Tons														
060 = 5 Tons														
072 = 6 Tons														
090 = 7.5 Tons (Dual Compressor)														
102 = 8.5 Tons (Dual Compressor)	120 = 10 Tons (Dual Compressor) 11.7 EER													
110 = 10 Tons (Dual Compressor) 12 EER	150 = 12.5 Tons (Dual Compressor)													
	Nominal Cooling Capacity													
K = 208/230-1-60														
H = 208/230-3-60														
L = 460-3-60														
S = 575-3-60	Voltage													
0 = No Heat	Heating Capacity (See spec sheet for actual capacity)													
X = Direct drive ECM motor (3-5 Ton All voltages 1 & 3 phase)														
A = Standard Static Option - (Belt Drive) 6-12.5 Ton with 1 speed IFM, 3 phase only														
C = Medium Static Option (Belt Drive) (3-12.5 Ton with 1 speed IFM, 3 phase only)														
B = High Static Option (Belt Drive) (3-10 Ton with 1 speed IFM, 3 phase only)														
E = High Static High Efficiency Option (Belt Drive) (12.5 Ton with 1 speed IFM)														
G = High Static Motor / Drive with Hot Gas Re-heat (12.5 Ton with 1 speed IFM)														
H = High Static Motor / Drive with Hot Gas Re-heat (3-10 Ton with 1 speed IFM, 7.5 to 12.5 ton with 2 speed IFM)	Motor Option													
A = None														
B = Economizer w/Bara-relief, OA Temp sensor														
E = Economizer w/Bara-relief + CO2 Sensor, OA Temp sensor														
H = Economizer w/Bara-relief, enthalpy sensor														
L = Economizer w/Bara-relief + CO2 Sensor, enthalpy sensor														
P = 2-Position damper w/Baro-relief														
U = Temp Ultra Low Leak Economizer w/Baro-relief (with 2 speed IFM only)														
W = Enthalpy Ultra Low Leak Economizer w/Baro-relief (with 2 speed IFM only)	Outdoor Air Options / Control (See spec sheet for details)													
0A = No Options														
4B = Non-Fused Disconnect														
AT = Non-powered 115v C.O.														
BR = Supply Air Smoke Detector														
AA = Easy Access Hinged Panels	Factory Installed Options													
A = Aluminum / Copper Cond & Alum/Copper Evap Coil														
B = Pre-coat Alum/Copper Cond & Alum / Copper Evap														
C = E-Coated Alum/Copper Cond & Alum / Copper Evap														
D = E-Coated Alum / Copper Cond & E-Coated Alum/Copper Evap														
E = Copper/Copper Cond & Alum/Copper Evap														
F = Copper/Copper Cond & Copper/Copper Evap	Condenser / Evaporator Coil Configuration													
A = Standard Motor														
T = 2-Speed Indoor Fan VFD Controller (For 2-stage units only)	Motor Type Option													

Table 1 – FACTORY INSTALLED OPTIONS AND FIELD INSTALLED ACCESSORIES

CATEGORY	ITEM	FACTORY INSTALLED OPTION	FIELD INSTALLED ACCESSORY
Cabinet	Thru-the-base electrical	X	X
	Hinged Access Panels	X	
	Supply Duct Cover (12.5 ton only)		X
Coil Options	Copper/Copper indoor and/or outdoor coils	X	
	Pre-coated outdoor coils	X	
	Premium, E-coated outdoor coils	X	
Humidity Control	Hot Gas Reheat	X	
Condenser Protection	Condenser coil hail guard (louvered design)	X	X
Controls	Smoke detector (supply air)	X	
	Time Guard II compressor delay control circuit		X
	Phase Monitor		X
	Temperature sensors		X
Economizers & Outdoor Air Dampers	Economizer IV (for electro-mechanical controlled RTUs)	X	X
	Motorized 2 position outdoor-air damper	X	X
	Manual outdoor-air damper		X
	Barometric relief ¹	X	X
	Power exhaust		X
	Ultra Low Leak Economizer X (for 2-Speed Indoor Fan Motor System only 090 to 150 sizes with 2 stages of cooling), vertical supply and return air only.	X	X
Economizer Sensors & IAQ Devices	Single dry bulb temperature sensors ²	X	X
	Single enthalpy sensors ²	X	X
	Differential enthalpy sensors ²		X
	CO ₂ sensor (wall, duct, or unit mounted) ²		X
Indoor Motor & Drive	Multiple motor and drive packages	X	
	2-Speed Indoor Fan Motor System w/VFD controller	X	
Electric Heat	Electric Resistance Heaters		X
	Single Point Kit		X
Low Ambient Control	Winter start kit ³		X
	Head pressure controller ³		X
Power Options	Convenience outlet (unpowered)	X	
	Non-fused disconnect ⁴	X	
Roof Curbs	Roof curb 14" (356mm)		X
	Roof curb 24" (610mm)		X

NOTES:

1. Included with economizer.
2. Sensors used to optimize economizer performance.
3. See application data for assistance.
4. Available on units with MOCP's of 80 amps or less
5. All FIOP's are 3 phase only

FACTORY OPTIONS AND/OR ACCESSORIES

Economizer (dry–bulb or enthalpy)

Economizers save money. They bring in fresh, outside air for ventilation; and provide cool, outside air to cool your building. This is the preferred method of low ambient cooling. When coupled to CO₂ sensors, Economizers can provide even more savings by coupling the ventilation air to only that amount required.

Economizers are available, installed and tested by the factory, with either enthalpy or dry–bulb temperature inputs. There are also models for electromechanical as well as direct digital controllers. Additional sensors are available as accessories to optimize the economizers.

Economizers include gravity controlled, barometric relief which equalizes building pressure and ambient air pressures. This can be a cost effective solution to prevent building pressurization.

CO₂ Sensor

Improves productivity and saves money by working with the economizer to intake only the correct amount of outside air for ventilation. As occupants fill your building, the CO₂ sensor detects their presence through increasing CO₂ levels, and opens the economizer appropriately.

When the occupants leave, the CO₂ levels decrease, and the sensor appropriately closes the economizer. This intelligent control of the ventilation air, called Demand Control Ventilation (DCV) reduces the overall load on the rooftop, saving money. CO₂ sensors are available with the economizer, installed and tested by the factory.

Smoke Detectors

Smoke detectors immediately shut down the rooftop unit when smoke is detected. Supply air smoke detectors are available, installed by the factory.

Louvered Hail Guards

Sleek, accessory louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact.

Convenience Outlet (un–powered)

Lower service bills by including a convenience outlet in your specification. Provides a convenient, 15 amp, 115v GFCI receptacle.

Non–fused Disconnect

This OSHA–compliant, factory–installed, safety switch allows a service technician to locally secure power to the rooftop.

Barometric Relief

Gravity controlled, barometric relief equalizes building pressure and ambient air pressures. This can be a cost effective solution to prevent building pressurization.

Power Exhaust

Superior internal building pressure control. This field–installed accessory may eliminate the need for costly, external pressure control fans.

Time Guard II Control Circuit

This accessory protects your compressor by preventing short–cycling in the event of some other failure, prevents the compressor from restarting for 30 seconds after stopping. Not required with authorized commercial thermostats.

Motorized 2–Position Damper

A 2–position, motorized outdoor air damper is available as a field installed accessory and admits up to 100% outside air. Using reliable, gear–driven technology, the 2–position damper opens to allow ventilation air and closes when the rooftop stops, stopping unwanted infiltration.

Manual OA Damper

Accessory manual outdoor air dampers are an economical way to bring in ventilation air.

2–Speed Indoor Fan Speed Motor System

The 2–Speed Indoor Fan Motor System saves energy and installation time by utilizing a Variable Frequency Drive (VFD) to automatically adjust the indoor fan motor speed in sequence with the units cooling operation. Per ASHRAE 90.1 2010 standard section 6.4.3.10.b, during the first stage of cooling operation the VFD will adjust the fan motor to provide 2/3rd of the total cfm established for the unit. When a call for the second stage of cooling is required, the VFD will allow the total cfm for the unit established (100%). During the heating mode the VFD will allow total design cfm (100%) operation and during the ventilation mode the VFD will allow operation to 2/3rd of total cfm.

Compared to 1–speed indoor fan motor systems, the 2–Speed Indoor Fan Motor System can save substantial energy, 25%+/-, versus 1–speed indoor fan motor systems.

The VFD used in the 2–Speed Indoor Fan Motor System has soft start capabilities to slowly ramp up the speeds, thus eliminating any high inrush air volume during initial start–up. It also has internal over–current protection for the fan motor and a field installed display kit that allows adjustment and in depth diagnostics of the VFD.

This 2–Speed Indoor Fan Motor System is available on models with 2–stage cooling operation with electromechanical or RTU Open, Multi Protocol controls. Both space sensor and conventional thermostats/controls can be used to provide accurate control in any application.

The 2–Speed Indoor Fan Motor System is very flexible for initial fan performance set up and adjustment. The standard factory shipped VFD is pre–programmed to automatically stage the fan speed between the first and second stage of cooling. The unit fan performance static pressure and cfm can be easily adjusted using the traditional means of pulley adjustments. The other means to adjust the unit static and cfm performance is to utilize the field installed Display Kit and adjust the frequency and voltage in the VFD to performance requirements. In either case, once set up, the VFD will automatically adjust the speed between the cooling stage operations.

Optional Hot Gas Reheat System

The Hot Gas Reheat System is an all–inclusive factory–installed option that can be ordered with any 3 phase RAH unit.

This system expands the envelope of operation of our rooftop products to provide unprecedented flexibility to meet year–round comfort conditions.

The Hot Gas Reheat System has the industry's only dual dehumidification mode setting. The Hot Gas Reheat System includes two new modes of operation.

The RAH rooftop coupled with the Hot Gas Reheat system is capable of operating in normal design cooling mode, subcooling mode, and hot gas reheat mode. Normal design cooling mode is when the unit will operate under its normal sequence of

operation by cycling compressors to maintain comfort conditions.

Subcooling mode will operate to satisfy part load type conditions when the space requires combined sensible and a higher proportion of latent load control. Hot Gas Reheat mode will operate when outdoor temperatures diminish and the need for latent capacity is required for sole humidity control. Hot Gas Reheat mode will provide neutral air for maximum dehumidification operation.

Head Pressure Controller

The motor controller is a low ambient, head pressure controller kit that is designed to maintain the unit's condenser head pressure during periods of low ambient cooling operation. This device should be used as an alternative to economizer free cooling not when economizer usage is either not appropriate or desired. The controller will either cycle the outdoor-fan motors or operate them at reduced speed to maintain the unit operation, depending on the model.

Hinged Access Panels

Allows access to unit's major components with specifically designed hinged access panels. Panels are: filters, control box, fan motor and compressor.

Winter Start Kit

The accessory winter start kit extends the low ambient limit of your rooftop to 25°F (-4°C). The kit bypasses the low pressure switch, preventing nuisance tripping of the low pressure switch. Other low ambient precautions may still be prudent.

Alternate Motors and Drives

Some applications need larger horsepower motors, some need more airflow, and some need both. Regardless of the case, your unit has a factory installed combination to meet your application. A wide selection of motors and pulleys (drives) are available, factory installed, to handle nearly any application.

Thru-the-Base Connections

Thru-the-base connections, available as an accessory, are necessary to ensure proper connection and seal when routing wire and piping through the rooftop's basepan and curb. These couplings eliminate roof penetration and should be considered for main power lines, as well as control power.

Electric Heaters

RAS units offer a full-line of accessory heaters. The heaters are very easy to use / install and are pre-engineered and certified.

Supply Duct Cover

This supply duct cover is required when field converting the factory standard vertical duct supply to horizontal duct supply configuration. One required per unit. (180 size only)

ACCESSORIES – RAH036–150

ECONOMIZERS		
Model Number	Description	Use With Model Size
DNECOMZR020A02	Vertical Economizer IV with solid–state controller, gear–driven, 3–position modulating damper, spring return actuator, up to 100% barometric relief, supply and outdoor air sensors, and CO2 sensor compatible.	036 – 060
DNECOMZR021A03	Vertical Economizer IV with solid–state controller, gear–driven, 3–position modulating damper, spring return actuator, up to 100% barometric relief, supply and outdoor air sensors, and CO2 sensor compatible.	072 – 120
DNECOMZR062A00	Vertical Economizer IV with solid–state controller, gear–driven, 3–position modulating damper, spring return actuator, up to 100% barometric relief, supply and outdoor air sensors, and CO2 sensor compatible.	150
CRECOMZR069A00 ^{1,2}	Ultra Low Leak Vertical ³ Economizer X with solid–state W7220 controller, gear–driven, modulating damper, spring return actuator, up to 100% barometric relief, supply and outdoor air sensors, and CO2 sensor compatible, for use in electro mechanical controls only.	090 – 120
CRECOMZR071A00 ^{1,2}	Ultra Low Leak Vertical ³ Economizer X with solid–state W7220 controller, gear–driven, modulating damper, spring return actuator, up to 100% barometric relief, supply and outdoor air sensors, and CO2 sensor compatible, for use in electro mechanical controls only.	150
DNECOMZR024A02	Horizontal Economizer IV with solid–state controller, gear–driven, 3–position modulating damper, spring return actuator, up to 100% barometric relief, supply and outdoor air sensors, and CO2 sensor compatible.	036 – 060
DNECOMZR025A02	Horizontal Economizer IV with solid–state controller, gear–driven, 3–position modulating damper, spring return actuator, up to 100% barometric relief, supply and outdoor air sensors, and CO2 sensor compatible.	072 – 120
DNECOMZR064A00	Horizontal Economizer IV with solid–state controller, gear–driven, 3–position modulating damper, spring return actuator, up to 100% barometric relief, supply and outdoor air sensors, and CO2 sensor compatible.	150
¹ Economizer X cannot be installed with Economizer IV, manual damper, or motorized damper. ² Can only be used on electrical mechanical units with 2–stage cooling and 2–speed fan control. ³ Economizer X is currently only available on vertical air flow configuration models.		
ECONOMIZER SENSORS		
Model Number	Description	Use With Model Size
DNTEMPSN002A00	Outdoor or Return Dry Bulb Temperature Sensor used with Electro–Mechanical control.	Economizer IV
DNCBDIOX005A00	CO ₂ Sensor for use in return airstream. Also includes Aspirator Box required for Duct Mounting.	Economizer IV & X
DNENTDIF004A00	Return Air Enthalpy Sensor used with Electro–Mechanical controls, use with AXB078ENT for differential enthalpy control.	Economizer IV
AXB078ENT	Accusensor II Economizer Differential Enthalpy Control Upgrade	Economizer IV
CRTEMPSN005A00	Outdoor or return dry bulb temperature sensor used with Honeywell W7220 electro–mechanical control.	Economizer X
HH57AC081	Enthalpy control for W7220 controller only. (One required for single enthalpy, two required for differential enthalpy)	Economizer X
NOTE: Supply air temperature sensor (SAT and low ambient lockout switch) provided with economizer IV or economizer X.		

ACCESSORIES – RAH036–150 (cont.)

POWER EXHAUST *		
Model Number	Description	Use With Model Size
DNPWREXH030A01	Vertical Power Exhaust 208/230 volt (1 or 3 Phase)	036 – 060
DNPWREXH021A01	Vertical Power Exhaust 460 volt	036 – 060
DNPWREXH022A01	Vertical Power Exhaust 208/230 volt	072 – 120
DNPWREXH023A01	Vertical Power Exhaust 460 volt	072 – 120
DNPWREXH080A00	Vertical Power Exhaust 208/230 volt	150
DNPWREXH081A00	Vertical Power Exhaust 460 volt	150
DNPWREXH028A01	Horizontal Power Exhaust 208/230 (1 or 3 Phase) & 575 volt	036 – 120
DNPWREXH029A01	Horizontal Power Exhaust 460 volt	036 – 120
DNPWREXH082A00	Horizontal Power Exhaust 208/230 & 575 volt	150
DNPWREXH083A00	Horizontal Power Exhaust 460 volt	150

* Vertical Power Exhaust requires a vertical economizer. Horizontal Power Exhaust should be duct-mounted in the return duct. Horizontal power exhaust includes exhaust hood, screens, and propeller fan system.

575V TRANSFORMER		
Model Number	Description	Use With Model Size
1171494 ²	Transformer for conversion from 575v to 208/230v power exhaust applications.	036 – 150

MANUAL OUTDOOR AIR DAMPERS		
Model Number	Description	Use With Model Size
CRMANDPR001A03	25% Open Manual Fresh Air Damper	036 – 060
CRMANDPR001A02	50% Open Manual Fresh Air Damper	036 – 060
CRMANDPR002A03	25% Open Manual Fresh Air Damper	072 – 120
CRMANDPR002A02	50% Open Manual Fresh Air Damper	072 – 120
CRMANDPR011A00	50% Open Manual Fresh Air Damper	150

MOTORIZED OUTDOOR AIR DAMPERS		
Model Number	Description	Use With Model Size
CRTWOPOS010A00	Motorized 2 position outdoor air damper (25–100% Outdoor Air)	036 – 060
CRTWOPOS011A00		072 – 120
CRTWOPOS014A00		150

LOUVERED HAIL GUARDS – CONDENSER COIL		
Model Number	Description	Use With Model Size
CRLVHLGD012A00	Louvered Condenser Coil Hail Guard	036
CRLVHLGD013A00	Louvered Condenser Coil Hail Guard	048 – 060
CRLVHLGD014A00	Louvered Condenser Coil Hail Guard	072
CRLVHLGD016A00	Louvered Condenser Coil Hail Guard	090 – 120
CRLVHLGD032A00	Louvered Condenser Coil Hail Guard	150

FLAT ROOF CURBS		
Model Number	Description	Use With Model Size
CRRFCURB001A01	14" High Roof Curb. Ductwork attaches to the roof curb. Includes thru-the-bottom capability.	036 – 060
CRRFCURB003A01		072 – 120
CRRFCURB074A00		150
CRRFCURB002A01	24" High Roof Curb. Ductwork attaches to the roof curb. Includes thru-the-bottom capability.	036 – 060
CRRFCURB004A01		072 – 120
CRRFCURB075A00		150

SPECIAL – 150 SIZE SPECIFIC ACCESSORIES		
Model Number	Description	Use With Model Size
CRDISBKT001A00	Disconnect Switch Bracket – Provides a pre engineered and sized mounting bracket for applications requiring a unit mounted fused disconnect of greater than 100 amps. Bracket assures that no damage will occur to coils when mounting with screws and other fasteners.	150
CRDUCTCV002A00	Supply Duct Cover – This supply duct cover is required when field converting the factory standard vertical duct supply to horizontal duct supply configuration. One required per unit.	150

ACCESSORIES – RAH036–150 (cont.)

THROUGH-THE-BOTTOM/CURB POWER CONNECTION		
Model Number	Description	Use With Model Size
CRBTMPWR001A01	Thru-the-bottom electrical connections and thru-the-curb gas connections. Includes a 3/4-inch diameter liquid tight conduit fitting for high voltage power wires	036 – 060
CRBTMPWR002A01	Thru-the-bottom electrical connections and thru-the-curb gas connections. Includes a 1-1/4-inch diameter liquid tight conduit fitting for high voltage power wires	072 – 120
CRBTMPWR003A01	Thru-the-bottom power, control, and gas connections. Includes a 3/4-inch diameter liquid tight conduit fitting for high voltage power wires	036 – 060
CRBTMPWR004A01	Thru-the-bottom power, control, and gas connections. Includes a 1-1/4-inch diameter liquid tight conduit fitting for high voltage power wires	072 – 120
CRBTMPWR005A01	Thru-the-bottom power, control, and gas connections. Includes a 1-1/4 inch diameter liquid tight conduit fitting for high voltage power wires	150
CRBTMPWR006A00	Thru-the-bottom power, control, and gas connections. Includes a 1-1/2 inch diameter liquid tight conduit fitting for high voltage power wires	
CRBTMPWR007A00	Thru-the-bottom power, control, and gas connections. Includes a 2 inch diameter liquid tight conduit fitting for high voltage power wires	

CONTROL UPGRADE KITS		
Model Number	Description	Use With Model Size
CRDISKIT001A00	2-Speed VFD display kit provides the field capability to set up points and troubleshooting codes on the VFD controller. Can be used for any associated unit with VFD.	All 2-Speed VFD Controllers
NRTIMEGD001A00	Time Guard II	036 – 150
CRSDTEST001A00	Remote keyed attenuator / test / reset station	036 – 150
DNWINSTR001A00	Electronic phase monitor breaks "R" control signal if trouble is detected. (Allows operation down to 25°F from standard 40°F.)	036 – 150
CRPHASE3001A02	Phase Monitor Control	036 – 150 (3 Phase 208/230v & 460v)
CRPHASE3002A00	Phase Monitor Control	036 – 150 (575v only)
CRSTATUS001A00	Fan/Filter Status Switch – Indicator light not included	036 – 150

ACCESSORY KITS FOR UNITS WITH HINGED ACCESS PANELS		
Model Number	Description	Use With Model Size
CRPECONV003A00	Vertical accessory kit used with installing a vertical economizer on a unit that has hinged access panels. Includes angle and seal strip	036–072
CRPECONV004A00	Vertical accessory kit used with installing a vertical economizer on a unit that has hinged access panels. Includes angle and seal strip	090–150
CRPECONV007A00	Vertical & Horizontal accessory kit used with installing a 2-position damper or vertical & horizontal economizer on a unit that has hinged access panels. Includes angle and seal strip	170
CRHNGPNL001A00	Horizontal accessory kit used with installing a vertical economizer on a unit that has hinged access panels. Includes angle and seal strip	036–072
CRHNGPNL002A00	Horizontal accessory kit used with installing a vertical economizer on a unit that has hinged access panels. Includes angle and seal strip	090–150
CRHNGPNL007A00	Vertical & Horizontal accessory kit used with installing a 2-position damper or vertical & horizontal economizer on a unit that has hinged access panels. Includes angle and seal strip	150

ACCESSORIES – RAH036–150 (cont.)

LOW AMBIENT CONTROLS *		
Model Number	Description	Use With Model Size
32LT900301 ¹	Motormaster I –20°F (–29°C) Low Ambient Control	036 – 102, 208/230–1–60, 208/203–3–60, 575–3–60
32LT900611 ¹	Motormaster I –20°F (–29°C) Low Ambient Control	048 – 102, 460–3–60
CPLOWAMB001A00	Motormaster® II –0°F (–18°C) Low Ambient Control (One DNWINSTR00AA00 required per refrigerant circuit)	036 – 150, 208/230–1–60, 208/230–3–60, 460–3–60
1178185 ²	Motormaster I Compatible Condenser Fan Motor	036, 208/230–3–60, 575–3–60
1171974 ²	Motormaster I Compatible Condenser Fan Motor	048 – 102, 208/230–3–60, 575–3–60
1171975 ²	Motormaster I Compatible Condenser Fan Motor	048 – 102, 460–3–60
CRLOWAMB030A00 ³	Motormaster®V Low Ambient Control Mechanical cooling operation down to –20°F (–29°C)	120, 208/230–3–60
CRLOWAMB031A00 ³		120, 460–3–60
CRLOWAMB032A00 ³		120, 575–3–60
CRLOWAMB039A00	Motormaster I Low Ambient Kit. Mechanical cooling operation down to –20° F (– 29° C). Kit includes 3 motors, MotorMaster controller, wiring label, and required wire ties and connectors, DNWINSTR001A00 also required (one per refrigerant circuit)	150, 208/230–3–60
CRLOWAMB040A00	Motormaster I Low Ambient Kit. Mechanical cooling operation down to –20° F (– 29° C). Kit includes 3 motors, MotorMaster controller, wiring label, and required wire ties and connectors) 575 Volt models also require CRTRXKIT002A00 plus DNWINSTR001A00 also required (one per refrigerant circuit)	150, 460–3–60
CRTRXKIT001A00	Motormaster I Low Ambient Control – Transformer Kit. Must be used in conjunction with Low Ambient Controller if used on 575–3–60 volt models.	150, 575–3–60

*See usage tables in kit instructions.

¹ Requires motor change out.

² Available from FAST Parts.

Note: Sizes 036–060 requires (1) low ambient controller and (1) compatible condenser fan motor for change out

Sizes 072–102 requires (1) low ambient controller and (2) compatible condenser fan motors for change out

³ No motor change is required on these specific models. Requires two DNWINSTR001A00 Winter Start kits (one per circuit).

Table 2 – AHRI COOLING RATING TABLE – 1 Stage

UNIT RAH	COOLING STAGES	NOM. CAPACITY (TONS)	NET COOLING CAPACITY (MBH)	TOTAL POWER (kW)	SEER	EER	IEER
036	1	3	36.0	2.9	15.00	12.50	N/A
048	1	4	48.5	3.7	15.60	13.00	N/A
060	1	5	57.5	4.6	15.20	12.45	N/A
072	1	6	73.0	6.0	N/A	12.20	13.20

Table 3 – AhRI COOLING RATING TABLE – 2 Stage

UNIT RAH	COOLING STAGES	NOM. CAPACITY (TONS)	NET COOLING CAPACITY (MBH)	TOTAL POWER (kW)	EER	IEER WITH 1-SPEED IFM	IEER WITH 2-SPEED IFM
090	2	7.5	89.0	7.3	12.2	13.2	14.0
102	2	8.5	97.0	8.0	12.2	13.2	14.0
110	2	10	111.0	9.3	12.0	12.6	14.5
120	2	10	115.0	9.8	11.7	12.2	12.6
150	2	12.5	146.0	11.8	12.4	13.2	14.1

LEGEND

- AHRI – Air Conditioning, Heating and Refrigeration Institute Test Standard
- ASHRAE – American Society of Heating, Refrigerating and Air Conditioning, Inc.
- EER – Energy Efficiency Ratio
- IEER – Integrated Energy Efficiency Ratio
- SEER – Seasonal Energy Efficiency Ratio

NOTES:

1. Rated and certified under AHRI Standard 210/240-06 or 340/360-04, as appropriate.
2. Ratings are based on:
Cooling Standard: 80°F (27°C) db, 67°F (19°C) wb indoor air temp and 95°F (35°C) db outdoor air temp.
IEER Standard: A measure that expresses cooling part-load EER efficiency for commercial unitary air-conditioning and heat pump equipment on the basis of weighted operation at various load capacities.
3. All RAH units comply with ASHRAE 90.1 2001, 2004 Energy Standard for minimum SEER and EER requirements.
4. RAH units comply with US Energy Policy Act (2005). To evaluate code compliance requirements, refer to state and local codes.



Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to www.ahridirectory.org.



As an Energy Star® Partner, International Comfort Products has determined that this product meets the ENERGY STAR® guidelines for energy efficiency.



Table 4 – MINIMUM – MAXIMUM AIRFLOWS ELECTRIC HEAT

UNIT RAH	COOLING				ELECTRIC HEATERS	
	Minimum Single Speed Fan Motor	Minimum 2–speed Fan Motor (at high speed)	Minimum 2–speed Fan Motor (at low speed)	Maximum	Minimum	Maximum
036	900	–	–	1500	900	1500
048	1200	–	–	2000	1200	2000
060	1500	–	–	2500	1500	2500
072	1800	–	–	3000	1800	3000
090	2250	2535	1673	3750	2250	3750
102	2550	2550	1683	4250	2250	4250
110	3000	3380	2231	5000	3000	5000
120	3000	3380	2231	5000	3000	5000
150	3750	4225	2789	6250	3750	6250

– Not available

Table 5 – SOUND PERFORMANCE TABLE

UNIT RAH	COOLING STAGES	OUTDOOR SOUND (dB) AT 60								
		A-WEIGHTED	63	125	250	500	1000	2000	4000	8000
036	1	76	78.2	78.0	74.2	73.3	70.6	66.0	62.4	56.9
048	1	78	84.7	83.6	77.1	74.6	72.3	68.3	64.7	60.9
060	1	77	87.5	82.5	76.1	73.6	71.3	67.1	64.1	60.0
072	1	82	90.1	82.6	81.0	79.4	77.0	73.0	70.4	66.7
090	2	82	90.6	84.3	80.2	79.3	77.1	72.2	67.4	63.7
102	2	82	88.6	85.0	81.6	79.5	77.4	74.1	71.0	66.3
110	2	87	85.9	87.9	85.6	84.4	82.8	78.5	74.9	72.5
120	2	87	85.9	87.9	85.6	84.4	82.8	78.5	74.9	72.5
150	2	83	89.3	86.0	82.9	80.7	78.5	73.6	69.6	64.5

LEGEND

dB – Decibel

NOTES:

1. Outdoor sound data is measure in accordance with AHRI standard 270–95.
2. Measurements are expressed in terms of sound power. Do not compare these values to sound pressure values because sound pressure depends on specific environmental factors which normally do not match individual applications. Sound power values are independent of the environment and therefore more accurate.
3. A-weighted sound ratings filter out very high and very low frequencies, to better approximate the response of “average” human ear. A-weighted measurements are taken in accordance with AHRI standard 270–95.

Table 6 – PHYSICAL DATA (COOLING) 3 – 6 TONS

RAH		036	048	060	072
Refrigeration System					
# Circuits / # Comp. / Type		1 / 1 / Scroll	1 / 1 / Scroll	1 / 1 / Scroll	1 / 1 / Scroll
R-410A refrigerant charge (lbs-oz)		9 – 0	12 – 8	13 – 3	14 – 0
Hot Gas Reheat- refrigerant R-410A charge (lbs-oz)		11 – 0	19 – 12	20 – 0	22 – 8
Metering Device		TXV	TXV	TXV	TXV
High-press. Trip / Reset (psig)		630 / 505	630 / 505	630 / 505	630 / 505
Low-press. Trip / Reset (psig)		54 / 117	54 / 117	54 / 117	54 / 117
Compressor Capacity Staging (%)		100%	100%	100%	100%
Evaporator Coil					
Material (Tube Fin)		Cu / Al	Cu / Al	Cu / Al	Cu / Al
Coil type		3/8-in RTPF	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF
Rows / FPI		3 / 15	3 / 15	4 / 15	3 / 15
Total Face Area (ft ²)		5.5	7.3	7.3	8.9
Condensate Drain Conn. Size		3/4-in	3/4-in	3/4-in	3/4-in
Hot Gas Reheat Coil					
Material (Tube Fin)		Cu / Al	Cu / Al	Cu / Al	Cu / Al
Coil type		3/8-in RTPF	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF
Rows / FPI		1 / 17	2 / 17	2 / 17	2 / 17
Total Face Area (ft ²)		3.9	5.2	5.2	5.2
Evaporator Fan and Motor					
Standard Static 1 phase	Motor Qty / Drive Type	1 / Direct	1 / Direct	1 / Direct	–
	Max BHP	1.0	1.0	1.0	–
	RPM Range	600–1200	600–1200	600–1200	–
	Motor Frame Size	48	48	48	–
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	–
	Fan Diameter (in)	10 x 10	10 x 10	10 x 10	–
Standard Static 3 phase	Motor Qty / Drive Type	–	–	–	1 / Belt
	Max BHP	–	–	–	1.7
	RPM Range	–	–	–	489–747
	Motor Frame Size	–	–	–	56
	Fan Qty / Type	–	–	–	1 / Centrifugal
	Fan Diameter (in)	–	–	–	15 x 15
Medium Static 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	1.2	1.7	2.4	2.9
	RPM Range	770–1175	920–1303	1035–1466	733–949
	Motor Frame Size	48	56	56	56
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	10 x 10	10 x 10	10 x 10	15 x 15
High Static 3 phase	Motor Qty / Drive Type	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	2.4	2.9	2.9	4.7
	RPM Range	1035–1466	1208–1639	1303–1687	909–1102
	Motor Frame Size	56	56	56	14
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	10 x 10	10 x 10	10 x 10	15 x 15
Cond. Coil					
Material (Tube/Fin)		Cu / Al	Cu / Al	Cu / Al	Cu / Al
Coil type		3/8-in RTPF	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF
Rows / FPI		2 / 17	2 / 17	2 / 17	2 / 17
Total Face Area (ft ²)		12.7	21.3	21.3	20.5
Cond. fan / motor					
Qty / Motor Drive Type		1/ Direct	1/ Direct	1/ Direct	2/ Direct
Motor HP / RPM		1/8 / 825	1/4 / 1100	1/4 / 1100	1/4 / 1100
Fan diameter (in)		22	22	22	22
Filters					
RA Filter # / Size (in)		2 / 16 x 25 x 2	4 / 16 x 16 x 2	4 / 16 x 16 x 2	4 / 16 x 20 x 2
OA inlet screen # / Size (in)		1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 20 x 36 x 1



– Not applicable




Table 7 – PHYSICAL DATA (COOLING) 7.5 – 12.5 TONS

RAH		090	102	110	120	150
Refrigeration System						
# Circuits / # Comp. / Type		2 / 2 / Scroll	2 / 2 / Scroll	2 / 2 / Scroll	2 / 2 / Scroll	2 / 2 / Scroll
Refrig R-410A charge A/B (lbs-oz)		9 – 10 / 9 – 10	9 – 14 / 9 – 14	12 – 10 / 13 – 0	12 – 11 / 12 – 5	16 – 7 / 15 – 5
Hot Gas Reheat Refrig R-410A A/B (lbs-oz)		17-0 / 17-0	15-2 / 15-0	-	18-3 / 17-3	25-8 / 22-8
Metering device		TXV	TXV	TXV	TXV	TXV
High-pess. Trip / Reset (psig)		630 / 505	630 / 505	630 / 505	630 / 505	630 / 505
Low-pess. Trip / Reset (psig)		54 / 117	54 / 117	27 / 44	54 / 117	54 / 117
Compressor Capacity Staging (%)		50% / 100%	50% / 100%	50% / 100%	50% / 100%	50% / 100%
Evaporator Coil						
Material (Tube/Fin)		Cu / Al	Cu / Al	Cu / Al	Cu / Al	Cu / Al
Coil type		3/8-in RTPF	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF
Rows / FPI		4 / 15	4 / 15	4 / 15	4 / 15	4 / 15
total face area (ft ²)		11.1	11.1	11.1	11.1	17.5
Condensate drain conn. size		3/4-in	3/4-in	3/4-in	3/4-in	3/4-in
Hot Gas Reheat Coil						
Material (Tube/Fin)		Cu / Al	Cu / Al	Cu / Al	Cu / Al	Cu / Al
Coil type		3/8-in RTPF	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF
Rows / FPI		2 / 17	2 / 17	2 / 17	2 / 17	1 / 17
total face area (ft ²)		6.3	8.4	8.6	8.6	13.8
Evaporator fan and motor						
Standard Static 3 phase	Motor Qty / Drive type	1 / Belt	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	1.7	1.7	2.4	2.4	2.9
	RPM range	518-733	518-733	591-838	591-838	440-609
	Motor Frame Size	56	56	56	56	56Y
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	15 x 15	15 x 15	15 x 15	15 x 15	18 x 18
Medium Static 3 phase	Motor Qty / Drive type	1 / Belt	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	2.4	2.4	3.7	3.7	3.7
	RPM range	690-936	690-936	838-1084	838-1084	609-778
	Motor Frame Size	56	56	56HZ	56HZ	56HZ
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	15 x 15	15 x 15	15 x 15	15 x 15	18 x 18
High Static 3 phase	Motor Qty / Drive type	1 / Belt	1 / Belt	1 / Belt	1 / Belt	1 / Belt
	Max BHP	3.7	3.7	4.9	4.9	6.1
	RPM range	838-1084	838-1084	1022-1240	1022-1240	776-955
	Motor Frame Size	56	56	145TY	145TY	S184T
	Fan Qty / Type	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal	1 / Centrifugal
	Fan Diameter (in)	15 x 15	15 x 15	15 x 15	15 x 15	18 x 18
Condenser Coil						
Material (Tube/Fin)		Cu / Al	Cu / Al	Cu / Al	Cu / Al	Cu / Al
Coil type		3/8-in RTPF	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF	3/8-in RTPF
Rows / FPI		2 / 17	2 / 17	3 / 17	3 / 17	2 / 17
Total Face Area (ft ²)		25.1	25.1	25.1	25.1	2 at 23.1
Condenser fan / motor						
Qty / Motor drive type		2 / direct	2 / direct	1 / direct ECM	1 / direct	3 / direct
Motor HP / RPM		1/4 / 1100	1/4 / 1100	1 / 1050	1 / 1175	1/4 / 1100
Fan diameter (in)		22	22	30	30	22
Filters						
RA Filter # / size (in)		4 / 20 x 20 x 2	4 / 20 x 20 x 2	4 / 20 x 20 x 2	4 / 20 x 20 x 2	6 / 18 x 24 x 2 Vert 2/24 x 27 x 1
OA inlet screen # / size (in)		1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 20 x 24 x 1	1 / 20 x 24 x 1	Horz 1/30 x 39 x 1


BASE UNIT DIMENSIONS – RAH036–060

NOTES:


1. DIMENSIONS ARE IN INCHES, DIMENSIONS IN [] ARE IN MILLIMETERS.
2.  CENTER OF GRAVITY
3.  DIRECTION OF AIR FLOW

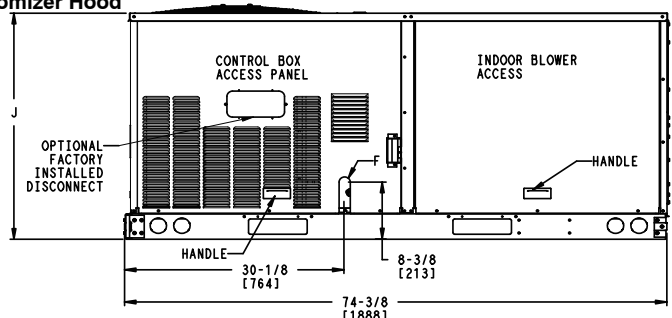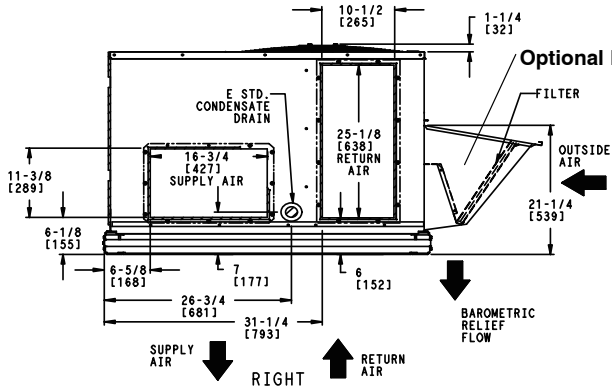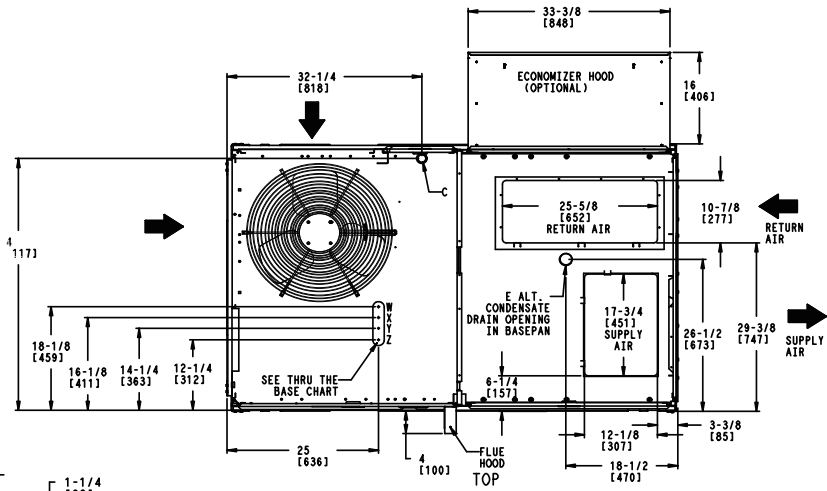

FRONT

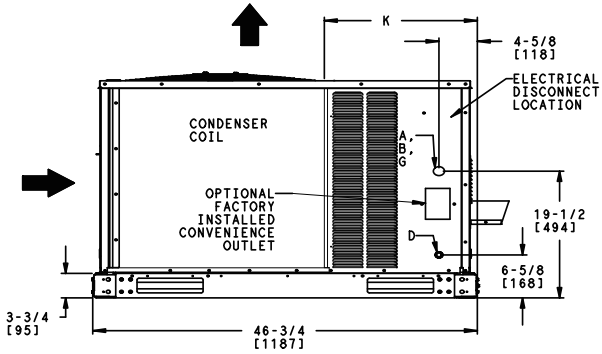

LEFT

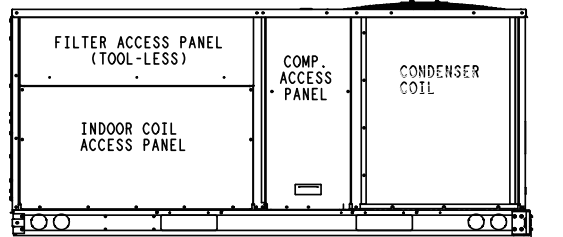

BACK

2-5/8 [67]
TYP CURB WIDTH


CONNECTION SIZES	
A	1 3/8" [35] DIA FIELD POWER SUPPLY HOLE
B	2" [50] DIA POWER SUPPLY KNOCKOUT
C	1 3/4" [51] DIA GAUGE ACCESS PLUG
D	7/8" [22] DIA FIELD CONTROL WIRING HOLE
E	3/4"-14 NPT CONDENSATE DRAIN
G	2 1/2" [64] DIA POWER SUPPLY KNOCK-OUT

THRU-THE-BASE CHART THESE HOLES REQUIRED FOR USE CRBTMPWR001A01, 003A01			
	THREADED CONDUIT SIZE	WIRE USE	REQ'D HOLE SIZES (MAX.)
W	1/2"	ACC.	7/8" [22.2]
X	1/2"	24V	7/8" [22.2]
Y *	3/4" (001,003)	POWER	1 1/8" [28.4]
Z**	(003) 1/2" FPT	GAS	1 3/16" [30.0]
FOR "THRU-THE-BASEPAN" FACTORY OPTION, FITTINGS FOR ONLY X, Y, & Z ARE PROVIDED			
*	SELECT EITHER 3/4" OR 1/2" FOR POWER, DEPENDING ON WIRE SIZE		

UNIT	J	K
036	33 3/8 [847]	18 5/8 [472]
048	41 3/8 [1051]	14 7/8 [377]
060	41 3/8 [1051]	14 7/8 [377]


WEIGHT & CLEARANCE DIMENSIONS – RAH036–060 (cont.)

UNIT	BASE UNIT WEIGHT		Corner Weight A		Corner Weight B		Corner Weight C		Corner Weight D		Center of Gravity In [mm]		
	LBS	KG	LBS	KG	LBS	KG	LBS	KG	LBS	KG	X	Y	Z
RAH036	458	208	128	58	109	49	101	46	120	54	34-1/8 [867]	22-1/2 [572]	19 3/4 [502]
RAH048	545	247	156	71	135	61	118	54	136	62	34-5/8 [879]	21-3/4 [552]	20-7/8 [530]
RAH060	550	249	160	73	136	62	117	53	138	63	34-1/8 [867]	21-5/8 [549]	20-1/4 [514]

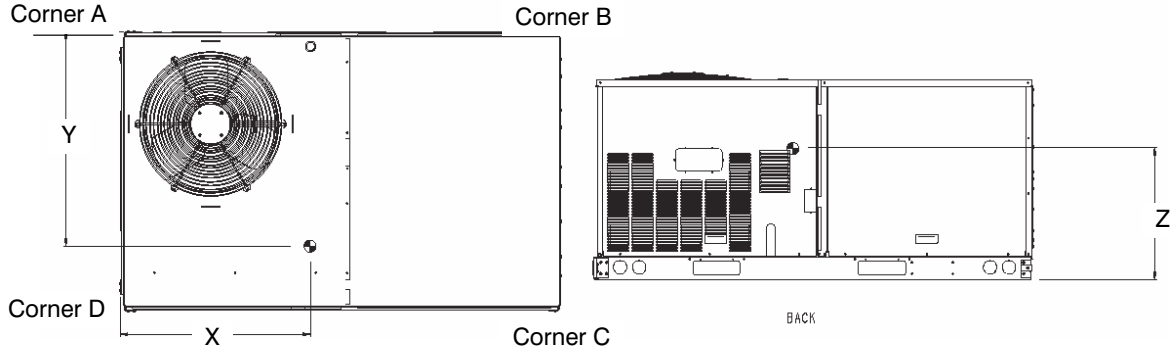

UNIT CLEARANCES






LOC	DIMENSION	CONDITION
A	48" (1219 mm)	Unit disconnect is mounted on panel
	18" (457 mm)	No disconnect, convenience outlet option
	18" (457 mm)	Recommended service clearance
	12" (305 mm)	Minimum clearance
B	42" (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall)
	36" (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)
	Special	Check for sources of flue products within 10-ft of unit fresh air intake hood
C	36" (914 mm)	Side condensate drain is used
	18" (457 mm)	Minimum clearance
D	42" (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall, another unit)
	36" (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)

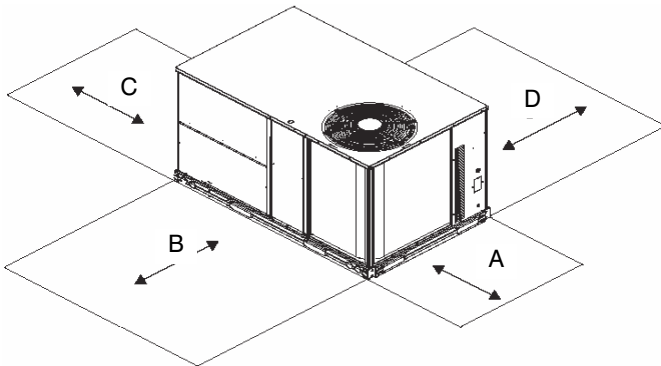

ROOF CURB DETAILS - RAH036-060

ROOF CURB ACCESSORY #	A	CONNECTOR PKG. ACC.	GAS CONNECTION TYPE	GAS FITTING	POWER WIRING FITTING	CONTROL WIRING FITTING	ACCESSORY CONVENIENCE OUTLET WIRING CONNECTOR
CRRCURB001A01	14" [356]	CRBTMPWR001A01	THRU THE CURB	3/4" [19] NPT	3/4" [19] NPT	1/2" [12.7] NPT	1/2" [12.7] NPT
CRRCURB002A01	24" [610]	CRBTMPWR003A01	THRU THE BOTTOM	1/2" [12.7] NPT			


- NOTES:
 1. ROOF CURB ACCESSORY IS SHIPPED DISASSEMBLED.
 2. INSULATED PANELS ARE 1/2" THICK POLYURETHANE FOAM, 44.5 [1134] DENSITY.
 3. DIMENSIONS IN LARGE INCHES.
 4. ROOF CURB: 18 GAGE STEEL.
 5. SERVICE CLEARANCE 4 FEET ON EACH SIDE.
 6. CONNECTOR PACKAGE CRBTMPWR001A01 IS FOR THRU-THE-CURB GAS TYPE.
 7. CONNECTOR PACKAGE CRBTMPWR003A01 IS FOR THRU-THE-BOTTOM TYPE GAS CONNECTIONS.

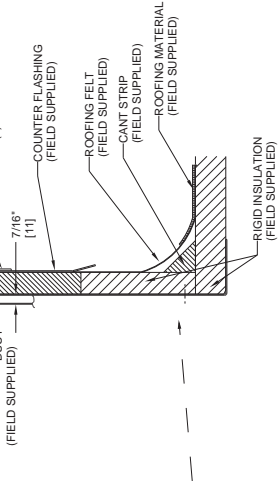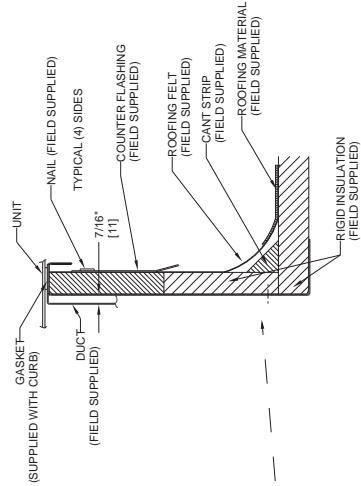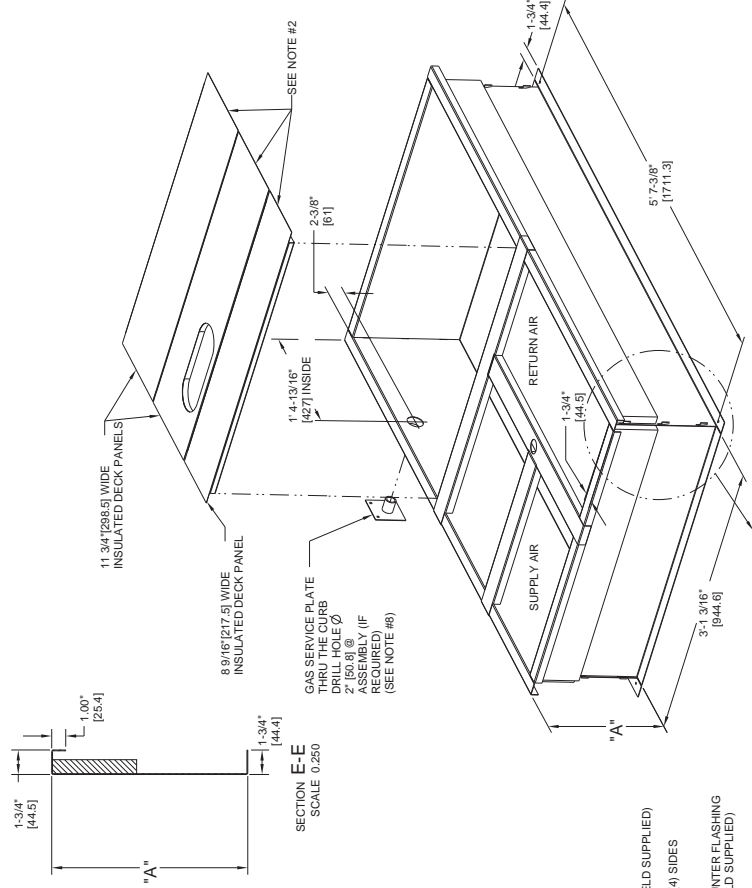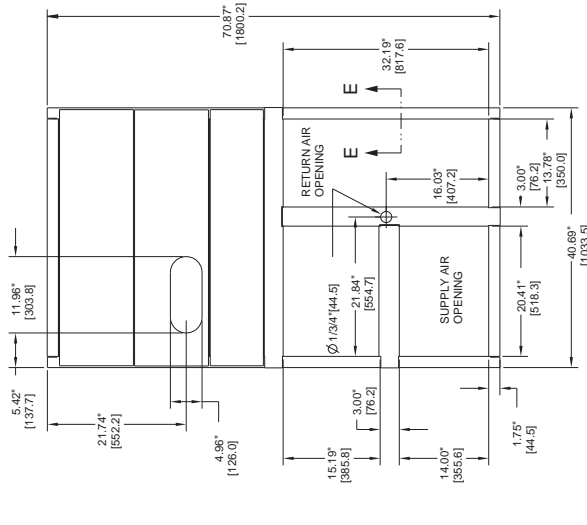

CERTIFIED DRAWING

DRAWING RELEASE LEVEL:	PRODUCTION	UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES
THIRD ANGLE PROJECTION	1 DEC 3 DEC 3 DEC	ANG ANG ANG
MATERIAL	104738	AUTHORIZATION NUMBER
ENGINEERING REQUIREMENTS	MANUFACTURING	ENGINEERING
Y-005, Y-002	MANUFACTURING	ENGINEERING
WEIGHT	CHECKER	DRAWER
MMMC	061711	MMMC
SURFACE FINISH	MODEL (INTERNAL USE ONLY)	MEASURE
PURCH		






REVISION RECORD	DATE	BY	CHKD	APPD	ECNO.
A	04/22/13	MMC			1067888
OVERALL DIM. 5-7 3/8" WAS 5-7 7/8; 18GA MATERIAL WA 16 GA. NAIL FIELD SUPPLIED WAS WITH CURB					

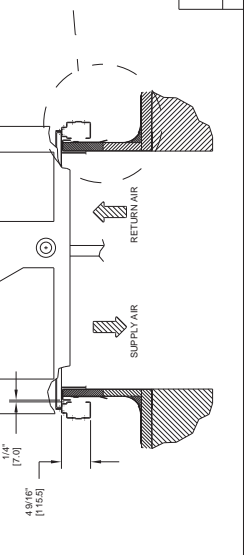

BASE UNIT DIMENSIONS – RAH072-102

NOTES:

1. DIMENSIONS ARE IN INCHES. DIMENSIONS IN [] ARE IN MILLIMETERS.
2. ⊕ CENTER OF GRAVITY
3. → DIRECTION OF AIR FLOW

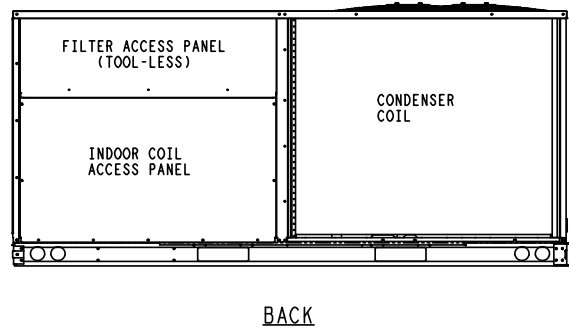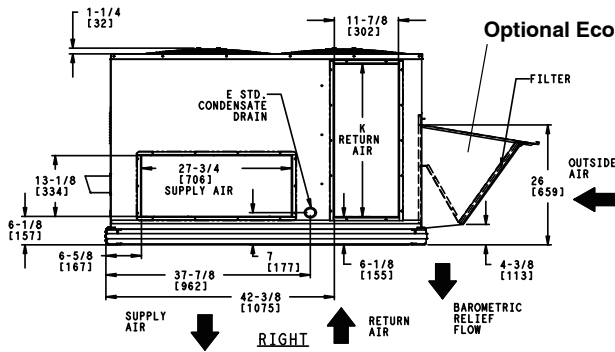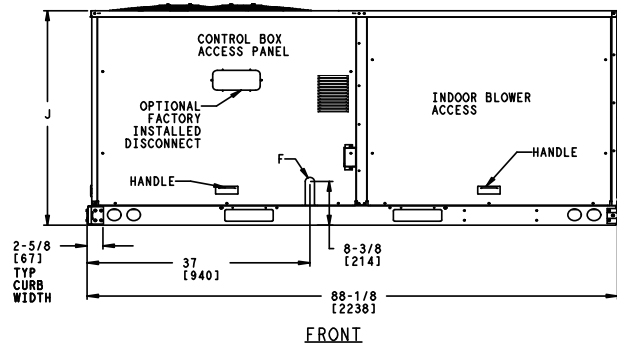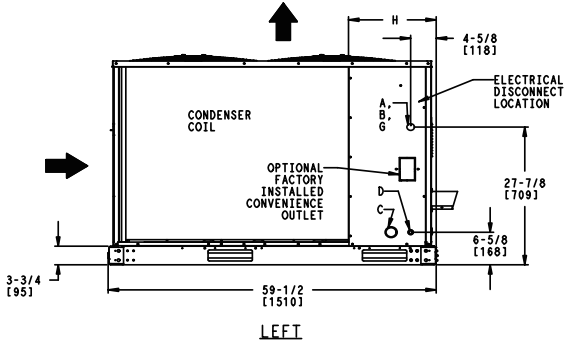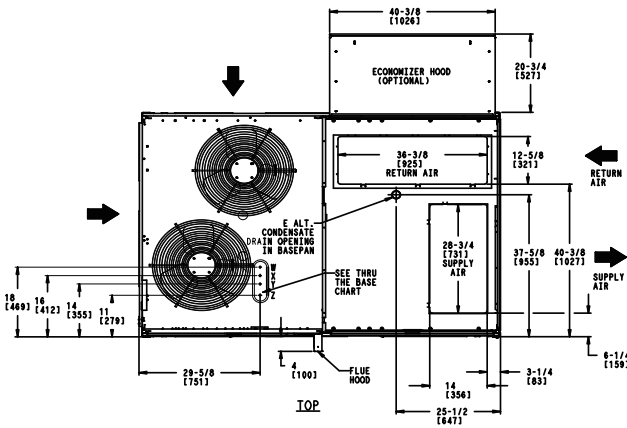

CONNECTION SIZES		
A	1 3/8" [35]	DIA FIELD POWER SUPPLY HOLE
B	2 1/2" [64]	DIA POWER SUPPLY KNOCKOUT
C	1 3/4" [51]	DIA GAUGE ACCESS PLUG
D	7/8" [22]	DIA FIELD CONTROL WIRING HOLE
E	3/4"-14 NPT	CONDENSATE DRAIN
G	2" [51]	DIA POWER SUPPLY KNOCK-OUT


THRU-THE-BASE CHART (FIELD INST)			
THESE HOLES REQUIRED FOR USE WITH ACCY KITS: CRBTMPWR001A01: 072 CRBTMPWR002A01: 090, 102			
	THREADED CONDUIT SIZE	WIRE USE	REQ'D HOLE SIZES (MAX.)
W	1/2"	ACC.	7/8" [22.2]
X	1/2"	24V	7/8" [22.2]
Y	3/4" (001,003) 1 1/4" (002,004)	POWER	1 1/8" [28.6] 1 3/4" [44.4]

UNIT	J	K	H
072	41 1/4 [1048]	33 [658]	15 7/8 [403]
090	49 3/8 [1253]	36 3/8 [925]	15 7/8 [403]
102	49 3/8 [1253]	36 3/8 [925]	15 7/8 [403]

THRU-THE-BASE CHART (FIOP)	
FOR "THRU-THE-BASEPAN" FACTORY OPTION, FITTINGS FOR ONLY X & Y ARE PROVIDED. **	
(1) 1/2" & (1) 1-1/4" Electrical Fittings	


WEIGHT & CLEARANCE DIMENSIONS – RAH072–102 (cont.)

UNIT	BASE UNIT WEIGHT		Corner Weight A		Corner Weight B		Corner Weight C		Corner Weight D		Center of Gravity In [mm]		
	LBS	KG	LBS	KG	LBS	KG	LBS	KG	LBS	KG	X	Y	Z
RAH072	715	324	199	73	142	65	193	88	219	99	41-3/8 [1051]	34-1/4 [870]	20-1/2 [521]
RAH090	860	390	199	90	176	80	227	103	257	117	41-3/8 [1051]	33-1/2 [851]	23-3/4 [603]
RAH102	860	390	199	90	176	80	227	103	257	117	41-3/8 [1051]	33-1/2 [851]	23-3/4 [603]

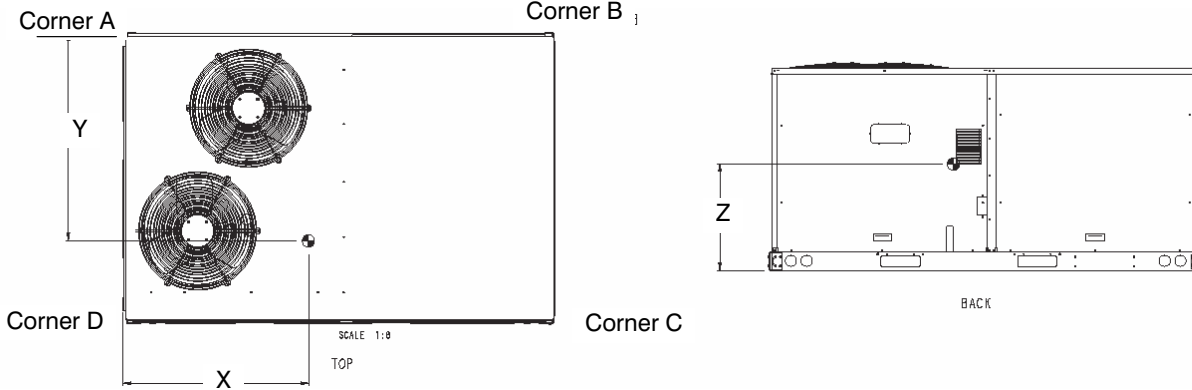



UNIT CLEARANCES

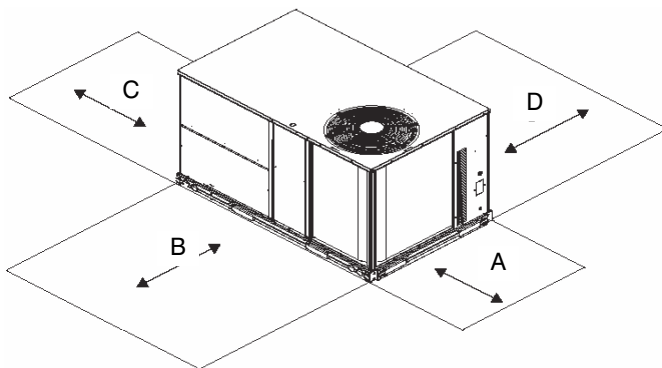LOC	DIMENSION	CONDITION
A	48" (1219 mm)	Unit disconnect is mounted on panel
	36" (914 mm)	If dimension-B is 12"
	18" (457 mm)	No disconnect, convenience outlet option
	18" (457 mm)	Recommended service clearance (use electric screwdriver)
	12" (305 mm)	Minimum clearance (use manual ratchet screwdriver)
B	36" (914 mm)	Unit has economizer
	12" (305 mm)	If dimension-A is 36"
	Special	Check for sources of flue products within 10-ft of unit fresh air intake hood
C	36" (914 mm)	Side condensate drain is used
	18" (457 mm)	Minimum clearance
D	42" (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall, another unit)
	36" (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)



BASE UNIT DIMENSIONS - RAH110/120


NOTES:

1. DIMENSIONS ARE IN INCHES. DIMENSIONS IN [] ARE IN MILLIMETERS.
2.  CENTER OF GRAVITY
3.  DIRECTION OF AIR FLOW

CONNECTION SIZES	
A	1 3/8" [35] DIA. FIELD POWER SUPPLY HOLE
B	2 1/2" [64] DIA. POWER SUPPLY KNOCKOUT
C	1 3/4" [51] DIA. GAUGE ACCESS PLUG
D	7/8" [22] DIA. FIELD CONTROL WIRING HOLE
E	3/4"-14 NPT CONDENSATE DRAIN
G	2" [51] DIA. POWER SUPPLY KNOCK-OUT


THRU-THE-BASE CHART THESE HOLES REQUIRED FOR USE (CRBTMPR002101)	
THREADED CONDUIT SIZE	REQ'D HOLE SIZES (MAX.)
1/2"	7/8" [22.2]
1/2"	24"
1 1/4" (002)	POWER 1 3/4" [44.4]

FOR *THRU-THE-BASEPANEL* FACTORY OPTION, FITTINGS FOR ONLY X & Y ARE PROVIDED.

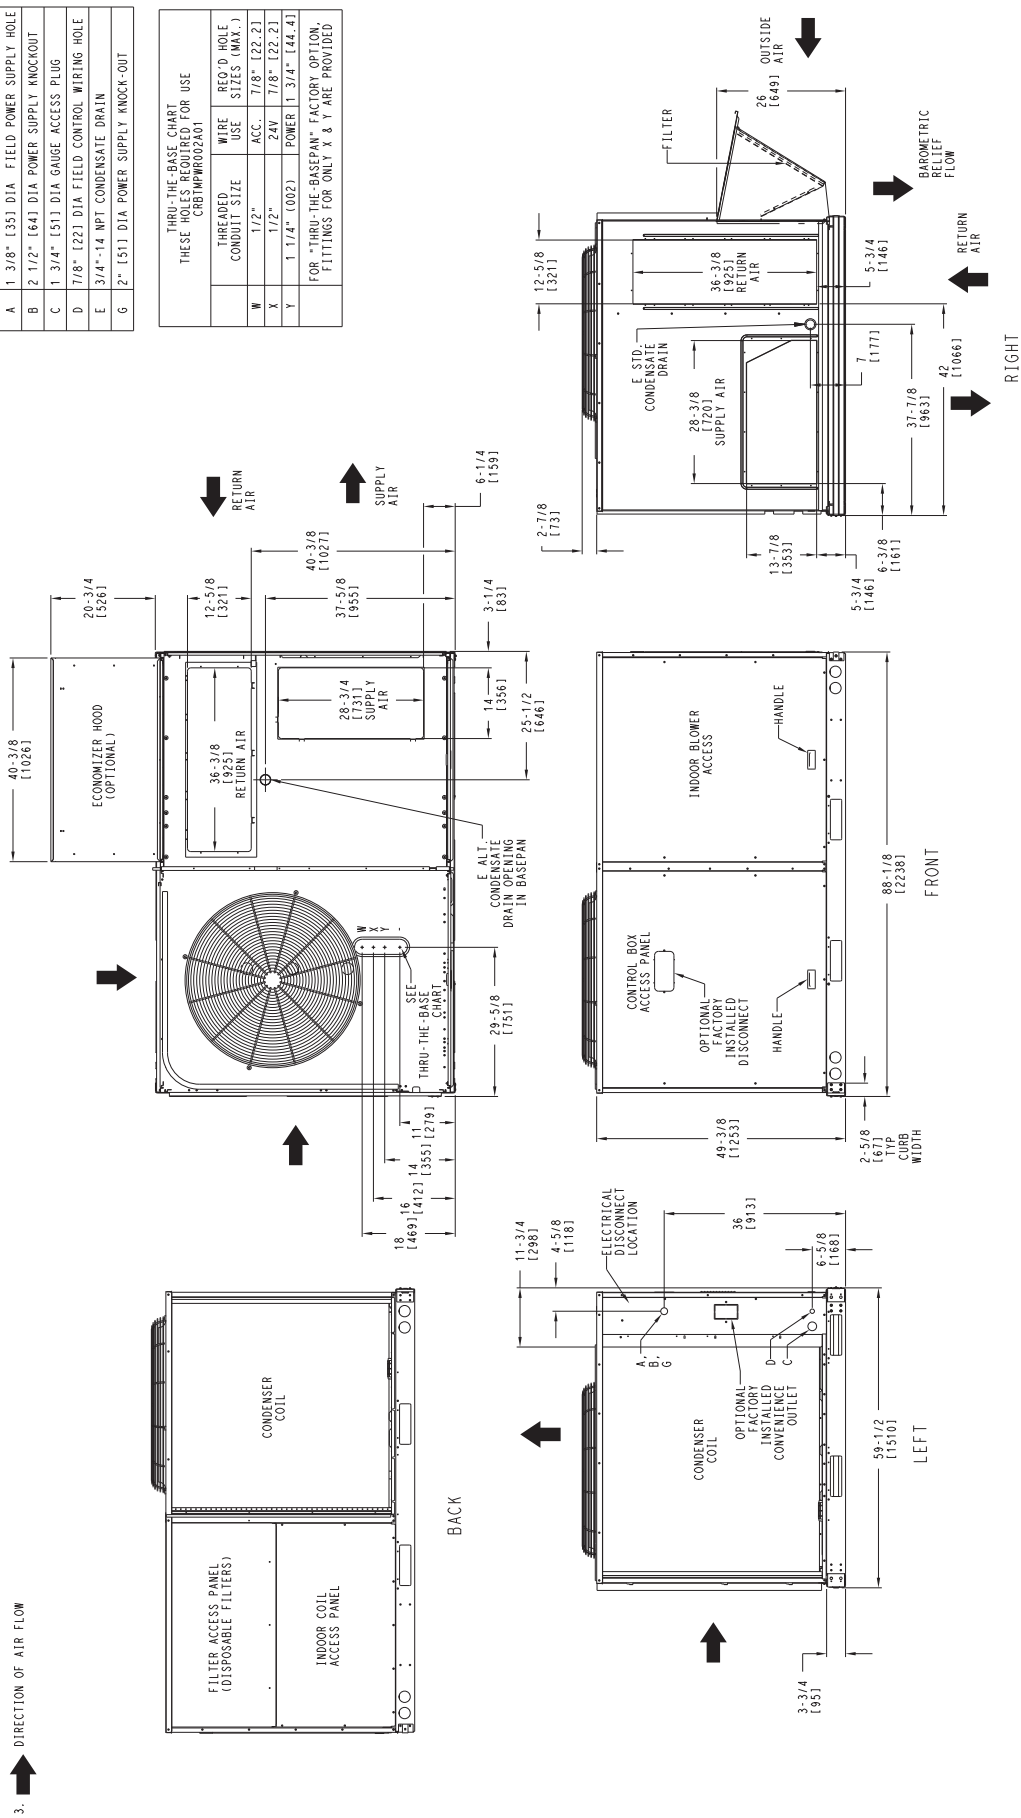


WEIGHT & CLEARANCE DIMENSIONS – RAH110/120 (cont.)

UNIT	BASE UNIT WEIGHT		Corner Weight A		Corner Weight B		Corner Weight C		Corner Weight D		Center of Gravity In [mm]		
	LBS	KG	LBS	KG	LBS	KG	LBS	KG	LBS	KG	X	Y	Z
RAH110	1025	466	308	140	146	66	184	84	387	176	28-3/8 [1041]	33-1/8 [841]	21-3/8 [543]
RAH120	1025	465	308	140	146	66	184	84	387	176	28-3/8 [1041]	33-1/8 [841]	21-3/8 [543]

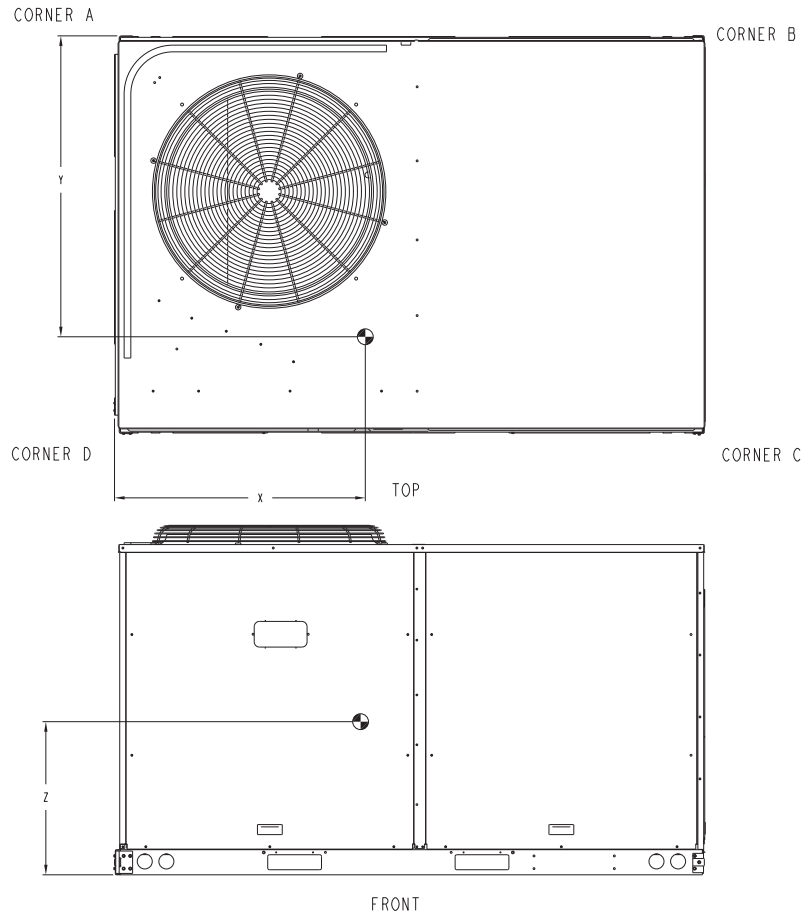

UNIT CLEARANCES RAH110/120


LOC	DIMENSION	CONDITION
A	48" (1219 mm)	Unit disconnect is mounted on panel
	18" (457 mm)	No disconnect, convenience outlet option
	18" (457 mm)	Recommended service clearance
	12" (305 mm)	Minimum clearance
B	42" (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall)
	36" (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)
	Special	Check for sources of flue products within 10-ft of unit fresh air intake hood
C	36" (914 mm)	Side condensate drain is used
D	18" (457 mm)	Minimum clearance
	42" (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall, another unit)
	36" (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)

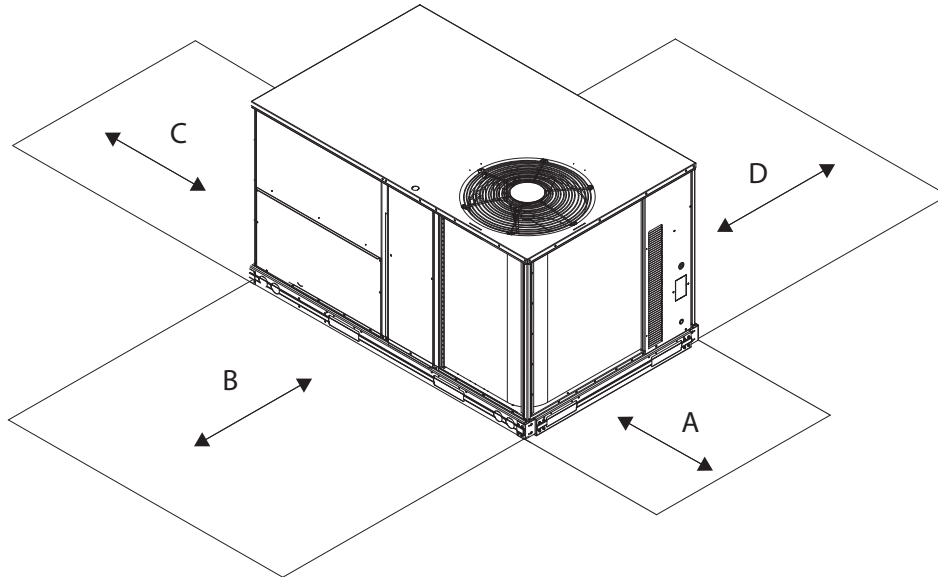

ROOF CURB DETAILS - RAH072 - 120

ROOF CURB ACCESSORY #	A	CONNECTOR PKG. ACC.	GAS CONNECTION TYPE	GAS FITTING	POWER WIRING FITTING	CONTROL WIRING FITTING	ACCESSORY CONVENIENCE OUTLET WIRING CONNECTOR
CRRFCURB003A01	14" [356]	CRBTMPWR002A01	THRU THE CURB	3/4" [19] NPT	1 1/4" [31.7] NPT	1/2" [12.7] NPT	1/2" [12.7] NPT
CRRFCURB004A01	24" [610]	CRBTMPWR004A01	THRU THE BOTTOM				

- NOTES:
1. ROOFCURB ACCESSORY IS SHIPPED DISASSEMBLED.
 2. INSULATED PANELS: 25.4 [1"] THK. POLYURETHANE FOAM, 44.5 [1.341"] # DENSITY.
 3. DIMENSIONS IN [] ARE IN MILLIMETERS.
 4. ROOFCURB IS MADE OF STEEL.
 5. ROOFCURB IS MADE OF STEEL. (FLANGES OF DUCT REST ON CURB).
 6. SERVICE CLEARANCE 4 FEET ON EACH SIDE.
 7. DIRECTION OF AIR FLOW.
 8. CONNECTOR PACKAGE CRBTMPWR002A01 IS FOR THRU-THE-CURB GAS TYPE PACKAGE CRBTMPWR004A01 IS FOR THRU-THE-BOTTOM TYPE GAS CONNECTIONS.

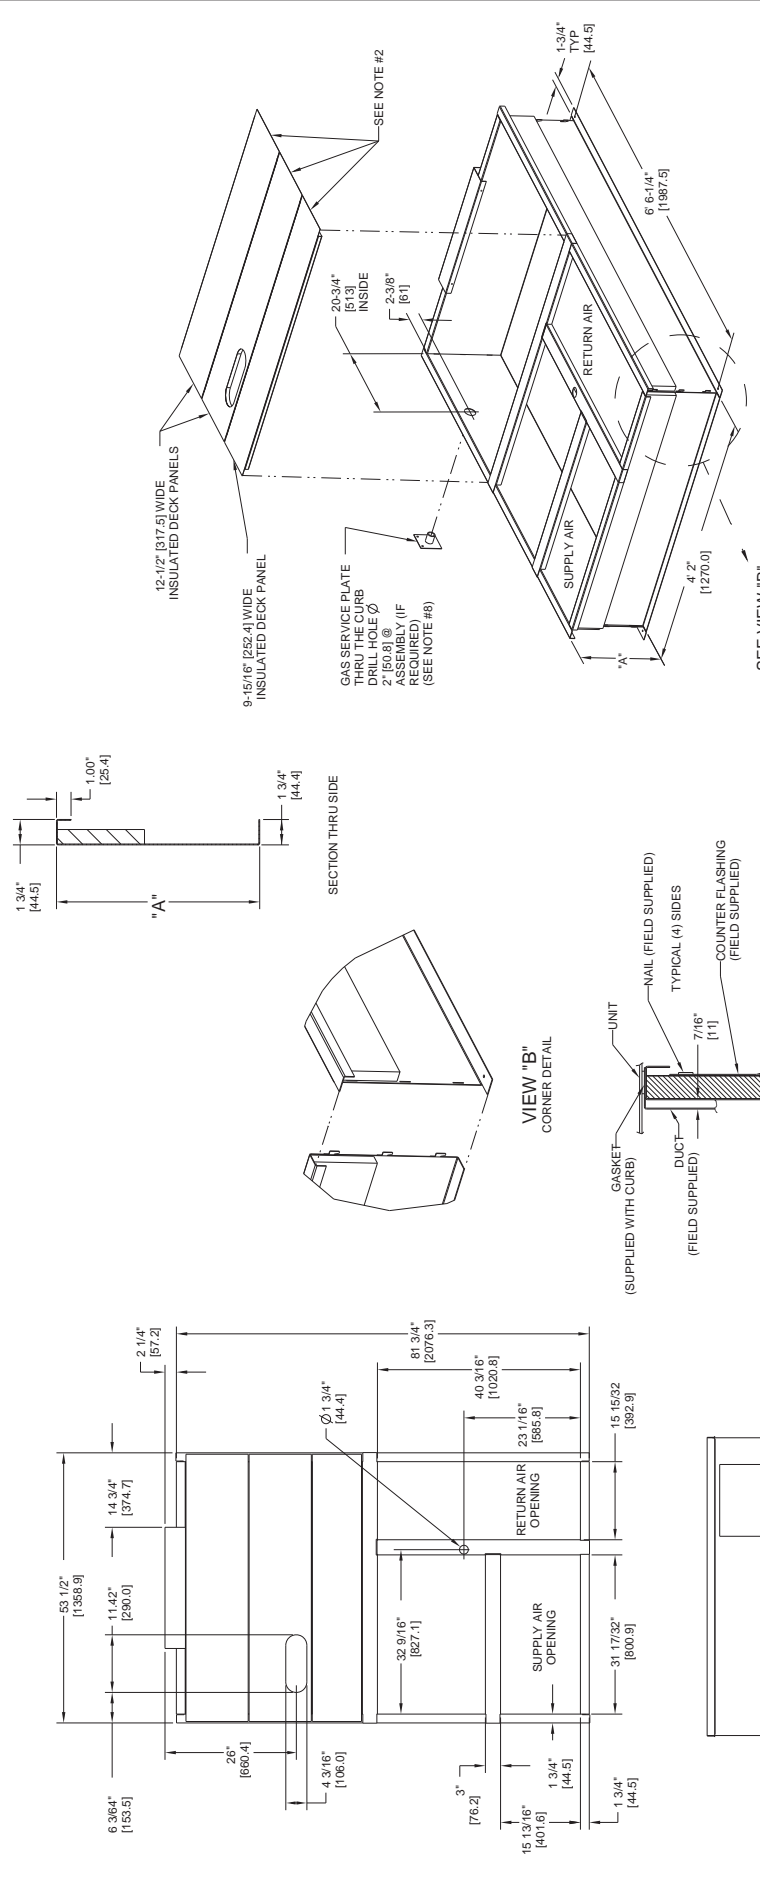

DRAWING RELEASE LEVEL:		PRODUCTION		UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES		THIS DOCUMENT AND THE INFORMATION CONTAINED HEREIN IS PROPRIETARY TO CARBER CORPORATION AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT THE WRITTEN AND CONSENT OF CARBER CORPORATION.	
THRO-ANGLE PROJECTION	1 DEC	2 DEC	3 DEC	ANG	±	±	±
MATERIAL	ENGINEERS	MANUFACTURING	AUTHORIZATION NUMBER		TITLE		REV
ENGINEERING REQUIREMENTS	T-005, Y-002	MM	12/16/09	1029120	CURB ASY, ROOF		C
WEIGHT	DRAPTOR	CHECKER	MODEL (INTERNAL USE ONLY)	SIZE	DRAWING NUMBER	SCALE	DISTRIBUTION
SURFACE FINISH	MM	12/16/09		D	50HJ405012	SHEET 5 OF 5	
PURCH	MM						
BY	DATE	CHKD	APPD	ECNO.	REV	SCALE	DISTRIBUTION
	4/22/13			1067898		N/A	
REVISION RECORD							
REV	DESCRIPTION	DATE	BY	CHKD	APPD	ECNO.	
C	18 GA WAS 16 GA.; 15 13/16" WAS 15 15/16" NAIL FIELD SUPPLIED WAS WITH CURB	4/22/13	MM			1067898	

BASE UNIT DIMENSIONS - RAH150

UNITED TECHNOLOGIES STRUCCURE, NY
CARRIER


P. O. Box 4808
13221

THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN PERMISSION OF CARRIER CORPORATION'S WRITTEN CONSENT.

CONNECTION SIZES	
B	2 1/2" - 1641 DIA. POWER SUPPLY HOLE
D	7/8" - 221 DIA. FIELD CONTROL WIRING HOLE
E	3/4" - 14 NPT CONDENSATE DRAIN
F	7/8" - 221 DIA. FIELD CONVENIENCE OUTLET HOLE

THRU-THE-BASE CHART THROU-HOLE FACTORY USE CREMTPW005A00,006A00,007A00			
ACCESSORY NO.	THREADED CONDUIT SIZE	WIRE USE	REQ'D HOLE SIZES (MAX.)
005	1/2"	ACC.	7/8" - 222, 21
	1/2"	24V	7/8" - 222, 21
	1/4"	POWER	1 1/2" - 138, 11
006	1/2"	ACC.	7/8" - 222, 21
	1/2"	24V	7/8" - 222, 21
	1/2"	POWER	2" - 130, 8
007	1/2"	ACC.	7/8" - 222, 21
	1/2"	24V	7/8" - 222, 21
	1/2"	POWER	2 1/2" - 163, 5

FOR "THRU-THE-BASE" FACTORY OPTION, FITTINGS FOR X, Y ARE PROVIDED AS SPECIFIED ON "006".


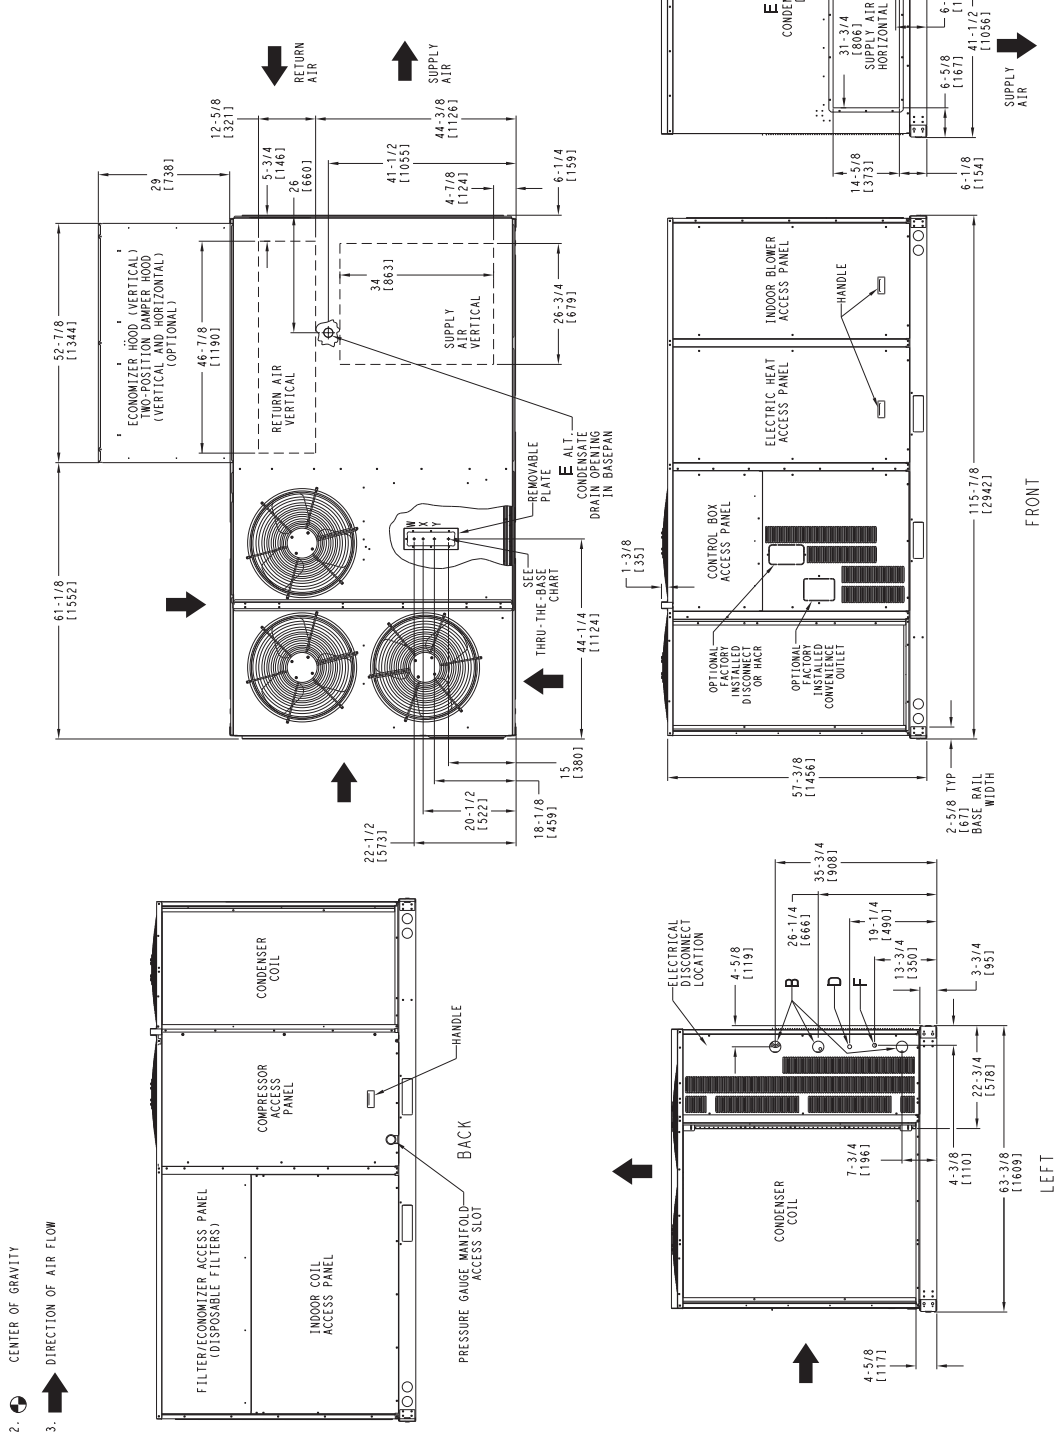


- NOTES:
1. DIMENSIONS ARE IN INCHES. DIMENSIONS IN [] ARE IN MILLIMETERS.
 2. CENTER OF GRAVITY
 3. DIRECTION OF AIR FLOW


WEIGHT & CLEARANCE DIMENSIONS – RAH150 (cont.)

UNIT	BASE UNIT WEIGHT*		Corner Weight A		Corner Weight B		Corner Weight C		Corner Weight D		Center of Gravity In [mm]		
	LBS	KG	LBS	KG	LBS	KG	LBS	KG	LBS	KG	X	Y	Z
RAH150	1360	617	335	151	361	164	344	156	320	145	60-1/8 [1527]	31 [787]	21-1/8 [536]

* Standard unit weight is without electric heat & without packaging.

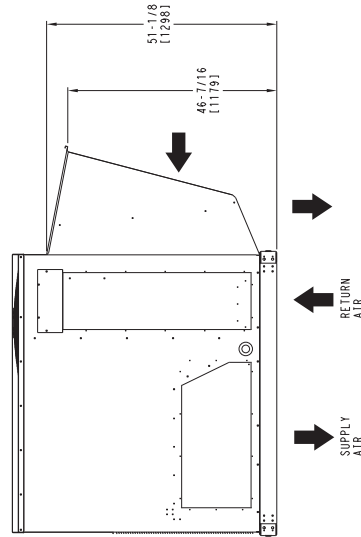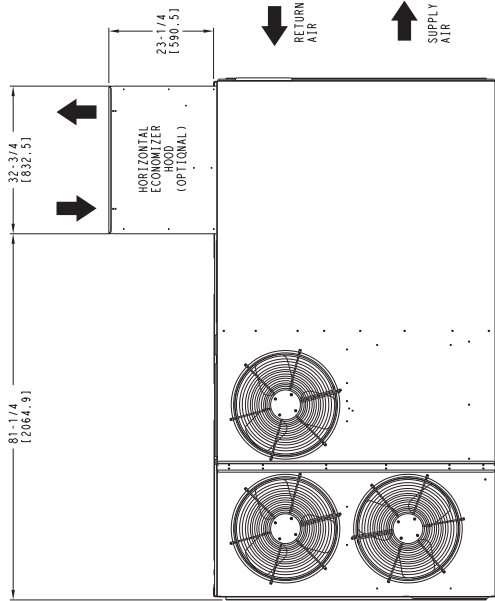


HORIZONTAL ECONOMIZER

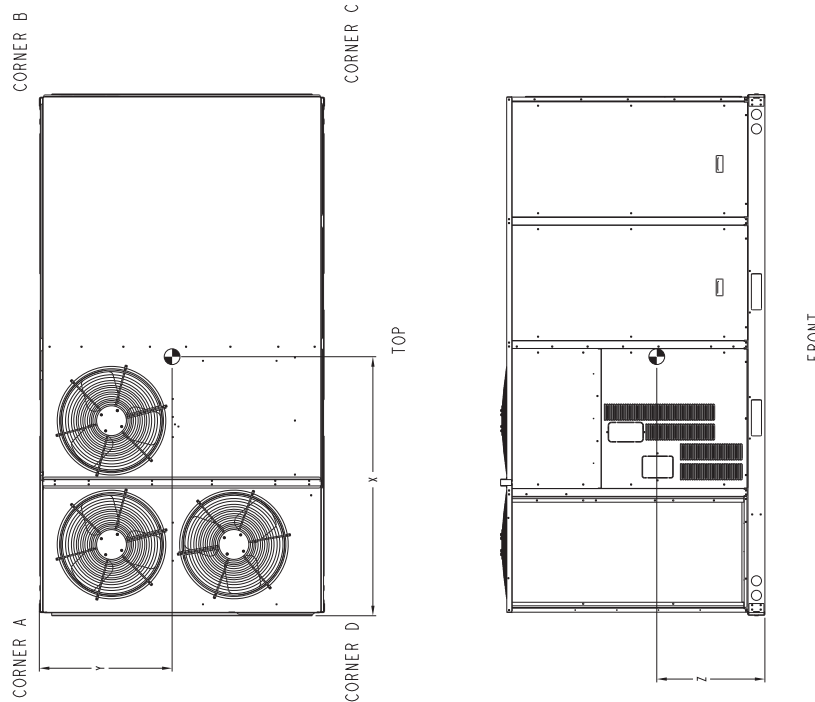

UNIT CLEARANCES RAH150


LOC	DIMENSION	CONDITION
A	48" (1219 mm)	Unit disconnect is mounted on panel
	18" (457 mm)	No disconnect, convenience outlet option
	18" (457 mm)	Recommended service clearance
	12" (305 mm)	Minimum clearance
B	42" (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall)
	36" (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)
	Special	Check for sources of flue products within 10-ft of unit fresh air intake hood
C	36" (914 mm)	Side condensate drain is used
D	18" (457 mm)	Minimum clearance
	42" (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall, another unit)
	36" (914 mm)	Surface behind servicer is electrically non-conductive (e.g., wood, fiberglass)




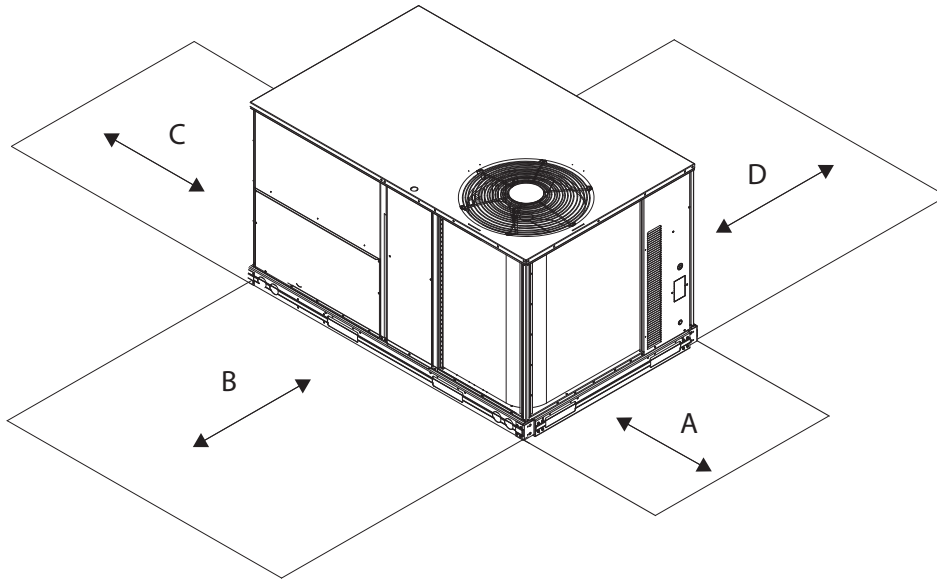


ROOF CURB DETAILS – RAH150

ROOF CURB ACCESSORY #	A
CRRFCURB074A00	14" [356]
CRRFCURB075A00	24" [610]

NOTES:

1. ROOFCURB ACCESSORY IS SHIPPED DISASSEMBLED.
2. INSULATED PANELS: 1/2" THK. NEOPRENE FOAM, 1.0# DENSITY.
3. DIMENSIONS IN [] ARE IN MILLIMETERS.
4. ROOFCURB SIDEWALLS: 16 GAGE STEEL.
5. ATTACH DUCTWORK TO CURB. (FLANGES OF DUCT REST ON CURB).
6. SERVICE CLEARANCE 4 FT ON EACH SIDE.
7.  DIRECTION OF AIR FLOW.
8. "L" & "S" DESIGNATIONS DENOTE LOCATION OF COMMON CROSS RAIL. (POSITION "L" FOR LARGE DUCT OPENING CURB).

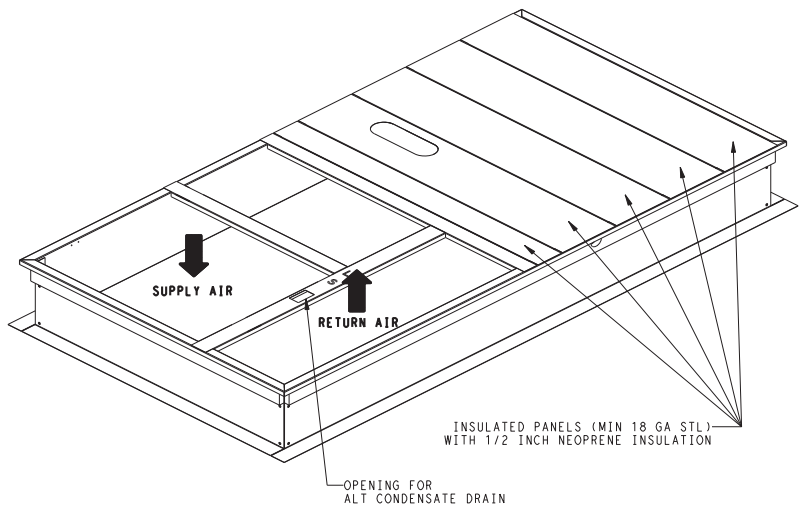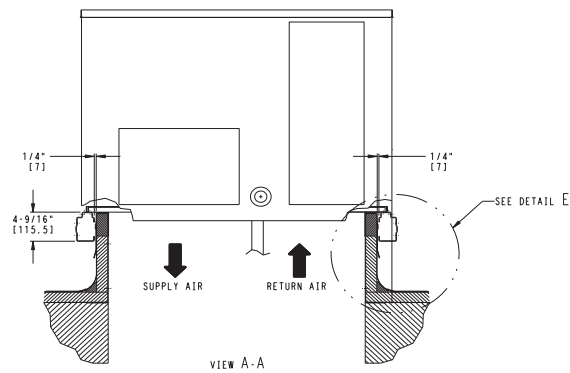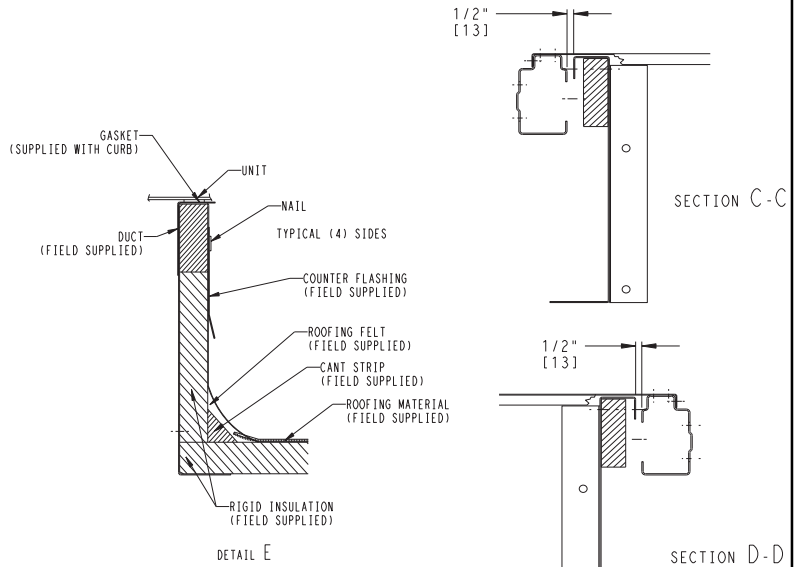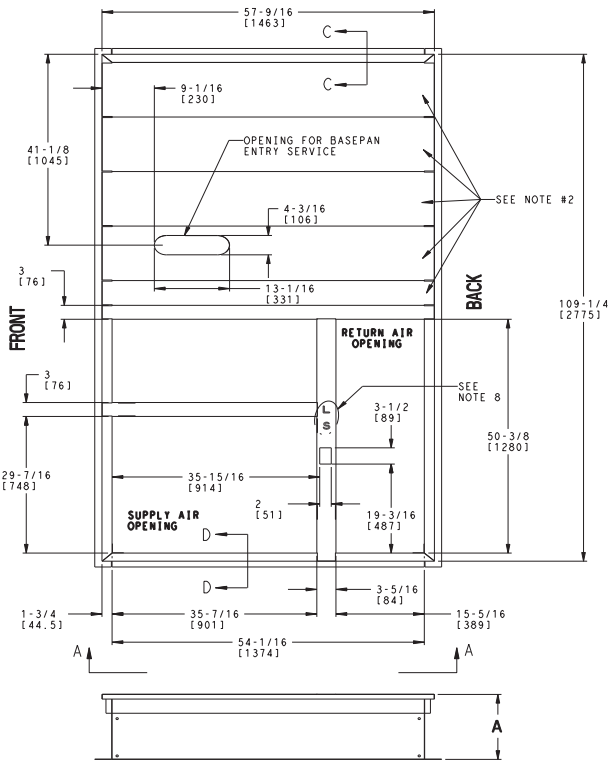

OPTIONS & ACCESSORY WEIGHTS

OPTION / ACCESSORY	OPTION / ACCESSORY WEIGHTS															
	Unit Size (ton)															
	3		4		5		6		7.5		8.5		10		12.5	
	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg
Hot Gas Reheat	15	7	23	10	25	11	29	13	38	17	47	21	57	21	47	21
Power Exhaust – vertical	50	23	50	23	50	23	50	23	75	34	75	34	75	34	75	34
Power Exhaust – horizontal	30	14	30	14	30	14	30	14	30	14	30	14	30	14	30	14
Economizer (IV or X)	50	23	50	23	50	23	50	23	75	34	75	34	75	34	75	34
Two Position damper	39	18	39	18	39	18	39	18	58	26	58	26	58	26	58	26
Manual Dampers	12	5	12	5	12	5	12	5	18	8	18	8	18	8	18	8
Hail Guard (louvered)	16	7	16	7	16	7	16	7	34	15	34	15	34	15	34	15
Cu/Cu Condenser Coil ¹	6	3	13	6	13	6	15	7	12	5	23	10	23	10	23	10
Cu/Cu Cond. & Evaporator Coils ¹	12	5	19	9	21	10	26	12	25	11	49	22	49	22	49	22
Roof Curb (14–in. curb)	115	52	115	52	115	52	115	52	143	65	143	65	143	65	143	65
Roof Curb (24–in. curb)	197	89	197	89	197	89	197	89	245	111	245	111	245	111	245	111
CO ₂ sensor	5	2	5	2	5	2	5	2	5	2	5	2	5	2	5	2
Electric Heater	30	14	30	14	30	14	30	14	45	20	45	20	45	20	45	20
Single Point Kit	10	5	10	5	10	5	10	5	12	5	12	5	12	5	15	7
Optional Indoor Motor / Drive	10	5	10	5	10	5	10	5	15	7	15	7	15	7	15	7
Motor Master Controller	35	16	35	16	35	16	35	16	35	16	35	16	35	16	40	18
Supply Smoke Detector	5	2	5	2	5	2	5	2	5	2	5	2	5	2	5	2
Non–Fused Disconnect	15	7	15	7	15	7	15	7	15	7	15	7	15	7	15	7
Non–Powered Convenience outlet	5	2	5	2	5	2	5	2	5	2	5	2	5	2	5	2
Enthalpy Sensor	2	1	2	1	2	1	2	1	2	1	2	1	2	1	2	1
Differential Enthalpy Sensor	3	1	3	1	3	1	3	1	3	1	3	1	3	1	3	1
2 Speed Indoor Fan Motor System with VFD	–	–	–	–	–	–	–	–	20	9	20	9	20	9	20	9

APPLICATION DATA

Min operating ambient temp (cooling):

In mechanical cooling mode, your rooftop can safely operate down to an outdoor ambient temperature of 25°F (-4°C), with an accessory winter start kit; 40°F (4°C) standard min operating temperature. It is possible to provide cooling at lower outdoor ambient temperatures by using less outside air, economizers, and/or accessory low ambient kits.

Max operating ambient temp (cooling):

The maximum operating ambient temperature for cooling mode is 115°F (46°C). While cooling operation above 115°F (46°C) may be possible, it could cause either a reduction in performance, reliability, or a protective action by the unit's internal safety devices.

Min and max airflow (heating and cooling):

To maintain safe and reliable operation of your rooftop, operate within the cooling airflow limits. Operating above the max may cause blow-off, undesired airflow noise, or airflow related problems with the rooftop unit. Operating below the min may cause problems with coil freeze-up.

Airflow:

All units are draw-through in cooling mode.

Outdoor air application strategies:

Economizers reduce operating expenses and compressor run time by providing a free source of cooling and a means of ventilation to match application changing needs. In fact, they should be considered for most applications. Also, consider the various economizer control methods and their benefits, as well as sensors required to accomplish your application goals. Please contact your local sales representative for assistance.

Motor limits, break horsepower (BHP):

Due to the internal unit design, air path, and specially designed motors, the full horsepower (maximum continuous BHP) band, as listed in Table 6, can be used with the utmost confidence. There is no need for extra safety factors, the motors are designed and rigorously tested to use the entire, listed BHP range without either nuisance tripping or premature motor failure.

Sizing a rooftop

Bigger isn't necessarily better. While an air conditioner needs to have enough capacity to meet the design loads, it doesn't need excess capacity. In fact, excess capacity typically results in very poor partload performance and humidity control.

Using higher design temperatures than ASHRAE recommends for your location, adding "safety factors" to the calculated load, are all signs of oversizing air conditioners. Oversizing the air conditioner leads to short cycling (quick on-off cycles) which results in poor humidity control, reduced efficiency, higher utility bills, larger indoor temperature swings, excessive noise, and increased wear and tear on the air conditioner.

Rather than oversizing an air conditioner, engineers should "right-size" or even slightly undersize air conditioners. Correctly sizing an air conditioner controls humidity better; promotes efficiency; reduces utility bills; extends equipment life, and maintains even, comfortable temperatures. Please contact your local representative for assistance.

Low ambient applications

The optional economizer can adequately cool your space by bringing in fresh, cool outside air. In fact, when so equipped, accessory low-ambient kit may not be necessary. In low ambient conditions, unless the outdoor air is excessively humid or contaminated, economizer-based "free cooling" is the preferred less costly and energy conscious method.

In low ambient applications where outside air might not be desired (such as contaminated or excessively humid outdoor environments), your rooftop can operate to ambient temperatures down to -20°F (-29°C) using the recommended accessory Motormaster low ambient controller.

Winter start

A winter start kit extends the low ambient limit of your rooftop to 25°F (-4°C). The kit bypasses the low pressure switch, preventing nuisance tripping of the low pressure switch. Other low ambient precautions may still be prudent.

2-speed indoor fan motor with Variable Frequency Drive (VFD)

The 2-Speed Indoor Fan Motor System utilizes a Variable Frequency Drive (VFD) to automatically adjust the indoor fan motor speed in sequence with the units cooling operation. Per ASHRAE 90.1 2010 standard section 6.4.3.10.b, during the first stage of cooling operation the VFD will adjust the fan motor to provide 2/3rd of the total cfm established for the unit. When a call for the second stage of cooling is required, the VFD will allow the total cfm for the unit established (100%). During the heating mode, the VFD will allow total design cfm (100%) operation and during the ventilation mode the VFD will allow operation to 2/3rd of total cfm.

The VFD used in the 2-Speed Indoor Fan Motor System has soft start capabilities to slowly ramp up the speeds, thus eliminating any high inrush air volume during initial start-up. It also has internal over current protection for the fan motor and a field installed display kit that allows adjustment and in depth diagnostics of the VFD.

This 2-Speed Indoor Fan Motor System is available on models with 2-stage cooling operation with electrical mechanical or RTU Open (multi Protocol) controls. Both space sensor and conventional thermostats/controls can be used to provide accurate control in any application.

The 2-Speed Indoor Fan Motor System is very flexible for initial fan performance set up and adjustment. The standard factory shipped VFD is pre programmed to automatically stage the fan speed between the first and second stage of cooling. The unit fan performance static pressure and cfm can be easily adjusted using the traditional means of pulley adjustments. The other means to adjust the unit static and cfm performance is to utilize the field installed display module and adjust the frequency and voltage in the VFD to required performance requirements. In either case, once set up the VFD will automatically adjust the speed between the cooling stage operation.

SELECTION PROCEDURE (WITH RAH072 EXAMPLE)¹

I. Determine cooling and heating loads.

Given:

Mixed Air Dry bulb	80°F (27°C)
Mixed Air Wet bulb	67°F (19°C)
Ambient Dry bulb	95°F (35°C)
TC _{Load}	69.0 MBH
SHC _{Load}	51.0 MBH
Vertical Supply Air	2100 CFM
External Static Pressure	0.66 in. wg
Electrical Characteristics	230-3-60

II. Make an initial guess at cooling tons.

$$\text{Refrig. tons} = \text{TC}_{\text{Load}} / 12 \text{ MBH per ton}$$

$$\text{Refrig. tons} = 69.0 / 12 = 5.75 \text{ tons}$$

In this case, start by looking at the 50HC*A07.

III. Look up the rooftop's TC and SHC.

Table 12 shows that, at the application's supply air CFM, mixed air and ambient temperatures, the RAH072 supplies:

$$\text{TC}_{\text{Load}} = 73.6 \text{ MBH}$$

$$\text{SHC}_{\text{Load}} = 53.3 \text{ MBH.}$$

IV. Calculate the building Latent Heat Load.

$$\text{LC}_{\text{Load}} = \text{TC}_{\text{Load}} - \text{SHC}_{\text{Load}}$$

$$\text{LC}_{\text{Load}} = 69.0 \text{ MBH} - 51.0 \text{ MBH} = 18.0 \text{ MBH}$$

V. Calculate RTU Latent Heat Capacity

$$\text{LC} = \text{TC} - \text{SHC}$$

$$\text{LC} = 73.6 \text{ MBH} - 53.3 \text{ MBH} = 20.3 \text{ MBH}$$

VI. Compare RTU capacities to loads.^{2,3}

Compare the rooftop's SHC and LC to the building's Sensible and Latent Heat Loads.

VII. Select factory options (FIOP)

Local code requires an economizer for any unit with TC larger than 65.0 MBH.

VIII. Calculate the total static pressure.

External static pressure	0.66 in. wg
--------------------------	-------------

Sum of FIOP/Accessory static	+0.05 in. wg
------------------------------	--------------

Total Static Pressure	0.71 in. wg
-----------------------	-------------

IX. Look up the Indoor Fan RPM & BHP.

Table 25 shows, at 2100 CFM & ESP= 0.71, RPM = 680 & BHP = 0.97

X. Convert BHP (Step IX) into fan motor heat.

$$\text{Fan Motor Heat} = 2.546 * 097 / .80 \text{ efficiency.}$$

$$\text{Fan Motor Heat} = 1.98 \text{ MBH}$$

Deduct this value from the gross capacity values for net capacity.

XI. Determine electrical requirements

Table 45 shows the MCA and MOCP of a RAH072 (without convenience outlet) as:

$$\text{MCA} = 32 \text{ amps} \ \& \ \text{Breaker size} = 50 \text{ amps}$$

$$\text{Min. Disconnect Size: FLA} = 31 \ \& \ \text{LRA} = 148.$$

XII. Determine electrical requirements

NOTES:

1. Selection software saves time by performing many of the steps above. Contact your sales representative for assistance.
2. Selecting a unit with a SHC slightly lower than the SHC_{Load} is often better than oversizing. Slightly lower SHC's will help control indoor humidity, and prevent temperature swings.
3. If the rooftop's capacity meets the Sensible Heat Load, but not the Latent Heat Load.
4. Indoor Fan Motor efficiency is available in Table 41. Use the decimal form in the equation eg. 80% = .8.

LEGEND

BHP	— Break horsepower
FLA	— Full load amps
LC	- Latent capacity
LRA	— Lock rotor amp
MBH	— (1,000) BTUH
MCA	— Min. circuit ampacity
MOCP	— Max. over-current protection
RPM	— Revolutions per minute
RTU	— Rooftop unit
SHC	— Sensible heat capacity
TC	— Total capacity

Table 8 – COOLING CAPACITIES

1 STAGE COOLING

3 TONS

RAH036			AMBIENT TEMPERATURE																
			85			95			105			115			125				
			EA (dB)			EA (dB)			EA (dB)			EA (dB)			EA (dB)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
900 Cfm	EA (wb)	58	TC	32.1	32.1	36.3	30.8	30.8	34.9	29.4	29.4	33.4	28.0	28.0	31.7	26.3	26.3	29.8	
			SHC	27.8	32.1	36.3	26.7	30.8	34.9	25.5	29.4	33.4	24.2	28.0	31.7	22.8	26.3	29.8	
		62	TC	34.0	34.0	34.3	32.3	32.3	33.5	30.6	30.6	32.6	28.7	28.7	31.7	26.6	26.6	30.6	
			SHC	25.0	29.7	34.3	24.2	28.9	33.5	23.4	28.0	32.6	22.5	27.1	31.7	21.5	26.0	30.6	
		67	TC	37.3	37.3	37.3	35.5	35.5	35.5	33.6	33.6	33.6	31.5	31.5	31.5	29.2	29.2	29.2	
			SHC	20.7	25.4	30.0	20.0	24.6	29.3	19.2	23.8	28.4	18.3	22.9	27.6	17.4	22.0	26.6	
	72	TC	40.8	40.8	40.8	38.9	38.9	38.9	36.9	36.9	36.9	34.6	34.6	34.6	32.2	32.2	32.2		
		SHC	16.3	21.0	25.7	15.6	20.3	25.0	14.8	19.5	24.1	13.9	18.6	23.3	13.0	17.7	22.3		
	76	TC	–	43.9	43.9	–	41.8	41.8	–	39.6	39.6	–	37.2	37.2	–	34.6	34.6		
		SHC	–	17.4	22.4	–	16.7	21.7	–	15.9	20.8	–	15.1	19.9	–	14.2	19.0		
	1050 Cfm	EA (wb)	58	TC	33.8	33.8	38.4	32.5	32.5	36.8	31.0	31.0	35.1	29.4	29.4	33.3	27.6	27.6	31.3
				SHC	29.3	33.8	38.4	28.1	32.5	36.8	26.9	31.0	35.1	25.5	29.4	33.3	23.9	27.6	31.3
62			TC	35.1	35.1	37.5	33.3	33.3	36.6	31.5	31.5	35.7	29.6	29.6	34.5	27.7	27.7	32.6	
			SHC	26.9	32.2	37.5	26.0	31.3	36.6	25.1	30.4	35.7	24.1	29.3	34.5	22.7	27.7	32.6	
67			TC	38.4	38.4	38.4	36.5	36.5	36.5	34.5	34.5	34.5	32.3	32.3	32.3	29.9	29.9	29.9	
			SHC	22.0	27.3	32.7	21.2	26.5	31.9	20.3	25.7	31.0	19.4	24.8	30.1	18.5	23.8	29.1	
72		TC	42.0	42.0	42.0	40.0	40.0	40.0	37.8	37.8	37.8	35.5	35.5	35.5	32.9	32.9	32.9		
		SHC	16.9	22.3	27.6	16.1	21.5	26.9	15.3	20.7	26.0	14.4	19.8	25.1	13.5	18.8	24.2		
76		TC	–	45.0	45.0	–	42.9	42.9	–	40.6	40.6	–	38.0	38.0	–	35.3	35.3		
		SHC	–	18.1	23.8	–	17.4	23.0	–	16.6	22.2	–	15.7	21.3	–	14.8	20.3		
1200 Cfm		EA (wb)	58	TC	35.3	35.3	40.0	33.9	33.9	38.4	32.3	32.3	36.6	30.6	30.6	34.7	28.7	28.7	32.5
				SHC	30.6	35.3	40.0	29.4	33.9	38.4	28.0	32.3	36.6	26.5	30.6	34.7	24.9	28.7	32.5
	62		TC	35.9	35.9	40.5	34.2	34.2	39.4	32.4	32.4	38.1	30.6	30.6	36.1	28.7	28.7	33.9	
			SHC	28.6	34.5	40.5	27.7	33.6	39.4	26.6	32.4	38.1	25.2	30.6	36.1	23.6	28.7	33.9	
	67		TC	39.3	39.3	39.3	37.3	37.3	37.3	35.2	35.2	35.2	32.9	32.9	32.9	30.5	30.5	31.6	
			SHC	23.1	29.1	35.2	22.3	28.3	34.4	21.4	27.5	33.5	20.5	26.6	32.6	19.5	25.6	31.6	
	72	TC	42.9	42.9	42.9	40.8	40.8	40.8	38.5	38.5	38.5	36.1	36.1	36.1	33.4	33.4	33.4		
		SHC	17.3	23.4	29.5	16.6	22.6	28.7	15.7	21.8	27.9	14.8	20.9	27.0	13.9	19.9	26.0		
	76	TC	–	45.9	45.9	–	43.7	43.7	–	41.3	41.3	–	38.7	38.7	–	35.9	35.9		
		SHC	–	18.8	25.1	–	18.0	24.3	–	17.2	23.4	–	16.3	22.5	–	15.4	21.5		
	1350 Cfm	EA (wb)	58	TC	36.6	36.6	41.5	35.1	35.1	39.7	33.4	33.4	37.9	31.6	31.6	35.8	29.6	29.6	33.6
				SHC	31.7	36.6	41.5	30.4	35.1	39.7	28.9	33.4	37.9	27.4	31.6	35.8	25.7	29.6	33.6
62			TC	36.7	36.7	43.2	35.1	35.1	41.3	33.4	33.4	39.4	31.6	31.6	37.3	29.6	29.6	34.9	
			SHC	30.2	36.7	43.2	28.8	35.1	41.3	27.5	33.4	39.4	26.0	31.6	37.3	24.4	29.6	34.9	
67			TC	39.9	39.9	39.9	37.9	37.9	37.9	35.8	35.8	35.9	33.4	33.4	34.9	30.9	30.9	33.9	
			SHC	24.2	30.9	37.6	23.4	30.1	36.8	22.5	29.2	35.9	21.6	28.3	34.9	20.6	27.2	33.9	
72		TC	43.6	43.6	43.6	41.4	41.4	41.4	39.1	39.1	39.1	36.6	36.6	36.6	33.9	33.9	33.9		
		SHC	17.8	24.5	31.3	17.0	23.7	30.5	16.1	22.9	29.6	15.2	22.0	28.7	14.3	21.0	27.7		
76		TC	–	46.7	46.7	–	44.4	44.4	–	41.9	41.9	–	39.2	39.2	–	36.3	36.3		
		SHC	–	19.4	26.3	–	18.6	25.5	–	17.8	24.6	–	16.9	23.7	–	15.9	22.7		
1500 Cfm		EA (wb)	58	TC	37.7	37.7	42.7	36.1	36.1	40.9	34.3	34.3	38.9	32.5	32.5	36.8	30.4	30.4	34.4
				SHC	32.6	37.7	42.7	31.3	36.1	40.9	29.8	34.3	38.9	28.1	32.5	36.8	26.3	30.4	34.4
	62		TC	37.7	37.7	44.4	36.1	36.1	42.5	34.4	34.4	40.5	32.5	32.5	38.3	30.4	30.4	35.8	
			SHC	31.0	37.7	44.4	29.7	36.1	42.5	28.3	34.4	40.5	26.7	32.5	38.3	25.0	30.4	35.8	
	67		TC	40.5	40.5	40.5	38.4	38.4	39.1	36.2	36.2	38.2	33.8	33.8	37.2	31.2	31.2	36.1	
			SHC	25.2	32.6	40.0	24.4	31.7	39.1	23.5	30.8	38.2	22.5	29.9	37.2	21.5	28.8	36.1	
	72	TC	44.2	44.2	44.2	41.9	41.9	41.9	39.6	39.6	39.6	37.0	37.0	37.0	34.2	34.2	34.2		
		SHC	18.2	25.6	33.0	17.4	24.8	32.2	16.5	23.9	31.3	15.6	23.0	30.4	14.7	22.0	29.4		
	76	TC	–	47.2	47.2	–	44.9	44.9	–	42.3	42.3	–	39.6	39.6	–	36.7	36.7		
		SHC	–	19.9	27.5	–	19.1	26.7	–	18.3	25.8	–	17.4	24.9	–	16.4	23.9		

LEGEND:

- Do not operate
- Cfm – Cubic feet per minute (supply air)
- EAT(db) – Entering air temperature (dry bulb)
- EAT(wb) – Entering air temperature (wet bulb)
- SHC – Sensible heat capacity
- TC – Total capacity

Table 8 (cont.) – COOLING CAPACITIES

1-STAGE COOLING

RAH036 (3 TONS) – UNIT WITH HOT GAS REHEAT SYSTEM IN SUBCOOLING MODE										
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR – CFM								
		900 / 0.01			1200 / 0.02			1500 / 0.04		
		Air Entering Evaporator – Ewb (F)								
		72	67	62	72	67	62	72	67	62
75	TC	44.6	40.3	36.5	47.0	43.0	39.1	48.8	44.3	40.8
	SHC	19.8	24.5	29.3	22.6	29.1	35.3	25.4	33.0	40.4
	kW	2.02	1.97	1.93	1.96	2.00	2.05	2.08	2.02	1.98
85	TC	42.1	38.1	34.4	44.6	40.5	36.9	46.1	41.9	38.6
	SHC	17.5	22.5	27.4	20.4	26.8	33.2	22.9	30.8	38.2
	kW	2.28	2.23	2.19	2.22	2.26	2.31	2.33	2.28	2.24
95	TC	39.6	35.8	32.3	41.9	38.0	34.5	43.2	39.3	36.2
	SHC	15.2	20.3	25.5	17.8	24.5	31.1	20.2	28.4	35.9
	kW	2.56	2.51	2.47	2.50	2.54	2.60	2.62	2.56	2.52
105	TC	36.8	33.2	30.0	38.9	35.3	32.0	40.2	36.5	33.6
	SHC	12.7	18.1	23.4	15.1	22.0	28.8	17.5	25.8	33.6
	kW	2.88	2.83	2.79	2.82	2.86	2.91	2.93	2.88	2.84
115	TC	33.9	30.5	27.5	35.8	32.4	29.4	37.0	33.5	30.9
	SHC	10.1	15.7	21.2	12.3	19.5	26.4	14.5	23.1	30.9
	kW	3.23	3.19	3.15	3.17	3.21	3.26	3.28	3.23	3.19
125	TC	30.8	27.7	24.9	32.5	29.3	26.5	33.5	30.3	27.9
	SHC	7.3	13.1	18.9	9.4	16.7	23.9	11.4	20.3	27.9
	kW	3.62	3.59	3.56	3.57	3.60	3.65	3.66	3.62	3.59

RAH036 (3 TONS) – UNIT WITH HOT GAS REHEAT SYSTEM IN HOT GAS REHEAT MODE										
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR - Ewb (F)								
		75 Dry Bulb			75 Dry Bulb			75 Dry Bulb		
		62.5 Wet Bulb			64 Wet Bulb			65.3 Wet Bulb		
		(50% Relative)			(56% Relative)			(60% Relative)		
		Air Entering Evaporator - Cfm								
900	1200	1500	900	1200	1500	900	1200	1500		
80	TC	16.46	17.15	17.74	16.66	17.23	17.79	16.85	17.74	18.29
	SHC	5.10	6.60	8.15	3.21	4.33	5.61	1.59	2.75	3.83
	kW	1.94	2.01	2.02	2.04	2.13	2.15	2.12	2.14	2.16
75	TC	16.61	17.52	18.09	17.18	18.09	18.67	17.69	18.61	19.19
	SHC	5.24	6.96	8.48	3.71	5.15	6.45	2.40	3.59	4.69
	kW	1.98	2.00	2.01	1.99	2.01	2.02	2.00	2.02	2.03
70	TC	17.00	18.06	18.63	17.56	18.46	19.40	18.41	19.35	20.10
	SHC	5.62	7.47	9.00	4.08	5.50	7.16	3.09	4.31	5.58
	kW	1.96	1.94	1.96	1.97	2.00	1.94	1.91	1.94	1.92
60	TC	17.63	18.49	19.37	18.17	19.38	19.95	18.66	19.52	20.46
	SHC	6.21	7.89	9.71	4.66	6.39	7.68	3.31	4.45	5.90
	kW	1.93	1.96	1.92	1.95	1.92	1.94	1.97	2.00	1.96
50	TC	17.82	18.59	19.72	18.31	19.73	20.26	18.76	20.21	20.73
	SHC	6.40	7.99	10.05	4.79	6.71	7.97	3.40	5.11	6.16
	kW	1.98	2.03	1.94	2.01	1.94	1.97	2.03	1.96	1.99
40	TC	17.70	19.38	19.85	19.10	20.30	20.34	19.53	20.76	21.26
	SHC	6.30	8.74	10.17	5.54	7.26	8.05	4.13	5.64	6.67
	kW	2.07	1.95	1.99	1.93	1.91	2.02	1.96	1.94	1.97

LEGEND

- Edb** – Entering Dry–Bulb
- Ewb** – Entering Wet–Bulb
- kW** – Compressor Motor Power Input
- ldb** – Leaving Dry–Bulb
- lwb** – Leaving Wet–Bulb
- SHC** – Sensible Heat Capacity (1000 Btuh) Gross
- TC** – Total Capacity (1000 Btuh) Gross

NOTES:

- 1. Direct interpolation is permissible. Do not extrapolate.
- 1. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{lwb} = Wet–bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 9 (cont.) – COOLING CAPACITIES

1-STAGE COOLING

RAH048 (4 TONS) – UNIT WITH HOT GAS REHEAT IN SUBCOOLING MODE										
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR – CFM								
		1200 / 0.04			1600 / 0.07			2000 / 0.10		
		Air Entering Evaporator – Ewb (F)								
		72	67	62	72	67	62	72	67	62
75	TC	57.8	52.3	47.2	61.5	55.6	50.6	63.7	57.9	0.0
	SHC	24.2	30.5	36.8	27.9	35.9	44.0	31.2	40.9	0.0
	kW	2.50	2.47	2.44	2.46	2.48	2.51	2.53	2.50	0.00
85	TC	54.1	48.9	44.1	57.1	52.0	47.3	59.6	54.0	49.5
	SHC	20.7	27.3	33.9	23.9	32.6	41.0	27.3	37.3	47.1
	kW	2.81	2.78	2.76	2.78	2.80	2.82	2.84	2.81	2.79
95	TC	50.1	45.3	40.8	53.3	48.2	43.7	55.2	50.1	45.8
	SHC	17.0	24.0	30.9	20.4	29.1	37.7	23.3	33.6	43.6
	kW	3.16	3.14	3.12	3.13	3.15	3.18	3.19	3.16	3.14
105	TC	45.7	41.1	37.2	48.6	43.8	39.8	50.5	45.5	41.8
	SHC	12.9	20.1	27.6	16.0	25.0	34.1	19.0	29.4	39.9
	kW	3.56	3.54	3.52	3.54	3.55	3.58	3.59	3.56	3.55
115	TC	41.1	37.0	33.2	43.5	39.2	35.5	45.4	41.1	37.5
	SHC	8.7	16.4	23.9	11.3	20.7	30.1	14.3	25.4	35.8
	kW	4.02	4.01	4.00	4.00	4.01	4.03	4.04	4.03	4.01
125	TC	36.3	32.5	29.0	38.6	34.7	31.2	40.2	36.1	32.9
	SHC	4.3	12.2	20.1	6.8	16.6	26.2	9.4	20.8	31.5
	kW	4.54	4.53	4.53	4.53	4.54	4.54	4.55	4.54	4.54

RAH048 (4 TONS) – UNIT WITH HOT GAS REHEAT SYSTEM IN HOT GAS REHEAT MODE										
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb			75 Dry Bulb			75 Dry Bulb		
		62.5 Wet Bulb			64 Wet Bulb			65.3 Wet Bulb		
		(50% Relative)			(56% Relative)			(60% Relative)		
		Air Entering Evaporator – Cfm								
1200	1600	2000	1200	1600	2000	1200	1600	2000		
80	TC	18.64	19.95	20.78	19.35	20.71	21.51	20.00	21.37	22.33
	SHC	0.78	4.36	8.24	-1.95	1.01	4.29	-4.33	-1.91	0.99
	kW	2.66	2.68	2.69	2.67	2.69	2.69	2.68	2.69	2.68
75	TC	19.37	21.21	22.15	20.47	21.97	22.92	21.15	22.78	23.65
	SHC	1.48	5.52	9.49	-0.91	2.18	5.57	-3.26	-0.61	2.20
	kW	2.62	2.54	2.54	2.56	2.55	2.55	2.56	2.55	2.56
70	TC	19.92	21.63	22.64	20.77	22.52	23.61	21.70	23.39	24.26
	SHC	2.01	5.94	9.98	-0.61	2.70	6.23	-2.72	-0.02	2.78
	kW	2.60	2.56	2.54	2.58	2.54	2.53	2.54	2.52	2.54
60	TC	20.11	21.27	22.23	20.75	23.15	23.43	22.49	23.78	24.55
	SHC	2.24	5.70	9.70	-0.57	3.35	6.15	-1.95	0.40	3.13
	kW	2.69	2.74	2.73	2.72	2.58	2.68	2.56	2.60	2.63
50	TC	21.56	22.70	23.37	22.18	23.33	24.01	22.75	23.90	25.40
	SHC	3.61	7.03	10.76	0.78	3.57	6.73	-1.67	0.57	3.96
	kW	2.57	2.63	2.66	2.60	2.66	2.69	2.63	2.69	2.62
40	TC	21.67	23.23	24.04	22.76	23.82	25.57	23.28	24.34	26.13
	SHC	3.74	7.56	9.89	1.35	4.06	8.17	-1.15	1.01	4.67
	kW	2.64	2.64	2.69	2.61	2.67	2.58	2.64	2.70	2.61

LEGEND

- Edb** – Entering Dry–Bulb
- Ewb** – Entering Wet–Bulb
- kW** – Compressor Motor Power Input
- ldb** – Leaving Dry–Bulb
- lwb** – Leaving Wet–Bulb
- SHC** – Sensible Heat Capacity (1000 Btuh) Gross
- TC** – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
1. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{lwb} = Wet–bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 10 (cont.) – COOLING CAPACITIES

1-STAGE COOLING

RAH060 (5 TONS) – UNIT WITH HOT GAS REHEAT IN SUBCOOLING MODE										
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR – CFM								
		1500 / 0.01			2000 / 0.02			2500 / 0.03		
		Air Entering Evaporator – Ewb (F)								
		72	67	62	72	67	62	72	67	62
75	TC	66.9	60.3	54.8	71.0	64.4	58.6	73.5	66.9	61.6
	SHC	25.8	34.1	43.0	30.5	41.7	52.6	35.0	48.6	61.2
	kW	3.11	3.06	3.03	3.05	3.09	3.16	3.16	3.11	3.07
85	TC	62.4	56.5	51.2	66.3	60.1	54.7	68.2	62.3	57.5
	SHC	21.5	30.6	39.6	26.1	37.6	49.0	29.9	44.2	57.2
	kW	3.47	3.43	3.39	3.42	3.46	3.51	3.52	3.48	3.44
95	TC	57.8	52.3	47.3	61.3	55.6	50.6	63.5	57.7	53.2
	SHC	17.2	26.6	35.9	21.4	33.3	45.1	25.6	39.9	53.2
	kW	3.89	3.85	3.80	3.83	3.88	3.93	3.95	3.90	3.86
105	TC	52.8	47.5	42.9	55.4	50.0	45.3	58.0	52.2	47.9
	SHC	12.5	22.1	31.7	15.8	28.1	40.1	20.4	34.7	47.9
	kW	4.36	4.31	4.26	4.29	4.33	4.38	4.42	4.36	4.32
115	TC	47.4	42.8	38.6	50.1	45.2	41.1	51.8	47.1	43.4
	SHC	7.4	17.7	27.8	11.0	23.6	36.1	14.7	30.0	43.4
	kW	4.88	4.83	4.78	4.81	4.86	4.91	4.93	4.88	4.84
125	TC	41.6	37.5	33.8	44.0	39.7	35.8	45.8	41.3	38.0
	SHC	2.1	12.8	23.3	5.3	18.6	31.2	9.1	24.7	38.0
	kW	5.44	5.39	5.35	5.37	5.42	5.47	5.49	5.44	5.40

RAH060 (5 TONS) – UNIT WITH HOT GAS REHEAT SYSTEM IN HOT GAS REHEAT MODE										
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb			75 Dry Bulb			75 Dry Bulb		
		62.5 Wet Bulb			64 Wet Bulb			65.3 Wet Bulb		
		(50% Relative)			(56% Relative)			(60% Relative)		
		Air Entering Evaporator – Cfm								
1500	2000	2500	1500	2000	2500	1500	2000	2500		
80	TC	25.29	27.61	28.72	26.81	28.62	29.71	27.68	29.53	30.63
	SHC	5.06	10.68	15.86	2.37	6.73	11.22	-0.40	3.30	7.17
	kW	3.23	3.12	3.13	3.12	3.13	3.14	3.12	3.14	3.15
75	TC	26.69	28.45	29.73	27.65	29.64	30.73	28.53	30.55	31.65
	SHC	6.39	11.52	16.85	3.20	7.72	12.20	0.43	4.29	8.16
	kW	3.08	3.11	3.09	3.10	3.09	3.11	3.11	3.10	3.12
70	TC	27.04	29.08	30.15	28.29	30.04	31.09	29.13	30.91	31.97
	SHC	6.76	12.14	17.28	3.82	8.14	12.60	1.02	4.67	8.51
	kW	3.15	3.12	3.15	3.11	3.14	3.17	3.13	3.16	3.18
60	TC	27.99	29.57	31.33	28.86	30.46	32.25	29.63	32.44	33.81
	SHC	7.70	12.66	18.45	4.41	8.60	13.74	1.54	6.16	10.28
	kW	3.17	3.23	3.15	3.21	3.26	3.18	3.23	3.12	3.10
50	TC	30.09	31.66	32.64	30.93	32.57	33.53	31.73	33.38	34.35
	SHC	9.72	14.66	19.72	6.40	10.61	14.99	3.56	7.10	10.85
	kW	3.01	3.07	3.11	3.04	3.10	3.15	3.07	3.14	3.18
40	TC	28.39	30.78	32.67	31.13	32.60	34.40	31.86	33.33	36.07
	SHC	8.17	13.89	19.80	6.63	10.69	15.85	3.72	7.10	12.51
	kW	3.39	3.32	3.24	3.14	3.23	3.15	3.18	3.27	3.08

LEGEND

- Edb** – Entering Dry–Bulb
- Ewb** – Entering Wet–Bulb
- kW** – Compressor Motor Power Input
- ldb** – Leaving Dry–Bulb
- lwb** – Leaving Wet–Bulb
- SHC** – Sensible Heat Capacity (1000 Btuh) Gross
- TC** – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
1. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{lwb} = Wet–bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 11 (cont.) – COOLING CAPACITIES

1-STAGE COOLING

RAH072 (6 TONS) – UNIT WITH HOT GAS REHEAT SYSTEM IN SUBCOOLING MODE										
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR – CFM								
		1800 / 0.06			2400 / 0.08			3000 / 0.10		
		Air Entering Evaporator – Ewb (F)								
		72	67	62	72	67	62	72	67	62
75	TC	85.7	77.4	70.0	91.1	82.6	74.9	94.5	85.7	78.4
	SHC	38.2	47.1	56.1	43.9	55.6	67.1	49.0	63.1	76.4
	kW	4.05	4.01	3.97	4.00	4.04	4.08	4.09	4.05	4.02
85	TC	80.9	73.1	66.0	85.9	77.9	70.6	89.2	80.9	73.9
	SHC	33.5	42.9	52.3	38.8	51.1	63.0	43.9	58.6	72.1
	kW	4.46	4.43	4.39	4.42	4.45	4.48	4.51	4.47	4.43
95	TC	75.7	68.4	61.7	80.6	72.9	66.0	83.6	75.7	69.1
	SHC	28.7	38.5	48.3	33.8	46.4	58.7	38.6	53.7	67.6
	kW	4.92	4.89	4.86	4.88	4.91	4.95	4.96	4.92	4.90
105	TC	70.2	63.3	57.0	74.7	67.5	61.1	77.5	70.1	64.0
	SHC	23.6	33.9	44.1	28.4	41.4	54.2	32.9	48.6	62.7
	kW	5.43	5.40	5.37	5.39	5.42	5.45	5.47	5.43	5.41
115	TC	64.3	57.8	52.0	68.4	61.7	55.7	71.0	64.1	58.3
	SHC	18.2	28.9	39.6	22.7	36.2	49.4	27.0	43.1	58.2
	kW	5.99	5.96	5.93	5.95	5.98	6.01	6.02	5.99	5.97
125	TC	57.9	52.0	46.6	61.6	55.4	49.9	64.0	57.5	52.4
	SHC	12.4	23.8	34.9	16.6	30.7	44.3	20.7	37.3	52.4
	kW	6.59	6.57	6.55	6.56	6.59	6.61	6.62	6.60	6.58

RAH072 (6 TONS) – UNIT WITH HOT GAS REHEAT SYSTEM IN HOT GAS REHEAT MODE										
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb			75 Dry Bulb			75 Dry Bulb		
		62.5 Wet Bulb			64 Wet Bulb			65.3 Wet Bulb		
		(50% Relative)			(56% Relative)			(60% Relative)		
		Air Entering Evaporator – Cfm								
1800	2400	3000	1800	2400	3000	1800	2400	3000		
80	TC	24.17	25.88	26.92	25.35	27.08	28.15	26.39	28.18	29.25
	SHC	-1.44	2.99	7.86	-5.08	-1.55	2.50	-8.25	-5.47	-2.14
	kW	4.15	4.16	4.17	4.17	4.18	4.18	4.18	4.19	4.20
75	TC	26.03	27.87	28.95	27.27	29.11	30.21	28.36	30.24	31.35
	SHC	0.43	4.97	9.86	-3.12	0.49	4.56	-6.19	-3.36	-0.03
	kW	3.96	3.97	3.98	3.98	3.99	4.00	4.00	4.01	4.01
70	TC	26.50	28.76	30.07	27.92	29.99	31.34	29.45	31.67	33.23
	SHC	0.87	5.84	10.97	-2.49	1.35	5.68	-5.06	-1.85	1.94
	kW	3.97	3.93	3.91	3.96	3.95	3.93	3.92	3.89	3.87
60	TC	27.59	29.22	30.17	28.70	30.33	31.30	31.50	31.32	32.91
	SHC	1.91	6.25	11.02	-1.79	1.63	5.57	-3.31	-2.39	1.45
	kW	3.95	3.99	4.01	3.99	4.02	4.04	4.09	4.05	4.01
50	TC	27.77	29.18	30.03	28.75	30.18	32.02	29.63	32.07	32.96
	SHC	2.03	6.18	10.85	-1.80	1.43	6.25	-5.14	-1.69	1.45
	kW	4.03	4.08	4.11	4.07	4.12	4.05	4.12	4.06	4.09
40	TC	29.02	30.38	31.46	29.96	31.32	32.09	30.79	33.49	34.34
	SHC	3.26	7.34	10.07	-0.63	2.54	6.29	-4.01	-0.30	2.80
	kW	3.96	4.02	4.08	4.01	4.08	4.11	4.06	4.00	4.03

LEGEND

- Edb** – Entering Dry–Bulb
- Ewb** – Entering Wet–Bulb
- kW** – Compressor Motor Power Input
- ldb** – Leaving Dry–Bulb
- lwb** – Leaving Wet–Bulb
- SHC** – Sensible Heat Capacity (1000 Btuh) Gross
- TC** – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
1. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{lwb} = Wet–bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 12 (cont.) – COOLING CAPACITIES

2-STAGE COOLING

RAH090 (7.5 TONS) – UNIT WITH HOT GAS REHEAT SYSTEM IS SUBCOOLING MODE										
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR – CFM								
		2250 / 0.03			3000 / 0.04			3750 / 0.06		
		Air Entering Evaporator – Ewb (F)								
		72	67	62	72	67	62	72	67	62
75	TC	101.9	92.9	84.0	109.6	96.3	89.9	113.6	103.0	94.5
	SHC	43.9	54.6	66.7	50.2	62.7	80.9	56.8	75.8	93.0
	kW	4.60	4.54	4.48	4.65	4.50	4.52	4.68	4.60	4.55
85	TC	96.6	87.3	78.9	102.8	92.9	84.5	106.5	96.7	88.7
	SHC	36.8	49.3	61.9	43.8	59.7	75.9	50.2	69.8	87.4
	kW	5.15	5.09	5.04	5.20	5.13	5.08	5.22	5.16	5.11
95	TC	90.2	81.4	73.5	95.7	86.8	78.8	99.4	90.1	82.7
	SHC	30.8	43.9	56.9	37.2	54.1	70.5	43.6	63.8	81.6
	kW	5.78	5.72	5.67	5.82	5.76	5.71	5.85	5.79	5.74
105	TC	83.5	75.2	67.8	88.8	80.2	72.7	92.0	83.2	76.4
	SHC	24.6	38.2	51.7	30.8	48.0	64.9	36.7	57.4	75.5
	kW	6.50	6.45	6.40	6.54	6.48	6.43	6.57	6.50	6.46
115	TC	76.3	68.7	61.8	81.1	73.2	66.3	84.1	76.0	69.7
	SHC	17.9	32.1	46.2	23.7	41.5	59.0	29.4	50.7	69.0
	kW	7.32	7.28	7.24	7.35	7.31	7.27	7.38	7.32	7.29
125	TC	68.6	61.6	55.4	73.0	65.7	59.3	75.8	68.2	62.6
	SHC	10.9	25.6	40.3	16.2	34.7	52.6	21.7	43.6	62.1
	kW	8.24	8.22	8.20	8.27	8.23	8.21	8.29	8.25	8.22

RAH090 (7.5 TONS) – UNIT WITH HOT GAS REHEAT SYSTEM IN HOT GAS REHEAT MODE										
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb			75 Dry Bulb			75 Dry Bulb		
		62.5 Wet Bulb			64 Wet Bulb			65.3 Wet Bulb		
		(50% Relative)			(56% Relative)			(60% Relative)		
		Air Entering Evaporator – Cfm								
2250	3000	3750	2250	3000	3750	2250	3000	3750		
80	TC	24.06	26.14	27.48	25.50	27.56	28.78	26.59	28.71	29.96
	SHC	-5.55	1.16	8.38	-10.20	-4.69	1.40	-14.39	-9.85	-4.68
	kW	4.43	4.42	4.41	4.40	4.41	4.42	4.42	4.43	4.44
75	TC	24.87	27.26	28.47	26.06	28.53	30.02	27.67	29.77	31.02
	SHC	-4.77	2.23	9.32	-9.65	-3.76	2.59	-13.35	-8.83	-3.66
	kW	4.42	4.36	4.38	4.45	4.38	4.36	4.36	4.39	4.40
70	TC	25.16	27.88	28.56	26.72	29.10	30.26	28.17	30.20	31.83
	SHC	-4.48	2.84	9.45	-9.02	-3.19	2.85	-12.88	-8.40	-2.87
	kW	4.49	4.38	4.48	4.44	4.41	4.44	4.40	4.44	4.40
60	TC	26.43	28.14	29.14	27.49	29.24	30.27	28.50	30.24	32.33
	SHC	-3.25	3.14	10.05	-8.26	-2.99	2.94	-12.54	-8.29	-2.32
	kW	4.48	4.55	4.59	4.53	4.60	4.65	4.58	4.65	4.54
50	TC	27.19	29.55	31.26	28.94	30.59	32.36	30.54	31.54	32.52
	SHC	-2.50	4.50	12.05	-6.87	-1.69	4.92	-10.60	-7.02	-2.07
	kW	4.53	4.51	4.46	4.48	4.57	4.52	4.43	4.63	4.70
40	TC	27.92	31.58	32.82	28.81	32.60	33.54	31.82	33.50	34.44
	SHC	-1.79	6.42	10.84	-6.94	0.23	6.05	-9.36	-5.15	-0.25
	kW	4.57	4.37	4.46	4.65	4.45	4.51	4.40	4.51	4.58

LEGEND

- Edb – Entering Dry–Bulb
- Ewb – Entering Wet–Bulb
- kW – Compressor Motor Power Input
- ldb – Leaving Dry–Bulb
- lwb – Leaving Wet–Bulb
- SHC – Sensible Heat Capacity (1000 Btuh) Gross
- TC – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
1. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{lwb} = Wet–bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 13 (cont.) – COOLING CAPACITIES

2-STAGE COOLING

RAH102 (8.5 TONS) – UNIT WITH HOT GAS REHEAT SYSTEM IN SUBCOOLING MODE										
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR – CFM								
		2550 / 0.04			3400 / 0.06			4250 / 0.08		
		Air Entering Evaporator – Ewb (F)								
		72	67	62	72	67	62	72	67	62
75	TC	114.7	103.9	93.9	104.3	110.6	100.5	122.9	114.6	105.5
	SHC	48.7	62.2	75.7	84.7	74.2	91.4	60.6	85.1	103.9
	kW	5.17	5.09	5.01	5.10	5.14	5.07	5.20	5.18	5.11
85	TC	107.8	97.4	88.0	114.2	102.9	94.2	116.2	107.6	98.7
	SHC	42.3	56.3	70.3	49.7	67.0	85.6	61.1	78.7	97.3
	kW	5.79	5.71	5.63	5.85	5.75	5.69	5.88	5.80	5.72
95	TC	100.5	90.8	82.0	106.6	96.2	87.7	110.2	100.1	92.2
	SHC	35.6	50.2	64.8	42.8	61.0	79.6	49.2	71.9	91.0
	kW	6.50	6.42	6.34	6.56	6.46	6.40	6.59	6.50	6.44
105	TC	92.7	83.8	75.7	98.5	89.0	80.9	102.1	92.4	85.1
	SHC	28.5	43.9	59.1	35.4	54.6	73.4	41.9	64.9	84.2
	kW	7.30	7.23	7.16	7.36	7.28	7.21	7.40	7.31	7.25
115	TC	85.0	76.5	69.0	90.0	81.3	73.8	93.3	84.4	77.7
	SHC	21.5	37.4	53.1	27.7	47.6	66.9	34.0	57.7	77.0
	kW	8.23	8.16	8.10	8.27	8.20	8.14	8.31	8.23	8.18
125	TC	76.5	68.8	61.8	81.1	72.9	66.2	84.1	75.8	69.8
	SHC	13.8	30.4	46.7	19.7	40.0	60.1	25.6	50.0	69.8
	kW	9.25	9.20	9.16	9.28	9.22	9.19	9.31	9.25	9.21

RAH102 (8.5 TONS) – UNIT WITH HOT GAS REHEAT SYSTEM IN HOT GAS REHEAT MODE											
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)									
		75 Dry Bulb			75 Dry Bulb			75 Dry Bulb			
		62.5 Wet Bulb			64 Wet Bulb			65.3 Wet Bulb			
		(50% Relative)			(56% Relative)			(60% Relative)			
		Air Entering Evaporator – Cfm									
2550	3400	4250	2550	3400	4250	2550	3400	4250	2550	3400	4250
80	TC	27.53	29.56	30.72	28.95	31.03	32.22	30.26	32.33	33.58	
	SHC	-3.84	3.82	11.92	-9.25	-2.92	4.09	-13.93	-8.77	-2.82	
	kW	5.09	5.11	5.13	5.11	5.14	5.15	5.14	5.15	5.17	
75	TC	29.09	31.60	32.81	30.77	33.10	34.33	32.30	34.45	35.73	
	SHC	-2.34	5.72	13.84	-7.51	-0.98	6.04	-11.95	-6.78	-0.82	
	kW	4.97	4.91	4.93	4.95	4.94	4.95	4.94	4.96	4.97	
70	TC	29.58	32.45	33.63	31.48	34.12	35.55	33.12	35.65	37.38	
	SHC	-1.88	6.54	14.63	-6.83	0.00	7.20	-11.16	-5.63	0.75	
	kW	4.99	4.90	4.92	4.96	4.90	4.89	4.93	4.90	4.86	
60	TC	30.71	33.44	34.52	32.90	34.79	35.86	34.07	36.02	37.09	
	SHC	-0.78	7.52	15.54	-5.47	0.68	7.57	-10.28	-5.24	0.55	
	kW	5.03	4.95	5.00	4.94	5.01	5.05	4.99	5.06	5.09	
50	TC	32.63	34.31	35.26	33.81	35.53	36.51	34.90	36.66	37.65	
	SHC	1.05	8.38	16.29	-4.60	1.42	8.24	-9.49	-4.59	1.14	
	kW	4.92	5.01	5.06	4.99	5.07	5.13	5.05	5.14	5.19	
40	TC	31.94	33.26	35.77	32.96	35.70	37.86	35.17	38.01	38.92	
	SHC	0.45	7.47	13.75	-5.35	1.63	9.52	-9.20	-3.29	2.36	
	kW	5.16	5.27	5.20	5.25	5.19	5.10	5.16	5.11	5.17	

LEGEND

- Edb** – Entering Dry–Bulb
- Ewb** – Entering Wet–Bulb
- kW** – Compressor Motor Power Input
- ldb** – Leaving Dry–Bulb
- lwb** – Leaving Wet–Bulb
- SHC** – Sensible Heat Capacity (1000 Btuh) Gross
- TC** – Total Capacity (1000 Btuh) Gross

NOTES:

- 1.Direct interpolation is permissible. Do not extrapolate.
- 1.The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{lwb} = Wet–bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 16 (cont.) – COOLING CAPACITIES

2-STAGE COOLING

RAH150 (12.5 TONS) – UNIT WITH HOT GAS REHEAT SYSTEM IN SUBCOOLING MODE										
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR – CFM								
		3750/0.02			5000/0.04			6250/0.05		
		Air Entering Evaporator – Ewb (F)								
		72	67	62	72	67	62	72	67	62
75	TC	162.0	147.4	132.8	185.6	167.2	148.8	209.5	187.2	164.9
	SHC	85.0	101.4	117.4	96.9	113.0	129.0	106.5	122.4	138.4
	kW	7.70	7.60	7.30	7.90	7.70	7.40	8.10	7.80	7.50
85	TC	154.8	140.9	127.0	171.7	154.4	137.1	188.8	168.0	147.2
	SHC	70.2	90.4	110.6	83.1	103.2	123.2	93.4	113.4	133.3
	kW	8.80	8.70	8.30	8.90	8.70	8.40	9.10	8.80	8.50
95	TC	147.5	134.4	121.2	157.8	141.6	125.4	168.1	148.8	129.6
	SHC	55.5	79.7	103.9	69.3	93.4	117.5	80.4	104.3	128.3
	kW	9.80	9.70	9.30	9.90	9.70	9.50	10.10	9.80	9.60
105	TC	140.3	127.8	115.4	143.8	128.7	113.7	147.4	129.7	111.9
	SHC	40.9	69.0	97.2	55.5	83.6	111.7	67.3	95.3	111.9
	kW	10.80	10.70	10.30	10.90	10.70	10.50	11.10	10.80	10.60
115	TC	133.0	121.3	109.5	129.9	115.9	101.9	126.7	110.5	94.2
	SHC	26.2	58.3	90.4	41.8	73.8	101.9	54.2	86.2	94.2
	kW	11.80	11.70	11.40	11.90	11.70	11.60	12.10	11.80	11.70
125	TC	125.8	114.7	103.7	115.9	103.1	90.2	106.0	91.3	76.6
	SHC	11.5	47.6	83.7	28.0	64.0	90.2	41.2	77.2	76.6
	kW	12.80	12.70	12.40	12.90	12.70	12.60	13.10	12.80	12.70

RAH150 (12.5 TONS) – UNIT WITH HOT GAS REHEAT SYSTEM IN HOT GAS REHEAT MODE										
Temp (F) Air Ent Condenser (Edb)		AIR ENTERING EVAPORATOR – Ewb (F)								
		75 Dry Bulb			75 Dry Bulb			75 Dry Bulb		
		62.5 Wet Bulb			64 Wet Bulb			65.3 Wet Bulb		
		(50% Relative)			(56% Relative)			(60% Relative)		
		Air Entering Evaporator – Cfm								
3750	5000	6250	3750	5000	6250	3750	5000	6250		
80	TC	57.70	60.00	66.40	60.20	66.80	69.50	64.30	69.10	72.30
	SHC	21.30	27.00	44.00	12.80	22.40	32.50	8.60	16.20	25.50
	kW	8.08	8.15	8.23	8.28	8.34	8.37	8.36	8.43	8.52
75	TC	59.00	61.20	67.90	61.40	68.10	71.00	65.80	70.70	73.70
	SHC	22.40	28.10	44.80	13.50	23.50	33.70	9.30	17.10	26.30
	kW	8.06	8.13	8.21	8.25	8.31	8.34	8.33	8.40	8.49
70	TC	60.40	62.90	69.20	63.10	69.40	72.50	67.00	72.00	75.00
	SHC	23.20	28.90	46.00	14.50	24.30	34.40	10.30	17.90	27.40
	kW	8.04	8.11	8.18	8.23	8.29	8.32	8.31	8.38	8.47
60	TC	63.40	65.70	72.00	65.90	72.30	75.20	70.00	74.80	77.80
	SHC	24.80	30.50	47.80	16.10	25.90	36.00	11.90	19.60	29.00
	kW	8.00	8.07	8.15	8.20	8.25	8.29	8.28	8.35	8.44
50	TC	66.20	68.60	74.30	68.80	74.60	78.20	72.80	77.80	80.70
	SHC	26.60	32.30	49.40	17.70	27.70	37.80	13.50	21.20	30.60
	kW	7.94	8.01	8.08	8.13	8.20	8.23	8.22	8.29	8.38
40	TC	69.10	71.60	77.80	71.80	78.00	81.00	75.70	80.60	83.70
	SHC	28.20	33.90	50.10	19.40	29.30	39.80	15.20	22.90	32.20
	kW	7.90	7.97	8.04	8.09	8.15	8.17	8.16	8.23	8.32

LEGEND

- Edb** – Entering Dry–Bulb
- Ewb** – Entering Wet–Bulb
- kW** – Compressor Motor Power Input
- ldb** – Leaving Dry–Bulb
- lwb** – Leaving Wet–Bulb
- SHC** – Sensible Heat Capacity (1000 Btuh) Gross
- TC** – Total Capacity (1000 Btuh) Gross

NOTES:

1. Direct interpolation is permissible. Do not extrapolate.
1. The following formulas may be used:

$$t_{ldb} = t_{edb} - \frac{\text{sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

t_{lwb} = Wet–bulb temperature corresponding to enthalpy of air leaving evaporator coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

Table 17 – STATIC PRESSURE ADDERS (Factory Options and/or Accessories)

Electric Heaters

3 – 5 TONS										
CFM (in. wg)	600	900	1200	1400	1600	1800	2000	2200	2400	2600
1 Electric Heater Module	0.03	0.05	0.07	0.09	0.09	0.10	0.11	0.11	0.12	0.13
2 Electric Heater Modules	0.13	0.15	0.16	0.16	0.16	0.17	0.17	0.17	0.18	0.18

6 – 10 TONS																
CFM (in. wg)	2250	2500	2750	3000	3250	3500	3750	4000	4250	4500	4750	5000	5250	5500	5750	6000
1 Electric Heater Module	0.03	0.04	0.04	0.05	0.06	0.07	0.08	0.09	0.10	0.11	0.12	0.13	0.14	0.15	0.16	0.18
2 Electric Heater Modules	0.04	0.05	0.05	0.06	0.07	0.08	0.09	0.10	0.11	0.12	0.13	0.15	0.16	0.17	0.19	0.20

12.5 TON									
CFM	3750	4063	4375	4688	5000	5313	5625	5938	6250
Vertical - 1 Electric Heater Module	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.04
Vertical - 2 Electric Heater Modules	0.03	0.04	0.04	0.05	0.05	0.06	0.06	0.07	0.08
Horizontal - 1 Electric Heater Module	0.04	0.05	0.05	0.06	0.06	0.07	0.07	0.08	0.09
Horizontal - 2 Electric Heater Modules	0.04	0.04	0.04	0.05	0.05	0.06	0.06	0.07	0.08

Hot Gas Reheat

3-6 TONS									
CFM (in. wg)	1000	1250	1500	1750	2000	2250	2500	2750	3000
3 Tons	0.04	0.052	0.07	-	-	-	-	-	-
4 Tons	-	0.106	0.138	0.172	0.21	-	-	-	-
5 Tons	-	-	0.138	0.172	0.21	0.252	0.30	-	-
6 Tons	-	-	-	0.112	0.125	0.161	0.19	0.22	0.25

7.5-12.5 TONS										
CFM (in. wg)	4000	4250	4500	4750	5000	5250	5500	5750	6000	6250
7.5 Tons	-	-	-	-	-	-	-	-	-	-
8.5 Tons	0.20	0.22	-	-	-	-	-	-	-	-
10 Tons	0.20	0.22	0.24	0.26	0.28	-	-	-	-	-
12.5 Tons	0.06	0.07	0.07	0.08	0.08	0.09	0.10	0.10	0.11	0.12

ECONOMIZER, BAROMETRIC RELIEF, AND PERFORMANCE

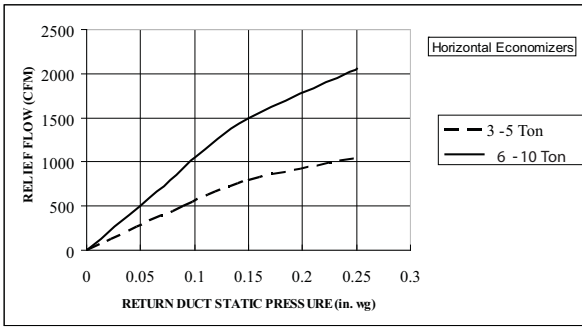


Fig. 1 Barometric Relief Flow – Horizontal 3–10 Ton

C10472

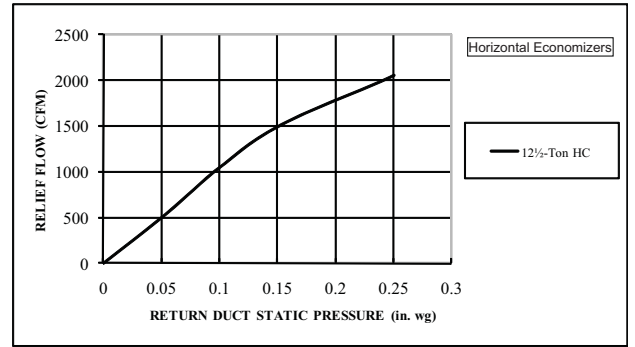


Fig. 5 Barometric Relief Flow – Horizontal 12.5 Ton

C101002

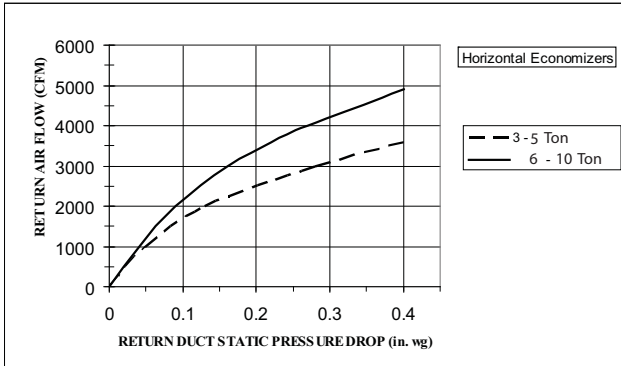


Fig. 2 Return Air Pressure Drop – Horizontal 3–10 Ton

C10474

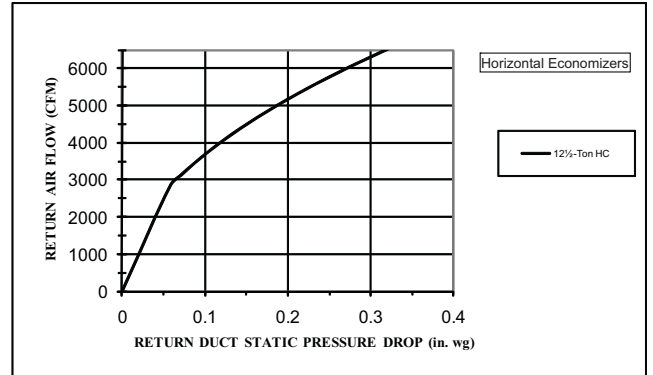


Fig. 6 Return Air Pressure Drop – Horizontal 12.5 Ton

C101003

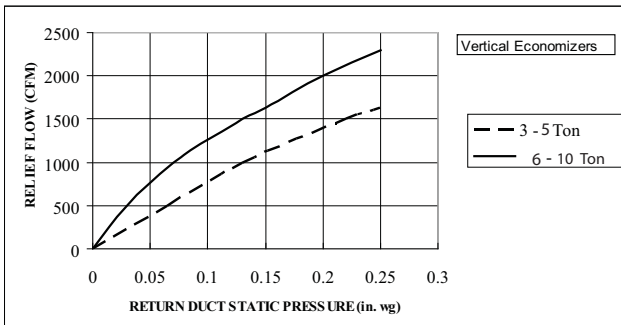


Fig. 3 Barometric Relief Flow Capacity – Vertical 3 – 10 Ton

C10475

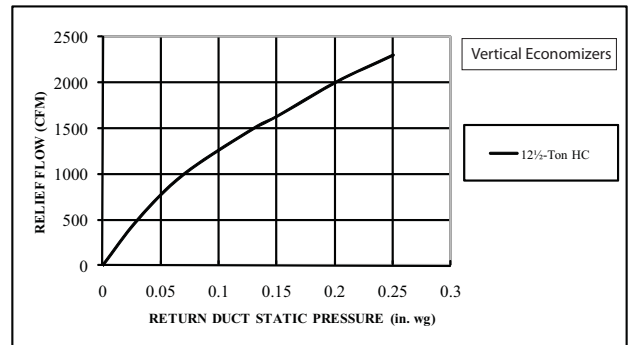


Fig. 7 Barometric Relief Flow Capacity – Vertical 12.5 Ton

C101004

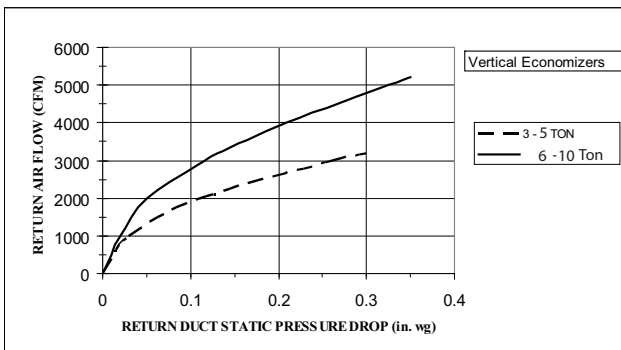


Fig. 4 Return Air Pressure Drop – Vertical 3 – 10 Ton

C10477

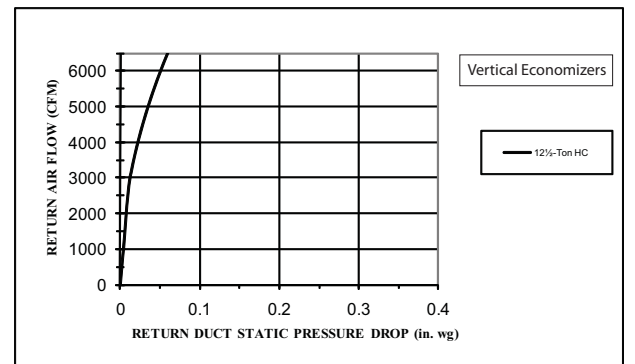


Fig. 8 Return Air Pressure Drop – Vertical 12.5 Ton

C101005

ECONOMIZER, BAROMETRIC RELIEF, AND PERFORMANCE (CONT)

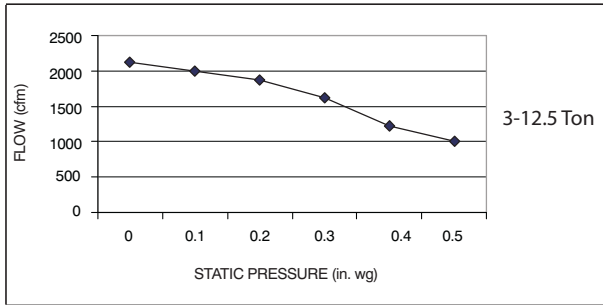


Fig 9 Horizontal Power Exhaust Performance

C10995

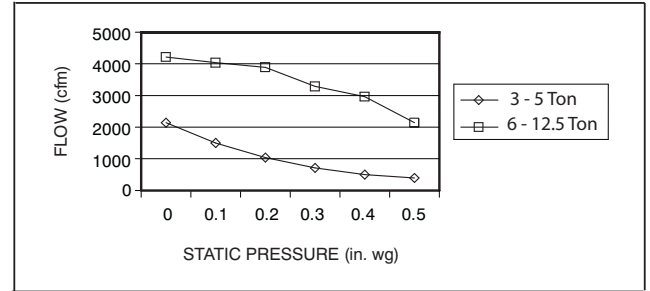


Fig. 10 Vertical Power Exhaust Performance

C10996

General fan performance notes:

1. Interpolation is permissible. Do not extrapolate.
2. External static pressure is the static pressure difference between the return duct and the supply duct plus the static pressure caused by any FIOPs or accessories.
3. Tabular data accounts for pressure loss due to clean filters, unit casing, and wet coils. Factory options and accessories may add static pressure losses, as shown in Table 17. Selection software is available, through your salesperson, to help you select the best motor/drive combination for your application.
4. The Fan Performance tables offer motor/drive recommendations. In cases when two motor/drive combinations would work, the lower horsepower options recommended.
5. For information on the electrical properties of motors, please see the Electrical information section of this book.
6. For more information on the performance limits of motors, see the application data section of this book.
7. The EPACT (Energy Policy Act of 1992) regulates energy requirements for specific types of indoor fan motors. Motors regulated by EPACT include any general purpose, T-frame (three-digit, 143 and larger), single-speed, foot mounted, polyphase, squirrel cage induction motors of NEMA (National Electrical Manufacturers Association) design A and B, manufactured for use in the United States. Ranging from 1 to 200 Hp, these continuous-duty motors operate on 230 and 460 volt, 60 Hz power. If a motor does not fit into these specifications, the motor does not have to be replaced by an EPACT compliant energy-efficient motor. Variable-speed motors are exempt from EPACT compliance requirements. Therefore, the indoor fan motors for RAH036-150 units are exempt from these requirements.

FAN PERFORMANCE

TABLE 18 – RAH036

3 PHASE NON-HOT GAS REHEAT

3 TON VERTICAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	594	0.15	740	0.25	867	0.37	981	0.52	1084	0.68
975	618	0.17	758	0.28	881	0.40	991	0.55	1092	0.71
1050	642	0.19	777	0.30	896	0.43	1003	0.58	1102	0.75
1125	668	0.22	797	0.34	912	0.47	1017	0.62	1113	0.79
1200	695	0.25	818	0.37	930	0.51	1032	0.66	1126	0.83
1275	722	0.29	841	0.41	949	0.55	1048	0.71	1140	0.88
1350	750	0.33	864	0.46	968	0.60	1065	0.76	1155	0.93
1425	778	0.37	888	0.50	989	0.65	1083	0.81	1171	0.99
1500	807	0.42	913	0.56	1011	0.71	1103	0.87	1188	1.05

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	1180	0.86	1269	1.05	1354	1.25	1434	1.47	1511	1.70
975	1186	0.89	1275	1.08	1358	1.29	1437	1.51	1513	1.74
1050	1194	0.92	1281	1.12	1363	1.32	1441	1.54	1516	1.78
1125	1204	0.97	1289	1.16	1370	1.37	1447	1.59	1520	1.82
1200	1215	1.01	1298	1.21	1378	1.42	1454	1.64	1526	1.87
1275	1227	1.06	1309	1.26	1387	1.47	1462	1.69	1533	1.92
1350	1240	1.12	1321	1.32	1397	1.53	1471	1.75	1541	1.99
1425	1254	1.18	1333	1.38	1409	1.59	1481	1.82	–	–
1500	1270	1.24	1347	1.45	1421	1.66	1492	1.89	–	–

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

Medium static 770–1175 RPM, 1.2 BHP max

High static 1035–1466 RPM, 2.4 BHP max

TABLE 19 – RAH036

3 PHASE HOT GAS REHEAT

3 TON VERTICAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	594	0.15	740	0.25	867	0.37	981	0.52	1084	0.68
975	618	0.17	758	0.28	881	0.40	991	0.55	1092	0.71
1050	642	0.19	777	0.30	896	0.43	1003	0.58	1102	0.75
1125	668	0.22	797	0.34	912	0.47	1017	0.62	1113	0.79
1200	695	0.25	818	0.37	930	0.51	1032	0.66	1126	0.83
1275	722	0.29	841	0.41	949	0.55	1048	0.71	1140	0.88
1350	750	0.33	864	0.46	968	0.60	1065	0.76	1155	0.93
1425	778	0.37	888	0.50	989	0.65	1083	0.81	1171	0.99
1500	807	0.42	913	0.56	1011	0.71	1103	0.87	1188	1.05

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	1180	0.86	1269	1.05	1354	1.25	1434	1.47	1511	1.70
975	1186	0.89	1275	1.08	1358	1.29	1437	1.51	1513	1.74
1050	1194	0.92	1281	1.12	1363	1.32	1441	1.54	1516	1.78
1125	1204	0.97	1289	1.16	1370	1.37	1447	1.59	1520	1.82
1200	1215	1.01	1298	1.21	1378	1.42	1454	1.64	1526	1.87
1275	1227	1.06	1309	1.26	1387	1.47	1462	1.69	1533	1.92
1350	1240	1.12	1321	1.32	1397	1.53	1471	1.75	1541	1.99
1425	1254	1.18	1333	1.38	1409	1.59	1481	1.82	–	–
1500	1270	1.24	1347	1.45	1421	1.66	1492	1.89	–	–

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

Standard static 560–854 RPM, 1.2 BHP max

Medium static 770–1175 RPM, 1.2 BHP max

High static 1035–1466 RPM, 2.4 BHP max

FAN PERFORMANCE (BELT DRIVE) (cont.)

TABLE 20 – RAH036

3 PHASE NON-HOT GAS REHEAT

3 TON HORIZONTAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	574	0.13	707	0.23	817	0.34	913	0.47	999	0.61
975	597	0.15	727	0.25	835	0.37	929	0.50	1015	0.64
1050	621	0.18	747	0.28	853	0.40	946	0.53	1030	0.68
1125	646	0.20	768	0.31	872	0.43	964	0.57	1047	0.72
1200	671	0.23	790	0.34	892	0.47	982	0.61	1064	0.76
1275	696	0.26	812	0.38	912	0.51	1001	0.65	1082	0.81
1350	723	0.30	835	0.42	933	0.55	1020	0.70	1100	0.86
1425	749	0.34	859	0.46	955	0.60	1040	0.75	1119	0.91
1500	776	0.38	883	0.51	977	0.65	1061	0.80	1138	0.97

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	1078	0.77	1151	0.93	1220	1.11	1284	1.30	1346	1.49
975	1093	0.80	1165	0.97	1233	1.15	1297	1.33	1358	1.53
1050	1108	0.84	1180	1.01	1247	1.19	1311	1.38	1371	1.58
1125	1123	0.88	1195	1.05	1261	1.23	1325	1.42	1385	1.62
1200	1140	0.92	1210	1.10	1276	1.28	1339	1.47	1399	1.68
1275	1157	0.97	1226	1.15	1292	1.33	1354	1.53	1414	1.73
1350	1174	1.02	1243	1.20	1308	1.39	1370	1.59	1429	1.80
1425	1192	1.08	1260	1.26	1325	1.45	1386	1.65	1444	1.86
1500	1210	1.14	1278	1.33	1342	1.52	1403	1.72	1461	1.93

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

Medium static 770–1175 RPM, 1.2 BHP max

High static 1035–1466 RPM, 2.4 BHP max

TABLE 21 – RAH036

3 PHASE HOT GAS REHEAT

3 TON HORIZONTAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	574	0.13	707	0.23	817	0.34	913	0.47	999	0.61
975	597	0.15	727	0.25	835	0.37	929	0.50	1015	0.64
1050	621	0.18	747	0.28	853	0.40	946	0.53	1030	0.68
1125	646	0.20	768	0.31	872	0.43	964	0.57	1047	0.72
1200	671	0.23	790	0.34	892	0.47	982	0.61	1064	0.76
1275	696	0.26	812	0.38	912	0.51	1001	0.65	1082	0.81
1350	723	0.30	835	0.42	933	0.55	1020	0.70	1100	0.86
1425	749	0.34	859	0.46	955	0.60	1040	0.75	1119	0.91
1500	776	0.38	883	0.51	977	0.65	1061	0.80	1138	0.97

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900	1078	0.77	1151	0.93	1220	1.11	1284	1.30	1346	1.49
975	1093	0.80	1165	0.97	1233	1.15	1297	1.33	1358	1.53
1050	1108	0.84	1180	1.01	1247	1.19	1311	1.38	1371	1.58
1125	1123	0.88	1195	1.05	1261	1.23	1325	1.42	1385	1.62
1200	1140	0.92	1210	1.10	1276	1.28	1339	1.47	1399	1.68
1275	1157	0.97	1226	1.15	1292	1.33	1354	1.53	1414	1.73
1350	1174	1.02	1243	1.20	1308	1.39	1370	1.59	1429	1.80
1425	1192	1.08	1260	1.26	1325	1.45	1386	1.65	1444	1.86
1500	1210	1.14	1278	1.33	1342	1.52	1403	1.72	1461	1.93

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

Standard static 560–854 RPM, 1.2 BHP max

Medium static 770–1175 RPM, 1.2 BHP max

High static 1035–1466 RPM, 2.4 BHP max

FAN PERFORMANCE (BELT DRIVE) (cont.)

TABLE 22 – RAH048

3 PHASE NON-HOT GAS REHEAT

4 TON VERTICAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	695	0.25	818	0.37	930	0.51	1032	0.66	1126	0.83
1300	731	0.30	849	0.43	955	0.57	1053	0.72	1145	0.89
1400	769	0.36	880	0.49	982	0.63	1077	0.79	1166	0.97
1500	807	0.42	913	0.56	1011	0.71	1103	0.87	1188	1.05
1600	847	0.49	948	0.63	1042	0.79	1130	0.96	1213	1.14
1700	887	0.57	983	0.72	1073	0.88	1158	1.06	1239	1.24
1800	928	0.66	1020	0.82	1106	0.98	1188	1.16	1266	1.35
1900	969	0.76	1057	0.92	1140	1.09	1219	1.28	1295	1.48
2000	1010	0.87	1095	1.04	1175	1.21	1251	1.41	1325	1.61

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	1215	1.01	1298	1.21	1378	1.42	1454	1.64	1526	1.87
1300	1231	1.08	1313	1.28	1390	1.49	1465	1.71	1536	1.94
1400	1249	1.16	1329	1.36	1405	1.57	1478	1.79	1547	2.03
1500	1270	1.24	1347	1.45	1421	1.66	1492	1.89	1561	2.13
1600	1292	1.34	1367	1.54	1440	1.76	1509	1.99	1576	2.23
1700	1315	1.44	1389	1.65	1459	1.88	1527	2.11	1593	2.35
1800	1341	1.56	1412	1.77	1481	2.00	1547	2.23	1612	2.48
1900	1367	1.68	1437	1.90	1504	2.13	1569	2.37	1632	2.62
2000	1395	1.82	1463	2.04	1528	2.28	1591	2.52	1653	2.77

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

Medium Static 920–1303 RPM, 1.7 BHP max

High Static 1208–1639 RPM, 2.9 BHP max

TABLE 23 – RAH048

3 PHASE HOT GAS REHEAT

4 TON VERTICAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	695	0.25	818	0.37	930	0.51	1032	0.66	1126	0.83
1300	731	0.30	849	0.43	955	0.57	1053	0.72	1145	0.89
1400	769	0.36	880	0.49	982	0.63	1077	0.79	1166	0.97
1500	807	0.42	913	0.56	1011	0.71	1103	0.87	1188	1.05
1600	847	0.49	948	0.63	1042	0.79	1130	0.96	1213	1.14
1700	887	0.57	983	0.72	1073	0.88	1158	1.06	1239	1.24
1800	928	0.66	1020	0.82	1106	0.98	1188	1.16	1266	1.35
1900	969	0.76	1057	0.92	1140	1.09	1219	1.28	1295	1.48
2000	1010	0.87	1095	1.04	1175	1.21	1251	1.41	1325	1.61

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	1215	1.01	1298	1.21	1378	1.42	1454	1.64	1526	1.87
1300	1231	1.08	1313	1.28	1390	1.49	1465	1.71	1536	1.94
1400	1249	1.16	1329	1.36	1405	1.57	1478	1.79	1547	2.03
1500	1270	1.24	1347	1.45	1421	1.66	1492	1.89	1561	2.13
1600	1292	1.34	1367	1.54	1440	1.76	1509	1.99	1576	2.23
1700	1315	1.44	1389	1.65	1459	1.88	1527	2.11	1593	2.35
1800	1341	1.56	1412	1.77	1481	2.00	1547	2.23	1612	2.48
1900	1367	1.68	1437	1.90	1504	2.13	1569	2.37	1632	2.62
2000	1395	1.82	1463	2.04	1528	2.28	1591	2.52	1653	2.77

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

Standard Static 560–854 RPM, 1.2 BHP max

Medium Static 770–1175 RPM, 1.7 BHP max

High Static 1208–1639 RPM, 2.9 BHP max

FAN PERFORMANCE (BELT DRIVE) (cont.)

TABLE 24 – RAH048

3 PHASE NON-HOT GAS REHEAT

4 TON HORIZONTAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	671	0.23	790	0.34	892	0.47	982	0.61	1064	0.76
1300	705	0.28	820	0.39	919	0.52	1007	0.67	1088	0.82
1400	740	0.33	851	0.45	947	0.58	1034	0.73	1113	0.89
1500	776	0.38	883	0.51	977	0.65	1061	0.80	1138	0.97
1600	813	0.45	916	0.58	1007	0.73	1089	0.89	1165	1.05
1700	851	0.52	949	0.66	1038	0.81	1118	0.97	1192	1.15
1800	888	0.60	984	0.75	1069	0.90	1148	1.07	1221	1.25
1900	927	0.69	1019	0.84	1102	1.00	1179	1.18	1250	1.36
2000	965	0.78	1054	0.94	1135	1.11	1210	1.29	1280	1.48

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	1140	0.92	1210	1.10	1276	1.28	1339	1.47	1399	1.68
1300	1162	0.99	1232	1.16	1297	1.35	1360	1.55	1419	1.75
1400	1186	1.06	1254	1.24	1319	1.43	1381	1.63	1439	1.84
1500	1210	1.14	1278	1.33	1342	1.52	1403	1.72	1461	1.93
1600	1236	1.23	1302	1.42	1365	1.62	1425	1.82	1483	2.04
1700	1262	1.33	1328	1.52	1390	1.72	1449	1.93	1505	2.15
1800	1289	1.44	1354	1.63	1415	1.84	1473	2.05	1529	2.27
1900	1317	1.55	1380	1.75	1441	1.96	1498	2.18	1553	2.41
2000	1345	1.68	1408	1.88	1467	2.10	1524	2.32	1579	2.55

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

Medium Static 920–1303 RPM, 1.7 BHP max

High Static 1208–1639 RPM, 2.9 max BHP

TABLE 25 – RAH048

3 PHASE HOT GAS REHEAT

4 TON HORIZONTAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	671	0.23	790	0.34	892	0.47	982	0.61	1064	0.76
1300	705	0.28	820	0.39	919	0.52	1007	0.67	1088	0.82
1400	740	0.33	851	0.45	947	0.58	1034	0.73	1113	0.89
1500	776	0.38	883	0.51	977	0.65	1061	0.80	1138	0.97
1600	813	0.45	916	0.58	1007	0.73	1089	0.89	1165	1.05
1700	851	0.52	949	0.66	1038	0.81	1118	0.97	1192	1.15
1800	888	0.60	984	0.75	1069	0.90	1148	1.07	1221	1.25
1900	927	0.69	1019	0.84	1102	1.00	1179	1.18	1250	1.36
2000	965	0.78	1054	0.94	1135	1.11	1210	1.29	1280	1.48

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	1140	0.92	1210	1.10	1276	1.28	1339	1.47	1399	1.68
1300	1162	0.99	1232	1.16	1297	1.35	1360	1.55	1419	1.75
1400	1186	1.06	1254	1.24	1319	1.43	1381	1.63	1439	1.84
1500	1210	1.14	1278	1.33	1342	1.52	1403	1.72	1461	1.93
1600	1236	1.23	1302	1.42	1365	1.62	1425	1.82	1483	2.04
1700	1262	1.33	1328	1.52	1390	1.72	1449	1.93	1505	2.15
1800	1289	1.44	1354	1.63	1415	1.84	1473	2.05	1529	2.27
1900	1317	1.55	1380	1.75	1441	1.96	1498	2.18	1553	2.41
2000	1345	1.68	1408	1.88	1467	2.10	1524	2.32	1579	2.55

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

Standard Static 560–854 RPM, 1.2 BHP max

Medium Static 770–1175 RPM, 1.7 BHP max

High Static 1208–1639 RPM, 2.9 BHP max

FAN PERFORMANCE (BELT DRIVE) (cont.)

TABLE 26 – RAH060

3 PHASE NON-HOT GAS REHEAT

5 TON VERTICAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	794	0.41	902	0.55	993	0.69	1074	0.85	1147	1.00
1625	840	0.49	945	0.64	1034	0.80	1113	0.96	1185	1.13
1750	888	0.59	988	0.75	1075	0.92	1153	1.09	1223	1.26
1875	936	0.70	1033	0.87	1117	1.05	1193	1.23	1263	1.41
2000	984	0.82	1078	1.00	1160	1.19	1235	1.39	1303	1.58
2125	1033	0.96	1124	1.15	1204	1.35	1277	1.56	1343	1.76
2250	1083	1.11	1170	1.32	1248	1.53	1319	1.74	1385	1.96
2375	1133	1.28	1217	1.50	1293	1.72	1363	1.95	1427	2.17
2500	1183	1.47	1265	1.70	1339	1.93	1406	2.17	1470	2.41

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	1214	1.16	1277	1.33	1336	1.50	1392	1.67	1445	1.85
1625	1251	1.30	1313	1.47	1371	1.65	1427	1.83	1479	2.02
1750	1289	1.44	1350	1.63	1407	1.81	1462	2.01	1514	2.20
1875	1327	1.60	1387	1.80	1444	1.99	1498	2.19	1550	2.40
2000	1366	1.78	1426	1.98	1482	2.19	1535	2.40	1586	2.61
2125	1406	1.97	1464	2.18	1520	2.40	1573	2.62	1623	2.84
2250	1446	2.18	1504	2.40	1559	2.62	1611	2.85	1661	3.09
2375	1487	2.40	1544	2.63	1598	2.87	1650	3.11	–	–
2500	1529	2.64	1585	2.89	1638	3.13	–	–	–	–

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

- Medium Static 1035 – 1466 RPM, 2.4 BHP max
- High Static 1303 – 1687 RPM, 2.9 max BHP

TABLE 27 – RAH060

3 PHASE HOT GAS REHEAT

5 TON VERTICAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	794	0.41	902	0.55	993	0.69	1074	0.85	1147	1.00
1625	840	0.49	945	0.64	1034	0.80	1113	0.96	1185	1.13
1750	888	0.59	988	0.75	1075	0.92	1153	1.09	1223	1.26
1875	936	0.70	1033	0.87	1117	1.05	1193	1.23	1263	1.41
2000	984	0.82	1078	1.00	1160	1.19	1235	1.39	1303	1.58
2125	1033	0.96	1124	1.15	1204	1.35	1277	1.56	1343	1.76
2250	1083	1.11	1170	1.32	1248	1.53	1319	1.74	1385	1.96
2375	1133	1.28	1217	1.50	1293	1.72	1363	1.95	1427	2.17
2500	1183	1.47	1265	1.70	1339	1.93	1406	2.17	1470	2.41

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	1214	1.16	1277	1.33	1336	1.50	1392	1.67	1445	1.85
1625	1251	1.30	1313	1.47	1371	1.65	1427	1.83	1479	2.02
1750	1289	1.44	1350	1.63	1407	1.81	1462	2.01	1514	2.20
1875	1327	1.60	1387	1.80	1444	1.99	1498	2.19	1550	2.40
2000	1366	1.78	1426	1.98	1482	2.19	1535	2.40	1586	2.61
2125	1406	1.97	1464	2.18	1520	2.40	1573	2.62	1623	2.84
2250	1446	2.18	1504	2.40	1559	2.62	1611	2.85	1661	3.09
2375	1487	2.40	1544	2.63	1598	2.87	1650	3.11	–	–
2500	1529	2.64	1585	2.89	1638	3.13	–	–	–	–

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

- Standard Static 770–1175 RPM, 1.2 BHP max
- Medium Static 1035–1466 RPM, 2.4 BHP max
- High Static 1303–1687 RPM, 2.9 BHP max

FAN PERFORMANCE (BELT DRIVE) (cont.)

TABLE 28 – RAH060

3 PHASE NON-HOT GAS REHEAT

5 TON HORIZONTAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	725	0.33	840	0.46	937	0.60	1023	0.75	1101	0.90
1625	765	0.40	876	0.54	970	0.68	1054	0.84	1131	1.00
1750	806	0.48	912	0.63	1004	0.78	1087	0.94	1162	1.11
1875	847	0.57	950	0.72	1039	0.88	1120	1.05	1194	1.23
2000	889	0.66	988	0.83	1075	1.00	1154	1.18	1226	1.36
2125	931	0.78	1027	0.95	1112	1.13	1189	1.31	1260	1.50
2250	974	0.90	1067	1.08	1149	1.27	1224	1.46	1294	1.66
2375	1018	1.03	1107	1.23	1187	1.43	1261	1.63	1329	1.84
2500	1061	1.19	1148	1.39	1226	1.59	1297	1.81	1364	2.02

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	1172	1.06	1239	1.23	1302	1.40	1361	1.58	1418	1.77
1625	1201	1.16	1267	1.34	1329	1.52	1388	1.71	1444	1.90
1750	1231	1.28	1296	1.46	1358	1.65	1416	1.84	1472	2.04
1875	1262	1.41	1326	1.60	1387	1.79	1445	1.99	1499	2.20
2000	1294	1.55	1357	1.74	1417	1.95	1474	2.15	1528	2.36
2125	1326	1.70	1388	1.90	1447	2.11	1504	2.33	1557	2.55
2250	1359	1.87	1420	2.08	1479	2.29	1534	2.51	1587	2.74
2375	1393	2.05	1453	2.27	1511	2.49	1566	2.72	1618	2.95
2500	1427	2.24	1487	2.47	1543	2.70	1597	2.94	1649	3.18

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

- Medium Static 1035 – 1466 RPM, 2.4 BHP max
- High Static 1303 – 1687 RPM, 2.9 BHP max

TABLE 29 – RAH060

3 PHASE HOT GAS REHEAT

5 TON HORIZONTAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	725	0.33	840	0.46	937	0.60	1023	0.75	1101	0.90
1625	765	0.40	876	0.54	970	0.68	1054	0.84	1131	1.00
1750	806	0.48	912	0.63	1004	0.78	1087	0.94	1162	1.11
1875	847	0.57	950	0.72	1039	0.88	1120	1.05	1194	1.23
2000	889	0.66	988	0.83	1075	1.00	1154	1.18	1226	1.36
2125	931	0.78	1027	0.95	1112	1.13	1189	1.31	1260	1.50
2250	974	0.90	1067	1.08	1149	1.27	1224	1.46	1294	1.66
2375	1018	1.03	1107	1.23	1187	1.43	1261	1.63	1329	1.84
2500	1061	1.19	1148	1.39	1226	1.59	1297	1.81	1364	2.02

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	1172	1.06	1239	1.23	1302	1.40	1361	1.58	1418	1.77
1625	1201	1.16	1267	1.34	1329	1.52	1388	1.71	1444	1.90
1750	1231	1.28	1296	1.46	1358	1.65	1416	1.84	1472	2.04
1875	1262	1.41	1326	1.60	1387	1.79	1445	1.99	1499	2.20
2000	1294	1.55	1357	1.74	1417	1.95	1474	2.15	1528	2.36
2125	1326	1.70	1388	1.90	1447	2.11	1504	2.33	1557	2.55
2250	1359	1.87	1420	2.08	1479	2.29	1534	2.51	1587	2.74
2375	1393	2.05	1453	2.27	1511	2.49	1566	2.72	1618	2.95
2500	1427	2.24	1487	2.47	1543	2.70	1597	2.94	1649	3.18

NOTE: For more information, see General Fan Performance Notes.

Boldface indicates field-supplied drive is required.

- Standard Static 770 – 1175 RPM 1.2 BHP max
- Medium Static 1035–1466 2.4 BHP max
- High Static 1303–1687 2.9 BHP max

FAN PERFORMANCE (BELT DRIVE) (cont.)

TABLE 30 – RAH072

3 PHASE

6 TON VERTICAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1800	446	0.33	534	0.50	609	0.70	676	0.91	736	1.14
1950	467	0.39	552	0.57	625	0.77	690	0.99	750	1.23
2100	489	0.45	571	0.64	642	0.86	706	1.08	764	1.33
2250	511	0.53	591	0.73	660	0.95	722	1.19	779	1.44
2400	534	0.61	611	0.82	678	1.05	739	1.30	795	1.56
2550	558	0.71	631	0.93	697	1.17	756	1.42	811	1.69
2700	581	0.81	652	1.04	716	1.29	774	1.55	828	1.83
2850	605	0.93	674	1.17	736	1.43	792	1.70	845	1.98
3000	630	1.06	696	1.31	756	1.58	811	1.86	863	2.15

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1800	791	1.39	843	1.65	892	1.93	938	2.22	981	2.53
1950	804	1.49	855	1.76	903	2.04	949	2.34	992	2.65
2100	818	1.59	868	1.87	915	2.16	961	2.46	1003	2.78
2250	832	1.71	882	1.99	928	2.29	973	2.59	1015	2.92
2400	847	1.83	896	2.12	942	2.43	986	2.74	1028	3.07
2550	862	1.97	910	2.27	956	2.58	999	2.90	1041	3.23
2700	878	2.12	926	2.42	971	2.74	1013	3.07	1055	3.41
2850	895	2.28	941	2.59	986	2.92	1028	3.25	1069	3.60
3000	912	2.46	958	2.78	1001	3.11	1043	3.45	1083	3.80

NOTE: For more information, see General Fan Performance Notes.

- Standard static 489–747 RPM, 1.7 BHP max
- Medium static 733–949 RPM, 2.9 BHP max
- High static 909–1102 RPM, 4.7 BHP max

TABLE 31 – RAH072

3 PHASE

6 TON HORIZONTAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1800	415	0.28	510	0.46	588	0.65	655	0.85	715	1.08
1950	431	0.32	525	0.51	601	0.71	668	0.93	727	1.16
2100	448	0.38	540	0.57	615	0.78	681	1.01	740	1.25
2250	465	0.43	555	0.64	629	0.86	694	1.10	753	1.34
2400	483	0.49	571	0.71	644	0.94	708	1.19	766	1.45
2550	501	0.56	587	0.79	659	1.04	722	1.29	779	1.56
2700	519	0.64	603	0.88	674	1.14	737	1.40	793	1.68
2850	538	0.72	620	0.98	689	1.24	751	1.52	807	1.80
3000	557	0.82	637	1.08	705	1.36	766	1.64	822	1.94

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1800	770	1.31	821	1.56	868	1.82	913	2.09	955	2.36
1950	782	1.40	832	1.66	879	1.92	924	2.20	966	2.49
2100	794	1.50	844	1.76	891	2.03	935	2.32	977	2.61
2250	806	1.60	856	1.87	903	2.15	947	2.45	988	2.75
2400	819	1.71	868	1.99	915	2.28	958	2.58	1000	2.89
2550	832	1.83	881	2.12	927	2.42	971	2.73	1012	3.05
2700	845	1.96	894	2.26	940	2.57	983	2.88	1024	3.21
2850	859	2.10	907	2.41	953	2.72	995	3.05	1036	3.38
3000	873	2.24	921	2.56	966	2.89	1008	3.22	1049	3.56

NOTE: For more information, see General Fan Performance Notes.

- Standard static 489–747 RPM, 1.7 BHP max
- Medium static 733–949 RPM, 2.9 BHP max
- High static 909–1102 RPM, 4.7 BHP max

FAN PERFORMANCE (BELT DRIVE) (cont.)

TABLE 32 – RAH090

3 PHASE

7.5 TON VERTICAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	482	0.36	577	0.51	659	0.66	732	0.82	799	0.98
2438	505	0.43	597	0.59	676	0.75	748	0.92	813	1.09
2625	529	0.51	617	0.68	694	0.85	764	1.03	827	1.22
2813	554	0.60	638	0.78	713	0.97	781	1.16	843	1.35
3000	579	0.70	660	0.89	732	1.09	799	1.29	860	1.50
3188	604	0.81	683	1.02	753	1.23	817	1.44	877	1.65
3375	630	0.94	706	1.15	774	1.37	836	1.60	895	1.82
3563	657	1.08	729	1.31	795	1.54	856	1.77	913	2.01
3750	683	1.23	753	1.47	817	1.71	877	1.96	933	2.21

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	860	1.14	917	1.31	971	1.48	1022	1.66	1071	1.84
2438	873	1.27	929	1.45	983	1.63	1033	1.81	1081	2.00
2625	887	1.40	942	1.59	995	1.78	1045	1.98	1092	2.18
2813	901	1.55	956	1.75	1008	1.95	1057	2.15	1104	2.36
3000	917	1.70	970	1.91	1021	2.13	1070	2.34	1117	2.56
3188	933	1.87	986	2.09	1036	2.32	1084	2.54	1130	2.77
3375	950	2.05	1002	2.29	1051	2.52	1098	2.76	1144	3.00
3563	967	2.25	1018	2.49	1067	2.74	1113	2.99	1158	3.24
3750	985	2.46	1035	2.71	1083	2.97	1129	3.23	1173	3.49

NOTE: For more information, see General Fan Performance Notes.

- Standard static 518–733 RPM, 1.7 BHP max
- Medium static 690–936 RPM, 2.4 BHP max
- High static 838–1084 RPM, 3.7 BHP max

TABLE 33 – RAH090

3 PHASE

7.5 TON HORIZONTAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	433	0.29	518	0.41	596	0.54	667	0.67	733	0.81
2438	454	0.35	535	0.48	609	0.61	677	0.75	741	0.90
2625	477	0.42	553	0.55	624	0.69	689	0.84	751	1.00
2813	500	0.49	572	0.64	640	0.78	703	0.94	763	1.10
3000	523	0.58	592	0.73	657	0.88	718	1.05	775	1.22
3188	547	0.68	613	0.83	675	1.00	733	1.17	789	1.34
3375	571	0.78	634	0.95	694	1.12	750	1.30	804	1.48
3563	596	0.90	656	1.07	713	1.25	768	1.44	820	1.63
3750	621	1.03	679	1.21	734	1.40	786	1.59	837	1.79

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	795	0.96	854	1.11	910	1.27	963	1.43	1014	1.60
2438	802	1.05	859	1.21	913	1.38	966	1.55	1016	1.72
2625	810	1.16	865	1.32	919	1.49	970	1.67	1019	1.85
2813	819	1.27	874	1.44	925	1.62	975	1.80	1023	1.99
3000	830	1.39	883	1.57	934	1.76	982	1.95	1029	2.14
3188	843	1.53	894	1.71	943	1.90	990	2.10	1036	2.30
3375	856	1.67	905	1.86	953	2.06	1000	2.27	1045	2.48
3563	870	1.83	918	2.03	965	2.23	1010	2.44	1054	2.66
3750	885	1.99	932	2.20	978	2.42	1022	2.64	1065	2.86

NOTE: For more information, see General Fan Performance Notes.

- Standard static 518–733 RPM, 1.7 BHP max
- Medium static 690–936 RPM, 2.4 BHP max
- High static 838–1084 RPM, 3.7 BHP max

FAN PERFORMANCE (BELT DRIVE) (cont.)

TABLE 34 – RAH102

3 PHASE

8.5 TON VERTICAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	482	0.36	577	0.51	659	0.66	732	0.82	799	0.98
2438	505	0.43	597	0.59	676	0.75	748	0.92	813	1.09
2625	529	0.51	617	0.68	694	0.85	764	1.03	827	1.22
2813	554	0.60	638	0.78	713	0.97	781	1.16	843	1.35
3000	579	0.70	660	0.89	732	1.09	799	1.29	860	1.50
3188	604	0.81	683	1.02	753	1.23	817	1.44	877	1.65
3375	630	0.94	706	1.15	774	1.37	836	1.60	895	1.82
3563	657	1.08	729	1.31	795	1.54	856	1.77	913	2.01
3750	683	1.23	753	1.47	817	1.71	877	1.96	933	2.21

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	860	1.14	917	1.31	971	1.48	1022	1.66	1071	1.84
2438	873	1.27	929	1.45	983	1.63	1033	1.81	1081	2.00
2625	887	1.40	942	1.59	995	1.78	1045	1.98	1092	2.18
2813	901	1.55	956	1.75	1008	1.95	1057	2.15	1104	2.36
3000	917	1.70	970	1.91	1021	2.13	1070	2.34	1117	2.56
3188	933	1.87	986	2.09	1036	2.32	1084	2.54	1130	2.77
3375	950	2.05	1002	2.29	1051	2.52	1098	2.76	1144	3.00
3563	967	2.25	1018	2.49	1067	2.74	1113	2.99	1158	3.24
3750	985	2.46	1035	2.71	1083	2.97	1129	3.23	1173	3.49

NOTE: For more information, see General Fan Performance Notes.

- Standard static 518–733 RPM, 1.7 BHP max
- Medium static 690–936 RPM, 2.4 BHP max
- High static 838–1084 RPM, 3.7 BHP max

TABLE 35 – RAH102

3 PHASE

8.5 TON HORIZONTAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	433	0.29	518	0.41	596	0.54	667	0.67	733	0.81
2438	454	0.35	535	0.48	609	0.61	677	0.75	741	0.90
2625	477	0.42	553	0.55	624	0.69	689	0.84	751	1.00
2813	500	0.49	572	0.64	640	0.78	703	0.94	763	1.10
3000	523	0.58	592	0.73	657	0.88	718	1.05	775	1.22
3188	547	0.68	613	0.83	675	1.00	733	1.17	789	1.34
3375	571	0.78	634	0.95	694	1.12	750	1.30	804	1.48
3563	596	0.90	656	1.07	713	1.25	768	1.44	820	1.63
3750	621	1.03	679	1.21	734	1.40	786	1.59	837	1.79

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	795	0.96	854	1.11	910	1.27	963	1.43	1014	1.60
2438	802	1.05	859	1.21	913	1.38	966	1.55	1016	1.72
2625	810	1.16	865	1.32	919	1.49	970	1.67	1019	1.85
2813	819	1.27	874	1.44	925	1.62	975	1.80	1023	1.99
3000	830	1.39	883	1.57	934	1.76	982	1.95	1029	2.14
3188	843	1.53	894	1.71	943	1.90	990	2.10	1036	2.30
3375	856	1.67	905	1.86	953	2.06	1000	2.27	1045	2.48
3563	870	1.83	918	2.03	965	2.23	1010	2.44	1054	2.66
3750	885	1.99	932	2.20	978	2.42	1022	2.64	1065	2.86

NOTE: For more information, see General Fan Performance Notes.

- Standard static 518–733 RPM, 1.7 BHP max
- Medium static 690–936 RPM, 2.4 BHP max
- High static 838–1084 RPM, 3.7 BHP max

FAN PERFORMANCE (BELT DRIVE) (cont.)

TABLE 36 – RAH110

3 PHASE

10 TON VERTICAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	556	0.65	623	0.80	684	0.95	738	1.11	789	1.26
3250	590	0.79	655	0.96	713	1.13	766	1.29	815	1.46
3500	625	0.96	687	1.14	742	1.32	794	1.50	841	1.68
3750	661	1.16	719	1.35	773	1.54	822	1.73	869	1.93
4000	697	1.37	753	1.58	804	1.79	852	1.99	897	2.20
4250	733	1.62	787	1.84	836	2.06	883	2.28	926	2.49
4500	770	1.89	821	2.13	869	2.36	914	2.59	956	2.82
4750	807	2.20	856	2.45	902	2.69	945	2.94	986	3.18
5000	844	2.54	891	2.80	936	3.06	978	3.31	1018	3.57

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	836	1.42	881	1.57	923	1.73	963	1.89	1001	2.05
3250	861	1.63	904	1.79	945	1.96	985	2.13	1023	2.30
3500	886	1.86	929	2.04	969	2.22	1008	2.40	1045	2.58
3750	912	2.12	954	2.31	994	2.50	1031	2.70	1068	2.89
4000	940	2.40	980	2.61	1019	2.81	1056	3.02	1092	3.22
4250	968	2.71	1007	2.93	1045	3.15	1081	3.36	1117	3.58
4500	996	3.05	1035	3.28	1072	3.51	1108	3.74	1142	3.97
4750	1026	3.42	1063	3.66	1100	3.91	1135	4.15	1168	4.39
5000	1056	3.82	1093	4.08	1128	4.34	1162	4.59	—	—

NOTE: For more information, see General Fan Performance Notes.

- Standard static 591–838 RPM, 2.4 BHP max
- Medium static 838–1084 RPM, 3.7 BHP max
- High static 1022–1240 RPM, 4.9 BHP max

TABLE 37 – RAH110

3 PHASE

10 TON HORIZONTAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	523	0.58	592	0.73	657	0.88	718	1.05	775	1.22
3250	555	0.71	620	0.87	681	1.04	739	1.21	794	1.39
3500	588	0.86	649	1.03	707	1.21	762	1.39	815	1.58
3750	621	1.03	679	1.21	734	1.40	786	1.59	837	1.79
4000	655	1.23	709	1.42	761	1.61	812	1.82	860	2.03
4250	689	1.45	741	1.65	790	1.86	838	2.07	885	2.29
4500	723	1.69	773	1.90	820	2.12	866	2.35	910	2.57
4750	758	1.96	805	2.19	850	2.42	894	2.65	937	2.89
5000	793	2.26	838	2.50	881	2.74	923	2.98	965	3.23

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	830	1.39	883	1.57	934	1.76	982	1.95	1029	2.14
3250	847	1.57	897	1.76	946	1.96	993	2.16	1039	2.36
3500	865	1.77	914	1.97	961	2.18	1007	2.38	1051	2.60
3750	885	1.99	932	2.20	978	2.42	1022	2.64	1065	2.86
4000	907	2.24	952	2.46	996	2.68	1038	2.91	1080	3.14
4250	930	2.51	973	2.74	1015	2.97	1057	3.21	1097	3.45
4500	954	2.81	996	3.05	1037	3.29	1076	3.54	1115	3.79
4750	979	3.13	1019	3.38	1059	3.63	1097	3.89	1135	4.15
5000	1005	3.49	1044	3.74	1082	4.01	1119	4.27	1156	4.55

NOTE: For more information, see General Fan Performance Notes.

- Standard static 591–838 RPM, 2.4 BHP max
- Medium static 838–1084 RPM, 3.7 BHP max
- High static 1022–1240 RPM, 4.9 BHP max

FAN PERFORMANCE (BELT DRIVE) (cont.)

TABLE 38 – RAH120

3 PHASE

10 TON VERTICAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	556	0.65	623	0.80	684	0.95	738	1.11	789	1.26
3250	590	0.79	655	0.96	713	1.13	766	1.29	815	1.46
3500	625	0.96	687	1.14	742	1.32	794	1.50	841	1.68
3750	661	1.16	719	1.35	773	1.54	822	1.73	869	1.93
4000	697	1.37	753	1.58	804	1.79	852	1.99	897	2.20
4250	733	1.62	787	1.84	836	2.06	883	2.28	926	2.49
4500	770	1.89	821	2.13	869	2.36	914	2.59	956	2.82
4750	807	2.20	856	2.45	902	2.69	945	2.94	986	3.18
5000	844	2.54	891	2.80	936	3.06	978	3.31	1018	3.57

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	836	1.42	881	1.57	923	1.73	963	1.89	1001	2.05
3250	861	1.63	904	1.79	945	1.96	985	2.13	1023	2.30
3500	886	1.86	929	2.04	969	2.22	1008	2.40	1045	2.58
3750	912	2.12	954	2.31	994	2.50	1031	2.70	1068	2.89
4000	940	2.40	980	2.61	1019	2.81	1056	3.02	1092	3.22
4250	968	2.71	1007	2.93	1045	3.15	1081	3.36	1117	3.58
4500	996	3.05	1035	3.28	1072	3.51	1108	3.74	1142	3.97
4750	1026	3.42	1063	3.66	1100	3.91	1135	4.15	1168	4.39
5000	1056	3.82	1093	4.08	1128	4.34	1162	4.59	—	—

NOTE: For more information, see General Fan Performance Notes.

- Standard static 591–838 RPM, 2.4 BHP max
- Medium static 838–1084 RPM, 3.7 BHP max
- High static 1022–1240 RPM, 4.9 BHP max

TABLE 39 – RAH120

3 PHASE

10 TON HORIZONTAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	523	0.58	592	0.73	657	0.88	718	1.05	775	1.22
3250	555	0.71	620	0.87	681	1.04	739	1.21	794	1.39
3500	588	0.86	649	1.03	707	1.21	762	1.39	815	1.58
3750	621	1.03	679	1.21	734	1.40	786	1.59	837	1.79
4000	655	1.23	709	1.42	761	1.61	812	1.82	860	2.03
4250	689	1.45	741	1.65	790	1.86	838	2.07	885	2.29
4500	723	1.69	773	1.90	820	2.12	866	2.35	910	2.57
4750	758	1.96	805	2.19	850	2.42	894	2.65	937	2.89
5000	793	2.26	838	2.50	881	2.74	923	2.98	965	3.23

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000	830	1.39	883	1.57	934	1.76	982	1.95	1029	2.14
3250	847	1.57	897	1.76	946	1.96	993	2.16	1039	2.36
3500	865	1.77	914	1.97	961	2.18	1007	2.38	1051	2.60
3750	885	1.99	932	2.20	978	2.42	1022	2.64	1065	2.86
4000	907	2.24	952	2.46	996	2.68	1038	2.91	1080	3.14
4250	930	2.51	973	2.74	1015	2.97	1057	3.21	1097	3.45
4500	954	2.81	996	3.05	1037	3.29	1076	3.54	1115	3.79
4750	979	3.13	1019	3.38	1059	3.63	1097	3.89	1135	4.15
5000	1005	3.49	1044	3.74	1082	4.01	1119	4.27	1156	4.55

NOTE: For more information, see General Fan Performance Notes.

- Standard static 591–838 RPM, 2.4 BHP max
- Medium static 838–1084 RPM, 3.7 BHP max
- High static 1022–1240 RPM, 4.9 BHP max

FAN PERFORMANCE (BELT DRIVE) (cont.)

TABLE 40 – RAH150

3 PHASE

12.5 TON VERTICAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3438	383	0.46	458	0.66	530	0.91	601	1.20	668	1.53
3750	402	0.56	474	0.77	540	1.01	605	1.30	670	1.64
4063	422	0.67	491	0.90	552	1.14	613	1.43	674	1.76
4375	443	0.79	508	1.04	567	1.29	623	1.58	680	1.90
4688	464	0.93	527	1.19	583	1.46	636	1.75	689	2.07
5000	486	1.10	546	1.37	600	1.65	651	1.95	700	2.27
5313	509	1.28	565	1.56	618	1.86	666	2.17	713	2.49
5625	533	1.48	585	1.77	636	2.09	683	2.41	728	2.74
5938	557	1.71	605	2.01	655	2.34	701	2.67	744	3.02
6250	581	1.97	626	2.26	673	2.61	718	2.96	760	3.32

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3438	729	1.88	783	2.25	833	2.62	879	2.99	921	3.37
3750	731	2.00	787	2.39	838	2.78	885	3.18	929	3.59
4063	733	2.13	789	2.52	841	2.94	890	3.36	935	3.79
4375	736	2.27	791	2.67	843	3.10	892	3.54	938	3.99
4688	741	2.43	794	2.83	845	3.26	894	3.72	941	4.19
5000	749	2.63	799	3.02	848	3.45	896	3.90	942	4.39
5313	760	2.85	806	3.23	853	3.66	899	4.11	944	4.60
5625	772	3.10	816	3.48	860	3.90	904	4.35	947	4.83
5938	786	3.38	827	3.76	869	4.18	911	4.62	952	5.09
6250	801	3.69	841	4.07	880	4.49	920	4.93	959	5.40

NOTE: For more information, see General Fan Performance Notes.

Standard static 440–609 RPM, 2.9 BHP max

Medium static 609–778 RPM, 3.7 BHP max

High static 776–955 RPM, 6.1 BHP max

TABLE 41 – RAH150

3 PHASE

12.5 TON HORIZONTAL SUPPLY

CFM	Available External Static Pressure (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3438	379	0.48	455	0.69	526	0.94	593	1.23	655	1.54
3750	399	0.59	469	0.80	536	1.06	600	1.35	660	1.67
4063	420	0.71	486	0.93	549	1.19	609	1.49	667	1.81
4375	442	0.84	503	1.08	562	1.35	620	1.65	675	1.97
4688	464	1.00	522	1.25	578	1.52	632	1.83	685	2.16
5000	486	1.17	541	1.44	594	1.72	646	2.03	696	2.37
5313	509	1.37	561	1.64	612	1.94	661	2.26	708	2.60
5625	532	1.58	582	1.87	630	2.18	677	2.51	722	2.86
5938	555	1.82	603	2.13	649	2.45	694	2.78	737	3.14
6250	578	2.09	625	2.41	669	2.74	711	3.09	753	3.45

CFM	Available External Static Pressure (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3438	713	1.89	766	2.25	816	2.64	863	3.04	907	3.46
3750	717	2.02	770	2.39	820	2.79	867	3.20	911	3.63
4063	722	2.17	774	2.55	824	2.95	870	3.37	914	3.81
4375	728	2.33	779	2.72	828	3.13	874	3.56	918	4.00
4688	736	2.52	785	2.91	832	3.32	878	3.76	922	4.21
5000	745	2.73	792	3.12	838	3.54	883	3.98	926	4.44
5313	755	2.97	801	3.36	846	3.78	889	4.23	931	4.69
5625	767	3.23	811	3.63	854	4.05	896	4.50	937	4.97
5938	780	3.52	822	3.92	864	4.35	904	4.80	944	5.27
6250	794	3.84	835	4.25	875	4.68	914	5.13	952	5.61

NOTE: For more information, see General Fan Performance Notes.

Standard static 440–609 RPM, 2.9 BHP max

Medium static 609–778 RPM, 3.7 BHP max

High static 776–955 RPM, 6.1 BHP max

FAN PERFORMANCE (cont.) ECM MULTI SPEED/TORQUE MOTOR

Table 42 – RAH036 Horizontal Unit Direct Drive

Speed (Torque) tap	CFM	ESP	BHP
1	900	0.47	0.21
	975	0.38	0.20
	1050	0.29	0.19
	1125	0.21	0.18
	1200	0.13	0.18
	1275	0.06	0.20
	1350	—	—
	1425	—	—
	1500	—	—
2	900	0.65	0.27
	975	0.54	0.26
	1050	0.44	0.25
	1125	0.33	0.24
	1200	0.23	0.23
	1275	0.13	0.21
	1350	0.02	0.20
	1425	—	—
	1500	—	—
3	900	0.96	0.38
	975	0.84	0.37
	1050	0.73	0.36
	1125	0.61	0.34
	1200	0.50	0.33
	1275	0.38	0.31
	1350	0.26	0.30
	1425	0.15	0.28
	1500	0.04	0.26
4	900	1.17	0.46
	975	1.08	0.46
	1050	0.98	0.46
	1125	0.87	0.45
	1200	0.75	0.44
	1275	0.63	0.42
	1350	0.51	0.40
	1425	0.39	0.39
	1500	0.27	0.37
5	900	1.35	0.52
	975	1.30	0.54
	1050	1.26	0.57
	1125	1.21	0.59
	1200	1.16	0.62
	1275	1.12	0.64
	1350	1.07	0.67
	1425	1.02	0.70
	1500	0.97	0.73

Table 43 – RAH036 Vertical Unit Direct Drive

Speed (Torque) tap	CFM	ESP	BHP
1	900	0.36	0.16
	975	0.27	0.16
	1050	0.18	0.15
	1125	0.10	0.15
	1200	0.04	0.16
	1275	—	—
	1350	—	—
	1425	—	—
	1500	—	—
2	900	0.51	0.21
	975	0.40	0.20
	1050	0.30	0.19
	1125	0.21	0.18
	1200	0.11	0.17
	1275	0.02	0.16
	1350	—	—
	1425	—	—
	1500	—	—
3	900	0.84	0.33
	975	0.72	0.32
	1050	0.60	0.31
	1125	0.49	0.29
	1200	0.38	0.28
	1275	0.28	0.26
	1350	0.17	0.25
	1425	0.07	0.24
	1500	—	—
4	900	1.06	0.41
	975	0.96	0.41
	1050	0.86	0.41
	1125	0.74	0.40
	1200	0.63	0.38
	1275	0.50	0.37
	1350	0.38	0.35
	1425	0.26	0.34
	1500	0.15	0.32
5	900	1.24	0.51
	975	1.19	0.52
	1050	1.14	0.54
	1125	1.08	0.57
	1200	1.03	0.59
	1275	0.98	0.61
	1350	0.93	0.64
	1425	0.88	0.67
	1500	0.82	0.69

FAN PERFORMANCE (cont.) ECM MULTI SPEED/TORQUE MOTOR

Table 44 – RAH048 Horizontal Unit Direct Drive

Speed (Torque) tap	CFM	ESP	BHP
1	1200	0.62	0.34
	1300	0.48	0.32
	1400	0.35	0.30
	1500	0.23	0.28
	1600	0.12	0.28
	1700	0.02	0.27
	1800	–	–
	1900	–	–
	2000	–	–
2	1200	0.74	0.39
	1300	0.60	0.37
	1400	0.46	0.35
	1500	0.32	0.32
	1600	0.19	0.30
	1700	0.07	0.27
	1800	–	–
	1900	–	–
	2000	–	–
3	1200	1.20	0.59
	1300	1.12	0.60
	1400	1.01	0.61
	1500	0.89	0.62
	1600	0.76	0.59
	1700	0.61	0.56
	1800	0.47	0.53
	1900	0.32	0.50
	2000	0.18	0.47
4	1200	1.24	0.60
	1300	1.18	0.63
	1400	1.11	0.65
	1500	1.03	0.69
	1600	0.93	0.69
	1700	0.82	0.69
	1800	0.70	0.69
	1900	0.56	0.66
	2000	0.41	0.63
5	1200	1.25	0.61
	1300	1.20	0.65
	1400	1.11	0.68
	1500	1.03	0.68
	1600	1.05	0.76
	1700	1.01	0.76
	1800	0.96	0.84
	1900	0.91	0.89
	2000	0.87	0.93

Table 45 – RAH048 Vertical Unit Direct Drive

Speed (Torque) tap	CFM	ESP	BHP
1	1200	0.57	0.31
	1300	0.44	0.29
	1400	0.30	0.27
	1500	0.16	0.25
	1600	0.03	0.25
	1700	–	–
	1800	–	–
	1900	–	–
	2000	–	–
	2	1200	0.68
1300		0.54	0.33
1400		0.40	0.31
1500		0.24	0.28
1600		0.10	0.26
1700		–	–
1800		–	–
1900		–	–
2000		–	–
3		1200	1.15
	1300	1.09	0.54
	1400	1.02	0.55
	1500	0.93	0.58
	1600	0.82	0.57
	1700	0.69	0.55
	1800	0.54	0.52
	1900	0.38	0.50
	2000	0.21	0.47
	4	1200	1.16
1300		1.12	0.59
1400		1.07	0.61
1500		1.00	0.65
1600		0.92	0.65
1700		0.80	0.66
1800		0.67	0.65
1900		0.51	0.62
2000		0.34	0.59
5		1200	1.16
	1300	1.11	0.63
	1400	1.00	0.67
	1500	0.88	0.67
	1600	0.96	0.75
	1700	0.91	0.75
	1800	0.86	0.83
	1900	0.80	0.87
	2000	0.74	0.91

FAN PERFORMANCE (cont.) ECM MULTI SPEED/TORQUE MOTOR

Table 46 – RAH060 Horizontal Unit Direct Drive

Speed (Torque) tap	CFM	ESP	BHP
1	1500	0.63	0.49
	1625	0.45	0.46
	1750	0.27	0.43
	1875	0.10	0.39
	2000	—	—
	2125	—	—
	2250	—	—
	2375	—	—
2500	—	—	
2	1500	0.88	0.61
	1625	0.69	0.58
	1750	0.49	0.55
	1875	0.30	0.51
	2000	0.12	0.48
	2125	—	—
	2250	—	—
	2375	—	—
2500	—	—	
3	1500	1.37	0.89
	1625	1.20	0.87
	1750	1.02	0.86
	1875	0.81	0.83
	2000	0.60	0.79
	2125	0.39	0.75
	2250	0.21	0.71
	2375	0.07	0.67
2500	—	—	
4	1500	1.48	0.95
	1625	1.35	0.95
	1750	1.20	0.99
	1875	1.03	0.99
	2000	0.83	0.96
	2125	0.63	0.93
	2250	0.42	0.89
	2375	0.22	0.84
2500	0.05	0.78	
5	1500	1.52	0.97
	1625	1.42	1.01
	1750	1.20	1.05
	1875	1.03	1.09
	2000	1.00	1.09
	2125	0.82	1.06
	2250	0.62	1.02
	2375	0.40	0.98
2500	0.16	0.93	

Table 47 – RAH060 Vertical Unit Direct Drive

Speed (Torque) tap	CFM	ESP	BHP
1	1500	0.50	0.44
	1625	0.32	0.42
	1750	0.14	0.39
	1875	—	—
	2000	—	—
	2125	—	—
	2250	—	—
	2375	—	—
	2500	—	—
2	1500	0.72	0.56
	1625	0.53	0.53
	1750	0.34	0.50
	1875	0.18	0.48
	2000	—	—
	2125	—	—
	2250	—	—
	2375	—	—
	2500	—	—
3	1500	1.20	0.84
	1625	1.02	0.82
	1750	0.82	0.82
	1875	0.61	0.79
	2000	0.40	0.75
	2125	0.20	0.71
	2250	0.04	0.67
	2375	—	—
	2500	—	—
4	1500	1.31	0.92
	1625	1.17	0.92
	1750	0.99	0.95
	1875	0.80	0.94
	2000	0.59	0.90
	2125	0.37	0.86
	2250	0.17	0.83
	2375	0.00	0.79
	2500	—	—
5	1500	1.36	0.94
	1625	1.24	0.99
	1750	0.99	1.02
	1875	0.80	1.05
	2000	0.74	1.03
	2125	0.53	0.99
	2250	0.31	0.94
	2375	0.08	0.90
	2500	—	0.86

FAN PERFORMANCE (cont.)

Table 48 – PULLEY ADJUSTMENT

UNIT RAH		Motor/Drive Combo	Motor Pulley turns open										
			0	0.5	1	1.5	2	2.5	3	3.5	4	4.5	5
036	3 Phase	Medium Static	1175	1135	1094	1054	1013	973	932	892	851	811	770
		High Static	1466	1423	1380	1337	1294	1251	1207	1164	1121	1078	1035
048	3 Phase	Medium Static	1303	1265	1226	1188	1150	1112	1073	1035	997	958	920
		High Static	1639	1596	1553	1510	1467	1424	1380	1337	1294	1251	1208
060	3 Phase	Medium Static	1466	1423	1380	1337	1294	1251	1207	1164	1121	1078	1035
		High Static	1687	1649	1610	1572	1533	1495	1457	1418	1380	1341	1303
072	3 Phase	Standard Static	747	721	695	670	644	618	592	566	541	515	489
		Medium Static	949	927	906	884	863	841	819	798	776	755	733
		High Static	1102	1083	1063	1044	1025	1006	986	967	948	928	909
090	3 Phase	Standard Static	733	712	690	669	647	626	604	583	561	540	518
		Medium Static	936	911	887	862	838	813	788	764	739	715	690
		High Static	1084	1059	1035	1010	986	961	936	912	887	863	838
102	3 Phase	Standard Static	733	712	690	669	647	626	604	583	561	540	518
		Medium Static	936	911	887	862	838	813	788	764	739	715	690
		High Static	1084	1059	1035	1010	986	961	936	912	887	863	838
120	3 Phase	Standard Static	838	813	789	764	739	715	690	665	640	616	591
		Medium Static	1084	1059	1035	1010	986	961	936	912	887	863	838
		High Static	1240	1218	1196	1175	1153	1131	1109	1087	1066	1044	1022
150	3 Phase	Standard Static	609	592	575	558	541	525	508	491	474	457	440
		Medium Static	778	761	744	727	710	694	677	660	643	626	609
		High Static	955	973	951	929	907	886	864	842	820	798	776

■ – Factory settings

ELECTRICAL DATA FOR UNITS PRODUCED ON OR AFTER JULY 30, 2012

NOTE: Check the serial number of unit to verify production date.

SERIAL NUMBER

1	2	3	4	5	6	7	8	9	10
U	1	2	3	1	1	2	3	4	5

Manufacture Location

Week of Manufacture
(fiscal calendar)

Sequence Number

Year of Manufacture
(12 = 2012)

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012)

TABLE 49 – RAH036 SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (ea)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-1-60	187	253	16.6	79	190	1.0	DD-STD	78%	7.4
					190	1.0	STD	67%	4.9
					190	1.0	MED	67%	4.9
230-1-60	187	253	16.6	79	190	1.0	DD-STD	78%	7.4
					190	1.0	STD	67%	4.9
					190	1.0	MED	67%	4.9
208-3-60	187	253	10.4	73	190	1.0	DD-STD	78%	7.4
					190	1.0	STD	75%	5.2
					190	1.0	MED	75%	5.2
					190	1.0	HIGH	87%	6.9
230-3-60	187	253	10.4	73	190	1.0	DD-STD	78%	7.4
					190	1.0	STD	75%	5.2
					190	1.0	MED	75%	5.2
					190	1.0	HIGH	87%	6.7
460-3-60	414	506	5.8	38	190	0.5	DD-STD	78%	4.0
					190	0.5	STD	75%	2.6
					190	0.5	MED	75%	2.6
					190	0.5	HIGH	87%	3.4
575-3-60	518	633	3.8	37	190	0.5	DD-STD	78%	4.0
					190	0.5	STD	73%	1.2
					190	0.5	MED	73%	1.2
					190	0.5	HIGH	78%	2.0

TABLE 50 – RAH048 SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (ea)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-1-60	187	253	21.8	117	325	1.4	DD-STD	78%	7.4
					325	1.4	STD	67%	4.9
					325	1.4	MED	67%	4.9
230-1-60	187	253	21.8	117	325	1.4	DD-STD	78%	7.4
					325	1.4	STD	67%	4.9
					325	1.4	MED	67%	4.9
208-3-60	187	253	13.7	83	325	1.4	DD-STD	78%	7.4
					325	1.4	STD	75%	5.2
					325	1.4	MED	87%	5.2
					325	1.4	HIGH	89%	8.4
230-3-60	187	253	13.7	83	325	1.4	DD-STD	78%	7.4
					325	1.4	STD	75%	5.2
					325	1.4	MED	87%	4.9
					325	1.4	HIGH	89%	8.3
460-3-60	414	506	6.2	41	325	0.9	DD-STD	78%	4.0
					325	0.9	STD	75%	2.6
					325	0.9	MED	87%	2.5
					325	0.9	HIGH	89%	4.2
575-3-60	518	633	4.8	33	325	0.9	DD-STD	78%	4.0
					325	0.9	STD	73%	1.2
					325	0.9	MED	72%	1.6
					325	0.9	HIGH	77%	2.8

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

TABLE 51 – RAH060 SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (ea)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-1-60	187	253	25.0	134	325	1.4	DD-STD	78%	7.4
					325	1.4	STD	67%	4.9
					325	1.4	MED	76%	7.0
230-1-60	187	253	25.0	134	325	1.4	DD-STD	78%	7.4
					325	1.4	STD	67%	4.9
					325	1.4	MED	76%	7.0
208-3-60	187	253	15.9	110	325	1.4	DD-STD	78%	7.4
					325	1.4	STD	75%	5.2
					325	1.4	MED	87%	6.9
230-3-60	187	253	15.9	110	325	1.4	HIGH	89%	8.4
					325	1.4	DD-STD	78%	7.4
					325	1.4	STD	75%	5.2
460-3-60	414	506	7.0	52	325	1.4	MED	87%	6.7
					325	1.4	HIGH	89%	8.3
					325	0.9	DD-STD	78%	4.0
575-3-60	518	633	5.1	40	325	0.9	STD	75%	2.6
					325	0.9	MED	87%	3.4
					325	0.9	HIGH	89%	4.2
208-3-60	187	253	19.0	123	325	0.9	DD-STD	78%	4.0
					325	0.9	STD	73%	1.2
					325	0.9	MED	78%	2.0
575-3-60	518	633	5.1	40	325	0.9	HIGH	77%	2.8

TABLE 52 – RAH072 SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (ea)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	19.0	123	325	1.5	STD	87%	5.2
					325	1.5	MED	89%	8.4
					325	1.5	HIGH	83%	13.6
230-3-60	187	253	19.0	123	325	1.5	STD	87%	4.9
					325	1.5	MED	89%	8.3
					325	1.5	HIGH	83%	12.7
460-3-60	414	506	9.7	62	325	0.8	STD	87%	2.5
					325	0.8	MED	89%	4.2
					325	0.8	HIGH	83%	6.4
575-3-60	518	633	7.4	50	325	0.6	STD	72%	1.6
					325	0.6	MED	77%	2.8
					325	0.6	HIGH	81%	5.6

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

TABLE 53 – RAH090
2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	13.6	83	13.6	83	325	1.5	STD	87%	5.2
							325	1.5	MED	87%	6.9
							325	1.5	HIGH	87%	10.6
230-3-60	187	253	13.6	83	13.6	83	325	1.5	STD	87%	4.9
							325	1.5	MED	87%	6.7
							325	1.5	HIGH	87%	10.6
460-3-60	414	506	6.1	41	6.1	41	325	0.8	STD	87%	2.5
							325	0.8	MED	87%	3.4
							325	0.8	HIGH	87%	5.3
575-3-60	518	633	4.2	33	4.2	33	325	0.6	STD	72%	1.6
							325	0.6	MED	78%	2
							325	0.6	HIGH	77%	2.8

TABLE 54 – RAH102
2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	13.7	83	13.7	83	325	1.5	STD	87%	5.2
							325	1.5	MED	87%	6.9
							325	1.5	HIGH	87%	10.6
230-3-60	187	253	13.7	83	13.7	83	325	1.5	STD	87%	4.9
							325	1.5	MED	87%	6.7
							325	1.5	HIGH	87%	10.6
460-3-60	414	506	6.2	41	6.2	41	325	0.8	STD	87%	2.5
							325	0.8	MED	87%	3.4
							325	0.8	HIGH	87%	5.3
575-3-60	518	633	4.8	33	4.8	33	325	0.6	STD	72%	1.6
							325	0.6	MED	78%	2
							325	0.6	HIGH	77%	2.8

TABLE 55 – RAH110
2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	15.9	110	15.9	110	610	7.4	STD	87%	6.9
							610	7.4	MED	87%	10.6
							610	7.4	HIGH	83%	13.6
230-3-60	187	253	15.9	110	15.9	110	610	7.4	STD	87%	6.7
							610	7.4	MED	87%	10.6
							610	7.4	HIGH	83%	12.7
460-3-60	414	506	7.0	52	7.0	52	610	3.6	STD	87%	3.4
							610	3.6	MED	87%	5.3
							610	3.6	HIGH	83%	6.4
575-3-60	518	633	5.1	40	5.1	40	610	3.6	STD	78%	2
							610	3.6	MED	77%	2.8
							610	3.6	HIGH	81%	5.6

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

TABLE 56 – RAH120
2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	15.9	110	15.9	110	1070	6.2	STD	87%	6.9
							1070	6.2	MED	87%	10.6
							1070	6.2	HIGH	83%	13.6
230-3-60	187	253	15.9	110	15.9	110	1070	6.2	STD	87%	6.7
							1070	6.2	MED	87%	10.6
							1070	6.2	HIGH	83%	12.7
460-3-60	414	506	7.7	52	7.7	52	1070	3.1	STD	87%	3.4
							1070	3.1	MED	87%	5.3
							1070	3.1	HIGH	83%	6.4
575-3-60	518	633	5.7	39	5.7	39	1070	2.5	STD	78%	2
							1070	2.5	MED	77%	2.8
							1070	2.5	HIGH	81%	5.6

TABLE 57 – RAH150
2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	19.0	123	19.0	123	280	1.5	STD	89%	8.4
							280	1.5	MED	87%	10.6
							280	1.5	HIGH	90%	20.4
230-3-60	187	253	19.0	123	19.0	123	280	1.5	STD	89%	8.3
							280	1.5	MED	87%	10.6
							280	1.5	HIGH	90%	20.4
460-3-60	414	506	9.7	62	9.7	62	280	0.8	STD	89%	4.2
							280	0.8	MED	87%	5.3
							280	0.8	HIGH	90%	10.2
575-3-60	518	633	7.4	50	7.4	50	280	0.7	STD	77%	2.8
							280	0.7	MED	77%	2.8
							280	0.7	HIGH	94%	9

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

TABLE 58 – RAH090
2-STAGE COOLING WITH 2-SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	13.6	83	13.6	83	325	1.5	STD	84%	5.8
							325	1.5	MED	77%	7.1
							325	1.5	HIGH	82%	10.8
230-3-60	187	253	13.6	83	13.6	83	325	1.5	STD	84%	5.6
							325	1.5	MED	77%	6.8
							325	1.5	HIGH	82%	9.8
460-3-60	414	506	6.1	41	6.1	41	325	0.8	STD	79%	2.9
							325	0.8	MED	77%	3.8
							325	0.8	HIGH	82%	4.9
575-3-60	518	633	4.2	33	4.2	33	325	0.6	STD	81%	2.8
							325	0.6	MED	80%	3.5
							325	0.6	HIGH	84%	4.5

TABLE 59 – RAH102
2-STAGE COOLING WITH 2-SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	13.7	83	13.7	83	325	1.5	STD	84%	5.8
							325	1.5	MED	77%	7.1
							325	1.5	HIGH	82%	10.8
230-3-60	187	253	13.7	83	13.7	83	325	1.5	STD	84%	5.6
							325	1.5	MED	77%	6.8
							325	1.5	HIGH	82%	9.8
460-3-60	414	506	6.2	41	6.2	41	325	0.8	STD	79%	2.9
							325	0.8	MED	77%	3.8
							325	0.8	HIGH	82%	4.9
575-3-60	518	633	4.8	33	4.8	33	325	0.6	STD	81%	2.8
							325	0.6	MED	80%	3.5
							325	0.6	HIGH	84%	4.5

TABLE 60 – RAH110
2-STAGE COOLING WITH 2-SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	15.9	110	15.9	110	610	7.4	STD	77%	7.1
							610	7.4	MED	82%	10.8
							610	7.4	HIGH	84%	13.6
230-3-60	187	253	15.9	110	15.9	110	610	7.4	STD	77%	6.8
							610	7.4	MED	82%	9.8
							610	7.4	HIGH	84%	12.7
460-3-60	414	506	7.0	52	7.0	52	610	3.6	STD	77%	3.8
							610	3.6	MED	82%	4.9
							610	3.6	HIGH	84%	6.4
575-3-60	518	633	5.1	40	5.1	40	610	3.6	STD	80%	3.5
							610	3.6	MED	84%	4.5
							610	3.6	HIGH	83%	6.2

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

TABLE 61 – RAH120
2-STAGE COOLING WITH 2-SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	15.9	110	15.9	110	1070	6.2	STD	77%	7.1
							1070	6.2	MED	82%	10.8
							1070	6.2	HIGH	84%	13.6
230-3-60	187	253	15.9	110	15.9	110	1070	6.2	STD	77%	6.8
							1070	6.2	MED	82%	9.8
							1070	6.2	HIGH	84%	12.7
460-3-60	414	506	7.7	52	7.7	52	1070	3.1	STD	77%	3.8
							1070	3.1	MED	82%	4.9
							1070	3.1	HIGH	84%	6.4
575-3-60	518	633	5.7	39	5.7	39	1070	2.5	STD	80%	3.5
							1070	2.5	MED	84%	4.5
							1070	2.5	HIGH	83%	6.2

TABLE 62 – RAH150
2-STAGE COOLING WITH 2-SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	19.0	123	19.0	123	280	1.5	STD	85%	8.6
							280	1.5	MED	82%	10.8
							280	1.5	HIGH	90%	20.4
230-3-60	187	253	19.0	123	19.0	123	280	1.5	STD	85%	7.8
							280	1.5	MED	82%	9.8
							280	1.5	HIGH	90%	20.4
460-3-60	414	506	9.7	62	9.7	62	280	0.8	STD	85%	3.8
							280	0.8	MED	82%	4.9
							280	0.8	HIGH	90%	10.2
575-3-60	518	633	7.4	50	7.4	50	280	0.7	STD	84%	4.5
							280	0.7	MED	84%	4.5
							280	0.7	HIGH	94%	9

**ELECTRICAL INFORMATION
(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.**

Table 63 – RAH036

**ELECTRIC HEAT – ELECTRICAL DATA
SINGLE STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR**

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE		
					NO C.O. or UNPWRD C.O.		
					NO P.E.	w/PE. (pwrd fr/unit)	
208/ 230–1–60	DD–STD	101A00	4.4	3.3/4.0	–	–	
		102A00	6.5	4.9/6.0	–	–	
		103B00	8.7	6.5/8.0	037	037	
		104B00	10.5	7.9/9.6	040	040	
		102A00,102A00	13.0	9.8/11.9	040	040	
208/ 230–3–60	DD–STD	101A00	4.4	3.3/4.0	–	–	
		102A00	6.5	4.9/6.0	–	–	
		103B00	8.7	6.5/8.0	–	–	
		104B00	10.5	7.9/9.6	–	–	
		105A00	16.0	12.0/14.7	037	037	
	MED	101A00	4.4	3.3/4.0	–	–	
		102A00	6.5	4.9/6.0	–	–	
		103B00	8.7	6.5/8.0	–	–	
		104B00	10.5	7.9/9.6	–	–	
		105A00	16.0	12.0/14.7	037	037	
	HIGH	101A00	4.4	3.3/4.0	–	–	
		102A00	6.5	4.9/6.0	–	–	
		103B00	8.7	6.5/8.0	–	–	
		104B00	10.5	7.9/9.6	–	–	
		105A00	16.0	12.0/14.7	037	037	
460–3–60	DD–STD	106A00	6.0	5.5	–	–	
		107A00	8.8	8.1	–	–	
		108A00	11.5	10.6	–	–	
		109A00	14.0	12.9	–	–	
	MED	106A00	6.0	5.5	–	–	
		107A00	8.8	8.1	–	–	
		108A00	11.5	10.6	–	–	
		109A00	14.0	12.9	–	–	
	HIGH	106A00	6.0	5.5	–	–	
		107A00	8.8	8.1	–	–	
		108A00	11.5	10.6	–	–	
		109A00	14.0	12.9	–	–	
	575–3–60	DD–STD	297A00	9.2	9.2	–	–
			298A00	13.8	13.8	–	–
		MED	297A00	9.2	9.2	–	–
298A00			13.8	13.8	–	–	
HIGH		297A00	9.2	9.2	–	–	
		298A00	13.8	13.8	–	–	

**ELECTRICAL INFORMATION
(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.**

Table 64 – RAH048

**ELECTRIC HEAT – ELECTRICAL DATA
SINGLE STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR**

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230–1–60	DD–STD	101A00	4.4	3.3/4.0	–	–
		103B00	8.7	6.5/8.0	037	037
		102A00,102A00	13.0	9.8/11.9	040	040
		103B00,103B00	17.4	13.1/16.0	040	040
		104B00,104B00	21.0	15.8/19.3	040	040
208/ 230–3–60	DD–STD	102A00	6.5	4.9/6.0	–	–
		103B00	8.7	6.5/8.0	–	–
		105A00	16.0	12.0/14.7	037	037
		104B00,104B00	21.0	15.8/19.3	038	038
	MED	102A00	6.5	4.9/6.0	–	–
		103B00	8.7	6.5/8.0	–	–
		105A00	16.0	12.0/14.7	037	037
		104B00,104B00	21.0	15.8/19.3	038	038
	HIGH	102A00	6.5	4.9/6.0	–	–
		103B00	8.7	6.5/8.0	–	–
		105A00	16.0	12.0/14.7	037	038
		104B00,104B00	21.0	15.8/19.3	038	038
460–3–60	DD–STD	106A00	6.0	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14.0	12.9	–	–
		108A00,108A00	23.0	21.1	037	037
	MED	106A00	6.0	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14.0	12.9	–	–
		108A00,108A00	23.0	21.1	037	037
	HIGH	106A00	6.0	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14.0	12.9	–	–
		108A00,108A00	23.0	21.1	037	037
575–3–60	DD–STD	297A00	9.2	9.2	–	–
		298A00	13.8	13.8	–	–
	MED	297A00	9.2	9.2	–	–
		298A00	13.8	13.8	–	–
	HIGH	297A00	9.2	9.2	–	–
		298A00	13.8	13.8	–	–

ELECTRICAL INFORMATION (UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 65 – RAH060

ELECTRIC HEAT – ELECTRICAL DATA SINGLE STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO PE.	w/PE. (pwrd fr/unit)
208/ 230–1–60	DD–STD	102A00	6.5	4.9/6.0	–	–
		103B00	8.7	6.5/8.0	037	037
		102A00,102A00	13.0	9.8/11.9	040	040
		103B00,103B00	17.4	13.1/16.0	040	040
		104B00,104B00	21.0	15.8/19.3	040	040
208/ 230–3–60	DD–STD	102A00	6.5	4.9/6.0	–	–
		104B00	10.5	7.9/9.6	–	–
		105A00	16.0	12.0/14.7	037	037
		104B00,104B00	21.0	15.8/19.3	038	038
		104B00,105A00	26.5	19.9/24.3	038	038
	MED	102A00	6.5	4.9/6.0	–	–
		104B00	10.5	7.9/9.6	–	–
		105A00	16.0	12.0/14.7	037	037
		104B00,104B00	21.0	15.8/19.3	038	038
		104B00,105A00	26.5	19.9/24.3	038	038
	HIGH	102A00	6.5	4.9/6.0	–	–
		104B00	10.5	7.9/9.6	–	–
105A00		16.0	12.0/14.7	037	038	
104B00,104B00		21.0	15.8/19.3	038	038	
104B00,105A00		26.5	19.9/24.3	038	038	
460–3–60	DD–STD	106A00	6.0	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14.0	12.9	–	–
		108A00,108A00	23.0	21.1	037	037
		108A00,109A00	25.5	23.4	037	037
	MED	106A00	6.0	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14.0	12.9	–	–
		108A00,108A00	23.0	21.1	037	037
		108A00,109A00	25.5	23.4	037	037
	HIGH	106A00	6.0	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14.0	12.9	–	–
		108A00,108A00	23.0	21.1	037	037
		108A00,109A00	25.5	23.4	037	037
575–3–60	DD–STD	298A00	13.8	13.8	–	–
		301A00	23.0	23.0	037	037
	STD	298A00	13.8	13.8	–	–
		301A00	23.0	23.0	037	037
	MED	298A00	13.8	13.8	–	–
		301A00	23.0	23.0	037	037
	HIGH	298A00	13.8	13.8	–	–
		301A00	23.0	23.0	037	037

NOTE: STD and MED IFM type are belt drive for 1 phase HC w/Hot Gas Reheat. HC 1 phase w/o Hot Gas Reheat must use DD–STD IFM type only.

ELECTRICAL INFORMATION (UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 66 – RAH036

**ELECTRIC HEAT – ELECTRICAL DATA
SINGLE STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR W/NON-FUSED DISCONNECT**

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE		
					NO C.O. or UNPWRD C.O.		
					NO P.E.	w/P.E. (pwrd fr/unit)	
208/ 230–1–60	DD–STD	101A00	4.4	3.3/4.0	037	037	
		102A00	6.5	4.9/6.0	037	037	
		103B00	8.7	6.5/8.0	037	037	
		104B00	10.5	7.9/9.6	040	040	
		102A00,102A00	13.0	9.8/11.9	040	040	
208/ 230–3–60	DD–STD	101A00	4.4	3.3/4.0	037	037	
		102A00	6.5	4.9/6.0	037	037	
		103B00	8.7	6.5/8.0	037	037	
		104B00	10.5	7.9/9.6	037	037	
		105A00	16.0	12.0/14.7	037	037	
	MED	101A00	4.4	3.3/4.0	037	037	
		102A00	6.5	4.9/6.0	037	037	
		103B00	8.7	6.5/8.0	037	037	
		104B00	10.5	7.9/9.6	037	037	
		105A00	16.0	12.0/14.7	037	037	
	HIGH	101A00	4.4	3.3/4.0	037	037	
		102A00	6.5	4.9/6.0	037	037	
		103B00	8.7	6.5/8.0	037	037	
		104B00	10.5	7.9/9.6	037	037	
		105A00	16.0	12.0/14.7	037	037	
460–3–60	DD–STD	106A00	6.0	5.5	–	–	
		107A00	8.8	8.1	–	–	
		108A00	11.5	10.6	–	–	
		109A00	14.0	12.9	–	–	
	MED	106A00	6.0	5.5	–	–	
		107A00	8.8	8.1	–	–	
		108A00	11.5	10.6	–	–	
		109A00	14.0	12.9	–	–	
	HIGH	106A00	6.0	5.5	–	–	
		107A00	8.8	8.1	–	–	
		108A00	11.5	10.6	–	–	
		109A00	14.0	12.9	–	–	
	575–3–60	DD–STD	297A00	9.2	9.2	–	–
			298A00	13.8	13.8	–	–
		MED	297A00	9.2	9.2	–	–
298A00			13.8	13.8	–	–	
HIGH		297A00	9.2	9.2	–	–	
		298A00	13.8	13.8	–	–	

ELECTRICAL INFORMATION (UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 67 – RAH048

**ELECTRIC HEAT – ELECTRICAL DATA
SINGLE STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR W/NON-FUSED DISCONNECT**

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230–1–60	DD–STD	101A00	4.4	3.3/4.0	037	037
		103B00	8.7	6.5/8.0	037	037
		102A00,102A00	13.0	9.8/11.9	040	040
		103B00,103B00	17.4	13.1/16.0	040	040
		104B00,104B00	21.0	15.8/19.3	040	040
208/ 230–3–60	DD–STD	102A00	6.5	4.9/6.0	037	037
		103B00	8.7	6.5/8.0	037	037
		105A00	16.0	12.0/14.7	037	037
		104B00,104B00	21.0	15.8/19.3	038	038
	MED	102A00	6.5	4.9/6.0	037	037
		103B00	8.7	6.5/8.0	037	037
		105A00	16.0	12.0/14.7	037	037
		104B00,104B00	21.0	15.8/19.3	038	038
	HIGH	102A00	6.5	4.9/6.0	037	037
		103B00	8.7	6.5/8.0	037	037
		105A00	16.0	12.0/14.7	037	038
		104B00,104B00	21.0	15.8/19.3	038	038
460–3–60	DD–STD	106A00	6.0	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14.0	12.9	–	–
		108A00,108A00	23.0	21.1	037	037
	MED	106A00	6.0	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14.0	12.9	–	–
		108A00,108A00	23.0	21.1	037	037
	HIGH	106A00	6.0	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14.0	12.9	–	–
		108A00,108A00	23.0	21.1	037	037
575–3–60	DD–STD	297A00	9.2	9.2	–	–
		298A00	13.8	13.8	–	–
	MED	297A00	9.2	9.2	–	–
		298A00	13.8	13.8	–	–
	HIGH	297A00	9.2	9.2	–	–
		298A00	13.8	13.8	–	–

ELECTRICAL INFORMATION (UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 68 – RAH060

**ELECTRIC HEAT – ELECTRICAL DATA
SINGLE STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR W/NON-FUSED DISCONNECT**

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO PE.	w/P.E. (pwrd fr/unit)
208/ 230–1–60	DD–STD	102A00	6.5	4.9/6.0	037	037
		103B00	8.7	6.5/8.0	037	037
		102A00,102A00	13.0	9.8/11.9	040	040
		103B00,103B00	17.4	13.1/16.0	040	040
		104B00,104B00	21.0	15.8/19.3	040	040
208/ 230–3–60	DD–STD	102A00	6.5	4.9/6.0	037	037
		104B00	10.5	7.9/9.6	037	037
		105A00	16.0	12.0/14.7	037	037
		104B00,104B00	21.0	15.8/19.3	038	038
		104B00,105A00	26.5	19.9/24.3	038	038
	MED	102A00	6.5	4.9/6.0	037	037
		104B00	10.5	7.9/9.6	037	037
		105A00	16.0	12.0/14.7	037	037
		104B00,104B00	21.0	15.8/19.3	038	038
		104B00,105A00	26.5	19.9/24.3	038	038
	HIGH	102A00	6.5	4.9/6.0	037	037
		104B00	10.5	7.9/9.6	037	037
105A00		16.0	12.0/14.7	037	038	
104B00,104B00		21.0	15.8/19.3	038	038	
104B00,105A00		26.5	19.9/24.3	038	038	
460–3–60	DD–STD	106A00	6.0	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14.0	12.9	–	–
		108A00,108A00	23.0	21.1	037	037
		108A00,109A00	25.5	23.4	037	037
	MED	106A00	6.0	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14.0	12.9	–	–
		108A00,108A00	23.0	21.1	037	037
		108A00,109A00	25.5	23.4	037	037
	HIGH	106A00	6.0	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14.0	12.9	–	–
		108A00,108A00	23.0	21.1	037	037
		108A00,109A00	25.5	23.4	037	037
575–3–60	DD–STD	298A00	13.8	13.8	–	–
		301A00	23.0	23.0	037	037
	MED	298A00	13.8	13.8	–	–
		301A00	23.0	23.0	037	037
	HIGH	298A00	13.8	13.8	–	–
		301A00	23.0	23.0	037	037

ELECTRICAL INFORMATION (UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 69 – RAH072

ELECTRIC HEAT – ELECTRICAL DATA SINGLE STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO PE.	w/PE. (pwrd fr/unit)
208/ 230–3–60	STD	264A00	6.5	4.9/6.0	042	042
		117A00	10.4	7.8/9.6	042	042
		110A00	16.0	12.0/14.7	042	042
		117A00,117A00	21.0	15.8/19.3	043	043
		110A00,117A00	26.5	19.9/24.3	043	043
	MED	264A00	6.5	4.9/6.0	042	042
		117A00	10.4	7.8/9.6	042	042
		110A00	16.0	12.0/14.7	042	043
		117A00,117A00	21.0	15.8/19.3	043	043
110A00,117A00		26.5	19.9/24.3	043	043	
HIGH	264A00	6.5	4.9/6.0	042	042	
	117A00	10.4	7.8/9.6	042	042	
	110A00	16.0	12.0/14.7	043	043	
	117A00,117A00	21.0	15.8/19.3	043	043	
	110A00,117A00	26.5	19.9/24.3	043	043	
460–3–60	STD	265A00	6.0	5.5	042	042
		266A00	11.5	10.6	042	042
		267A00	14.0	12.9	042	042
		268A00	23.0	21.1	042	042
		269A00	25.5	23.4	042	042
	MED	265A00	6.0	5.5	042	042
		266A00	11.5	10.6	042	042
		267A00	14.0	12.9	042	042
		268A00	23.0	21.1	042	042
		269A00	25.5	23.4	042	042
	HIGH	265A00	6.0	5.5	042	042
		266A00	11.5	10.6	042	042
		267A00	14.0	12.9	042	042
		268A00	23.0	21.1	042	042
		269A00	25.5	23.4	042	042
575–3–60	STD	118A00	17.0	17.0	042	042
		299A00	25.7	25.7	042	042
	MED	118A00	17.0	17.0	042	042
		299A00	25.7	25.7	042	042
	HIGH	118A00	17.0	17.0	042	042
		299A00	25.7	25.7	042	042

**ELECTRICAL INFORMATION
(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.**

TABLE 70 – RAH090

**ELECTRIC HEAT – ELECTRICAL DATA
2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR**

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047	047
		110A00	16.0	12.0/14.7	047	047
		111A00	24.8	18.6/22.8	049	049
		112A00	32.0	24.0/29.4	049	049
		112A00,117A00	42.4	31.8/38.9	051	051
	MED	117A00	10.4	7.8/9.6	047	047
		110A00	16.0	12.0/14.7	047	049
		111A00	24.8	18.6/22.8	049	049
		112A00	32.0	24.0/29.4	049	049
		112A00,117A00	42.4	31.8/38.9	051	051
	HIGH	117A00	10.4	7.8/9.6	047	047
		110A00	16.0	12.0/14.7	049	049
111A00		24.8	18.6/22.8	049	049	
112A00		32.0	24.0/29.4	049	049	
112A00,117A00		42.4	31.8/38.9	051	051	
460–3–60	STD	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		114A00	27.8	25.5	047	047
		115A00	33.0	30.3	047	047
		114A00,116A00	41.7	38.3	050	050
	MED	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		114A00	27.8	25.5	047	047
		115A00	33.0	30.3	047	047
		114A00,116A00	41.7	38.3	050	050
	HIGH	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		114A00	27.8	25.5	047	047
		115A00	33.0	30.3	047	047
		114A00,116A00	41.7	38.3	050	050
575–3–60	STD	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	047
	MED	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	047
	HIGH	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	047

**ELECTRICAL INFORMATION
(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.**

TABLE 71 – RAH102

**ELECTRIC HEAT – ELECTRICAL DATA
2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR**

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/PE. (pwrd fr/unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047	047
		110A00	16.0	12.0/14.7	047	047
		111A00	24.8	18.6/22.8	049	049
		112A00	32.0	24.0/29.4	049	049
		112A00,117A00	42.4	31.8/38.9	051	051
	MED	117A00	10.4	7.8/9.6	047	047
		110A00	16.0	12.0/14.7	047	049
		111A00	24.8	18.6/22.8	049	049
		112A00	32.0	24.0/29.4	049	049
112A00,117A00		42.4	31.8/38.9	051	051	
HIGH	117A00	10.4	7.8/9.6	047	047	
	110A00	16.0	12.0/14.7	049	049	
	111A00	24.8	18.6/22.8	049	049	
	112A00	32.0	24.0/29.4	049	049	
	112A00,117A00	42.4	31.8/38.9	051	051	
460–3–60	STD	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		114A00	27.8	25.5	047	047
		115A00	33.0	30.3	047	047
		114A00,116A00	41.7	38.3	050	050
	MED	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		114A00	27.8	25.5	047	047
		115A00	33.0	30.3	047	047
114A00,116A00		41.7	38.3	050	050	
HIGH	116A00	13.9	12.8	047	047	
	113A00	16.5	15.2	047	047	
	114A00	27.8	25.5	047	047	
	115A00	33.0	30.3	047	047	
	114A00,116A00	41.7	38.3	050	050	
575–3–60	STD	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	047
	MED	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	047
	HIGH	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	047

**ELECTRICAL INFORMATION
(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.**

TABLE 72 – RAH110

**ELECTRIC HEAT – ELECTRICAL DATA
2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR**

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO PE.	w/PE. (pwrd fr/unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047	047
		110A00	16.0	12.0/14.7	047	049
		112A00	32.0	24.0/29.4	049	049
		112A00,117A00	42.4	31.8/38.9	051	051
		112A00,110A00	50.0	37.6/45.9	051	051
	MED	117A00	10.4	7.8/9.6	047	049
		110A00	16.0	12.0/14.7	049	049
		112A00	32.0	24.0/29.4	049	049
		112A00,117A00	42.4	31.8/38.9	051	051
		112A00,110A00	50.0	37.6/45.9	051	051
	HIGH	117A00	10.4	7.8/9.6	049	049
		110A00	16.0	12.0/14.7	049	049
112A00		32.0	24.0/29.4	049	049	
112A00,117A00		42.4	31.8/38.9	051	051	
112A00,110A00		50.0	37.6/45.9	051	051	
460–3–60	STD	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		115A00	33.0	30.3	047	047
		114A00,116A00	41.7	38.3	050	050
		115A00,113A00	50.0	45.9	050	050
	MED	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		115A00	33.0	30.3	047	047
		114A00,116A00	41.7	38.3	050	050
		115A00,113A00	50.0	45.9	050	050
	HIGH	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
115A00		33.0	30.3	047	047	
114A00,116A00		41.7	38.3	050	050	
115A00,113A00		50.0	45.9	050	050	
575–3–60	STD	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	047
		118A00,119A00	51.0	51.0	050	050
	MED	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	047
		118A00,119A00	51.0	51.0	050	050
	HIGH	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	050
		118A00,119A00	51.0	51.0	050	050

**ELECTRICAL INFORMATION
(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.**

TABLE 73 – RAH120

**ELECTRIC HEAT – ELECTRICAL DATA
2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR**

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO PE.	w/PE. (pwrd fr/unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047	047
		110A00	16.0	12.0/14.7	047	049
		112A00	32.0	24.0/29.4	049	049
		112A00,117A00	42.4	31.8/38.9	051	051
		112A00,110A00	50.0	37.6/45.9	051	051
	MED	117A00	10.4	7.8/9.6	047	049
		110A00	16.0	12.0/14.7	049	049
		112A00	32.0	24.0/29.4	049	049
		112A00,117A00	42.4	31.8/38.9	051	051
112A00,110A00		50.0	37.6/45.9	051	051	
HIGH	117A00	10.4	7.8/9.6	047	049	
	110A00	16.0	12.0/14.7	049	049	
	112A00	32.0	24.0/29.4	049	049	
	112A00,117A00	42.4	31.8/38.9	051	051	
	112A00,110A00	50.0	37.6/45.9	051	051	
460–3–60	STD	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		115A00	33.0	30.3	047	047
		114A00,116A00	41.7	38.3	050	050
		115A00,113A00	50.0	45.9	050	050
	MED	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		115A00	33.0	30.3	047	047
		114A00,116A00	41.7	38.3	050	050
115A00,113A00		50.0	45.9	050	050	
HIGH	116A00	13.9	12.8	047	047	
	113A00	16.5	15.2	047	047	
	115A00	33.0	30.3	047	047	
	114A00,116A00	41.7	38.3	050	050	
	115A00,113A00	50.0	45.9	050	050	
575–3–60	STD	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	047
		118A00,119A00	51.0	51.0	050	050
	MED	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	047
		118A00,119A00	51.0	51.0	050	050
	HIGH	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	050
		118A00,119A00	51.0	51.0	050	050

ELECTRICAL INFORMATION (UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

TABLE 74 – RAH150

ELECTRIC HEAT – ELECTRICAL DATA 2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO PE.	w/PE. (pwrd fr/unit)
208/ 230–3–60	STD	291A00	16.5	12.4/15.2	049	049
		288A00,291A00	26.5	19.9/24.3	049	049
		294A00	33.5	25.2/30.8	049	049
		288A00,294A00	43.5	32.7/40.0	051	051
		291A00,294A00	50.0	37.6/45.9	051	051
	MED	291A00	16.5	12.4/15.2	049	049
		288A00,291A00	26.5	19.9/24.3	049	049
		294A00	33.5	25.2/30.8	049	049
		288A00,294A00	43.5	32.7/40.0	051	051
		291A00,294A00	50.0	37.6/45.9	051	051
	HIGH	291A00	16.5	12.4/15.2	049	049
		288A00,291A00	26.5	19.9/24.3	049	049
		294A00	33.5	25.2/30.8	049	049
		288A00,294A00	43.5	32.7/40.0	051	051
		291A00,294A00	50.0	37.6/45.9	051	051
460–3–60	STD	292A00	16.5	15.2	–	–
		289A00,292A00	26.5	24.3	047	047
		295A00	33.5	30.8	047	047
		289A00,295A00	43.5	40.0	050	050
		292A00,295A00	50.0	45.9	050	050
	MED	292A00	16.5	15.2	–	–
		289A00,292A00	26.5	24.3	047	047
		295A00	33.5	30.8	047	047
		289A00,295A00	43.5	40.0	050	050
		292A00,295A00	50.0	45.9	050	050
	HIGH	292A00	16.5	15.2	–	–
		289A00,292A00	26.5	24.3	047	047
		295A00	33.5	30.8	050	050
		289A00,295A00	43.5	40.0	050	050
		292A00,295A00	50.0	45.9	050	050
575–3–60	STD	293A00	16.5	15.2	–	–
		290A00,293A00	26.5	24.3	047	047
		296A00	33.5	30.8	047	047
		290A00,296A00	43.5	40.0	047	050
		293A00,296A00	50.0	45.9	047	047
	MED	293A00	16.5	15.2	–	–
		290A00,293A00	26.5	24.3	047	047
		296A00	33.5	30.8	047	047
		290A00,296A00	43.5	40.0	047	050
		293A00,296A00	50.0	45.9	047	047
	HIGH	293A00	16.5	15.2	–	–
		290A00,293A00	26.5	24.3	047	047
		296A00	33.5	30.8	047	047
		290A00,296A00	43.5	40.0	050	050
		293A00,296A00	50.0	45.9	050	050

**ELECTRICAL INFORMATION
(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.**

TABLE 75 – RAH090

**ELECTRIC HEAT – ELECTRICAL DATA
2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR**

NOM. V-PH-Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER	
					CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/PE. (pwrd fr/ unit)
208/ 230-3-60	STD	117A00	10.4	7.8/9.6	047	047
		110A00	16.0	12.0/14.7	047	047
		111A00	24.8	18.6/22.8	049	049
		112A00	32.0	24.0/29.4	049	049
		112A00,117A00	42.4	31.8/38.9	051	051
	MED	117A00	10.4	7.8/9.6	047	047
		110A00	16.0	12.0/14.7	047	049
		111A00	24.8	18.6/22.8	049	049
		112A00	32.0	24.0/29.4	049	049
112A00,117A00		42.4	31.8/38.9	051	051	
HIGH	117A00	10.4	7.8/9.6	047	047	
	110A00	16.0	12.0/14.7	049	049	
	111A00	24.8	18.6/22.8	049	049	
	112A00	32.0	24.0/29.4	049	049	
	112A00,117A00	42.4	31.8/38.9	051	051	
460-3-60	STD	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		114A00	27.8	25.5	047	047
		115A00	33.0	30.3	047	047
		114A00,116A00	41.7	38.3	050	050
	MED	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		114A00	27.8	25.5	047	047
		115A00	33.0	30.3	047	047
114A00,116A00		41.7	38.3	050	050	
HIGH	116A00	13.9	12.8	047	047	
	113A00	16.5	15.2	047	047	
	114A00	27.8	25.5	047	047	
	115A00	33.0	30.3	047	047	
	114A00,116A00	41.7	38.3	050	050	
575-3-60	STD	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	047
	MED	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	050
	HIGH	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	050

**ELECTRICAL INFORMATION
(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.**

TABLE 76 – RAH102

**ELECTRIC HEAT – ELECTRICAL DATA
2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR**

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER	
					CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/PE. (pwrd fr/ unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047	047
		110A00	16.0	12.0/14.7	047	047
		111A00	24.8	18.6/22.8	049	049
		112A00	32.0	24.0/29.4	049	049
		112A00,117A00	42.4	31.8/38.9	051	051
	MED	117A00	10.4	7.8/9.6	047	047
		110A00	16.0	12.0/14.7	047	049
		111A00	24.8	18.6/22.8	049	049
		112A00	32.0	24.0/29.4	049	049
112A00,117A00		42.4	31.8/38.9	051	051	
HIGH	117A00	10.4	7.8/9.6	047	047	
	110A00	16.0	12.0/14.7	049	049	
	111A00	24.8	18.6/22.8	049	049	
	112A00	32.0	24.0/29.4	049	049	
	112A00,117A00	42.4	31.8/38.9	051	051	
460–3–60	STD	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		114A00	27.8	25.5	047	047
		115A00	33.0	30.3	047	047
		114A00,116A00	41.7	38.3	050	050
	MED	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		114A00	27.8	25.5	047	047
		115A00	33.0	30.3	047	047
114A00,116A00		41.7	38.3	050	050	
HIGH	116A00	13.9	12.8	047	047	
	113A00	16.5	15.2	047	047	
	114A00	27.8	25.5	047	047	
	115A00	33.0	30.3	047	047	
	114A00,116A00	41.7	38.3	050	050	
575–3–60	STD	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	047
	MED	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	050
	HIGH	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	050

**ELECTRICAL INFORMATION
(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.**

TABLE 77 – RAH110

**ELECTRIC HEAT – ELECTRICAL DATA
2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR**

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER	
					CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/PE. (pwrd fr/ unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047	047
		110A00	16.0	12.0/14.7	047	049
		112A00	32.0	24.0/29.4	049	049
		112A00,117A00	42.4	31.8/38.9	051	051
		112A00,110A00	50.0	37.6/45.9	051	051
	MED	117A00	10.4	7.8/9.6	047	049
		110A00	16.0	12.0/14.7	049	049
		112A00	32.0	24.0/29.4	049	049
		112A00,117A00	42.4	31.8/38.9	051	051
		112A00,110A00	50.0	37.6/45.9	051	051
	HIGH	117A00	10.4	7.8/9.6	049	049
		110A00	16.0	12.0/14.7	049	049
112A00		32.0	24.0/29.4	049	049	
112A00,117A00		42.4	31.8/38.9	051	051	
112A00,110A00		50.0	37.6/45.9	051	051	
460–3–60	STD	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		115A00	33.0	30.3	047	047
		114A00,116A00	41.7	38.3	050	050
		115A00,113A00	50.0	45.9	050	050
	MED	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
		115A00	33.0	30.3	047	047
		114A00,116A00	41.7	38.3	050	050
		115A00,113A00	50.0	45.9	050	050
	HIGH	116A00	13.9	12.8	047	047
		113A00	16.5	15.2	047	047
115A00		33.0	30.3	047	047	
114A00,116A00		41.7	38.3	050	050	
115A00,113A00		50.0	45.9	050	050	
575–3–60	STD	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	050
		118A00,119A00	51.0	51.0	050	050
	MED	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	050
		118A00,119A00	51.0	51.0	050	050
	HIGH	118A00	17.0	17.0	047	047
		119A00	34.0	34.0	047	050
		118A00,119A00	51.0	51.0	050	050

ELECTRICAL INFORMATION (UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

TABLE 78 – RAH120

ELECTRIC HEAT – ELECTRICAL DATA 2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE			
					NO C.O. or UNPWRD C.O.		w/PWRD C.O.	
					NO P.E.	w/P.E. (pwr fr/ unit)	NO P.E.	w/P.E. (pwr fr/ unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047	047	047	049
		110A00	16.0	12.0/14.7	047	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	MED	117A00	10.4	7.8/9.6	047	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
		112A00	32.0	24.0/29.4	049	049	049	049
		112A00,117A00	42.4	31.8/38.9	051	051	051	051
		112A00,110A00	50.0	37.6/45.9	051	051	051	051
	HIGH	117A00	10.4	7.8/9.6	047	049	049	049
		110A00	16.0	12.0/14.7	049	049	049	049
112A00		32.0	24.0/29.4	049	049	049	049	
112A00,117A00		42.4	31.8/38.9	051	051	051	051	
112A00,110A00		50.0	37.6/45.9	051	051	051	051	
460–3–60	STD	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	047
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	MED	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	047	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
	HIGH	116A00	13.9	12.8	047	047	047	047
		113A00	16.5	15.2	047	047	047	047
		115A00	33.0	30.3	047	047	050	050
		114A00,116A00	41.7	38.3	050	050	050	050
		115A00,113A00	50.0	45.9	050	050	050	050
575–3–60	STD	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	MED	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	047	050
		118A00,119A00	51.0	51.0	050	050	050	050
	HIGH	118A00	17.0	17.0	047	047	047	047
		119A00	34.0	34.0	047	050	050	050
		118A00,119A00	51.0	51.0	050	050	050	050

**ELECTRICAL INFORMATION
(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.**

TABLE 79 – RAH150

**ELECTRIC HEAT – ELECTRICAL DATA
2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR**

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER	
					CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/PE. (pwrd fr/ unit)
208/ 230–3–60	STD	291A00	16.5	12.4/15.2	049	049
		288A00,291A00	26.5	19.9/24.3	049	049
		294A00	33.5	25.2/30.8	049	049
		288A00,294A00	43.5	32.7/40.0	051	051
		291A00,294A00	50.0	37.6/45.9	051	051
	MED	291A00	16.5	12.4/15.2	049	049
		288A00,291A00	26.5	19.9/24.3	049	049
		294A00	33.5	25.2/30.8	049	049
		288A00,294A00	43.5	32.7/40.0	051	051
		291A00,294A00	50.0	37.6/45.9	051	051
	HIGH	291A00	16.5	12.4/15.2	049	049
		288A00,291A00	26.5	19.9/24.3	049	049
294A00		33.5	25.2/30.8	049	049	
288A00,294A00		43.5	32.7/40.0	051	051	
291A00,294A00		50.0	37.6/45.9	051	051	
460–3–60	STD	292A00	16.5	15.2	–	–
		289A00,292A00	26.5	24.3	047	047
		295A00	33.5	30.8	047	047
		289A00,295A00	43.5	40.0	050	050
		292A00,295A00	50.0	45.9	050	050
	MED	292A00	16.5	15.2	–	–
		289A00,292A00	26.5	24.3	047	047
		295A00	33.5	30.8	047	047
		289A00,295A00	43.5	40.0	050	050
		292A00,295A00	50.0	45.9	050	050
	HIGH	292A00	16.5	15.2	–	–
		289A00,292A00	26.5	24.3	047	047
295A00		33.5	30.8	050	050	
289A00,295A00		43.5	40.0	050	050	
292A00,295A00		50.0	45.9	050	050	
575–3–60	STD	293A00	16.5	15.2	–	–
		290A00,293A00	26.5	24.3	047	047
		296A00	33.5	30.8	047	047
		290A00,296A00	43.5	40.0	047	050
		293A00,296A00	50.0	45.9	047	047
	MED	293A00	16.5	15.2	–	–
		290A00,293A00	26.5	24.3	047	047
		296A00	33.5	30.8	047	047
		290A00,296A00	43.5	40.0	047	050
		293A00,296A00	50.0	45.9	047	047
	HIGH	293A00	16.5	15.2	–	–
		290A00,293A00	26.5	24.3	047	047
296A00		33.5	30.8	047	047	
290A00,296A00		43.5	40.0	050	050	
293A00,296A00		50.0	45.9	050	050	

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

TABLE 80 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR

Unit	NO M. V. PH-HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwr fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH036	208/230-1-60	DD-STD	NONE	—	—	30	45	29	88	32	45	31	90
			101A	3.3/4.4	15.9/18.3	30/33	45/45	29/30	88/88	32/35	45/45	31/32	90/90
			102A	4.9/6.5	23.5/27.1	39/44	45/45	36/40	88/88	41/46	45/50	38/42	90/90
			103B	6.5/8.7	31.4/36.3	49/55	50/60	45/50	88/88	51/57	60/60	47/52	90/90
			104B	7.9/10.5	37.9/43.8	57/64	60/70	52/59	88/88	59/67	60/70	54/61	90/90
			102A+102A	9.8/13.0	46.9/54.2	68/77	70/80	62/71	88/88	71/80	80/80	65/73	90/90
	208/230-3-60	DD-STD	NONE	—	—	22	30	22	82	24	30	24	84
			101A	3.3/4.4	9.2/10.6	22/23	30/30	22/22	82/82	24/25	30/30	24/24	84/84
			102A	4.9/6.5	13.6/15.6	27/29	30/30	24/26	82/82	29/32	30/35	26/29	84/84
			103B	6.5/8.7	18.1/20.9	32/36	35/40	29/33	82/82	35/38	35/40	32/35	84/84
			104B	7.9/10.5	21.9/25.3	37/41	40/45	34/38	82/82	39/44	40/45	36/40	84/84
			105A	12.0/16.0	33.4/38.5	51/58	60/60	47/53	82/82	54/60	60/60	49/55	84/84
		MED	NONE	—	—	20	25	19	94	22	30	21	96
			101A	3.3/4.4	9.2/10.6	20/20	25/25	19/19	94/94	22/23	30/30	21/21	96/96
			102A	4.9/6.5	13.6/15.6	24/26	25/30	22/24	94/94	26/29	30/30	24/26	96/96
			103B	6.5/8.7	18.1/20.9	30/33	30/35	27/30	94/94	32/35	35/40	29/32	96/96
			104B	7.9/10.5	21.9/25.3	34/39	35/40	31/35	94/94	37/41	40/45	33/37	96/96
			105A	12.0/16.0	33.4/38.5	49/55	50/60	44/50	94/94	51/57	60/60	47/52	96/96
		HIGH	NONE	—	—	21/21	30/30	21/21	132	23/23	30/30	23/23	134
			101A	3.3/4.4	9.2/10.6	21/22	30/30	21/21	132/132	23/24	30/30	23/23	134/134
			102A	4.9/6.5	13.6/15.6	26/28	30/30	24/26	132/132	28/31	30/35	26/28	134/134
			103B	6.5/8.7	18.1/20.9	32/35	35/35	29/32	132/132	34/37	35/40	31/34	134/134
			104B	7.9/10.5	21.9/25.3	36/40	40/40	33/37	132/132	39/43	40/45	35/39	134/134
			105A	12.0/16.0	33.4/38.5	51/57	60/60	46/52	132/132	53/59	60/60	49/54	134/134
	460-3-60	DD-STD	NONE	—	—	12	15	12	43	13	15	13	44
			106A	6.0	7.2	14	15	13	43	16	20	14	44
			107A	8.8	10.6	19	20	17	43	20	20	18	44
			108A	11.5	13.8	23	25	20	43	24	25	22	44
			109A	14.0	16.8	26	30	24	43	28	30	25	44
		MED	NONE	—	—	11	15	10	48	12	15	11	49
			106A	6.0	7.2	13	15	11	48	14	15	12	49
			107A	8.8	10.6	17	20	15	48	18	20	16	49
			108A	11.5	13.8	21	25	19	48	22	25	20	49
			109A	14.0	16.8	25	25	22	48	26	30	23	49
		HIGH	NONE	—	—	12	15	11	67	13	15	12	68
			106A	6.0	7.2	14	15	12	67	15	15	13	68
	107A		8.8	10.6	18	20	16	67	19	20	17	68	
	108A		11.5	13.8	22	25	20	67	23	25	21	68	
	109A		14.0	16.8	26	30	23	67	27	30	24	68	
	575-3-60	DD-STD	NONE	—	—	10	15	10	42	12	15	12	44
			297A	9.2	9.2	17	20	15	42	19	20	17	44
			298A	13.8	13.8	23	25	20	42	25	25	23	44
MED		NONE	—	—	7	15	6	45	9	15	9	47	
		297A	9.2	9.2	13	15	12	45	16	20	14	47	
		298A	13.8	13.8	19	20	17	45	22	25	19	47	
HIGH		NONE	—	—	8	15	7	49	10	15	9	51	
		297A	9.2	9.2	14	15	13	49	17	20	15	51	
		298A	13.8	13.8	20	20	18	49	23	25	20	51	

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 80 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR (cont)

Unit	NO M. V. PH-HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH048	208/230-1-60	DD-STD	NONE	—	—	37	50	35	127	38	50	37	129
			101A	3.3/4.4	15.9/18.3	37/37	50/50	35/35	127/127	38/38	50/50	37/37	129/129
			103B	6.5/8.7	31.4/36.3	49/55	50/60	45/50	127/127	51/57	60/60	47/52	129/129
			102A+102A	9.8/13.0	46.9/54.2	68/77	70/80	62/71	127/127	71/80	80/80	65/73	129/129
			103B+103B	13.1/17.4	62.8/72.5	88/100	90/100	81/92	127/127	91/103	100/110	83/94	129/129
			104B+104B	15.8/21.0	75.8/87.5	104/119	110/125	96/109	127/127	107/121	110/125	98/111	129/129
	208/230-3-60	DD-STD	NONE	—	—	26	30	26	93	28	40	28	95
			102A	4.9/6.5	13.6/15.6	27/29	30/30	26/26	93/93	29/32	40/40	28/29	95/95
			103B	6.5/8.7	18.1/20.9	32/36	35/40	29/33	93/93	35/38	40/40	32/35	95/95
			105A	12.0/16.0	33.4/38.5	51/58	60/60	47/53	93/93	54/60	60/60	49/55	95/95
			104B+104B	15.8/21.0	43.8/50.5	64/73	70/80	59/67	93/93	67/75	70/80	61/69	95/95
		MED	NONE	—	—	24/24	30/30	23/23	122	26/26	30/30	26/25	124
			102A	4.9/6.5	13.6/15.6	24/26	30/30	23/24	122/122	26/28	30/30	26/26	124/124
			103B	6.5/8.7	18.1/20.9	30/33	30/35	27/30	122/122	32/35	35/35	29/32	124/124
			105A	12.0/16.0	33.4/38.5	49/55	50/60	44/50	122/122	51/57	60/60	47/52	124/124
			104B+104B	15.8/21.0	43.8/50.5	62/70	70/70	56/64	122/122	64/72	70/80	59/66	124/124
		HIGH	NONE	—	—	27/27	40/40	27/27	158	29/29	40/40	29/29	160
			102A	4.9/6.5	13.6/15.6	28/30	40/40	27/27	158/158	30/33	40/40	29/30	160/160
	103B		6.5/8.7	18.1/20.9	34/37	40/40	30/34	158/158	36/39	40/40	33/36	160/160	
	105A		12.0/16.0	33.4/38.5	53/59	60/60	48/54	158/158	55/61	60/70	50/56	160/160	
	104B+104B		15.8/21.0	43.8/50.5	66/74	70/80	60/68	158/158	68/76	70/80	62/70	160/160	
	460-3-60	DD-STD	NONE	—	—	13	15	13	47	14	20	14	48
			106A	6.0	7.2	14	15	13	47	16	20	14	48
			108A	11.5	13.8	23	25	20	47	24	25	22	48
			109A	14.0	16.8	26	30	24	47	28	30	25	48
			108A+108A	23.0	27.7	40	40	36	47	41	45	38	48
		MED	NONE	—	—	12	15	11	61	13	15	12	62
			106A	6.0	7.2	13	15	11	61	14	15	12	62
108A			11.5	13.8	21	25	19	61	22	25	20	62	
109A			14.0	16.8	25	25	22	61	26	30	23	62	
108A+108A			23.0	27.7	38	40	35	61	39	40	36	62	
HIGH		NONE	—	—	13	15	13	79	14	20	14	80	
		106A	6.0	7.2	15	15	13	79	16	20	14	80	
	108A	11.5	13.8	23	25	21	79	24	25	22	80		
	109A	14.0	16.8	27	30	24	79	28	30	25	80		
	108A+108A	23.0	27.7	40	40	37	79	42	45	38	80		
575-3-60	DD-STD	NONE	—	—	11	15	11	39	13	15	13	41	
		297A	9.2	9.2	17	20	15	39	19	20	17	41	
		298A	13.8	13.8	23	25	20	39	25	25	23	41	
	MED	NONE	—	—	9	15	8	42	11	15	11	44	
		297A	9.2	9.2	14	15	12	42	16	20	15	44	
		298A	13.8	13.8	20	20	18	42	22	25	20	44	
	HIGH	NONE	—	—	10	15	10	57	12	15	12	59	
		297A	9.2	9.2	15	15	14	57	18	20	16	59	
		298A	13.8	13.8	21	25	19	57	24	25	21	59	

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 80 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR (cont)

Unit	NO M. V.–Ph.–HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH060	208/230–1–60	DD–STD	NONE	–	–	41	60	39	144	42	60	41	146
			102A	4.9/6.5	23.5/27.1	41/44	60/60	39/40	144/144	42/46	60/60	41/42	146/146
			103B	6.5/8.7	31.4/36.3	49/55	60/60	45/50	144/144	51/57	60/60	47/52	146/146
			102A+102A	9.8/13.0	46.9/54.2	68/77	70/80	62/71	144/144	71/80	80/80	65/73	146/146
			103B+103B	13.1/17.4	62.8/72.5	88/100	90/100	81/92	144/144	91/103	100/110	83/94	146/146
			104B+104B	15.8/21.0	75.8/87.5	104/119	110/125	96/109	144/144	107/121	110/125	98/111	146/146
	208/230–3–60	DD–STD	NONE	–	–	29	40	28	120	31	45	31	122
			102A	4.9/6.5	13.6/15.6	29/29	40/40	28/28	120/120	31/32	45/45	31/31	122/122
			104B	7.9/10.5	21.9/25.3	37/41	40/45	34/38	120/120	39/44	45/45	36/40	122/122
			105A	12.0/16.0	33.4/38.5	51/58	60/60	47/53	120/120	54/60	60/60	49/55	122/122
			104B+104B	15.8/21.0	43.8/50.5	64/73	70/80	59/67	120/120	67/75	70/80	61/69	122/122
			104B+105A	19.9/26.5	55.2/63.8	79/89	80/90	72/82	120/120	81/92	90/100	74/84	122/122
		MED	NONE	–	–	29/28	40/40	28/28	170	31/30	45/45	30/30	172
			102A	4.9/6.5	13.6/15.6	29/28	40/40	28/28	170/170	31/31	45/45	30/30	172/172
			104B	7.9/10.5	21.9/25.3	36/40	40/40	33/37	170/170	39/43	45/45	35/39	172/172
			105A	12.0/16.0	33.4/38.5	51/57	60/60	46/52	170/170	53/59	60/60	49/54	172/172
			104B+104B	15.8/21.0	43.8/50.5	64/72	70/80	58/66	170/170	66/74	70/80	60/68	172/172
			104B+105A	19.9/26.5	55.2/63.8	78/89	80/90	71/81	170/170	80/91	90/100	74/83	172/172
		HIGH	NONE	–	–	30/30	45/45	30/29	185	32/32	45/45	32/32	187
			102A	4.9/6.5	13.6/15.6	30/30	45/45	30/29	185/185	32/33	45/45	32/32	187/187
			104B	7.9/10.5	21.9/25.3	38/42	45/45	35/39	185/185	41/45	45/45	37/41	187/187
			105A	12.0/16.0	33.4/38.5	53/59	60/60	48/54	185/185	55/61	60/70	50/56	187/187
			104B+104B	15.8/21.0	43.8/50.5	66/74	70/80	60/68	185/185	68/76	70/80	62/70	187/187
			104B+105A	19.9/26.5	55.2/63.8	80/91	80/100	73/83	185/185	82/93	90/100	75/85	187/187
	460–3–60	DD–STD	NONE	–	–	14	20	14	58	15	20	15	59
			106A	6.0	7.2	14	20	14	58	16	20	15	59
			108A	11.5	13.8	23	25	20	58	24	25	22	59
			109A	14.0	16.8	26	30	24	58	28	30	25	59
			108A+108A	23.0	27.7	40	40	36	58	41	45	38	59
			108A+109A	25.5	30.7	44	45	40	58	45	45	41	59
		MED	NONE	–	–	14	20	13	82	15	20	14	83
			106A	6.0	7.2	14	20	13	82	15	20	14	83
			108A	11.5	13.8	22	25	20	82	23	25	21	83
			109A	14.0	16.8	26	30	23	82	27	30	24	83
			108A+108A	23.0	27.7	39	40	36	82	41	45	37	83
			108A+109A	25.5	30.7	43	45	39	82	44	45	40	83
HIGH		NONE	–	–	14	20	14	90	15	20	15	91	
		106A	6.0	7.2	15	20	14	90	16	20	15	91	
		108A	11.5	13.8	23	25	21	90	24	25	22	91	
		109A	14.0	16.8	27	30	24	90	28	30	25	91	
		108A+108A	23.0	27.7	40	40	37	90	42	45	38	91	
		108A+109A	25.5	30.7	44	45	40	90	45	45	41	91	
575–3–60	DD–STD	NONE	–	–	12	15	12	46	14	15	14	48	
		298A	13.8	13.8	23	25	20	46	25	25	23	48	
		301A	23.0	23.1	34	35	31	46	37	40	33	48	
	MED	NONE	–	–	10	15	9	53	12	15	11	55	
		298A	13.8	13.8	20	20	18	53	23	25	20	55	
		301A	23.0	23.1	32	35	29	53	34	35	31	55	
	HIGH	NONE	–	–	11	15	10	64	12	15	12	66	
		298A	13.8	13.8	21	25	19	64	24	25	21	66	
		301A	23.0	23.1	33	35	30	64	35	35	32	66	

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 80 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR (cont)

UNIT	NO M. V – Ph – HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH072	208/230-3-60	STD	NONE	–	–	32/32	50/50	31/31	165	36/36	50/50	36/35	169
			264A	4.9/6.5	13.6/15.6	32/32	50/50	31/31	165/165	36/36	50/50	36/35	169/169
			117A	7.8/10.4	21.7/25.0	34/38	50/50	31/34	165/165	39/43	50/50	36/39	169/169
			110A	12.0/16.0	33.4/38.5	49/55	50/60	44/50	165/165	53/59	60/60	49/54	169/169
			117A+117A	15.8/21.0	43.8/50.5	62/70	70/70	56/64	165/165	66/74	70/80	61/68	169/169
			110A+117A	19.9/26.5	55.2/63.8	76/86	80/90	69/79	165/165	81/91	90/100	74/83	169/169
		MED	NONE	–	–	36/36	50/50	35/35	201	39/39	50/50	39/39	205
			264A	4.9/6.5	13.6/15.6	36/36	50/50	35/35	201/201	39/39	50/50	39/39	205/205
			117A	7.8/10.4	21.7/25.0	38/42	50/50	35/38	201/201	43/47	50/50	39/43	205/205
			110A	12.0/16.0	33.4/38.5	53/59	60/60	48/54	201/201	57/64	60/70	52/58	205/205
			117A+117A	15.8/21.0	43.8/50.5	66/74	70/80	60/68	201/201	70/79	80/80	64/72	205/205
			110A+117A	19.9/26.5	55.2/63.8	80/91	80/100	73/83	201/201	85/95	90/100	78/87	205/205
		HIGH	NONE	–	–	41/40	50/50	41/40	217	45/44	60/60	45/44	221
			264A	4.9/6.5	13.6/15.6	41/40	50/50	41/40	217/217	45/44	60/60	45/44	221/221
			117A	7.8/10.4	21.7/25.0	45/48	50/50	41/43	217/217	49/52	60/60	45/48	221/221
	110A		12.0/16.0	33.4/38.5	59/64	60/70	54/59	217/217	64/69	70/70	58/63	221/221	
	117A+117A		15.8/21.0	43.8/50.5	72/79	80/80	66/73	217/217	77/84	80/90	70/77	221/221	
	110A+117A		19.9/26.5	55.2/63.8	86/96	90/100	79/88	217/217	91/101	100/110	83/92	221/221	
	460-3-60	STD	NONE	–	–	17	25	16	84	18	25	18	86
			265A	6.0	7.2	17	25	16	84	18	25	18	86
			266A	11.5	13.8	21	25	19	84	23	25	21	86
			267A	14.0	16.8	25	25	22	84	27	30	24	86
			268A	23.0	27.7	38	40	35	84	40	45	37	86
			269A	25.5	30.7	42	45	38	84	44	45	40	86
		MED	NONE	–	–	18	25	18	102	20	25	20	104
			265A	6.0	7.2	18	25	18	102	20	25	20	104
			266A	11.5	13.8	23	25	21	102	25	25	23	104
267A			14.0	16.8	27	30	24	102	29	30	26	104	
268A			23.0	27.7	40	40	37	102	43	45	39	104	
269A			25.5	30.7	44	45	40	102	46	50	42	104	
HIGH		NONE	–	–	21	25	20	110	22	30	22	112	
		265A	6.0	7.2	21	25	20	110	22	30	22	112	
		266A	11.5	13.8	26	30	23	110	28	30	25	112	
		267A	14.0	16.8	29	30	27	110	32	35	29	112	
		268A	23.0	27.7	43	45	39	110	45	45	41	112	
		269A	25.5	30.7	47	50	43	110	49	50	45	112	
575-3-60	STD	NONE	–	–	13	15	12	61	16	20	16	65	
		118A	17.0	20.4	28	30	25	61	33	35	30	65	
		299A	25.7	25.8	35	35	32	61	39	40	36	65	
	MED	NONE	–	–	14	20	13	76	18	20	17	80	
		118A	17.0	20.4	29	30	27	76	34	35	31	80	
		299A	25.7	25.8	36	40	33	76	41	45	37	80	
	HIGH	NONE	–	–	17	20	16	90	20	25	21	94	
		118A	17.0	20.4	33	35	30	90	38	40	34	94	
		299A	25.7	25.8	40	40	36	90	44	45	40	94	

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 80 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR (cont)

UNIT	NO M. V. – Ph–HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO PE.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH090	208/230–3–60	STD	NONE	–	–	39/39	50/50	41/40	208	43/43	50/50	45/45	212
			117A	7.8/10.4	21.7/25.0	39/39	50/50	41/40	208/208	43/43	50/50	45/45	212/212
			110A	12.0/16.0	33.4/38.5	49/55	50/60	44/50	208/208	53/59	60/60	49/54	212/212
			111A	18.6/24.8	51.7/59.7	72/81	80/90	65/74	208/208	76/86	80/90	70/79	212/212
			112A	24.0/32.0	66.7/77.0	90/103	90/110	83/94	208/208	95/108	100/110	87/99	212/212
			112A+117A	31.8/42.4	88.4/102.0	117/134	125/150	108/123	208/208	122/139	125/150	112/127	212/212
		MED	NONE	–	–	41/41	50/50	43/42	229	45/45	50/50	47/47	233
			117A	7.8/10.4	21.7/25.0	41/41	50/50	43/42	229/229	45/45	50/50	47/47	233/233
			110A	12.0/16.0	33.4/38.5	51/57	60/60	46/52	229/229	56/62	60/70	51/56	233/233
			111A	18.6/24.8	51.7/59.7	74/83	80/90	67/76	229/229	78/88	80/90	72/81	233/233
			112A	24.0/32.0	66.7/77.0	92/105	100/110	85/96	229/229	97/110	100/110	89/101	233/233
			112A+117A	31.8/42.4	88.4/102.0	120/136	125/150	110/125	229/229	124/141	125/150	114/129	233/233
		HIGH	NONE	–	–	45	50	47	258	48	60	51	262
			117A	7.8/10.4	21.7/25.0	45/45	50/50	47/47	258/258	48/50	60/60	51/51	262/262
			110A	12.0/16.0	33.4/38.5	55/62	60/70	51/56	258/258	60/67	60/70	55/61	262/262
	111A		18.6/24.8	51.7/59.7	78/88	80/90	72/81	258/258	83/93	90/100	76/85	262/262	
	112A		24.0/32.0	66.7/77.0	97/110	100/110	89/101	258/258	102/115	110/125	93/105	262/262	
	112A+117A		31.8/42.4	88.4/102.0	124/141	125/150	114/129	258/258	129/146	150/150	118/134	262/262	
	460–3–60	STD	NONE	–	–	18	20	19	104	20	25	21	106
			116A	13.9	16.7	24	25	22	104	27	30	24	106
			113A	16.5	19.8	28	30	26	104	31	35	28	106
			114A	27.8	33.4	45	45	41	104	48	50	43	106
			115A	33.0	39.7	53	60	49	104	55	60	51	106
			114A+116A	41.7	50.2	66	70	61	104	69	70	63	106
		MED	NONE	–	–	19	25	20	114	21	25	22	116
			116A	13.9	16.7	26	30	23	114	28	30	25	116
			113A	16.5	19.8	29	30	27	114	32	35	29	116
			114A	27.8	33.4	46	50	42	114	49	50	44	116
			115A	33.0	39.7	54	60	50	114	57	60	52	116
			114A+116A	41.7	50.2	67	70	62	114	70	70	64	116
		HIGH	NONE	–	–	21	25	22	129	23	25	24	131
			116A	13.9	16.7	28	30	25	129	30	30	27	131
			113A	16.5	19.8	32	35	29	129	34	35	31	131
	114A		27.8	33.4	49	50	45	129	51	60	47	131	
	115A		33.0	39.7	57	60	52	129	59	60	54	131	
	114A+116A		41.7	50.2	70	70	64	129	72	80	66	131	
575–3–60	STD	NONE	–	–	13	15	13	77	17	20	17	81	
		118A	17.0	20.4	28	30	25	77	33	35	30	81	
		119A	34.0	40.9	54	60	49	77	58	60	53	81	
	MED	NONE	–	–	13	15	13	81	17	20	18	85	
		118A	17.0	20.4	28	30	26	81	33	35	30	85	
		119A	34.0	40.9	54	60	49	81	59	60	54	85	
	HIGH	NONE	–	–	14	15	14	92	18	20	19	96	
		118A	17.0	20.4	29	30	27	92	34	35	31	96	
		119A	34.0	40.9	55	60	50	92	60	60	55	96	

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 80 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR (cont)

UNIT	NO M. V-Ph-HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH102	208/230-3-60	STD	NONE	—	—	39/39	50/50	41/41	208	43/43	50/50	45/45	212
			117A	7.8/10.4	21.7/25.0	39/39	50/50	41/41	208/208	43/43	50/50	45/45	212/212
			110A	12.0/16.0	33.4/38.5	49/55	50/60	44/50	208/208	53/59	60/60	49/54	212/212
			111A	18.6/24.8	51.7/59.7	72/81	80/90	65/74	208/208	76/86	80/90	70/79	212/212
			112A	24.0/32.0	66.7/77.0	90/103	90/110	83/94	208/208	95/108	100/110	87/99	212/212
		112A+117A	31.8/42.4	88.4/102.0	117/134	125/150	108/123	208/208	122/139	125/150	112/127	212/212	
		MED	NONE	—	—	41/41	50/50	43/43	229	45/45	50/50	47/47	233
			117A	7.8/10.4	21.7/25.0	41/41	50/50	43/43	229/229	45/45	50/50	47/47	233/233
			110A	12.0/16.0	33.4/38.5	51/57	60/60	46/52	229/229	56/62	60/70	51/56	233/233
			111A	18.6/24.8	51.7/59.7	74/83	80/90	67/76	229/229	78/88	80/90	72/81	233/233
			112A	24.0/32.0	66.7/77.0	92/105	100/110	85/96	229/229	97/110	100/110	89/101	233/233
		112A+117A	31.8/42.4	88.4/102.0	120/136	125/150	110/125	229/229	124/141	125/150	114/129	233/233	
		HIGH	NONE	—	—	45	50	47	258	49	60	52	262
			117A	7.8/10.4	21.7/25.0	45/45	50/50	47/47	258/258	49/50	60/60	52/52	262/262
			110A	12.0/16.0	33.4/38.5	55/62	60/70	51/56	258/258	60/67	60/70	55/61	262/262
	111A		18.6/24.8	51.7/59.7	78/88	80/90	72/81	258/258	83/93	90/100	76/85	262/262	
	112A		24.0/32.0	66.7/77.0	97/110	100/110	89/101	258/258	102/115	110/125	93/105	262/262	
	112A+117A	31.8/42.4	88.4/102.0	124/141	125/150	114/129	258/258	129/146	150/150	118/134	262/262		
	460-3-60	STD	NONE	—	—	19	20	19	104	20	25	21	106
			116A	13.9	16.7	24	25	22	104	27	30	24	106
			113A	16.5	19.8	28	30	26	104	31	35	28	106
			114A	27.8	33.4	45	45	41	104	48	50	43	106
			115A	33.0	39.7	53	60	49	104	55	60	51	106
		114A+116A	41.7	50.2	66	70	61	104	69	70	63	106	
		MED	NONE	—	—	19	25	20	114	21	25	22	116
			116A	13.9	16.7	26	30	23	114	28	30	25	116
			113A	16.5	19.8	29	30	27	114	32	35	29	116
			114A	27.8	33.4	46	50	42	114	49	50	44	116
			115A	33.0	39.7	54	60	50	114	57	60	52	116
		114A+116A	41.7	50.2	67	70	62	114	70	70	64	116	
		HIGH	NONE	—	—	21	25	22	129	23	25	24	131
			116A	13.9	16.7	28	30	25	129	30	30	27	131
			113A	16.5	19.8	32	35	29	129	34	35	31	131
	114A		27.8	33.4	49	50	45	129	51	60	47	131	
	115A		33.0	39.7	57	60	52	129	59	60	54	131	
	114A+116A	41.7	50.2	70	70	64	129	72	80	66	131		
575-3-60	STD	NONE	—	—	14	15	14	77	18	20	19	81	
		118A	17.0	20.4	28	30	25	77	33	35	30	81	
		119A	34.0	40.9	54	60	49	77	58	60	53	81	
	MED	NONE	—	—	14	20	15	81	18	20	19	85	
		118A	17.0	20.4	28	30	26	81	33	35	30	85	
		119A	34.0	40.9	54	60	49	81	59	60	54	85	
	HIGH	NONE	—	—	15	20	16	92	19	20	20	96	
		118A	17.0	20.4	29	30	27	92	34	35	31	96	
		119A	34.0	40.9	55	60	50	92	60	60	55	96	

ELECTRICAL INFORMATION (UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 80 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR (cont)

UNIT	NO M. V.-Ph.-HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH110	208/230-3-60	STD	NONE	—	—	51/50	60/60	53/53	284	54/54	60/60	57/57	288
			117A	7.8/10.4	21.7/25.0	51/50	60/60	53/53	284/284	54/54	60/60	57/57	288/288
			110A	12.0/16.0	33.4/38.5	51/57	60/60	53/53	284/284	56/62	60/70	57/57	288/288
			112A	24.0/32.0	66.7/77.0	92/105	100/110	85/96	284/284	97/110	100/110	89/101	288/288
			112A+117A	31.8/42.4	88.4/102.0	120/136	125/150	110/125	284/284	124/141	125/150	114/129	288/288
			112A+110A	37.6/50.0	104.2/120.3	139/129	150/150	128/146	284/284	144/134	150/150	132/150	288/288
		MED	NONE	—	—	54	60	57	313	58	70	62	317
			117A	7.8/10.4	21.7/25.0	54/54	60/60	57/57	313/313	58/58	70/70	62/62	317/317
			110A	12.0/16.0	33.4/38.5	55/62	60/70	57/57	313/313	60/67	70/70	62/62	317/317
			112A	24.0/32.0	66.7/77.0	97/110	100/110	89/101	313/313	102/115	110/125	93/105	317/317
			112A+117A	31.8/42.4	88.4/102.0	124/141	125/150	114/129	313/313	129/146	150/150	118/134	317/317
			112A+110A	37.6/50.0	104.2/120.3	144/134	150/150	132/151	313/313	149/139	150/150	136/155	317/317
	HIGH	NONE	—	—	57/56	70/60	61/60	315	61/60	70/70	65/64	319	
		117A	7.8/10.4	21.7/25.0	57/56	70/60	61/60	315/315	61/60	70/70	65/64	319/319	
		110A	12.0/16.0	33.4/38.5	59/64	70/70	61/60	315/315	64/69	70/70	65/64	319/319	
		112A	24.0/32.0	66.7/77.0	101/113	110/125	92/103	315/315	106/117	110/125	97/108	319/319	
		112A+117A	31.8/42.4	88.4/102.0	128/144	150/150	117/132	315/315	133/149	150/150	122/136	319/319	
		112A+110A	37.6/50.0	104.2/120.3	148/137	150/150	135/153	315/315	152/141	175/175	140/157	319/319	
	460-3-60	STD	NONE	—	—	23	25	24	136	25	30	26	138
			116A	13.9	16.7	26	30	24	136	28	30	26	138
			113A	16.5	19.8	29	30	27	136	32	35	29	138
			115A	33.0	39.7	54	60	50	136	57	60	52	138
			114A+116A	41.7	50.2	67	70	62	136	70	70	64	138
			115A+113A	50.0	60.1	65	70	73	136	67	70	75	138
		MED	NONE	—	—	25	30	26	151	27	30	28	153
			116A	13.9	16.7	28	30	26	151	30	30	28	153
			113A	16.5	19.8	32	35	29	151	34	35	31	153
			115A	33.0	39.7	57	60	52	151	59	60	54	153
			114A+116A	41.7	50.2	70	70	64	151	72	80	66	153
			115A+113A	50.0	60.1	67	80	75	151	69	80	77	153
	HIGH	NONE	—	—	26	30	28	152	28	30	30	154	
		116A	13.9	16.7	29	30	28	152	32	35	30	154	
		113A	16.5	19.8	33	35	30	152	35	35	32	154	
		115A	33.0	39.7	58	60	53	152	60	60	55	154	
		114A+116A	41.7	50.2	71	80	65	152	73	80	67	154	
		115A+113A	50.0	60.1	69	80	76	152	71	80	79	154	
575-3-60	STD	NONE	—	—	18	20	18	95	21	25	23	99	
		118A	17.0	20.4	28	30	26	95	33	35	30	99	
		119A	34.0	40.9	54	60	49	95	59	60	54	99	
		118A+119A	51.0	61.3	64	70	73	95	69	80	77	99	
	MED	NONE	—	—	18	20	19	106	22	25	23	110	
		118A	17.0	20.4	29	30	27	106	34	35	31	110	
		119A	34.0	40.9	55	60	50	106	60	60	55	110	
		118A+119A	51.0	61.3	65	70	74	106	70	80	78	110	
	HIGH	NONE	—	—	21	25	22	120	25	30	27	124	
		118A	17.0	20.4	33	35	30	120	38	40	34	124	
		119A	34.0	40.9	59	60	53	120	63	70	58	124	
		118A+119A	51.0	61.3	69	80	77	120	74	80	81	124	

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 80 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR (cont)

UNIT	NO. M. V. - PH - HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrdr fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH120	208/230-3-60	STD	NONE	-	-	49/49	60/60	52/51	309	53/53	60/60	56/56	313
			117A	7.8/10.4	21.7/25.0	49/49	60/60	52/51	309/309	53/53	60/60	56/56	313/313
			110A	12.0/16.0	33.4/38.5	51/57	60/60	52/52	309/309	56/62	60/70	56/56	313/313
			112A	24.0/32.0	66.7/77.0	92/105	100/110	85/96	309/309	97/110	100/110	89/101	313/313
			112A+117A	31.8/42.4	88.4/102.0	120/136	125/150	110/125	309/309	124/141	125/150	114/129	313/313
			112A+110A	37.6/50.0	104.2/120.3	139/129	150/150	128/146	309/309	144/134	150/150	132/150	313/313
		MED	NONE	-	-	53	60	56	338	57	70	60	342
			117A	7.8/10.4	21.7/25.0	53/53	60/60	56/56	338/338	57/57	70/70	60/60	342/342
			110A	12.0/16.0	33.4/38.5	55/62	60/70	56/56	338/338	60/67	70/70	60/61	342/342
			112A	24.0/32.0	66.7/77.0	97/110	100/110	89/101	338/338	102/115	110/125	93/105	342/342
			112A+117A	31.8/42.4	88.4/102.0	124/141	125/150	114/129	338/338	129/146	150/150	118/134	342/342
			112A+110A	37.6/50.0	104.2/120.3	144/134	150/150	132/151	338/338	149/139	150/150	136/155	342/342
		HIGH	NONE	-	-	56/55	60/60	59/58	340	60/59	70/70	64/63	344
			117A	7.8/10.4	21.7/25.0	56/55	60/60	59/58	340/340	60/59	70/70	64/63	344/344
			110A	12.0/16.0	33.4/38.5	59/64	60/70	59/59	340/340	64/69	70/70	64/63	344/344
			112A	24.0/32.0	66.7/77.0	101/113	110/125	92/103	340/340	106/117	110/125	97/108	344/344
			112A+117A	31.8/42.4	88.4/102.0	128/144	150/150	117/132	340/340	133/149	150/150	122/136	344/344
			112A+110A	37.6/50.0	104.2/120.3	148/137	150/150	135/153	340/340	152/141	175/175	140/157	344/344
	460-3-60	STD	NONE	-	-	24	30	25	148	26	30	27	150
			116A	13.9	16.7	26	30	25	148	28	30	27	150
			113A	16.5	19.8	29	30	27	148	32	35	29	150
			115A	33.0	39.7	54	60	50	148	57	60	52	150
			114A+116A	41.7	50.2	67	70	62	148	70	70	64	150
			115A+113A	50.0	60.1	65	70	73	148	67	70	75	150
		MED	NONE	-	-	26	30	27	163	28	30	29	165
			116A	13.9	16.7	28	30	27	163	30	30	29	165
			113A	16.5	19.8	32	35	29	163	34	35	31	165
			115A	33.0	39.7	57	60	52	163	59	60	54	165
			114A+116A	41.7	50.2	70	70	64	163	72	80	66	165
			115A+113A	50.0	60.1	67	80	75	163	69	80	77	165
		HIGH	NONE	-	-	27	30	29	164	29	35	31	166
			116A	13.9	16.7	29	30	29	164	32	35	31	166
			113A	16.5	19.8	33	35	30	164	35	35	32	166
			115A	33.0	39.7	58	60	53	164	60	60	55	166
			114A+116A	41.7	50.2	71	80	65	164	73	80	67	166
			115A+113A	50.0	60.1	69	80	76	164	71	80	79	166
575-3-60	STD	NONE	-	-	18	20	18	105	22	25	23	109	
		118A	17.0	20.4	28	30	26	105	33	35	30	109	
		119A	34.0	40.9	54	60	49	105	59	60	54	109	
		118A+119A	51.0	61.3	64	70	73	105	69	80	77	109	
	MED	NONE	-	-	19	20	19	116	22	25	24	120	
		118A	17.0	20.4	29	30	27	116	34	35	31	120	
		119A	34.0	40.9	55	60	50	116	60	60	55	120	
		118A+119A	51.0	61.3	65	70	74	116	70	80	78	120	
	HIGH	NONE	-	-	21	25	22	130	25	30	27	134	
		118A	17.0	20.4	33	35	30	130	38	40	34	134	
		119A	34.0	40.9	59	60	53	130	63	70	58	134	
		118A+119A	51.0	61.3	69	80	77	130	74	80	81	134	

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 80 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR (cont)

UNIT	NO M. V-PH-HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH150	208/230-3-60	STD	NONE	—	—	56/56	70/70	59/58	330	60/60	70/70	63/63	334
			291A	12.4/16.5	34.4/39.7	56/60	70/70	59/58	330/330	60/65	70/70	63/63	334/334
			288A+291A	19.9/26.5	55.3/63.8	80/91	80/100	73/83	330/330	85/95	90/100	78/87	334/334
			294A	25.2/33.5	69.9/80.6	98/112	100/125	90/102	330/330	103/116	110/125	94/107	334/334
			288A+294A	32.7/43.5	90.7/104.7	124/142	125/150	114/130	330/330	129/146	150/150	118/134	334/334
			291A+294A	37.6/50.0	104.3/120.3	141/131	150/150	130/148	330/330	146/136	150/150	134/152	334/334
		MED	NONE	—	—	58	70	61	344	62	80	65	348
			291A	12.4/16.5	34.4/39.7	58/63	70/70	61/61	344/344	62/68	80/80	65/65	348/348
			288A+291A	19.9/26.5	55.3/63.8	83/93	90/100	76/86	344/344	88/98	90/100	80/90	348/348
			294A	25.2/33.5	69.9/80.6	101/114	110/125	93/105	344/344	106/119	110/125	97/109	348/348
			288A+294A	32.7/43.5	90.7/104.7	127/145	150/150	116/133	344/344	132/149	150/150	121/137	348/348
			291A+294A	37.6/50.0	104.3/120.3	144/134	150/150	132/151	344/344	149/139	150/150	137/155	348/348
	HIGH	NONE	—	—	68	80	72	350	72	80	77	354	
		291A	12.4/16.5	34.4/39.7	69/76	80/80	72/72	350/350	74/80	80/80	77/77	354/354	
		288A+291A	19.9/26.5	55.3/63.8	95/106	100/110	87/97	350/350	100/110	100/125	91/101	354/354	
		294A	25.2/33.5	69.9/80.6	113/127	125/150	104/116	350/350	118/131	125/150	108/121	354/354	
		288A+294A	32.7/43.5	90.7/104.7	139/157	150/175	128/144	350/350	144/162	150/175	132/148	354/354	
		291A+294A	37.6/50.0	104.3/120.3	156/146	175/175	143/162	350/350	161/151	175/175	148/166	354/354	
	460-3-60	STD	NONE	—	—	29	35	30	166	31	35	32	168
			292A	16.5	19.9	31	35	30	166	33	35	32	168
			289A+292A	26.5	31.9	46	50	42	166	48	50	44	168
			295A	33.5	40.3	56	60	51	166	58	60	53	168
			289A+295A	43.5	52.3	71	80	65	166	73	80	67	168
			292A+295A	50.0	60.2	66	70	74	166	68	80	76	168
MED		NONE	—	—	30	35	31	173	32	40	33	175	
		292A	16.5	19.9	32	35	31	173	34	40	33	175	
		289A+292A	26.5	31.9	47	50	43	173	49	50	45	175	
		295A	33.5	40.3	57	60	52	173	60	60	55	175	
		289A+295A	43.5	52.3	72	80	66	173	75	80	68	175	
		292A+295A	50.0	60.2	67	80	75	173	70	80	77	175	
HIGH	NONE	—	—	35	40	37	176	37	45	39	178		
	292A	16.5	19.9	38	40	37	176	40	45	39	178		
	289A+292A	26.5	31.9	53	60	48	176	55	60	50	178		
	295A	33.5	40.3	64	70	58	176	66	70	60	178		
	289A+295A	43.5	52.3	79	80	72	176	81	90	74	178		
	292A+295A	50.0	60.2	73	80	81	176	76	80	83	178		
575-3-60	STD	NONE	—	—	22	25	23	128	26	30	27	132	
		293A	16.5	15.9	24	25	23	128	29	30	27	132	
		290A+293A	26.5	25.5	36	40	33	128	41	45	37	132	
		296A	33.5	32.2	44	45	40	128	49	50	45	132	
		290A+296A	43.5	41.8	56	60	51	128	61	70	56	132	
		293A+296A	50.0	48.1	52	60	59	128	57	60	63	132	
	MED	NONE	—	—	22	25	23	128	26	30	27	132	
		293A	16.5	15.9	24	25	23	128	29	30	27	132	
		290A+293A	26.5	25.5	36	40	33	128	41	45	37	132	
		296A	33.5	32.2	44	45	40	128	49	50	45	132	
		290A+296A	43.5	41.8	56	60	51	128	61	70	56	132	
		293A+296A	50.0	48.1	52	60	59	128	57	60	63	132	
HIGH	NONE	—	—	29	35	30	140	32	40	34	144		
	293A	16.5	15.9	32	35	30	140	36	40	34	144		
	290A+293A	26.5	25.5	44	45	40	140	48	50	44	144		
	296A	33.5	32.2	52	60	47	140	57	60	52	144		
	290A+296A	43.5	41.8	64	70	58	140	69	70	63	144		
	293A+296A	50.0	48.1	60	70	66	140	65	70	70	144		

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

TABLE 81 – UNIT WIRE SIZING DATA WITH FACTORY INSTALLED 2 SPEED INDOOR FAN OPTION

UNIT	NO M. V.–PH.–HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH090	208/230–3–60	STD	NONE	–	–	40/40	50/50	41/41	195	44/43	50/50	46/46	199
			117A	7.8/10.4	21.7/25.0	40/40	50/50	41/41	195/195	44/43	50/50	46/46	199/199
			110A	12.0/16.0	33.4/38.5	49/56	50/60	45/51	195/195	54/60	60/60	49/55	199/199
			111A	18.6/24.8	51.7/59.7	72/82	80/90	66/75	195/195	77/87	80/90	70/79	199/199
			112A	24.0/32.0	66.7/77.0	91/104	100/110	83/95	195/195	96/108	100/110	88/99	199/199
			112A+117A	31.8/42.4	88.4/102.0	118/135	125/150	108/124	195/195	123/140	125/150	113/128	199/199
		MED	NONE	–	–	41/41	50/50	43/43	199	45/45	50/50	47/47	203
			117A	7.8/10.4	21.7/25.0	41/41	50/50	43/43	199/199	45/45	50/50	47/47	203/203
			110A	12.0/16.0	33.4/38.5	51/57	60/60	47/52	199/199	56/62	60/70	51/56	203/203
			111A	18.6/24.8	51.7/59.7	74/84	80/90	68/76	199/199	79/88	80/90	72/81	203/203
			112A	24.0/32.0	66.7/77.0	93/105	100/110	85/96	199/199	97/110	100/110	89/101	203/203
			112A+117A	31.8/42.4	88.4/102.0	120/136	125/150	110/125	199/199	125/141	125/150	114/129	203/203
		HIGH	NONE	–	–	45/44	50/50	47/46	249	49/48	60/60	52/50	253
			117A	7.8/10.4	21.7/25.0	45/44	50/50	47/46	249/249	49/49	60/60	52/50	253/253
			110A	12.0/16.0	33.4/38.5	56/61	60/70	51/56	249/249	60/66	60/70	55/60	253/253
	111A		18.6/24.8	51.7/59.7	79/87	80/90	72/80	249/249	83/92	90/100	76/84	253/253	
	112A		24.0/32.0	66.7/77.0	97/109	100/110	89/100	249/249	102/114	110/125	93/104	253/253	
	112A+117A		31.8/42.4	88.4/102.0	124/140	125/150	114/129	249/249	129/145	150/150	118/133	253/253	
	460–3–60	STD	NONE	–	–	19	20	19	97	20	25	21	99
			116A	13.9	16.7	25	25	23	97	27	30	25	99
			113A	16.5	19.8	29	30	26	97	31	35	28	99
			114A	27.8	33.4	46	50	42	97	48	50	44	99
			115A	33.0	39.7	54	60	49	97	56	60	51	99
			114A+116A	41.7	50.2	67	70	61	97	69	70	63	99
		MED	NONE	–	–	20	25	20	100	21	25	22	102
			116A	13.9	16.7	26	30	24	100	28	30	26	102
			113A	16.5	19.8	30	30	27	100	32	35	29	102
114A			27.8	33.4	47	50	43	100	49	50	45	102	
115A			33.0	39.7	55	60	50	100	57	60	52	102	
114A+116A			41.7	50.2	68	70	62	100	70	70	64	102	
HIGH		NONE	–	–	21	25	22	125	22	25	24	127	
		116A	13.9	16.7	27	30	25	125	30	30	27	127	
		113A	16.5	19.8	31	35	28	125	34	35	30	127	
		114A	27.8	33.4	48	50	44	125	51	60	46	127	
		115A	33.0	39.7	56	60	51	125	58	60	53	127	
		114A+116A	41.7	50.2	69	70	63	125	72	80	65	127	
575–3–60	STD	NONE	–	–	14	15	14	79	18	20	19	83	
		118A	17.0	20.4	29	30	27	79	34	35	31	83	
		119A	34.0	40.9	55	60	50	79	60	60	55	83	
	MED	NONE	–	–	15	20	15	83	18	20	19	87	
		118A	17.0	20.4	30	30	27	83	35	35	32	87	
		119A	34.0	40.9	56	60	51	83	61	70	55	87	
	HIGH	NONE	–	–	16	20	16	92	19	25	21	96	
		118A	17.0	20.4	32	35	29	92	36	40	33	96	
		119A	34.0	40.9	57	60	52	92	62	70	57	96	

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 81 – UNIT WIRE SIZING DATA WITH FACTORY INSTALLED 2 SPEED INDOOR FAN OPTION (cont)

UNIT	NO M. V – Ph – HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH102	208/230-3-60	STD	NONE	–	–	40/40	50/50	42/41	195	44/44	50/50	46/46	199
			117A	7.8/10.4	21.7/25.0	40/40	50/50	42/41	195/195	44/44	50/50	46/46	199/199
			110A	12.0/16.0	33.4/38.5	49/56	50/60	45/51	195/195	54/60	60/60	49/55	199/199
			111A	18.6/24.8	51.7/59.7	72/82	80/90	66/75	195/195	77/87	80/90	70/79	199/199
			112A	24.0/32.0	66.7/77.0	91/104	100/110	83/95	195/195	96/108	100/110	88/99	199/199
			112A+117A	31.8/42.4	88.4/102.0	118/135	125/150	108/124	195/195	123/140	125/150	113/128	199/199
		MED	NONE	–	–	41/41	50/50	43/43	199	45/45	50/50	47/47	203
			117A	7.8/10.4	21.7/25.0	41/41	50/50	43/43	199/199	45/45	50/50	47/47	203/203
			110A	12.0/16.0	33.4/38.5	51/57	60/60	47/52	199/199	56/62	60/70	51/56	203/203
			111A	18.6/24.8	51.7/59.7	74/84	80/90	68/76	199/199	79/88	80/90	72/81	203/203
			112A	24.0/32.0	66.7/77.0	93/105	100/110	85/96	199/199	97/110	100/110	89/101	203/203
			112A+117A	31.8/42.4	88.4/102.0	120/136	125/150	110/125	199/199	125/141	125/150	114/129	203/203
	HIGH	NONE	–	–	45/44	50/50	47/46	249	49/48	60/60	52/51	253	
		117A	7.8/10.4	21.7/25.0	45/44	50/50	47/46	249/249	49/49	60/60	52/51	253/253	
		110A	12.0/16.0	33.4/38.5	56/61	60/70	51/56	249/249	60/66	60/70	55/60	253/253	
		111A	18.6/24.8	51.7/59.7	79/87	80/90	72/80	249/249	83/92	90/100	76/84	253/253	
		112A	24.0/32.0	66.7/77.0	97/109	100/110	89/100	249/249	102/114	110/125	93/104	253/253	
		112A+117A	31.8/42.4	88.4/102.0	124/140	125/150	114/129	249/249	129/145	150/150	118/133	253/253	
	460-3-60	STD	NONE	–	–	19	25	19	97	21	25	22	99
			116A	13.9	16.7	25	25	23	97	27	30	25	99
			113A	16.5	19.8	29	30	26	97	31	35	28	99
			114A	27.8	33.4	46	50	42	97	48	50	44	99
			115A	33.0	39.7	54	60	49	97	56	60	51	99
			114A+116A	41.7	50.2	67	70	61	97	69	70	63	99
		MED	NONE	–	–	20	25	20	100	22	25	23	102
			116A	13.9	16.7	26	30	24	100	28	30	26	102
			113A	16.5	19.8	30	30	27	100	32	35	29	102
			114A	27.8	33.4	47	50	43	100	49	50	45	102
			115A	33.0	39.7	55	60	50	100	57	60	52	102
			114A+116A	41.7	50.2	68	70	62	100	70	70	64	102
		HIGH	NONE	–	–	21	25	22	125	23	25	24	127
			116A	13.9	16.7	27	30	25	125	30	30	27	127
			113A	16.5	19.8	31	35	28	125	34	35	30	127
			114A	27.8	33.4	48	50	44	125	51	60	46	127
			115A	33.0	39.7	56	60	51	125	58	60	53	127
			114A+116A	41.7	50.2	69	70	63	125	72	80	65	127
575-3-60	STD	NONE	–	–	15	20	16	79	19	20	20	83	
		118A	17.0	20.4	29	30	27	79	34	35	31	83	
		119A	34.0	40.9	55	60	50	79	60	60	55	83	
	MED	NONE	–	–	16	20	16	83	20	25	21	87	
		118A	17.0	20.4	30	30	27	83	35	35	32	87	
		119A	34.0	40.9	56	60	51	83	61	70	55	87	
	HIGH	NONE	–	–	17	20	18	92	21	25	22	96	
		118A	17.0	20.4	32	35	29	92	36	40	33	96	
		119A	34.0	40.9	57	60	52	92	62	70	57	96	

ELECTRICAL INFORMATION (UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 81 – UNIT WIRE SIZING DATA WITH FACTORY INSTALLED 2 SPEED INDOOR FAN OPTION (cont)

UNIT	NO M. V-Ph-HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH110	208/230-3-60	STD	NONE	—	—	51/50	60/60	53/53	254	55/54	60/60	58/57	258
			117A	7.8/10.4	21.7/25.0	51/50	60/60	53/53	254/254	55/54	60/60	58/57	258/258
			110A	12.0/16.0	33.4/38.5	51/57	60/60	53/53	254/254	56/62	60/70	58/57	258/258
			112A	24.0/32.0	66.7/77.0	93/105	100/110	85/96	254/254	97/110	100/110	89/101	258/258
			112A+117A	31.8/42.4	88.4/102.0	120/136	125/150	110/125	254/254	125/141	125/150	114/129	258/258
		112A+110A	37.6/50.0	104.2/120.3	140/129	150/150	128/146	254/254	144/134	150/150	132/151	258/258	
		MED	NONE	—	—	54/53	60/60	58/56	304	58/57	70/70	62/61	308
			117A	7.8/10.4	21.7/25.0	54/53	60/60	58/56	304/304	58/57	70/70	62/61	308/308
			110A	12.0/16.0	33.4/38.5	56/61	60/70	58/56	304/304	60/66	70/70	62/61	308/308
			112A	24.0/32.0	66.7/77.0	97/109	100/110	89/100	304/304	102/114	110/125	93/104	308/308
			112A+117A	31.8/42.4	88.4/102.0	124/140	125/150	114/129	304/304	129/145	150/150	118/133	308/308
		112A+110A	37.6/50.0	104.2/120.3	144/133	150/150	132/150	304/304	149/138	150/150	137/154	308/308	
		HIGH	NONE	—	—	57/56	70/60	61/60	315	61/60	70/70	65/64	319
			117A	7.8/10.4	21.7/25.0	57/56	70/60	61/60	315/315	61/60	70/70	65/64	319/319
			110A	12.0/16.0	33.4/38.5	59/64	70/70	61/60	315/315	64/69	70/70	65/64	319/319
	112A		24.0/32.0	66.7/77.0	101/113	110/125	92/103	315/315	106/117	110/125	97/108	319/319	
	112A+117A		31.8/42.4	88.4/102.0	128/144	150/150	117/132	315/315	133/149	150/150	122/136	319/319	
	112A+110A	37.6/50.0	104.2/120.3	148/137	150/150	135/153	315/315	152/141	175/175	140/157	319/319		
	460-3-60	STD	NONE	—	—	24	30	25	122	25	30	27	124
			116A	13.9	16.7	26	30	25	122	28	30	27	124
			113A	16.5	19.8	30	30	27	122	32	35	29	124
			115A	33.0	39.7	55	60	50	122	57	60	52	124
			114A+116A	41.7	50.2	68	70	62	122	70	70	64	124
		115A+113A	50.0	60.1	65	70	73	122	68	80	76	124	
		MED	NONE	—	—	25	30	26	147	27	30	28	149
			116A	13.9	16.7	27	30	26	147	30	30	28	149
			113A	16.5	19.8	31	35	28	147	34	35	30	149
			115A	33.0	39.7	56	60	51	147	58	60	53	149
			114A+116A	41.7	50.2	69	70	63	147	72	80	65	149
		115A+113A	50.0	60.1	67	80	75	147	69	80	77	149	
		HIGH	NONE	—	—	26	30	28	152	28	30	30	154
			116A	13.9	16.7	29	30	28	152	32	35	30	154
			113A	16.5	19.8	33	35	30	152	35	35	32	154
	115A		33.0	39.7	58	60	53	152	60	60	55	154	
	114A+116A		41.7	50.2	71	80	65	152	73	80	67	154	
	115A+113A	50.0	60.1	69	80	76	152	71	80	79	154		
575-3-60	STD	NONE	—	—	19	20	20	97	23	25	24	101	
		118A	17.0	20.4	30	30	27	97	35	35	32	101	
		119A	34.0	40.9	56	60	51	97	61	70	55	101	
		118A+119A	51.0	61.3	66	70	75	97	71	80	79	101	
	MED	NONE	—	—	20	25	21	106	24	25	25	110	
		118A	17.0	20.4	32	35	29	106	36	40	33	110	
		119A	34.0	40.9	57	60	52	106	62	70	57	110	
		118A+119A	51.0	61.3	67	80	76	106	72	80	80	110	
	HIGH	NONE	—	—	22	25	23	120	26	30	27	124	
		118A	17.0	20.4	34	35	31	120	38	40	35	124	
		119A	34.0	40.9	59	60	54	120	64	70	59	124	
		118A+119A	51.0	61.3	70	80	78	120	74	80	82	124	

ELECTRICAL INFORMATION (UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 81 – UNIT WIRE SIZING DATA WITH FACTORY INSTALLED 2 SPEED INDOOR FAN OPTION (cont)

UNIT	NO M. V-Ph-HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH120	208/230-3-60	STD	NONE	—	—	50/49	60/60	52/52	279	53/53	60/60	56/56	283
			117A	7.8/10.4	21.7/25.0	50/49	60/60	52/52	279/279	53/53	60/60	56/56	283/283
			110A	12.0/16.0	33.4/38.5	51/57	60/60	52/52	279/279	56/62	60/70	56/56	283/283
			112A	24.0/32.0	66.7/77.0	93/105	100/110	85/96	279/279	97/110	100/110	89/101	283/283
			112A+117A	31.8/42.4	88.4/102.0	120/136	125/150	110/125	279/279	125/141	125/150	114/129	283/283
			112A+110A	37.6/50.0	104.2/120.3	140/129	150/150	128/146	279/279	144/134	150/150	132/151	283/283
		MED	NONE	—	—	53/52	60/60	56/55	329	57/56	70/60	60/59	333
			117A	7.8/10.4	21.7/25.0	53/52	60/60	56/55	329/329	57/56	70/60	60/59	333/333
			110A	12.0/16.0	33.4/38.5	56/61	60/70	56/56	329/329	60/66	70/70	60/60	333/333
			112A	24.0/32.0	66.7/77.0	97/109	100/110	89/100	329/329	102/114	110/125	93/104	333/333
			112A+117A	31.8/42.4	88.4/102.0	124/140	125/150	114/129	329/329	129/145	150/150	118/133	333/333
			112A+110A	37.6/50.0	104.2/120.3	144/133	150/150	132/150	329/329	149/138	150/150	137/154	333/333
		HIGH	NONE	—	—	56/55	60/60	59/58	340	60/59	70/70	64/63	344
			117A	7.8/10.4	21.7/25.0	56/55	60/60	59/58	340/340	60/59	70/70	64/63	344/344
			110A	12.0/16.0	33.4/38.5	59/64	60/70	59/59	340/340	64/69	70/70	64/63	344/344
	112A		24.0/32.0	66.7/77.0	101/113	110/125	92/103	340/340	106/117	110/125	97/108	344/344	
	112A+117A		31.8/42.4	88.4/102.0	128/144	150/150	117/132	340/340	133/149	150/150	122/136	344/344	
	112A+110A		37.6/50.0	104.2/120.3	148/137	150/150	135/153	340/340	152/141	175/175	140/157	344/344	
	460-3-60	STD	NONE	—	—	25	30	26	134	26	30	28	136
			116A	13.9	16.7	26	30	26	134	28	30	28	136
			113A	16.5	19.8	30	30	27	134	32	35	29	136
			115A	33.0	39.7	55	60	50	134	57	60	52	136
			114A+116A	41.7	50.2	68	70	62	134	70	70	64	136
			115A+113A	50.0	60.1	65	70	73	134	68	80	76	136
		MED	NONE	—	—	26	30	27	159	28	30	29	161
			116A	13.9	16.7	27	30	27	159	30	30	29	161
			113A	16.5	19.8	31	35	28	159	34	35	30	161
			115A	33.0	39.7	56	60	51	159	58	60	53	161
			114A+116A	41.7	50.2	69	70	63	159	72	80	65	161
			115A+113A	50.0	60.1	67	80	75	159	69	80	77	161
		HIGH	NONE	—	—	27	30	29	164	29	35	31	166
			116A	13.9	16.7	29	30	29	164	32	35	31	166
			113A	16.5	19.8	33	35	30	164	35	35	32	166
	115A		33.0	39.7	58	60	53	164	60	60	55	166	
	114A+116A		41.7	50.2	71	80	65	164	73	80	67	166	
	115A+113A		50.0	60.1	69	80	76	164	71	80	79	166	
575-3-60	STD	NONE	—	—	19	25	20	107	23	25	24	111	
		118A	17.0	20.4	30	30	27	107	35	35	32	111	
		119A	34.0	40.9	56	60	51	107	61	70	55	111	
		118A+119A	51.0	61.3	66	70	75	107	71	80	79	111	
	MED	NONE	—	—	20	25	21	116	24	30	26	120	
		118A	17.0	20.4	32	35	29	116	36	40	33	120	
		119A	34.0	40.9	57	60	52	116	62	70	57	120	
		118A+119A	51.0	61.3	67	80	76	116	72	80	80	120	
	HIGH	NONE	—	—	22	25	23	130	26	30	27	134	
		118A	17.0	20.4	34	35	31	130	38	40	35	134	
		119A	34.0	40.9	59	60	54	130	64	70	59	134	
		118A+119A	51.0	61.3	70	80	78	130	74	80	82	134	

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

Table 81 – UNIT WIRE SIZING DATA WITH FACTORY INSTALLED 2 SPEED INDOOR FAN OPTION (cont)

UNIT	NO. M. V-Ph-HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH150	208/230-3-60	STD	NONE	—	—	56/56	70/60	59/58	311	60/59	70/70	63/62	315
			291A	12.4/16.5	34.4/39.7	56/60	70/60	59/58	311/311	60/65	70/70	63/62	315/315
			288A+291A	19.9/26.5	55.3/63.8	80/90	80/90	73/82	311/311	85/95	90/100	78/87	315/315
			294A	25.2/33.5	69.9/80.6	99/111	100/125	90/102	311/311	103/116	110/125	95/106	315/315
			288A+294A	32.7/43.5	90.7/104.7	125/141	125/150	114/129	311/311	129/146	150/150	119/134	315/315
		291A+294A	37.6/50.0	104.3/120.3	142/131	150/150	130/147	311/311	146/135	150/150	134/152	315/315	
		MED	NONE	—	—	59/58	70/70	61/60	335	62/61	80/70	66/65	339
			291A	12.4/16.5	34.4/39.7	59/62	70/70	61/60	335/335	62/67	80/70	66/65	339/339
			288A+291A	19.9/26.5	55.3/63.8	83/92	90/100	76/85	335/335	88/97	90/100	80/89	339/339
			294A	25.2/33.5	69.9/80.6	101/113	110/125	93/104	335/335	106/118	110/125	97/108	339/339
			288A+294A	32.7/43.5	90.7/104.7	127/144	150/150	117/132	335/335	132/148	150/150	121/136	339/339
		291A+294A	37.6/50.0	104.3/120.3	144/133	150/150	132/150	335/335	149/138	150/150	137/154	339/339	
		HIGH	NONE	—	—	68	80	72	350	72	80	77	354
			291A	12.4/16.5	34.4/39.7	69/76	80/80	72/72	350/350	74/80	80/80	77/77	354/354
			288A+291A	19.9/26.5	55.3/63.8	95/106	100/110	87/97	350/350	100/110	100/125	91/101	354/354
	294A		25.2/33.5	69.9/80.6	113/127	125/150	104/116	350/350	118/131	125/150	108/121	354/354	
	288A+294A		32.7/43.5	90.7/104.7	139/157	150/175	128/144	350/350	144/162	150/175	132/148	354/354	
	291A+294A	37.6/50.0	104.3/120.3	156/146	175/175	143/162	350/350	161/151	175/175	148/166	354/354		
	460-3-60	STD	NONE	—	—	28	35	29	157	30	35	32	159
			292A	16.5	19.9	30	35	29	157	32	35	32	159
			289A+292A	26.5	31.9	45	45	41	157	47	50	43	159
			295A	33.5	40.3	56	60	51	157	58	60	53	159
			289A+295A	43.5	52.3	71	80	65	157	73	80	67	159
		292A+295A	50.0	60.2	65	70	74	157	68	80	76	159	
		MED	NONE	—	—	30	35	31	169	31	40	33	171
			292A	16.5	19.9	31	35	31	169	34	40	33	171
			289A+292A	26.5	31.9	46	50	42	169	49	50	44	171
			295A	33.5	40.3	57	60	52	169	59	60	54	171
			289A+295A	43.5	52.3	72	80	66	169	74	80	68	171
		292A+295A	50.0	60.2	67	80	75	169	69	80	77	171	
		HIGH	NONE	—	—	35	40	37	176	37	45	39	178
			292A	16.5	19.9	38	40	37	176	40	45	39	178
			289A+292A	26.5	31.9	53	60	48	176	55	60	50	178
	295A		33.5	40.3	64	70	58	176	66	70	60	178	
	289A+295A		43.5	52.3	79	80	72	176	81	90	74	178	
	292A+295A	50.0	60.2	73	80	81	176	76	80	83	178		
	575-3-60	STD	NONE	—	—	24	30	25	128	28	30	29	132
			293A	16.5	15.9	26	30	25	128	31	35	29	132
			290A+293A	26.5	25.5	38	40	35	128	43	45	39	132
			296A	33.5	32.2	46	50	42	128	51	60	47	132
			290A+296A	43.5	41.8	58	60	53	128	63	70	58	132
		293A+296A	50.0	48.1	54	60	60	128	59	60	65	132	
		MED	NONE	—	—	24	30	25	128	28	30	29	132
			293A	16.5	15.9	26	30	25	128	31	35	29	132
			290A+293A	26.5	25.5	38	40	35	128	43	45	39	132
			296A	33.5	32.2	46	50	42	128	51	60	47	132
			290A+296A	43.5	41.8	58	60	53	128	63	70	58	132
		293A+296A	50.0	48.1	54	60	60	128	59	60	65	132	
HIGH		NONE	—	—	29	35	30	140	32	40	34	144	
		293A	16.5	15.9	32	35	30	140	36	40	34	144	
		290A+293A	26.5	25.5	44	45	40	140	48	50	44	144	
	296A	33.5	32.2	52	60	47	140	57	60	52	144		
	290A+296A	43.5	41.8	64	70	58	140	69	70	63	144		
293A+296A	50.0	48.1	60	70	66	140	65	70	70	144			

ELECTRICAL INFORMATION

(UNITS PRODUCED ON OR AFTER JULY 30, 2012) cont.

LEGEND:

- BRKR – Circuit breaker
- CO – Convenience outlet
- DISC – Disconnect
- FLA – Full load amps
- IFM – Indoor fan motor
- LRA – Locked rotor amps
- MCA – Minimum circuit amps
- MOCP – MAX FUSE or HACR Breaker
- PE – Power exhaust
- PWRD CO – Powered convenient outlet
- UNPWR CO – Unpowered convenient outlet



NOTES:

1. In compliance with NEC requirements for multimotor and combinat (refer to NEC Articles 430 and 440), the overcurrent protective shall be fuse or HACR breaker. Canadian units may be fuse or c

1. Unbalanced 3-Phase Supply Voltage

Never operate a motor where a phase imbalance in supply vol 2%. Use the following formula to determine the percentage of vc

$$\% \text{ Voltage Imbalance} = 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

Example: Supply voltage is 230-3-60



- AB = 224 v
- BC = 231 v
- AC = 226 v

$$\begin{aligned} \text{Average Voltage} &= \frac{(224 + 231 + 226)}{3} = \frac{681}{3} \\ &= 227 \end{aligned}$$

Determine maximum deviation from average voltage.

(AB) 227 – 224 = 3 v

(BC) 231 – 227 = 4 v

(AC) 227 – 226 = 1 v

Maximum deviation is 4 v.

Determine percent of voltage imbalance.

$$\begin{aligned} \% \text{ Voltage Imbalance} &= 100 \times \frac{4}{227} \\ &= 1.76\% \end{aligned}$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

ELECTRICAL DATA FOR UNITS PRODUCED PRIOR TO JULY 30, 2012

NOTE: Check the serial number of unit to verify production date.

SERIAL NUMBER

1	2	3	4	5	6	7	8	9	10
U	1	2	3	1	1	2	3	4	5

Manufacture Location

Week of Manufacture
(fiscal calendar)

Sequence Number

Year of Manufacture
(12 = 2012)

ELECTRICAL INFORMATION (UNITS PRODUCED PRIOR TO JULY 30, 2012)

TABLE 82 – RAH036
SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (ea)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-1-60	187	253	16.6	79	190	1.0	DD-STD	84%	7.4
							BD-STD	70%	4.9
							MED	70%	4.9
230-1-60	187	253	16.6	79	190	1.0	DD-STD	84%	7.4
							BD-STD	70%	4.9
							MED	70%	4.9
208-3-60	187	253	10.4	73	190	1.0	DD-STD	84%	7.4
							BD-STD	70%	4.9
							MED	70%	4.9
							HIGH	80%	5.2
230-3-60	187	253	10.4	73	190	1.0	DD-STD	84%	7.4
							BD-STD	70%	4.9
							MED	70%	4.9
							HIGH	80%	5.2
460-3-60	414	506	5.8	38	190	0.5	DD-STD	84%	4.0
							BD-STD	70%	2.1
							MED	70%	2.1
							HIGH	80%	2.6
575-3-60	518	633	3.8	37	190	0.5	DD-STD	84%	4.0
							BD-STD	71%	1.9
							MED	71%	1.9
							HIGH	80%	2.0

TABLE 83 – RAH048
SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (ea)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-1-60	187	253	21.8	117	325	1.4	DD-STD	84%	7.4
							BD-STD	70%	4.9
							MED	70%	4.9
230-1-60	187	253	21.8	117	325	1.4	DD-STD	84%	7.4
							BD-STD	70%	4.9
							MED	70%	4.9
208-3-60	187	253	13.7	83	325	1.4	DD-STD	84%	7.4
							BD-STD	70%	4.9
							MED	70%	4.9
							HIGH	80%	5.2
230-3-60	187	253	13.7	83	325	1.4	DD-STD	84%	7.4
							BD-STD	70%	4.9
							MED	70%	4.9
							HIGH	80%	5.2
460-3-60	414	506	6.2	41	325	0.9	DD-STD	84%	4.0
							BD-STD	70%	2.1
							MED	70%	2.1
							HIGH	80%	2.6
575-3-60	518	633	4.8	33	325	0.9	DD-STD	84%	4.0
							BD-STD	71%	1.9
							MED	71%	1.9
							HIGH	80%	2.0

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 84 – RAH060
SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (ea)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-1-60	187	253	25.0	134	325	1.4	DD-STD	84%	7.4
							BD-STD	70%	4.9
							MED	70%	7.0
230-1-60	187	253	25.0	134	325	1.4	DD-STD	84%	7.4
							BD-STD	70%	4.9
							MED	70%	7.0
208-3-60	187	253	15.9	110	325	1.4	DD-STD	84%	7.4
							BD-STD	70%	4.9
							MED	80%	5.2
							HIGH	81%	7.5
230-3-60	187	253	15.9	110	325	1.4	DD-STD	84%	7.4
							BD-STD	70%	4.9
							MED	80%	5.2
							HIGH	81%	7.5
460-3-60	414	506	7.0	52	325	0.9	DD-STD	84%	4.0
							BD-STD	70%	2.1
							MED	80%	2.6
							HIGH	81%	3.4
575-3-60	518	633	5.1	40	325	0.9	DD-STD	84%	4.0
							BD-STD	71%	1.9
							MED	81%	2.0
							HIGH	81%	2.8

TABLE 85 – RAH072
SINGLE STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (ea)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	19.0	123	325	1.5	STD	80%	5.2
							MED	81%	7.5
							HIGH	81%	15.0
230-3-60	187	253	19.0	123	325	1.5	STD	80%	5.2
							MED	81%	7.5
							HIGH	81%	15.0
460-3-60	414	506	9.7	62	325	0.8	STD	80%	2.6
							MED	81%	3.4
							HIGH	81%	7.4
575-3-60	518	633	7.4	50	325	0.6	STD	80%	2.4
							MED	81%	2.8
							HIGH	81%	5.6

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 86 – RAH090
2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V–Ph–Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208–3–60	187	253	13.6	83	13.6	83	325	1.5	STD	80%	5.2
									MED	81%	7.5
									HIGH	81%	15.0
230–3–60	187	253	13.6	83	13.6	83	325	1.5	STD	80%	5.2
									MED	81%	7.5
									HIGH	81%	15.0
460–3–60	414	506	6.1	41	6.1	41	325	0.8	STD	80%	2.6
									MED	81%	3.4
									HIGH	81%	7.4
575–3–60	518	633	4.2	33	4.2	33	325	0.6	STD	80%	2.4
									MED	81%	2.8
									HIGH	81%	5.6

TABLE 87 – RAH102
2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V–Ph–Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208–3–60	187	253	13.7	83	13.7	83	325	1.5	STD	80%	5.2
									MED	80%	5.2
									HIGH	80%	10.0
230–3–60	187	253	13.7	83	13.7	83	325	1.5	STD	80%	5.2
									MED	80%	5.2
									HIGH	80%	10.0
460–3–60	414	506	6.2	41	6.2	41	325	0.8	STD	80%	2.6
									MED	80%	2.6
									HIGH	80%	4.4
575–3–60	518	633	4.8	37	4.8	37	325	0.6	STD	80%	2.4
									MED	80%	2.0
									HIGH	81%	2.8

TABLE 88 – RAH110
2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V–Ph–Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208–3–60	187	253	15.9	110.0	15.9	110.0	610	7.4	STD	80%	5.2
									MED	81%	10.0
									HIGH	81%	15.0
230–3–60	187	253	15.9	110.0	15.9	110.0	610	7.4	STD	80%	5.2
									MED	81%	10.0
									HIGH	81%	15.0
460–3–60	414	506	7.1	52.0	7.1	52.0	610	3.6	STD	80%	2.6
									MED	81%	4.4
									HIGH	81%	7.4
575–3–60	518	633	5.1	39.5	5.1	39.5	610	3.6	STD	80%	2.0
									MED	81%	2.8
									HIGH	81%	5.6

ELECTRICAL INFORMATION (UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 89 – RAH120
2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	15.9	110	15.9	110	1070	6.2	STD	80%	5.2
									MED	81%	10.0
									HIGH	81%	15.0
230-3-60	187	253	15.9	110	15.9	110	1070	6.2	STD	80%	5.2
									MED	81%	10.0
									HIGH	81%	15.0
460-3-60	414	506	7.7	52	7.7	52	1070	3.1	STD	80%	2.6
									MED	81%	4.4
									HIGH	81%	7.4
575-3-60	518	633	5.7	39	5.7	39	1070	2.5	STD	80%	2.0
									MED	81%	2.8
									HIGH	81%	5.6

TABLE 90 – RAH150
2-STAGE COOLING WITH SINGLE SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP (Cir 1)		COMP (Cir 2)		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	19.0	123	19.0	123	1288	1.5	STD	81%	7.5
									MED	81%	10.0
									HIGH	89.5%	20.4
230-3-60	187	253	19.0	123	19.0	123	1288	1.5	STD	81%	7.5
									MED	81%	10.0
									HIGH	89.5%	20.4
460-3-60	414	506	9.7	62	9.7	62	1288	0.8	STD	81%	3.4
									MED	81%	4.4
									HIGH	89.5%	10.2
575-3-60	518	633	7.4	50	7.4	50	1288	0.7	STD	81%	2.8
									MED	81%	2.8
									HIGH	89.5%	9.0

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 91 – RAH090
2-STAGE COOLING WITH 2-SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP 1		COMP 2		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	13.6	83	13.6	83	325	1.5	STD	84%	5.8
							325	1.5	MED	77%	7.1
							325	1.5	HIGH	82%	10.8
230-3-60	187	253	13.6	83	13.6	83	325	1.5	STD	84%	5.6
							325	1.5	MED	77%	6.8
							325	1.5	HIGH	82%	9.8
460-3-60	414	506	6.1	41	6.1	41	325	0.8	STD	79%	2.9
							325	0.8	MED	77%	3.8
							325	0.8	HIGH	82%	4.9
575-3-60	518	633	4.2	33	4.2	33	325	0.6	STD	81%	2.8
							325	0.6	MED	80%	3.5
							325	0.6	HIGH	84%	4.5

TABLE 92 – RAH102
2-STAGE COOLING WITH 2-SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP 1		COMP 2		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	13.7	83	13.7	83	325	1.5	STD	84%	5.8
							325	1.5	MED	77%	7.1
							325	1.5	HIGH	82%	10.8
230-3-60	187	253	13.7	83	13.7	83	325	1.5	STD	84%	5.6
							325	1.5	MED	77%	6.8
							325	1.5	HIGH	82%	9.8
460-3-60	414	506	6.2	41	6.2	41	325	0.8	STD	79%	2.9
							325	0.8	MED	77%	3.8
							325	0.8	HIGH	82%	4.9
575-3-60	518	633	4.8	33	4.8	33	325	0.6	STD	81%	2.8
							325	0.6	MED	80%	3.5
							325	0.6	HIGH	84%	4.5

TABLE 93 – RAH110
2-STAGE COOLING WITH 2-SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP 1		COMP 2		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	15.9	110	15.9	110	610	7.4	STD	77%	7.1
							610	7.4	MED	82%	10.8
							610	7.4	HIGH	84%	13.6
230-3-60	187	253	15.9	110	15.9	110	610	7.4	STD	77%	6.8
							610	7.4	MED	82%	9.8
							610	7.4	HIGH	84%	12.7
460-3-60	414	506	7.0	52	7.0	52	610	3.6	STD	77%	3.8
							610	3.6	MED	82%	4.9
							610	3.6	HIGH	84%	6.4
575-3-60	518	633	5.1	40	5.1	40	610	3.6	STD	80%	3.5
							610	3.6	MED	84%	4.5
							610	3.6	HIGH	83%	6.2

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 94 – RAH120
2-STAGE COOLING WITH 2-SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP 1		COMP 2		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	15.9	110	15.9	110	1070	6.2	STD	77%	7.1
							1070	6.2	MED	82%	10.8
							1070	6.2	HIGH	84%	13.6
230-3-60	187	253	15.9	110	15.9	110	1070	6.2	STD	77%	6.8
							1070	6.2	MED	82%	9.8
							1070	6.2	HIGH	84%	12.7
460-3-60	414	506	7.7	52	7.7	52	1070	3.1	STD	77%	3.8
							1070	3.1	MED	82%	4.9
							1070	3.1	HIGH	84%	6.4
575-3-60	518	633	5.7	39	5.7	39	1070	2.5	STD	80%	3.5
							1070	2.5	MED	84%	4.5
							1070	2.5	HIGH	83%	6.2

TABLE 95 – RAH150
2-STAGE COOLING WITH 2-SPEED INDOOR FAN MOTOR

V-Ph-Hz	VOLTAGE RANGE		COMP 1		COMP 2		OFM (ea)		IFM		
	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
208-3-60	187	253	19.0	123	19.0	123	280	1.5	STD	85%	8.6
							280	1.5	MED	82%	10.8
							280	1.5	HIGH	90%	20.4
230-3-60	187	253	19.0	123	19.0	123	280	1.5	STD	85%	7.8
							280	1.5	MED	82%	9.8
							280	1.5	HIGH	90%	20.4
460-3-60	414	506	9.7	62	9.7	62	280	0.8	STD	85%	3.8
							280	0.8	MED	82%	4.9
							280	0.8	HIGH	90%	10.2
575-3-60	518	633	7.4	50	7.4	50	280	0.7	STD	84%	4.5
							280	0.7	MED	84%	4.5
							280	0.7	HIGH	94%	9.0

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

Table 96 – RAH036

ELECTRIC HEAT – ELECTRICAL DATA SINGLE STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER	
					CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/ unit)
208/ 230–1–60	DD–STD	101A00	4.4	3.3/4.0	–	–
		102A00	6.5	4.9/6.0	–	–
		103B00	8.7	6.5/8.0	037A00	037A00
		104B00	10.5	7.9/9.6	040A00	040A00
		102A00,102A00	13	9.8/11.9	040A00	040A00
208/ 230–3–60	DD–STD	101A00	4.4	3.3/4.0	–	–
		102A00	6.5	4.9/6.0	–	–
		103B00	8.7	6.5/8.0	–	–
		104B00	10.5	7.9/9.6	–	–
		105A00	16	12.0/14.7	037A00	037A00
	MED	101A00	4.4	3.3/4.0	–	–
		102A00	6.5	4.9/6.0	–	–
		103B00	8.7	6.5/8.0	–	–
		104B00	10.5	7.9/9.6	–	–
		105A00	16	12.0/14.7	037A00	037A00
	HIGH	101A00	4.4	3.3/4.0	–	–
		102A00	6.5	4.9/6.0	–	–
		103B00	8.7	6.5/8.0	–	–
		104B00	10.5	7.9/9.6	–	–
		105A00	16	12.0/14.7	037A00	037A00
460–3–60	DD–STD	106A00	6	5.5	–	–
		107A00	8.8	8.1	–	–
		108A00	11.5	10.6	–	–
		109A00	14	12.9	–	–
	MED	106A00	6	5.5	–	–
		107A00	8.8	8.1	–	–
		108A00	11.5	10.6	–	–
		109A00	14	12.9	–	–
	HIGH	106A00	6	5.5	–	–
		107A00	8.8	8.1	–	–
		108A00	11.5	10.6	–	–
		109A00	14	12.9	–	–
		106A00	6	5.5	–	–
		107A00	8.8	8.1	–	–
		109A00	14	12.9	–	–

LEGEND

APP PWR – 208 / 230V / 460V / 575V
 DD – Direct drive
 BD – Belt drive
 C.O. – Convenient outlet

FLA – Full load amps
 IFM – Indoor fan motor
 NOM PWR – 240V / 480V / 600V
 P.E. – Power exhaust
 UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 97 – RAH048

ELECTRIC HEAT – ELECTRICAL DATA SINGLE STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER	
					CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/PE. (pwrd fr/ unit)
208/ 230–1–60	DD–STD	101A00	4.4	3.3/4.0	–	–
		103B00	8.7	6.5/8.0	037A00	037A00
		102A00,102A00	13	9.8/11.9	040A00	040A00
		103B00,103B00	17.4	13.1/16.0	040A00	040A00
		104B00,104B00	21	15.8/19.3	040A00	040A00
208/ 230–3–60	DD–STD	102A00	6.5	4.9/6.0	–	–
		103B00	8.7	6.5/8.0	–	–
		105A00	16	12.0/14.7	037A00	037A00
		104B00,104B00	21	15.8/19.3	038A00	038A00
	MED	102A00	6.5	4.9/6.0	–	–
		103B00	8.7	6.5/8.0	–	–
		105A00	16	12.0/14.7	037A00	037A00
		104B00,104B00	21	15.8/19.3	038A00	038A00
	HIGH	102A00	6.5	4.9/6.0	–	–
		103B00	8.7	6.5/8.0	–	–
		105A00	16	12.0/14.7	037A00	037A00
		104B00,104B00	21	15.8/19.3	038A00	038A00
460–3–60	DD–STD	106A00	6	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14	12.9	–	–
		108A00,108A00	23	21.1	037A00	037A00
	MED	106A00	6	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14	12.9	–	–
		108A00,108A00	23	21.1	037A00	037A00
	HIGH	106A00	6	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14	12.9	–	–
		108A00,108A00	23	21.1	037A00	037A00

LEGEND

APP PWR – 208 / 230V / 460V / 575V
 DD – Direct drive
 BD – Belt drive
 C.O. – Convenient outlet

FLA – Full load amps
 IFM – Indoor fan motor
 NOM PWR – 240V / 480V / 600V
 PE. – Power exhaust
 UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 98 – RAH060

ELECTRIC HEAT – ELECTRICAL DATA SINGLE STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/PE. (pwrd fr/ unit)
208/ 230–1–60	DD–STD	102A00	6.5	4.9/6.0	–	–
		103B00	8.7	6.5/8.0	037A00	037A00
		102A00,102A00	13	9.8/11.9	040A00	040A00
		103B00,103B00	17.4	13.1/16.0	040A00	040A00
		104B00,104B00	21	15.8/19.3	040A00	040A00
208/ 230–3–60	DD–STD	102A00	6.5	4.9/6.0	–	–
		104B00	10.5	7.9/9.6	–	–
		105A00	16	12.0/14.7	037A00	037A00
		104B00,104B00	21	15.8/19.3	038A00	038A00
		104B00,105A00	26.5	19.9/24.3	038A00	038A00
	MED	102A00	6.5	4.9/6.0	–	–
		104B00	10.5	7.9/9.6	–	–
		105A00	16	12.0/14.7	037A00	037A00
		104B00,104B00	21	15.8/19.3	038A00	038A00
		104B00,105A00	26.5	19.9/24.3	038A00	038A00
	HIGH	102A00	6.5	4.9/6.0	–	–
		104B00	10.5	7.9/9.6	–	–
		105A00	16	12.0/14.7	037A00	037A00
		104B00,104B00	21	15.8/19.3	038A00	038A00
		104B00,105A00	26.5	19.9/24.3	038A00	038A00
460–3–60	DD–STD	106A00	6	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14	12.9	–	–
		108A00,108A00	23	21.1	037A00	037A00
		108A00,109A00	25.5	23.4	037A00	037A00
	MED	106A00	6	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14	12.9	–	–
		108A00,108A00	23	21.1	037A00	037A00
		108A00,109A00	25.5	23.4	037A00	037A00
	HIGH	106A00	6	5.5	–	–
		108A00	11.5	10.6	–	–
		109A00	14	12.9	–	–
		108A00,108A00	23	21.1	037A00	037A00
		108A00,109A00	25.5	23.4	037A00	037A00

LEGEND

- APP PWR – 208 / 230V / 460V / 575V
- DD – Direct drive
- BD – Belt drive
- C.O. – Convenient outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 99 – RAH072

ELECTRIC HEAT – ELECTRICAL DATA SINGLE STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER	
					CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/PE. (pwrd fr/ unit)
208/ 230–3–60	STD	264A00	6.5	4.9/6.0	042A00	042A00
		117A00	10.5	7.9/9.6	042A00	042A00
		110A00	16.0	12.0/14.7	042A00	042A00
		117A00,117A00	21.0	15.8/19.3	043A00	043A00
		110A00,117A00	26.5	19.9/24.3	043A00	043A00
	MED	264A00	6.5	4.9/6.0	042A00	042A00
		117A00	10.5	7.9/9.6	042A00	042A00
		110A00	16.0	12.0/14.7	042A00	043A00
		117A00,117A00	21.0	15.8/19.3	043A00	043A00
		110A00,117A00	26.5	19.9/24.3	043A00	043A00
	HIGH	264A00	6.5	4.9/6.0	042A00	042A00
		117A00	10.5	7.9/9.6	042A00	042A00
		110A00	16.0	12.0/14.7	043A00	043A00
		117A00,117A00	21.0	15.8/19.3	043A00	043A00
		110A00,117A00	26.5	19.9/24.3	043A00	043A00
460–3–60	STD	265A00	6.0	5.5	042A00	042A00
		266A00	11.5	10.6	042A00	042A00
		267A00	14.0	12.9	042A00	042A00
		268A00	23.0	21.1	042A00	042A00
		269A00	25.5	23.4	042A00	042A00
	MED	265A00	6.0	5.5	042A00	042A00
		266A00	11.5	10.6	042A00	042A00
		267A00	14.0	12.9	042A00	042A00
		268A00	23.0	21.1	042A00	042A00
		269A00	25.5	23.4	042A00	042A00
	HIGH	265A00	6.0	5.5	042A00	042A00
		266A00	11.5	10.6	042A00	042A00
		267A00	14.0	12.9	042A00	042A00
		268A00	23.0	21.1	042A00	042A00
		269A00	25.5	23.4	042A00	042A00

LEGEND

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenient outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- PE. – Power exhaust
- UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 100 – RAH090

ELECTRIC HEAT – ELECTRICAL DATA 2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER	
					CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/ unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	047A00	047A00
		111A00	24.8	18.6/22.8	049A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
	MED	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	047A00	047A00
		111A00	24.8	18.6/22.8	049A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
	HIGH	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	049A00	049A00
111A00		24.8	18.6/22.8	049A00	049A00	
112A00		32.0	24.0/29.4	049A00	049A00	
112A00,117A00		42.4	31.8/38.9	051A00	051A00	
460–3–60	STD	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		114A00	27.8	25.5	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
	MED	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		114A00	27.8	25.5	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
	HIGH	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
114A00		27.8	25.5	047A00	047A00	
115A00		33.0	30.3	047A00	047A00	
114A00,116A00		41.7	38.3	050A00	050A00	
575–3–60	STD	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	047A00
	MED	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	047A00
	HIGH	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	047A00

LEGEND

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenient outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 101 – RAH090

ELECTRIC HEAT – ELECTRICAL DATA 2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR

NOM. V–Ph–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER	
					CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/ P.E. (pwrd fr/unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	047A00	047A00
		111A00	24.8	18.6/22.8	049A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
	MED	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	047A00	049A00
		111A00	24.8	18.6/22.8	049A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
	HIGH	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	049A00	049A00
111A00		24.8	18.6/22.8	049A00	049A00	
112A00		32.0	24.0/29.4	049A00	049A00	
112A00,117A00		42.4	31.8/38.9	051A00	051A00	
460–3–60	STD	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		114A00	27.8	25.5	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
	MED	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		114A00	27.8	25.5	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
	HIGH	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
114A00		27.8	25.5	047A00	047A00	
115A00		33.0	30.3	047A00	047A00	
114A00,116A00		41.7	38.3	050A00	050A00	
575–3–60	STD	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	047A00
	MED	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	050A00
	HIGH	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	050A00

LEGEND

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenient outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 102 – RAH102

ELECTRIC HEAT – ELECTRICAL DATA 2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/P.E. (pwr fr/unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	047A00	047A00
		111A00	24.8	18.6/22.8	049A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
	MED	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	047A00	047A00
		111A00	24.8	18.6/22.8	049A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
	HIGH	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	049A00	049A00
111A00		24.8	18.6/22.8	049A00	049A00	
112A00		32.0	24.0/29.4	049A00	049A00	
112A00,117A00		42.4	31.8/38.9	051A00	051A00	
460–3–60	STD	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		114A00	27.8	25.5	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
	MED	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		114A00	27.8	25.5	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
	HIGH	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		114A00	27.8	25.5	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
575–3–60	STD	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	047A00
	MED	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	047A00
	HIGH	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	047A00

LEGEND

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenient outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 103 – RAH102

ELECTRIC HEAT – ELECTRICAL DATA 2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR

NOM. V–Ph–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER	
					CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/ P.E. (pwrd fr/unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	047A00	047A00
		111A00	24.8	18.6/22.8	049A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
	MED	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	047A00	049A00
		111A00	24.8	18.6/22.8	049A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
	HIGH	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	049A00	049A00
111A00		24.8	18.6/22.8	049A00	049A00	
112A00		32.0	24.0/29.4	049A00	049A00	
112A00,117A00		42.4	31.8/38.9	051A00	051A00	
460–3–60	STD	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		114A00	27.8	25.5	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
	MED	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		114A00	27.8	25.5	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
	HIGH	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
114A00		27.8	25.5	047A00	047A00	
115A00		33.0	30.3	047A00	047A00	
114A00,116A00		41.7	38.3	050A00	050A00	
575–3–60	STD	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	047A00
	MED	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	050A00
	HIGH	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	050A00

LEGEND

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenient outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 104 – RAH110

ELECTRIC HEAT – ELECTRICAL DATA 2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/P.E. (pwr fr/ unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	047A00	047A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
		112A00,110A00	50.0	37.6/45.9	051A00	051A00
	MED	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	049A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
		112A00,110A00	50.0	37.6/45.9	051A00	051A00
	HIGH	117A00	10.4	7.8/9.6	049A00	049A00
		110A00	16.0	12.0/14.7	049A00	049A00
112A00		32.0	24.0/29.4	049A00	049A00	
112A00,117A00		42.4	31.8/38.9	051A00	051A00	
112A00,110A00		50.0	37.6/45.9	051A00	051A00	
460–3–60	STD	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		115A00,116A00	41.7	38.3	050A00	050A00
		115A00,113A00	50.0	45.9	050A00	050A00
	MED	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
		115A00,113A00	50.0	45.9	050A00	050A00
	HIGH	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
115A00		33.0	30.3	047A00	050A00	
114A00,116A00		41.7	38.3	050A00	050A00	
115A00,113A00		50.0	45.9	050A00	050A00	
575–3–60	STD	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	047A00
		118A00,119A00	51.0	51.0	050A00	050A00
	MED	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	047A00
		118A00,119A00	51.0	51.0	050A00	050A00
	HIGH	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	050A00
		118A00,119A00	51.0	51.0	050A00	050A00

LEGEND

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenient outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 105 – RAH110

ELECTRIC HEAT – ELECTRICAL DATA 2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR

NOM. V–Ph–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER	
					CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO RE.	w/ RE. (pwrd fr/unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	047A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
	MED	112A00,110A00	50.0	37.6/45.9	051A00	051A00
		117A00	10.4	7.8/9.6	047A00	049A00
		110A00	16.0	12.0/14.7	049A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
	HIGH	112A00,117A00	42.4	31.8/38.9	051A00	051A00
		112A00,110A00	50.0	37.6/45.9	051A00	051A00
		117A00	10.4	7.8/9.6	047A00	049A00
		110A00	16.0	12.0/14.7	049A00	049A00
460–3–60	STD	112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
		112A00,110A00	50.0	37.6/45.9	051A00	051A00
		116A00	13.9	12.8	047A00	047A00
	MED	113A00	16.5	15.2	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
		115A00,113A00	50.0	45.9	050A00	050A00
	HIGH	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
575–3–60	STD	115A00,113A00	50.0	45.9	050A00	050A00
		116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
	MED	114A00,116A00	41.7	38.3	050A00	050A00
		115A00,113A00	50.0	45.9	050A00	050A00
		118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	050A00
	HIGH	118A00,119A00	51.0	51.0	050A00	050A00
		118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	050A00
		118A00,119A00	51.0	51.0	050A00	050A00

LEGEND

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenient outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- RE. – Power exhaust
- UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 106 – RAH120

ELECTRIC HEAT – ELECTRICAL DATA 2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/P.E. (pwr fr/ unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	047A00	047A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
		112A00,110A00	50.0	37.6/45.9	051A00	051A00
	MED	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	049A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
		112A00,110A00	50.0	37.6/45.9	051A00	051A00
	HIGH	117A00	10.4	7.8/9.6	049A00	049A00
		110A00	16.0	12.0/14.7	049A00	049A00
112A00		32.0	24.0/29.4	049A00	049A00	
112A00,117A00		42.4	31.8/38.9	051A00	051A00	
112A00,110A00		50.0	37.6/45.9	051A00	051A00	
460–3–60	STD	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		115A00,116A00	41.7	38.3	050A00	050A00
		115A00,113A00	50.0	45.9	050A00	050A00
	MED	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
		115A00,113A00	50.0	45.9	050A00	050A00
	HIGH	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
115A00		33.0	30.3	047A00	050A00	
114A00,116A00		41.7	38.3	050A00	050A00	
115A00,113A00		50.0	45.9	050A00	050A00	
575–3–60	STD	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	047A00
		118A00,119A00	51.0	51.0	050A00	050A00
	MED	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	047A00
		118A00,119A00	51.0	51.0	050A00	050A00
	HIGH	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	050A00
		118A00,119A00	51.0	51.0	050A00	050A00

LEGEND

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenient outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 107 – RAH120

ELECTRIC HEAT – ELECTRICAL DATA 2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR

NOM. V–Ph–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO RE.	w/ RE. (pwrd fr/unit)
208/ 230–3–60	STD	117A00	10.4	7.8/9.6	047A00	047A00
		110A00	16.0	12.0/14.7	047A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
		112A00,117A00	42.4	31.8/38.9	051A00	051A00
	MED	112A00,110A00	50.0	37.6/45.9	051A00	051A00
		117A00	10.4	7.8/9.6	047A00	049A00
		110A00	16.0	12.0/14.7	049A00	049A00
		112A00	32.0	24.0/29.4	049A00	049A00
	HIGH	112A00,117A00	42.4	31.8/38.9	051A00	051A00
		112A00,110A00	50.0	37.6/45.9	051A00	051A00
		117A00	10.4	7.8/9.6	047A00	049A00
		110A00	16.0	12.0/14.7	049A00	049A00
460–3–60	STD	116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
	MED	115A00,113A00	50.0	45.9	050A00	050A00
		116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
		115A00	33.0	30.3	047A00	047A00
	HIGH	114A00,116A00	41.7	38.3	050A00	050A00
		115A00,113A00	50.0	45.9	050A00	050A00
		116A00	13.9	12.8	047A00	047A00
		113A00	16.5	15.2	047A00	047A00
575–3–60	STD	115A00	33.0	30.3	047A00	047A00
		114A00,116A00	41.7	38.3	050A00	050A00
		115A00,113A00	50.0	45.9	050A00	050A00
	MED	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	050A00
		118A00,119A00	51.0	51.0	050A00	050A00
	HIGH	118A00	17.0	17.0	047A00	047A00
		119A00	34.0	34.0	047A00	050A00
		118A00,119A00	51.0	51.0	050A00	050A00

LEGEND

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenient outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- RE. – Power exhaust
- UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 108 – RAH150

ELECTRIC HEAT – ELECTRICAL DATA 2-STAGE COOLING SINGLE SPEED INDOOR FAN MOTOR

NOM. V–PH–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER	
					CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/P.E. (pwrd fr/ unit)
208/ 230–3–60	STD	291A00	16.5	12.4/15.2	–	049A00
		288A00,291A00	26.5	19.9/24.3	049A00	049A00
		294A00	33.5	25.2/30.8	049A00	049A00
		288A00,294A00	43.5	32.7/40.0	051A00	051A00
		291A00,294A00	50.0	37.6/45.9	051A00	051A00
	MED	291A00	16.5	12.4/15.2	049A00	049A00
		288A00,291A00	26.5	19.9/24.3	049A00	049A00
		294A00	33.5	25.2/30.8	049A00	049A00
		288A00,294A00	43.5	32.7/40.0	051A00	051A00
		291A00,294A00	50.0	37.6/45.9	051A00	051A00
	HIGH	291A00	16.5	12.4/15.2	049A00	049A00
		288A00,291A00	26.5	19.9/24.3	049A00	049A00
		294A00	33.5	25.2/30.8	049A00	049A00
		288A00,294A00	43.5	32.7/40.0	051A00	051A00
		291A00,294A00	50.0	37.6/45.9	051A00	051A00
460–3–60	STD	292A00	16.5	15.2	–	–
		289A00,292A00	26.5	24.3	047A00	047A00
		295A00	33.5	30.8	047A00	047A00
		289A00,295A00	43.5	40.0	050A00	050A00
		292A00,295A00	50.0	45.9	050A00	050A00
	MED	292A00	16.5	15.2	–	–
		289A00,292A00	26.5	24.3	047A00	047A00
		295A00	33.5	30.8	047A00	047A00
		289A00,295A00	43.5	40.0	050A00	050A00
		292A00,295A00	50.0	45.9	050A00	050A00
	HIGH	292A00	16.5	15.2	–	–
		289A00,292A00	26.5	24.3	047A00	047A00
		295A00	33.5	30.8	050A00	050A00
		289A00,295A00	43.5	40.0	050A00	050A00
		292A00,295A00	50.0	45.9	050A00	050A00
575–3–60	STD	293A00	16.5	15.2	–	–
		290A00,293A00	26.5	24.3	047A00	047A00
		296A00	33.5	30.8	050A00	050A00
		290A00,296A00	43.5	40.0	050A00	050A00
		293A00,296A00	50.0	45.9	050A00	050A00
	MED	293A00	16.5	15.2	–	–
		290A00,293A00	26.5	24.3	047A00	047A00
		296A00	33.5	30.8	050A00	050A00
		290A00,296A00	43.5	40.0	050A00	050A00
		293A00,296A00	50.0	45.9	050A00	050A00
	HIGH	293A00	16.5	15.2	–	–
		290A00,293A00	26.5	24.3	047A00	047A00
		296A00	33.5	30.8	050A00	050A00
		290A00,296A00	43.5	40.0	050A00	050A00
		293A00,296A00	50.0	45.9	050A00	050A00

LEGEND

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenient outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 109 – RAH150

ELECTRIC HEAT – ELECTRICAL DATA 2-STAGE COOLING 2-SPEED INDOOR FAN MOTOR

NOM. V–Ph–Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER CRHEATER	NOM PWR (kW)	APP PWR (kW)	SINGLE POINT KIT PART NUMBER	
					CRSINGLE	
					NO C.O. or UNPWRD C.O.	
					NO P.E.	w/ P.E. (pwrd fr/unit)
208/ 230–3–60	STD	291A00	16.5	12.4/15.2	049A00	049A00
		288A00,291A00	26.5	19.9/24.3	049A00	049A00
		294A00	33.5	25.2/30.8	049A00	049A00
		288A00,294A00	43.5	32.7/40.0	051A00	051A00
		291A00,294A00	50.0	37.6/45.9	051A00	051A00
	MED	291A00	16.5	12.4/15.2	049A00	049A00
		288A00,291A00	26.5	19.9/24.3	049A00	049A00
		294A00	33.5	25.2/30.8	049A00	049A00
		288A00,294A00	43.5	32.7/40.0	051A00	051A00
		291A00,294A00	50.0	37.6/45.9	051A00	051A00
	HIGH	291A00	16.5	12.4/15.2	049A00	049A00
		288A00,291A00	26.5	19.9/24.3	049A00	049A00
		294A00	33.5	25.2/30.8	049A00	049A00
		288A00,294A00	43.5	32.7/40.0	051A00	051A00
		291A00,294A00	50.0	37.6/45.9	051A00	051A00
460–3–60	STD	292A00	16.5	15.2	–	–
		289A00,292A00	26.5	24.3	047A00	047A00
		295A00	33.5	30.8	047A00	047A00
		289A00,295A00	43.5	40.0	050A00	050A00
		292A00,295A00	50.0	45.9	050A00	050A00
	MED	292A00	16.5	15.2	–	–
		289A00,292A00	26.5	24.3	047A00	047A00
		295A00	33.5	30.8	047A00	047A00
		289A00,295A00	43.5	40.0	050A00	050A00
		292A00,295A00	50.0	45.9	050A00	050A00
	HIGH	292A00	16.5	15.2	–	–
		289A00,292A00	26.5	24.3	047A00	047A00
		295A00	33.5	30.8	050A00	050A00
		289A00,295A00	43.5	40.0	050A00	050A00
		292A00,295A00	50.0	45.9	050A00	050A00
575–3–60	STD	293A00	16.5	15.2	–	–
		290A00,293A00	26.5	24.3	047A00	047A00
		296A00	33.5	30.8	047A00	047A00
		290A00,296A00	43.5	40.0	047A00	050A00
		293A00,296A00	50.0	45.9	047A00	047A00
	MED	293A00	16.5	15.2	–	–
		290A00,293A00	26.5	24.3	047A00	047A00
		296A00	33.5	30.8	047A00	047A00
		290A00,296A00	43.5	40.0	047A00	050A00
		293A00,296A00	50.0	45.9	047A00	047A00
	HIGH	293A00	16.5	15.2	–	–
		290A00,293A00	26.5	24.3	047A00	047A00
		296A00	33.5	30.8	047A00	047A00
		290A00,296A00	43.5	40.0	050A00	050A00
		293A00,296A00	50.0	45.9	050A00	050A00

LEGEND

- APP PWR – 208 / 230V / 460V / 575V
- C.O. – Convenient outlet
- FLA – Full load amps
- IFM – Indoor fan motor
- NOM PWR – 240V / 480V / 600V
- P.E. – Power exhaust
- UNPWRD – Unpowered convenient outlet

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 110 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA

UNIT	NO M. V. – Ph–HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO RE.				w/ RE. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH036	208/230–1–60*	DD–STD	NONE	–	–	30	45	29	88	32	45	31	90
			101A	3.3/4.4	15.9/18.3	30/33	45/45	29/30	88/88	32/35	45/45	31/32	90/90
			102A	4.9/6.5	23.5/27.1	39/44	45/45	36/40	88/88	41/46	45/50	38/42	90/90
			103B	6.5/8.7	31.4/36.3	49/55	50/60	45/50	88/88	51/57	60/60	47/52	90/90
			104B	7.9/10.5	37.9/43.8	57/64	60/70	52/59	88/88	59/67	60/70	54/61	90/90
			102A+102A	9.8/13.0	46.9/54.2	68/77	70/80	62/71	88/88	71/80	80/80	65/73	90/90
	208/230–3–60	DD–STD	NONE	–	–	22	30	22	82	24	30	24	84
			101A	3.3/4.4	9.2/10.6	22/23	30/30	22/22	82/82	24/25	30/30	24/24	84/84
			102A	4.9/6.5	13.6/15.6	27/29	30/30	24/26	82/82	29/32	30/35	26/29	84/84
			103B	6.5/8.7	18.1/20.9	32/36	35/40	29/33	82/82	35/38	35/40	32/35	84/84
			104B	7.9/10.5	21.9/25.3	37/41	40/45	34/38	82/82	39/44	40/45	36/40	84/84
			105A	12.0/16.0	33.4/38.5	51/58	60/60	47/53	82/82	54/60	60/60	49/55	84/84
		MED	NONE	–	–	19	25	19	87	21	30	21	89
			101A	3.3/4.4	9.2/10.6	19/20	25/25	19/19	87/87	21/22	30/30	21/21	89/89
			102A	4.9/6.5	13.6/15.6	24/26	25/30	21/24	87/87	26/28	30/30	23/26	89/89
			103B	6.5/8.7	18.1/20.9	29/33	30/35	26/30	87/87	32/35	35/35	29/32	89/89
			104B	7.9/10.5	21.9/25.3	34/38	35/40	31/35	87/87	36/41	40/45	33/37	89/89
			105A	12.0/16.0	33.4/38.5	48/55	50/60	44/50	87/87	51/57	60/60	46/52	89/89
		HIGH	NONE	–	–	20	25	19	105	22	30	21	107
			101A	3.3/4.4	9.2/10.6	20/20	25/25	19/19	105/105	22/23	30/30	21/21	107/107
			102A	4.9/6.5	13.6/15.6	24/26	25/30	22/24	105/105	26/29	30/30	24/26	107/107
			103B	6.5/8.7	18.1/20.9	30/33	30/35	27/30	105/105	32/35	35/40	29/32	107/107
			104B	7.9/10.5	21.9/25.3	34/39	35/40	31/35	105/105	37/41	40/45	33/37	107/107
			105A	12.0/16.0	33.4/38.5	49/55	50/60	44/50	105/105	51/57	60/60	47/52	107/107
	460–3–60	DD–STD	NONE	–	–	12	15	12	43	13	15	13	44
			106A	6.0	7.2	14	15	13	43	16	20	14	44
			107A	8.8	10.6	19	20	17	43	20	20	18	44
			108A	11.5	13.8	23	25	20	43	24	25	22	44
			109A	14.0	16.8	26	30	24	43	28	30	25	44
		MED	NONE	–	–	10	15	10	45	11	15	11	46
			106A	6.0	7.2	12	15	11	45	13	15	12	46
			107A	8.8	10.6	16	20	15	45	18	20	16	46
			108A	11.5	13.8	20	20	18	45	22	25	19	46
			109A	14.0	16.8	24	25	22	45	25	25	23	46
		HIGH	NONE	–	–	11	15	10	54	12	15	11	55
			106A	6.0	7.2	13	15	11	54	14	15	12	55
	107A		8.8	10.6	17	20	15	54	18	20	16	55	
	108A		11.5	13.8	21	25	19	54	22	25	20	55	
	109A		14.0	16.8	25	25	22	54	26	30	23	55	
	575–3–60	DD–STD	NONE	–	–	10	15	10	42	12	15	12	44
			297A	9.2	9.2	17	20	15	42	19	20	17	44
			298A	13.8	13.8	23	25	20	42	25	25	23	44
		MED	NONE	–	–	8	15	7	43	10	15	9	45
			297A	9.2	9.2	14	15	13	43	17	20	15	45
			298A	13.8	13.8	20	20	18	43	22	25	20	45
		HIGH	NONE	–	–	8	15	7	49	10	15	9	51
			297A	9.2	9.2	14	15	13	49	17	20	15	51
			298A	13.8	13.8	20	20	18	49	23	25	20	51

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

Table 110 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (cont)

UNIT	NO M. V – PH – HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.								
			CRHEATER***A00	Nom (kW)	FLA	NO PE.				w/ PE. (pwrd fr/unit)				
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE		
								FLA	LRA			FLA	LRA	
RAH048	208/230–1–60*	DD–STD	NONE	–	–	37	50	35	127	38	50	37	129	
			101A	3.3/4.4	15.9/18.3	37/37	50/50	35/35	127/127	38/38	50/50	37/37	129/129	
			103B	6.5/8.7	31.4/36.3	49/55	50/60	45/50	127/127	51/57	60/60	47/52	129/129	
			102A+102A	9.8/13.0	46.9/54.2	68/77	70/80	62/71	127/127	71/80	80/80	65/73	129/129	
			103B+103B	13.1/17.4	62.8/72.5	88/100	90/100	81/92	127/127	91/103	100/110	83/94	129/129	
			104B+104B	15.8/21.0	75.8/87.5	104/119	110/125	96/109	127/127	107/121	110/125	98/111	129/129	
	208/230–3–60	DD–STD	NONE	–	–	26	30	26	93	28	40	28	95	
			102A	4.9/6.5	13.6/15.6	27/29	30/30	26/26	93/93	29/32	40/40	28/29	95/95	
			103B	6.5/8.7	18.1/20.9	32/36	35/40	29/33	93/93	35/38	40/40	32/35	95/95	
			105A	12.0/16.0	33.4/38.5	51/58	60/60	47/53	93/93	54/60	60/60	49/55	95/95	
			104B+104B	15.8/21.0	43.8/50.5	64/73	70/80	59/67	93/93	67/75	70/80	61/69	95/95	
		MED	NONE	–	–	24	30	23	105	26	30	26	107	
			102A	4.9/6.5	13.6/15.6	24/26	30/30	23/24	105/105	26/29	30/30	26/26	107/107	
			103B	6.5/8.7	18.1/20.9	30/33	30/35	27/30	105/105	32/35	35/40	29/32	107/107	
			105A	12.0/16.0	33.4/38.5	49/55	50/60	44/50	105/105	51/57	60/60	47/52	107/107	
			104B+104B	15.8/21.0	43.8/50.5	62/70	70/70	56/64	105/105	64/72	70/80	59/66	107/107	
		HIGH	NONE	–	–	26	30	26	142	28	40	28	144	
			102A	4.9/6.5	13.6/15.6	27/29	30/30	26/27	142/142	29/32	40/40	28/29	144/144	
			103B	6.5/8.7	18.1/20.9	32/36	35/40	29/33	142/142	35/38	40/40	32/35	144/144	
			105A	12.0/16.0	33.4/38.5	52/58	60/60	47/53	142/142	54/60	60/60	49/55	144/144	
			104B+104B	15.8/21.0	43.8/50.5	65/73	70/80	59/67	142/142	67/75	70/80	61/69	144/144	
		460–3–60	DD–STD	NONE	–	–	13	15	13	47	14	20	14	48
				106A	6.0	7.2	14	15	13	47	16	20	14	48
				108A	11.5	13.8	23	25	20	47	24	25	22	48
	109A			14.0	16.8	26	30	24	47	28	30	25	48	
	108A+108A			23.0	27.7	40	40	36	47	41	45	38	48	
	MED		NONE	–	–	12	15	11	52	13	15	12	53	
			106A	6.0	7.2	13	15	11	52	14	15	12	53	
108A			11.5	13.8	21	25	19	52	22	25	20	53		
109A			14.0	16.8	25	25	22	52	26	30	23	53		
108A+108A			23.0	27.7	38	40	35	52	40	40	36	53		
HIGH	NONE		–	–	13	15	12	71	14	15	13	72		
	106A		6.0	7.2	14	15	12	71	15	15	13	72		
	108A	11.5	13.8	22	25	20	71	23	25	21	72			
	109A	14.0	16.8	26	30	23	71	27	30	24	72			
	108A+108A	23.0	27.7	39	40	36	71	41	45	37	72			
575–3–60	DD–STD	NONE	–	–	11	15	11	39	13	15	13	41		
		297A	9.2	9.2	17	20	15	39	19	20	17	41		
		298A	13.8	13.8	23	25	20	39	25	25	23	41		
		NONE	–	–	9	15	8	42	11	15	11	44		
	MED	297A	9.2	9.2	14	15	12	42	16	20	15	44		
		298A	13.8	13.8	20	20	18	42	22	25	20	44		
		NONE	–	–	10	15	10	57	12	15	12	59		
		297A	9.2	9.2	15	15	14	57	18	20	16	59		
	HIGH	298A	13.8	13.8	21	25	19	57	24	25	21	59		

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

Table 110 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA (cont)

UNIT	NO M, V-PH-HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH060	208/230-1-60*	DD-STD	NONE	—	—	41	60	39	144	42	60	41	146
			102A	4.9/6.5	23.5/27.1	41/44	60/60	39/40	144/144	42/46	60/60	41/42	146/146
			103B	6.5/8.7	31.4/36.3	49/55	60/60	45/50	144/144	51/57	60/60	47/52	146/146
			102A+102A	9.8/13.0	46.9/54.2	68/77	70/80	62/71	144/144	71/80	80/80	65/73	146/146
			103B+103B	13.1/17.4	62.8/72.5	88/100	90/100	81/92	144/144	91/103	100/110	83/94	146/146
			104B+104B	15.8/21.0	75.8/87.5	104/119	110/125	96/109	144/144	107/121	110/125	98/111	146/146
	208/230-3-60	DD-STD	NONE	—	—	29	40	28	120	31	45	31	122
			102A	4.9/6.5	13.6/15.6	29/29	40/40	28/28	120/120	31/32	45/45	31/31	122/122
			104B	7.9/10.5	21.9/25.3	37/41	40/45	34/38	120/120	39/44	45/45	36/40	122/122
			105A	12.0/16.0	33.4/38.5	51/58	60/60	47/53	120/120	54/60	60/60	49/55	122/122
			104B+104B	15.8/21.0	43.8/50.5	64/73	70/80	59/67	120/120	67/75	70/80	61/69	122/122
			104B+105A	19.9/26.5	55.2/63.8	79/89	80/90	72/82	120/120	81/92	90/100	74/84	122/122
		MED	NONE	—	—	27	40	26	143	29	40	28	145
			102A	4.9/6.5	13.6/15.6	27/27	40/40	26/26	143/143	29/29	40/40	28/28	145/145
			104B	7.9/10.5	21.9/25.3	34/39	40/40	31/35	143/143	37/41	40/45	33/37	145/145
			105A	12.0/16.0	33.4/38.5	49/55	50/60	44/50	143/143	51/57	60/60	47/52	145/145
			104B+104B	15.8/21.0	43.8/50.5	62/70	70/70	56/64	143/143	64/72	70/80	59/66	145/145
			104B+105A	19.9/26.5	55.2/63.8	76/87	80/90	69/79	143/143	78/89	80/90	72/82	145/145
		HIGH	NONE	—	—	29	40	29	169	31	45	31	171
			102A	4.9/6.5	13.6/15.6	29/29	40/40	29/29	169/169	31/32	45/45	31/31	171/171
			104B	7.9/10.5	21.9/25.3	37/41	40/45	34/38	169/169	40/44	45/45	36/40	171/171
			105A	12.0/16.0	33.4/38.5	52/58	60/60	47/53	169/169	54/60	60/60	49/55	171/171
			104B+104B	15.8/21.0	43.8/50.5	65/73	70/80	59/67	169/169	67/75	70/80	61/69	171/171
			104B+105A	19.9/26.5	55.2/63.8	79/90	80/90	72/82	169/169	81/92	90/100	74/84	171/171
460-3-60	DD-STD	NONE	—	—	14	20	14	58	15	20	15	59	
		106A	6.0	7.2	14	20	14	58	16	20	15	59	
		108A	11.5	13.8	23	25	20	58	24	25	22	59	
		109A	14.0	16.8	26	30	24	58	28	30	25	59	
		108A+108A	23.0	27.7	40	40	36	58	41	45	38	59	
		108A+109A	25.5	30.7	44	45	40	58	45	45	41	59	
	MED	NONE	—	—	13	15	12	69	14	20	13	70	
		106A	6.0	7.2	13	15	12	69	14	20	13	70	
		108A	11.5	13.8	21	25	19	69	22	25	20	70	
		109A	14.0	16.8	25	25	22	69	26	30	23	70	
		108A+108A	23.0	27.7	38	40	35	69	40	40	36	70	
		108A+109A	25.5	30.7	42	45	38	69	43	45	39	70	
	HIGH	NONE	—	—	14	20	13	82	15	20	14	83	
		106A	6.0	7.2	14	20	13	82	15	20	14	83	
		108A	11.5	13.8	22	25	20	82	23	25	21	83	
		109A	14.0	16.8	26	30	23	82	27	30	24	83	
		108A+108A	23.0	27.7	39	40	36	82	41	45	37	83	
		108A+109A	25.5	30.7	43	45	39	82	44	45	40	83	
575-3-60	DD-STD	NONE	—	—	12	15	12	46	14	15	14	48	
		298A	13.8	13.8	23	25	20	46	25	25	23	48	
		301A	23.0	23.1	34	35	31	46	37	40	33	48	
	MED	NONE	—	—	10	15	9	53	12	15	11	55	
		298A	13.8	13.8	20	20	18	53	23	25	20	55	
		301A	23.0	23.1	32	35	29	53	34	35	31	55	
	HIGH	NONE	—	—	11	15	10	64	12	15	12	66	
		298A	13.8	13.8	21	25	19	64	24	25	21	66	
		301A	23.0	23.1	33	35	30	64	35	35	32	66	

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

TABLE 111 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR

UNIT	NO M. V.-Ph-HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH072	208/230-3-60	STD	NONE	—	—	32	50	31	148	36	50	36	152
			264A	4.9/6.5	13.6/15.6	32/32	50/50	31/31	148/148	36/36	50/50	36/36	152/152
			117A	7.8/10.4	21.7/25.0	34/38	50/50	31/35	148/148	39/43	50/50	36/39	152/152
			110A	12.0/16.0	33.4/38.5	49/55	50/60	44/50	148/148	53/60	60/60	49/55	152/152
			117A+117A	15.8/21.0	43.8/50.5	62/70	70/70	56/64	148/148	66/75	70/80	61/68	152/152
			110A+117A	19.9/26.5	55.2/63.8	76/87	80/90	69/79	148/148	81/91	90/100	74/84	152/152
		MED	NONE	—	—	35	50	34	185	39	50	38	189
			264A	4.9/6.5	13.6/15.6	35/35	50/50	34/34	185/185	39/39	50/50	38/38	189/189
			117A	7.8/10.4	21.7/25.0	37/41	50/50	34/37	185/185	42/46	50/50	38/42	189/189
			110A	12.0/16.0	33.4/38.5	52/58	60/60	47/53	185/185	56/63	60/70	51/57	189/189
			117A+117A	15.8/21.0	43.8/50.5	65/73	70/80	59/67	185/185	69/78	70/80	63/71	189/189
			110A+117A	19.9/26.5	55.2/63.8	79/90	80/90	72/82	185/185	84/94	90/100	76/86	189/189
		HIGH	NONE	—	—	42	60	43	211	46	60	47	215
			264A	4.9/6.5	13.6/15.6	42/42	60/60	43/43	211/211	46/46	60/60	47/47	215/215
			117A	7.8/10.4	21.7/25.0	46/50	60/60	43/46	211/211	51/55	60/60	47/50	215/215
	110A		12.0/16.0	33.4/38.5	61/67	70/70	56/62	211/211	66/72	70/80	60/66	215/215	
	117A+117A		15.8/21.0	43.8/50.5	74/82	80/90	68/75	211/211	79/87	80/90	72/80	215/215	
	110A+117A		19.9/26.5	55.2/63.8	88/99	90/100	81/91	211/211	93/104	100/110	85/95	215/215	
	460-3-60	STD	NONE	—	—	17	25	16	75	19	25	18	77
			265A	6.0	7.2	17	25	16	75	19	25	18	77
			266A	11.5	13.8	21	25	19	75	23	25	21	77
			267A	14.0	16.8	25	25	22	75	27	30	24	77
			268A	23.0	27.7	38	40	35	75	41	45	37	77
			269A	25.5	30.7	42	45	38	75	44	45	40	77
		MED	NONE	—	—	18	25	17	94	19	25	19	96
			265A	6.0	7.2	18	25	17	94	19	25	19	96
			266A	11.5	13.8	22	25	20	94	24	25	22	96
			267A	14.0	16.8	26	30	23	94	28	30	25	96
			268A	23.0	27.7	39	40	36	94	42	45	38	96
			269A	25.5	30.7	43	45	39	94	45	45	41	96
HIGH		NONE	—	—	22	30	22	107	23	30	24	109	
		265A	6.0	7.2	22	30	22	107	23	30	24	109	
		266A	11.5	13.8	27	30	24	107	29	30	26	109	
	267A	14.0	16.8	31	35	28	107	33	35	30	109		
	268A	23.0	27.7	44	45	40	107	47	50	42	109		
	269A	25.5	30.7	48	50	44	107	50	50	46	109		
575-3-60	STD	NONE	—	—	12	15	11	61	16	20	16	65	
		118A	17.0	20.4	27	30	25	61	32	35	29	65	
		299A	25.7	25.8	34	35	31	61	39	40	35	65	
	MED	NONE	—	—	14	20	13	76	18	20	17	80	
		118A	17.0	20.4	29	30	27	76	34	35	31	80	
		299A	25.7	25.8	36	40	33	76	41	45	37	80	
	HIGH	NONE	—	—	17	20	16	90	20	25	21	94	
		118A	17.0	20.4	33	35	30	90	38	40	34	94	
		299A	25.7	25.8	40	40	36	90	44	45	40	94	

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

Table 111 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR (cont)

UNIT	NO M. V--Ph--HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrdr fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH090	208/230--3--60	STD	NONE	—	—	39	50	41	191	43	50	45	195
			117A	7.8/10.4	21.7/25.0	39/39	50/50	41/41	191/191	43/43	50/50	45/45	195/195
			110A	12.0/16.0	33.4/38.5	49/55	50/60	44/50	191/191	53/60	60/60	49/55	195/195
			111A	18.6/24.8	51.7/59.7	72/82	80/90	65/75	191/191	76/86	80/90	70/79	195/195
			112A	24.0/32.0	66.7/77.0	90/103	90/110	83/95	191/191	95/108	100/110	87/99	195/195
		112A+117A	31.8/42.4	88.4/102.0	117/134	125/150	108/123	191/191	122/139	125/150	112/128	195/195	
		MED	NONE	—	—	39	50	41	202	43	50	45	206
			117A	7.8/10.4	21.7/25.0	39/39	50/50	41/41	202/202	43/43	50/50	45/45	206/206
			110A	12.0/16.0	33.4/38.5	49/55	50/60	44/50	202/202	53/60	60/60	49/55	206/206
			111A	18.6/24.8	51.7/59.7	72/82	80/90	65/75	202/202	76/86	80/90	70/79	206/206
			112A	24.0/32.0	66.7/77.0	90/103	90/110	83/95	202/202	95/108	100/110	87/99	206/206
		112A+117A	31.8/42.4	88.4/102.0	117/134	125/150	108/123	202/202	122/139	125/150	112/128	206/206	
		HIGH	NONE	—	—	44	50	46	245	48	60	51	249
			117A	7.8/10.4	21.7/25.0	44/44	50/50	46/46	245/245	48/49	60/60	51/51	249/249
			110A	12.0/16.0	33.4/38.5	55/61	60/70	50/56	245/245	59/66	60/70	54/60	249/249
	111A		18.6/24.8	51.7/59.7	78/88	80/90	71/80	245/245	82/92	90/100	75/85	249/249	
	112A		24.0/32.0	66.7/77.0	96/109	100/110	88/100	245/245	101/114	110/125	93/104	249/249	
	112A+117A	31.8/42.4	88.4/102.0	123/140	125/150	113/129	245/245	128/145	150/150	118/133	249/249		
	460--3--60	STD	NONE	—	—	18	20	19	95	20	25	21	97
			116A	13.9	16.7	25	25	22	95	27	30	24	97
			113A	16.5	19.8	28	30	26	95	31	35	28	97
			114A	27.8	33.4	45	50	41	95	48	50	43	97
			115A	33.0	39.7	53	60	49	95	56	60	51	97
		114A+116A	41.7	50.2	66	70	61	95	69	70	63	97	
		MED	NONE	—	—	18	20	19	101	20	25	21	103
			116A	13.9	16.7	25	25	22	101	27	30	24	103
			113A	16.5	19.8	28	30	26	101	31	35	28	103
			114A	27.8	33.4	45	50	41	101	48	50	43	103
			115A	33.0	39.7	53	60	49	101	56	60	51	103
		114A+116A	41.7	50.2	66	70	61	101	69	70	63	103	
		HIGH	NONE	—	—	20	25	21	123	22	25	23	125
			116A	13.9	16.7	27	30	24	123	29	30	26	125
			113A	16.5	19.8	31	35	28	123	33	35	30	125
	114A		27.8	33.4	48	50	43	123	50	50	46	125	
	115A		33.0	39.7	56	60	51	123	58	60	53	125	
	114A+116A	41.7	50.2	69	70	63	123	71	80	65	125		
575--3--60	STD	NONE	—	—	12	15	12	77	16	20	17	81	
		118A	17.0	20.4	27	30	25	77	32	35	29	81	
		119A	34.0	40.9	53	60	48	77	58	60	53	81	
	MED	NONE	—	—	13	15	13	81	17	20	18	85	
		118A	17.0	20.4	28	30	26	81	33	35	30	85	
		119A	34.0	40.9	54	60	49	81	59	60	54	85	
	HIGH	NONE	—	—	14	15	14	92	18	20	19	96	
		118A	17.0	20.4	29	30	27	92	34	35	31	96	
		119A	34.0	40.9	55	60	50	92	60	60	55	96	

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

Table 111 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR (cont)

UNIT	NO M. V.–Ph–HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH102	208/230–3–60	STD	NONE	–	–	39	50	41	191	43	50	45	195
			117A	7.8/10.4	21.7/25.0	39/39	50/50	41/41	191/191	43/43	50/50	45/45	195/195
			110A	12.0/16.0	33.4/38.5	49/55	50/60	44/50	191/191	53/60	60/60	49/55	195/195
			111A	18.6/24.8	51.7/59.7	72/82	80/90	65/75	191/191	76/86	80/90	70/79	195/195
			112A	24.0/32.0	66.7/77.0	90/103	90/110	83/95	191/191	95/108	100/110	87/99	195/195
			112A+117A	31.8/42.4	88.4/102.0	117/134	125/150	108/123	191/191	122/139	125/150	112/128	195/195
		MED	NONE	–	–	39	50	41	202	43	50	45	206
			117A	7.8/10.4	21.7/25.0	39/39	50/50	41/41	202/202	43/43	50/50	45/45	206/206
			110A	12.0/16.0	33.4/38.5	49/55	50/60	44/50	202/202	53/60	60/60	49/55	206/206
			111A	18.6/24.8	51.7/59.7	72/82	80/90	65/75	202/202	76/86	80/90	70/79	206/206
			112A	24.0/32.0	66.7/77.0	90/103	90/110	83/95	202/202	95/108	100/110	87/99	206/206
			112A+117A	31.8/42.4	88.4/102.0	117/134	125/150	108/123	202/202	122/139	125/150	112/128	206/206
	HIGH	NONE	–	–	44	50	46	245	48	60	51	249	
		117A	7.8/10.4	21.7/25.0	44/44	50/50	46/46	245/245	48/49	60/60	51/51	249/249	
		110A	12.0/16.0	33.4/38.5	55/61	60/70	50/56	245/245	59/66	60/70	54/60	249/249	
		111A	18.6/24.8	51.7/59.7	78/88	80/90	71/80	245/245	82/92	90/100	75/85	249/249	
		112A	24.0/32.0	66.7/77.0	96/109	100/110	88/100	245/245	101/114	110/125	93/104	249/249	
		112A+117A	31.8/42.4	88.4/102.0	123/140	125/150	113/129	245/245	128/145	150/150	118/133	249/249	
	460–3–60	STD	NONE	–	–	19	20	19	95	20	25	21	97
			116A	13.9	16.7	25	25	22	95	27	30	24	97
			113A	16.5	19.8	28	30	26	95	31	35	28	97
			114A	27.8	33.4	45	50	41	95	48	50	43	97
			115A	33.0	39.7	53	60	49	95	56	60	51	97
			114A+116A	41.7	50.2	66	70	61	95	69	70	63	97
MED		NONE	–	–	19	20	19	101	20	25	21	103	
		116A	13.9	16.7	25	25	22	101	27	30	24	103	
		113A	16.5	19.8	28	30	26	101	31	35	28	103	
		114A	27.8	33.4	45	50	41	101	48	50	43	103	
		115A	33.0	39.7	53	60	49	101	56	60	51	103	
		114A+116A	41.7	50.2	66	70	61	101	69	70	63	103	
HIGH	NONE	–	–	20	25	21	123	22	25	23	125		
	116A	13.9	16.7	27	30	24	123	29	30	26	125		
	113A	16.5	19.8	31	35	28	123	33	35	30	125		
	114A	27.8	33.4	48	50	43	123	50	50	46	125		
	115A	33.0	39.7	56	60	51	123	58	60	53	125		
	114A+116A	41.7	50.2	69	70	63	123	71	80	65	125		
575–3–60	STD	NONE	–	–	14	15	14	77	17	20	18	81	
		118A	17.0	20.4	27	30	25	77	32	35	29	81	
		119A	34.0	40.9	53	60	48	77	58	60	53	81	
	MED	NONE	–	–	14	20	15	81	18	20	19	85	
		118A	17.0	20.4	28	30	26	81	33	35	30	85	
		119A	34.0	40.9	54	60	49	81	59	60	54	85	
	HIGH	NONE	–	–	15	20	16	92	19	20	20	96	
		118A	17.0	20.4	29	30	27	92	34	35	31	96	
		119A	34.0	40.9	55	60	50	92	60	60	55	96	

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

Table 111 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR (cont)

UNIT	NO M. V. PH-HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrdr fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH110	208/230-3-60	STD	NONE	—	—	49	60	51	257	53	60	55	261
			117A	7.8/10.4	21.7/25.0	49/49	60/60	51/51	257/257	53/53	60/60	55/55	261/261
			110A	12.0/16.0	33.4/38.5	49/55	60/60	51/51	257/257	53/60	60/60	55/55	261/261
			112A	24.0/32.0	66.7/77.0	90/103	90/110	83/95	257/257	95/108	100/110	87/99	261/261
			112A+117A	31.8/42.4	88.4/102.0	117/134	125/150	108/123	257/257	122/139	125/150	112/128	261/261
		112A+110A	37.6/50.0	104.2/120.3	137/127	150/150	126/144	257/257	142/132	150/150	130/149	261/261	
		MED	NONE	—	—	54	60	57	300	57	70	61	304
			117A	7.8/10.4	21.7/25.0	54/54	60/60	57/57	300/300	57/57	70/70	61/61	304/304
			110A	12.0/16.0	33.4/38.5	55/61	60/70	57/57	300/300	59/66	70/70	61/61	304/304
			112A	24.0/32.0	66.7/77.0	96/109	100/110	88/100	300/300	101/114	110/125	93/104	304/304
			112A+117A	31.8/42.4	88.4/102.0	123/140	125/150	113/129	300/300	128/145	150/150	118/133	304/304
		112A+110A	37.6/50.0	104.2/120.3	143/133	150/150	131/150	300/300	148/138	150/150	136/154	304/304	
	HIGH	NONE	—	—	59	70	62	309	62	70	67	313	
		117A	7.8/10.4	21.7/25.0	59/59	70/70	62/62	309/309	62/62	70/70	67/67	313/313	
		110A	12.0/16.0	33.4/38.5	61/67	70/70	62/62	309/309	66/72	70/80	67/67	313/313	
		112A	24.0/32.0	66.7/77.0	103/115	110/125	94/106	309/309	107/120	110/125	98/110	313/313	
		112A+117A	31.8/42.4	88.4/102.0	130/147	150/150	119/135	309/309	134/151	150/175	123/139	313/313	
		112A+110A	37.6/50.0	104.2/120.3	149/140	150/175	137/156	309/309	154/144	175/175	141/160	313/313	
	460-3-60	STD	NONE	—	—	22	25	23	123	24	30	25	125
			116A	13.9	16.7	25	25	23	123	27	30	25	125
			113A	16.5	19.8	28	30	26	123	31	35	28	125
			115A	33.0	39.7	53	60	49	123	56	60	51	125
			114A+116A	41.7	50.2	66	70	61	123	69	70	63	125
			115A+113A	50.0	60.1	64	70	72	123	66	70	74	125
		MED	NONE	—	—	24	30	25	145	26	30	27	147
			116A	13.9	16.7	27	30	25	145	29	30	27	147
			113A	16.5	19.8	31	35	28	145	33	35	30	147
			115A	33.0	39.7	56	60	51	145	58	60	53	147
			114A+116A	41.7	50.2	69	70	63	145	71	80	65	147
			115A+113A	50.0	60.1	66	80	74	145	68	80	76	147
		HIGH	NONE	—	—	27	30	29	149	29	35	31	151
			116A	13.9	16.7	31	35	29	149	33	35	31	151
			113A	16.5	19.8	34	35	31	149	37	40	33	151
			115A	33.0	39.7	59	60	54	149	62	70	56	151
			114A+116A	41.7	50.2	72	80	66	149	75	80	68	151
			115A+113A	50.0	60.1	70	80	78	149	72	80	80	151
575-3-60	STD	NONE	—	—	18	20	18	95	21	25	23	99	
		118A	17.0	20.4	28	30	26	95	33	35	30	99	
		119A	34.0	40.9	54	60	49	95	59	60	54	99	
		118A+119A	51.0	61.3	64	70	73	95	69	80	77	99	
	MED	NONE	—	—	18	20	19	106	22	25	23	110	
		118A	17.0	20.4	29	30	27	106	34	35	31	110	
		119A	34.0	40.9	55	60	50	106	60	60	55	110	
		118A+119A	51.0	61.3	65	70	74	106	70	80	78	110	
	HIGH	NONE	—	—	21	25	22	120	25	30	27	124	
		118A	17.0	20.4	33	35	30	120	38	40	34	124	
		119A	34.0	40.9	59	60	53	120	63	70	58	124	
		118A+119A	51.0	61.3	69	80	77	120	74	80	81	124	

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

Table 111 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR (cont)

UNIT	NO M. V.—PH.—HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER*** A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH120	208/230—3—60	STD	NONE	—	—	48	60	50	282	51	60	54	286
			117A	7.8/10.4	21.7/25.0	48/48	60/60	50/50	282/282	51/51	60/60	54/54	286/286
			110A	12.0/16.0	33.4/38.5	49/55	60/60	50/50	282/282	53/60	60/60	54/55	286/286
			112A	24.0/32.0	66.7/77.0	90/103	90/110	83/95	282/282	95/108	100/110	87/99	286/286
			112A+117A	31.8/42.4	88.4/102.0	117/134	125/150	108/123	282/282	122/139	125/150	112/128	286/286
		112A+110A	37.6/50.0	104.2/120.3	137/127	150/150	126/144	282/282	142/132	150/150	130/149	286/286	
		MED	NONE	—	—	52	60	55	325	56	60	60	329
			117A	7.8/10.4	21.7/25.0	52/52	60/60	55/55	325/325	56/56	60/60	60/60	329/329
			110A	12.0/16.0	33.4/38.5	55/61	60/70	55/56	325/325	59/66	60/70	60/60	329/329
			112A	24.0/32.0	66.7/77.0	96/109	100/110	88/100	325/325	101/114	110/125	93/104	329/329
			112A+117A	31.8/42.4	88.4/102.0	123/140	125/150	113/129	325/325	128/145	150/150	118/133	329/329
		112A+110A	37.6/50.0	104.2/120.3	143/133	150/150	131/150	325/325	148/138	150/150	136/154	329/329	
		HIGH	NONE	—	—	57	70	61	334	61	70	65	338
			117A	7.8/10.4	21.7/25.0	57/57	70/70	61/61	334/334	61/61	70/70	65/65	338/338
			110A	12.0/16.0	33.4/38.5	61/67	70/70	61/62	334/334	66/72	70/80	65/66	338/338
	112A		24.0/32.0	66.7/77.0	103/115	110/125	94/106	334/334	107/120	110/125	98/110	338/338	
	112A+117A		31.8/42.4	88.4/102.0	130/147	150/150	119/135	334/334	134/151	150/175	123/139	338/338	
	112A+110A	37.6/50.0	104.2/120.3	149/140	150/175	137/156	334/334	154/144	175/175	141/160	338/338		
	460—3—60	STD	NONE	—	—	23	30	24	135	25	30	26	137
			116A	13.9	16.7	25	30	24	135	27	30	26	137
			113A	16.5	19.8	28	30	26	135	31	35	28	137
			115A	33.0	39.7	53	60	49	135	56	60	51	137
			114A+116A	41.7	50.2	66	70	61	135	69	70	63	137
		115A+113A	50.0	60.1	64	70	72	135	66	70	74	137	
		MED	NONE	—	—	25	30	26	157	27	30	28	159
			116A	13.9	16.7	27	30	26	157	29	30	28	159
			113A	16.5	19.8	31	35	28	157	33	35	30	159
			115A	33.0	39.7	56	60	51	157	58	60	53	159
			114A+116A	41.7	50.2	69	70	63	157	71	80	65	159
		115A+113A	50.0	60.1	66	80	74	157	68	80	76	159	
		HIGH	NONE	—	—	28	30	30	161	30	35	32	163
			116A	13.9	16.7	31	35	30	161	33	35	32	163
			113A	16.5	19.8	34	35	31	161	37	40	33	163
	115A		33.0	39.7	59	60	54	161	62	70	56	163	
	114A+116A		41.7	50.2	72	80	66	161	75	80	68	163	
	115A+113A	50.0	60.1	70	80	78	161	72	80	80	163		
575—3—60	STD	NONE	—	—	18	20	18	105	22	25	23	109	
		118A	17.0	20.4	28	30	26	105	33	35	30	109	
		119A	34.0	40.9	54	60	49	105	59	60	54	109	
		118A+119A	51.0	61.3	64	70	73	105	69	80	77	109	
	MED	NONE	—	—	19	20	19	116	22	25	24	120	
		118A	17.0	20.4	29	30	27	116	34	35	31	120	
		119A	34.0	40.9	55	60	50	116	60	60	55	120	
	118A+119A	51.0	61.3	65	70	74	116	70	80	78	120		
	HIGH	NONE	—	—	21	25	22	130	25	30	27	134	
118A		17.0	20.4	33	35	30	130	38	40	34	134		
119A	34.0	40.9	59	60	53	130	63	70	58	134			
118A+119A	51.0	61.3	69	80	77	130	74	80	81	134			

ELECTRICAL INFORMATION

(UNITS PRODUCED PRIOR TO JULY 30, 2012) cont.

Table 111 – UNIT WIRE/FUSE OR HACR BREAKER SIZING DATA WITH SINGLE SPEED INDOOR FAN MOTOR (cont)

UNIT	NO M. V-Ph-HZ	IFM TYPE	ELEC. HTR			NO C.O. or UNPWR C.O.							
			CRHEATER***A00	Nom (kW)	FLA	NO P.E.				w/ P.E. (pwrd fr/unit)			
						MCA	MAX FUSE or HACR BRKR	DISC. SIZE		MCA	MAX FUSE or HACR BRKR	DISC. SIZE	
								FLA	LRA			FLA	LRA
RAH150	208/230-3-60	STD	NONE	—	—	55	60	58	314	59	70	62	318
			291A	12.4/16.5	34.4/39.7	55/59	60/60	58/58	314/314	59/64	70/70	62/62	318/318
			288A+291A	19.9/26.5	55.3/63.8	79/90	80/90	72/82	314/314	84/94	90/100	77/86	318/318
			294A	25.2/33.5	69.9/80.6	97/111	100/125	89/101	314/314	102/115	110/125	93/106	318/318
			288A+294A	32.7/43.5	90.7/104.7	123/141	125/150	113/129	314/314	128/145	150/150	117/133	318/318
		291A+294A	37.6/50.0	104.3/120.3	140/130	150/150	129/147	314/314	145/135	150/150	133/151	318/318	
		MED	NONE	—	—	58	70	60	331	62	80	65	335
			291A	12.4/16.5	34.4/39.7	58/63	70/70	60/60	331/331	62/67	80/80	65/65	335/335
			288A+291A	19.9/26.5	55.3/63.8	82/93	90/100	75/85	331/331	87/97	90/100	79/89	335/335
			294A	25.2/33.5	69.9/80.6	100/114	100/125	92/104	331/331	105/118	110/125	96/109	335/335
			288A+294A	32.7/43.5	90.7/104.7	126/144	150/150	116/132	331/331	131/149	150/150	120/136	335/335
		291A+294A	37.6/50.0	104.3/120.3	143/133	150/150	131/150	331/331	148/138	150/150	136/154	335/335	
	HIGH	NONE	—	—	68	80	72	350	72	80	77	354	
		291A	12.4/16.5	34.4/39.7	69/76	80/80	72/72	350/350	74/80	80/80	77/77	354/354	
		288A+291A	19.9/26.5	55.3/63.8	95/106	100/110	87/97	350/350	100/110	100/125	91/101	354/354	
		294A	25.2/33.5	69.9/80.6	113/127	125/150	104/116	350/350	118/131	125/150	108/121	354/354	
		288A+294A	32.7/43.5	90.7/104.7	139/157	150/175	128/144	350/350	144/162	150/175	132/148	354/354	
	291A+294A	37.6/50.0	104.3/120.3	156/146	175/175	143/162	350/350	161/151	175/175	148/166	354/354		
	460-3-60	STD	NONE	—	—	28	35	29	158	30	35	31	160
			292A	16.5	19.9	30	35	29	158	32	35	31	160
			289A+292A	26.5	31.9	45	45	41	158	47	50	43	160
			295A	33.5	40.3	55	60	50	158	57	60	52	160
			289A+295A	43.5	52.3	70	70	64	158	72	80	66	160
		292A+295A	50.0	60.2	65	70	73	158	67	70	75	160	
MED		NONE	—	—	29	35	30	167	31	40	32	169	
		292A	16.5	19.9	31	35	30	167	33	40	32	169	
		289A+292A	26.5	31.9	46	50	42	167	48	50	44	169	
		295A	33.5	40.3	56	60	51	167	59	60	53	169	
		289A+295A	43.5	52.3	71	80	65	167	74	80	67	169	
292A+295A		50.0	60.2	66	80	74	167	68	80	76	169		
HIGH	NONE	—	—	35	40	37	176	37	45	39	178		
	292A	16.5	19.9	38	40	37	176	40	45	39	178		
	289A+292A	26.5	31.9	53	60	48	176	55	60	50	178		
	295A	33.5	40.3	64	70	58	176	66	70	60	178		
	289A+295A	43.5	52.3	79	80	72	176	81	90	74	178		
292A+295A	50.0	60.2	73	80	81	176	76	80	83	178			
575-3-60	STD	NONE	—	—	22	25	23	128	26	30	27	132	
		293A	16.5	15.9	24	25	23	128	29	30	27	132	
		290A+293A	26.5	25.5	36	40	33	128	41	45	37	132	
		296A	33.5	32.2	44	45	40	128	49	50	45	132	
		290A+296A	43.5	41.8	56	60	51	128	61	70	56	132	
	293A+296A	50.0	48.1	52	60	59	128	57	60	63	132		
	MED	NONE	—	—	22	25	23	128	26	30	27	132	
		293A	16.5	15.9	24	25	23	128	29	30	27	132	
		290A+293A	26.5	25.5	36	40	33	128	41	45	37	132	
		296A	33.5	32.2	44	45	40	128	49	50	45	132	
		290A+296A	43.5	41.8	56	60	51	128	61	70	56	132	
	293A+296A	50.0	48.1	52	60	59	128	57	60	63	132		
HIGH	NONE	—	—	29	35	30	140	32	40	34	144		
	293A	16.5	15.9	32	35	30	140	36	40	34	144		
	290A+293A	26.5	25.5	44	45	40	140	48	50	44	144		
	296A	33.5	32.2	52	60	47	140	57	60	52	144		
	290A+296A	43.5	41.8	64	70	58	140	69	70	63	144		
293A+296A	50.0	48.1	60	70	66	140	65	70	70	144			

LEGEND:

- BRKR – Circuit breaker
- CO – Convenience outlet
- DISC – Disconnect
- FLA – Full load amps
- IFM – Indoor fan motor
- LRA – Locked rotor amps
- MCA – Minimum circuit amps
- MOCP – MAX FUSE or HACR Breaker
- PE – Power exhaust
- UNPWR CO – Unpowered convenient outlet



NOTES:

1. In compliance with NEC requirements for multimotor and combinat (refer to NEC Articles 430 and 440), the overcurrent protective shall be fuse or HACR breaker. Canadian units may be fuse or c

1. Unbalanced 3-Phase Supply Voltage

Never operate a motor where a phase imbalance in supply vol
2%. Use the following formula to determine the percentage of vc

$$\% \text{ Voltage Imbalance} = 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

Example: Supply voltage is 230-3-60



AB = 224 v

BC = 231 v

AC = 226 v

$$\text{Average Voltage} = \frac{(224 + 231 + 226)}{3} = \frac{681}{3}$$

$$= 227$$

Determine maximum deviation from average voltage.

(AB) 227 – 224 = 3 v

(BC) 231 – 227 = 4 v

(AC) 227 – 226 = 1 v

Maximum deviation is 4 v.

Determine percent of voltage imbalance.

$$\% \text{ Voltage Imbalance} = 100 \times \frac{4}{227}$$

$$= 1.76\%$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

SEQUENCE OF OPERATION

General

The sequence below describes the sequence of operation for an electro-mechanical unit with and without a factory installed Economizer™ IV and X (called “economizer” in this sequence). For information regarding a direct digital controller, see the start-up, operations, and troubleshooting manual for the applicable controller.

Electro-mechanical units with no economizer

Cooling (Single speed indoor fan motor) —

When the thermostat calls for cooling, terminals G and Y1 are energized. As a result, the indoor-fan contactor (IFC) and the compressor contactor (C1) are energized, causing the indoor-fan motor (IFM), compressor #1, and outdoor fan to start. If the unit has 2 stages of cooling, the thermostat will additionally energize Y2. The Y2 signal will energize compressor contactor #2 (C2), causing compressor #2 to start. Regardless of the number of stages, the outdoor-fan motor runs continuously while unit is cooling.

Cooling (2-speed indoor fan motor) —

Per ASHRAE 90.1 2010 standard section 6.4.3.10.b, during the first stage of cooling operation the VFD will adjust the fan motor to provide 2/3rd of the total cfm established for the unit. When a call for the second stage of cooling is required, the VFD will allow the total cfm for the unit established (100%).

Heating

NOTE: The RAH is sold as cooling only. If electric heaters are required, use only factory-approved electric heaters. They will operate as described below.

Units have either 1 or 2 stages of electric heat. When the thermostat calls for heating, power is applied to the W1 terminal at the unit. The unit control will energize the indoor fan contactor and the first stage of electric heat. On units with two-stage heating, when additional heating is required, the second stage of electric heat (if equipped) will be energized when power is applied at the W2 terminal on the unit.

Electro-mechanical units with an economizer

Cooling —

When free cooling is not available, the compressors will be controlled by the zone thermostat. When free cooling is available, the outdoor-air damper is modulated by the Economizer IV and X control to provide a 50°F (10°C) to 55°F (13°C) mixed-air temperature into the zone. As the mixed air temperature fluctuates above 55°F (13°C) or below 50°F (10°C) dampers will be modulated (open or close) to bring the mixed-air temperature back within control. If mechanical cooling is utilized with free cooling, the outdoor-air damper will maintain its current position at the time the compressor is started. If the increase in cooling capacity causes the mixed-air temperature to drop below 45°F (9°C), then the outdoor-air damper position will be decreased to the minimum position. If the mixed-air temperature continues to fall, the outdoor-air damper will close. Control returns to normal once the mixed-air temperature rises above 48°F (9°C). The power exhaust fans will be energized and de-energized, if installed, as the outdoor-air damper opens and closes.

If field-installed accessory CO₂ sensors are connected to the Economizer IV and X control, a demand controlled ventilation strategy will begin to operate. As the CO₂ level in the zone increases above the CO₂ setpoint, the minimum position of the damper will be increased proportionally. As the CO₂ level decreases because of the increase in fresh air, the outdoor-air damper will be proportionally closed. For Economizer IV and X operation, there must be a thermostat call for the fan (G). If the

unit is occupied and the fan is on, the damper will operate at minimum position. Otherwise, the damper will be closed.

When the Economizer IV and X control is in the occupied mode and a call for cooling exists (Y1 on the thermostat), the control will first check for indoor fan operation. If the fan is not on, then cooling will not be activated. If the fan is on, then the control will open the Economizer IV and X damper to the minimum position.

On the initial power to the Economizer IV and X control, it will take the damper up to 2 1/2 minutes before it begins to position itself. After the initial power-up, further changes in damper position can take up to 30 seconds to initiate. Damper movement from full closed to full open (or vice versa) will take between 1 1/2 and 2 1/2 minutes. If free cooling can be used as determined from the appropriate changeover command (switch, dry bulb, enthalpy curve, differential dry bulb, or differential enthalpy), then the control will modulate the dampers open to maintain the mixed-air temperature setpoint at 50°F (10°C) to 55°F (13°C). If there is a further demand for cooling (cooling second stage – Y2 is energized), then the control will bring on compressor stage 1 to maintain the mixed-air temperature setpoint. The Economizer IV and X damper will be open at maximum position. Economizer IV and X operation is limited to a single compressor.

2-Speed Note: When operating in ventilation mode only, the indoor fan motor will automatically adjust to 2/3rd of the total cfm established.

Heating

The sequence of operation for the heating is the same as an electromechanical unit with no economizer. The only difference is how the economizer acts. The economizer will stay at the Economizer Minimum Position while the evaporator fan is operating. The outdoor-air damper is closed when the indoor fan is not operating.

Optional Hot Gas Reheat System

Units with the factory equipped Perfect Humidity option are capable of providing multiple modes of improved dehumidification as a variation of the normal cooling cycle. The Perfect Humidity option includes additional valves in the liquid line and discharge line of each refrigerant circuit, a small reheat condenser coil downstream of the evaporator, and Motormaster variable-speed control of some or all outdoor fans. Operation of the revised refrigerant circuit for each mode is described below.

The Perfect Humidity system provides three sub-modes of operation: Cool, Reheat1, and Reheat2.


Cool mode – provides a normal ratio of Sensible and Latent Cooling effect from the evaporator coil.

Reheat1 – provides increased Latent Cooling while slightly reducing the Sensible Cooling effect.


Reheat2 – provides normal Latent Cooling but with null or minimum Sensible Cooling effect delivered to the space.

The Reheat1 and Reheat2 modes are available when the unit is not in a Heating mode and when the Low Ambient Lockout switch is closed.


The following diagrams depict piping for Single Stage cooling units.

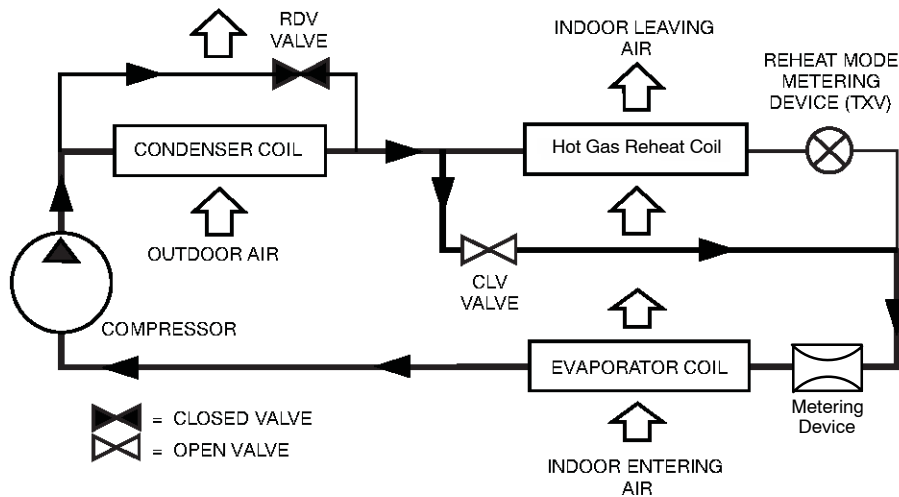

C12702

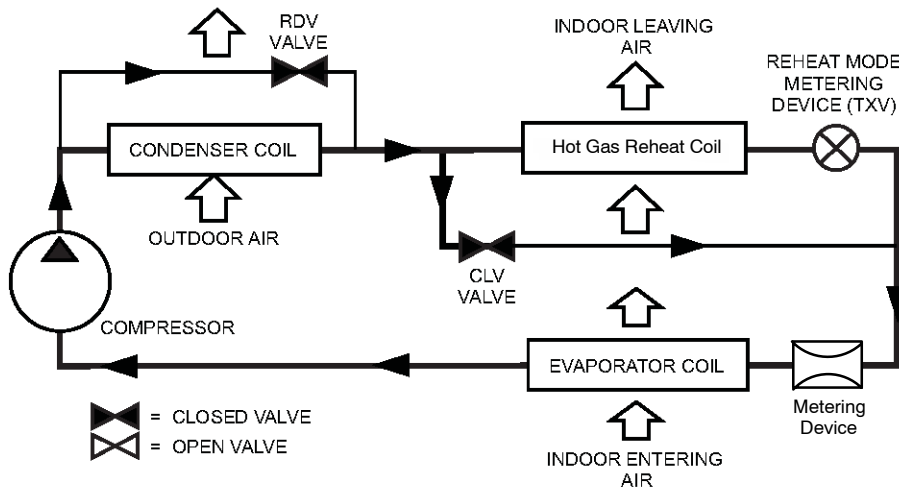

C12703

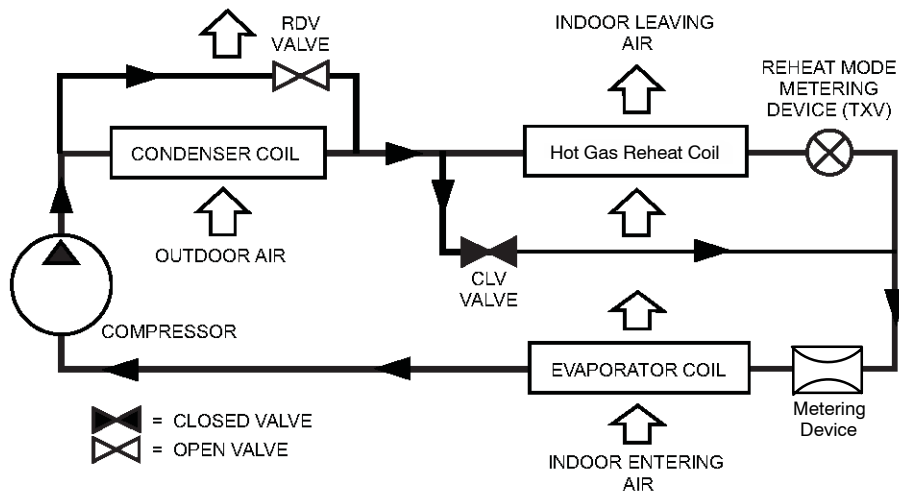

C12704

Electric Cooling Packaged Rooftop

HVAC Guide Specifications

Size Range: 3 to 12.5 Nominal Tons



As an Energy Star® Partner, International Comfort Products has determined that this product meets the ENERGY STAR® guidelines for energy efficiency.

<u>Section</u>	<u>Description</u>
----------------	--------------------

23 06 80	Schedules for Decentralized HVAC Equipment
-----------------	---

- | | |
|----------------|---|
| 23 06 80.13 | Decentralized Unitary HVAC Equipment Schedule |
| 23 06 80.13.A. | Rooftop unit schedule |
| 1. | Schedule is per the project specification requirements. |

23 07 16	HVAC Equipment Insulation
-----------------	----------------------------------

- | | |
|----------------|---|
| 23 07 16.13 | Decentralized, Rooftop Units: |
| 23 07 16.13.A. | Evaporator fan compartment: |
| 1. | Interior cabinet surfaces shall be insulated with a minimum 1/2-in. thick, minimum 1 1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, neoprene coated on the air side. |
| 2. | Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation. |
| 23 07 16.13.B. | Electric heat compartment: |
| 1. | Aluminum foil-faced fiberglass insulation shall be used. |
| 2. | Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation. |

23 09 13	Instrumentation and Control Devices for HVAC
-----------------	---

- | | |
|----------------|---|
| 23 09 13.23 | Sensors and Transmitters |
| 23 09 13.23.A. | Thermostats |
| 1. | Thermostat must |
| a. | energize both "W" and "G" when calling for heat. |
| b. | have capability to energize 2 different stages of cooling, and 2 different stages of heating. |
| c. | include capability for occupancy scheduling. |

23 09 23	Direct-digital Control system for HVAC
-----------------	---

- | | |
|----------------|---|
| 23 09 23.13 | Decentralized, Rooftop Units: |
| 23 09 23.13.A. | N/A |
| 23 09 23.13.B. | N/A |
| 23 09 23.13.C. | RTU Open multi-protocol, direct digital controller: |
| 1. | Shall be ASHRAE 62–2001 compliant. |
| 2. | Shall accept 18–30VAC, 50–60Hz, and consumer 15VA or less power. |
| 3. | Shall have an operating temperature range from –40°F (–40°C) to 130°F (54°C), 10% – 90% RH (non-condensing). |
| 4. | Shall include built-in protocol for BACNET (MS/TP and PTP modes), Modbus (RTU and ASCII), Johnson N2 and LonWorks. LonWorks Echelon processor required for all Lon applications shall be contained in separate communication board. |
| 5. | Shall allow access of up to 62 network variables (SNVT). Shall be compatible with all open controllers. |
| 6. | Baud rate Controller shall be selectable using a dipswitch. |
| 7. | Shall have an LED display independently showing the status of serial communication, running, errors, power, all digital outputs, and all analog inputs. |
| 8. | Shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air quality, compressor lock-out, fire shutdown, enthalpy switch, and fan status/filter status/ humidity/ remote occupancy. |
| 9. | Shall provide the following outputs: economizer, fan, cooling stage 1, cooling stage 2, heat stage 1, heat stage 2, heat stage 3/ exhaust/ reversing valve. |
| 10. | Shall have built-in surge protection circuitry through solid state polyswitches. Polyswitches shall be used on incoming power and network connections. Polyswitches will return to normal when the "trip" condition clears. |

11. Shall have a battery back-up capable of a minimum of 10,000 hours of data and time clock retention during power outages.
12. Shall have built-in support for Bryant technician tool.
13. Shall include an EIA-485 protocol communication port, an access port for connection of either a computer or a Bryant technician tool, an EIA-485 port for network communication to intelligent space sensors and displays, and a port to connect an optional LonWorks communications card.
14. Software upgrades will be accomplished by either local or remote download. No software upgrades through chip replacements are allowed.

23 09 33 Electric and Electronic Control System for HVAC

23 09 33.13 Decentralized, Rooftop Units:

23 09 33.13.A. General:

1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side. Transformer shall have 75VA capability.
2. Shall utilize color-coded wiring.
3. Shall include a central control terminal board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, DDC control options, and low and high pressure switches.
4. Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.

23 09 33.23.B. Safeties:

1. Compressor over-temperature, over current.
2. Low-pressure switch.
 - a. Units with 2 compressors shall have different sized connectors for the circuit 1 and circuit 2 low and high pressure switches. They shall physically prevent the cross-wiring of the safety switches between circuits 1 and 2.
 - b. Low pressure switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
3. High-pressure switch.
 - a. Units with 2 compressors shall have different sized connectors for the circuit 1 and circuit 2 low and high pressure switches. They shall physically prevent the cross-wiring of the safety switches between circuits 1 and 2.
 - b. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
4. Automatic reset, motor thermal overload protector.

23 09 93 Sequence of Operations for HVAC Controls

23 09 93.13 Decentralized, Rooftop Units:

23 09 93.13 INSERT SEQUENCE OF OPERATION

23 40 13 Panel Air Filters

23 40 13.13 Decentralized, Rooftop Units:

23 40 13.13.A. Standard filter section

1. Shall consist of factory-installed, low velocity, throwaway 2-in. thick fiberglass filters of commercially available sizes.
2. Unit shall use only one filter size. Multiple sizes are not acceptable.
3. Filters shall be accessible through an access panel with "no-tool" removal as described in the unit cabinet section of this specification (23 81 19.13.H).

23 81 19 Self-Contained Air Conditioners

23 81 19.13 Small-Capacity Self-Contained Air Conditioners (RAH*04-14)

23 81 19.13.A. General

1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a(n) hermetic scroll compressor(s) for cooling duty and gas combustion for heating duty.
2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
3. Unit shall use environmentally safe, R-410A refrigerant.
4. Unit shall be installed in accordance with the manufacturer's instructions.
5. Unit must be selected and installed in compliance with local, state, and federal codes.

23 81 19.13.B. Quality Assurance

1. Unit meets ASHRAE 90.1 minimum efficiency requirements.
2. 3 phase units are Energy Star qualified.
3. Unit shall be rated in accordance with AHRI Standards 210/240 and 340/360.
4. Unit shall be designed to conform to ASHRAE 15, 2001.
5. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
6. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
7. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM B117 (scribed specimen).

8. Unit casing shall be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 5000-hour salt spray.
 9. Unit shall be designed in accordance with ISO 9001, and shall be manufactured in a facility registered by ISO 9001.
 10. Roof curb shall be designed to conform to NRCA Standards.
 11. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
 12. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
 13. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.
 14. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.
 15. High Efficient Motors listed shall meet section 313 of the Energy Independence and Security Act of 2007 (EISA 2007).
- 23 81 19.13.C. Delivery, Storage, and Handling
1. Unit shall be stored and handled per manufacturer's recommendations.
 2. Lifted by crane requires either shipping top panel or spreader bars.
 3. Unit shall only be stored or positioned in the upright position.
- 23 81 19.13.D. Project Conditions
1. As specified in the contract.
- 23 81 19.13.E. Project Conditions
1. As specified in the contract.
- 23 81 19.13.F. Operating Characteristics
1. Unit shall be capable of starting and running at 125°F (52°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 210/240 or 340/360 at ± 10% voltage.
 2. Compressor with standard controls shall be capable of operation down to 35°F (2°C), ambient outdoor temperatures. Accessory low ambient kits shall be available if operation below 35°F (2°C), is required. See below for head pressure control package or winter start kit.
 3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
 4. Unit shall be factory configured for vertical supply & return configurations.
 5. Unit shall be field convertible from vertical to horizontal airflow on all models. No special kit required on 04–12 models. Supply duct kit required for 14 size model only.
 6. Unit shall be capable of mixed operation: vertical supply with horizontal return or horizontal supply with vertical return.
- 23 81 19.13.G. Electrical Requirements
1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.
- 23 81 19.13.H. Unit Cabinet
1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a pre-painted baked enamel finish on all externally exposed surfaces.
 2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 inches minimum, gloss (per ASTM D523, 60°F): 60, Hardness: H-2H Pencil hardness.
 3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 210/240 or 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2-in. thick, 1 lb density, flexible fiberglass insulation, neoprene coated on the air side. Aluminum foil-faced fiberglass insulation shall be used in the heat compartment.
 4. Base of unit shall have a minimum of four locations for thru-the-base gas and electrical connections (factory installed or field installed), standard.
 5. Base Rail
 - a. Unit shall have base rails on a minimum of 2 sides.
 - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
 - c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
 - d. Base rail shall be a minimum of 16 gauge thickness.
 6. Condensate pan and connections:
 - a. Shall be an internally sloped condensate drain pan made of a non-corrosive material.
 - b. Shall comply with ASHRAE Standard 62.
 - c. Shall use a 3/4" –14 NPT drain connection, possible either through the bottom or end of the drain pan. Connection shall be made per manufacturer's recommendations.
 7. Top panel:
 - a. Shall be a single piece top panel on 04 thru 12 sizes, two piece on 14 size.
 8. Electrical Connections
 - a. All unit power wiring shall enter unit cabinet at a single, factory-prepared, knockout location.
 - b. Thru-the-base capability
 - (1.) Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
 - (2.) Optional, factory-approved, water-tight connection method must be used for thru-the-base electrical connections.
 - (3.) No basepan penetration, other than those authorized by the manufacturer, is permitted.

9. Component access panels (standard)
 - a. Cabinet panels shall be easily removable for servicing.
 - b. Unit shall have one factory installed, tool-less, removable, filter access panel.
 - c. Panels covering control box, indoor fan, indoor fan motor, gas components (where applicable), and compressors shall have molded composite handles.
 - d. Handles shall be UV modified, composite, permanently attached, and recessed into the panel.
 - e. Screws on the vertical portion of all removable access panel shall engage into heat resistant, molded composite collars.
 - f. Collars shall be removable and easily replaceable using manufacturer recommended parts.

23 81 19.13.I. N/A

23 81 19.13.J. Coils

1. Standard Aluminum Fin/Copper Tube Coils:
 - a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
 - b. Evaporator coils shall be leak tested to 150 psig, pressure tested to 450 psig, and qualified to UL 1995 burst test at 1775 psig.
 - c. Condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to UL 1995 burst test at 1980 psig.
2. Optional Pre-coated aluminum-fin condenser coils (3 phase models only):
 - a. Shall have a durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments.
 - b. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.
 - c. Epoxy-phenolic barrier shall minimize galvanic action between dissimilar metals.
3. Optional Copper-fin evaporator and condenser coils (3 phase models only):
 - a. Shall be constructed of copper fins mechanically bonded to copper tubes and copper tube sheets.
 - b. Galvanized steel tube sheets shall not be acceptable.
 - c. A polymer strip shall prevent coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan.
4. Optional E-coated aluminum-fin evaporator and condenser coils (3 phase models only):
 - a. Shall have a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins.
 - b. Coating process shall ensure complete coil encapsulation of tubes, fins and headers.
 - c. Color shall be high gloss black with gloss per ASTM D523-89.
 - d. Uniform dry film thickness from 0.8 to 1.2 mil on all surface areas including fin edges.
 - e. Superior hardness characteristics of 2H per ASTM D3363-92A and cross-hatch adhesion of 4B-5B per ASTM D3359-93.
 - f. Impact resistance shall be up to 160 in.-lb (ASTM D2794-93).
 - g. Humidity and water immersion resistance shall be up to minimum 1000 and 250 hours respectively (ASTM D2247-92 and ASTM D870-92).
 - h. Corrosion durability shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117-90.
5. Optional E-coated aluminum-fin, aluminum tube condenser coils:
 - a. Shall have a flexible epoxy polymer coating uniformly applied to all coil external surface areas without material bridging between fins or louvers.
 - b. Coating process shall ensure complete coil encapsulation, including all exposed fin edges.
 - c. E-coat thickness of 0.8 to 1.2 mil with top coat having a uniform dry film thickness from 1.0 to 2.0 mil on all external coil surface areas, including fin edges, shall be provided.
 - d. Shall have superior hardness characteristics of 2H per ASTM D3363-00 and cross-hatch adhesion of 4B-5B per ASTM D3359-02.
 - e. Shall have superior impact resistance with no cracking, chipping or peeling per NSF/ANSI 51-2002 Method 10.2.

23 81 19.13.K. Refrigerant Components

1. Refrigerant circuit shall include the following control, safety, and maintenance features:
 - a. Thermostatic Expansion Valve (TXV) shall help provide optimum performance across the entire operating range. Shall contain removable power element to allow change out of power element and bulb without removing the valve body.
 - b. Refrigerant filter drier.
 - c. Service gauge connections on suction and discharge lines.
 - d. Pressure gauge access through a specially designed access port in the top panel of the unit.
2. There shall be gauge line access port in the skin of the rooftop, covered by a black, removable plug.
 - a. The plug shall be easy to remove and replace.
 - b. When the plug is removed, the gauge access port shall enable maintenance personnel to route their pressure gauge lines.

- c. This gauge access port shall facilitate correct and accurate condenser pressure readings by enabling the reading with the compressor access panel on.
 - d. The plug shall be made of a leak proof, UV-resistant, composite material.
3. Compressors
- a. Unit shall use one fully hermetic, scroll compressor for each independent refrigeration circuit.
 - b. Models shall be available with single compressor/single stage cooling designs on 036–072 sizes and 2 compressor/2–stage cooling models on 090–150 sizes.
 - c. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
 - d. Compressors shall be internally protected from high discharge temperature conditions.
 - e. Compressors shall be protected from an over-temperature and over-ampereage conditions by an internal, motor overload device.
 - f. Compressor shall be factory mounted on rubber grommets.
 - g. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
 - h. Crankcase heaters shall not be required for normal operating range, unless provided by the factory.

23 81 19.13.L. Filter Section

- 1. Filters access is specified in the unit cabinet section of this specification.
- 2. Filters shall be held in place by a pivoting filter tray, facilitating easy removal and installation.
- 3. Shall consist of factory-installed, low velocity, throw-away 2-in. thick fiberglass filters.
- 4. Filters shall be standard, commercially available sizes.
- 5. Only one size filter per unit is allowed.

23 81 19.13.M. Evaporator Fan and Motor

- 1. Evaporator fan motor:
 - a. Shall have permanently lubricated bearings.
 - b. Shall have inherent automatic-reset thermal overload protection or circuit breaker.
 - c. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.
- 2. Electric Drive (Direct Drive) ECM – 5 Speed/Torque Evaporator Fan:
 - a. Multi speed motor with easy quick adjustment settings.
 - b. Blower fan shall be double-inlet type with forward-curved blades.
 - c. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.
 - d. Standard on all 036–060 models with 208/230/1/60 operation without Perfect Humidity.
 - e. Standard on all 036–060 3-phase models without Perfect Humidity, with optional belt drive.
- 3. Belt-driven Evaporator Fan:
 - a. Belt drive shall include an adjustable-pitch motor pulley.
 - b. Shall use sealed, permanently lubricated ball-bearing type.
 - c. Blower fan shall be double-inlet type with forward-curved blades.
 - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.
 - e. Standard on all 036–072 size and 036–060 size models with Perfect Humidity. Optional on all 036–060 3-phase models.

23 81 19.13.N. Condenser Fans and Motors

- 1. Condenser fan motors:
 - a. Shall be a totally enclosed motor.
 - b. Shall use permanently lubricated bearings.
 - c. Shall have inherent thermal overload protection with an automatic reset feature.
 - d. Shall use a shaft-down design on 036 to 072 models.
- 2. Condenser Fans:
 - a. Shall be a direct-driven propeller type fan.
 - b. Shall have galvalum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.

23 81 19.13.O. Special Features, Options and Accessories

- 1. 2-speed indoor fan motor for 2-stage cooling models only:
 - a. Evaporator fan motor:
 - (1.) Shall have permanently lubricated bearings.
 - (2.) Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating.
 - (3.) Shall be Variable Frequency duty and 2-speed control.
 - (4.) Shall contain motor shaft grounding ring to prevent electrical bearing fluting damage by safely diverting harmful shaft voltages and bearing currents to ground.
- 2. Variable Frequency Drive (VFD). Only available on 2-speed indoor fan motor option:
 - a. Shall be installed inside the unit cabinet, mounted, wired and tested.
 - b. Shall contain Electromagnetic Interference (EMI) frequency protection.

- c. Insulated Gate Bi-Polar Transistors (IGBT) used to produce the output pulse width modulated (PWM) waveform, allowing for quiet motor operation.
 - d. Self diagnostics with fault and power code LED indicator. Field accessory Display Kit available for further diagnostics and special setup applications.
 - e. RS485 capability standard.
 - f. Electronic thermal overload protection.
 - g. 5% swinging chokes for harmonic reduction and improved power factor.
 - h. All printed circuit boards shall be conformal coated.
3. Standard Integrated Economizers (Factory installed on 3 Phase Models Only. Field installed on all 3 and 1 Phase Models):
- a. Integrated, gear-driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
 - b. Independent modules for vertical or horizontal return configurations shall be available. Vertical return modules shall be available as a factory installed option.
 - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
 - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
 - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
 - f. Standard models shall be equipped with low-leakage dampers, not to exceed 2% leakage at 1 in. wg pressure differential. Economizer controller on electromechanical units shall be Honeywell W7212 that provides:
 - (1.) Combined minimum and DCV maximum damper position potentiometers with compressor staging relay.
 - (2.) Functions with solid state analog enthalpy or dry bulb changeover control sensing.
 - (3.) Contain LED indicates for:
 - when free cooling is available
 - when module is in DCV mode
 - when exhaust fan contact is closed
 - g. Ultra low leak Economizer X system shall be available on models with 2-speed indoor fan motor 2-speed Variable Frequency Drive (VFD) systems. Only available on 2-Speed Indoor Fan Motor Systems with electromechanical controls.
 - (1.) Maximum damper leakage rate to be equal to or less than 4.0 cfm/sq. ft. at 1.0 in. w.g., meeting or exceeding ASHRAE 90.1 requirements. Economizer controller on electromechanical units shall be Honeywell W7220 that provides:
 - (2.) 2-line LCD interface screen for setup, configuration and troubleshooting
 - (3.) On-board fault detection and diagnostics
 - (4.) Sensor failure loss of communication identification
 - (5.) Automatic sensor detection
 - (6.) Capabilities for use with multiple-speed indoor fan systems
 - (7.) Utilize digital sensors: Dry bulb and Enthalpy
 - h. Shall be capable of introducing up to 100% outdoor air.
 - i. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air.
 - j. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
 - k. Dry bulb outdoor air temperature sensor shall be provided as standard. Outdoor air sensor setpoint shall be adjustable and shall range from 40 to 100°F / 4 to 38°C. Additional sensor options shall be available as accessories.
 - l. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
 - m. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy. A remote potentiometer may be used to override the damper setpoint.
 - n. Dampers shall be completely closed when the unit is in the unoccupied mode.
 - o. Economizer controller shall accept a 2-10 Vdc CO₂ sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
 - p. Compressor lockout sensor shall open at 35°F (2°C) and close closes at 50°F (10°C).
 - q. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
 - r. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
4. Two-Position Damper (Factory installed on 3 Phase Models Only. Field installed on all 3 and 1 Phase Models)
- a. Damper shall be a Two-Position Damper. Damper travel shall be from the full closed position to the field adjustable %-open setpoint.
 - b. Damper shall include adjustable damper travel from 25% to 100% (full open).
 - c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
 - d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.
 - e. Damper will admit up to 100% outdoor air for applicable rooftop units.

- f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
 - g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
 - h. Outside air hood shall include aluminum water entrainment filter
5. Manual damper
 - a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 50% outdoor air for year round ventilation.
 6. Hot Gas Reheat System (3 phase models only):
 - a. The Hot Gas Reheat System shall be factory-installed and shall provide greater dehumidification of the occupied space by two modes of dehumidification operations beside its normal design cooling mode:
 - (1.) Subcooling mode further subcools the hot liquid refrigerant leaving the condenser coil when both temperature and humidity in the space are not satisfied.
 - (2.) Hot gas reheat mode shall mix a portion of the hot gas from the discharge of the compressor with the hot liquid refrigerant leaving the condenser coil to create a two-phase heat transfer in the system, resulting in a neutral leaving-air temperature when only humidity in the space is not satisfied.
 - (3.) Includes Head Pressure Controller.
 7. Head Pressure Control Package (MotorMaster)
 - a. Controller shall control coil head pressure by condenser-fan speed modulation or condenser-fan cycling and wind baffles.
 - b. Shall consist of solid-state control and condenser-coil temperature sensor to maintain condensing temperature between 90°F (32°C) and 110°F (43°C) at outdoor ambient temperatures down to -20°F (-29°C).
 8. Condenser Coil Hail Guard Assembly (Factory installed option on 3 phase models. Field installed on all 3 and 1 phase models)
 - a. Shall protect against damage from hail.
 - b. Shall be louvered design.
 9. Unit-Mounted, Non-Fused Disconnect Switch:
 - a. Switch shall be factory-installed, internally mounted.
 - b. National Electric Code (NEC) and UL approved non-fused switch shall provide unit power shutoff.
 - c. Shall be accessible from outside the unit
 - d. Shall provide local shutdown and lockout capability.
 10. Convenience Outlet:
 - a. Non-Powered convenience outlet.
 - (1.) Outlet shall be powered from a separate 115/120v power source.
 - (2.) A transformer shall not be included.
 - (3.) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
 - (4.) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
 - (5.) Outlet shall be accessible from outside the unit.
 - (6.) Outlet shall include a field-installed "Wet in Use" cover.
 11. Thru-the-Base Connectors:
 - a. Kits shall provide connectors to permit electrical connections to be brought to the unit through the unit basepan.
 - b. Minimum of four connection locations per unit.
 12. Propeller Power Exhaust:
 - a. Power exhaust shall be used in conjunction with an integrated economizer.
 - b. Independent modules for vertical or horizontal return configurations shall be available.
 - c. Horizontal power exhaust is shall be mounted in return ductwork.
 - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0-100% adjustable setpoint on the economizer control.
 13. Roof Curbs (Vertical):
 - a. Full perimeter roof curb with exhaust capability providing separate air streams for energy recovery from the exhaust air without supply air contamination.
 - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
 - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
 14. High-Static Indoor Fan Motor(s) and Drive(s):
 - a. High-static motor(s) and drive(s) shall be factory-installed to provide additional performance range.
 15. Condenser Coil Grille:
 - a. Shall protect against damage from hail.
 - b. Shall be of louvered style.
 16. Thru-the-Bottom Utility Connectors:
 - a. Kit shall provide connectors to permit gas and electrical connections to be brought to the unit through the basepan.

17. Outdoor Air Enthalpy Sensor:
 - a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
18. Return Air Enthalpy Sensor:
 - a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
19. Indoor Air Quality (CO₂) Sensor:
 - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
 - b. The IAQ sensor shall be available in duct mount, wall mount, or wall mount with LED display. The setpoint shall have adjustment capability.
20. Smoke detectors (factory-installed only):
 - a. Shall be a Four-Wire Controller and Detector.
 - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
 - c. Shall use magnet-activated test/reset sensor switches.
 - d. Shall have tool-less connection terminal access.
 - e. Shall have a recessed momentary switch for testing and resetting the detector.
 - f. Controller shall include:
 - (1.) One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
 - (2.) Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
 - (3.) One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
 - (4.) Capable of direct connection to two individual detector modules.
 - (5.) Can be wired to up to 14 other duct smoke detectors for multiple fan shutdown applications.
21. Winter start kit
 - a. Shall contain a bypass device around the low pressure switch.
 - b. Shall be required when mechanical cooling is required down to 25°F (-4°C).
 - c. Shall not be required to operate on an economizer when below an outdoor ambient of 40°F (4°C).
22. Time Guard
 - a. Shall prevent compressor short cycling by providing a 5-minute delay (±2 minutes) before restarting a compressor after shutdown for any reason.
 - b. One device shall be required per compressor.
23. Electric Heat:
 - a. Heating Section
 - (1.) Heater element open coil resistance wire, nickel-chrome alloy, 0.29 inches inside diameter, strung through ceramic insulators mounted on metal frame. Coil ends are staked and welded to terminal screw slots.
 - (2.) Heater assemblies are provided with integral fusing for protection of internal heater circuits not exceeding 48 amps each. Auto reset thermo limit controls, magnetic heater contactors (24 v coil) and terminal block all mounted in electric heater control box (minimum 18 ga galvanized steel) attached to end of heater assembly.
24. Hinged access panels:
 - a. Shall provide easy access through integrated quarter turn latches.
 - b. Shall be on major panels of; filter, control box, fan motor and compressor.
25. Display Kit for Variable Frequency Drive
 - a. Kit allows the ability to access the VFD controller programs to provide special setup capabilities and diagnostics.
 - b. Kit contains display module, mounting bracket and communication cable.
 - c. Display Kit can be permanently installed in the unit or used on any 2-Speed Indoor Fan Motor System VFD controller as needed.