

**CALOWAMB001A00-  
CALOWAMB011A00  
CALOWAMB030A00-  
CALOWAMB036A00**

**SPLIT SYSTEMS  
ACCESSORY MOTORMASTER® I  
HEAD PRESSURE CONTROLLER  
6 to 12.5 TONS**

## Installation Instructions


**IMPORTANT:** Read these instructions completely before attempting to install this accessory.

### SAFETY CONSIDERATIONS

Installation, start-up and servicing of this equipment can be hazardous due to system pressures, electrical components and equipment location (roofs, elevated structures, etc.)

Untrained personnel can perform the basic maintenance functions. All other operations should be performed by trained service personnel. When working on air-conditioning equipment, observe precautions in the literature, tags and labels attached to the unit, and other safety precautions that may apply.

Follow all safety codes. Wear safety glasses and work gloves.

Recognize safety information. This is the safety-alert symbol . When you see this symbol on the unit and in instructions or manuals, be alert to the potential for personal injury.

Understand the signal words DANGER, WARNING, and CAUTION. These words are used with the safety-alert symbol. DANGER identifies the most serious hazards which **will** result in severe personal injury or death. WARNING signifies a hazard which **could** result in personal injury or death. CAUTION is used to identify unsafe practices which **may** result in minor personal injury or product and property damage. NOTE is used to highlight suggestions which **will** result in enhanced installation, reliability, or operation.

### WARNING

#### ELECTRICAL SHOCK HAZARD

Failure to follow this warning could cause personal injury or death.

Before performing service or maintenance operations on unit, turn off main power switch to unit and install lockout tag. Ensure electrical service to unit agrees with voltage and amperage listed on the unit rating plate.

### CAUTION

#### EQUIPMENT DAMAGE HAZARD

Failure to follow this caution may result in damage to equipment.

When removing panels from the unit, be careful not to damage the roof or other surfaces with the panels.

### CAUTION

#### CUT HAZARD

Failure to follow this caution may result in personal injury. Sheet metal parts may have sharp edges or burrs. Use care and wear appropriate protective clothing, safety glasses and gloves when handling parts and servicing units.

### GENERAL

Motormaster I solid--state head pressure control regulates outdoor (condenser) fan speed during Cooling mode operation. A temperature sensor, mounted on a return bend of the outdoor (condenser) coil, controls the speed of approved outdoor (condenser) fan motors in order to maintain a constant head pressure in the outdoor (condenser) coil. When properly installed, the control will maintain the appropriate head pressure at low ambient temperatures down to -20°F (-28°C).

On all units, the single Motormaster I control is connected to both outdoor (condenser) fan motors.

Heat Pump ONLY: Speed Control Bypass relay SCB is energized during the Heating mode. The SCB relay bypasses the Motormaster controller output to force all outdoor (condenser) fan motors to run at full speed during Heating mode.

575-V UNITS ONLY: TRANSFORMER WITH 460-V MOTORS AND CONTROL -- On 575-v units, the 575-v motors installed by factory are replaced with 460-v fan motors, powered through a stepdown (575-v to 460-v) autotransformer and controlled through a 460-v Motormaster controller.

Table 1 – Package Usage

CARRIER			OUTDOOR COIL TYPE	
Model	Size	Electrical Characteristic V-PH-60HZ (Pos# 12)	Pos #11: A,B,C,E,M,N,P,R (Round Tube / Plate Fin)	Pos #11: G,K,T,W (Novation / MCHX)
			Motormaster CALOWAMB	Motormaster CALOWAMB
38AUZ	07	208/230-3 (5)	030A00	001A00
		460-3 (6)	031A00	002A00
		575-3 (1)	033A00	003A00
	08	208/230-3 (5)	030A00	001A00
		460-3 (6)	031A00	002A00
		575-3 (1)	033A00	003A00
	12	208/230-3 (5)	030A00	001A00
		460-3 (6)	032A00	008A00
		575-3 (1)	033A00	003A00
	14	208/230-3 (5)	030A00	001A00
		460-3 (6)	032A00	008A00
		575-3 (1)	033A00	003A00
38AUD	12	208/230-3 (5)	034A00	010A00
		460-3 (6)	035A00	011A00
		575-3 (1)	036A00	007A00
	14	208/230-3 (5)	034A00	010A00
		460-3 (6)	035A00	011A00
		575-3 (1)	036A00	007A00
38AUQ	07	208/230-3 (5)	004A00	NA
		460-3 (6)	005A00	NA
		575-3 (1)	006A00	NA
	08	208/230-3 (5)	004A00	NA
		460-3 (6)	005A00	NA
		575-3 (1)	006A00	NA
	12	208/230-3 (5)	004A00	NA
		460-3 (6)	009A00	NA
		575-3 (1)	006A00	NA

BRYANT			OUTDOOR COIL TYPE	
Model	Size	Electrical Characteristic V-PH-60HZ (Pos# 5)	Pos #12: A,B,C,E,M,N,P,R (Round Tube / Plate Fin)	Pos #12: G,K,T,W (Novation / MCHX)
			Motormaster CALOWAMB	Motormaster CALOWAMB
569J	07A	208/230-3 (P)	030A00	001A00
		460-3 (E)	031A00	002A00
		575-3 (T)	033A00	003A00
	08A	208/230-3 (P)	030A00	001A00
		460-3 (E)	031A00	002A00
		575-3 (T)	033A00	003A00
	12A	208/230-3 (P)	030A00	001A00
		460-3 (E)	032A00	008A00
		575-3 (T)	033A00	003A00
	14A	208/230-3 (P)	030A00	001A00
		460-3 (E)	032A00	008A00
		575-3 (T)	033A00	003A00
	12D	208/230-3 (P)	034A00	010A00
		460-3 (E)	035A00	011A00
		575-3 (T)	036A00	007A00
	14D	208/230-3 (P)	034A00	010A00
		460-3 (E)	035A00	011A00
		575-3 (T)	036A00	007A00
575J	07A	208/230-3 (P)	004A00	NA
		460-3 (E)	005A00	NA
		575-3 (T)	006A00	NA
	08A	208/230-3 (P)	004A00	NA
		460-3 (E)	005A00	NA
		575-3 (T)	006A00	NA
	12A	208/230-3 (P)	004A00	NA
		460-3 (E)	009A00	NA
		575-3 (T)	006A00	NA

ICP			OUTDOOR COIL TYPE	
Model	Size	Electrical Characteristic V-PH-60HZ (Pos# 7)	Pos #9: A,B,C,E,M,N,P,R (Round Tube / Plate Fin)	Pos #9: G,K,T,W (Novation / MCHX)
			Motormaster CALOWAMB	Motormaster CALOWAMB
CAS	072	208/230-3 (H)	030A00	001A00
		460-3 (L)	031A00	002A00
		575-3 (S)	033A00	003A00
	091	208/230-3 (H)	030A00	001A00
		460-3 (L)	031A00	002A00
		575-3 (S)	033A00	003A00
	121	208/230-3 (H)	030A00	001A00
		460-3 (L)	032A00	008A00
		575-3 (S)	033A00	003A00
	151	208/230-3 (H)	030A00	001A00
		460-3 (L)	032A00	008A00
		575-3 (S)	033A00	003A00
	120	208/230-3 (H)	034A00	010A00
		460-3 (L)	035A00	011A00
		575-3 (S)	036A00	007A00
	150	208/230-3 (H)	034A00	010A00
		460-3 (L)	035A00	011A00
		575-3 (S)	036A00	007A00
CHS	072	208/230-3 (H)	004A00	NA
		460-3 (L)	005A00	NA
		575-3 (S)	006A00	NA
	091	208/230-3 (H)	004A00	NA
		460-3 (L)	005A00	NA
		575-3 (S)	006A00	NA
	121	208/230-3 (H)	004A00	NA
		460-3 (L)	009A00	NA
		575-3 (S)	006A00	NA

**Table 2 – Package Contents Tables**  
**A: COOLING Units, RTPF Coil Type**

	<b>ACCESSORY PACKAGE NUMBER CALOWAMB _____ / Unit Voltage</b>						
<b>Materials Description</b>	<b>030A00 208/230-v</b>	<b>031A00 460-v</b>	<b>032A00 460-v</b>	<b>033A00 575-v</b>	<b>034A00 208/230-v</b>	<b>035A00 460-v</b>	<b>036A00 575-v</b>
Motormaster I	1 x 230-v	1 x 460-v	1 x 460-v	1 x 460-v	1 x 230-v	1 x 460-v	1 x 460-v
Motors	2 x 230-v	2 x 460-v	2 x 460-v	2 x 460-v	2 x 230-v	2 x 460-v	2 x 460-v
Capacitor, Dual 10 mfd	--	1	--	1	--	--	1
Transformer 240x460/120x240	--	--	--	1	--	--	1
Relay, TDR HN67XZ210	1	1	1	1	2	2	2
Mounting Plate	1	1	1	1	1	1	1
Screws, #10x5/8	11	11	11	11	11	11	11
Screws, 1/4AB-14x5/8	--	--	--	4	--	--	4
<b>Wires</b>							
BLK x 12-in	1	1	1	1	2	2	2
BRN x 22-in	1	1	1	1	2	2	2
BLU x 12-in	2	2	2	2	4	4	4
Wire Ties	10	10	10	10	10	10	10

**B: COOLING Units, Novation/MCHX Coil Type**

	<b>ACCESSORY PACKAGE NUMBER CALOWAMB _____ / Unit Voltage</b>						
<b>Materials Description</b>	<b>001A00 208/230-v</b>	<b>002A00 460-v</b>	<b>003A00 575-v</b>	<b>007A00 575-v</b>	<b>008A00 460-v</b>	<b>010A00 208/230-v</b>	<b>011A00 460-v</b>
Motormaster I	1 x 230-v	1 x 460-v	1 x 460-v	1 x 460-v	1 x 460-v	1 x 230-v	1 x 460-v
Motors	2 x 230-v	2 x 460-v	2 x 460-v	2 x 460-v	2 x 460-v	2 x 230-v	2 x 460-v
Capacitor, Dual 10 mfd	--	1	1	1	--	--	--
Transformer 240x460/120x240	--	--	1	1	--	--	--
Relay, TDR HN67XZ210	1	1	1	2	1	2	2
Mounting Plate	1	1	1	1	1	1	1
Screws, #10x5/8	11	11	11	11	11	11	11
Screws, 1/4AB-14x5/8	--	--	4	4	--	--	--
<b>Wires</b>							
BLK x 12-in	1	1	1	2	1	2	2
BRN x 22-in	1	1	1	2	1	2	2
BLU x 12-in	2	2	2	4	2	4	4
Wire Ties, UVR	10	10	10	10	10	10	10

**C: HEAT PUMP Units, RTPF Coil Type**

<b>Materials Description</b>	<b>ACCESSORY PACKAGE NUMBER CALOWAMB _____ /Unit Voltage</b>			
	<b>004A00 208/230-v</b>	<b>005A00 460-v</b>	<b>006A00 575-v</b>	<b>009A00 460-v</b>
Motormaster I	1 x 230-v	1 x 460-v	1 x 460-v	1 x 460-v
Motors	2 x 230-v	2 x 460-v	2 x 460-v	2 x 460-v
Capacitor, Dual 10 mfd	--	1	1	--
Transformer 240x460/120x240	--	--	1	--
Relay, DPST-NO HN61PC005 SCB	1	1	1	1
Mounting Plate	1	1	1	1
Screws, #10x5/8	13	13	13	13
Screws, 1/4AB-14x5/8	--	--	4	--
<b>Wires</b>				
BLK x 30-in	1	1	--	1
ORN x 30-in	1	1	1	1
BRN x 30-in	1	1	1	1
Wire Ties	10	10	10	10

## INSTALLATION

### Check voltage of kit parts against unit voltage.

Before starting, check controller and motor voltage against unit voltage.

**NOTE:** 575-v units use 460-v controller and motors with stepdown autotransformer.

## INSTALLATION

### Changing outdoor fan motors (all units)

#### **⚠ WARNING**

##### **ELECTRICAL SHOCK HAZARD**

Failure to follow this warning could result in personal injury or death.

Turn off all power to unit and install lockout tag. Power can come to unit from multiple sources. Verify power is off with a meter or probe.

1. Disconnect power to the unit. Lock-out/tag-out.
2. Remove main access panel and control box cover.
3. At run capacitor CAP, identify the YEL wire from contactor C (or C1); do not disconnect. Disconnect the two other YEL leads and the BRN leads (from OFM1 and OFM2).
4. Disconnect two OFM BLK wires per table below.

UNIT	DISCONNECT AT
38AUZ/569J_A/ CAS 072,091,121,151	C terminal 21
3AUD/569J_D/ CAS 120-150	Relay OFR Terminals 2,6
38AUQ/575J/ CHS	Relay OFR Terminals 2,6

5. Trace the motor leads from OFM1 and OFM2 to the control box. Note wire path into the control box. Pull these leads out of the control box.
6. Remove the screws securing the OFM1 and OFM2 fan grilles from the unit top cover. Save these screws.
7. Remove the fan grille assemblies at OFM1 and OFM2 by lifting the assemblies straight up until the prop blades clear the fan deck. Invert the grille assemblies and place on a support surface.
8. Mark the hub to indicate motor location. Measure and record the dimension of the top edge of the prop blade to the grille.
9. For each fan assembly, remove the prop fan from the motor shaft.
10. Observe the orientation of the fan motor wires at the grille and motor shell opening. Remove the fan motors from the grille center plate.
11. Attach the motors from the accessory kit to the grilles. Torque the mounting nuts onto the motor throughbolts to 20 in-lbs (2260 mNm) Do not over-tighten the nuts onto the motor throughbolt ends. Secure wires to grille as noted in step 10.

12. Mount the prop fan onto the motor shaft. Locate the prop at the distance from the grille measured in step 8 above. If the prop blade contacts the motor housing, adjust prop position until the prop clears the motor by 1/2-in (12 mm). Rotate the hub on the motor shaft to position the set screw over the shaft flat. Torque the prop set screws to 84 in-lbs (9.5 Nm).
13. Position the OFM1 grille assembly over its top panel opening and carefully insert the motor wires and prop through the opening and lower into place. Secure using screws removed in step 6. Repeat for OFM2 grille assembly.
14. Rotate the prop fan to ensure there is no interference or contact with unit piping or motor wiring.
15. Route the motor leads into the control box as noted in step 5.


### Modifying Motormaster sensor type (Units with Novation/MCHX Coils Only)

If the accessory kits unique to use with all-aluminum (Novation/MCHX) coils are not available, the comparable RTPF accessory package can be modified for aluminum coil use by changing the Motormaster sensor-cable assembly. Order Part Number HH79NZ099 from service parts. Disconnect power to the Motormaster controller. Disconnect the factory sensor-cable assembly at the wire nuts; connect the replacement sensor-cable at same location.

### Prepare/Attach the Motormaster/Transformer Plate (Bracket)

#### 208/230-3 and 460-3-v only:


1. See Fig. 1 for Motormaster/transformer mounting plate (bracket). Note screw hole patterns on left-side (used for 575-v transformer mounting) and on right-hand side (used for Motormaster mounting).

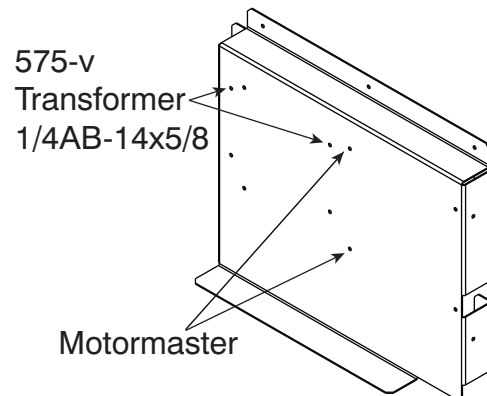

C13120

**Fig. 1 - Mounting Bracket, Starter Screws**

2. Locate two screw holes for Motormaster left-side mounting.
3. Start two #10x5/8 screws in these holes. Engage half-length.
4. Attached the plate to inside of the unit panel per Fig. 2 with six #10 screws.

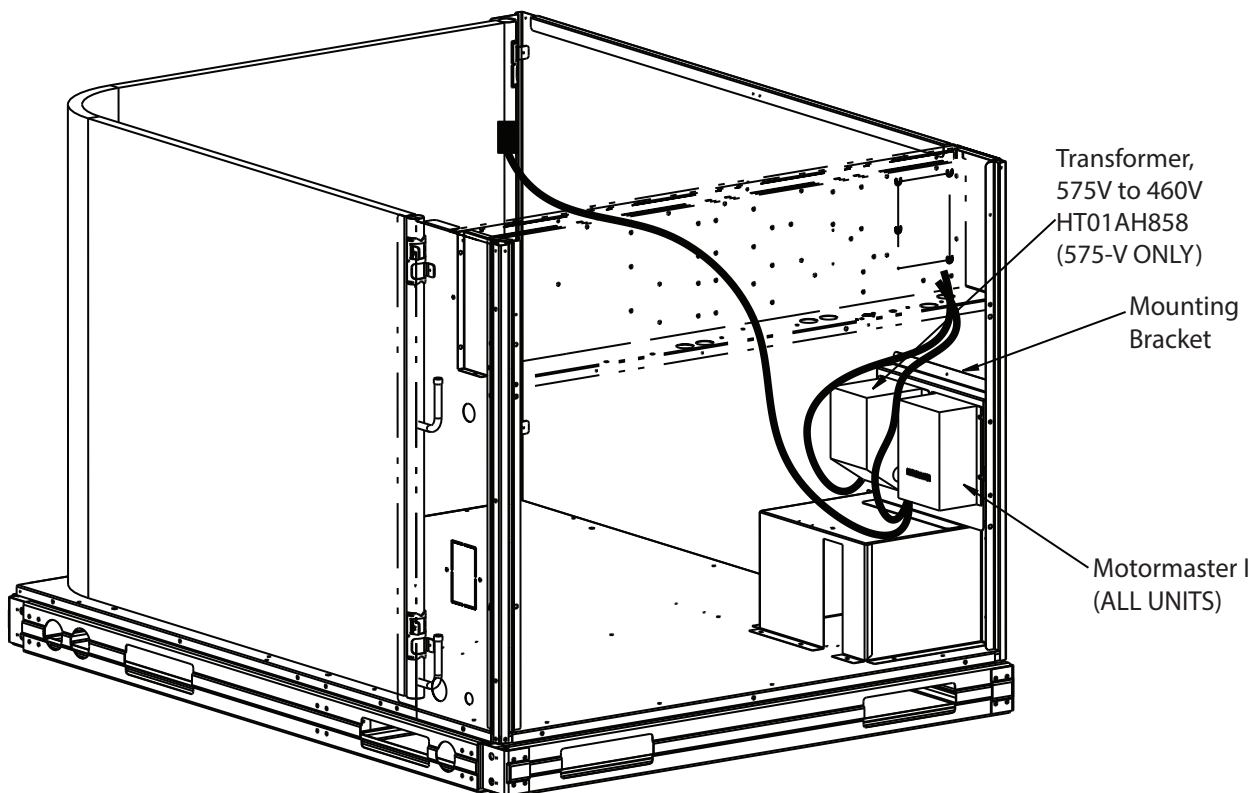

**Fig. 2 - Motormaster Control Mounting**

C10184

5. Handling the Motormaster assembly carefully to not damage the three long leads and the sensor cable, with leads exiting the control housing from the bottom, position the side mounting slots under the two mounting screws, and hold in place. Insert a #10 screw at the right side flange screw slot and tighten. Insert a second screw in the side slot and tighten. Tighten the two screws at the left side mounting slots.
6. Route the three power leads into the unit control box.
7. Route the Motormaster sensor cord to the coil (left of compressor with RTPF coil type or opposite end header with Novation/MCHX coil). See Fig. 3 and 4.

**575-v only:**

1. See Fig. 1 for Motormaster/transformer mounting plate (bracket). Note screw hole patterns on left-side (used for 575-v transformer mounting) and on right-hand side (used for Motormaster mounting)
2. Locate two screw holes for transformer top mounting.
3. Start two 1/4AB-14x5/8 screws in these holes. Engage half-length.
4. Locate two screw holes for Motormaster left-side mounting.
5. Start two #10x5/8 screws in these holes. Engage half-length.
6. Attached the plate to inside of the unit panel per Fig. 2 with six #10 screws.
7. Handling the transformer assembly carefully to not damage the four long leads, position the top mount-

ing flange keyholes over the two mounting screws. Insert two 1/4AB-14 screws at the flange bottom screw holes. Tighten the four screws.

8. Route the four leads into the unit control box.
9. Handling the Motormaster assembly carefully to not damage the three long leads and the sensor cable, with leads exiting the control housing from the bottom, position the side mounting slots under the two mounting screws and hold in place. Insert a #10 screw at the right-side flange screw slot and tighten. Insert a second screw in the side slot and tighten. Tighten the two screws at the left side mounting slots.
10. Route the three power leads into the unit control box.
11. Route the Motormaster sensor cord to the coil (left of compressor with RTPF coil type or opposite end header with Novation/MCHX coil). See Fig. 3 and 4.


**Control Box Changes and Wiring**

Refer to Component Location view on unit wiring label to determine location in control box for new components. See also Fig. 16 for Cooling Units or Fig. 17 for Heat Pump Units.

**Replace CAP (460-v size 07-08/072-090 and all 575-v units)**


1. Disconnect the YEL wire at run capacitor CAP center terminal.
2. Unscrew the capacitor strap at CAP carefully so that it can be reused.
3. Remove the capacitor and store it in a safe place or discard properly.



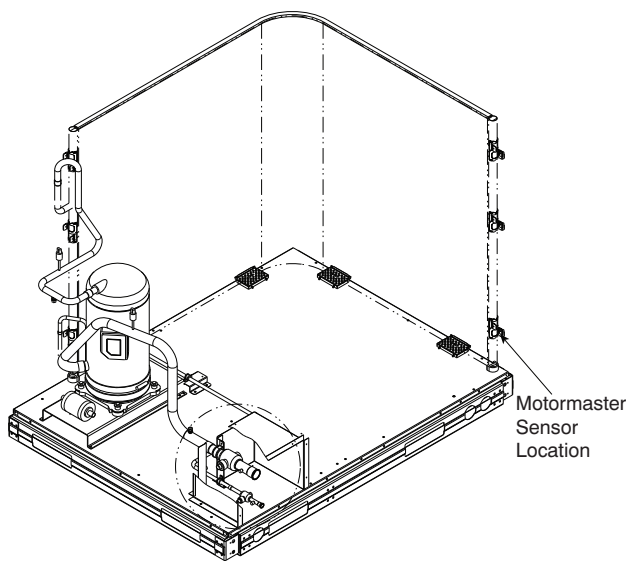

C13121

**Fig. 3 - Typical Sensor Location, Novation/MCHX Coil**

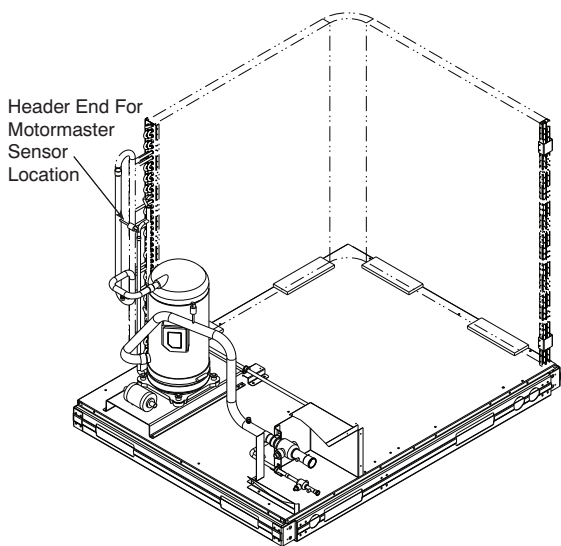

SPLIT SYSTEM 10 TON - SINGLE CKT - RTPF

C13122

**Fig. 4 - Typical Motormaster Sensor Location, RTPF Coil**

4. Using the capacitor strap, safely secure the new 10mfdx10mfd capacitor in the original capacitor location.
5. Reconnect the YEL wire at the capacitor center terminal.

### Cooling Model Units (38AUZ, 38AUD, 569J, CAS)

Mount TDR relay – Accessory packages for these cooling units will contain one or two Time Delay Relays (TDR). Refer to Component Arrangement view on the unit wiring diagram; mount the relay or relays in the unit control box in TDR positions using screws provided.

### Wiring Connections

#### TDR Wiring

All cooling models use a single TDR across the unit's single or Circuit 1 low pressure switch. Refer to Fig. 10-13.

Locate these wires:

COLOR	LENGTH, IN. [MM]
BRN	22 [559]
BLU (2 required)	12 [305]
BLK	12 [305]

1. Connect BRN wire, female quick connect end, to TDR terminal 3. Connect other end to compressor contactor C or C1 at coil terminal with BRN lead.
2. Connect BLK wire, female quick connect end, to TDR terminal 2. Connect other end to TB2 at HPS1-Out connection.
3. Connect BLU wire, female quick connect end, at TDR terminal 1. Connect other end to TB2 at LPS1-Out connection.
4. Connect second BLU wire, female quick connect end, at TDR terminal 5. Connect other end to TB2 at LPS1-In connection.

Dual Circuit Models Only – The accessory kit for these models includes a second TDR to bypass the low pressure switch in Circuit 2. Refer to Fig. 12 and 13. Locate the second set of BRN, BLU and BLK wires.

1. Connect BRN wire, female quick connect end, to TDR2 terminal 3. Connect other end to compressor contactor C2 at coil terminal with BRN lead.
2. Connect BLK wire, female quick connect end, to TDR2 terminal 2. Connect other end to TB2 at HPS2-Out connection.
3. Connect BLU wire, female quick connect end, at TDR2 terminal 1. Connect other end to TB2 at LPS2-Out connection.
4. Connect second BLU wire, female quick connect end, at TDR2 terminal 5. Connect other end to TB2 at LPS2-In connection.

### Motormaster/OFM1/OFM2 Wiring

1. Locate the YEL and BRN leads from new OFM1 and OFM2; pull to run capacitor CAP.
2. Connect both YEL leads at CAP terminal C.
3. Connect BRN lead from OFM1 at CAP terminal F.
4. Connect BRN lead from OFM2 at CAP terminal H.
5. Locate the BLK leads from new OFM1 and OFM2; pull to CAP location.
6. Locate the two BLK leads from the Motormaster controller. Pull to CAP location.
7. Connect BLK leads from OFM1 and OFM2 to mating connectors on BLK leads from Motormaster.
8. Locate the RED lead from Motormaster controller.
9. Apply a FIELD-SUPPLIED ¼-in. quick connect terminal on the RED lead per table below.
10. Connect the RED lead per table below:

UNIT	CONNECT RED AT:	FIG.
38AUZ/569J_Z/ CAS 072-091-121-151 208/230-V, 460-V	Contactors C terminal 21 QC Terminal required	10
38AUZ/569J_Z/ CAS 072-090-121-151 575-V	No connection required	11
38AUD/569J_D/ CAS 120-150 208/230-V, 460-V	Relay OFR terminal 6 QC Terminal required	12
38AUD/569J_D/ CAS 120-150 575-V	Relay OFR terminal 6	13

### 575-V Unit only, Transformer Connections:

#### 38AUZ/569J\_A/CAS 072-091-121-151

1. Locate BLK, VIO and YEL leads from 575-v/460-v transformer.
2. At CAP, identify the YEL lead from contactor C. Follow back to contactor C and disconnect at terminal 23.
3. Connect the VIO lead from the transformer at contactor C terminal 23.
4. Connect BLK lead from transformer at contactor C terminal 21.
5. Pull YEL from transformer and YEL disconnected in step 2 together. Cut the terminal off the factory wire, strip insulation 1/2 -inch and splice YEL leads using wire connector.

#### 38AUD/569J\_D/CAS 120-150

1. Locate BLK, VIO and YEL leads from 575-v/460-v transformer.
2. At CAP, identify the YEL lead from contactor C. Follow back to contactor C1 and disconnect at terminal 13.
3. Connect the VIO lead from the transformer at contactor C2 terminal 13.
4. Connect BLK lead from transformer at relay OFR terminal 8.
5. Pull YEL from transformer and YEL disconnected in step 2 together. Cut the terminal off the factory wire, strip insulation 1/2 -inch and splice YEL leads using wire connector.

### Heat Pump Units (38AUQ/575J/CHS)

#### Mount SCB relay

Accessory packages for these heat pumps include one DPST-NO relay; use for Speed Controller Bypass SCB function. Refer to Component Arrangement view on the unit wiring diagram; mount the relay in the unit control box in SCB position using screws provided.

#### Wiring Connections

#### SCB Relay Wiring

Locate these wires:

COLOR	LENGTH, IN. [MM]
BRN	30 [762]
ORN	30 [762]
BLK (used on 230-v, 460-v units only)	30 [762]

1. Connect BRN wire at SCB terminal 0. Connect other end of BRN wire to unit control voltage terminal board TB, terminal C.
2. Connect ORN wire at SCB terminal 1; connect other end to terminal board TB terminal W1.
3. At OFR terminal 4, trace the BLK lead to contactor C terminal 11 and disconnect at C.
4. Pull the BLK disconnected at C in step 4 to SCB; connect at terminal 2.

### Motormaster/OFM1/OFM2 Wiring

1. Locate the RED lead from the Motormaster controller. Pull to SCB, connect to terminal 4.
2. Locate the BLK lead from the Motormaster controller. Pull to SCB, connect to terminal 2.
3. Locate the BLK leads from new OFM1 and OFM2; pull to OFR, connect to terminal 2 and terminal 6.
4. Locate the YEL and BRN leads from new OFM1 and OFM2; pull to capacitor CAP.
5. Connect both YEL leads at CAP terminal C.
6. Connect BRN lead from OFM1 at CAP terminal F.
7. Connect BRN lead from OFM2 at CAP terminal H.

### 230-v, 460-v Unit only:

1. Connect new BLK wire at SCB terminal 4. Pull other end to contactor C.
2. At contactor C terminal 11, connect the new BLK wire.

### 575-v Unit only with Transformer:

1. Locate four leads from transformer – RED, BLK, YEL and VIO (or BRN). Locate two leads from Motormaster – RED and BLK.
2. Pull the two RED leads to relay SCB. Connect on SCB terminal 4.
3. Pull the BLK lead from Motormaster to SCB. Connect on SCB terminal 2.
4. At contactor C terminal 13, identify the YEL lead from CAP and disconnect from C. Reconnect to YEL lead from the transformer.
5. Connect the VIO (or BRN) lead from the transformer at contactor C terminal 13.
6. Connect the BLK lead from the transformer to contactor C terminal 11.

### Sensor Location

#### Unit with Copper Tube Coil

Sensor is attached to a transfer header tube on coil, located to the left of the compressors. Refer to Fig. 5, 6 and 9 for specific tube location. Use machine screw and nut to secure sensor clamp to the tube.

## Unit with Aluminum Tube (Novation) Coil

Sensor is attached to the return header at the opposite end of coil. See Fig. 3. Access header location through rear unit panel. See Fig. 7 and 8 for sensor location details. Use black nylon wire tie to secure sensor to the header tube. Reinstall the rear corner panel.

## Wind Baffles

Wind baffles are required to prevent wind cross currents from causing abnormally low condensing temperatures during Cooling mode operation at low outdoor temperatures..

Use 20--gauge sheet metal to fabricate wind baffles

(see Fig. 18 and Table 3) and mounting brackets.

## Inspect Wiring / Restore Power

Visually inspect all fan motor wiring to ensure no interference with fan blades or contact with refrigerant tubing. Use wire ties to dress wires as required.

Visually inspect all wiring around and to Motormaster module and 575-v autotransformer. Coil up all excess wire and secure it next to the controller; use wire tie as required.

Replace the control box cover. Replace the unit access panel.

Remove the tag and lockout at the unit disconnect. Restore power to unit.


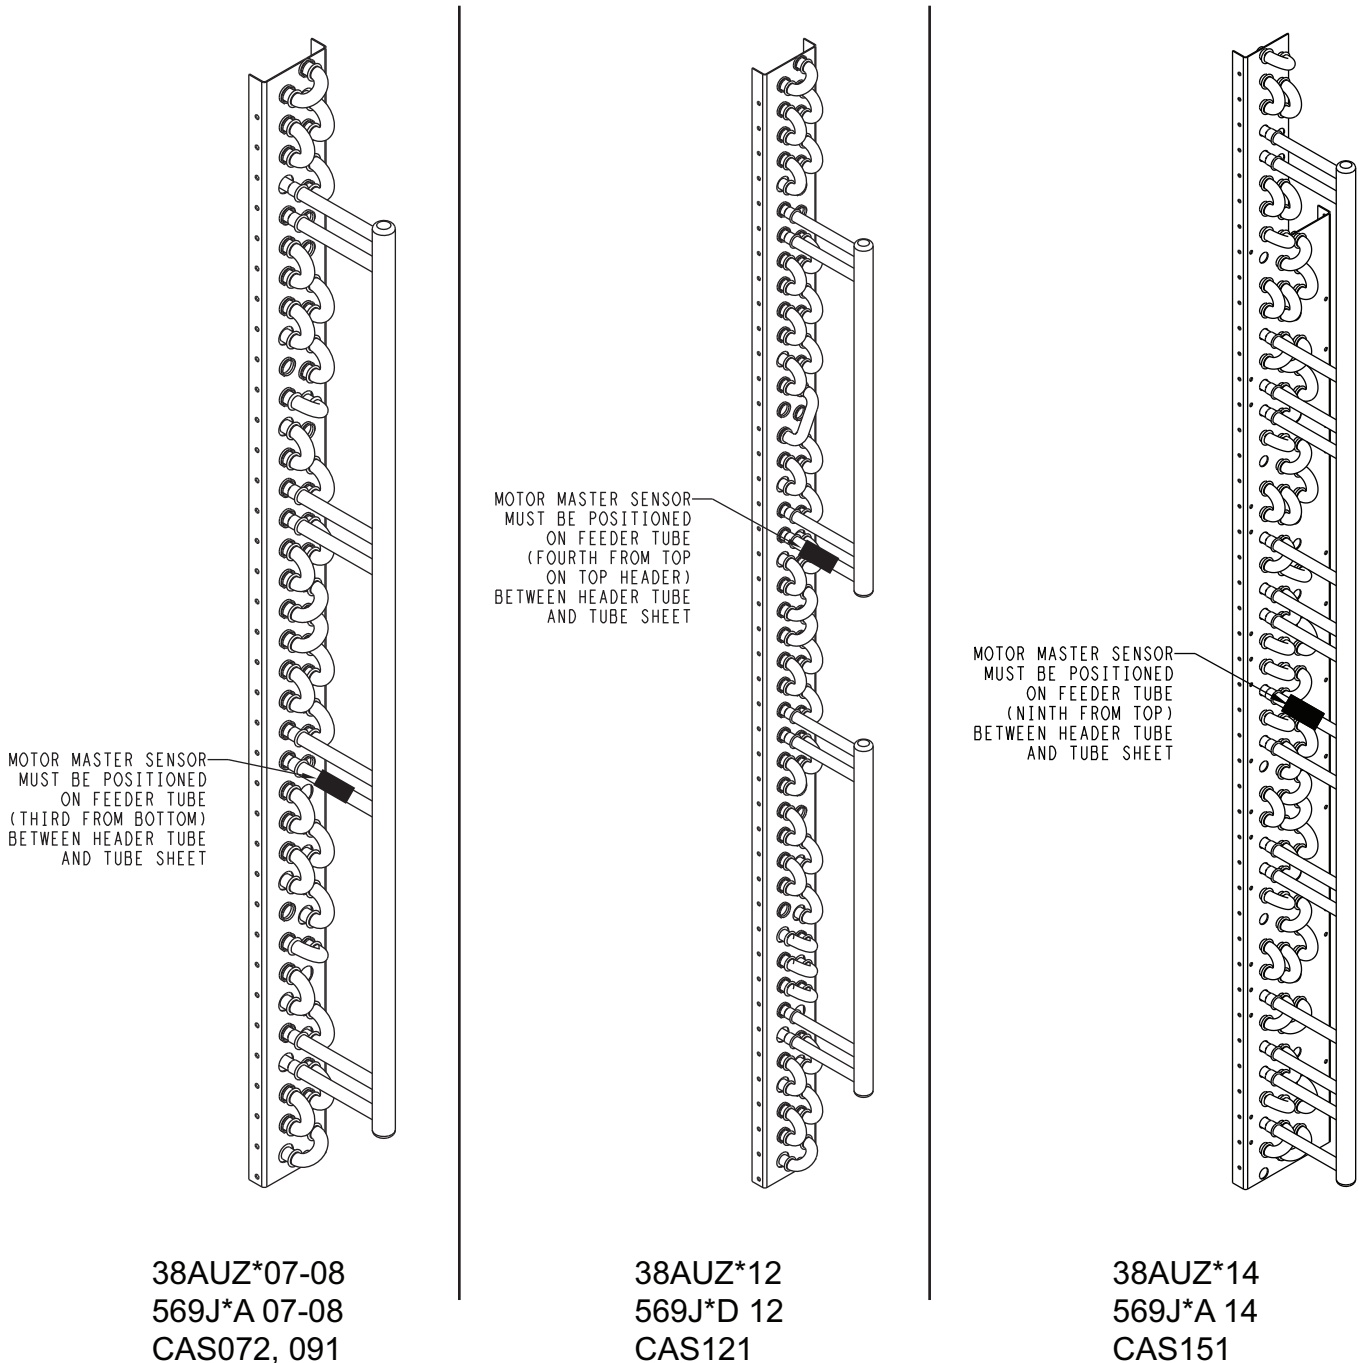


Fig. 5 - Motormaster Sensor Locations (RTPF)


C11095

MOTOR MASTER SENSOR  
MUST BE POSITIONED  
ON FEEDER TUBE  
(SECOND FROM TOP  
ON BOTTOM HEADER)  
BETWEEN HEADER TUBE  
AND TUBE SHEET

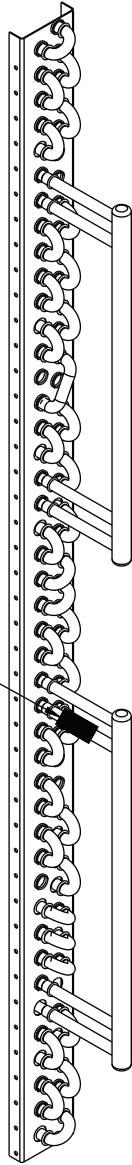

38AUD\*12  
569J\_12D  
CAS 120


MOTOR MASTER SENSOR  
MUST BE POSITIONED  
ON FEEDER TUBE  
(TOP MOST ON  
BOTTOM HEADER)  
BETWEEN HEADER TUBE  
AND TUBE SHEET

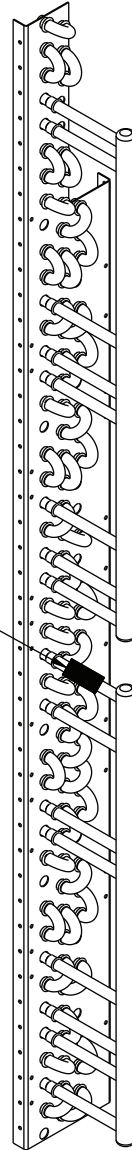


38AUD\*14  
569J\_14D  
CAS 150

Fig. 6 - Motormaster Sensor Locations (RTPF)


C11096

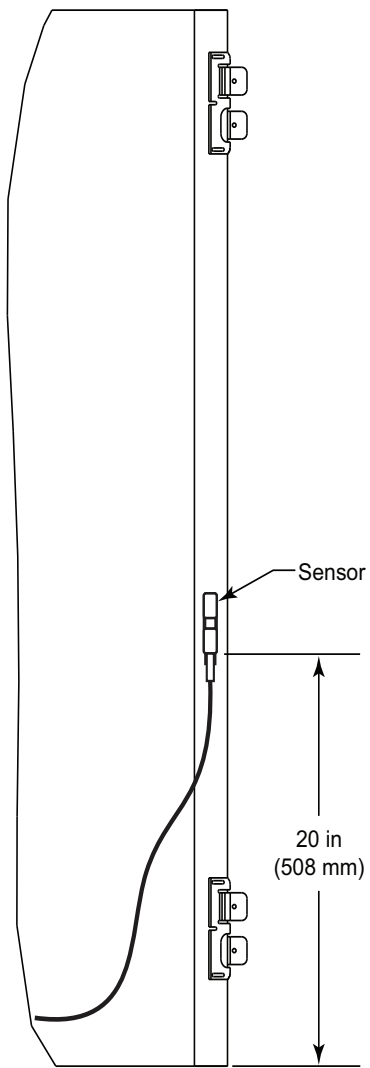

C10931  
**Fig. 7 - 38AUZ 7-14, 569J\_A7-14, CAS 072, 091, 121, 151 Motormaster Sensor Location (All Sizes - Novation)**

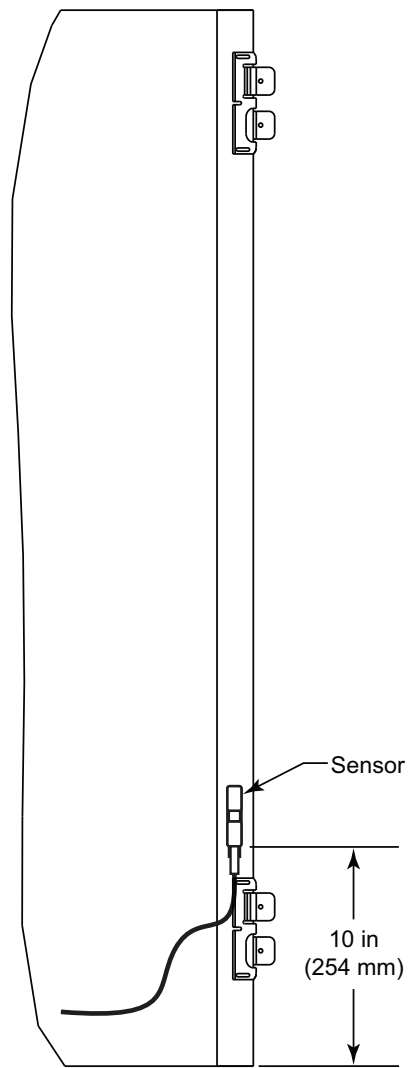

C10932  
**Fig. 8 - 38AUD\*12-14, 569J\_D12-14, CAS120, 150 Motormaster Sensor Location (Novation)**

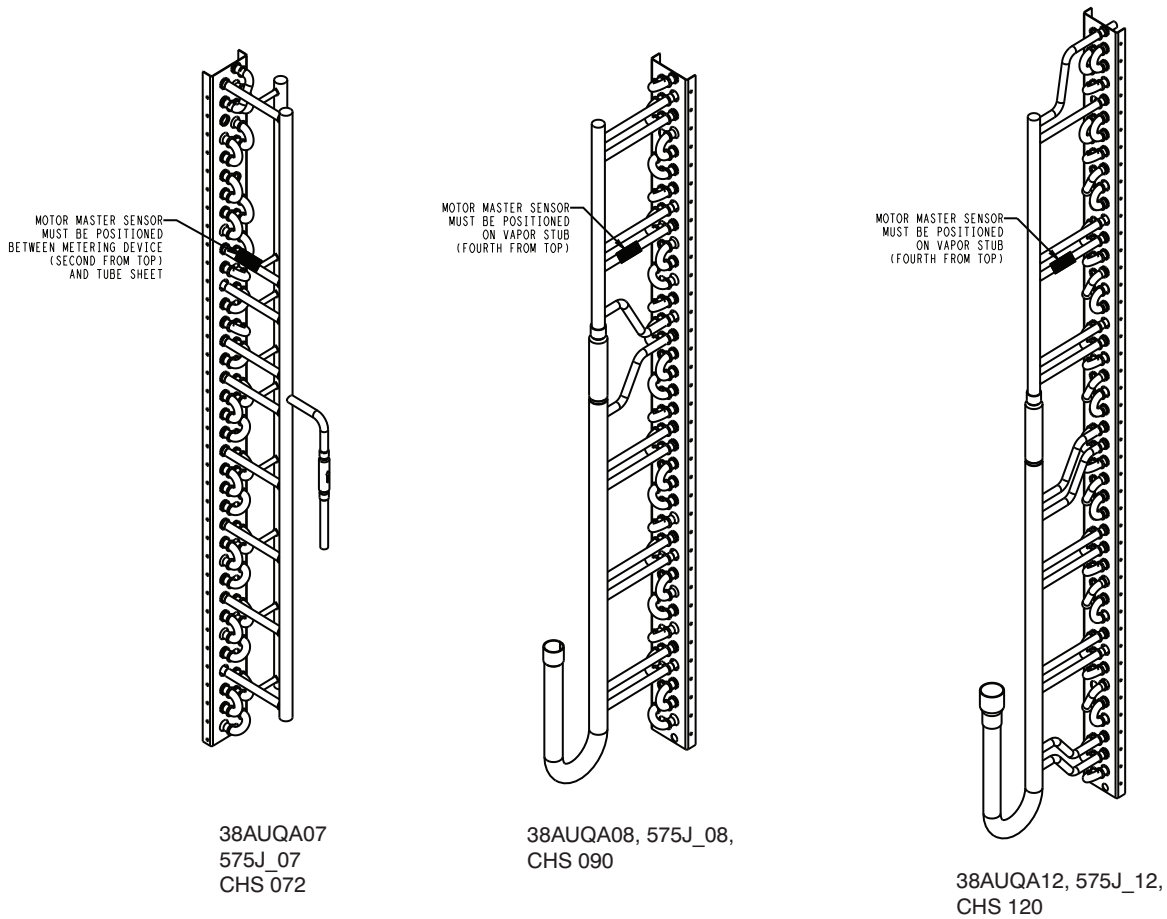

**Fig. 9 - Sensor Locations**

C10185




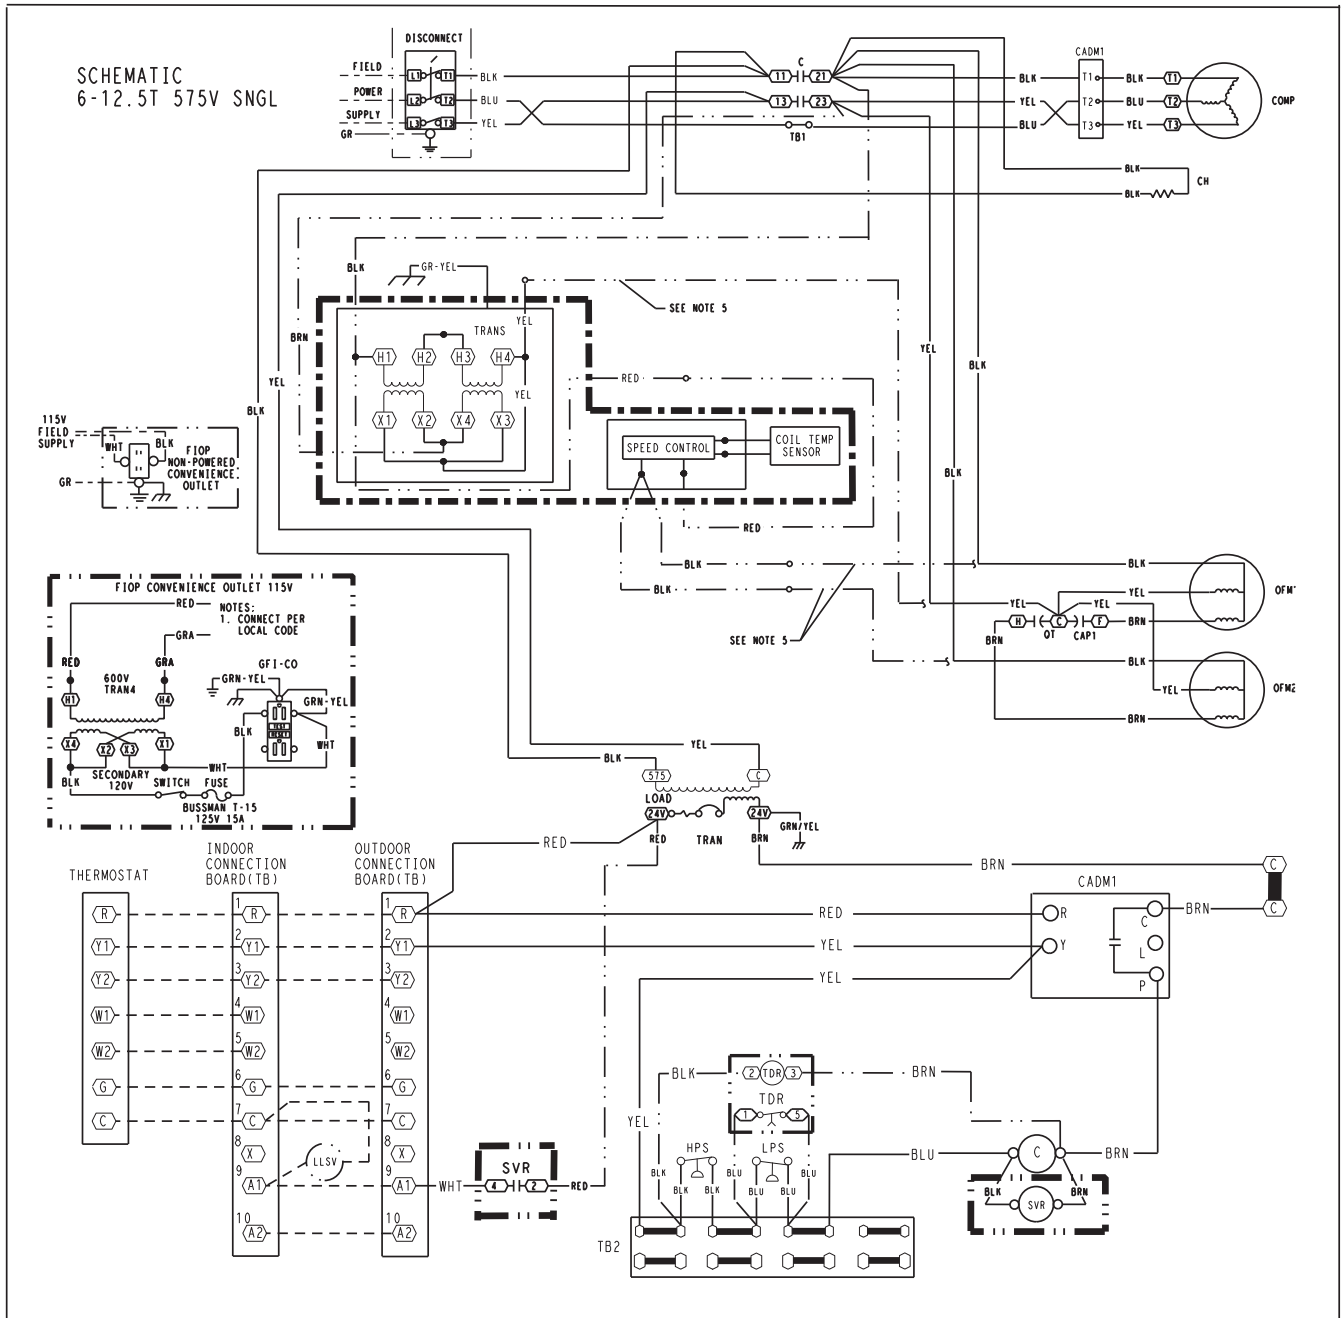


Fig. 11 - Motormaster Wiring Details - 38AUZ 07-14, 569J\*07-14A, CAS072, 091, 121, 151 575V

C10189



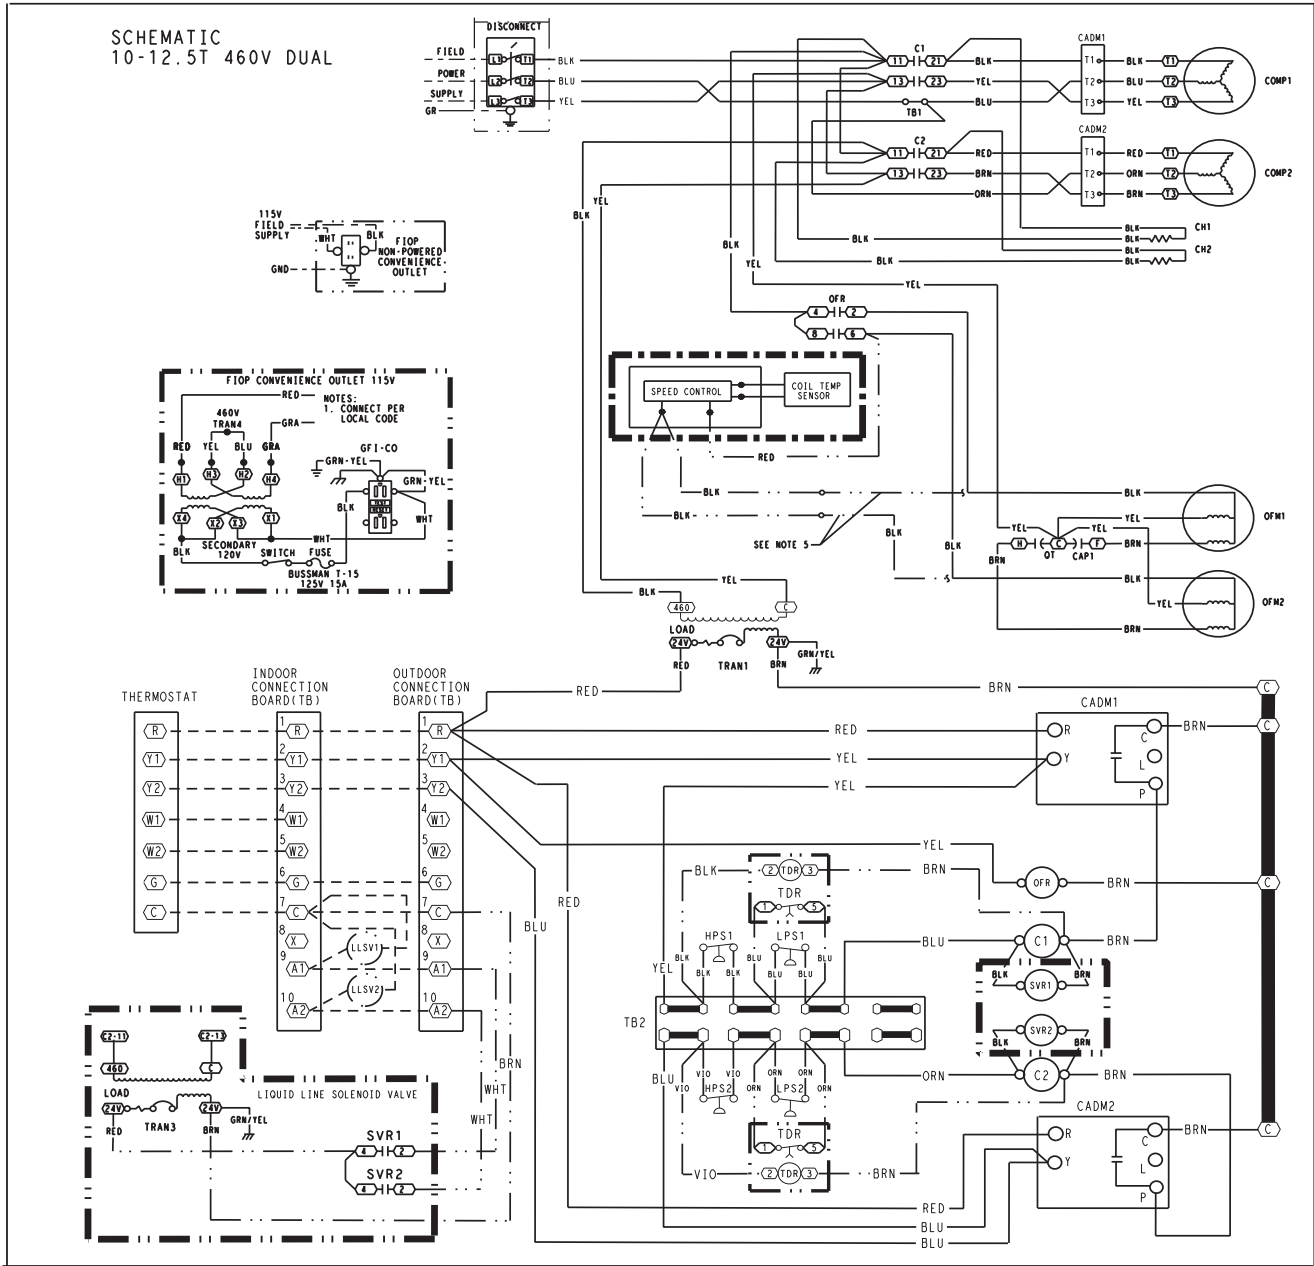

C10190


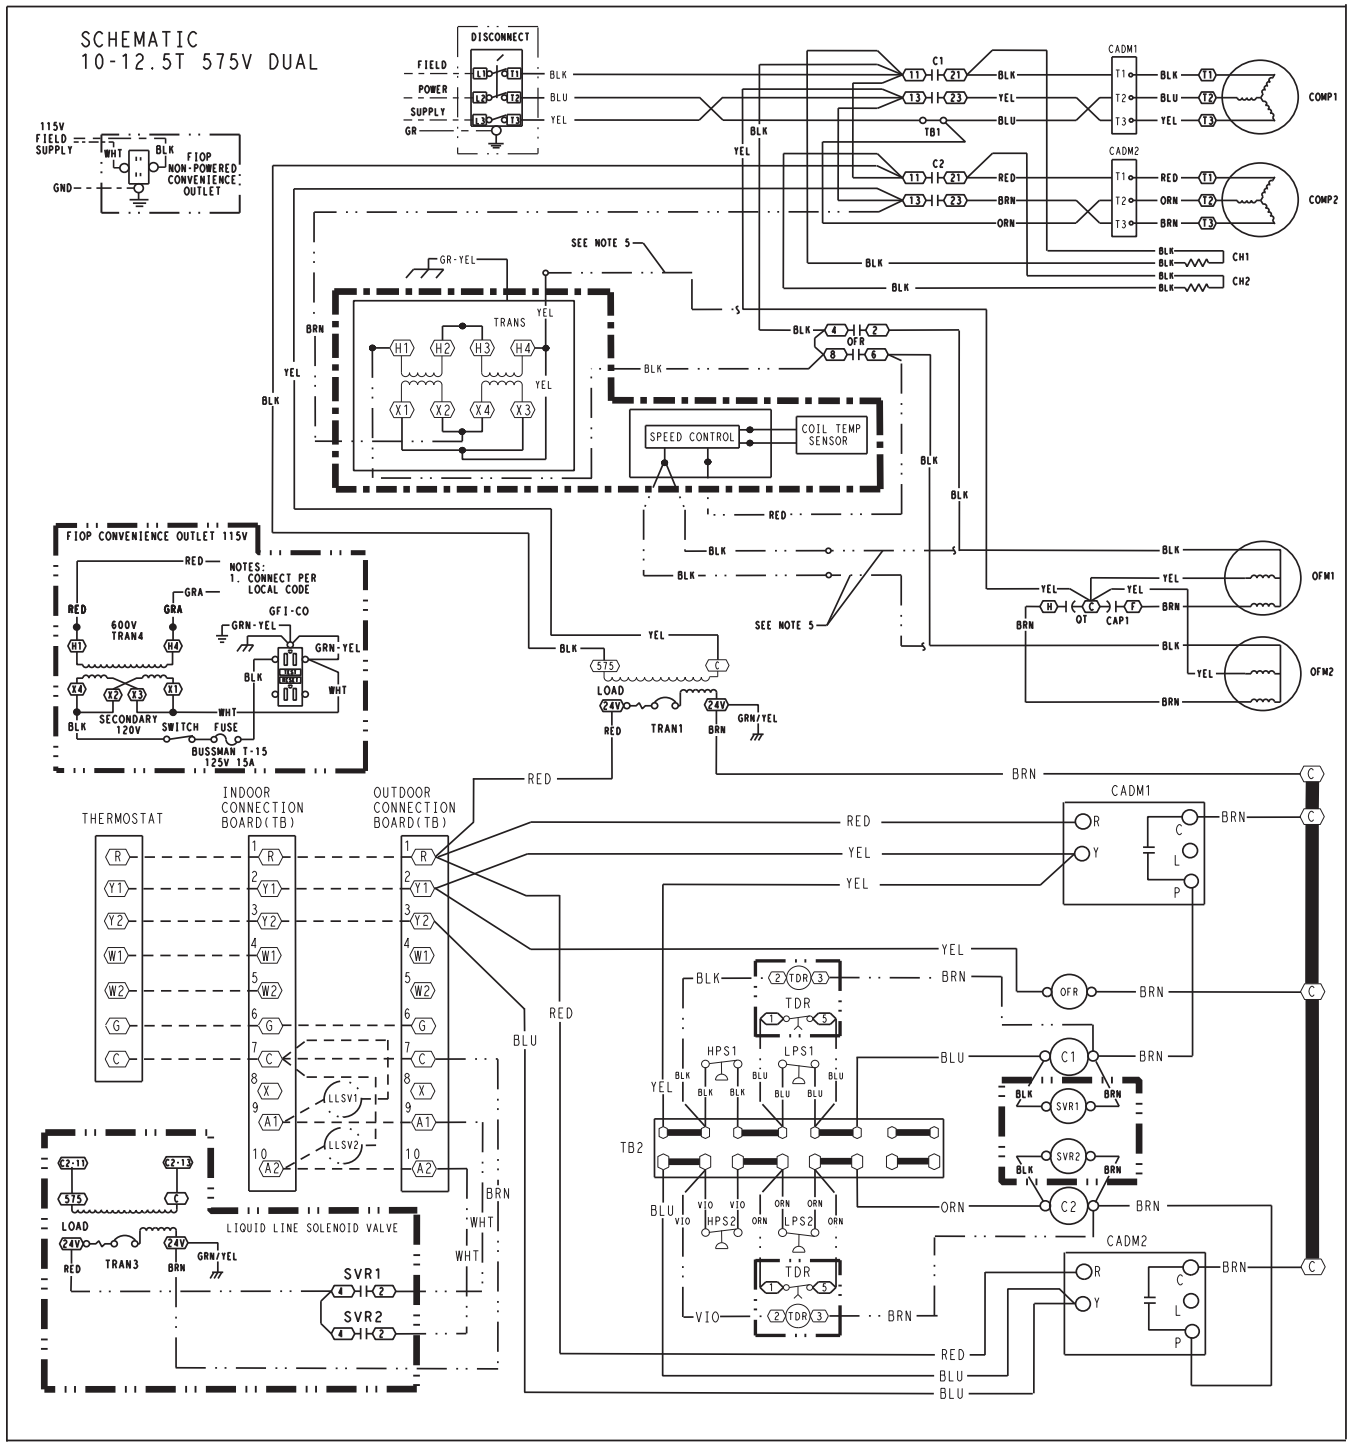


Fig. 13 - Motormaster Wiring Details - 38AUD 12-14, 569J\*12-14D, CAS120, 150 575V

C10191

**SCHEMATIC**  
460V 6,7.5,10T SNGL HP

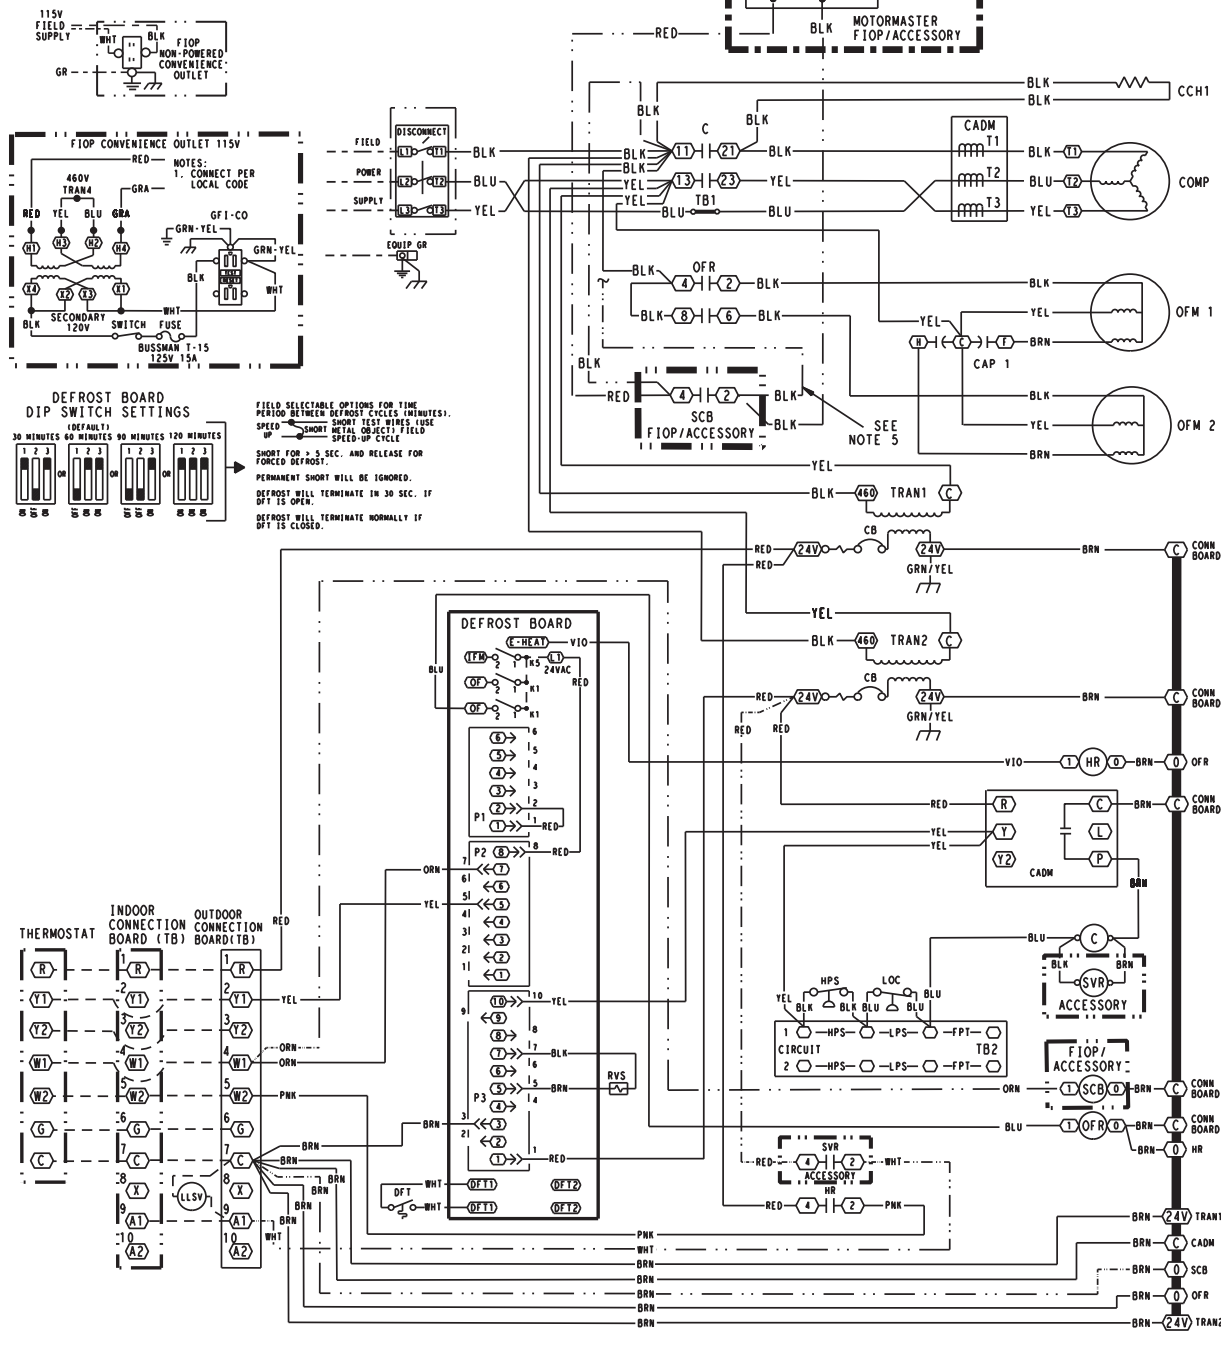

**Fig. 14 - Motormaster Wiring Details - 38AUQ 07-12, 575J\* 07-12, CHS072, 091, 121 208/230-3-60, 460-3-60**

C10192

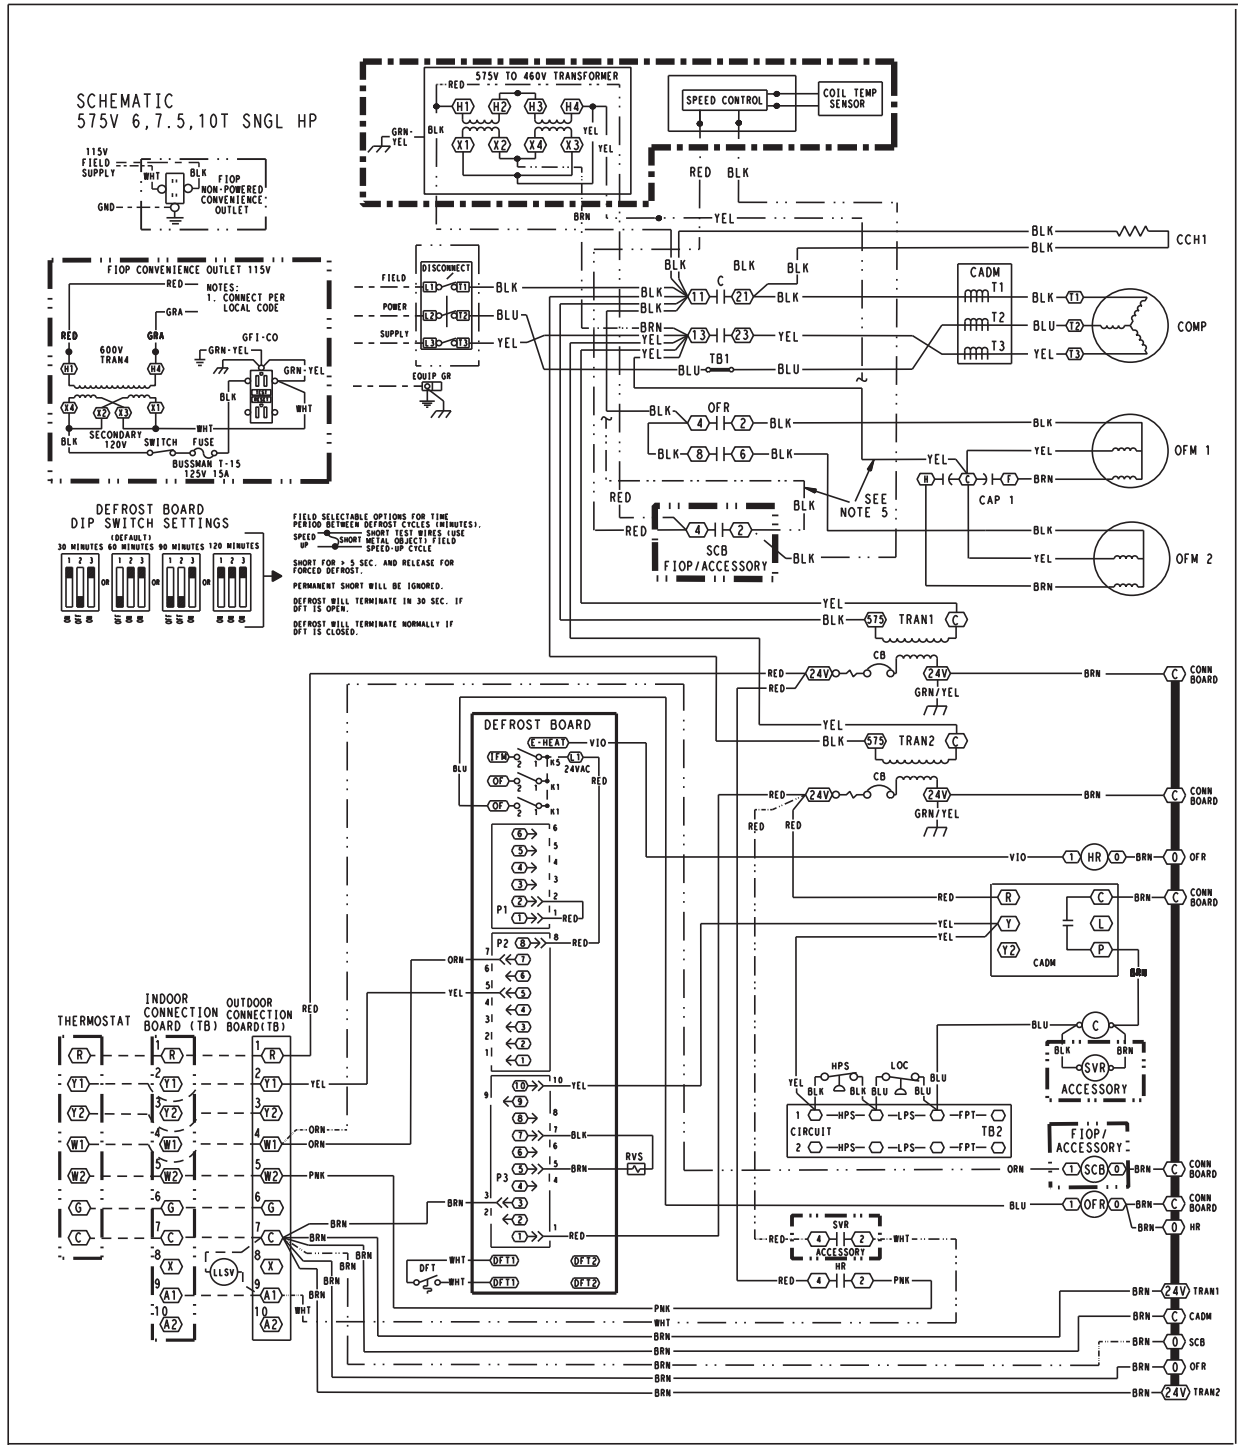


Fig. 15 - Motormaster Wiring Details - 38AUQ 07-12, 575J\* 07-12, CHS072, 091, 121 575V

C10193

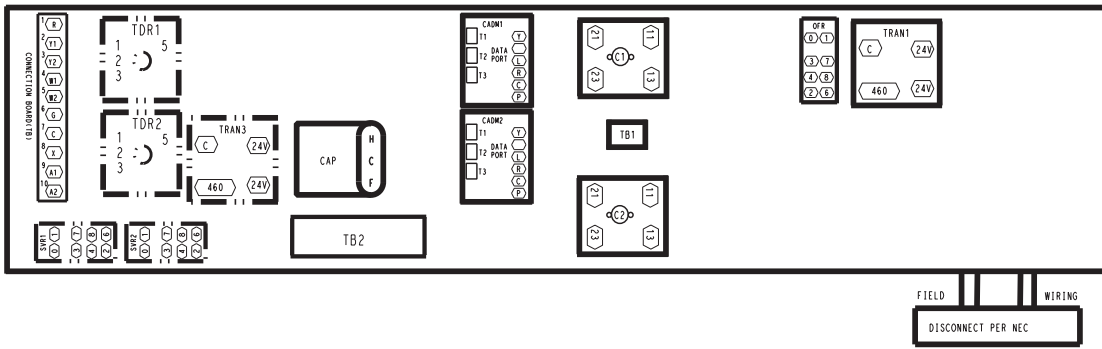


Fig. 16 - Component Locations - 38AUD, 569J\*D, CAS Cooling Only Shown

C10194

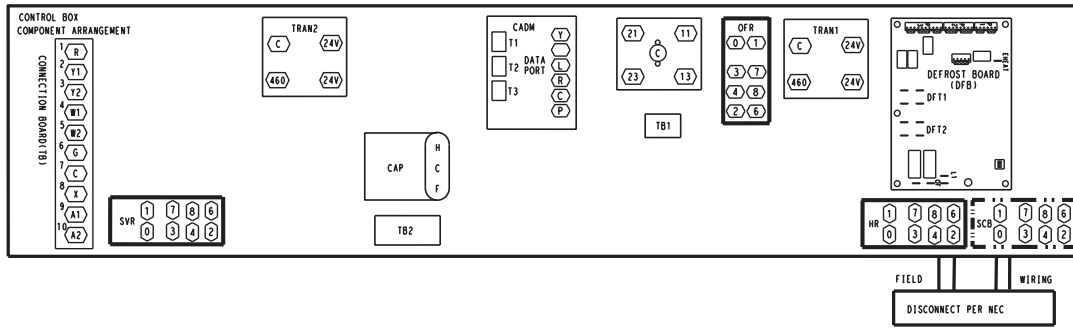


Fig. 17 - Component Locations - 38AUQ, 575J, CHS Heat Pump Shown

C10195

0.85 (TYP)  
0.47 (TYP)

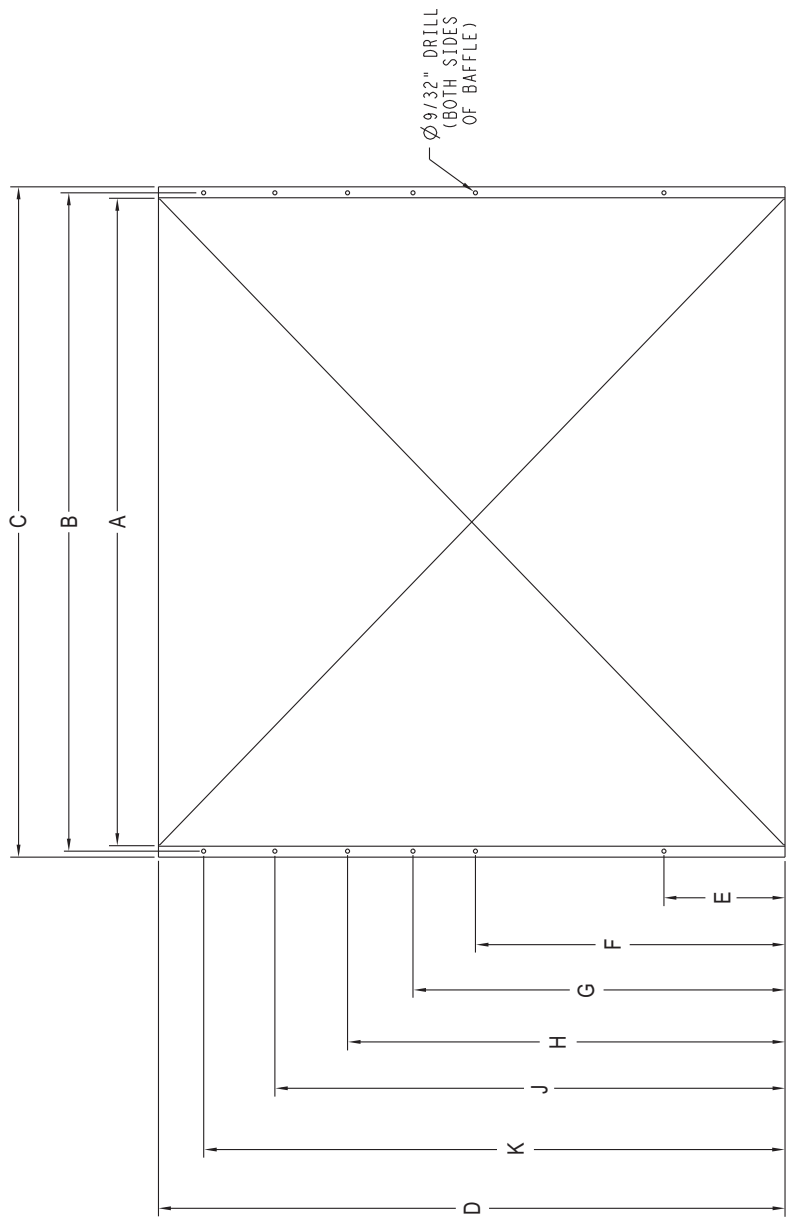
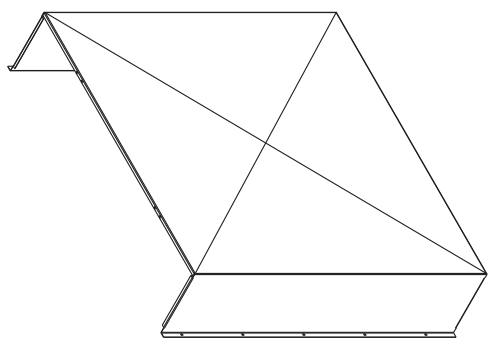
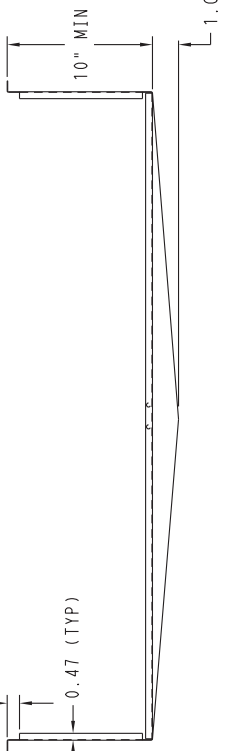


Fig. 18 - Wind Baffles

Table 3 – Wind Baffle Dimensions (Inches)

DIMENSIONS – INCHES												
UNIT	COIL TYPE	BAFFLE	A	B	C	D	E	F	G	H	J	K
38AUZ 07	MCHX	LEFT SIDE	32 1/2	33 1/4	34	35 1/4	6	18	34 1/8	–	–	–
		BACK	40 1/2	41 1/4	42	35 1/4	4 1/2	18	32 5/8	–	–	–
38AUZ 08	MCHX	LEFT SIDE	44 1/2	45 1/4	46	35 1/4	6	18	34 1/8	–	–	–
		BACK	40 1/2	41 1/4	42	35 1/4	4 1/2	18	32 5/8	–	–	–
38AUZ 12 38AUD 12	MCHX	LEFT SIDE	44 1/2	45 1/4	46	43 1/8	8 3/8	21 1/4	29	40	–	–
		BACK	40 1/2	41 1/4	42	43 1/8	7 1/8	20	29	38 3/4	–	–
38AUZ 14 38AUD 14	MCHX	LEFT SIDE	44 1/2	45 1/4	46	43 1/8	8 3/8	21 1/4	29	40	–	–
		BACK	40	40 3/4	41 1/2	43 1/8	7 1/8	20	29	38 3/4	–	–
		RIGHT SIDE	24 1/2	25	25 3/4	43 1/8	6 7/8	19 3/4	29	38 1/2	–	–
38AUZ 07 569J*07A CAS072	RTPF	LEFT SIDE	28 1/2	29	29 3/4	35 1/4	1 1/4	9 1/4	17 1/4	25 1/4	33 1/4	–
		BACK	40	40 3/4	41 1/2	35 1/4	4 1/4	11 1/4	18 1/4	25 1/4	32 1/4	–
38AUZ 08 569J*08A CAS091	RTPF	LEFT SIDE	28 1/2	29	29 3/4	35 1/4	1 1/4	9 1/4	17 1/4	25 1/4	33 1/4	–
		BACK	40	40 3/4	41 1/2	35 1/4	4 1/4	11 1/4	18 1/4	25 1/4	32 1/4	–
38AUZ 12 569J*12A CAS121 38AUD 12 569J*12D CAS120	RTPF	LEFT SIDE	40 1/2	41	41 3/4	43 1/8	1 1/4	9 1/4	17 1/4	25 1/4	33 1/4	41 1/4
		BACK	40	40 3/4	41 1/2	43 1/8	4 1/4	11 1/4	18 1/4	25 1/4	32 1/4	39 1/4
38AUZ 14 569J*14A CAS151 38AUD 14 569J*14D CAS150	RTPF	LEFT SIDE	40 1/2	41	41 3/4	43 1/8	1 1/4	9 1/4	17 1/4	25 1/4	33 1/4	41 1/4
		BACK	40	40 3/4	41 1/2	43 1/8	4 1/4	11 1/4	18 1/4	25 1/4	32 1/4	39 1/4
		RIGHT SIDE	25	25 1/2	26 1/4	43 1/8	4 1/4	11 1/4	18 1/4	25 1/4	32 1/4	39 1/4
38AUZ 07 575J 07 CHS072	RTPF	LEFT SIDE	28 1/4	29	29 3/4	35 1/4	1 1/4	9 1/4	17 1/4	25 1/4	33 1/4	–
		BACK	40 1/4	41	41 3/4	35 1/4	4 1/8	11 1/8	18 1/8	25 1/8	32 1/8	–
38AUZ 08 575J 08 CHS091	RTPF	LEFT SIDE	28 1/4	29	29 3/4	35 1/4	1 1/4	9 1/4	17 1/4	25 1/4	33 1/4	–
		BACK	40	40 3/4	41 1/2	35 1/4	4 1/2	18	32 5/8	–	–	–
		RIGHT SIDE	24 3/8	25 1/8	25 7/8	35 1/4	4 1/4	11 1/4	18 1/4	25 1/4	32 1/4	–
38AUZ 12 575J 12 CHS121	RTPF	LEFT SIDE	28 1/4	29	29 3/4	43 1/8	1 1/4	9 1/4	17 1/4	25 1/4	33 1/4	41 1/4
		BACK	40	40 3/4	41 1/2	43 1/8	6 7/8	19 3/4	28 3/4	38 1/2	–	–
		RIGHT SIDE	24 1/4	25 1/8	25 7/8	43 1/8	4 1/4	11 1/4	18 1/4	25 1/4	32 1/4	39 1/4

**Wind Baffle Dimensions (MM)**

DIMENSIONS – MM												
UNIT	COIL TYPE	BAFFLE	A	B	C	D	E	F	G	H	J	K
38AUZ 07	MCHX	LEFT SIDE	826	845	864	895	151	457	865	–	–	–
		BACK	1029	1048	1067	895	113	457	827	–	–	–
38AUZ 08	MCHX	LEFT SIDE	1130	1149	1168	895	151	457	865	–	–	–
		BACK	1029	1048	1067	895	113	457	827	–	–	–
38AUZ 12 38AUD 12	MCHX	LEFT SIDE	1130	1149	1168	1095	212	539	737	1015	–	–
		BACK	1029	1048	1067	1095	180	507	737	983	–	–
38AUZ 14 38AUD 14	MCHX	LEFT SIDE	1130	1149	1168	1095	212	539	737	1015	–	–
		BACK	1016	1035	1054	1095	180	507	737	983	–	–
		RIGHT SIDE	616	635	654	1095	174	501	737	977	–	–
38AUZ 07 569J*07A CAS072	RTPF	LEFT SIDE	718	737	756	895	33	236	439	643	846	–
		BACK	1016	1035	1054	895	107	284	462	640	818	–
38AUZ 08 569J*08A CAS091	RTPF	LEFT SIDE	718	737	756	895	33	236	439	643	846	–
		BACK	1016	1035	1054	895	107	284	462	640	818	–
38AUZ 12 569J*12A CAS121 38AUD 12 569J*12D CAS120	RTPF	LEFT SIDE	1022	1041	1060	1095	33	236	439	643	846	1049
		BACK	1016	1035	1054	1095	107	284	462	640	818	996
38AUZ 14 569J*14A CAS151 38AUD 14 569J*14D CAS150	RTPF	LEFT SIDE	1022	1041	1060	1095	33	236	439	643	846	1049
		BACK	1016	1035	1054	1095	107	284	462	640	818	996
		RIGHT SIDE	629	648	667	1095	107	284	462	640	818	996
38AUQ 07 575J 07 CHS072	RTPF	LEFT SIDE	719	738	757	895	33	236	439	643	846	–
		BACK	1023	1042	1061	895	106	284	461	639	817	–
38AUQ 08 575J 08 CHS091	RTPF	LEFT SIDE	719	738	757	895	33	236	439	643	846	–
		BACK	1016	1035	1054	895	113	457	827	–	–	–
		RIGHT SIDE	618	637	656	895	109	287	465	643	820	–
38AUQ 12 575J 12 CHS121	RTPF	LEFT SIDE	719	738	757	1095	33	236	439	643	846	1049
		BACK	1016	1035	1054	1095	175	502	732	978	–	–
		RIGHT SIDE	618	637	656	1095	109	287	465	643	820	998



## OPERATION

### Fan System Operation with Motormaster

#### Speed Control (Motormaster)

##### General

As low outdoor ambient conditions or reduced condenser loads allow the Saturated Condensing Temperature to approach 100 F (38 C) at the Motormaster temperature sensor location, the Motormaster controller will reduce the outdoor fan motor speed in both outdoor fan motors. The reduction in motor speed reduces the condenser fan air quantity until the condensing temperature decrease is stabilized. While operating in this reduced load range, the Motormaster controller may command motor speeds between full rpm and zero rpm.

##### Cooling, Single Compressor

The unit's two outdoor fans are controlled through compressor contactor C. On a thermostat Y1 call for Cooling, if the CADM anti-recycle timer has expired and compressor operation is permitted, contactor C will be energized and both fan motors will start and speed will ramp up as condenser coil temperature increases.

The unit's Low Pressure Switch is equipped with a bypass time delay relay. On start-up, the time delay relay contacts close for 180 seconds, bypassing the LPS contacts and permitting system operation at cold ambient conditions. At the end of the 180 second period, if LPS contacts are closed, normal system operation continues. If the LPS contacts are still open after the 180 second period, contactor C will open and compressor and outdoor fan motors will stop. Restart will be permitted by CADM when anti-recycle time delay and all conditions allow.

##### Cooling, Dual Circuit

The unit's two outdoor fans are controlled through relay OFR. On a thermostat Y1 call for Cooling, the OFR is energized and Motormaster controller is energized. Until Compressor 1 starts and runs to increase the coil temperature, the two outdoor fan motors will remain at zero rpm. When Compressor 1 runs, the condenser coil temperature at the coil temperature sensor location will increase and the Motormaster will command motor speeds to increase.

The Motormaster controller temperature sensor is mounted on Circuit 1 only. If Circuit 1's compressor operation is not available, then both outdoor fan motors will be ramped down to zero rpm as Circuit 1 coil temperature cools below 80°F (27°C). Circuit 2 operation is not available when Circuit 1 is off.

The unit's Circuit 1 Low Pressure Switch (LPS1) is equipped with a bypass time delay relay. On start-up, the time delay relay contacts close for 180 seconds, bypassing the LPS1 contacts and permitting system operation of Circuit 1 at cold ambient conditions. At the end of the 180 second period, if LPS1 contacts are closed, normal system operation continues. If the LPS1 contacts are still open after the 180 second period, contactor C1 will open and Compressor 1 and outdoor fan motors will stop. Restart will be permitted by CADM1 when anti-recycle time delay and all conditions allow.

### 230,460-v Models

#### Accessory kits built before July 2013

Circuit 2 does not include a bypass time relay at LPS2. Low ambient unit operation is restricted to Circuit 1. If extended operation of Circuit 2 is required to meet space load conditions, purchase accessory package CRWINSTR001A00 and install the time delay relay across LPS2.

#### 230,460-v (Accessory kits built after June 2013)

##### 575-v Models All

Circuit 2 also includes a bypass time relay at LPS2. Low ambient unit operation is available on both Circuit 1 and Circuit 2 when Circuit 1 is operating properly.

##### Heat Pump Models

The heat pump unit's two outdoor fans are controlled through relay OFR with sequence logic from Defrost Board via output OF. Relay Speed Control Bypass (SCB) is energized during Heating to bypass the Motormaster control.

On a thermostat Y1 call for Cooling, the Defrost Board output OF will energize relay OFR; outdoor fan motor operation is enabled. If the CADM anti-recycle timer has expired and compressor operation is permitted, contactor C will be energized, compressor will start and run and condenser coil temperature will increase. Both fan motors will start and speed will ramp up as condenser coil temperature increases, reaching full speed rpm as coil temperature rises above 100 F (38 C).

On a thermostat W1 call for Heating, relay SCB is energized; its contacts bypass the Motormaster output, forcing both fan motors to run at full speed when enabled by OFR position. Defrost Board output OF energizes relay OFR; outdoor fan motors start and run at full speed.

During Heating, a Defrost cycle will cause the Defrost Board output OF to be removed; relay OFR is de-energized and both fan motors will stop for the duration of the Defrost cycle.

# TROUBLESHOOTING

OBSERVATION	POSSIBLE REMEDY
Fans won't start	All fans: Check power & wiring Check outdoor fan relay (OFR) Check speed control sensor location Check speed sensor resistance
Cooling – Slow fan speed for fans at start or during low outdoor ambient	Normal operation
Cooling – Slow fan speed for fans above 85°F (29°F) outdoor ambient (should be full speed)	Check speed control sensor location Check speed control sensor resistance Check fan motor capacitor
Cooling – motor current into speed control is greater than motor name-plate FLA	Normal operation Up to 30% higher amps at partial speed at low ambient

## Speed Control Sensor Resistance

TEMPERATURE		RESISTANCE
°F +/-2°F°	°C +/-1C	Ohms, nominal
-22	-30	88350
-4	-20	48485
14	-10	27650
32	0	16325
50	10	9950
68	20	6245
77	25	5000
86	30	4028
104	40	2663
122	50	1801
140	60	1244
158	70	876