

# RHS

## **Product Specifications**

# ASHRAE 90.1 COMPLIANT PACKAGED ROOFTOP HEAT PUMP UNITS, R-410A, 15 - 20 TONS

## **BUILT TO LAST, EASY TO INSTALL AND SERVICE**

- One-piece electric heating and electric cooling units with a low profile, prewired, tested, and charged at the factory
- Dedicated vertical or horizontal air flow duct configuration models. No field kits required.
- Full perimeter base rail with built-in rigging adapters and fork truck slots
- Pre-painted exterior panels and primer-coated interior panels tested to 500 hours salt spray protection
- Fully insulated cabinet
- Two-stage cooling with independent circuits and control on all models
- Scroll compressors with internal line-break overload protection on all models
- All units have loss of charge, freeze protection and high pressure switches
- Two inch disposable fiberglass type return air filters in dedicated rack with tool–less filter access door
- Liquid line filter drier and refrigerant accumulator on each circuit
- Dependable time/temperature defrost logic provides a defrost cycle, if needed, every 30, 60, 90, or 120 minutes and is adjustable
- Copper round tube and aluminum plate fin condenser and evaporator coils
- Exclusive non-corrosive composite condensate pan in accordance with ASHRAE 62 Standard, sloping design; end drain
- Belt drive evaporator-fan motor and pulley combinations available to meet most applications
- Access panels with easy grip handles provide quick and easy access to the blower and blower motor, control box, and compressors.
- "No-strip" screw system has superior holding power and guides screws into position while
  preventing the screw from stripping the unit's metal.
- Newly designed terminal board facilitates simple safety circuit troubleshooting and simplified control box arrangement
- Outdoor temperature cooling operation range up to 115°F (46°C) and down to 30°F (-1°C)
- Fixed orifice metering devices on all models to precisely control refrigerant flow
- Large, laminated control wiring and power wiring drawings are affixed to unit to make troubleshooting easy
- Standard, medium and high static fan motor options available
- Provisions for thru-the-bottom power entry capability
- · Single point electrical connections

#### **WARRANTY**

- 5 Year compressor limited warranty
- 1 Year parts limited warranty



15 Ton



Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to www.ahridirectory.org.





UNIT PERFORM	UNIT PERFORMANCE DATA – Two Stage Cooling									
			COOLI	NG	HEATIN	NG	Total		Unit	
UNIT	Dedicated Airflow	Nom. Tons	Net Cap. (Btuh)	EER	HighCap. (Btuh)	СОР	Power (kW)	Unit Dimensions H x W x L	Weight lb. [kg]	
RHS181*0AA0AAA	Vertical	15	172,000	10.8	166,000	3.3	14.6	49-3/8" x 86-3/8" x 127-7/8" (1253 x 2194 x 3249)	1775 [807]	
RHS183*0AA0AAA	Horizontal	15	172,000	10.8	166,000	3.3	14.6	49-3/8" x 86-3/8" x 127-7/8" (1253 x 2194 x 3249)	1775 [807]	
RHS240*0AA0AAA	Vertical	20	232,000	10.5	220,000	3.3	20.5	49-3/8" x 86-3/8" x 141-1/2" (1253 x 2194 x 3595)	2100 [955]	
RHS243*0AA0AAA	Horizontal	20	232,000	10.5	220,000	3.3	20.5	49-3/8" x 86-3/8" x 141-1/2" (1253 x 2194 x 3595)	2100 [955]	

\* Indicates Unit voltage: H = 208/230-3-60, L = 460-3-60, S = 575-3-60

NOTE: BASE MODEL NUMBERS LISTED. SEE MODEL NOMENCLATURE LISTING FOR ADDITIONAL OPTIONS

## **TABLE OF CONTENTS**

PAGE	PAGE
MODEL NUMBER NOMENCLATURE	HEATING TABLES
FACTORY OPTIONS AND/OR ACCESSORIES 4	STATIC PRESSURE ADDERS 23
AHRI COOLING/HEATING RATING TABLE	FAN PERFORMANCE
SOUND PERFORMANCE TABLE 8	OUTDOOR AIR INTAKE & EXHAUST PERF 27
PHYSICAL DATA9	ELECTRICAL INFO
ELECTRIC DATA11	MCA / MOCP
CURBS & WEIGHTS DIMENSIONS 12	TYPICAL WIRING DIAGRAMS31
APPLICATION DATA19	SEQUENCE OF OPERATION
COOLING TABLES	GUIDE SPECIFICATIONS

## **MODEL NOMENCLATURE**

MODEL SERIES	R	Н	S	1	8	1	Н	0	Α	В	0	Α	Α	Α
Position Number	1	2	3	4	5	6	7	8	9	10	11	12	13	14
R = Rooftop	•													
H = Heat Pump		<b>.</b>												
A = Air Conditioning (Cooling Only)														
G = Gas/Electric		Type												
S = Standard ASHRAE 90.1-2010 Efficiency		Effi	iciency											
181 = 181,000 = 15 Tons Dedicated Vertical S	SA/RA (S	SA = Sur	oply Air. I	RA = Re	turn Air)									
183 = 180,000 = 15 Tons Dedicated Horizonta			, p. ,, .		,									
240 = 240,000 = 20 Tons Dedicated Vertical S														
243 = 240,000 = 20 Tons Dedicated Horizonta		١												
•			Nor	ninal Co	oling Ca	pacity								
H = 208/230-3-60	_	_	_		_		•							
L = 460-3-60														
S = 575-3-60						'	/oltage							
0 = No Heat														
						He	ating Ca	pacity	J					
A = Standard Option														
B = High Static Option (15 ton only)														
E = High Static Option - High Efficiency Moto	r (20 ton	only)												
C = Medium Static Motor (15 ton only)			,											
F = Medium Static Option - High Efficiency N A = None	lotor (20	ton only	/)					Motor	Option					
B = Economizer w/Bara-relief, OA Temp sens	or													
E = Economizer w/Bara-relief + CO <sub>2</sub> sensor,		n senso	r											
H = Economizer w/Bara-relief, Enthalpy sens		p oonoo	•											
L = Economizer w/Bara-relief + CO <sub>2</sub> sensor,		/ sensor												
P = 2-Position damper w/Baro-relief							Outdoo	r Air Op	tions / (	Control				
0A = No Options											,			
4B = Non-fused Disconnect														
AT = Non-powered 115v Convenience Outlet														
BA = Non-powered 115v Convenience Outlet	. + Supp	oly Air Sr	noke De	tector										
BR = Supply Air Smoke Detector														
7C = Non-fused Disconnect + Non-powered	115v Co	nvenien	ce Outle	t.										
7K = Non-fused Disconnect + Non-powered			ce Outle	t. + Supp	oly Air Sn	oke De	tector							
8A = Non-fused Disconnect + Supply Air Smo	oke Dete	ector							Fac	ctory Ins	stalled C	ptions		
A = RTPF Alum / Copper Cond & Alum / Copp														
B = Pre-coated Alum / Copper Cond & Alum		-												
C = E-Coated Alum / Copper Cond, Alum / C		-												
D = E-Coated Alum / Copper Cond & E-Coat		ı / Coppe	er Evap											
E = Copper / Copper Cond & Alum / Copper E	-							_		_				
F = Copper / Copper Cond & Copper / Coppe	r Evap							Cond	ienser /	Evapora	ator Coil	Configu	ıration	
A = Original Design													Sale	s Digit

Table 1 - FACTORY INSTALLED OPTIONS AND FIELD INSTALLED ACCESSORIES

CATEGORY	ITEM	FACTORY INSTALLED OPTION	FIELD INSTALLED ACCESSORY
Cabinet	Dedicated Vertical Air Flow Duct Configuration	Х	
Cabillet	Dedicated Horizontal Air Flow Duct Configuration	Х	
	Cu/Cu (indoor and outdoor) coils	X	
Coil Options	E-coated (indoor & outdoor) coils	Х	
	Pre-coated (indoor & outdoor) coils	Х	
Condenser Protection	Condenser coil hail guard (louvered design)	Х	X
	Smoke detector (supply air)	X	
Controls	Time Guard II compressor delay control circuit		X
	Phase Monitor		X
	EconoMi\$er IV (for electro-mechanical controlled RTUs)	X	X
	Motorized 2 position outdoor-air damper	X	X
Economizers & Outdoor Air	Manual outdoor-air damper (25%)		X
Dampers	Barometric relief <sup>1</sup>	X	X
Dampere	Power exhaust		X
	Barometric relief hood (Horizontal economizer only)		X
	Single dry bulb temperature sensors <sup>2</sup>	X	X
<b>5</b>	Differential dry bulb temperature sensors <sup>2</sup>		X
Economizer Sensors & IAQ Devices	Single enthalpy sensors <sup>2</sup>	X	X
a lad Devices	Differential enthalpy sensors <sup>2</sup>		X
	CO <sub>2</sub> sensor (wall, duct, or unit mounted) <sup>3</sup>	X	X
Electric Heat	Electric Heaters		X
Electric neat	Single Point Kit		X
Indoor Motor & Drive	Multiple motor and drive packages	X	
Low Ambient Control	Motormaster head pressure controller <sup>3</sup>		X
Power	Convenience outlet (unpowered)	X	
Options	Non-fused disconnect	X	
Roof Curbs	Roof curb 14-in (356mm)		X
nooi cuibs	Roof curb 24-in (610mm)		X

## NOTES:

- Included with economizer.
   Sensors used to optimize economizer performance.
   See application data for assistance.

## **FACTORY OPTIONS AND/OR ACCESSORIES**

#### Economizer (dry-bulb or enthalpy)

Economizers save money. They bring in fresh, outside air for ventilation; and provide cool, outside air to cool your building. This is the preferred method of low-ambient cooling. When coupled to  $\mathrm{CO}_2$  sensors, Economizers can provide even more savings by coupling the ventilation air to only that amount required.

Economizers are available, installed and tested by the factory, with either enthalpy or dry-bulb temperature inputs. There are also models for electromechanical as well as direct digital controllers. Additional sensors are available as accessories to optimize the economizers.

Economizers include gravity controlled, barometric relief equalizes building pressure and ambient air pressures. This can be a cast effective solution to prevent building pressurization. If further control of exhaust air is required, a dual centrifugal fan power exhaust system is also available.

## CO<sub>2</sub> Sensor

Improves productivity and saves money by working with the economizer to intake only the correct amount of outside air for ventilation. As occupants fill your building, the  $\rm CO_2$  sensor detects their presence through increasing  $\rm CO_2$  levels, and opens the economizer appropriately.

When the occupants leave, the  ${\rm CO_2}$  levels decrease, and the sensor appropriately closes the economizer. This intelligent control of the ventilation air, called Demand Control Ventilation (DCV) reduces the overall load on the rooftop, saving money.

#### **Smoke Detectors**

Smoke detectors make your application safer and your job easier. Smoke detectors immediately shut down the rooftop unit when smoke is detected. They are available, installed by the factory for supply air.

## **Louvered Hail Guards**

Sleek, louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact.

### Convenience Outlet (un-powered)

Reduce service and/or installation costs by including a convenience outlet in your specification. Installed at the factory, this feature provides a convenient, 15 amp, 115v GFCI receptacle with "Wet in Use" cover. The "unpowered" option is to be powered from a separate 115/120v power source.

### Non-Fused Disconnect

This OSHA-compliant, factory-installed, safety switch allows a service technician to locally secure power to the rooftop.

#### **Power Exhaust with Barometric Relief**

Superior internal building pressure control. This field-installed accessory or factory-installed option may eliminate the need for costly, external pressure control fans.

#### **Time Guard II Control Circuit**

This accessory protects your compressor by preventing short-cycling in the event of some other failure, prevents the compressor from restarting for 30 seconds after stopping.

#### Filter or Fan Status Switches

Use these differential pressure switches to detect a filter clog or indoor fan motor failure. When used in conjunction with a compatible unit controller/thermostat, the switches will activate an alarm to warn the appropriate personnel.

### **Motorized 2-Position Damper**

The 2-position, motorized outdoor air damper admits up to 100% outside air. Using reliable, gear-driven technology, the 2-position damper opens to allow ventilation air and closes when the rooftop stops, stopping unwanted infiltration.

#### **Manual OA Damper**

Manual outdoor air dampers are an economical way to bring in ventilation air. The dampers are available in 25% versions.

### **Motormaster Head Pressure Controller**

The Motormaster motor controller is a low ambient, head pressure controller kit that is designed to maintain the unit's condenser head pressure during periods of low ambient cooling operation. This device should be used as an alternative to economizer free cooling not when economizer usage is either not appropriate or desired. The Motormaster will either cycle the outdoor–fan motors or operate them at reduced speed to maintain the unit operation, depending on the model.

### **Alternate Motors and Drives**

Some applications need larger horsepower motors, some need more airflow, and some need both. A wide selection of motors and pulleys (drives) are available, factory installed, to handle nearly any application.

## **Electric Heaters / Single Point Kit**

A full-line of field-installed accessory heaters and single point kits are available.

#### **Barometric Hood**

For Horizontal Economizer applications where relief damper is installed in duct work. This kit provides the needed protection.

## **ACCESSORIES - RHS181-243**

FLAT ROOF CURB	\$	
Model Number	Description	Use With Model Size
CDDECLIDDO45A00	14" High Roof Curb * Vertical and Horizontal Economizer IV with solid	101/102
CRRFCURB045A00	state controller, gear driven, modulating damper, spring return actu-	181/183
CRRFCURB047A00	ator, up to 100% barometric relief, supply and outdoor air sensors	240/242
ChnFCUhbu4/Auu	and outdoor air hood. CO2 sensor compatible.	240/243
CRRFCURB046A00	24" High Roof Curb * Vertical and Horizontal Economizer IV with solid	101/102
CRRFCURBU40AUU	state controller, gear driven, modulating damper, spring return actu-	181/183
CRRFCURB048A00	ator, up to 100% barometric relief, supply and outdoor air sensors	240/243
CRRFCURBU48AUU	and outdoor air hood. CO2 sensor compatible.	240/243
ECONOMIZERS		
Model Number	Description	Use With Model Size
DNECOMZR052A00	Vertical & Horizontal with solid state controller	181/183 – 240/243
Note: Barometric relief	must be installed in return ductwork on horizontal configured models (183, 243)	
BARAMETRIC REL		
Model Number	Description	Use With Model Size
	Barometric Hood – For Horizontal Economizer applications where relief	Horizontal Economizers
CRBARHOD001A00	damper is installed in duct work, This kit provides the needed protection.	(183 – 243)
ECONOMIZER SEN		,
Model Number	Description	Use With Model Size
DNTEMPSN002A00	Single (dry bulb) Control	ALL Economizers
DNCBDIOX005A00	CO2 Sensor and aspirator box for use in return airstream.	ALL Economizers
DNODDIOX003A00	Return Air Enthalpy Sensor (Use with AXB078ENT for differential enthalpy	ALL LCOHOMIZERS
DNENTDIF004A00	control	ALL Economizers
AXB078ENT	Enthalpy Control	ALL
POWER EXHAUST		
Model Number	Description	Use With Model Size
CRPWREXH068A00	Vertical and Horizontal, 208/230–3–60	181/183 – 240/243
CRPWREXH069A00	Vertical and Horizontal, 460–3–60	181/183 – 240/243
CRPWREXH070A00	Vertical and Horizontal, 575–3–60	181/183 – 240/243
MANUAL OUTDOO		
		Lloc With Model Size
Model Number	Description  25% Open Manual Fresh Air Damper	Use With Model Size 181/183 - 240/243
		181/183 – 240/243
MOTORIZED OUT	OOOR AIR DAMPERS	
Model Number	Description	Use With Model Size
CRTWOPOS012A00	Motorized 2 position outdoor air damper	181/183 – 240/243
LOW AMBIENT CO	NTROLS	
Model Number	Description	Use With Model Size
CRLOWAMB041A00	Motormaster® I –20° Low Ambient Control 208/230–3–60	181/183 - 240/243
CRLOWAMB042A00	Motormaster® I –20° Low Ambient Control 460–3–60, 575–3–60	181/183 – 240/243
CRTRXKIT001A00	Motormaster® I –20° Transformer 575–3–60 <sup>1</sup>	181/183 – 240/243
CONTROL UPGRA	DE KITS	
Model Number	Description	Use With Model Size
NRTIMEGD001A00	Time Guard II	181 – 243
CRSDTEST001A00	Smoke detector remote Test/Reset/Alarm indicator kit	181 – 243
CRPHASE3001A02	Electronic Phase Monitor – All 208/230/460–3–60 models	181 – 243
CRPHASE3002A00	Electronic Phase Monitor – All 575–3–60 models	181 – 243
CRSTATUS005A00	Fan/filter Status Switch – Indicator light not included	181 – 243
CRSMKSEN002A00	Smoke Detector Control Module	181 – 243
	Smoke Detector Control Module (Smoke Detector Sensor with sampling	
CRSMKKIT002A00	tube & exhaust tube)	181 – 243

<sup>\*</sup> When power exhaust is used on horizontal applications, it must be field mounted to the side of the return duct.

 $<sup>^{1}</sup>$  Must use in conjunction with CRLOWAMB042A00 if used on 575–3–60 models.

<sup>&</sup>lt;sup>2</sup> This control allows mechanical cooling operation down to 30° F (-1° degrees C). If mechanical cooling below 25° F (-4° C) is necessary, consider low ambient control measures such as MotorMaster or economizer.

## ACCESSORIES - RHS181-243 (cont.)

Model Number	Description	Use With Model Size
CRFLTTRK001A00	4" Field Conversion Kit	181 – 243
OUVERED HAIL GUA	RDS	
Model Number	Description	Use With Model Size
CRLVHLGD017A00	Louvered Condenser Coil Hail Guard	181/183
CRLVHLGD018A00	Louvered Condenser Coil Hail Guard	240/243
LECTRIC HEAT - HO	RIZONTAL DUCT CONFIGURATION	
Model Number	Nominal kW	Use With Model Size
CRHEATER270A00	25.0	
CRHEATER271A00	50.0	All Horizontal Duct 208/230v Model
CRHEATER272A00	75.0	
CRHEATER273A00	25.0	
CRHEATER274A00	50.0	All Horizontal Duct 460v Models
CRHEATER275A00	75.0	
CRHEATER276A00	24.8	
CRHEATER277A00	49.6	All Horizontal Duct 575v Models
CRHEATER278A00	74.4	
LECTRIC HEAT - VEF	RTICAL DUCT CONFIGURATION	
Model Number	Nominal kW	Use With Model Size
CRHEATER279A00	25.0	
CRHEATER280A00	50.0	All Vertical Duct 208/230v Models
CRHEATER281A00	75.0	
CRHEATER282A00	25.0	
CRHEATER283A00	50.0	All Vertical Duct 460v Models
CRHEATER284A00	75.0	
CRHEATER285A00	24.8	
CRHEATER286A00	49.6	All Vertical Duct 575v Models
CRHEATER287A00	74.4	
INGLE POINT CONNE	CTION KIT	
Model Number	Description	Use With Electric Heater
	Single Point Connection for 208/230V Heaters	CRHEATER270-272A00 CRHEATER279-281A00
CRSINGLE056A00		CRHEATER273-278A00

#### Table 2 – AHRI COOLING / HEATING RATING TABLES

	COOLING MODE - 2 STAGE						
MODEL RHS	COOLING STAGES	NOMINAL CAPACITY (TONS)	NET COOLING CAPACITY (BTUH)	TOTAL POWER (kW)	IEER	EER	
181 – 183	2	15	172,000	14.6	11.5	10.8	
240 – 243	2	20	232,000	20.5	11.3	10.5	

	HEATING MODE							
Heating, Low Heating, High (BTUH)								
MODEL RHS	Capacity (BTUH)	СОР	Capacity (BTUH)	СОР				
181 – 183	103,000	2.4	166,000	3.3				
240 – 243	134,000	2.3	220,000	3.3				

#### **LEGEND**

COP

**EER** 

**IEER** 

AHRI – Air-Conditioning, Heating & Refrigeration Institute

ASHRAE - American Society of Heating, Refrigerating

and Air Conditioning, Inc.

- Coefficient of performance

- Energy Efficiency Ratio

- Integrated Energy Efficiency







Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to www.ahridirectory.org.

## NOTES:

- 1. Rated and certified under AHRI Standard 340/360-04, as appropriate.
- 2. Ratings are based on:

**Cooling Standard:** 80°F (27°C) db, 67°F (19°C) wb indoor air temp and 95°F (35°C) db outdoor air temp.

**IPLV Standard**: 80°F (27°C) db, 67°F (19°C) wb indoor air temp and 80°F (27°C) db outdoor air temp.

- 3. All RHS units comply with ASHRAE 90.1 2001, 2004 Energy Standard for minimum SEER and EER requirements.
- 4. RHS units comply with US Energy Policy Act (2005). To evaluate code compliance requirements, refer to state and local codes or visit the following website: http://bcap-energy.org to determine if compliance with this standard pertains to your state, territory, or municipality.

## Table 3 - SOUND PERFORMANCE TABLE

						Outdoor Sc	ound (dB)				
MODEL RHS	COOLING STAGES	A-Wtg.	AHRI 370 Rating	63	125	250	500	1000	2000	4000	8000
181 – 183	2	84.1	84	92.2	83.9	80.4	81.8	78.7	76.5	72.2	65.4
240 – 243	2	86.5	87	95.6	87.5	84.2	84.2	81.7	77.9	73.2	66.3

### **LEGEND**

dB - Decibel

## NOTES:

- 1. Outdoor sound data is measured in accordance with AHRI standard 270–2008.
- Measurements are expressed in terms of sound power. Do not compare these values to sound pressure values because sound pressure depends on specific environmental factors which normally do not match individual applications. Sound power values are independent of the environment and therefore more accurate.
- 3. A-weighted sound ratings filter out very high and very low frequencies, to better approximate the response of "average" human ear. A-weighted measurements are taken in accordance with AHRI standard 270–2008.

## Table 4 - PHYSICAL DATA (COOLING) 15 - 20 TONS

UNIT	RHS	181/183	240/243
Refrigeration Sys		101/100	240/240
Tremgeration by	# Circuits / # Comp. / Type	2 / 2 / Scroll	2 / 2 / Scroll
	R-410a charge A/B (lbs)	16.0/16.5	23.4/23.4
		•	630 / 505
	High-press. Trip / Reset (psig)	630 / 505	*
	Low-press. Trip / Reset (psig)	24 / 45	24 / 45
	Compressor Capacity Staging (%)	50 / 100	50 / 100
Evap. Coil			
Material		Cu / Al	Cu / Al
Tube Diameter		3/8-in	3/8-in
Rows / FPI		3 / 15	4 / 15
Total face area (ft2	2)	19.56	22.00
Condensate drain		3/4-in	3/4-in
Condensate drain	COMM. SIZE	5/4 111	5/4 111
Evap. fan and mo	otor		
	Motor Oty / Drive to a	4 / Dali	4 / Dall
ttic	Motor Qty / Drive type	1 / Belt	1 / Belt
Standard Static	Max BHP	2.2	4.9
rd	RPM range	518–713	676–819
gpu	Motor frame size	56	56
Stal	Fan Qty / Type	2 / Centrifugal	2 / Centrifugal
0,	Fan Diameter (in)	15 x 15	15 x 15
0	Motor Qty / Drive type	1 / Belt	n/a
Medium Static	Max BHP	3.3	n/a
S	RPM range	700–876	n/a
<u>ii</u>	Motor frame size	56	n/a
Vec	Fan Qty / Type	2 / Centrifugal	n/a
	Fan Diameter (in)	15 x 15	n/a
	Motor Qty / Drive type	1 / Belt	n/a
O	Max BHP	4.9	n/a
itati	RPM range	836-1049	n/a
High Static	Motor frame size	56	n/a
H jë	Fan Qty / Type	2 / Centrifugal	n/a
	Fan Diameter (in)	15 x 15	n/a
	Motor Qty / Drive type	n/o	1 / Belt
ti:	Max BHP	n/a	6.5
Sta 		n/a	
Medium Static High Eff*	RPM range	n/a	814–1008
Hig	Motor frame size	n/a	184T
Δe	Fan Qty / Type	n/a	2 / Centrifugal
	Fan Diameter (in)	n/a	15 x 15
	Motor Qty / Drive type	n/a	1 / Belt
₩ ∰	Max BHP	n/a	8.7
High Static	RPM range	n/a	965–1170
dgi	Motor frame size	n/a	213T
ヺ゙ヹ	Fan Qty / Type	n/a	2 / Centrifugal
	Fan Diameter (in)	n/a	15 x 15
* 0 " 000 1" 5		(EISA 2007) mandates that the officiency of general	

<sup>\*</sup> Section 313 of the Energy Independence and Security Act of 2007 (EISA 2007) mandates that the efficiency of general purpose motors we use in our Light Commercial Rooftops rated at 5.0 HP and larger be increased on or after December 19, 2010.

## TABLE 4 - PHYSICAL DATA (COOLING) 15 - 20 TONS (CONT.)

	UNIT: RHS	181/183	240/243
HORIZONTAL			
	Motor Qty / Drive type	1 / Belt	1 / Belt
Standard Static	Max BHP	2.2	4.9
<u>5</u>	RPM range	518-713	676–819
larc	Motor frame size	56	56
anc	Fan Qty / Type	2 / Centrifugal	2 / Centrifugal
Ø.	Fan Diameter (in)	18 x 15/15 X 11	18 x 15/15 X 11
	Motor Qty / Drive type	1 / Belt	n/a
atic	Max BHP	3.3	n/a
200	RPM range	518-733	n/a
in in	Motor frame size	56	n/a
Medium Static	Fan Qty / Type	2 / Centrifugal	n/a
2	Fan Diameter (in)	18 x 15/15 X 11	n/a
	Motor Qty / Drive type	1 / Belt	n/a
Ë	Max BHP	4.9	n/a
High Static	RPM range	693-870	n/a
db ;	Motor frame size	56	n/a
Ī	Fan Qty / Type	2 / Centrifugal	n/a
	Fan Diameter (in)	18 x 15/15 X 11	n/a
0	Motor Qty / Drive type	n/a	1 / Belt
* tat	Max BHP	n/a	6.5
Medium Static High Eff*	RPM range	n/a	814–1008
ligh	Motor frame size	n/a	184T
79V	Fan Qty / Type	n/a	2 / Centrifugal
2	Fan Diameter (in)	n/a	15 x 15
	Motor Qty / Drive type	n/a	1 / Belt
. <u>o</u> *	Max BHP	n/a	8.7
Stat	RPM range	n/a	965–1170
High Static	Motor frame size	n/a	213T
풀 포	Fan Qty / Type	n/a	2 / Centrifugal
	Fan Diameter (in)	n/a	15 x 15
Cond. Coil (Circuit A)			
	Coil type	RTPF	RTPF
	Coil Length (in)	70	82
	Coil Height (in)	44	44
	Rows / FPI Total face area (ft2)	2 Rows / 17 FPI 21.4	2 Rows / 17 FPI 25.1
Cond. Coil (Circuit B)			
	Coil type	RTPF	RTPF
	Coil Leight (in)	70	82
	Coil Height (in)	44 2 Pows / 17 EDI	44 2 Pows / 17 EDI
	Rows / FPI Total face area (ft2)	2 Rows / 17 FPI 21.4	2 Rows / 17 FPI 25.1
Cond. fan / motor			
,	Qty / Motor drive type	3 / direct	4 / direct
	Motor HP / RPM	1/4 / 1100	1/4 / 1100
	Fan diameter (in)	22	22
Filters			
	RA Filter # / size (in)	6 / 20 x 25 x 2	6 / 20 x 25 x 2
	OA inlet screen # / size (in)	4 / 16 x 25 x 1	4 / 16 x 25 x 1

RTPF - Round tube / plate fin design

<sup>\*</sup> Section 313 of the Energy Independence and Security Act of 2007 (EISA 2007) mandates that the efficiency of general purpose motors we use in our Light Commercial Rooftops rated at 5.0 HP and larger be increased on or after December 19, 2010.

Table 5 - ELECTRIC HEAT - ELECTRICAL DATA 15 - 20 TONS


UNIT RHS	NOM. V—PH—HZ	IFM TYPE	VERTICAL ELECTRIC HEATER PART NUMBER CRHEATER	HORIZONTAL ELECTRIC HEATER PART NUMBER CRHEATER	NOMINAL (KW)	APPLICATION (KW)	APPLICATION OUTPUT (MBH
			279A00	270A00	25.0	18.8/23.0	64.1/78.3
		STD	280A00	271A00	50.0	37.6/45.9	128.1/156.7
			281A00	272A00	75.0	56.3/68.9	192.2/235.0
			279A00	270A00	25.0	18.8/23.0	64.1/78.3
	208/230-3-60	MED	280A00	271A00	50.0	37.6/45.9	128.1/156.7
			281A00	272A00	75.0	56.3/68.9	192.2/235.0
			279A00	270A00	25.0	18.8/23.0	64.1/78.3
	HIGH	280A00	271A00	50.0	37.6/45.9	128.1/156.7	
		281A00	272A00	75.0	56.3/68.9	192.2/235.0	
			282A00	273A00	25.0	23.0	78.3
		STD	283A00	274A00	50.0	45.9	156.7
		0.2	284A00	275A00	75.0	68.9	235.0
			282A00	273A00	25.0	23.0	78.3
81/183	460-3-60	60 MED	283A00	274A00	50.0	45.9	156.7
51,100	-00-0-00		284A00	275A00	75.0	68.9	235.0
			282A00	273A00	25.0	23.0	78.3
		HIGH	283A00	274A00	50.0	45.9	156.7
		HIGH	284A00	275A00	75.0	68.9	235.0
			285A00	276A00	24.8	22.8	77.7
		STD	286A00	277A00	49.6	45.6	155.4
		310				68.3	233.1
			287A00	278A00	74.4 24.8	22.8	77.7
	575 0 00	MED	285A00	276A00			
	575-3-60		286A00	277A00	49.6	45.6	155.4
			287A00	278A00	74.4	68.3	233.1
		=	285A00	276A00	24.8	22.8	77.7
		HIGH	286A00	277A00	49.6	45.6	155.4
			287A00	278A00	74.4	68.3	233.1
			279A00	270A00	25.0	18.8/23.0	64.1/78.3
		STD	280A00	271A00	50.0	37.6/45.9	128.1/156.7
		MED-High Eff	281A00	272A00	75.0	56.3/68.9	192.2/235.0
	_		279A00	270A00	25.0	18.8/23.0	64.1/78.3
	208/230-3-60		280A00	271A00	50.0	37.6/45.9	128.1/156.7
			281A00	272A00	75.0	56.3/68.9	192.2/235.0
			279A00	270A00	25.0	18.8/23.0	64.1/78.3
		Eff	280A00	271A00	50.0	37.6/45.9	128.1/156.7
			281A00	272A00	75.0	56.3/68.9	192.2/235.0
			282A00	273A00	25.0	23.0	78.3
		STD	283A00	274A00	50.0	45.9	156.7
			284A00	275A00	75.0	68.9	235.0
			282A00	273A00	25.0	23.0	78.3
240/243	460-3-60	MED-High Eff	283A00	274A00	50.0	45.9	156.7
			284A00	275A00	75.0	68.9	235.0
		HIGH-High	282A00	273A00	25.0	23.0	78.3
		Eff	283A00	274A00	50.0	45.9	156.7
			284A00	275A00	75.0	68.9	235.0
			285A00	276A00	24.8	22.8	77.7
		STD	286A00	277A00	49.6	45.6	155.4
			287A00	278A00	74.4	68.3	233.1
			285A00	276A00	24.8	22.8	77.7
	575-3-60	MED-High Eff	286A00	277A00	49.6	45.6	155.4
			287A00	278A00	74.4	68.3	233.1
			285A00	276A00	24.8	22.8	77.7
		HIGH-High	286A00	277A00	49.6	45.6	155.4
		Eff	287A00	278A00	74.4	68.3	233.1

LEGEND

APP PWR - 208 / 230V / 460V / 575V NOM PWR - 240V / 480V / 600V IFM - Indoor Fan Motor


NOTE: Must use accessory single point electrical connection kit. See page 7 for usage information.

## **BASE UNIT DIMENSIONS - RHS181/183**

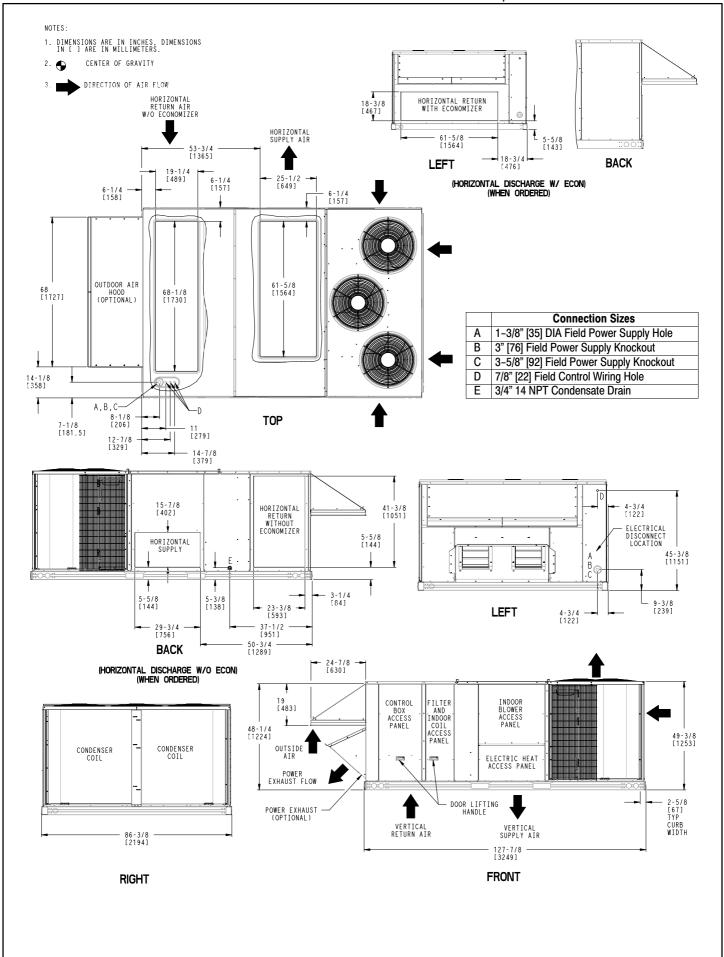

## WEIGHT & DIMENSIONS - RHS181/183 (cont.)

UNIT	BASE WEI			ner ight A	Cor Wei E		Cor Wei		Cor Wei		C	Center of Gravity In [mm]	
RHS	LBS	KG	LBS	KG	LBS	KG	LBS	KG	LBS	KG	X	Υ	Z
15 Ton	1775	807	479	218	364	166	403	183	530	241	45-1/4 [1149]	55-1/4 [1403]	16-1/2 [419]

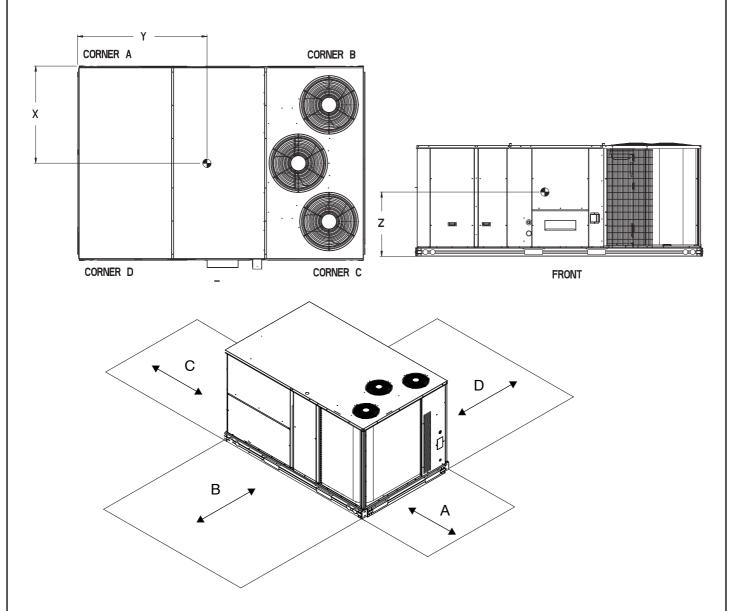


LOC	DIMENSION	CONDITION
	48 in. (1219 mm)	Unit disconnect is mounted on panel
.	18 in. (457 mm)	No disconnect, convenience outlet option
Α	18 in. (457 mm)	Recommended service clearance
	12 in. (305 mm)	Minimum clearance
	42 in. (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall)
В	36 in. (914 mm)	Surface behind servicer is electrically non-conductive (eg., wood, fiberglass)
	Special	Check for sources of flue products within 10 ft. of unit fresh air intake hood
С	36 in. (914 mm)	Side condensate drain is used
	18 in. (457 mm)	Minimum clearance
_	42 in. (1067 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall, another unit)
D	36 in. (914 mm)	Surface behind servicer is electrically non-conductive (eg., wood, fiberglass)

## **ROOF CURB DETAILS - RHS181/183**


## NOTES: Roofcurb accessory is shipped disassembled. Dimensions in. [] in millimeters. RoofCurb Accessory Unit Size CRRFCURB045A01 1' 2 " [356] 3. Roofcurb galvanized steel. RHS181/183 CRRFCURB046A01 2' 0" [610] 4. Attach ductwork to curb (Flanges of duct rest on curb) 5. Service clearance 4' on each side. Direction of airflow. 2'-3-7/8" [708.4] (INSIDE) FRONT 1'-2-7/8" - [377.5] SUPPLY AIR OPENING BACK 0'-4-5/16" [110.2] REF 0'-3-3/4" 4'-2" [1269.5] ROOF CURB 2'-0-1/16" [611.1] REF RETURN AIR OPENING RETURN END 0'-2-15/16" 0'-1/4" - .28°7 [5.9] OPENING FOR THRU THE BASE ELECTRICAL SERVICE ROOF CURB 6'-8-5/8" [2047.8] (OUTSIDE) MAX CURB LEVELING TOLERANCES GASKET (SUPPLIED WITH CURB) 0'-7/16" [11] - COUNTER FLASHING (FIELD SUPPLIED) -ROOFING FELT (FIELD SUPPLIED) CANT STRIP (FIELD SUPPLIED) ROOFING MATERIAL (FIELD SUPPLIED) RIGID INSULATION (FIELD SUPPLIED) RETURN AIR SUPPLY AIR 1'-7-1/4" [489.0] TYPICAL 4 SIDES Accessory Wire Coil Guard Not Available -see detail A SEE DETAIL B 0' 0 1/2" [12.9] ALL FLANGES 1-1/4" [31] 0'-0-1/4" [6.2] INSULATED PANS (MINIMUM 18 GAUGE STEEL) WITH 1/2 INCH NEOPRENE INSULATION DETAIL Å SCALE 1:2 TYP FRONT AND BACK DETAIL B SCALE 1:2 TYP BOTH ENDS


## **BASE UNIT DIMENSIONS - RHS240/243**

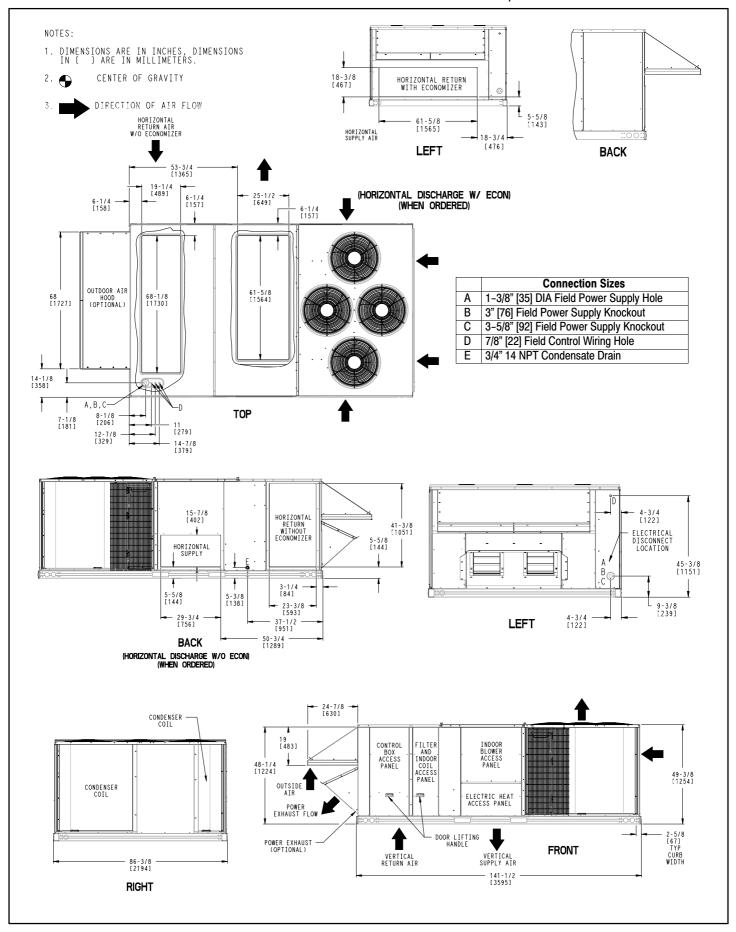

## **WEIGHT & CLEARANCE DIMENSIONS - RHS240/243 (cont.)**


	Un Wei		Cor Weigl	ner ht (A)	Cori Weigh		Cor Weigh		Cori Weigh		Center of Gravity In [mm]			
UNIT	Lb	Kg	Lb	Kg	Lb	Kg	Lb	Kg	Lb	Kg	Х	Z		
20 Ton	2100	955	534	243	517	235	516	235	533	242	43-1/8 [1092]	69-1/2 [1765]	16-1/2 [419]	

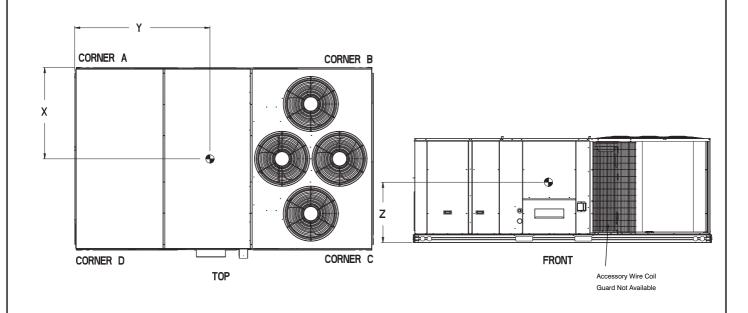

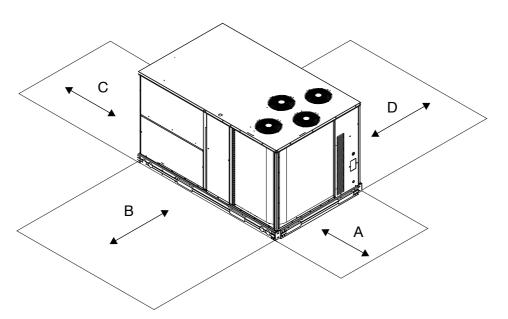

LOC	DIMENSION	CONDITION
А	48 in. (1219 mm) 18 in. (457 mm) 18 in. (457 mm) 12 in. (305 mm)	Unit disconnect is mounted on panel No disconnect, convenience outlet option Recommended service clearance Minimum clearance
В	42 in. (1067 mm) 36 in. (914 mm) Special	Surface behind servicer is grounded (e.g., metal, masonry wall) Surface behind servicer is electrically non—conductive (eg., wood, fiberglass) Check for sources of flue products within 10 ft. of unit fresh air intake hood
С	36 in. (914 mm) 18 in. (457 mm)	Side condensate drain is used Minimum clearance
D	42 in. (1067 mm) 36 in. (914 mm)	Surface behind servicer is grounded (e.g., metal, masonry wall, another unit) Surface behind servicer is electrically non—conductive (eg., wood, fiberglass)

## **ROOF CURB DETAILS - RHS240/243**

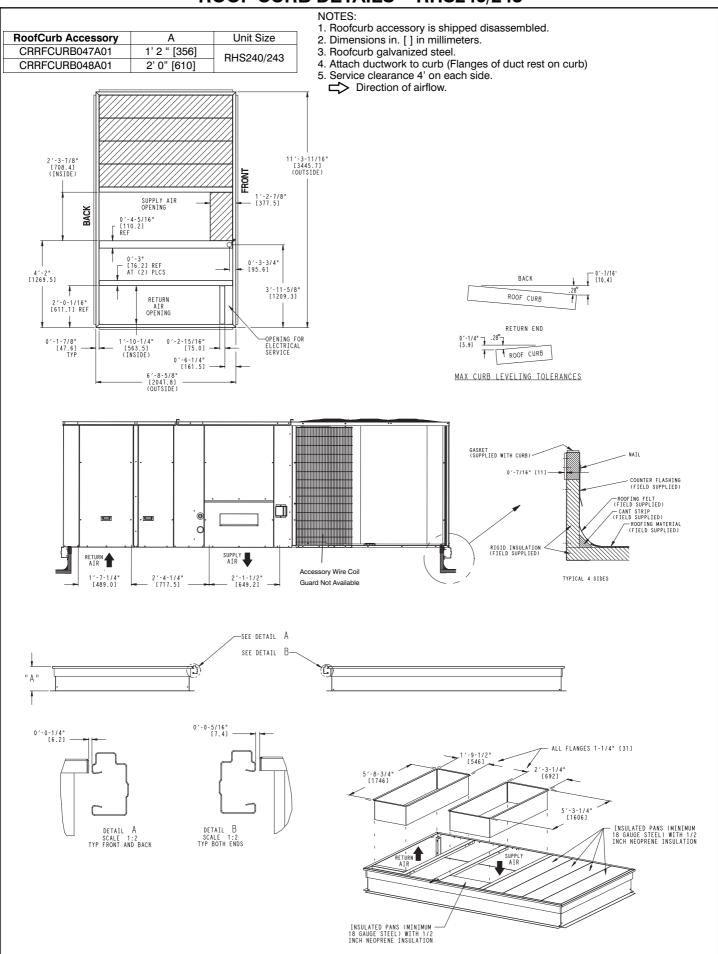

## **OPTIONS AND ACCESSORIES WEIGHT ADDERS**

BASE UNIT WITH OPTIONS AND		MAX WEI	GHT ADD	
ACCESSORIES	RHS18	81/183	RHS2	40/243
(Weight Adders)	lb	kg	lb	kg
Power Exhaust	125	57	125	57
Economizer	170	77	170	77
Copper Tube/Fin Evaporator Coil	110	50	135	61
Roof Curb (14 inch)	240	109	240	109
Roof Curb (24 inch)	340	154	340	154
Louvered Hail Guard	60	27	120	54
CO <sub>2</sub> sensor	5	2	5	2
Supply Smoke Detector	5	2	5	2
Fan/Filter Status Switch	2	1	2	1
Non-Fused Disconnect	15	7	15	7
Non-Powered Convenience outlet	5	2	5	2
Enthalpy Sensor	2	1	2	1
Differential Enthalpy Sensor	3	1	3	1
Two Position Motorized Damper	50	23	50	23
Manual Damper	35	16	35	16
4-in Field Filter Track	12	5	12	5
MotorMaster Controller	35	16	35	16
Medium Static Motor/Drive	5	2	6	3
High Static Motor/Drive	11	5	16	7

**NOTE**: Where multiple variations are available, the heaviest combination is listed.

## APPLICATION DATA

### Min operating ambient temp (cooling):

In mechanical cooling mode, your rooftop can safely operate down to an outdoor ambient temperature of  $30\,^{\circ}\text{F}$  (–1 $^{\circ}\text{C}$ ). It is possible to provide cooling at lower outdoor ambient temperatures by using less outside air, economizers, and/or accessory low ambient kits.

### Max operating ambient temp (cooling):

The maximum operating ambient temperature for cooling mode is 115°F (46°C). While cooling operation above 115°F (46°C) may be possible, it could cause either a reduction in performance, reliability, or a protective action by the unit's internal safety devices.

### Min and max airflow (cooling mode):

To maintain safe and reliable operation of your rooftop, operate within the cooling airflow limits. Operating above the max may cause blow-off, undesired airflow noise, or airflow related problems with the rooftop unit. Operating below the min may cause problems with coil freeze-up.

#### Airflow:

All units are draw-though in cooling mode.

### Outdoor air application strategies:

Economizers reduce operating expenses and compressor run time by providing a free source of cooling and a means of ventilation to match application changing needs. In fact, they should be considered for most applications. Also, consider the various economizer control methods and their benefits, as well as sensors required to accomplish your application goals.

## Motor limits, break horsepower (BHP):

Due to the internal unit design, air path, and specially designed motors, the full horsepower (maximum continuous BHP) band, as listed in the Physical Data, can be used with the utmost confidence.

#### Sizing a rooftop

Bigger isn't necessarily better. While an air conditioner needs to have enough capacity to meet the load, it doesn't need excess capacity. In fact, having excess capacity typically results in very poor part load performance and humidity control.

Using higher design temperatures than ASHRAE recommends for your location, adding "safety factors" to the calculated load, and rounding up to the next largest unit, are all signs of oversizing air conditioners. Oversizing can cause short-cycling, and short cycling leads to poor humidity control, reduced efficiency, higher utility bills, drastic indoor temperature swings, excessive noise, and increased wear and tear on the air conditioner.

Rather than oversizing an air conditioner, wise contractors and engineers "right-size" or even slightly undersize air conditioners. Correctly sizing an air conditioner controls humidity better; promotes efficiency; reduces utility bills; extends equipment life, and maintains even, comfortable temperatures.

#### Low ambient applications

When equipped with an economizer, your rooftop unit can cool your space by bringing in fresh, cool outside air. In fact, when so equipped, accessory low-ambient kit may not be necessary. In low ambient conditions, unless the outdoor air is excessively humid or contaminated, economizer-based "free cooling" is the preferred less costly and energy conscious method.

In low ambient applications where outside air might not be desired (such as contaminated or excessively humid outdoor environments), the rooftop can operate to ambient temperatures down to -20°F (-29°C) using the recommended accessory Motormaster low ambient controller.

Table 6 – COOLING CAPACITIES 15 TONS (2 Stage Cooling)

								AMBIE	NT TEN	IPERATUF	RE		- <i>.</i>		
	ВΠ	C101/-	102		85			95			105			115	
	КΠ	S181/1	163		EA (db)			EA (db)			A (db)			EA (db)	
				75	80	85	75	80	85	75	80	85	75	80	85
		58	TC	152.7	153.6	161.2	145.9	147.8	155.6	138.8	141.9	149.5	131.2	135.6	143.0
			SHC	135.5	153.6	161.2	132.0	147.8	155.6	128.4	141.9	149.5	124.4	135.6	143.0
		62	TC	164.1	163.9	164.2	156.9	156.7	157.1	149.2	149.0	150.0	141.0	140.8	143.1
4500 CFM	<u>á</u>		SHC	118.5 179.4	139.2	158.6 179.0	115.2	135.9 171.4	155.1	111.7	132.3 162.9	150.0	108.1 154.2	128.4	143.1 153.6
၁	EAT (wb)	67	TC SHC	96.7	179.2 117.5	138.3	171.6 93.5	114.3	171.1 135.0	163.2 90.0	110.8	162.7 131.6	86.5	154.0 107.2	127.9
20(	ΙÄ		TC	195.8	195.6	195.3	187.2	187.0	186.7	178.0	177.8	177.5	168.2	167.9	167.6
4	-	72	SHC	74.1	95.4	116.2	71.1	92.1	113.0	67.9	88.8	109.6	64.5	85.2	106.0
			TC	-	209.5	209.2		200.2	199.9	-	190.2	190.0	-	179.6	179.3
		76	SHC	_	77.4	98.2	_	74.2	95.0	_	70.9	91.7	_	67.4	88.2
			TC	157.5	161.1	169.6	150.4	155.2	163.5	143.0	148.9	156.9	135.1	142.0	149.8
		58	SHC	146.1	161.1	169.6	142.4	155.2	163.5	138.2	148.9	156.9	133.5	142.0	149.8
			TC	169.1	168.8	170.2	161.5	161.2	163.7	153.3	153.2	157.1	144.6	144.6	149.9
≥	-	62	SHC	127.1	150.6	170.2	123.7	147.0	163.7	120.1	143.1	157.1	116.4	138.7	149.9
5250 CFM	(wp)	67	TC	184.7	184.4	184.1	176.3	176.1	175.7	167.5	167.2	166.8	158.0	157.7	157.3
20	EAT (	67	SHC	102.2	126.0	149.7	98.9	122.6	146.3	95.4	119.1	142.7	91.7	115.4	138.8
52	7	72	TC	201.2	201.0	200.7	192.1	191.9	191.5	182.4	182.2	181.8	172.1	171.8	171.3
		12	SHC	77.0	100.7	124.5	73.7	97.4	121.2	70.3	94.0	117.8	66.7	90.4	114.1
		76	TC	_	215.0	214.7	_	205.1	204.8	_	194.7	194.3	_	183.5	183.1
		70	SHC	_	80.3	104.1	_	77.0	100.8	_	73.7	97.4	_	70.1	93.9
		58	TC	161.4	167.8	176.7	154.1	161.5	170.2	146.9	154.7	163.1	139.3	147.4	155.5
		00	SHC	155.5	167.8	176.7	151.8	161.5	170.2	145.6	154.7	163.1	139.3	147.4	155.5
		62	TC	172.9	172.7	176.9	164.9	164.9	170.3	156.4	156.7	163.3	147.4	148.2	155.6
₹	Q	_	SHC	135.1	160.8	176.9	131.7	156.8	170.3	128.0	152.3	163.3	124.2	146.4	155.6
6000 CFM	EAT (wb)	67	TC	188.7	188.3	187.9	180.0	179.6	179.2	170.7	170.4	170.0	160.9	160.5	160.2
00	ΑŦ		SHC	107.3 205.4	133.9 205.1	160.4 204.7	103.9 195.9	130.5 195.6	156.8 195.1	100.4 185.8	126.9 185.5	152.9 185.0	96.6 175.1	123.2 174.7	148.7 174.2
9	ш	72	TC SHC	79.1	105.7	132.4	75.8	102.4	129.0	72.3	98.9	125.5	68.7	95.2	121.8
			TC	-	219.2	218.9	75.6	209.0	208.5	-	198.0	197.6	-	186.5	186.0
		76	SHC	_	82.9	109.6	_	79.7	106.3	_	76.2	102.8	_	72.7	99.2
			TC	165.1	173.4	182.8	158.0	166.8	175.9	150.9	159.6	168.4	143.5	151.9	160.3
		58	SHC	163.2	173.4	182.8	158.0	166.8	175.9	150.9	159.6	168.4	143.5	151.9	160.3
			TC	176.0	176.2	182.9	167.7	168.2	176.0	158.9	160.0	168.5	149.6	152.0	160.4
⋝		62	SHC	142.8	169.9	182.9	139.3	165.7	176.0	135.6	160.0	168.5	131.6	152.0	160.4
CF	×		TC	191.9	191.5	191.1	182.9	182.5	182.1	173.3	172.9	172.7	163.2	162.7	162.8
6750 CFM	EAT (wb)	67	SHC	112.2	141.5	170.3	108.7	138.1	166.5	105.1	134.4	162.2	101.3	130.6	157.1
67	Ą	70	TC	208.8	208.4	207.9	198.9	198.5	198.0	188.5	188.1	187.5	177.4	177.0	176.4
		72	SHC	81.1	110.5	139.9	77.8	107.1	136.5	74.3	103.6	132.9	70.6	99.9	129.2
		76	TC	-	222.6	222.2	_	212.0	211.5	_	200.7	200.2	-	188.8	188.3
		, 0	SHC	_	85.4	114.8	_	82.1	111.5	_	78.7	108.0	_	75.1	104.4
		58	TC	168.7	178.2	187.9	161.9	171.2	180.7	154.7	163.7	172.8	147.0	155.6	164.4
			SHC	168.7	178.2	187.9	161.9	171.2	180.7	154.7	163.7	172.8	147.0	155.6	164.4
_		62	TC	178.5	179.4	188.1	170.0	171.6	180.8	160.9	163.8	172.9	151.4	155.8	164.5
7500 CFM	ð		SHC	150.2	177.3	188.1	146.6	171.6	180.8	142.6	163.8	172.9	138.3	155.8	164.5
၁	٤	67	TC	194.5	194.1	193.8	185.3	184.8	184.6	175.5	174.9	175.1	165.0	164.5	165.4
20(	EAT (wb)		SHC	116.8	148.8	179.5	113.3	145.3	175.2	109.7	141.7	170.2	105.8	137.8	163.5
7		72	SHC	211.5 83.1	211.1	210.6 147.2	201.4 79.7	201.0 111.6	200.3 143.7	190.7 76.1	190.2 108.1	189.6 140.1	179.4 72.4	178.8 104.3	178.2
			TC	83.1	115.1 225.4	224.9	79.7	214.5	213.9	76.1	202.9	202.3	72.4	190.8	136.3 190.1
		76	SHC		87.8	119.9		84.5	116.5	_	81.0	113.0		77.4	109.3
			3110	_	07.0	113.3	_	04.0	110.5		01.0	113.0	-	11.4	103.3

## LEGEND:

Do not operateCubic feet per minute (supply air) Cfm EAT(db) - Entering air temperature (dry bulb) EAT(wb) — Entering air temperature (wet bulb)

SHC - Sensible heat capacity

TC - Total capacity

 $\begin{aligned} & & & \frac{\text{total capacity (Btuh)}}{\text{h_{lwb}} = \text{h}_{\text{ewb}} - } & & & \frac{\text{total capacity (Btuh)}}{\text{4.5 x cfm}} \\ & & & \text{Where: h}_{\text{ewb}} = \text{Enthalpy of air entering evaporator coil} \end{aligned}$ 

**Table 7 - COOLING CAPACITIES** 20 TONS (2 Stage Cooling)

						LING O				/IPERATU	RE	<u> </u>			
					85			95			105			115	
	RH	S240/2	243		EAT (db)										
				75	80	85	75	80	85	75	80	85	75	80	85
		58	TC	211.1	214.4	225.9	201.2	206.2	217.5	190.5	197.3	208.3	179.4	187.7	198.3
		56	SHC	191.5	214.4	225.9	186.3	206.2	217.5	180.6	197.3	208.3	173.1	187.7	198.3
		62	TC	227.4	227.1	228.8	216.8	216.4	219.2	205.2	204.9	208.6	192.8	192.6	198.5
₽	<u> </u>	02	SHC	168.0	197.4	222.1	163.1	192.4	215.5	157.8	186.9	208.6	152.3	180.9	198.5
6000 CFM	(dw)	67	TC	249.2	248.8	248.4	237.7	237.2	236.8	225.1	224.6	224.1	211.5	211.0	210.5
00	EAT	0,	SHC	137.5	167.2	196.8	132.7	162.4	191.9	127.5	157.2	186.7	122.0	151.7	181.0
9	Щ	72	TC	272.6	272.1	271.6	259.9	259.5	258.9	246.2	245.7	245.1	231.3	230.8	230.2
			SHC	106.0	136.2	165.9	101.4	131.4	161.1	96.4	126.3	156.0	91.2	120.9	150.6
		76	TC	_	291.8	291.3	_	278.2	277.6	_	263.3	262.7	_	247.4	246.7
			SHC	-	110.8	140.7	-	106.1	136.0	-	101.1	130.9	-	95.8	125.6
		58	TC	218.0	225.8	238.1	207.9	217.0	229.0	197.5	207.4	219.0	186.3	196.9	208.1
			SHC	206.7	225.8	238.1	199.7	217.0	229.0	192.4	207.4	219.0	184.6	196.9	208.1
_		62	TC	234.3	234.0	238.5	223.0	222.9	229.2	210.8	211.0	219.2	197.6	199.1	208.3
Ε	(qw)		SHC	180.8	214.0	238.5	175.7	208.4	229.2	170.3	201.5	219.2	164.6	193.2	208.3
7000 CFM	<u>₹</u>	67	TC SHC	256.5 145.7	256.0 179.8	255.4 213.7	244.2 140.8	243.7 174.8	243.1 208.6	230.9 135.5	230.4 169.5	229.8 203.0	216.6 129.9	216.0 163.9	215.6 196.9
Ö	EAT		TC	280.1	279.5	278.9	266.7	266.1	265.4	252.2	251.6	250.9	236.6	236.0	235.2
7	ш	72	SHC	109.9	144.2	178.3	105.1	139.3	173.4	99.9	134.1	168.2	94.4	128.6	162.6
			TC		299.4	298.7	-	285.0	284.2	-	269.4	268.6		252.6	251.7
		76	SHC	_	115.2	149.4		110.4	144.6		105.3	139.5	_	99.9	134.0
			TC	224.7	235.3	248.4	214.6	225.9	238.6	203.6	215.6	227.9	192.8	204.4	216.2
		58	SHC	218.0	235.3	248.4	211.0	225.9	238.6	203.6	215.6	227.9	192.8	204.4	216.2
			TC	239.6	239.8	248.6	227.8	229.0	238.8	215.0	217.3	228.1	201.4	204.7	216.4
5	_	62	SHC	192.9	228.6	248.6	187.7	220.5	238.8	182.1	212.7	228.1	176.2	204.7	216.4
Ä	(dw)		TC	262.1	261.5	260.9	249.2	248.6	248.1	235.4	234.7	234.5	220.5	219.8	220.1
8000 CFM	<u>د</u>	67	SHC	153.4	191.8	229.5	148.4	186.7	224.0	143.0	181.3	217.8	137.3	175.6	209.5
900	EAT		TC	285.9	285.2	284.4	271.9	271.2	270.4	256.9	256.1	255.2	240.7	239.9	239.0
••		72	SHC	113.2	151.7	190.2	108.3	146.8	185.2	103.0	141.5	179.9	97.5	135.9	174.2
			TC	_	305.2	304.4	_	290.2	289.3	_	274.0	273.0	_	256.6	255.6
		76	SHC	_	119.2	157.8	_	114.3	152.9	_	109.1	147.6	_	103.7	142.1
			TC	230.7	243.3	256.9	220.3	233.4	246.5	209.9	222.5	235.2	198.6	210.7	222.8
		58	SHC	228.5	243.3	256.9	220.3	233.4	246.5	209.9	222.5	235.2	198.6	210.7	222.8
		62	TC	243.8	245.9	257.1	231.6	234.7	246.7	218.5	222.7	235.4	204.5	210.8	223.0
≥	<u>6</u>	02	SHC	204.4	238.9	257.1	199.0	231.3	246.7	193.2	222.7	235.4	186.8	210.8	223.0
2	(wp)	67	TC	266.5	265.8	265.4	253.2	252.5	252.4	239.0	238.1	239.0	223.6	222.7	224.9
9000 CFM	EAT	υ,	SHC	160.8	203.3	243.9	155.6	198.2	237.6	150.2	192.6	228.9	144.4	186.7	219.9
96	Щ	72	TC	290.5	289.7	288.8	276.1	275.3	274.3	260.6	259.7	258.6	243.9	243.0	241.9
			SHC	116.3	159.0	201.6	111.3	154.0	196.5	106.0	148.6	191.2	100.4	142.9	185.4
		76	TC	_	309.8	308.8	_	294.3	293.2	_	277.6	276.5	_	259.8	258.6
			SHC	_	123.0	165.8	_	118.1	160.8	_	112.8	155.5	_	107.3	149.9
		58	TC	236.3	250.2	264.2	226.3	239.7	253.3	215.4	228.3	241.4	203.6	216.0	228.5
			SHC	236.3	250.2	264.2	226.3	239.7	253.3	215.4	228.3	241.4	203.6	216.0	228.5
5		62	TC	247.3	251.2	264.4	234.8	239.9	253.5	221.4	228.5	241.6	207.2	216.1	228.7
10,000 CFM	Q.		SHC	215.3	249.0	264.4	209.6	239.9	253.5	203.4	228.5	241.6	196.2	216.1	228.7
00	ا خ	67	TC	270.1	269.3	269.5	256.5	255.6	256.9	241.8	240.9	243.4	226.1	225.2	229.0
)0,	EAT (wb)		SHC TC	167.8 294.3	214.4 293.4	256.5 292.3	162.7 279.5	209.1 278.5	247.6 277.4	157.1 263.5	203.4 262.5	238.8 261.3	151.3 246.5	197.1 245.4	229.0 244.2
7		72	SHC	119.1	293.4 165.9	292.3	114.1	160.9	207.5	108.8	155.5	202.0	103.1	149.7	196.1
			TC		313.5	312.4	-	297.6	296.4		280.5	279.2		262.3	261.0
		76	SHC	_	126.6	173.5	_	121.7	168.5	_	116.4	163.1	_	110.8	157.5
. = 0	END:		3110	_	120.0	173.5		161.1	100.0		110.4	100.1	_	110.0	137.3

## LEGEND:

Do not operate
Cfm
Cubic feet per minute (supply air)
EAT(db)
Entering air temperature (dry bulb) EAT(wb) - Entering air temperature (wet bulb)

SHC Sensible heat capacity

 Total capacity TC

Table 8 – HEATING CAPACITIES 15 TONS

RHS181/183 RETURN AIR	OFM (CTANDAD)	D AID)	TEMPERATURE AIR ENTERING OUTDOOR COIL (°F db at 70% RH)										
(°F db)	CFM (STANDAR	J AIK)	-5	0	10	17	30	40	47	50	60		
	4500	Capacity	72.8	80.1	95.8	107.6	132.6	155.3	171.2	175.7	195.4		
	4500	Int. Cap.	67.1	73.7	87.9	98.1	116.2	155.3	171.2	175.7	195.4		
<i></i>	6000	Capacity	75.8	83.1	99.3	111.6	137.6	160.5	174.1	178.4	197.5		
55	6000	Int. Cap.	69.9	76.5	91.1	101.7	120.6	160.5	174.1	178.4	197.5		
	7500	Capacity	79.4	86.7	103.2	116.0	142.4	164.0	176.9	181.1	199.6		
	7500	Int. Cap.	73.2	79.8	94.7	105.8	124.8	164.0	176.9	181.1	199.6		
	4500	Capacity	65.8	73.0	88.9	100.5	124.7	145.1	163.1	168.7	190.3		
	4500	Int. Cap.	60.6	67.2	81.6	91.6	109.2	145.1	163.1	168.7	190.3		
70	6000	Capacity	68.9	76.4	92.6	104.5	129.6	151.5	169.0	174.0	193.0		
70	6000	Int. Cap.	63.5	70.3	85.0	95.3	113.6	151.5	169.0	174.0	193.0		
	7500	Capacity	72.6	80.2	96.6	108.8	134.5	157.3	173.2	177.4	195.7		
	7500	Int. Cap.	66.9	73.8	88.7	99.2	117.9	157.3	173.2	177.4	195.7		
	4500	Capacity	60.3	67.5	83.8	95.4	118.8	139.0	156.5	162.2	186.4		
	4500	Int. Cap.	55.5	62.1	76.9	87.0	104.1	139.0	156.5	162.2	186.4		
90	6000	Capacity	63.3	70.8	87.5	99.4	123.8	144.7	163.0	168.5	189.9		
80	6000	Int. Cap.	58.4	65.2	80.3	90.6	108.5	144.7	163.0	168.5	189.9		
	7500	Capacity	67.0	74.7	91.5	103.6	128.8	149.9	168.5	173.6	192.8		
	7500	Int. Cap.	61.7	68.7	84.0	94.5	112.8	149.9	168.5	173.6	192.8		

Indicates standard rating point

**LEGEND** 

Capacity - Instantaneous Capacity (1000 Btuh) includes indoor fan motor heat @AHRI static conditions

Int. Cap. - Integrated Capacity is Instantaneous Capacity minus the effects of frost on the outdoor coil and the heat

required to defrost

RH - Relative Humidity

db – Dry Bulb

Table 9 – HEATING CAPACITIES 20 TONS

RHS240/243	OFM (OTANDAE	ID AID)	TEMPERATURE AIR ENTERING OUTDOOR COIL (°F db at 70% RH)										
RETURN AIR (°F db)	CFM (STANDAF	ID AIK)	-5	0	10	17	30	40	47	50	60		
	0000	Capacity	93.4	104.1	125.2	141.7	177.0	206.9	229.0	235.4	261.4		
	6000	Int. Cap.	86.1	95.8	114.9	129.2	155.1	206.9	229.0	235.4	261.4		
55	0000	Capacity	98.8	109.5	131.2	160.8	184.4	214.6	233.4	238.4	264.3		
55	8000	Int. Cap.	91.0	100.8	120.4	146.6	161.6	214.6	233.4	238.4	264.3		
	10000	Capacity	104.8	115.7	137.8	155.0	191.2	221.0	236.8	242.2	267.3		
	10000	Int. Cap.	96.65	106.4	126.4	141.4	167.5	221.0	236.8	242.2	267.3		
	0000	Capacity	81.1	92.2	114.9	131.1	165.6	195.1	219.1	226.5	256.2		
	6000	Int. Cap.	74.7	84.9	105.5	119.5	145.1	195.1	219.1	226.5	256.2		
70	0000	Capacity	86.1	97.5	120.3	137.0	173.1	203.3	227.0	233.8	259.2		
70	8000	Int. Cap.	79.3	89.7	110.4	124.9	151.7	203.3	227.0	233.8	259.2		
	10000	Capacity	91.9	103.5	126.4	143.5	179.7	211.8	233.6	239.8	262.9		
	10000	Int. Cap.	84.7	95.2	116.0	130.8	157.5	211.8	233.6	239.8	262.9		
	0000	Capacity	72.6	84.0	107.3	124.4	157.7	187.2	210.7	218.5	250.8		
	6000	Int. Cap.	66.9	77.3	98.5	113.5	138.2	187.2	210.7	218.5	250.8		
90	80 8000	Capacity	77.2	88.9	112.8	129.9	164.8	195.8	219.6	227.2	256.7		
80		Int. Cap.	71.2	81.8	103.5	118.4	144.4	195.8	219.6	227.2	256.7		
	10000	Capacity	82.8	94.7	118.9	136.0	172.0	203.8	227.4	234.5	261.7		
	10000	Int. Cap.	76.3	87.1	109.2	124.0	150.7	203.8	227.4	234.5	261.7		

Indicates standard rating point

**LEGEND** 

Capacity - Instantaneous Capacity (1000 Btuh) includes indoor fan motor heat @AHRI static conditions

Int. Cap. — Integrated Capacity is Instantaneous Capacity minus the effects of frost on the outdoor coil and the heat

required to defrost

RH - Relative Humidity

db - Dry Bulb

## Table 10 – STATIC PRESSURE ADDERS (Factory Options and/or Accessories)

## **Economizer – Vertical and Horizontal Duct Configuration**

	Model Sizes 181 - 243													
CFM	4500	5000	5500	6000	6500	7000	7500	8000						
Vertical & Horizontal	0.047	0.052	0.057	0.062	0.067	0.072	0.077	0.082						

	Model Sizes 181 – 243												
CFM	8500	9000	9500	10000	10500	11000	11500	12000	12500				
Vertical & Horizontal	0.088	0.093	0.098	0.103	0.109	0.114	0.119	0.125	0.131				

## **Electric Heaters - Vertical and Horizontal Duct Configuration**

	Model Sizes 181 – 243													
CFM	4500	5000	5500	6000	6500	7000	7500	8000						
25 kW Heater	0.010	0.010	0.015	0.020	0.025	0.030	0.035	0.040						
50 kW Heater	0.020	0.020	0.030	0.040	0.050	0.060	0.070	0.080						
75 kW Heater	0.030	0.040	0.050	0.060	0.070	0.080	0.100	0.120						

Model Sizes 181 – 243												
CFM 8500 9000 9500 10000 10500 11000 11500 12000 1250												
25 kW Heater	0.045	0.050	0.055	0.060	0.070	0.080	0.090	0.100	0.105			
50 kW Heater	0.090	0.100	0.120	0.130	0.150	0.160	0.180	0.200	0.230			
75 kW Heater	0.140	0.150	0.180	0.200	0.230	0.250	0.270	0.300	0.330			

## General fan performance notes:

- 1. Interpolation is permissible. Do not extrapolate.
- 2. External static pressure is the static pressure difference between the return duct and the supply duct plus the static pressure caused by any FIOPs or accessories.
- 3. Tabular data accounts for pressure loss due to clean filters, high gas heat, unit casing, and wet coils. Factory options and accessories may add static pressure losses, as shown in Table 10.
- 4. The Fan Performance tables offer motor/drive recommendations. In cases when two motor/drive combinations would work, the lower horsepower option is recommended.
- 5. For information on the electrical properties of motors, please see the Electrical information section of this book.
- 6. For more information on the performance limits of motors, see the application data section of this book.

## **FAN PERFORMANCE**

## Table 11 - RHS181, 15 TON VERTICAL SUPPLY / RETURN

			Δ	VAILABLE E	XTERNAL ST	ATIC PRESS	URE (IN. WG	i)		
CFM	0.	.2	0.	4	0.	.6	0.	.8	1.	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3900	409	0.46	509	0.73	594	1.03	670	1.36	738	1.71
4400	430	0.57	525	0.86	607	1.18	681	1.52	748	1.89
4800	451	0.69	542	1.00	622	1.34	693	1.70	758	2.08
5300	473	0.83	560	1.16	637	1.51	706	1.89	770	2.30
5700	496	0.98	579	1.34	653	1.71	720	2.11	782	2.53
6100	519	1.16	599	1.54	670	1.94	735	2.35	796	2.79
6600	543	1.37	619	1.76	688	2.18	751	2.62	810	3.07
7000	567	1.59	640	2.01	707	2.45	768	2.91	826	3.38
7400	592	1.84	662	2.28	726	2.74	785	3.22	842	3.72
7900	616	2.12	683	2.59	746	3.07	804	3.56	858	4.08

			Α	VAILABLE E	XTERNAL ST	TATIC PRESS	URE (IN. WG	i)		
CFM	1.	.2	1.	4	1	.6	1.	.8	2	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3900	801	2.08	860	2.47	915	2.88	967	3.31	1017	3.75
4400	809	2.27	867	2.68	922	3.10	973	3.55	1022	4.01
4800	819	2.48	876	2.91	929	3.35	980	3.80	1028	4.28
5300	829	2.72	885	3.16	938	3.61	988	4.09	1036	4.57
5700	840	2.97	895	3.43	947	3.90	996	4.39	1043	4.89
6100	853	3.25	906	3.72	957	4.21	1006	4.72		
6600	866	3.55	918	4.04	968	4.55				
7000	880	3.88	931	4.38	980	4.90				
7400	895	4.23	945	4.76						
7900	910	4.61								

White background with black font — Field—supplied drive Light shading — Standard static motor and drive

White background with bold font — High static option with field supplied fan drives Med shade — High static motor and drive

White background with bold font - High static option with field supplied fan drives

--- Outside operating range

Table 12 - RHS183, 15 TON HORIZONTAL SUPPLY / RETURN

			A	VAILABLE E	XTERNAL ST	ATIC PRESS	URE (IN. WG	i)		
CFM	0.	.2	0	.4	0.	.6	0.	.8	1.	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
4000	422	0.66	510	1.07	582	1.52	646	2.00	703	2.51
4500	451	0.83	535	1.27	605	1.75	667	2.27	723	2.81
5000	482	1.04	561	1.51	629	2.02	690	2.57	745	3.15
5500	518	1.28	588	1.78	654	2.32	713	2.91	767	3.52
6000	546	1.57	617	2.10	680	2.67	738	3.29	790	3.93
6500	579	1.90	646	2.46	707	3.07	763	3.71	814	4.39
7000	613	2.20	677	2.87	735	3.51	789	4.19	839	4.89
7500	648	2.71	708	3.34	764	4.01	816	4.72	865	5.46
8000	683	3.20	740	3.86	794	4.57	844	5.30	892	6.08

			Δ	VAILABLE E	EXTERNAL ST	ATIC PRESS	SURE (IN. WG	i)		
CFM	1.	.2	1.	.4	1	.6	1	.8	2	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
4000	754	3.05	802	3.62	847	4.21	889	4.82	929	5.45
4500	774	3.39	822	3.98	866	4.60	908	5.25	948	5.91
5000	795	3.75	842	4.38	886	5.03	928	5.71	967	6.40
5500	817	4.15	863	4.82	907	5.50	948	6.21	987	6.93
6000	839	4.60	885	5.29	928	6.01	969	6.75	1008	7.51
6500	862	5.09	907	5.82	950	6.57	990	7.34		
7000	886	5.63	930	6.39	972	7.17				
7500	911	6.22	954	7.01						
8000	936	6.87	979	7.69						

White background with black font — Field—supplied drive Light shading — Standard static motor and drive

Med shade - High static motor and drive

--- Outside operating range

## **FAN PERFORMANCE (cont.)**

## Table 13 - RHS240, 20 TON VERTICAL SUPPLY / RETURN

			Δ	VAILABLE E	XTERNAL ST	ATIC PRESS	URE (IN. WG	i)		
CFM	0.	.2	0.	4	0.	.6	0.	8	1.	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
4500	429	0.57	528	0.81	612	1.06	685	1.32	751	1.60
5000	454	0.72	549	0.99	629	1.26	701	1.54	765	1.84
5500	480	0.91	570	1.19	648	1.49	718	1.79	781	2.10
6000	506	1.12	593	1.43	668	1.74	736	2.07	798	2.40
6500	533	1.36	616	1.70	689	2.04	754	2.39	815	2.74
7000	561	1.64	640	2.01	710	2.37	774	2.74	833	3.11
7500	588	1.96	664	2.35	732	2.74	795	3.13	852	3.53
8000	617	2.32	689	2.74	755	3.15	816	3.57	872	3.99
8500	645	2.73	715	3.17	779	3.60	837	4.04	892	4.49
9000	676	3.18	741	3.64	803	4.10	860	4.57	913	5.04
9500	703	3.67	767	4.16	827	4.65	883	5.14	935	5.64
10000	732	4.22	794	4.74	852	5.25	906	5.77	957	6.29

			Δ	VAILABLE E	XTERNAL ST	ATIC PRESS	URE (IN. WG	)		
CFM	1.	.2	1.	.4	1.	6	1.	8	2.	0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
4500	811	1.90	868	2.20	921	2.52	971	2.86	1019	3.20
5000	825	2.15	881	2.47	933	2.80	982	3.15	1029	3.51
5500	840	2.43	894	2.77	946	3.12	995	3.48	1041	3.86
6000	855	2.75	909	3.11	959	3.47	1008	3.85	1054	4.24
6500	871	3.11	924	3.48	974	3.87	1022	4.26	1067	4.67
7000	888	3.50	940	3.89	989	4.30	1036	4.71	1081	5.13
7500	906	3.94	957	4.35	1005	4.77	1052	5.20	1096	5.64
8000	925	4.42	975	4.85	1022	5.29	1068	5.74	1111	6.20
8500	944	4.94	993	5.40	1040	5.86	1084	6.33	1127	6.81
9000	964	5.51	1012	5.99	1058	6.48	1102	6.97	1144	7.46
9500	984	6.13	1032	6.64	1077	7.14	1120	7.65	1161	8.17
10000	1006	6.81	1052	7.33	1096	7.86	1138	8.40		

White background with black font — Field—supplied drive Light shading — Standard static motor and drive

White background with bold font — High static option with field supplied fan drives Med shade — High static motor and drive

--- Outside operating range

## Table 14 - RHS243, 20 TON HORIZONTAL SUPPLY / RETURN

			Δ	<b>VAILABLE</b>	XTERNAL ST	ATIC PRESS	URE (IN. WG	i)		
CFM	0.	.2	0.	.4	0.	.6	0.	.8	1.	0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
6000	546	1.57	617	2.10	680	2.67	738	3.29	790	3.93
6500	579	1.90	646	2.46	707	3.07	763	3.71	814	4.39
7000	613	2.28	677	2.87	735	3.51	789	4.19	839	4.89
7500	648	2.71	708	3.34	764	4.01	816	4.72	865	5.46
8000	683	3.20	740	3.86	794	4.57	846	5.30	892	6.08
8500	718	3.76	773	4.45	825	5.18	873	5.95	919	6.75
9000	754	4.37	814	5.10	856	5.87	903	6.67	947	7.50
9500	790	5.06	840	5.82	887	6.51	933	7.45	976	8.31
10000	826	5.82	874	6.50	920	7.44	965	8.30		

			-	VAILABLE E	XTERNAL ST	TATIC PRESS	SURE (IN. WG	i)		
CFM	1.	.2	1.	.4	1	.6	1.	8	2	.0
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
6000	839	4.60	885	5.29	928	6.01	969	6.75	1008	7.51
6500	862	5.09	907	5.82	950	6.57	990	7.34	1028	8.13
7000	886	5.63	930	6.39	972	7.17	1012	7.97	1050	8.70
7500	911	6.22	954	7.01	995	7.83	1035	8.66		
8000	936	6.87	979	7.69	1019	8.54				
8500	965	7.58	1004	8.44						
9000	990	8.36								
9500										
10000										

White background with black font — Field—supplied drive Light shading — Standard static motor and drive

--- Outside operating range

White background with bold font — High static option with field supplied fan drives Med shade — High static motor and drive

## **FAN PERFORMANCE (cont.)**

## Table 15 - PULLEY ADJUSTMENT

Unit						Motor P	ulley tur	ns open				
RHS	Motor/Drive Combo	0.0	0.5	1.0	1.5	2.0	2.5	3.0	3.5	4.0	4.5	5.0
	Standard Static	819	798	776	755	733	712	690	669	647	626	604
181 – 183	Medium Static	958	939	920	901	882	863	843	824	805	786	767
	High Static	1134	1112	1090	1069	1047	1025	1003	981	960	938	916
	Standard Static	819	798	776	755	733	712	690	669	647	626	604
240 - 243	Medium Static	1008	989	969	950	930	911	892	872	853	833	814
	High Static	1170	1150	1129	1109	1088	1068	1047	1027	1006	986	965

NOTE: Do not adjust pulley further than 5 turns open.

– Factory settings

## DAMPER, BAROMETRIC RELIEF, AND PERFORMANCE, 15 to 20 Ton

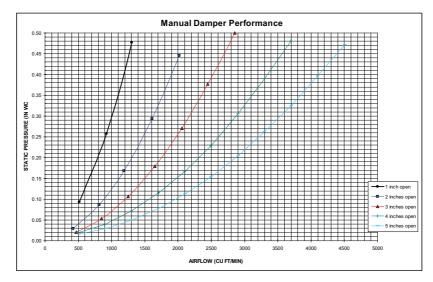


Fig 1 - Manual Damper Performance

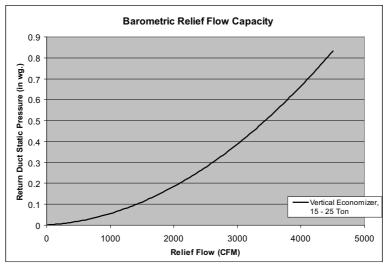


Fig 2 - Barametric Relief Flow Capacity

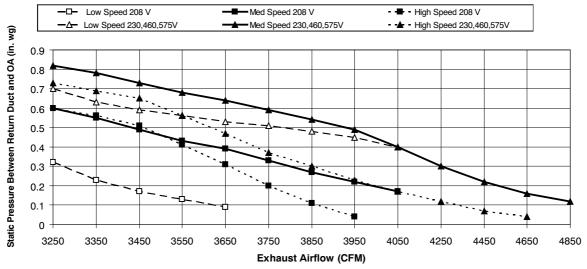


Fig 3 - Power Exhaust Fan Performance

## **ELECTRICAL INFORMATION**

## Table 16 – 2 Stage Cooling

	HZ	.,,,,,		со	MP 1	СО	MP 2	OFM (	ea)		IFM	
	V-PH-HZ		TAGE NGE								EFF at Full Load	FLA
Unit RHS	>	MIN	MAX	RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFF at Full Load	FLA
	-90									STD	81.3%	7.5
	208-3-60	187	253	25.0	164.0	25.0	164.0	350	1.5	MED	83.8%	10.2
	208									HIGH	83.6%	15.0
	-90									STD	81.3%	7.5
	230-3-60	187	253	25.0	164.0	25.0	164.0	350	1.5	MED	83.8%	10.2
181/183	230									HIGH	83.6%	15.0
181/183	-90									STD	81.3%	3.4
	460-3-60	414	506	12.2	100.0	12.2	100.0	277	0.9	MED	83.8%	4.8
	460									HIGH	83.6%	7.4
	-90									STD	81.1%	2.8
	575-3-60	518	633	9	78	9	78	397	0.6	MED	81.1%	2.8
	575									HIGH	83.6%	5.6
	09-									STD	83.6%	15.0
	208-3-60	187	253	33.3	239.0	30.1	225.0	350	1.5	MED-High Eff	89.5%	20.4
	208									HIGH-High Eff	91.7%	33.1
	09-									STD	83.6%	15.0
	230-3-60	187	253	33.3	239.0	30.1	225.0	350	1.5	MED-High Eff	89.5%	20.4
0.10/0.10	230									HIGH-High Eff	91.7%	33.1
240/243	09-									STD	83.6%	7.4
	460-3-60	414	506	17.9	125	16.7	114.0	277	0.9	MED-High Eff	89.5%	20.4
	460									HIGH-High Eff	91.7%	33.1
	09-									STD	83.6%	5.6
	575-3-60	518	633	12.8	80	12.2	80	397	0.6	MED-High Eff	89.5%	9.0
	575									HIGH-High Eff	91.7%	9.5

Table 17 - MCA/MOCP DETERMINATION NO C.O. OR UNPWRD C.O.

	HZ		ELECTRI	IC HEATER			NC	O C.O. or U	NPWR C.O.			
	Ŧ					NO P	E.		w	/ P.E. (pwr	d fr/unit)	
Unit	NOM. V-PH-HZ	IFM	Nom				DISC.	SIZE			DISC	SIZE
RHS	2	TYPE	(kW)	FLA	MCA	MOCP	FLA	LRA	MCA	МОСР	FLA	LRA
			_	_	68.3	90.0	71.0	393.0	80.1	100.0	85.0	413.0
		STD	18.8/25.0	52.1/60.1	133.4/143.4	150/150	131/140	445/453	145.2/155.2	150/175	145/154	465/473
		310	37.6/50.0	104.2/120.3	198.5/188.6	200/200	191/210	497/513	210.3/200.4	225/225	205/223	517/533
	9		56.3/75.0	156.4/180.4	224.7/248.7	250/300	251/279	549/573	236.5/260.5	250/300	265/292	569/593
	208/230-3-60		_	_	71.0	90.0	74.0	410.0	82.8	100.0	88.0	430.0
	Ϊ	MED	18.8/25.0	52.1/60.1	136.1/146.1	150/150	134/144	462/470	147.9/157.9	150/175	148/157	482/490
	230	MED	37.6/50.0	104.2/120.3	201.2/191.3	225/200	194/213	514/530	213.0/203.1	225/225	208/226	534/550
	8		56.3/75.0	156.4/180.4	227.4/251.4	250/300	254/282	566/590	239.2/263.2	250/300	268/295	586/610
	2		_	_	75.8	100.0	80.0	419.0	87.6	100.0	93.0	439.0
		HIGH	18.8/25.0	52.1/60.1	140.9/150.9	150/175	140/149	471/479	152.7/162.7	175/175	153/163	491/499
		піап	37.6/50.0	104.2/120.3	206.0/196.1	225/225	200/218	523/539	217.8/207.9	225/225	213/232	543/559
			56.3/75.0	156.4/180.4	232.2/256.2	250/300	260/287	575/599	244.0/268.0	300/300	273/301	595/619
			_	_	33.6	45.0	35.0	234.0	39.8	50.0	42.0	246.0
		STD	25.0	30.1	71.2	80.0	70.0	264.0	77.4	80.0	77.0	276.0
		310	50.0	60.1	93.7	100.0	104.0	294.0	99.9	110.0	111.0	306.0
			75.0	90.2	123.8	150	139	324	130.0	150	146	336
	9		_	_	35.0	45.0	37.0	243.0	41.2	50.0	44.0	255.0
181/183	460-3-60	MED	25.0	30.1	72.6	80.0	71.0	273.0	78.8	80.0	78.0	285.0
101/100	P	MED	50.0	60.1	95.1	100.0	106.0	303.0	101.3	110.0	113.0	315.0
	46		75.0	90.2	125.2	150	140	333	131.4	150	148.0	345.0
			_	_	37.6	45.0	40.0	247.0	43.8	50.0	47.0	259.0
		HIGH	25.0	30.1	75.2	80.0	74.0	277.0	81.4	90.0	81.0	289.0
		піап	50.0	60.1	97.7	110.0	109.0	307.0	103.9	110.0	116.0	319.0
			75.0	90.2	127.8	150	143	337	134.0	150	151	349
			_	_	24.9	30.0	26.0	184.0	29.7	35.0	32.0	192.0
		STD	24.8	23.9	54.7	60.0	53.0	208.0	59.5	60.0	59.0	216.0
		310	49.6	47.7	84.5	90.0	81.0	232.0	89.3	90.0	86.0	240.0
			74.4	71.6	96.5	100	108	256	101.3	110	114	264
	575-3-60		_	_	24.9	30.0	26.0	184.0	29.7	35.0	32.0	192.0
	မှ	MED	24.8	23.9	54.7	60.0	53.0	208.0	59.5	60.0	59.0	216.0
	5 L	IVIED	49.6	47.7	84.5	90.0	81.0	232.0	89.3	90.0	86.0	240.0
	57		74.4	71.6	96.5	100	108	256	101.3	110	114	264
			_	_	27.7	30.0	29.0	198.0	32.5	40.0	35.0	206.0
		HIGH	24.8	23.9	57.5	60.0	57.0	222.0	62.3	70.0	62.0	230.0
		indii	49.6	47.7	87.3	90.0	84.0	246.0	92.1	100.0	90.0	254.0
			74.4	71.6	99.3	110	112	270	104.1	110	117	278

See LEGEND on next page.

TABLE 23 - MCA/MOCP DETERMINATION NO C.O. OR UNPWRD C.O. (Cont.)

	-HZ		ELECTRIC HEATER		NO C.O. or UNPWR C.O.							
	Ŧ	IFM	Nom		NO P.E.				w/ P.E. (pwrd fr/unit)			
Unit	NOM. V-PH-HZ						DISC. SIZE				DISC. SIZE	
RHS	8	TYPE	(kW)	FLA	MCA	MOCP	FLA	LRA	MCA	MOCP	FLA	LRA
240/243	208/230—3—60	STD	_	_	92.7	125.0	97.0	558.0	104.5	125.0	111.0	578.0
			18.8/25.0	52.1/60.1	157.9/167.9	175/175	157/166	610/618	169.7/179.7	175/200	171/180	630/638
			37.6/50.0	104.2/120.3	223.0/213.0	225/225		662/678	234.8/224.8	250/250	230/249	682/698
			56.3/75.0	156.4/180.4	249.1/273.1	300/300	277/305	714/738	260.9/284.9	300/300	290/318	734/758
		MED- High Eff	_	_	98.1	125.0	103.0	568.0	109.9	125.0	117.0	588.0
			18.8/25.0	52.1/60.1	163.3/173.3	175/175	163/172	620/628	175.1/185.1	200/200	177/186	640/648
			37.6/50.0	104.2/120.3	228.4/218.4	250/250	223/242	672/688	240.2/230.2	250/250	237/255	692/708
			56.3/75.0	156.4/180.4	254.5/278.5	300/300	283/311	724/748	266.3/290.3	300/300	297/324	744/768
			_	_	110.8	125.0	118.0	642.0	122.6	150.0	131.0	662.0
		HIGH- High Eff	18.8/25.0	52.1/60.1	176.0/186.0	200/200	178/187	694/702	187.8/197.8	200/200	191/201	714/722
			37.6/50.0	104.2/120.3	241.1/231.1	250/250	238/256	746/762	252.9/242.9	300/300	251/270	766/782
			56.3/75.0	156.4/180.4	267.2/291.2	300/300	298/325	798/822	279.0/303.0	300/350	311/339	818/842
	460–3–60	STD	_	_	50.1	60.0	52.0	288.0	56.3	70.0	60.0	300.0
			25.0	30.1	87.7	90.0	87.0	318.0	93.9	100.0	94.0	330.0
			50.0	60.1	110.2	125.0	122.0	348.0	116.4	125.0	129.0	360.0
			75.0	90.2	140.3	150	156	378	146.5	175	163	390
		MED- High Eff	_	_	52.9	60.0	56.0	293.0	59.1	70.0	63.0	305.0
			25.0	30.1	90.5	100.0	90.0	323.0	96.7	100.0	97.0	335.0
			50.0	60.1	113.0	125.0	125.0	353.0	119.2	125.0	132.0	365.0
			75.0	90.2	143.1	150	159	383	149.3	175	167	395
		HIGH- High Eff	_	_	58.9	70.0	63.0	330.0	65.1	80.0	70.0	342.0
			25.0	30.1	96.5	100.0	97.0	360.0	102.7	110.0	104.0	372.0
			50.0	60.1	119.0	125.0	132.0	390.0	125.2	150.0	139.0	402.0
			75.0	90.2	149.1	175	166	420	155.3	175	173	432
		STD	_	_	36.2	45.0	38.0	204.0	41.0	50.0	43.0	212.0
			24.8	23.9	66.1	70.0	65.0	228.0	70.9	80.0	71.0	236.0
	575-3-60		49.6	47.7	95.8	100.0	93.0	252.0	100.6	110.0	98.0	260.0
			74.4	71.6	107.8	125	120	276	112.6	125	126	284
		MED-	_	_	39.6	50.0	42.0	202.0	44.4	50.0	47.0	210.0
			24.8	23.9	69.5	70.0	69.0	226.0	74.3	80.0	75.0	234.0
	Į.	High Eff	49.6	47.7	99.2	100.0	97.0	250.0	104.0	110.0	102.0	258.0
	57		74.4	71.6	111.2	125	124	274	116.0	125	130	282
		HIGH- High Eff	_	_	40.1	50.0	42.0	229.0	44.9	50.0	48.0	237.0
			24.8	23.9	70.0	70.0	70.0	253.0	74.8	80.0	75.0	261.0
			49.6	47.7	99.7	100.0	97.0	277.0	104.5	110.0	103.0	285.0
			74.4	71.6	111.7	125	125	301	116.5	125	130	309

LEGEND:

C.O. Convenient outlet DISC Disconnect FLA Full load amps **IFM** Indoor fan motor LRA Locked rotor amps



MCA Minimum circuit amps MOCP Maximum over current protection Power exhaust

UNPWRD CO Unpowered convenient outlet

NOTES:

1. In compliance with NEC requirements for multimotor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be fuse or HACR breaker. Canadian units

may be fuse or circuit breaker. 2. Unbalanced 3-Phase Supply Voltage

Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percentage of voltage imbalance.

max voltage deviation from average voltage % Voltage Imbalance = 100 xaverage voltage

Example: Supply voltage is 230-3-60



$$AB = 224 \text{ V}$$
  
 $BC = 231 \text{ V}$   
 $AC = 226 \text{ V}$ 

Average Voltage = 
$$\frac{(224 + 231 + 226)}{3} = \frac{681}{3}$$

227

Determine maximum deviation from average voltage.

(AB) 227 - 224 = 3 v

(BC) 231 - 227 = 4 v

(AC) 227 - 226 = 1 v

Maximum deviation is 4 v.

Determine percent of voltage imbalance.

% Voltage Imbalance = 
$$100 \text{ x}$$
  $\frac{4}{227}$  =  $1.76\%$ 

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

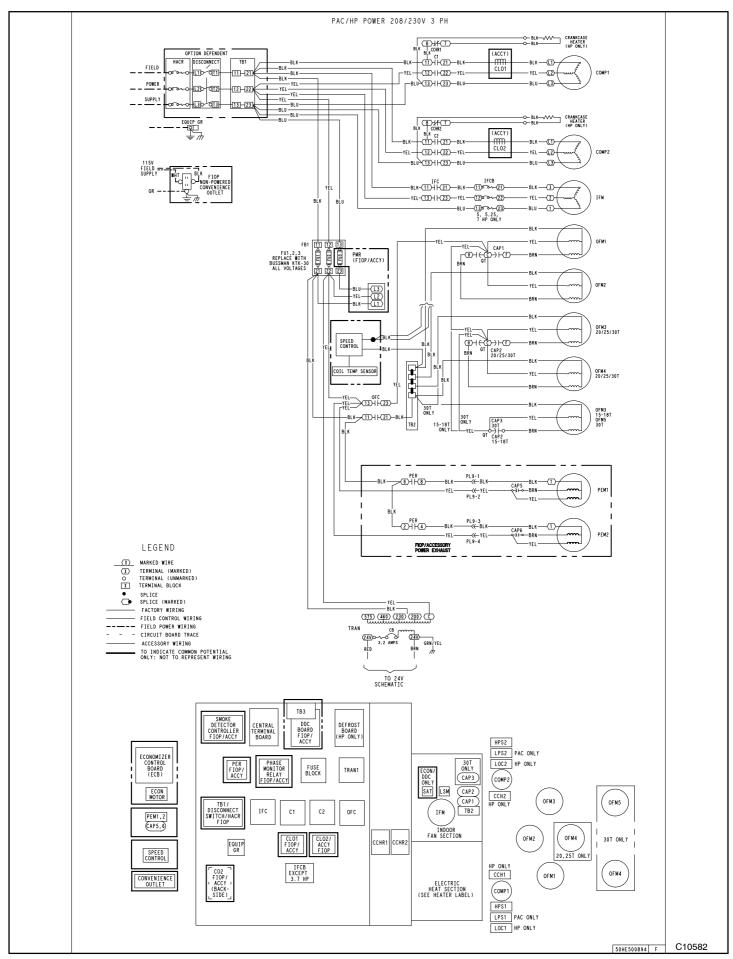


Fig. 4 Typical Power Diagram (2 Stage Cooling)

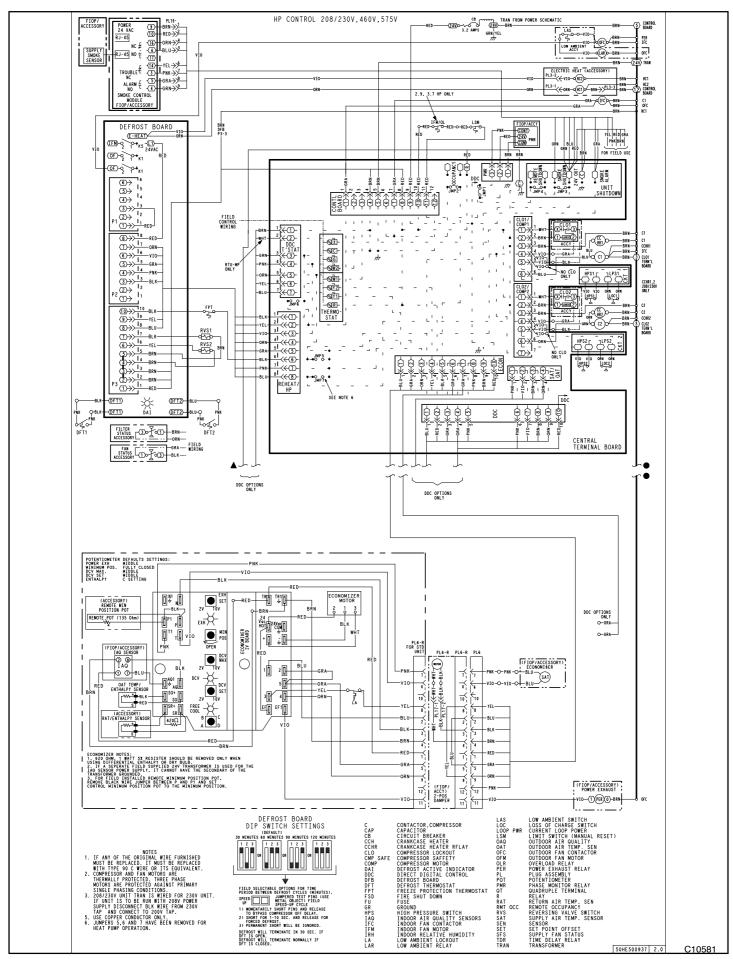


Fig. 5 Typical Control Diagram (2 Stage Cooling)

## SEQUENCE OF OPERATION

#### Cooling, unit without economizer

When thermostat calls for cooling, terminals G and Y1 are energized. The indoor fan contactor (IFC), reversing valve solenoid (RVS) and compressor contactor are energized and indoor fan motor, compressor, and outdoor fan starts. The outdoor fan motor runs continuously while unit is cooling.

Two-stage models: If Stage 1 cooling does not satisfy the space load, the space temperature will rise until thermostat calls for Stage 2 cooling (Y2 closes). Defrost Board activates Stage 2 Compressor. Reversing valve 2 switches to Cooling position. Compressor 2 contactor is energized; Compressor 2 starts and Circuit 2 operates in Cooling mode.

When Cooling Stage 2 is satisfied, thermostat Y2 opens. Compressor 2 contactor is de-energized; Compressor 2 stops. Reversing Valve 2 remains energized.

When Cooling Stage 1 is satisfied, thermostat Y1 opens. Compressor 1 contactor is de-energized; Compressor 1 stops. Outdoor fan relay is de-energized; outdoor fans stop. After the Fan Delay period, the Indoor fan contactor is de-energized; indoor fan stops (unless Continuous Fan operation has been selected). Reversing Valve 1 remains energized.

Reversing valve solenoids are energized in Cooling modes. Each solenoid will remain energized until the next Heating mode is initiated for this circuit.

## Heating, unit without economizer

Upon a request for heating from the space thermostat, terminal W1 will be energized with 24V. The IFC, outdoor fan contactor (OFC), C1, and C2 will be energized. The indoor fan, outdoor fans, and compressor no. 1, and compressor no. 2 are energized and reversing valves are de-energized and switch position.

If the space temperature continues to fall while W1 is energized, W2 will be energized with 24V, and the heater contactor(s) (HC) will be energized, which will energize the electric heater(s).

When the space thermostat is satisfied, W2 will be de-energized first, and the electric heater(s) will be de-energized.

Upon a further rise in space temperature, W1 will be de-energized.

Two compressor models: When the thermostat calls for heating, terminal W1 is energized. Defrost Board de-energizes both reversing valve solenoids and reversing valves move to Heating position. The indoor fan contactor is energized; indoor fan motor starts. Outdoor fan relay is energized; both outdoor fan motors run. Compressor contactors C1 and C2 are energized; both refrigeration circuits operate in Heating mode.

If Stage 1 heating does not satisfy the space load, the space temperature will fall until thermostat calls for Stage 2 heating (W2 closes). Terminal W2 is energized. Defrost Board issues an output at EHEAT. Heater contactor 1 and heater contactor 2 (if installed) are energized; all electric heaters are energized.

When space heating load is partially satisfied, thermostat terminal W2 is de-energized; heater contactors are de-energized and all electric heat is terminated. Stage 1 heating continues.

When the space heating load is fully satisfied, thermostat terminal W1 is also de-energized.

Reversing valve solenoids remain de-energized until the next call for Cooling mode is initiated.

#### Cooling, unit with economizer

When free cooling is not available, the compressors will be controlled by the zone thermostat. When free cooling is available, the outdoor air damper is modulated by the EconoMi\$er IV control to provide a 50 to 55°F (10° to 13°C) mixed air temperature into the zone. As the mixed air temperature fluctuates above 55 or below 50°F (13° to 10°C), the dampers will be modulated (open or close) to bring the mixed air temperature back within control.

If mechanical cooling is utilized with free cooling, the outdoor air damper will maintain its current position at the time the compressor is started. If the increase in cooling capacity causes the mixed air temperature to drop below 45°F (7°C), then the outdoor air damper position will be decreased to the minimum position. If the mixed air temperature continues to fall, the outdoor air damper will close. Control returns to normal once the mixed air temperature rises above 48°F (9°C).

If optional power exhaust is installed, as the outdoor air damper opens and closes, the power exhaust fans will be energized and de-energized.

If field-installed accessory  $\mathrm{CO}_2$  sensors are connected to the EconoMi\$er IV control, a demand controlled ventilation strategy will begin to operate. As the  $\mathrm{CO}_2$  level in the zone increases above the  $\mathrm{CO}_2$  setpoint, the minimum position of the damper will be increased proportionally. As the  $\mathrm{CO}_2$  level decreases because of the increase in fresh air, the outdoor air damper will be proportionally closed.

For EconoMi\$er IV operation, there must be a thermostat call for the fan (G). If the unit is occupied and the fan is on, the damper will operate at minimum position. Otherwise, the damper will be closed.

When the EconoMi\$er IV control is in the occupied mode and a call for cooling exists (Y1 on the thermostat), the control will first check for indoor fan operation. If the fan is not on, then cooling will not be activated. If the fan is on, then the control will open the EconoMi\$er IV damper to the minimum position.

On the initial power to the EconoMi\$er IV control, it will take the damper up to  $2^1/_2$  minutes before it begins to position itself. Any change in damper position will take up to 30 seconds to initiate. Damper movement from full closed to full open (or vice versa) will take between  $1^1/_2$  and  $2^1/_2$  minutes.

If free cooling can be used as determined from the appropriate changeover command (switch, dry bulb, enthalpy curve, differential dry bulb, or differential enthalpy), then the control will modulate the dampers open to maintain the mixed air temperature setpoint at 50° to 55°F (10° to 13°C).

If there is a further demand for cooling (cooling second stage — Y2 is energized), then the control will bring on compressor stage 1 to maintain the mixed air temperature setpoint. The EconoMi\$er IV damper will be open at maximum position. EconoMi\$er IV operation is limited to a single compressor.

## Heating, unit with economizer

When the room temperature calls for heat through terminal W1, the indoor (evaporator) fan contactor (IFC) and heater contactor no. 1 (HC1) are energized and the reversing valve(s) de-energize and switches position. On units equipped for 2 stages of heat, when additional heat is needed, heater contactor no. 2 is energized through W2. The economizer damper moves to the minimum position. When the thermostat is satisfied, the damper moves to the fully closed position.

## **SEQUENCE OF OPERATION (CONT.)**

#### Defrost

When the temperature of the outdoor coil drops below  $28^{\circ}F$  ( $-2^{\circ}C$ ) as sensed by the defrost thermostat (DFT2) and the defrost timer is at the end of a timed period (adjustable at 30, 60, 90 or 120 minutes), reversing valve solenoids (RVS1 and RVS2) are energized and the OFC is de–energized. This switches the position of the reversing valves and shuts off the outdoor fan. The electric heaters (if installed) will be energized.

The unit continues to defrost until the coil temperature as measured by DFT2 reaches 65°F (18°C), or the duration of defrost cycle completes a 10-minute period.

During the Defrost mode, if circuit 1 defrosts first, RVS1 will oscillate between Heating and Cooling modes until the Defrost mode is complete.

At the end of the defrost cycle, the electric heaters (if installed) will be de-energized; the reversing valves switch and the outdoor fan motor will be energized. The unit will now operate in the Heating mode.

If the space thermostat is satisfied during a defrost cycle, the unit will continue in the Defrost mode until the time or temperature constraints are satisfied.

#### Automatic changeover

When the system selection switch is set at AUTO. position, unit automatically changes from heating operation to cooling operation when the temperature of the conditioned space rises to the cooling level setting. When the temperature of the conditioned space falls to the heating level setting, unit automatically changes from cooling to heating operation (with a 3°F deadband in between).

#### Continuous air circulation

Turn unit power on. Set system control at OFF position. Set fan switch at ON position. The indoor fan contactor is energized through the thermostat switch and the indoor fan runs continuously.

## **Emergency heat**

When the switch is on (thermostat is set to the EM HT position), compressor circuit and outdoor thermostats are bypassed, and the second stage of thermostat energizes the indoor blower and the electric resistance heaters.

## **GUIDE SPECIFICATIONS - RHS181 - 243**

## **HEAT PUMP / ELECTRIC HEAT PACKAGED ROOFTOP**

**HVAC Guide Specifications** 

Size Range: 15 to 20 Nominal Tons



## Section Description

## 23 06 80 Schedules for Decentralized HVAC Equipment

23 06 80.13 Decentralized Unitary HVAC Equipment Schedule

23 06 80.13.A. Rooftop unit schedule

1. Schedule is per the project specification requirements.

#### 23 07 16 HVAC Equipment Insulation

23 07 16.13 Decentralized, Rooftop Units:

23 07 16.13.A. Evaporator fan compartment:

- 1. Interior cabinet surfaces shall be insulated with a minimum 1/2-in. thick, minimum 1 1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, neoprene coated on the air side.
- 2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
- 23 07 16.13.B. Electric heat compartment:
  - 1. Aluminum foil-faced fiberglass insulation shall be used.
  - 2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

## 23 09 13 Instrumentation and Control Devices for HVAC

23 09 13.23 Sensors and Transmitters

23 09 13.23.A. Thermostats

- 1. Thermostat must
  - a. energize both "W" and "G" when calling for heat.
  - b. have capability to energize 2 different stages of cooling, and 2 different stages of heating.
  - c. include capability for occupancy scheduling.

## 23 09 23 Direct-digital Control system for HVAC

23 09 23.13

23 09 23.13.A

## 23 09 33 Electric and Electronic Control System for HVAC

23 09 33.13 Decentralized, Rooftop Units:

23 09 33.13.A. General:

- 1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side. Transformer shall have 75VA capability.
- Shall utilize color-coded wiring.
- 3. Shall include a central control terminal board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, DDC control options, and low and high pressure switches.
- 4. Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.
- 5. Shall include integrated defrost system to prevent excessive frost accumulation during heating duty, and shall be controlled as follows:
  - Defrost shall be initiated on the basis of time and coil temperature.
  - A 30,60,90,120 minute timer shall activate the defrost cycle only if the coil temperature is low enough to indicate a heavy frost condition.
  - c. Defrost cycle shall terminate when defrost thermostat is satisfied and shall have a positive termination time of 10 minutes.
- 6. Defrost system shall also include:
  - a. Defrost Cycle Indicator LED.
  - b. Dip switch selectable defrost time between 30, 60, 90 and 120 minutes. Factory set at 30 minutes.
  - c. Molded plug connection to insure proper connection.

### 23 09 33.23.B. Safeties:

Compressor over-temperature, over current.

- 2. Loss of charge switch.
  - a. Units with 2 compressors shall have different sized connectors for the circuit 1 and circuit 2 loss of charge switches. They shall physically prevent the cross-wiring of the safety switches between circuits 1 and 2.
  - b. Loss of charge switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
- 3. High pressure switch
  - a. Units with 2 compressors shall have different sized connectors for the circuit 1 and circuit 2 high pressure switches. They shall physically prevent the cross-wiring of the safety switches between circuits 1 and 2.
  - b. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
- 4. Freeze protection thermostat, evaporator coil.
- 5. Automatic reset, motor thermal overload protector.

#### 23 09 93 Sequence of Operations for HVAC Controls

23 09 93.13 Decentralized, Rooftop Units:

23 09 93.13 INSERT SEQUENCE OF OPERATION

## 23 40 13 Panel Air Filters

23 40 13.13 Decentralized, Rooftop Units:

23 40 13.13.A. Standard filter section

- 1. Shall consist of factory-installed, low velocity, throwaway 2-in. thick fiberglass filters of commercially available sizes.
- 2. Unit shall use only one filter size. Multiple sizes are not acceptable.
- 3. Filters shall be accessible through a dedicated, weather tight panel.
- 4. 4-in. filter capabilities shall be capable with pre engineered and approved filter track field installed accessory. This kit requires field furnished filters.

#### 23 81 19 Self-Contained Air Conditioners

23 81 19.13 Medium-Capacity Self-Contained Air Conditioners (RHS181-243)

23 81 19.13.A. Genera

- 1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a(n) hermetic scroll compressor(s) for cooling duty and gas combustion for heating duty.
- 2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
- 3. Unit shall use environmentally safe, R-410A refrigerant.
- 4. Unit shall be installed in accordance with the manufacturer's instructions.
- 5. Unit must be selected and installed in compliance with local, state, and federal codes.

## 23 81 19.13.B. Quality Assurance

- 1. Unit meets ASHRAE 90.1–2007 minimum efficiency requirements.
- 2. Unit shall be rated in accordance with AHRI Standard 340/360.
- 3. Unit shall be designed to conform to ASHRAE 15.
- 4. Unit shall be ETL-tested and certified in accordance with ANSI Z21.47 Standards and ETL-listed and certified under Canadian standards as a total package for safety requirements.
- 5. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
- 6. Unit casing shall be capable of withstanding 500-hour salt spray exposure per ASTM B117 (scribed specimen).
- 7. Unit casing shall be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 5000-hour salt spray.
- 8. Unit shall be designed in accordance with ISO 9001:2000, and shall be manufactured in a facility registered by ISO 9001:2000.
- 9. Roof curb shall be designed to conform to NRCA Standards.
- 10. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
- 11. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
- 12. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.
- 13. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.
- 14. High Efficient Motors listed shall meet section 313 of the Energy Independence and Security Act of 2007 (EISA 2007).
- 23 81 19.13.C. Delivery, Storage, and Handling
  - 1. Unit shall be stored and handled per manufacturer's recommendations.
  - 2. Lifted by crane requires either shipping top panel or spreader bars.
  - 3. Unit shall only be stored or positioned in the upright position.
- 23 81 19.13.D. Project Conditions
  - 1. As specified in the contract.
- 23 81 19.13.E. Project Conditions
  - 1. As specified in the contract.

#### 23 81 19.13.F. Operating Characteristics

- 1. Unit shall be capable of starting and running at  $115^{\circ}F$  ( $46^{\circ}C$ ) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 340/360 at  $\pm$  10% voltage.
- 2. Compressor with standard controls shall be capable of operation from 30°F (-1°C), ambient outdoor temperatures. Accessory kits are necessary if mechanically cooling at ambient temperatures below 30°F (-1°C).
- 3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
- 4. Unit shall be factory configured and ordered for vertical supply & return configurations.
- 5. Unit shall be factory furnished for either vertical or horizontal configuration without the use of special conversion kits. No field kits conversion is possible.
- 6. Unit shall be capable of mixed operation: vertical supply with horizontal return or horizontal supply with vertical return.

## 23 81 19.13.G. Electrical Requirements

1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

#### 23 81 19.13.H. Unit Cabinet

- 1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a pre-painted baked enamel finish on all externally exposed surfaces.
- 2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 inches minimum, gloss (per ASTM D523, 60°F): 60, Hardness: H-2H Pencil hardness.
- 3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2-in. thick, 1 lb density, flexible fiberglass insulation, neoprene coated on the air side. Aluminum foil-faced fiberglass insulation shall be used in the heat compartment.
- 4. Base of unit shall have a minimum of four locations for factory thru-the-base electrical connections. Connections shall be internal to the cabinet to protect from environmental issues.

#### 5. Base Rail

- a. Unit shall have base rails on a minimum of 2 sides.
- b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
- c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
- d. Base rail shall be a minimum of 16 gauge thickness.
- 6. Condensate pan and connections:
  - a. Shall be a sloped condensate drain pan made of a non-corrosive material.
  - b. Shall comply with ASHRAE Standard 62.
  - c. Shall use a 3/4-in -14 NPT drain connection at the end of the drain pan. Connection shall be made per manufacturer's recommendations.

#### 7. Top panel:

a. Shall be a multi-piece top panel linked with water tight flanges and interlocking systems.

#### 8. Electrical Connections

- a. All unit power wiring shall enter unit cabinet at a single, factory-prepared, knockout location.
- b. Thru-the-base capability
  - (1.) Standard unit shall have a thru-the-base electrical location(s) using a raised, embossed portion of the unit basepan.
  - (2.) Optional, factory-approved, water-tight connection method must be used for thru-the-base electrical connections.
  - (3.) No basepan penetration, other than those authorized by the manufacturer, is permitted.
- 9. Component access panels (standard)
  - a. Cabinet panels shall be easily removable for servicing.
  - b. Unit shall have one factory installed, tool-less, removable, filter access panel.
  - c. Panels covering control box and filters shall have molded composite handles while the blower access door shall have an integrated flange for easy removal.
  - d. Handles shall be UV modified, composite. permanently attached, and recessed into the panel.
  - e. Screws on the vertical portion of all removable access panel shall engage into heat resistant, molded composite collars.
  - f. Collars shall be removable and easily replaceable using manufacturer recommended parts.

## 23 81 19.13.I. N/A

## 23 81 19.13.J. Coils

- 1. Standard Aluminum/Copper Coils: on all models.
  - a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
  - b. Evaporator coils shall be leak tested to 150 psig, pressure tested to 450 psig, and qualified to UL 1995 burst test at 1775 psig.
  - c. Condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to UL 1995 burst test at 1980 psig.
- 2. Optional Pre-coated aluminum fin condenser coils: on all models.
  - a. Shall have a durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments.

- b. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.
- c. Epoxy-phenolic barrier shall minimize galvanic action between dissimilar metals.
- 3. Optional Copper-fin evaporator and condenser coils: on all models.
  - a. Shall be constructed of copper fins mechanically bonded to copper tubes and copper tube sheets.
  - b. Galvanized steel tube sheets shall not be acceptable.
  - c. A polymer strip shall prevent coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan.
- 4. Optional E-coated aluminum-fin evaporator and condenser coils: on all models.
  - a. Shall have a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins.
  - b. Coating process shall ensure complete coil encapsulation of tubes, fins and headers.
  - c. Color shall be high gloss black with gloss per ASTM D523-89.
  - d. Uniform dry film thickness from 0.8 to 1.2 mil on all surface areas including fin edges.
  - e. Superior hardness characteristics of 2H per ASTM D3363-92A and cross-hatch adhesion of 4B-5B per ASTM D3359-93.
  - f. Impact resistance shall be up to 160 in.-lb (ASTM D2794-93).
  - g. Humidity and water immersion resistance shall be up to minimum 1000 and 250 hours respectively (ASTM D2247-92 and ASTM D870-92).
  - h. Corrosion durability shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117-90.

## 23 81 19.13.K. Refrigerant Components

- 1. Refrigerant circuit shall include the following control, safety, and maintenance features:
  - a. Fixed orifice metering system shall prevent mal-distribution of two-phase refrigerant by including multiple fixed orifice devices in each refrigeration circuit. Each orifice is to be optimized to the coil circuit it serves.
  - b. High capacity refrigerant filter drier on each refrigerant circuit.
  - c. Service gauge connections on suction and discharge lines.
  - d. Pressure gauge access through a specially designed screen on the side of the unit.
  - e. Precision-sized suction line accumulator on each refrigerant circuit shall protect from oil being removed from the scroll compressor rotating orbiter and plate during the activation of the defrost mode and switching back and forth from cooling and heating operations.

#### 2. Compressors

- a. Unit shall use one fully hermetic, scroll compressor for each independent refrigeration circuit.
- b. Models shall be available with 2 compressor/2 stage cooling.
- c. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
- d. Compressors shall be internally protected from high discharge temperature conditions.
- e. Compressors shall be protected from an over-temperature and over-amperage conditions by an internal, motor overload device.
- f. Compressor shall be factory mounted on rubber grommets.
- g. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
- h. Crankcase heaters shall be provided by the factory.
- i. 23 81 19.13.L. Filter Section
- 1. Filters access is specified in the unit cabinet section of this specification.
- 2. Filters shall be held in place by a preformed slide out filter tray, facilitating easy removal and installation.
- 3. Shall consist of factory-installed, low velocity, throw-away 2-in. thick fiberglass filters.
- 4. Filters shall be standard, commercially available sizes.
- 5. Only one size filter per unit is allowed.
- 6. 4-in filter capability is possible with a field installed pre engineered slide out filter track accessory. 4-in filters are field furnished.

## 23 81 19.13.M. Evaporator Fan and Motor

- 1. Evaporator fan motor:
  - a. Shall have inherent automatic-reset thermal overload protection or circuit breaker.
  - b. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating shall be required.
- 2. Belt-driven Evaporator Fan:
  - a. Belt drive shall include an adjustable-pitch motor pulley and belt break protection system.
  - b. Shall use rigid pillow block bearing system with lubricate fittings at are accessible or lubrication line.
  - c. Blower fan shall be double-inlet type with forward-curved blades.
  - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

## 23 81 19.13.N. Condenser Fans and Motors

1. Condenser fan motors:

- a. Shall be a totally enclosed motor.
- b. Shall use permanently lubricated bearings.
- c. Shall have inherent thermal overload protection with an automatic reset feature.
- d. Shall use a shaft-down design.

#### 2. Condenser Fans:

- a. Shall be a direct-driven propeller type fan.
- b. Shall have aluminum blades riveted to corrosion-resistant steel spiders and shall be dynamically balanced.

#### 23 81 19.13.O. Special Features, Options and Accessories

#### 1. Integrated Economizers:

- a. Integrated, gear-driven parallel modulating blade design type capable of simultaneous economizer and compressor operation.
- b. Independent modules for vertical or horizontal return configurations shall be available. Vertical and horizontal return modules shall be available as a factory installed option.
- c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
- d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
- e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
- f. Shall be equipped with low-leakage dampers, not to exceed 2% leakage at 1 in. wg pressure differential.
- g. Shall be capable of introducing up to 100% outdoor air.
- h. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air.
- i. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
- j. Dry bulb outdoor-air temperature sensor shall be provided as standard. Outdoor air sensor setpoint shall be adjustable and shall range from 40 to 100°F / 4 to 38°C. Additional sensor options shall be available as accessories.
- k. The economizer controller shall also provide control of an accessory power exhaust unit. function. Factory set at 100%, with a range of 0% to 100%.
- I. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy. A remote potentiometer may be used to override the damper setpoint.
- m. Dampers shall be completely closed when the unit is in the unoccupied mode.
- n. Economizer controller shall accept a 2–10Vdc CO<sub>2</sub> sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor–air damper to provide ventilation based on the sensor input.
- o. Compressor lockout sensor shall open at 35°F (2°C) and close closes at 50°F (10°C).
- p. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
- q. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.

#### 2. Two-Position Motorized Damper

- a. Damper shall be a Two-Position Damper. Damper travel shall be from the full closed position to the field adjustable %-open setpoint.
- b. Damper shall include adjustable damper travel from 25% to 100% (full open).
- c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
- d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.
- e. Damper will admit up to 100% outdoor air for applicable rooftop units.
- f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
- g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
- h. Outside air hood shall include aluminum water entrainment filter.

### 3. Manual damper

a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 25% outdoor air for year round ventilation.

### 4. Head Pressure Control Package

- a. Controller shall control coil head pressure by condenser-fan speed modulation or condenser-fan cycling and wind baffles.
- b. Shall consist of solid-state control and condenser-coil temperature sensor to maintain condensing temperature between 90°F (32°C) and 110°F (43°C) at outdoor ambient temperatures down to -20°F (-29°C).

## 5. Condenser Coil Hail Guard Assembly

- a. Shall protect against damage from hail.
- b. Shall be louvered style design.
- 6. Unit-Mounted, Non-Fused Disconnect Switch:
  - a. Switch shall be factory-installed, internally mounted.
  - b. National Electric Code (NEC) and UL approved non-fused switch shall provide unit power shutoff.
  - c. Shall be accessible from outside the unit.

- d. Shall provide local shutdown and lockout capability.
- 7. Convenience Outlet:
  - e. Non-Powered convenience outlet.
  - (1.) Outlet shall be powered from a separate 115/120v power source.
  - (2.) A transformer shall not be included.
  - (3.) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
  - (4.) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
  - (5.) Outlet shall be accessible from outside the unit.
  - (6.) Outlet shall include a field-installed "Wet in Use" cover.
- 8. N/A
- 9. Fan/Filter Status Switch:
  - a. Switch shall provide status of indoor evaporator fan (ON/OFF) or filter (CLEAN/DIRTY).
  - b. Status shall be displayed either over communication bus (when used with direct digital controls) or with an indicator light at the thermostat.
- 10. Centrifugal Power Exhaust:
  - a. Power exhaust shall be used in conjunction with an integrated economizer.
  - b. Independent modules for vertical or horizontal return configurations shall be available.
  - c. Horizontal power exhaust is shall be mounted in return ductwork.
  - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0-100% adjustable setpoint on the economizer control.
- 11. Roof Curbs (Vertical):
  - a. Full perimeter roof curb with exhaust capability providing separate air streams for energy recovery from the exhaust air without supply air contamination.
  - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
  - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
- 12. N/A
- 13. High-Static Indoor Fan Motor(s) and Drive(s):
  - a. High-static motor(s) and drive(s) shall be factory-installed to provide additional performance range.
- 14. N/A
- 15. Outdoor Air Enthalpy Sensor:
  - a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
- 16. Return Air Enthalpy Sensor:
  - a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
- 17. Indoor Air Quality (CO<sub>2</sub>) Sensor:
  - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
  - b. The IAQ sensor shall be available in duct mount, wall mount, or wall mount with LED display. The setpoint shall have adjustment capability.
- 18. Smoke detectors:
  - a. Shall be a Four-Wire Controller and Detector.
  - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
  - c. Shall use magnet-activated test/reset sensor switches.
  - d. Shall have tool-less connection terminal access.
  - e. Shall have a recessed momentary switch for testing and resetting the detector.
  - f. Controller shall include:
  - (1.) One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
  - (2.) Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
  - (3.) One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
  - (4.) Capable of direct connection to two individual detector modules.
  - (5.) Can be wired to up to 14 other duct smoke detectors for multiple fan shutdown applications.
- 19. Time Guard
  - a. Shall prevent compressor short cycling by providing a 5-minute delay (±2 minutes) before restarting a compressor after shutdown for any reason.
  - b. One device shall be required per compressor.
- 20. Barometric Hood (Horizontal Economizer Applications)

a. Shall be required when a horizontal economizer and barometric relief are required. Barometric relief damper must be installed in the return air (horizontal) duct work. This hood provides weather protection.

## 21. Electric Heat:

- a. Heating Section
- (1.) Heater element open coil resistance wire, nickel-chrome alloy, 0.29 inches inside diameter, strung through ceramic insulators mounted on metal frame. Coil ends are staked and welded to terminal screw slots.
- (2.) Heater assemblies are provided with integral fusing for protection of internal heater circuits not exceeding 48 amps each. Auto reset thermo limit controls, magnetic heater contactors (24 v coil) and terminal block all mounted in electric heater control box (minimum 18 ga galvanized steel) attached to end of heater assembly.